


100 Hemlock Road,
Wakefield, MA 01880


PARTITION TYPE ABBREVIATIONS

ARGB	ABUSE RESISTANT GYPSUM BOARD
GBB	GLAZED BLOCK BASE
CMU	CONCRETE MASONRY UNIT
CT	CERAMIC TILE
FRP	FIBERGLASS REINFORCED PANELS
GWB	GYPSUM WALL BOARD
GYP	GYPSUM
GMF	LIGHT GAUGE METAL FRAMING
NA	NOT APPLICABLE
JL	UNDERWRITERS LABORATORIES
WD	HARDWOOD


GWB PARTITIONS: *GWB UNLESS NOTED OTHERWISE, STUD SPACING 16" O.C. MAX U.N.O

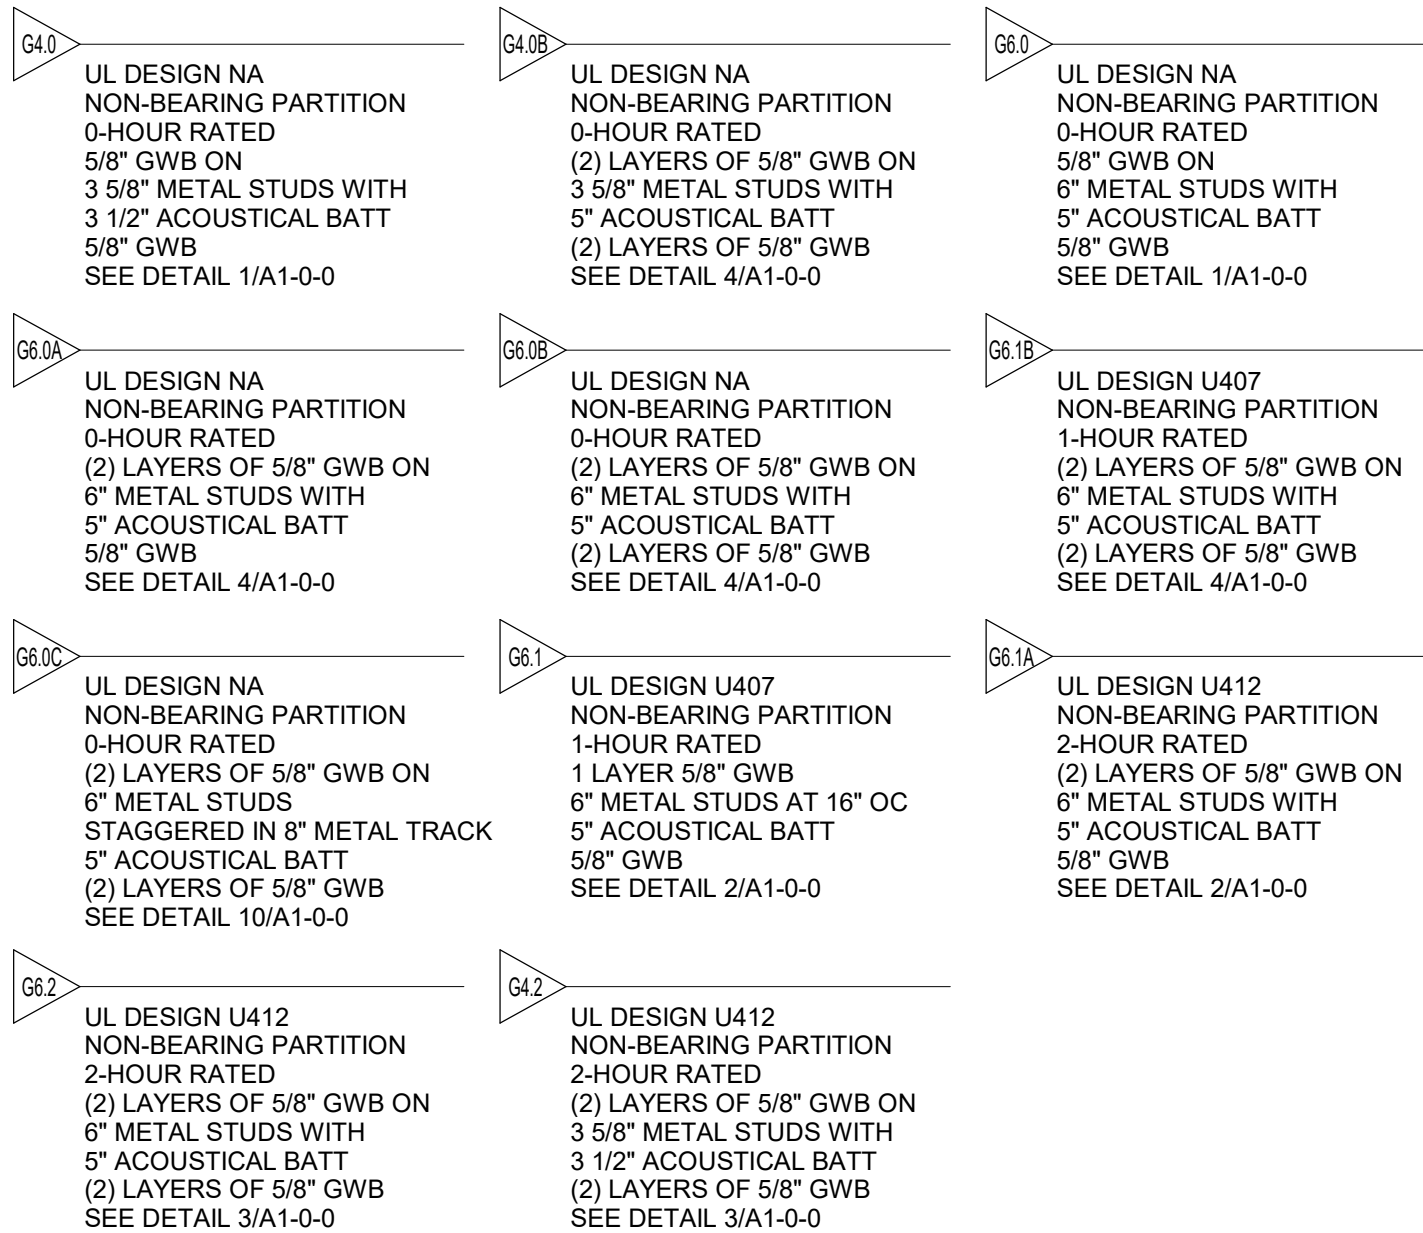


FURRING PARTITIONS: *GWB UNLESS NOTED OTHERWISE, STUD SPACING 16" O.C. MAX U.N.O

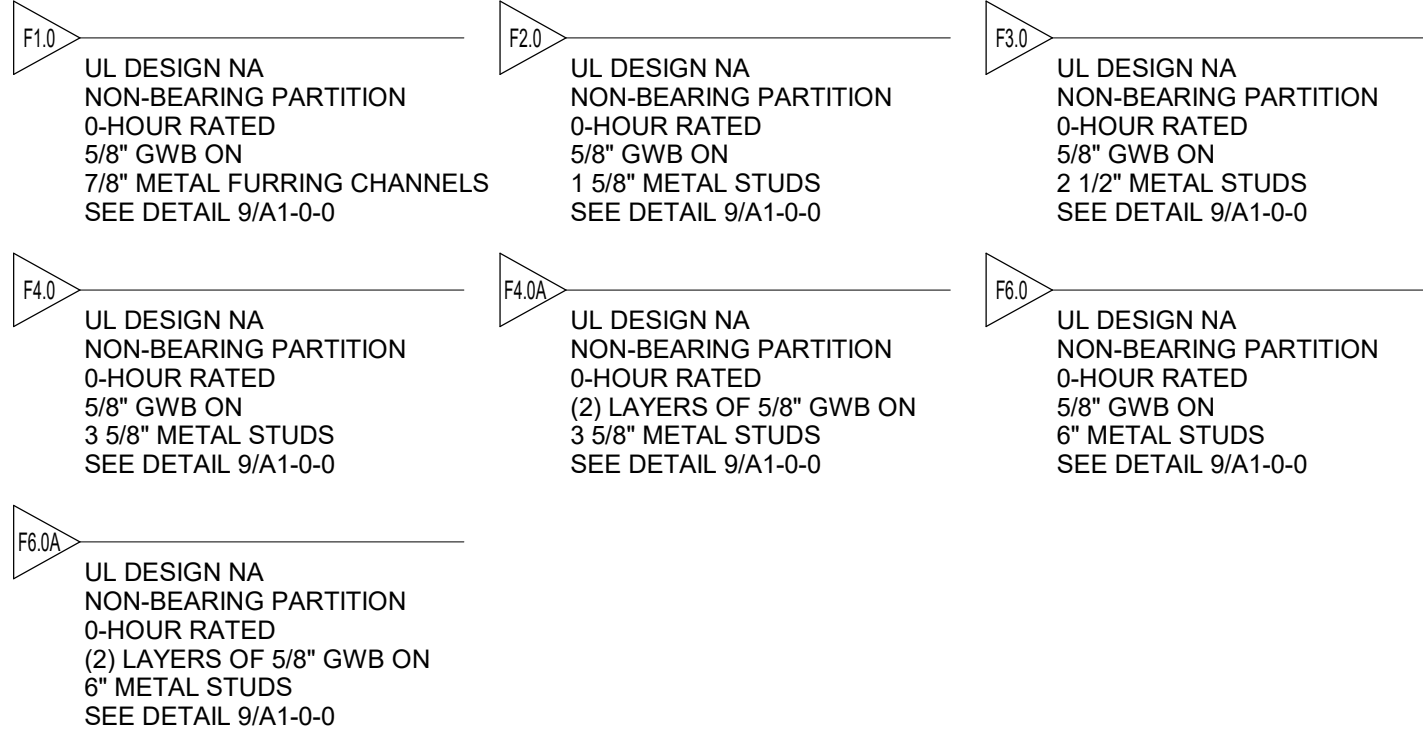

MASONRY PARTITIONS: *WHERE "LOW" IS INDICATED ON PARTITION TYPE TAGS SEE 12/A1-0-0

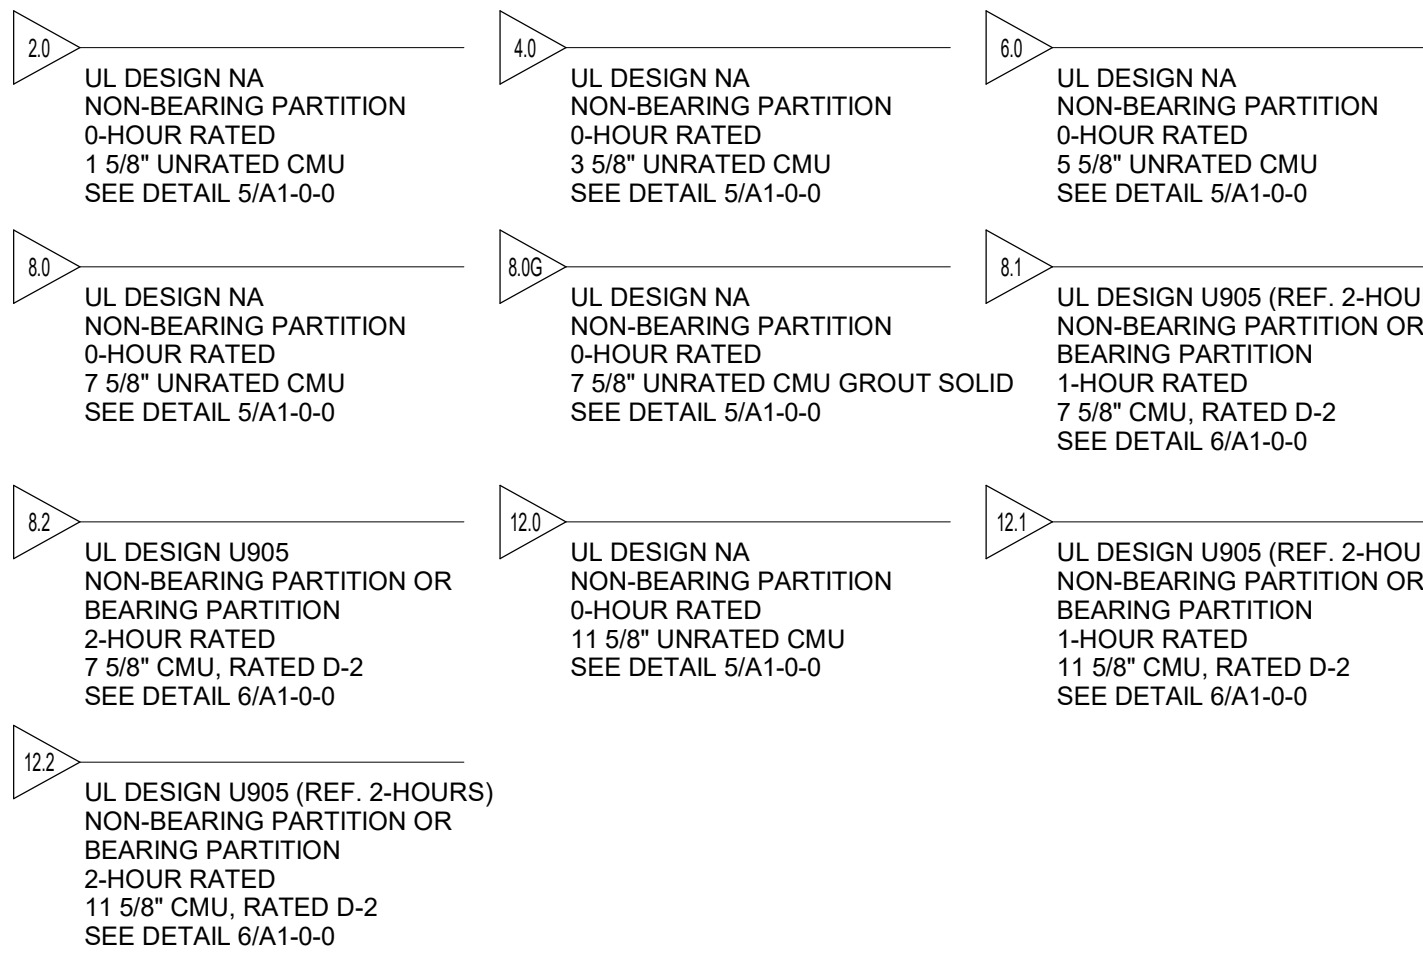

SHAFT WALL PARTITIONS:

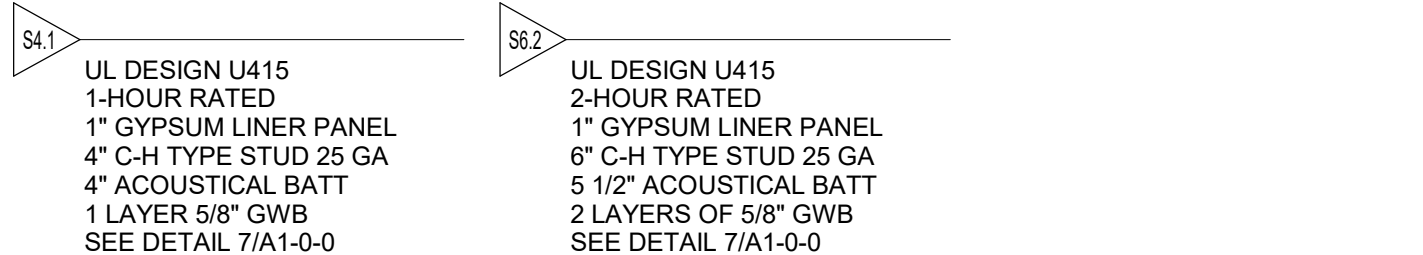

GENERAL NOTES – PARTITION TYPES

ALL PARTITIONS TO TYPE 6 OR UNLESS NOTED OTHERWISE OR WHERE FIRE RATING CONSTRUCTION IS INDICATED

PROVIDE CEMENTITIOUS TILE BACKER BOARD AT ALL TILED WALLS UNLESS NOTED OTHERWISE

PROVIDE RUBBER WALL BASE TRIM AT ALL PARTITIONS UNLESS NOTED OTHERWISE

STEELED, STUD, ANGLE REINSTRUMENT AND ASSOCIATED STEEL CHANNELS AT TOP OF ALL INTERIOR CURT PARTITION AND WALLS. ALL ANGLES AND CHANNELS ARE TO BE FURNISHED AND INSTALLED BY THE FABRICATOR/INSTALLER (SUB CONTRACTOR). SEE STRUCTURAL DRAWINGS FOR SIZE AND DETAILS.

RATED WALLS WITH "I" DESIGN NUMBER INCLUDES REQUIREMENTS INDICATED IN THE "I" DIRECTORY AND IN THE PARTITION MANUAL, WHICH MAY NOT BE REPRESENTED IN THE PARTITION TYPE DETAILS WHICH MAY SHOW ONLY PRINCIPAL COMPONENTS AND REQUIREMENTS

RATED PARTITIONS SHALL HAVE A HEAD DESIGN, SEALANT AND FILT MATERIAL, OF THE SAME RATING.

FINISHES APPLIED TO PARTITIONS ARE INDICATED IN THE ROOM FINISH SCHEDULES. INTERIOR ELEVATIONS, WALL FINISHES PLAN, AND ELSEWHERE.

TERMINATE RATED AND UNRATED GIVE PARTITIONS AT UNDERSIDE OF FLOOR DECKS AND ROOF DECKS.

ALL MATERIALS AND COMPONENTS SHOWN IN PARTITION DETAILS OR INDICATED IN SCHEDULES ARE CONTINUOUS UNLESS NOTED OTHERWISE.

ALL MATERIALS AND COMPONENTS SHOWN IN PARTITION DETAILS OR INDICATED IN SCHEDULES OR ON ALL SIDES OF PARTITIONS UNLESS INDICATED OTHERWISE.

SEE STRUCTURAL DRAWINGS FOR LOCATIONS OF BEARING PARTITIONS, SHEAR WALLS, AND OTHER MASONRY PARTITIONS. PROVIDE WALLS WITH REINFORCING AND OTHER SPECIAL REQUIREMENTS.

SEE STRUCTURAL DRAWINGS AND PROJECT MANUAL, FOR REINFORCING DETAILS AND REINFORCING REQUIREMENTS.

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE FRAMING MEMBERS AT 16" O.C. MAXIMUM.

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE FRAMING TRACKS OR REQUIREMENTS AND DETAILS.

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE DEFLECTION TRACK AT EXTERIOR WALLS, ROOF TERMINATIONS AND AS INDICATED ON PARTITION TYPE DETAILS.

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE REINFORCED FASTENERS

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE BRACING

ALL STEEL, STUD AND LOMF PARTITIONS PROVIDE ALL OTHER FRAMING ACCESSORIES AS SHOWN, AND AS REQUIRED.

COORDINATE STUD SPACING WITH MODULAR WALL FINISH MATERIAL FASTENING REQUIREMENTS.


OWN AND WALL FINISH TO BE OMITTED ON UNEXPOSED SIDE OF UNRATED GYPSUM WALLBOARD PARTITIONS USED FOR CHASES, DUCTWORK ENCLOSURES, ETC.

PROVIDE BLOCKING AND REINFORCING, COORDINATE BLOCKING REQUIREMENTS WITH ALL PARTITIONS TO FLOOR WALLS.

PROVIDE GIVE FIRE PROTECTION AT STRUCTURAL STEEL AS INDICATED IN THE ARCHITECTURAL DRAWINGS.




PROJECT NORTH

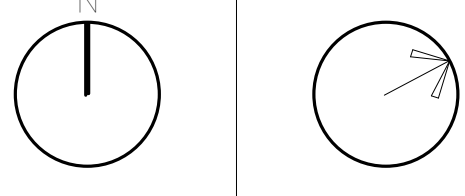


File No.:	As indicated
Page No.:	20202


Drawn By: DRA
Date: May 12TH, 2023
Page 3 of 4

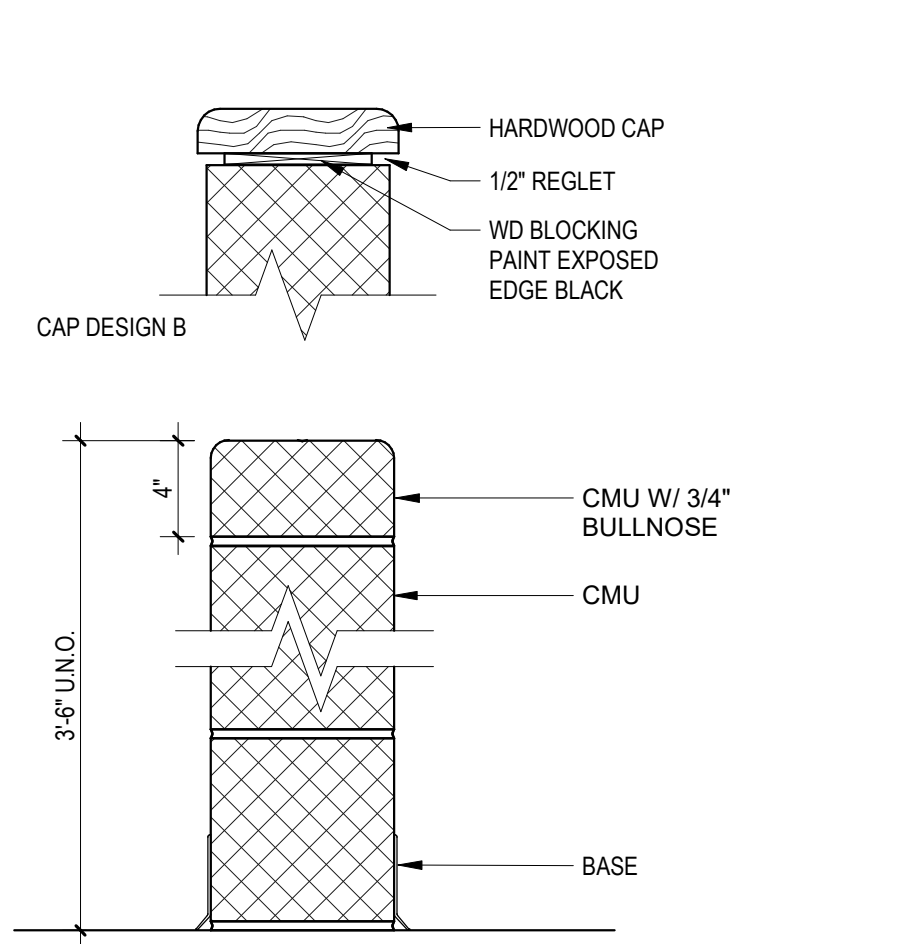


12 LOW WALL CMU PARTITION
1 1/2" = 1'-0"

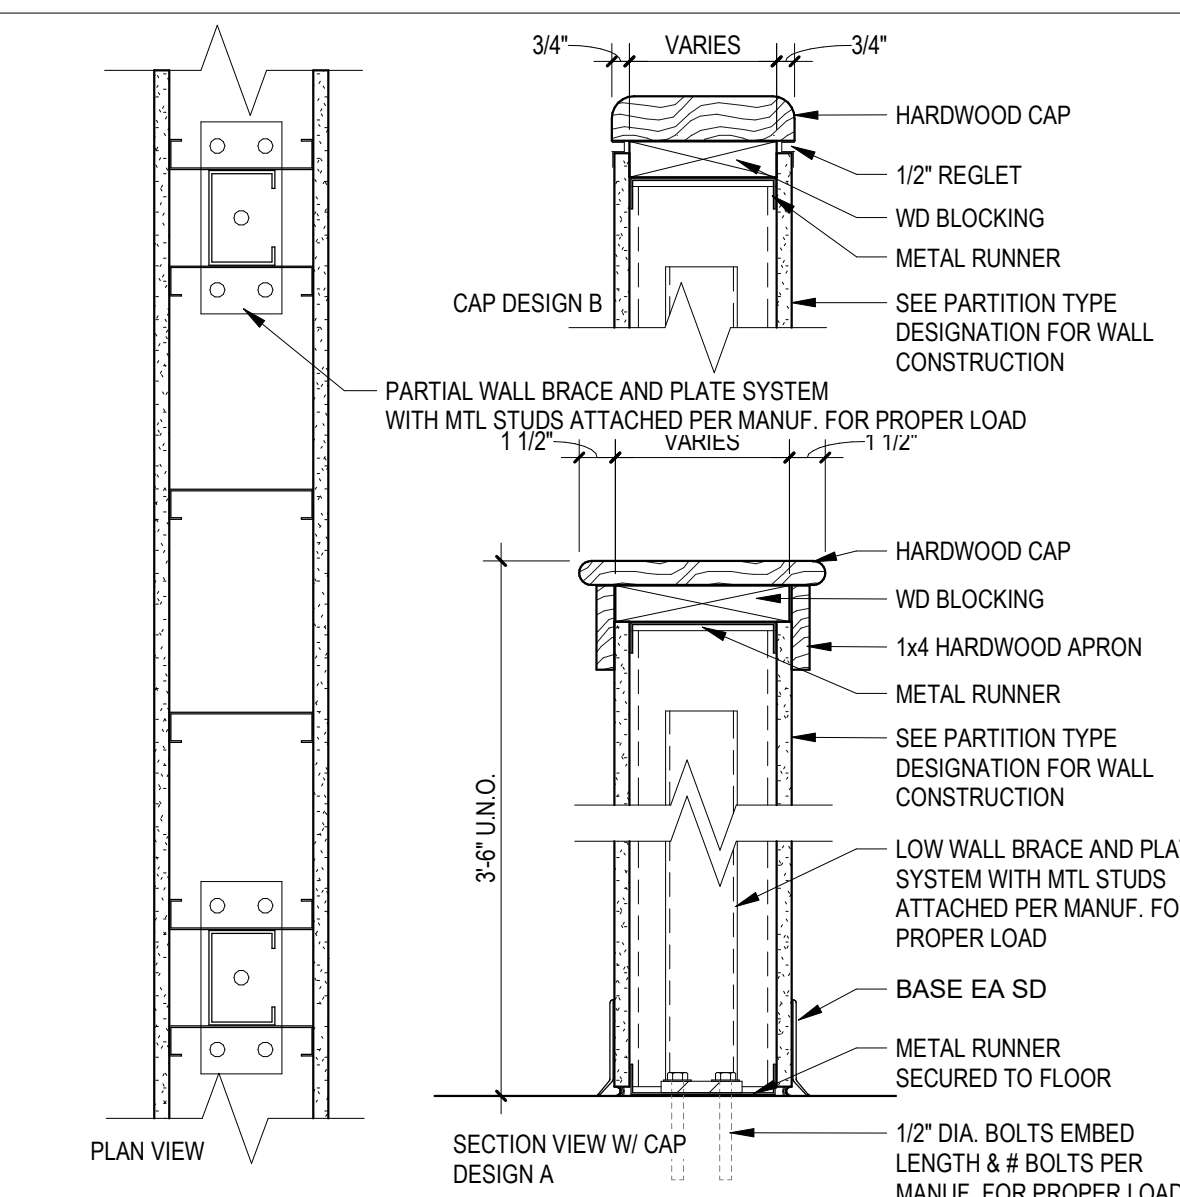


11 LOW WALL METAL STUD PARTITION
1 1/2" = 1'-0"

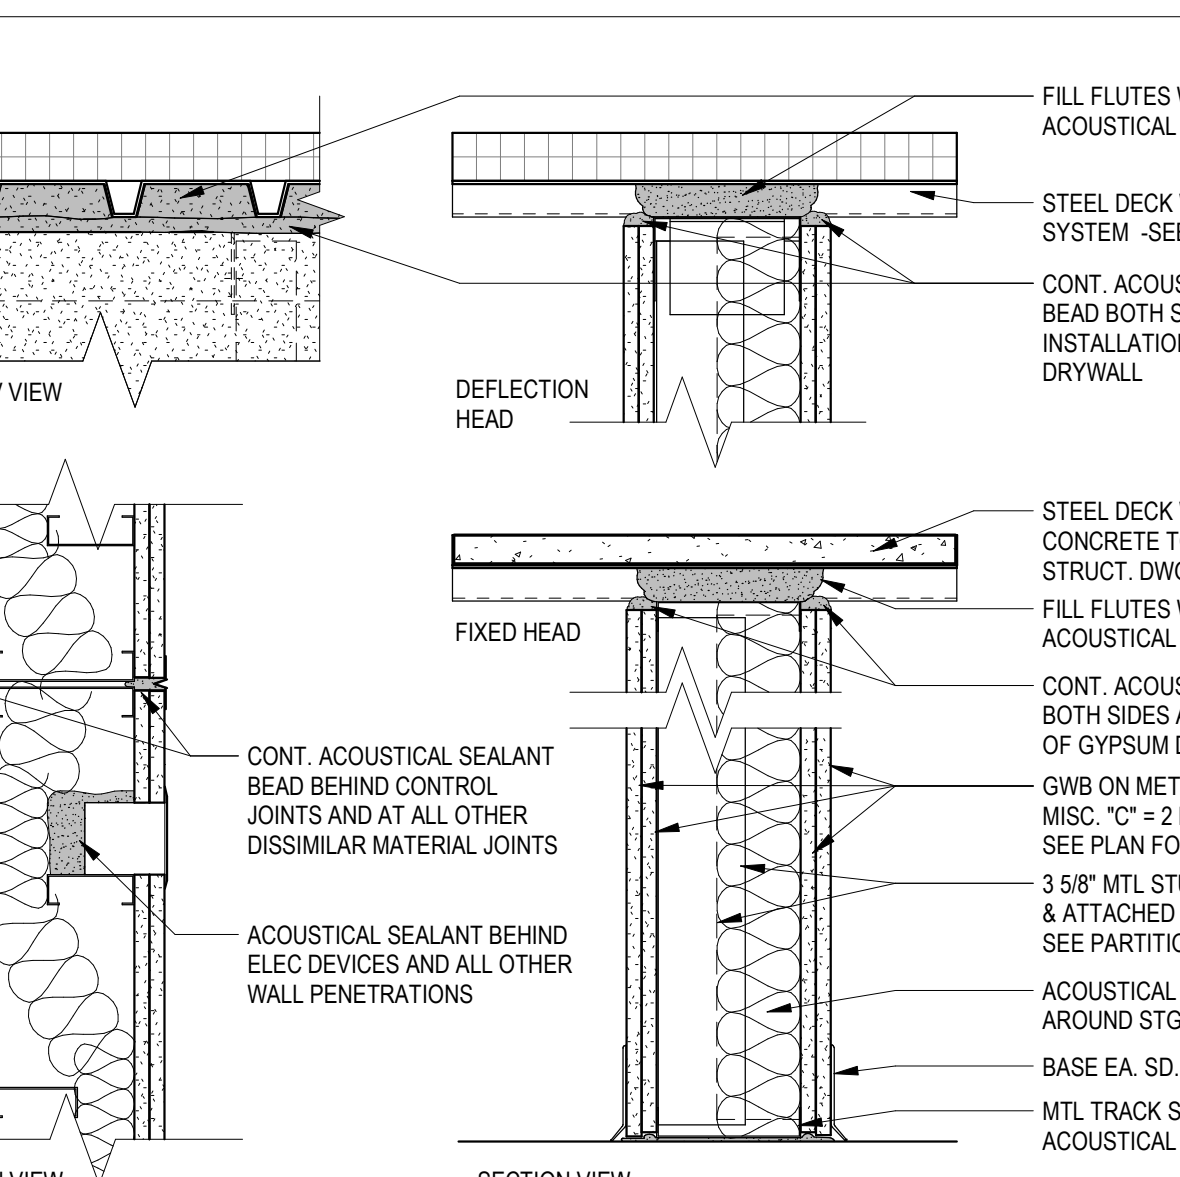


10 GWB - 0-HOUR
1' 1/2" = 1' 0"

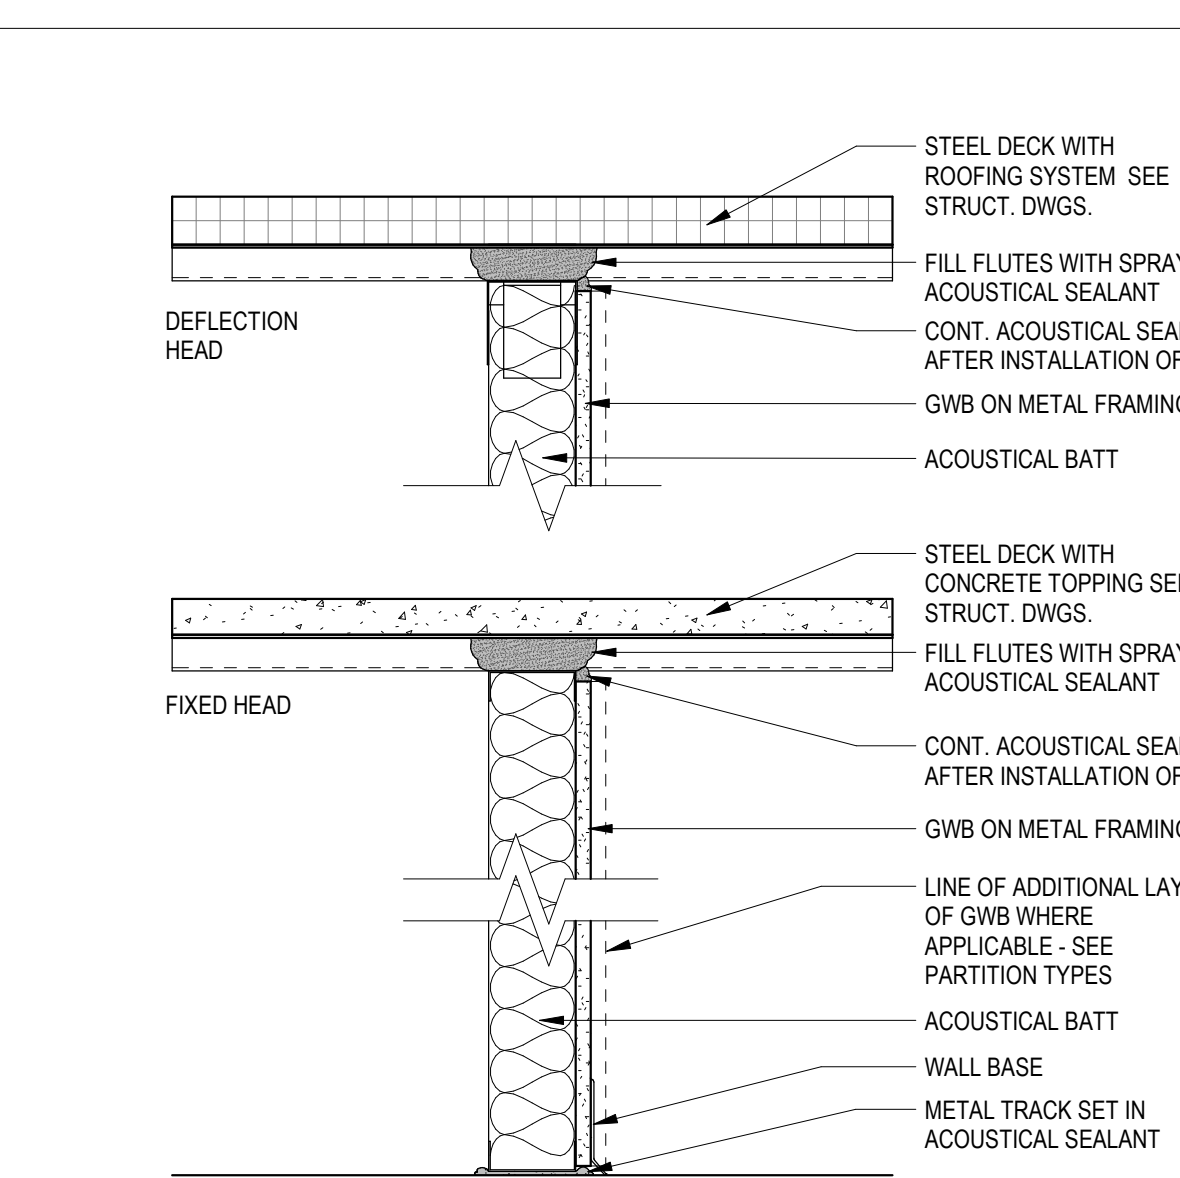


9 **GWB - 0-HOUR**

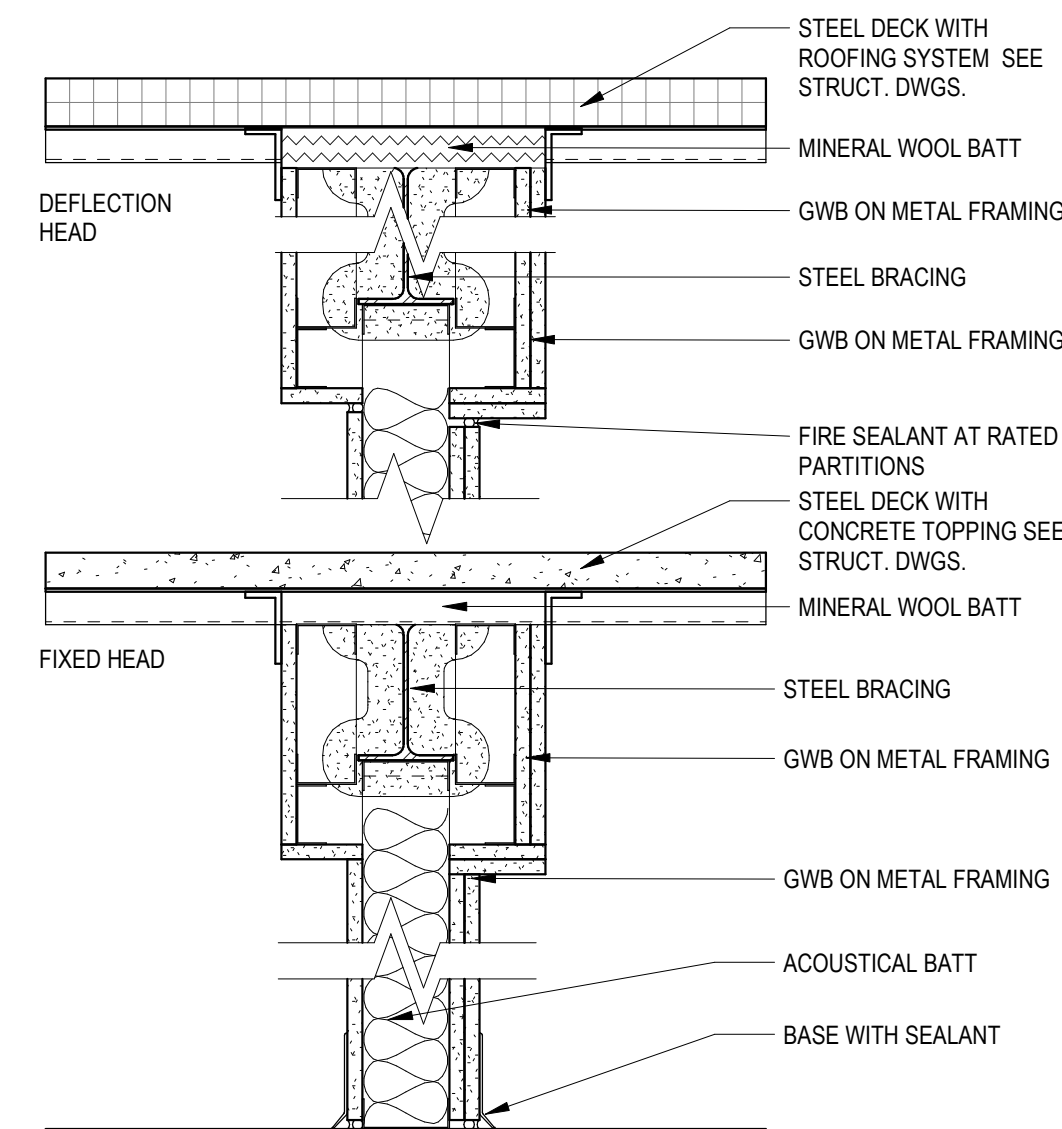


8) **GWB - 0,1 & 2-HOUR**
1 1/2" = 1'-0"

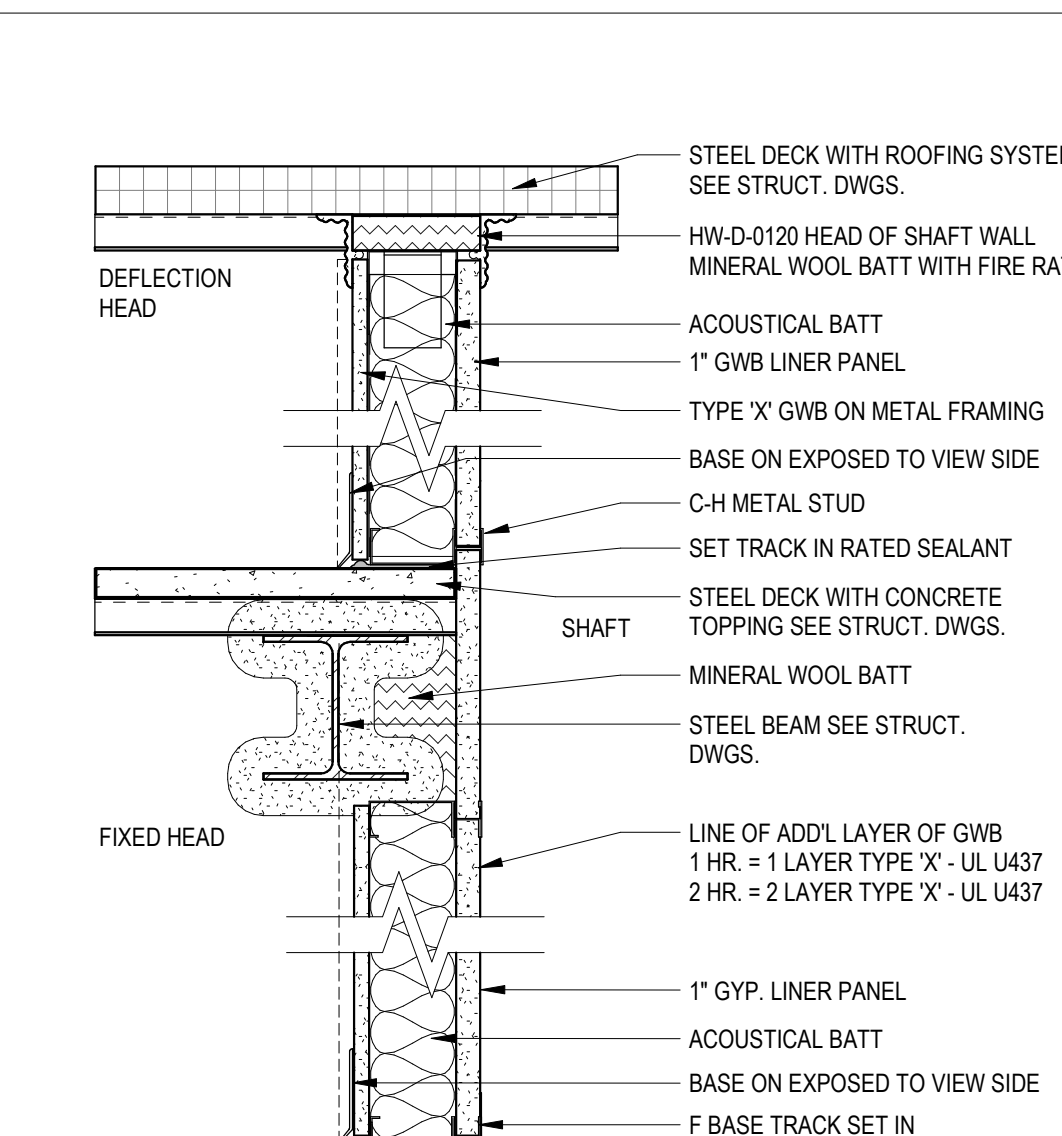


7 SHAFTWALL - 1,2&3 HR
1 1/2" $\equiv$ 1'-0"

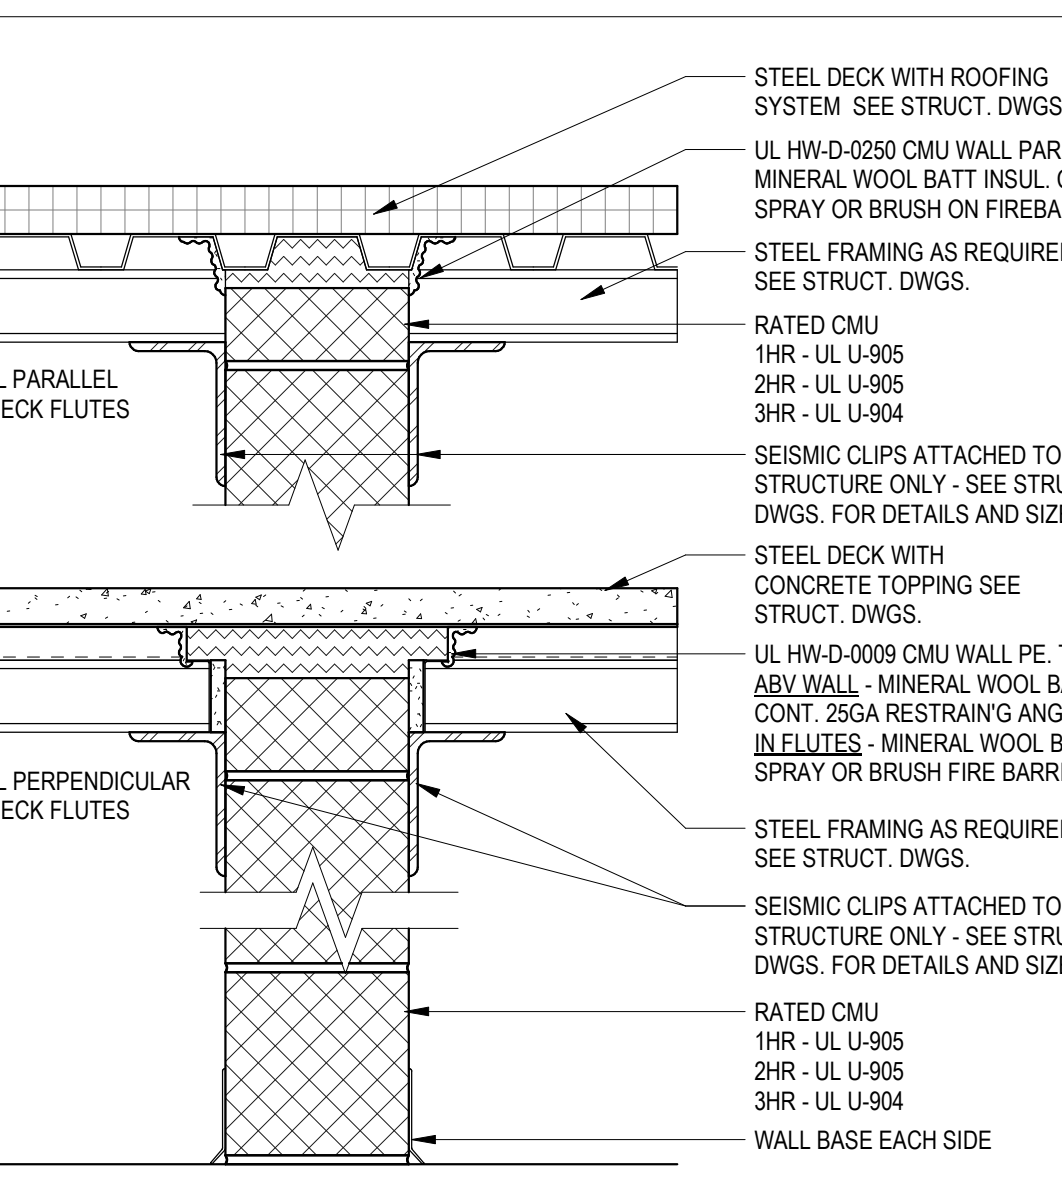


6 CMU - 1,2&3 HR
1 1/2" = 1' 0"

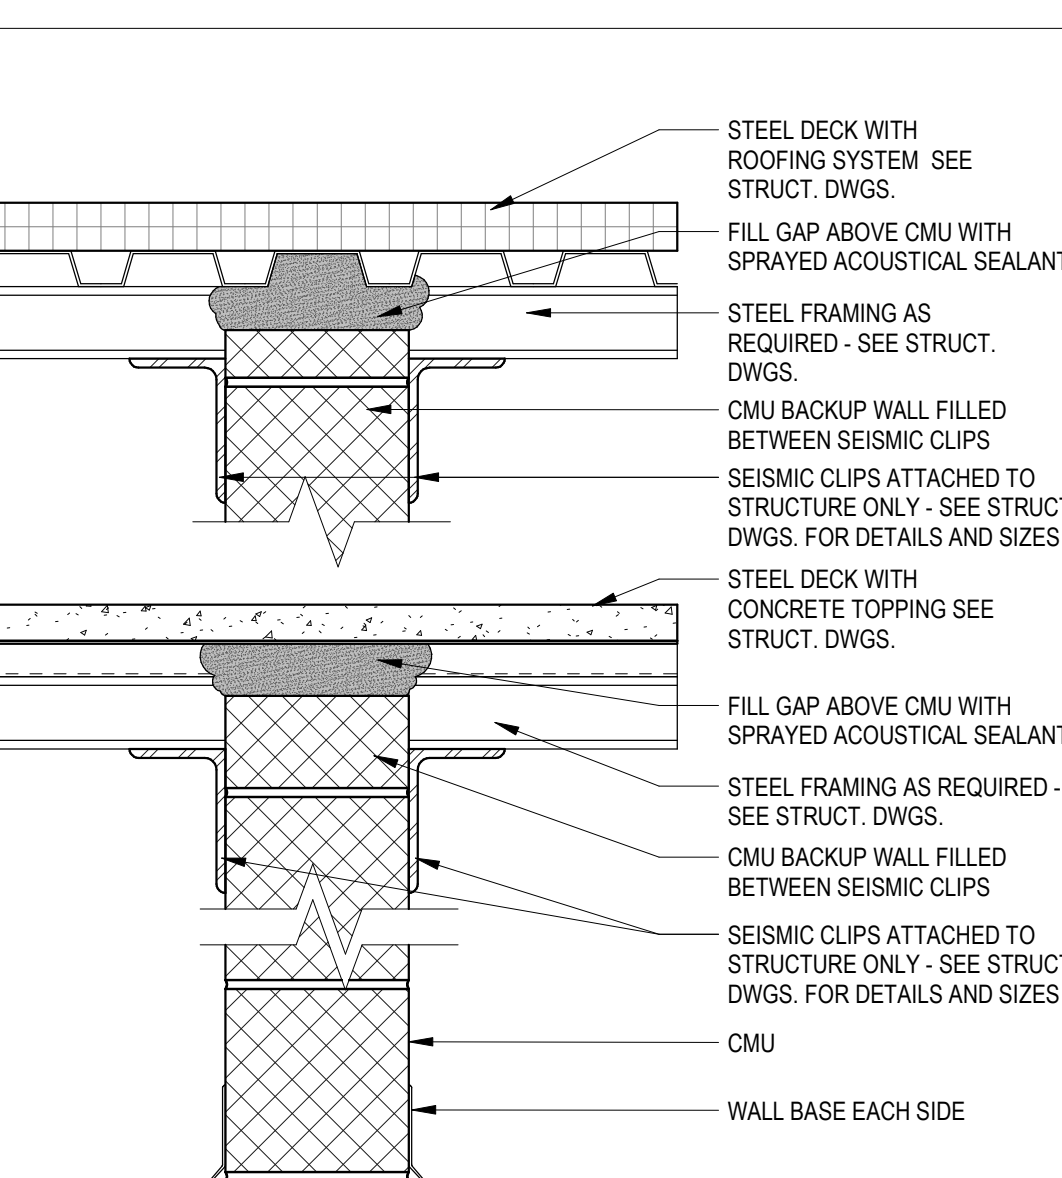


5 CMU - 0 HR

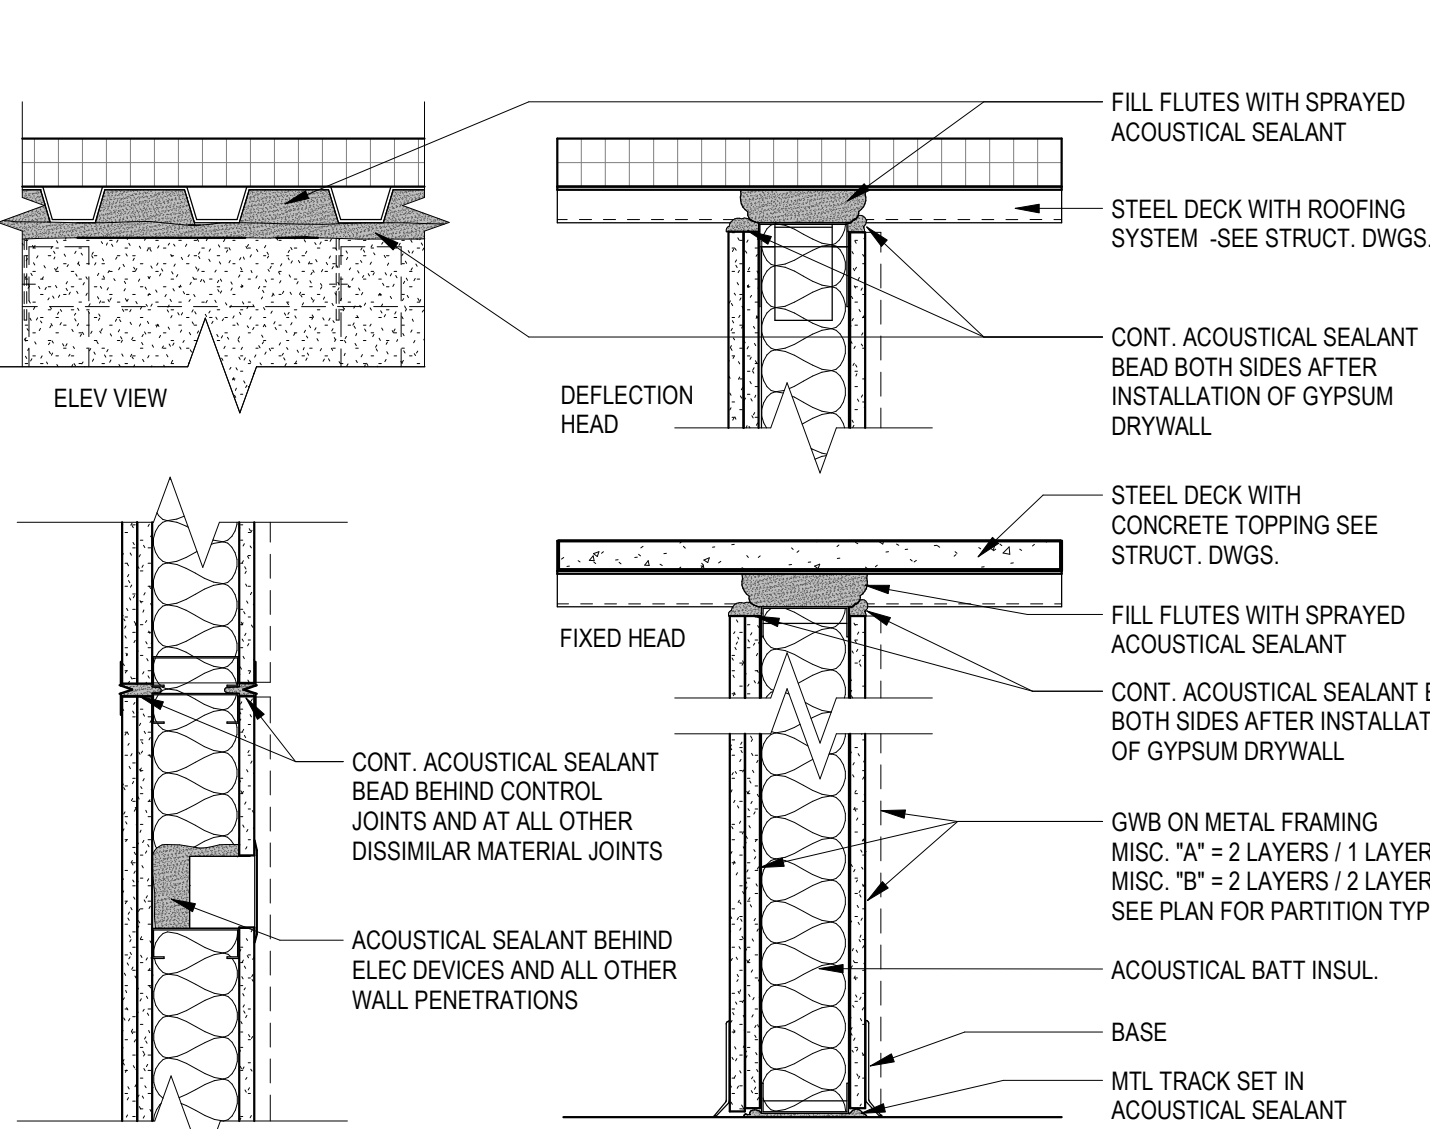


4) GWB - 0-HOUR
1 1/2" = 1'-0"

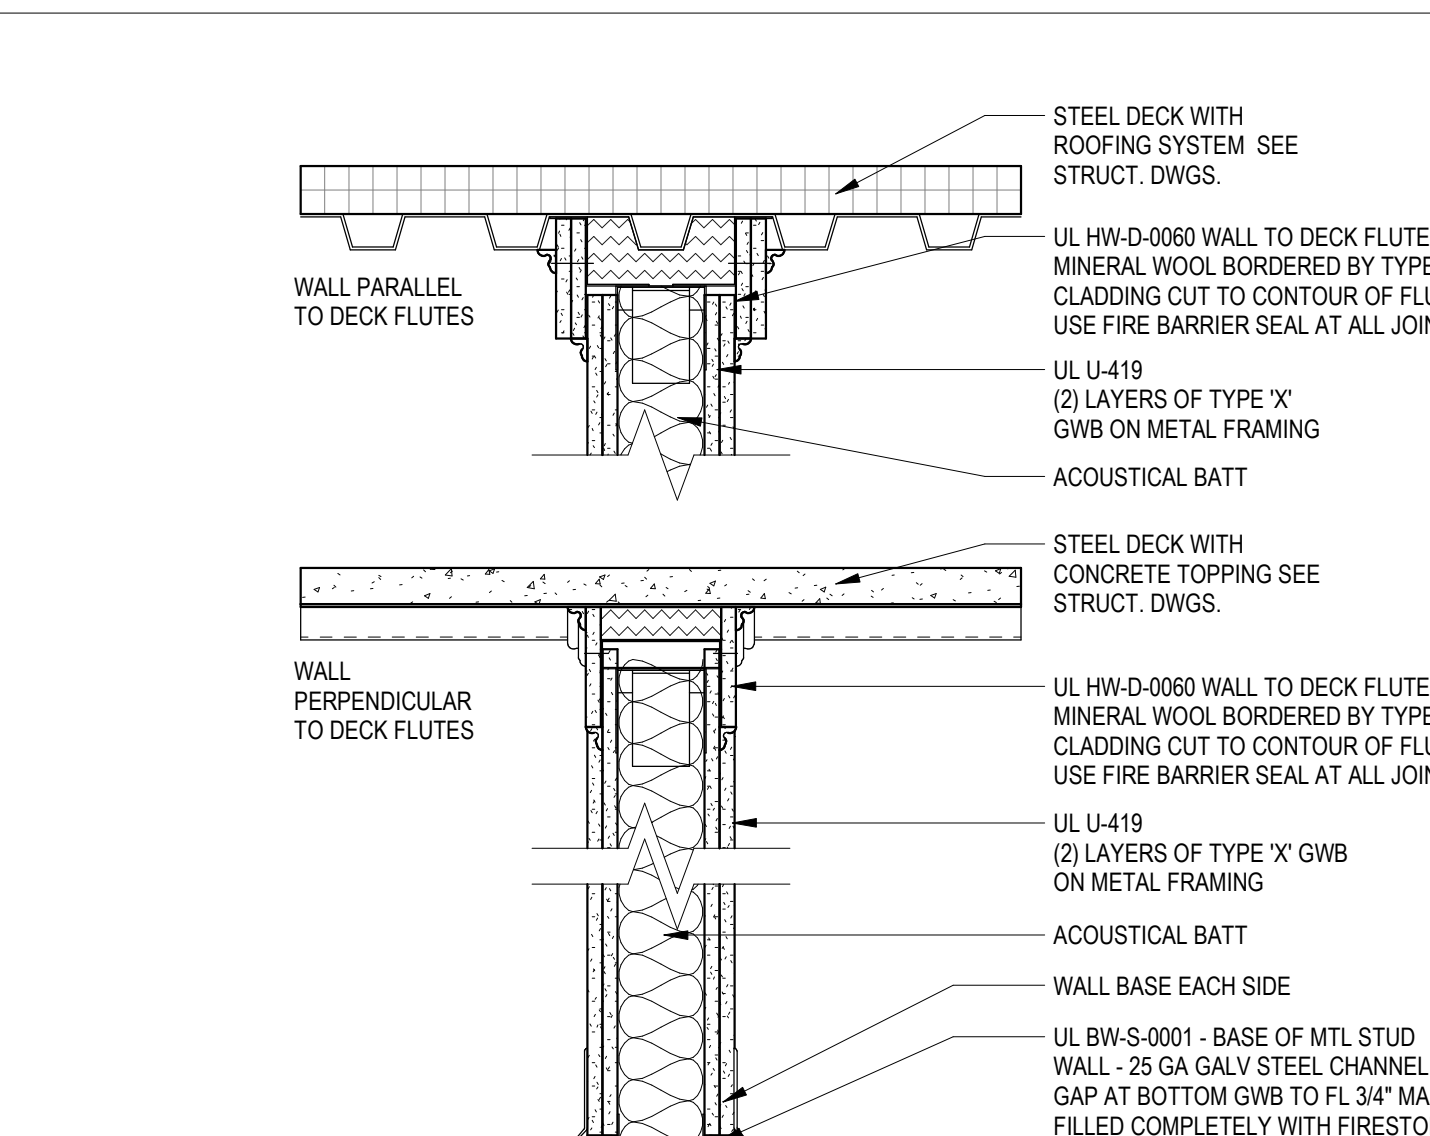


3) **GWB - 2-HOUR**
1 1/2" $\equiv$ 1'-0"

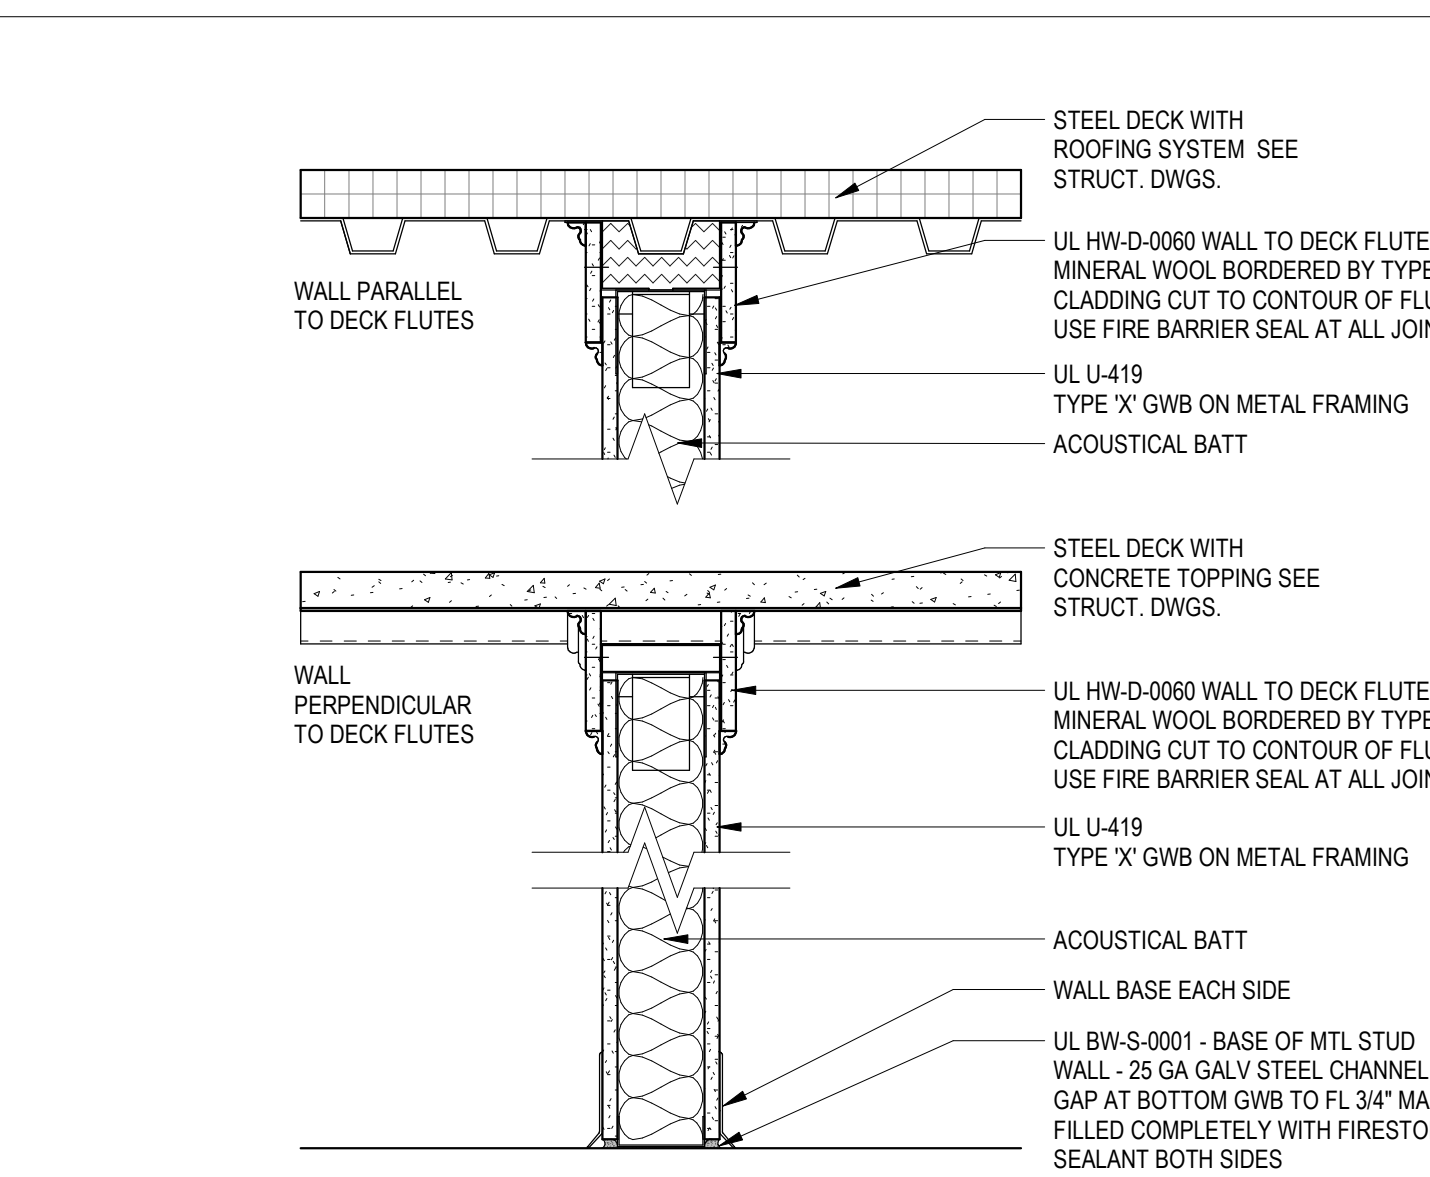

2 GWB - 1-HOUR
1 1/2" = 1' 0"

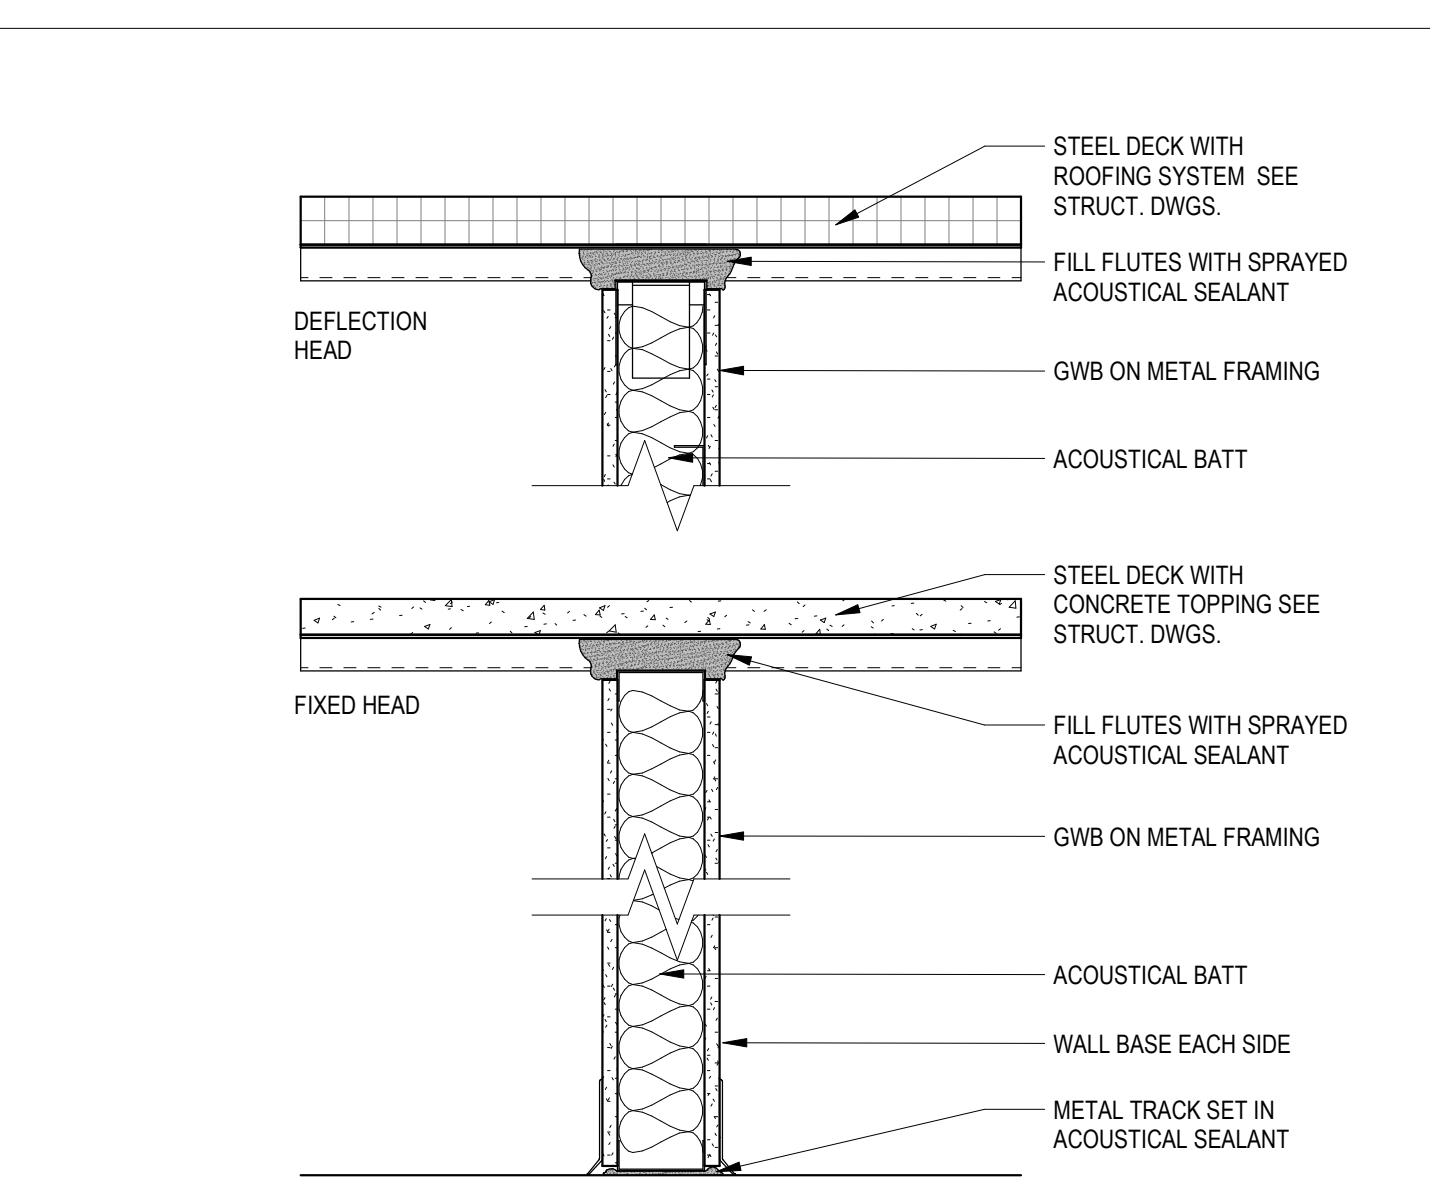

1 **GWB - 0-HOUR**




DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com


280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

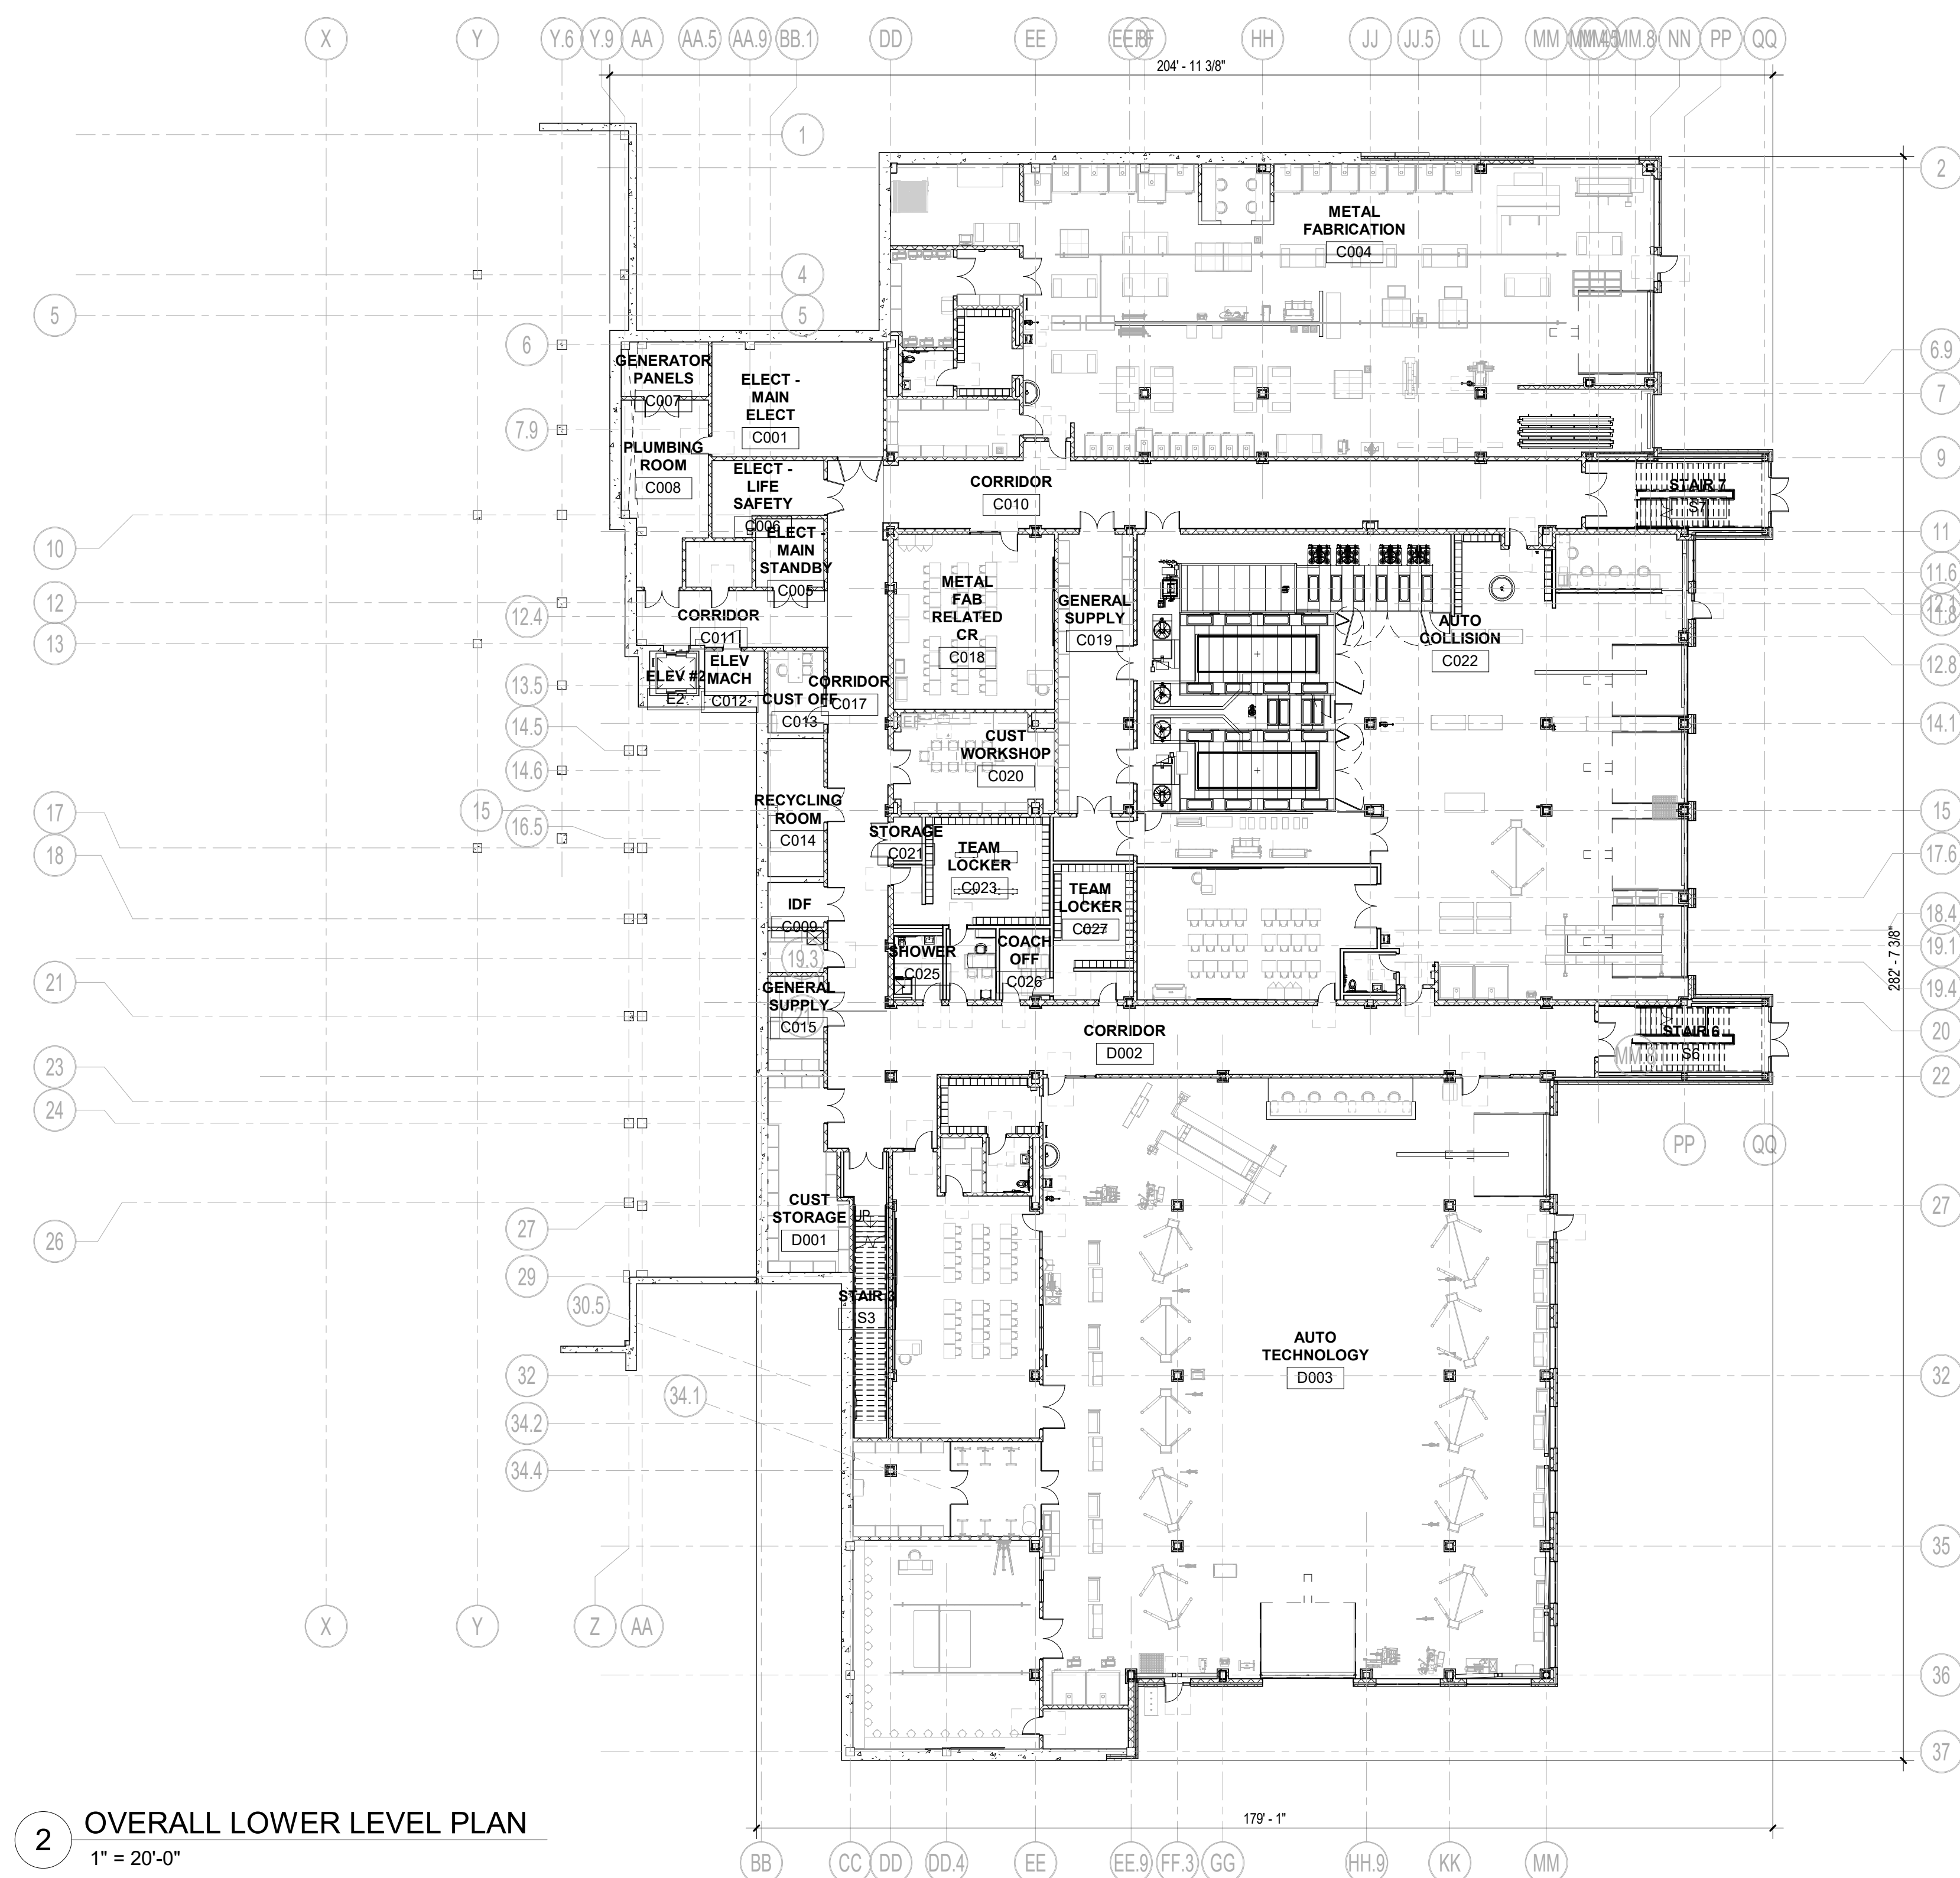


2 OVERALL LOWER LEVEL PLAN
1" = 20'-0"

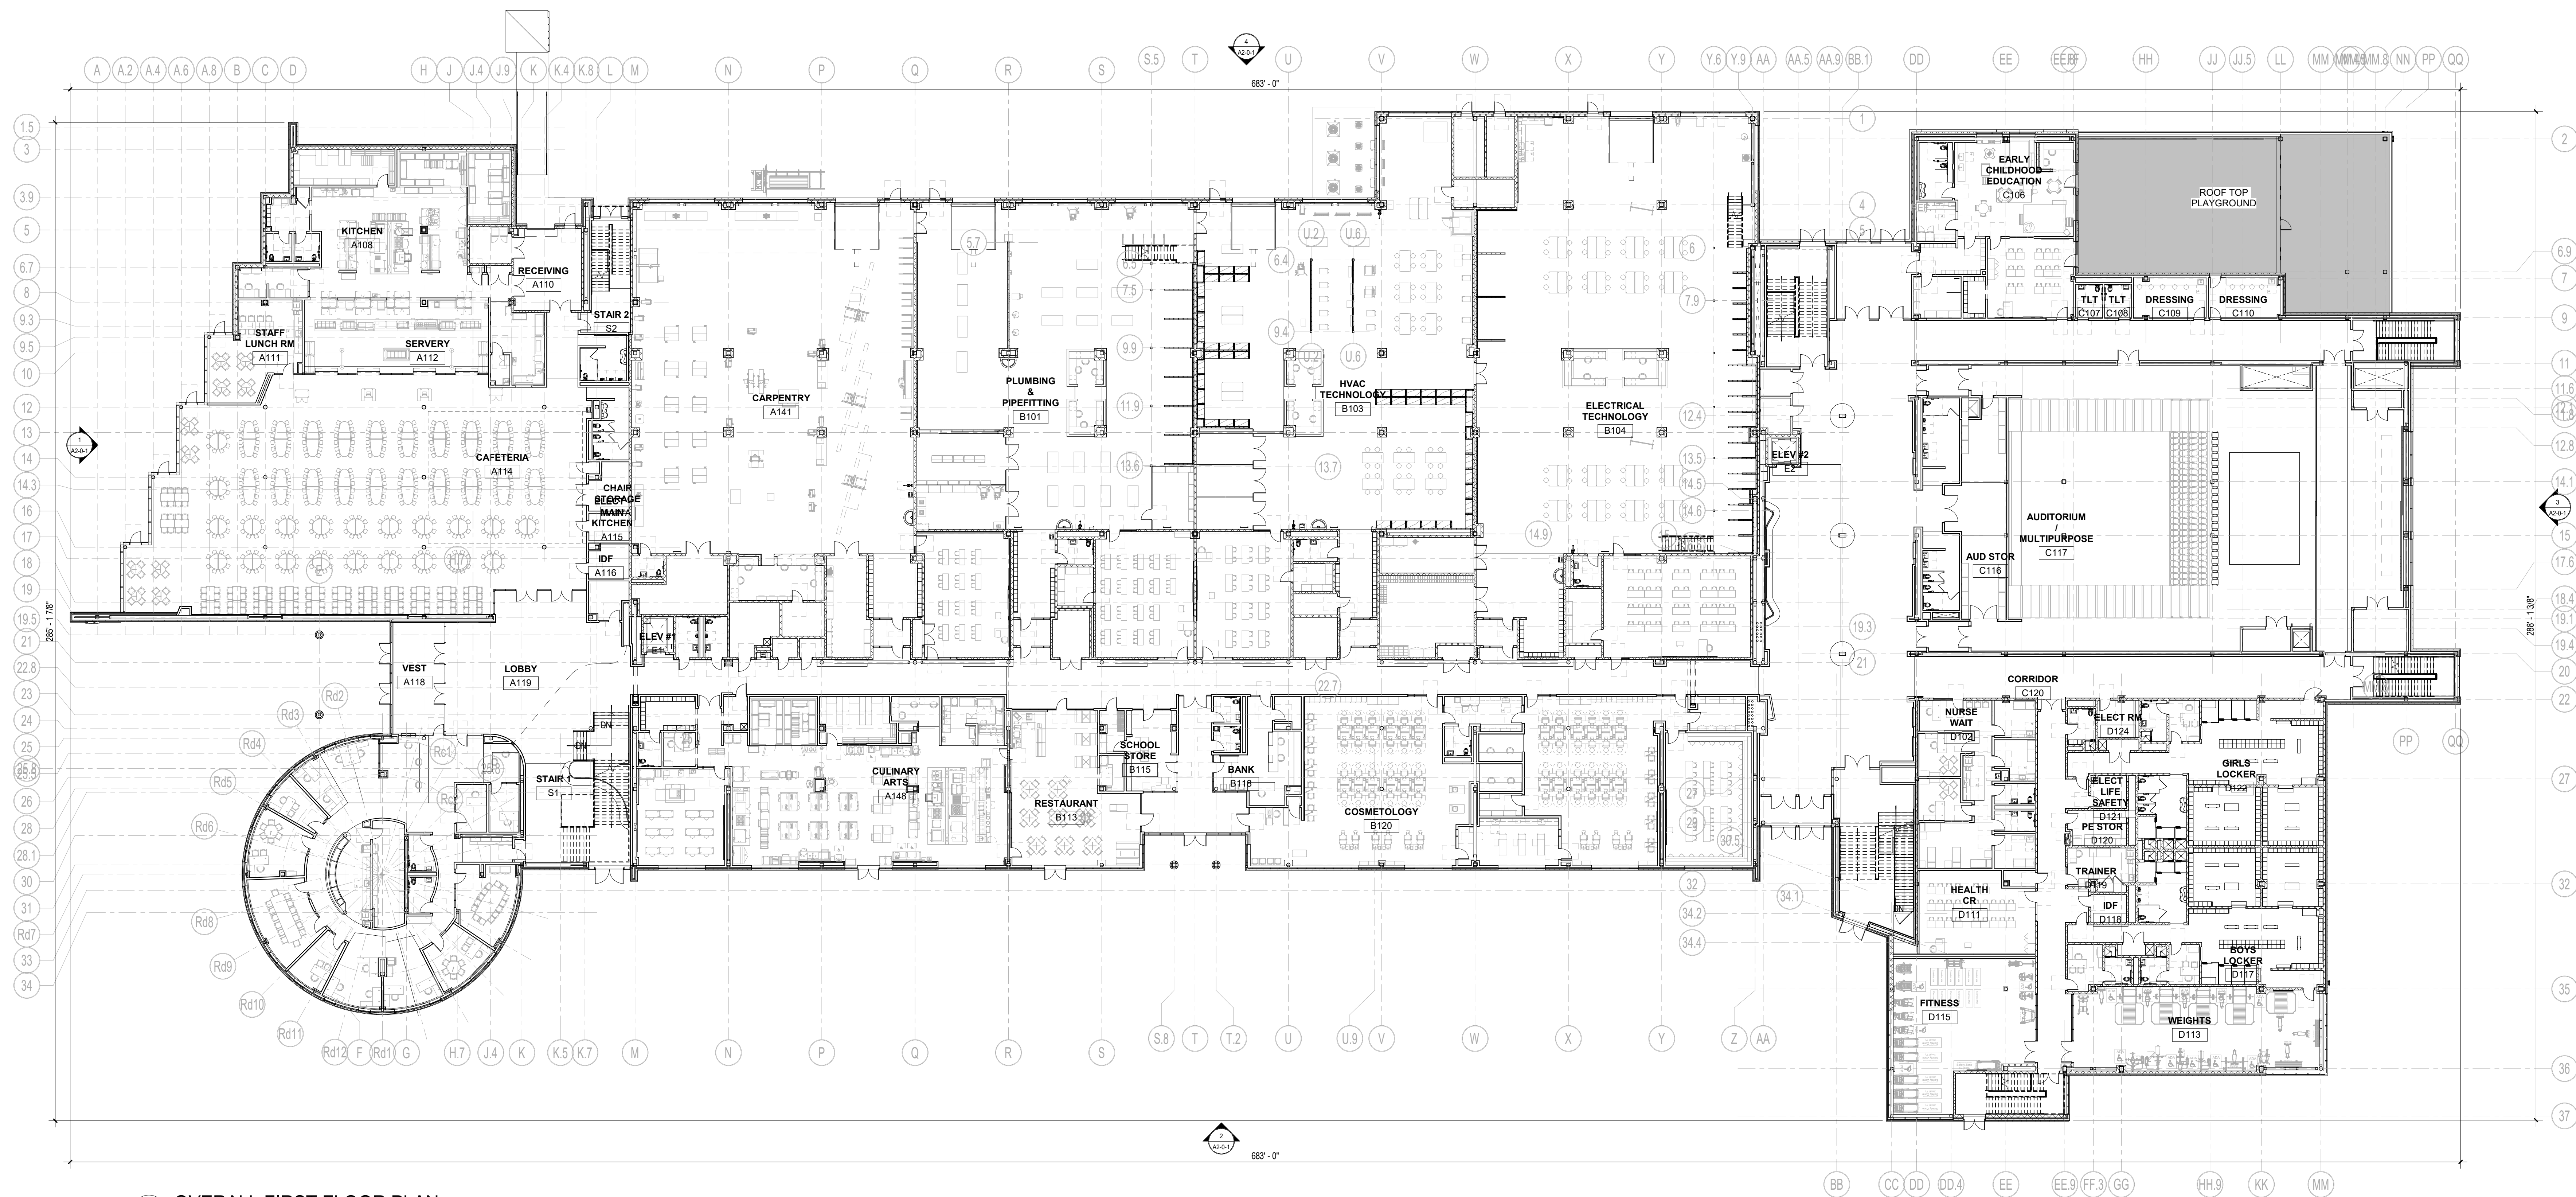

1 OVERALL FIRST FLOOR PLAN
1" = 20'-0"


© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023



KEY PLAN

PROJECT NORTH MAGNETIC NORTH

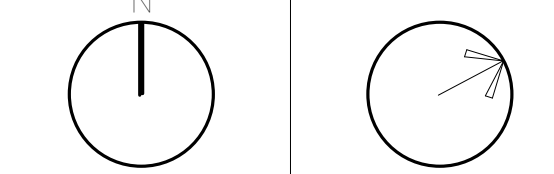

**OVERALL
LOWER LEVEL &
FIRST FLOOR
PLANS**

Scale: 1" = 20'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-1

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.drainc.com

260 Charles Street
Studio 300
Waltham, MA
02453


Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

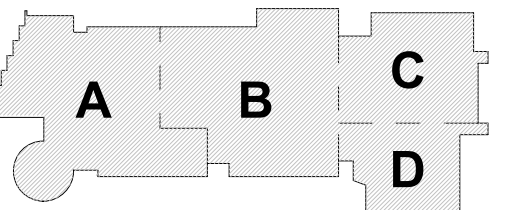

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

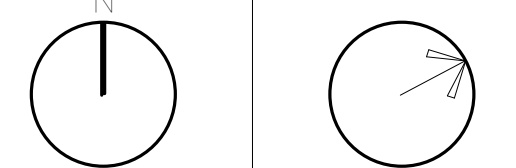

**OVERALL
LOWER LEVEL
AND FIRST
FLOOR MEZZ.
PLANS**

Scale: 1" = 20'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A1-0-2

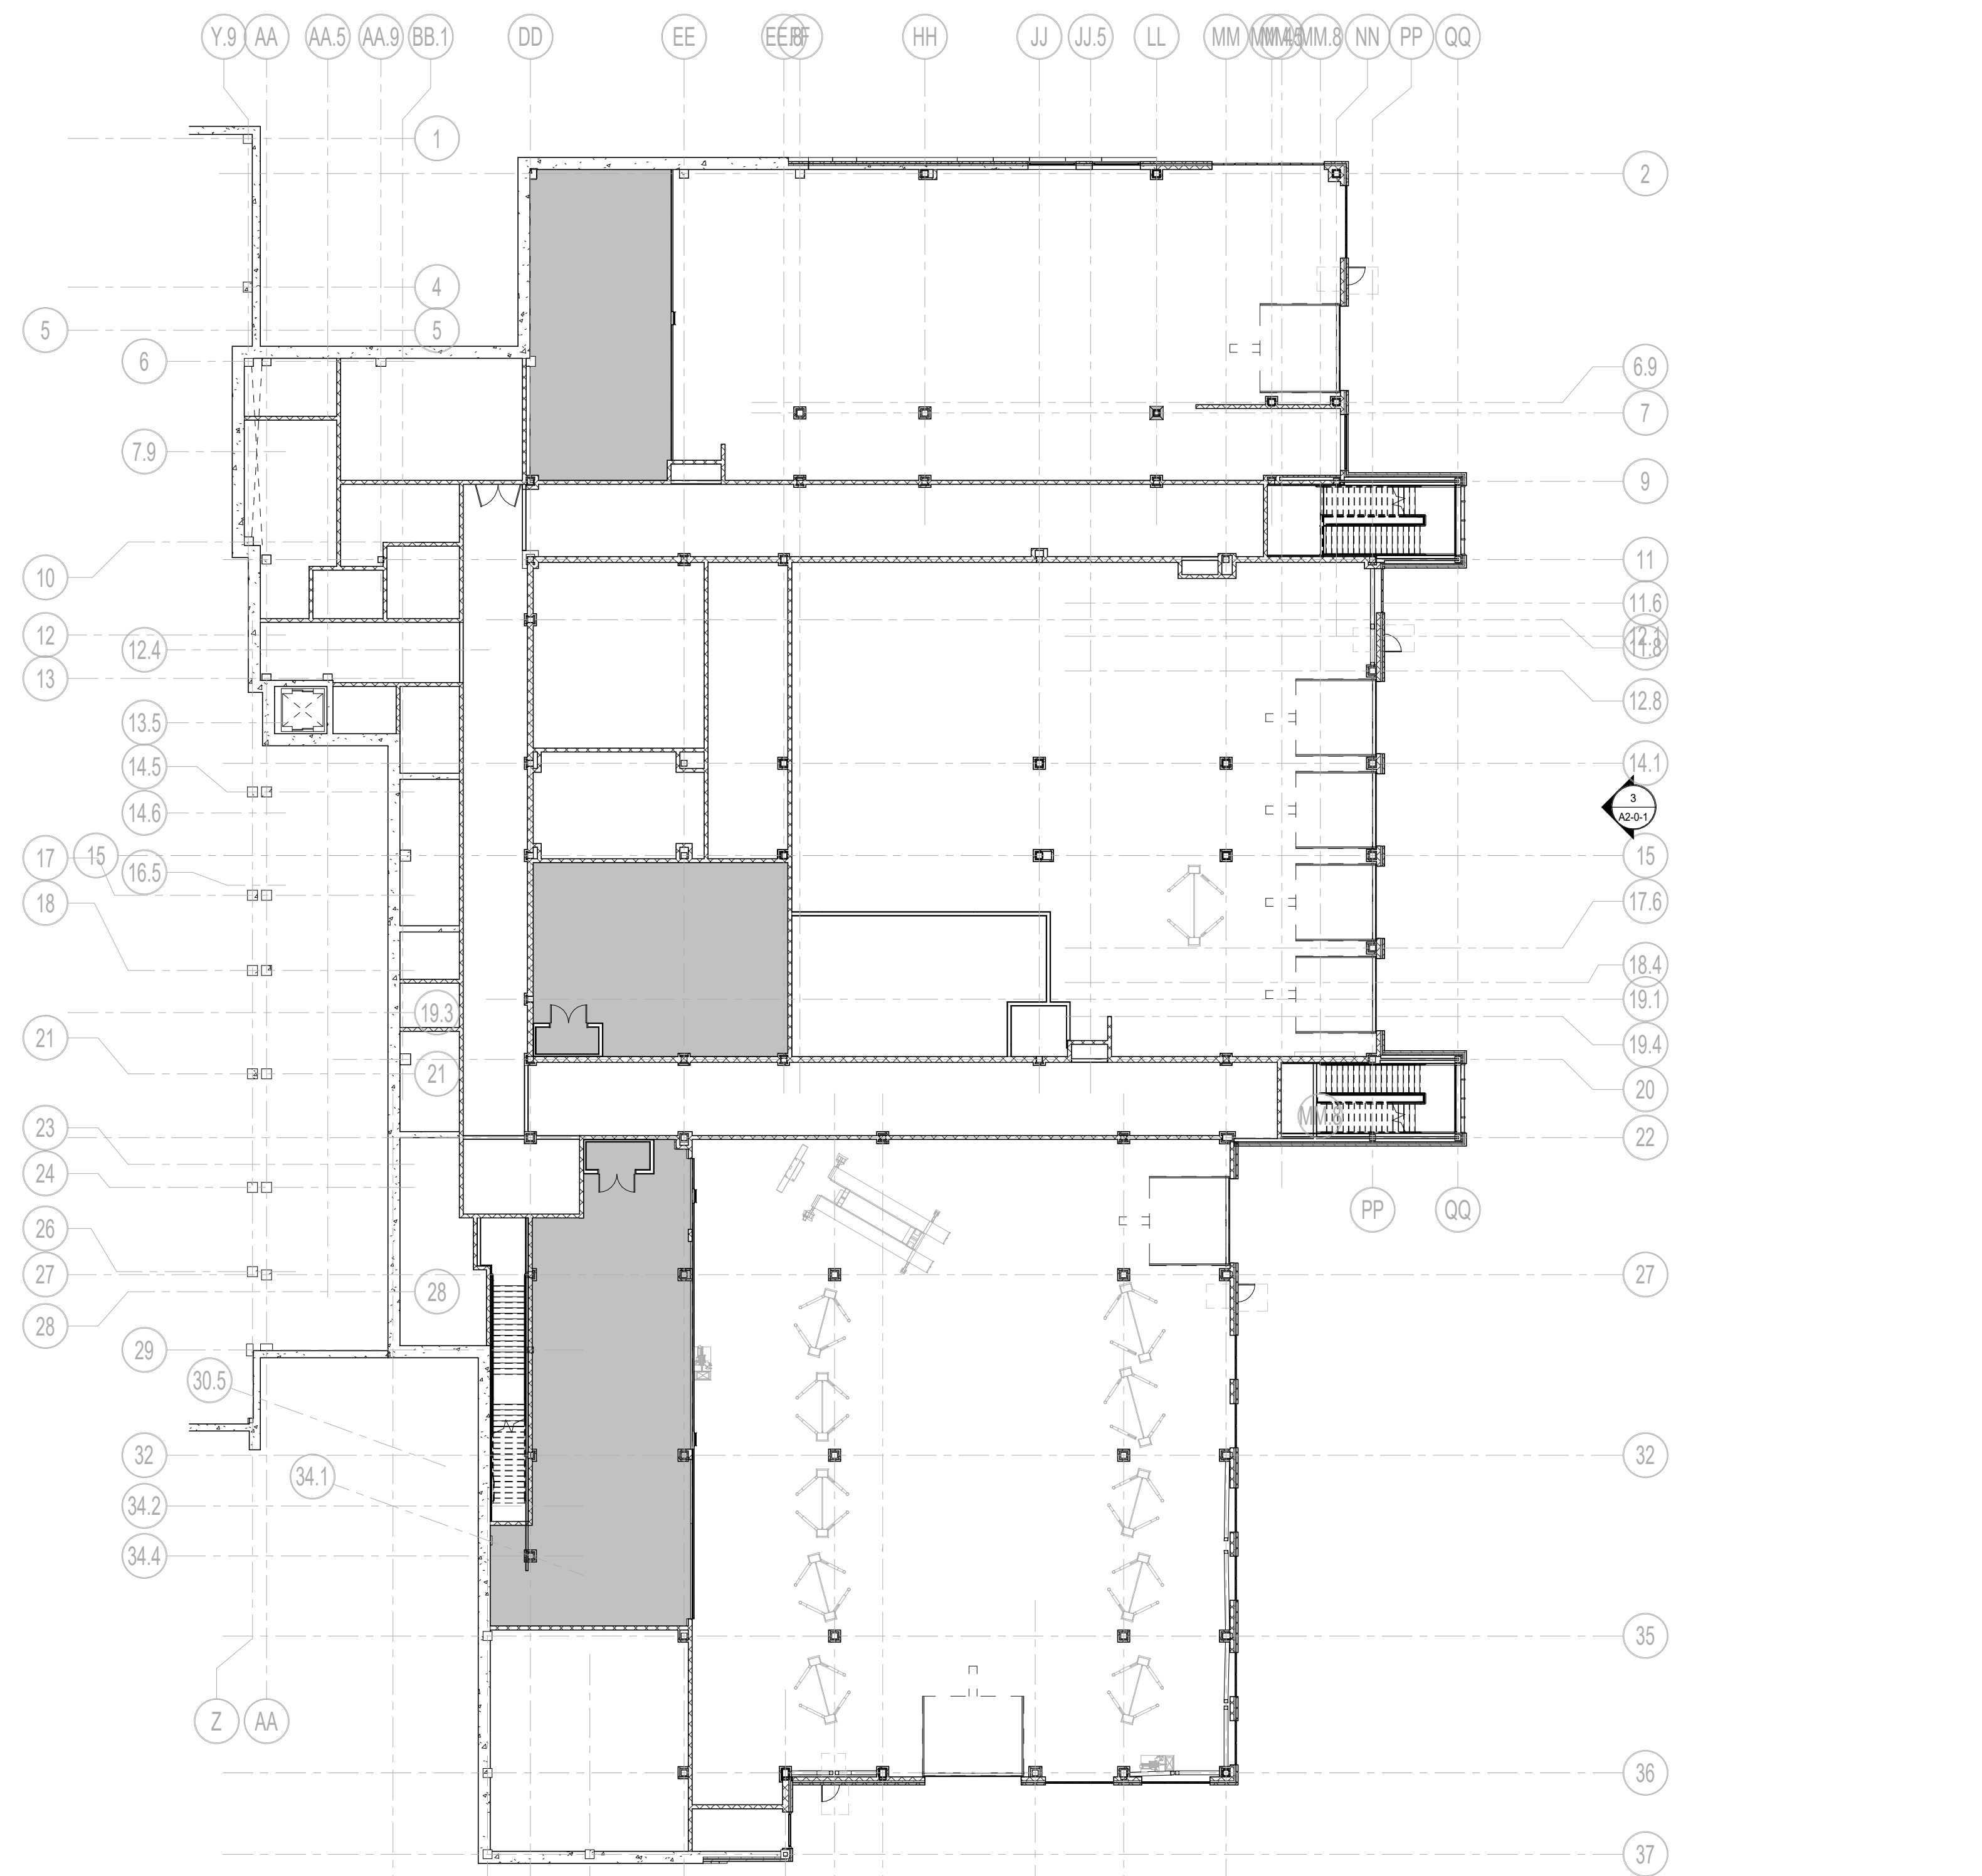

1 OVERALL LOWER LEVEL MEZZANINE PLAN
1" = 20'-0"

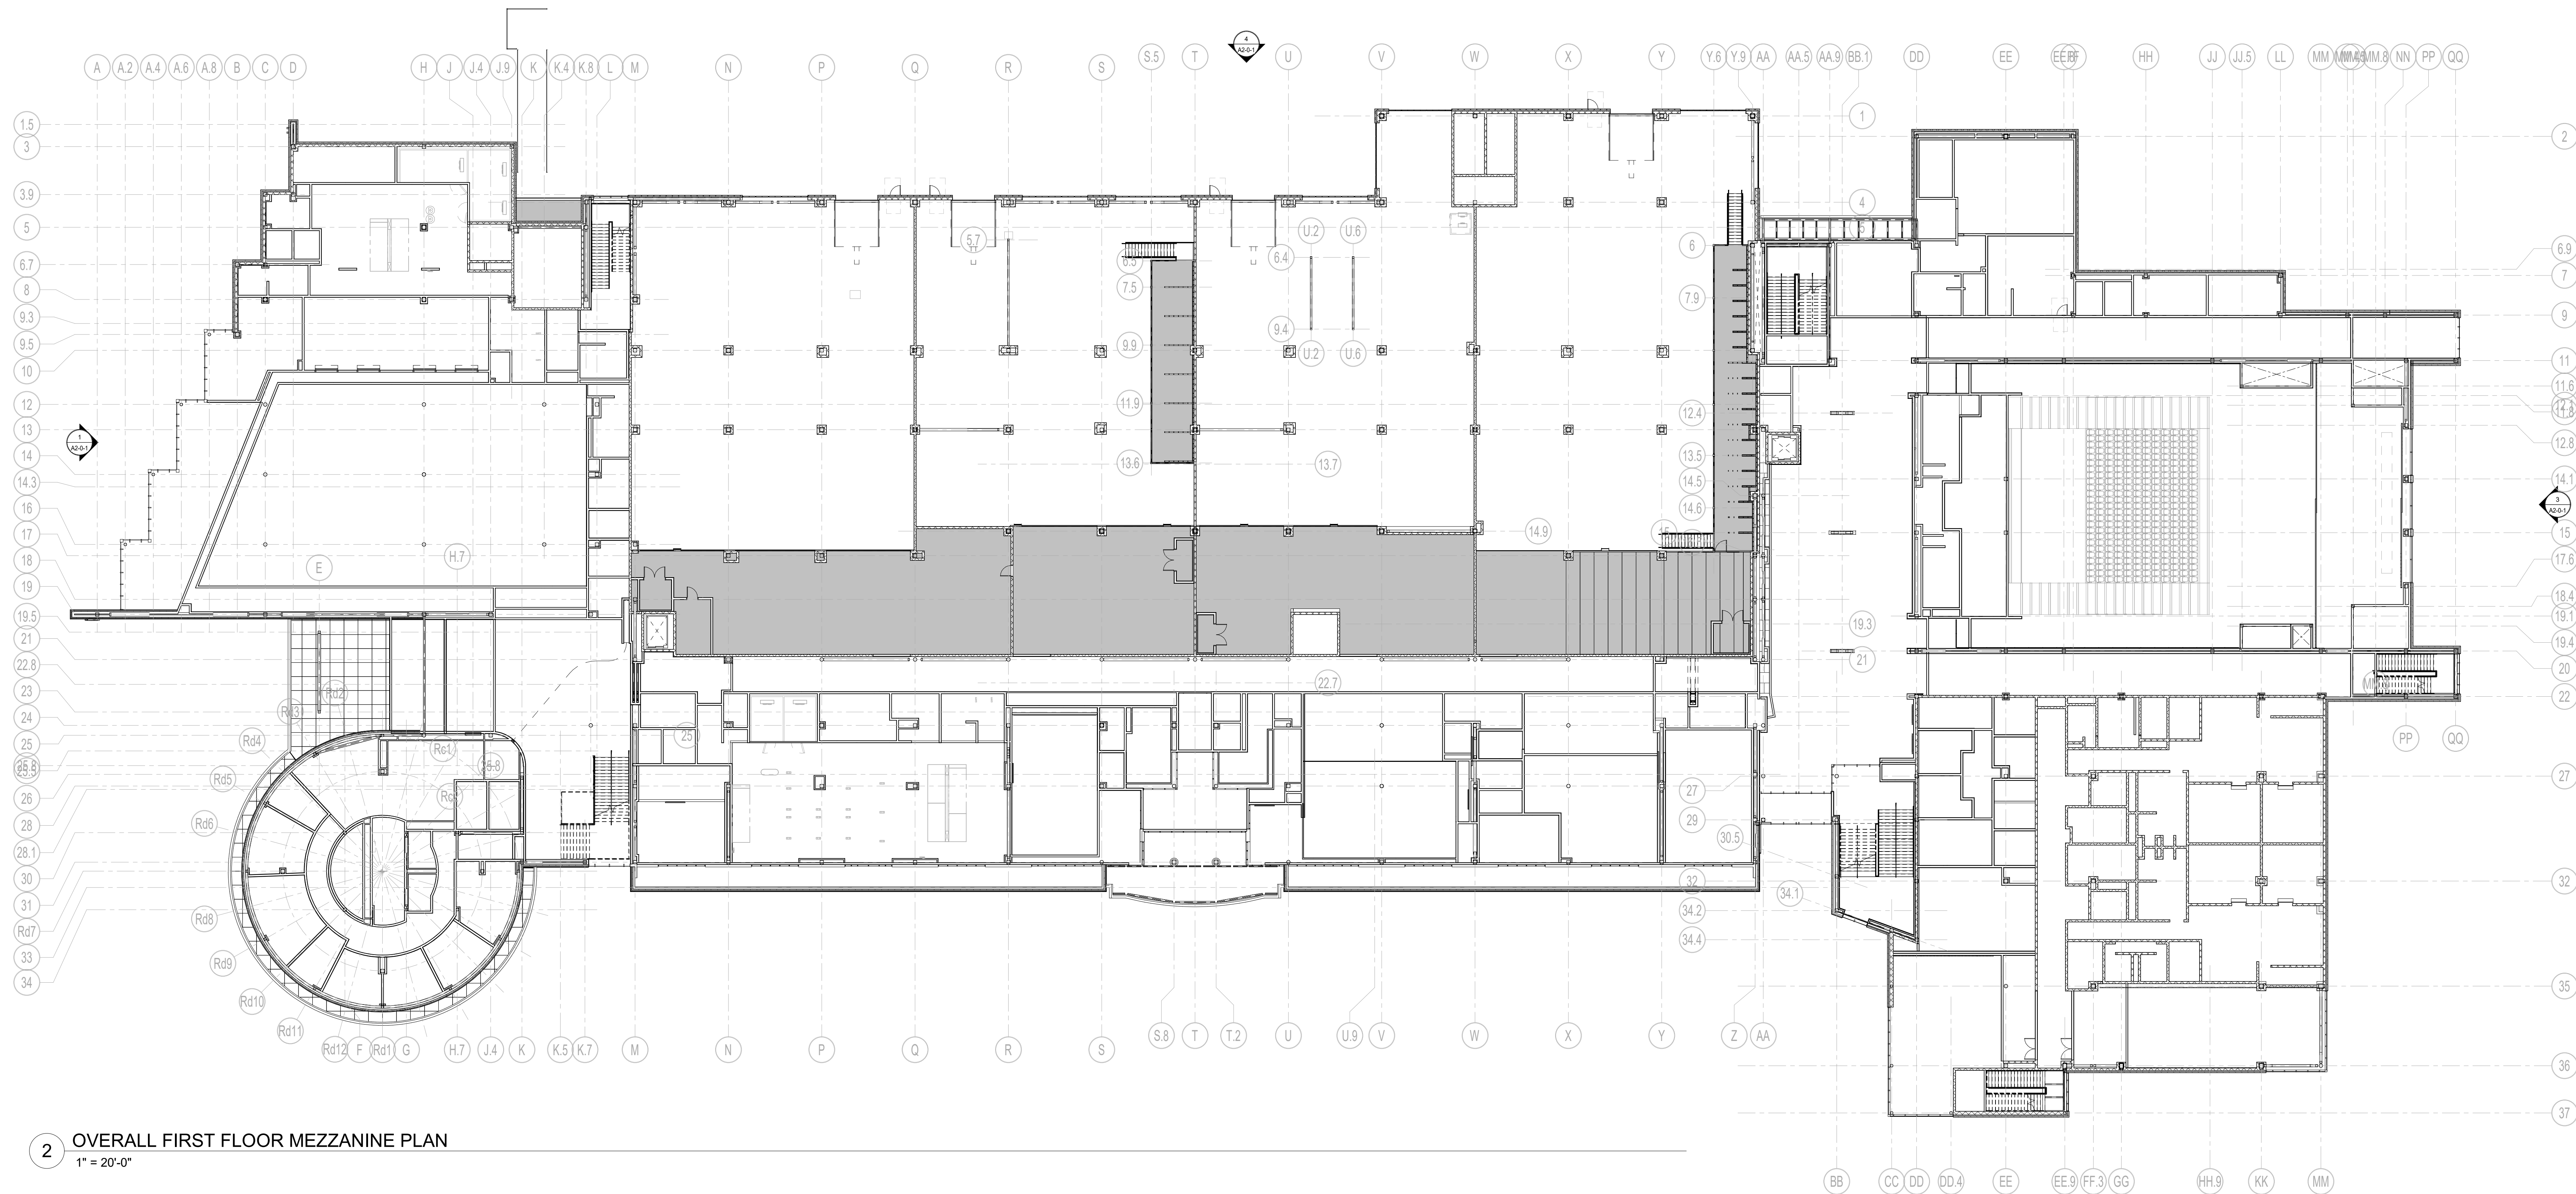


2 OVERALL FIRST FLOOR MEZZANINE PLAN
1" = 20'-0"

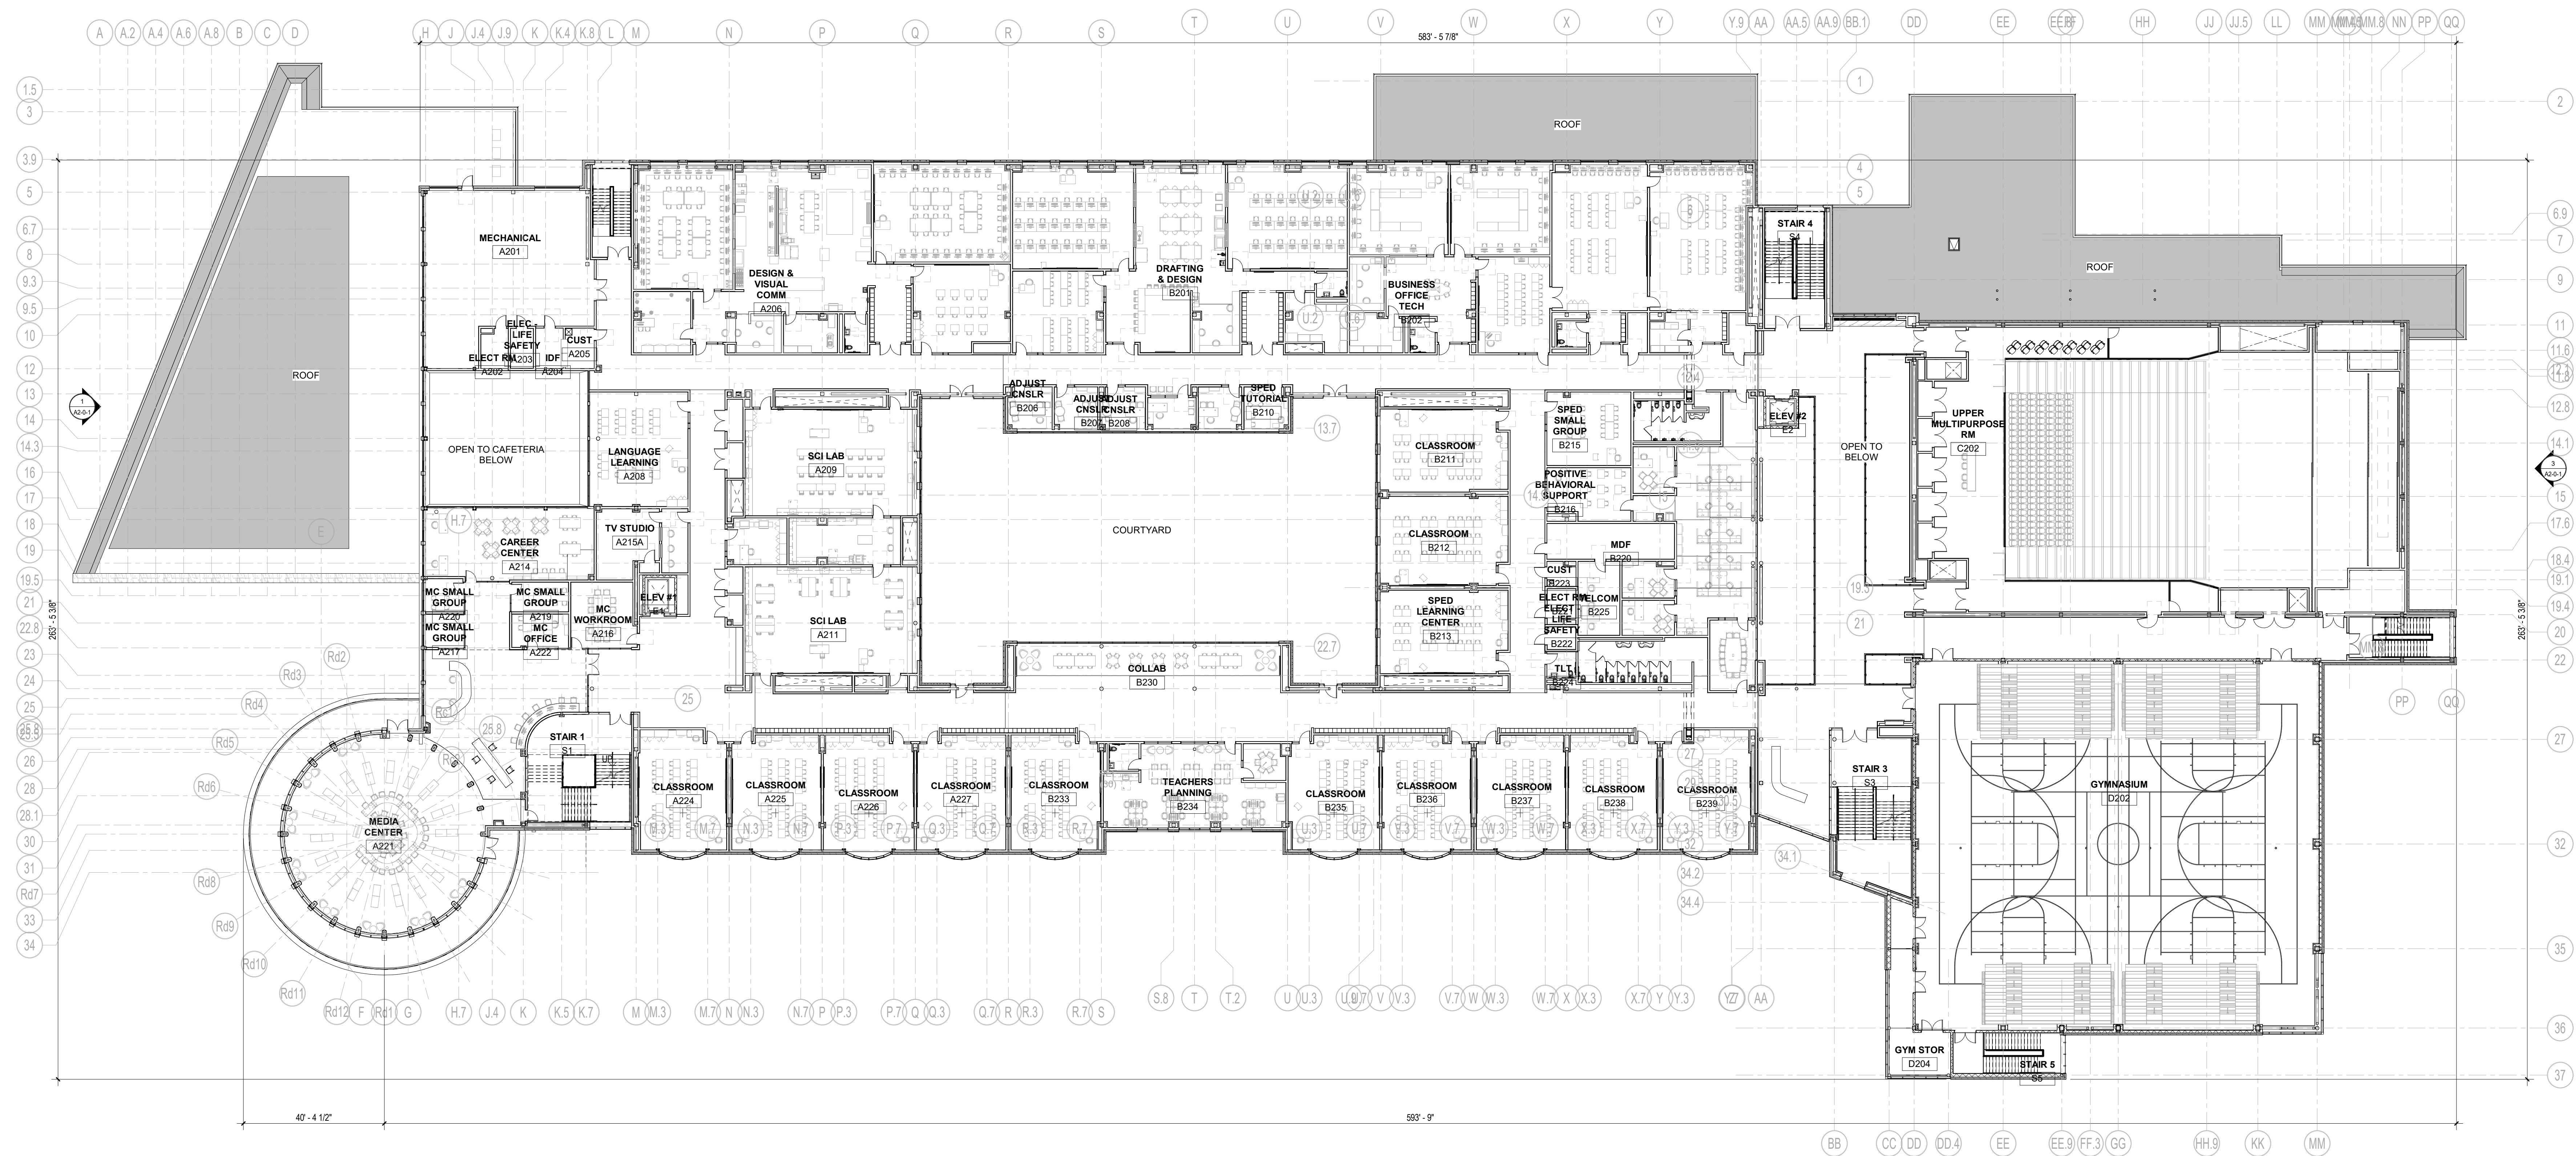

1 OVERALL SECOND FLOOR PLAN
1" = 20'-0"


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

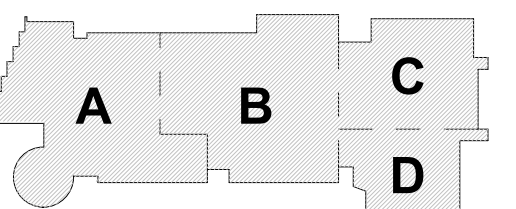

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

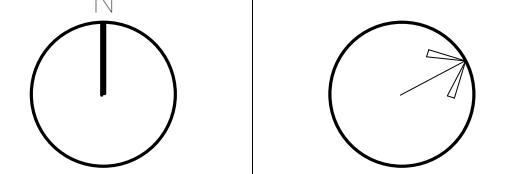

**OVERALL
SECOND FLOOR
PLAN**

Scale: 1" = 20'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-3

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA
02453


Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.



MSBA 90% CD
SUBMISSION
May 12TH, 2023



KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



**OVERALL THIRD
FLOOR PLAN**

Scale: 1" = 20'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-0-4

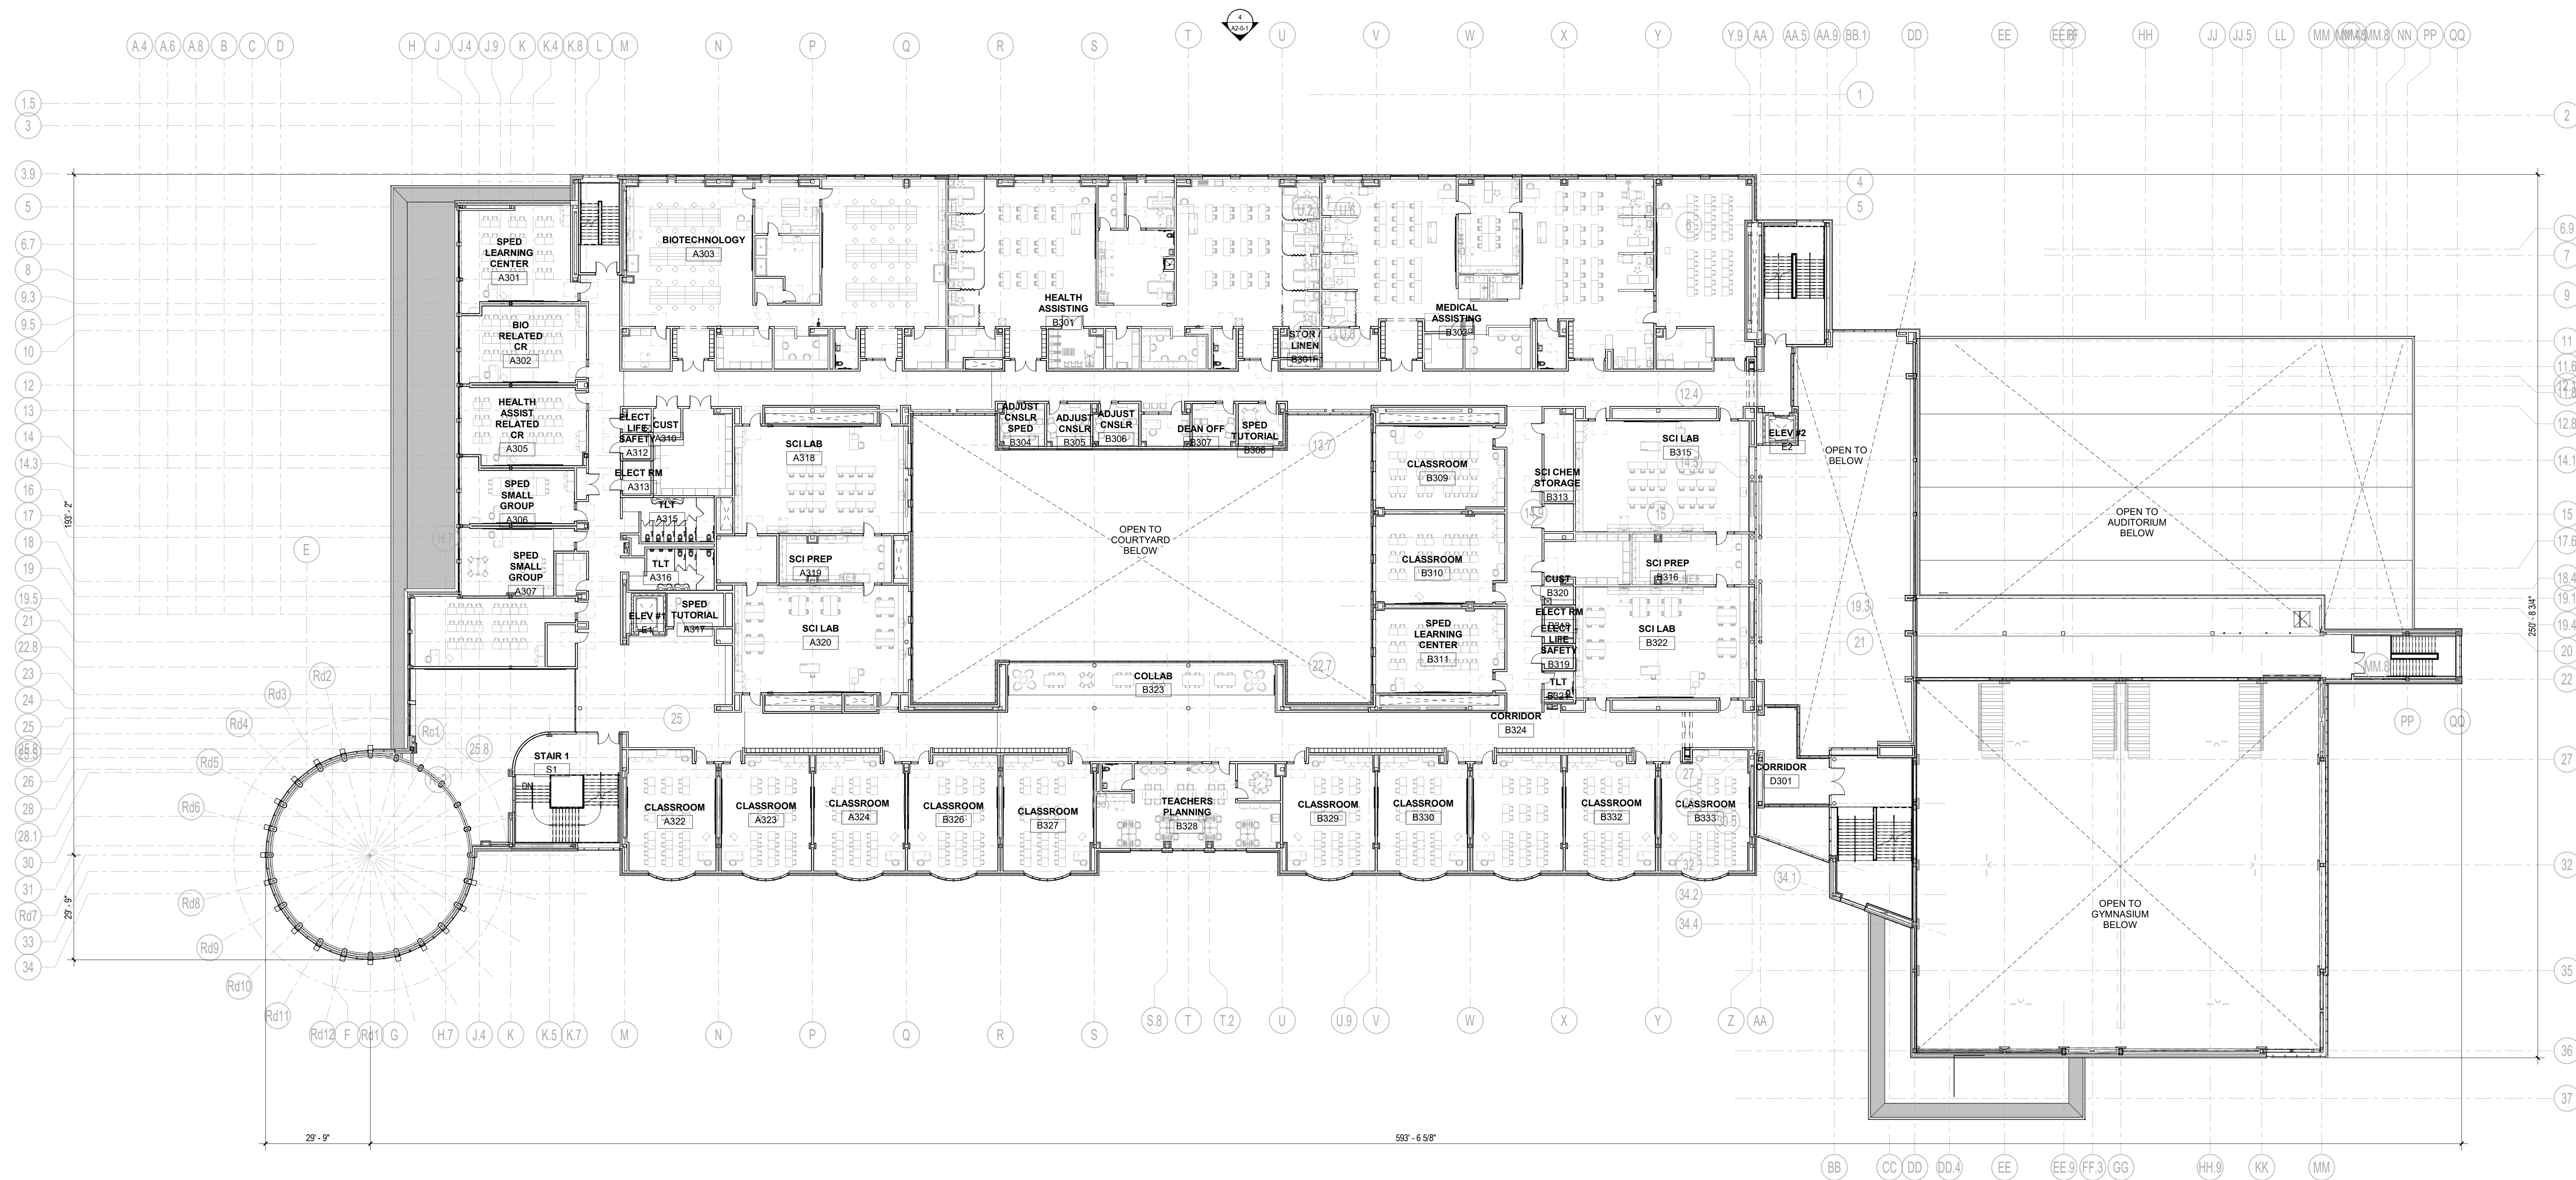

1 OVERALL THIRD FLOOR PLAN
1" = 20'-0"

100 Hemlock Road,
Wakefield, MA 01880



A diagram showing a 2x3 grid of blocks. The top row contains blocks labeled A, B, and C from left to right. The bottom row contains an empty space, block D, and another empty space from left to right.

Scale: 1" = 20'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

ROOF LEGEND

ROOF SYSTEM A:
PITCHED METAL
DECKING - SEE
ROOF DRAIN &
SUMP - TYPICAL

ROOF SYSTEM B:
TAPERED ROOF
INSULATION OVER
METAL DECKING -
SEE
ROOF DRAIN &
SUMP - TYPICAL

WALKABLE ROOF
RUBBER ROOFTOP
PAVERS OVER ROOF
MEMBRANE

TAPERED INSULATION
CRICKET
SINGLE PLY MEMBRANE
ROOF OVER COVER
BOARD TAPERED ROOF
INSULATION OVER ROOF
SYSTEM A (COVER
BOARD OMITTED) - MIN.
1/2" PER FOOT SLOPE

PRE-VEGETATED ROOF
GARDEN SYSTEM

FUTURE PHOTOVOLTAIC
ARRAYS

H.P.
ELEVATION OF PITCHED
METAL DECK - SEE WALL
SECTIONS FOR B.O.
DECK ELEVATIONS

7'-11/4"
ELEVATION OF PITCHED
STEEL RELATIVE TO
ADJACENT HIGH POINT

4'-1/2"
THICKNESS OF
TAPERED INSULATION
OVER ROOF DECK

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION

May 12TH, 2023


KEY PLAN


PROJECT NORTH
MAGNETIC NORTH

OVERALL ROOF
PLAN


Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-6

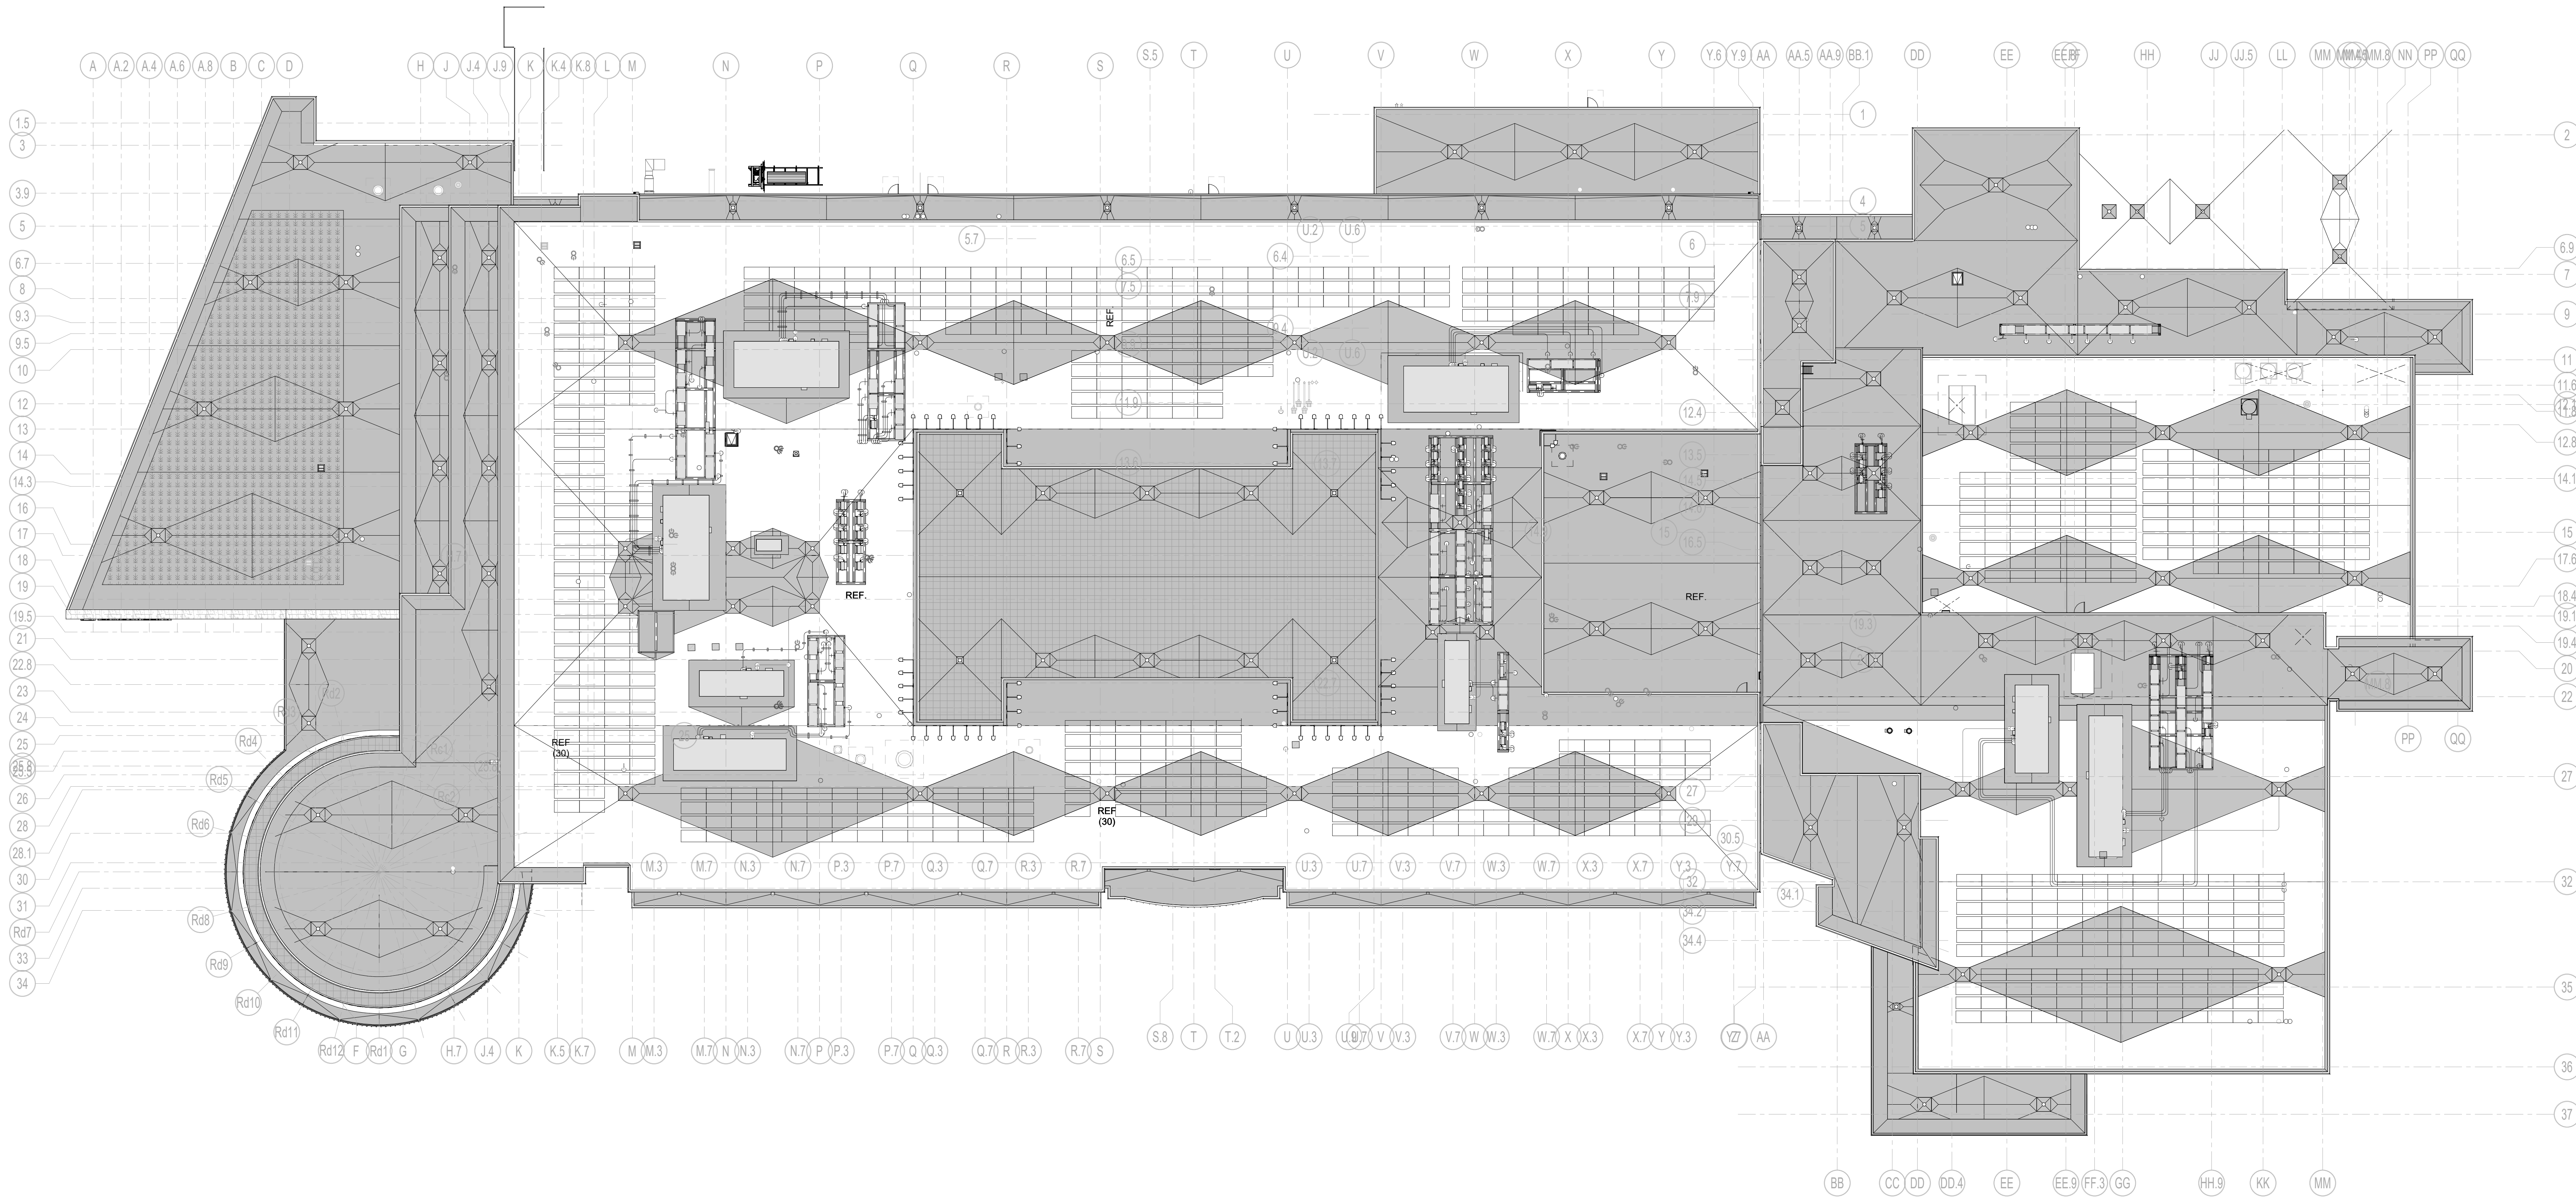

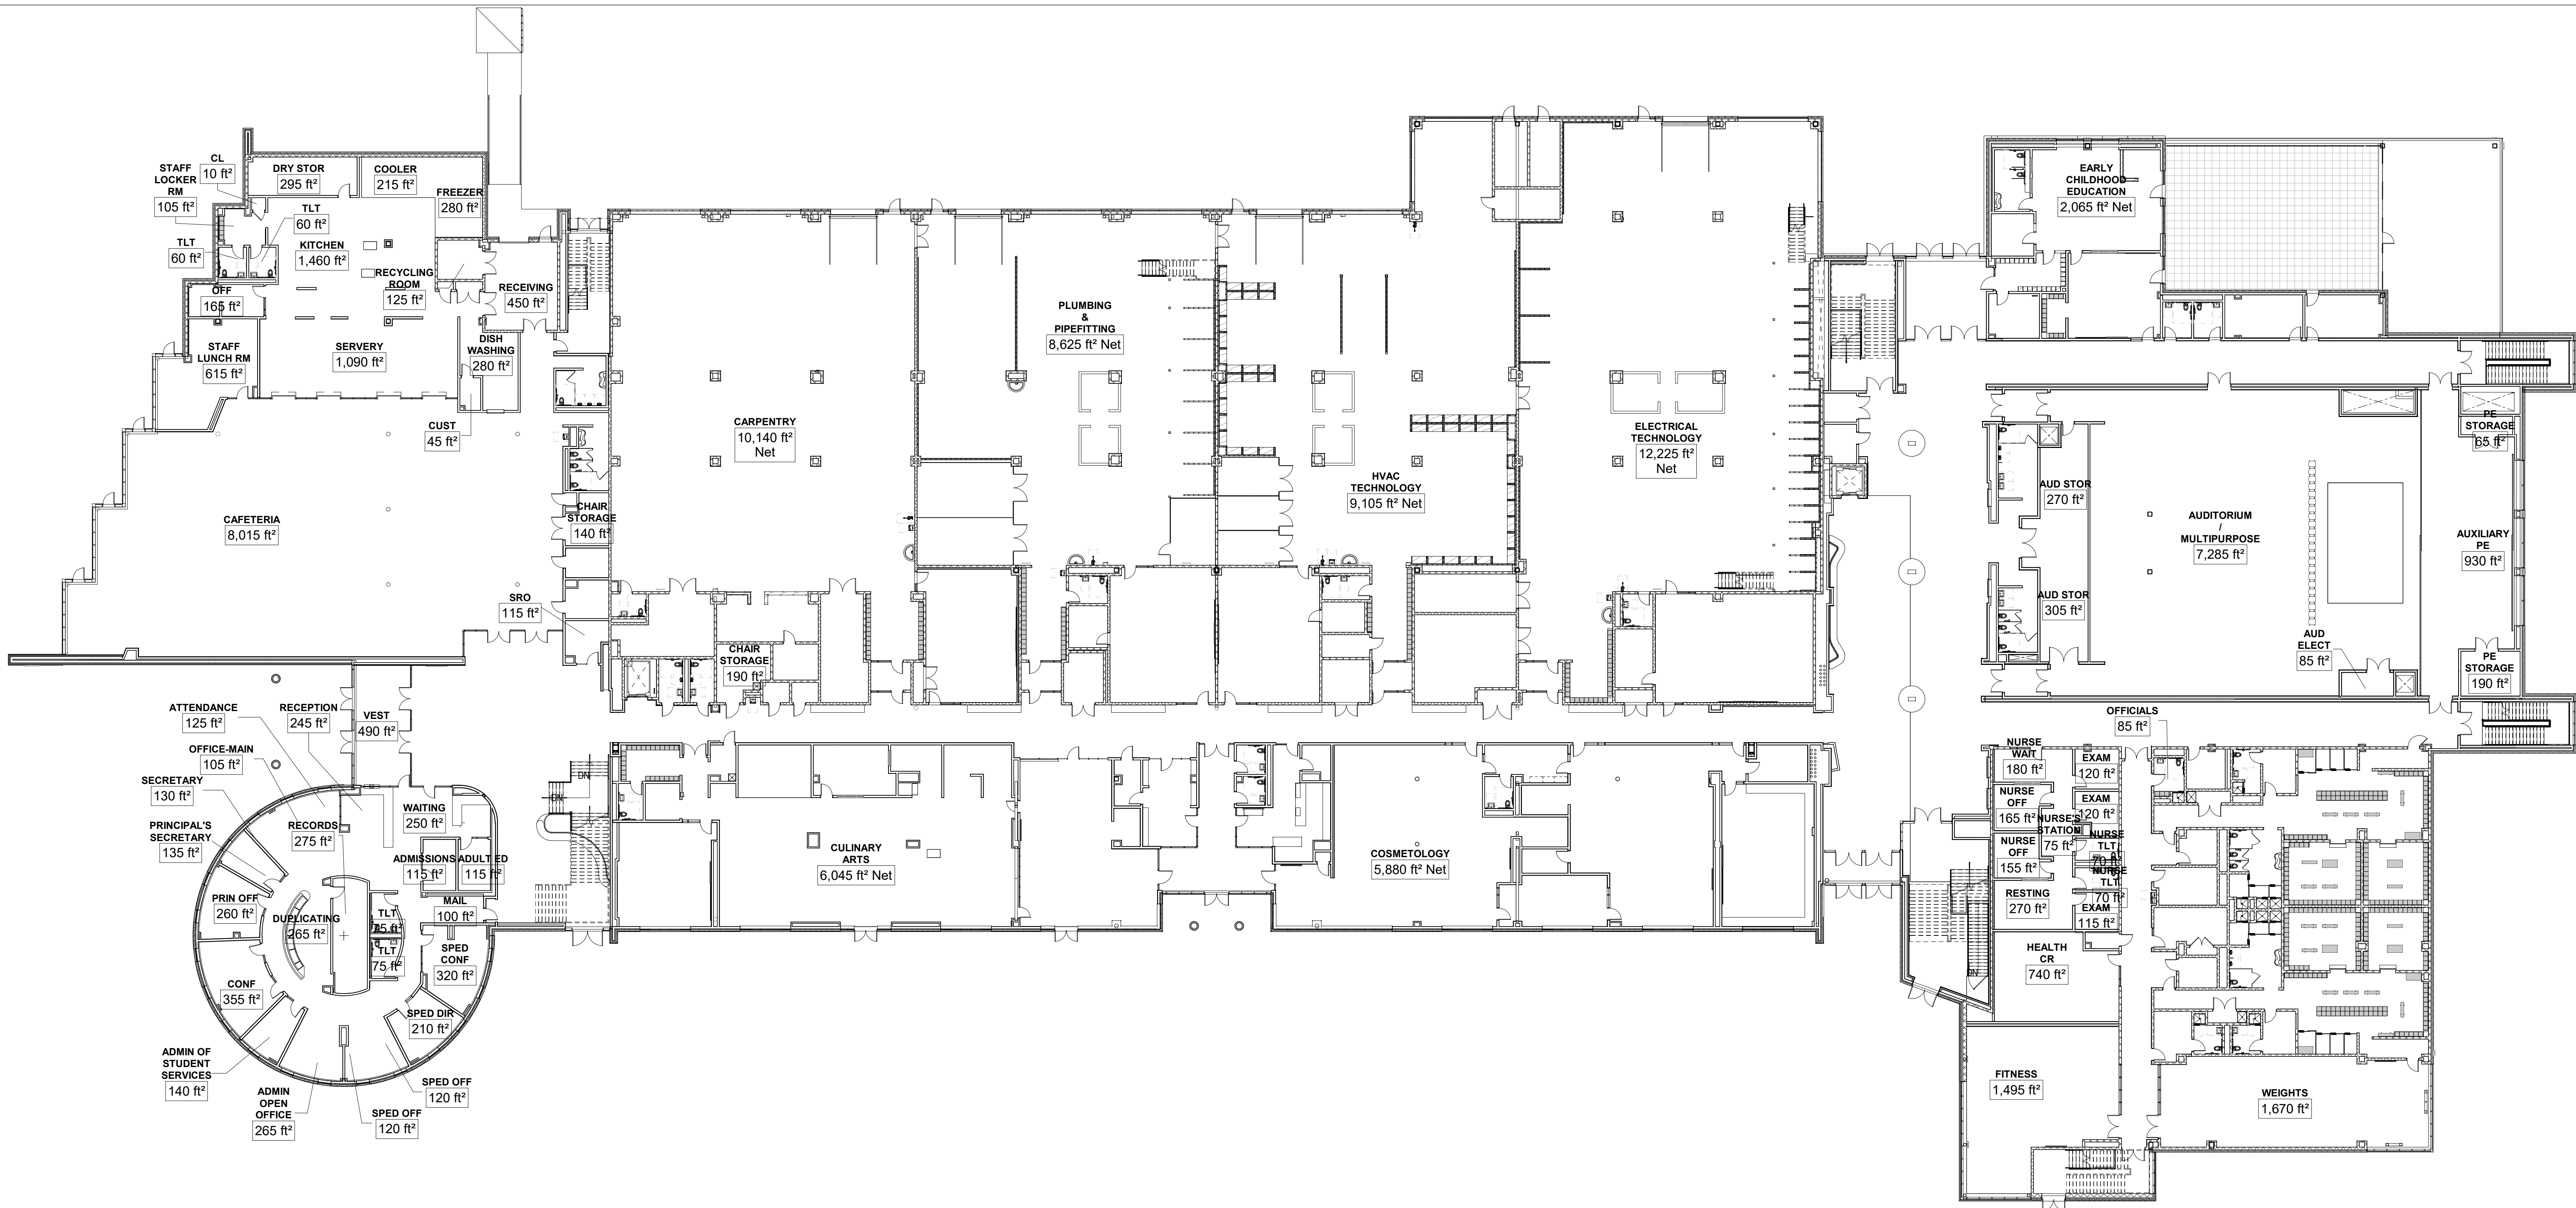

2 FIRST FLOOR SHOPS
1" = 20'-0"

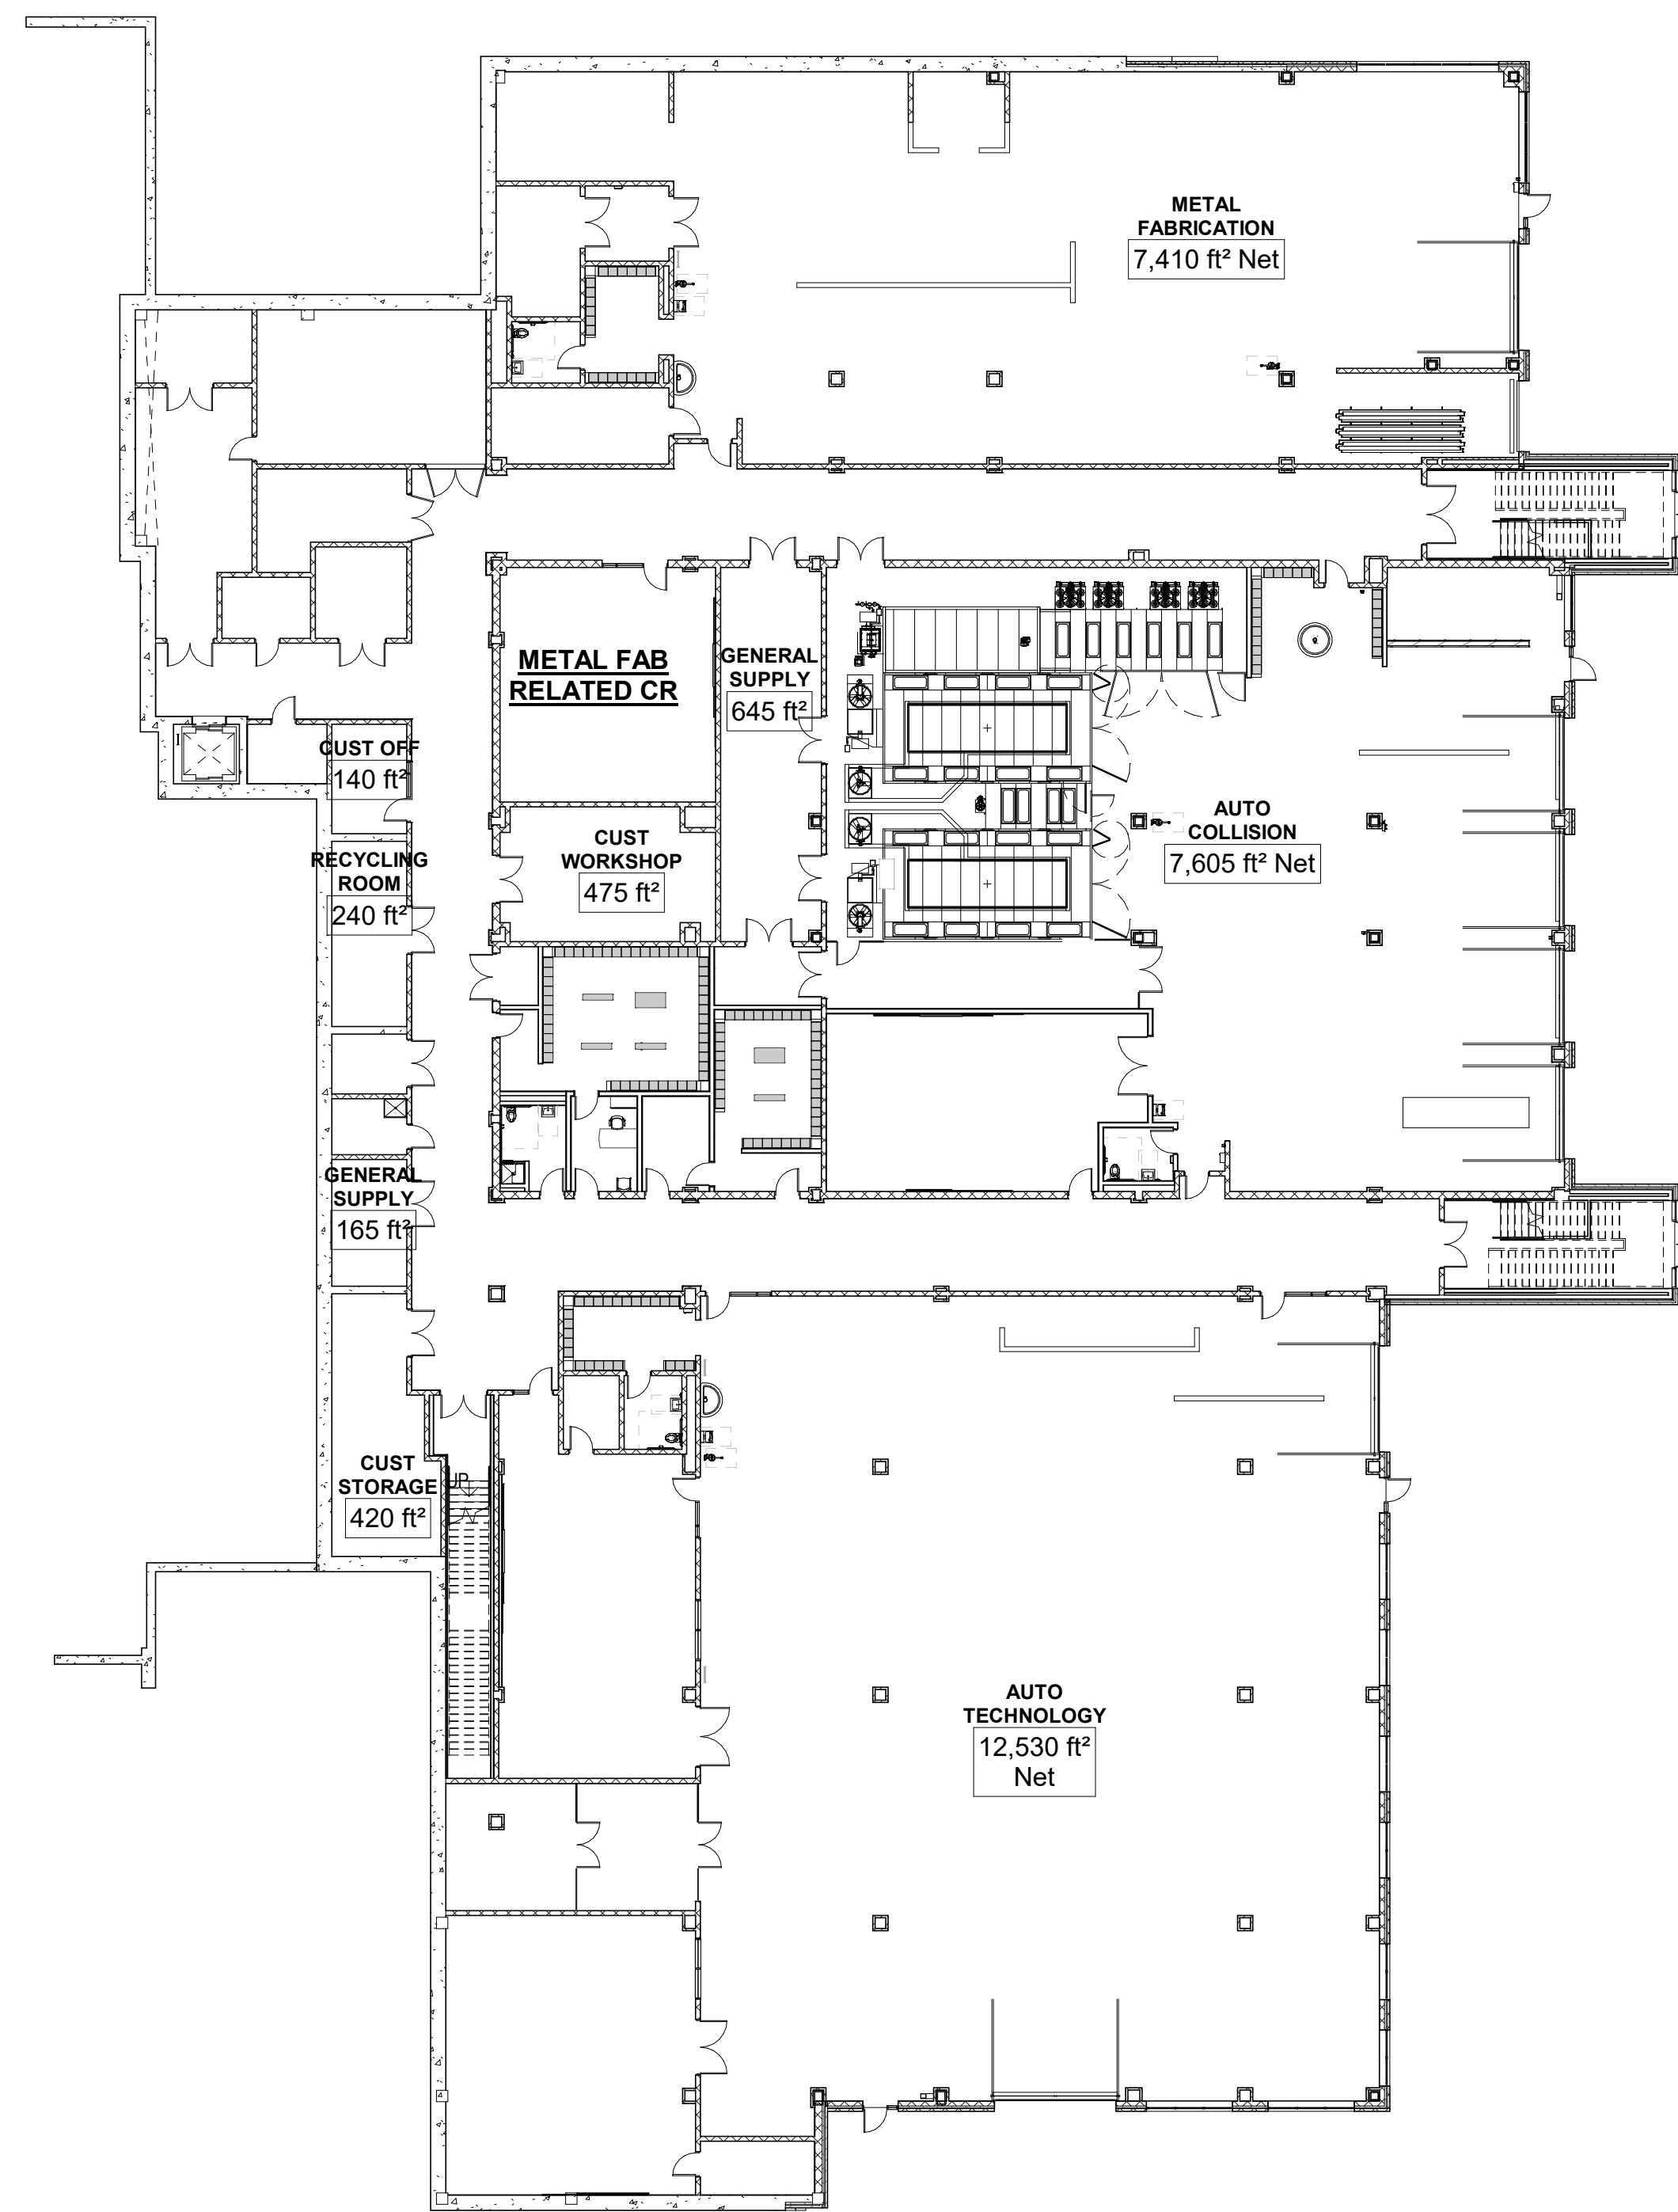


1 LOWER LEVEL - AREA A
1" = 20'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

2 THIRD FLOOR PLAN
1" = 20'-0"

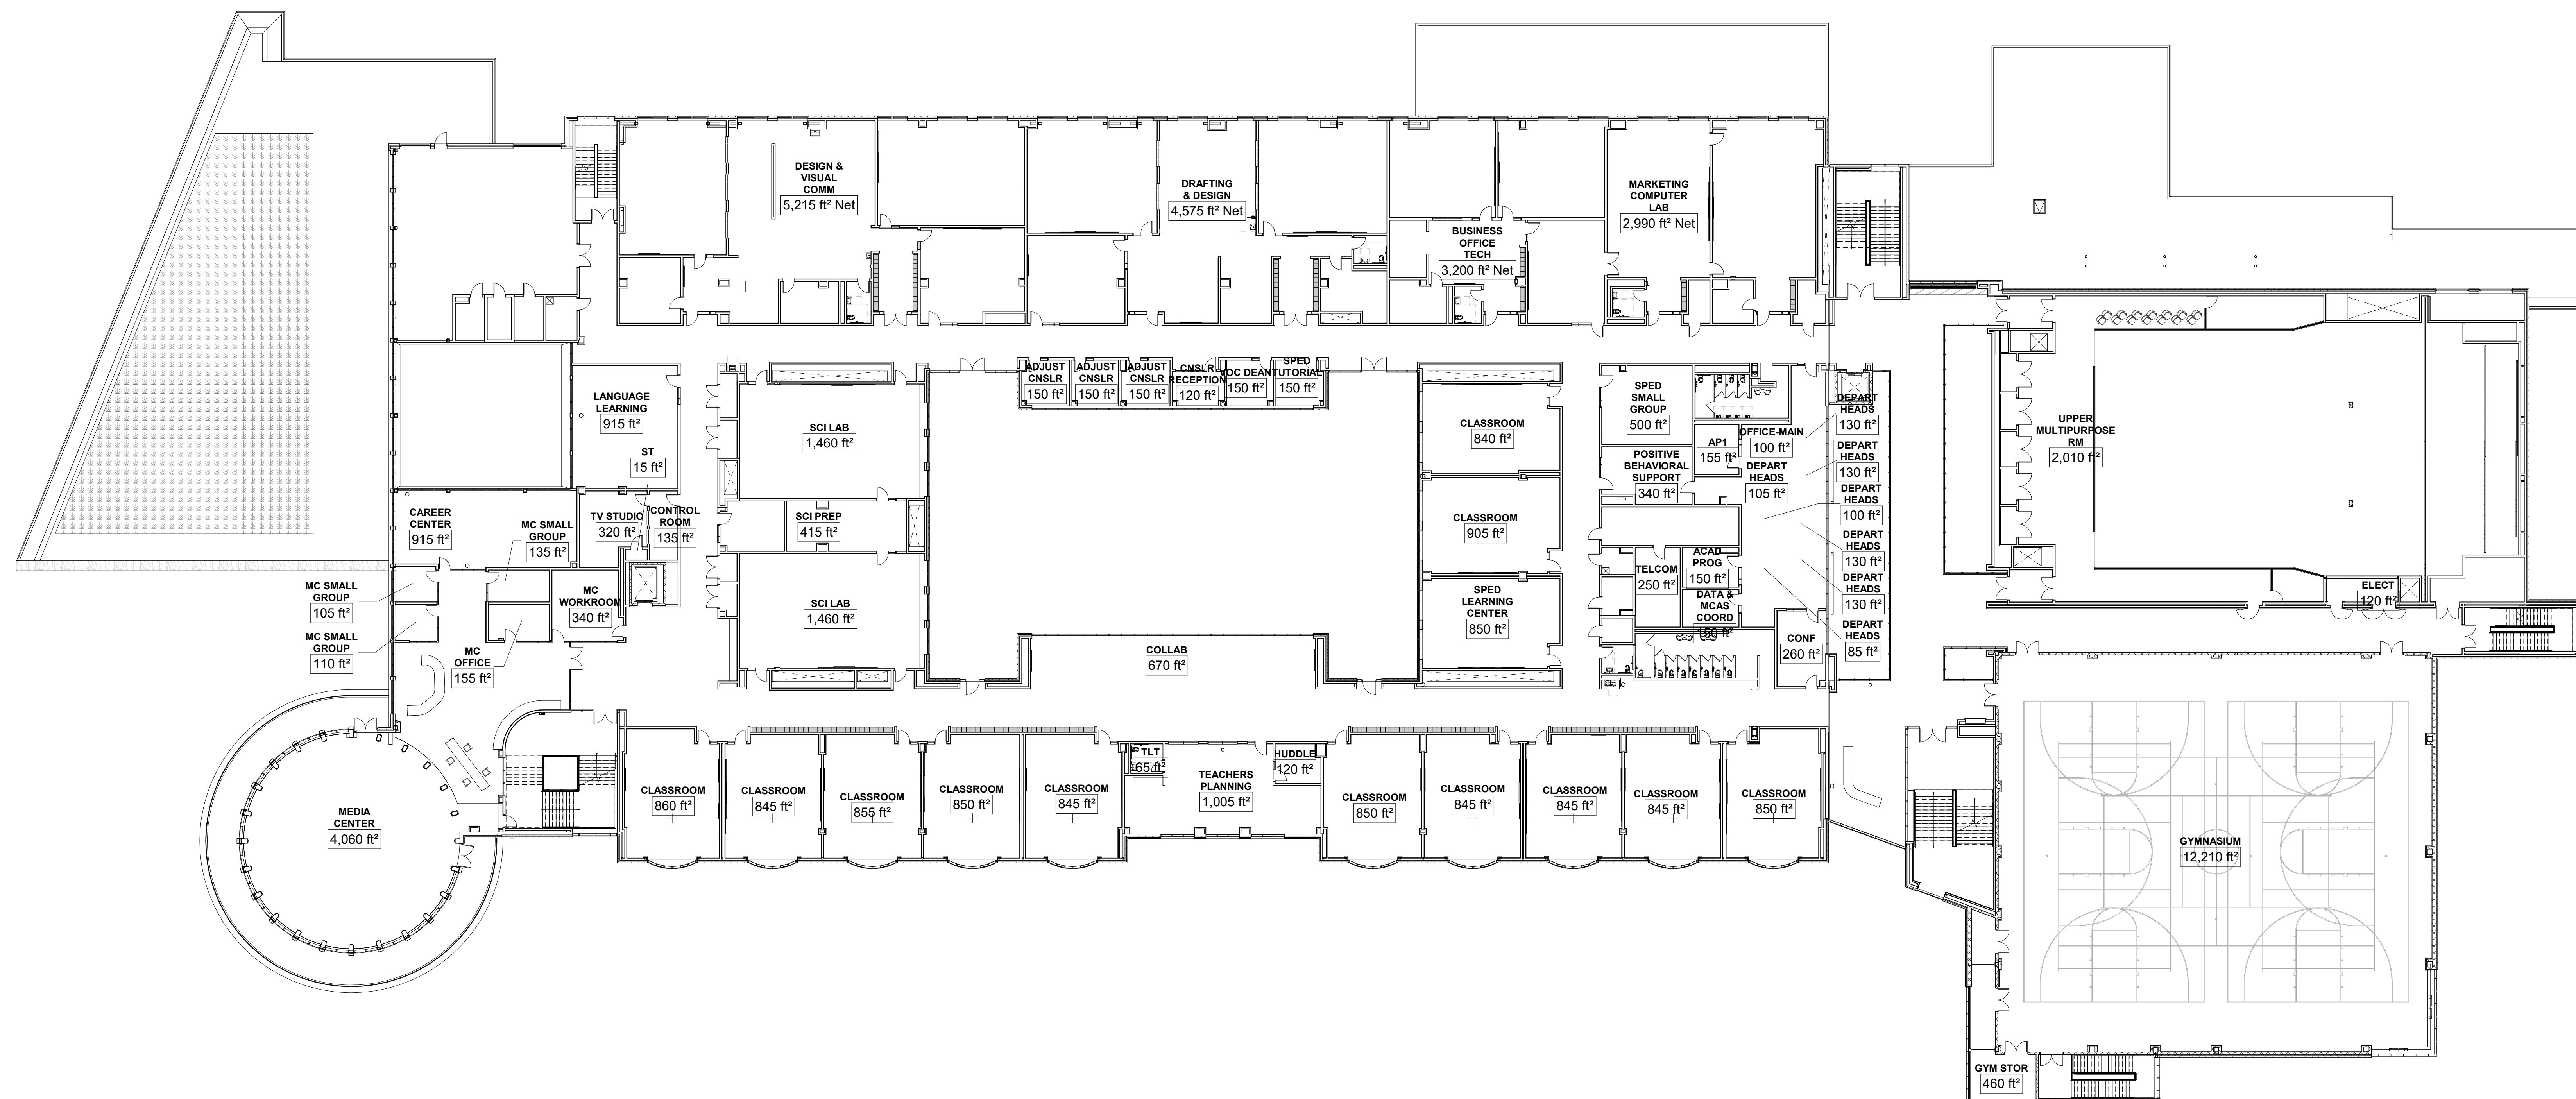


1 SECOND FLOOR PLAN
1" = 20'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023




KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**SECOND &
THIRD FLOOR
NET AREA
PLANS**

Scale: 1" = 20'-0"

Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4

A1-0-9

3 LOCKER BUILDING SECOND FLOOR PLAN
1" = 20'-0"

2 LOCKER BUILDING FIRST FLOOR PLAN
1" = 20'-0"

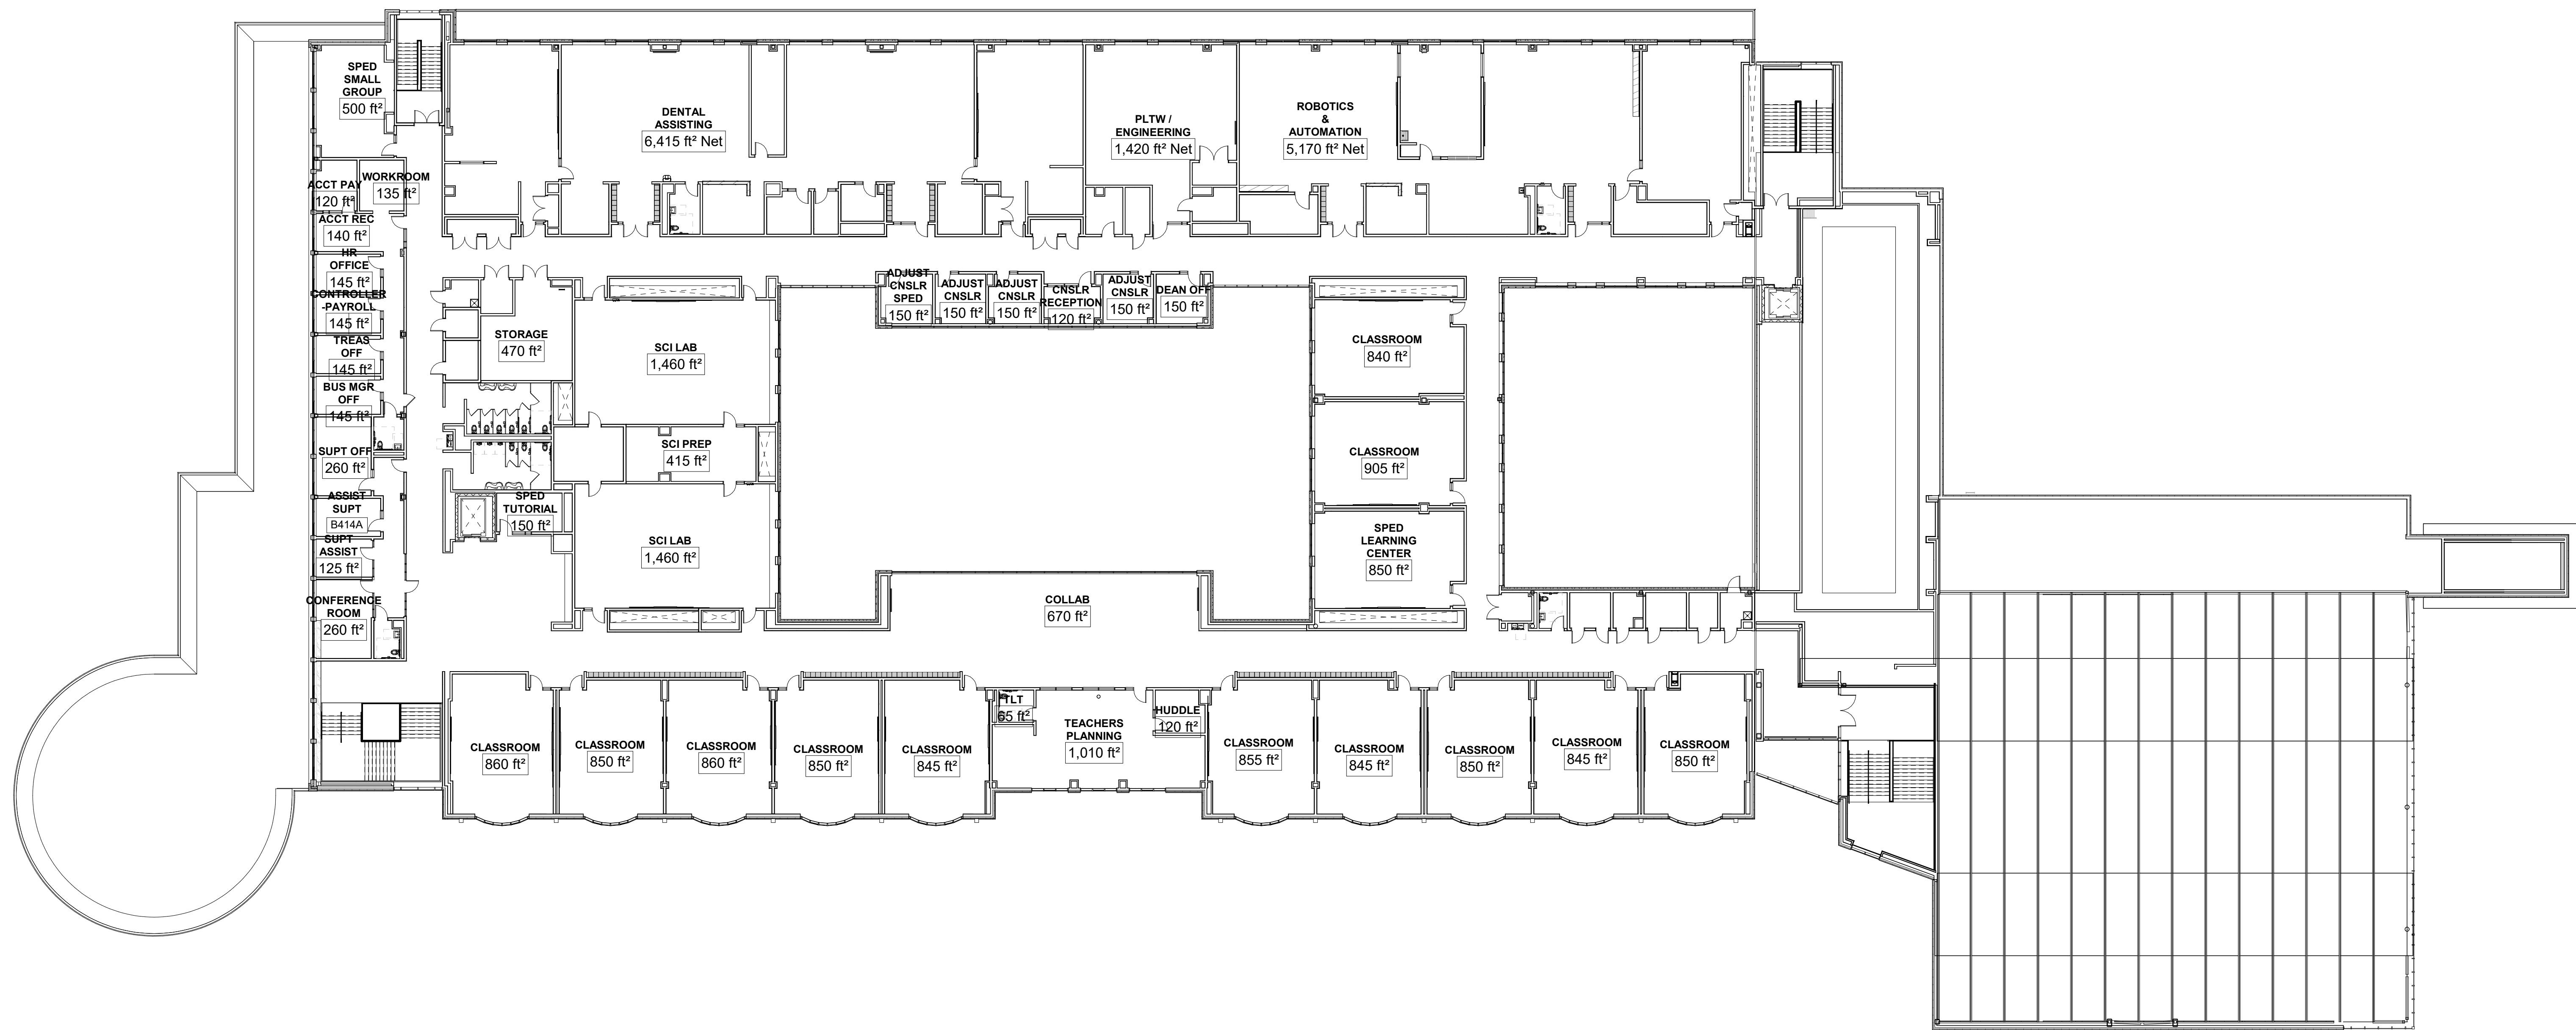


1 4-Overall Fourth Floor Plan - Net Area
1" = 20'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

EDGE OF SLAB PLAN GENERAL NOTES:

1. PROVIDE ELEVATOR PIT WATERPROOFING AT ALL SLAB ON GRADE RECESSES INCLUDING, BUT NOT LIMITED TO, ELEVATOR PIT, TRENCH DRAINS, GREASE TRAPS, ETC. ...

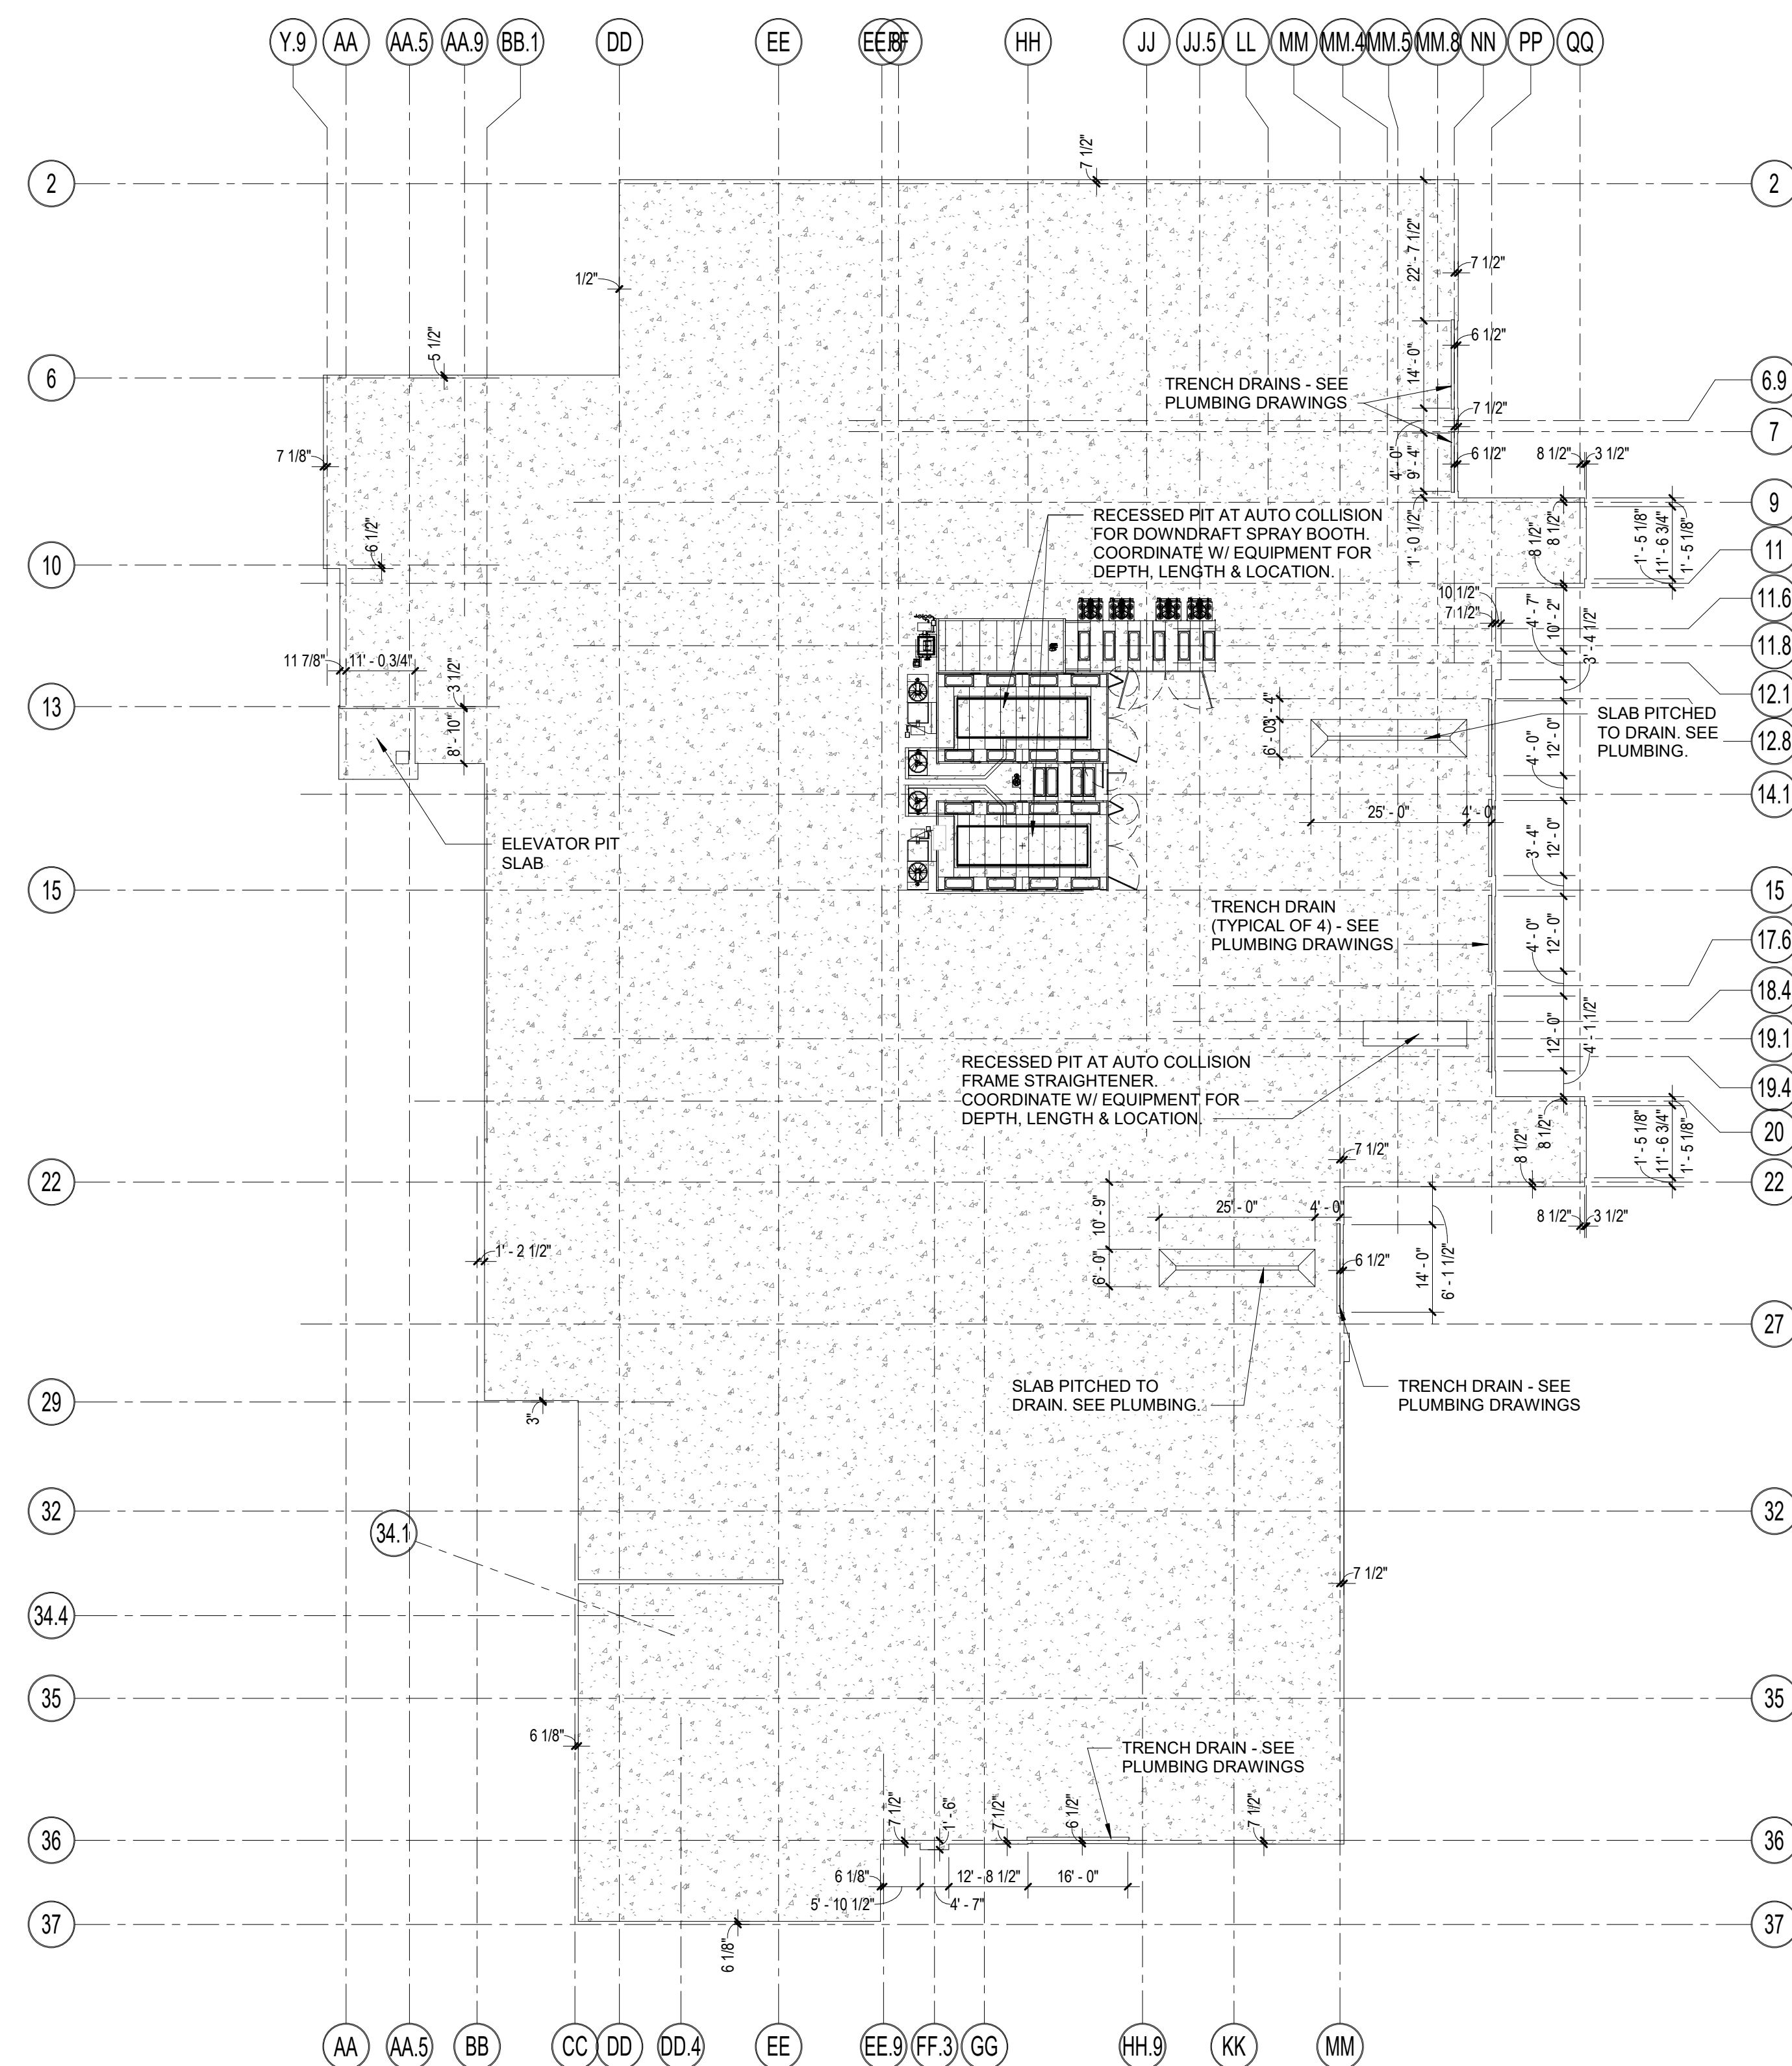


2 LOWER LEVEL EDGE OF SLAB
1" = 20'-0"

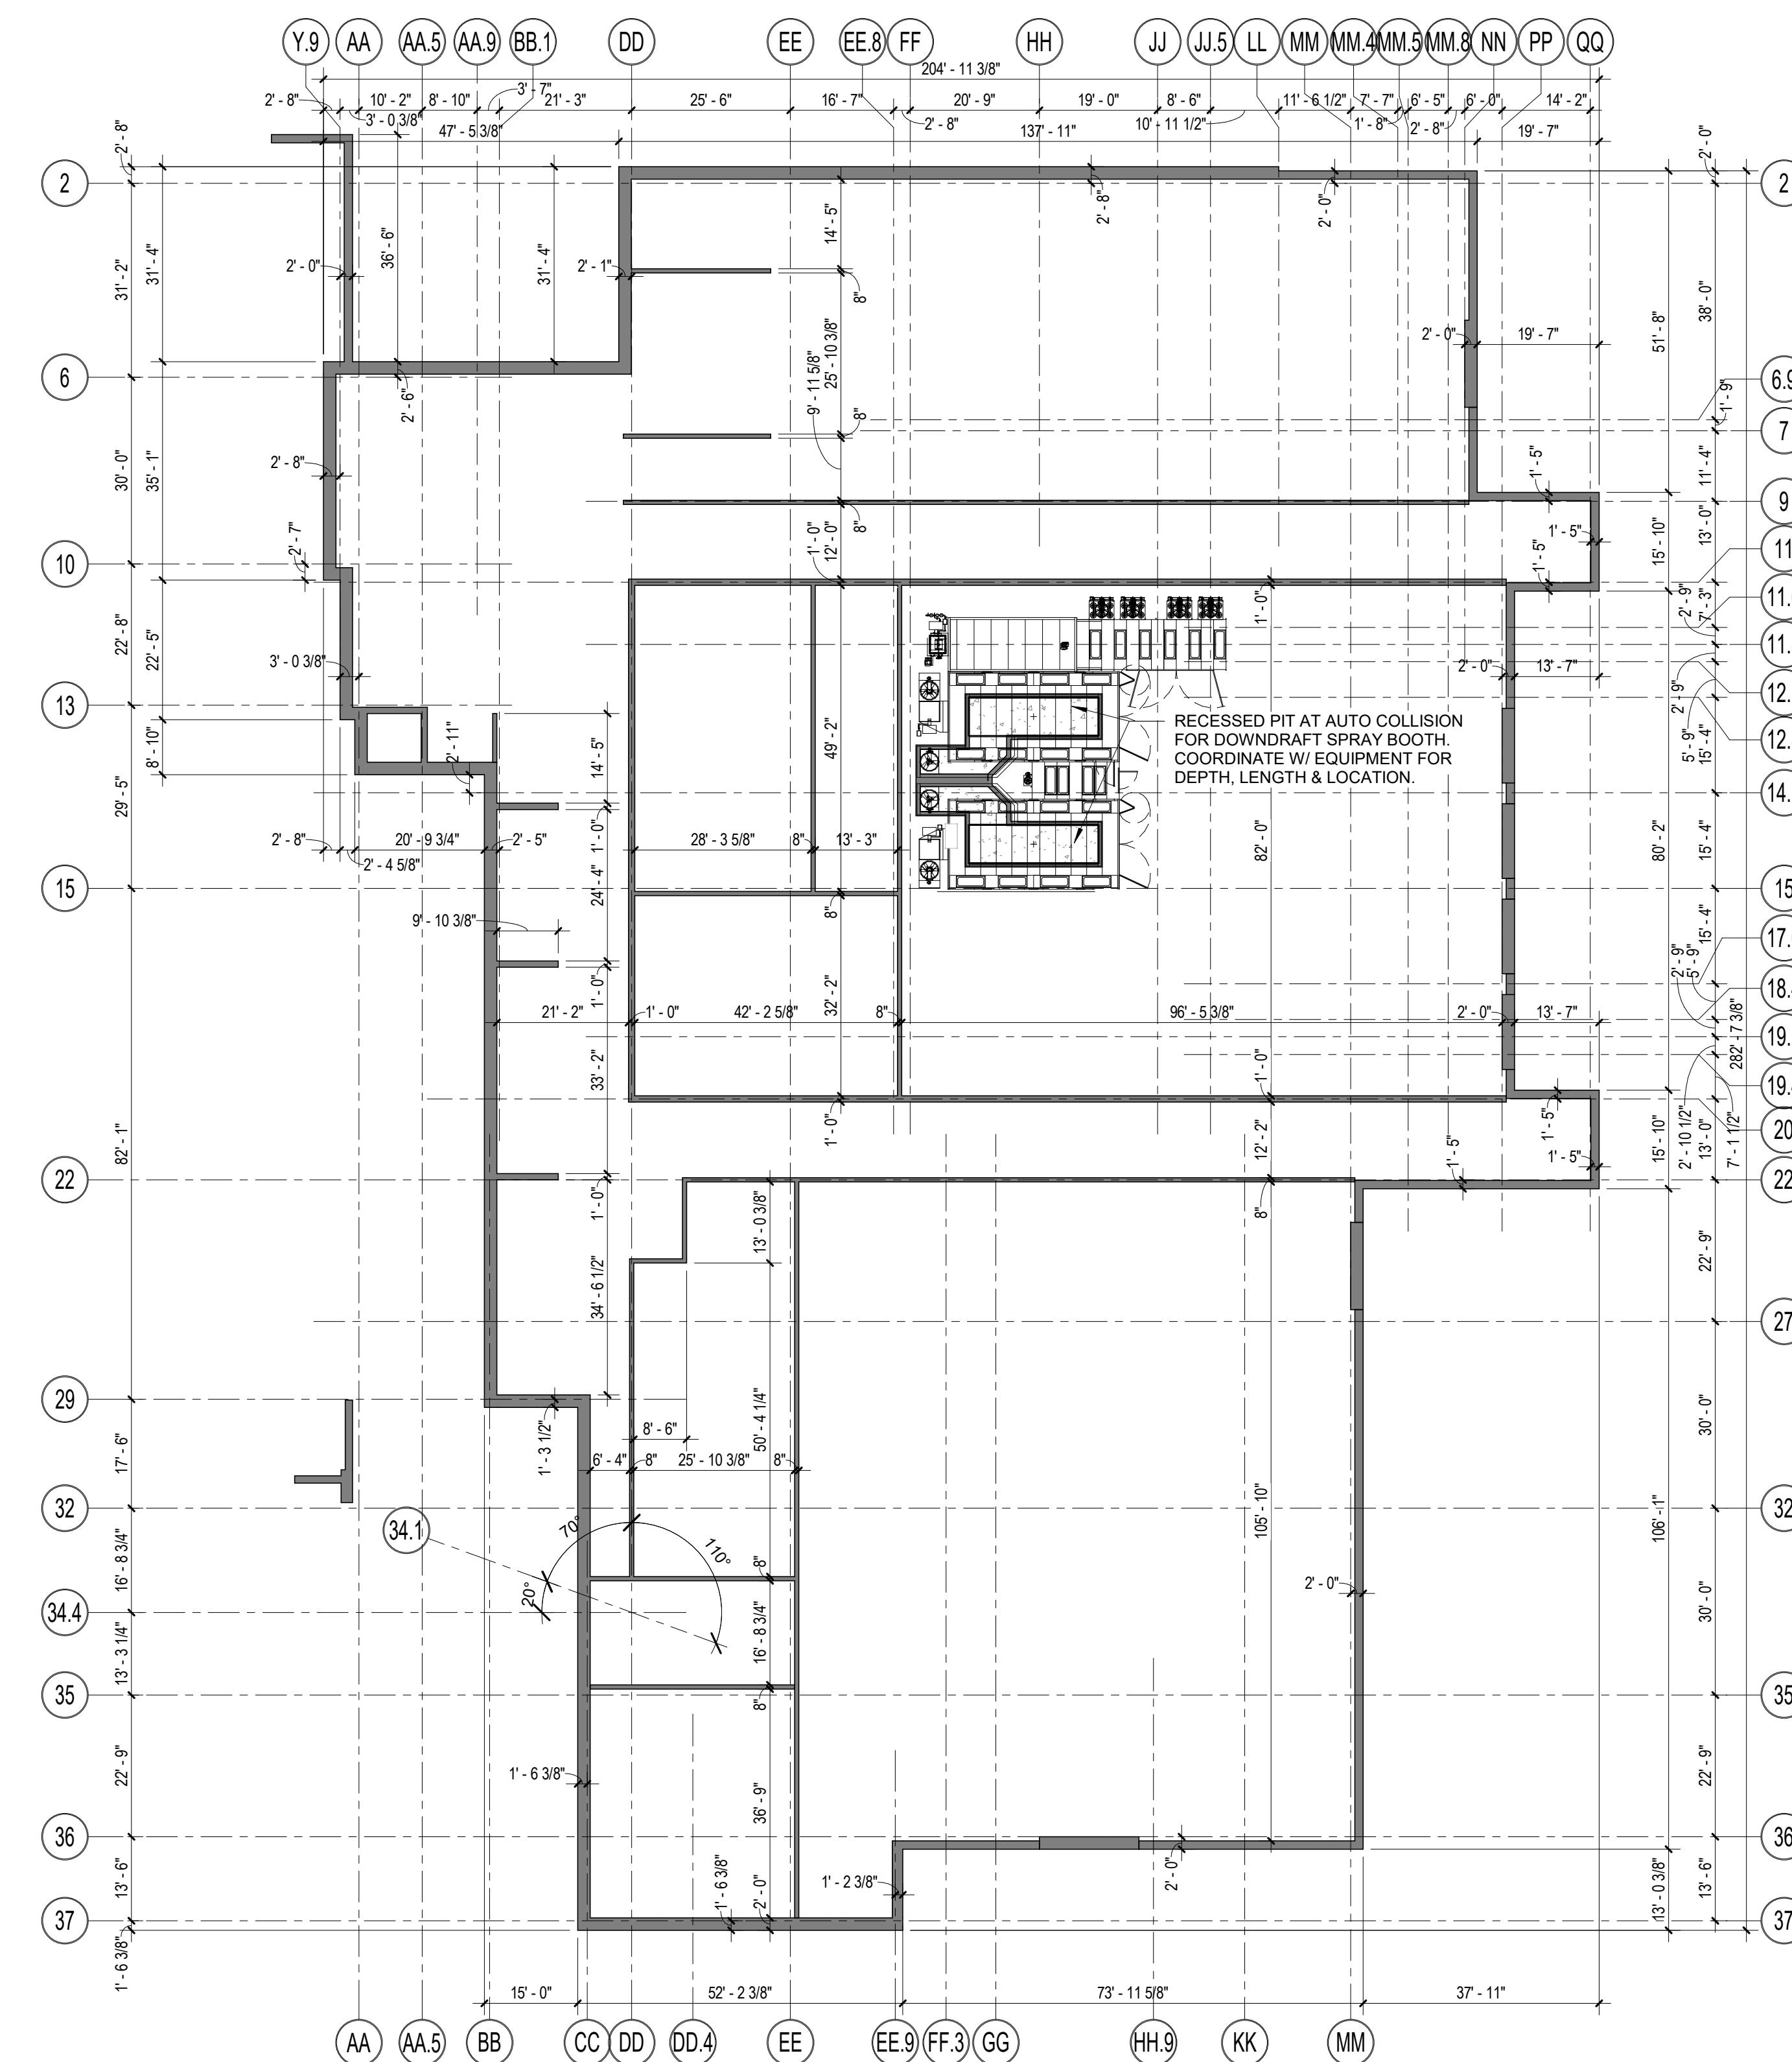


1 LOWER LEVEL BUILDING LAYOUT PLAN
1" = 20'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

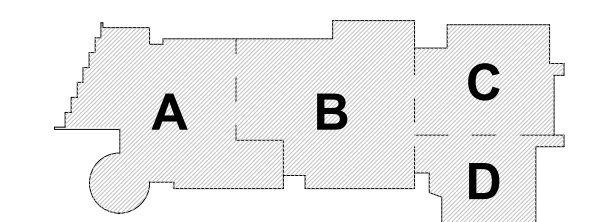

KEY PLAN

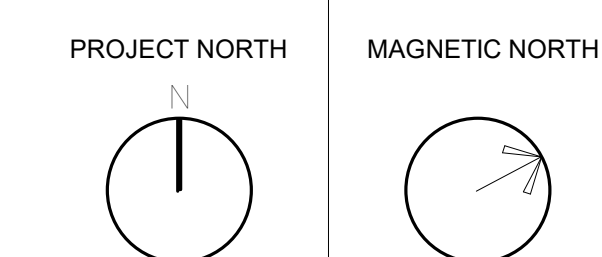


**LOWER LEVEL
BUILDING
LAYOUT & EDGE
OF SLAB PLAN**

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-11



1 FIRST FLOOR BUILDING LAYOUT PLAN
1" = 20'-0"

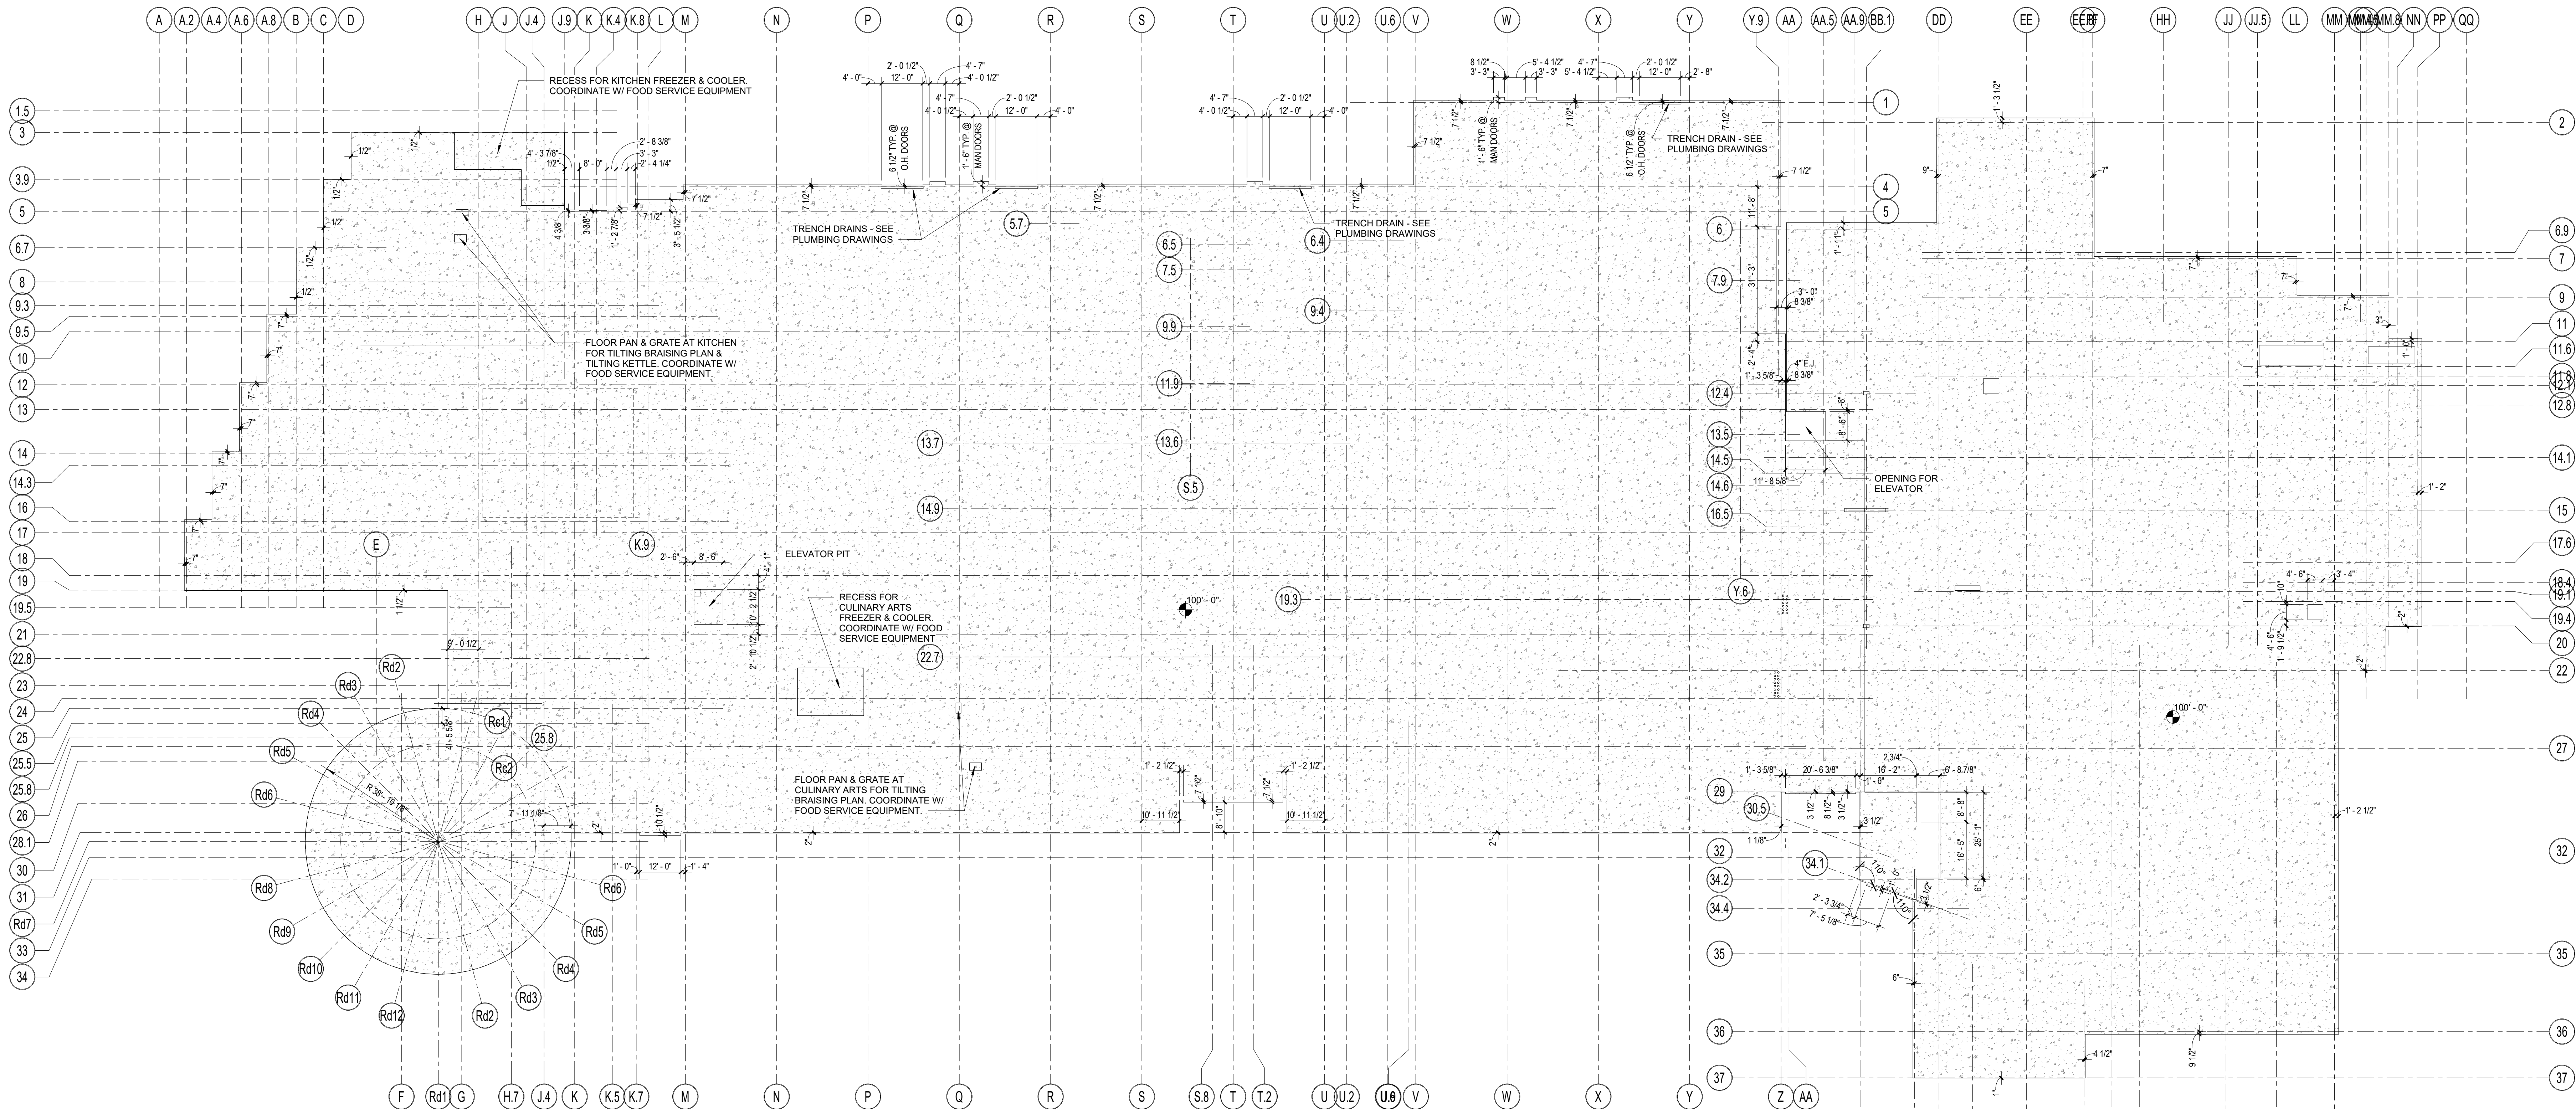


2 FIRST FLOOR EDGE OF SLAB PLAN
1" = 20'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

EDGE OF SLAB PLAN GENERAL NOTES:
1. PROVIDE ELEVATOR PIT WATERPROOFING AT ALL SLAB ON GRADE RECESSES INCLUDING, BUT NOT LIMITED TO, ELEVATOR PIT, TRENCH DRAINS, GREASE TRAPS, ETC. ...

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

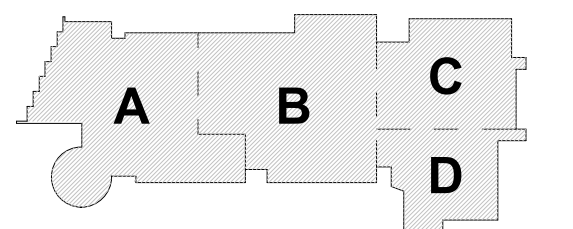

PROJECT NORTH
MAGNETIC NORTH

**FIRST FLOOR
BUILDING
LAYOUT & EDGE
OF SLAB PLAN**

Scale: As Indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-12


DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.dra.com


260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

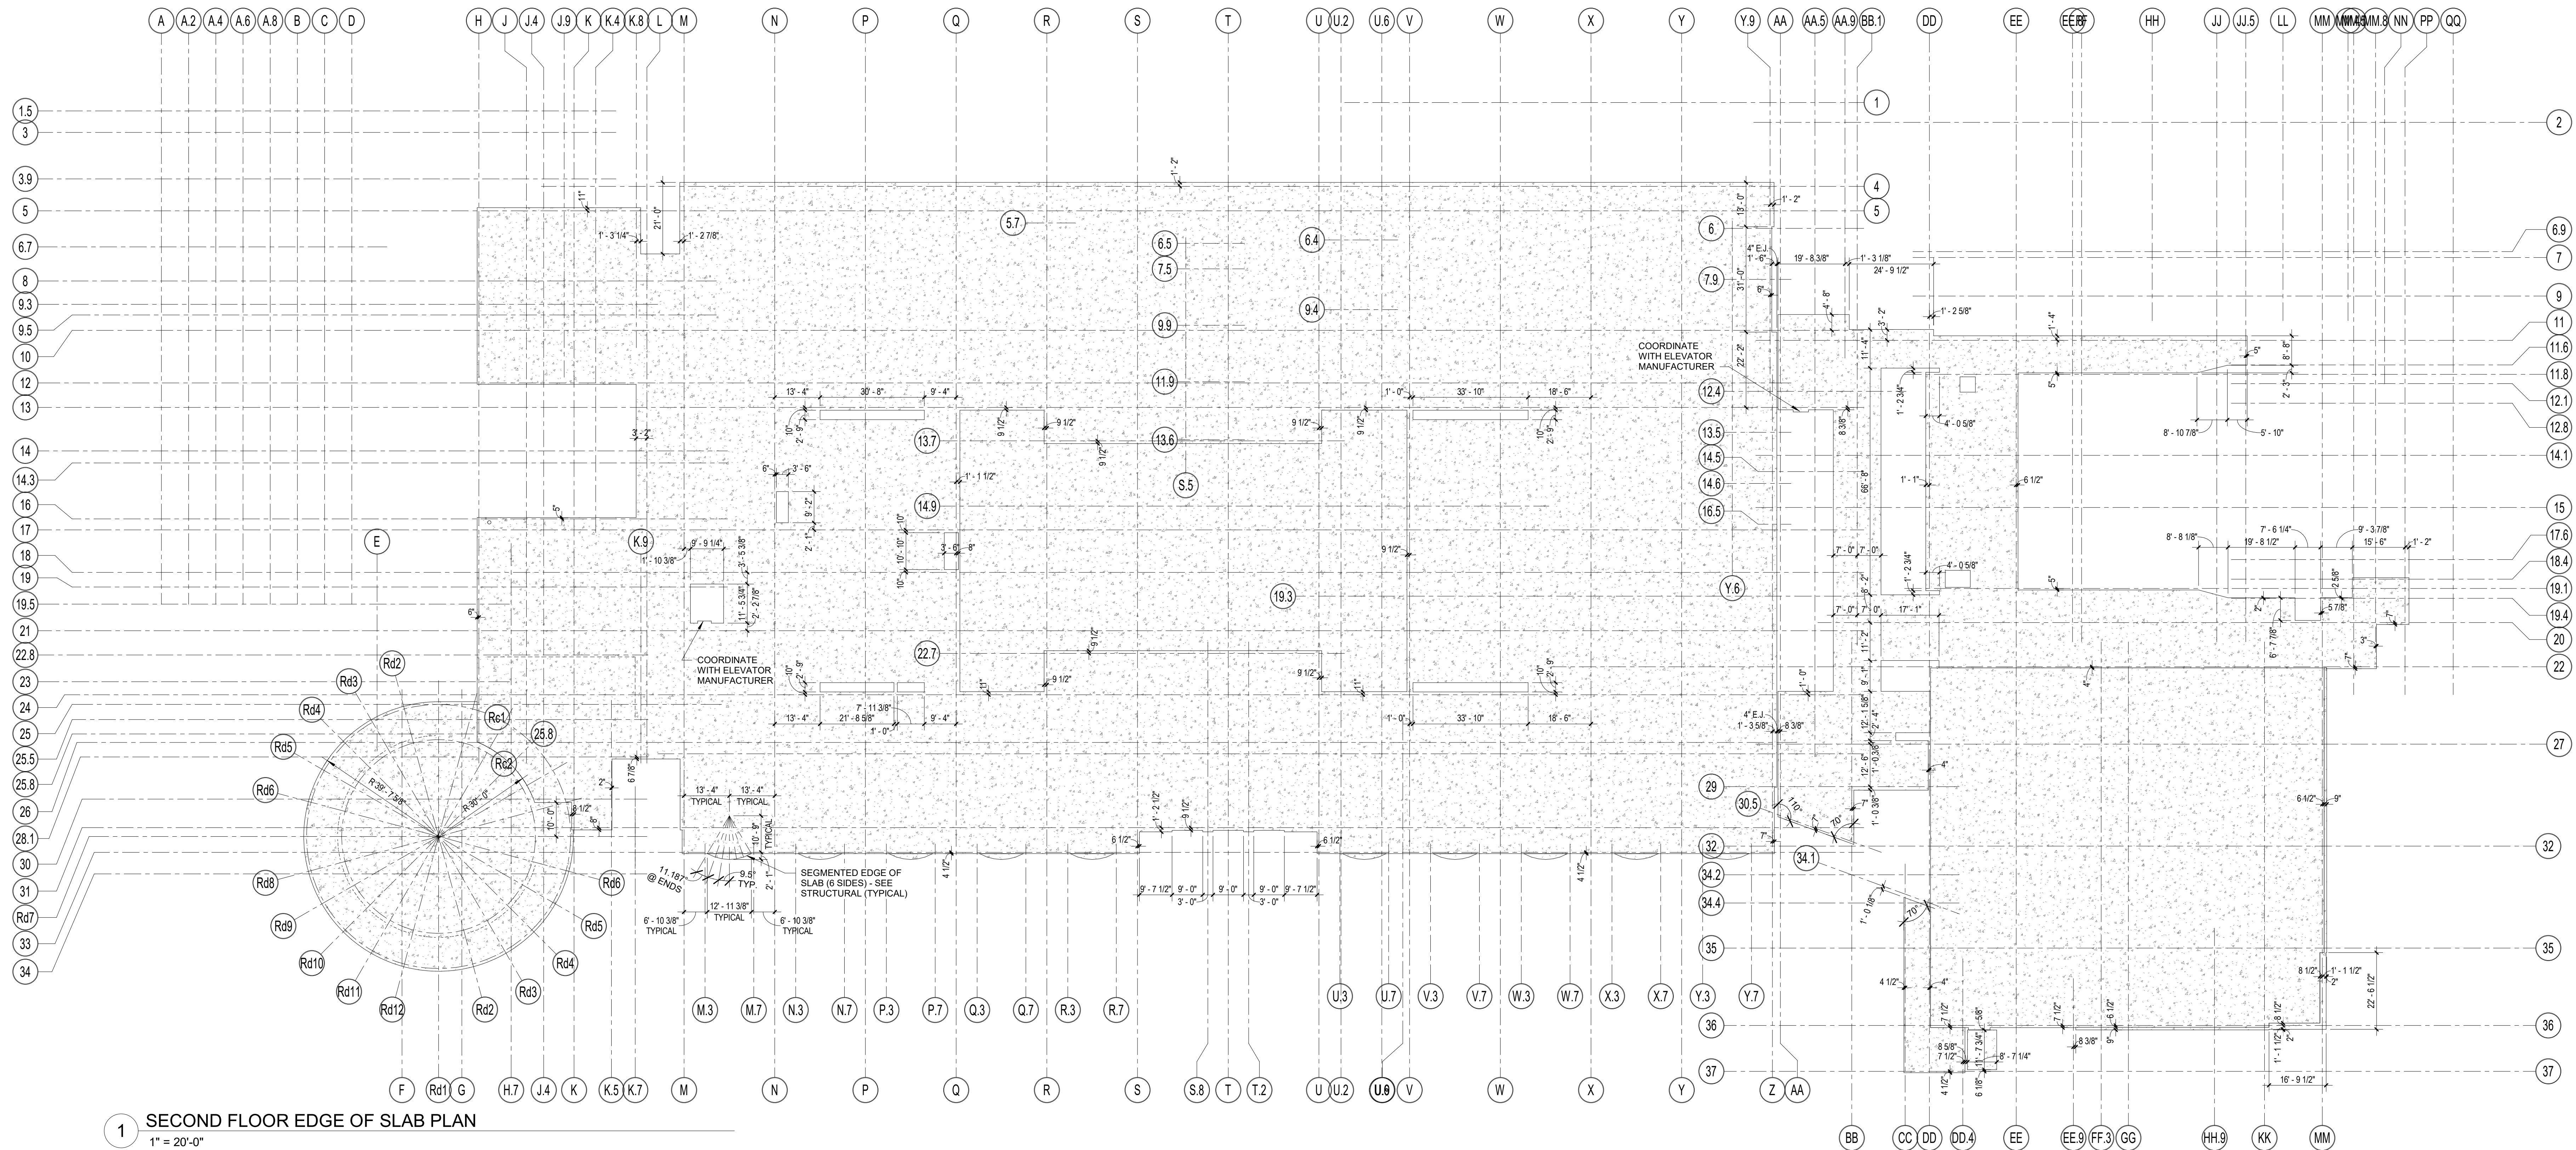


1 SECOND FLOOR EDGE OF SLAB PLAN
1" = 20'-0"

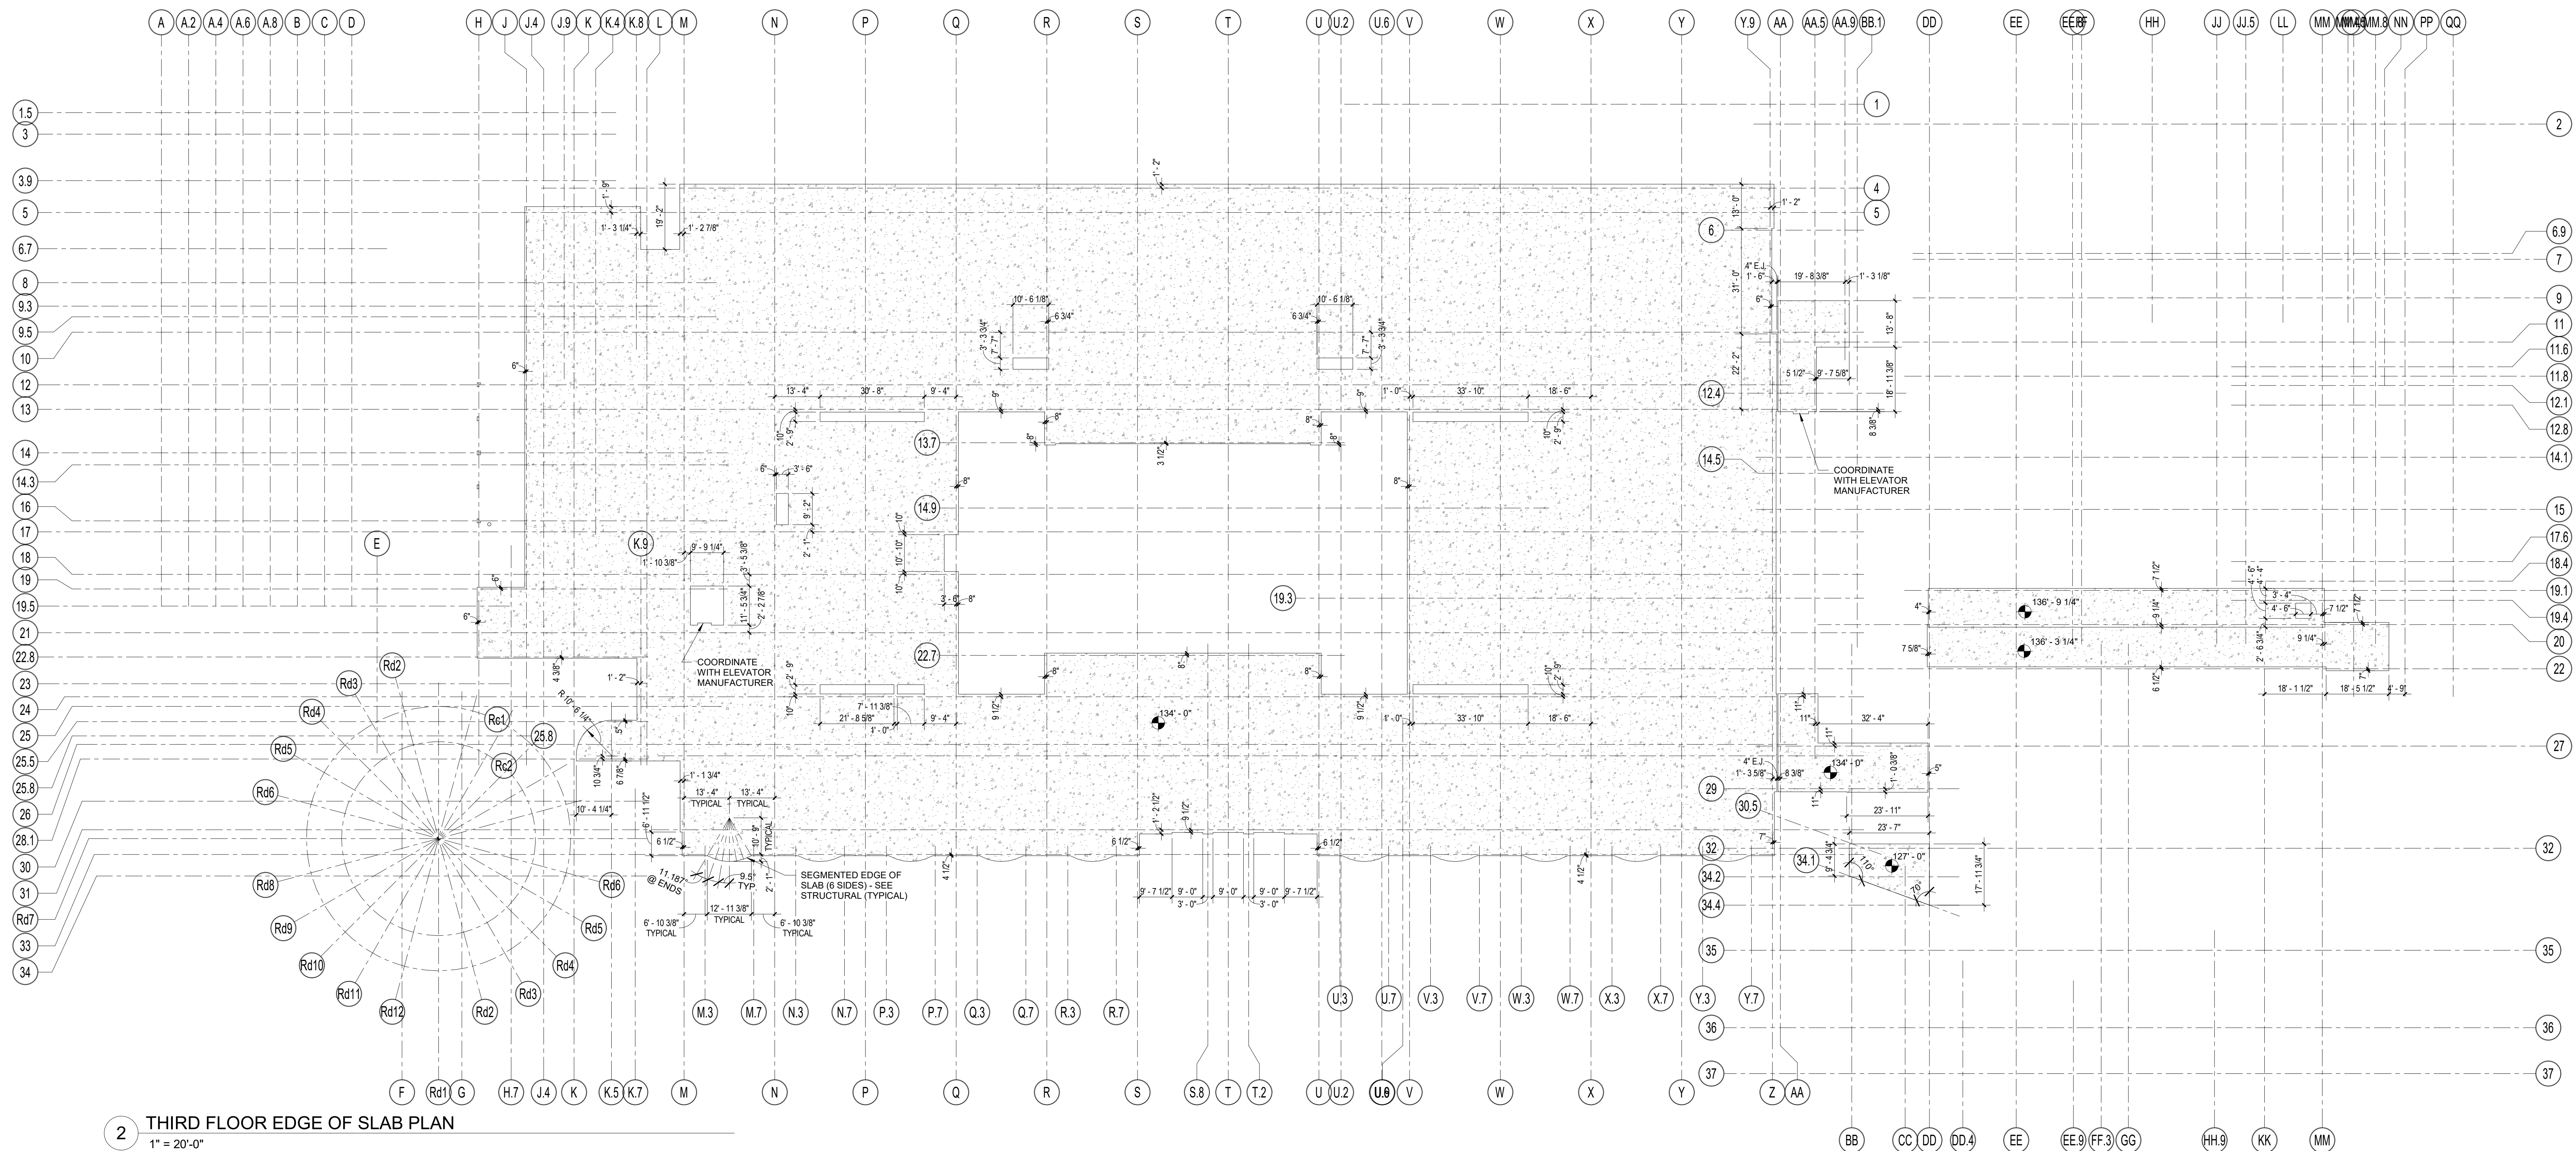


2 THIRD FLOOR EDGE OF SLAB PLAN
1" = 20'-0"

MSBA 90% CD
SUBMISSION
May 12TH, 2023

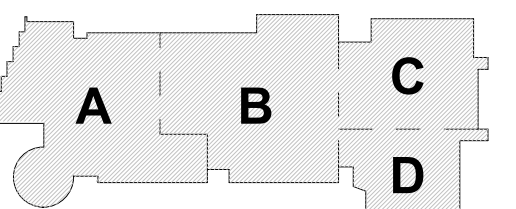


PROJECT NORTH
MAGNETIC NORTH

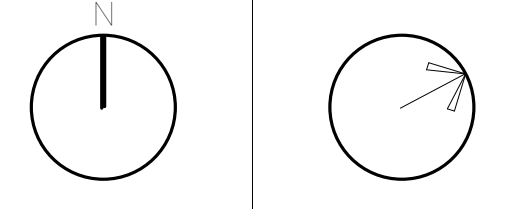

**SECOND &
THIRD FLOOR
EDGE OF SLAB
PLANS**

Scale: 1" = 20'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-13

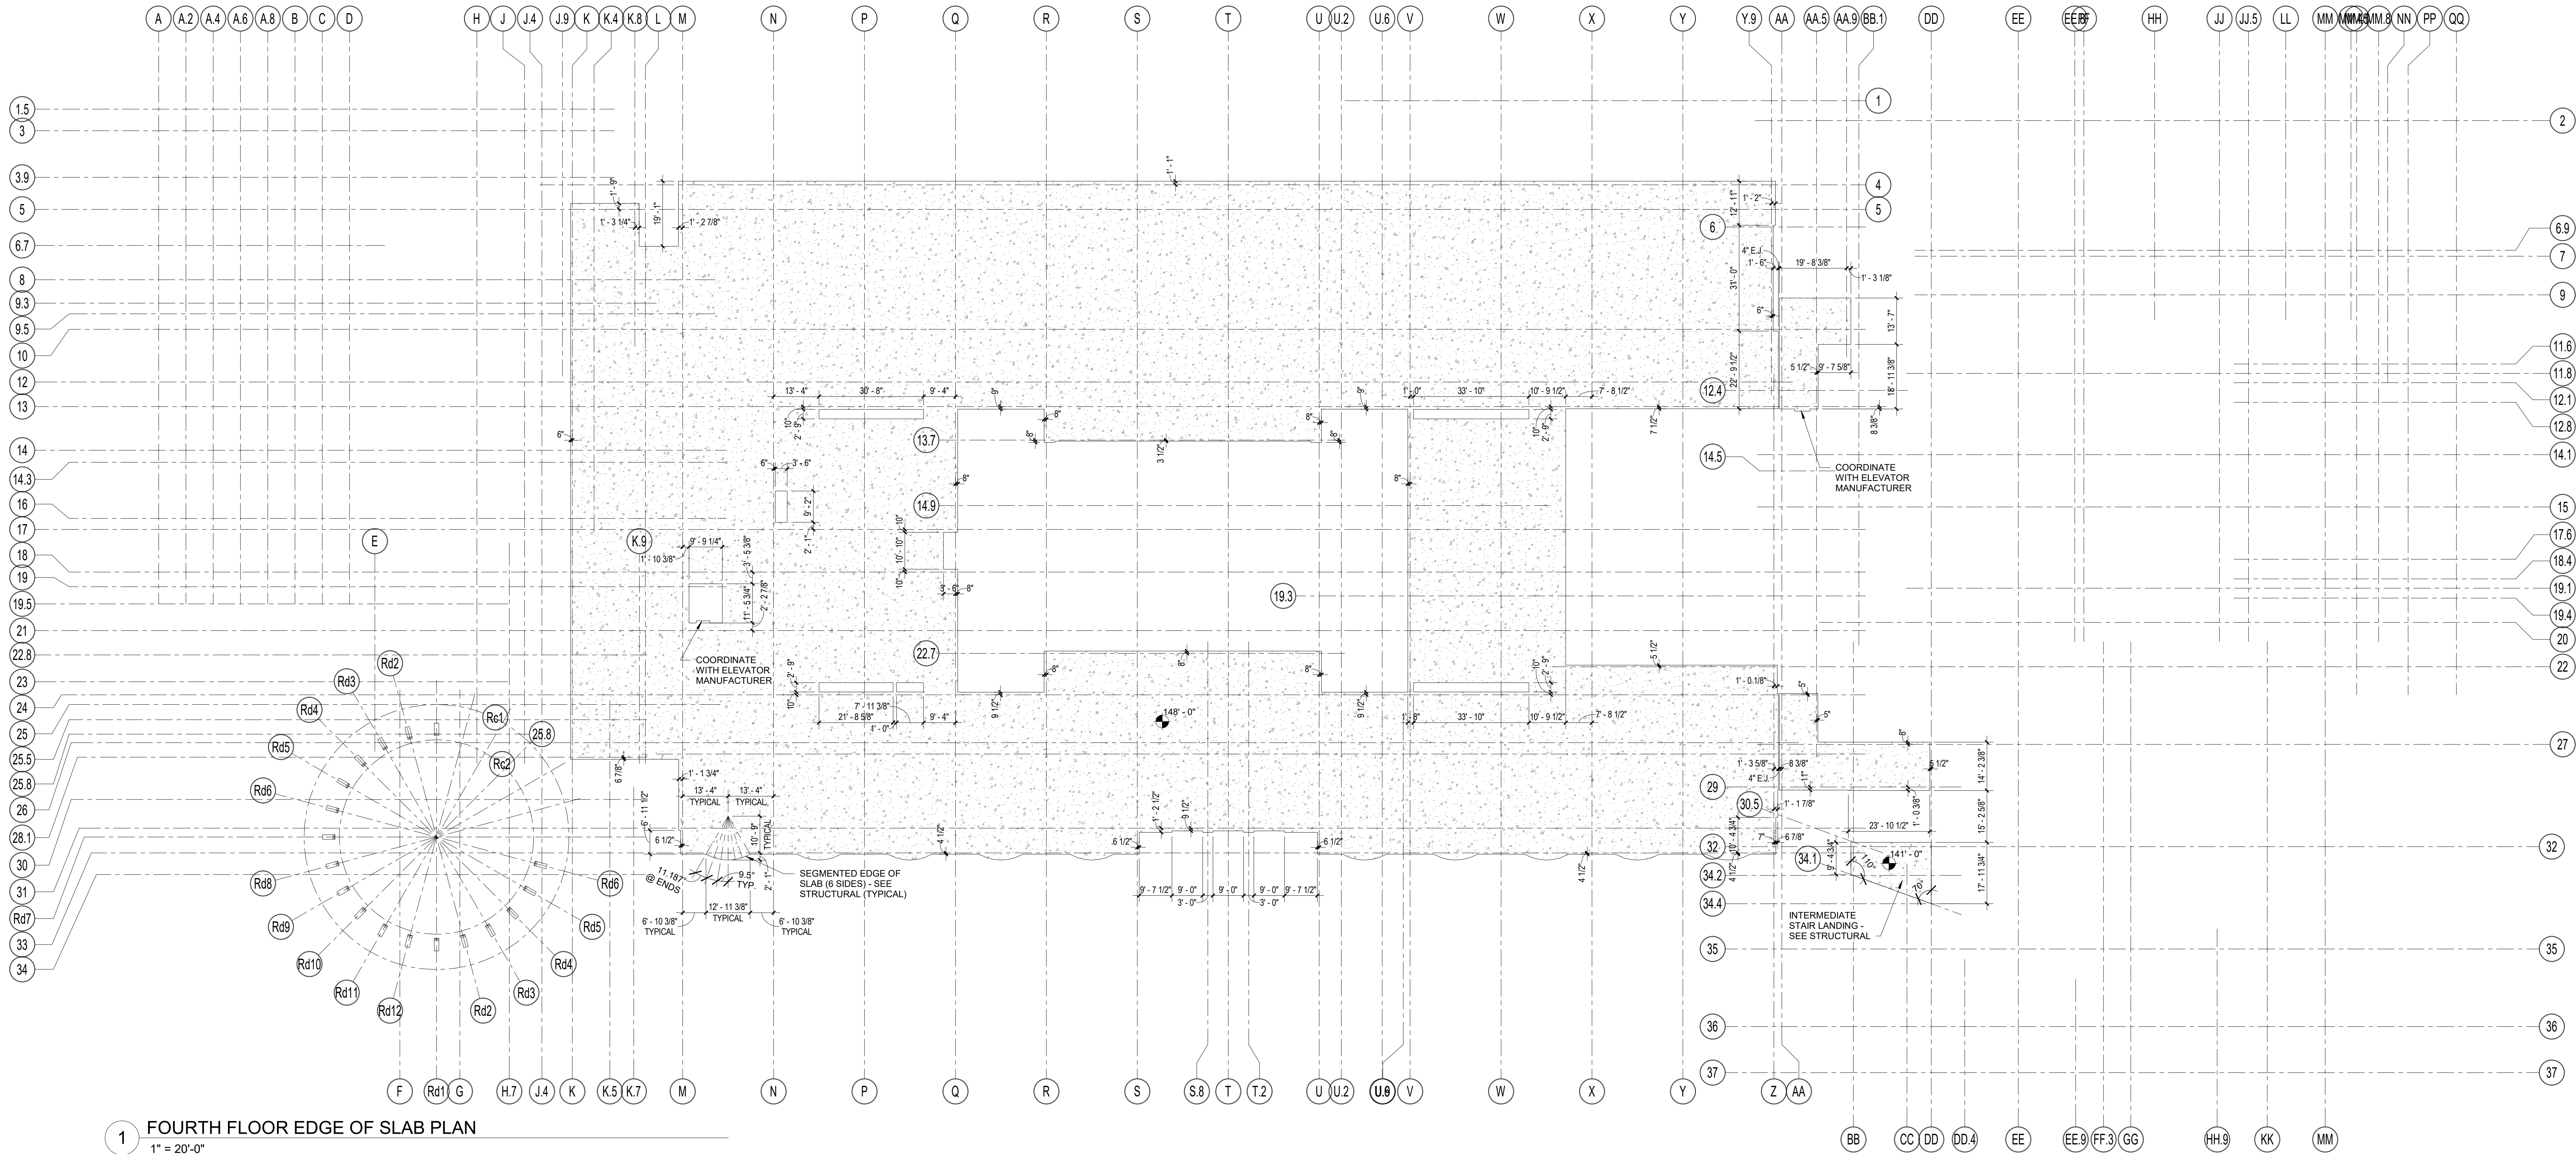

1 FOURTH FLOOR EDGE OF SLAB PLAN
1" = 20'-0"



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.drainc.com


260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

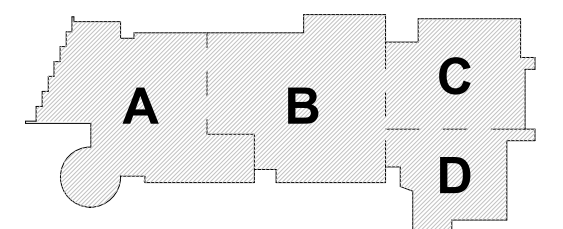


KEY PLAN

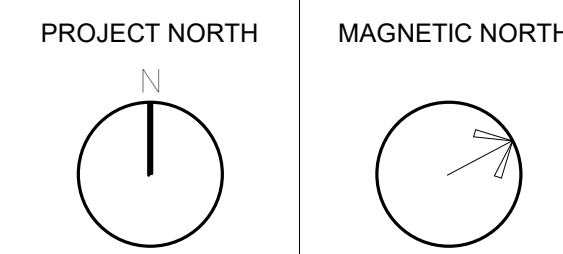

**FOURTH FLOOR
EDGE OF SLAB
PLAN**

Scale: 1" = 20'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-0-14

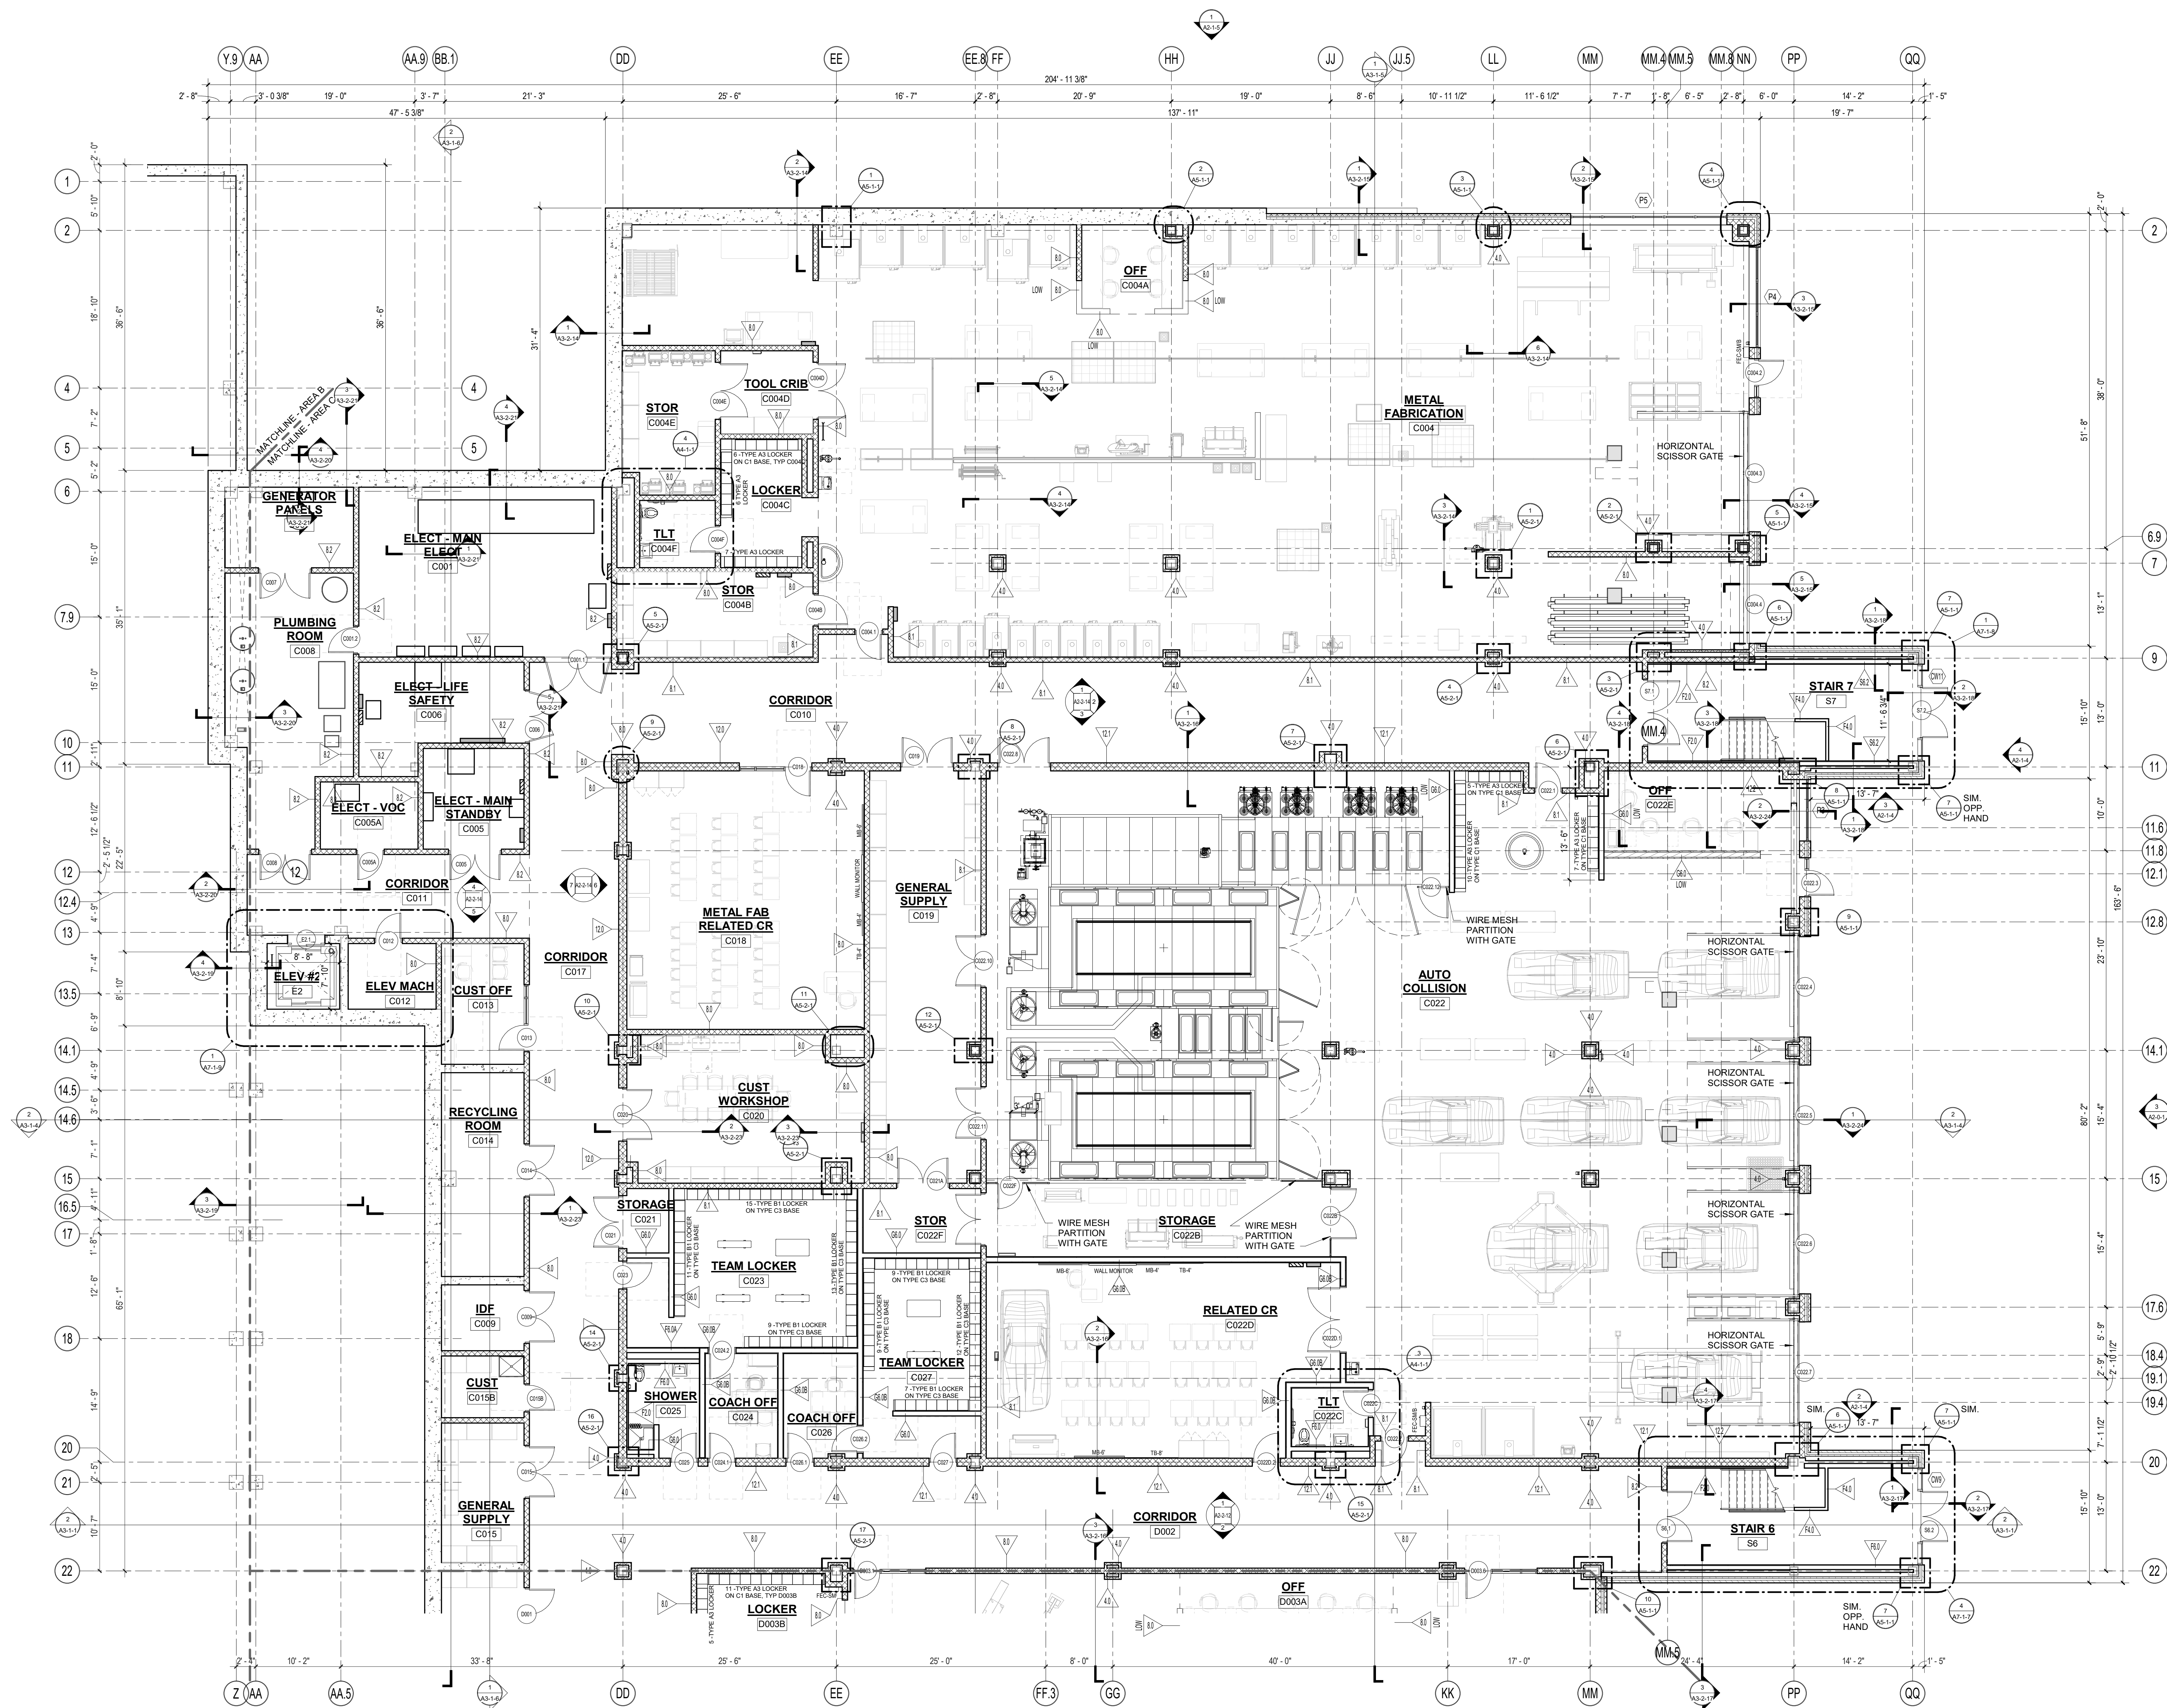

1 LOWER LEVEL PLAN - AREA C
1/8" = 1'-0"

DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1702
www.dra.com

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. TO SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.00' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATORS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
9. FOR CONTROL JOINT LOCATIONS AT INTERIOR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILET SHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.


NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

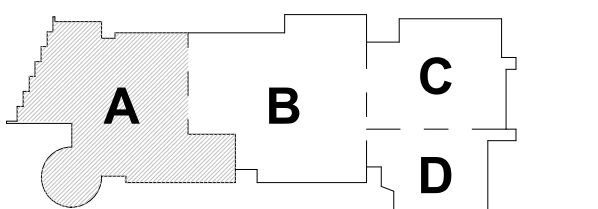

KEY PLAN
PROJECT NORTH
MAGNETIC NORTH

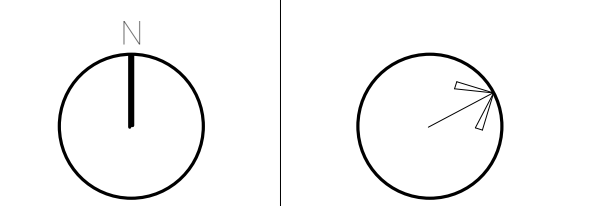

LOWER LEVEL FLOOR PLAN - AREA C

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-0C

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.dra.com

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
9. FOR CONTROL JOINT LOCATIONS AT INTERIOR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
10. FOR CONTROL JOINT LOCATION AT GWR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

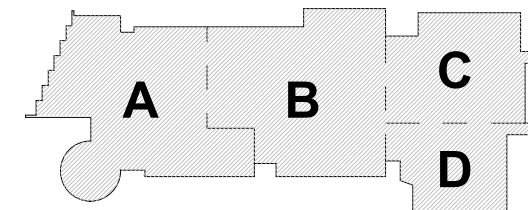

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

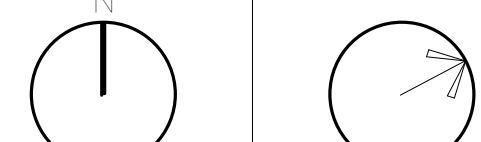

LOWER LEVEL FLOOR PLAN - AREA D

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-0D

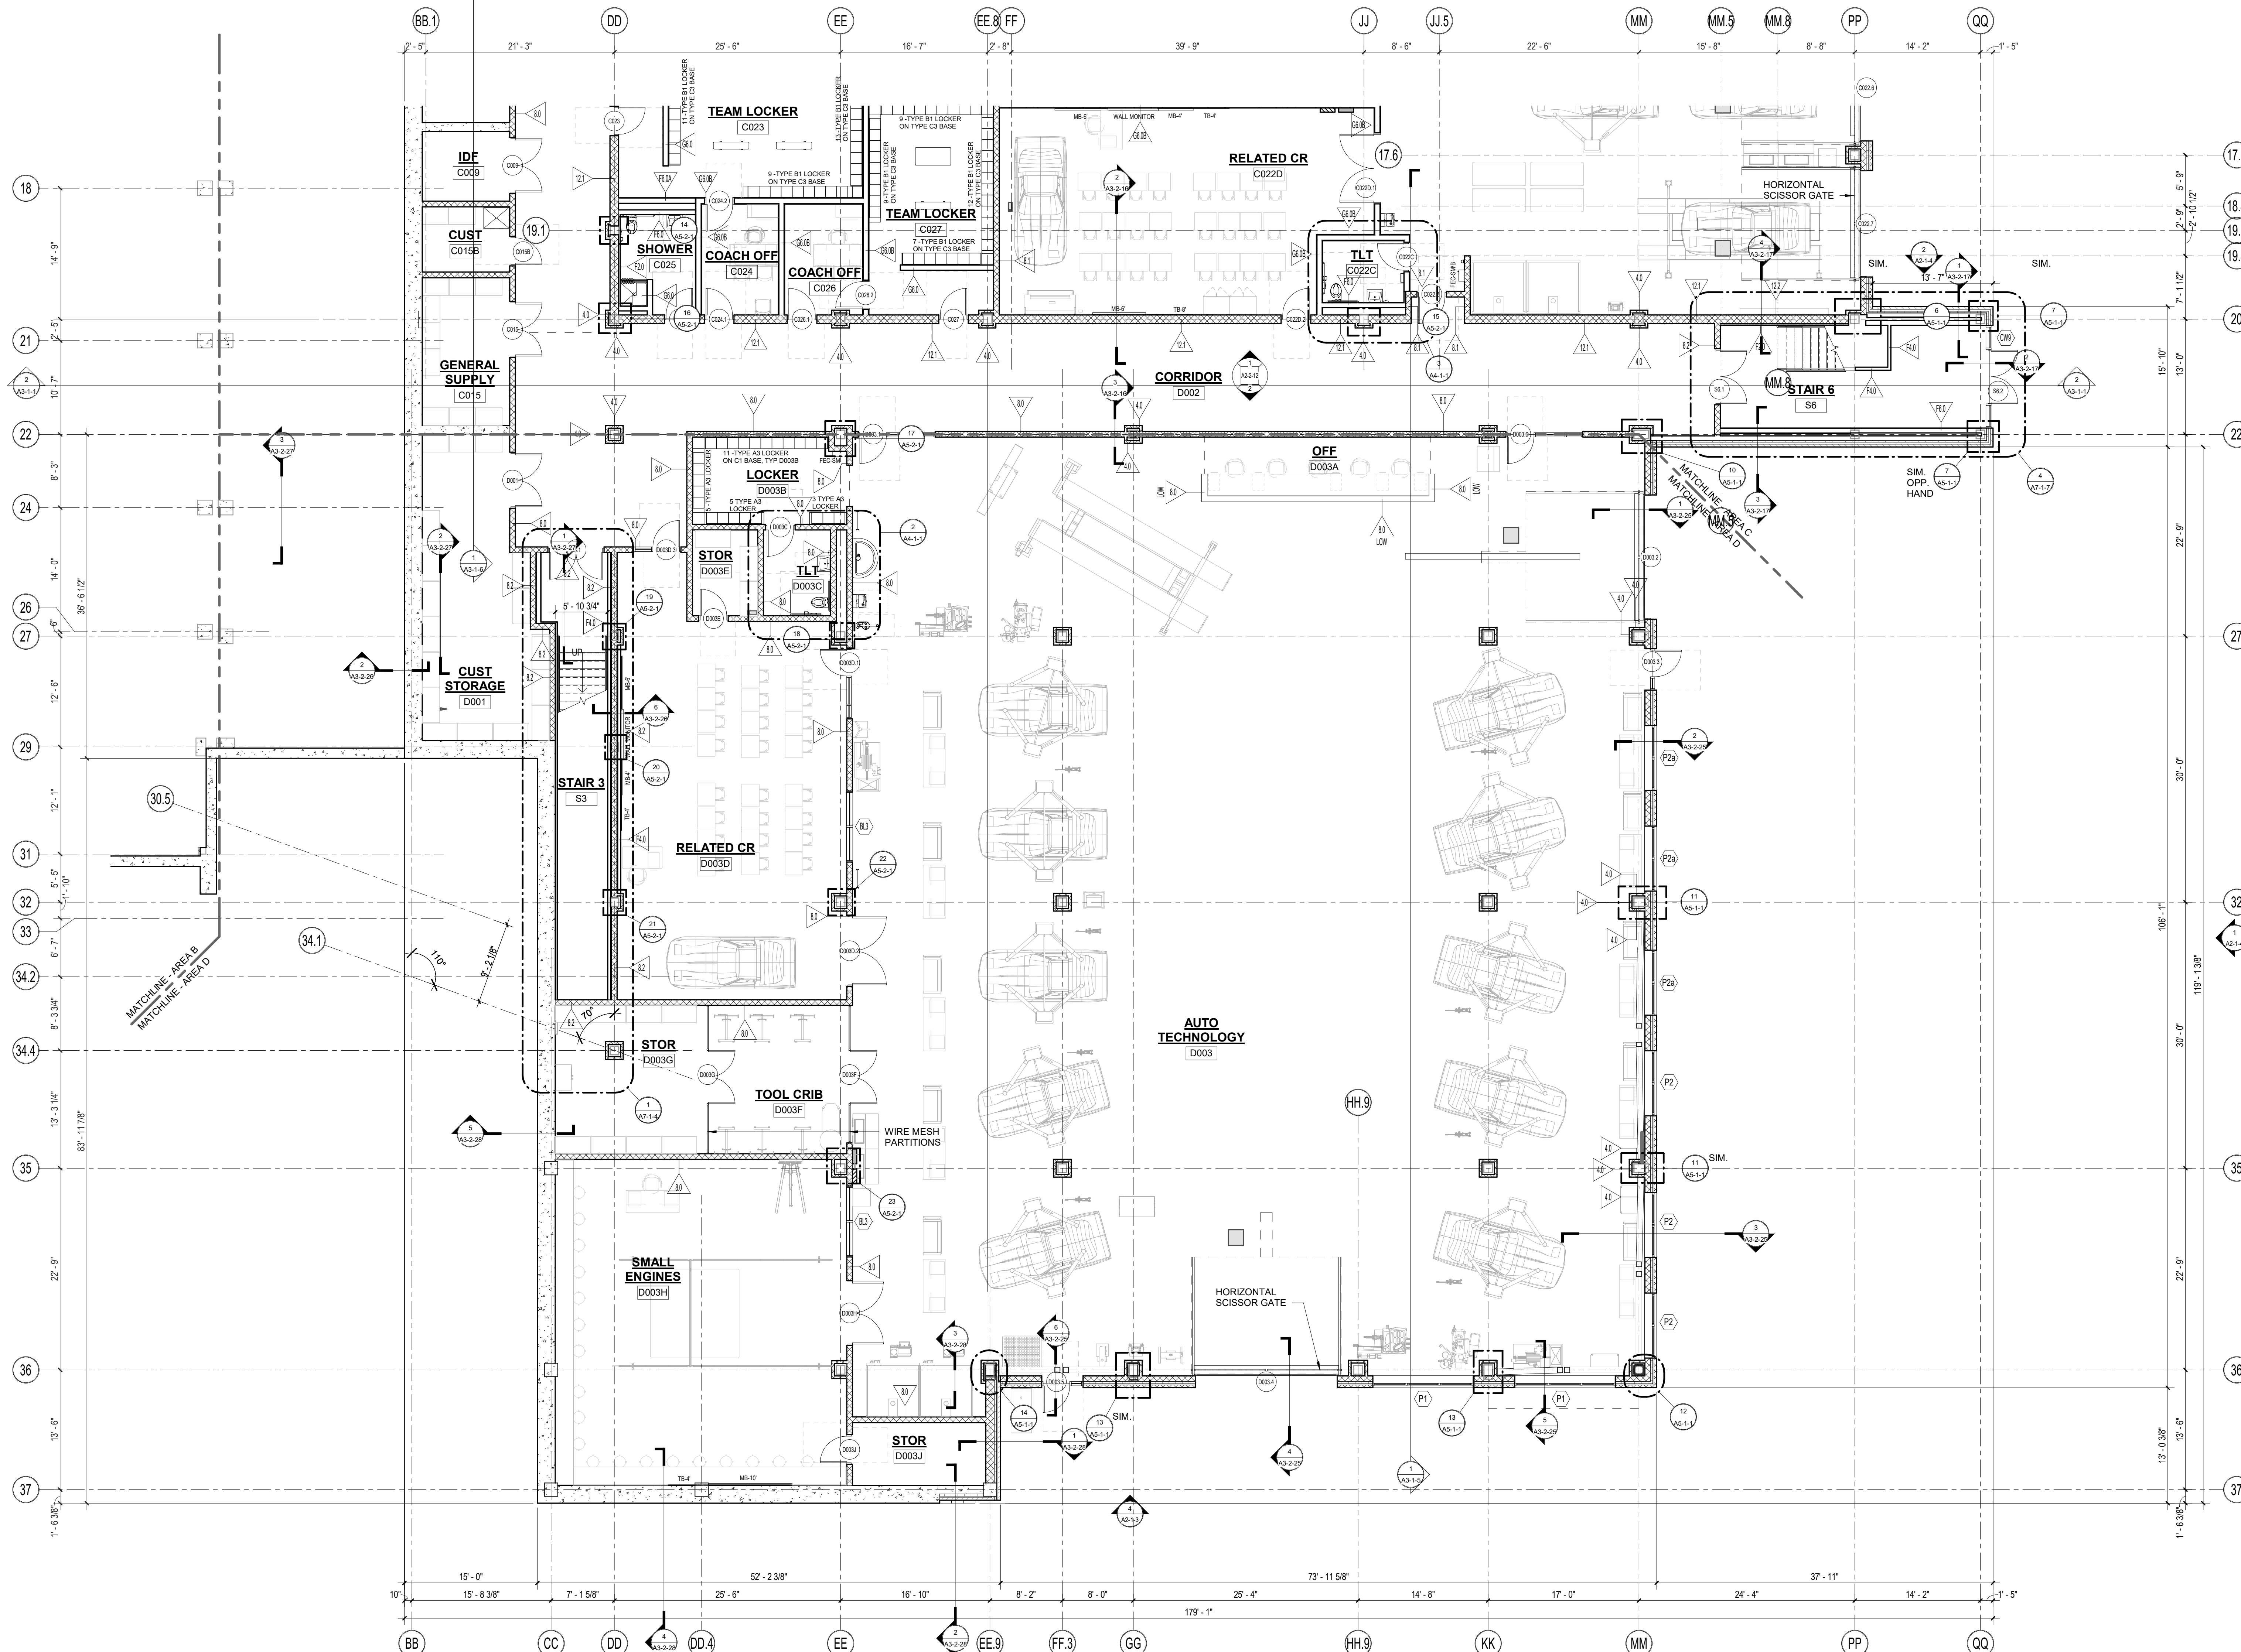

1 LOWER LEVEL PLAN - AREA D
1/8" = 1'-0"

Drummeys Rosane Anderson, Inc.	
225 Oakland Road Studio 205 South Windsor, CT 06074	260 Charles Street Studio 300 Waltham, MA 02453

Planning | Architecture | Interior Design
Tel: 617.954.1700
www.draws.com

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.50' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0"

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS & METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAIL ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENING TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.

13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND
GWB (CONCEALED FROM VIEW) AS REQUIRED
FOR MOUNTING OF THE MARKERBOARDS,
TACKBOARDS, ACOUSTICAL PANELS, AND
MARKER WALLS OCCURRING ON METAL STUD
WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILET/SHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.

17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR"


18. AT WALL LOCATIONS WHERE PARTITIONS WITH

MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATION

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION



May 12TH, 2023

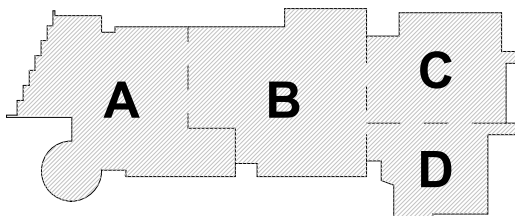

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



**LOWER LEVEL
MEZZANINE
PLAN - AREA C**

Scale: 1/8" = 1'-0"

Job No. 30302


Drawn By: DR

Date: May 12TH 2023

Volume 3 of 4


A1-1-0MC

1 LOWER LEVEL MEZZANINE PLAN - AREA C
1/8" = 1'-0"

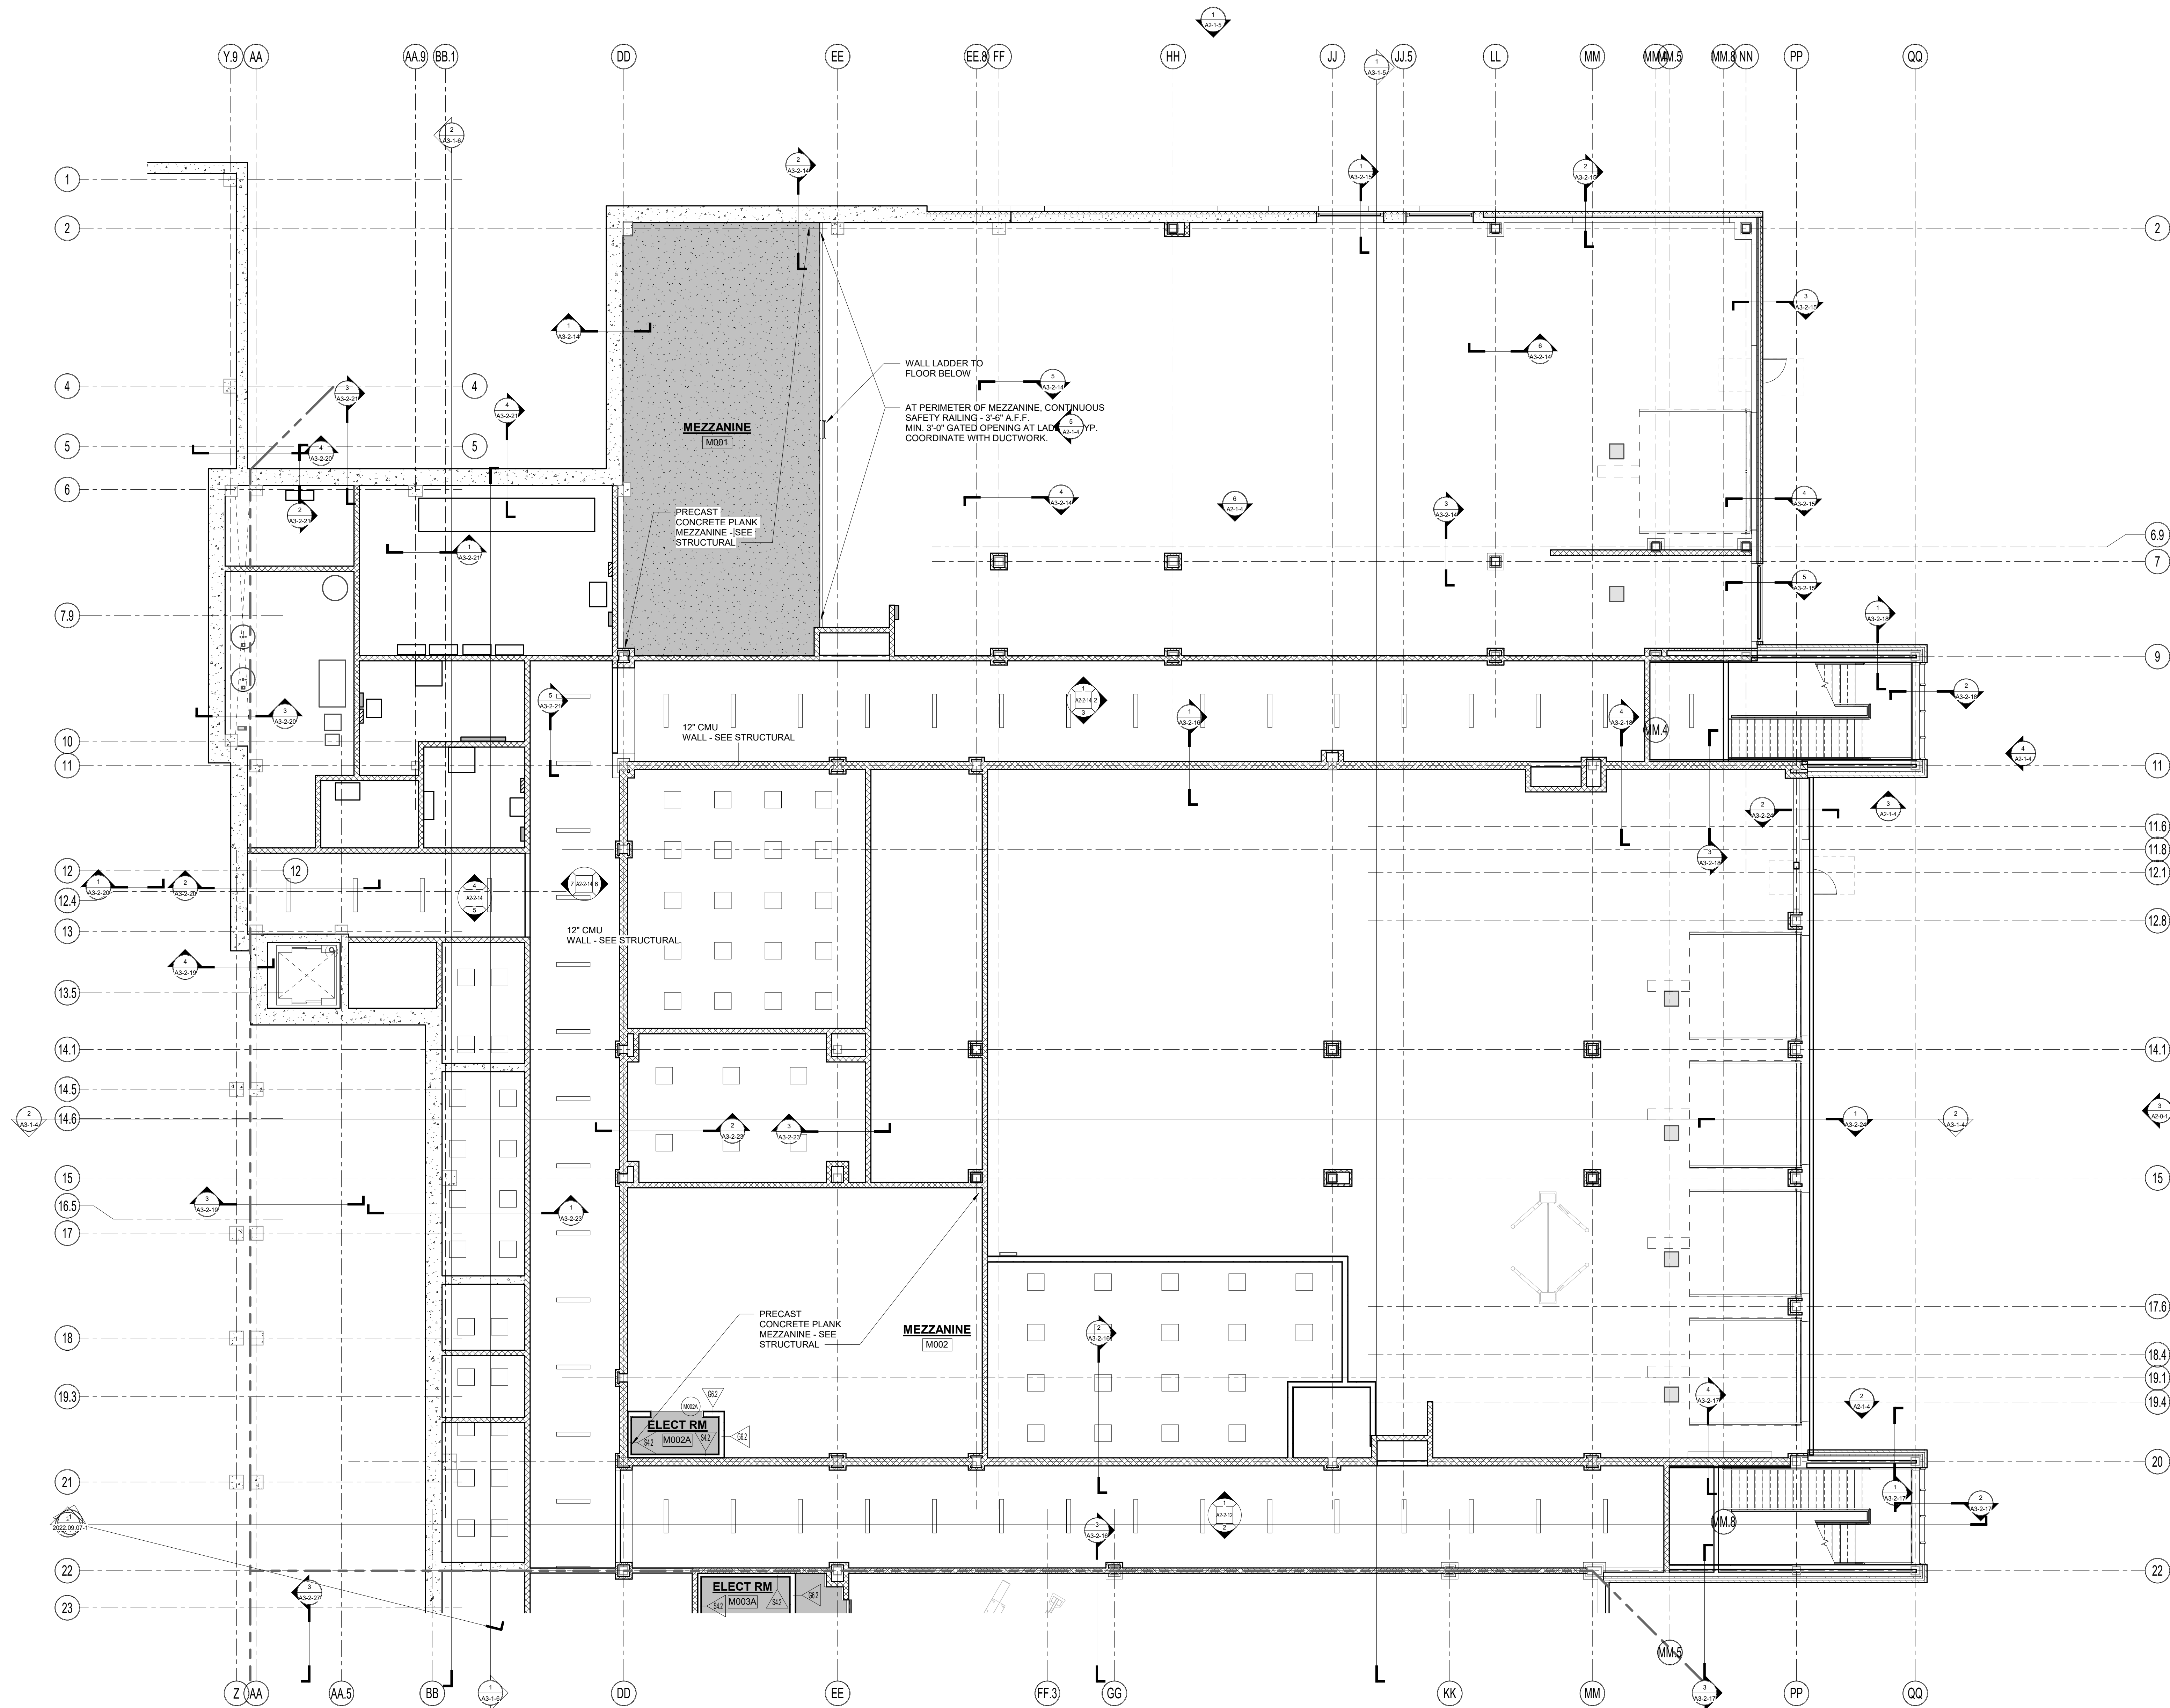

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

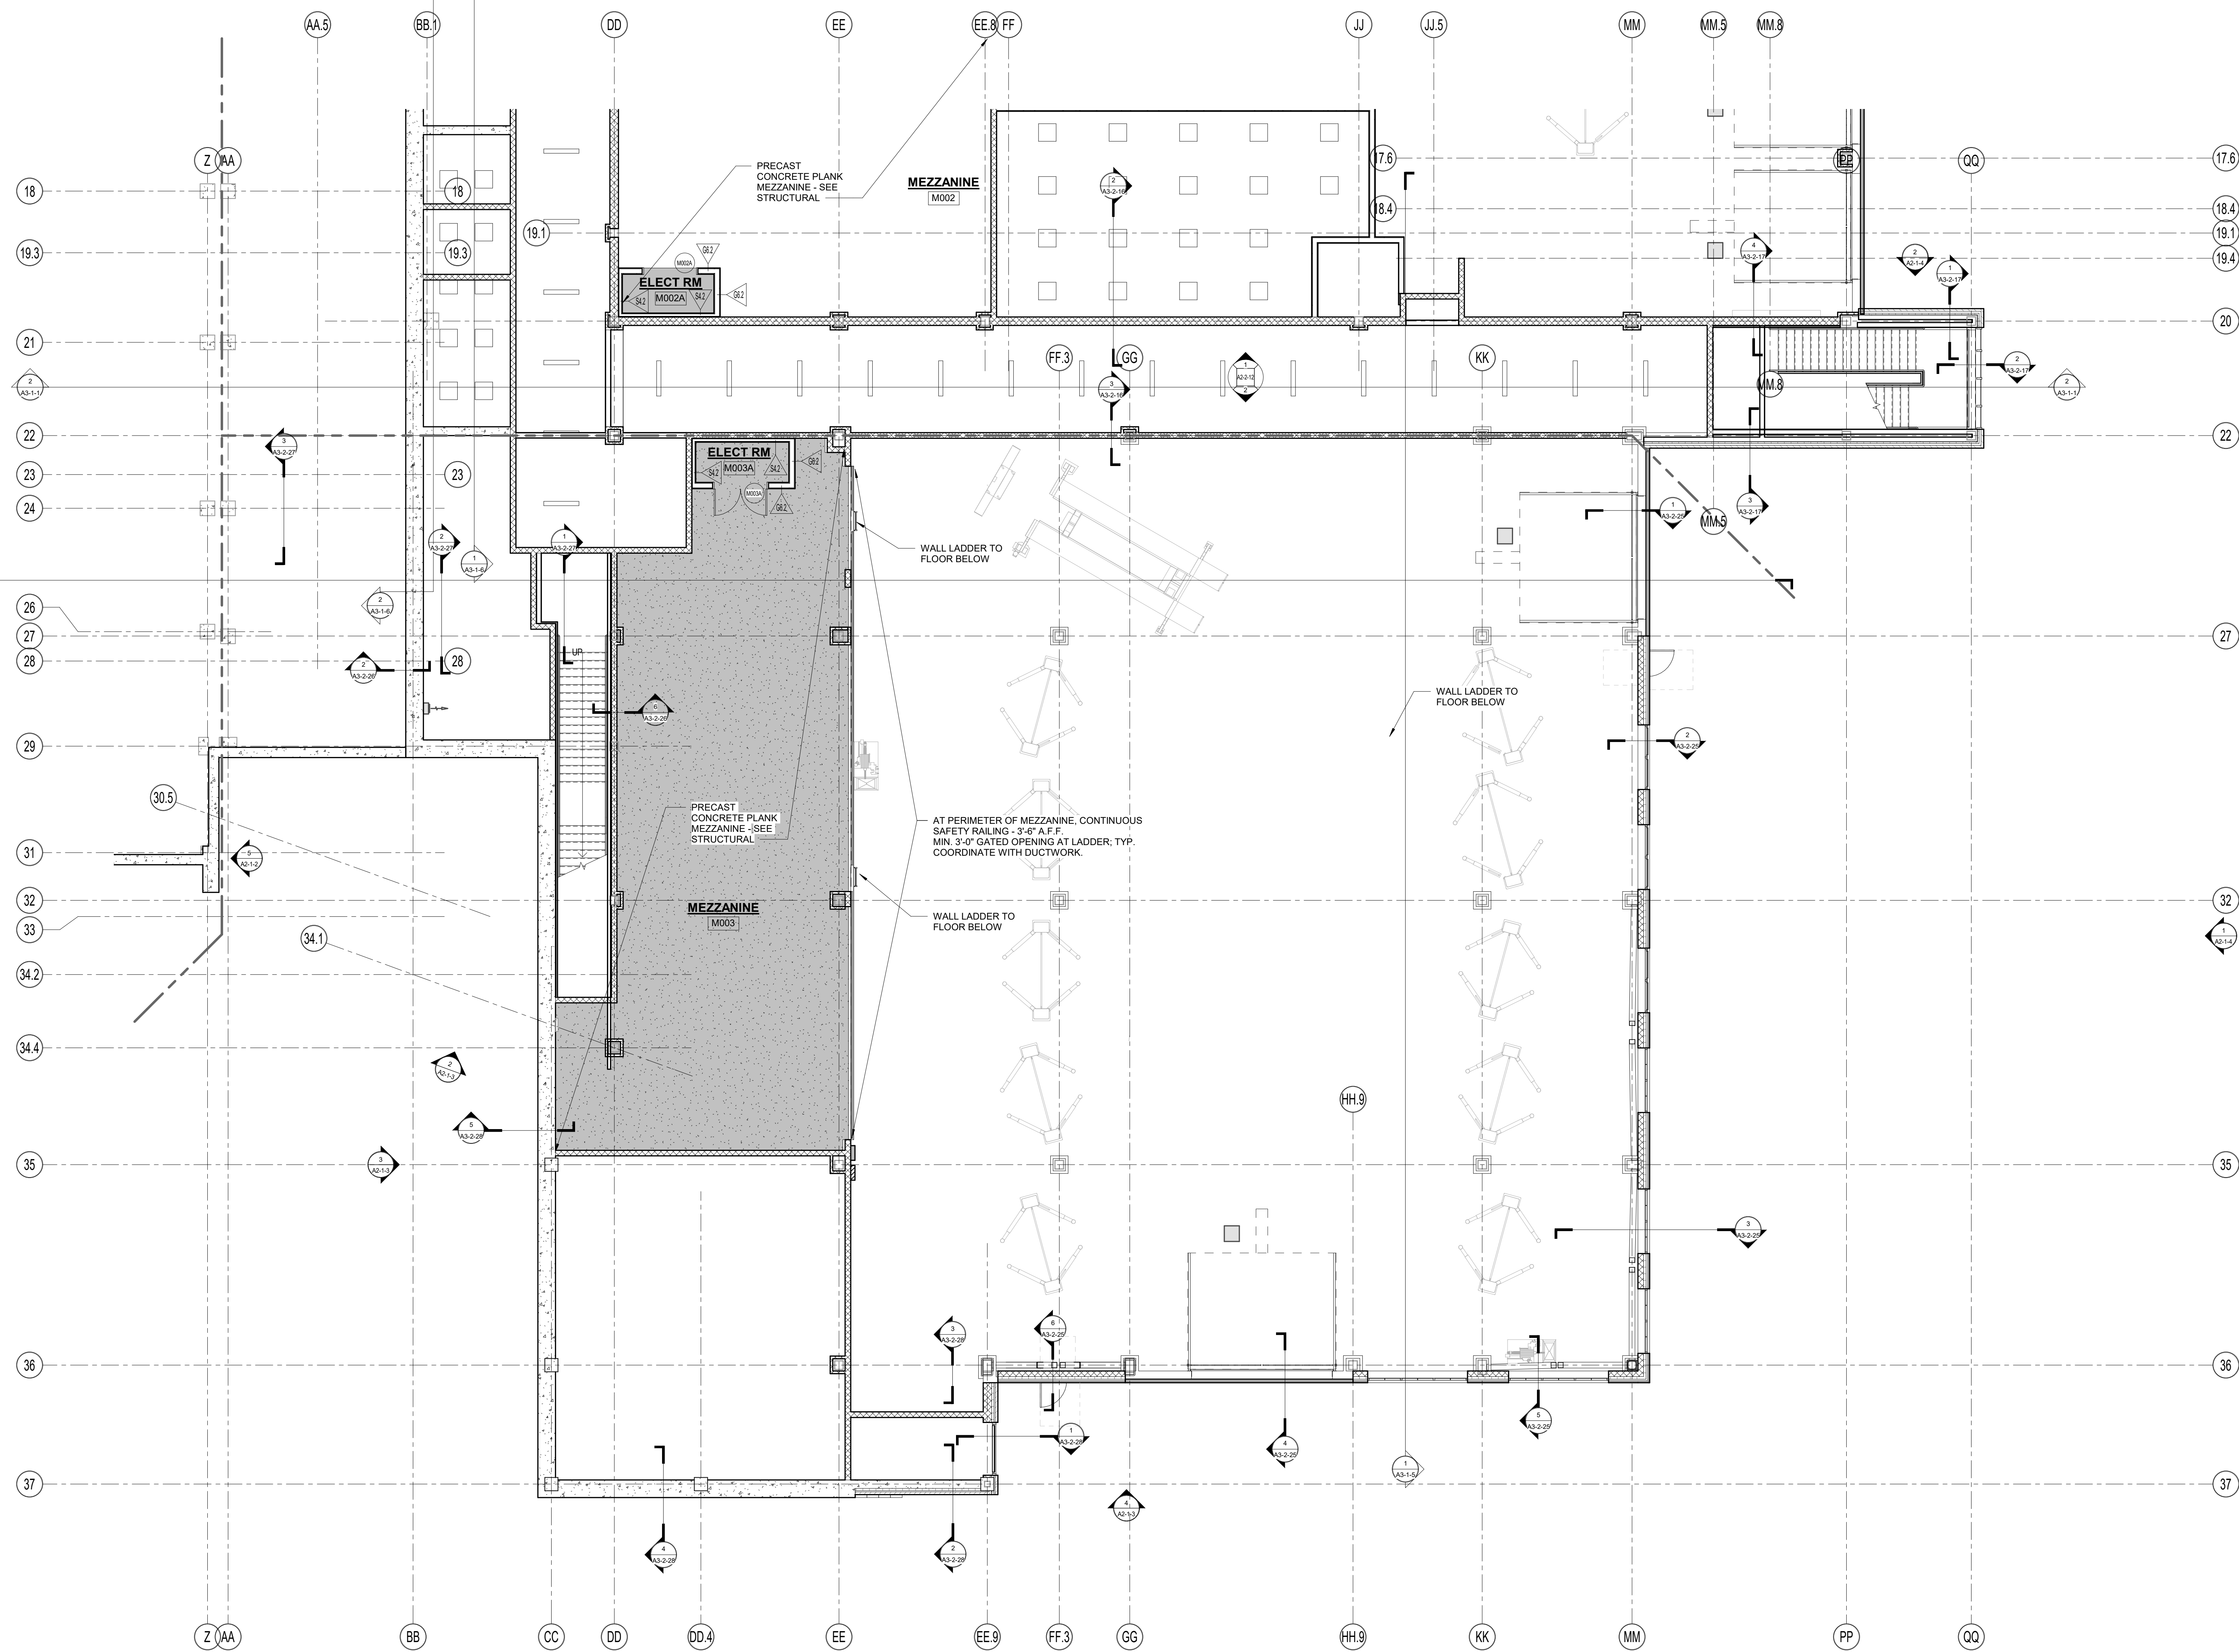


1 LOWER LEVEL MEZZANINE PLAN - AREA D
1/8" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

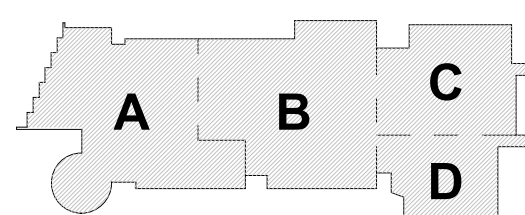

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

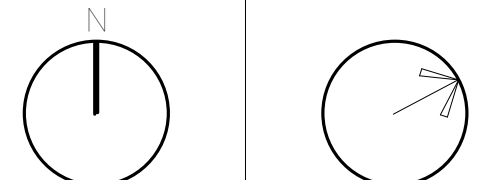

**LOWER LEVEL
MEZZANINE
PLAN - AREA D**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-0MD

DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1702
www.dra.com


Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880

- FLOOR PLAN GENERAL NOTES:**
1. TO SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILET/SHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A:** AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

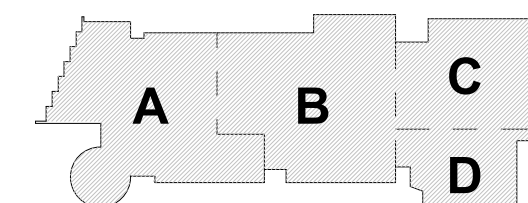

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

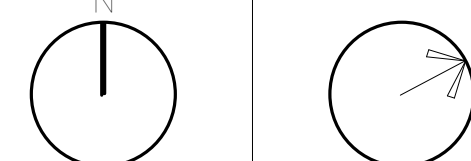

FIRST FLOOR PLAN - AREA B

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-B

Volume 3 of 4

Volume 3 of 4

Volume 3 of 4

Volume 3 of 4

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.dra.com

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.50' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR PARTITIONS, SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND NOTED MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SUBMIT INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ABR) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

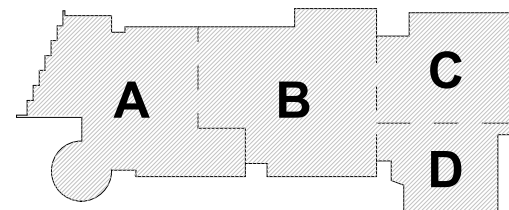

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

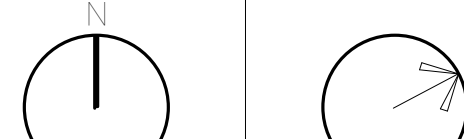

FIRST FLOOR PLAN - AREA C

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-1C

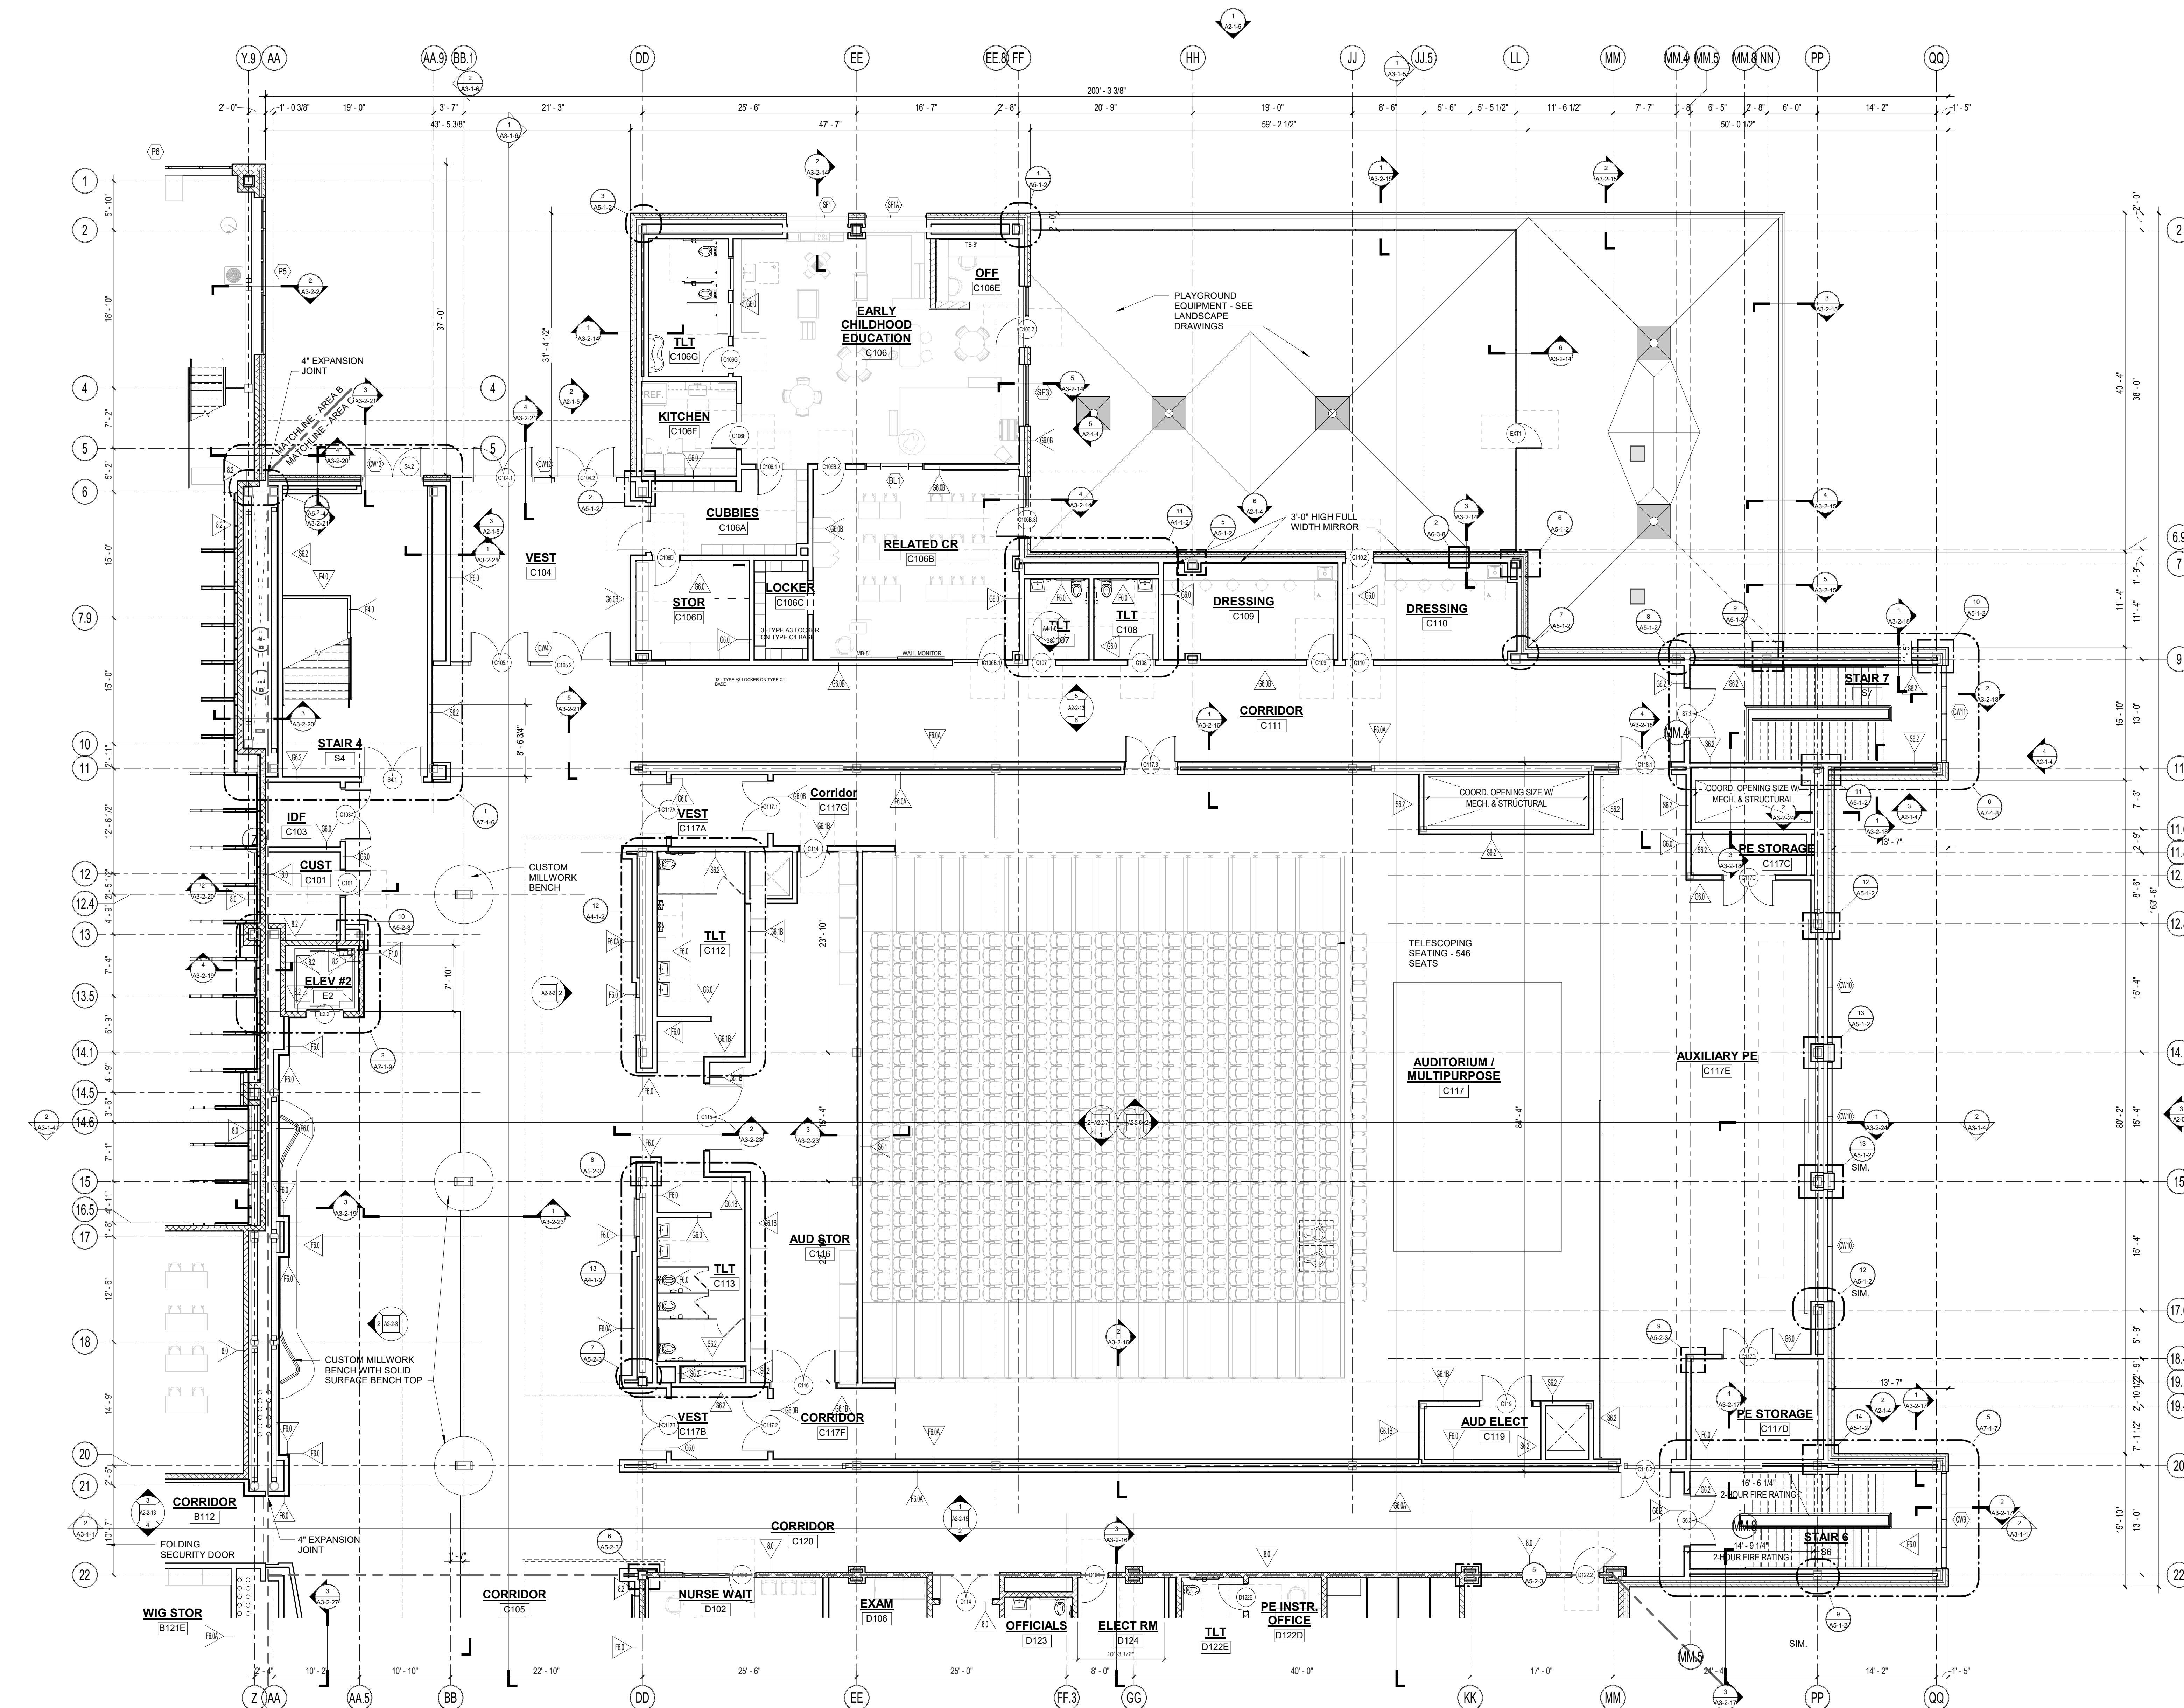

1 FIRST FLOOR PLAN - AREA C
1/8" = 1'-0"

Drummeys Rosane Anderson, Inc.	
225 Oakland Road	260 Charles Street
Studio 205	Studio 300
South Windsor, CT	Waltham, MA
06074	02453

Planning | Architecture | Interior Design
Tel: 617.954.1700
www.ciraws.com

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. TO 1.0 SLAB @ FIRST FLOOR DATUM ELEVATION OF 101.70 CORRESPONDING TO 163.50 MEAN SEA LEVEL DATUM. PROVIDE ALL OTHER ELEVATIONS DATUM SHOWN IN THE DRAWINGS.
 2. ALL OTHER ELEVATIONS DATUM SHALL BE IN THE DATUM OF THE FINISH FLOOR.
 3. ALL MASONRY PARTITIONS SHALL BE IN CMU (8 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. ALL GWB INTERIOR PARTITIONS PROVIDE 6.0 G WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 5. FURNISH AND INSTALL MASONRY UNITS BY MASON (TRADE-BID CONTRACTOR) AT ALL PARTITIONS. PROVIDE TO SPECIFICATIONS. PROVIDE REFERENCE TO PLANS, ELEVATIONS, AND SECTION DRAWINGS FOR MASONRY UNITS. PROVIDE REFERENCE TO MECHANICAL (H/VAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY UNIT SCHEDULE ON STRUCTURAL DRAWINGS.
 6. FURNISH AND INSTALL SEISMIC RESTRAINTS IN METAL FABRICATIONS (TRADE-BID CONTRACTOR TO PROVIDE TO SPECIFICATIONS). REFER TO DETAIL ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENING PARTITIONS. PROVIDE PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIIUS BULB NOSE CMU TO THE INTERIOR CORNER CONDITIONS. UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR CORNER CONDITIONS, PROVIDE TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS C-11 D-1, C-2 D-2 FOR ALL REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED POLYURETHANE INSULATION. PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 13. SEE FOODSERVICE AND EQUIPMENT REQUIREMENTS FOR ALL PARTITIONS.
 14. PROVIDE 20 GAUGE METAL STRAPPING BARS (GWB CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, MARKERBOARDS, ACoustICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD PARTITIONS.
 15. PROVIDE 3"x4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND PARTITIONS TO PROVIDE A SURFACE FOR MOUNTING OF THE WALL MOUNTED EQUIPMENT. PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 16. PROVIDE WOOD BLOCKING BEHIND PARTITIONS TO PROVIDE A SURFACE FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND EQUIPMENT. PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS SHALL BE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO PARTITIONS WITH MULTIPLE LAYERS OF 1/2" GWB, ALIGN THE FACES OF THE FINISH WALL.
 19. PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
- NOTE 1: AT METAL STUD PARTITIONS WITH THIN WALLS, PROVIDE TO SPECIFICATIONS. PROVIDE REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LOCATION TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION



May 12TH, 2023

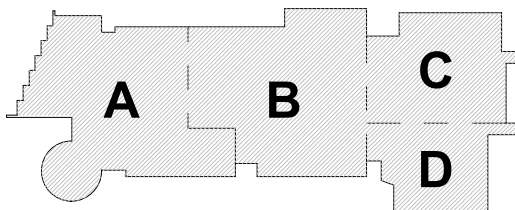

KEY PLAN

PROJECT NORT

MAGNETIC NORTH



**FIRST FLOOR
PLAN - AREA D**

Scale: $1/8" = 1'-0"$

Job No. 30302


DATE: 01/11/2011

Date: May 12th

Volume 3 of 4

A1-1-1D

Volume 3 of 4

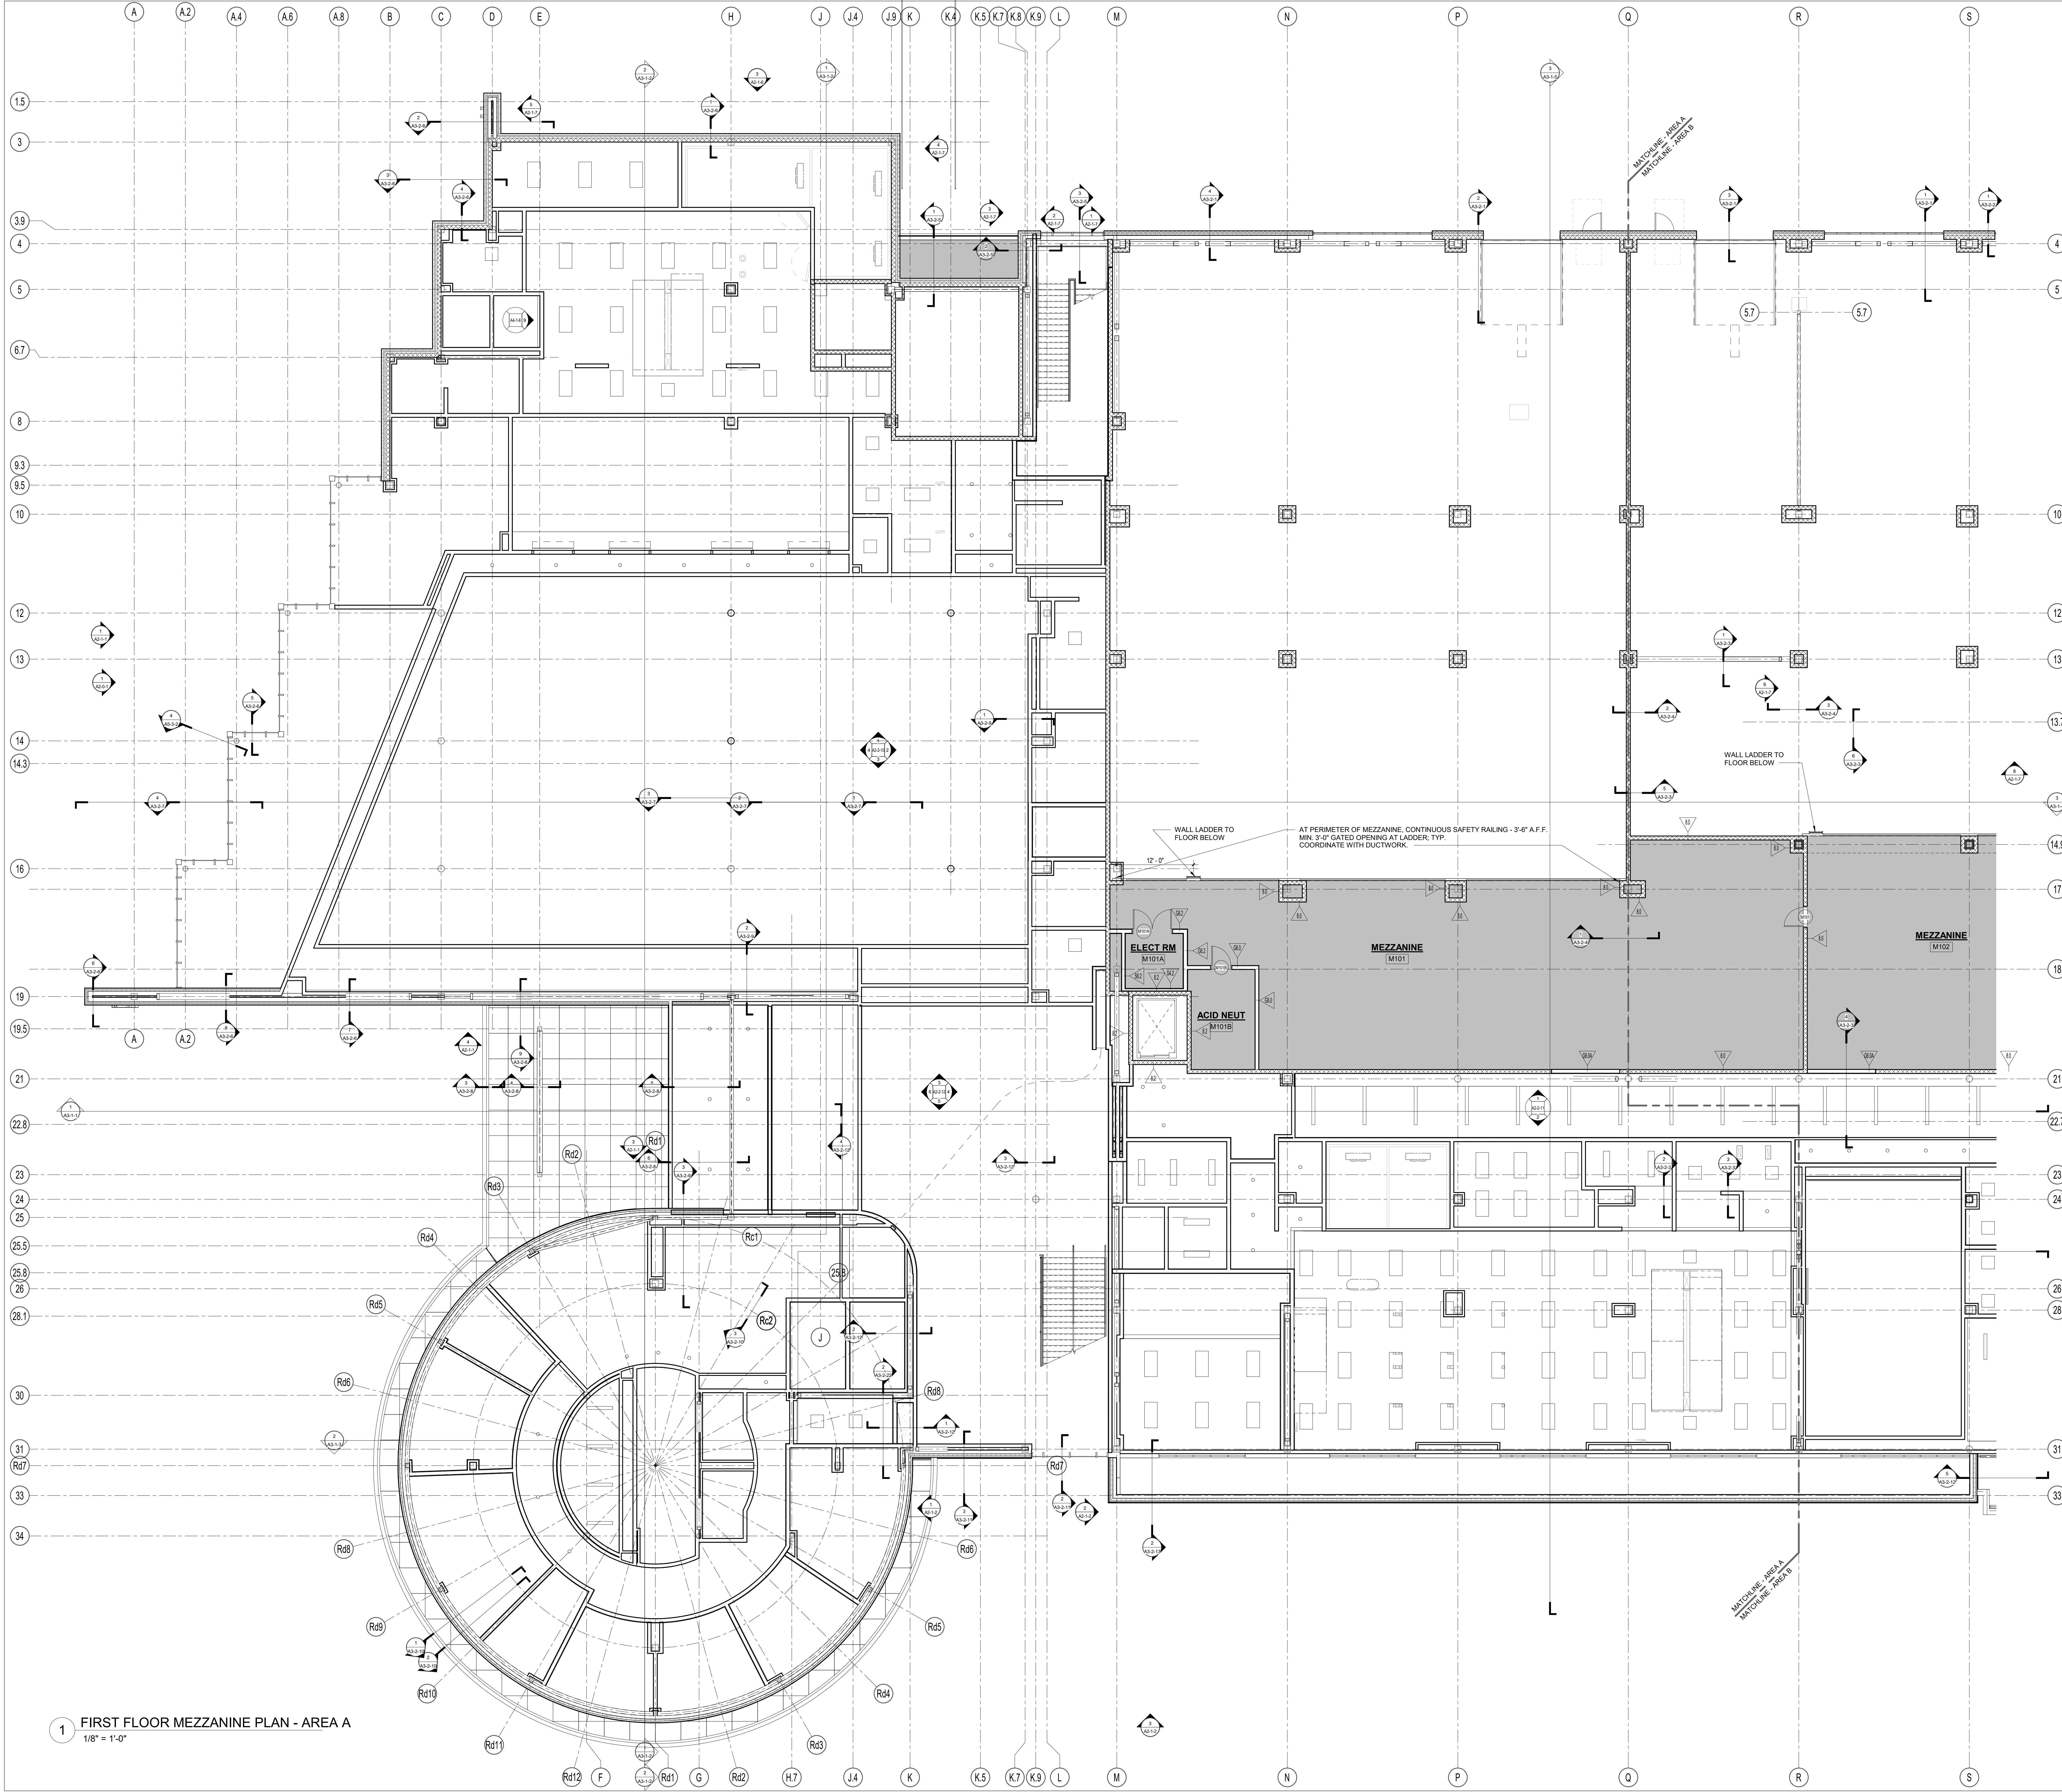

1 FIRST FLOOR MEZZANINE PLAN - AREA A
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.30' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTERMEDIATE MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.

13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.

17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".

18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A B C D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

FIRST FLOOR
MEZZANINE
PLAN - AREA A

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023


A1-1-1MA

Volume 3 of 4

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880


- FLOOR PLAN GENERAL NOTES:**
1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.30' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A:** AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

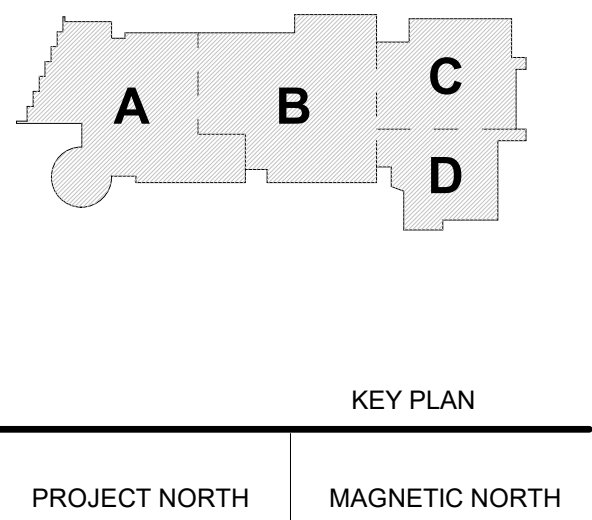

**FIRST FLOOR
MEZZANINE
PLAN - AREA B**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

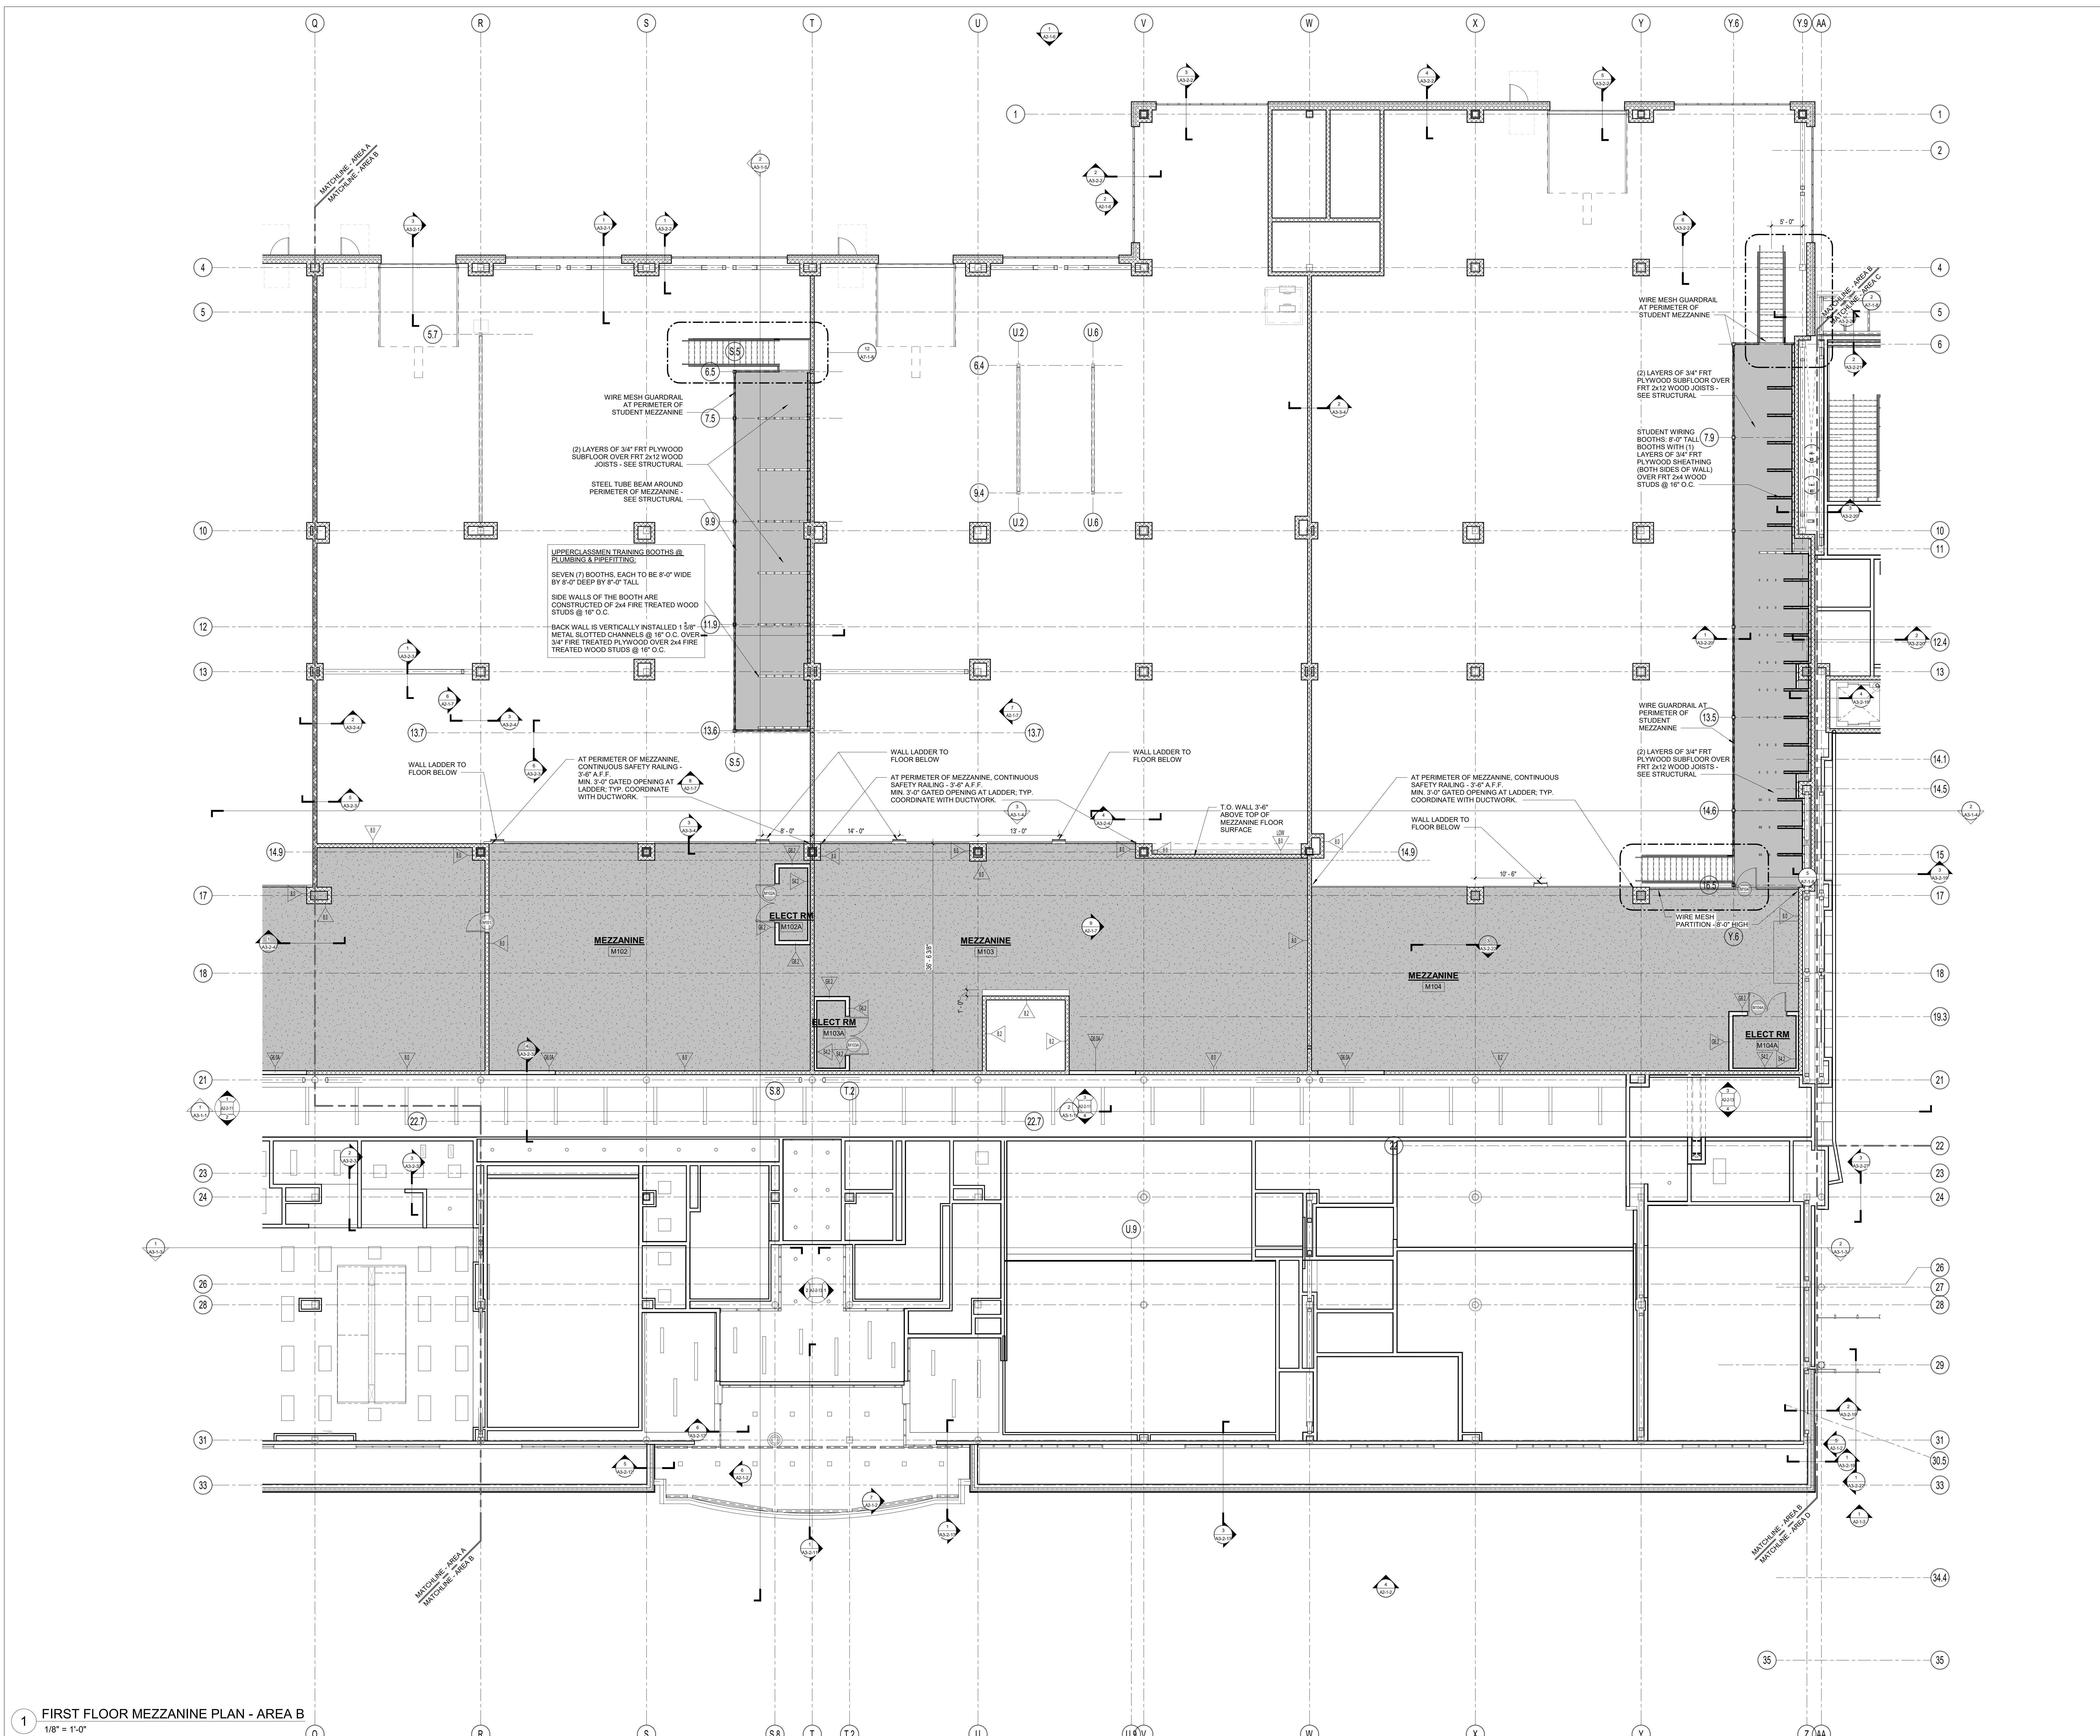

FIRST FLOOR MEZZANINE PLAN - AREA B
1/8" = 1'-0"

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.50' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0"

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS & METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAIL ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENING TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS

AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE

13. SEE FOODSERVICE AND EQUIPMENT

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND
GWB (CONCEALED FROM VIEW) AS REQUIRED
FOR MOUNTING OF THE MARKERBOARDS

FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED

PROJECTORS, INTERACTIVE FLAT PANELS
DISPLAYS, AND TV MONITORS OCCURRING ON
METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILET/SHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD.

17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED

18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB

ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATION

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION

REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A diagram showing a cross-section of a structure divided into three vertical sections labeled A, B, and C. Section A is on the left, B is in the middle, and C is on the right. The structure has a stepped profile with varying heights and widths.

1. *Journal of the American Medical Association*, 2000; 284: 2689-2694.

KEY PLAN	
PROJECT NORTH	MAGNETIC NORTH

— 10 —

SECOND FLOOR

**SECOND FLOOR
PLAN - AREA A**

Scale: 1/8" = 1'-0"

Drawn By: DRA
Date: May 12TH, 2023

Volume 3 of 4	
---------------	--



DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


- FLOOR PLAN GENERAL NOTES:**
1. TO SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.50' MEAN SEA LEVEL. AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8" WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATORS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTATIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE: A. AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

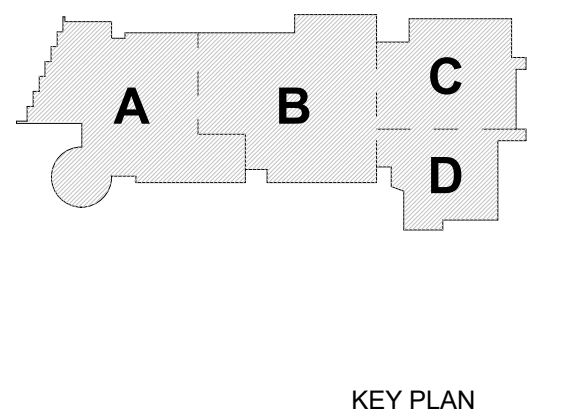

PROJECT NORTH
MAGNETIC NORTH

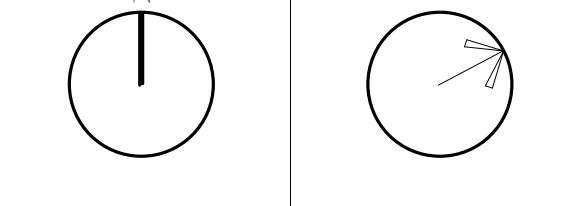

**SECOND FLOOR
PLAN - AREA B**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-2B



DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.dra-inc.com

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION



May 12TH, 2023

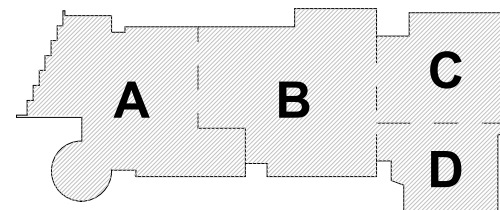

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



SECOND FLOOR PLAN - AREA C

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-2C

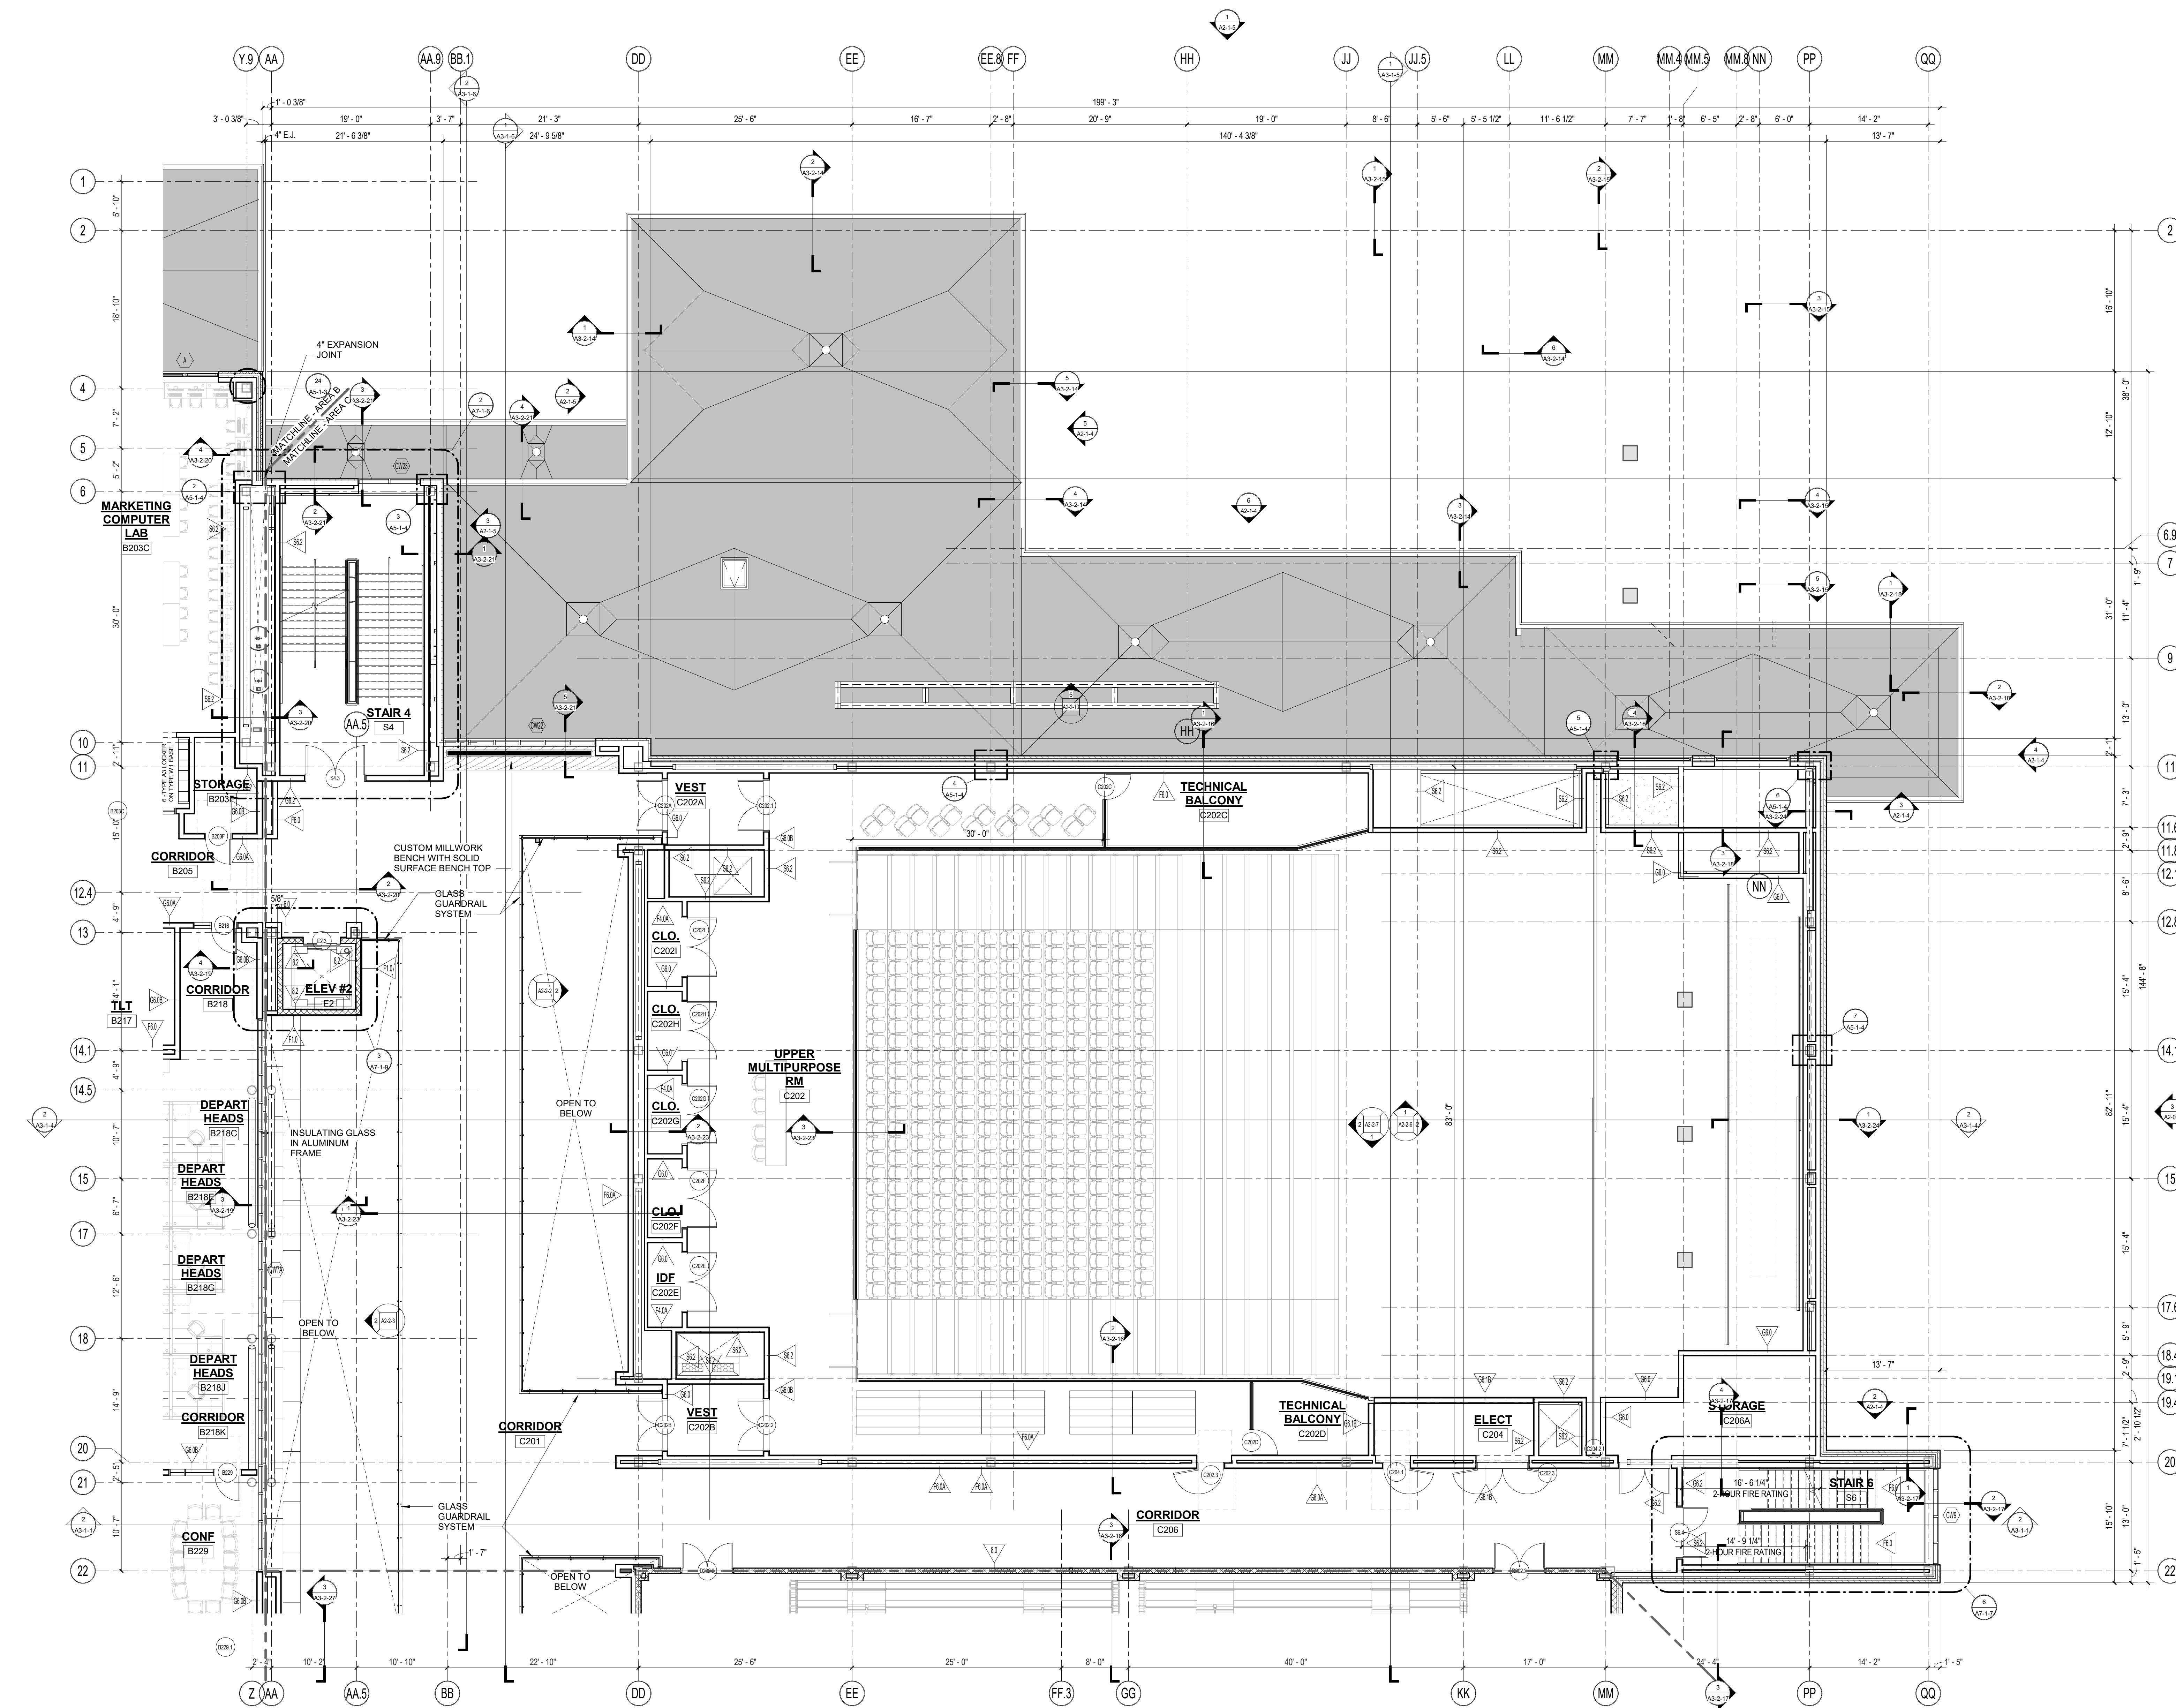

1 SECOND FLOOR PLAN - AREA C
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453


Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:


1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWR INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

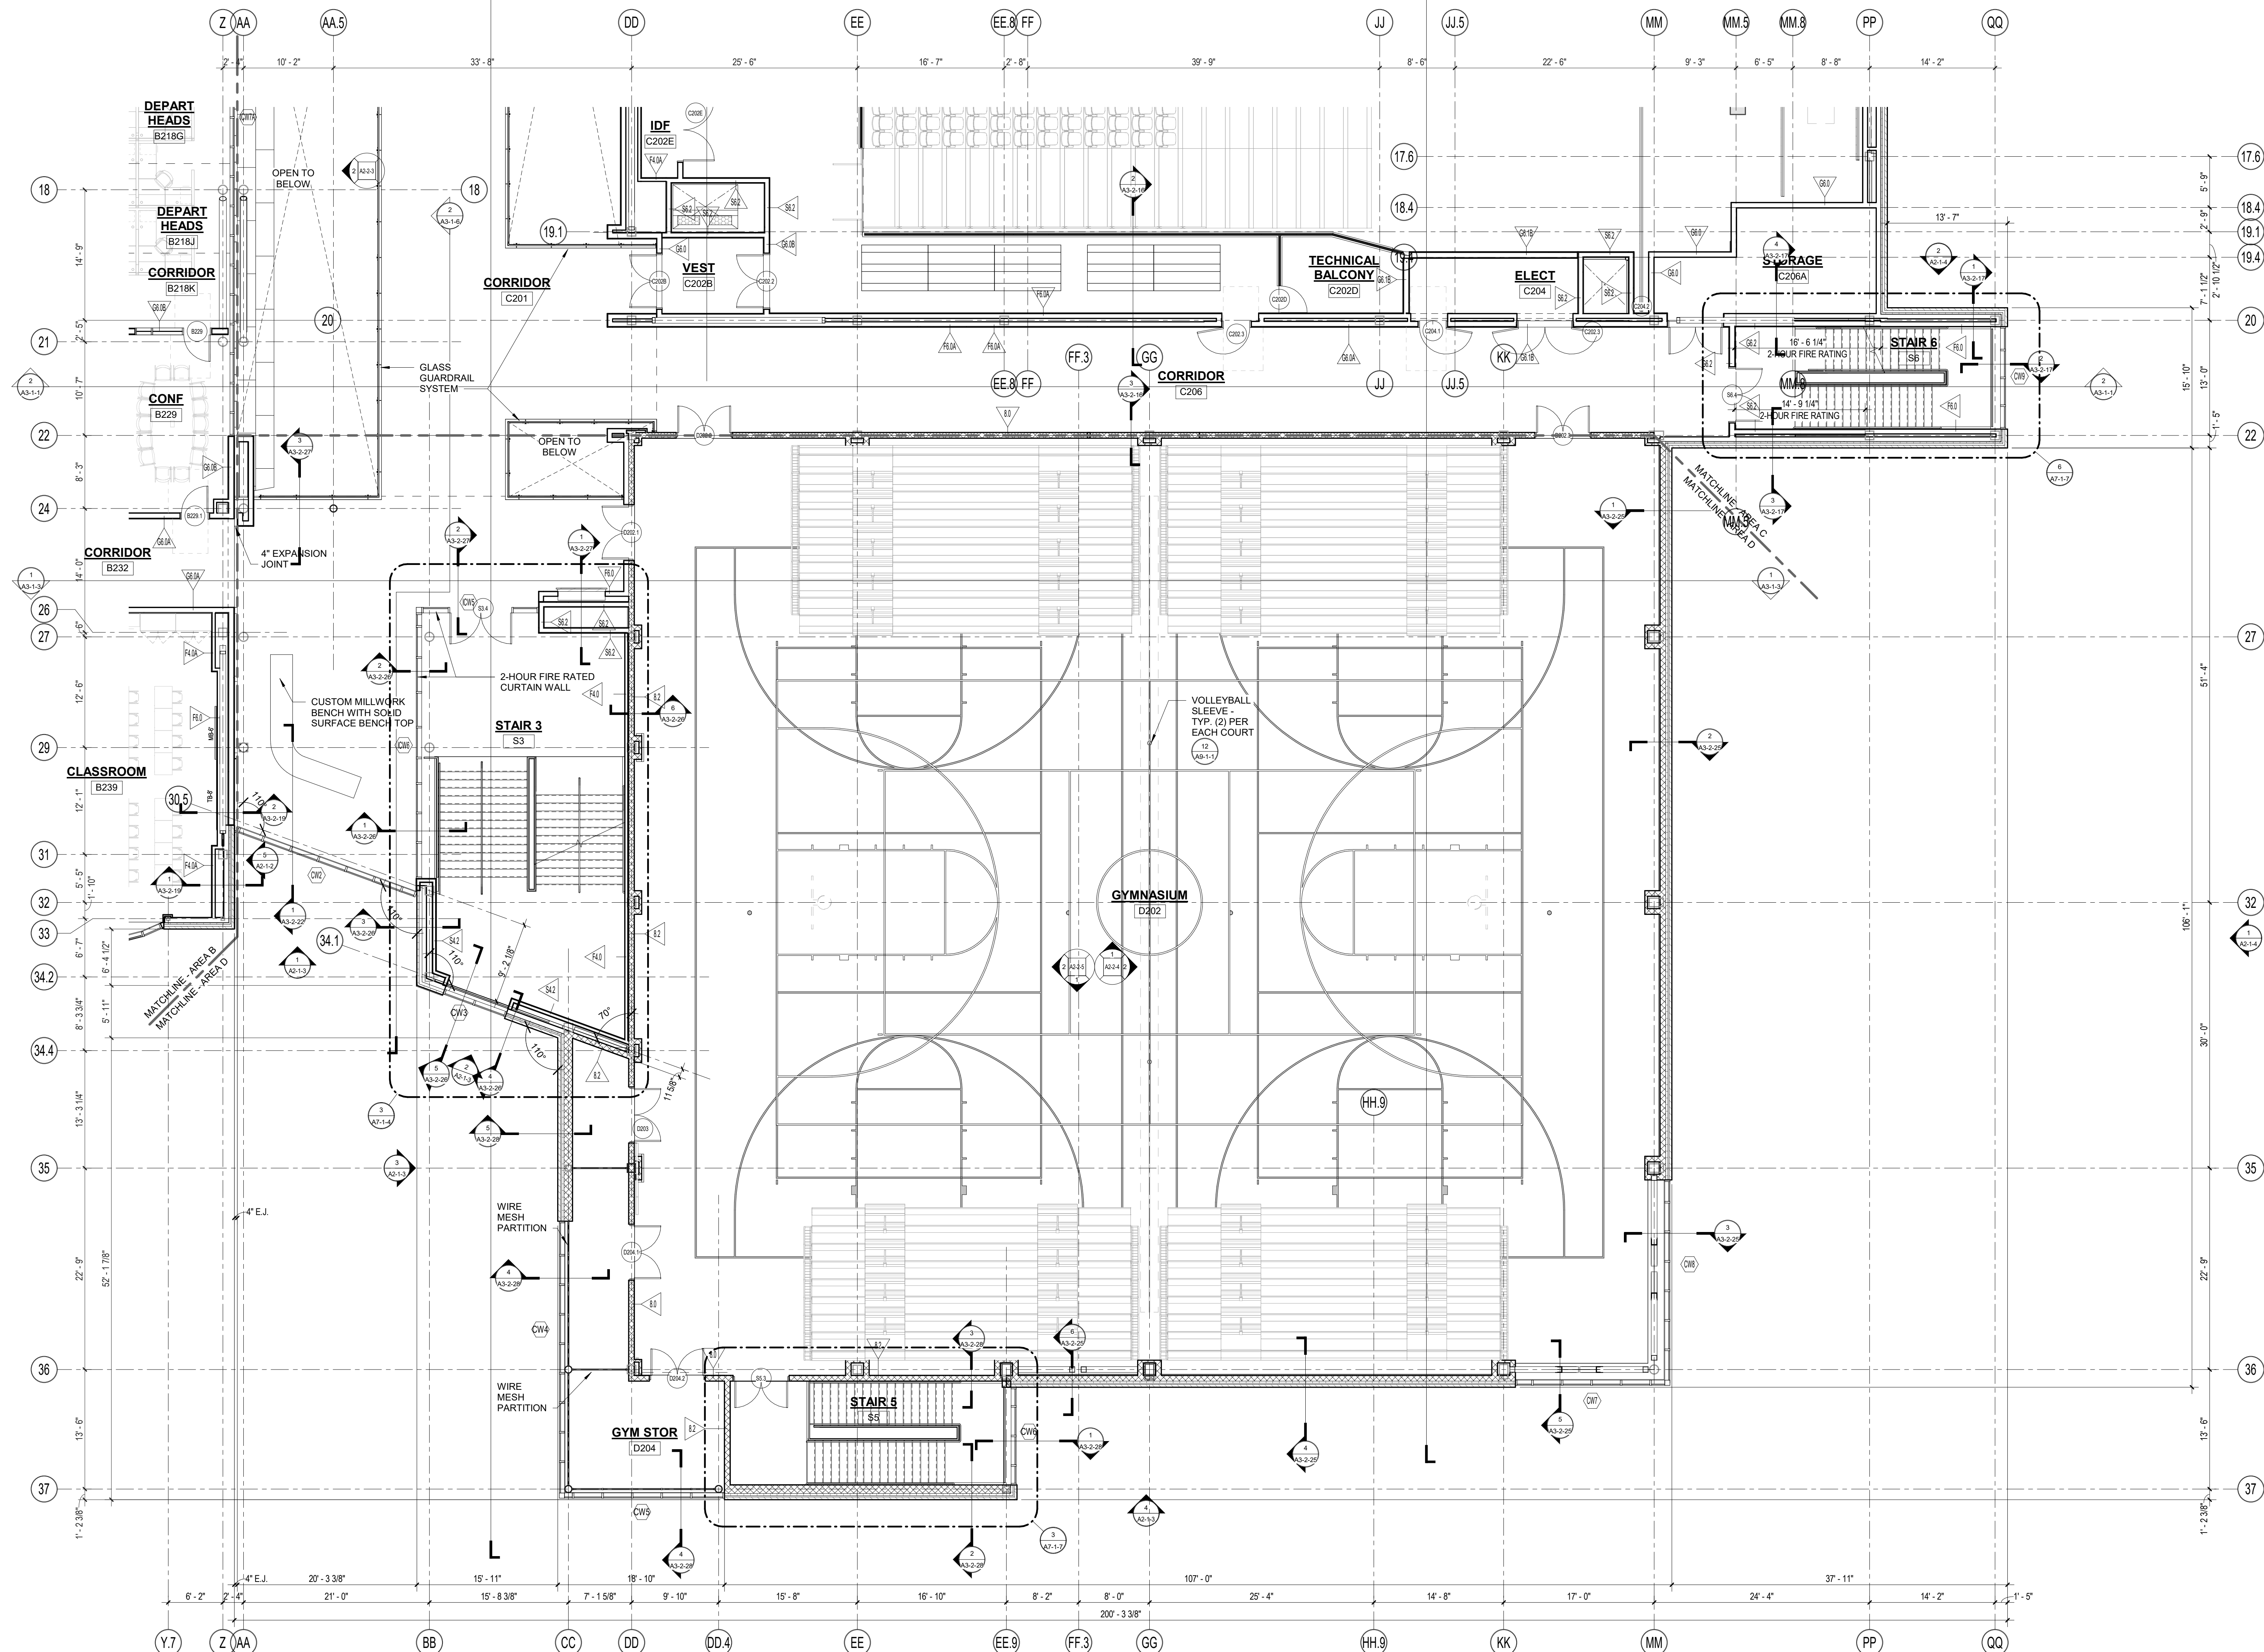

1 SECOND FLOOR PLAN - AREA D
1/8" = 1'-0"

MSBA 90% CD
SUBMISSION
May 12TH, 2023

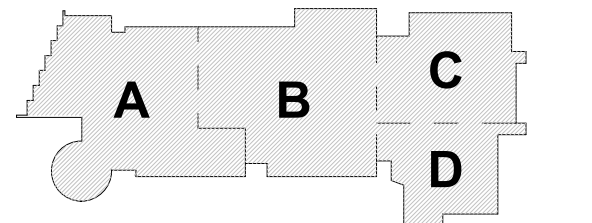


KEY PLAN
PROJECT NORTH
MAGNETIC NORTH

**SECOND FLOOR
PLAN - AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-2D

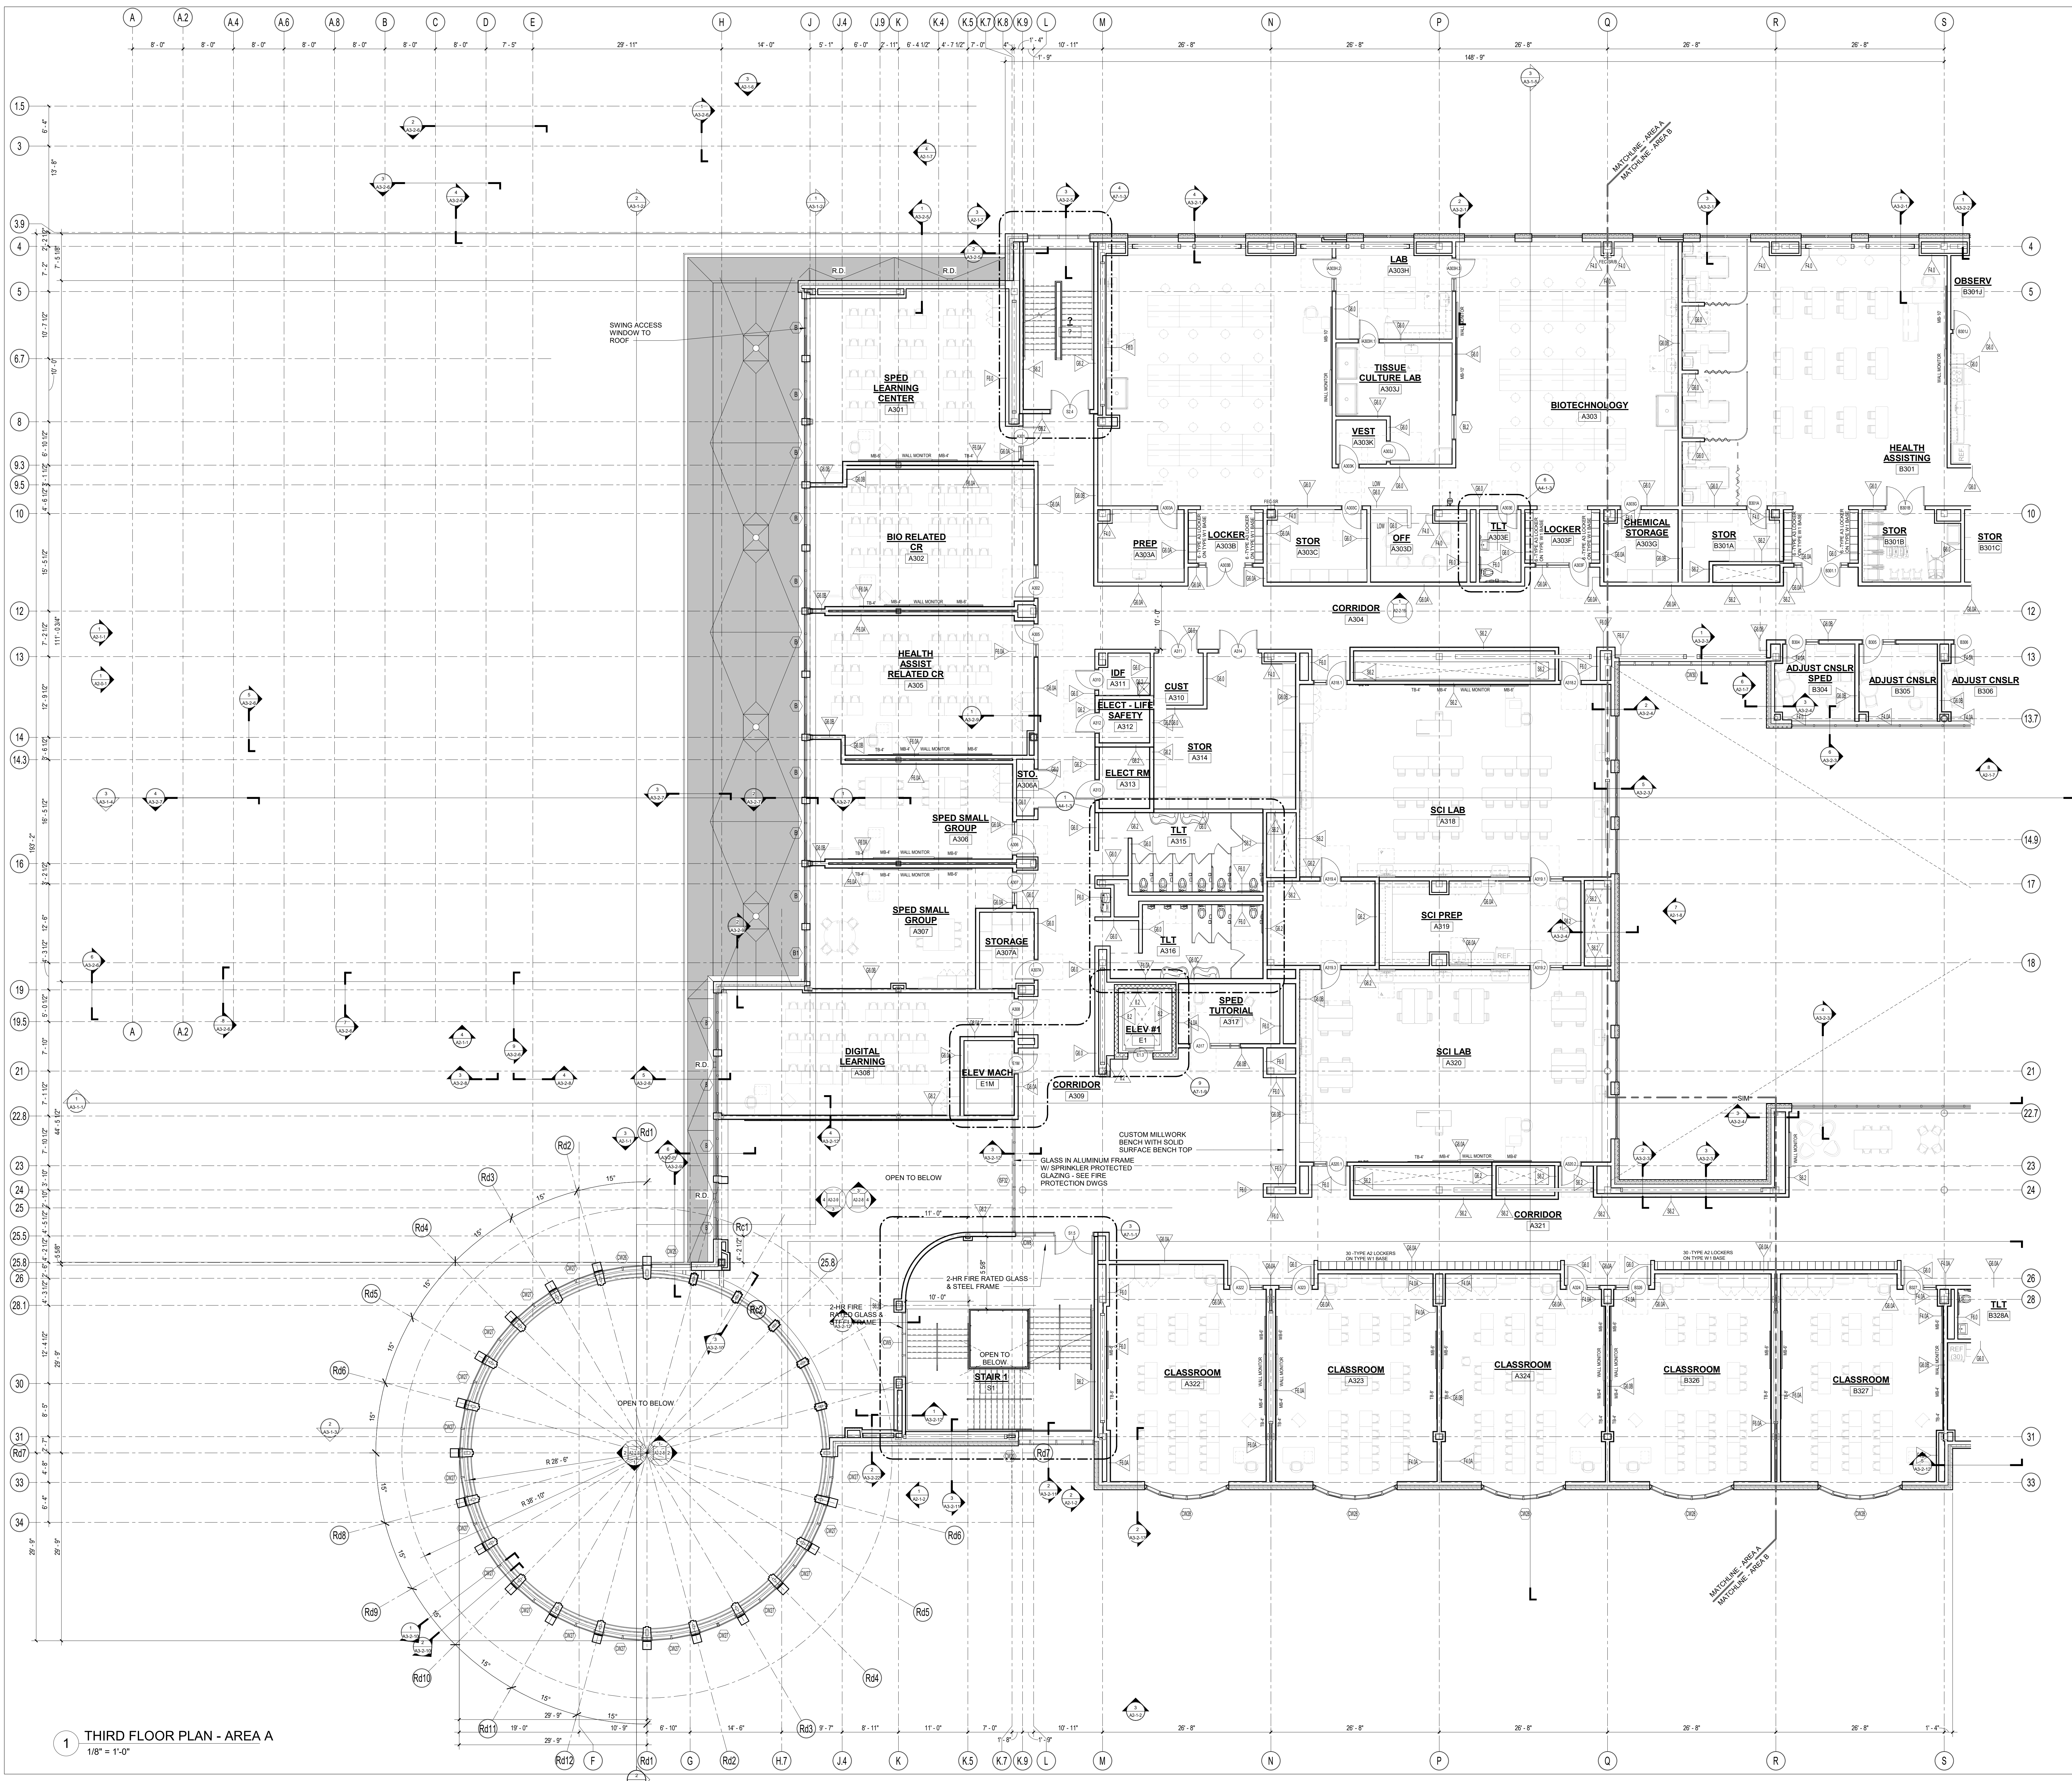

1 THIRD FLOOR PLAN - AREA A
1/8" = 1'-0"



Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453


Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School


100 Hemlock Road,
Wakefield, MA 01880

- FLOOR PLAN GENERAL NOTES:**
1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.30' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (AGRB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

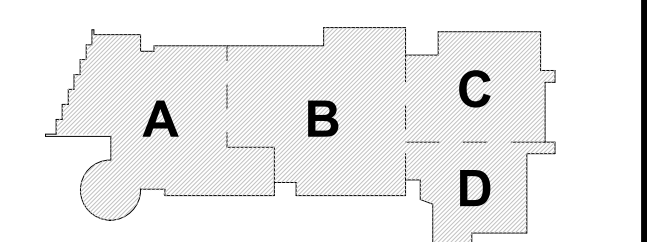

PROJECT NORTH
MAGNETIC NORTH

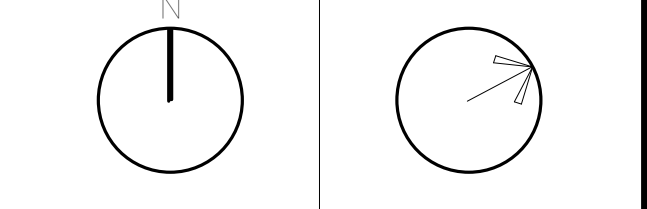

THIRD FLOOR PLAN - AREA A

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-3A

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.dra.com


Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880

- FLOOR PLAN GENERAL NOTES:**
1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATORS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A:** AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

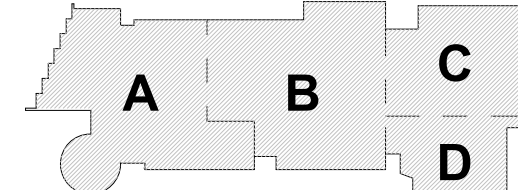

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH



THIRD FLOOR PLAN - AREA B

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-3B

1 THIRD FLOOR PLAN - AREA B

1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.dra.com


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

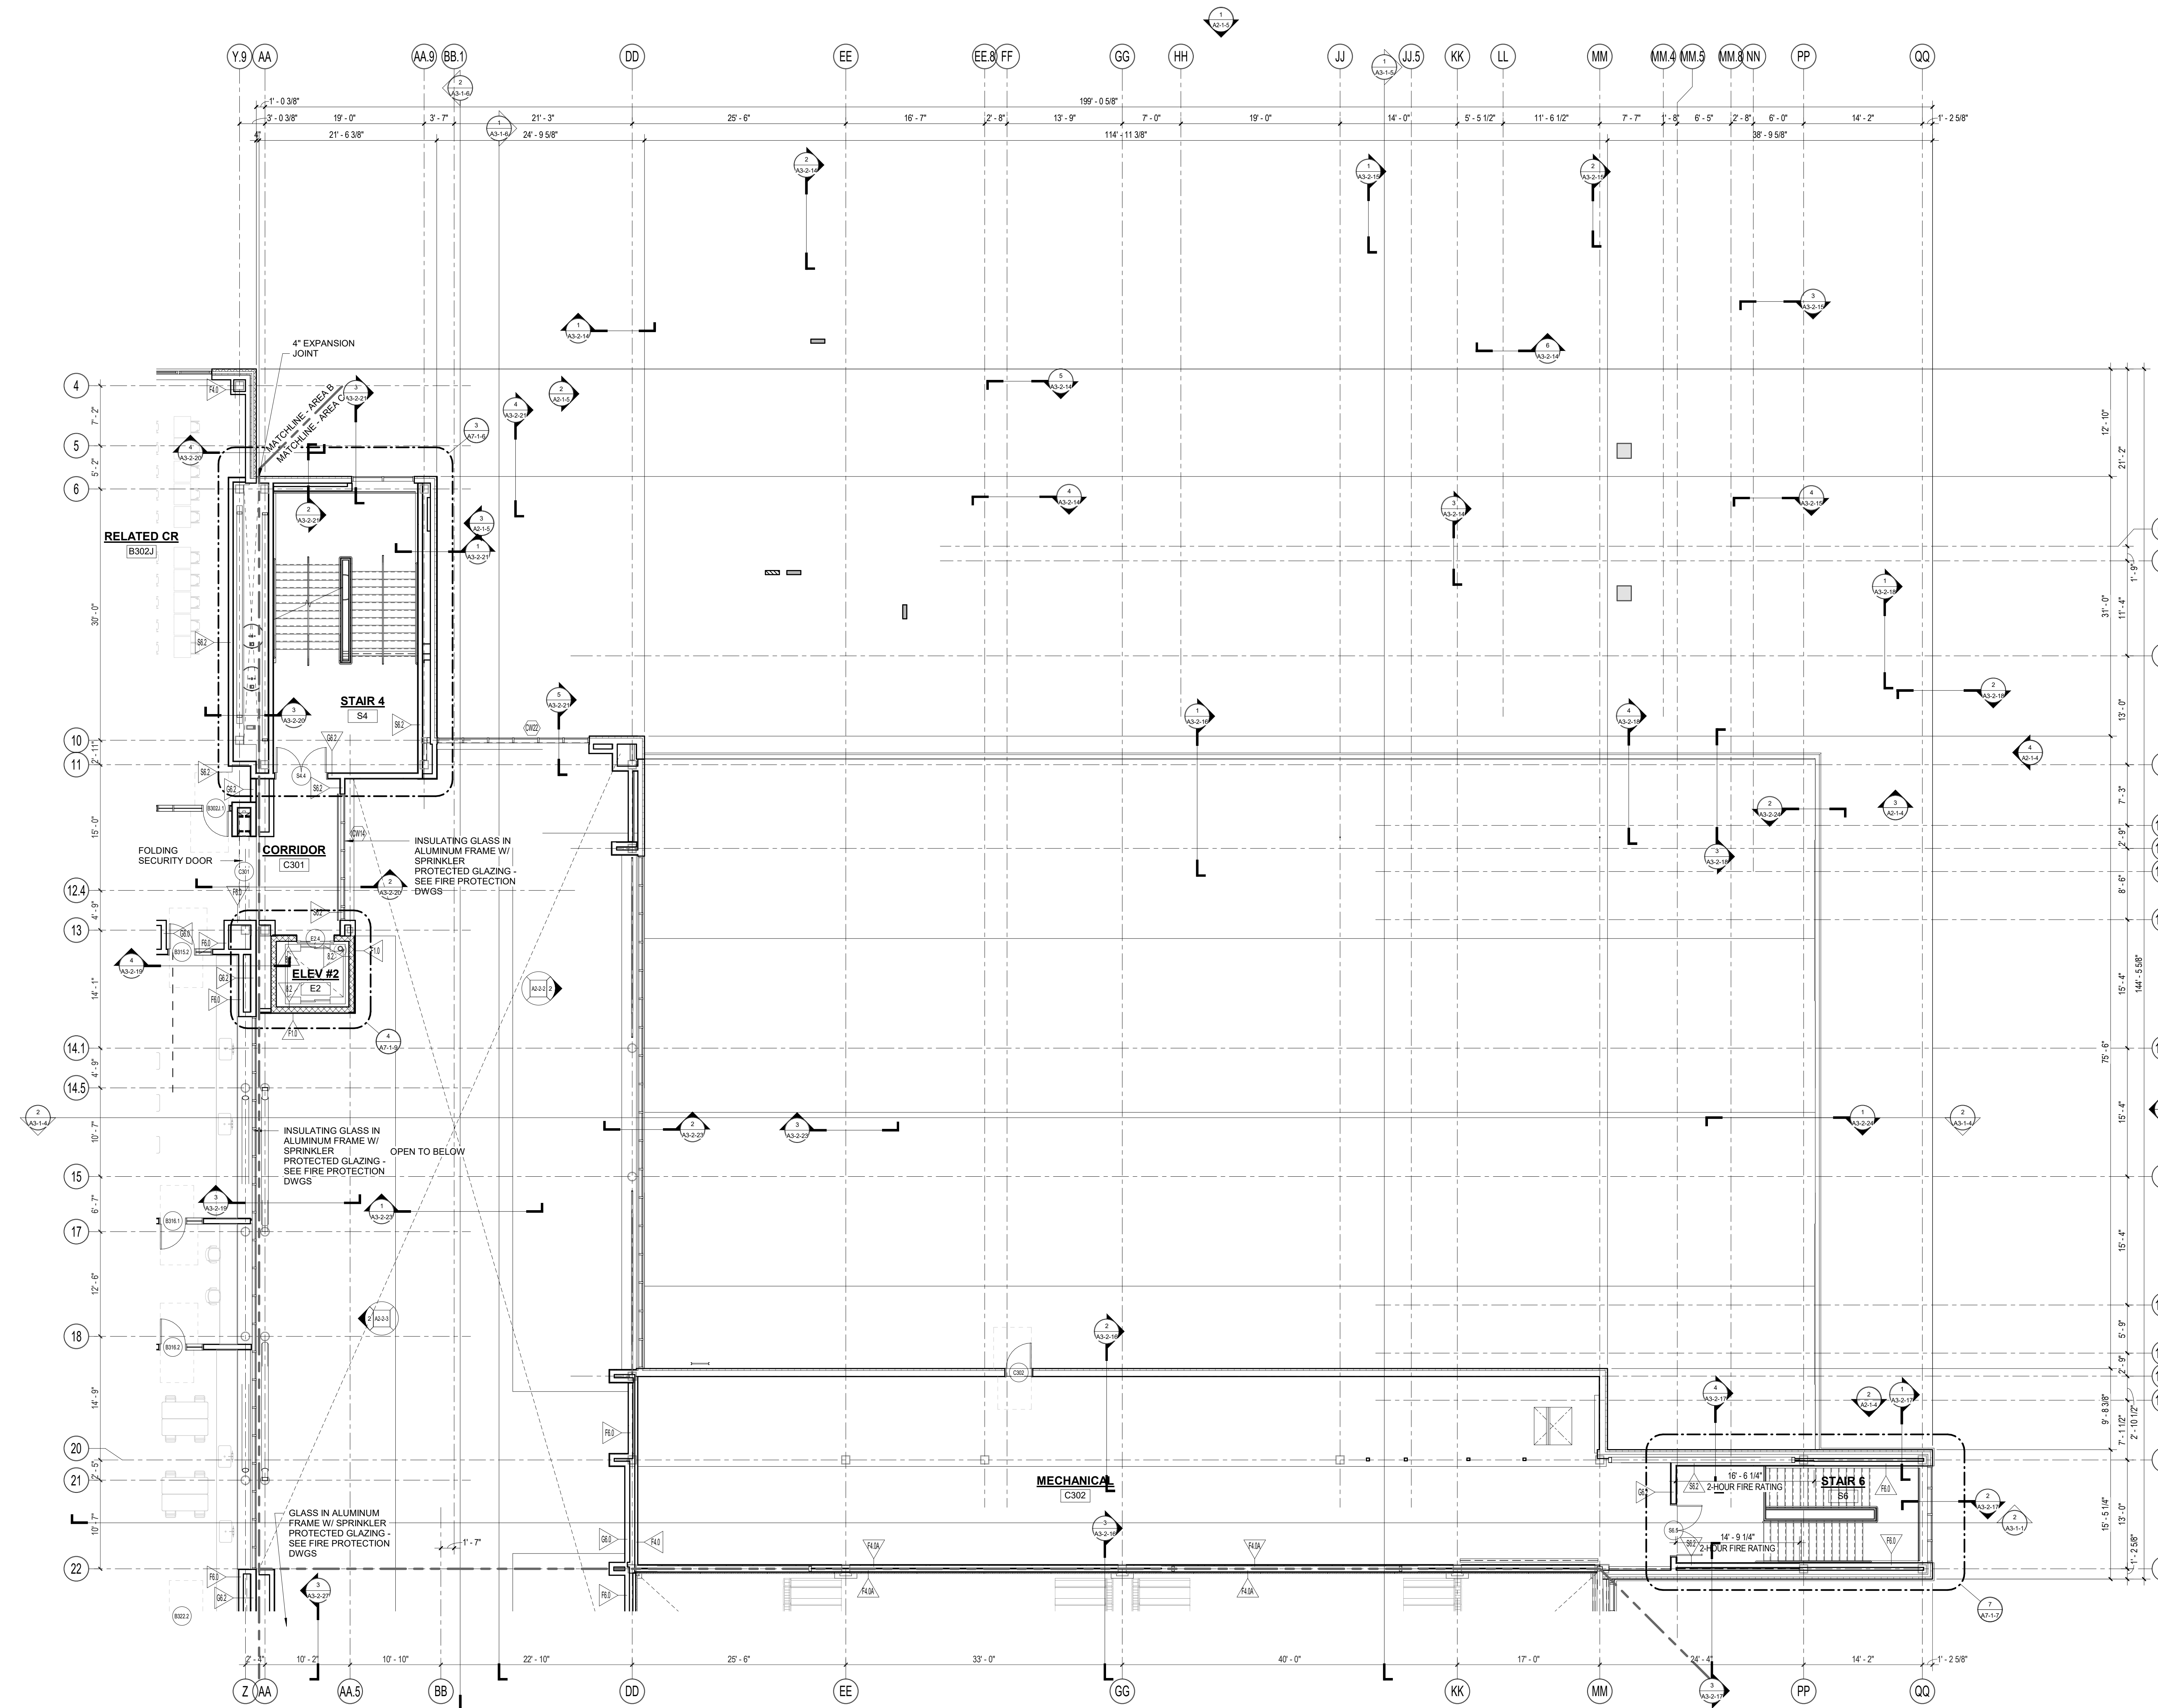

1 THIRD FLOOR PLAN - AREA C
1/8" = 1'-0"

MSBA 90% CD
SUBMISSION



May 12TH, 2023

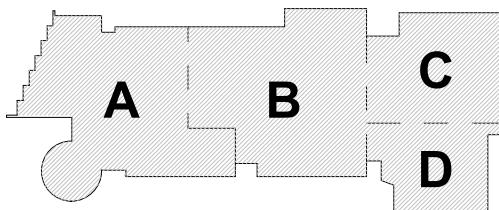

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



**THIRD FLOOR
PLAN - AREA C**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-1-3C

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Tel: 617.854.1702
www.dra.com

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
3. ALL GWR INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULE AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
9. FOR CONTROL JOINT LOCATIONS AT INTERIOR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
10. FOR CONTROL JOINT LOCATION AT GWR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION



May 12TH, 2023

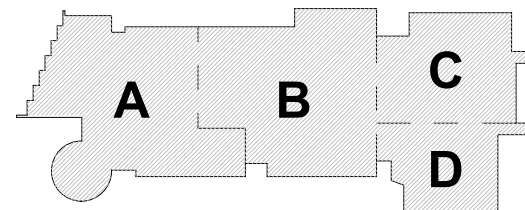

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



THIRD FLOOR PLAN - AREA D

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4

A1-1-3D

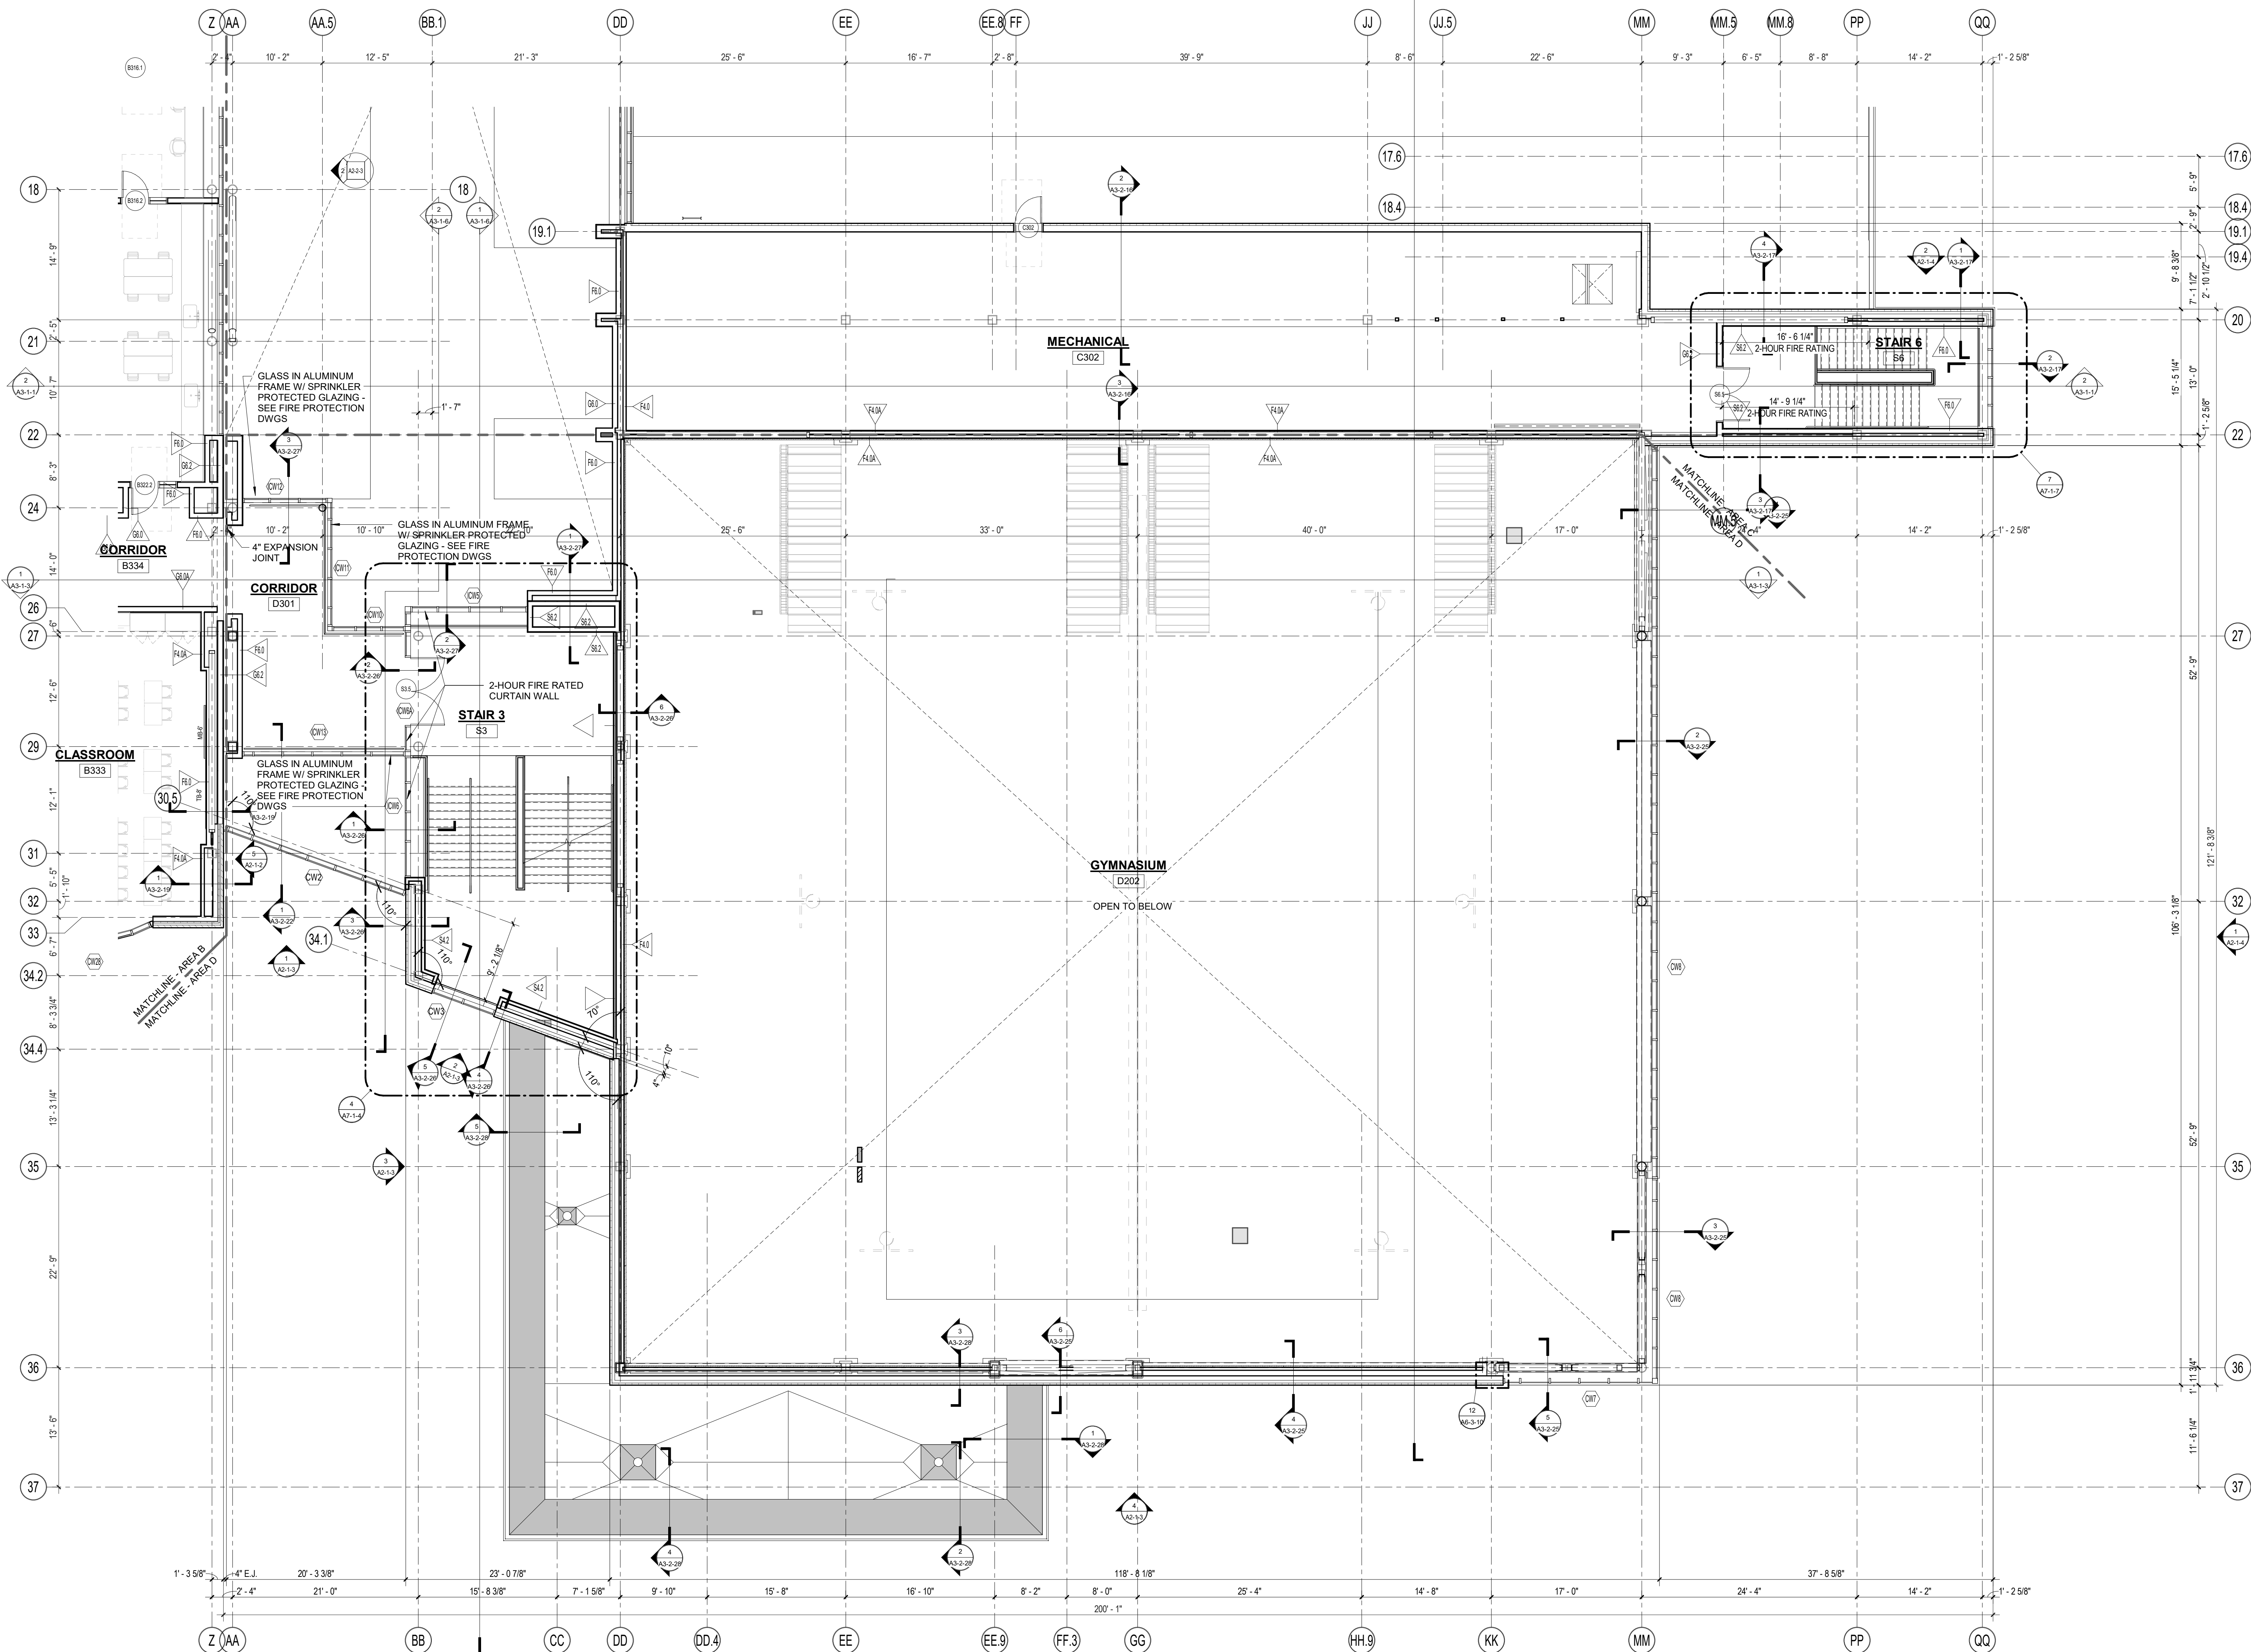

1 THIRD FLOOR PLAN - AREA D
1/8" = 1'-0"

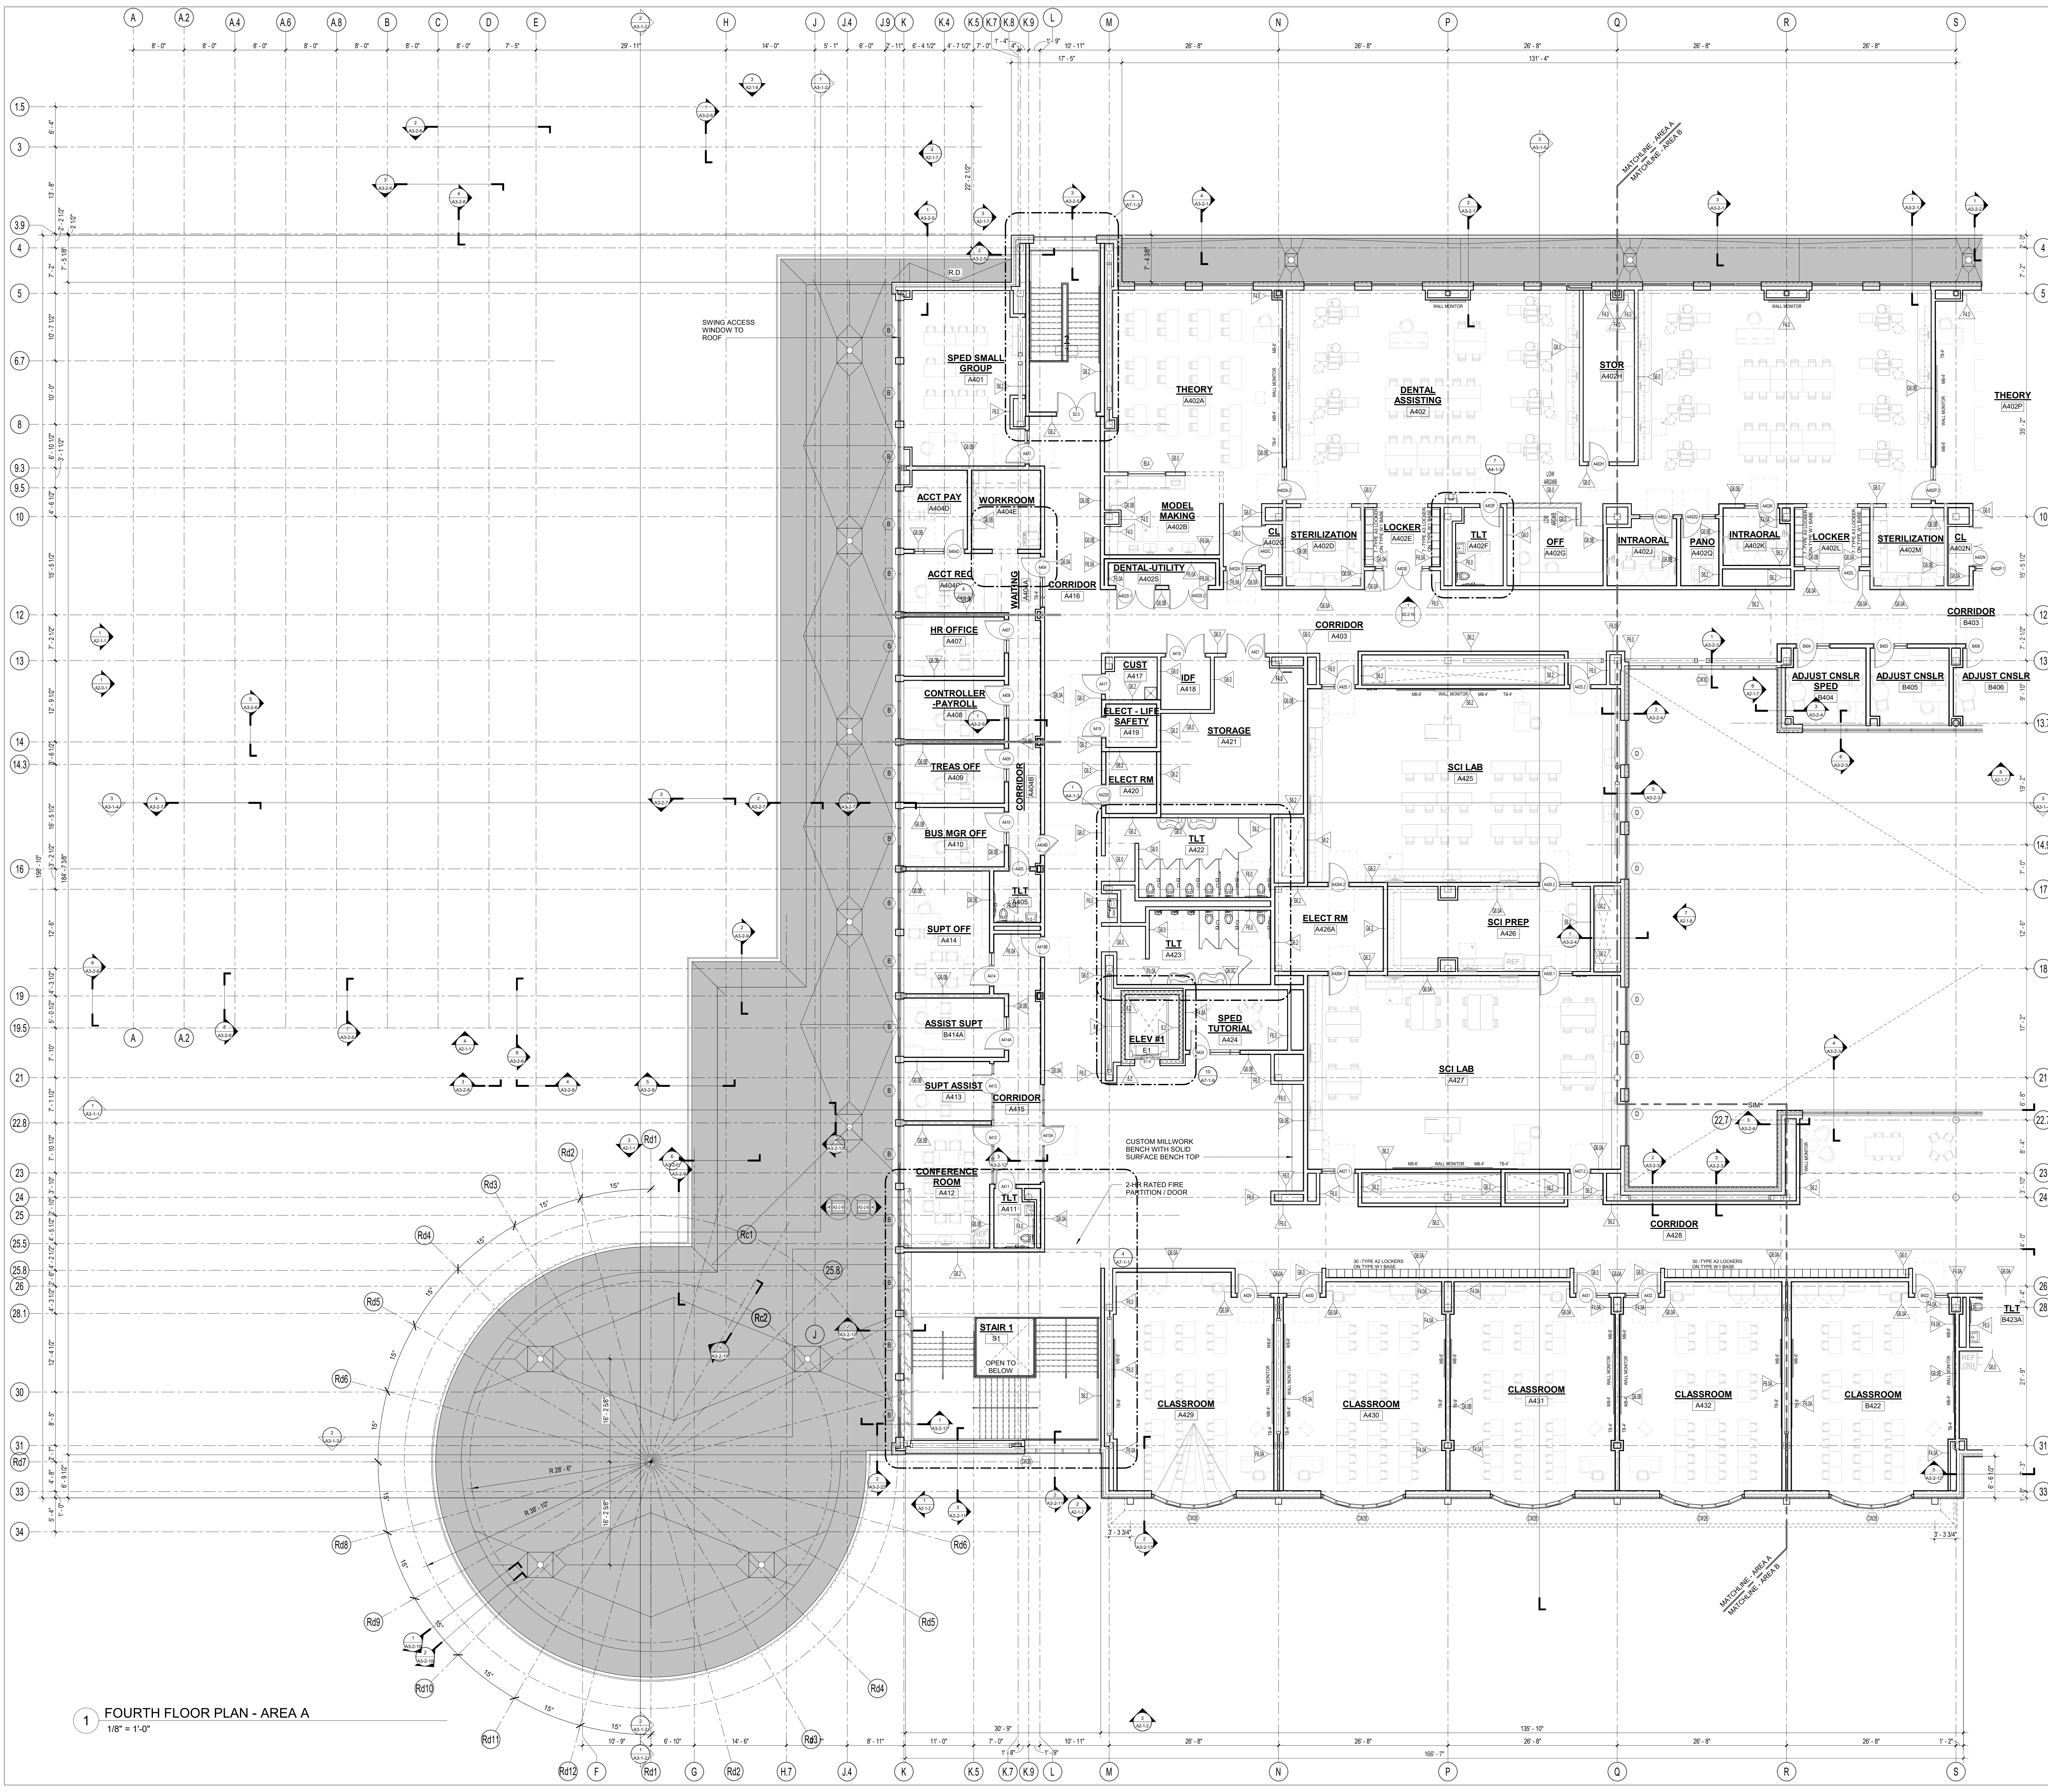

1 FOURTH FLOOR PLAN - AREA A
1/8" = 1'-0"

DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.30' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATORS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTIMESMANT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.

13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.

17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".

18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A B C D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

FOURTH FLOOR
PLAN - AREA A

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-4A

DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 617.854.1700
www.dra.com

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.30' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETS/HOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.


NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

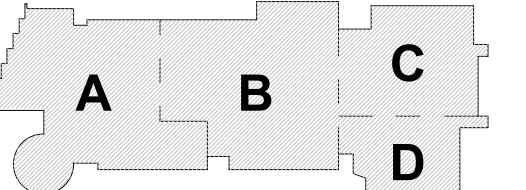

PROJECT NORTH
MAGNETIC NORTH

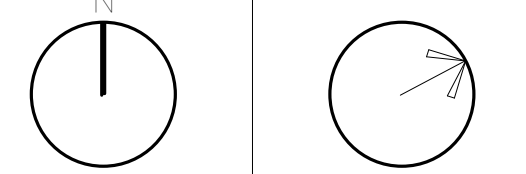

**FOURTH FLOOR
PLAN - AREA B**

Scale: 1/8" = 1'-0"
Job No.: 20202

Drawn By: DRA
Date: May 12TH, 2023

Volume 3 of 4

A1-1-4B

FOURTH FLOOR PLAN - AREA B

1/8" = 1'-0"

FOURTH FLOOR PLAN - AREA B

FOURTH FLOOR PLAN - AREA B

FOURTH FLOOR PLAN - AREA B

FOURTH FLOOR PLAN - AREA B

FOURTH FLOOR PLAN - AREA B

FOURTH FLOOR PLAN - AREA B


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
 2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
 4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
 5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
 6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
 7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
 8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
 9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
 11. REFER TO CODE ANALYSIS CD-1.1, CD-1.2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
 12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
 13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
 14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
 15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
 16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
 17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
 18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.
- NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

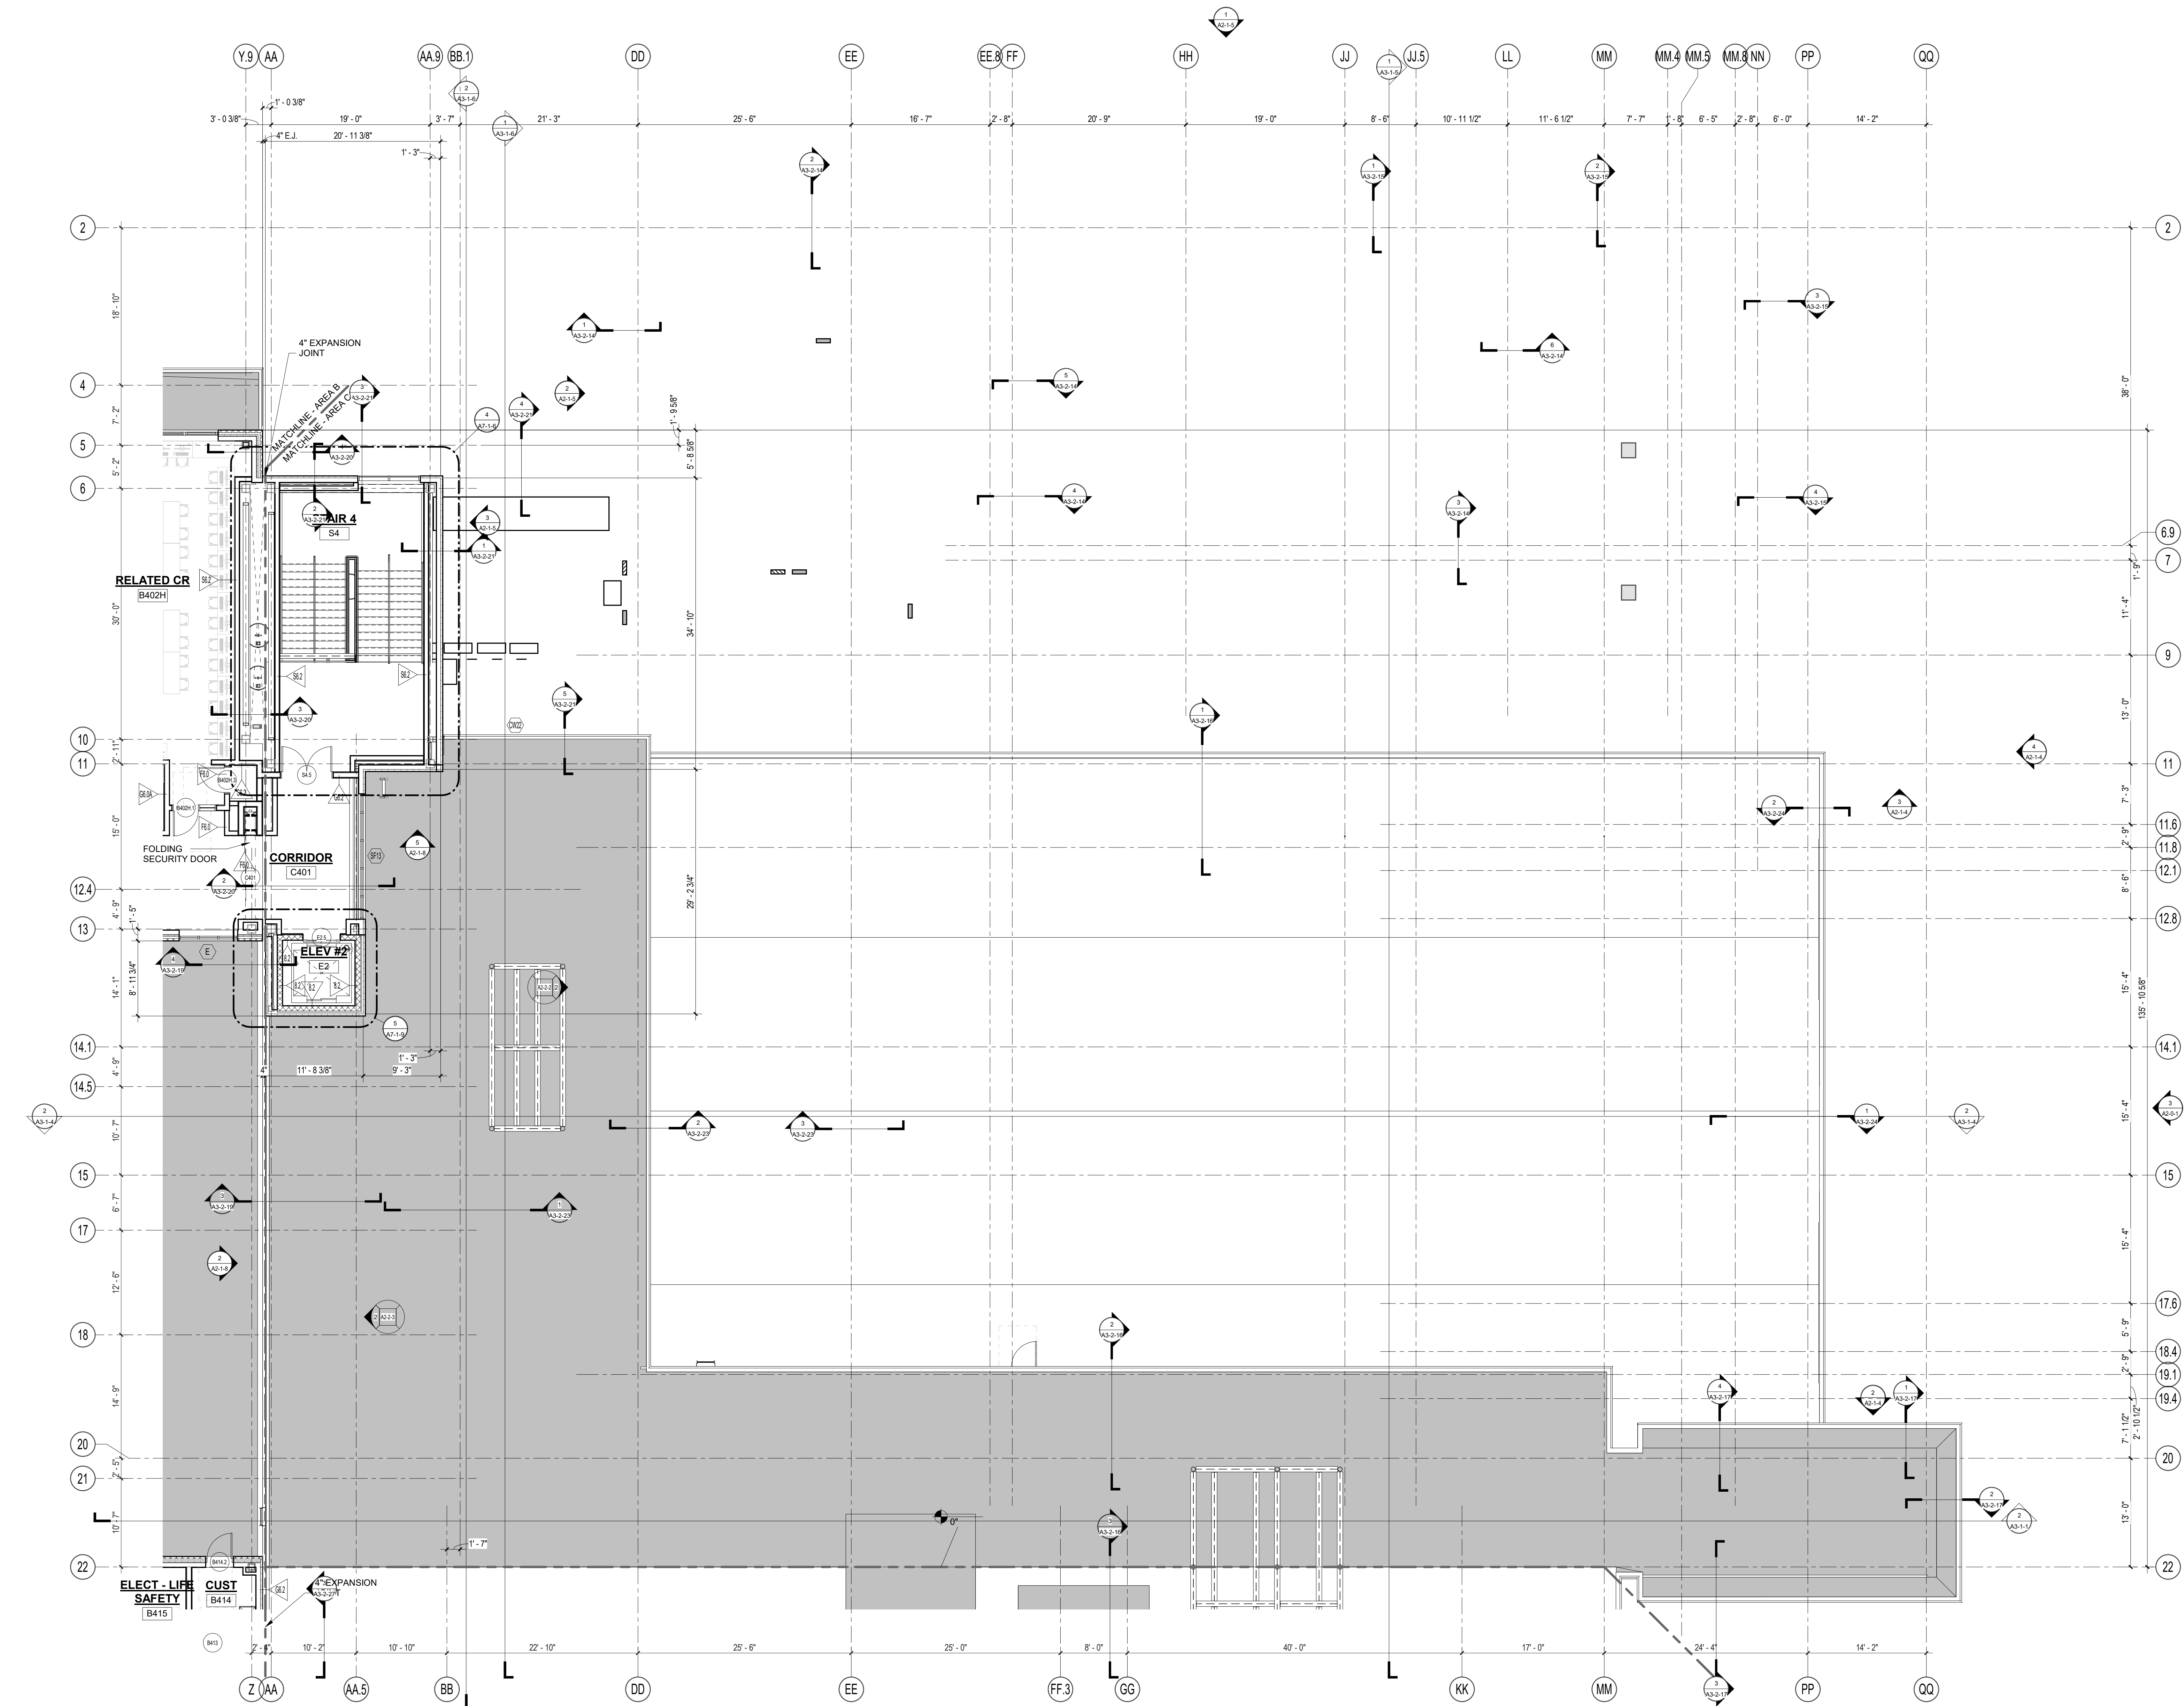

1 FOURTH FLOOR PLAN - AREA C
1/8" = 1'-0"


**MSBA 90% CD
SUBMISSION**

May 12TH, 2023

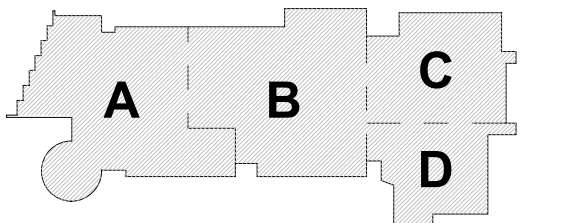

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

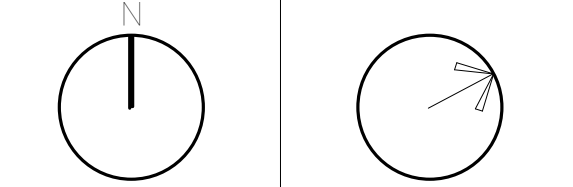

**FOURTH FLOOR
PLAN - AREA C**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-1-4C

Drummeys Rosane Anderson, Inc.

225 Oakland Road Studio 205 South Windsor, CT 06074	260 Charles Street Studio 300 Waltham, MA 02453
--	--

Planning | Architecture | Interior Design

Tel: 617.954.1700
www.drums.com


100 Hemlock Road,
Wakefield, MA 01880

FOR PLAN GENERAL NOTES:

- [illegible]


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

May 12TH, 2023

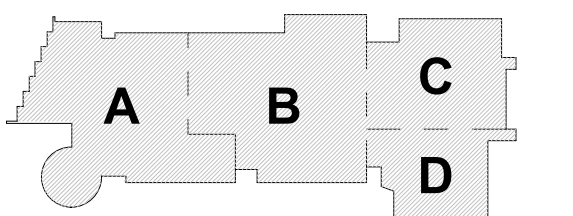


KEY PLAN

PROJECT NORTH	MAGNETIC NORTH
---------------	----------------

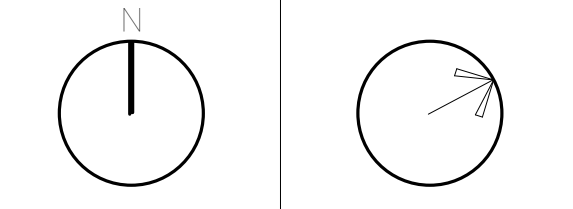

**FOURTH FLOOR
PLAN - AREA D**

Scale: 1/8" = 1'-0"
 No.: 20202
 Drawn By: DRA
 Date: May 12TH, 2023
 Page 3 of 4




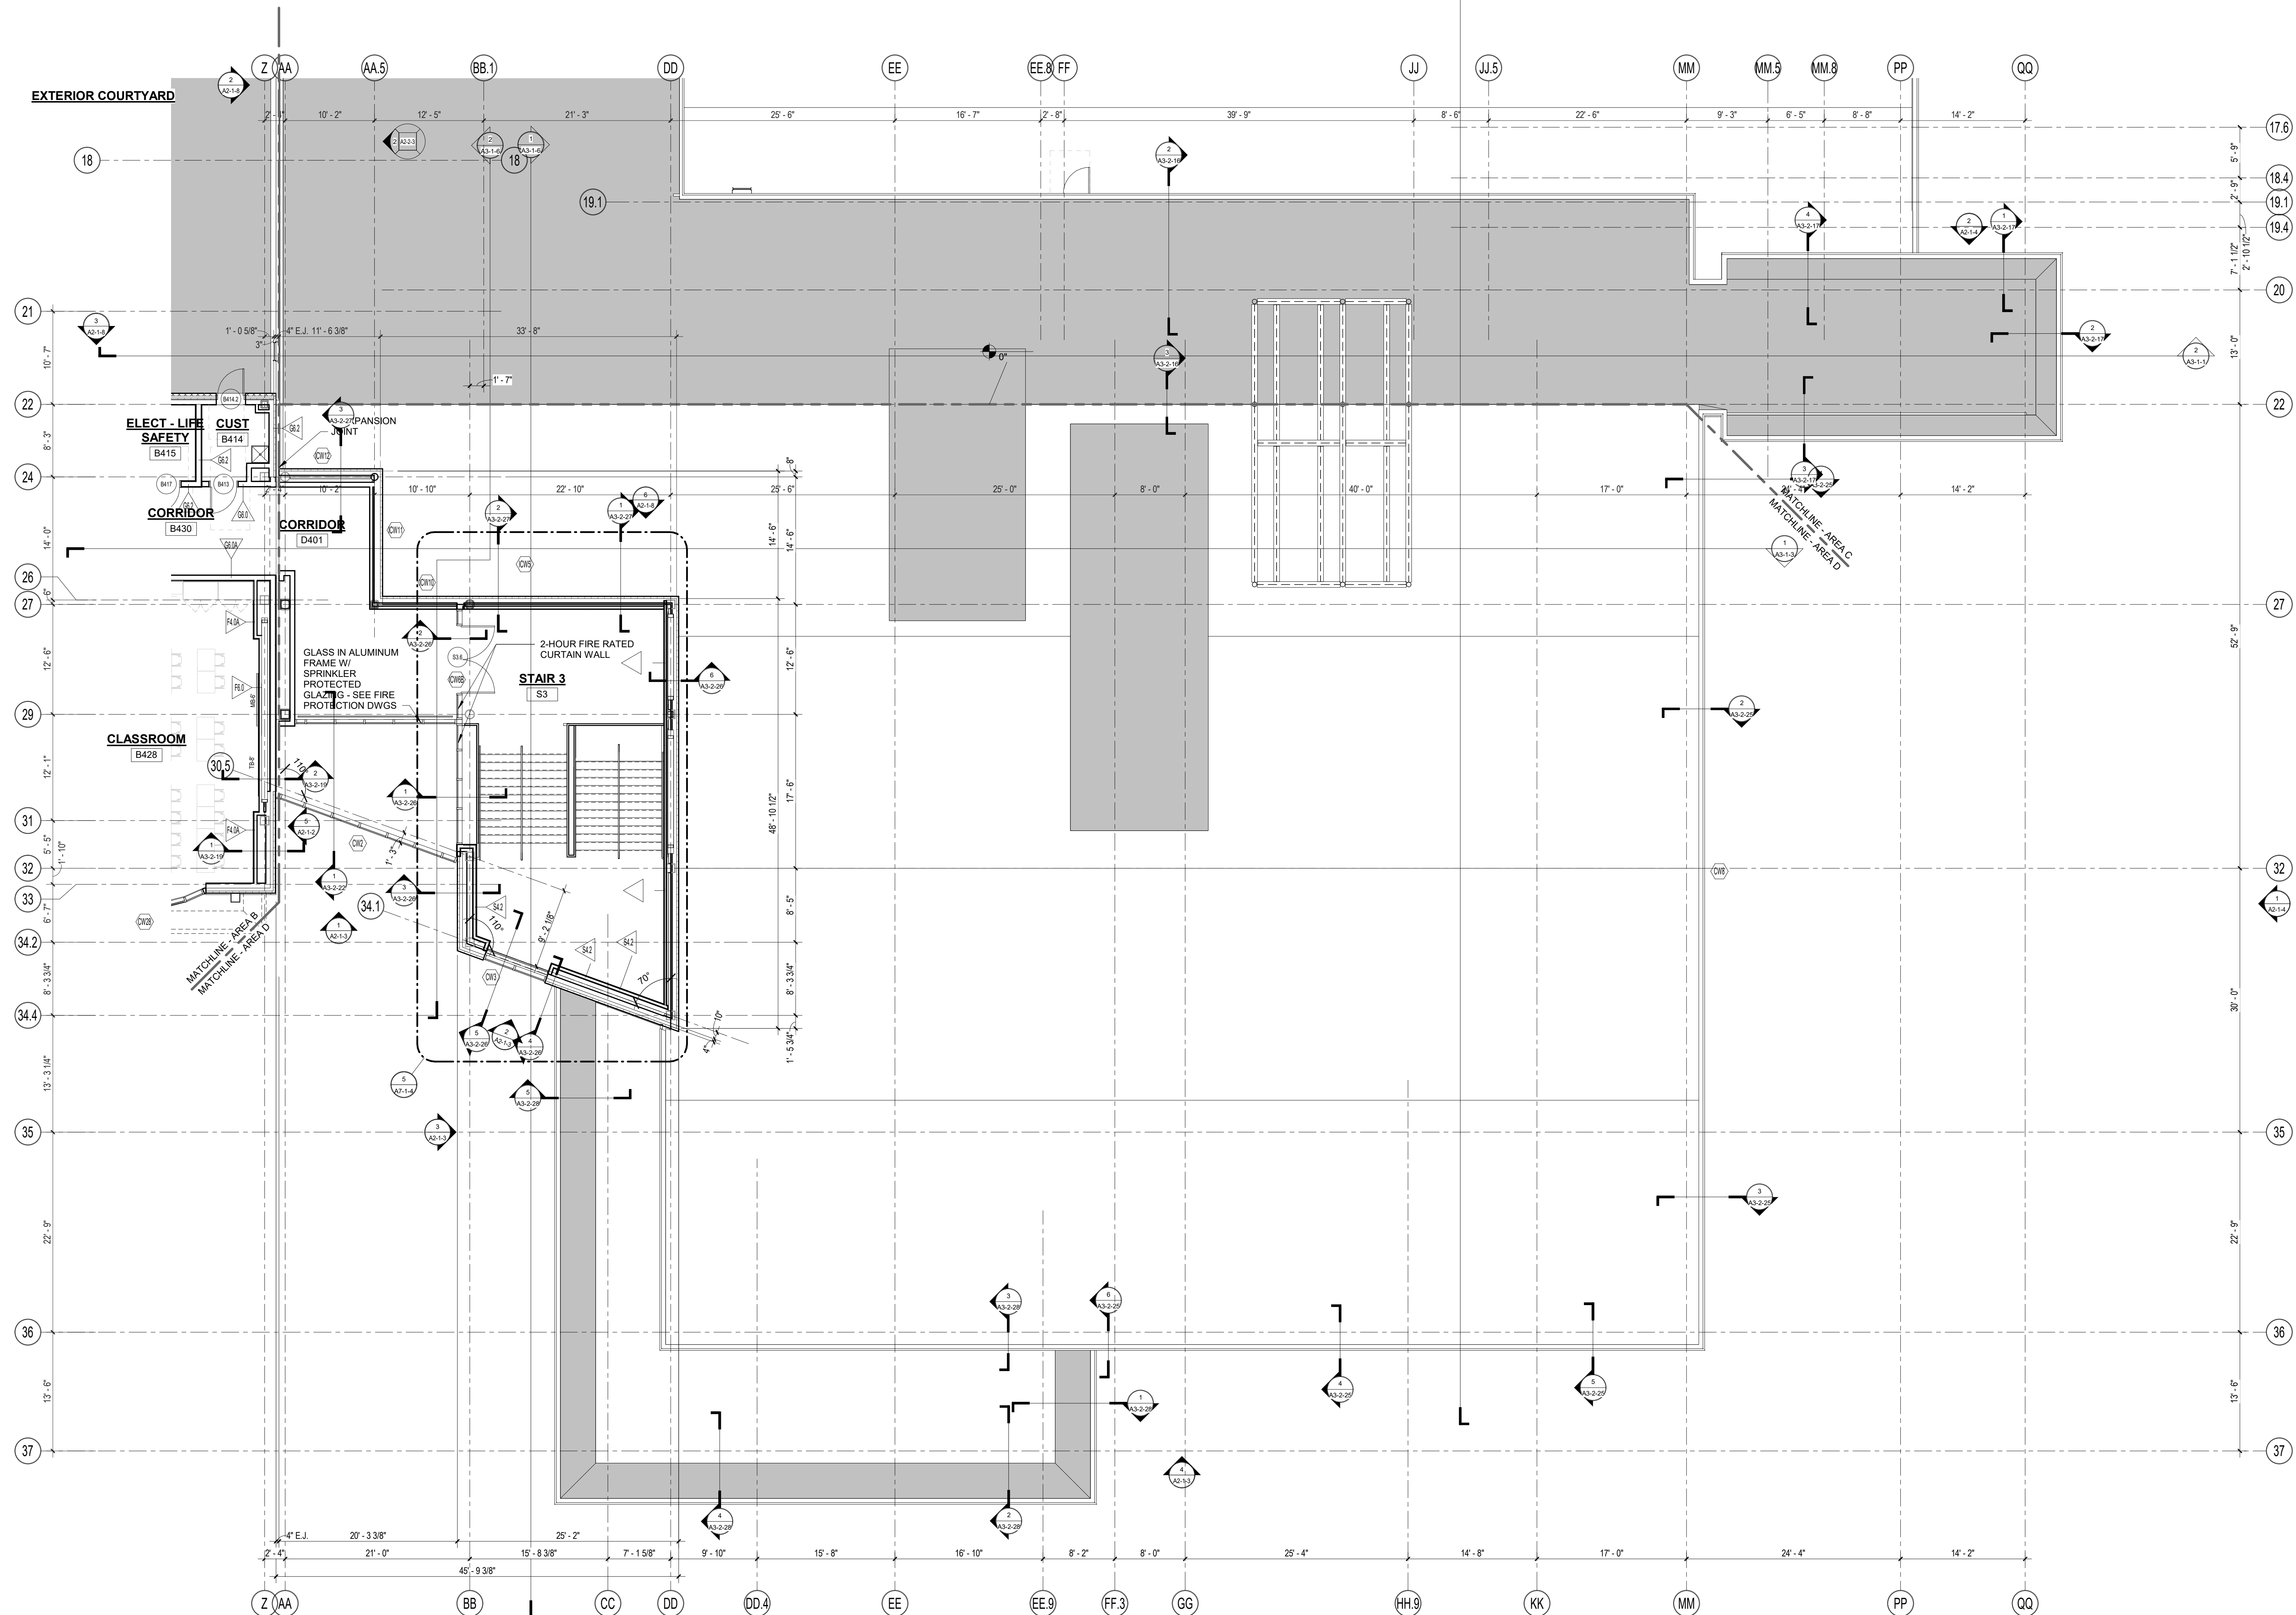


1 FOURTH FLOOR PLAN - AREA D
1/8" = 1'-0"

100 Hemlock Road,
Wakefield, MA 01880

ROOF LEGEND

ROOF LEGEND

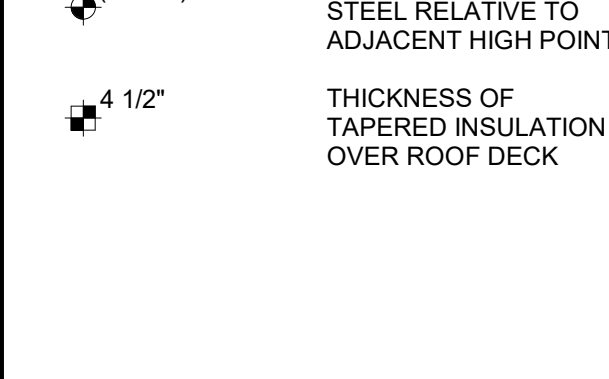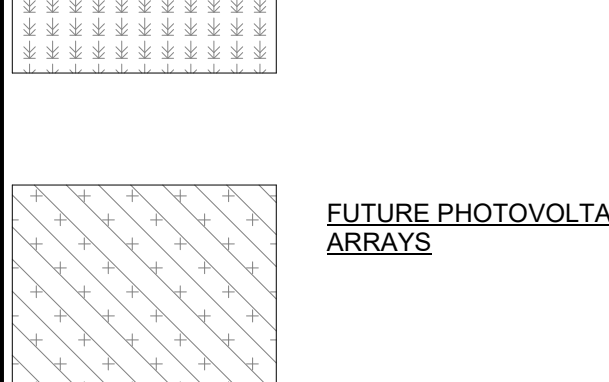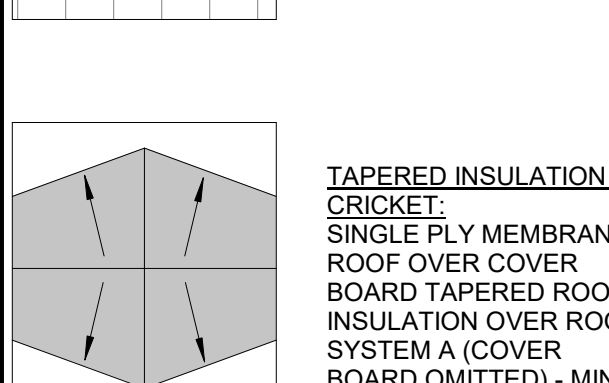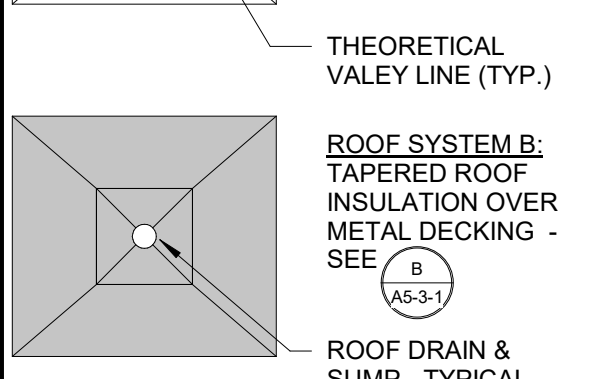

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON INC

MSBA 90% CD
SUBMISSION

May 12TH, 2023




Scale: 1/8" = 1'-0"	
Job No.: 20202	

Scale: 1/8" = 1'-0"	
Job No.: 20202	

Drawn By: DRA **A1-2-1A**

Date: May 12TH, 2023

Volume 3 of 4	
---------------	--

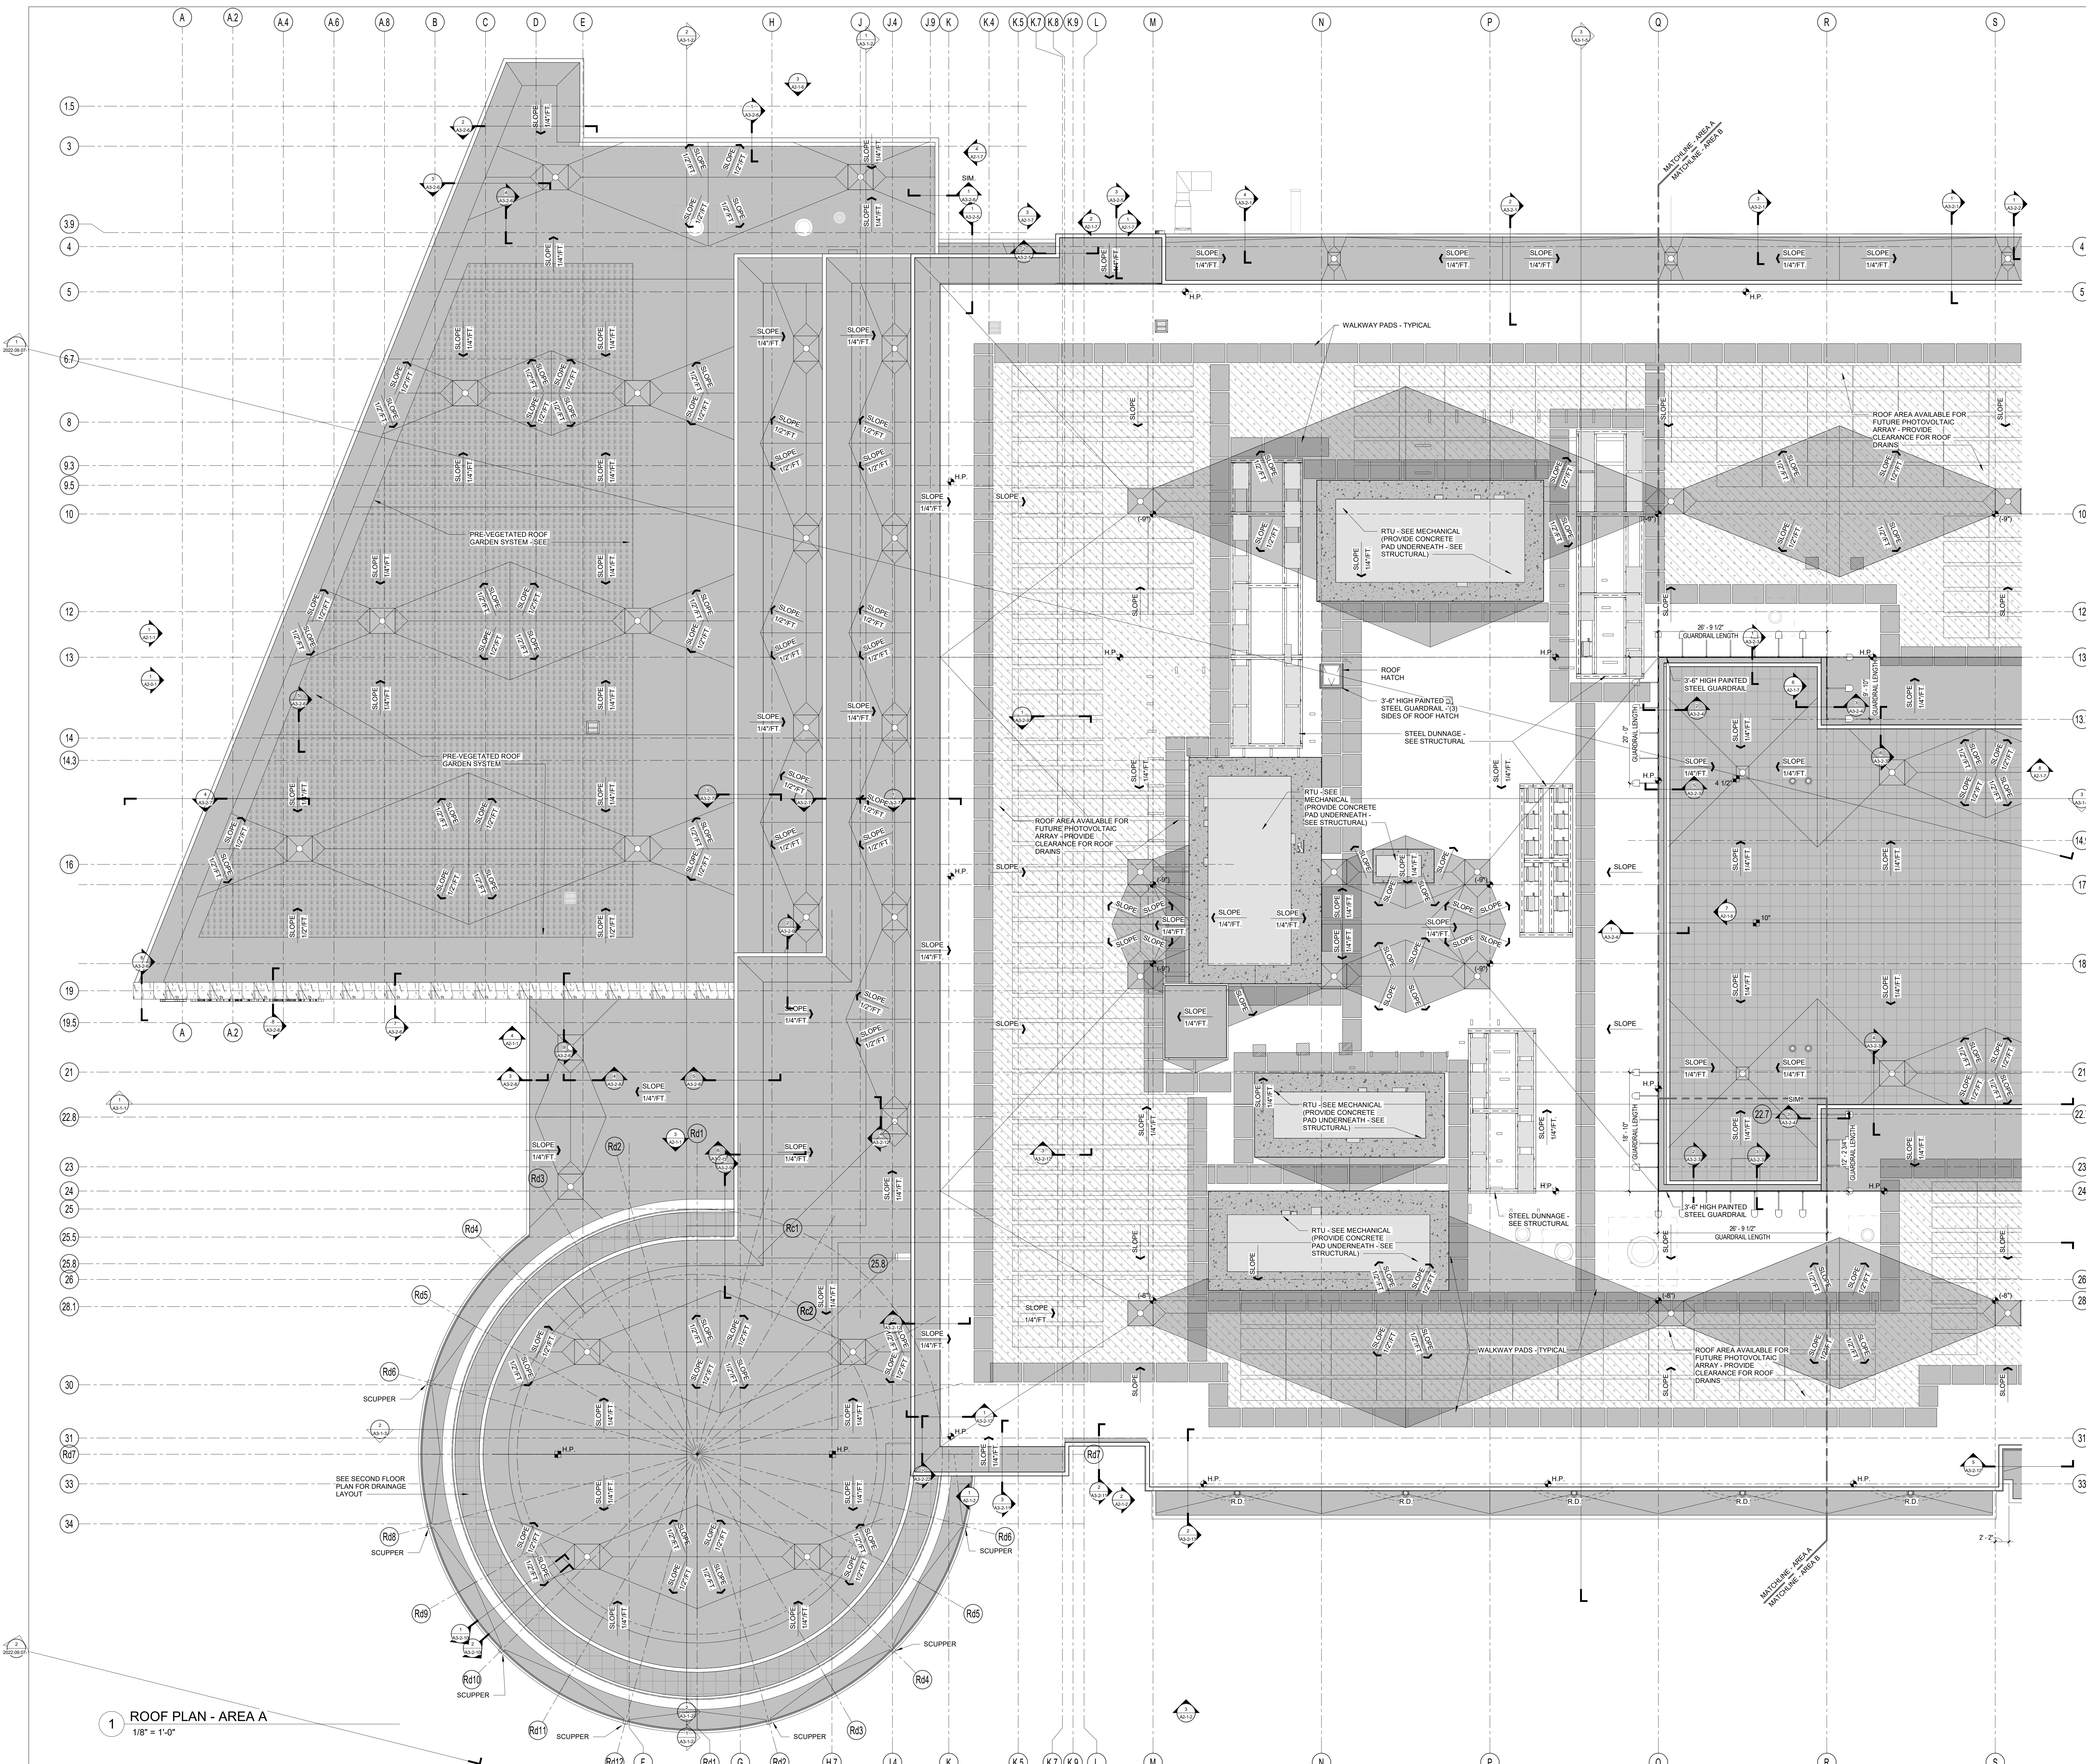

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

ROOF LEGEND

ROOF SYSTEM A:
ROOF INSULATION OVER
PITCHED METAL
DECKING - SEE
ROOF DRAIN &
SUMP - TYPICAL

ROOF SYSTEM B:
TAPERED ROOF
INSULATION OVER
METAL DECKING -
SEE
ROOF DRAIN &
SUMP - TYPICAL

WALKABLE ROOF:
RUBBER ROOFTOP
PAVERS OVER ROOF
MEMBRANE

TAPERED INSULATION:
CRICKET
SINGLE PLY MEMBRANE
ROOF OVER COVER
BOARD TAPERED ROOF
INSULATION OVER ROOF
SYSTEM A (COVER
BOARD OMITTED) - MIN.
1/2" PER FOOT SLOPE


PRE-VEGETATED ROOF:
GARDEN SYSTEM

FUTURE PHOTOVOLTAIC
AREAS

H.P.
ELEVATION OF PITCHED
STEEL RELATIVE TO
ADJACENT HIGH POINT
THICKNESS OF
TAPERED INSULATION
OVER ROOF DECK


MSBA 90% CD
SUBMISSION

May 12TH, 2023

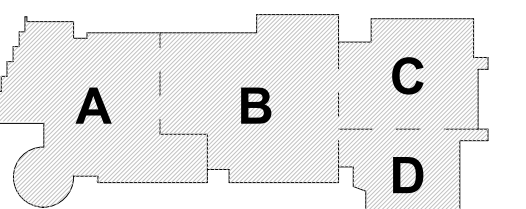


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**ROOF PLAN -
AREA B**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A1-2-1B

1 ROOF PLAN - AREA B
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.draa.com







280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


ROOF LEGEND

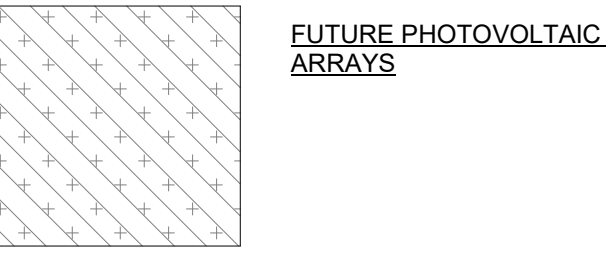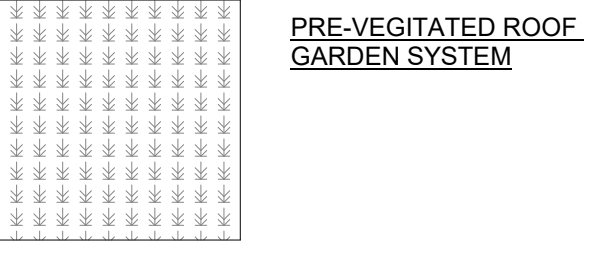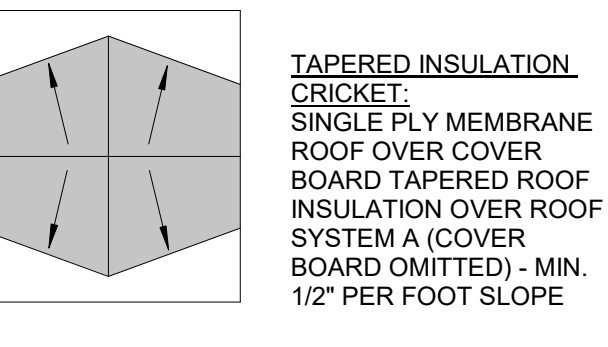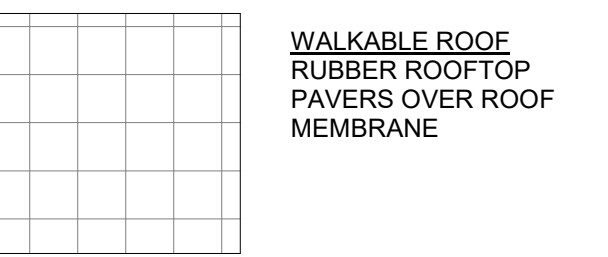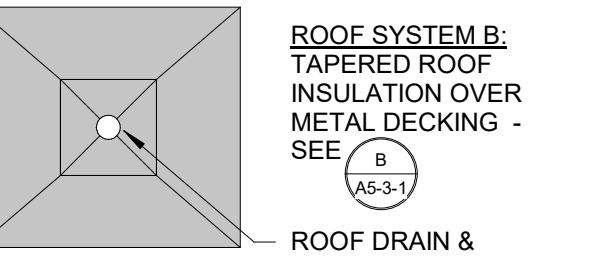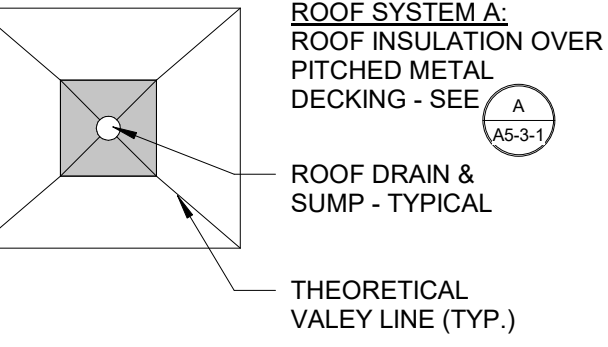

H.P.
ELEVATION OF PITCHED STEEL RELATIVE TO ADJACENT HIGH POINT
THICKNESS OF TAPERED INSULATION OVER ROOF DECK


MSBA 90% CD
SUBMISSION

May 12TH, 2023

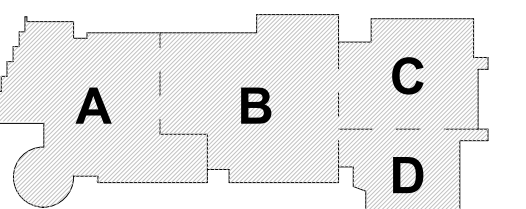

KEY PLAN


PROJECT NORTH
MAGNETIC NORTH

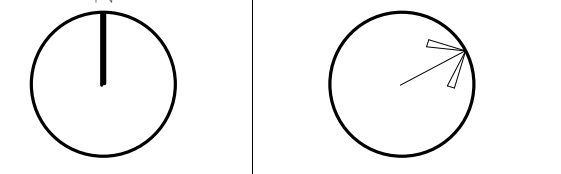

**ROOF PLAN -
AREA C**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4








A1-2-1C

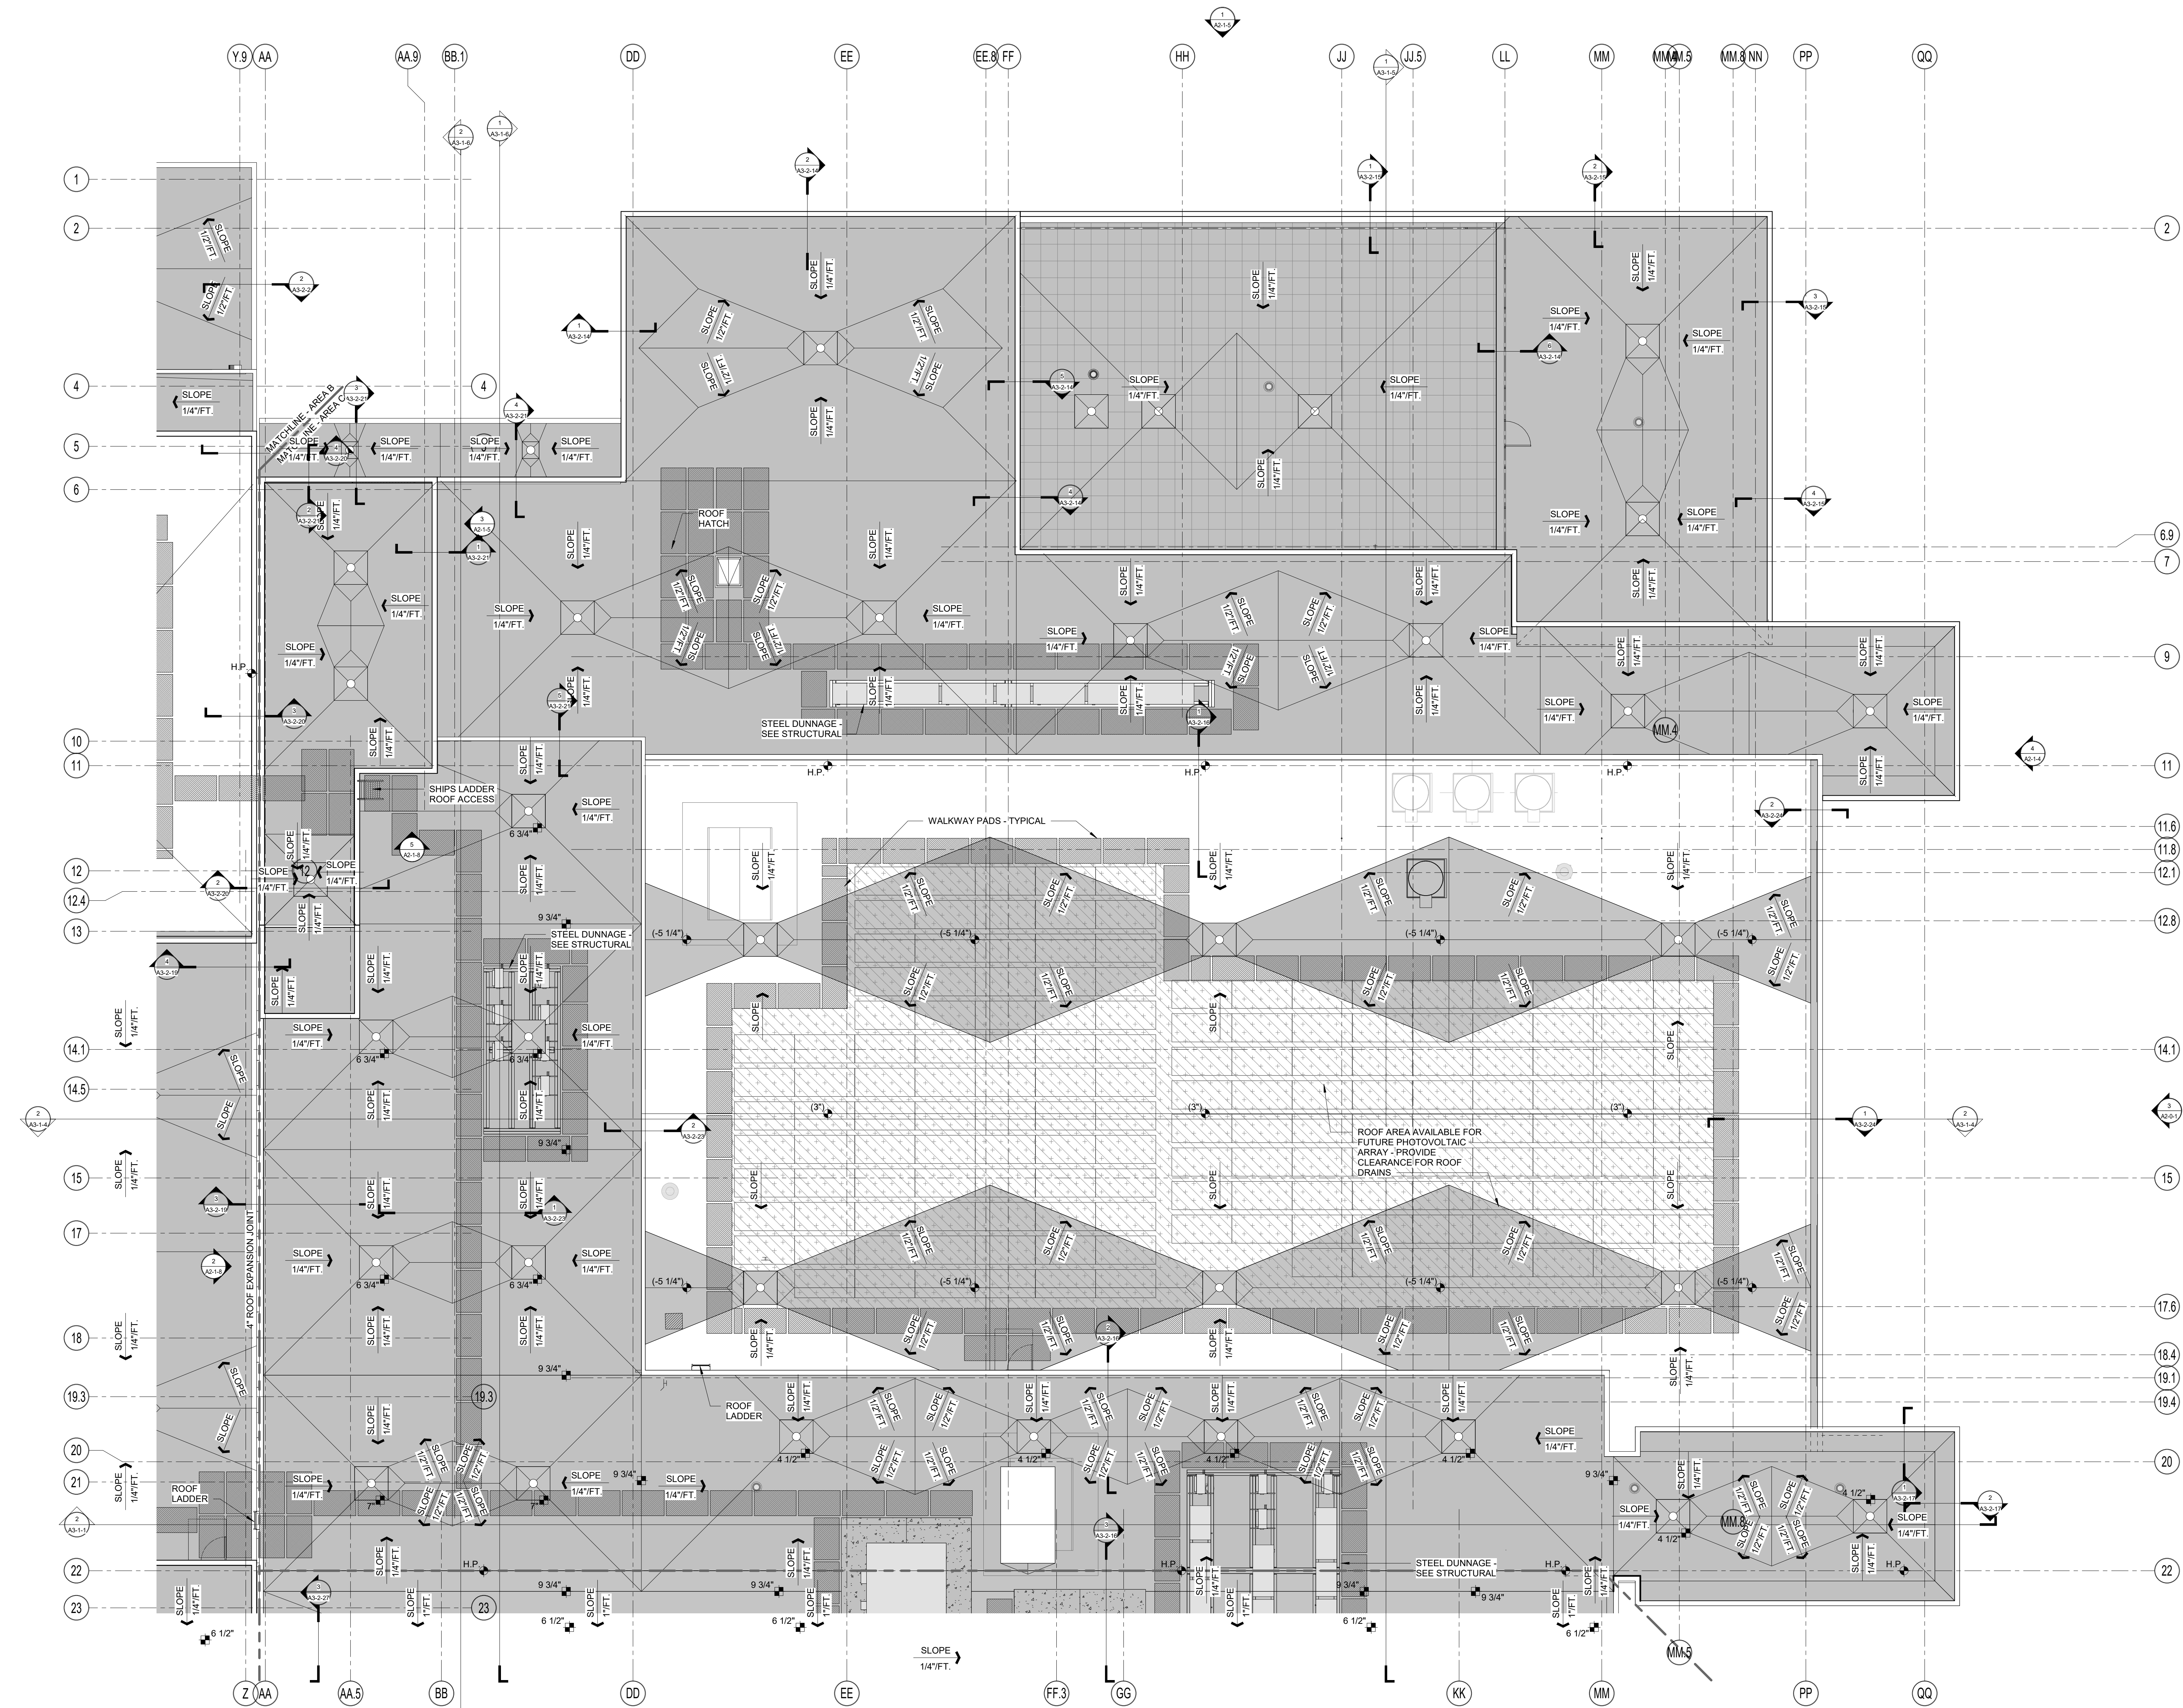


1 ROOF PLAN - AREA C
1/8" = 1'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

ROOF LEGEND

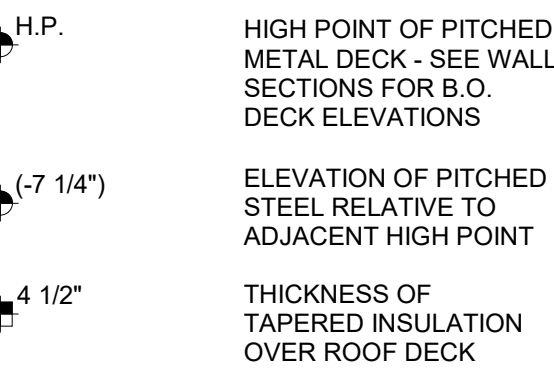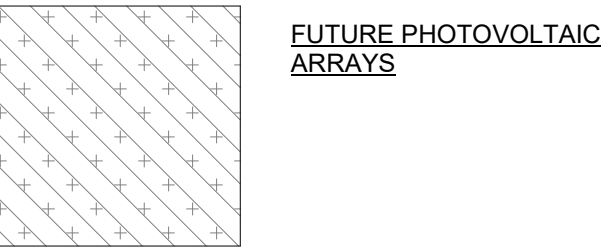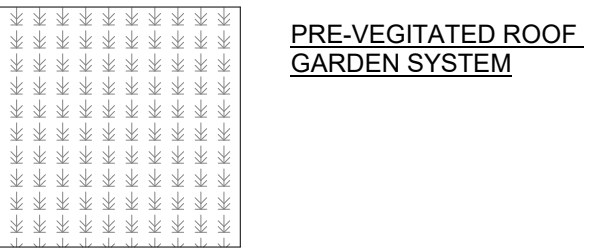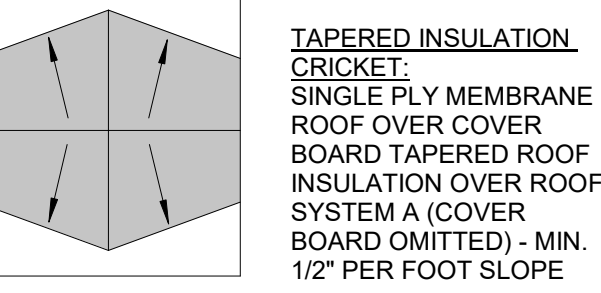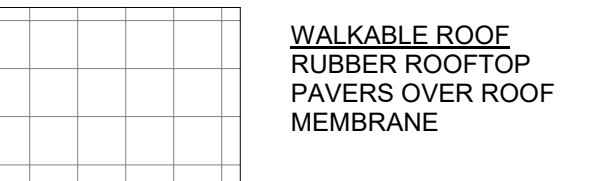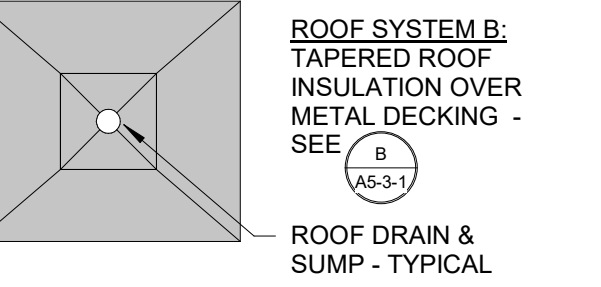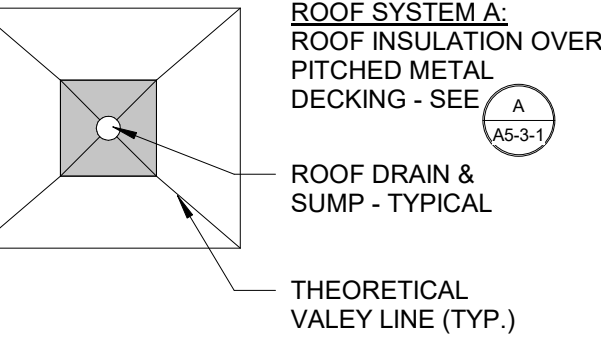


MSBA 90% CD
SUBMISSION
May 12TH, 2023

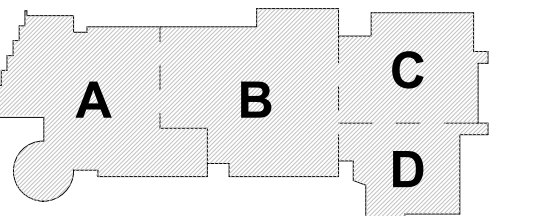

KEY PLAN


PROJECT NORTH
MAGNETIC NORTH

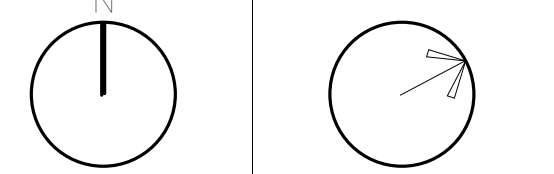




**ROOF PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A1-2-1D

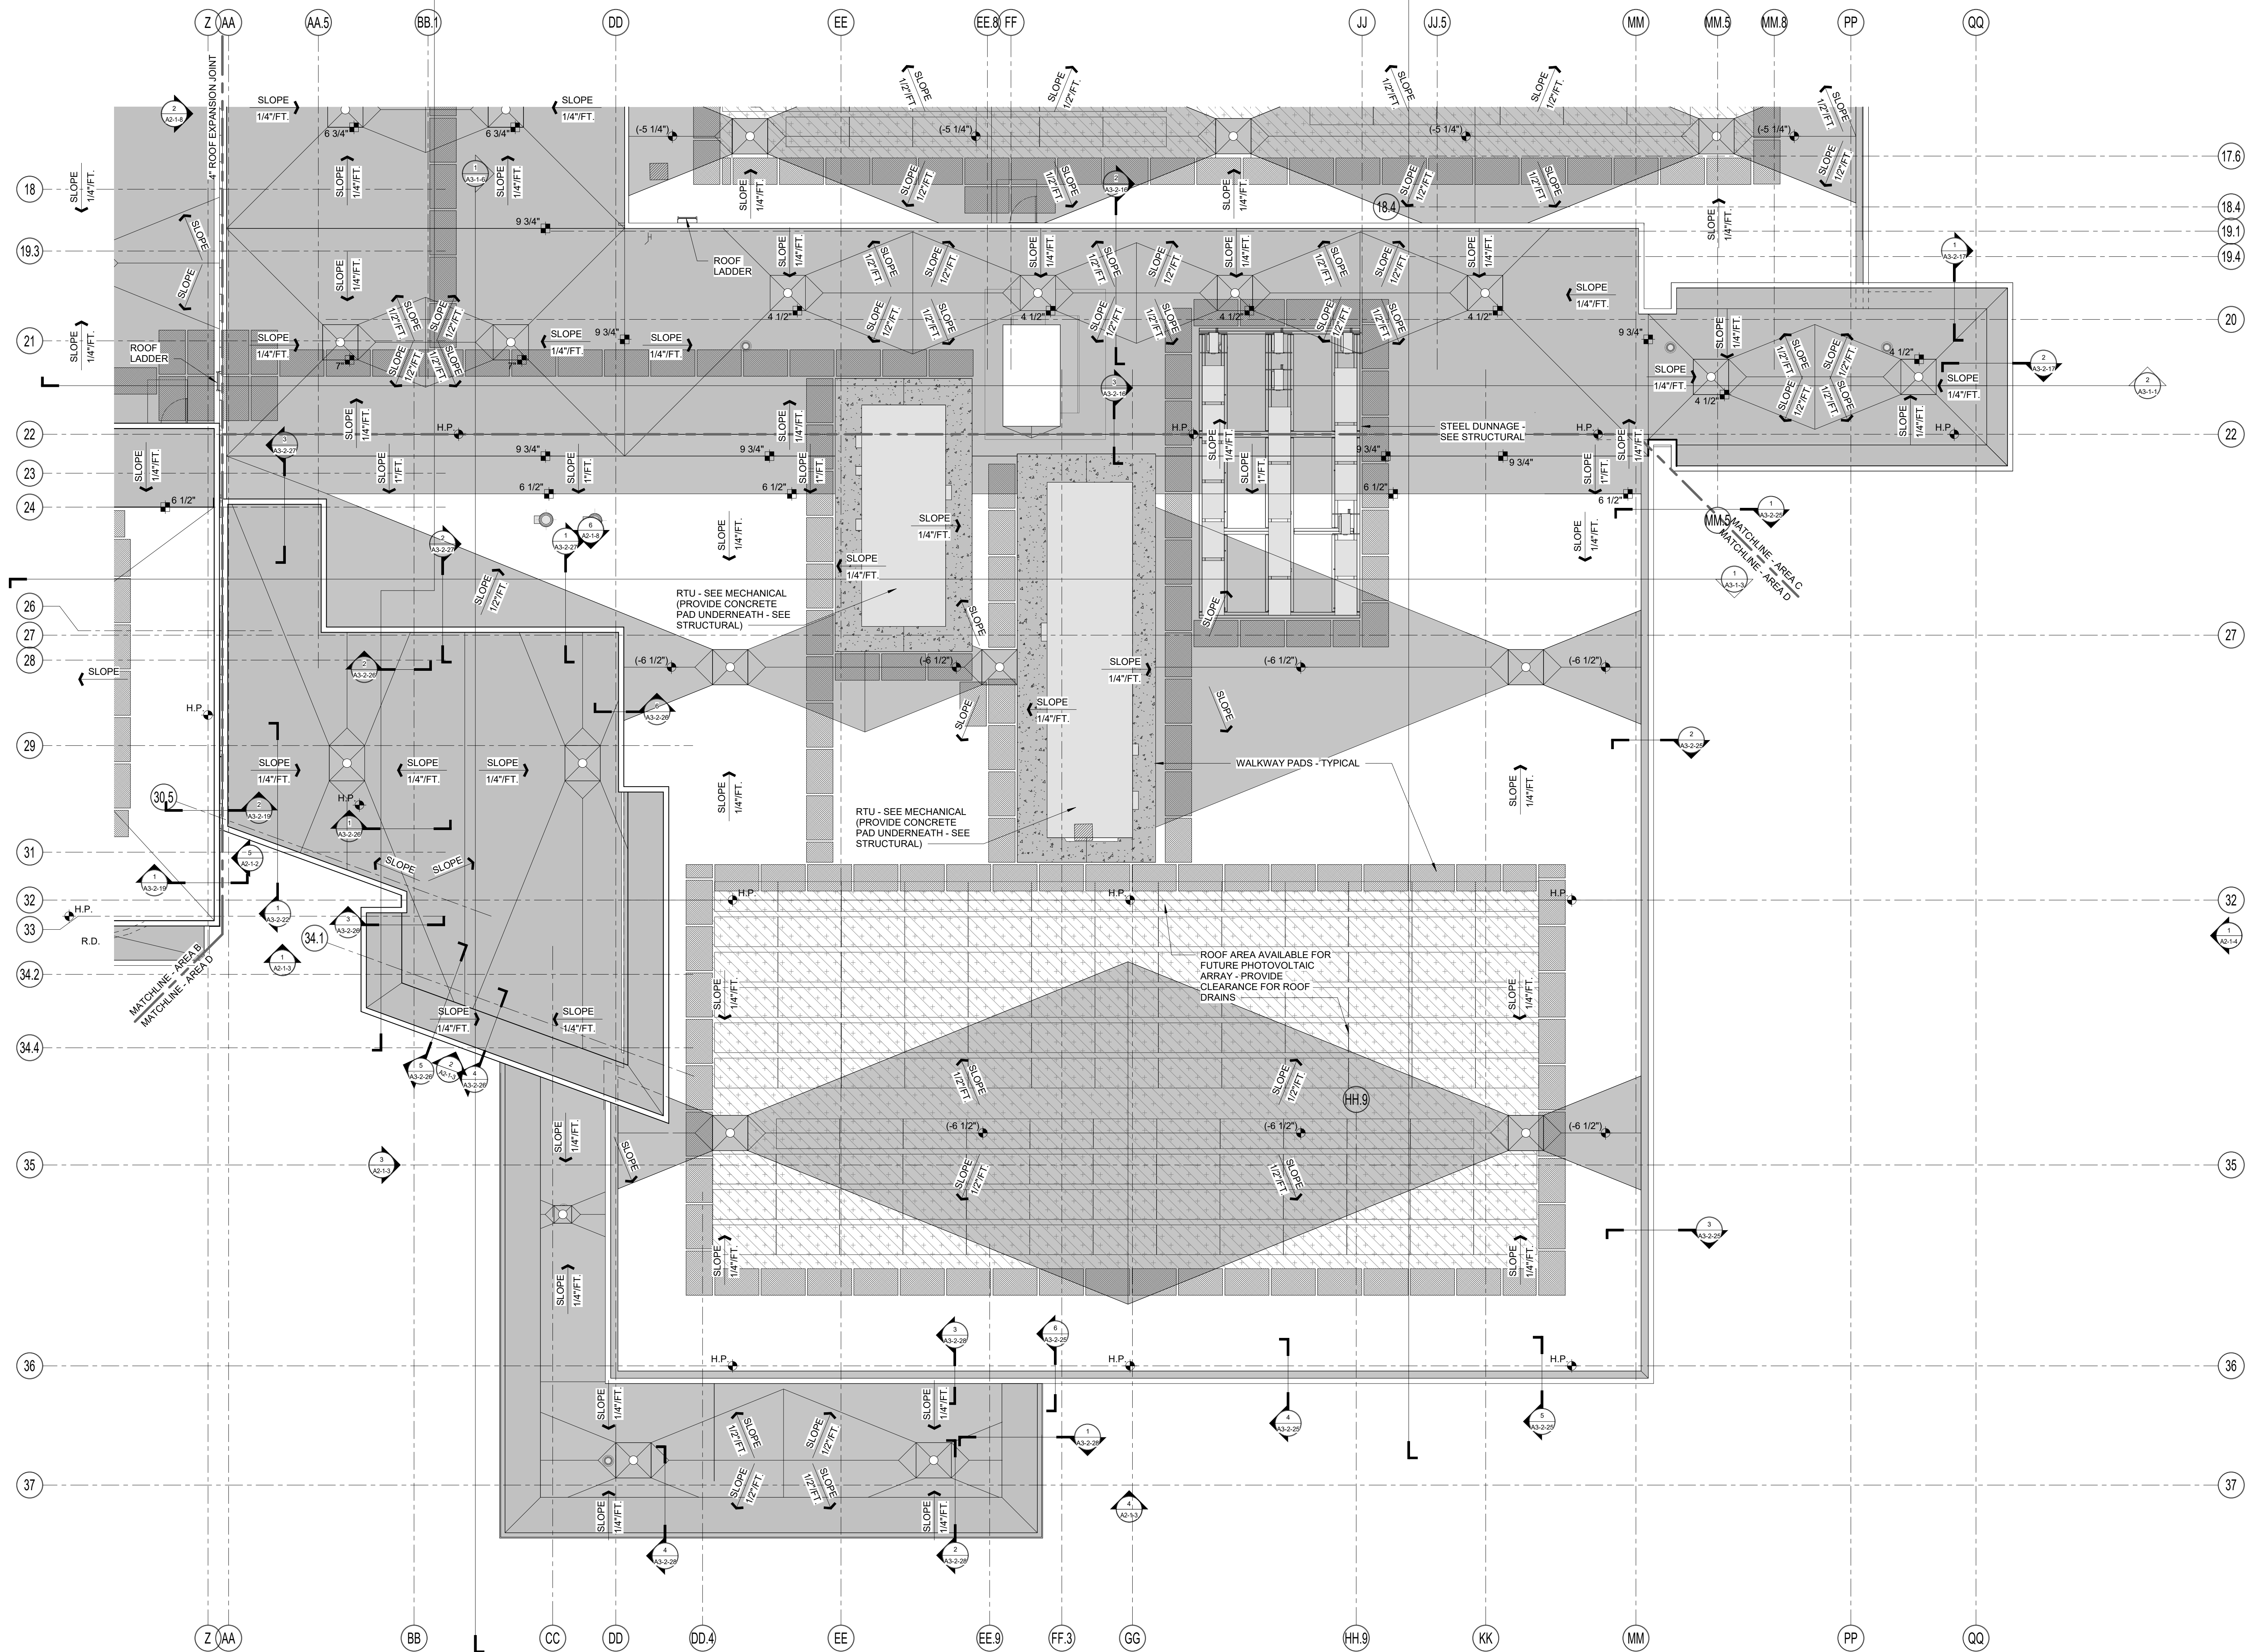


1 ROOF PLAN - AREA D
1/8" = 1'-0"

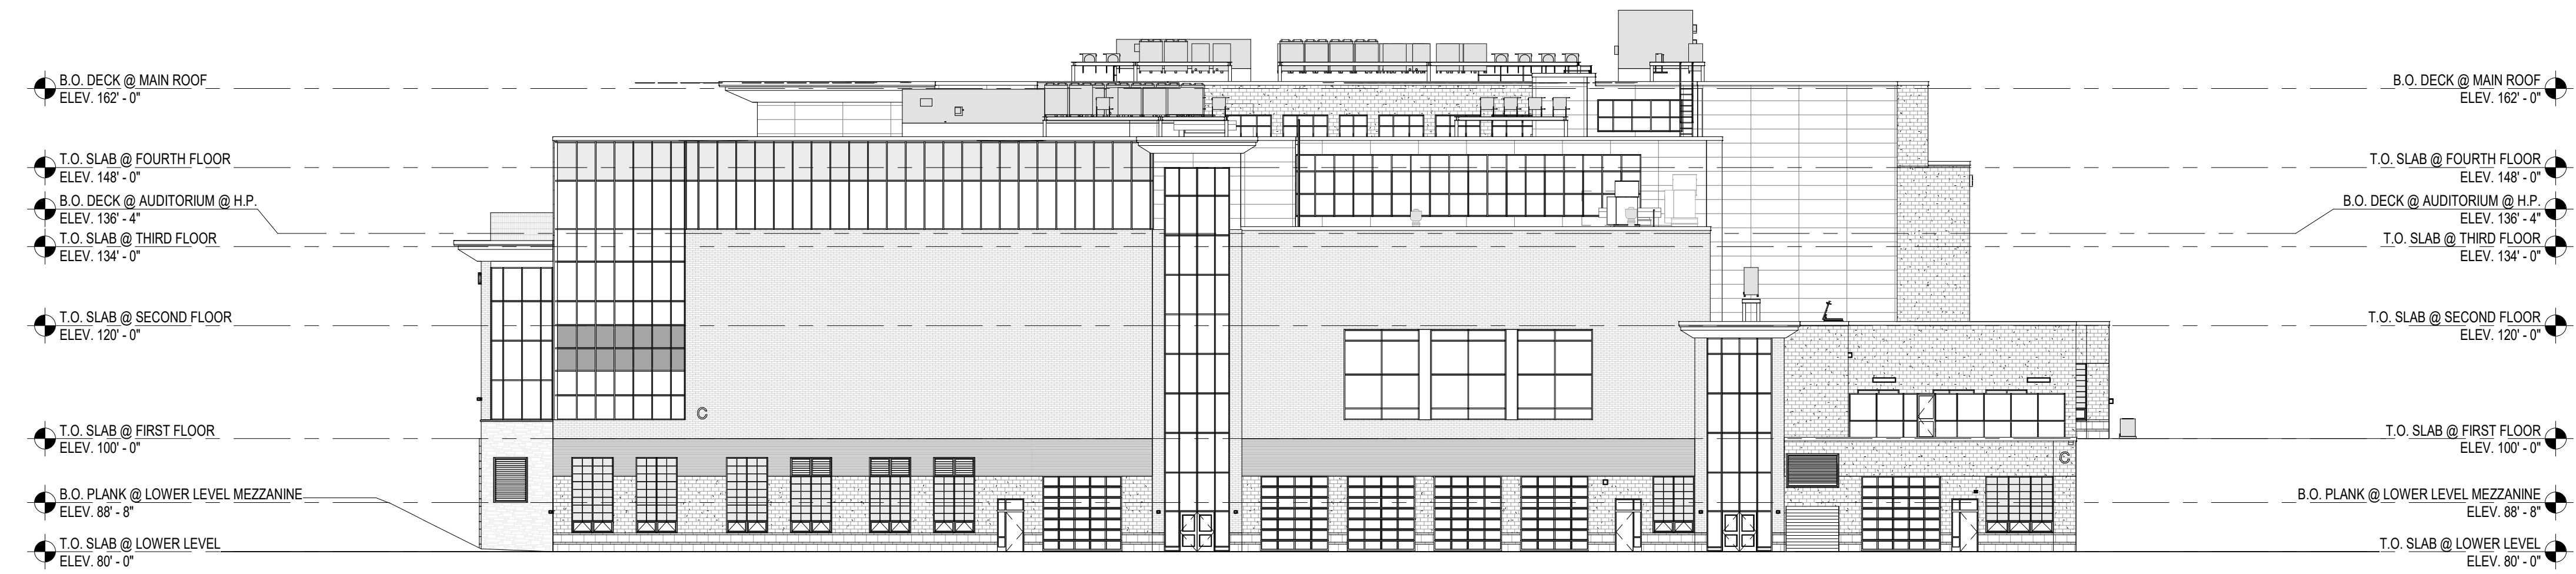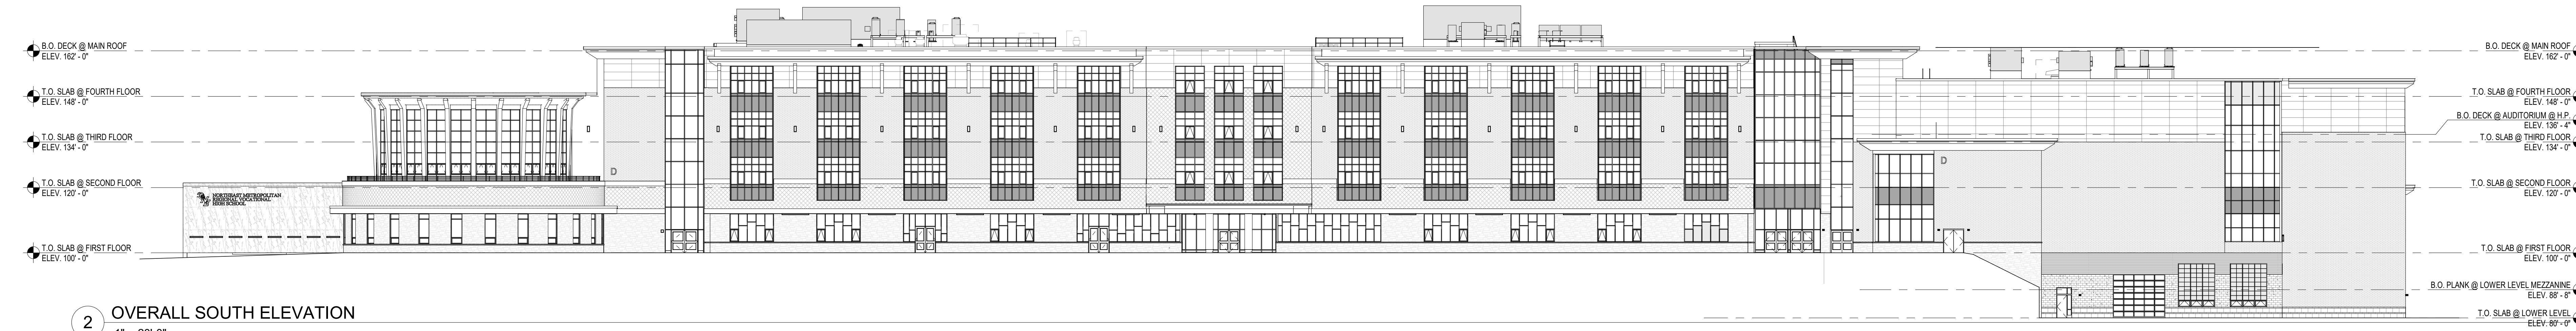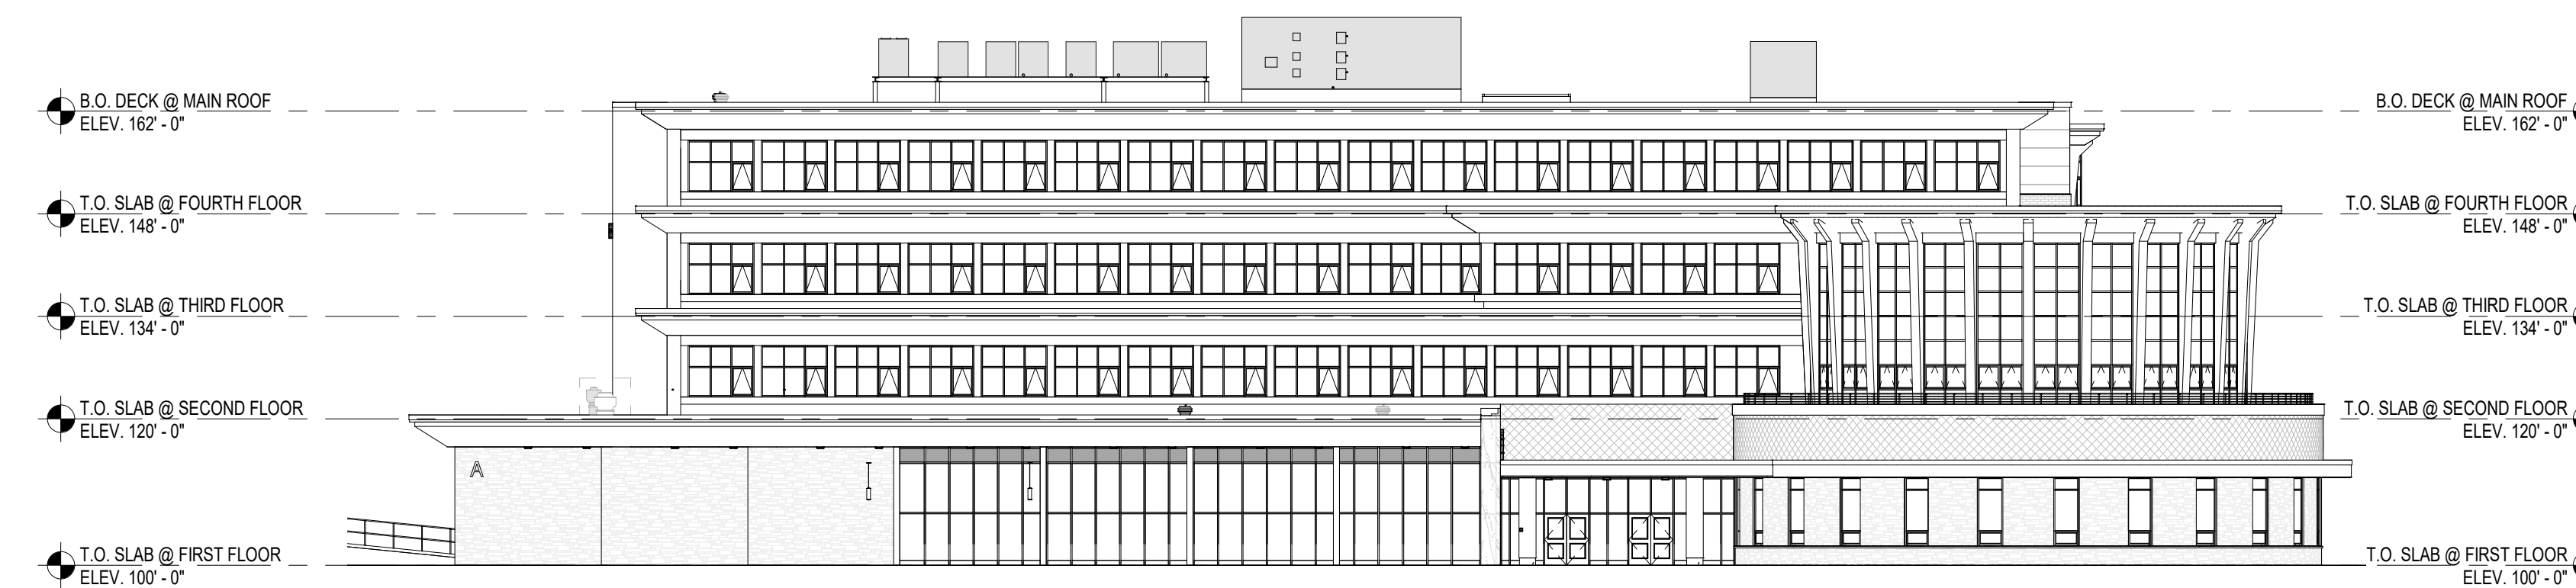**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880**4 OVERALL NORTH ELEVATION**
1" = 20'-0"**3 OVERALL EAST ELEVATION**
1" = 20'-0"**2 OVERALL SOUTH ELEVATION**
1" = 20'-0"**1 OVERALL WEST ELEVATION**
1" = 20'-0"

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

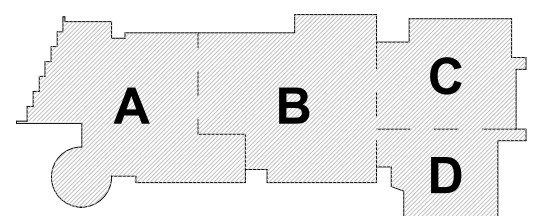


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH

**OVERALL
BUILDING
ELEVATIONS**

Scale: 1" = 20'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A2-0-1

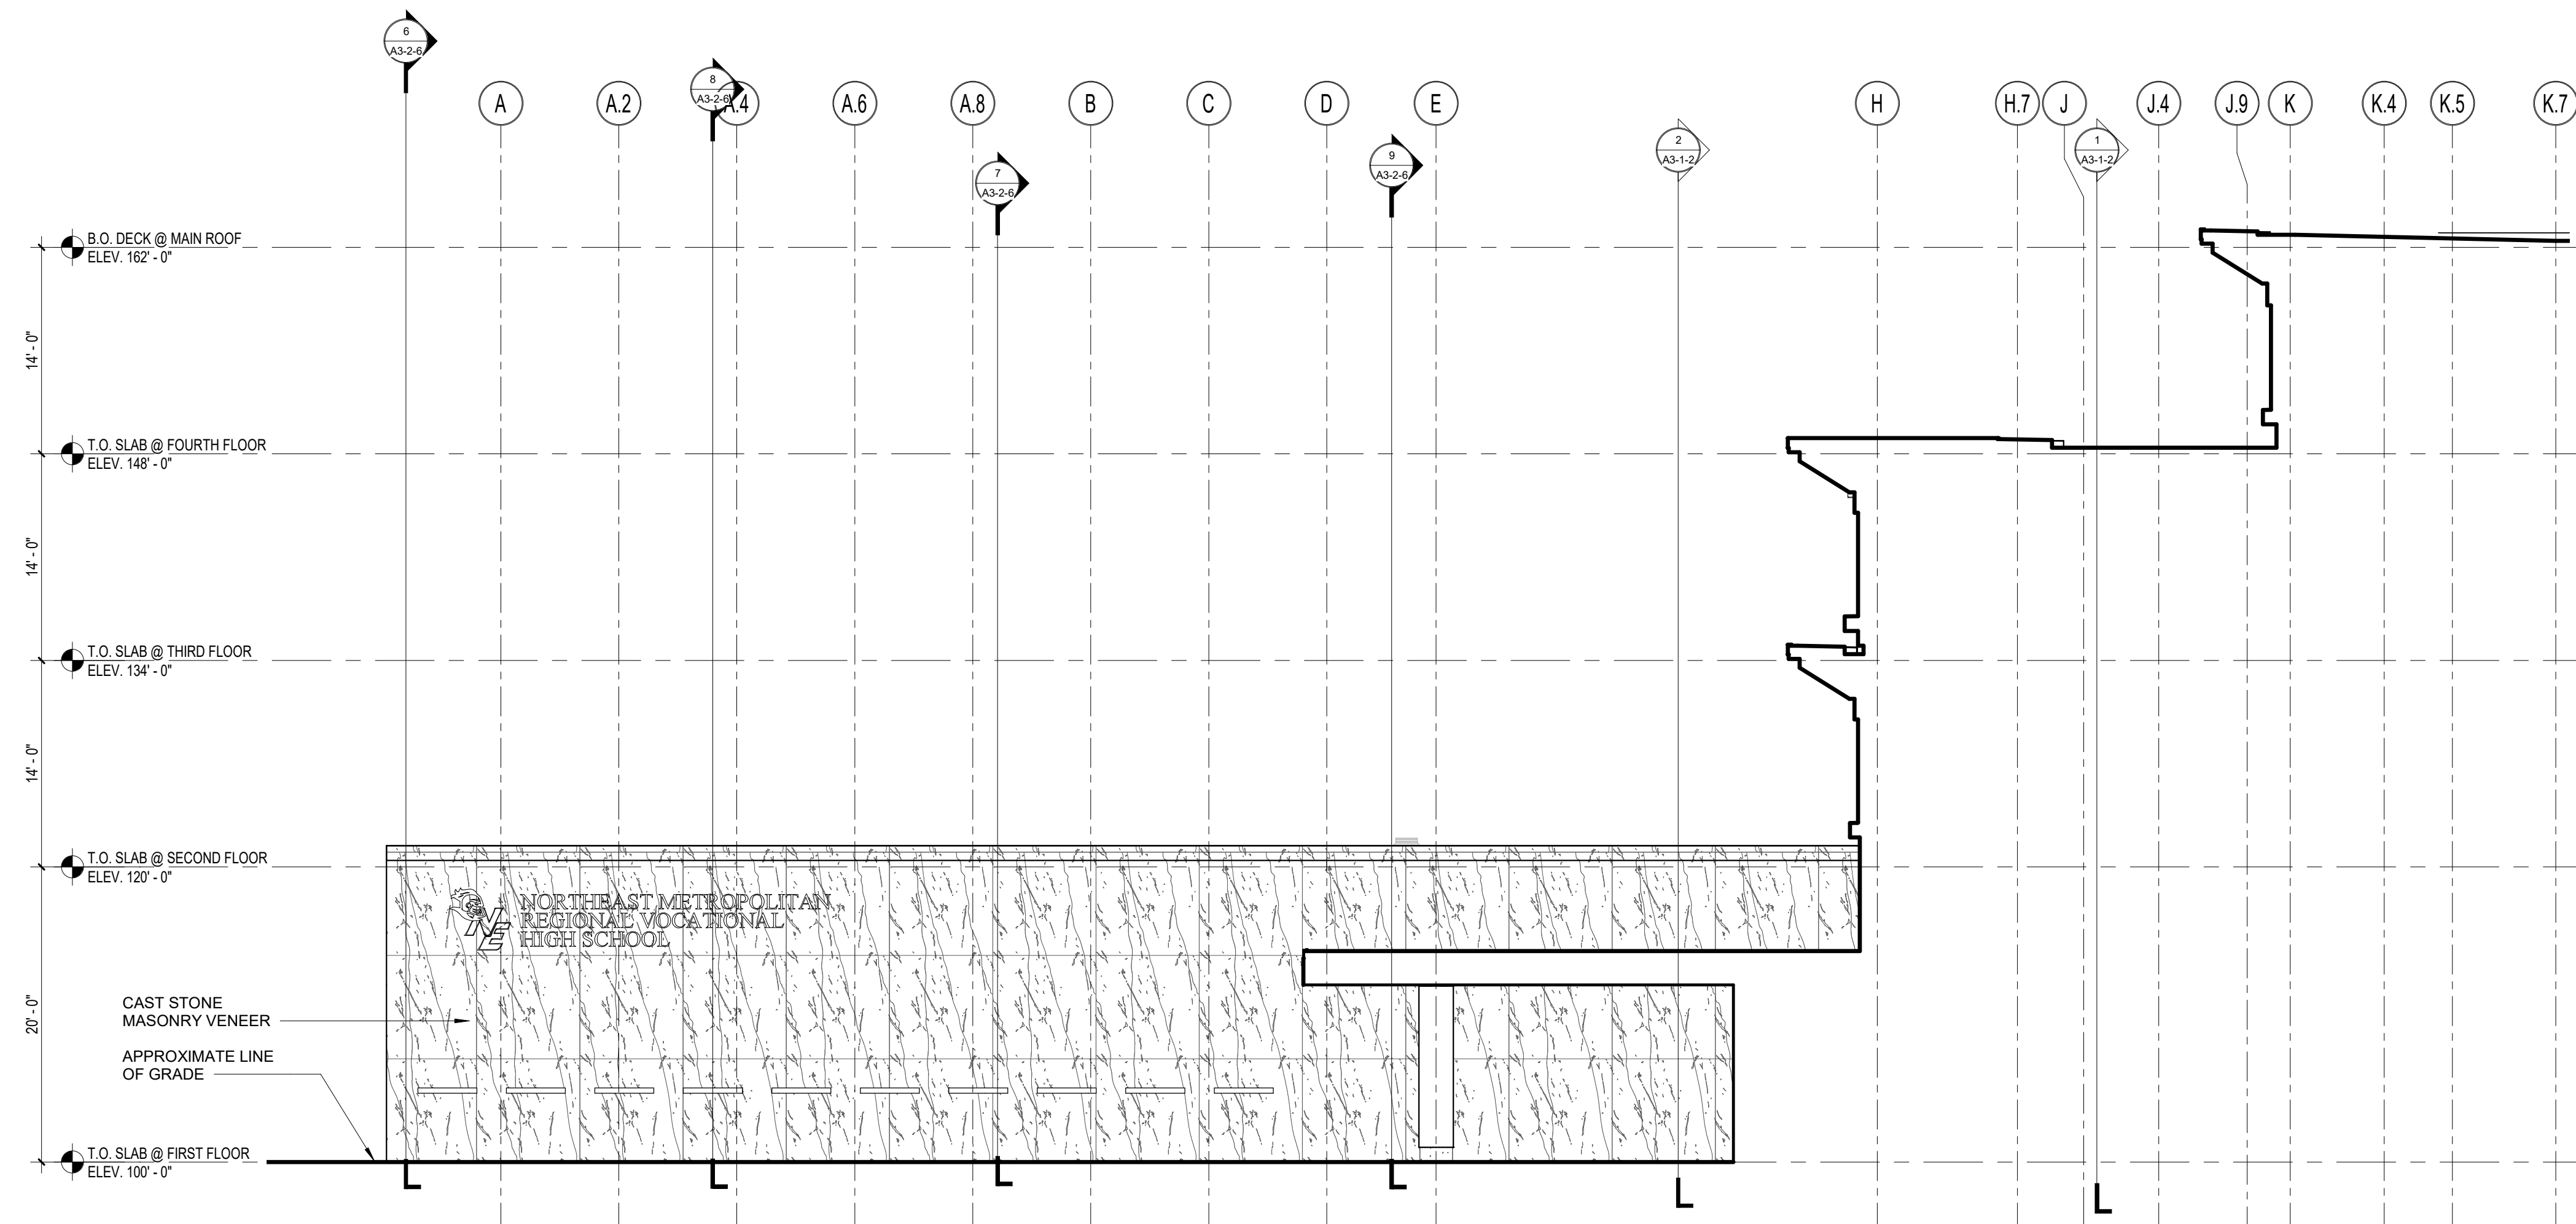


2 SOUTH ELEVATION - BASE BID
1/8" = 1'-0"

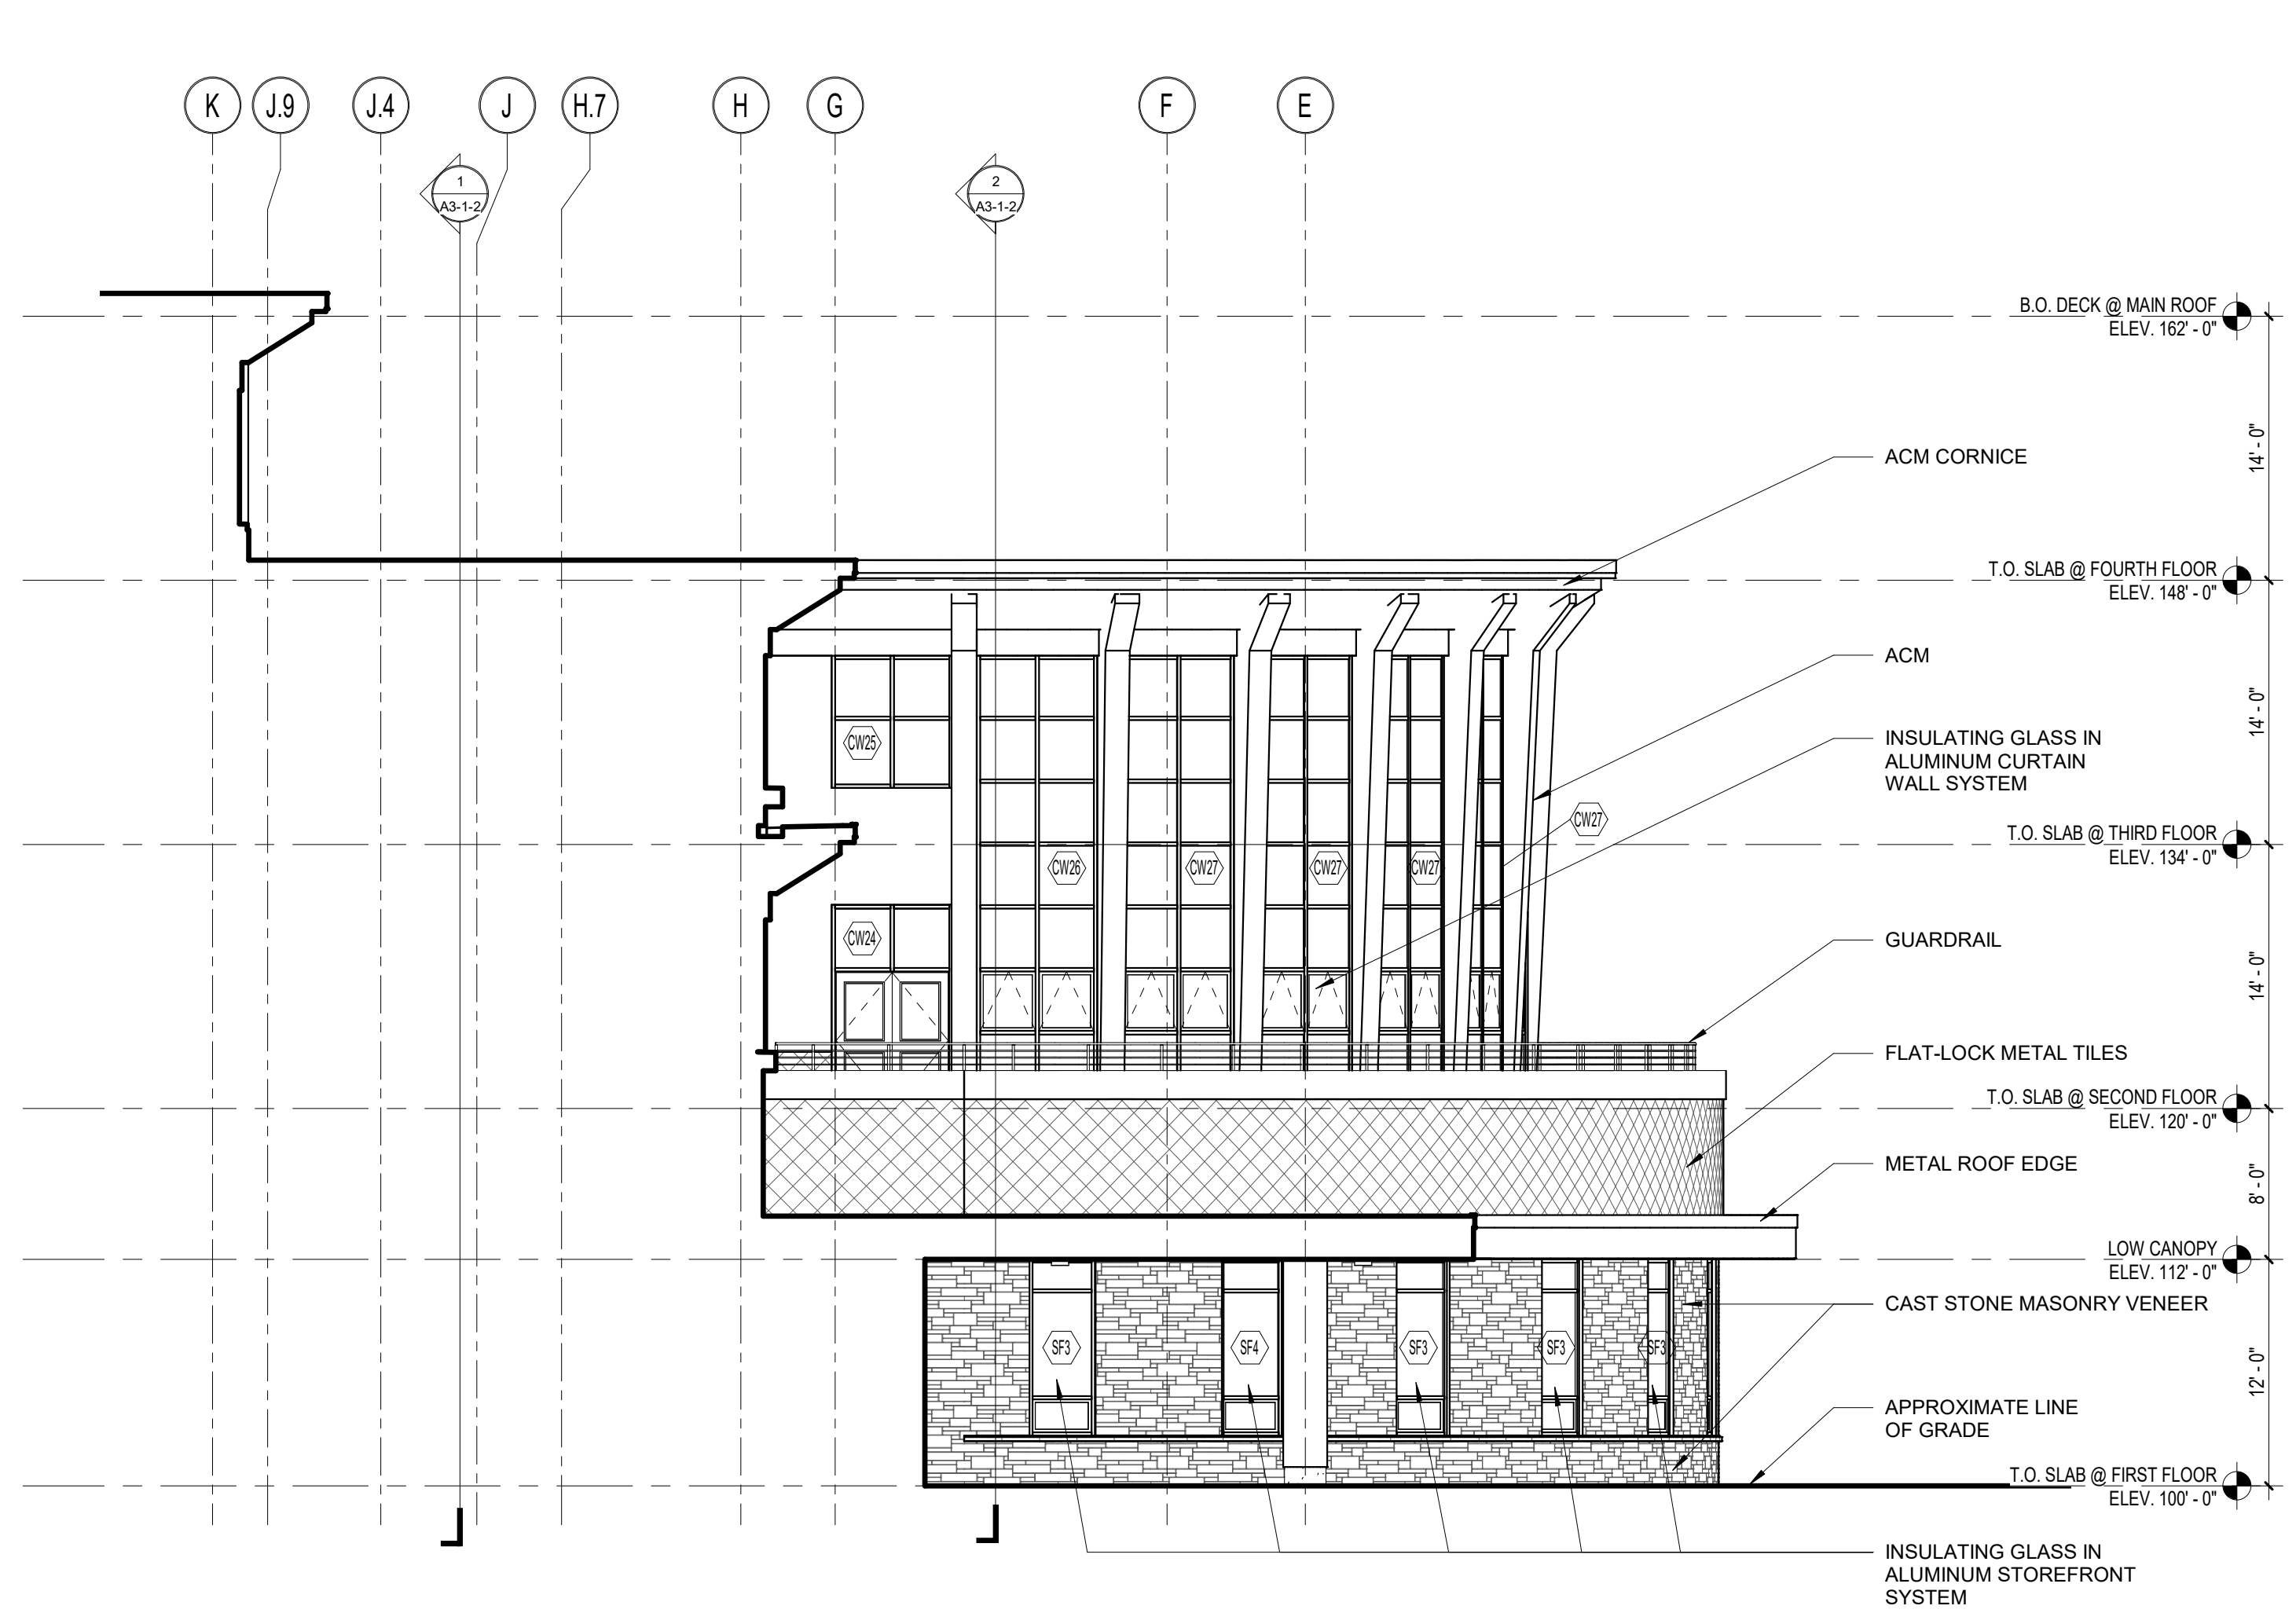

3 NORTH ELEVATION
1/8" = 1'-0"

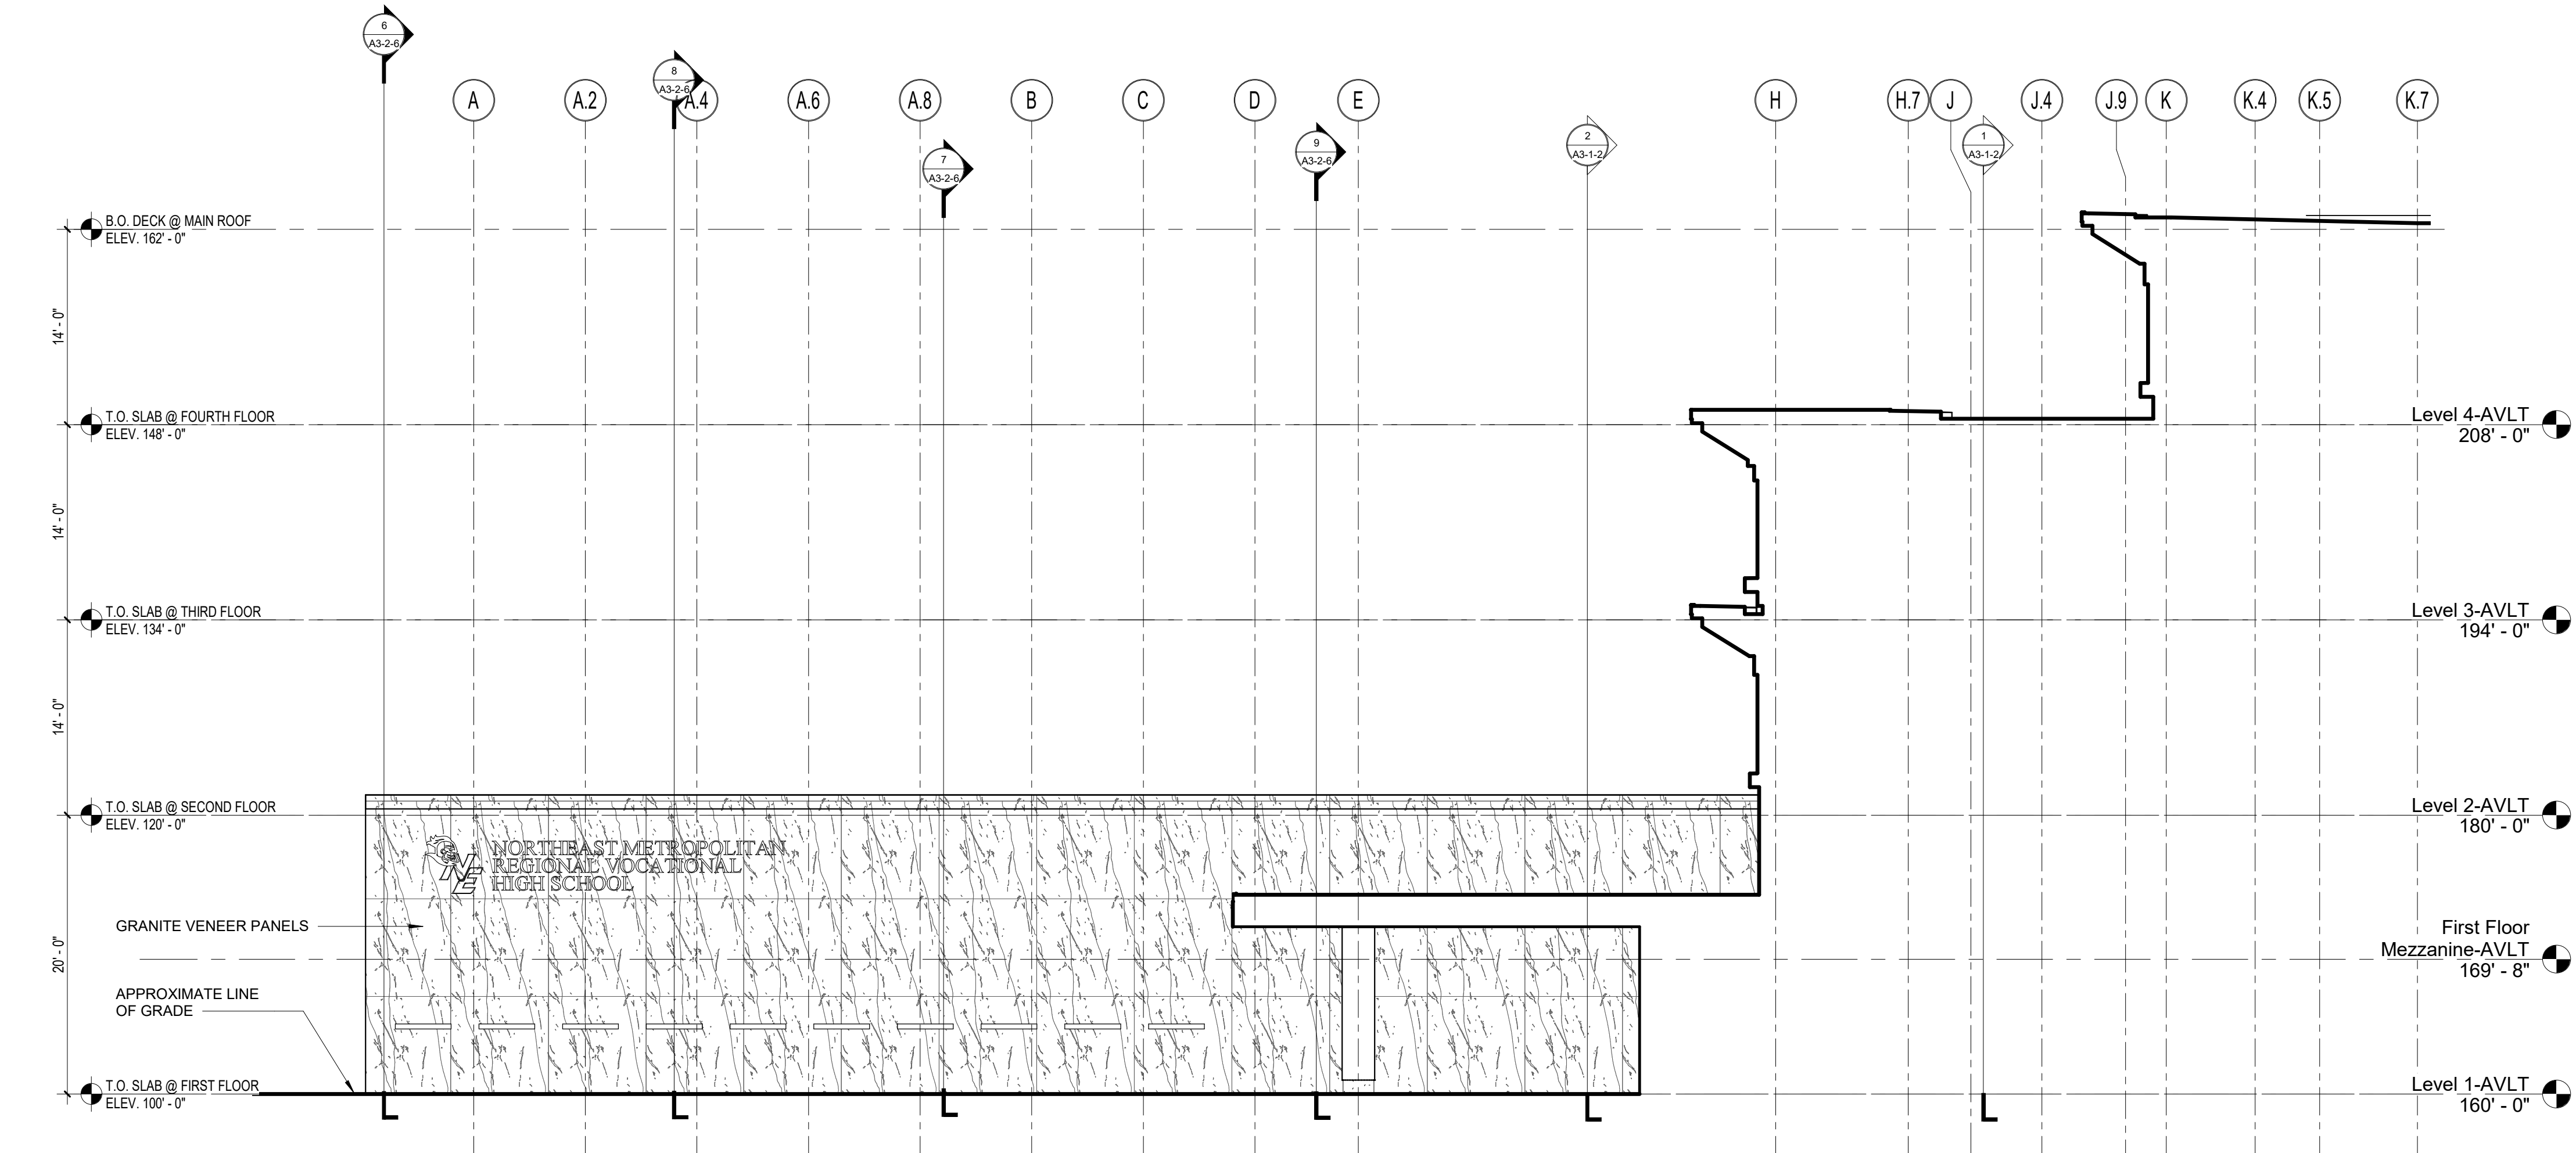

4 SOUTH ELEVATION - ALTERNATE
1/8" = 1'-0"

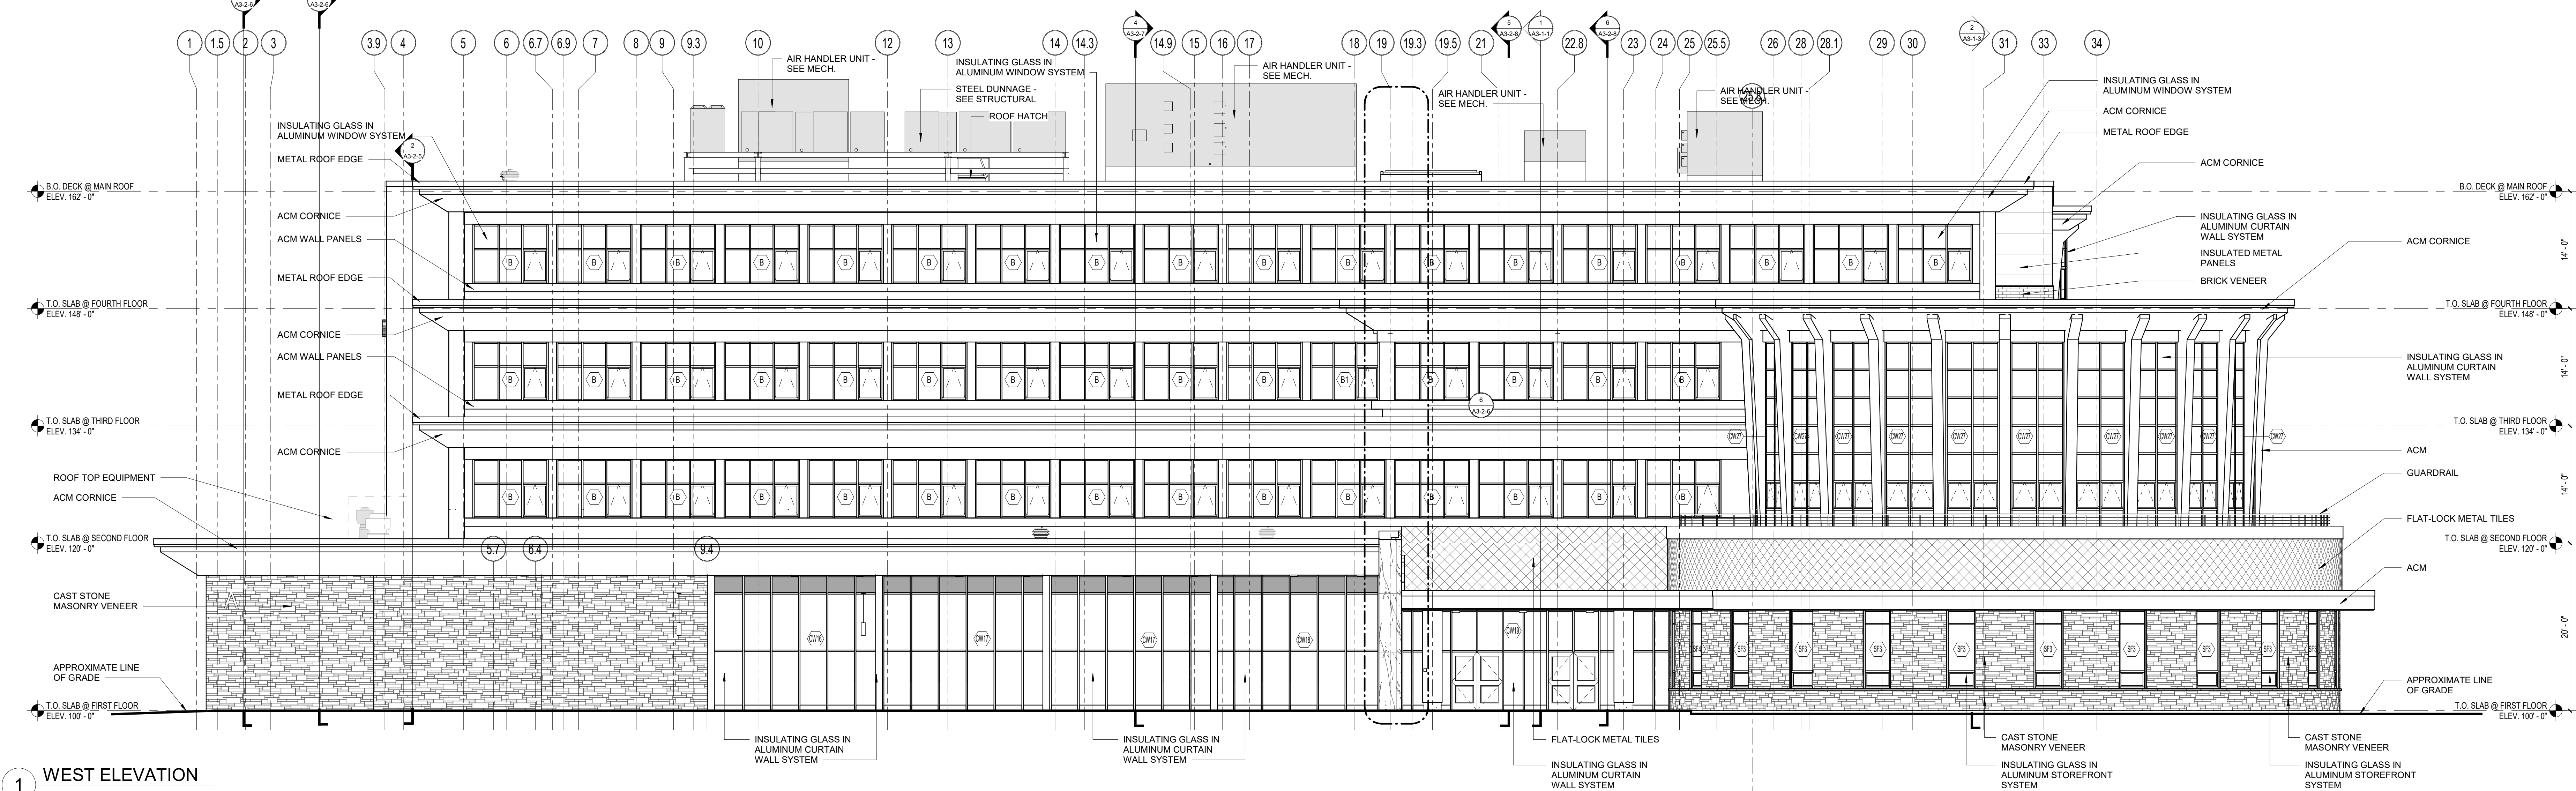

1 WEST ELEVATION
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
South Windsor, CT 06074
Tel: 817.854.1700
www.drainc.com

280 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.854.1700
www.drainc.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

BUILDING
ELEVATIONS

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A2-1-1

DRA


Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453
Tel: 817.854.1700
www.dra.com

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

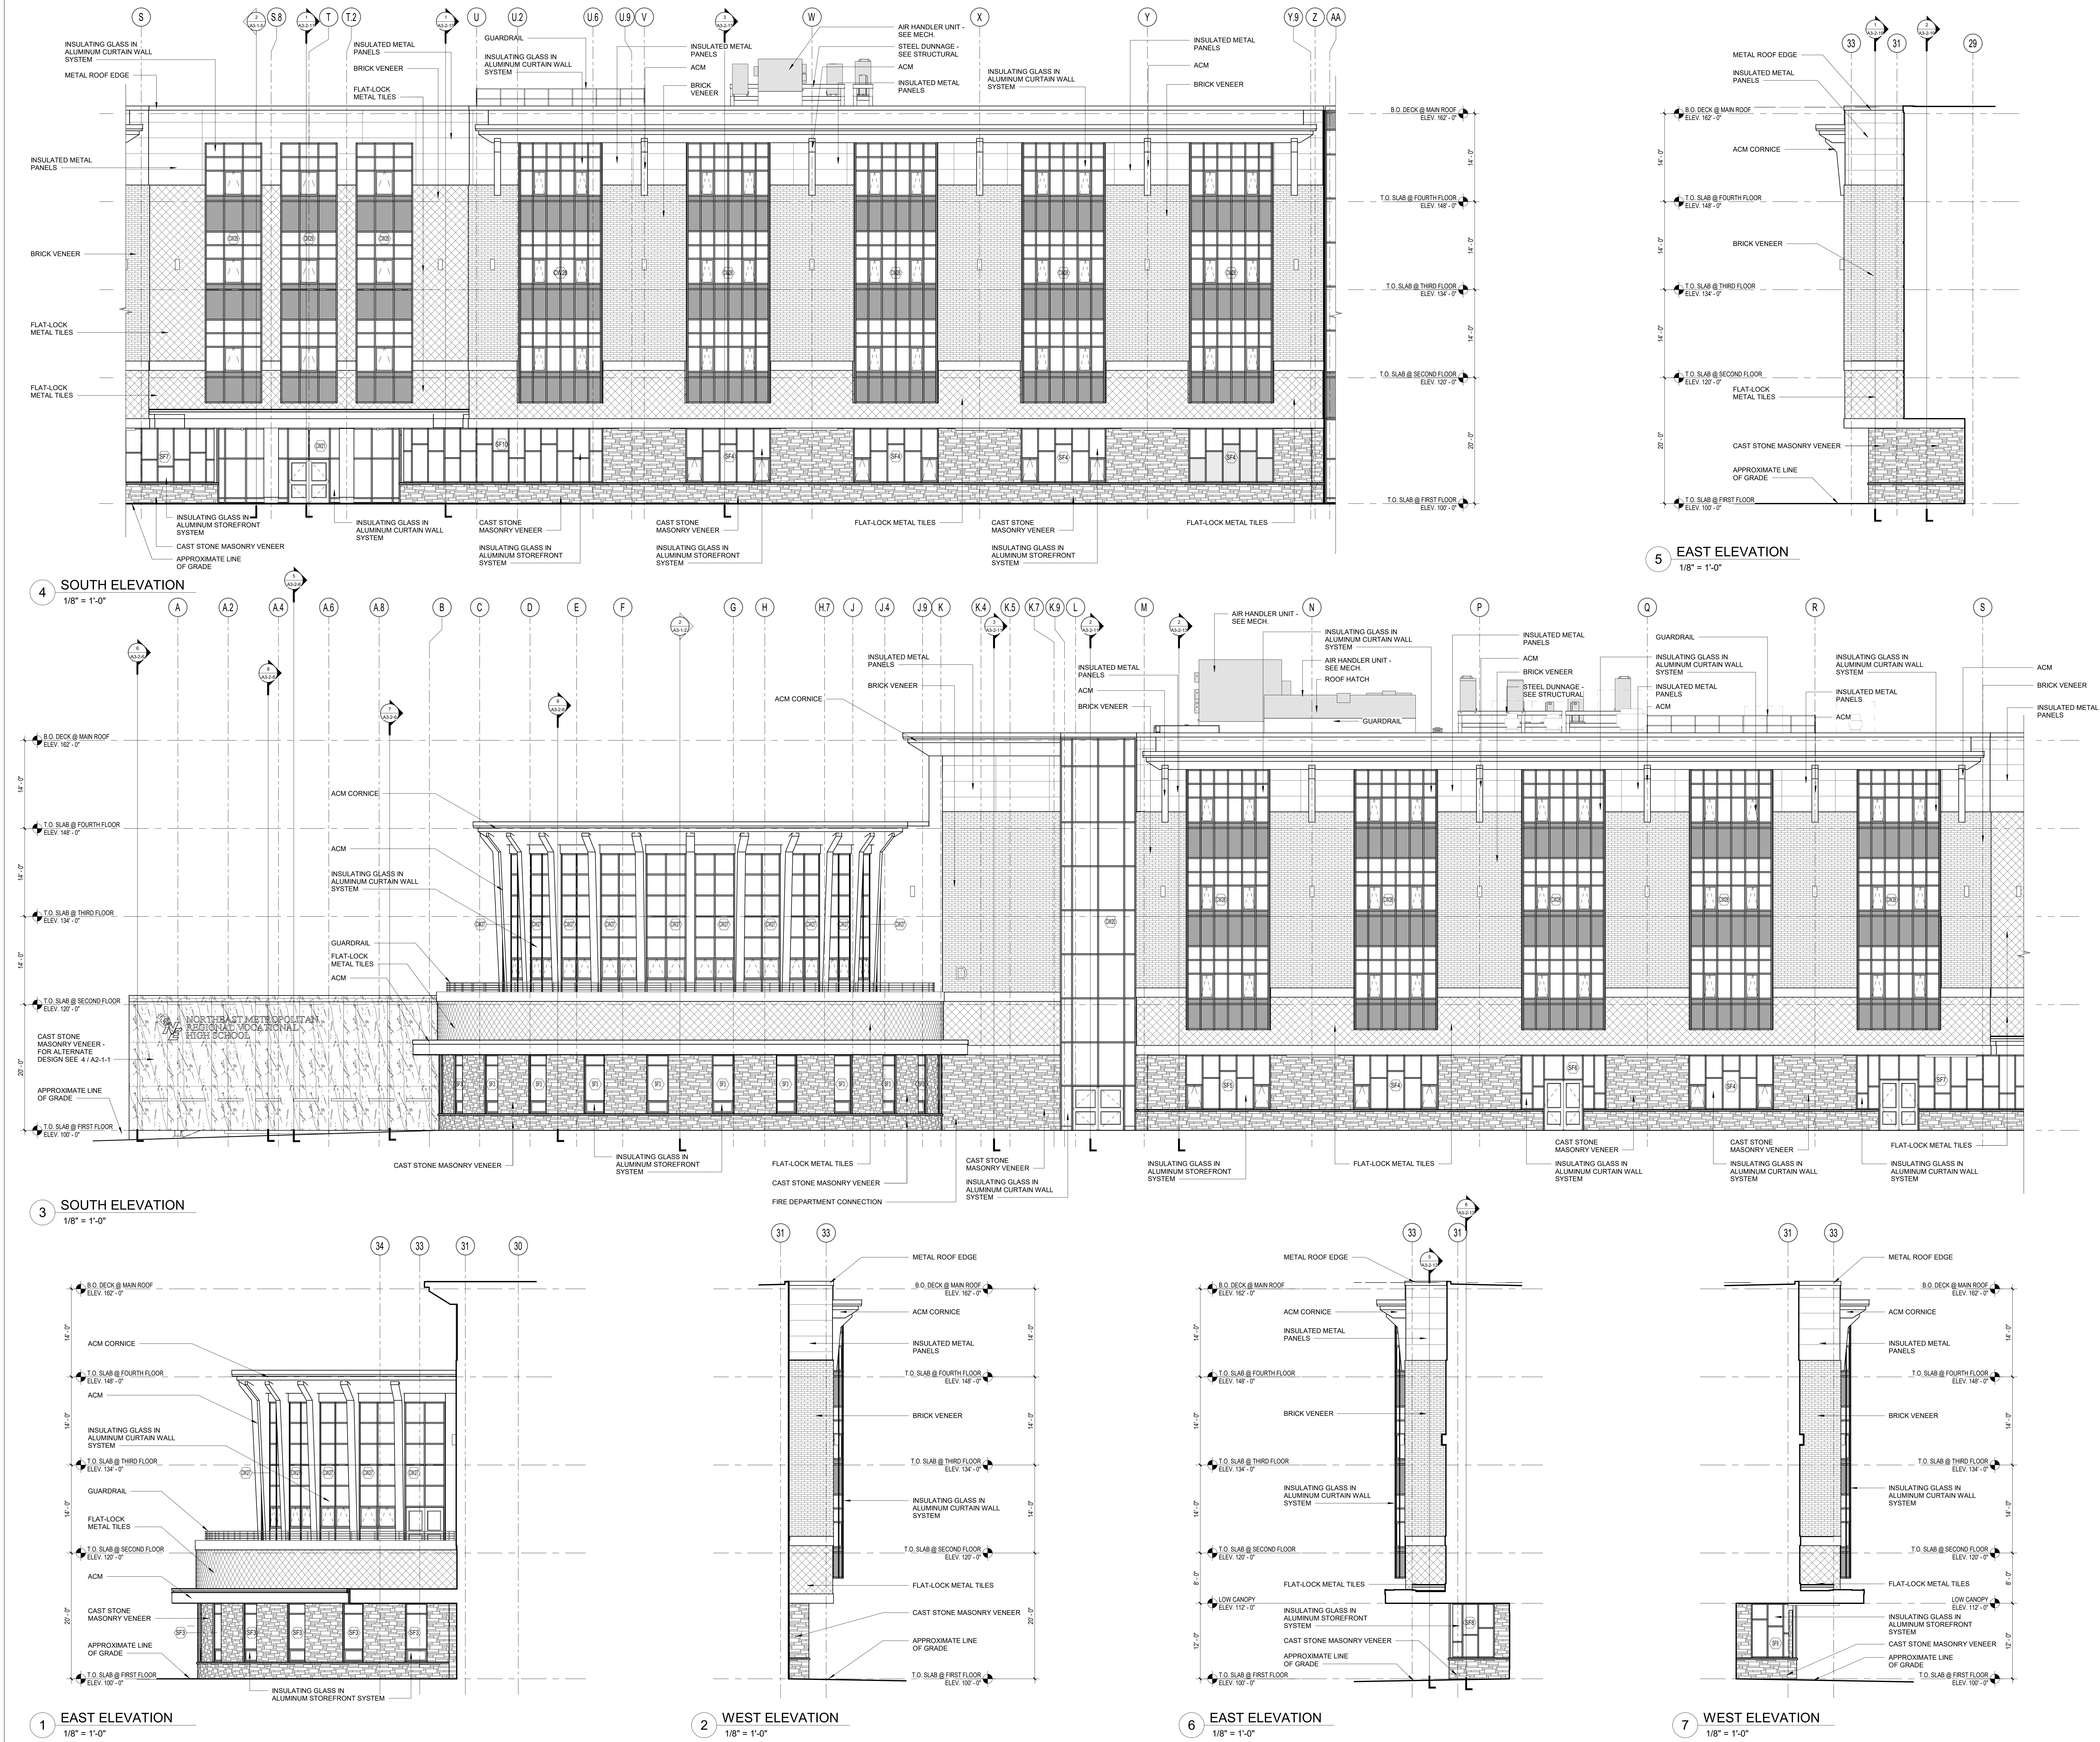

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

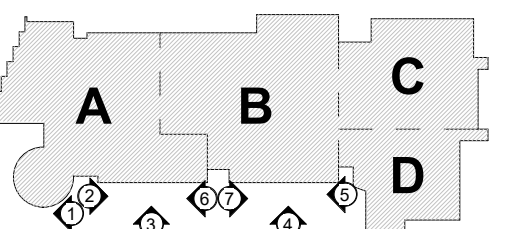


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
ELEVATIONS**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A2-1-2


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

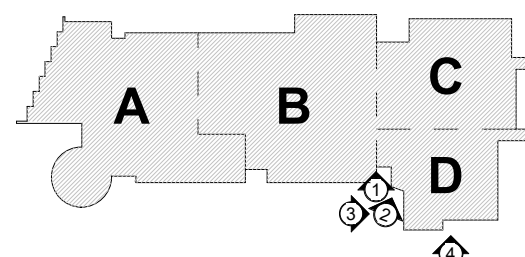


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
ELEVATIONS**

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A2-1-3

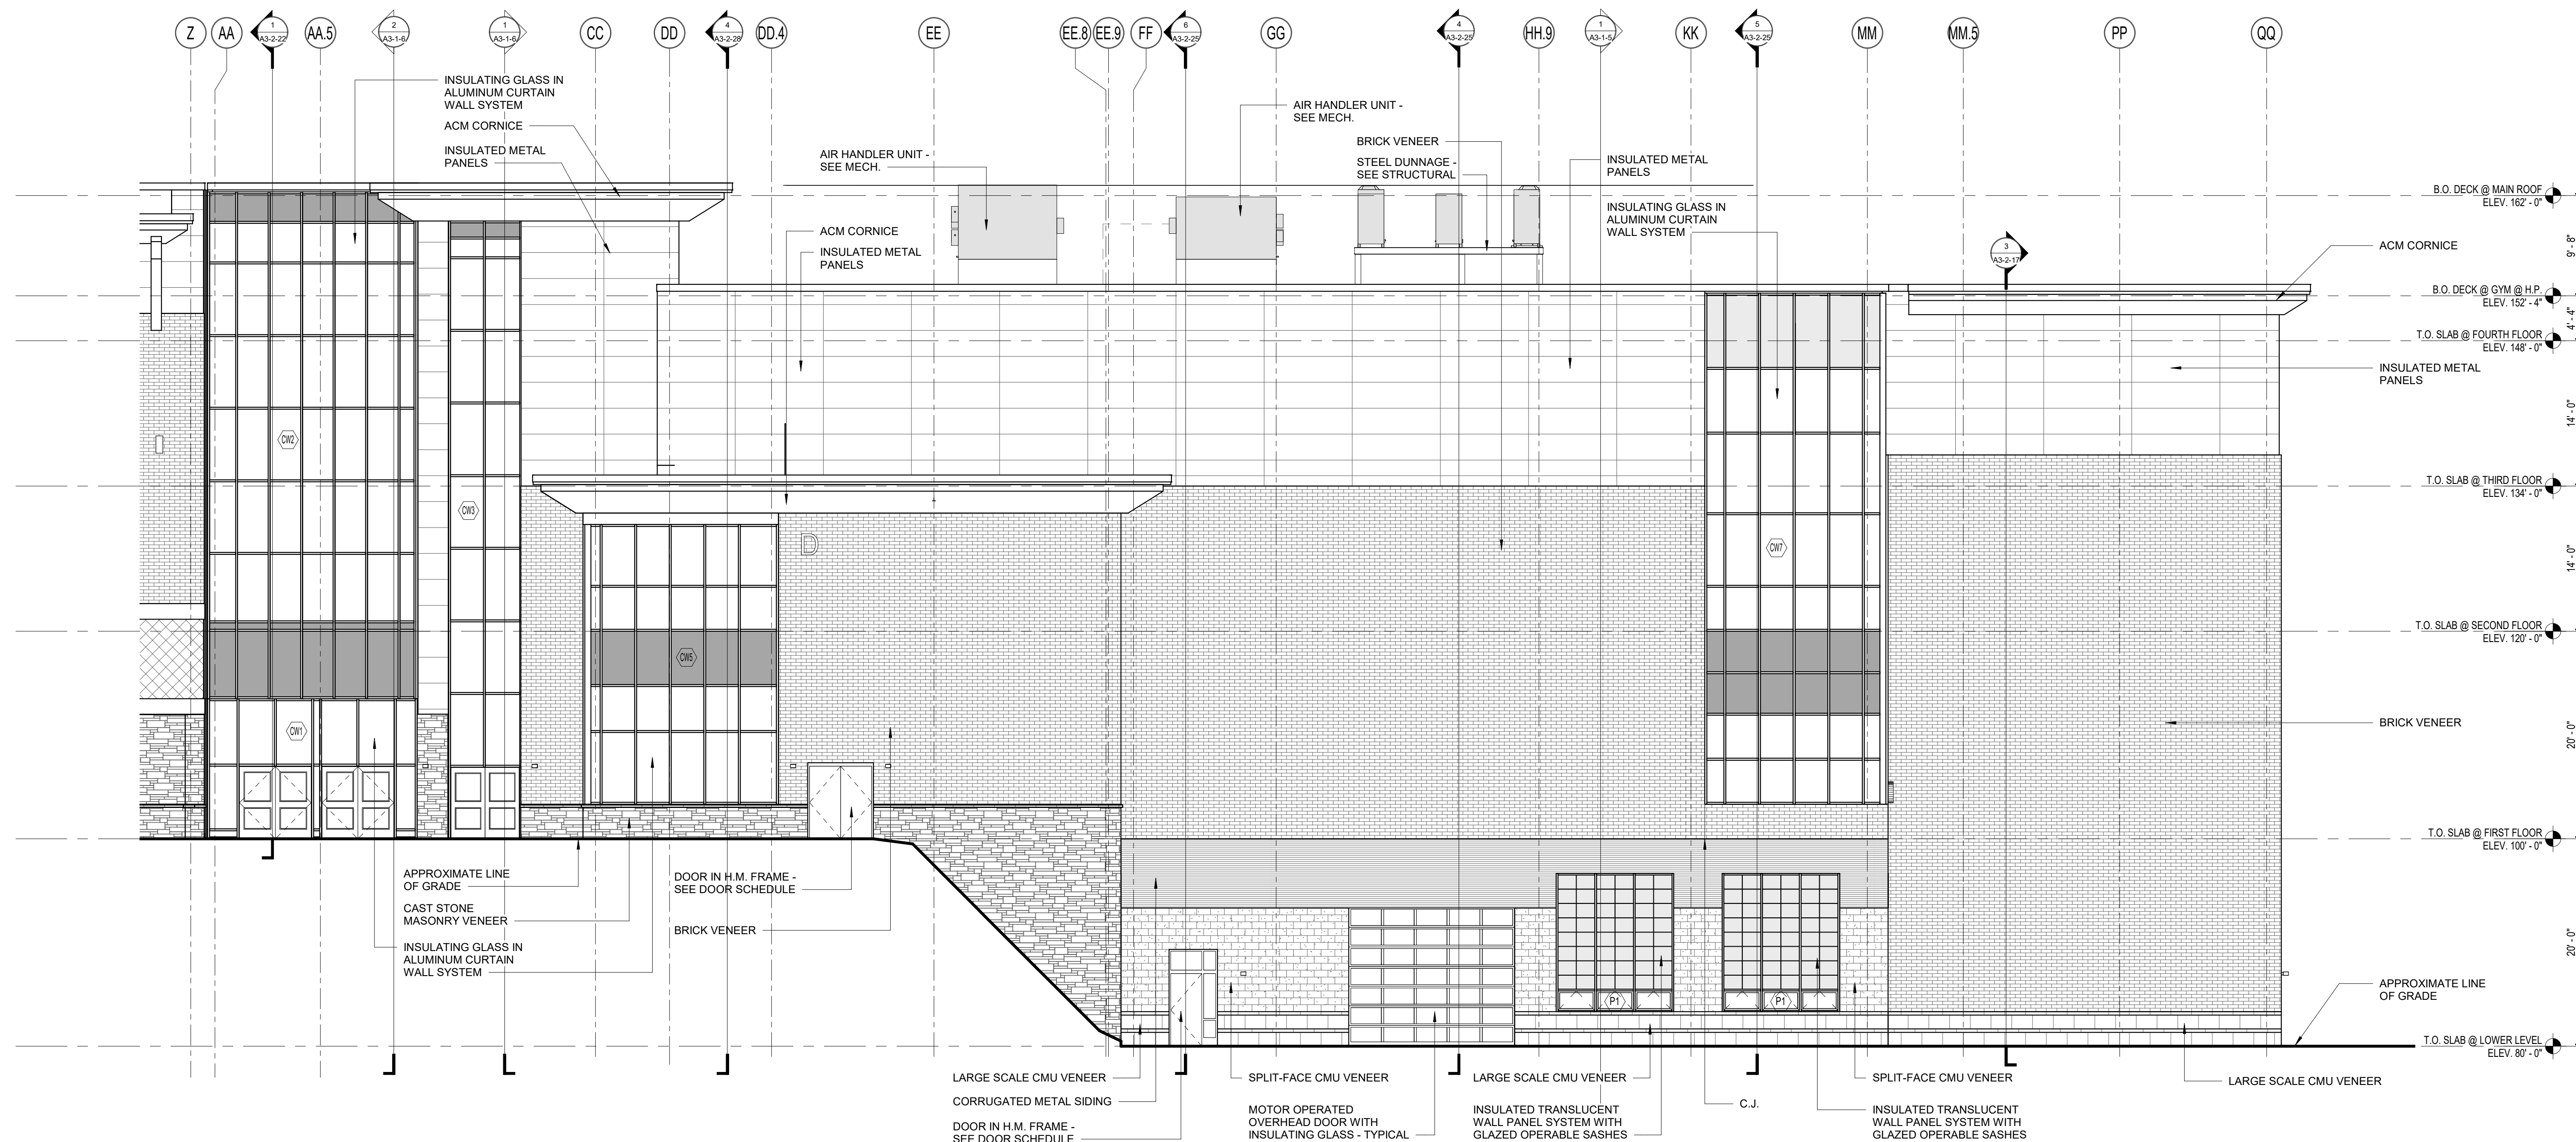


4 SOUTH ELEVATION
1/8" = 1'-0"

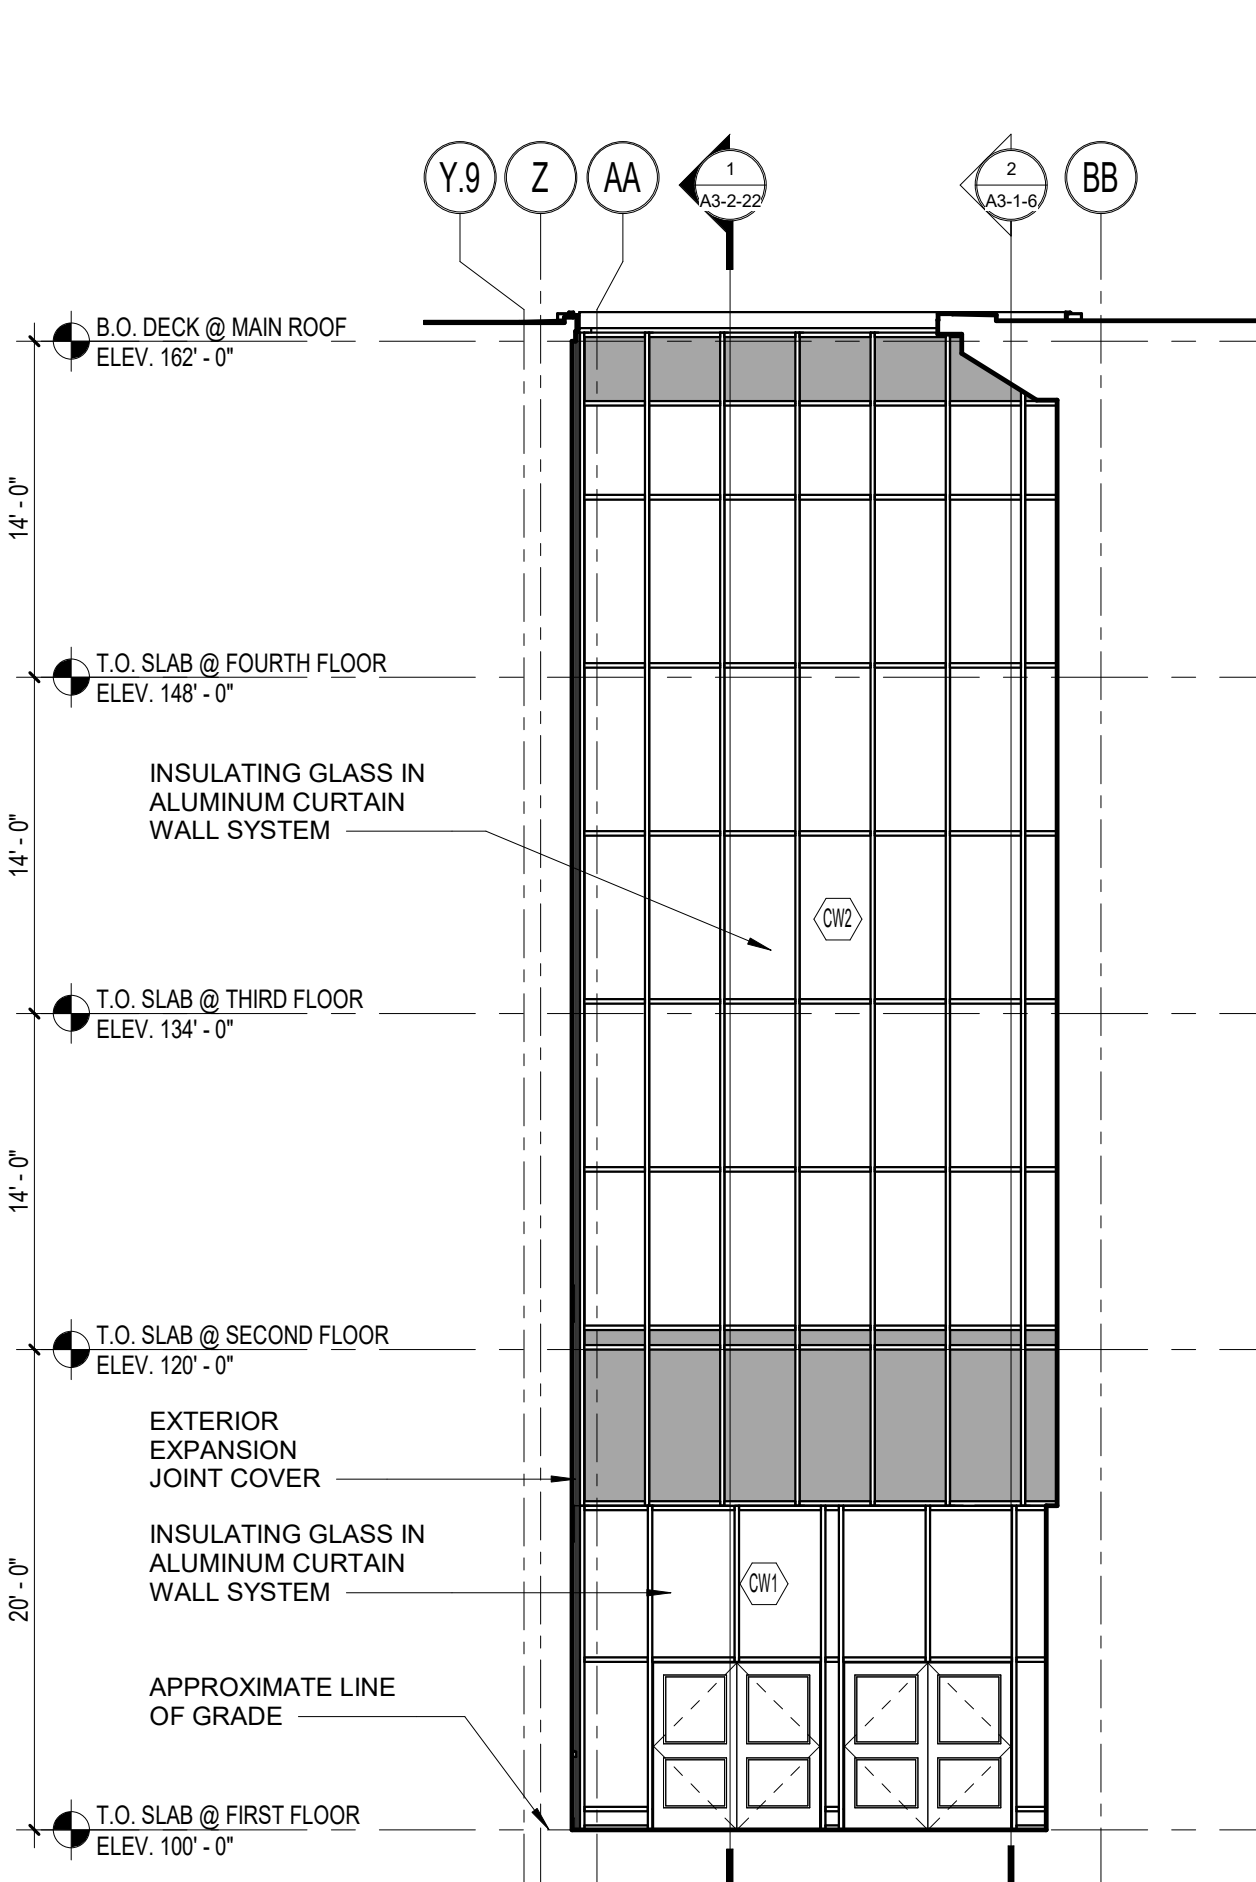

1 SOUTH ELEVATION
1/8" = 1'-0"

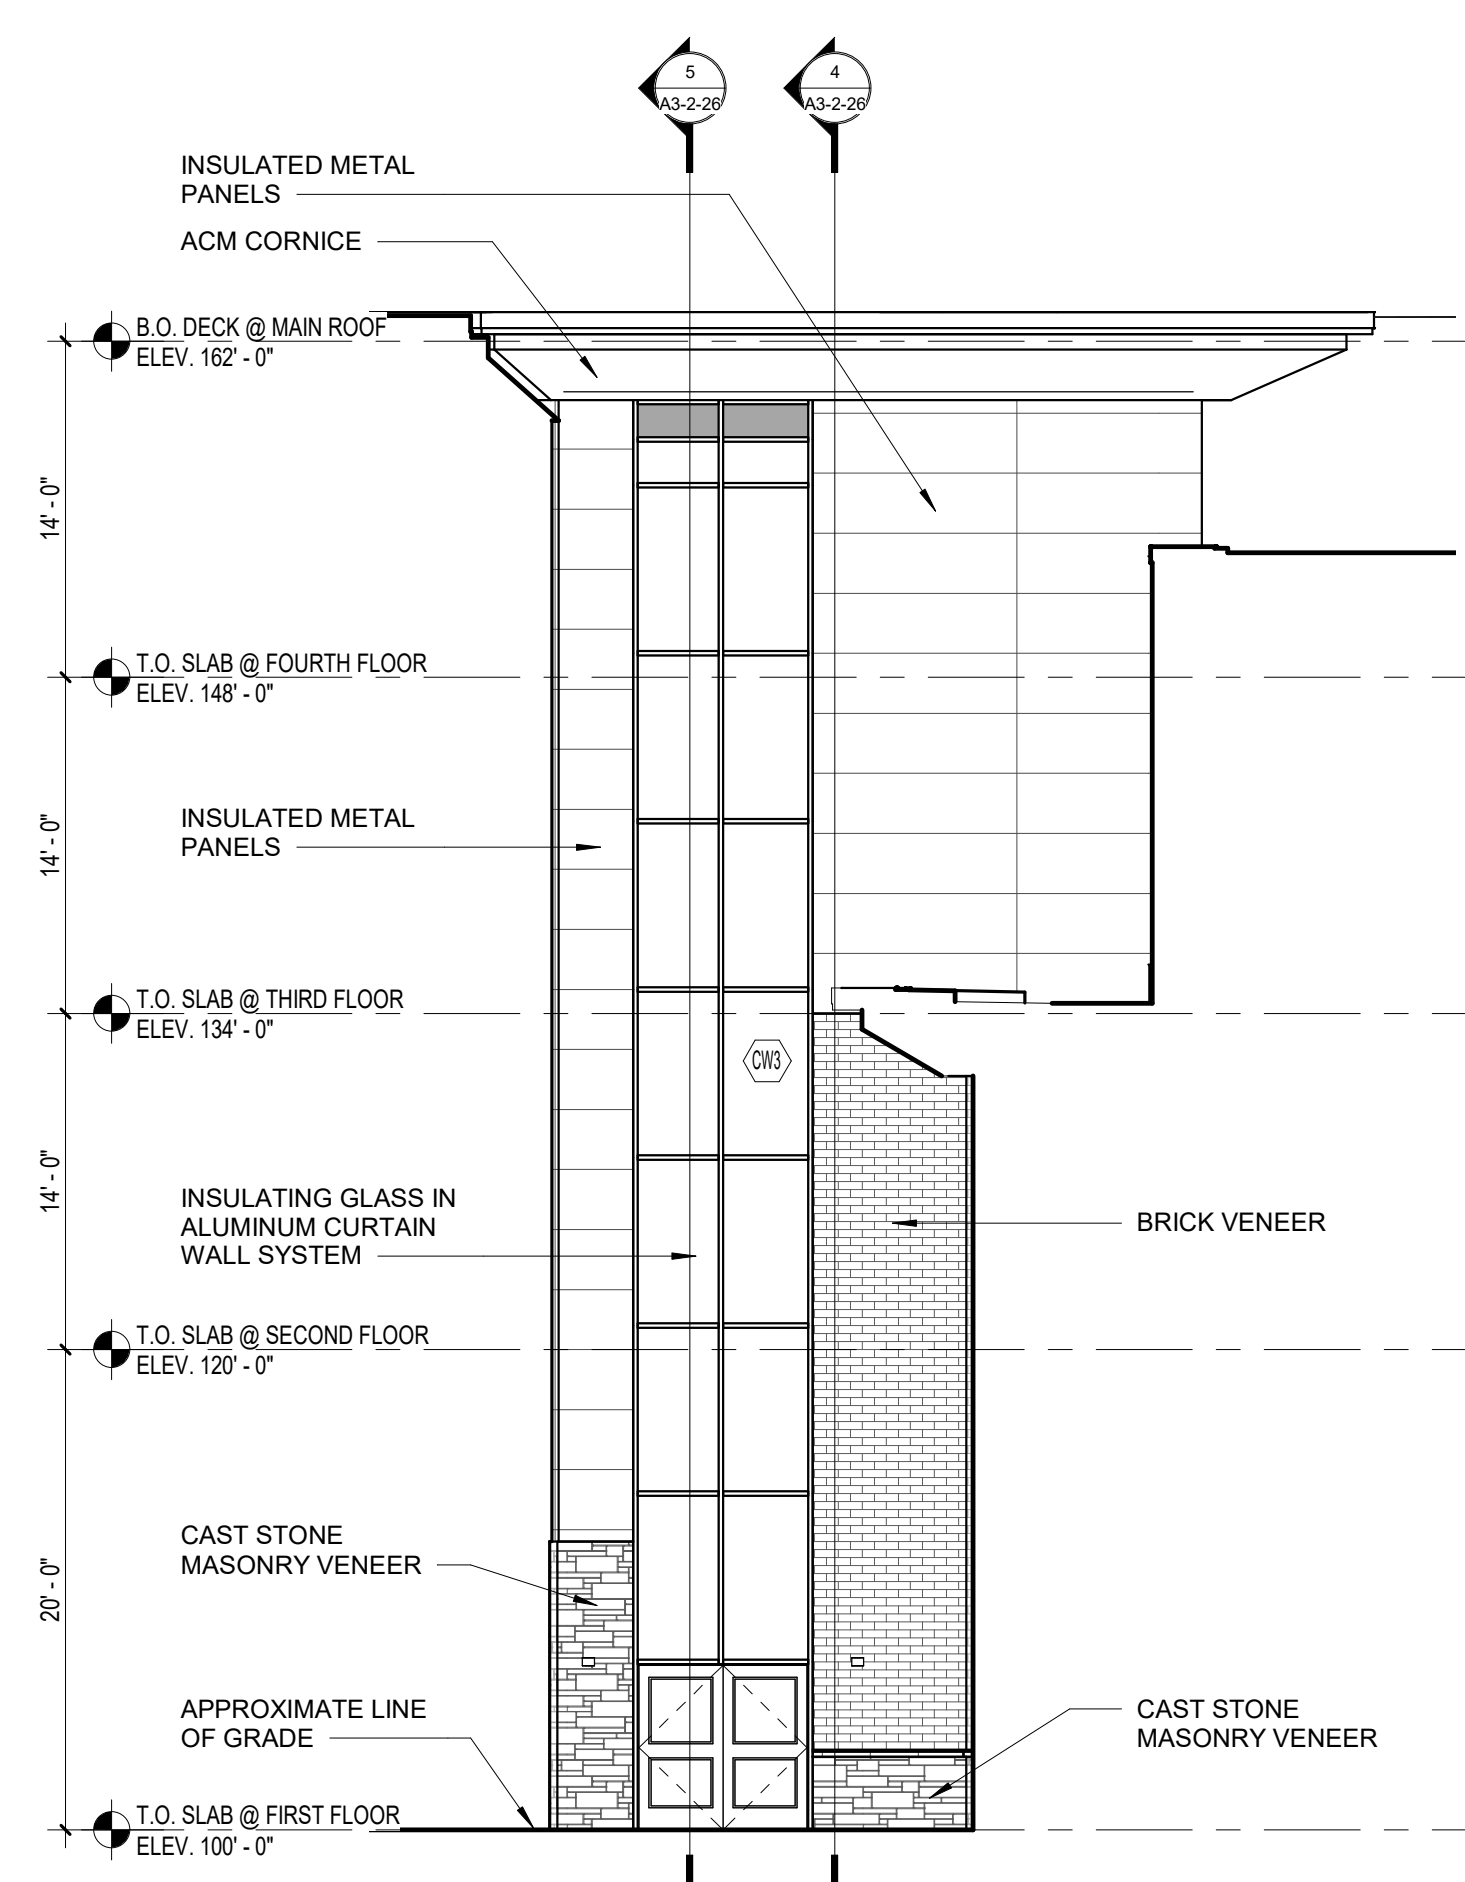

2 SOUTHWEST ELEVATION
1/8" = 1'-0"

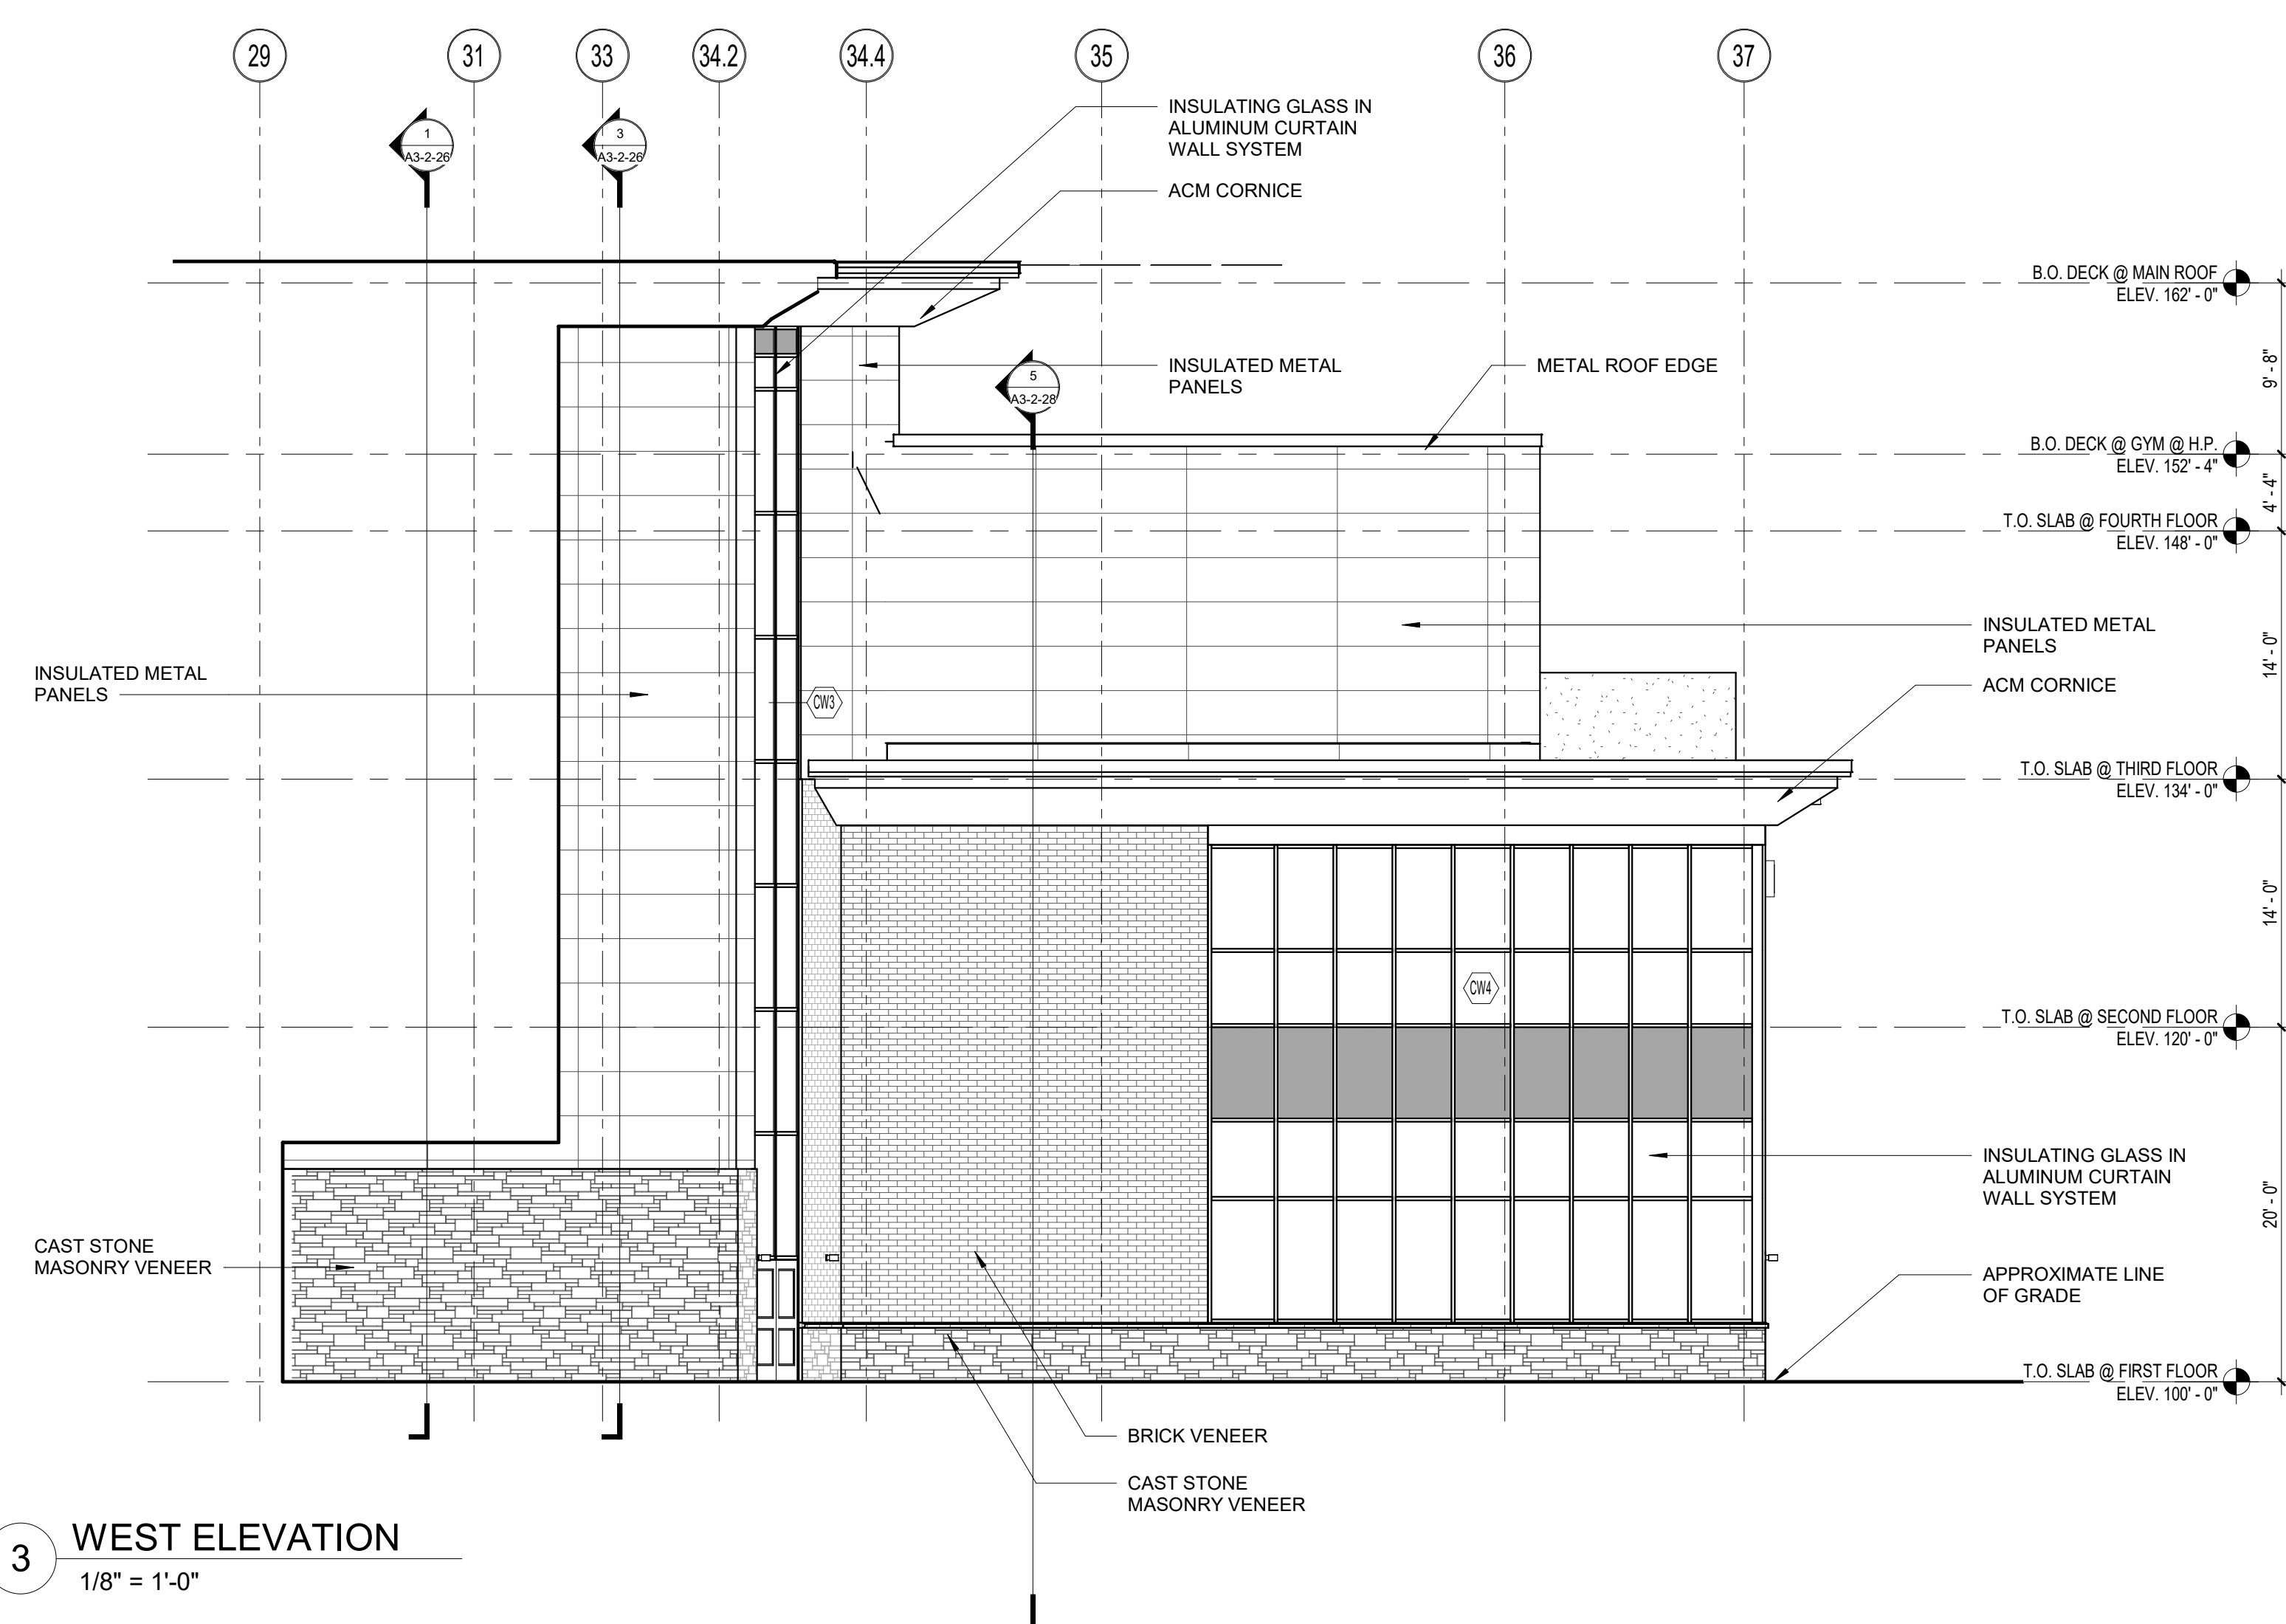


3 WEST ELEVATION
1/8" = 1'-0"




**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

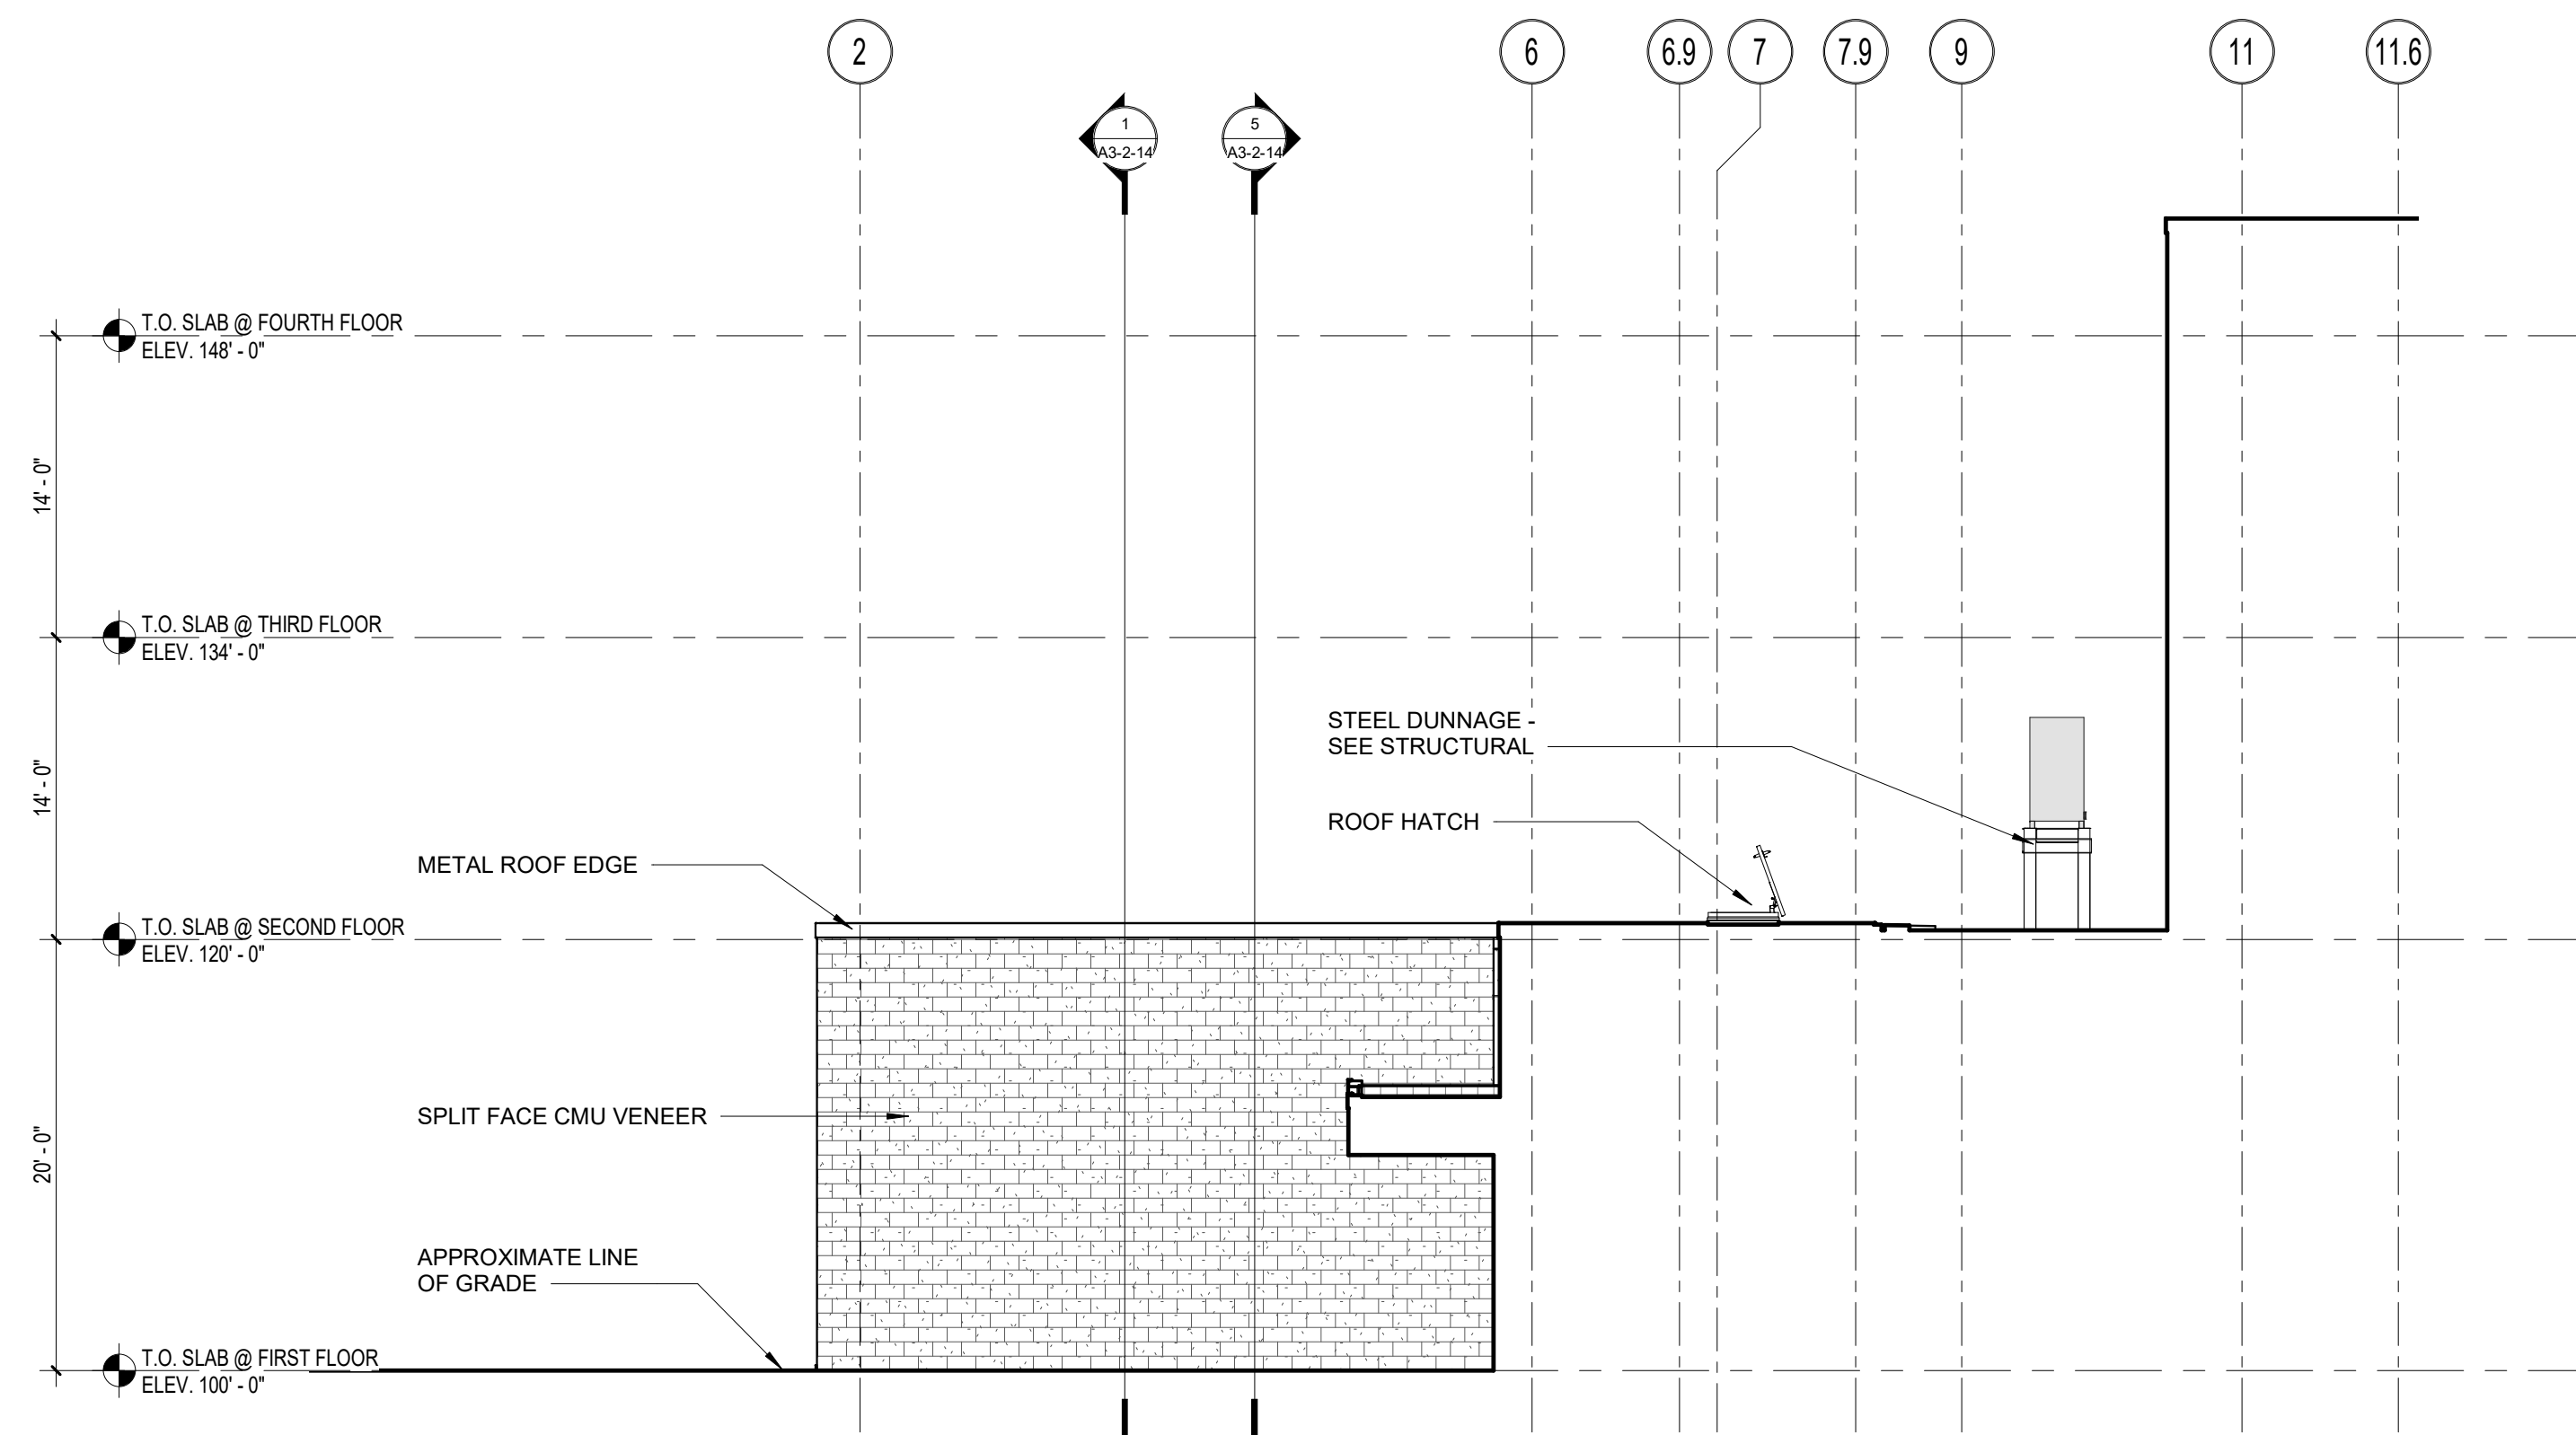

2 WEST ELEVATION
1/8" = 1'-0"

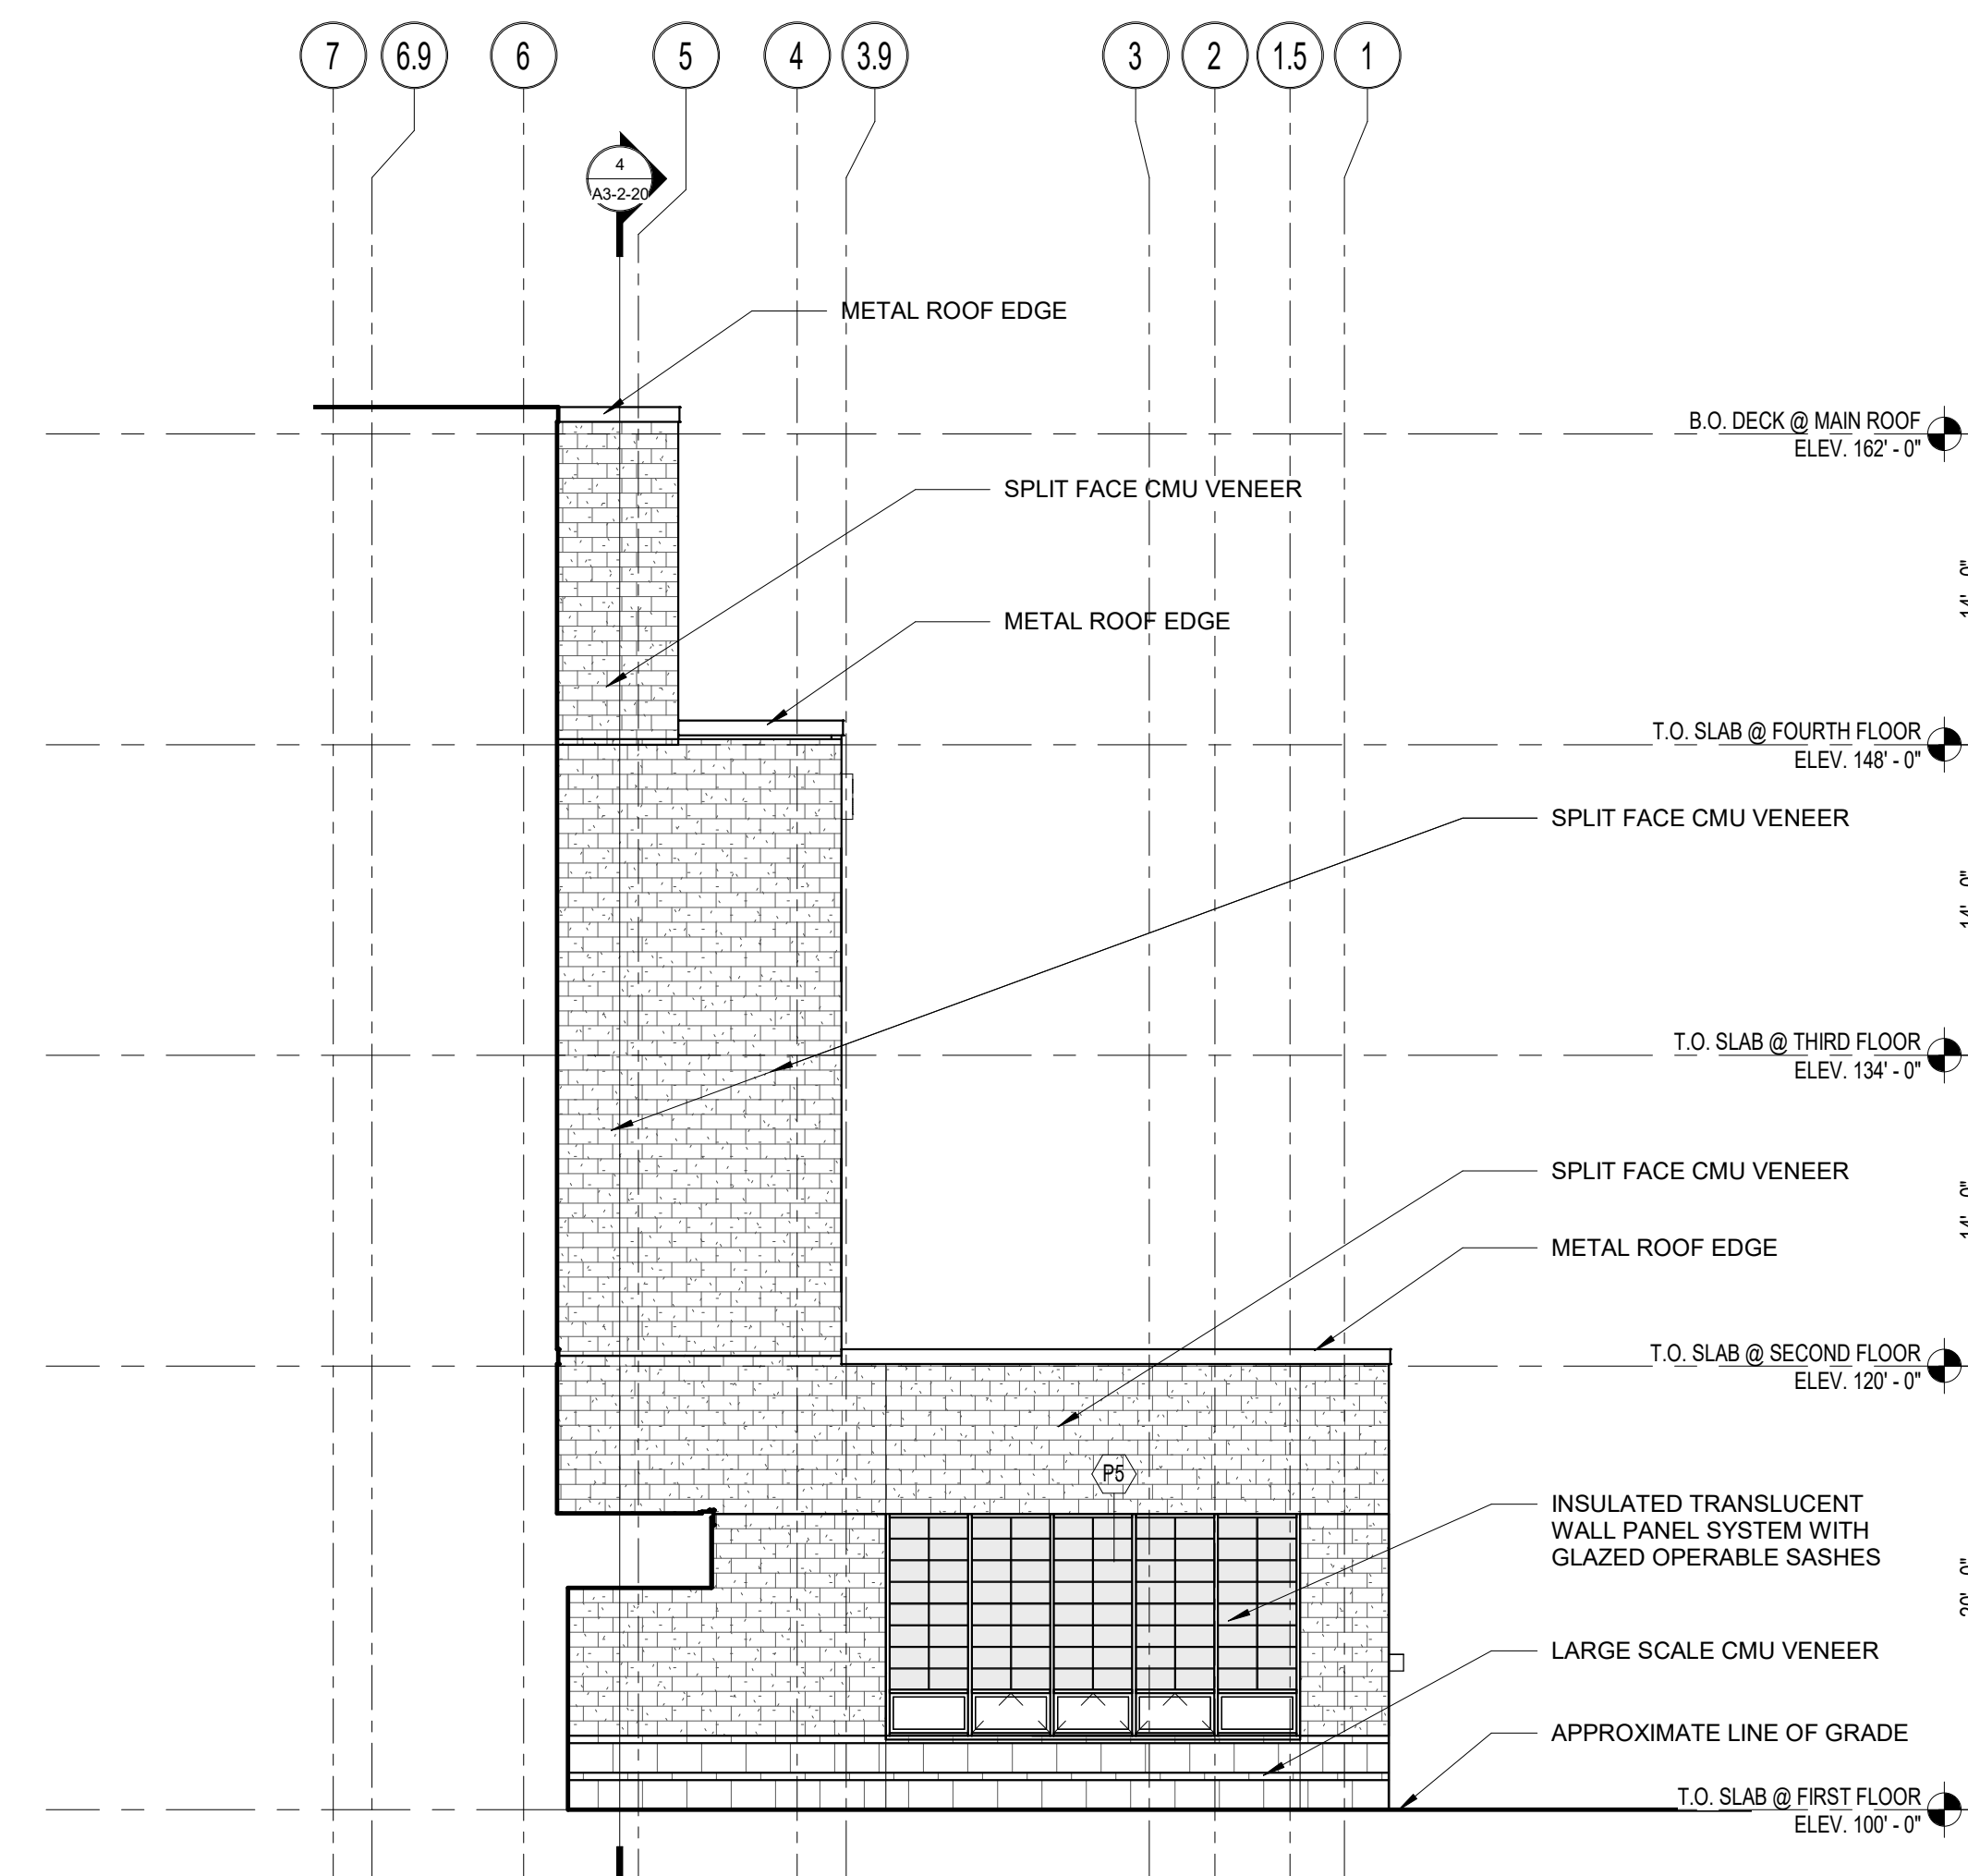

3 EAST ELEVATION
1/8" = 1'-0"

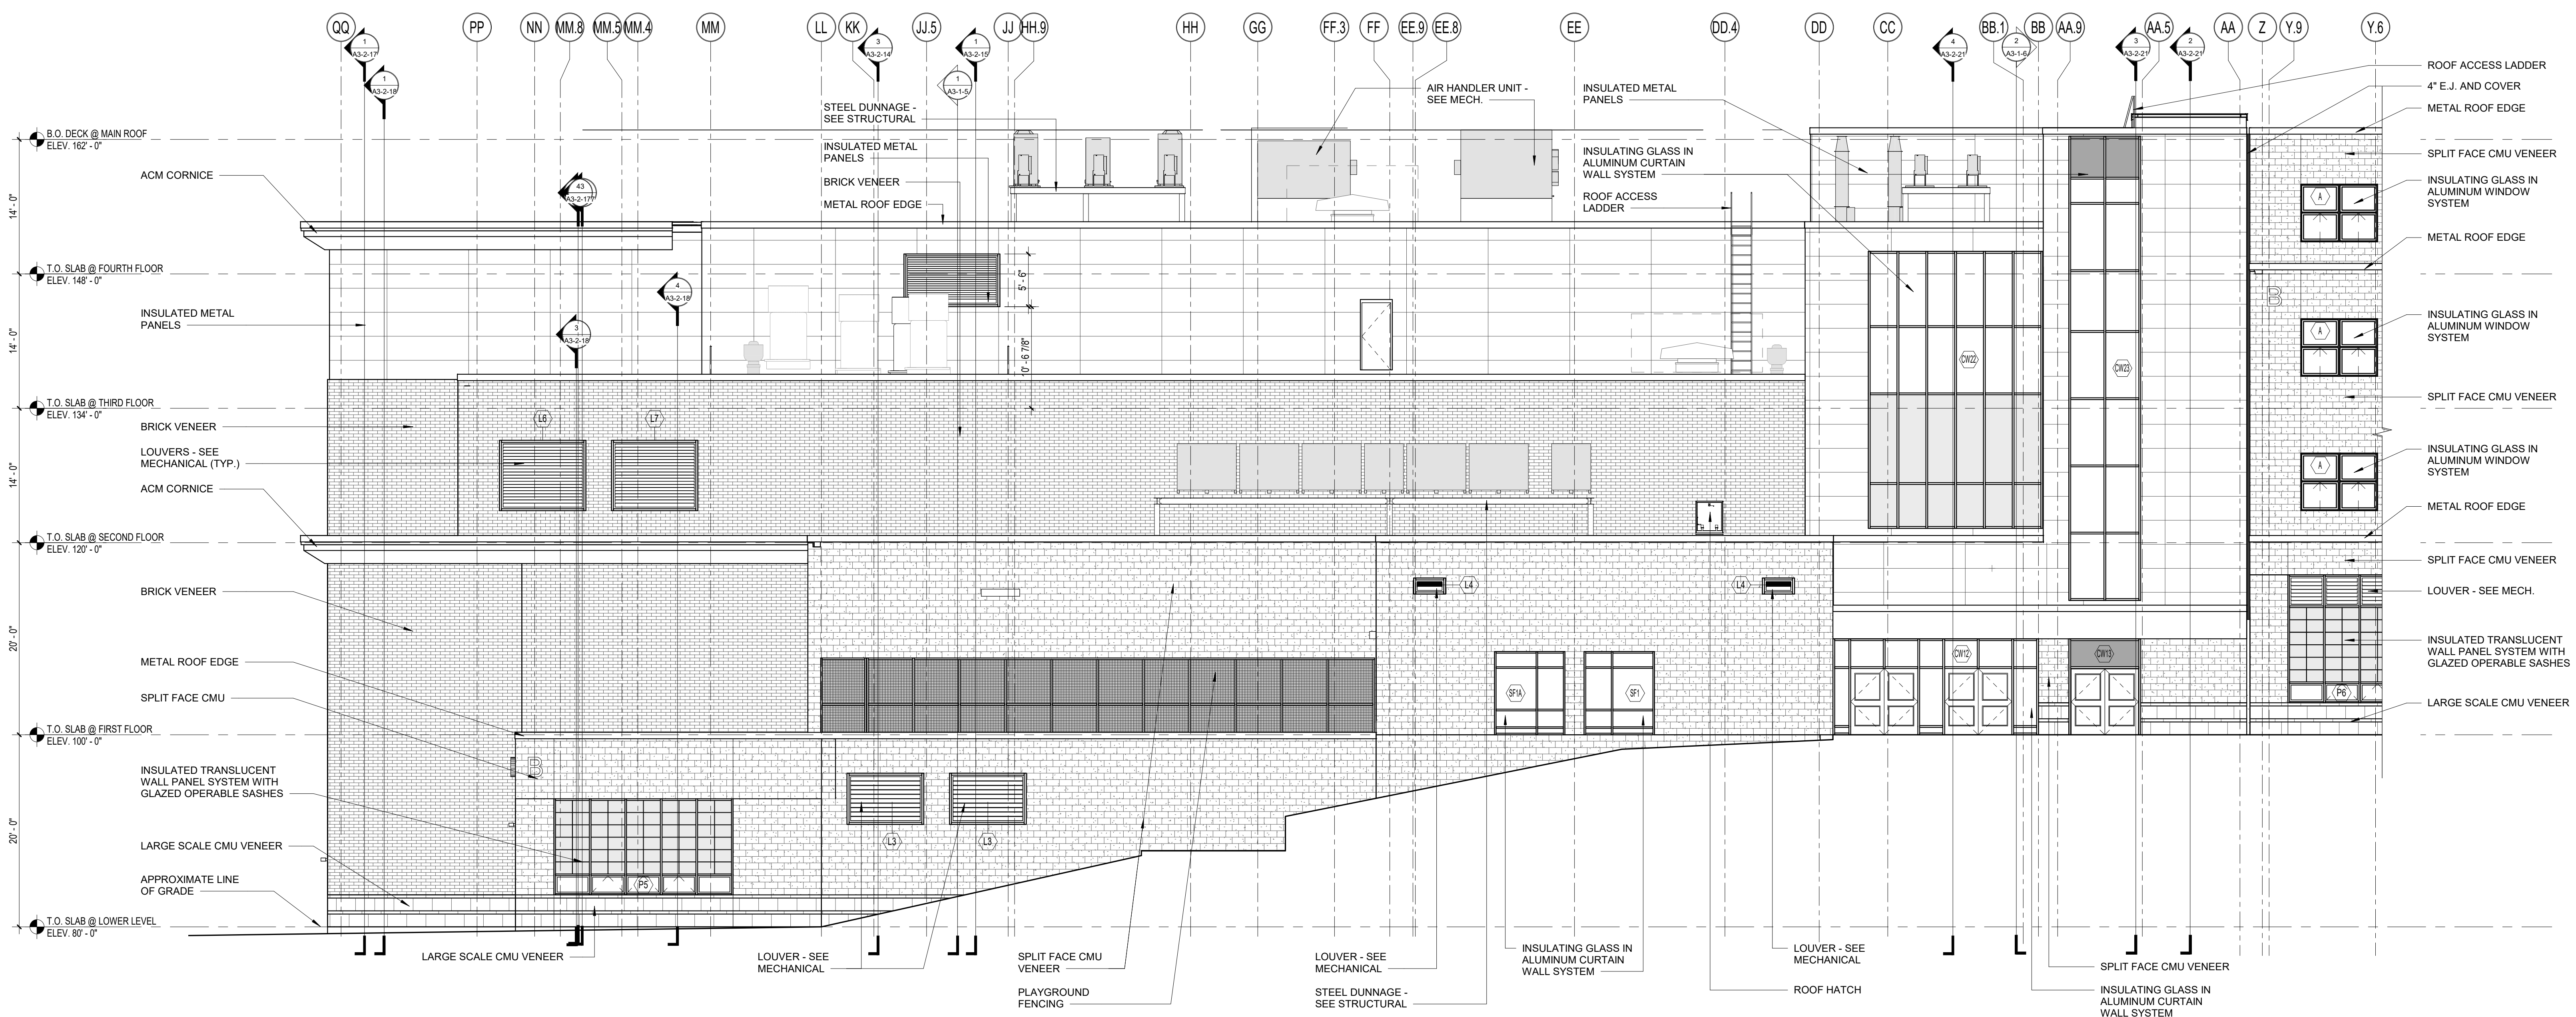


1 NORTH ELEVATION
1/8" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

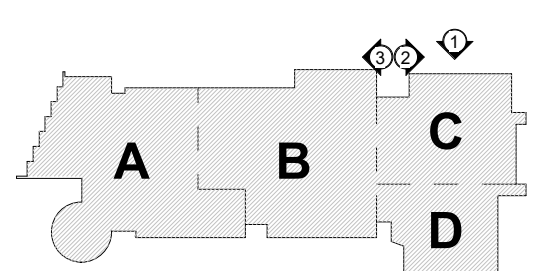


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
ELEVATIONS**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4


A2-1-5

100 Hemlock Road,
Wakefield, MA 01880




KEY PLAN	
PROJECT NORTH	MAGNETIC NORTH


Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

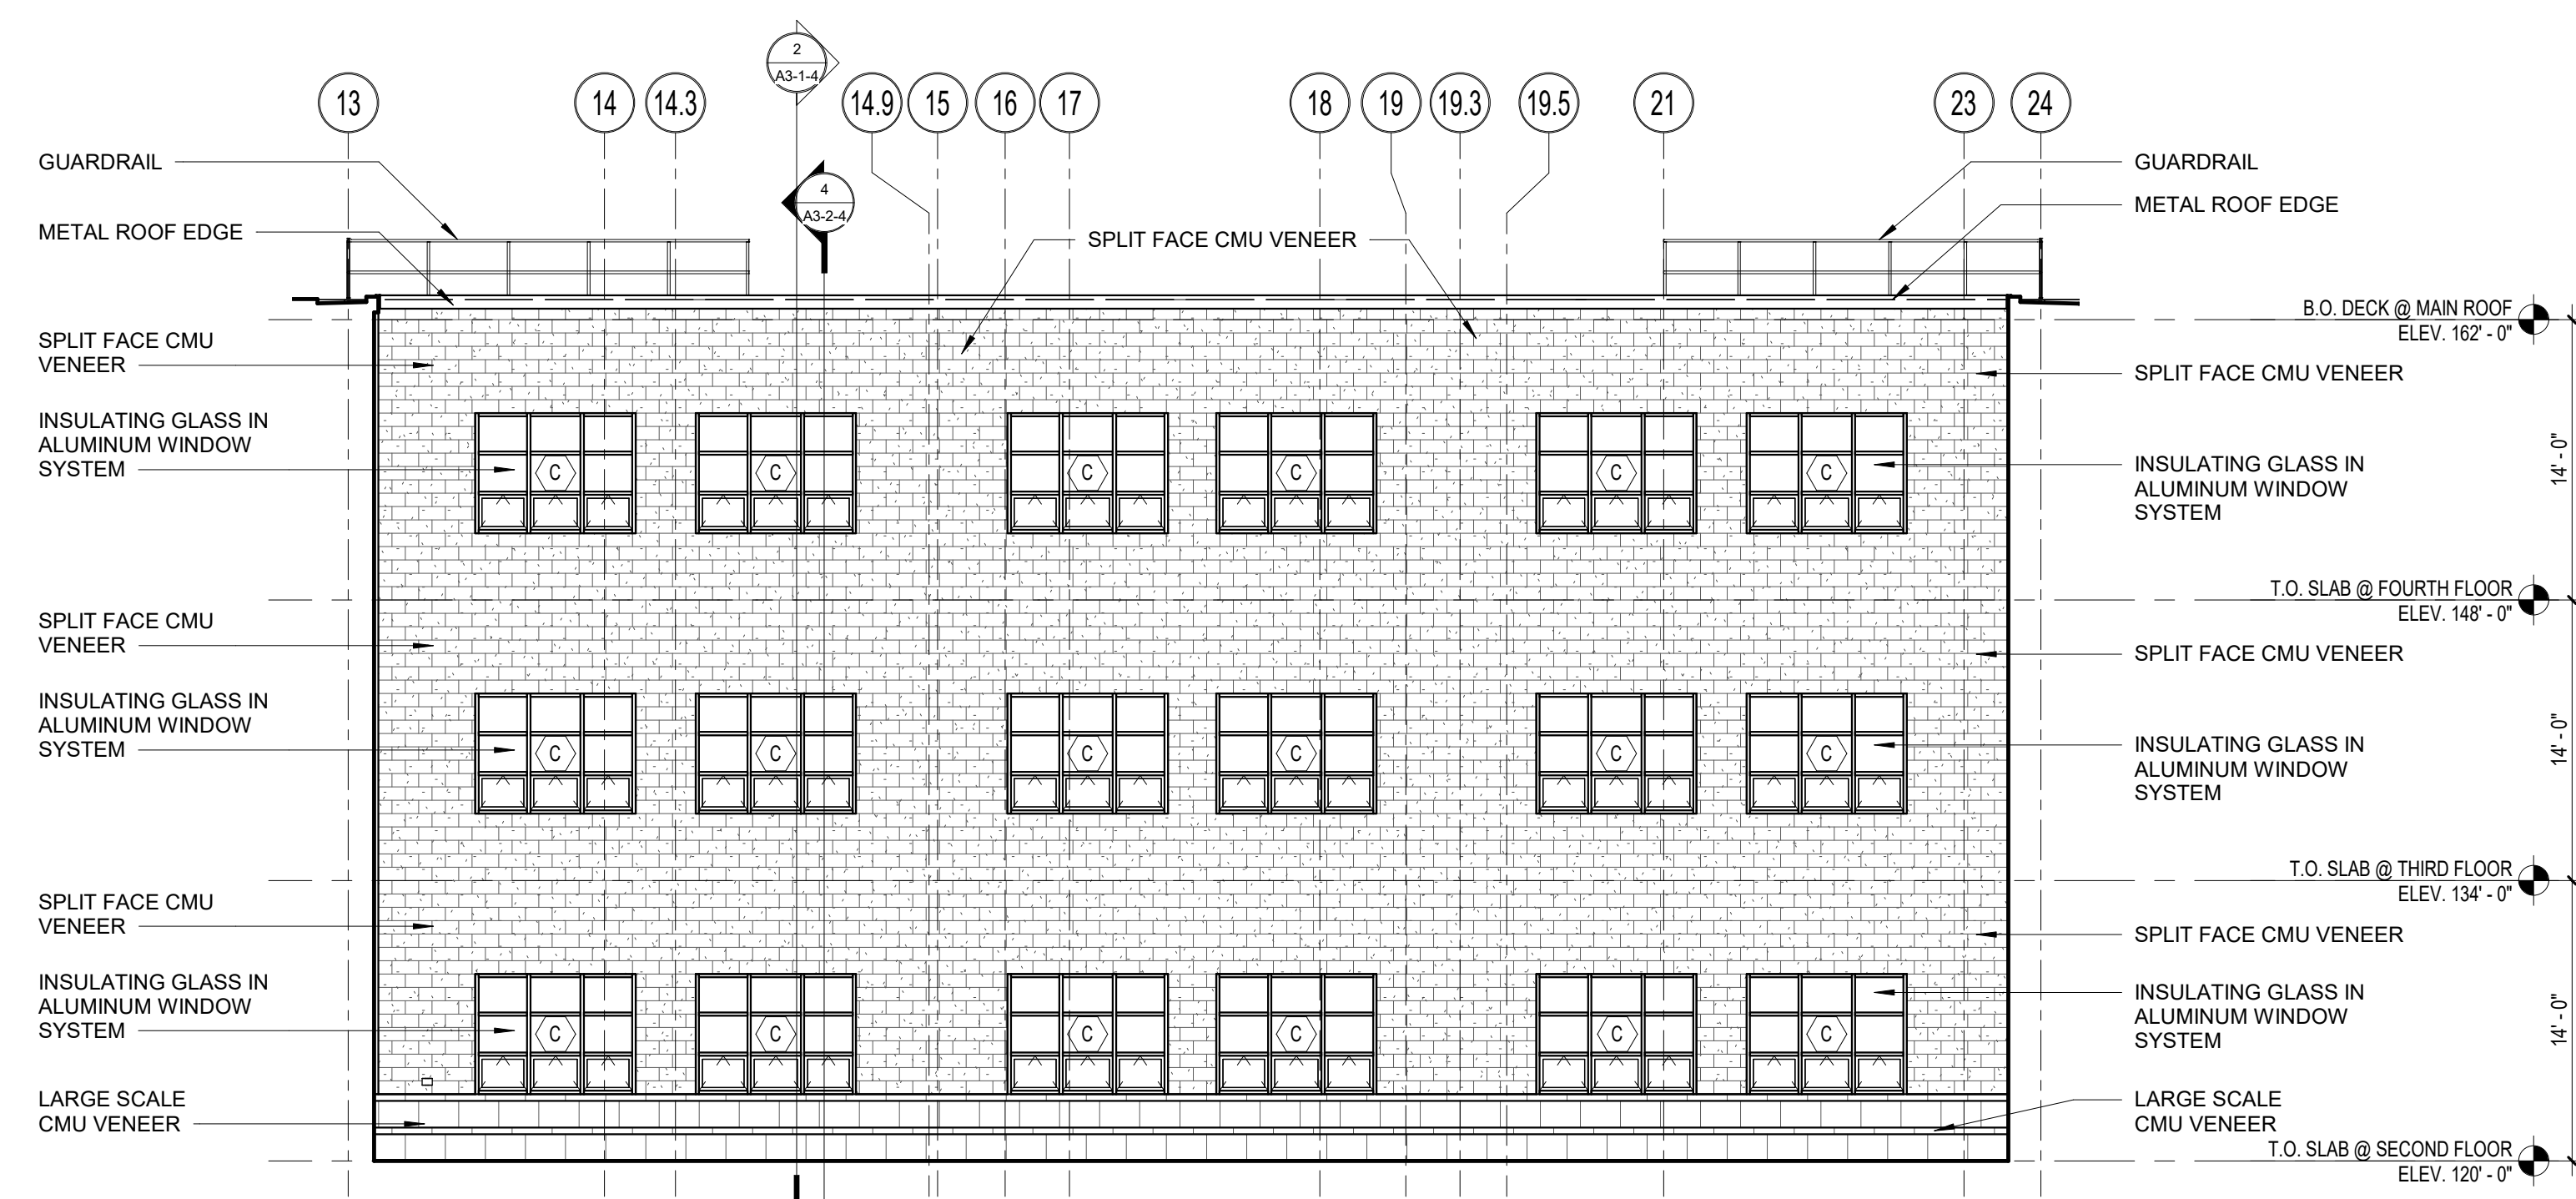


9 WEST ELEVATION
1/8" = 1'-0"

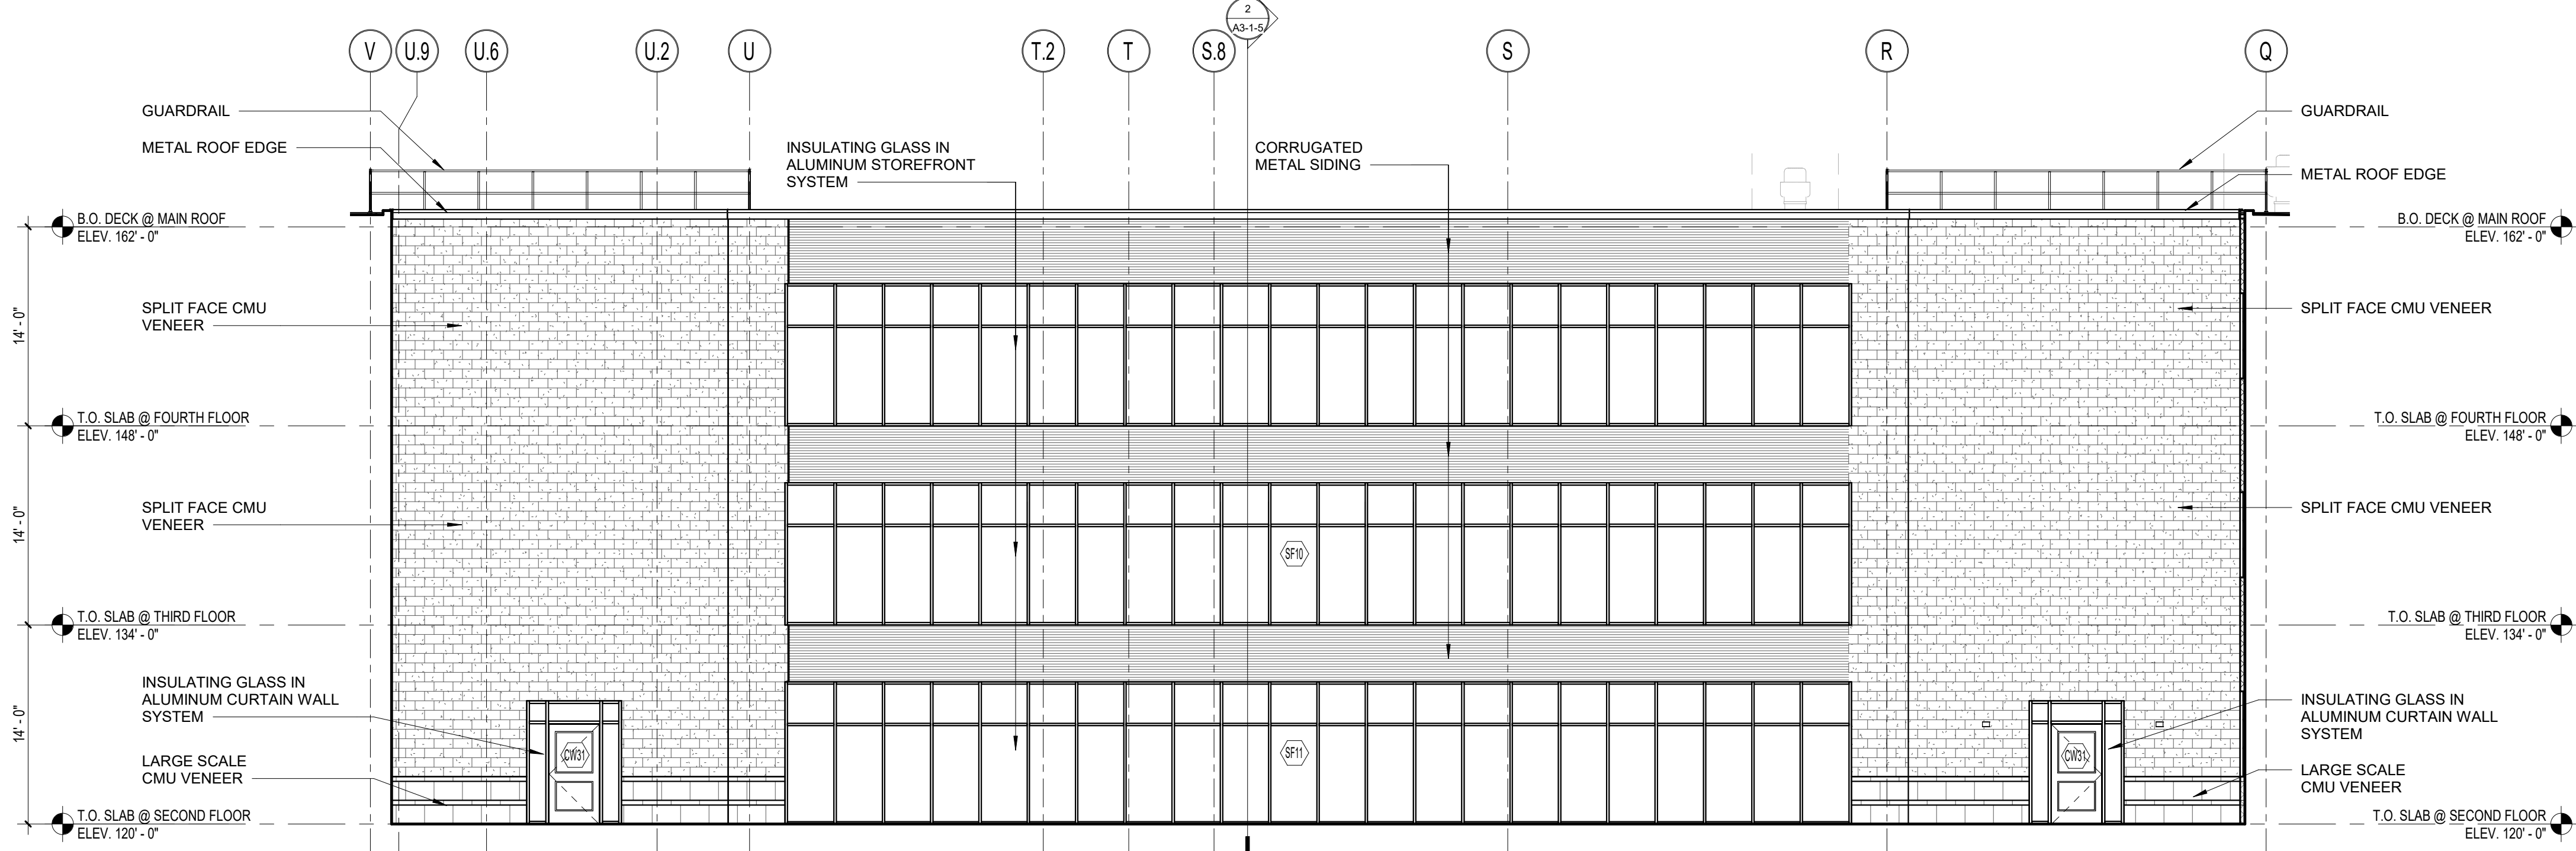


10 NORTH ELEVATION
1/8" = 1'-0"

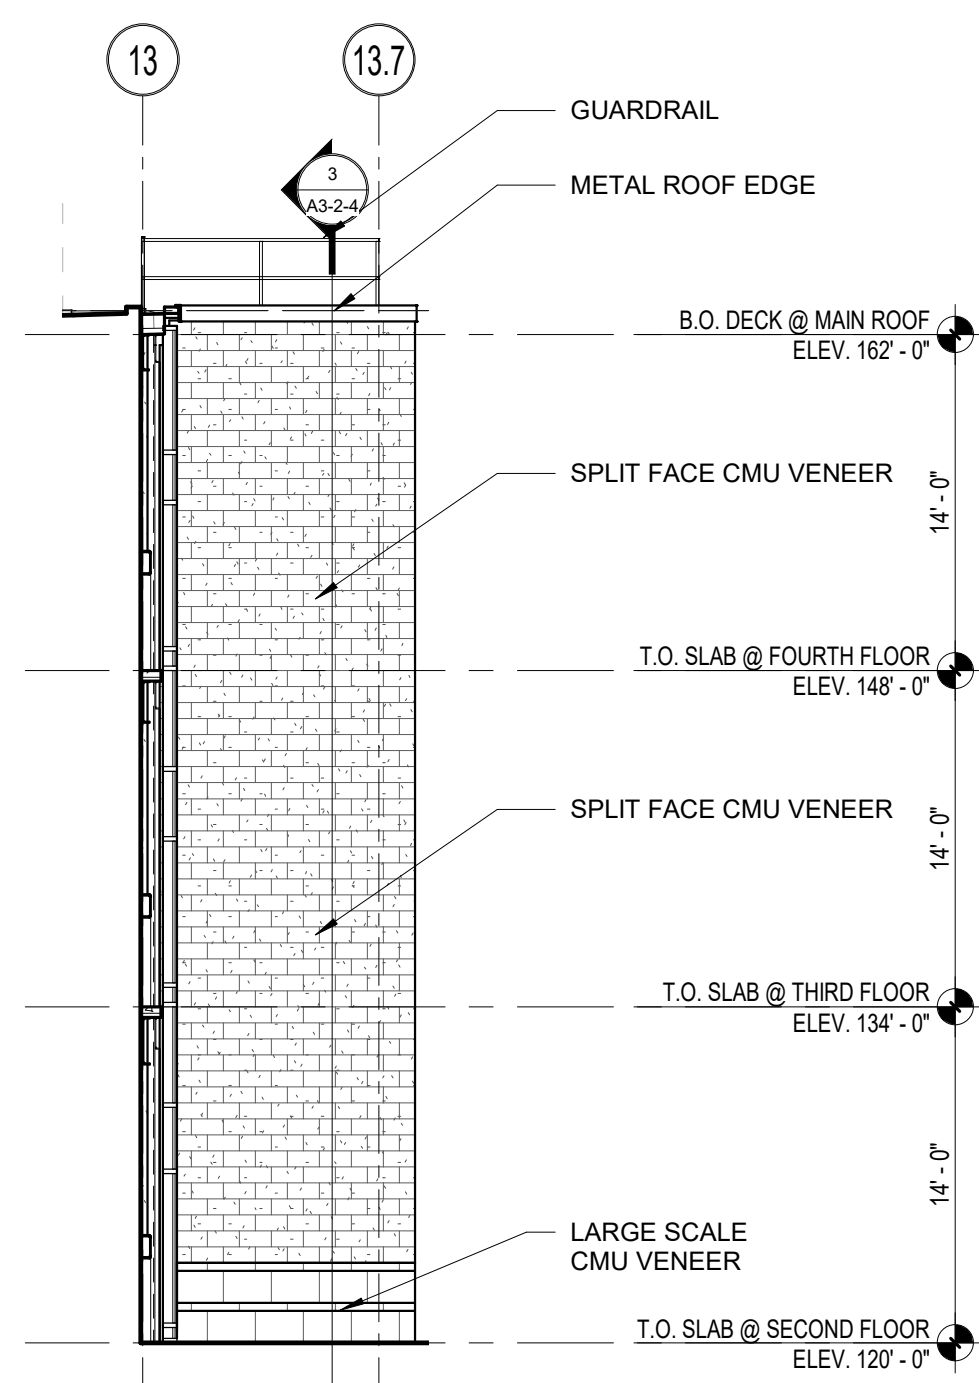


6 WEST ELEVATION
1/8" = 1'-0"

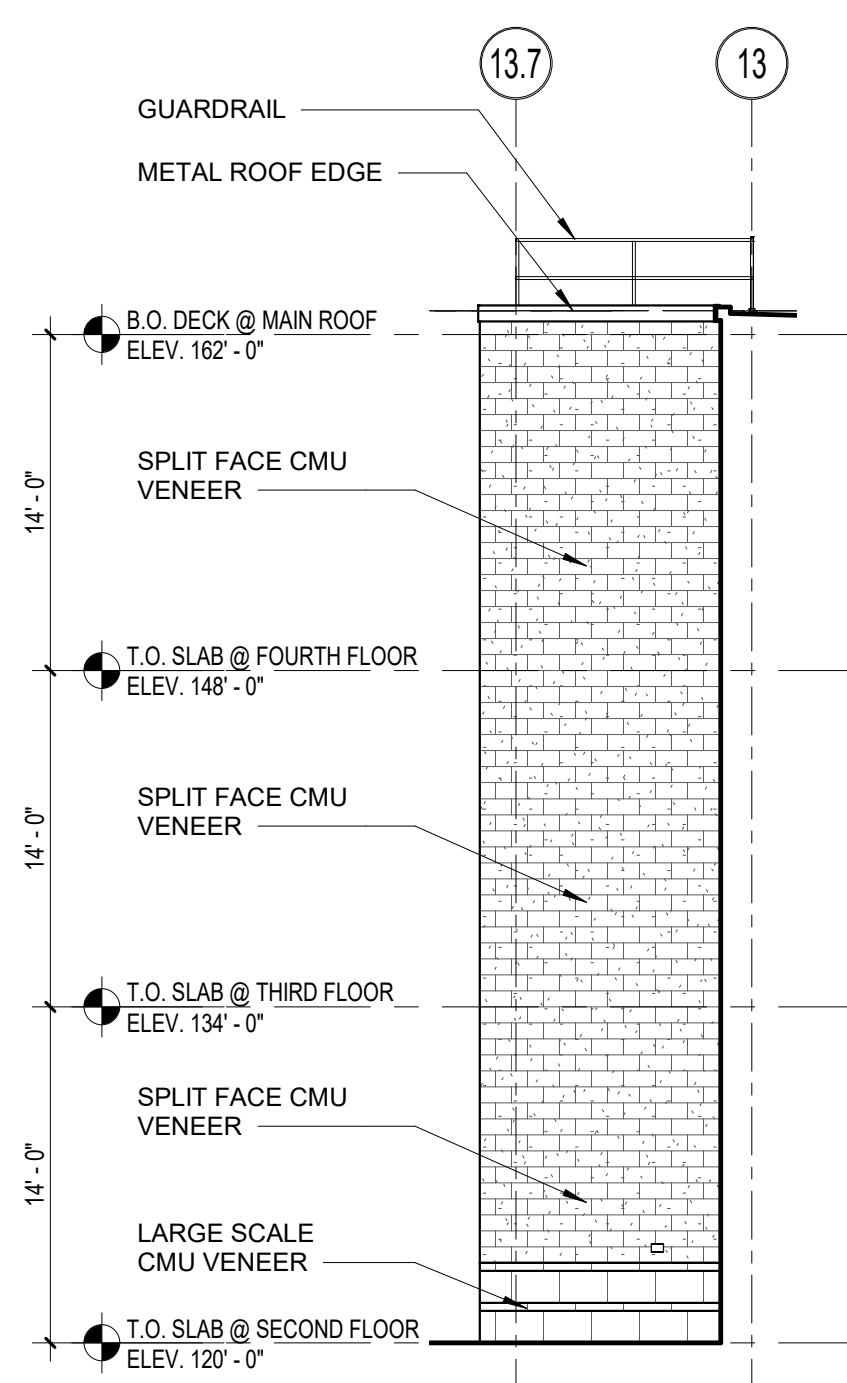


7 EAST ELEVATION
1/8" = 1'-0"

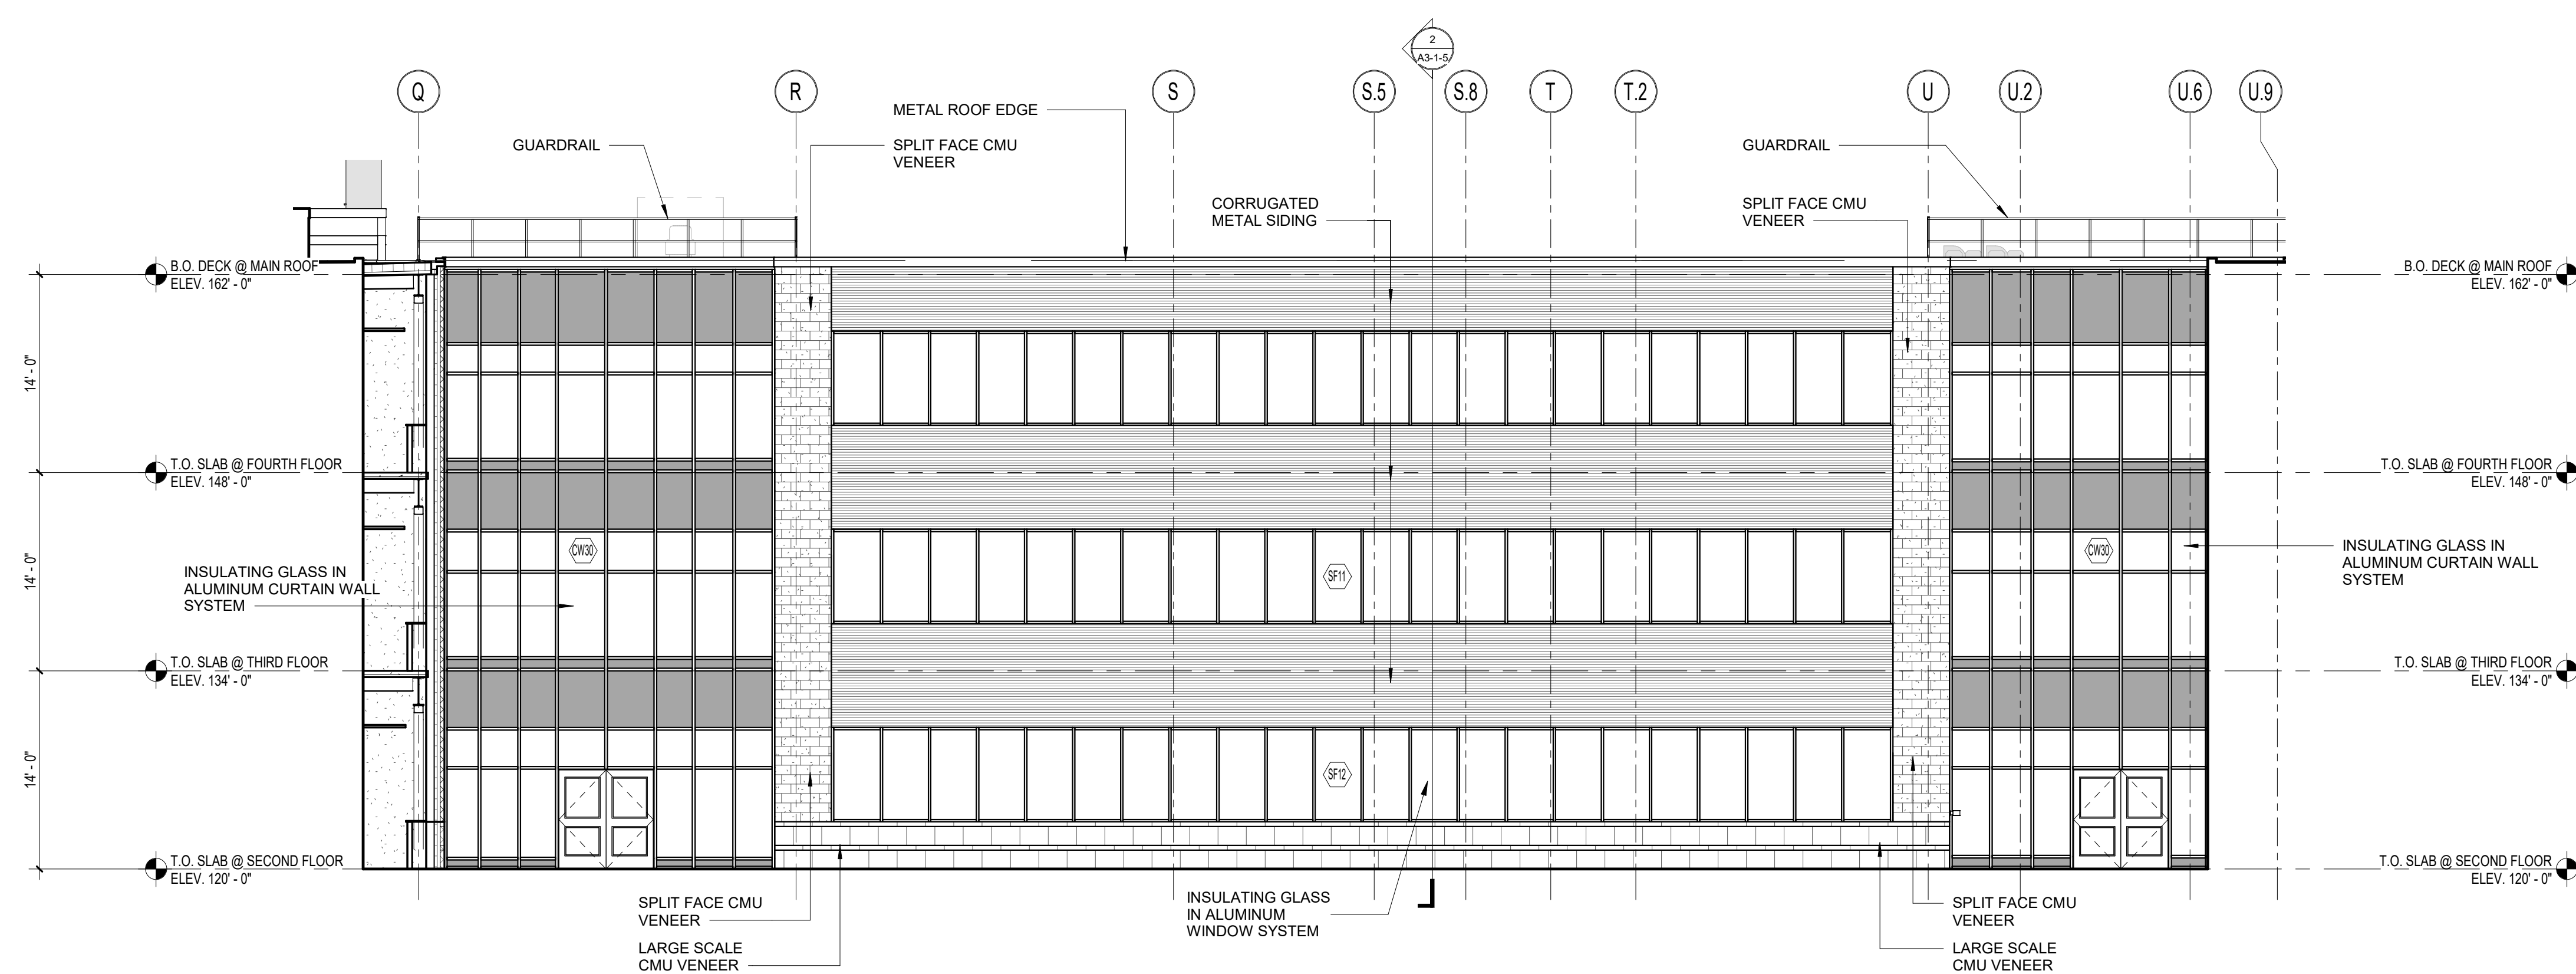


8 SOUTH ELEVATION
1/8" = 1'-0"

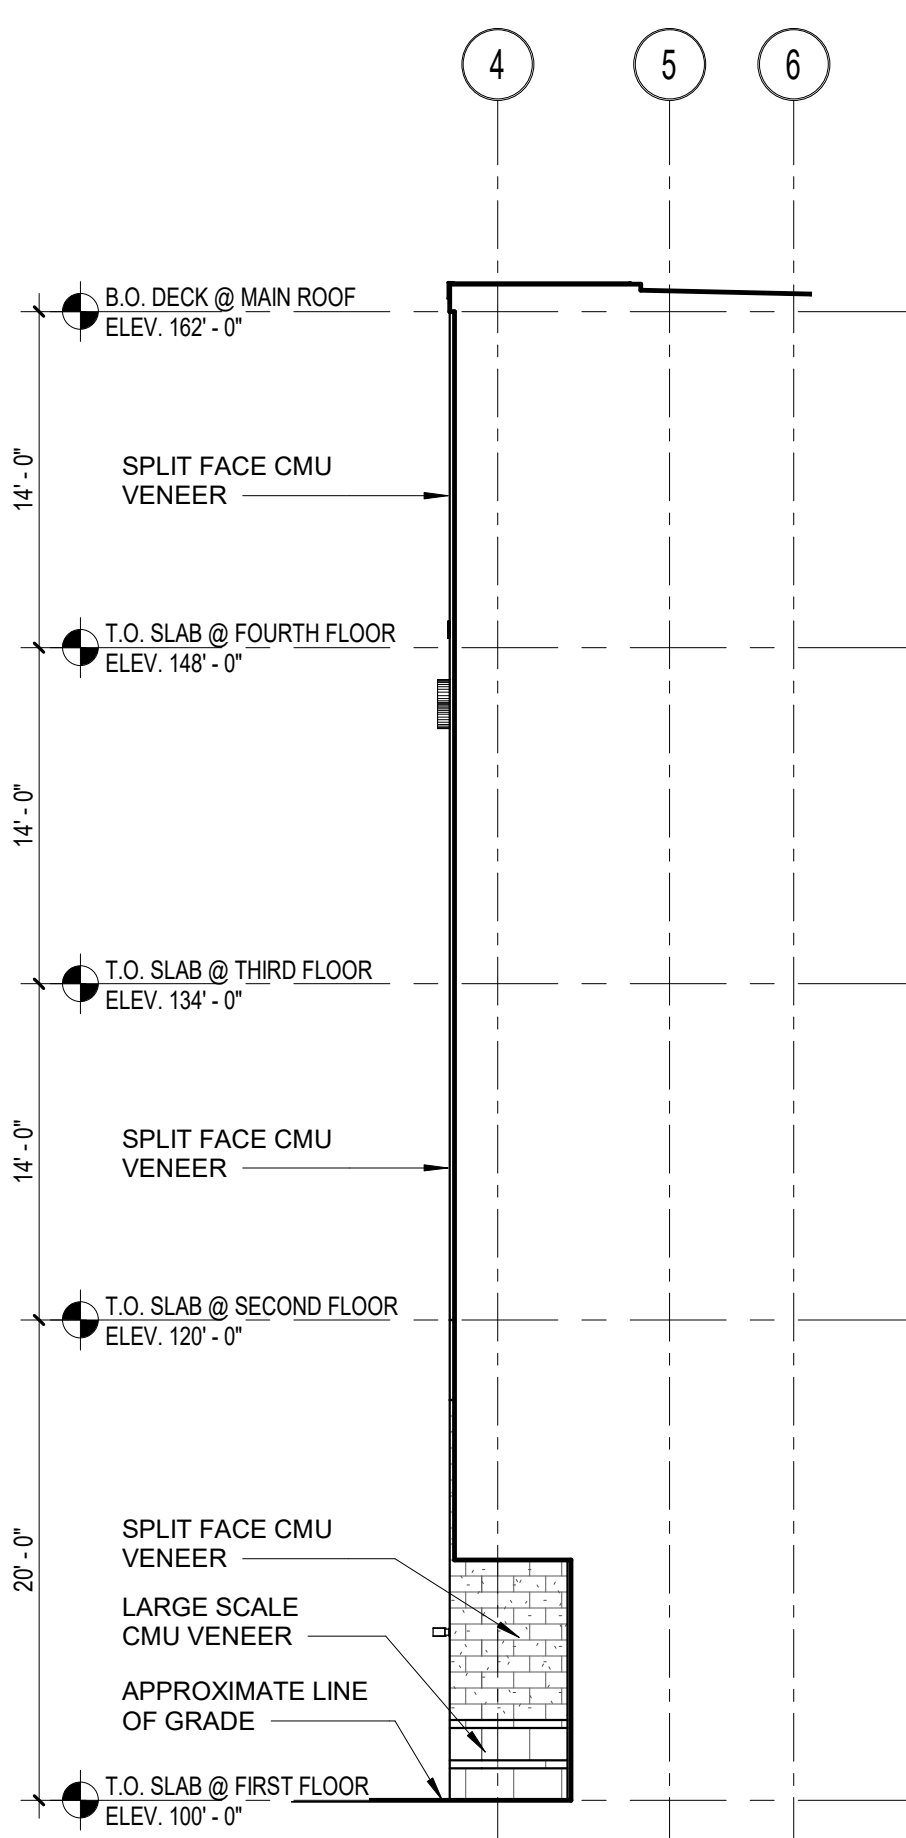


1 WEST ELEVATION
1/8" = 1'-0"

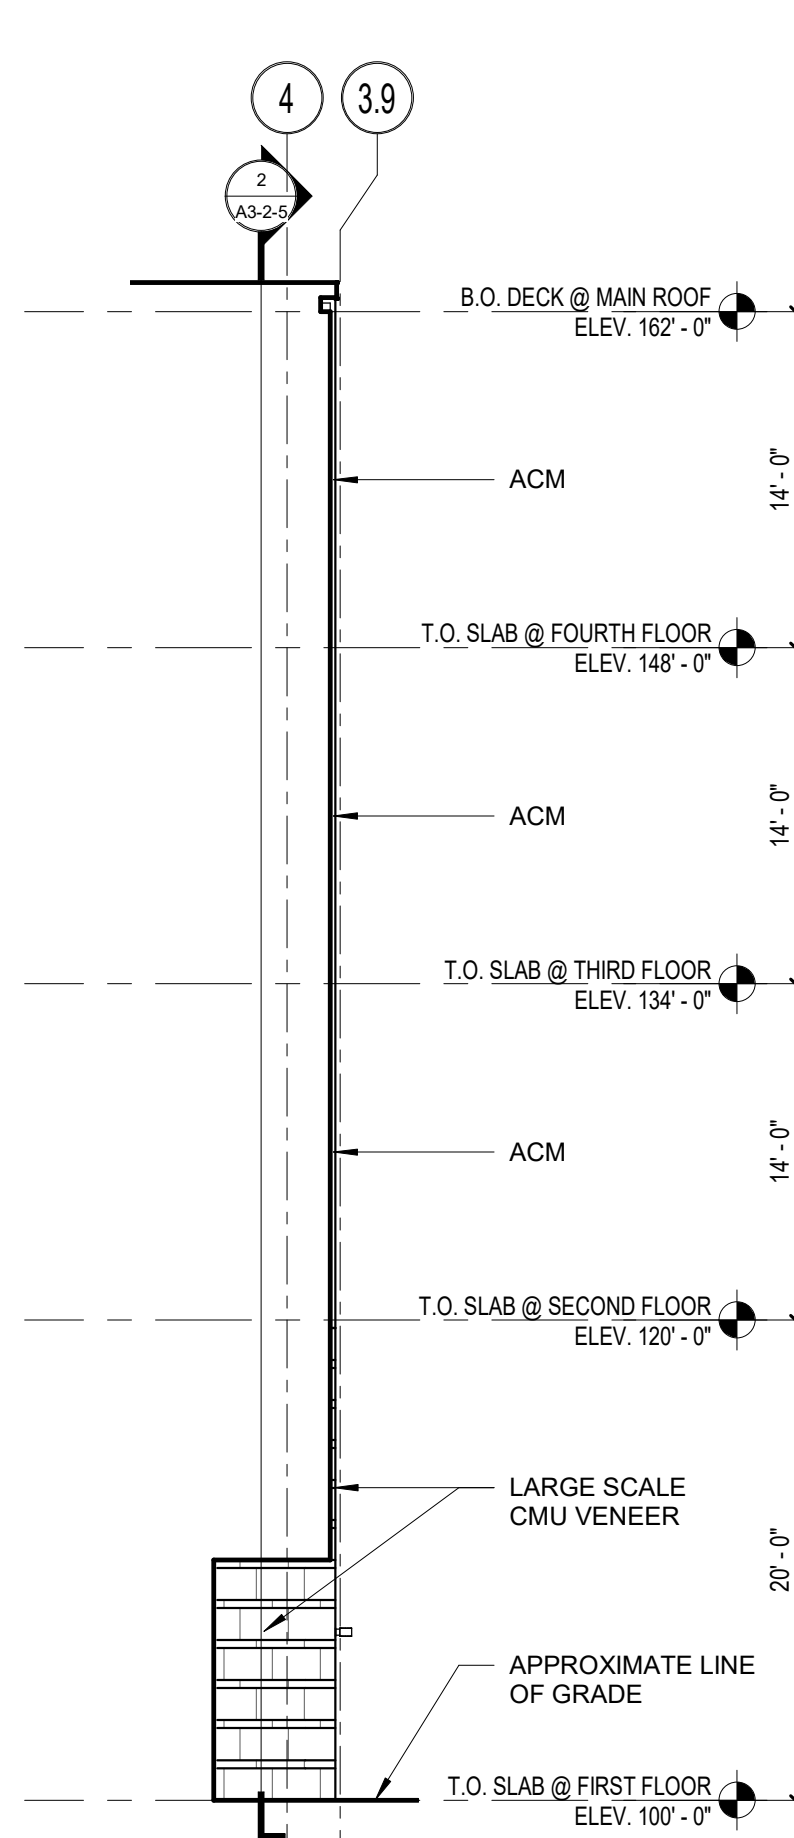


2 EAST ELEVATION
1/8" = 1'-0"

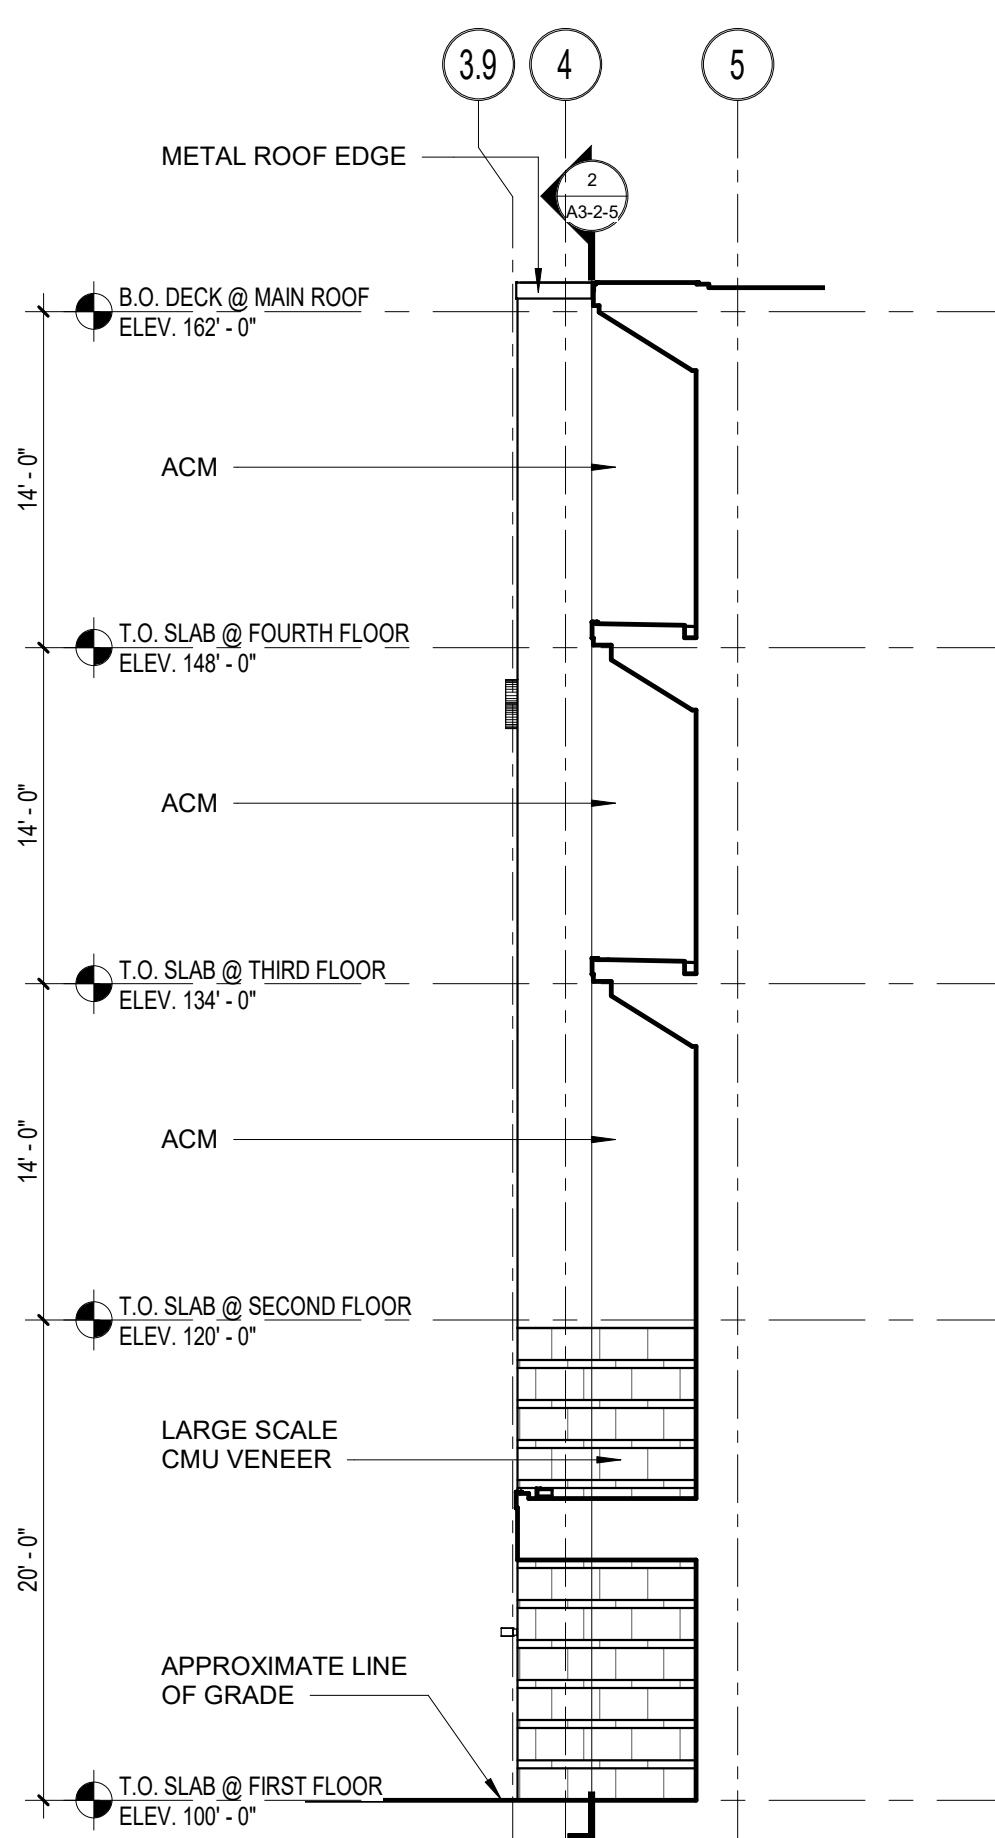



3 WEST ELEVATION
1/8" = 1'-0"

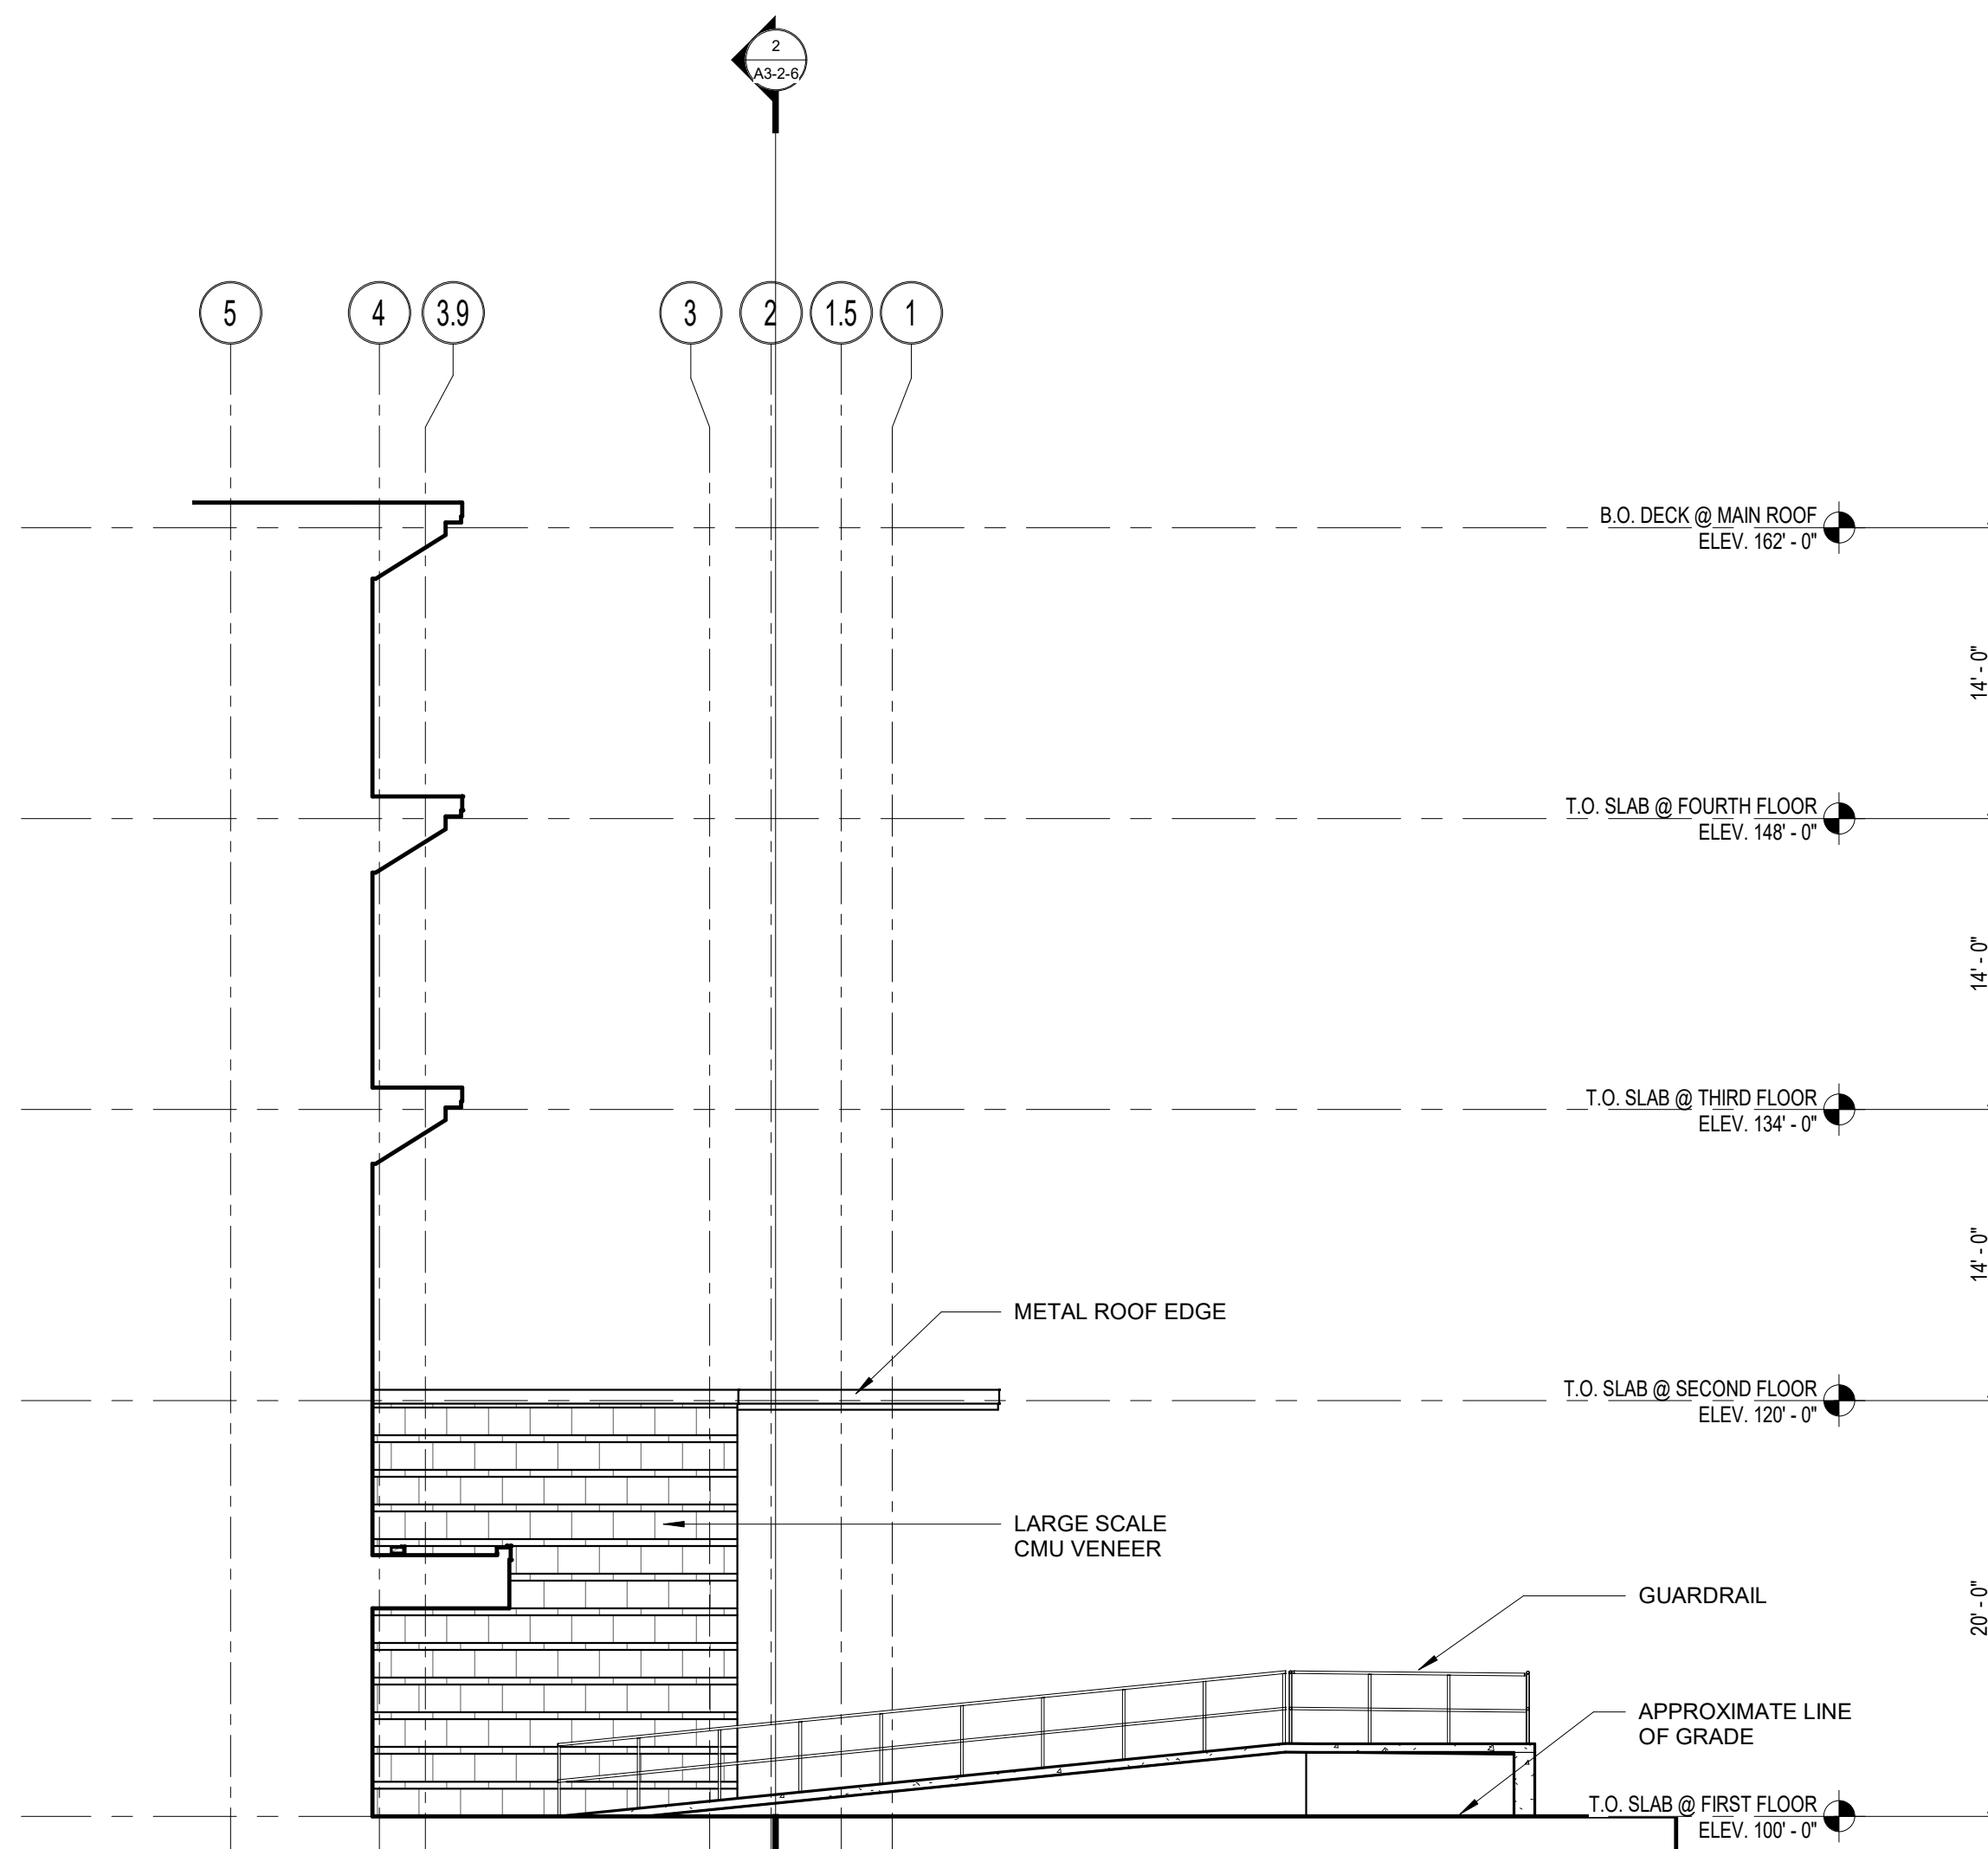

4 EAST ELEVATION
1/8" = 1'-0"

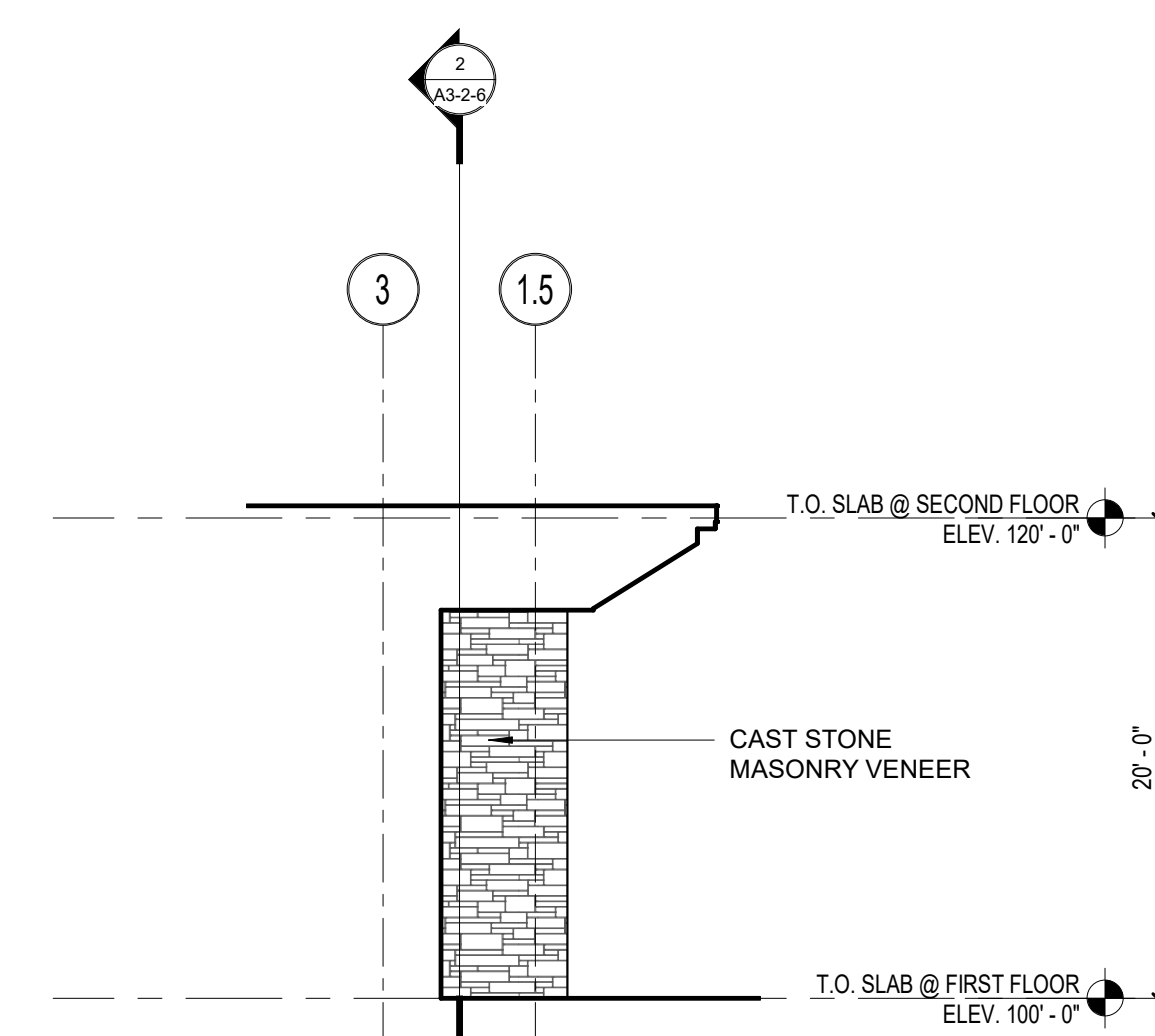


5 EAST ELEVATION
1/8" = 1'-0"

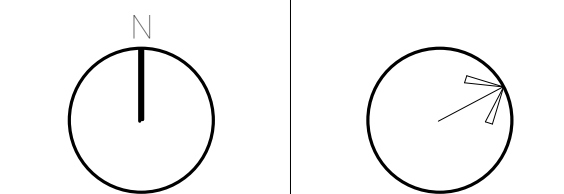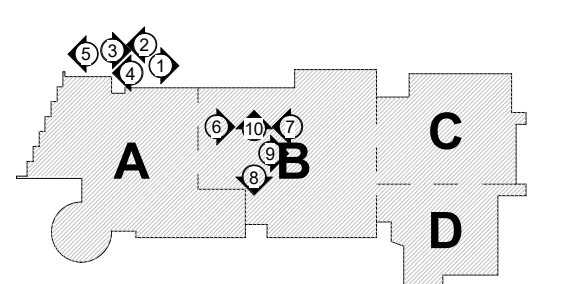


**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

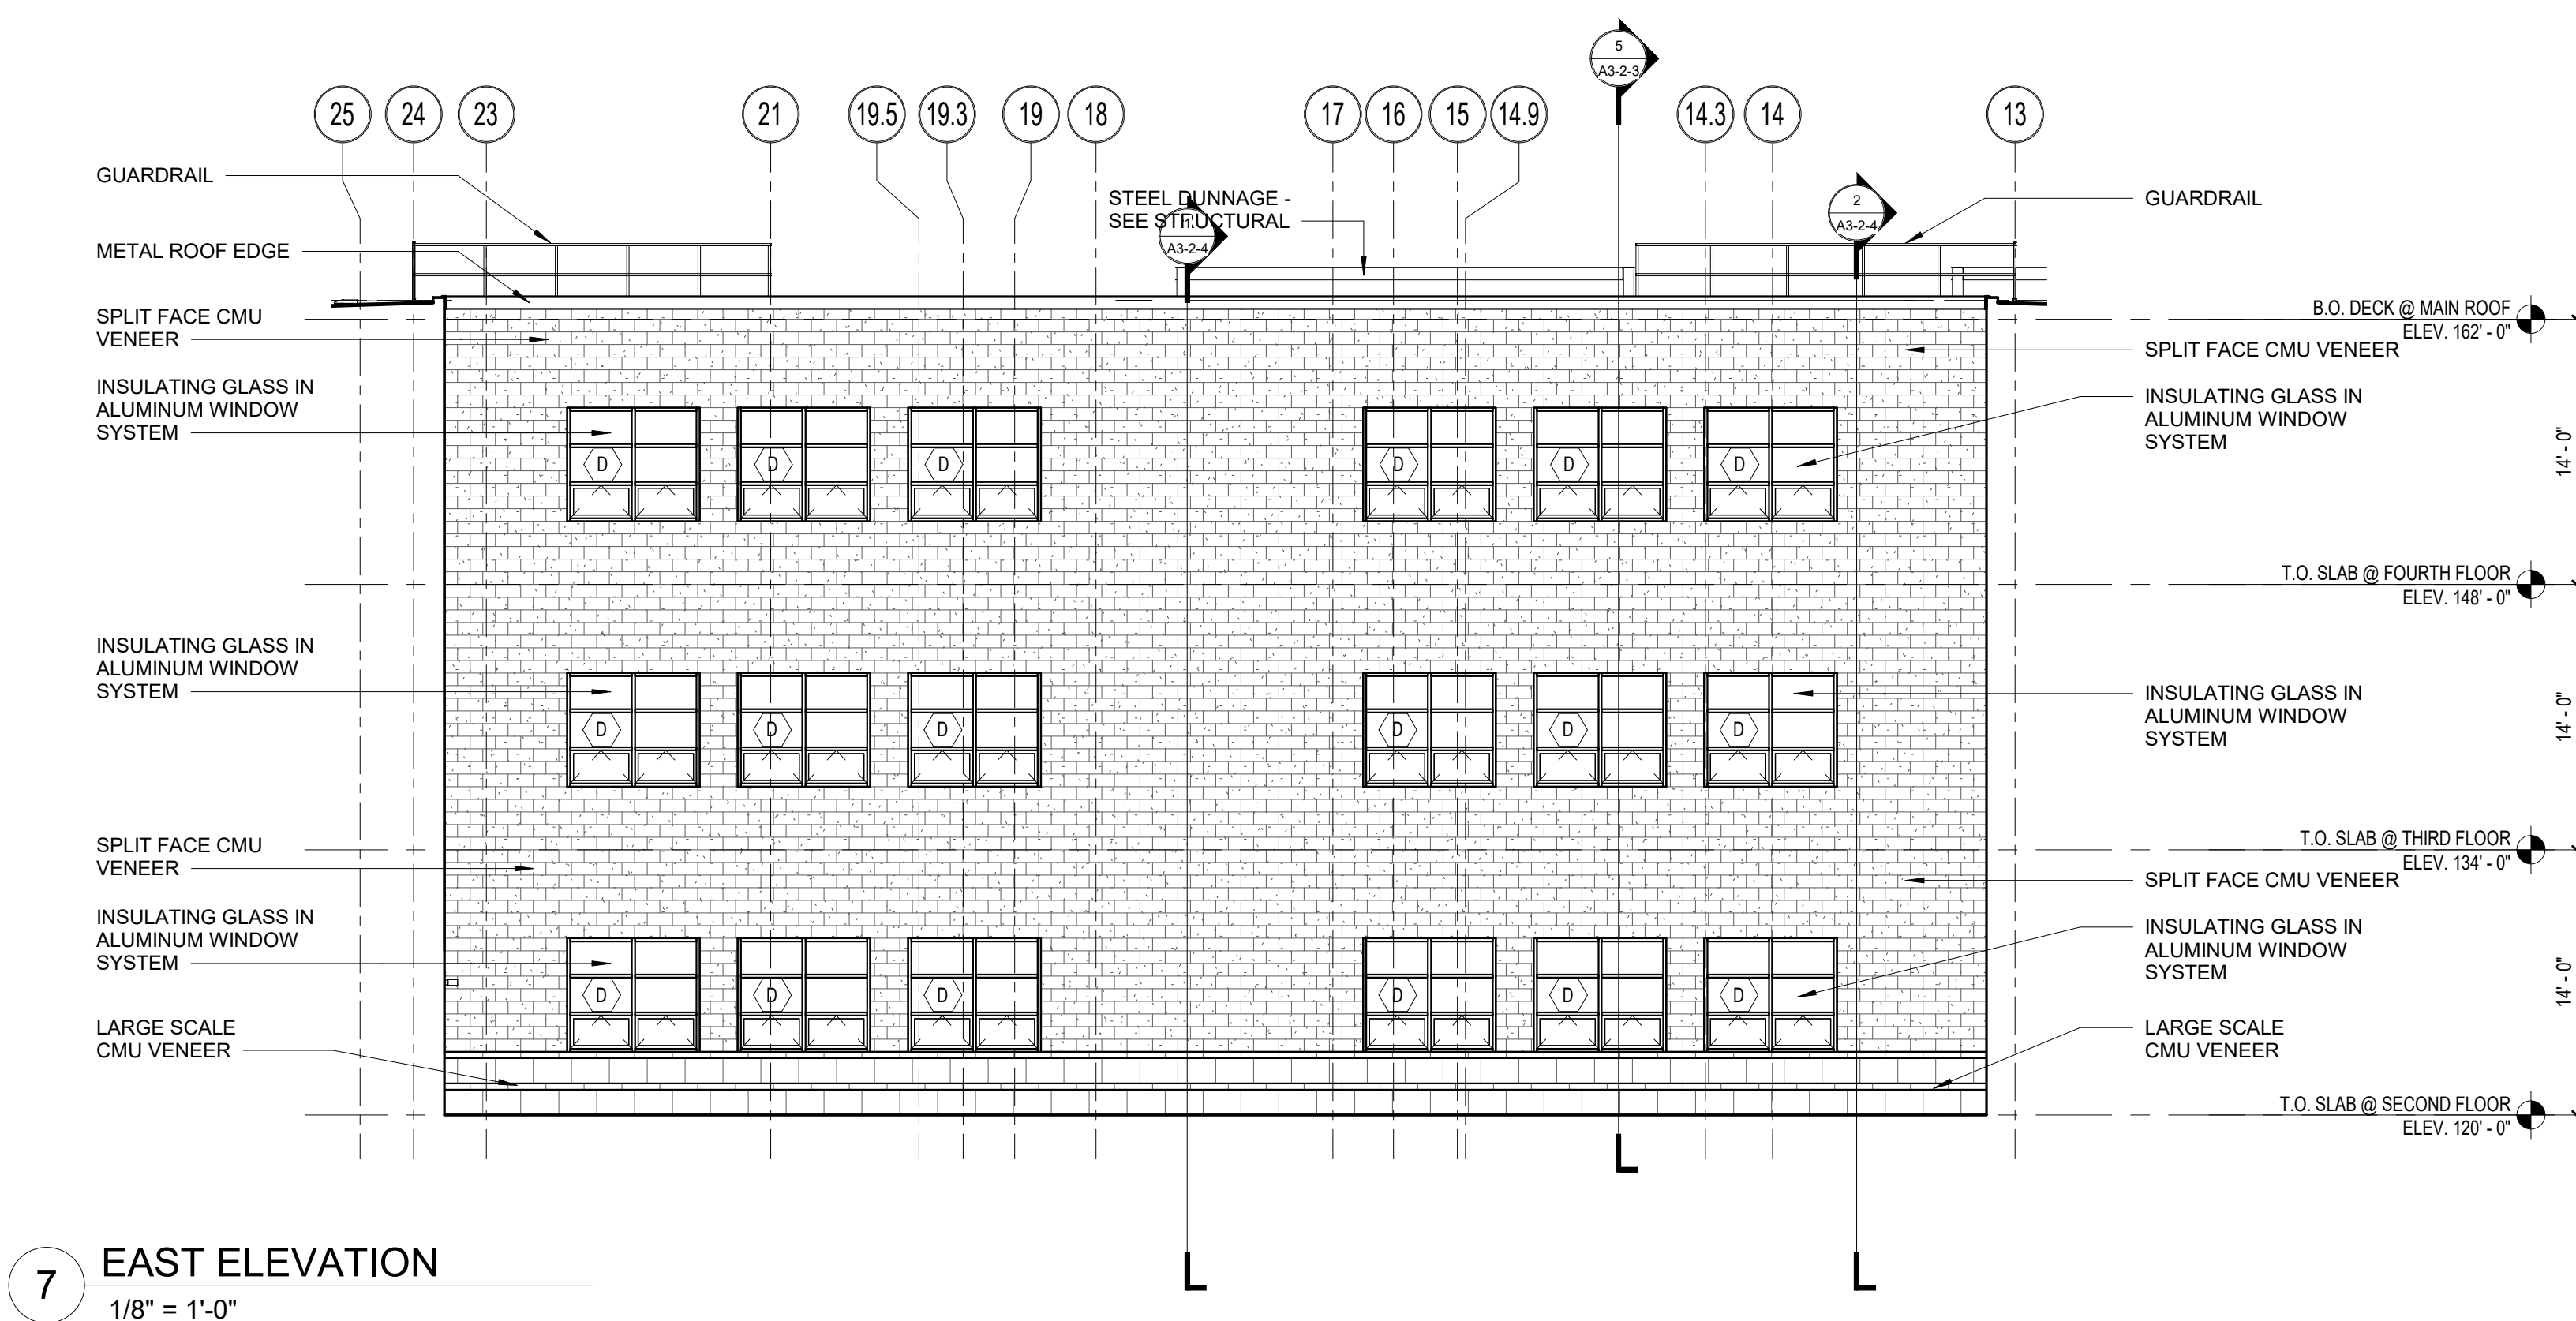


7 EAST ELEVATION
1/8" = 1'-0"

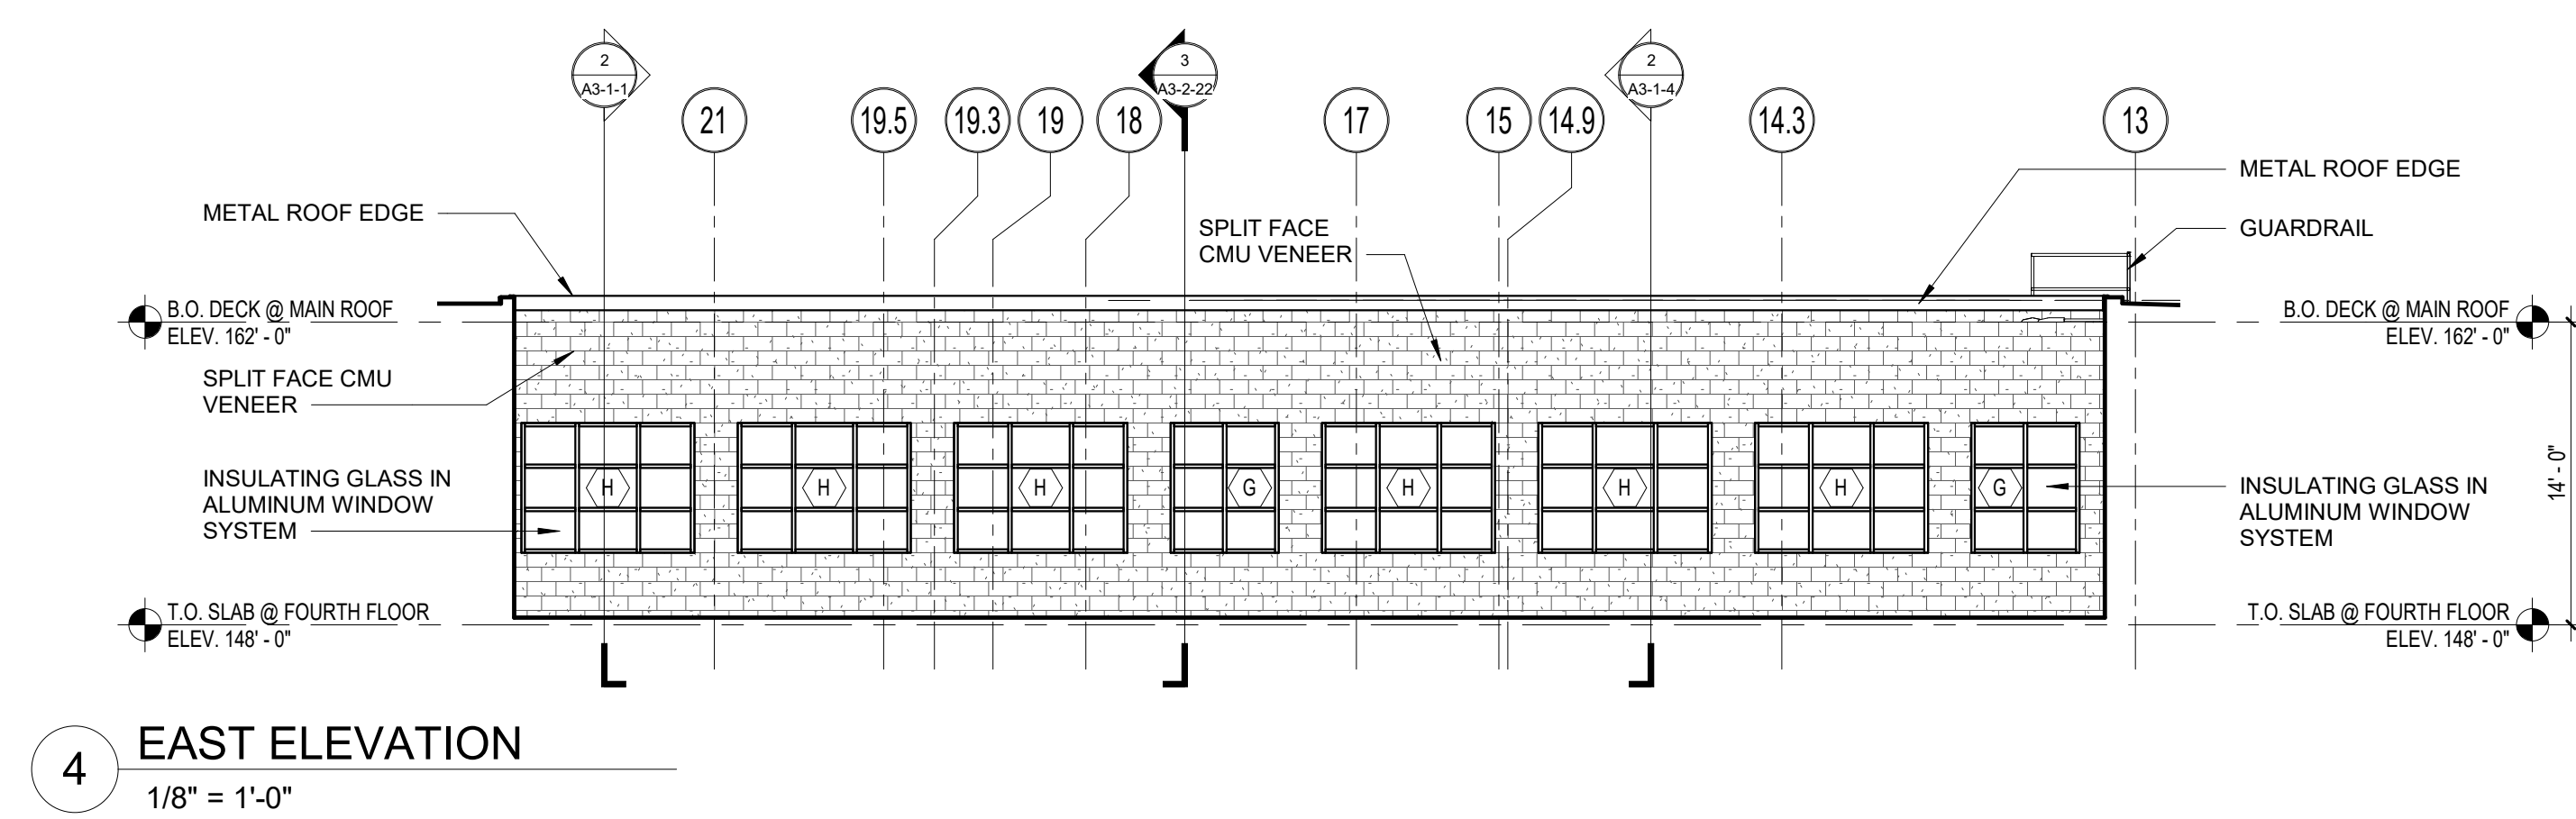


4 EAST ELEVATION
1/8" = 1'-0"

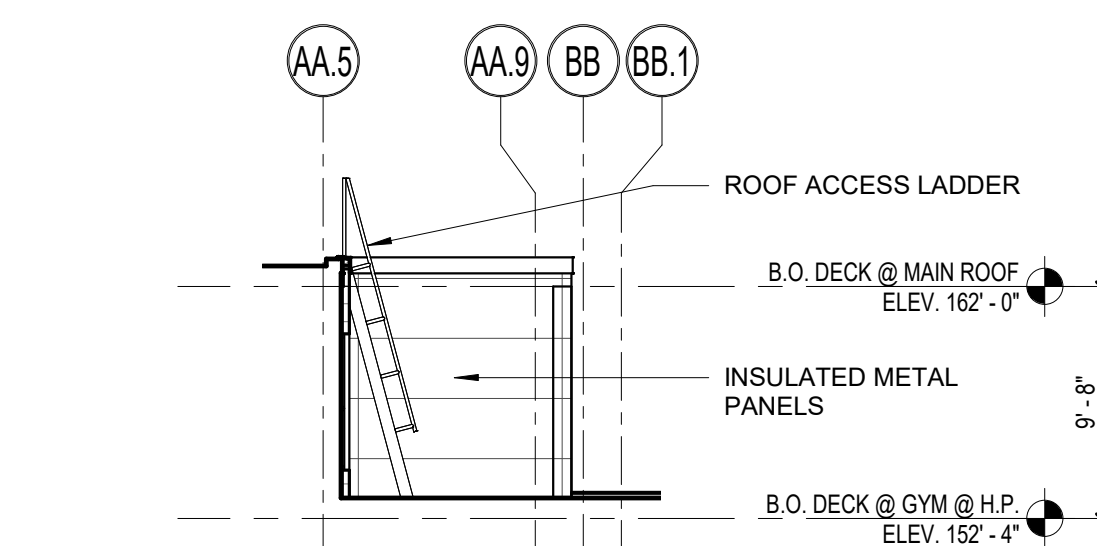


5 SOUTH ELEVATION
1/8" = 1'-0"

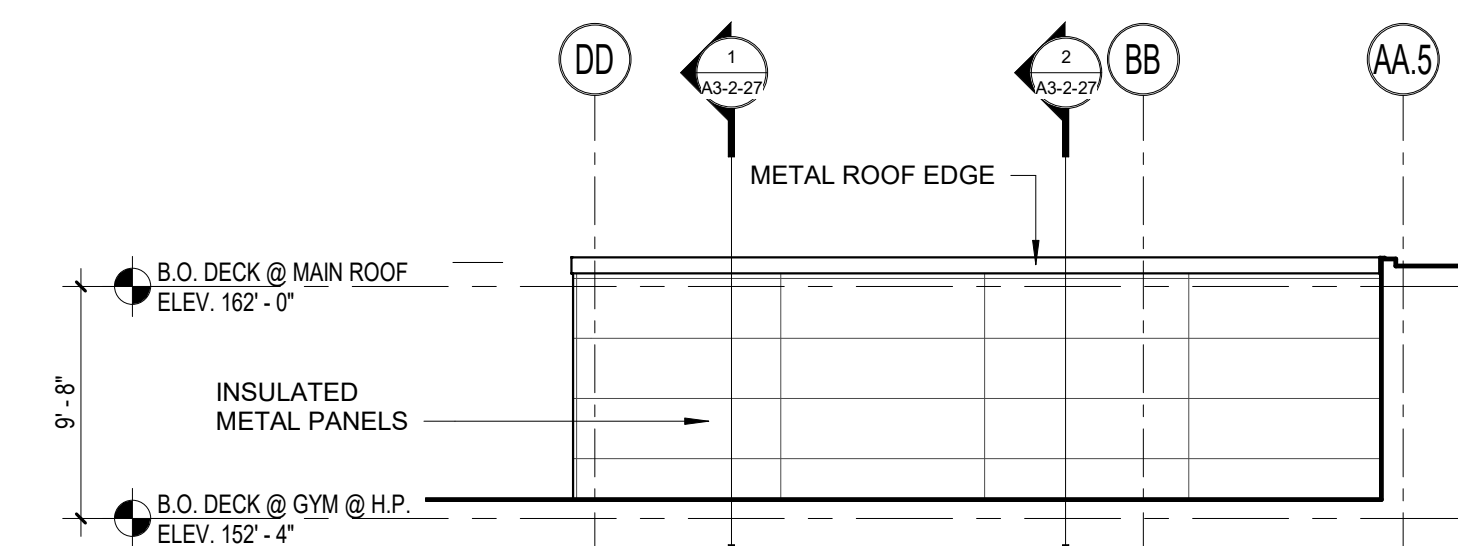


6 NORTH ELEVATION
1/8" = 1'-0"

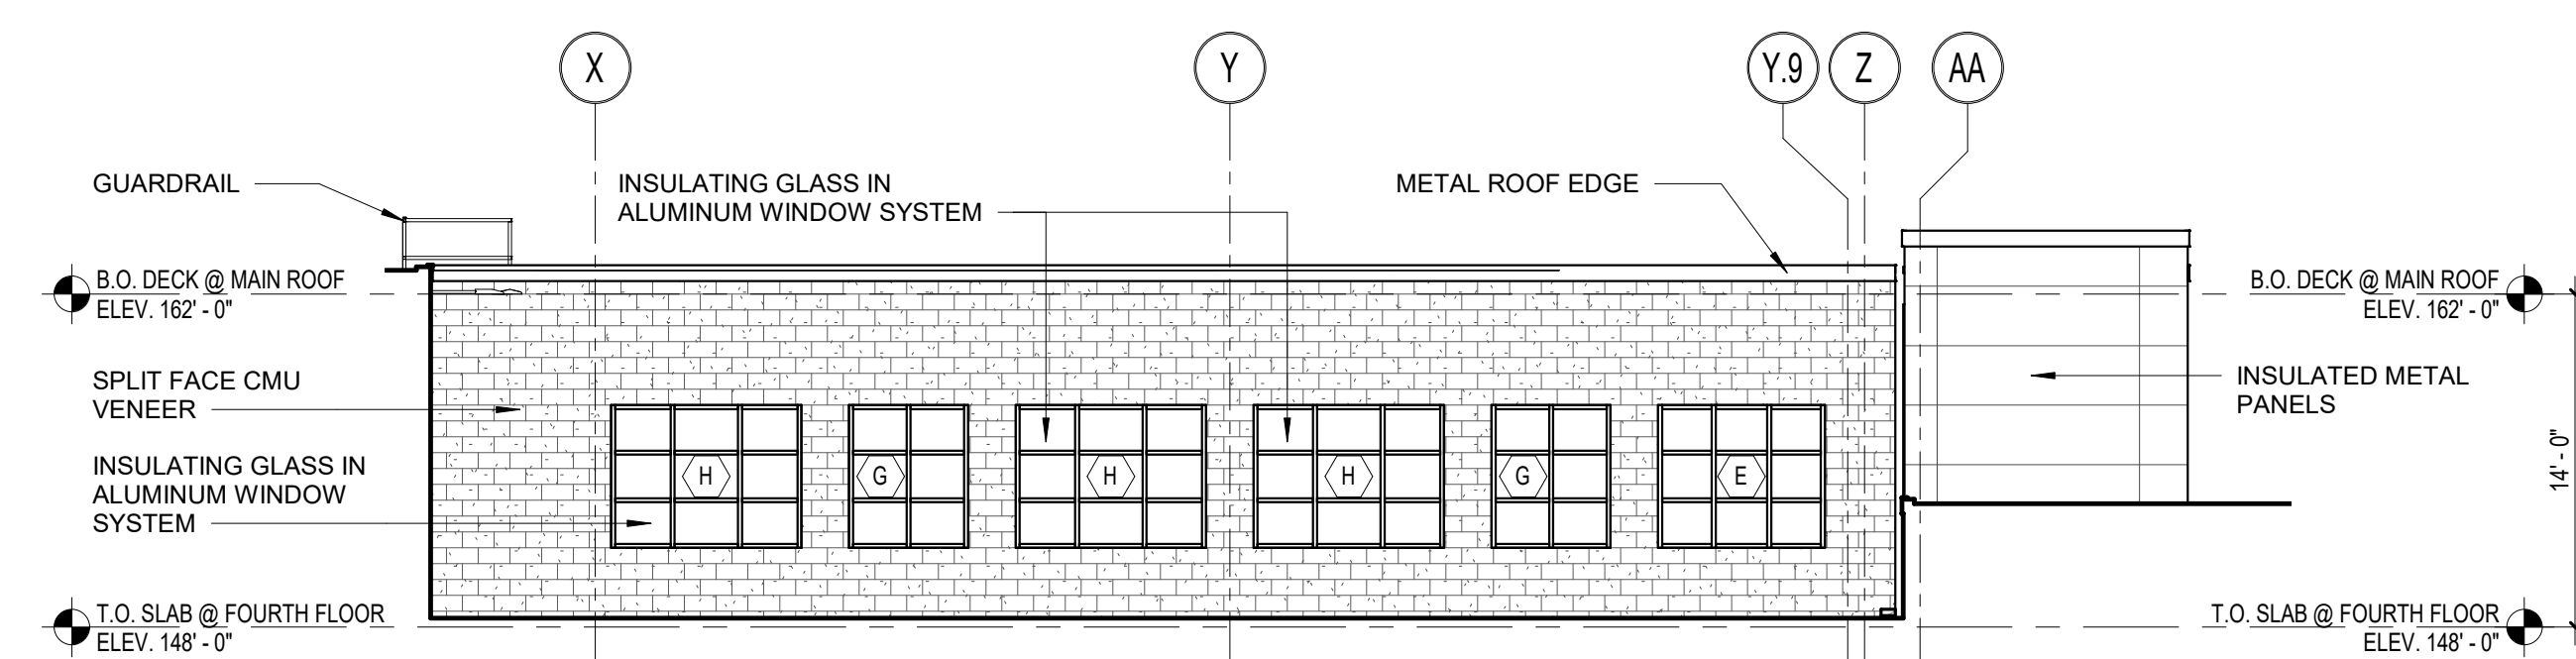

1 SOUTH ELEVATION
1/8" = 1'-0"

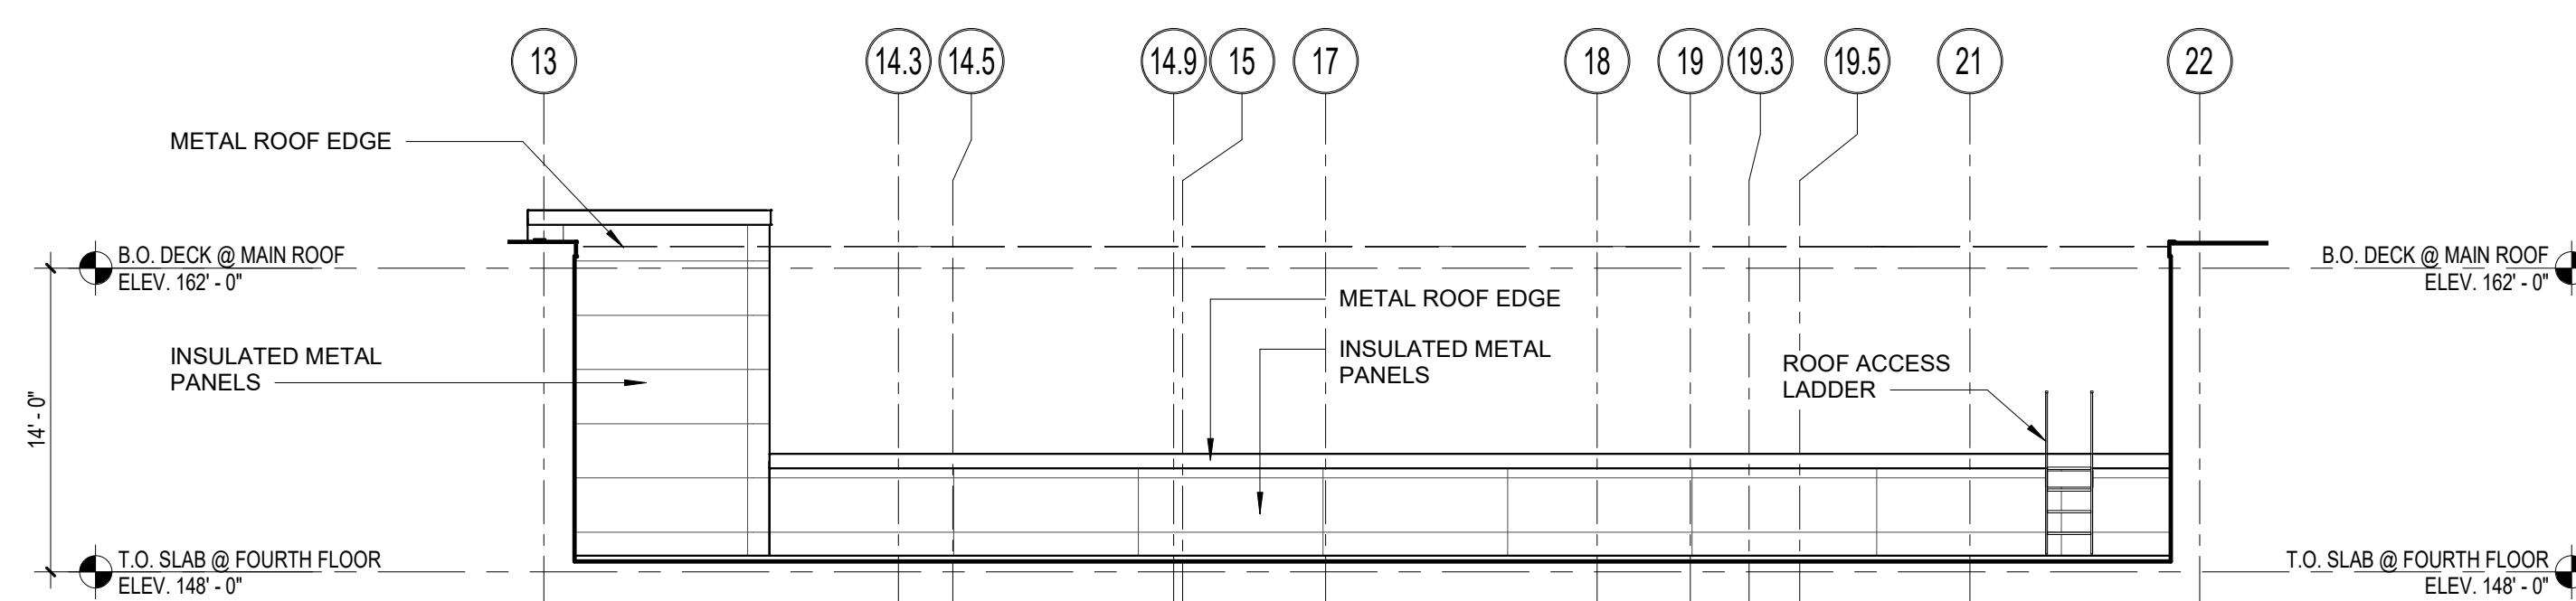


2 WEST ELEVATION
1/8" = 1'-0"

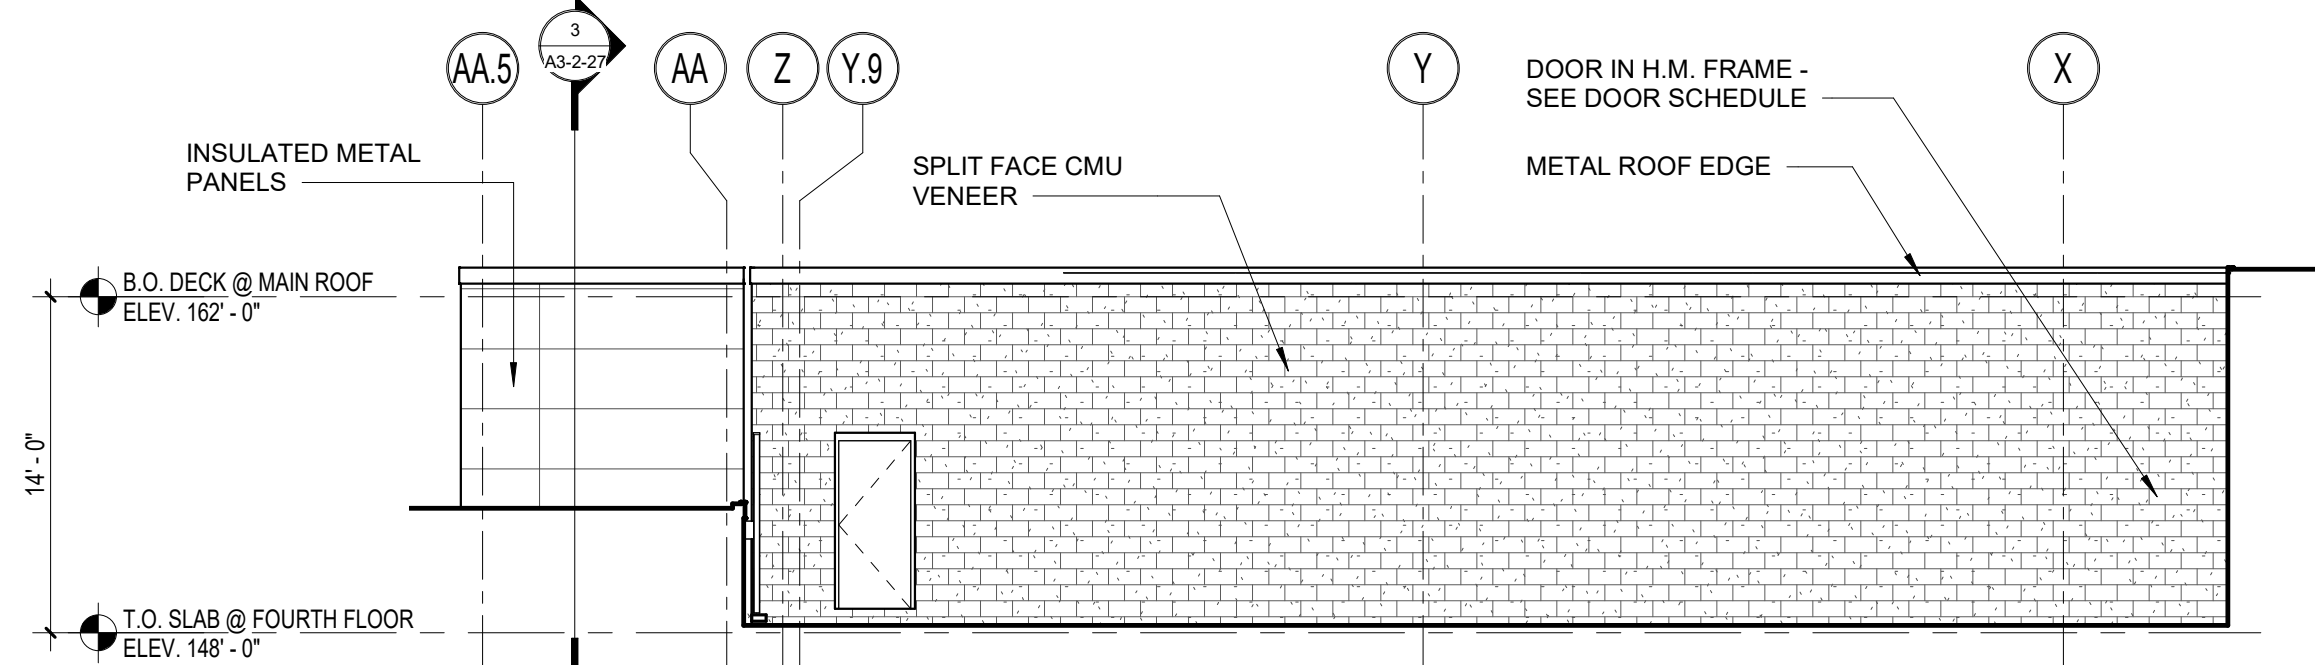


3 NORTH ELEVATION
1/8" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023




KEY PLAN

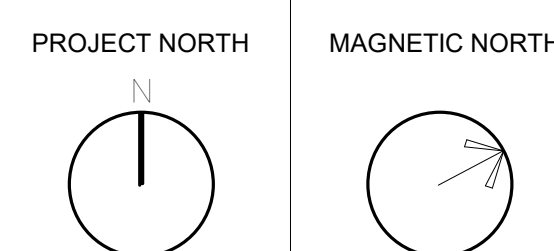


**BUILDING
ELEVATIONS**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A2-1-8

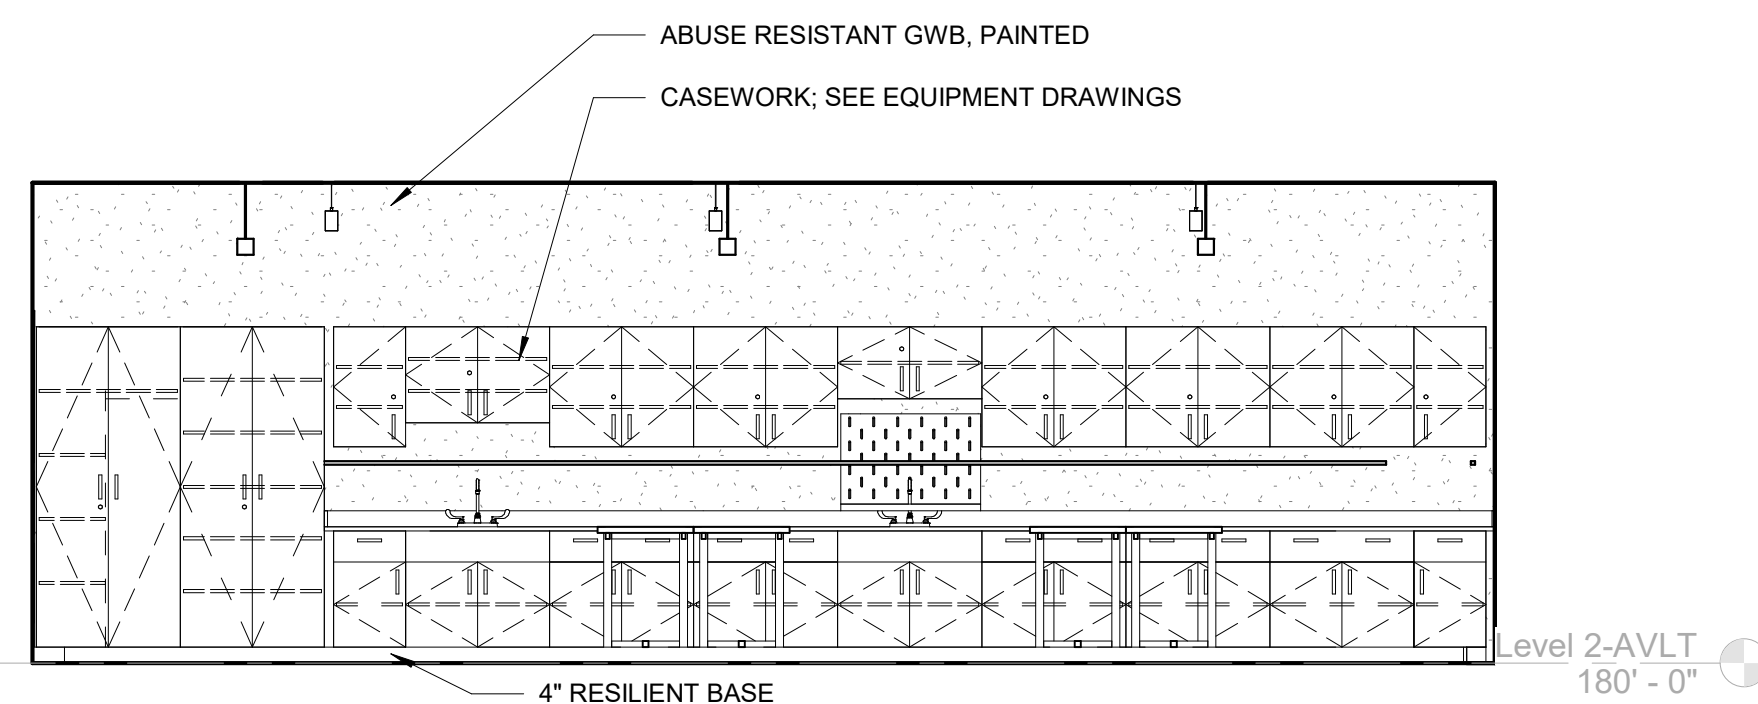


8 TYPICAL SCIENCE LAB ELEVATION
1/4" = 1'-0"

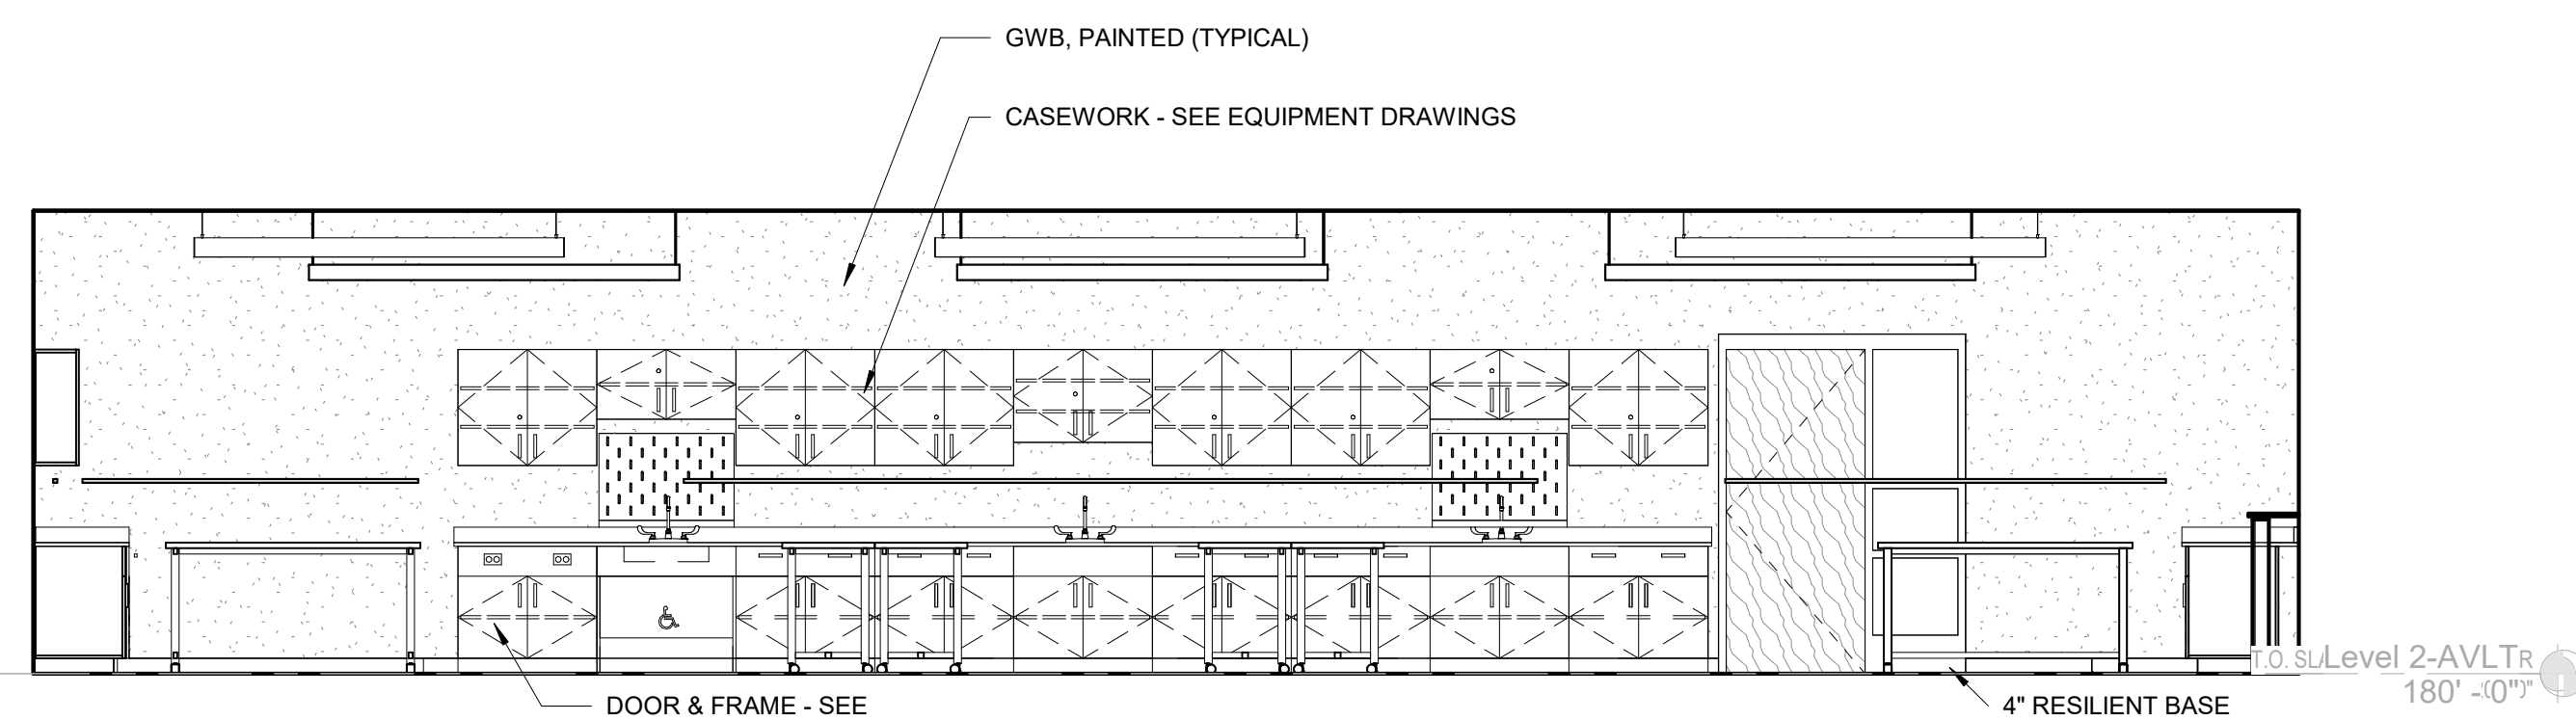


5 TYPICAL SCIENCE LAB ELEVATION
1/4" = 1'-0"

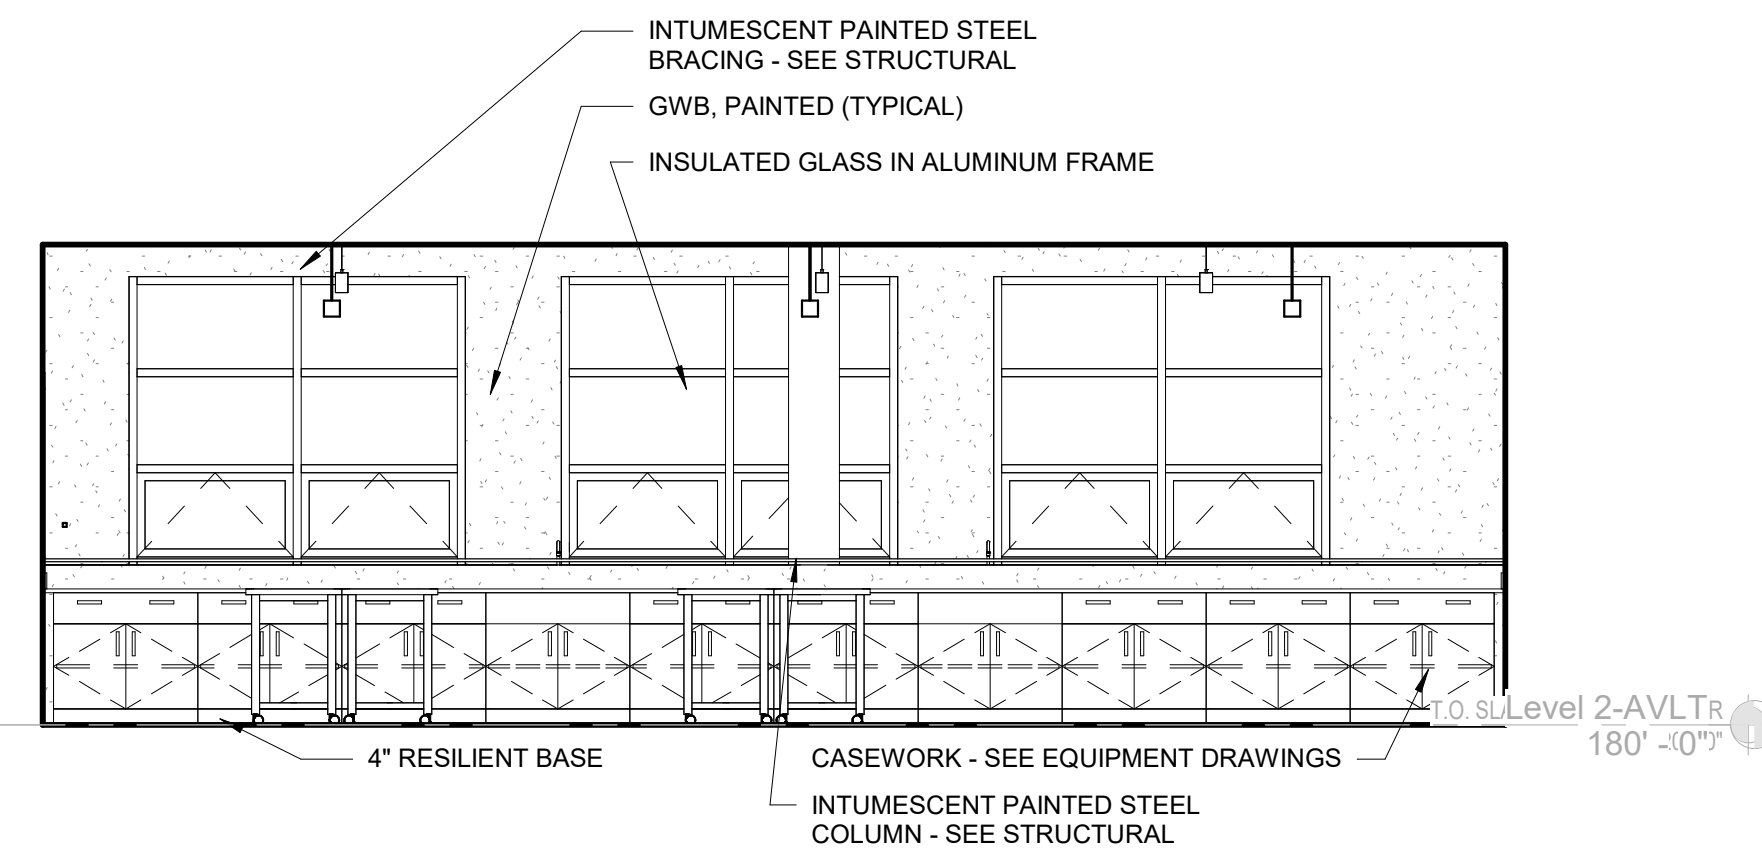


6 TYPICAL SCIENCE LAB ELEVATION
1/4" = 1'-0"

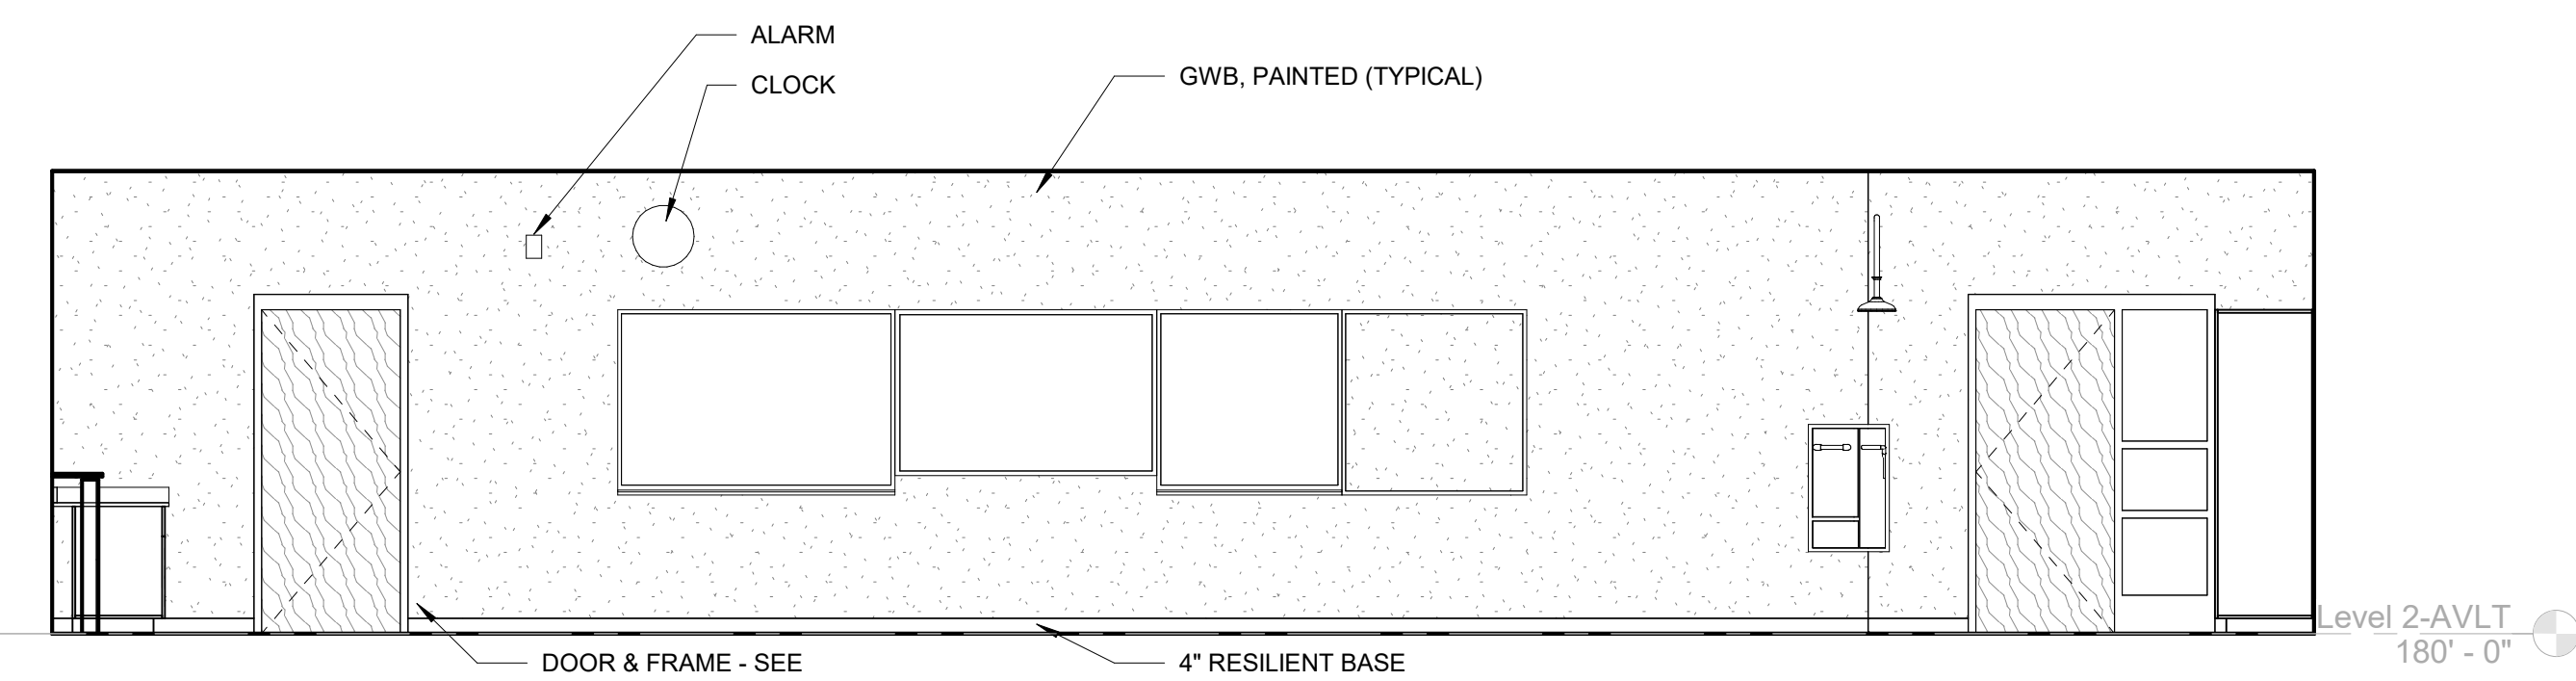


7 TYPICAL SCIENCE LAB ELEVATION
1/4" = 1'-0"

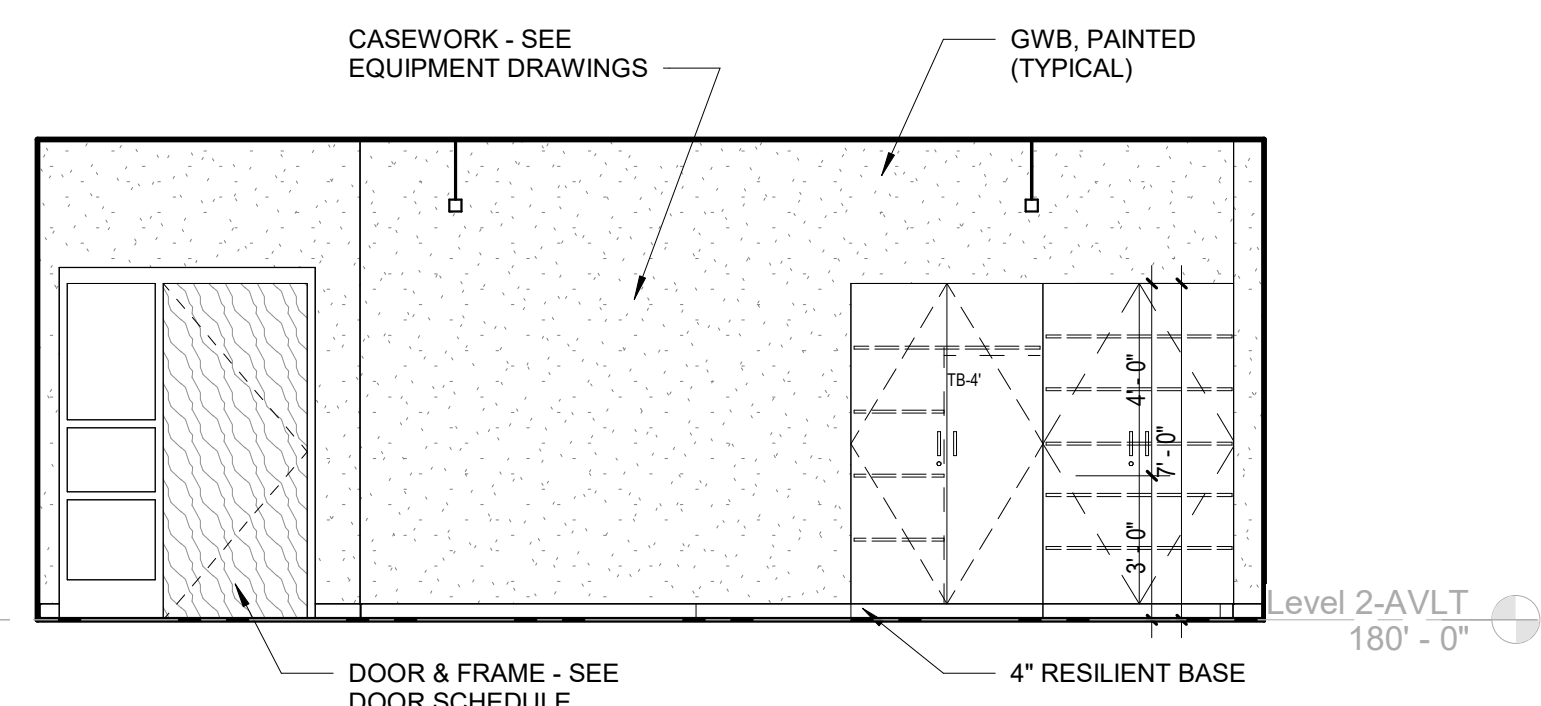


1 TYPICAL CLASSROOM ELEVATION
1/4" = 1'-0"

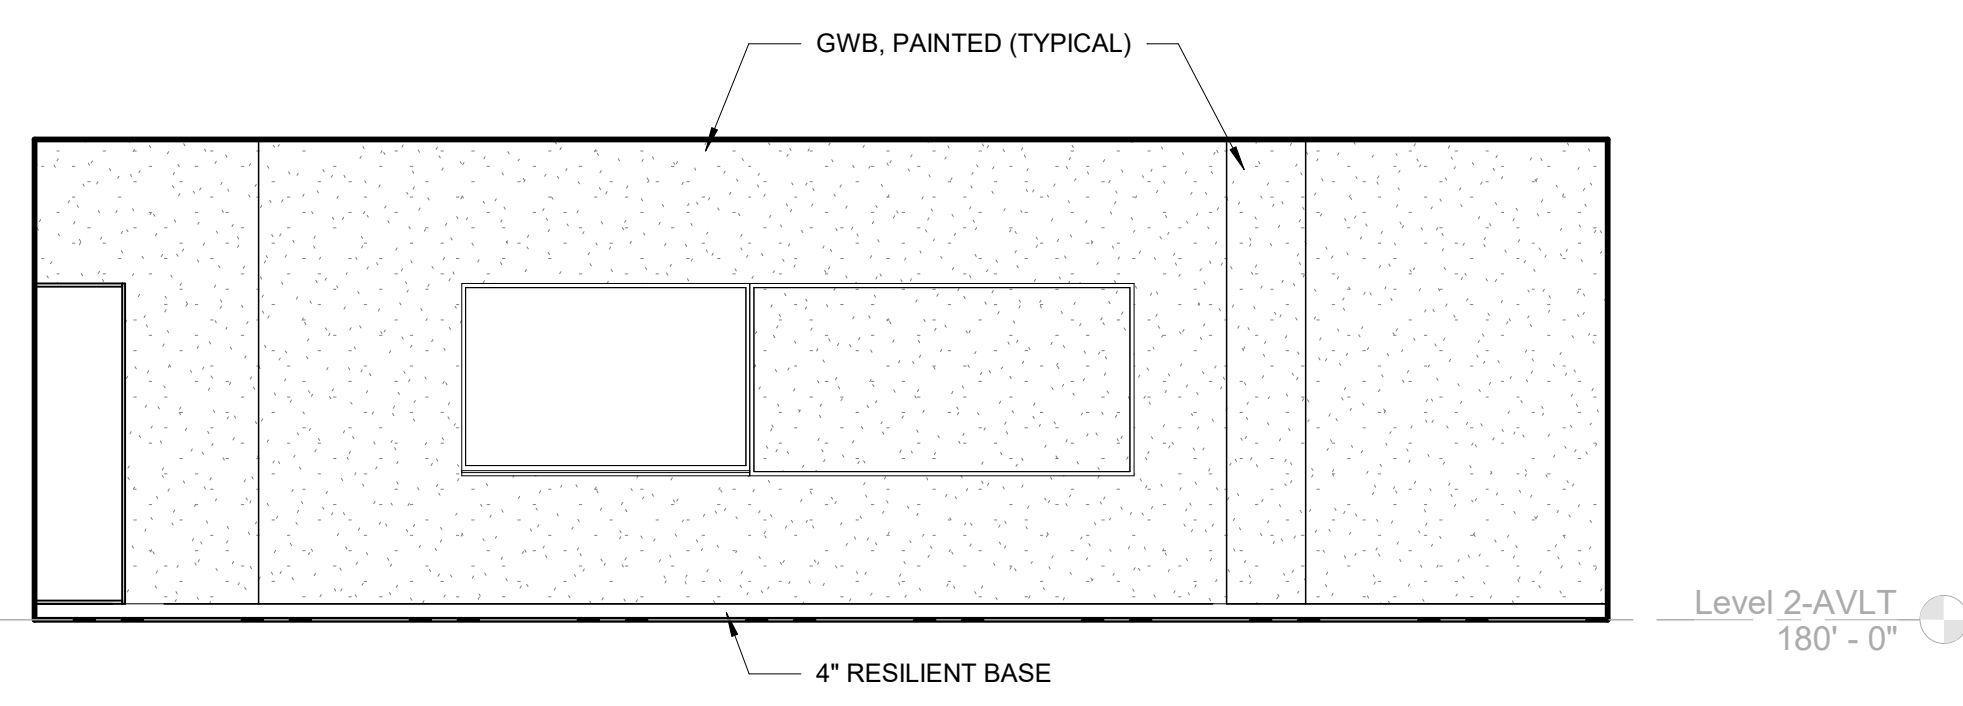

2 TYPICAL CLASSROOM ELEVATION
1/4" = 1'-0"

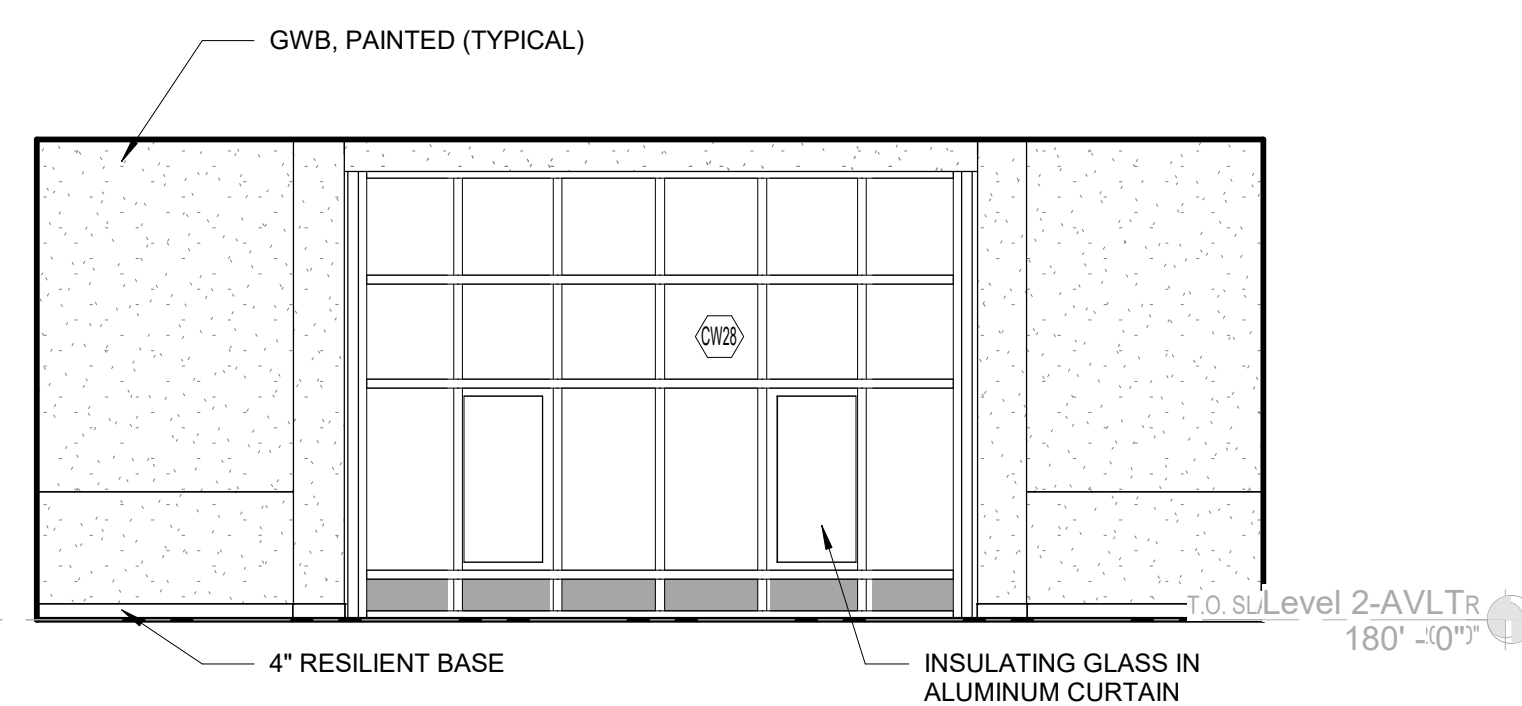


3 TYPICAL CLASSROOM ELEVATION
1/4" = 1'-0"

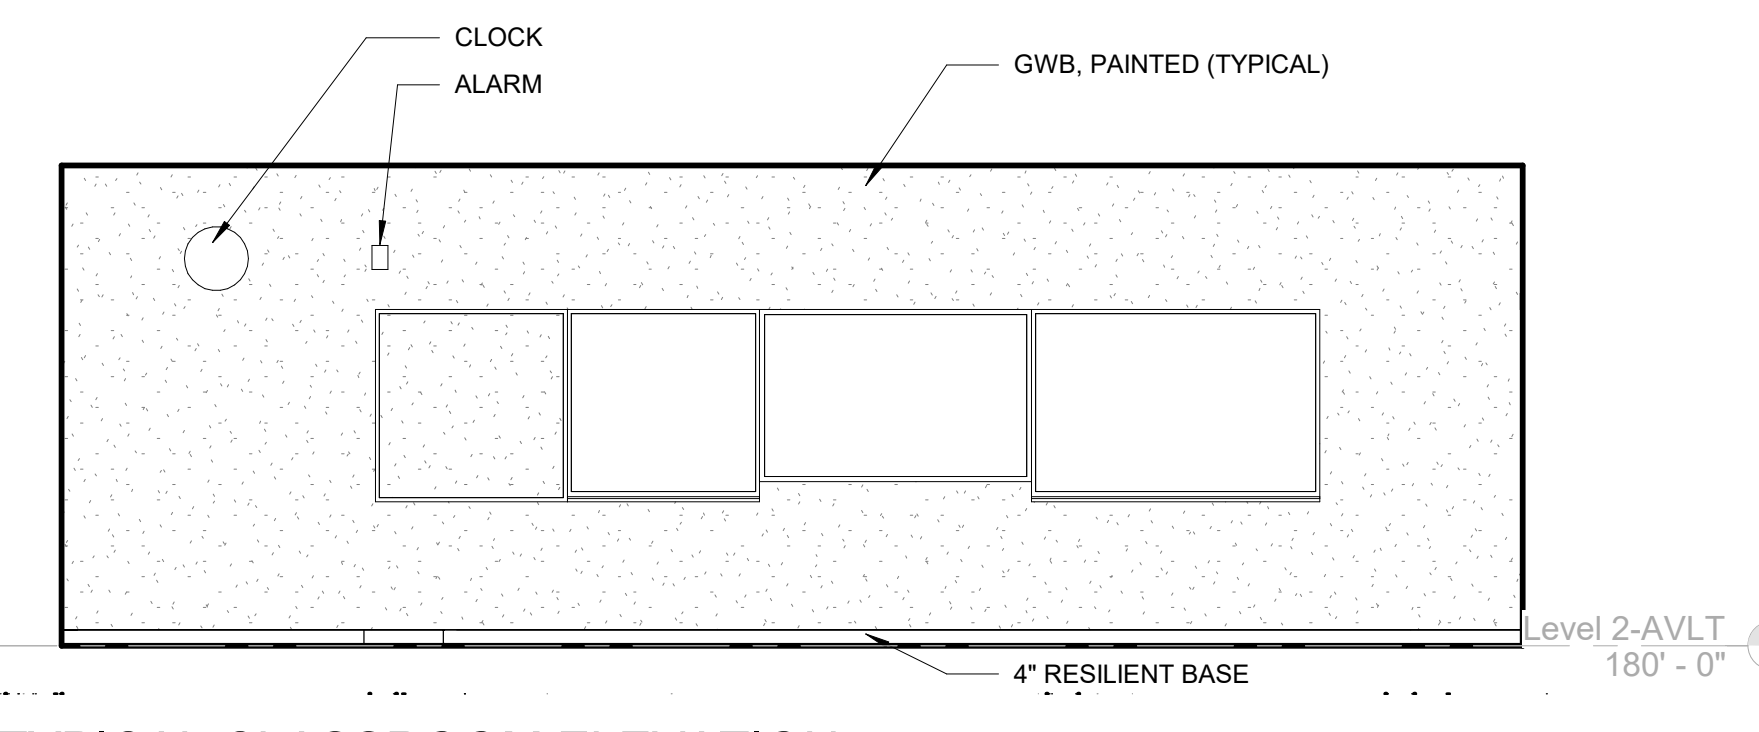

4 TYPICAL CLASSROOM ELEVATION
1/4" = 1'-0"


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

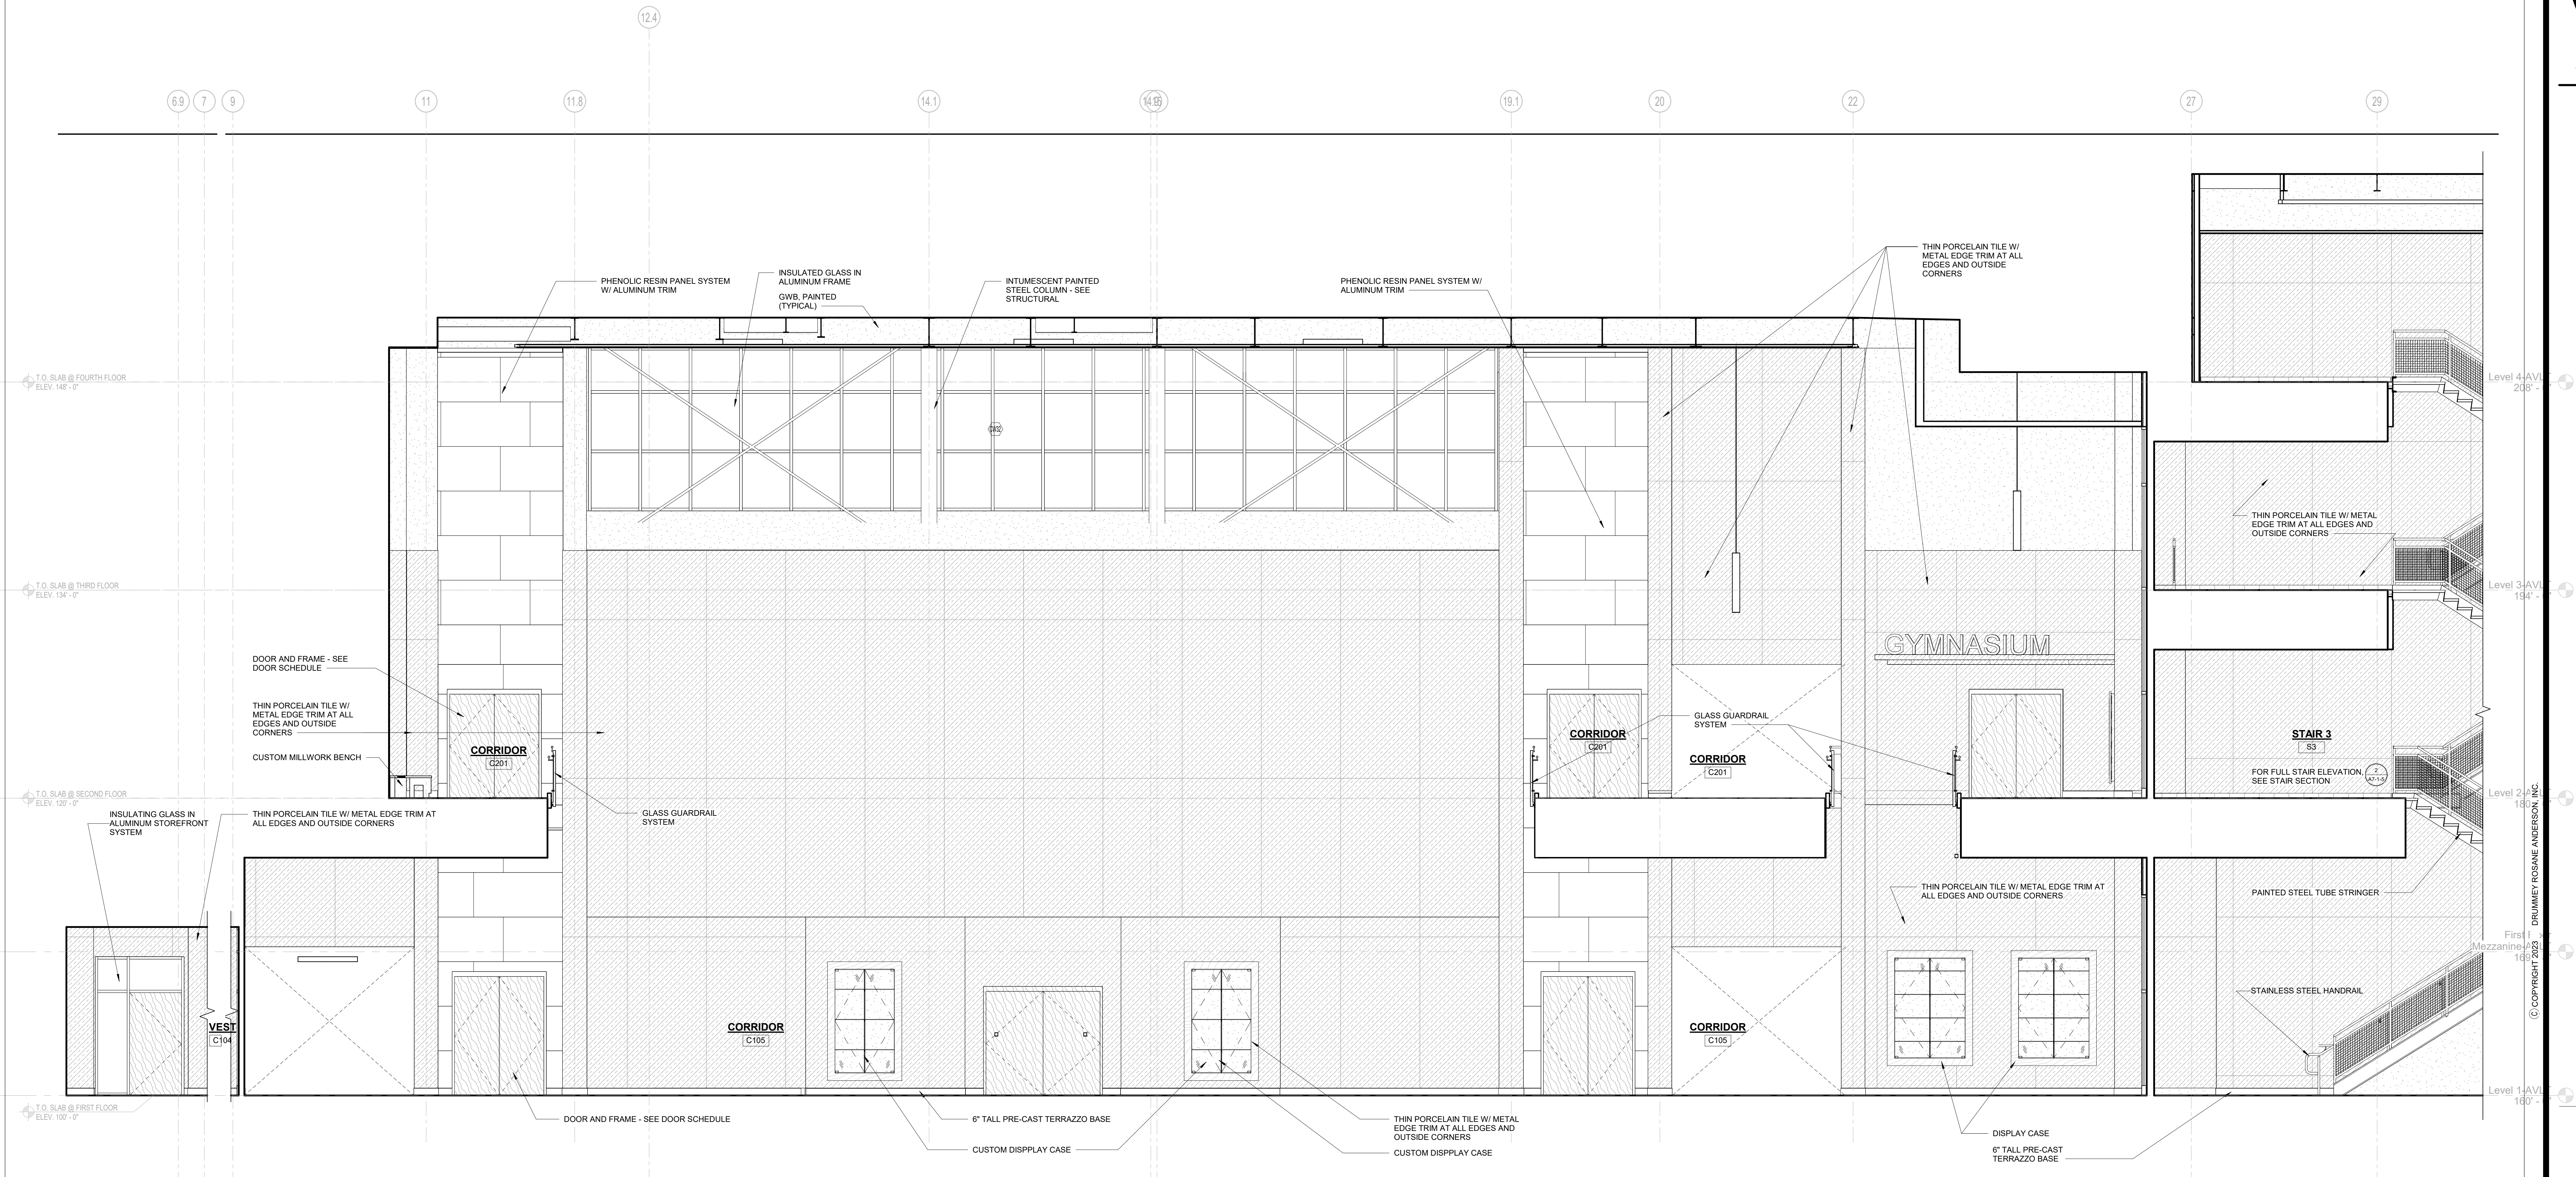


2 GYM/AUDITORIUM LOBBY ELEVATION
1/4" = 1'-0"

MSBA 90% CD
SUBMISSION
May 12TH, 2023

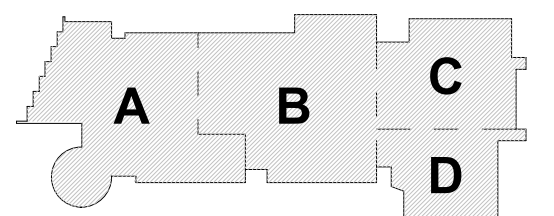


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4


A2-2-2

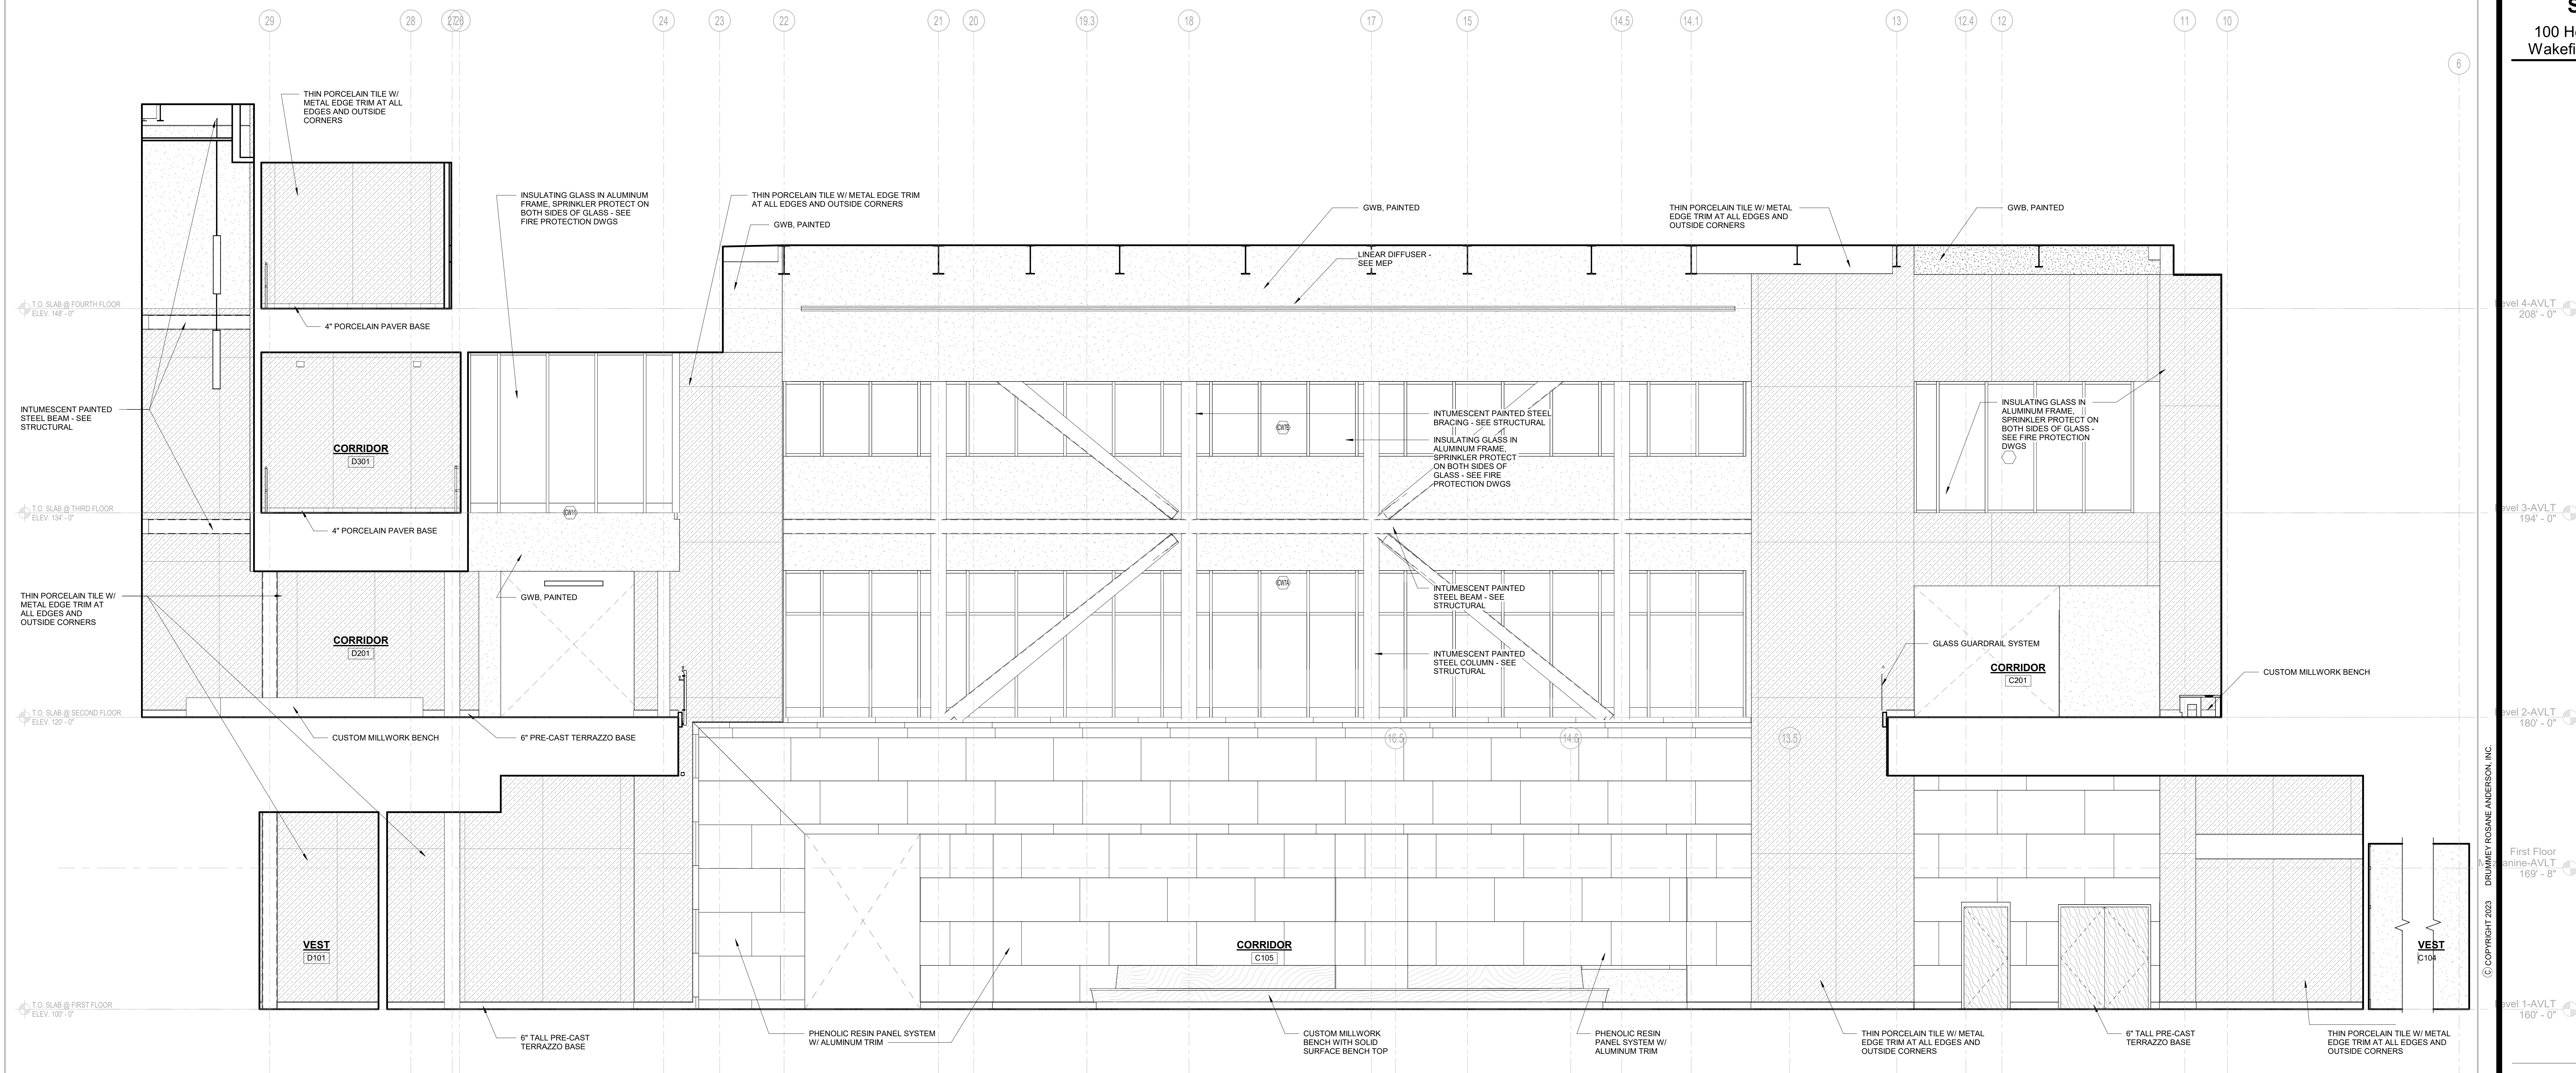

2 GYM/AUDITORIUM LOBBY ELEVATION
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

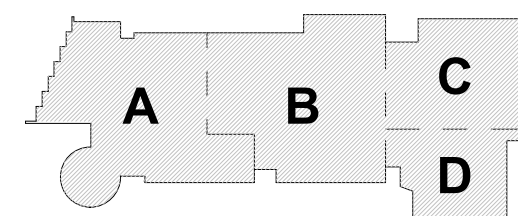


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"



Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4


A2-2-3

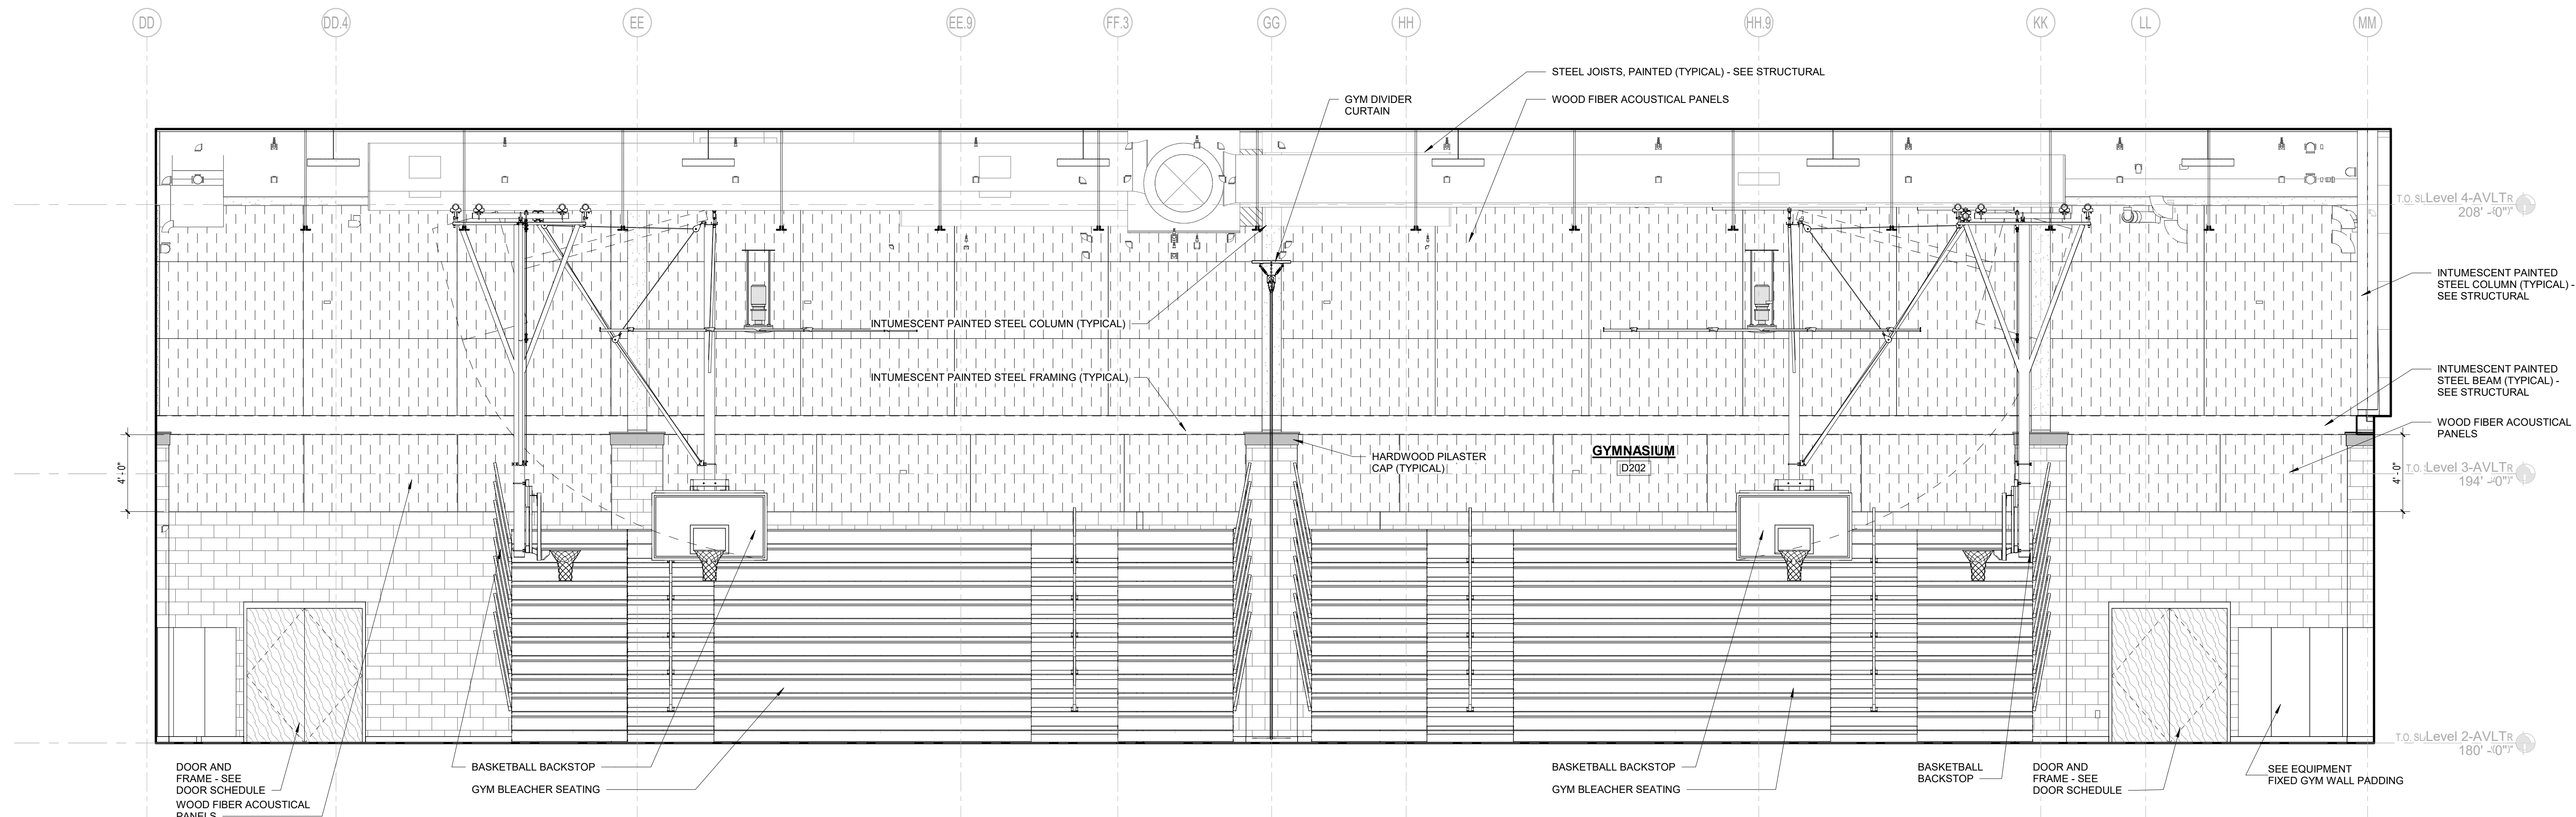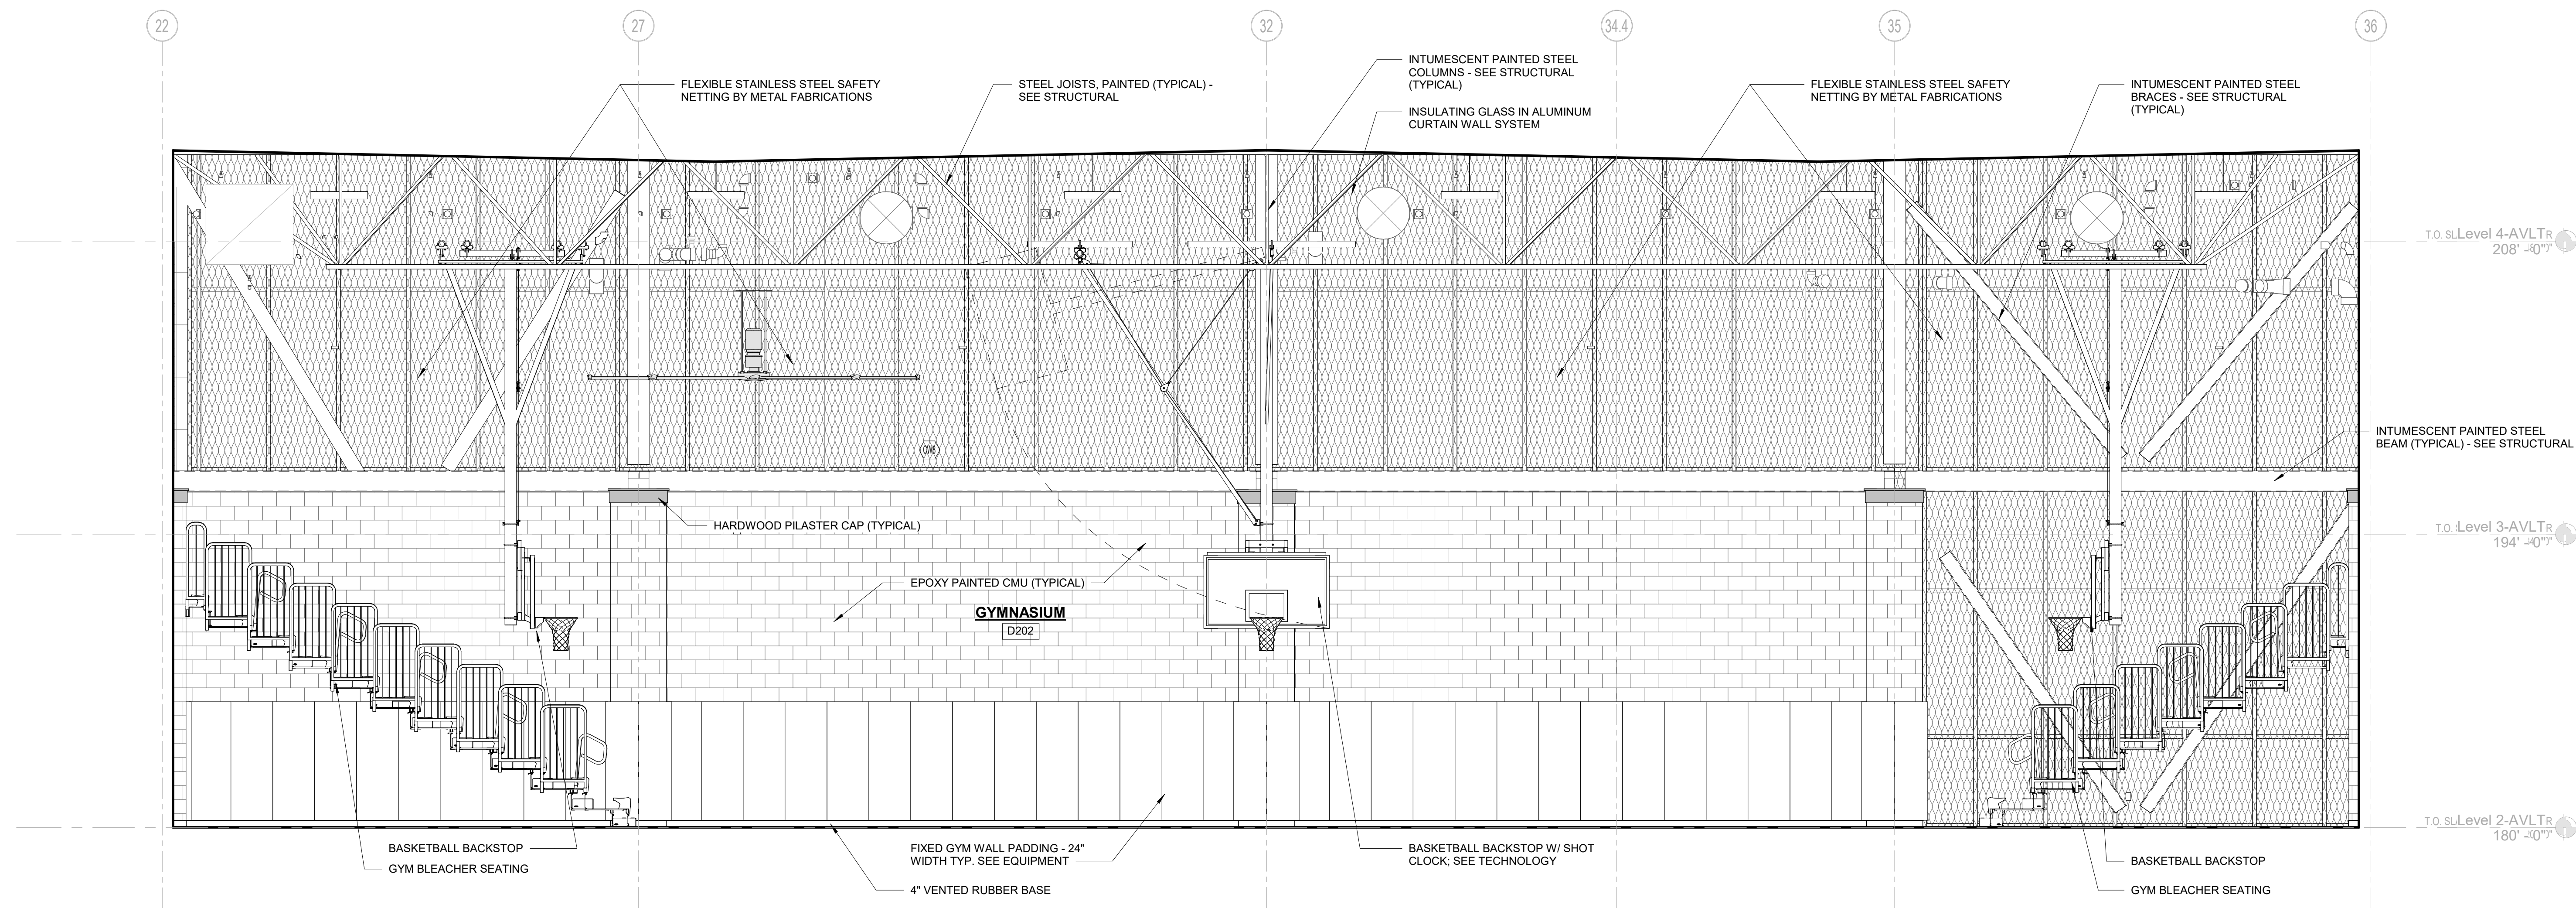**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880**1 GYMNASIUM ELEVATION - NORTH**
1/4" = 1'-0"**2 GYMNASIUM ELEVATION - EAST**
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION



May 12TH, 2023

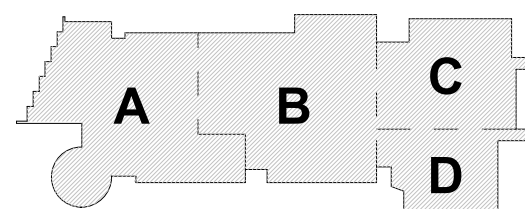

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4

A2-2-4

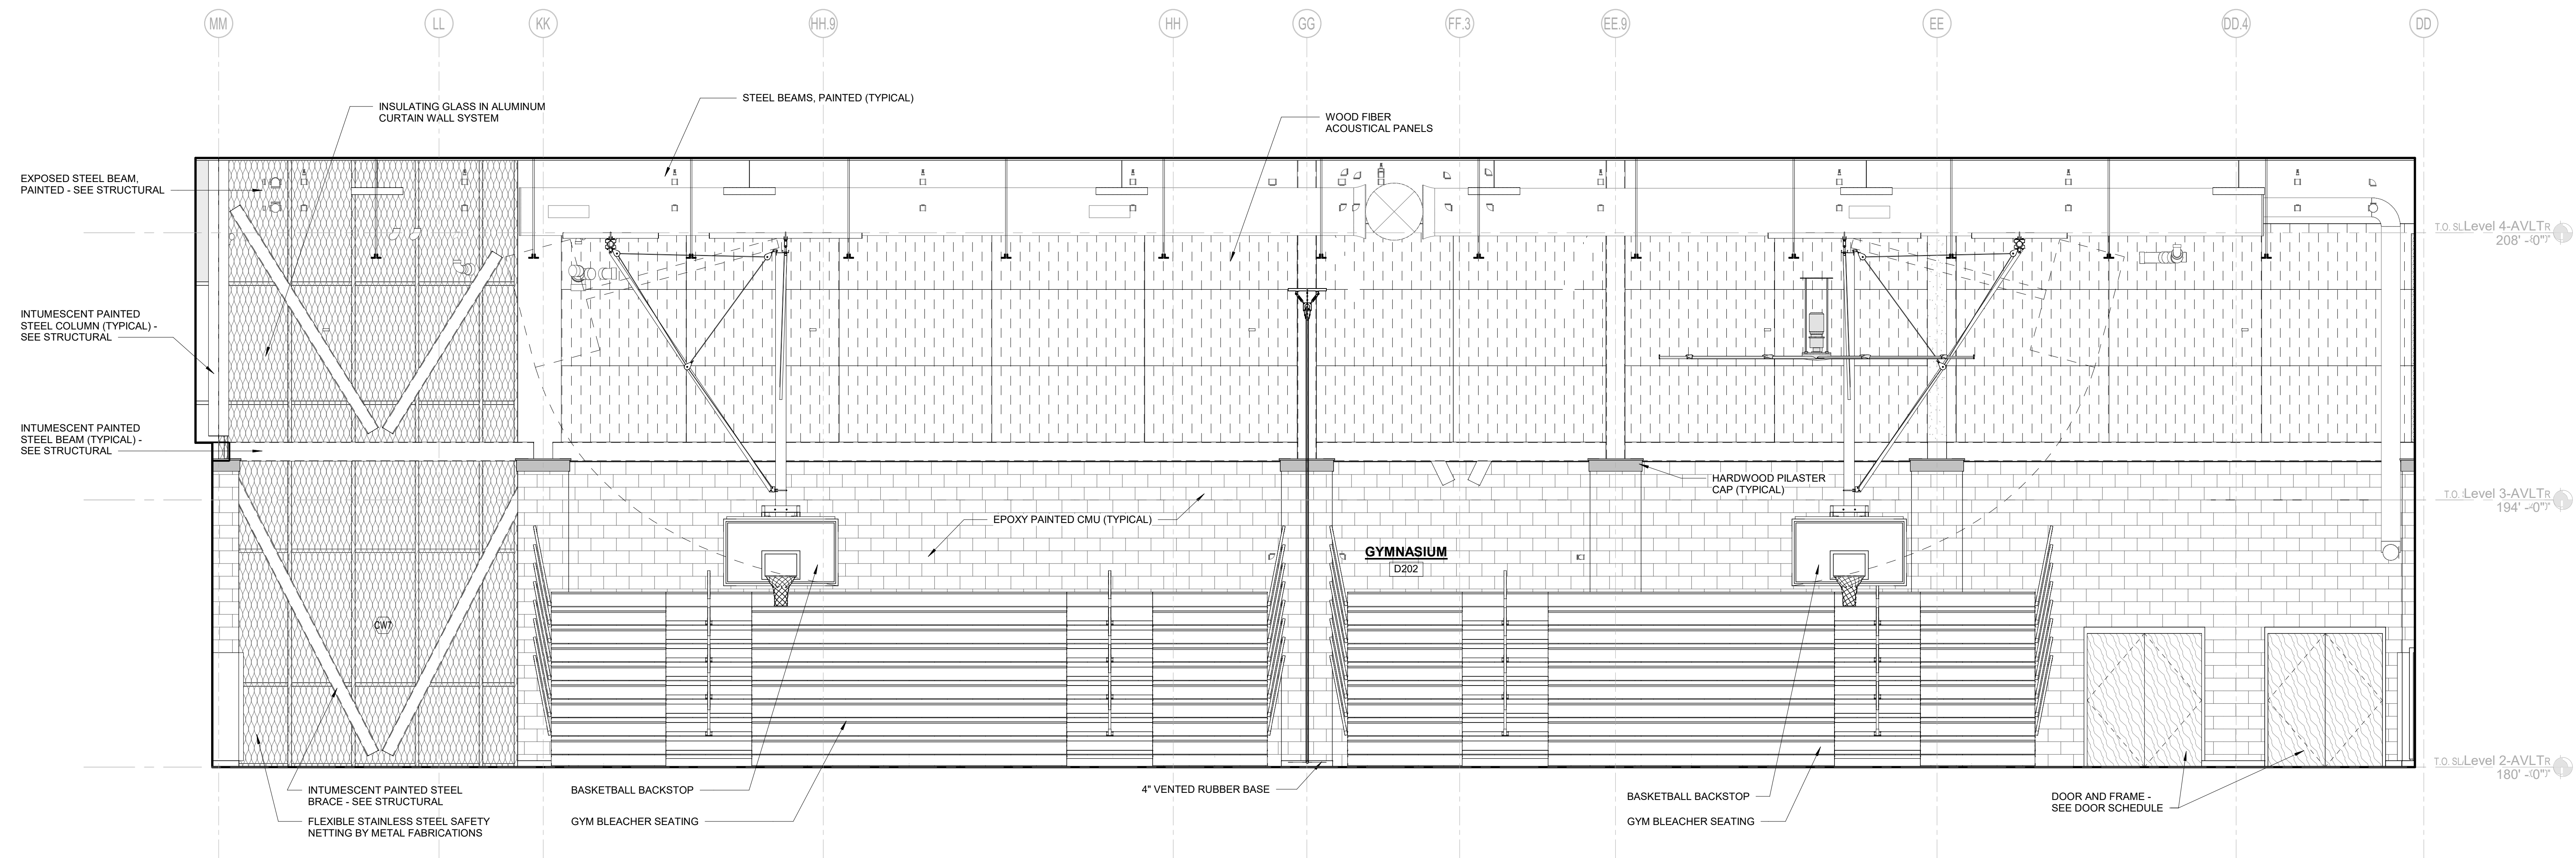


1 GYMNASIUM ELEVATION - SOUTH
1/4" = 1'-0"

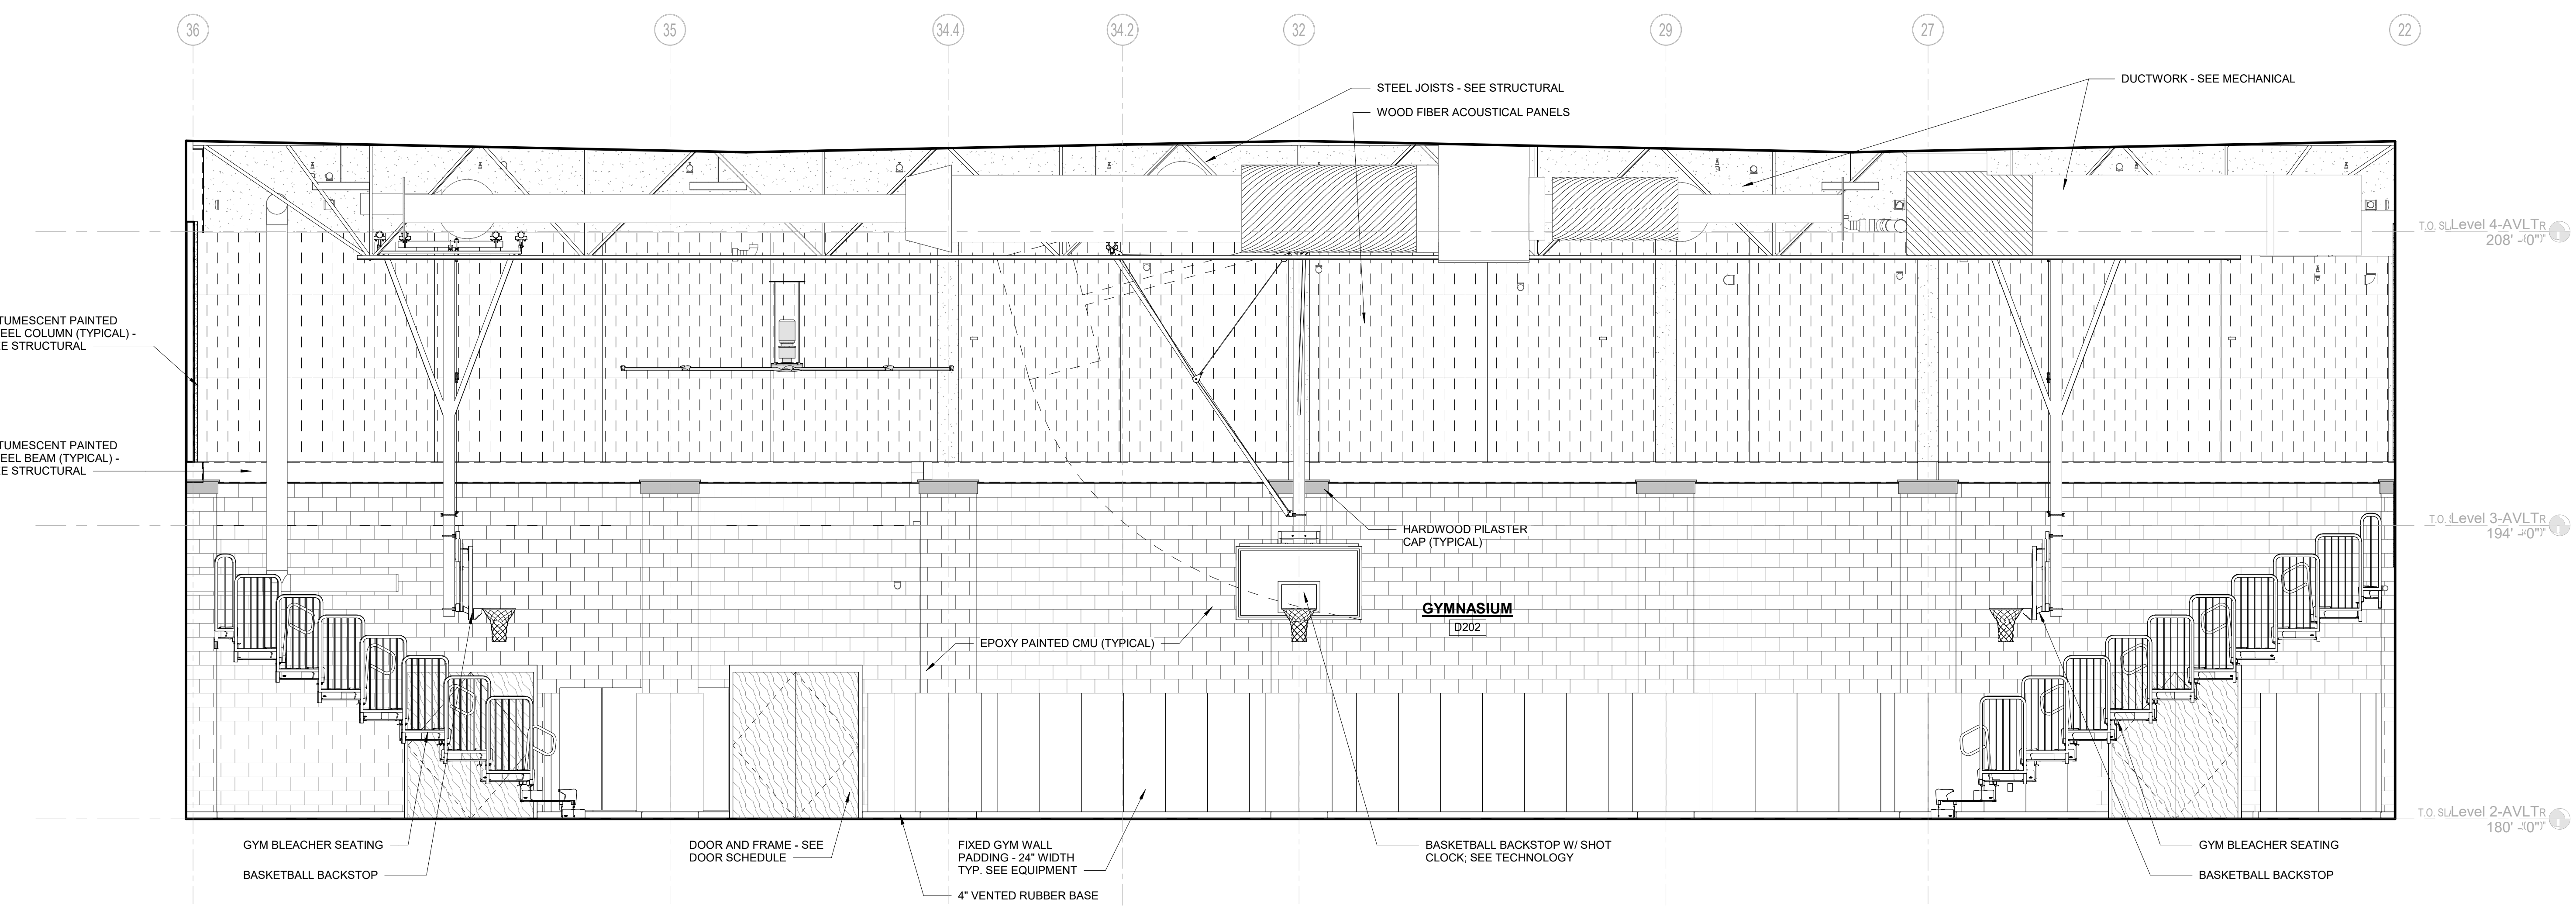


2 GYMNASIUM ELEVATION - WEST
1/4" = 1'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

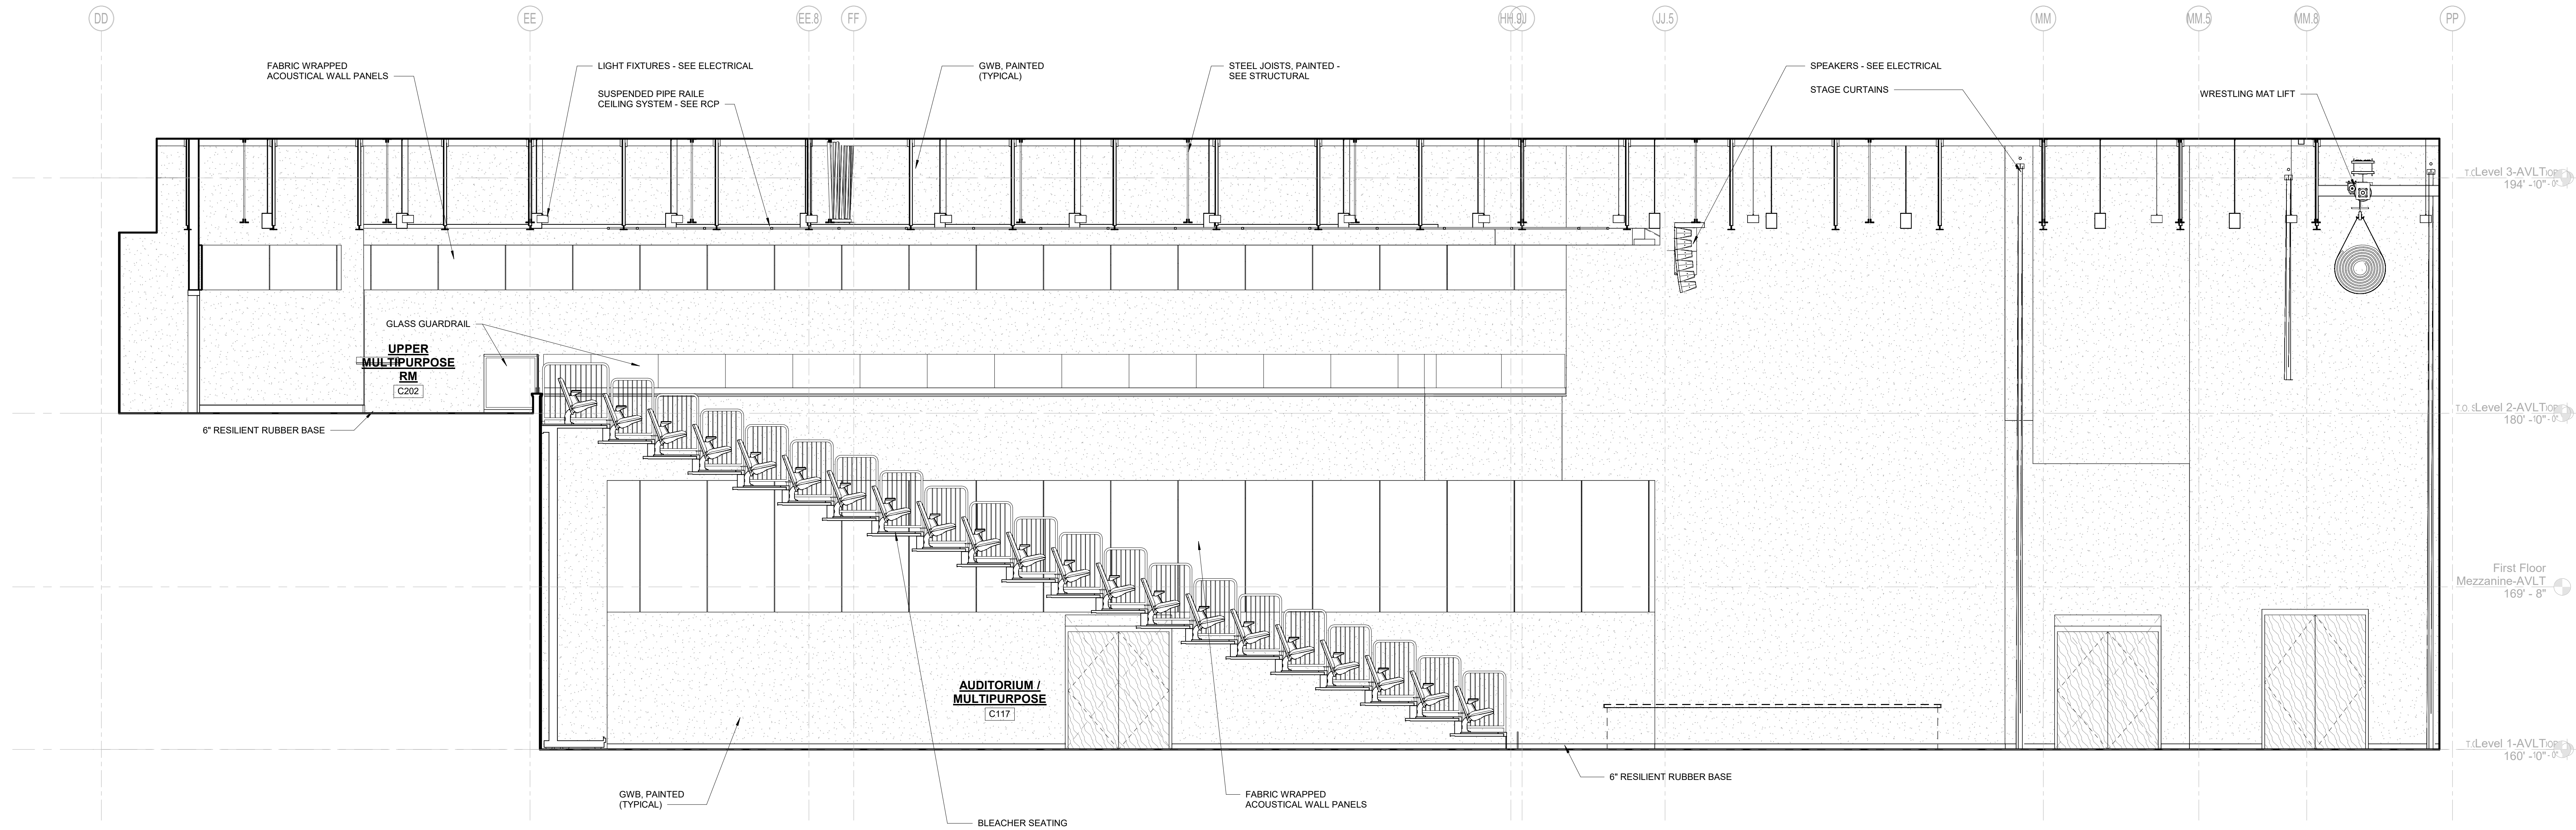

1 AUDITORIUM INTERIOR ELEVATION
1/4" = 1'-0"

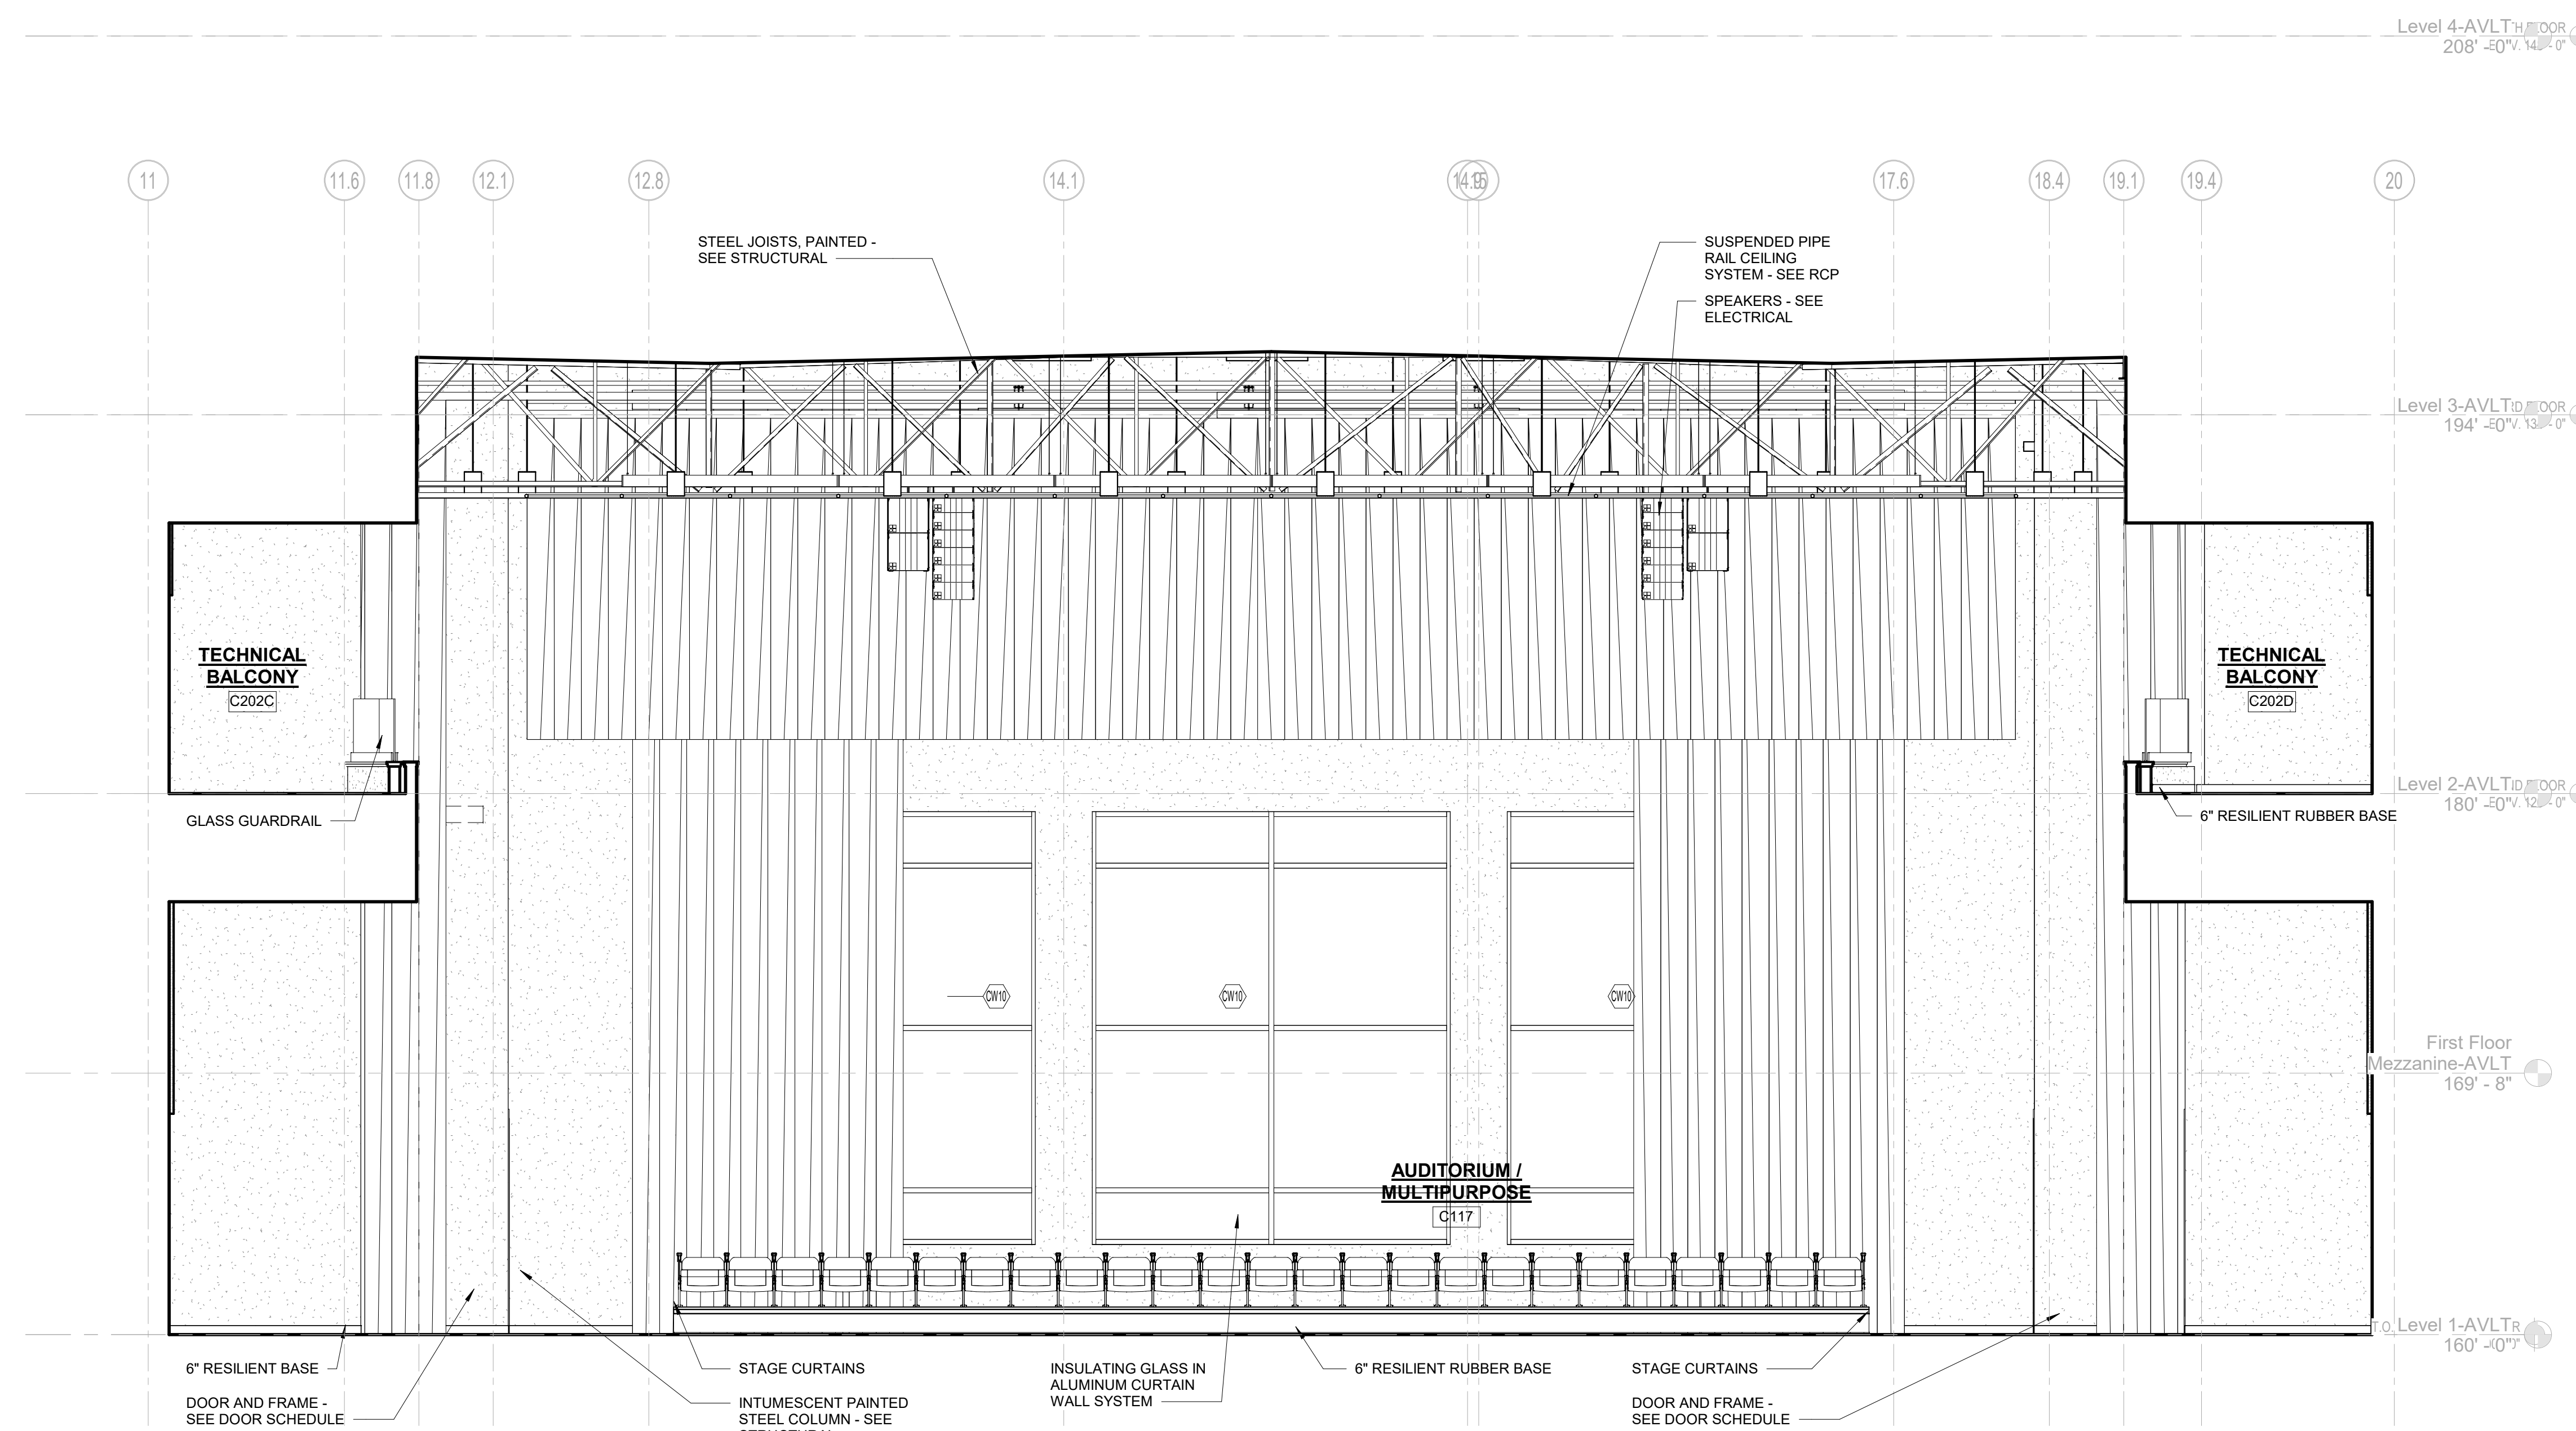


2 AUDITORIUM INTERIOR ELEVATION
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

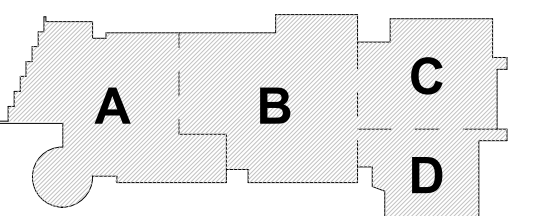


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4




A2-2-6

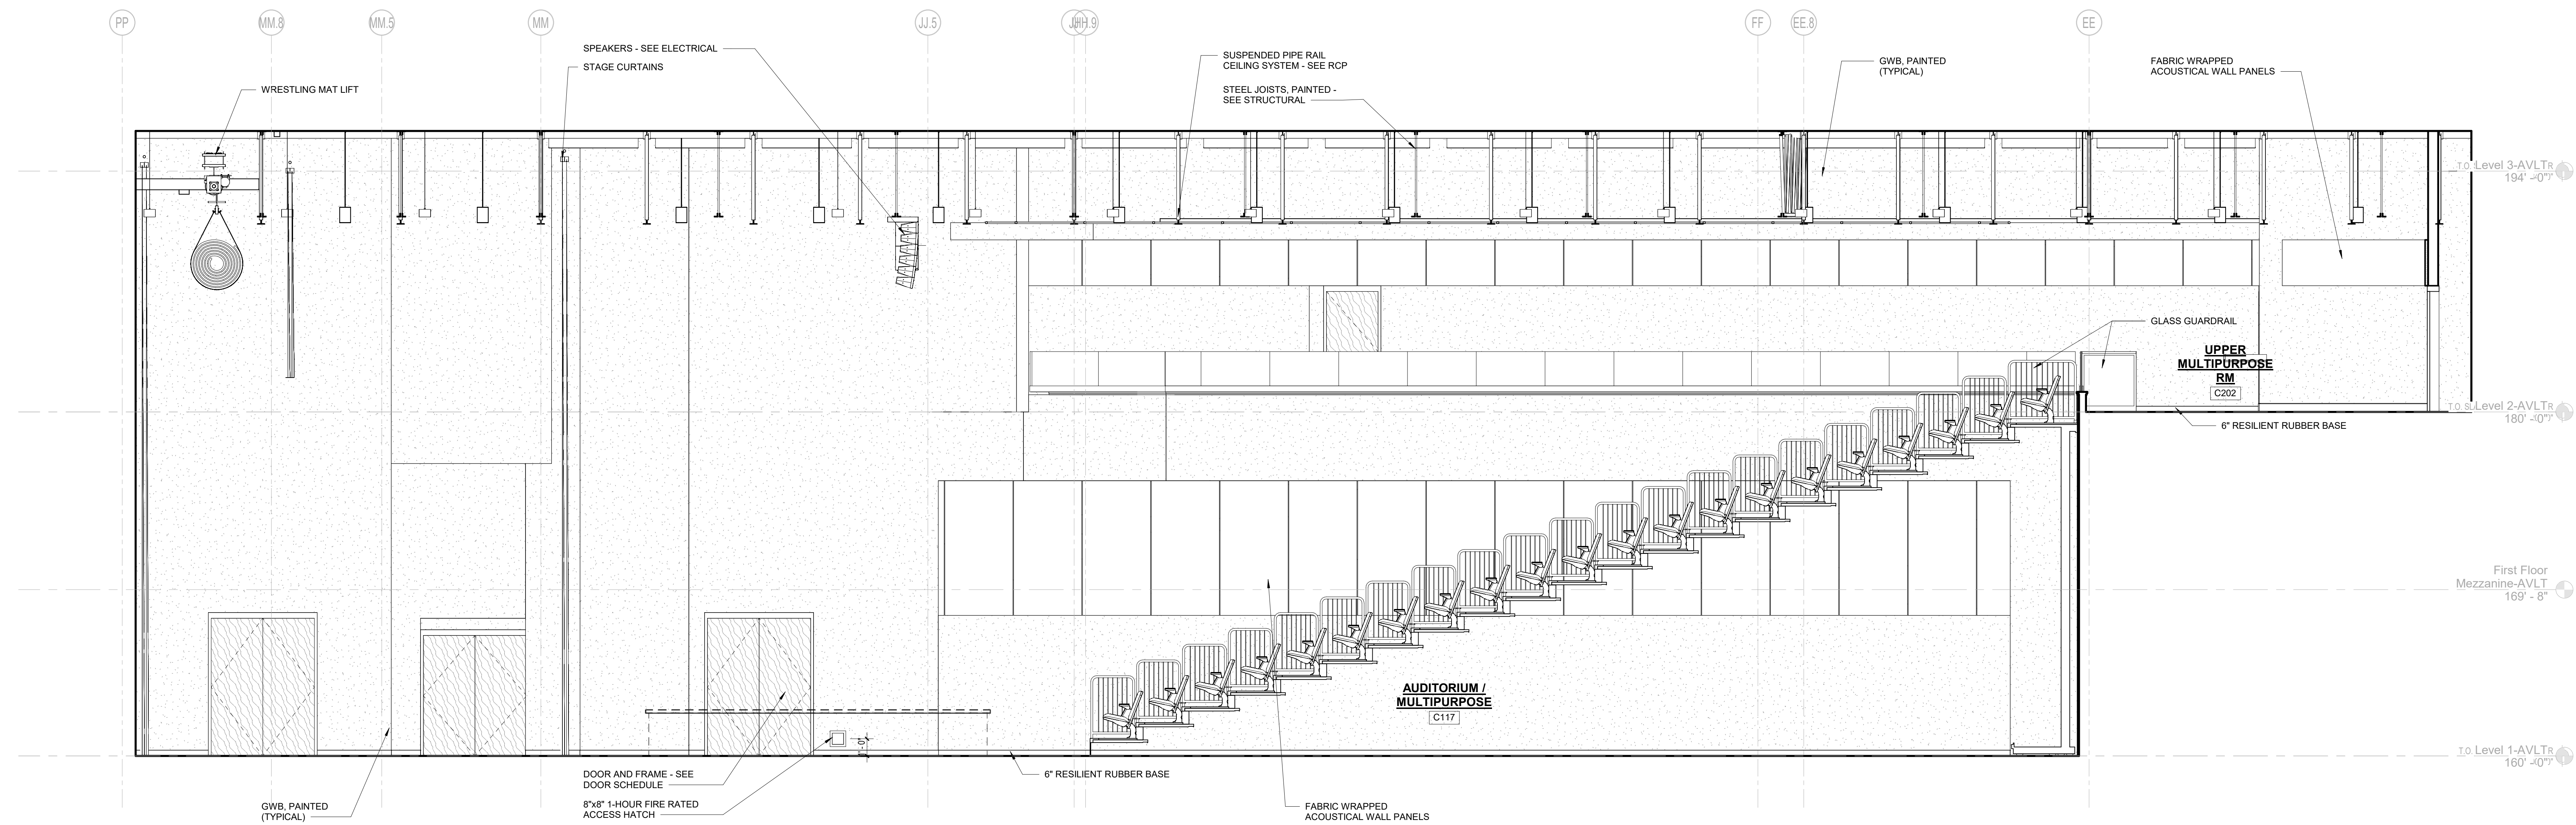


1 AUDITORIUM INTERIOR ELEVATION
1/4" = 1'-0"

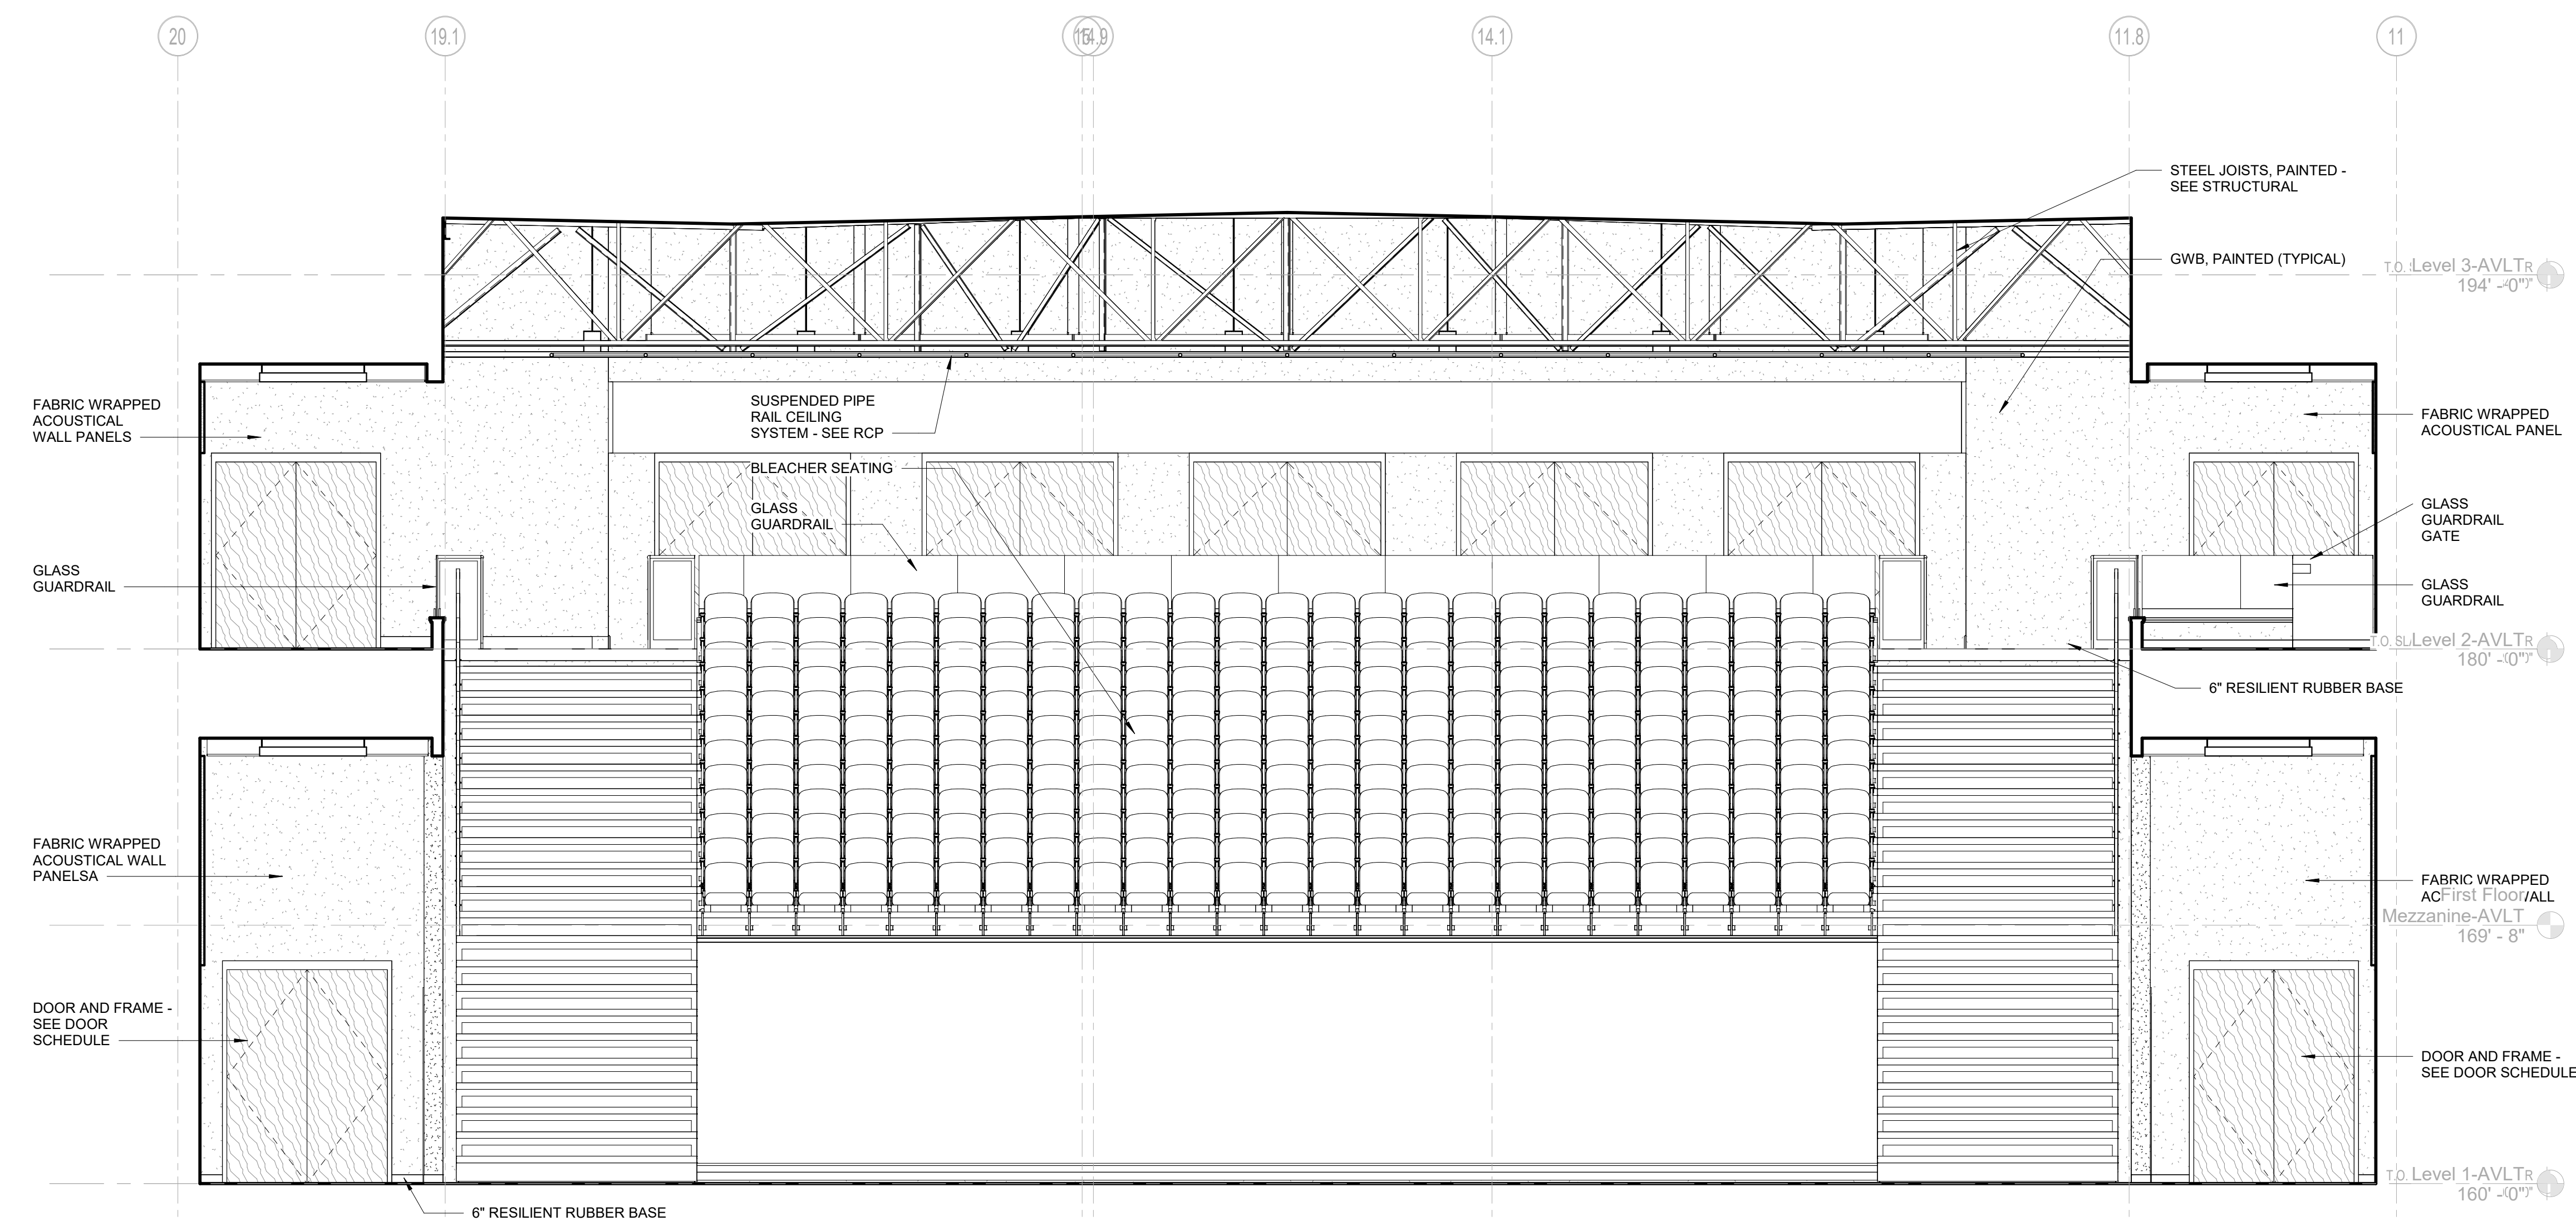


2 AUDITORIUM INTERIOR ELEVATION
1/4" = 1'-0"




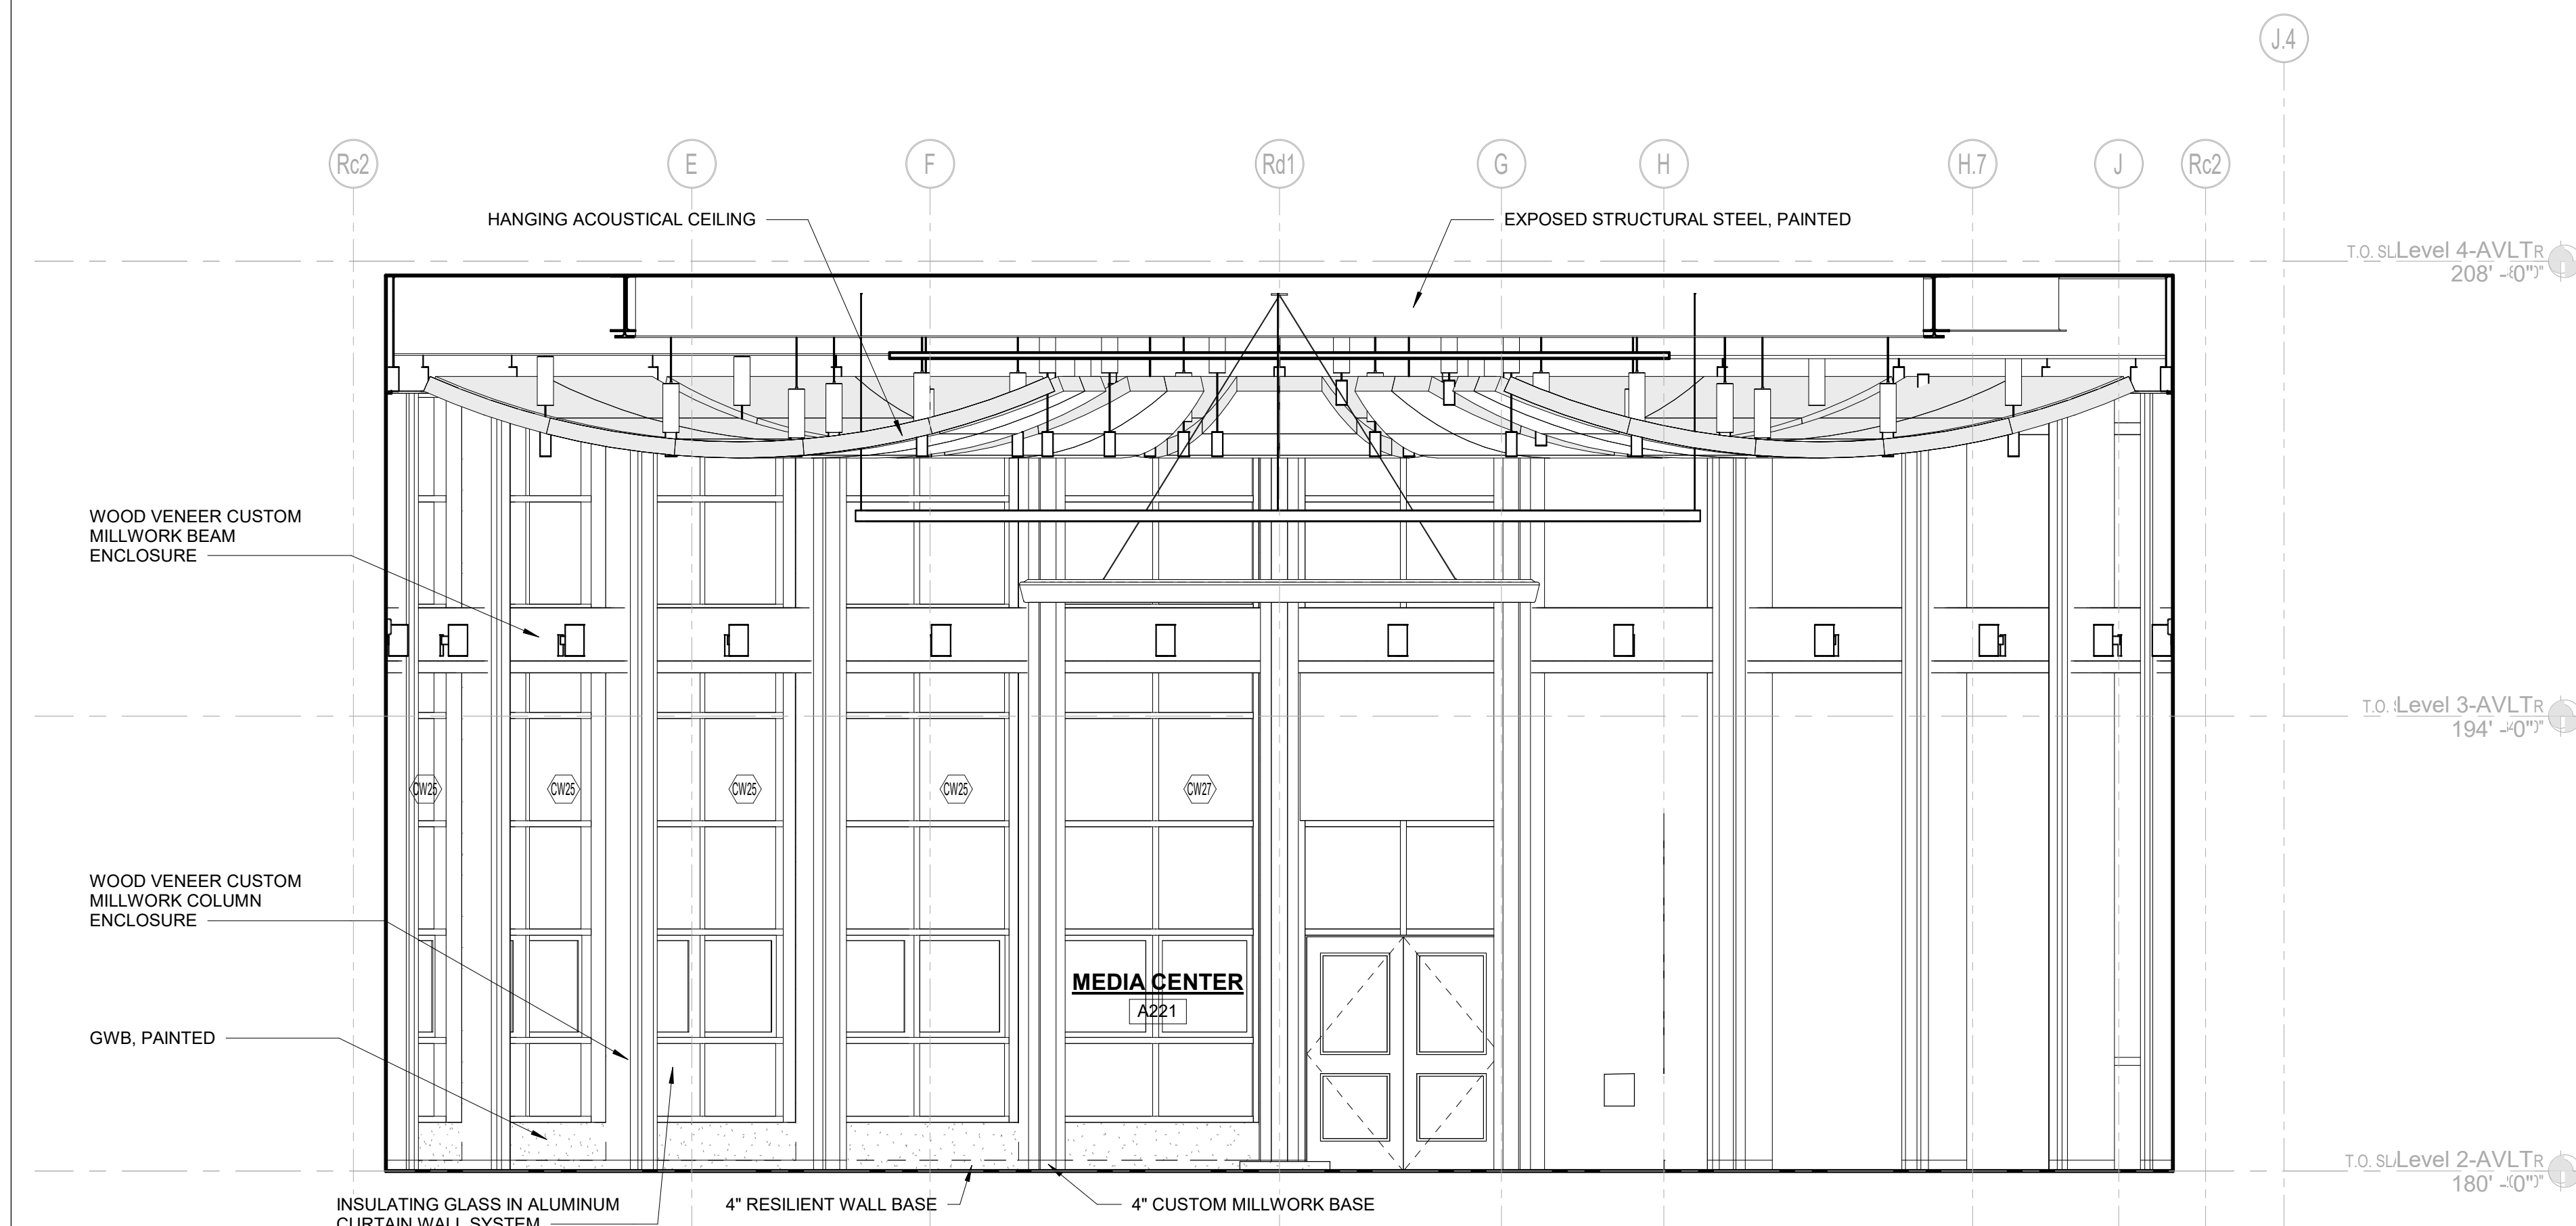


1 MEDIA CENTER ELEVATION
1/4" = 1'-0"

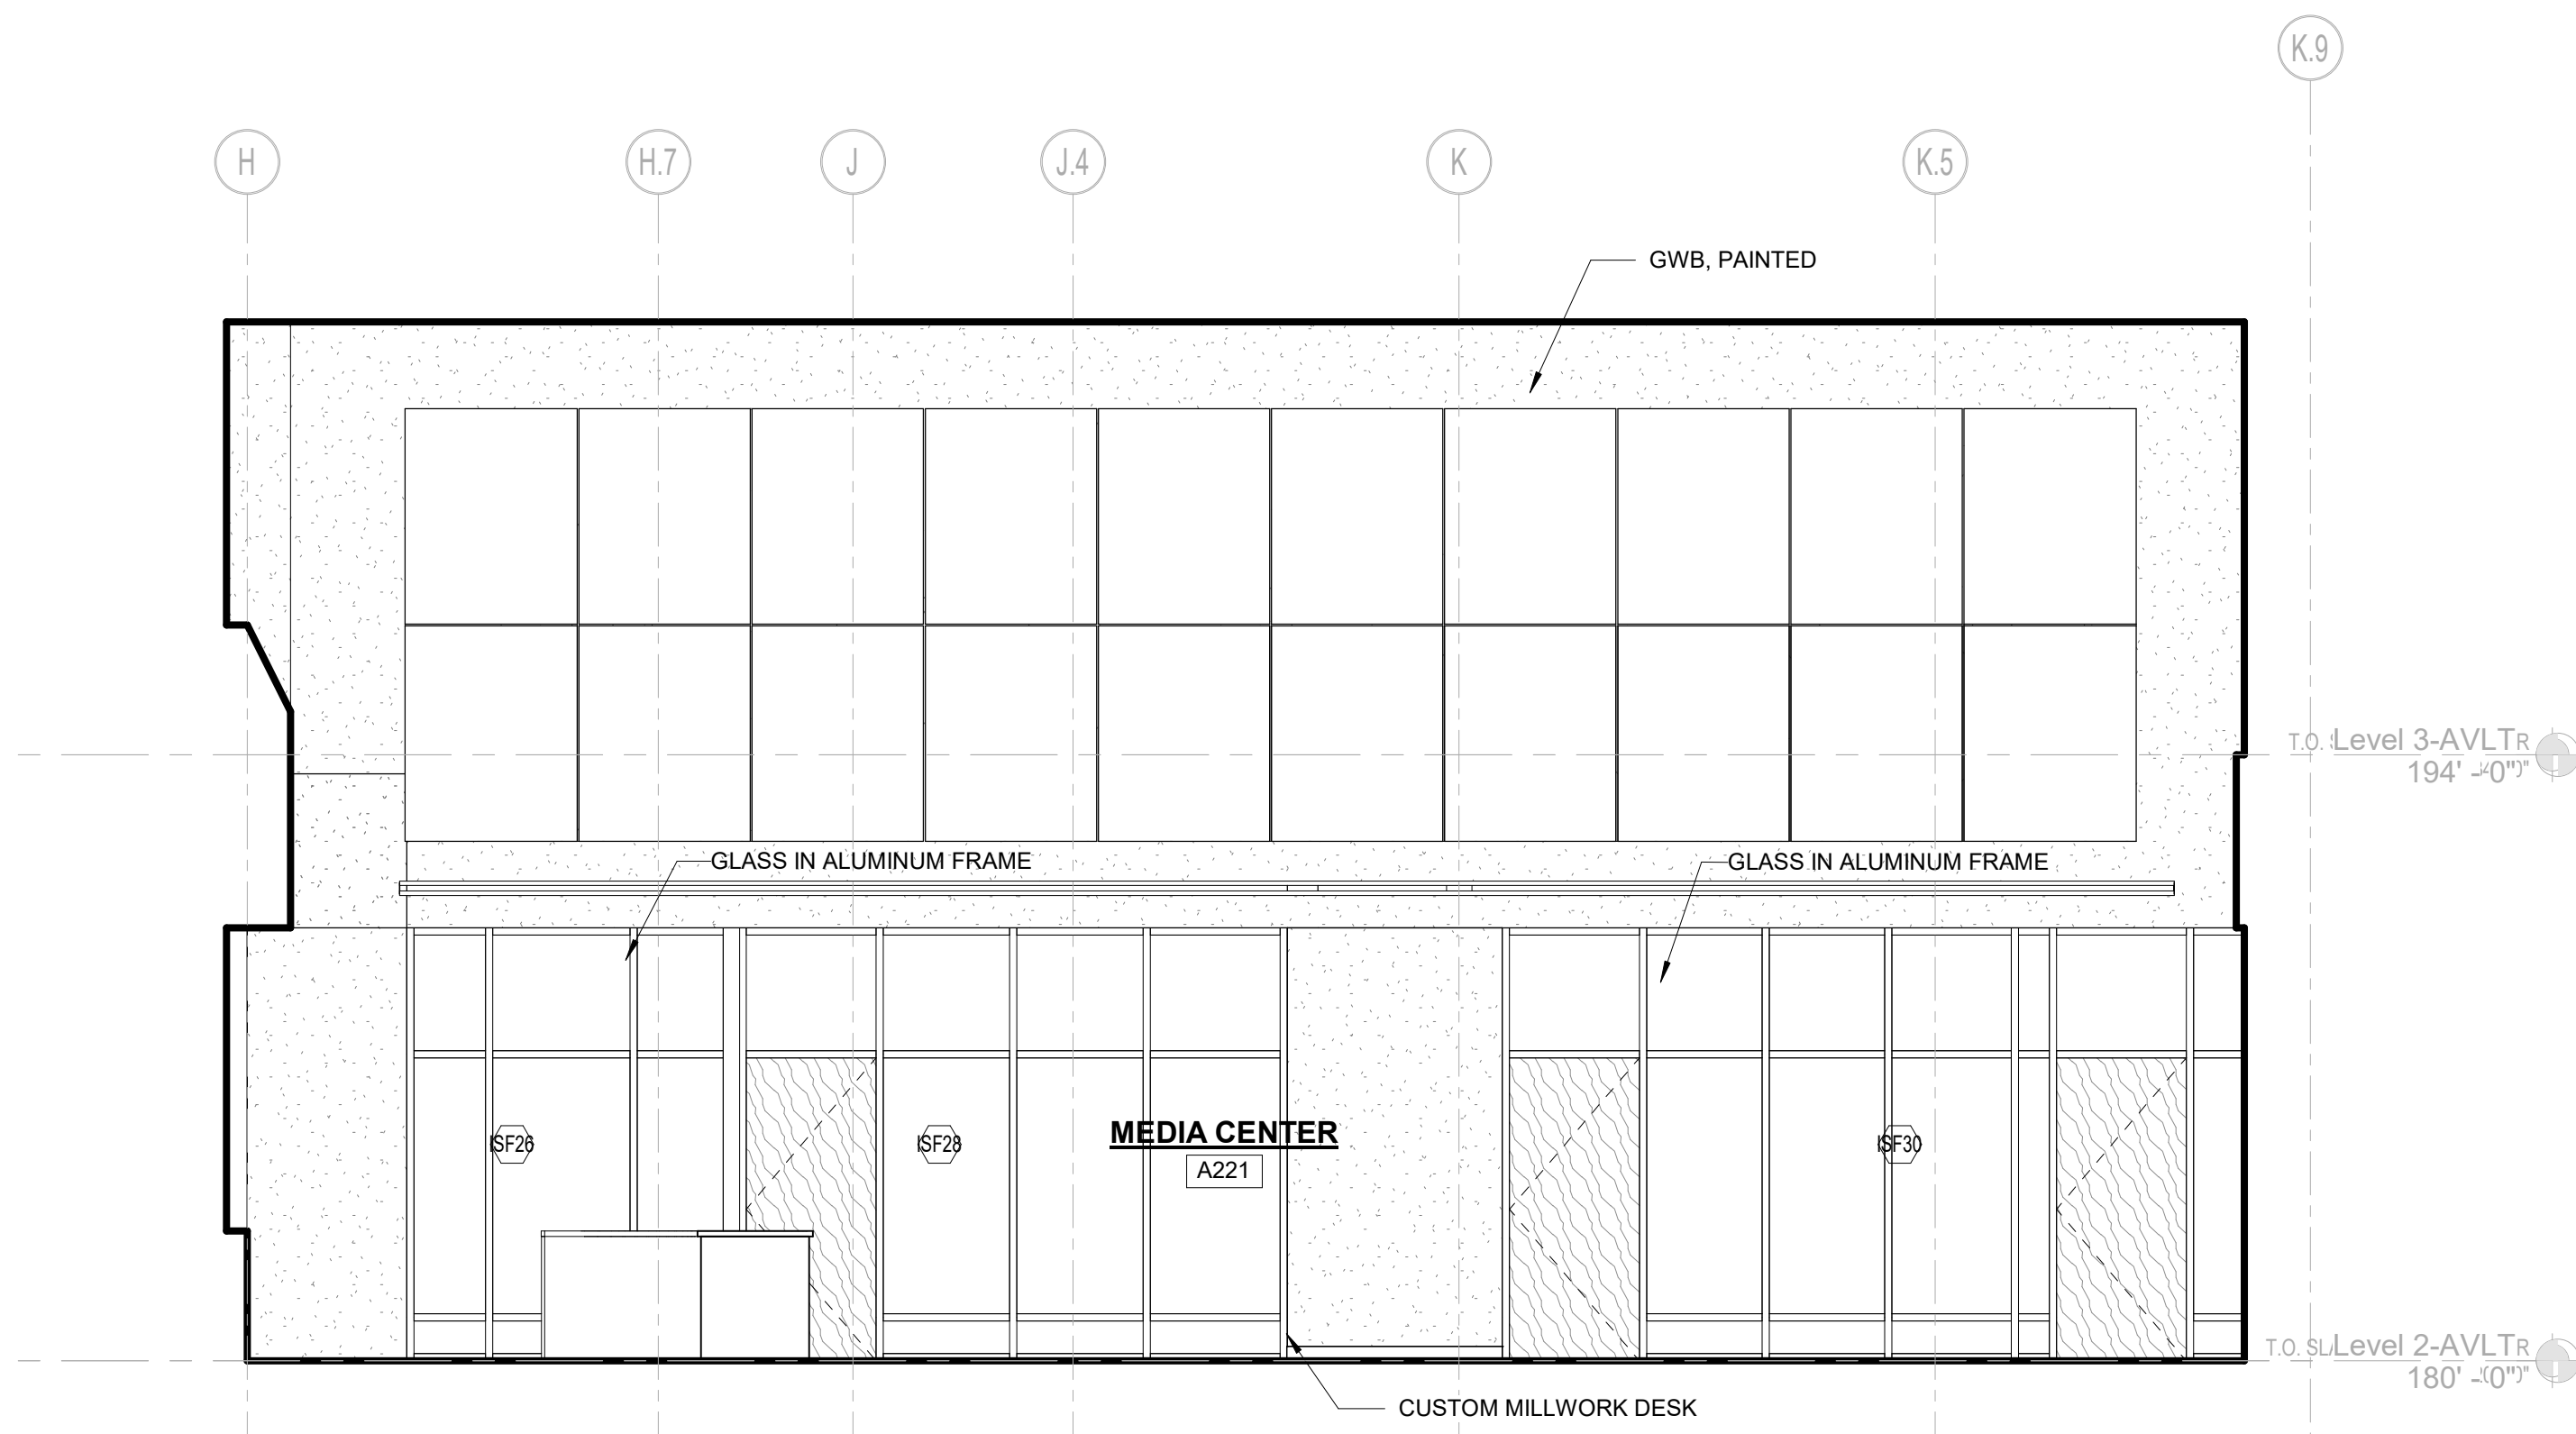


3 Media Center Elevation North
1/4" = 1'-0"

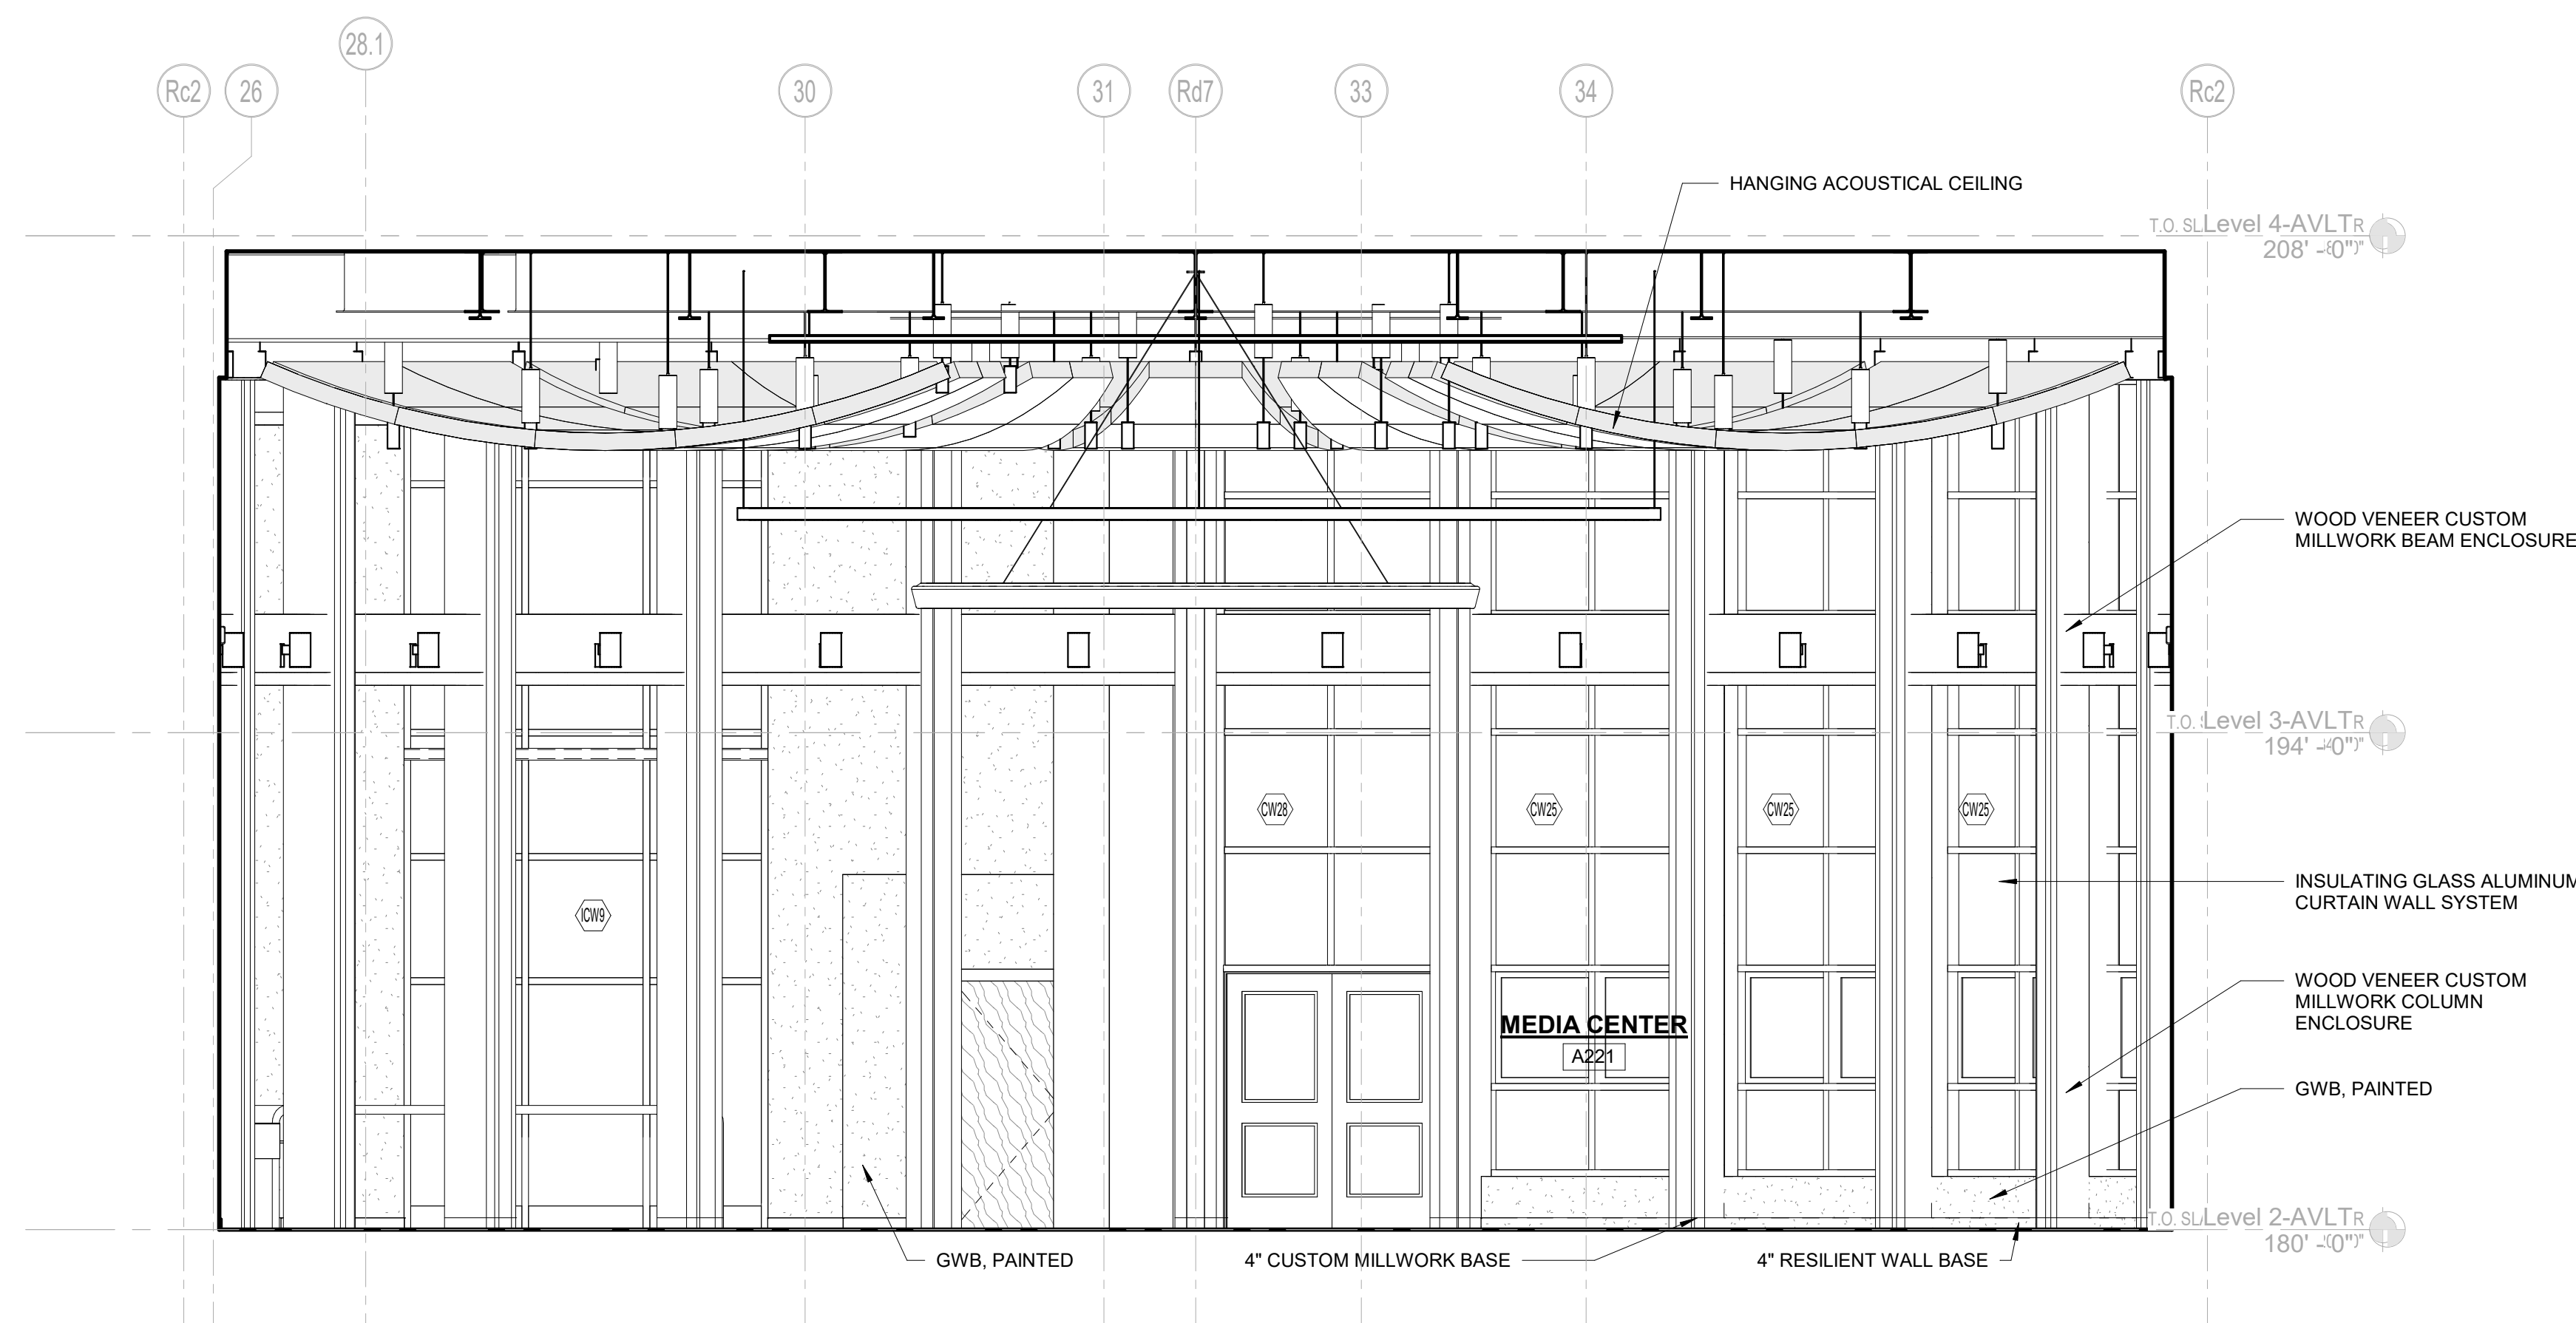


2 MEDIA CENTER ELEVATION
1/4" = 1'-0"

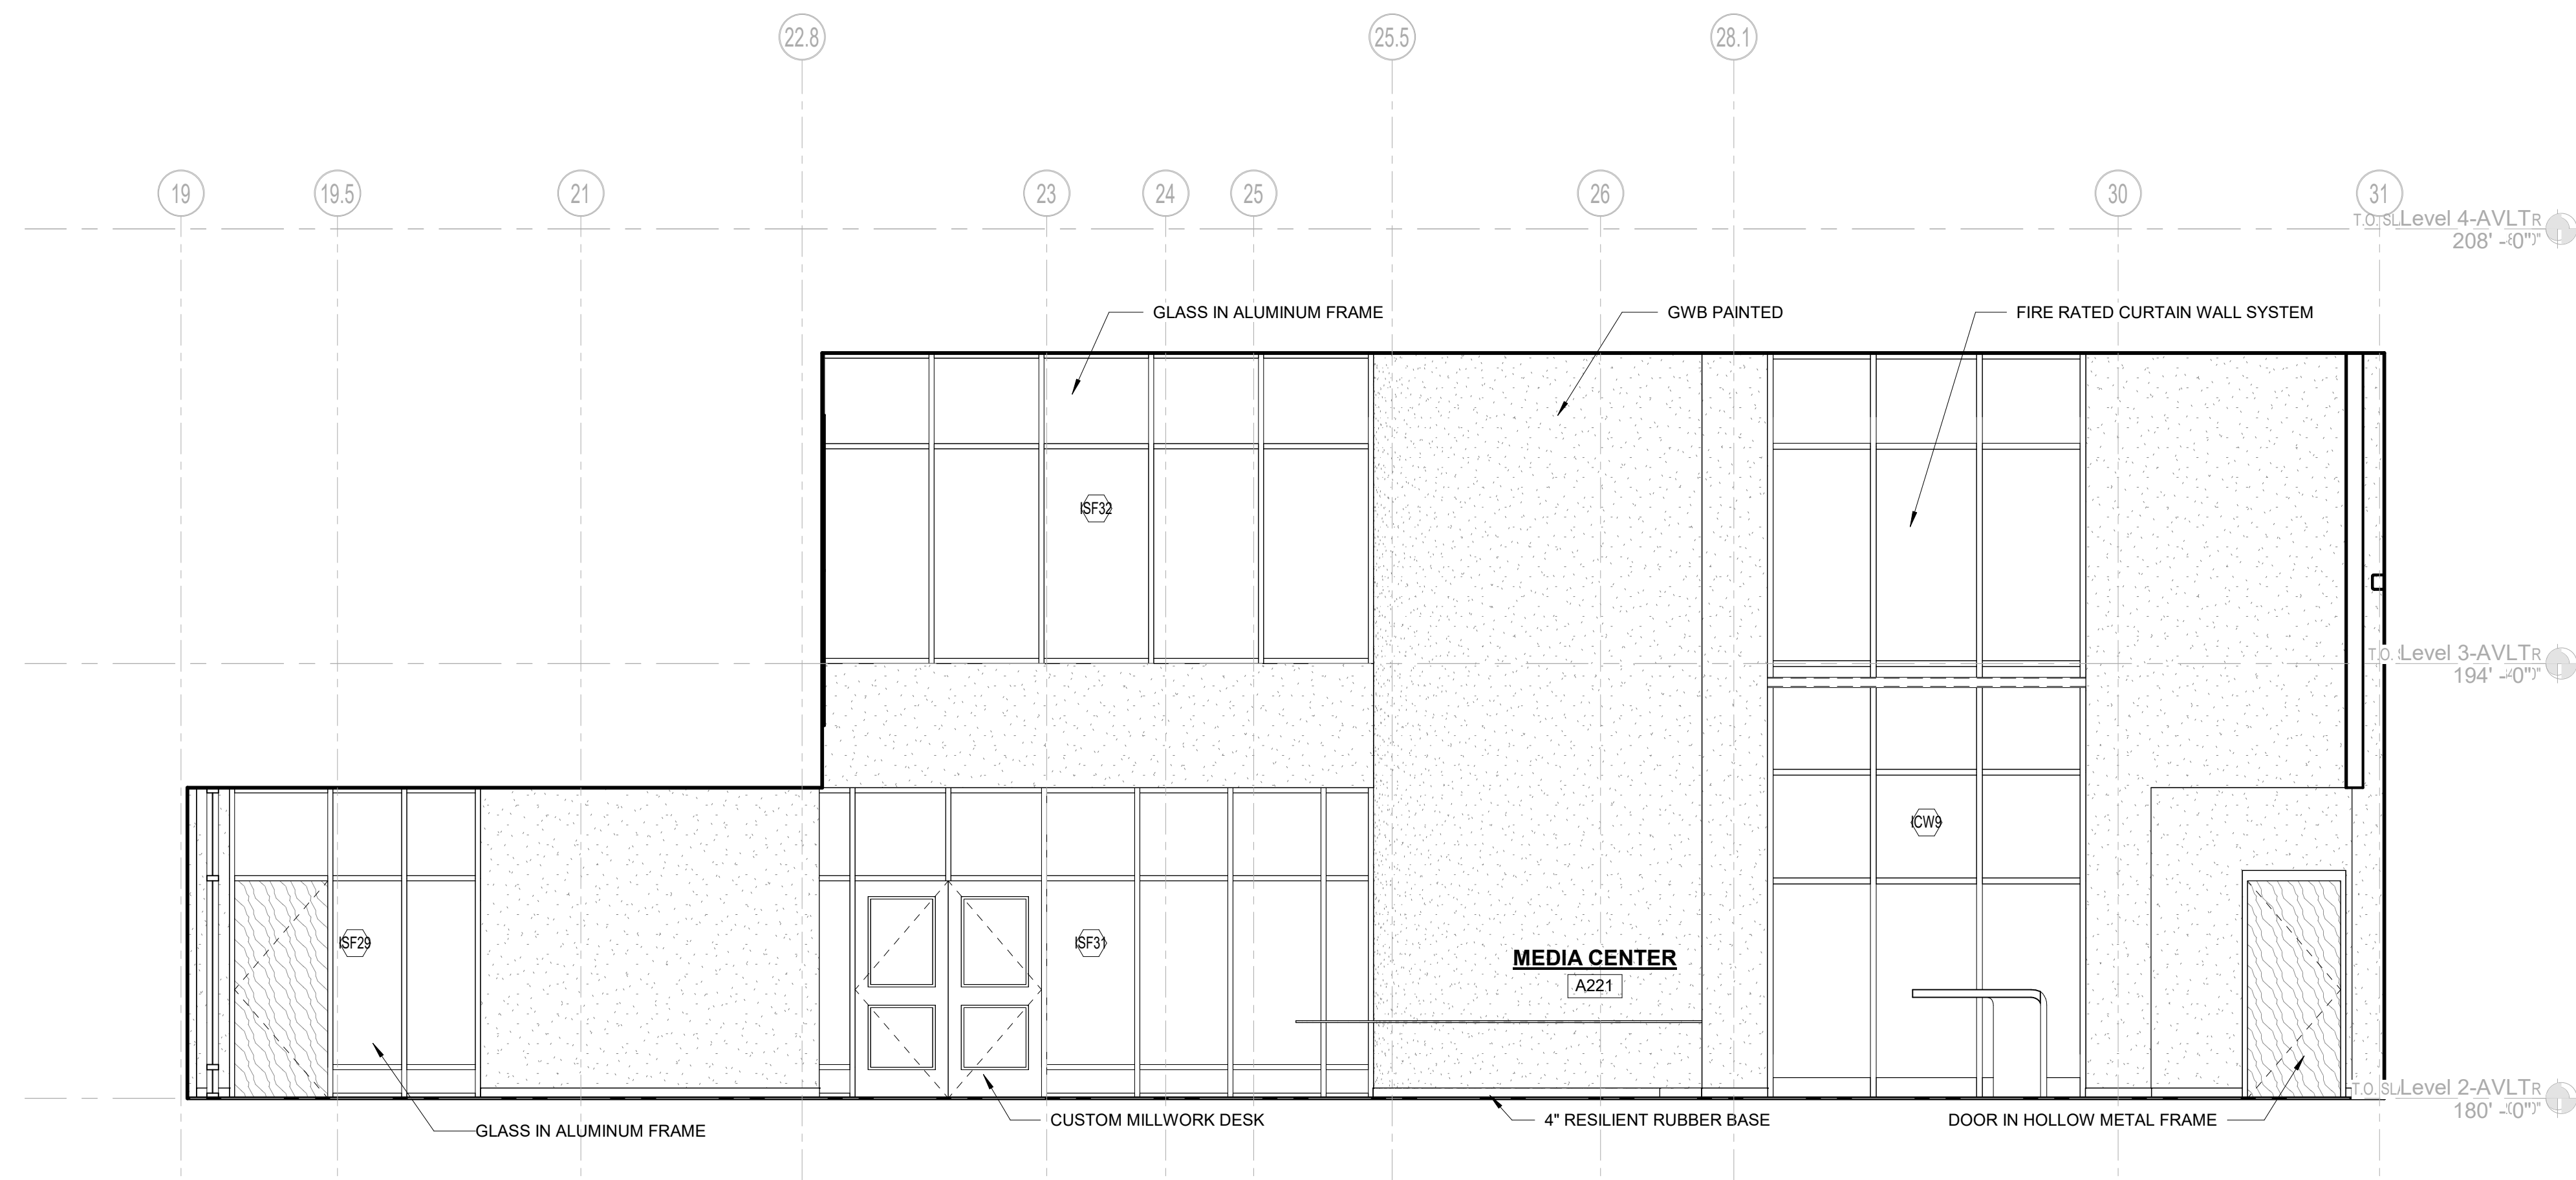


4 Media Center Elevation East
1/4" = 1'-0"

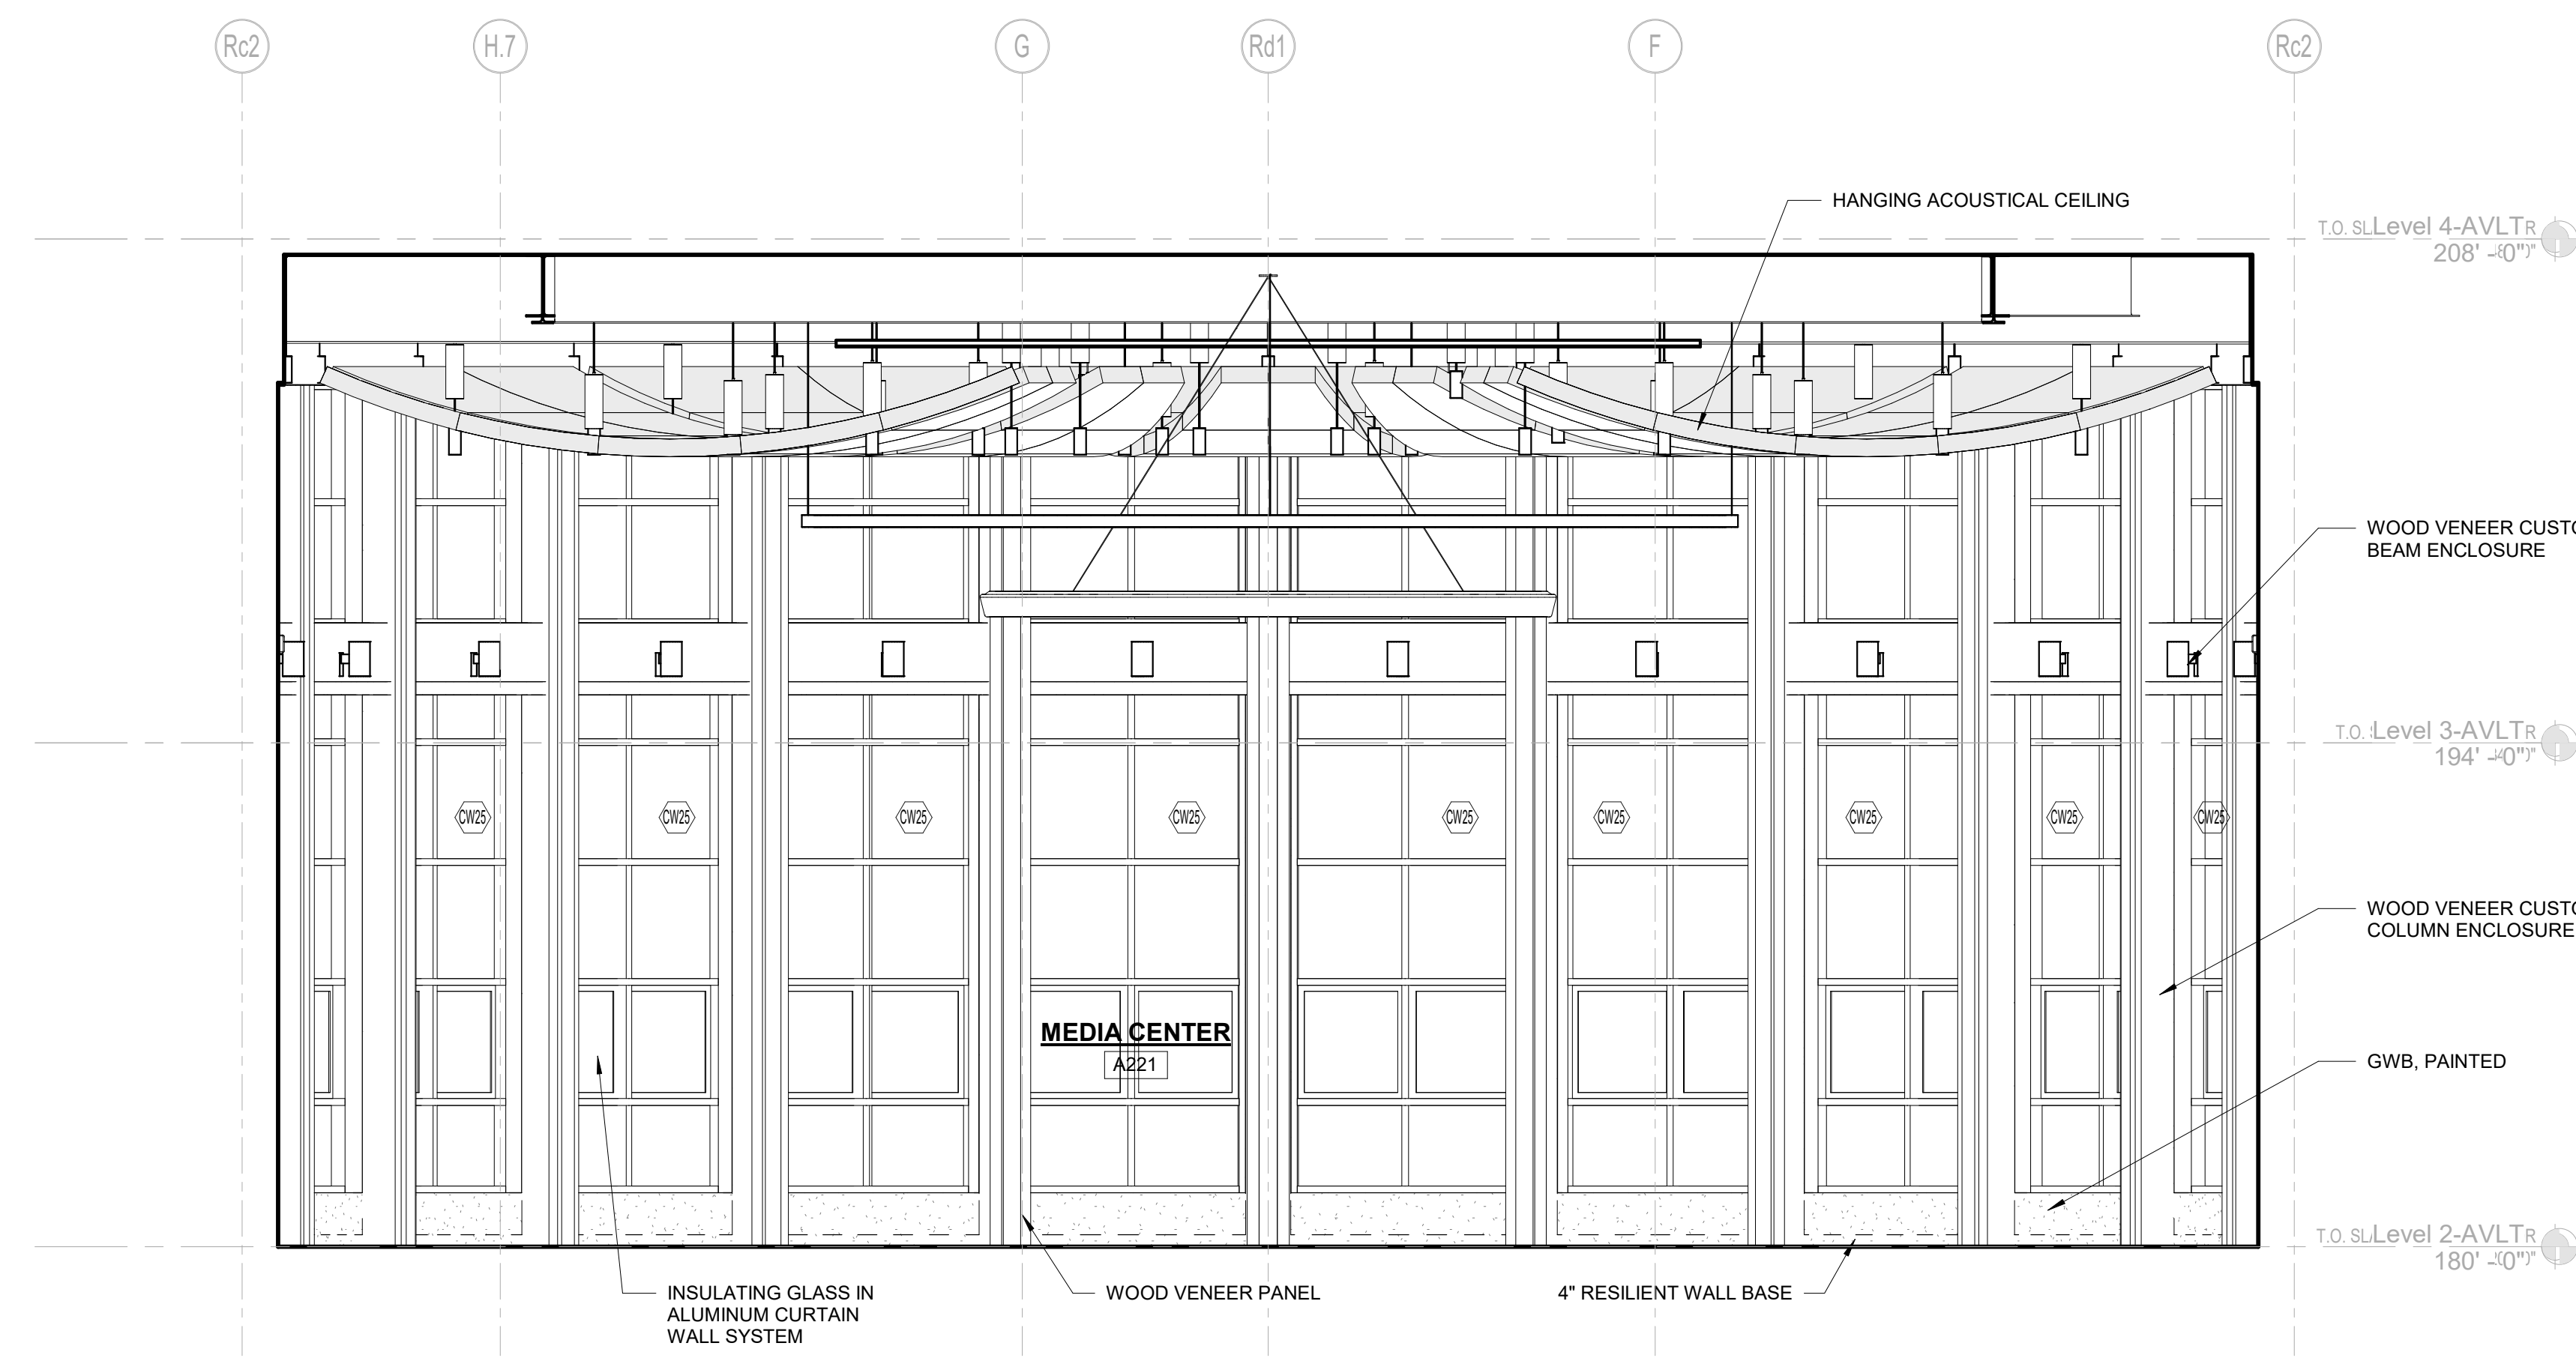


1 MEDIA CENTER ELEVATION
1/4" = 1'-0"

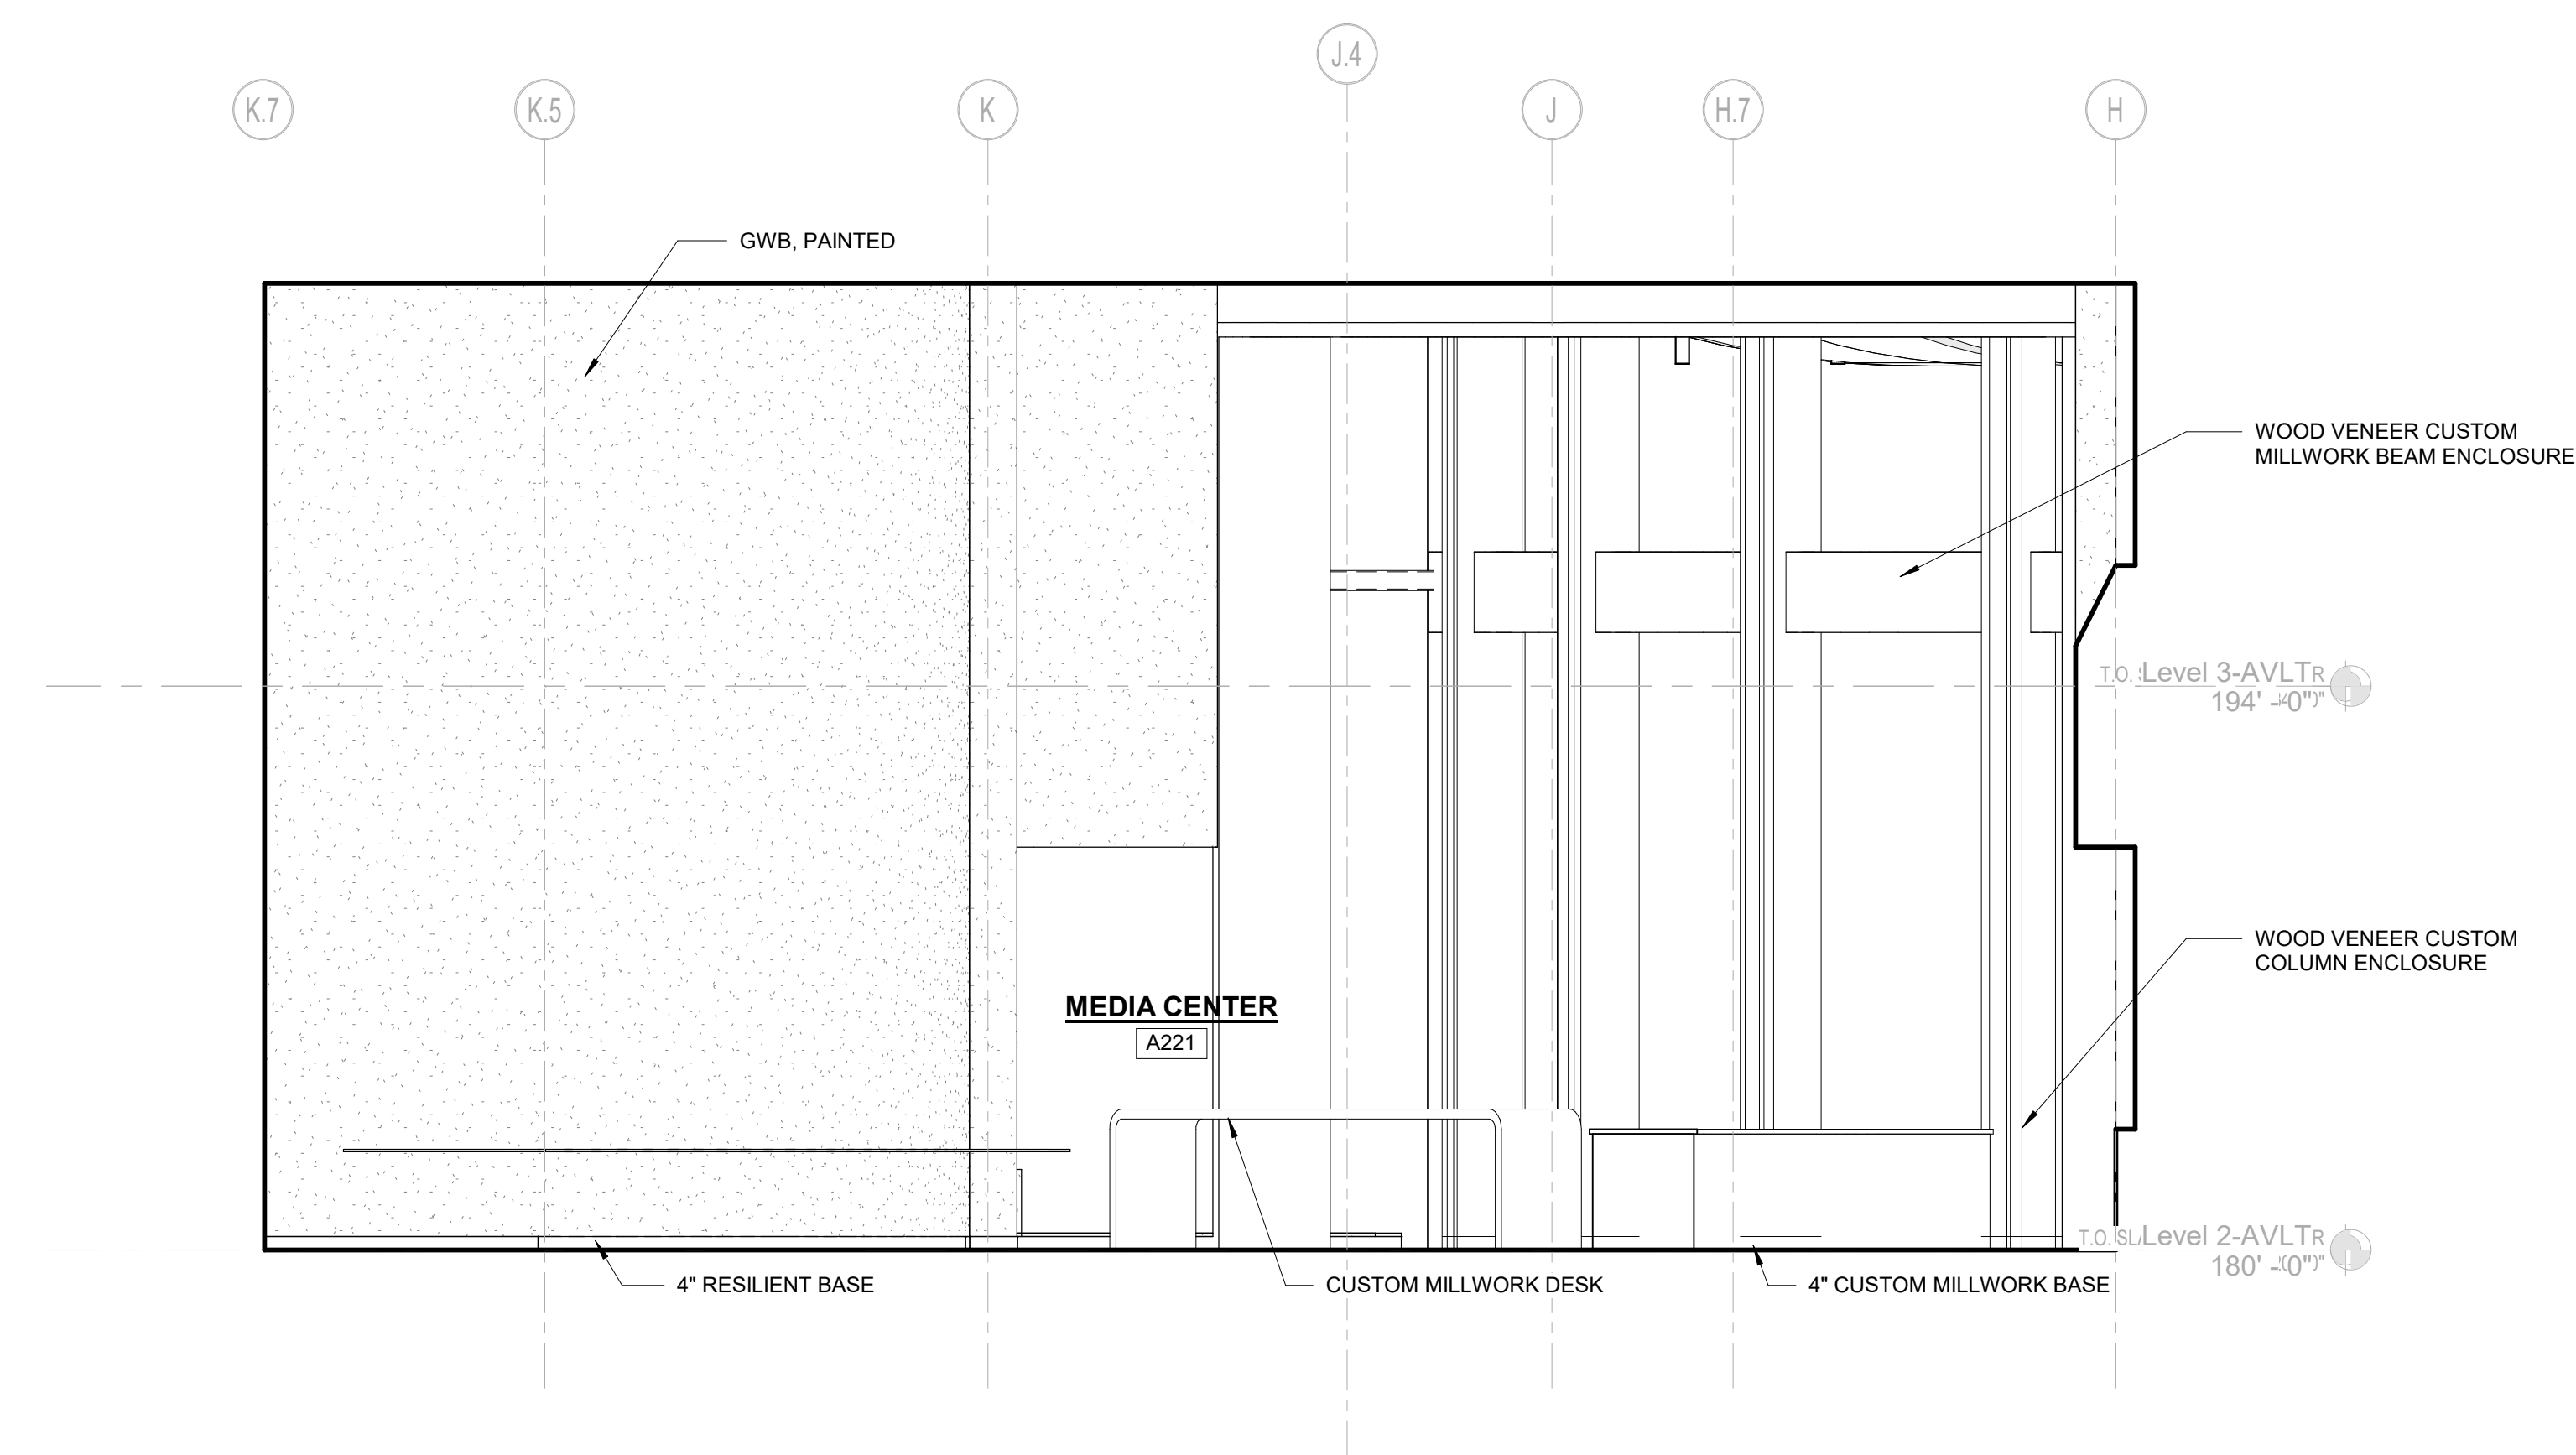

3 Media Center Elevation South
1/4" = 1'-0"

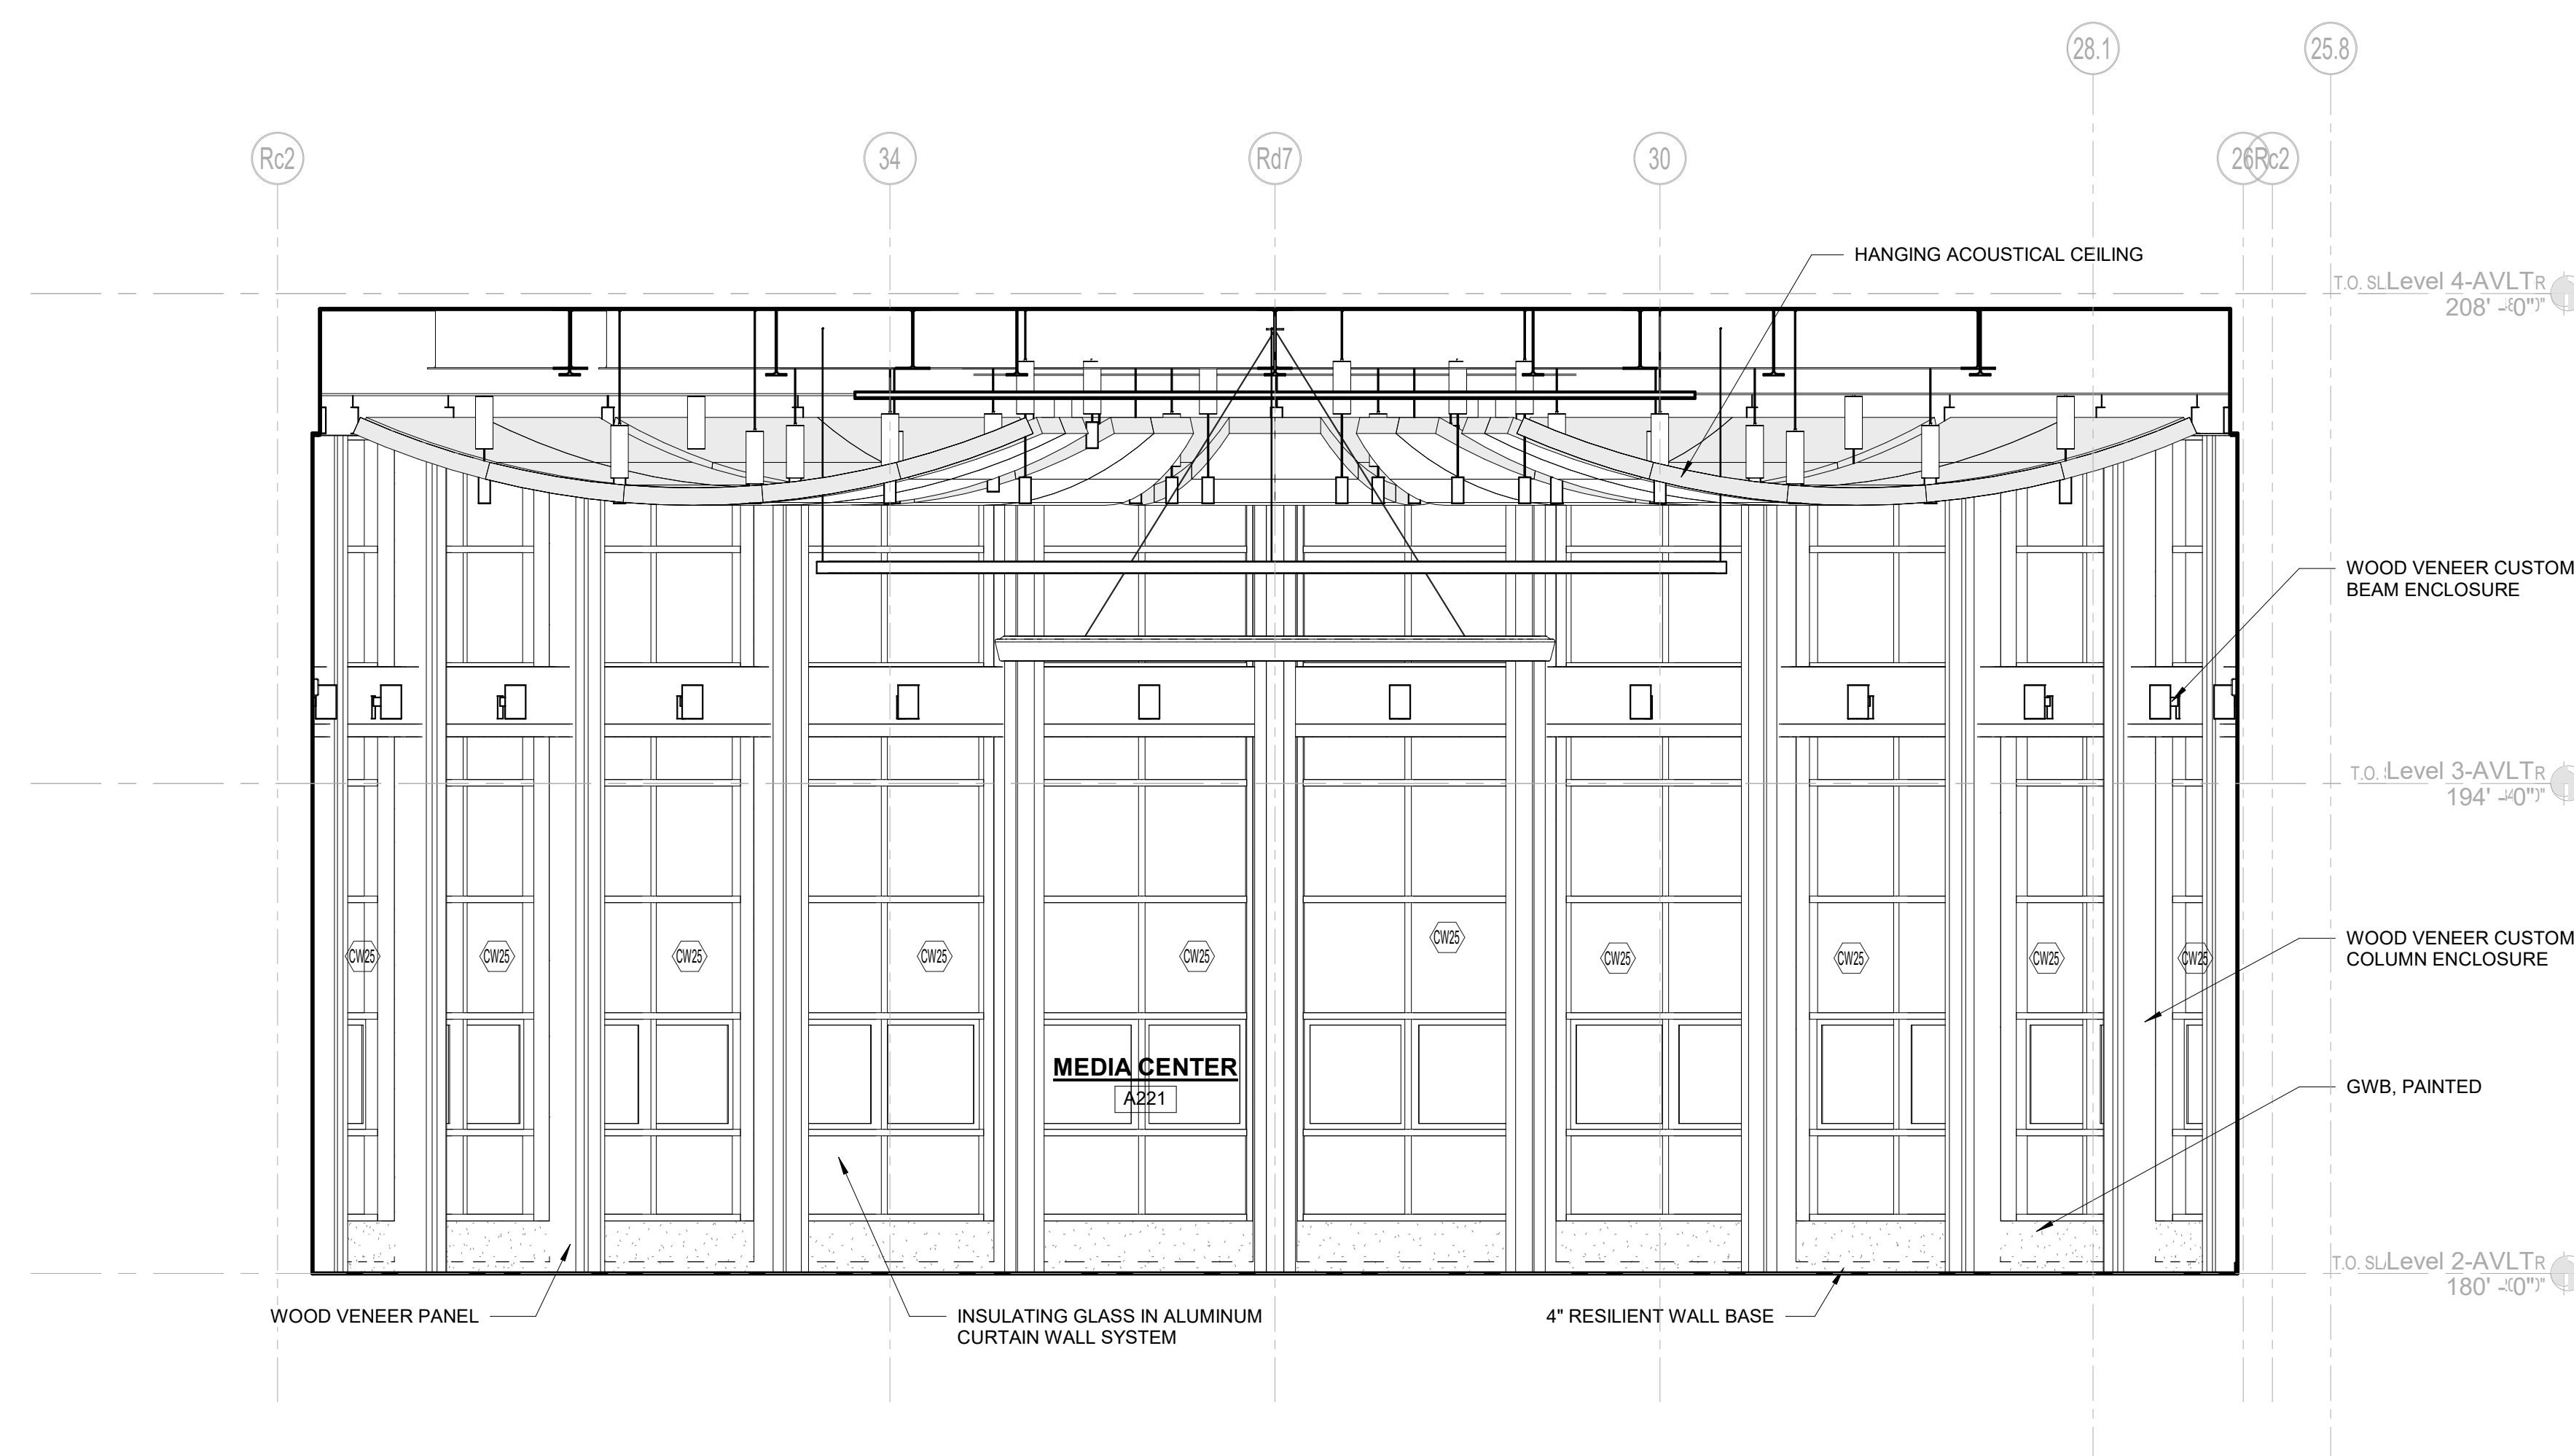

2 MEDIA CENTER ELEVATION
1/4" = 1'-0"

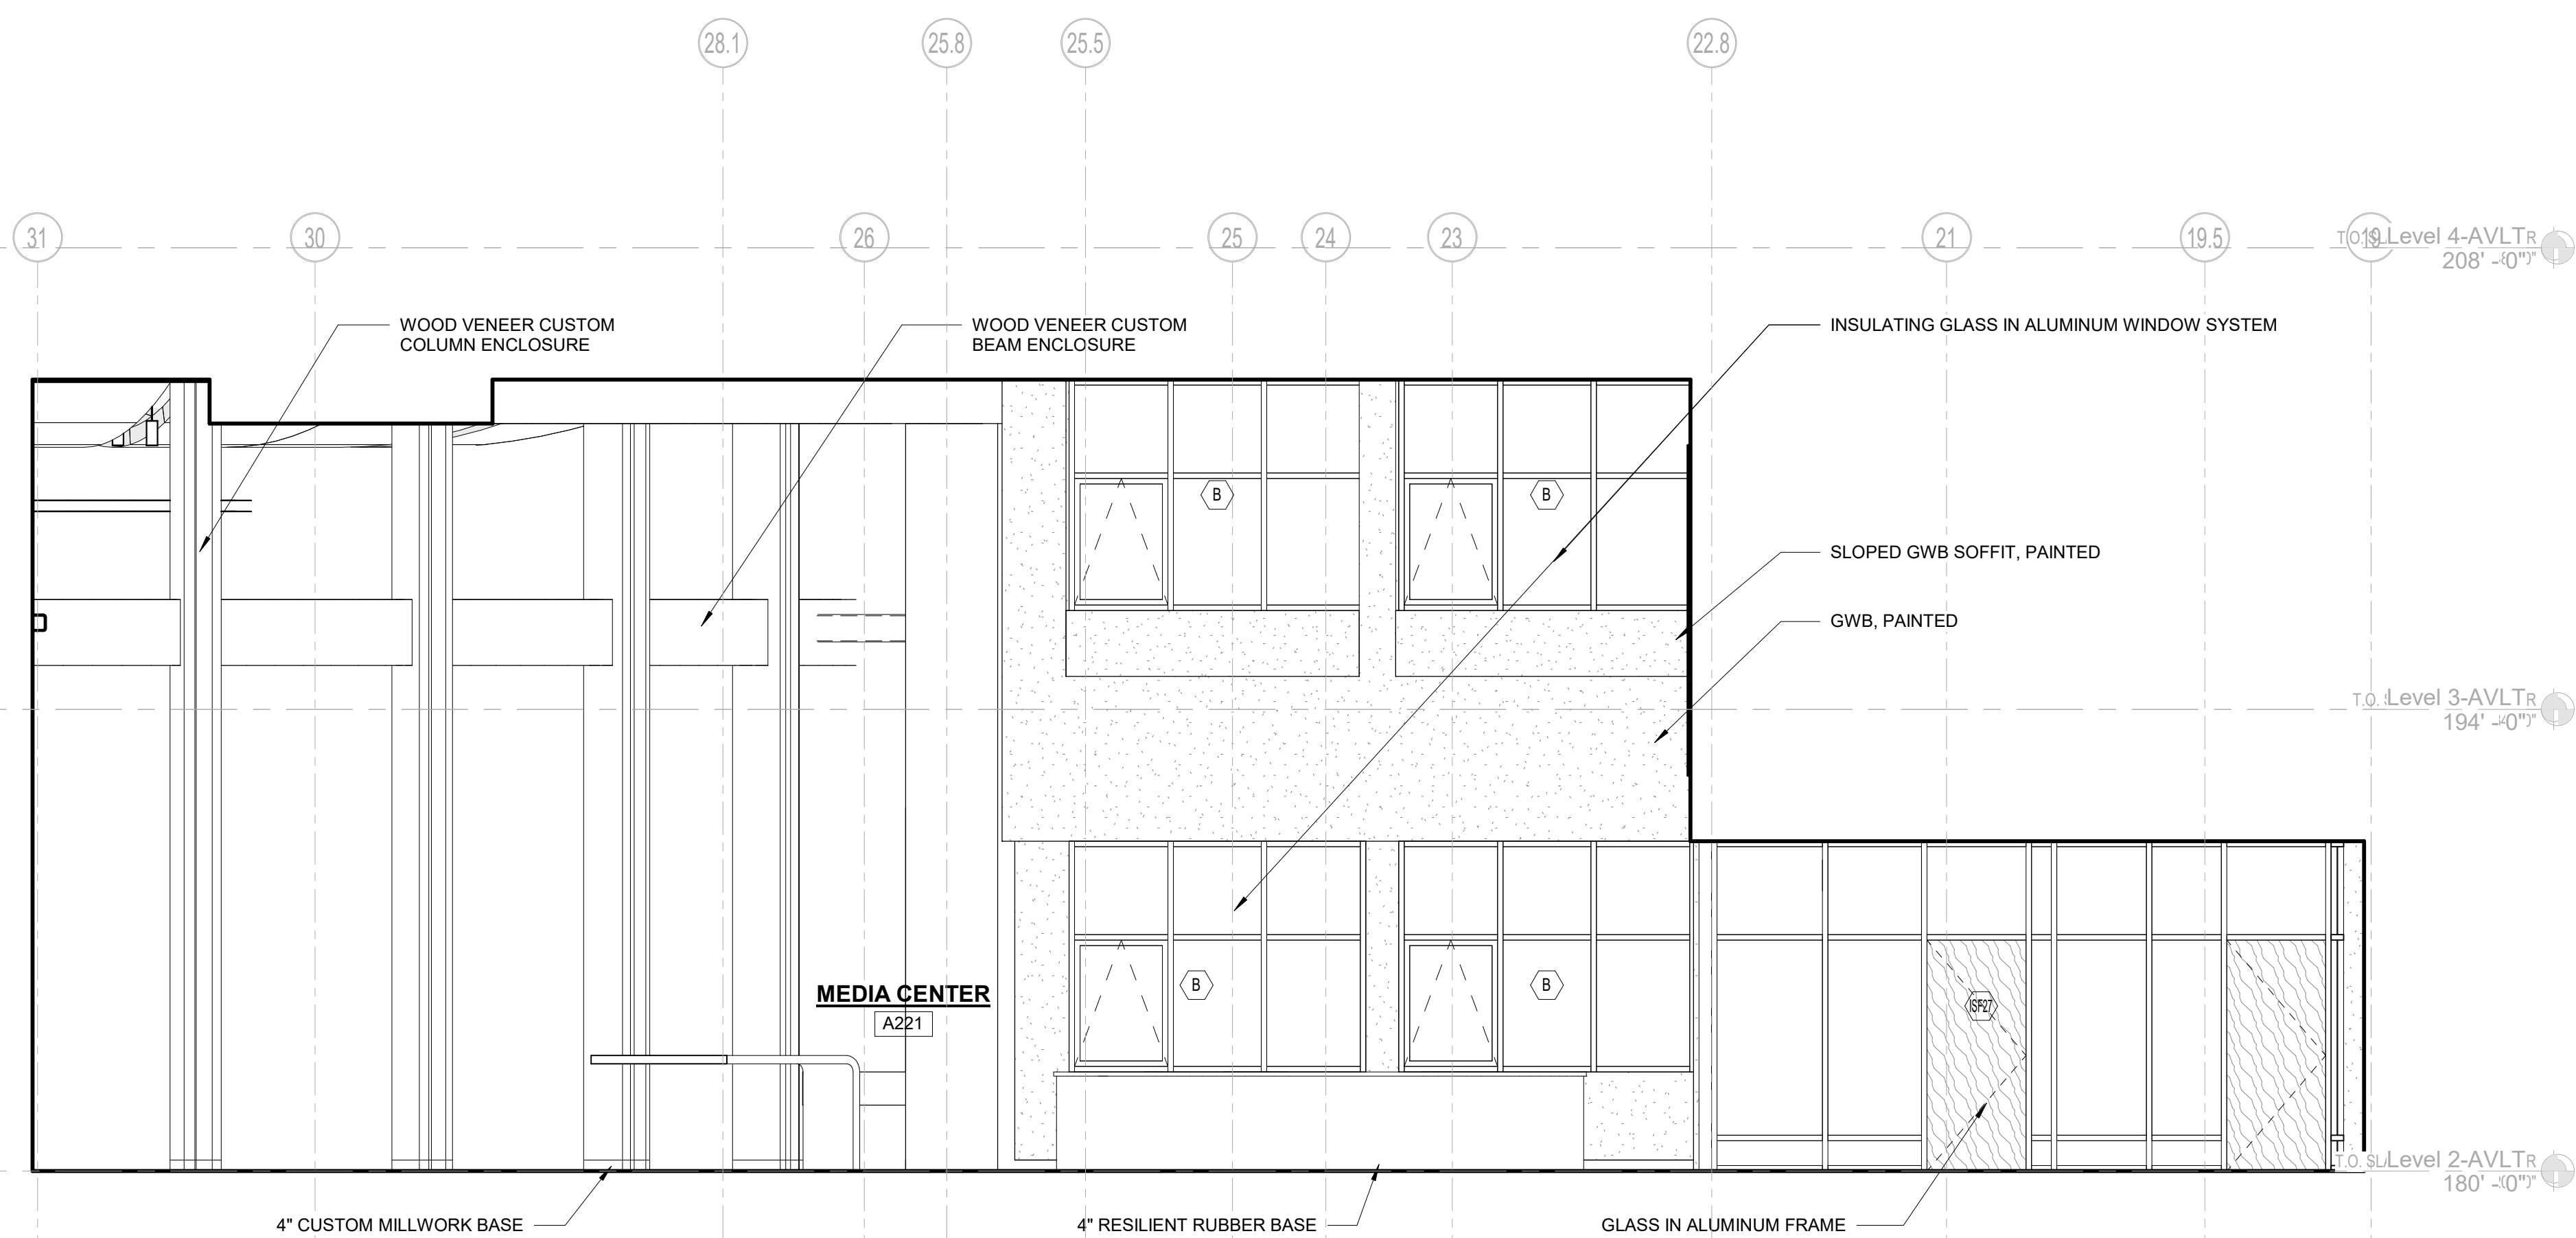

4 Media Center Elevation West
1/4" = 1'-0"


DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com


280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

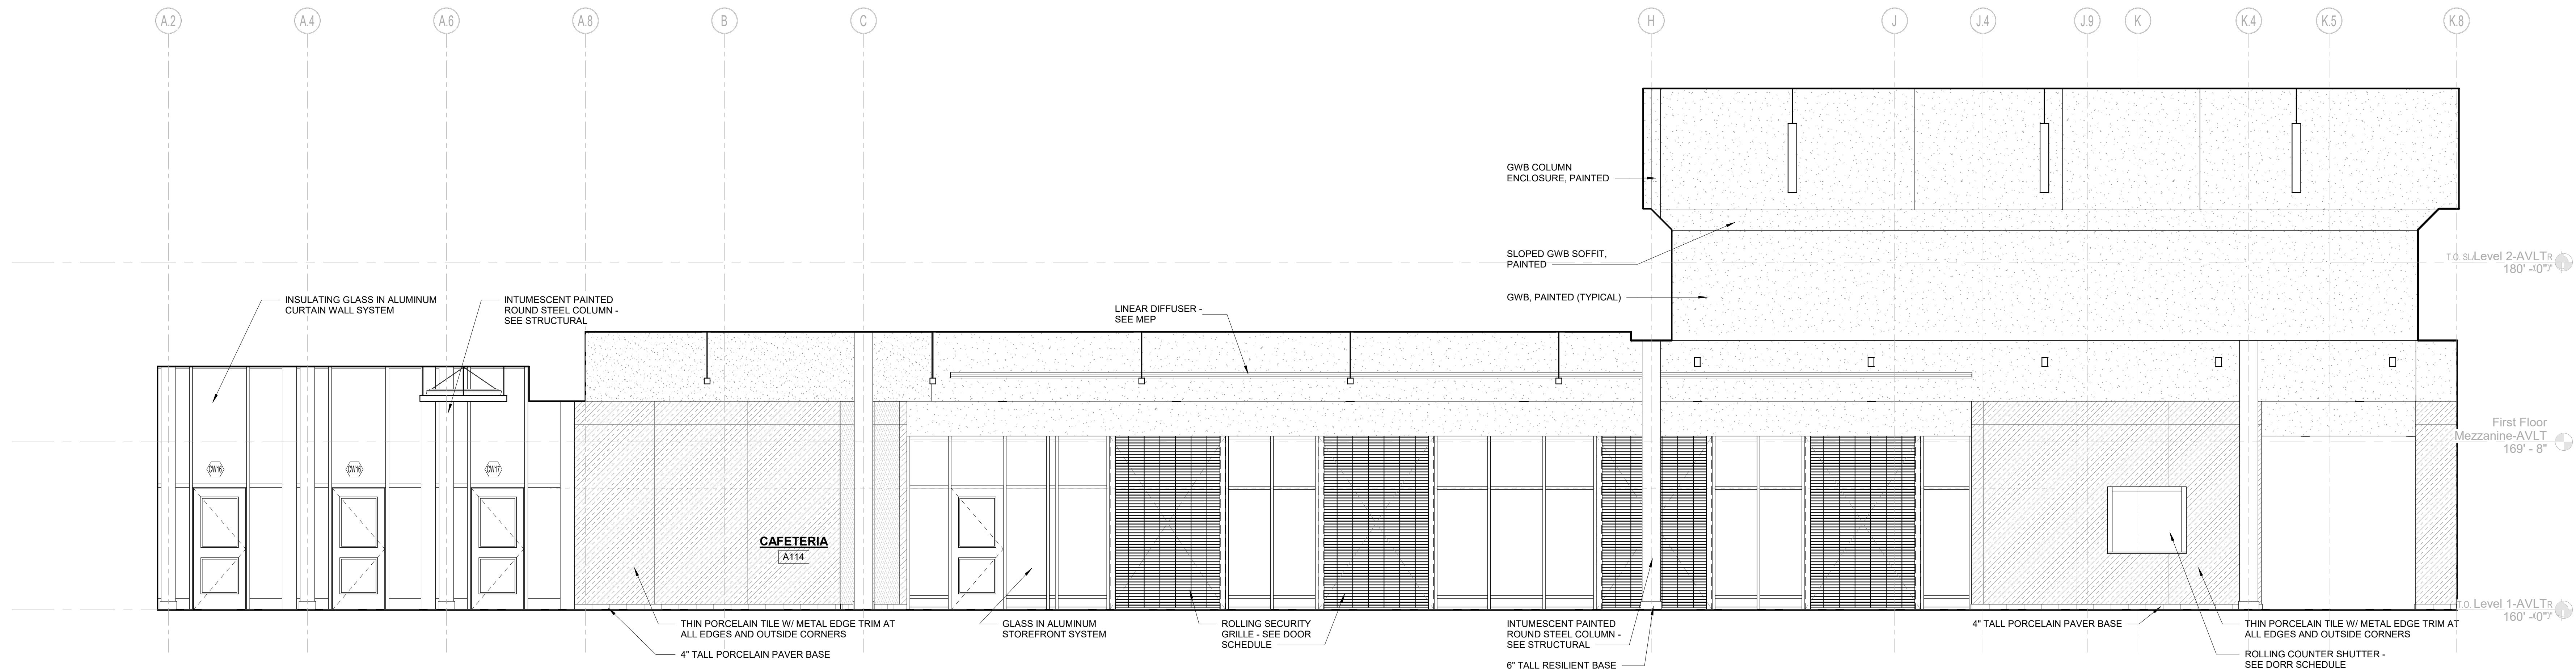


1 CAFETERIA ELEVATION - NORTH
1/4" = 1'-0"

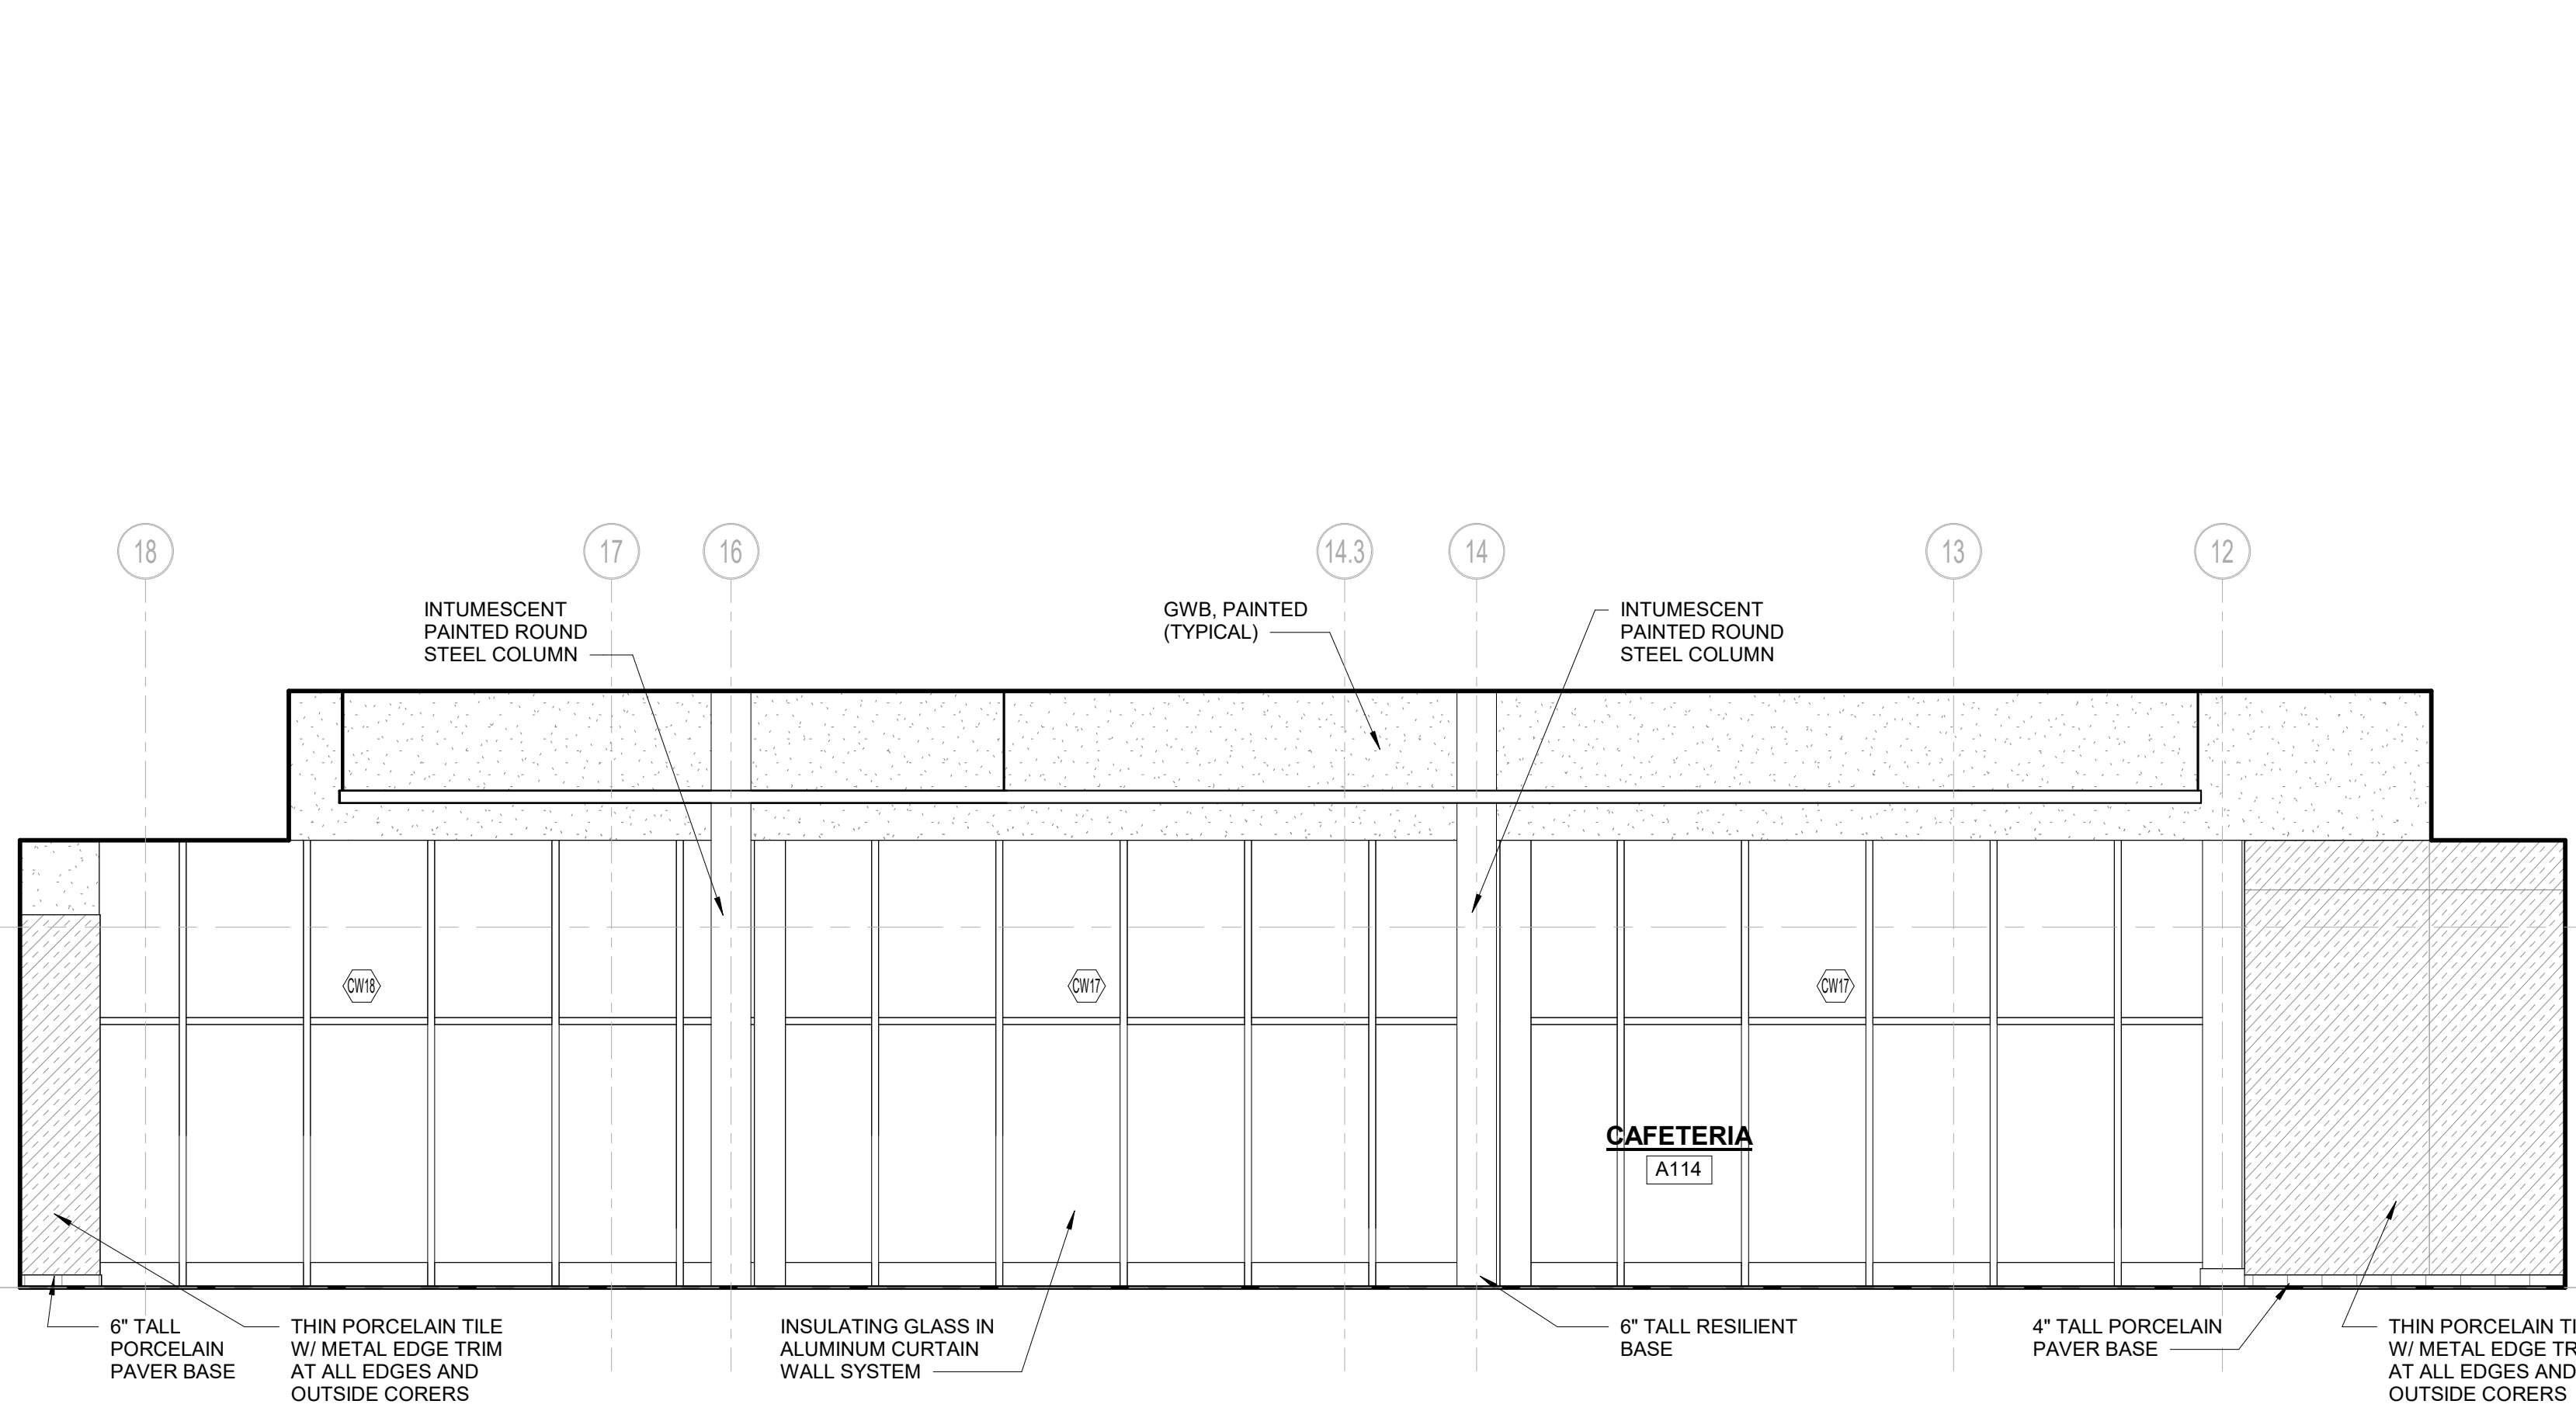

4 CAFETERIA ELEVATION - WEST
1/4" = 1'-0"

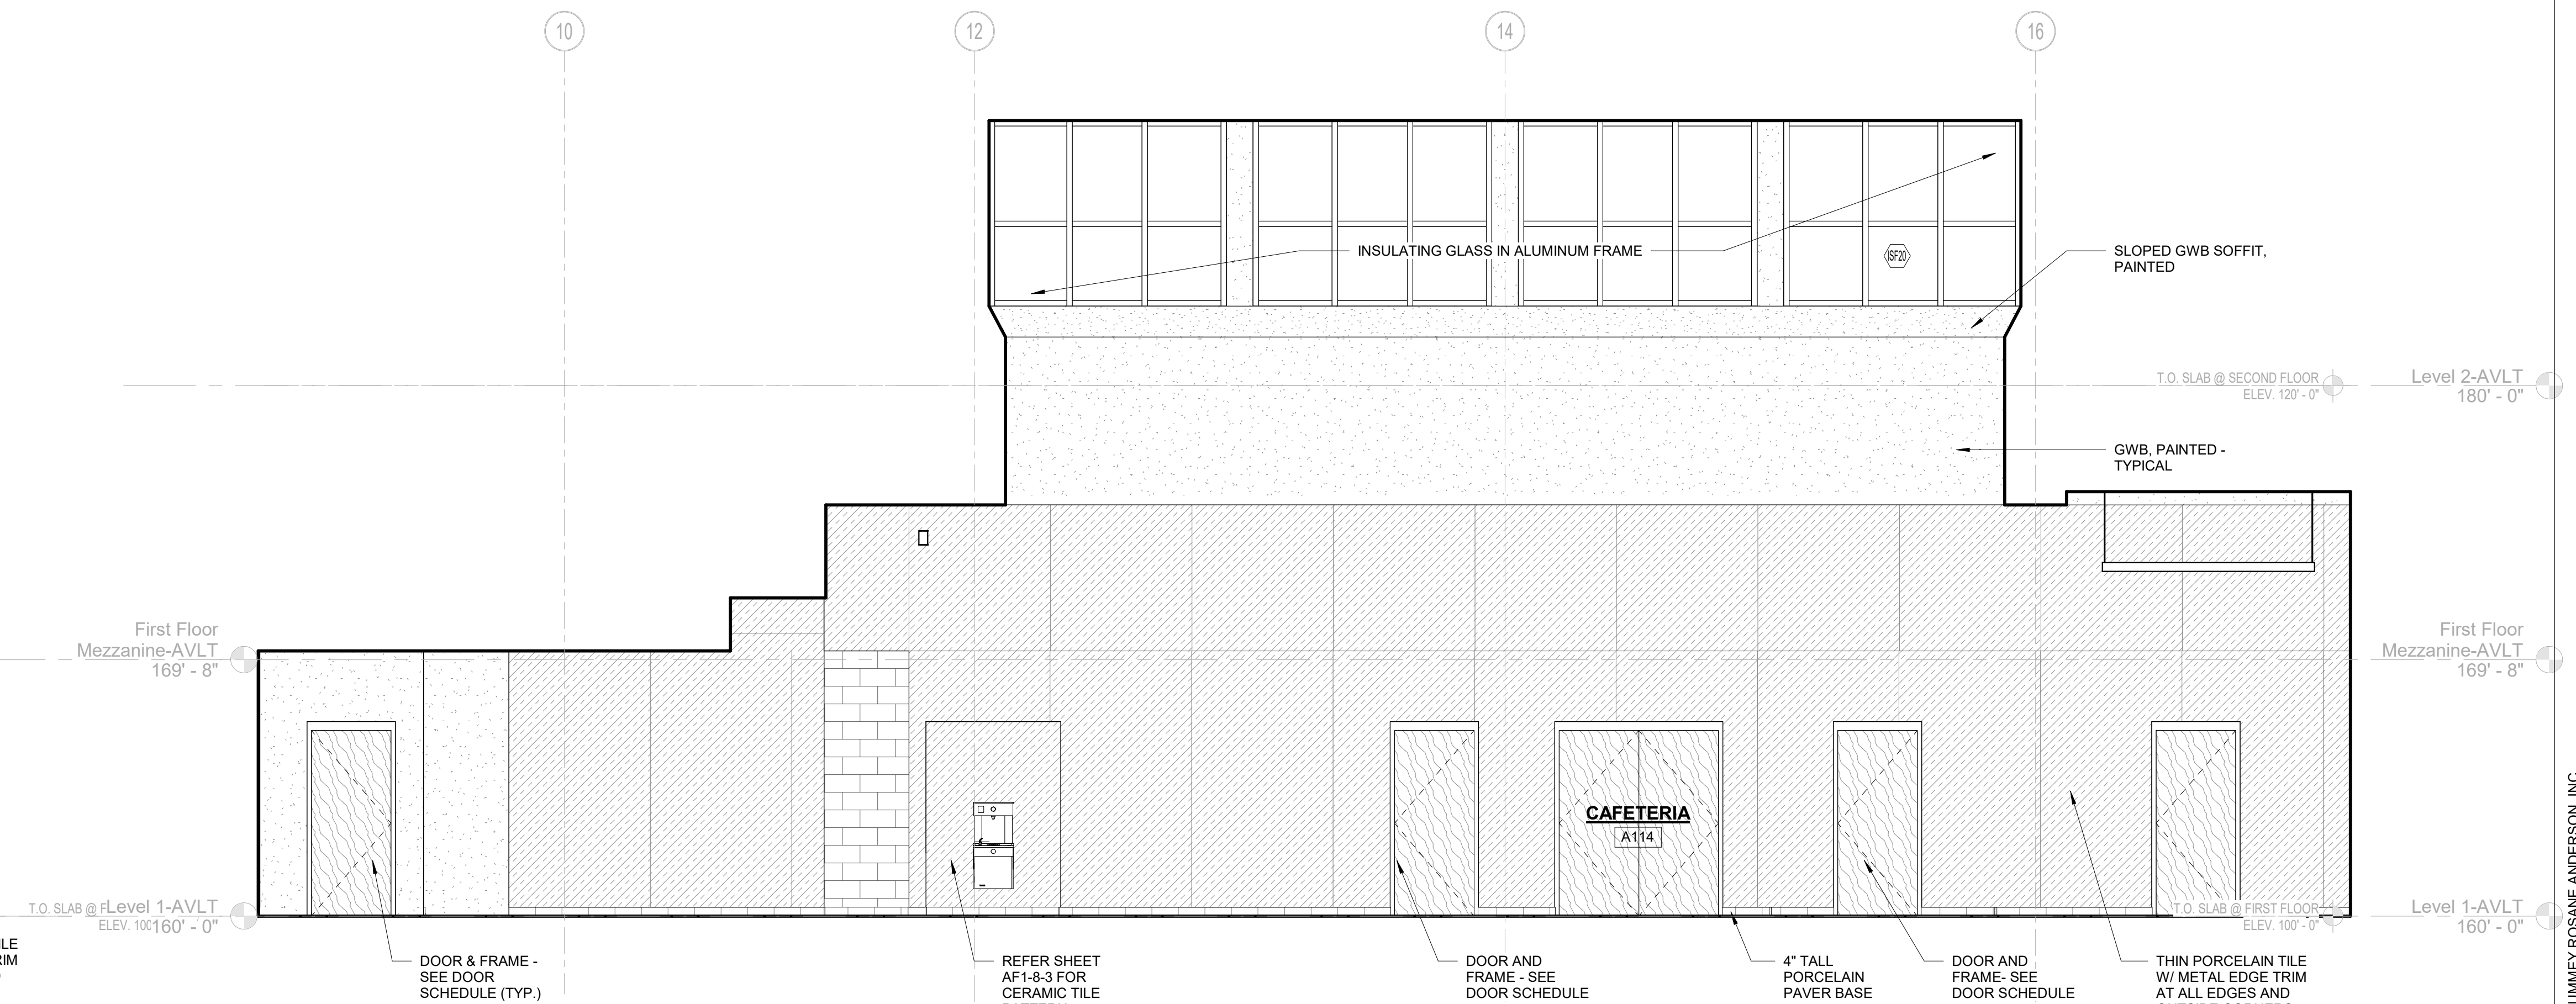


2 CAFETERIA ELEVATION - EAST
1/4" = 1'-0"

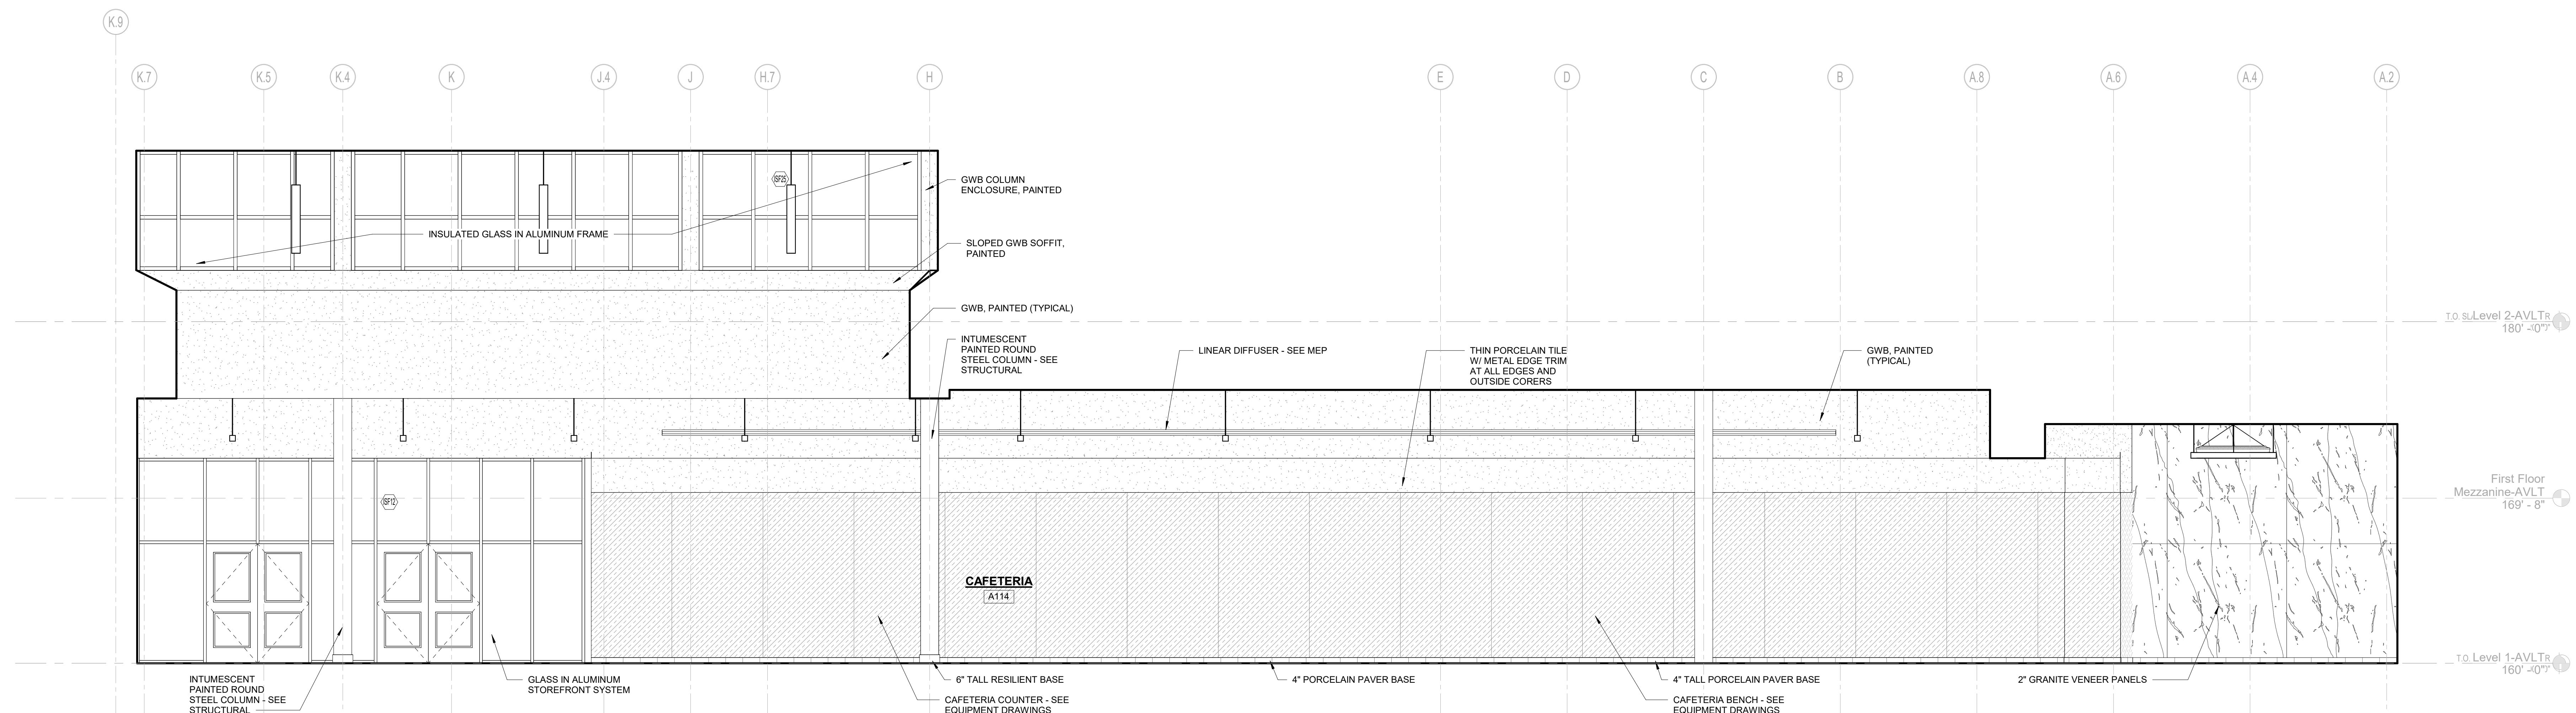

3 CAFETERIA ELEVATION - SOUTH
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

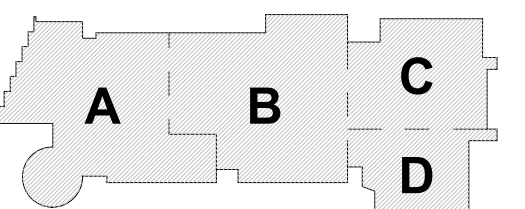

KEY PLAN




PROJECT NORTH
MAGNETIC NORTH

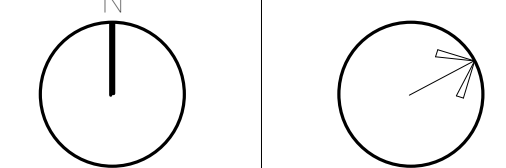


**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A2-2-10

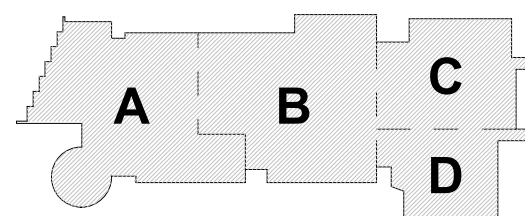


4 CORRIDOR B111 - SOUTH
1/4" = 1'-0"

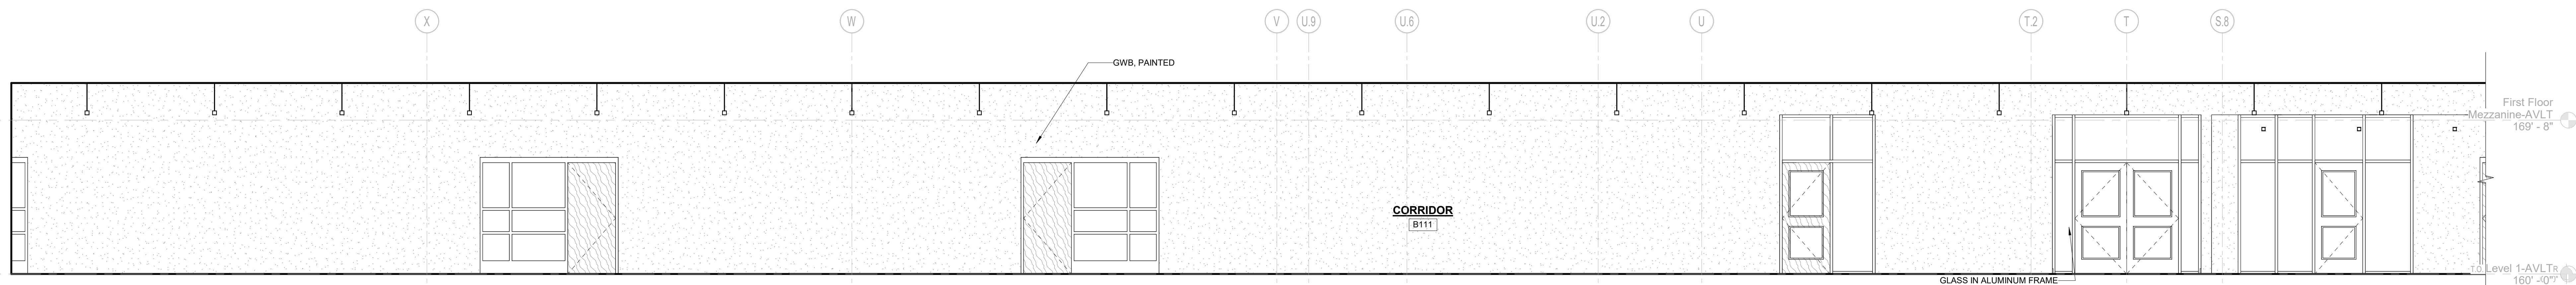


3 CORRIDOR B111 - NORTH
1/4" = 1'-0"





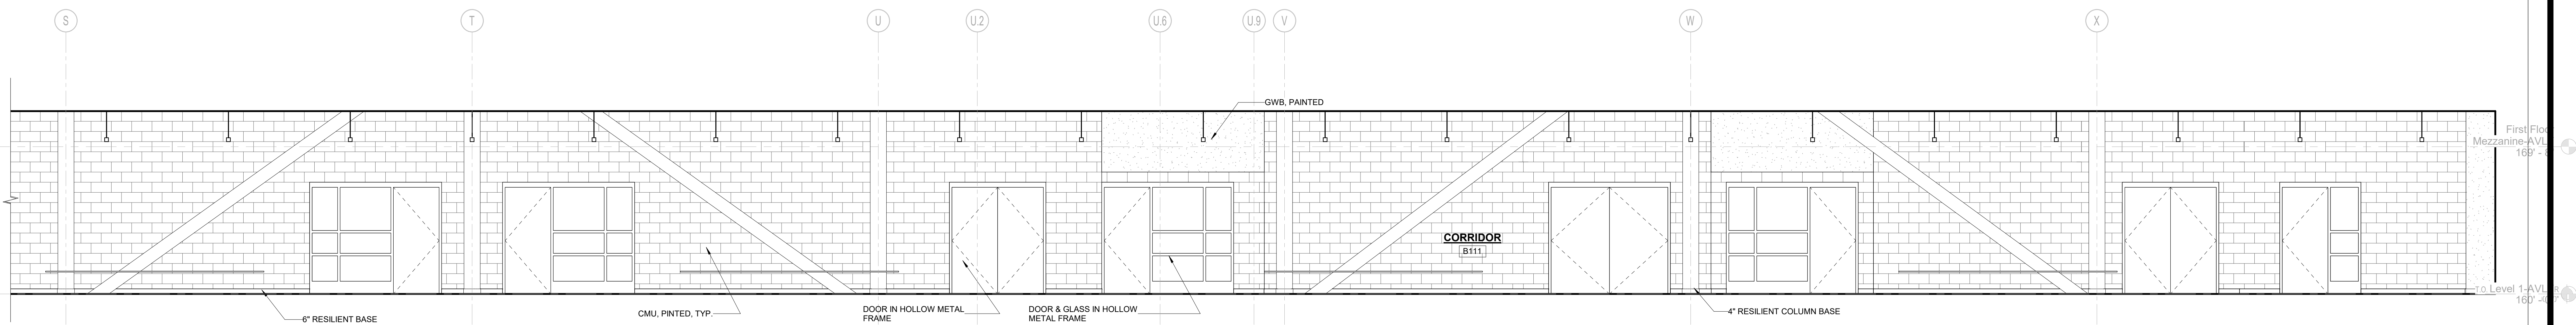


2 CORRIDOR A146 - SOUTH
1/4" = 1'-0"

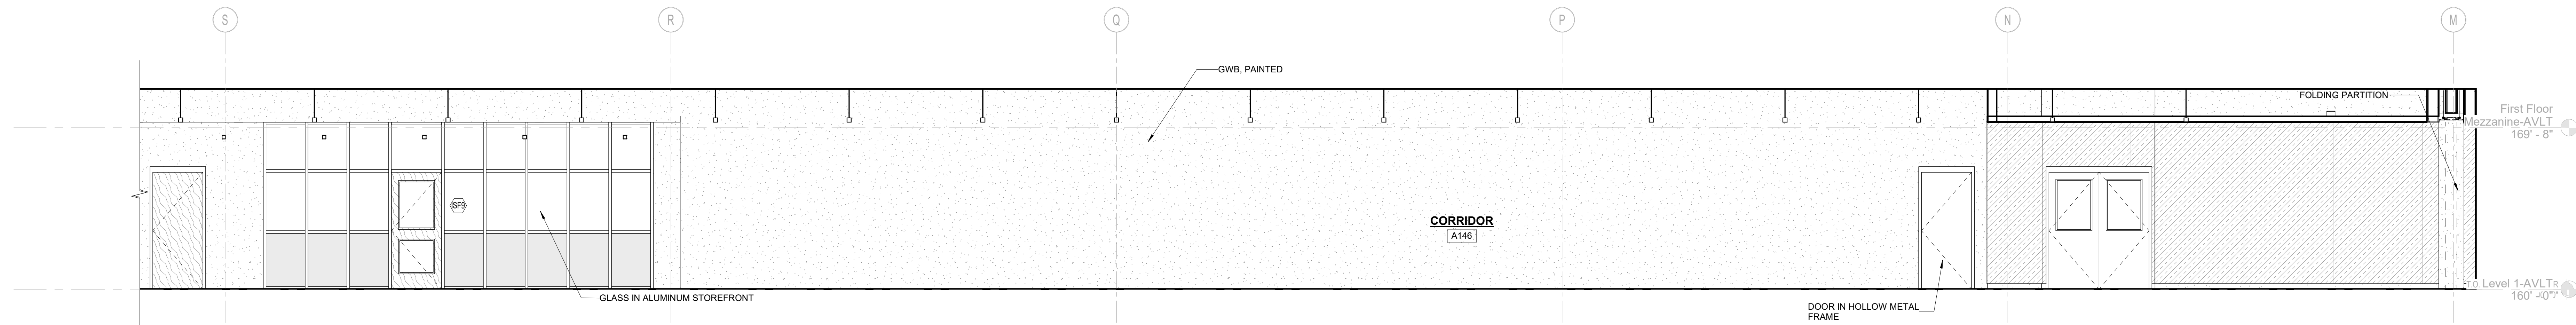

1 CORRIDOR A146 - NORTH
1/4" = 1'-0"

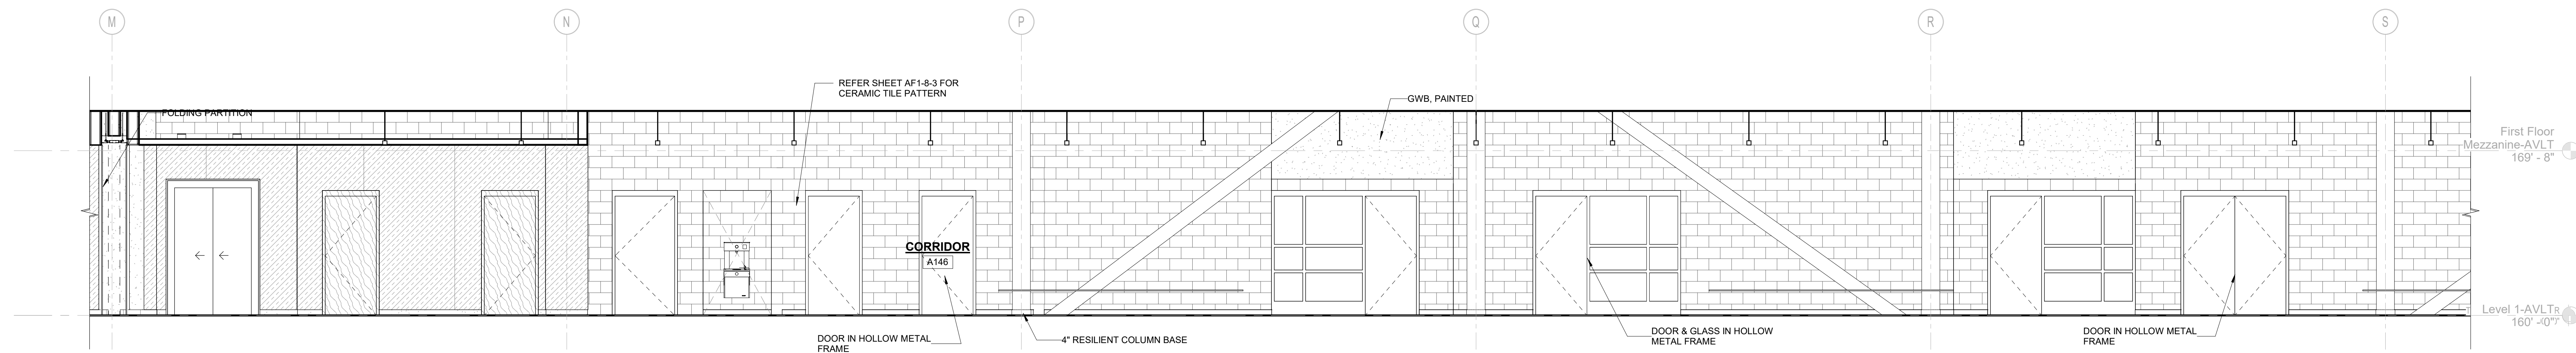


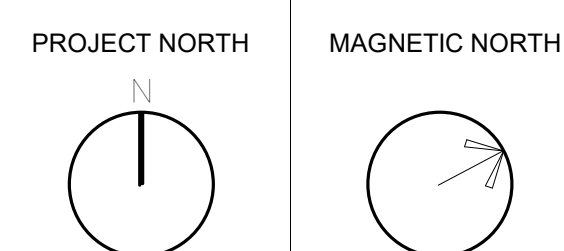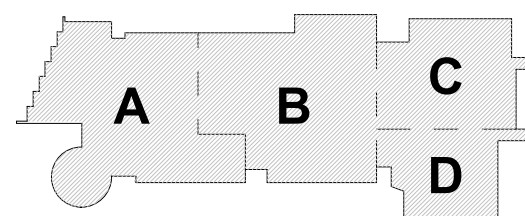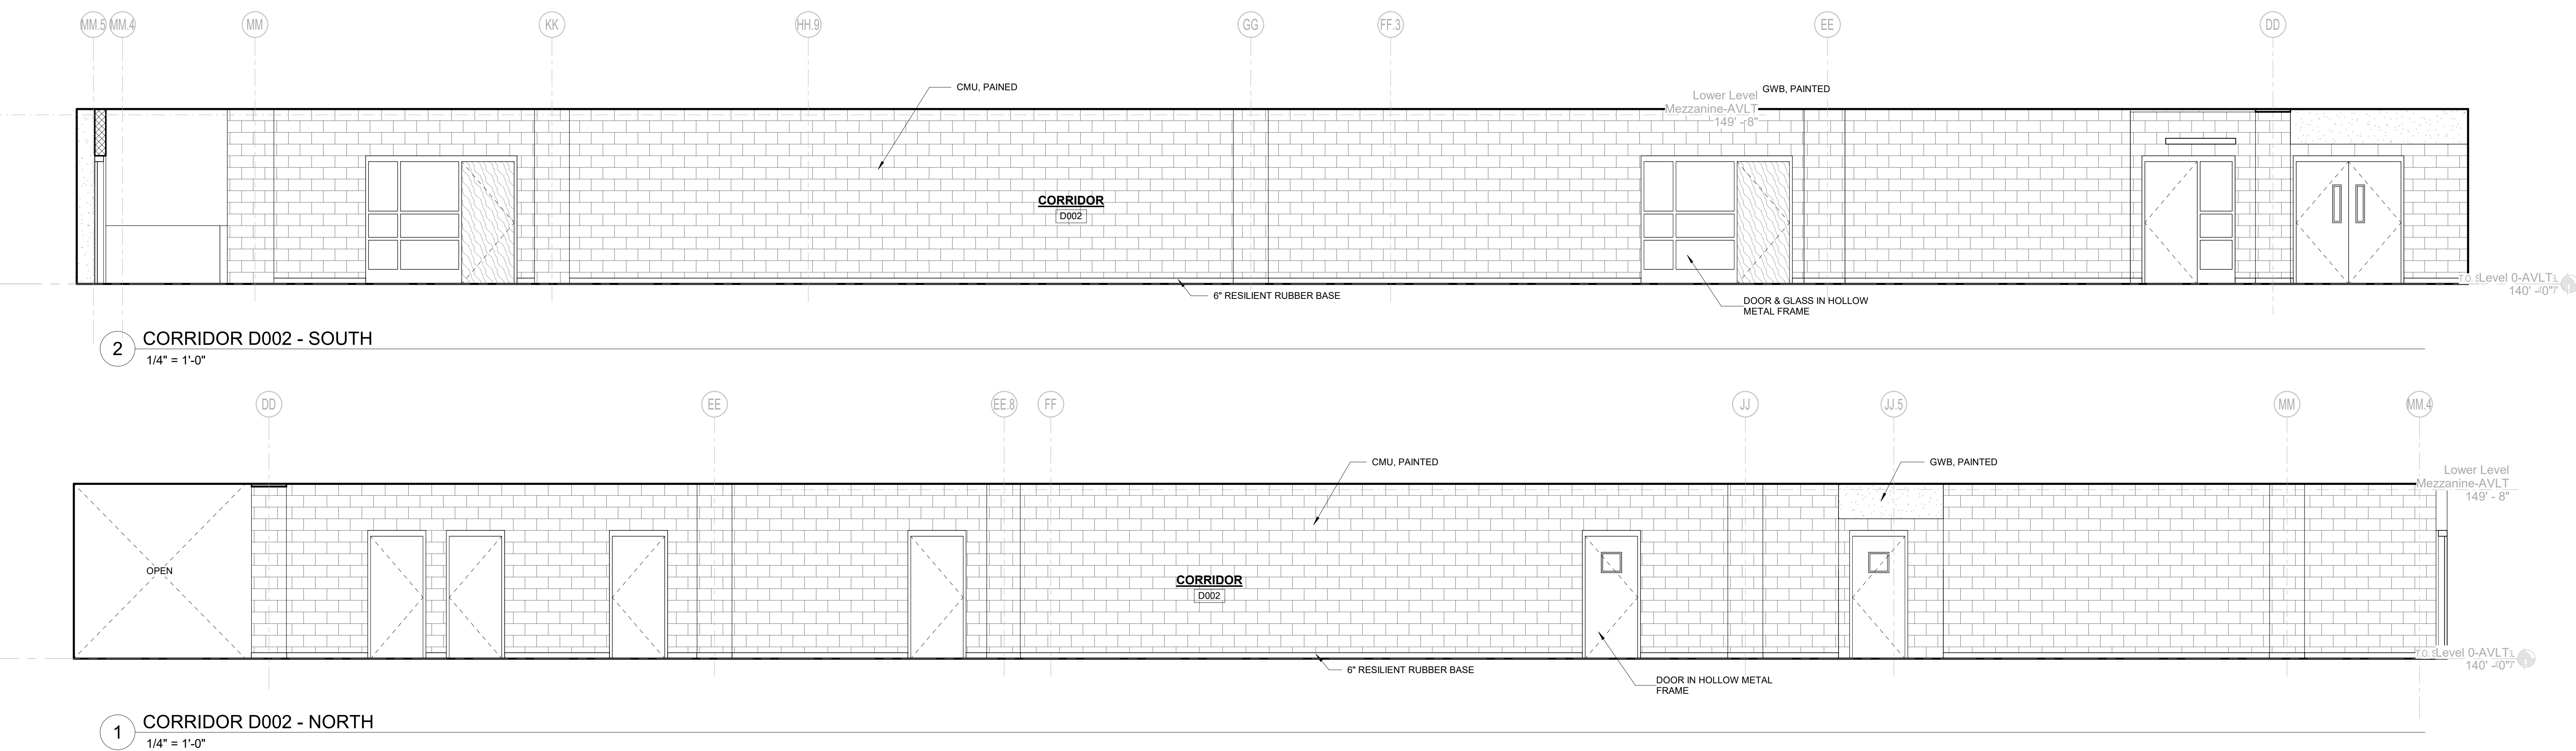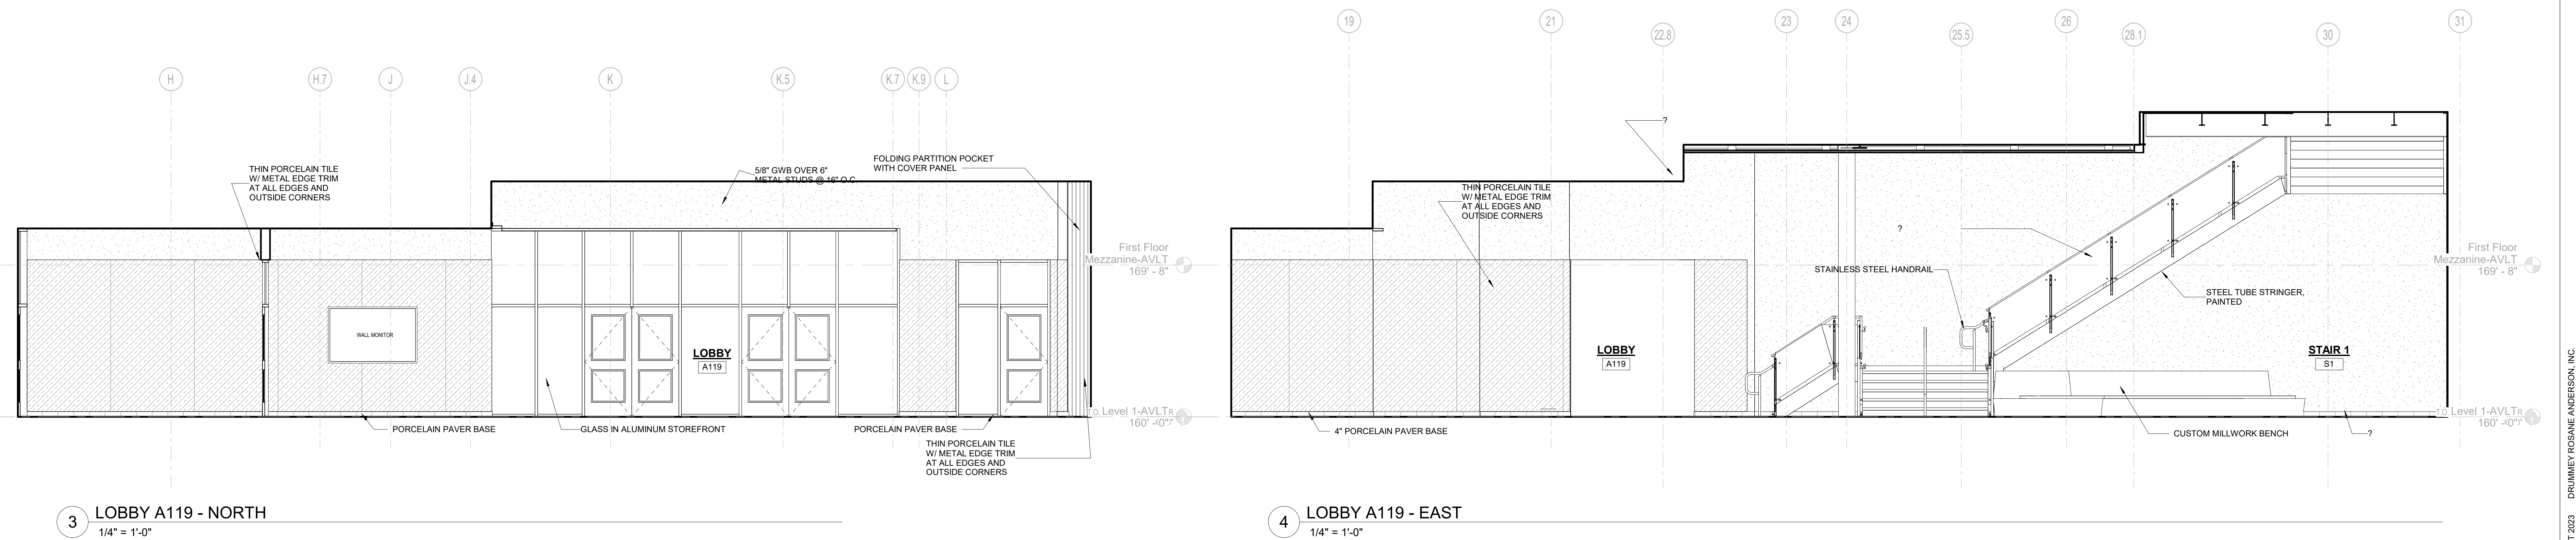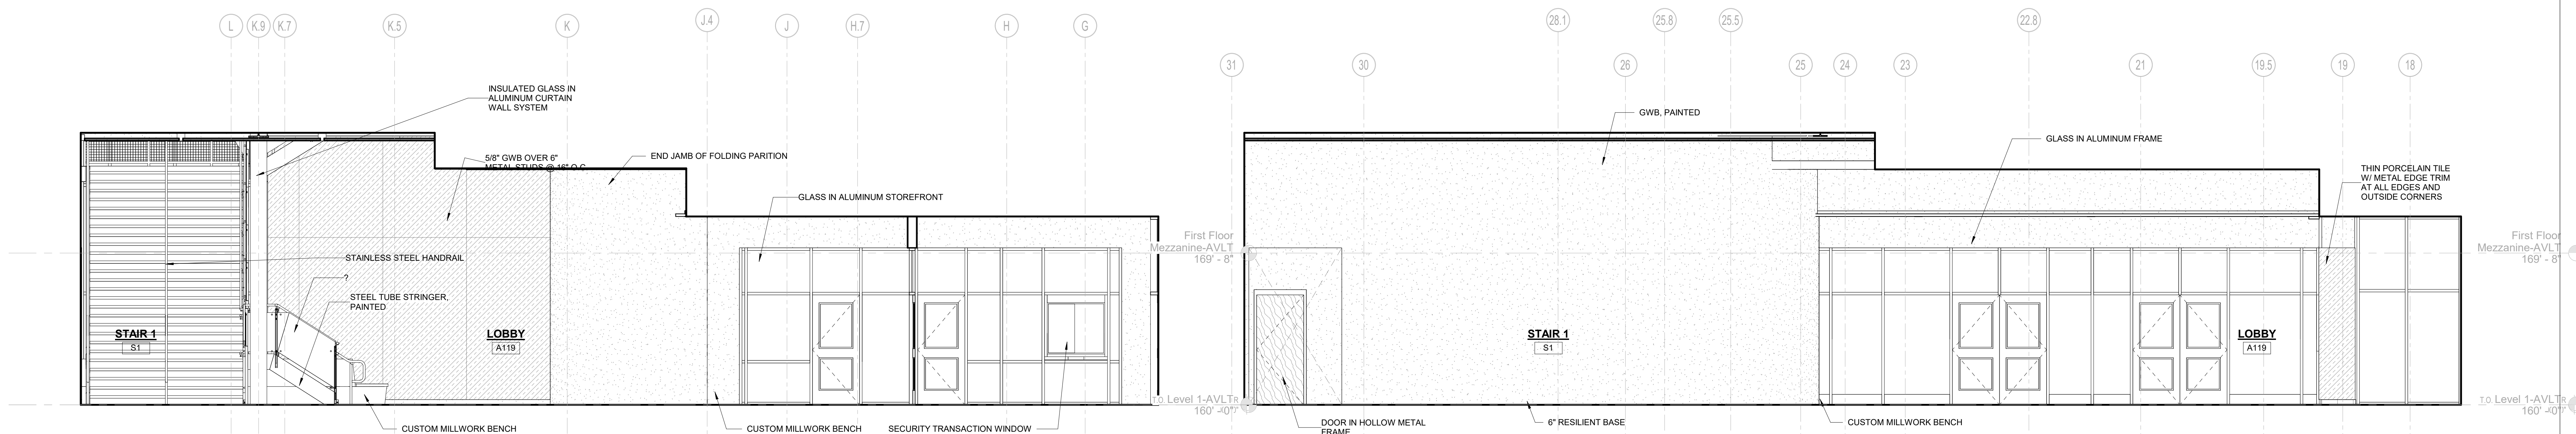




Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Tel: 617.854.1700
www.drainc.com


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

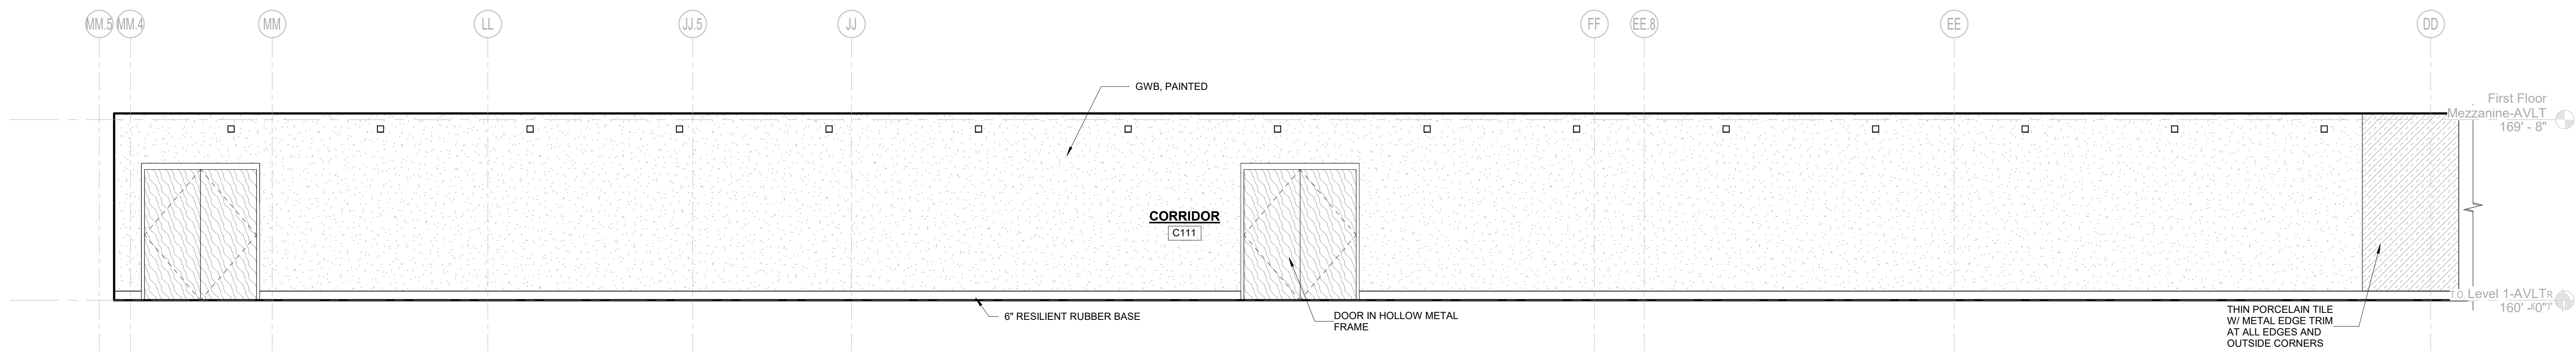


6 CORRIDOR C111 - SOUTH
1/4" = 1'-0"

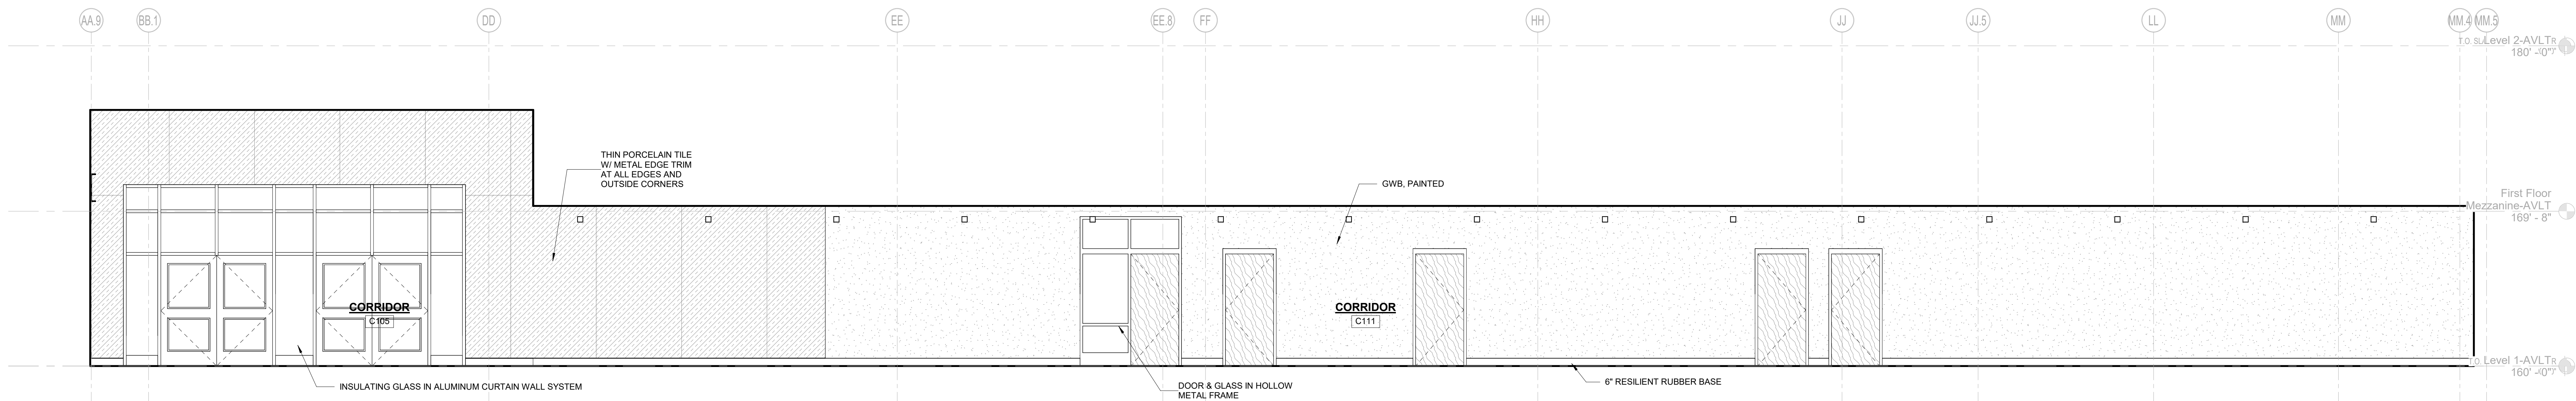


5 CORRIDOR C111 - NORTH
1/4" = 1'-0"

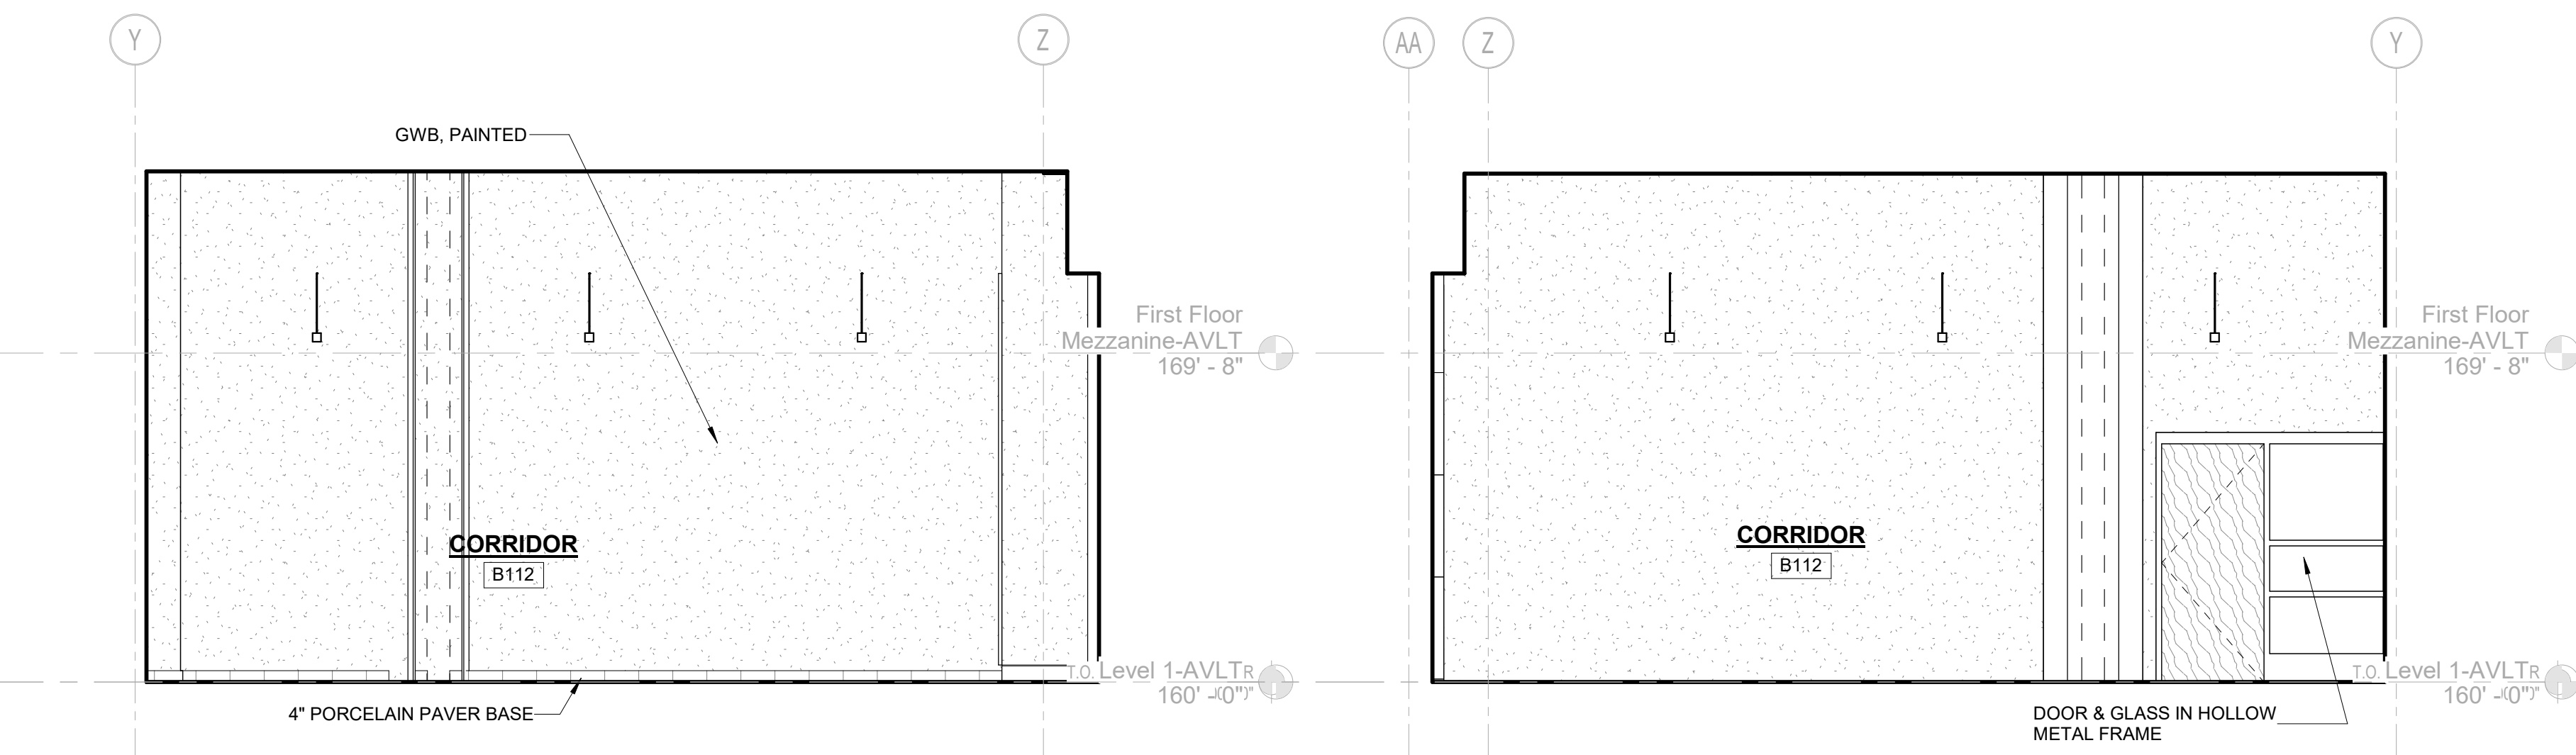


3 CORRIDOR B112 - NORTH
1/4" = 1'-0"

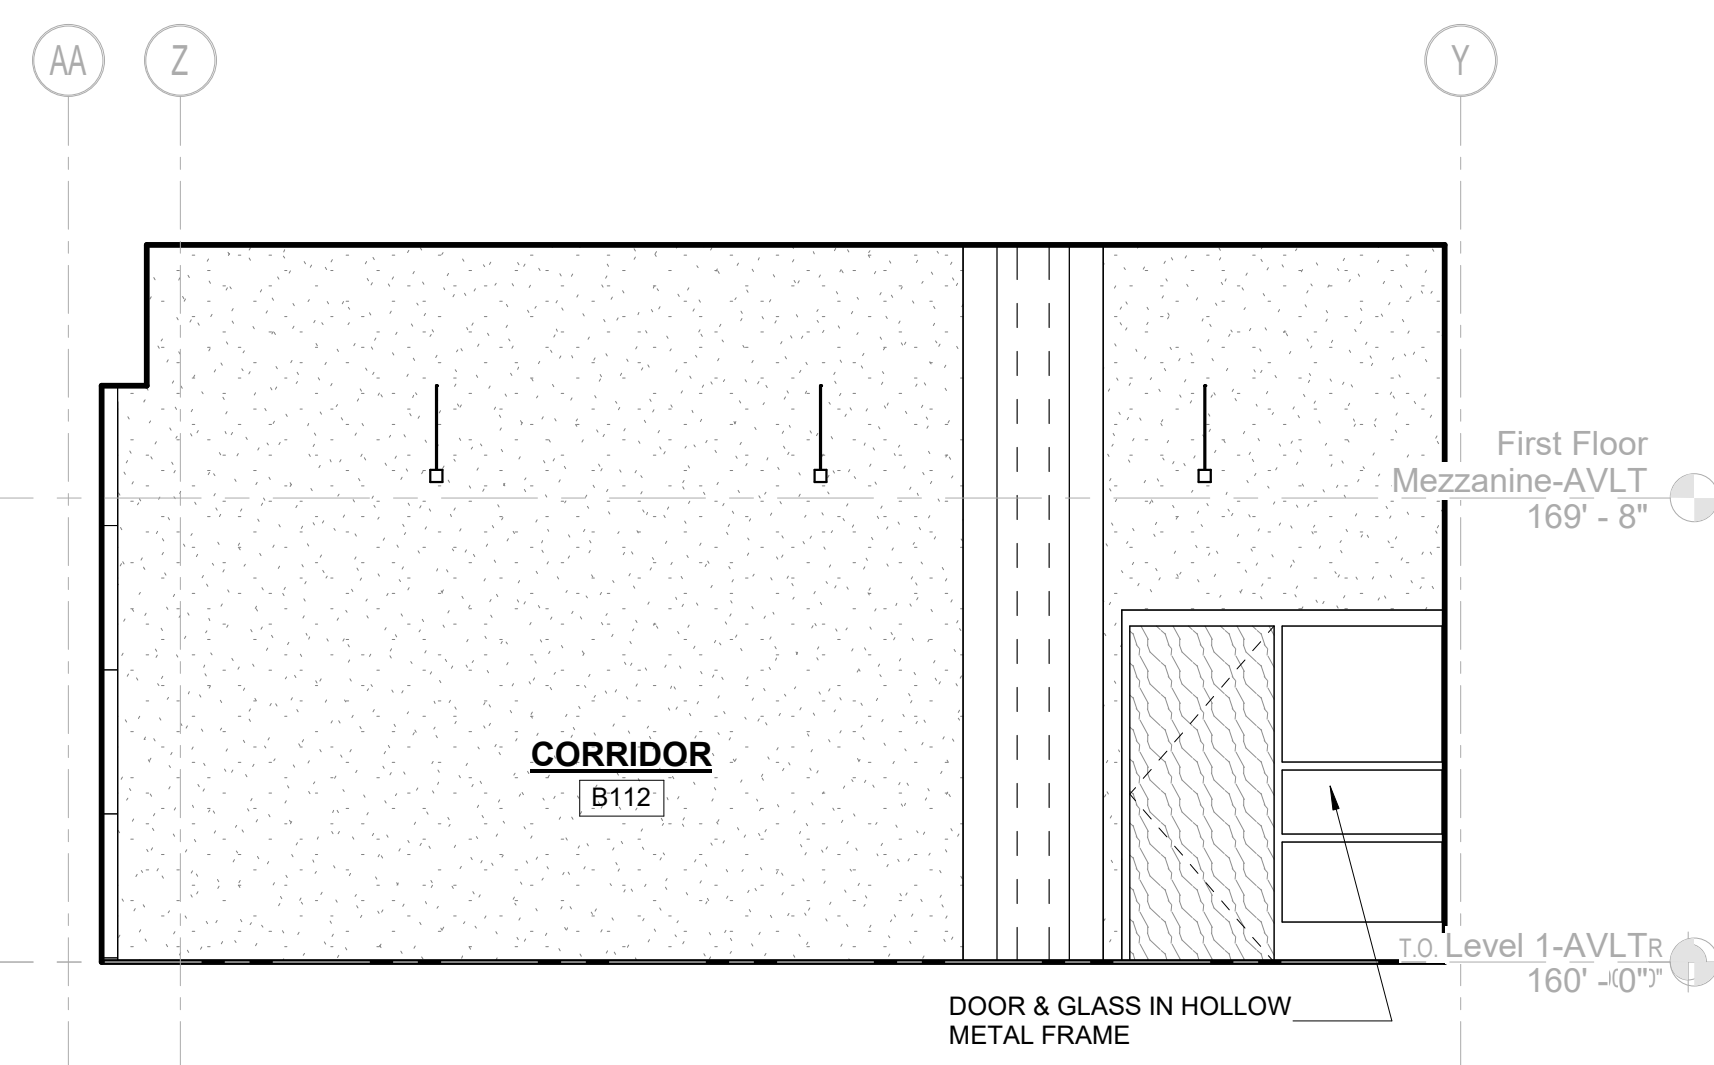

4 CORRIDOR B112 - SOUTH
1/4" = 1'-0"

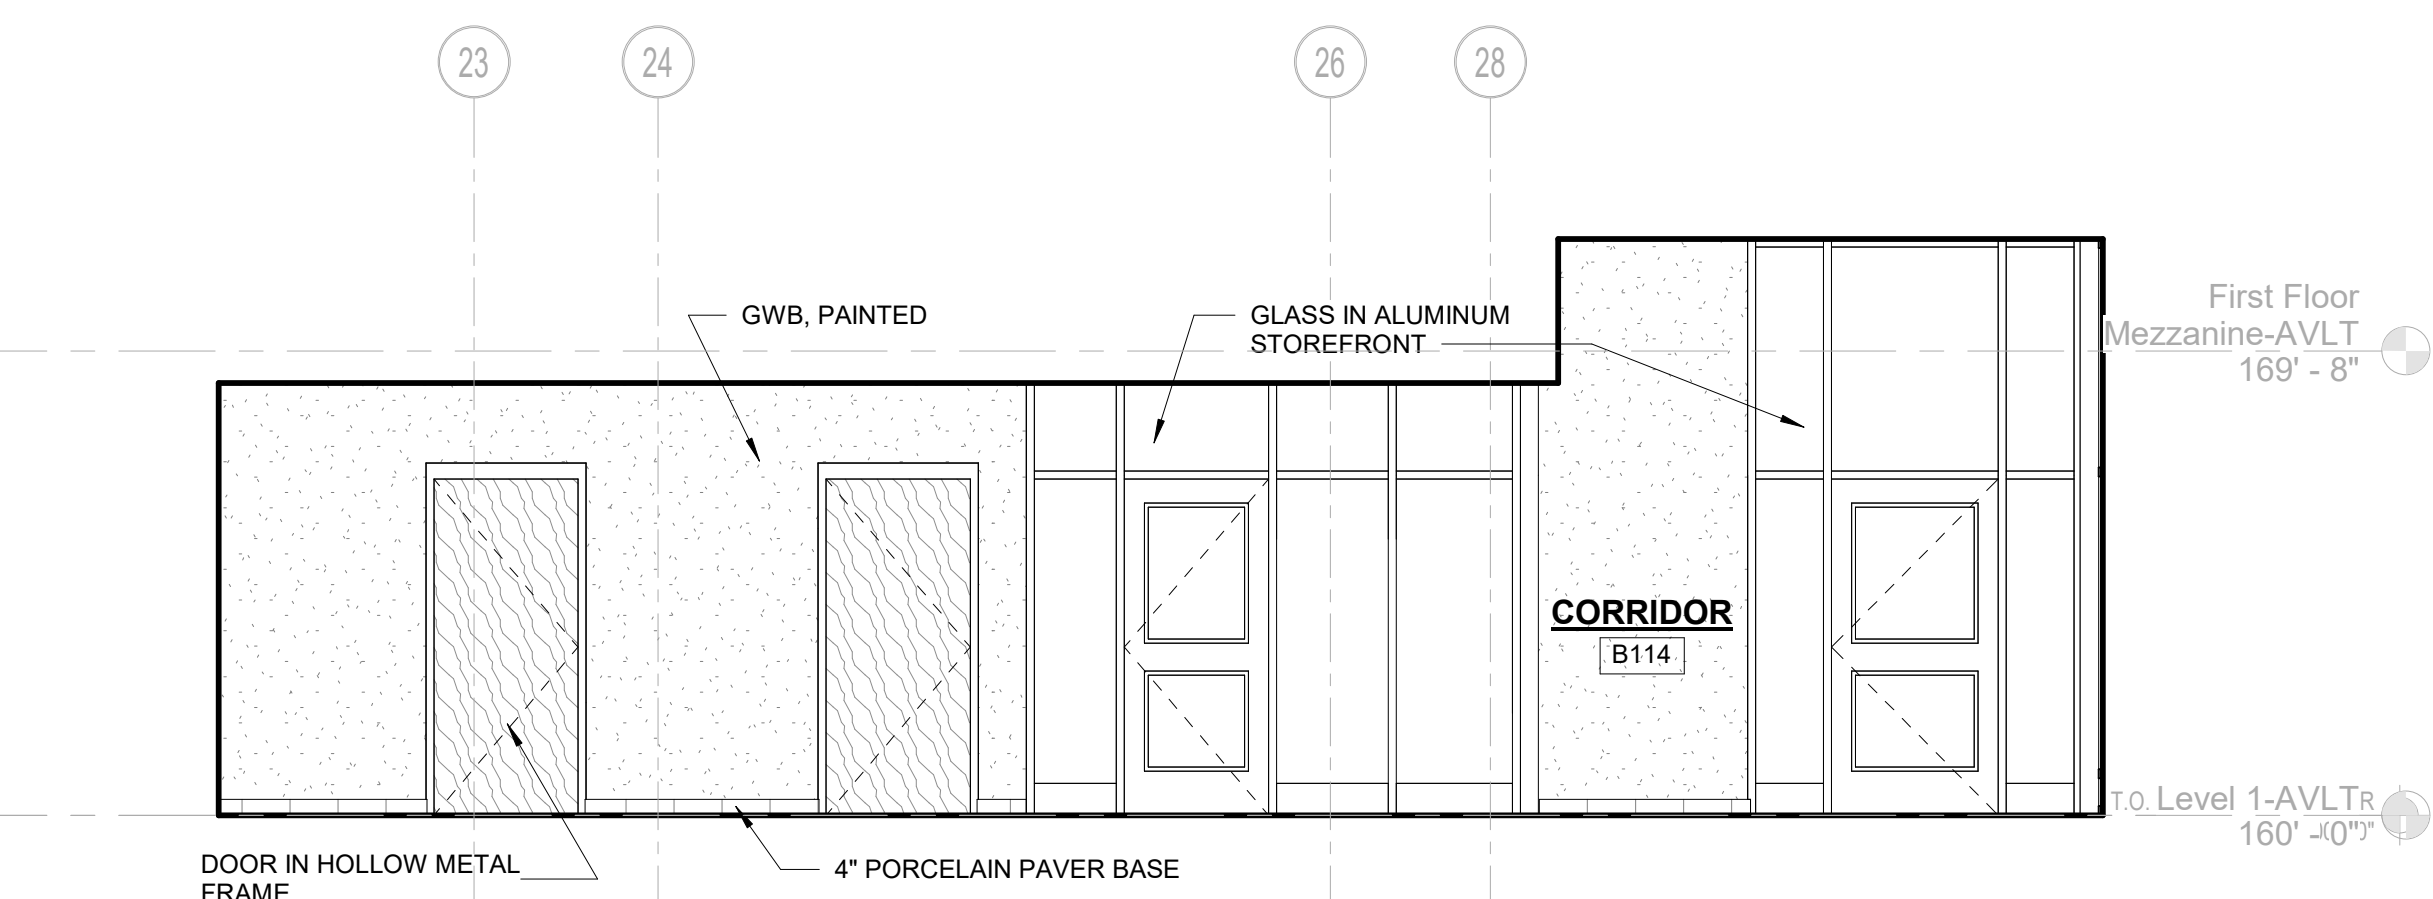


1 CORRIDOR B114 - EAST
1/4" = 1'-0"

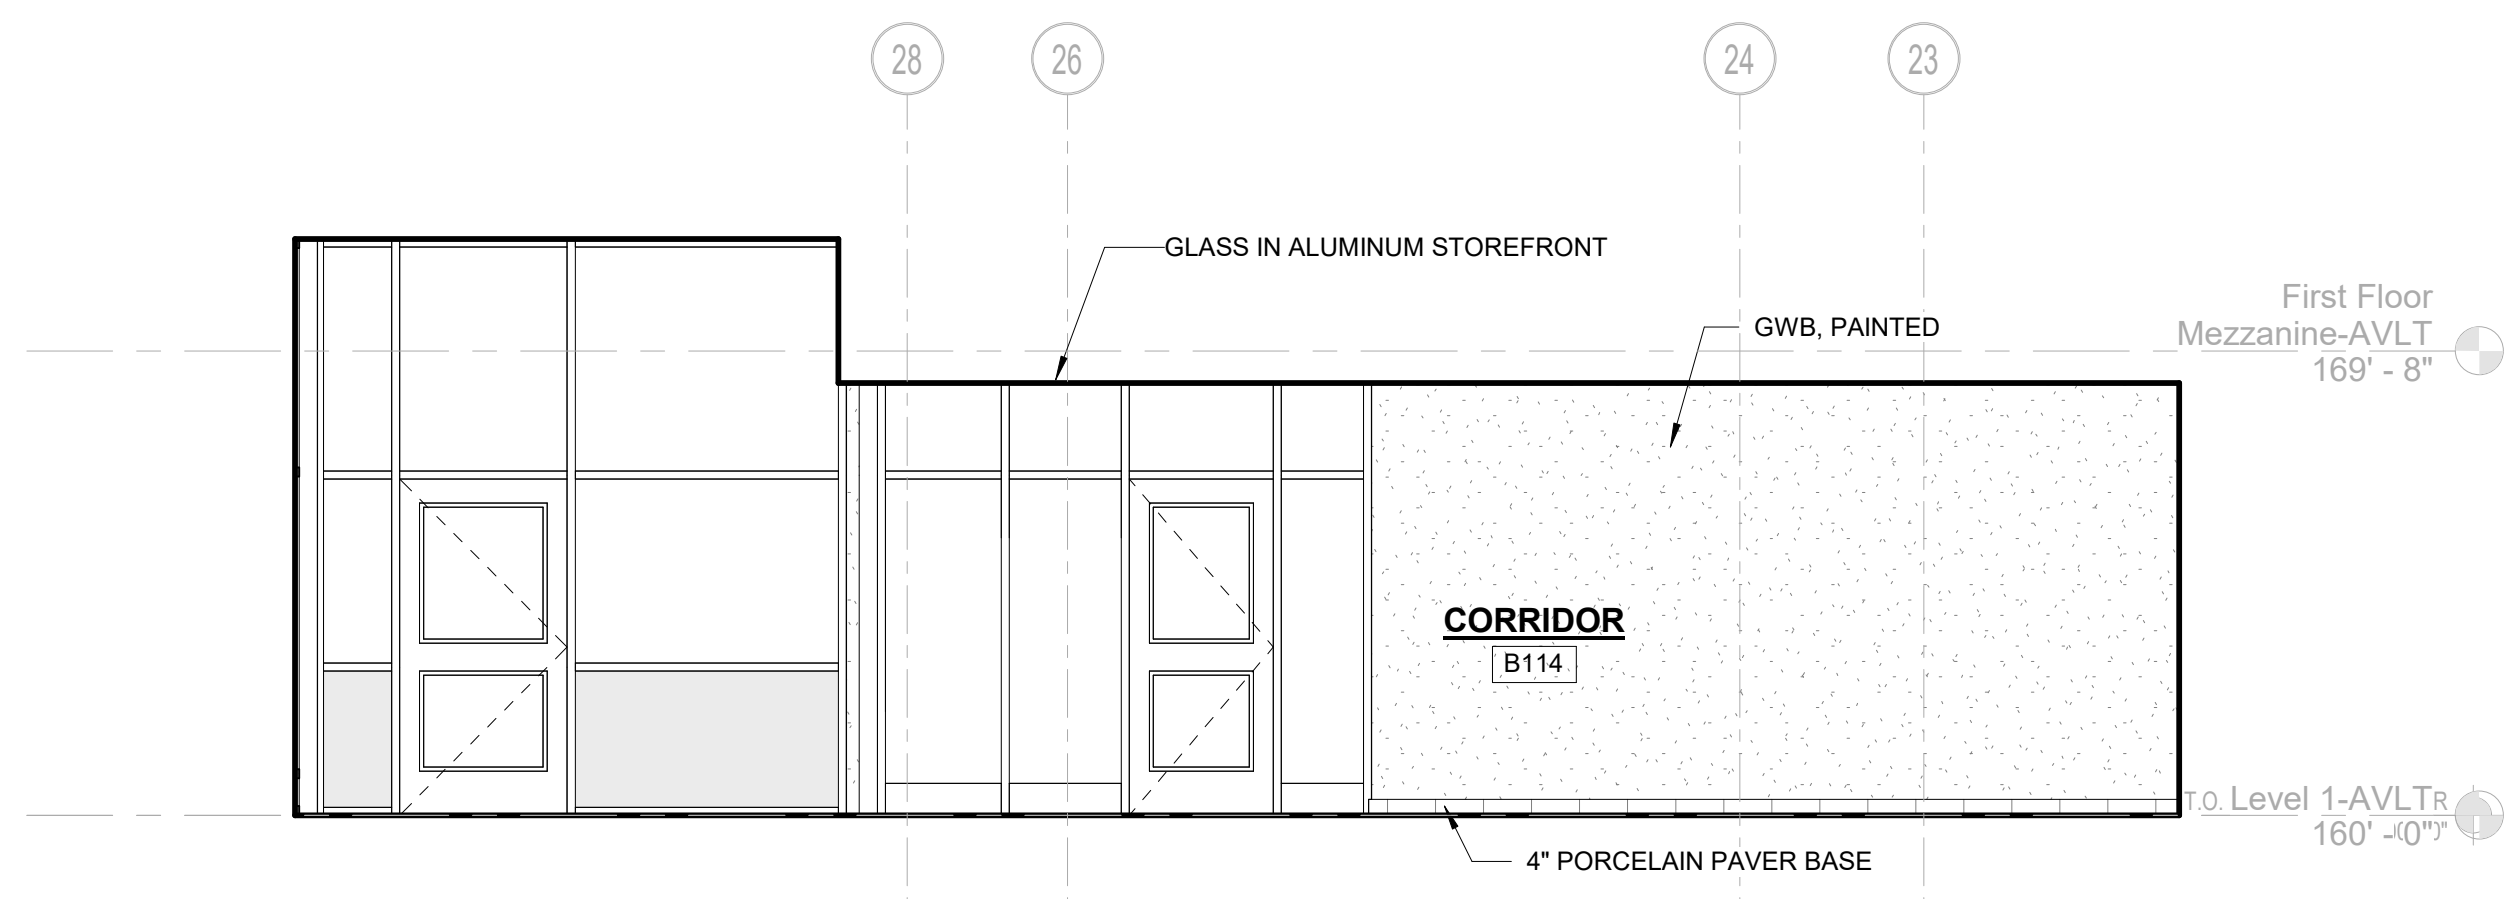


2 CORRIDOR B114 - WEST
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

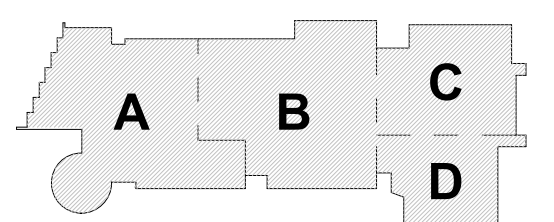





KEY PLAN

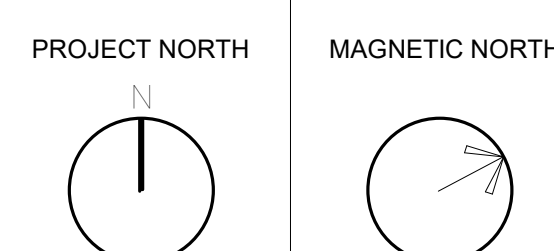


**INTERIOR
ELEVATIONS**

Scale: 1/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A2-2-13

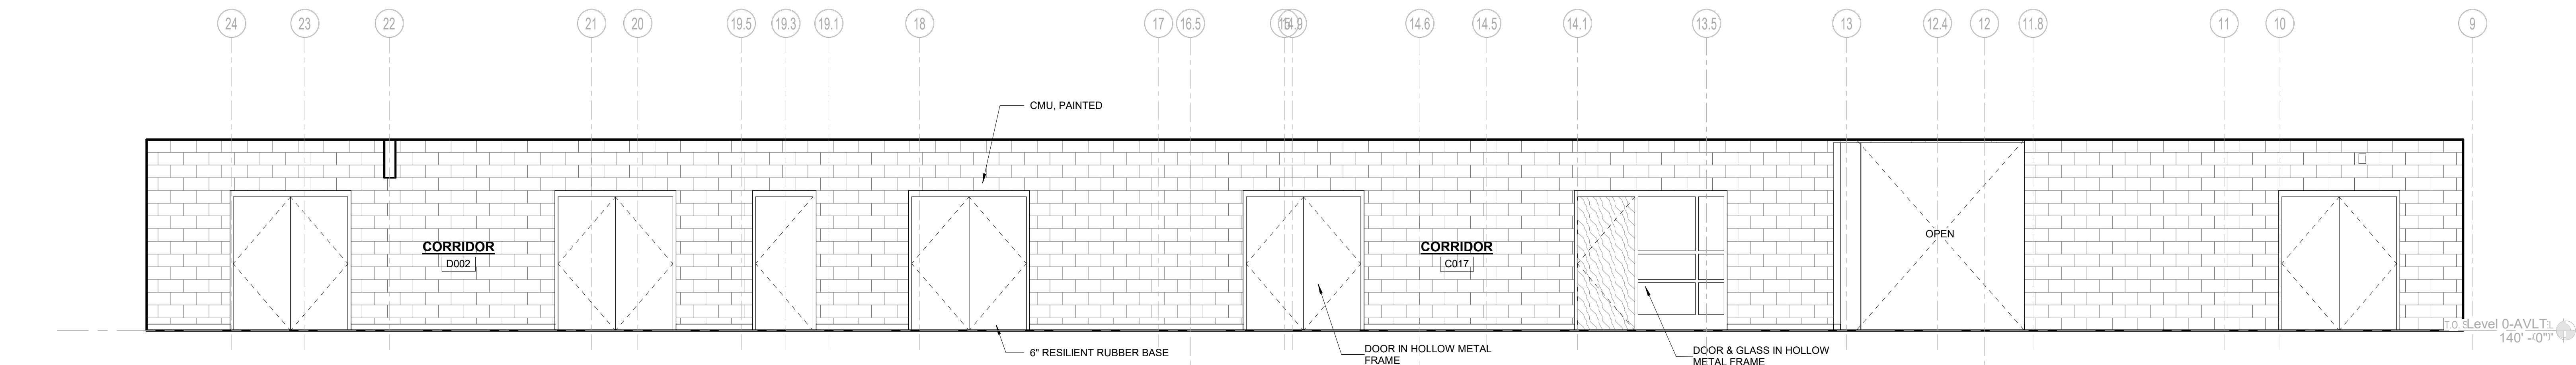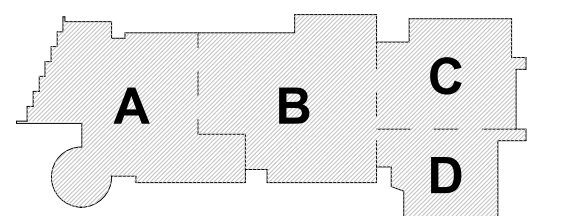

7 CORRIDOR C017 - WEST
1/4" = 1'-0"

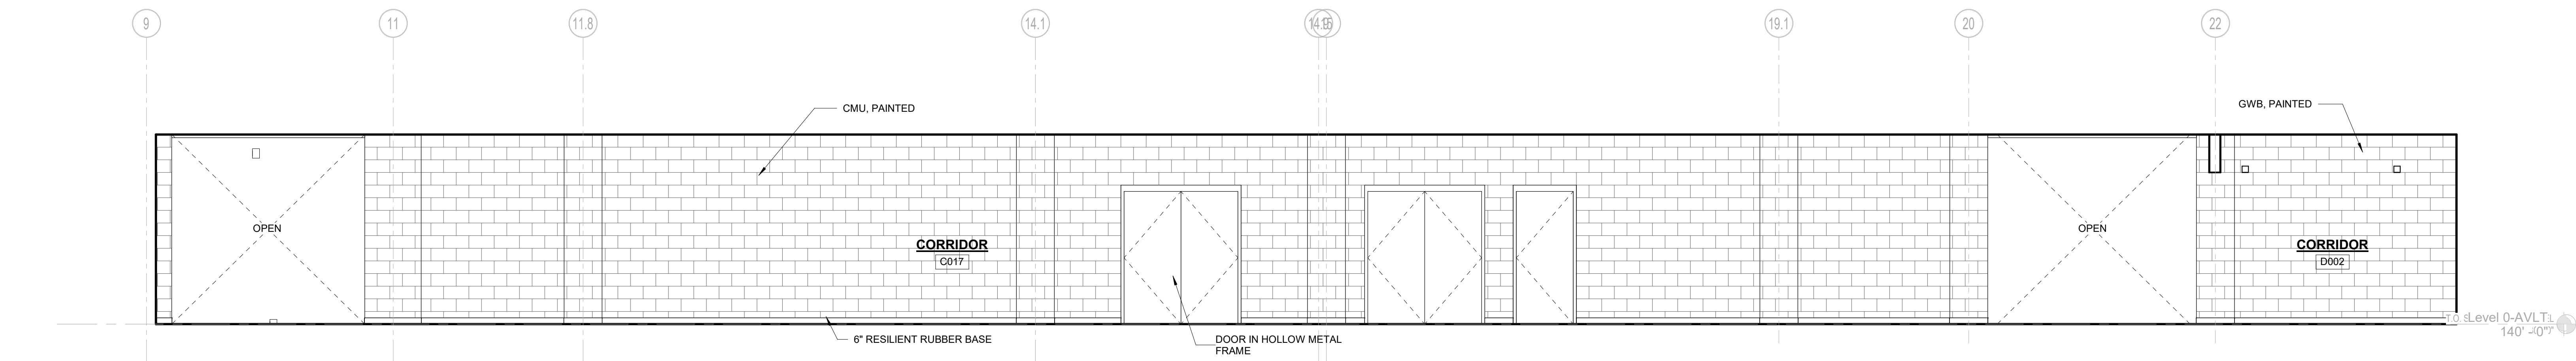


6 CORRIDOR C017 - EAST
1/4" = 1'-0"

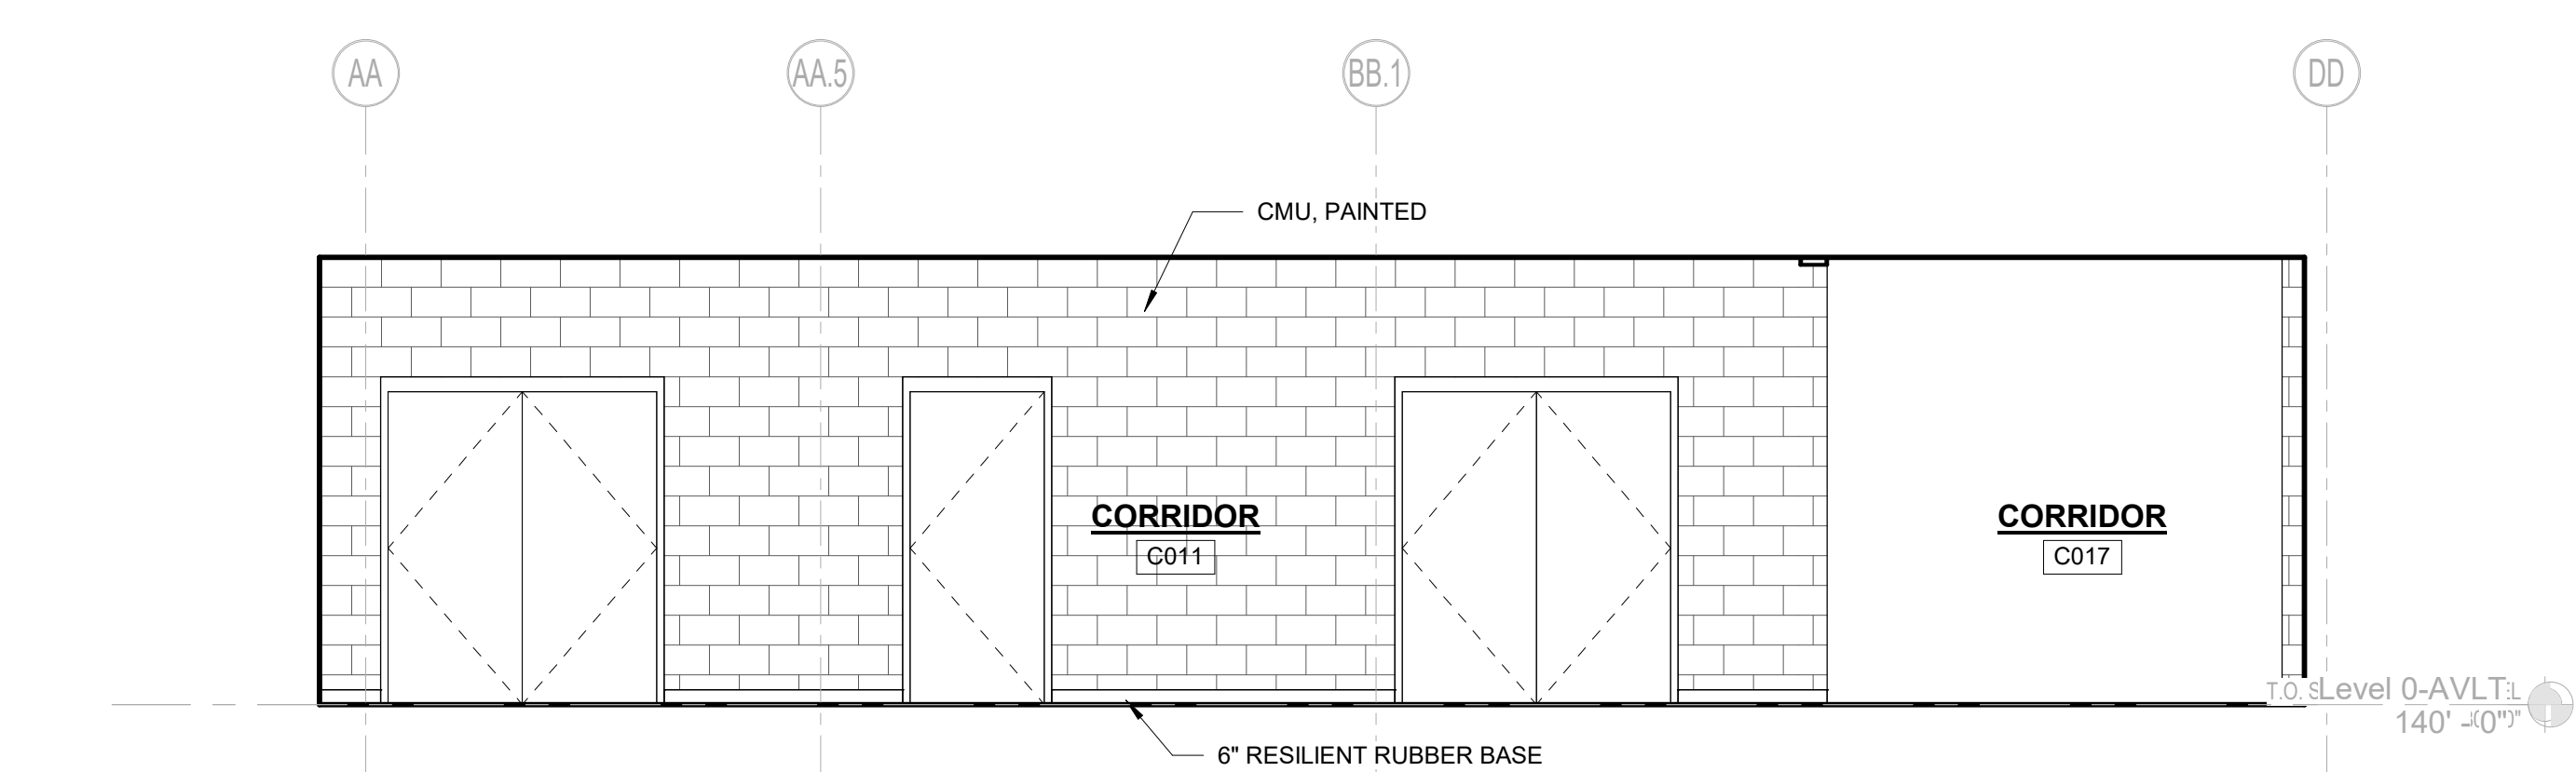


4 CORRIDOR C011 - NORTH
1/4" = 1'-0"



5 CORRIDOR C011 - SOUTH
1/4" = 1'-0"

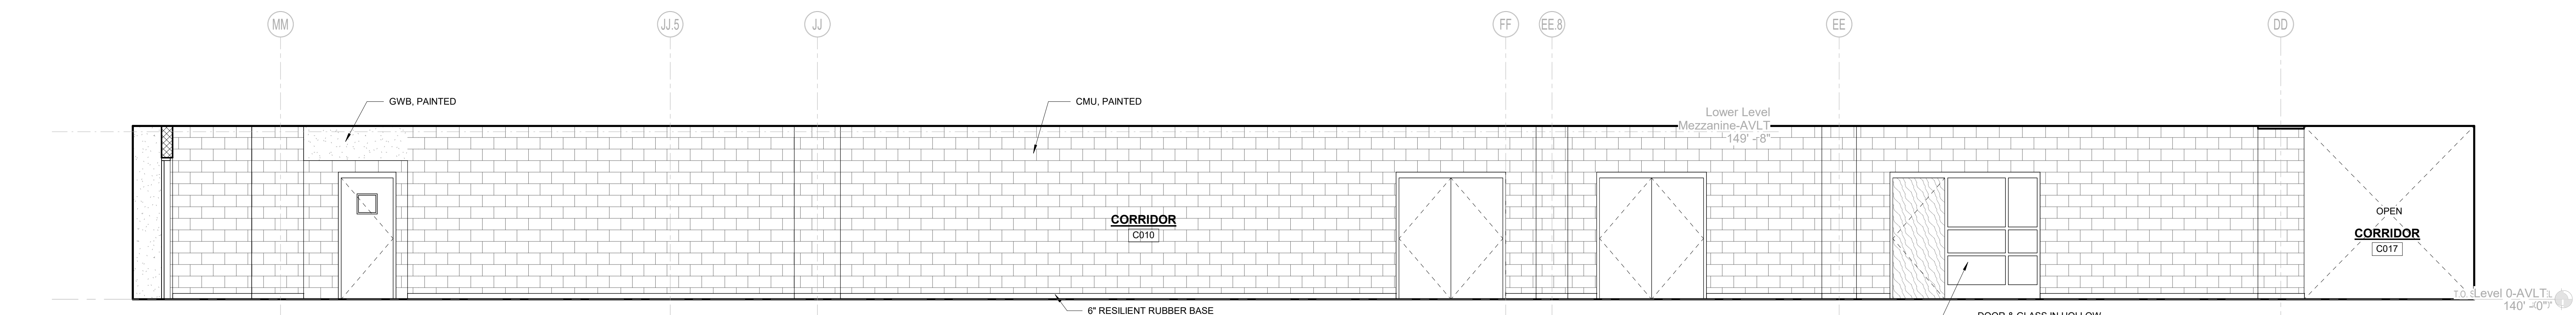

3 CORRIDOR C010 - SOUTH
1/4" = 1'-0"

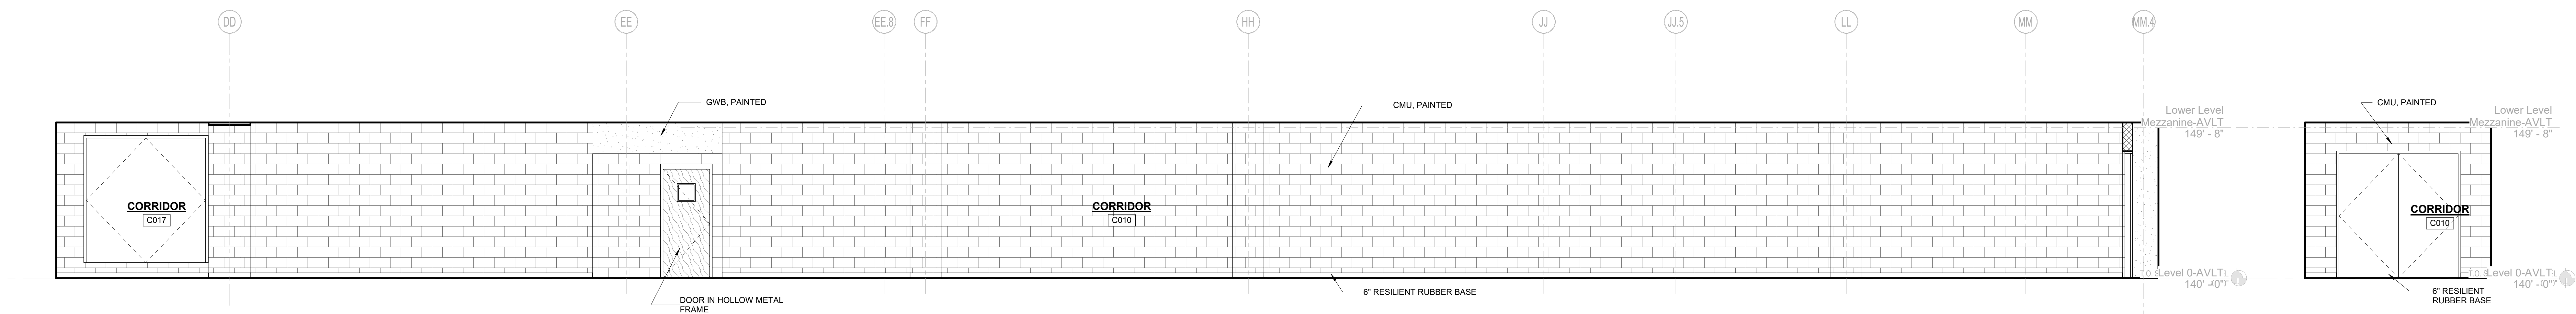

1 CORRIDOR C010 - NORTH
1/4" = 1'-0"

2 CORRIDOR C010 - EAST
1/4" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.

225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

INTERIOR
ELEVATIONS

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A2-2-15

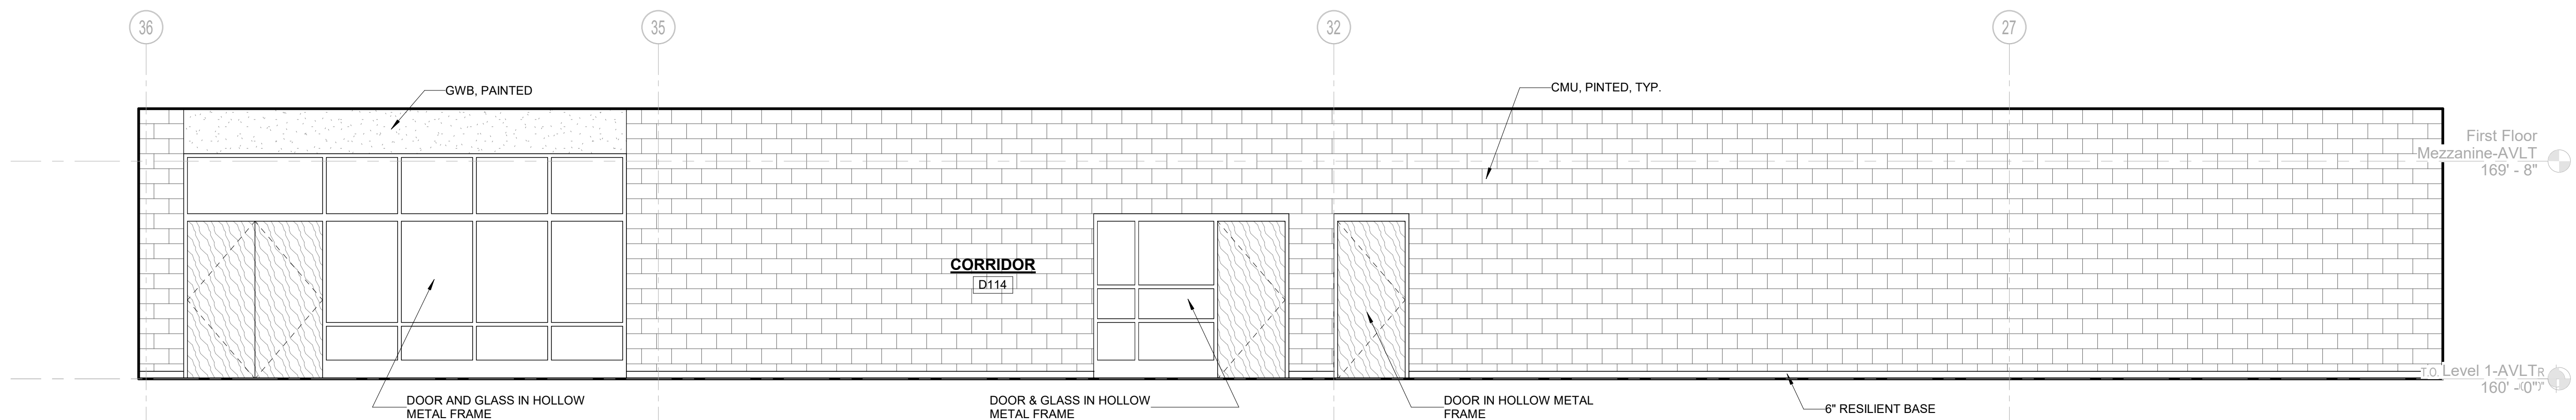


4 CORRIDOR D114 - WEST
1/4" = 1'-0"

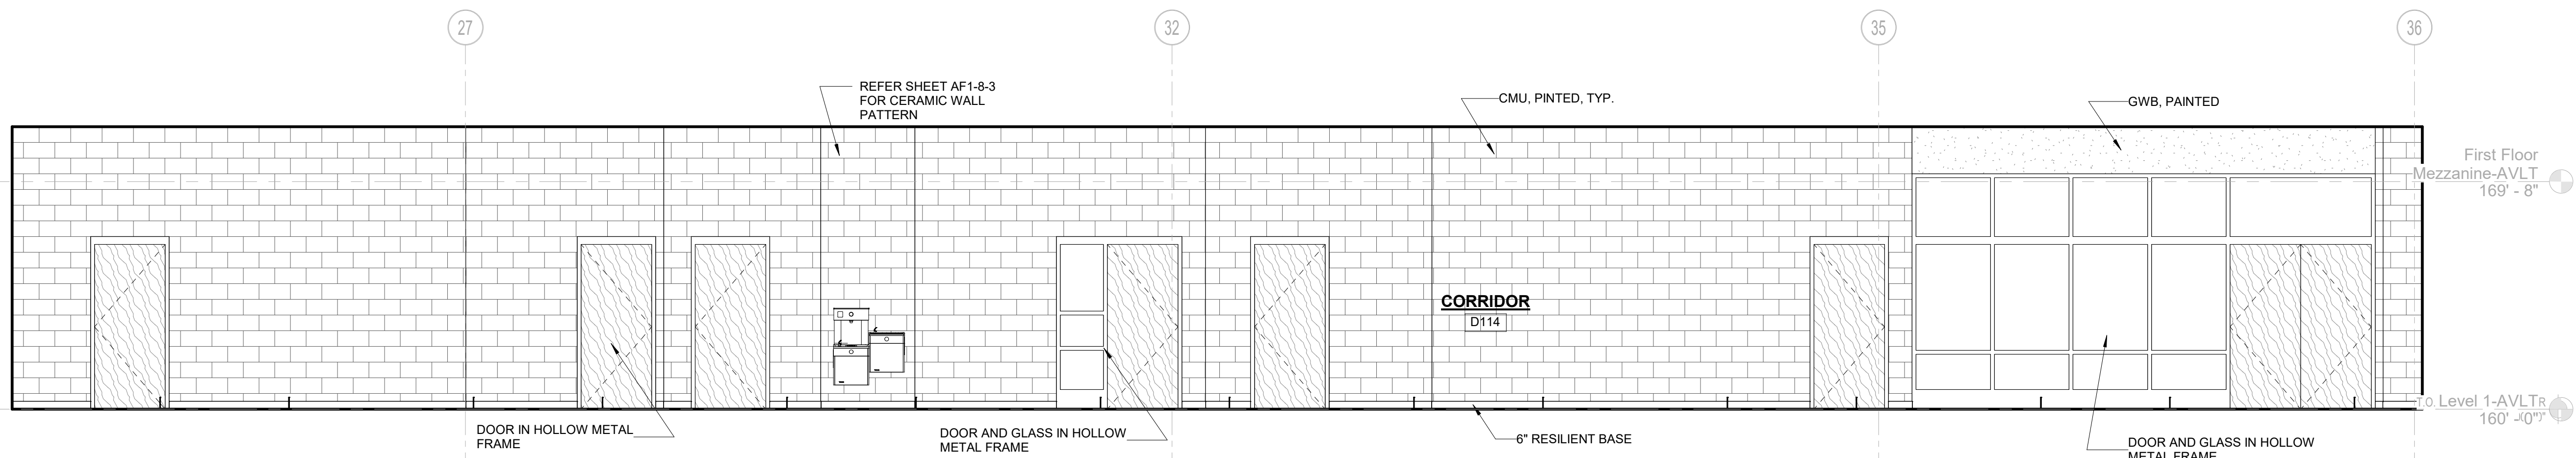

3 CORRIDOR D114 - EAST
1/4" = 1'-0"

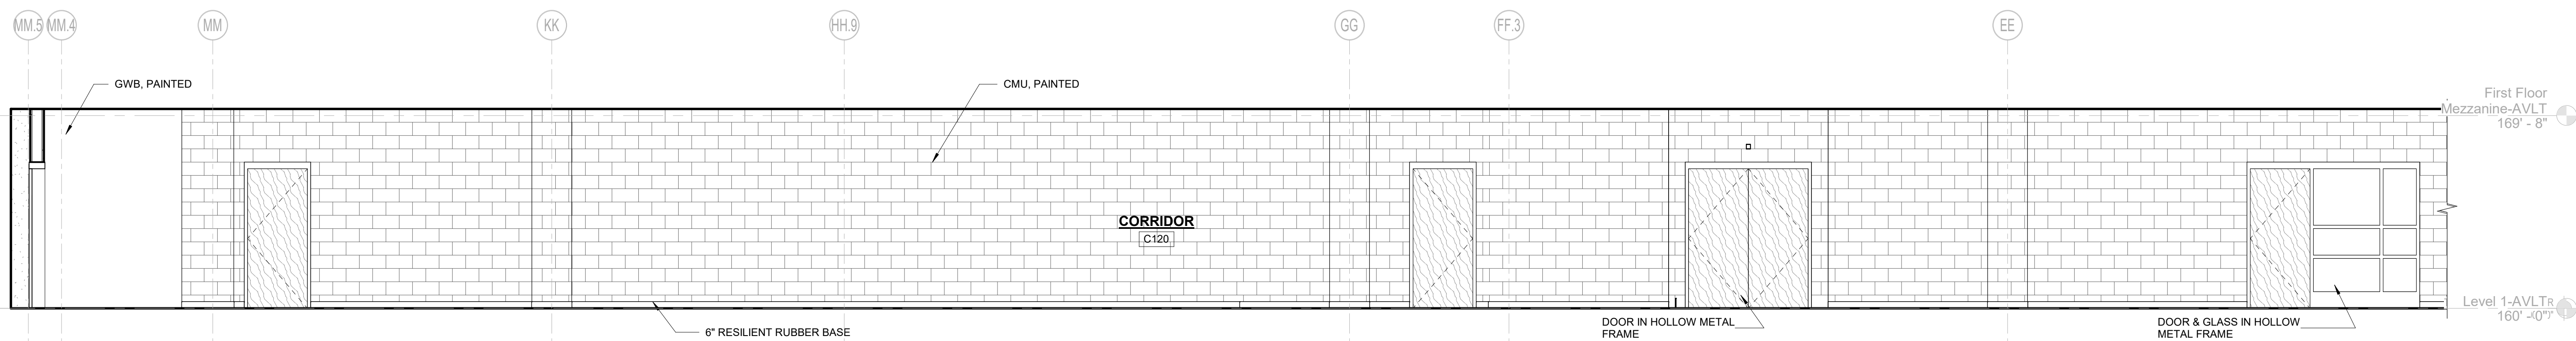

2 CORRIDOR C120 - SOUTH
1/4" = 1'-0"

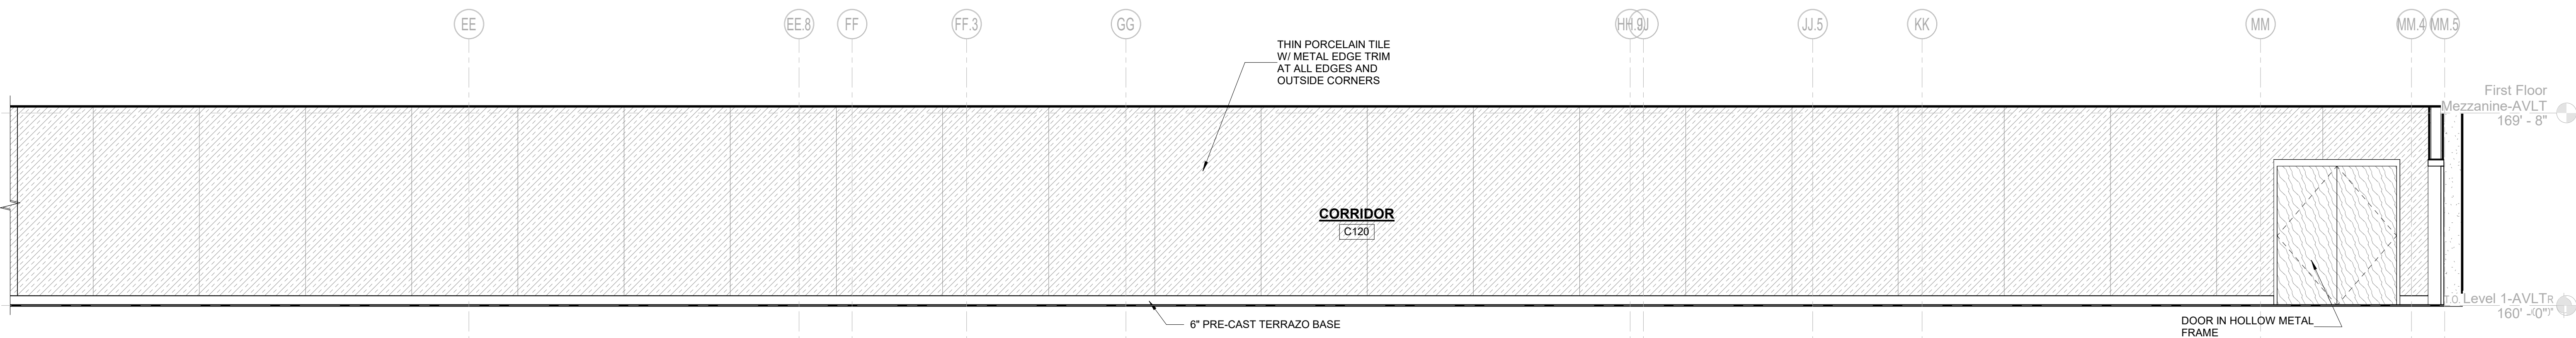


1 CORRIDOR C120 - NORTH
1/4" = 1'-0"



Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Planning | Architecture | Interior Design
Tel: 617.854.1700
www.draa.com


Northeast
Metropolitan
Regional
Vocational High
School
100 Hemlock Road,
Wakefield, MA 01880

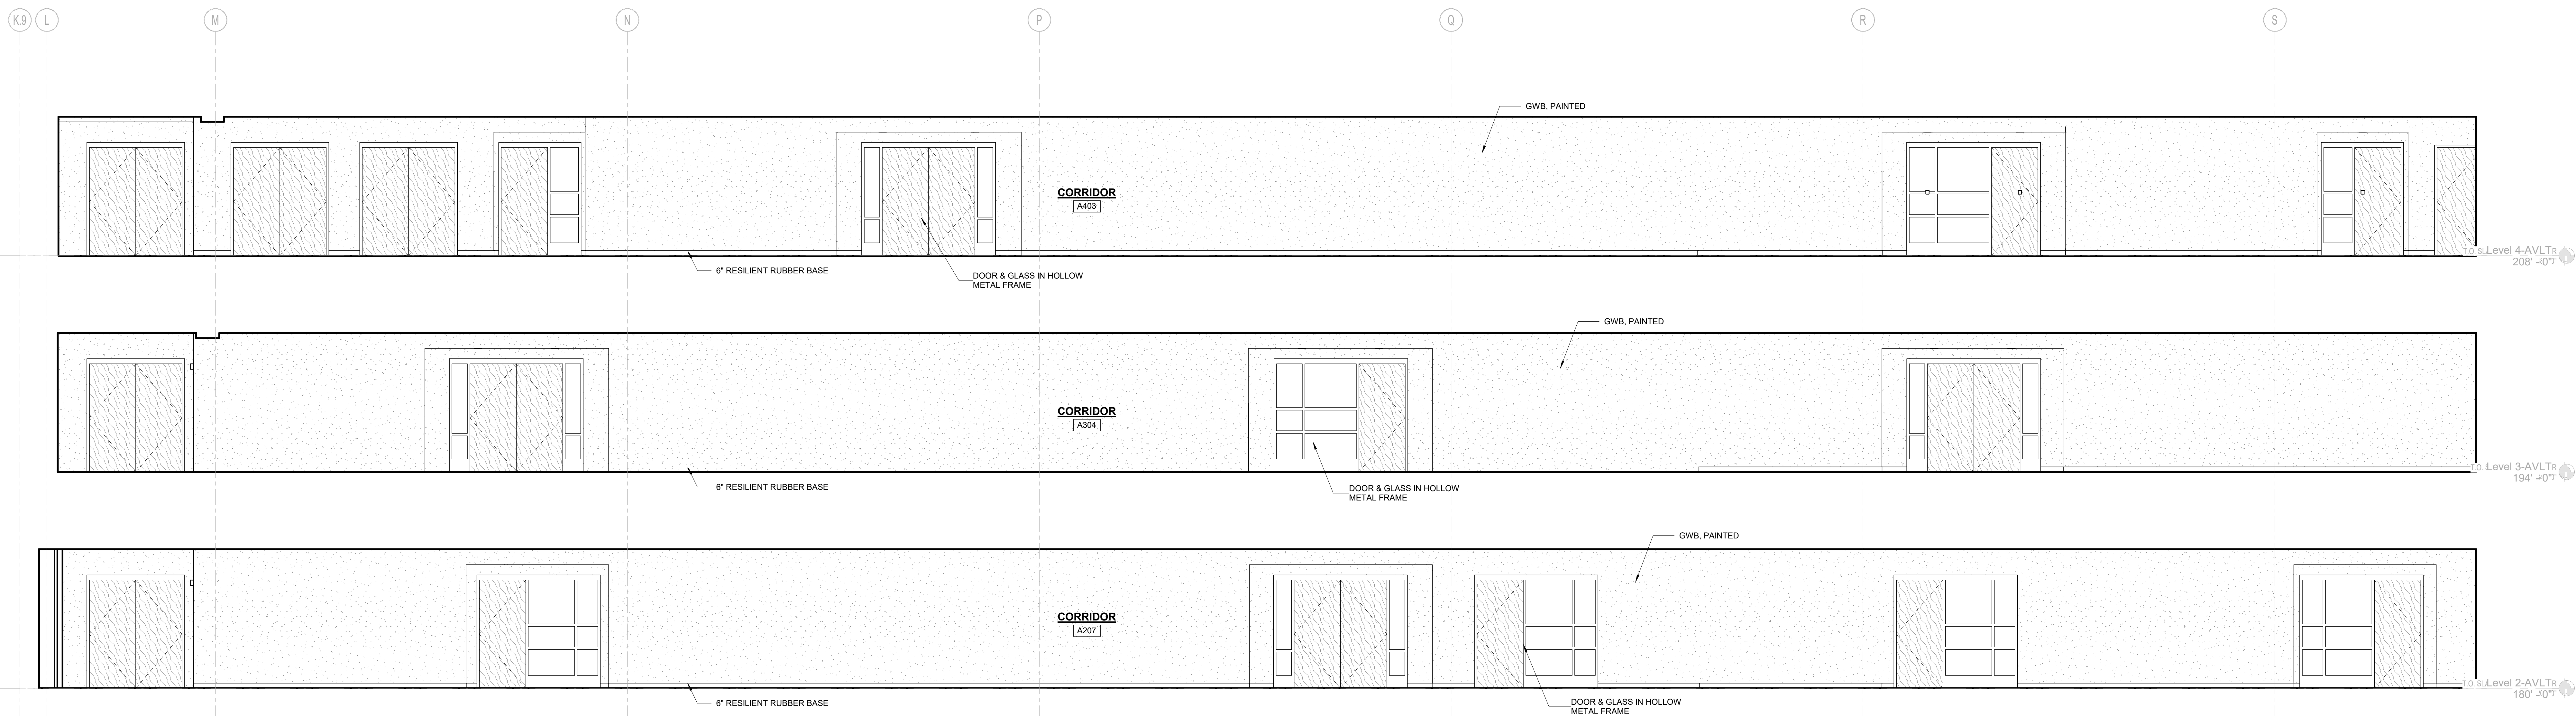

1 CORRIDOR A207, A304 AND A403 - NORTH (LEFT)
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

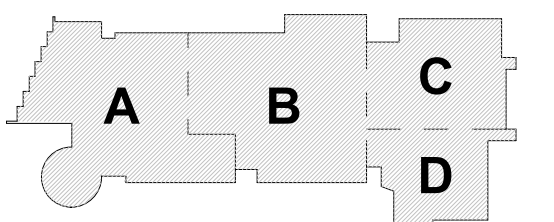

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

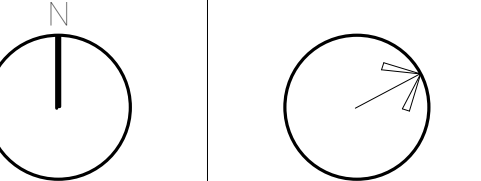


INTERIOR
ELEVATIONS

Scale: 1/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A2-2-16

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

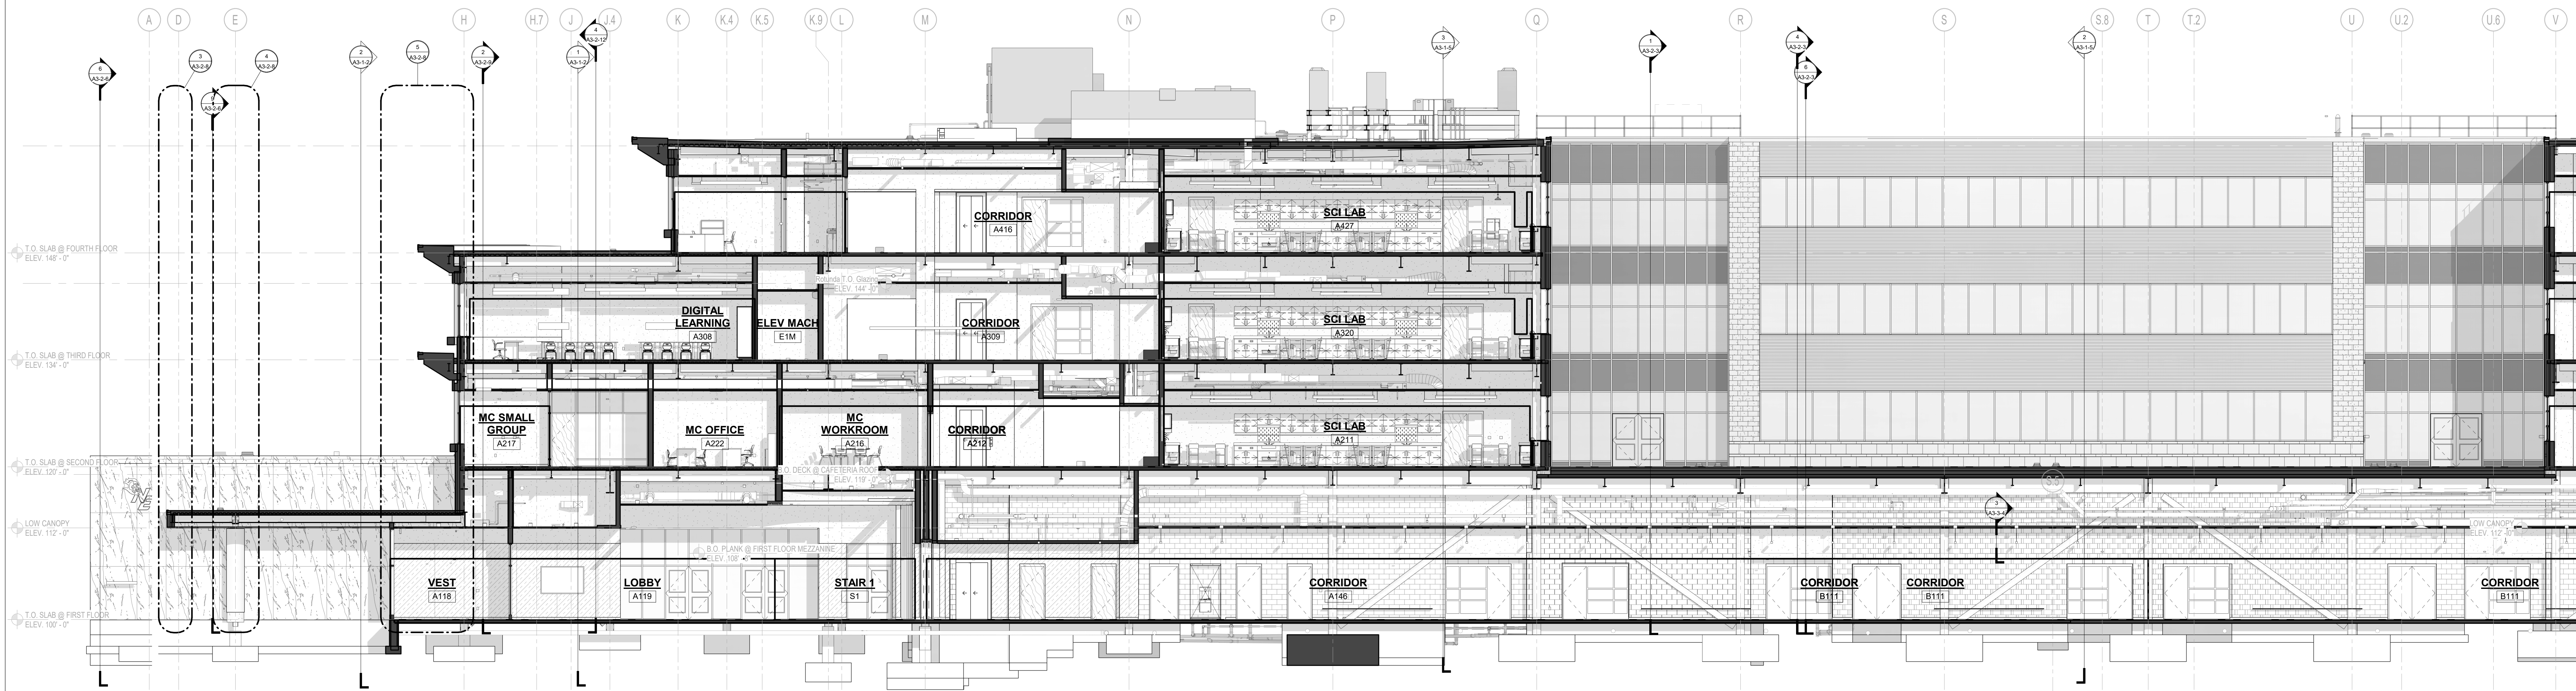

1 BUILDING SECTION - MAIN ENTRANCE
1/8" = 1'-0"

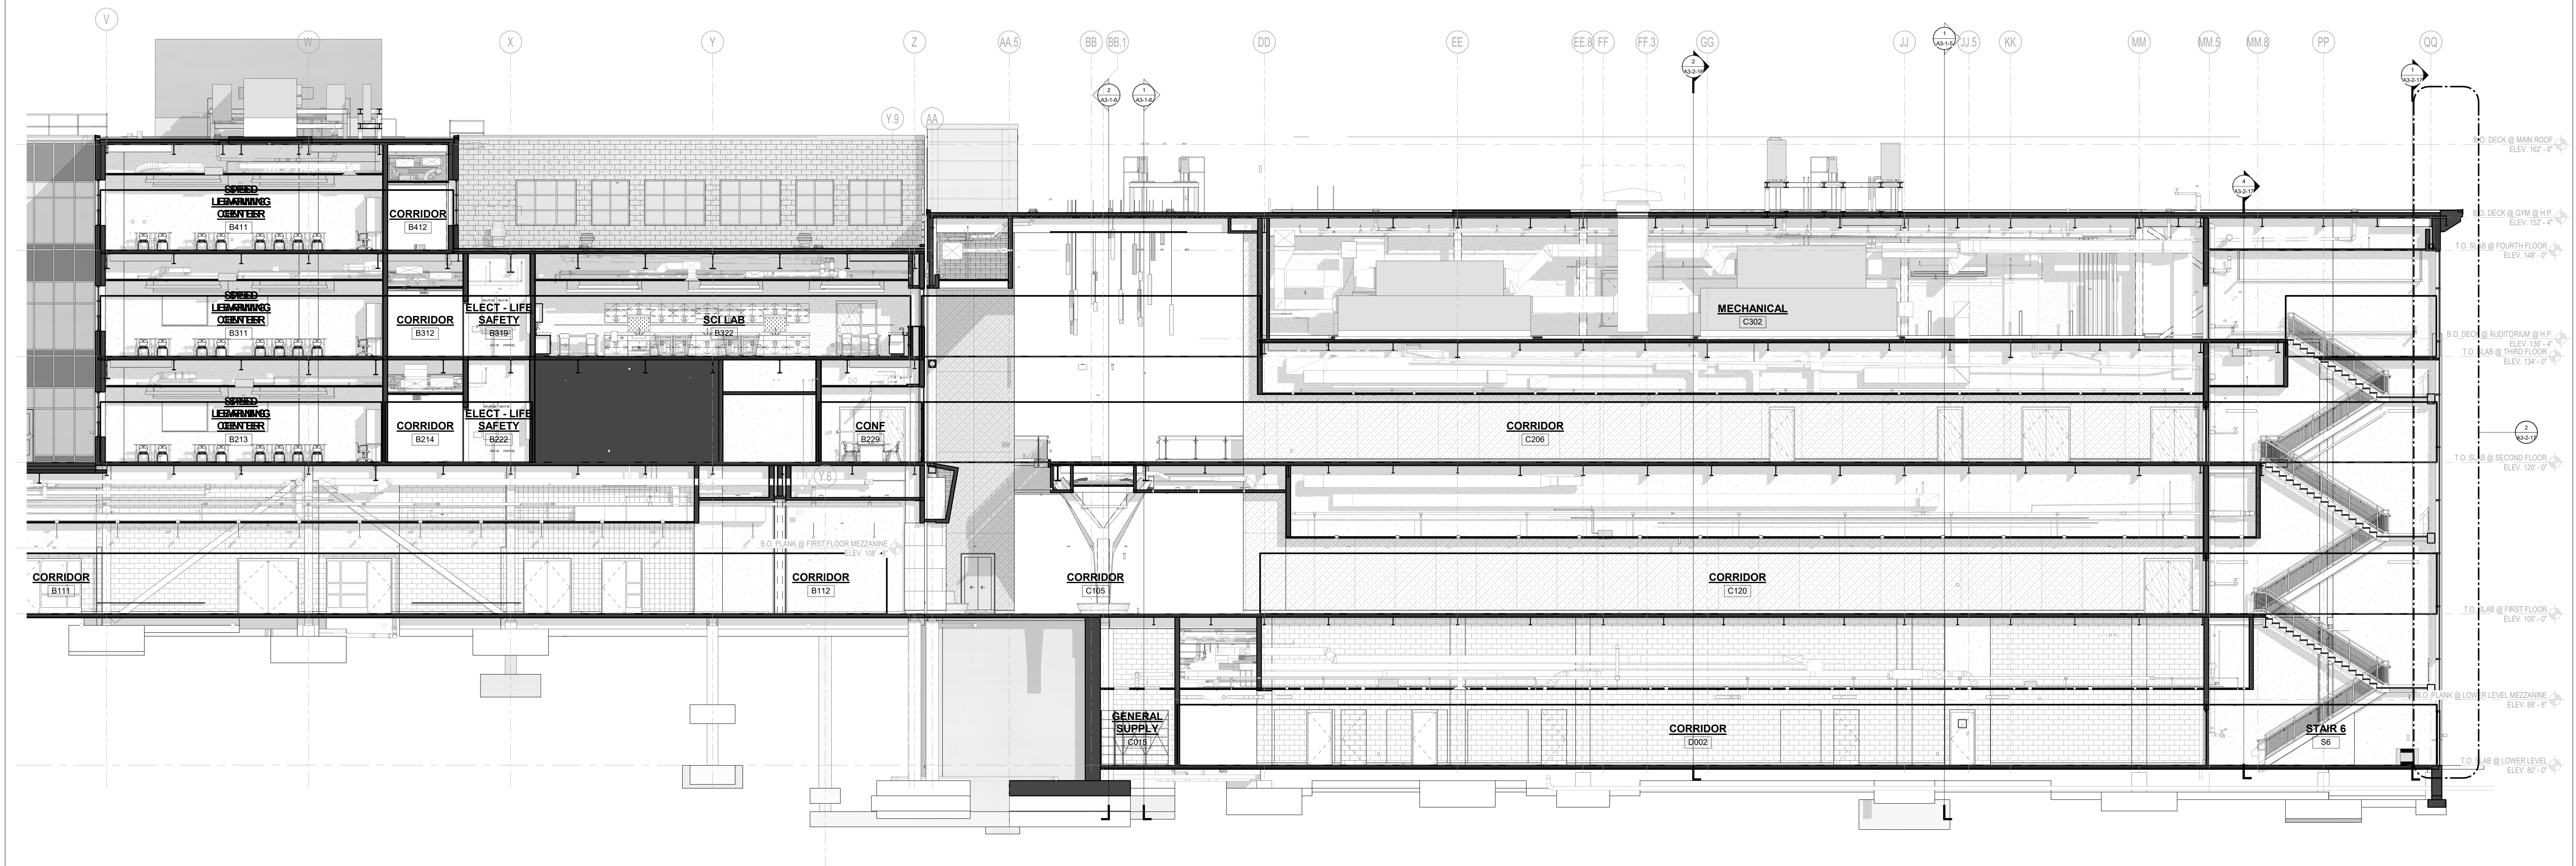


2 BUILDING SECTION - ATRIUM NEAR GYM/AUDITORIUM
1/8" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

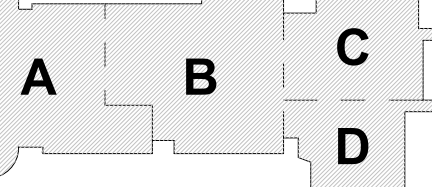


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
SECTIONS**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA



Date: May 12TH, 2023

Volume 3 of 4

A3-1-1

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

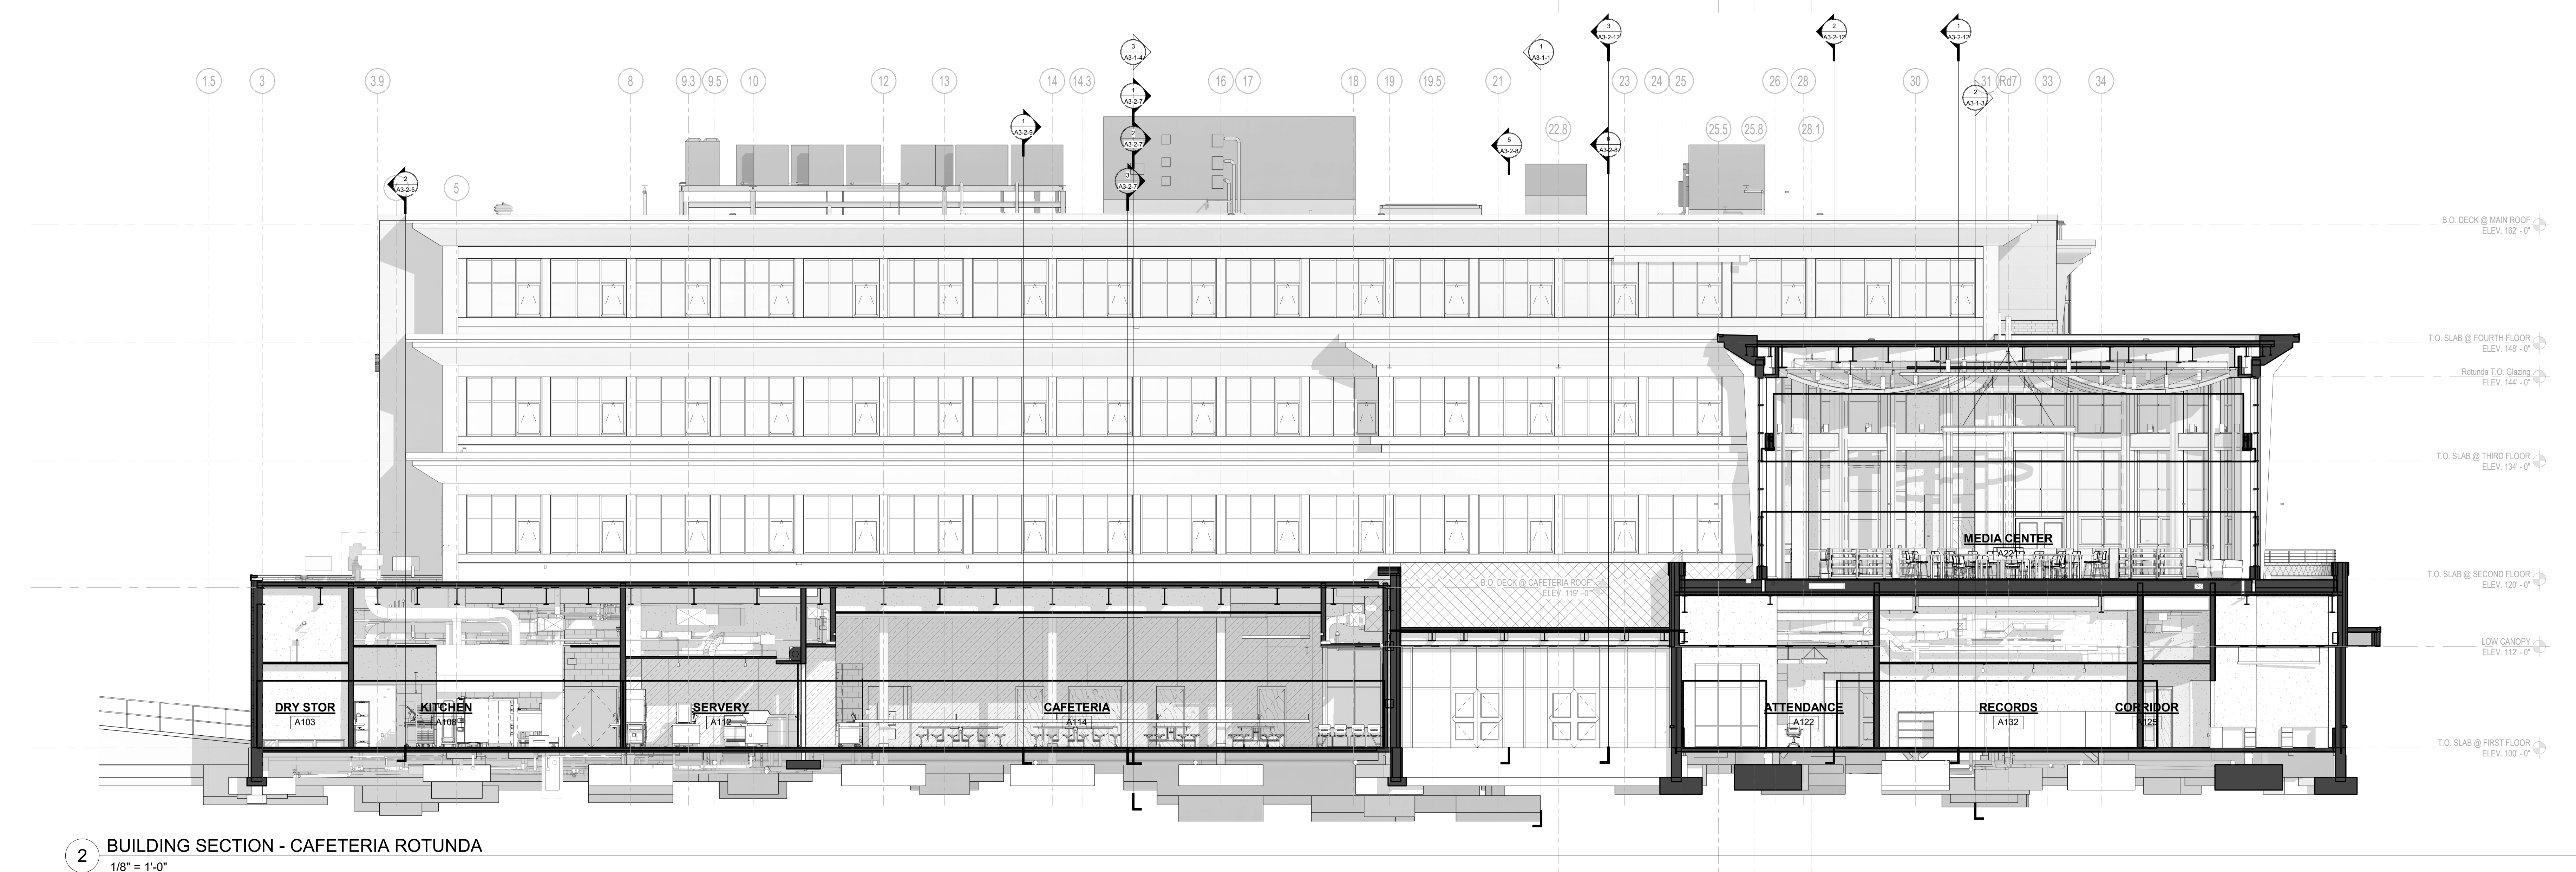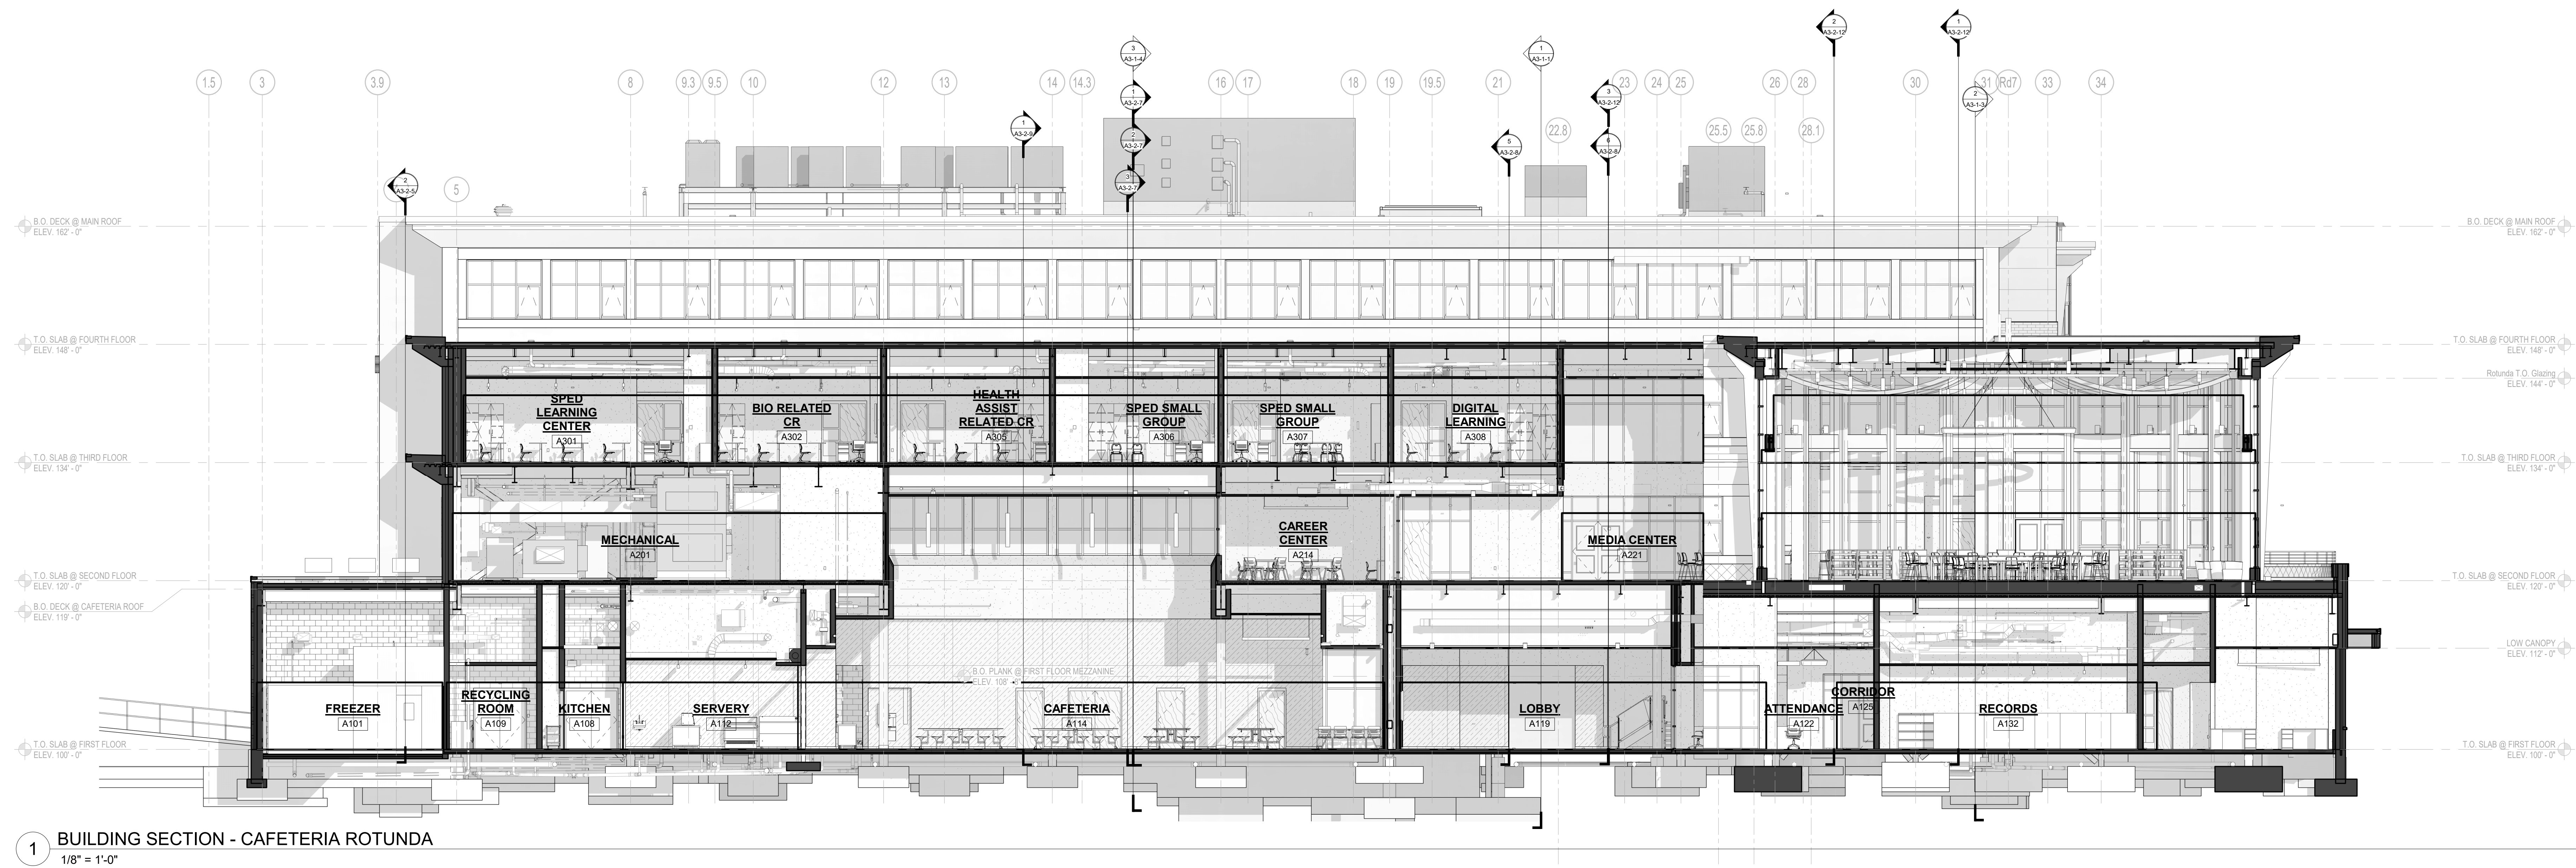

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023




KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
SECTIONS**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4


A3-1-2

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION



May 12TH, 2023

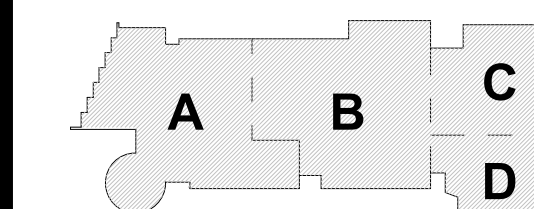

KEY PLAIN

PROJECT NORT

MAGNETIC NORTH



BUILDING SECTIONS

Scale: 1/8" = 1'-0"

Job No. 30302

DOI: 10.1002/for

Drawn By: DRA
Date: May 12TH 2003


A3-1-3

Volume 3 of


100 Hemlock Road,
Wakefield, MA 01880



MSBA 90% CD
SUBMISSION
May 12TH, 2023

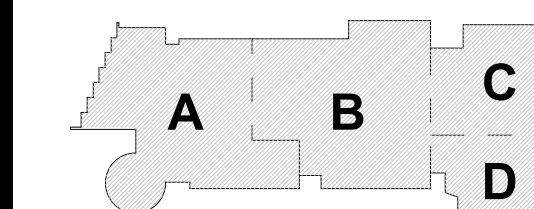

KEY PLAY

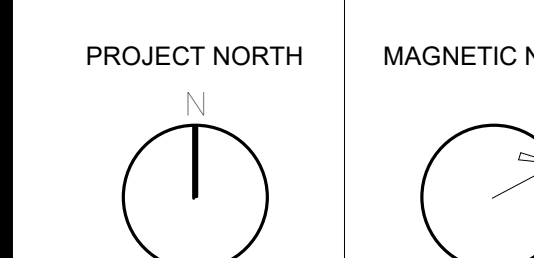


BUILDING SECTIONS

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Tel: 617.854.1700
www.draa.com


Planning | Architecture | Interior Design
**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

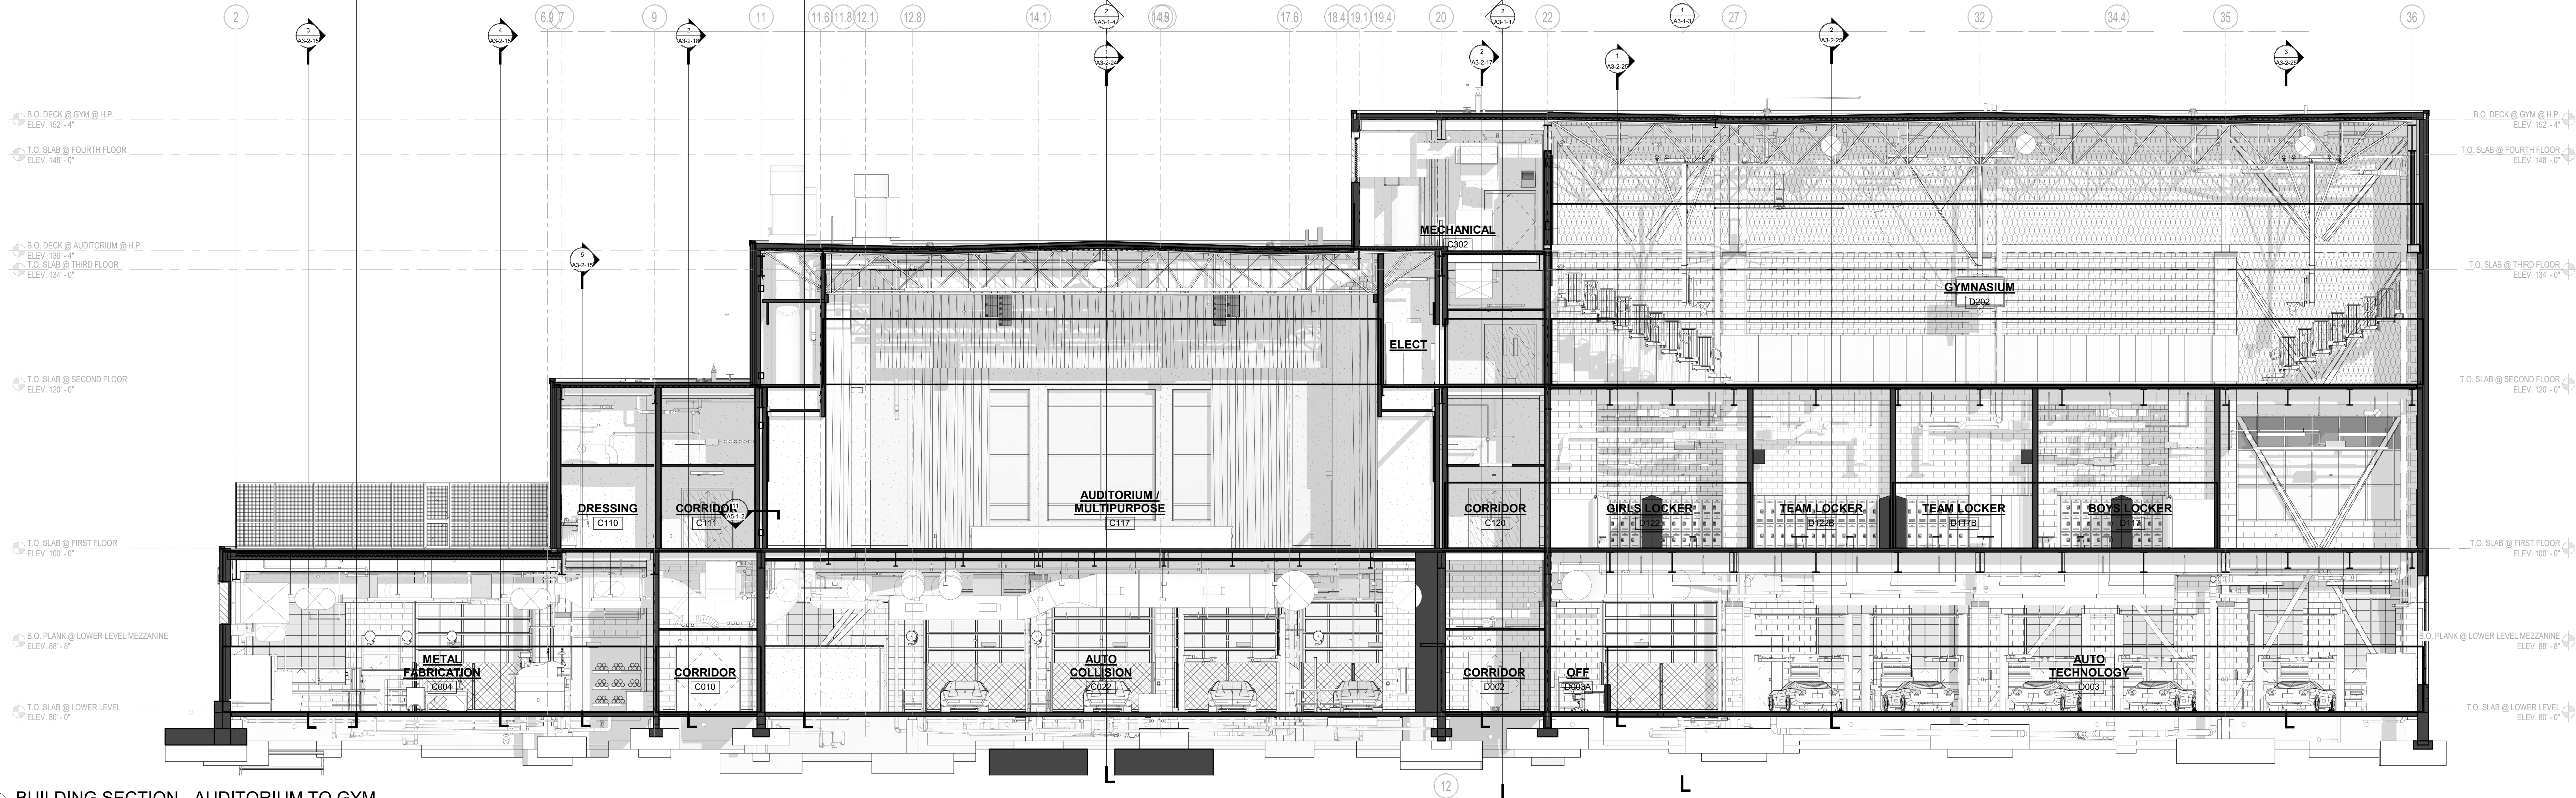

1 BUILDING SECTION - AUDITORIUM TO GYM
1/8" = 1'-0"

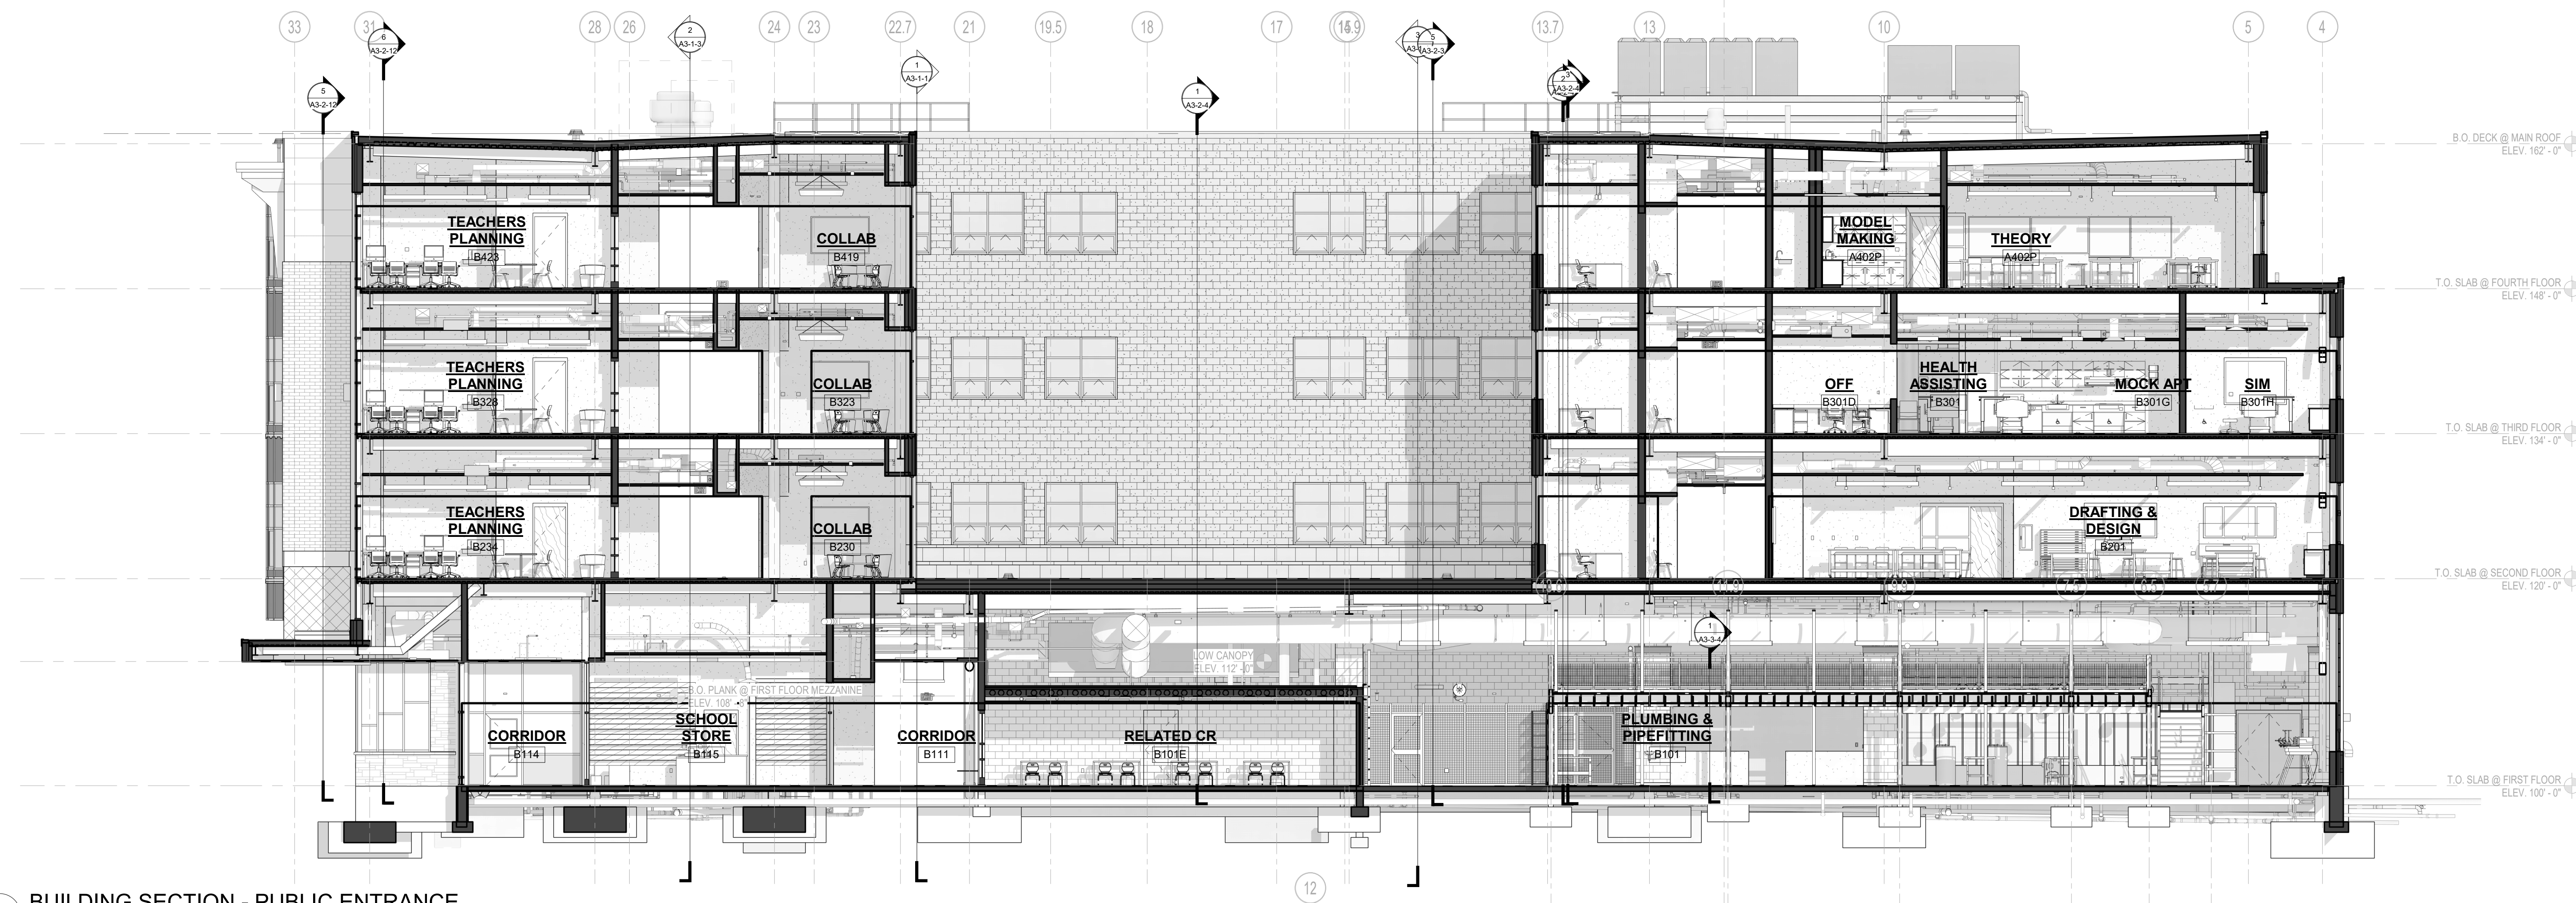


2 BUILDING SECTION - PUBLIC ENTRANCE
1/8" = 1'-0"

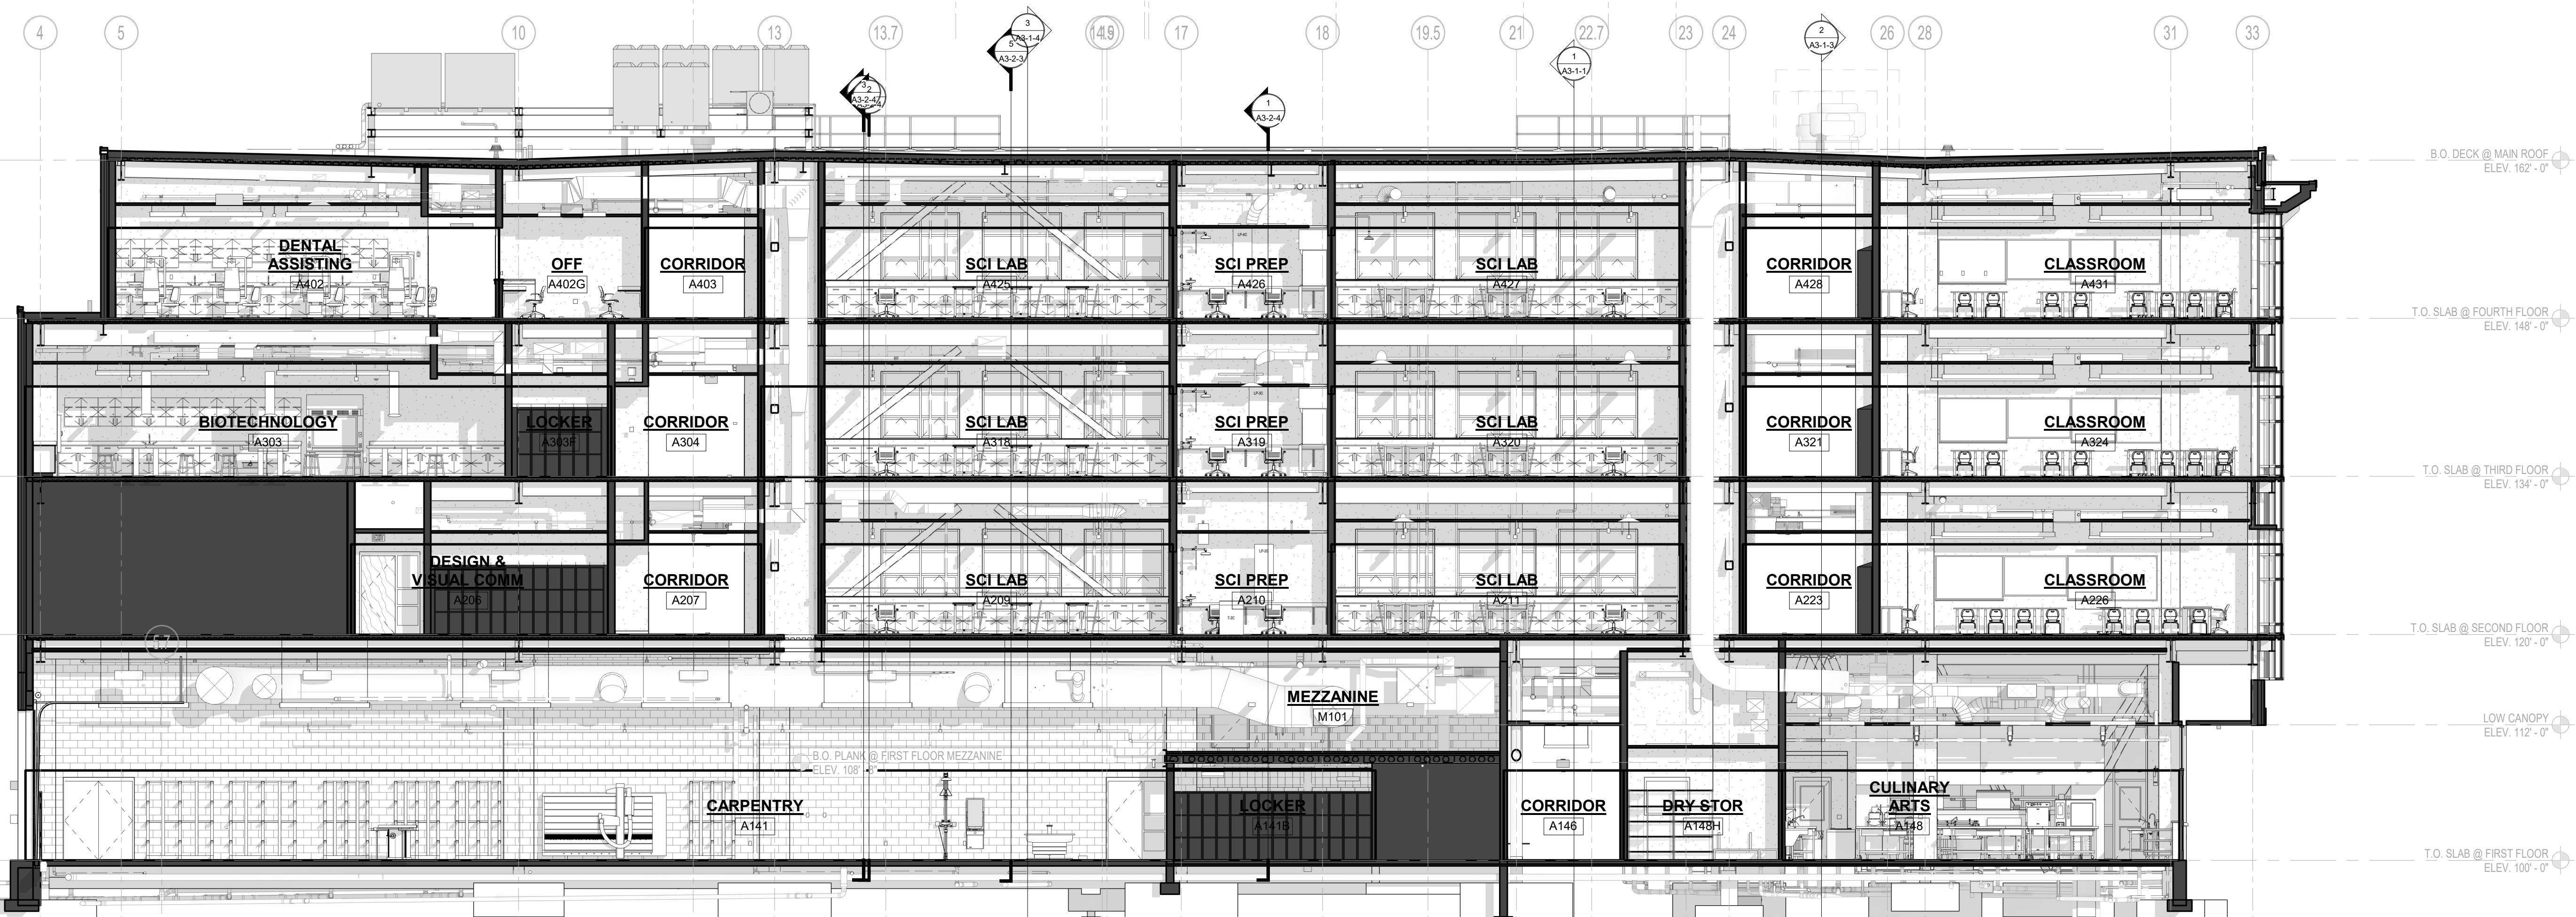

3 BUILDING SECTION - CLASSROOMS AND SHOPS
1/8" = 1'-0"


© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

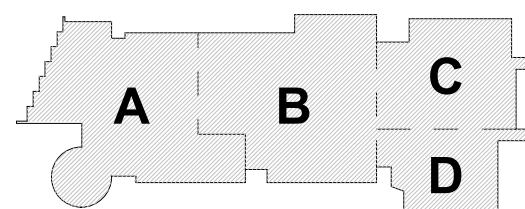


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**BUILDING
SECTIONS**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

A3-1-5

100 Hemlock Road,
Wakefield, MA 01880





MSBA 90% CD
SUBMISSION
May 12TH, 2023

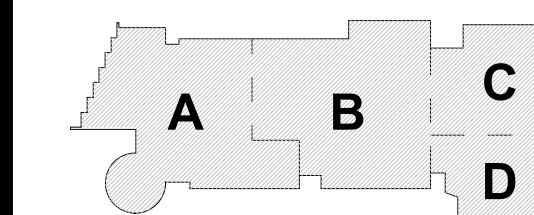

KEY PLAY

PROJECT NORTH


MAGNETIC NORTH



BUILDING SECTIONS

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DR
Date: May 12TH, 2023
Volume 3 of 4

A3-1-6

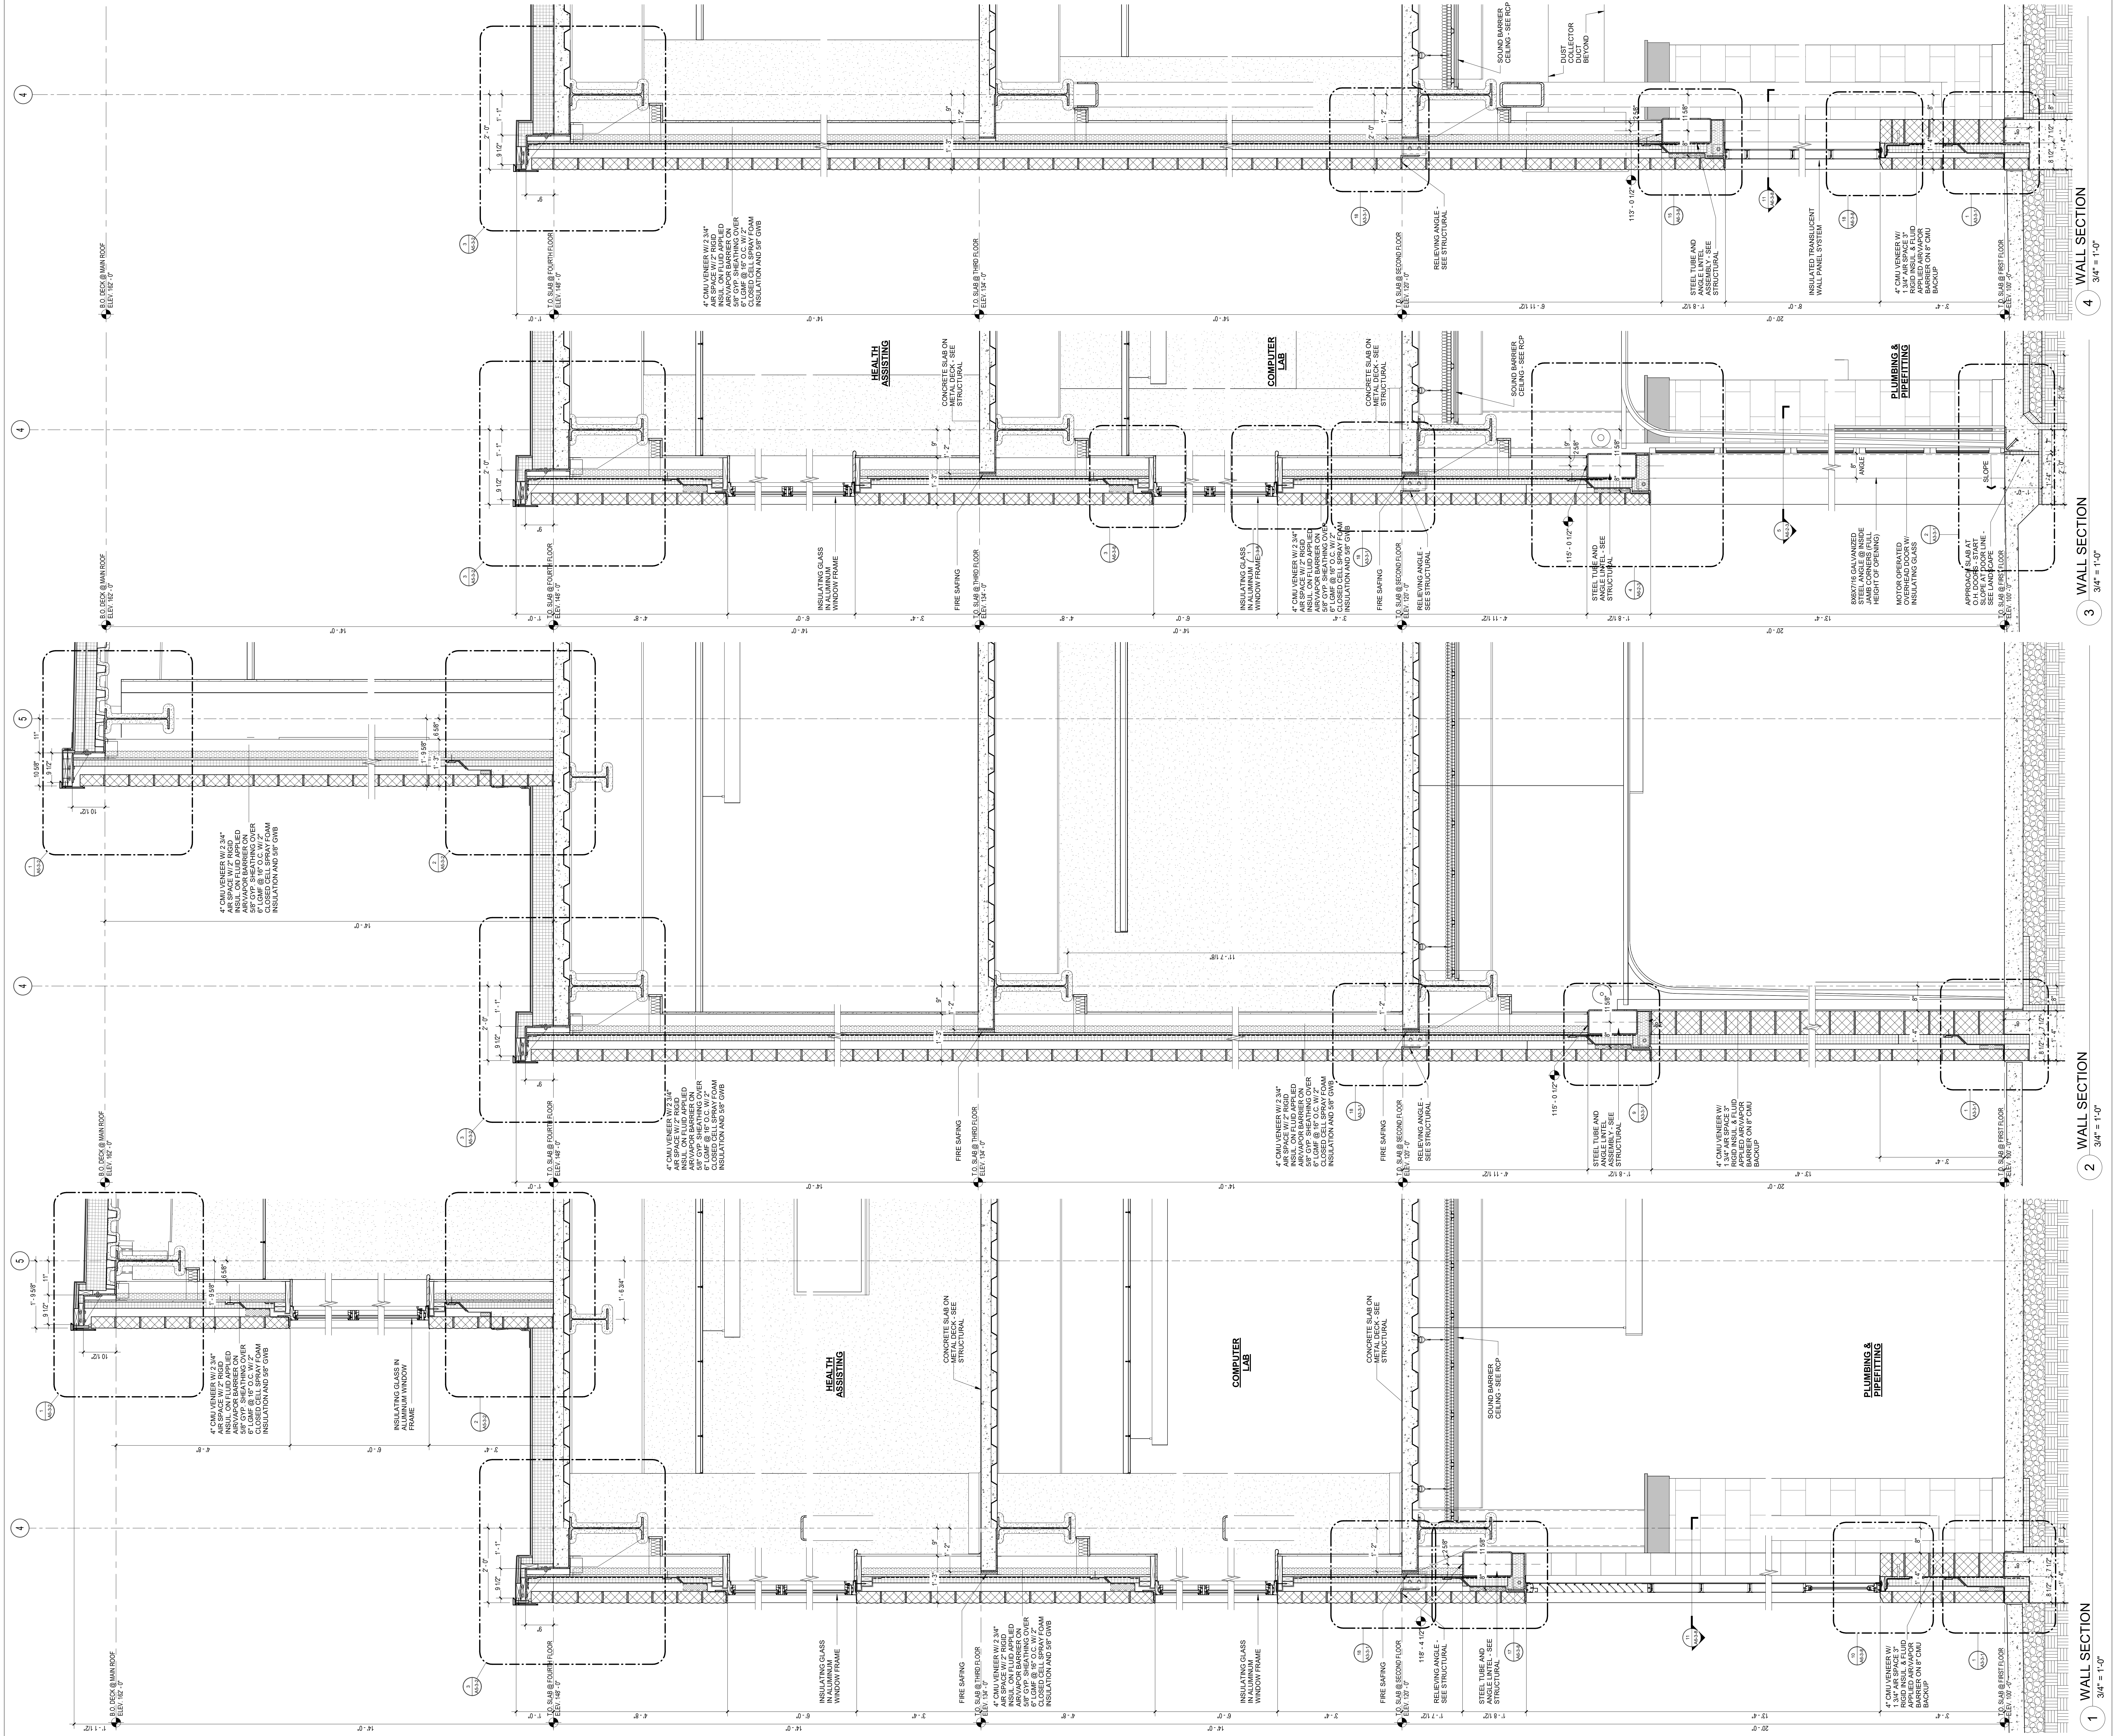

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.854.1702
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.854.1702
www.dra.com

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road, Wakefield, MA 01880

MSBA 90% CD SUBMISSION

May 12TH, 2023

A B C D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-1

100 Hemlock Road,
Wakefield, MA 01880



May 12TH, 2023

A3-2-2

100 Hemlock Road,
Wakefield, MA 01880



KEY PLAN

PROJECT NO.

MAGNETIC NORTH


0.1 0.45 1.1



Job No. 30302

1000

A3-2-4


Volume 3 of

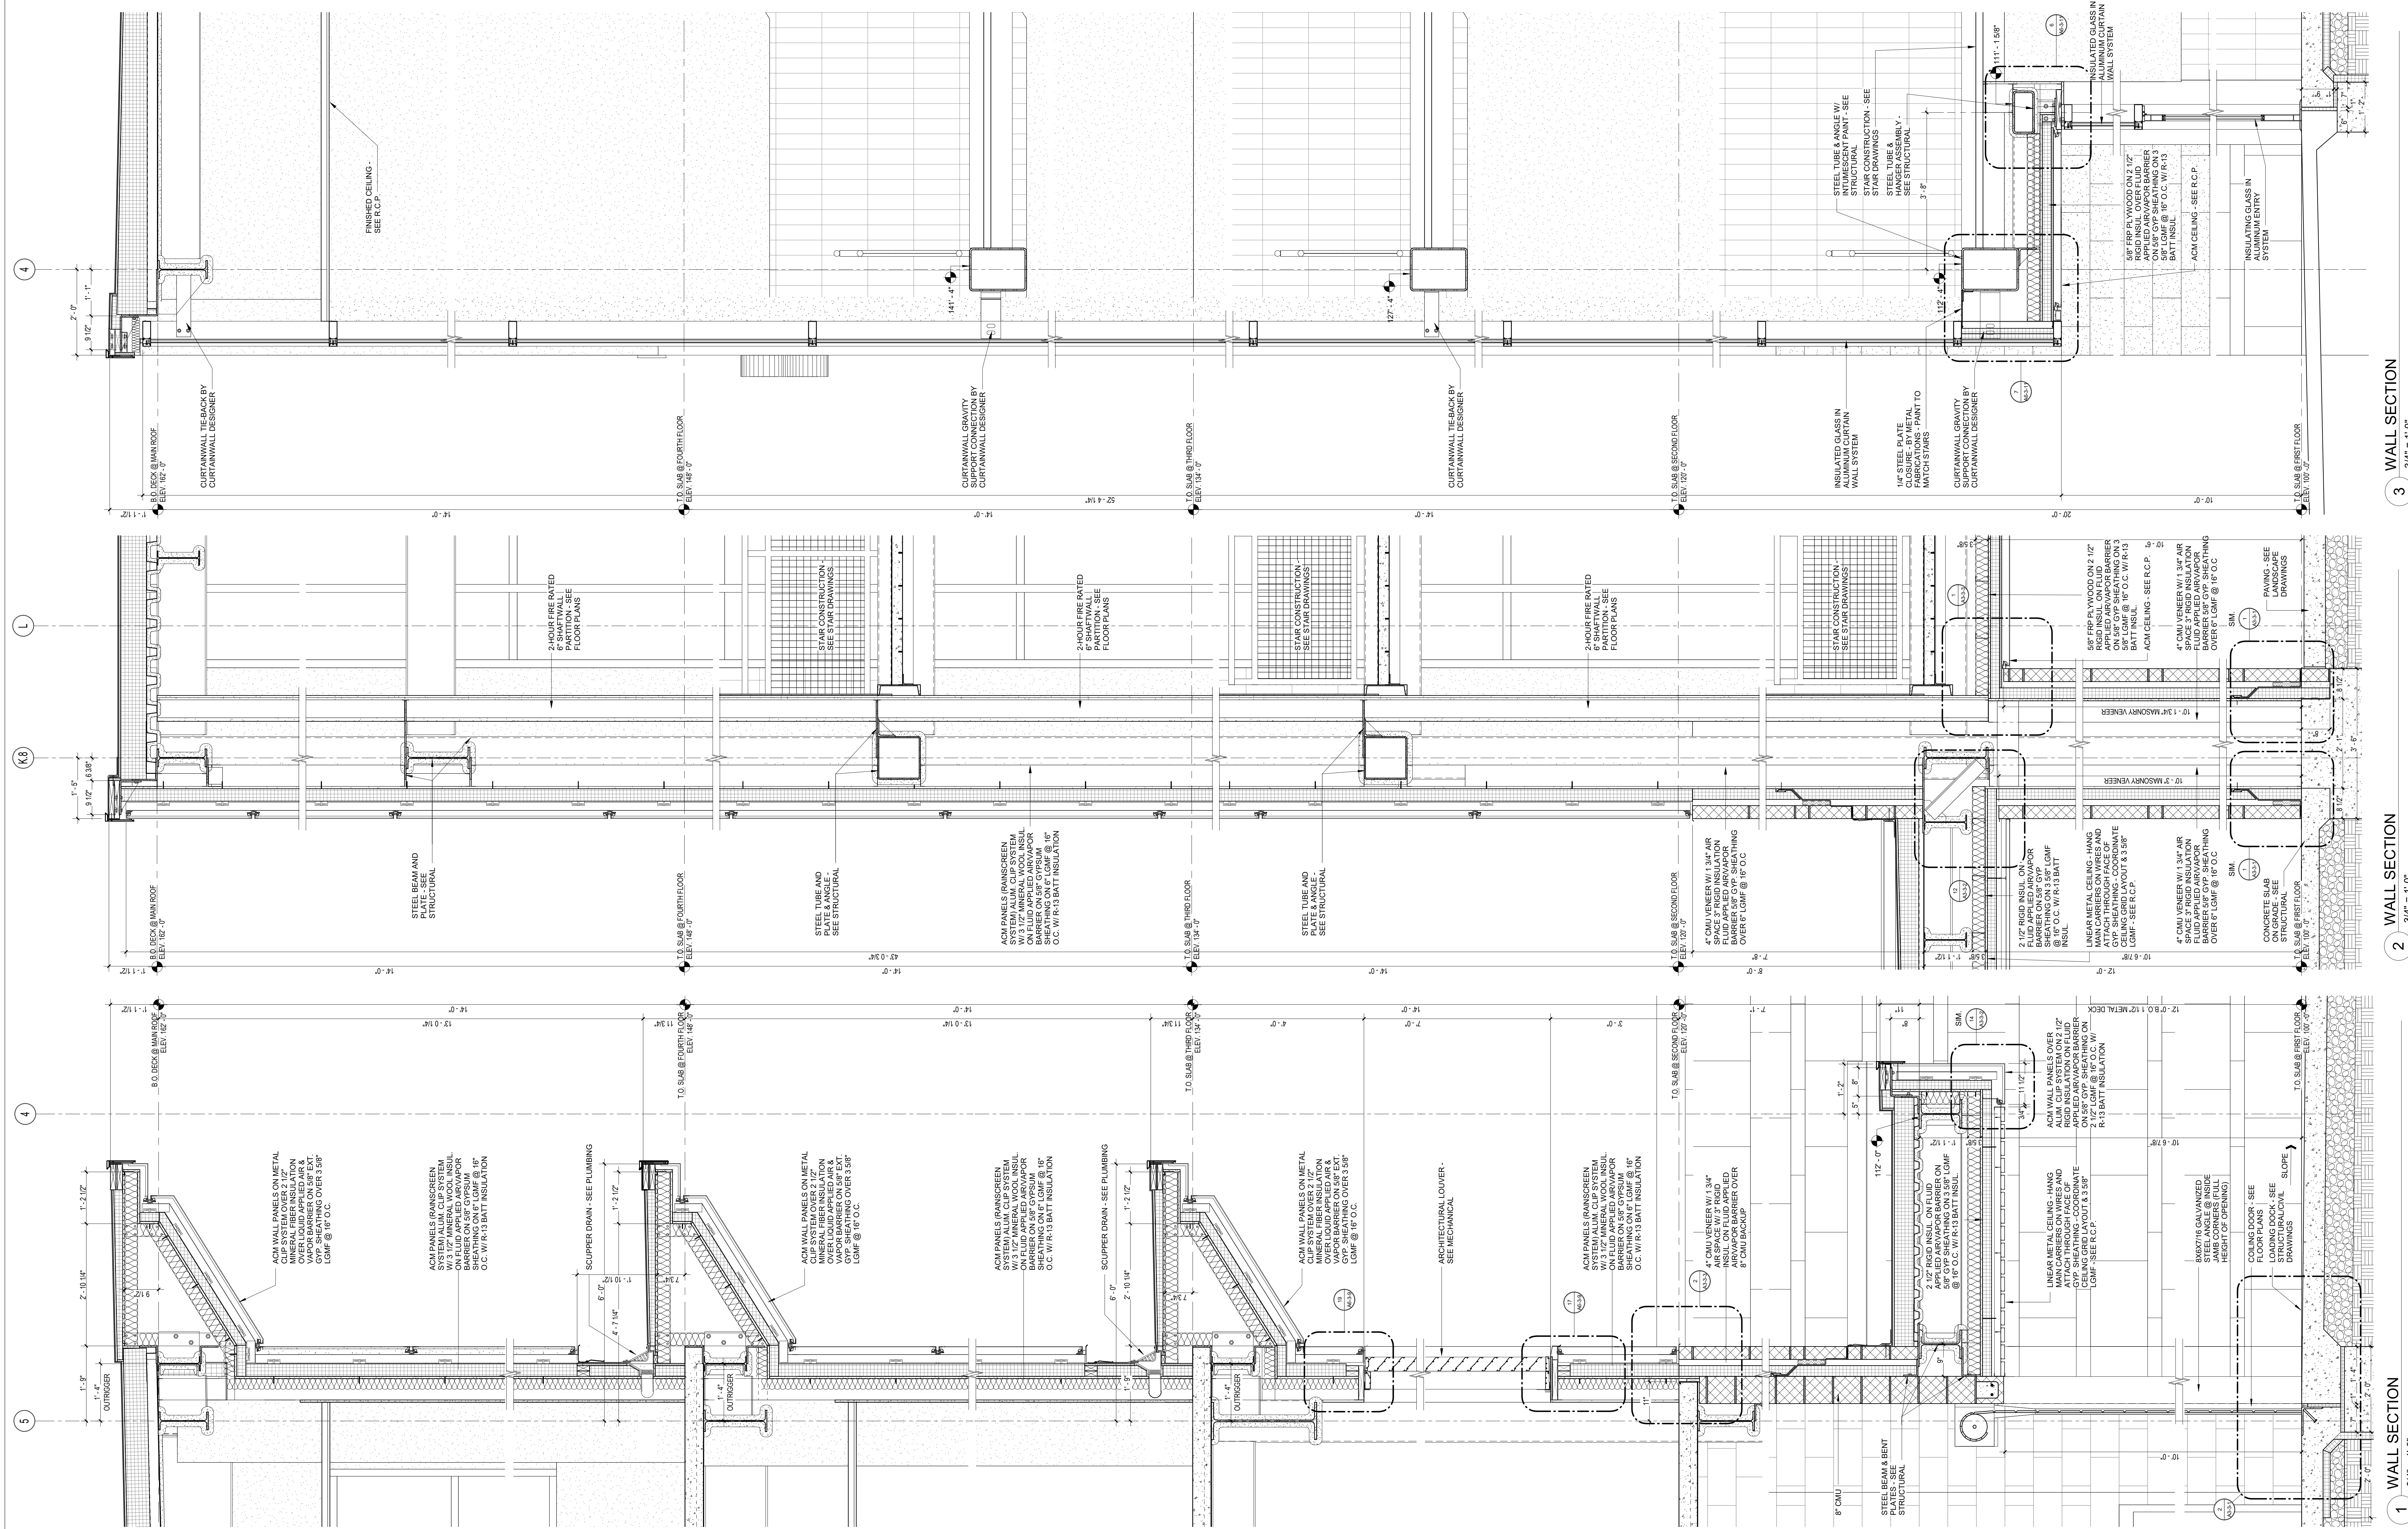
Northeast
Metropolitan
Regional
Vocational High
School100 Hemlock Road,
Wakefield, MA 01880

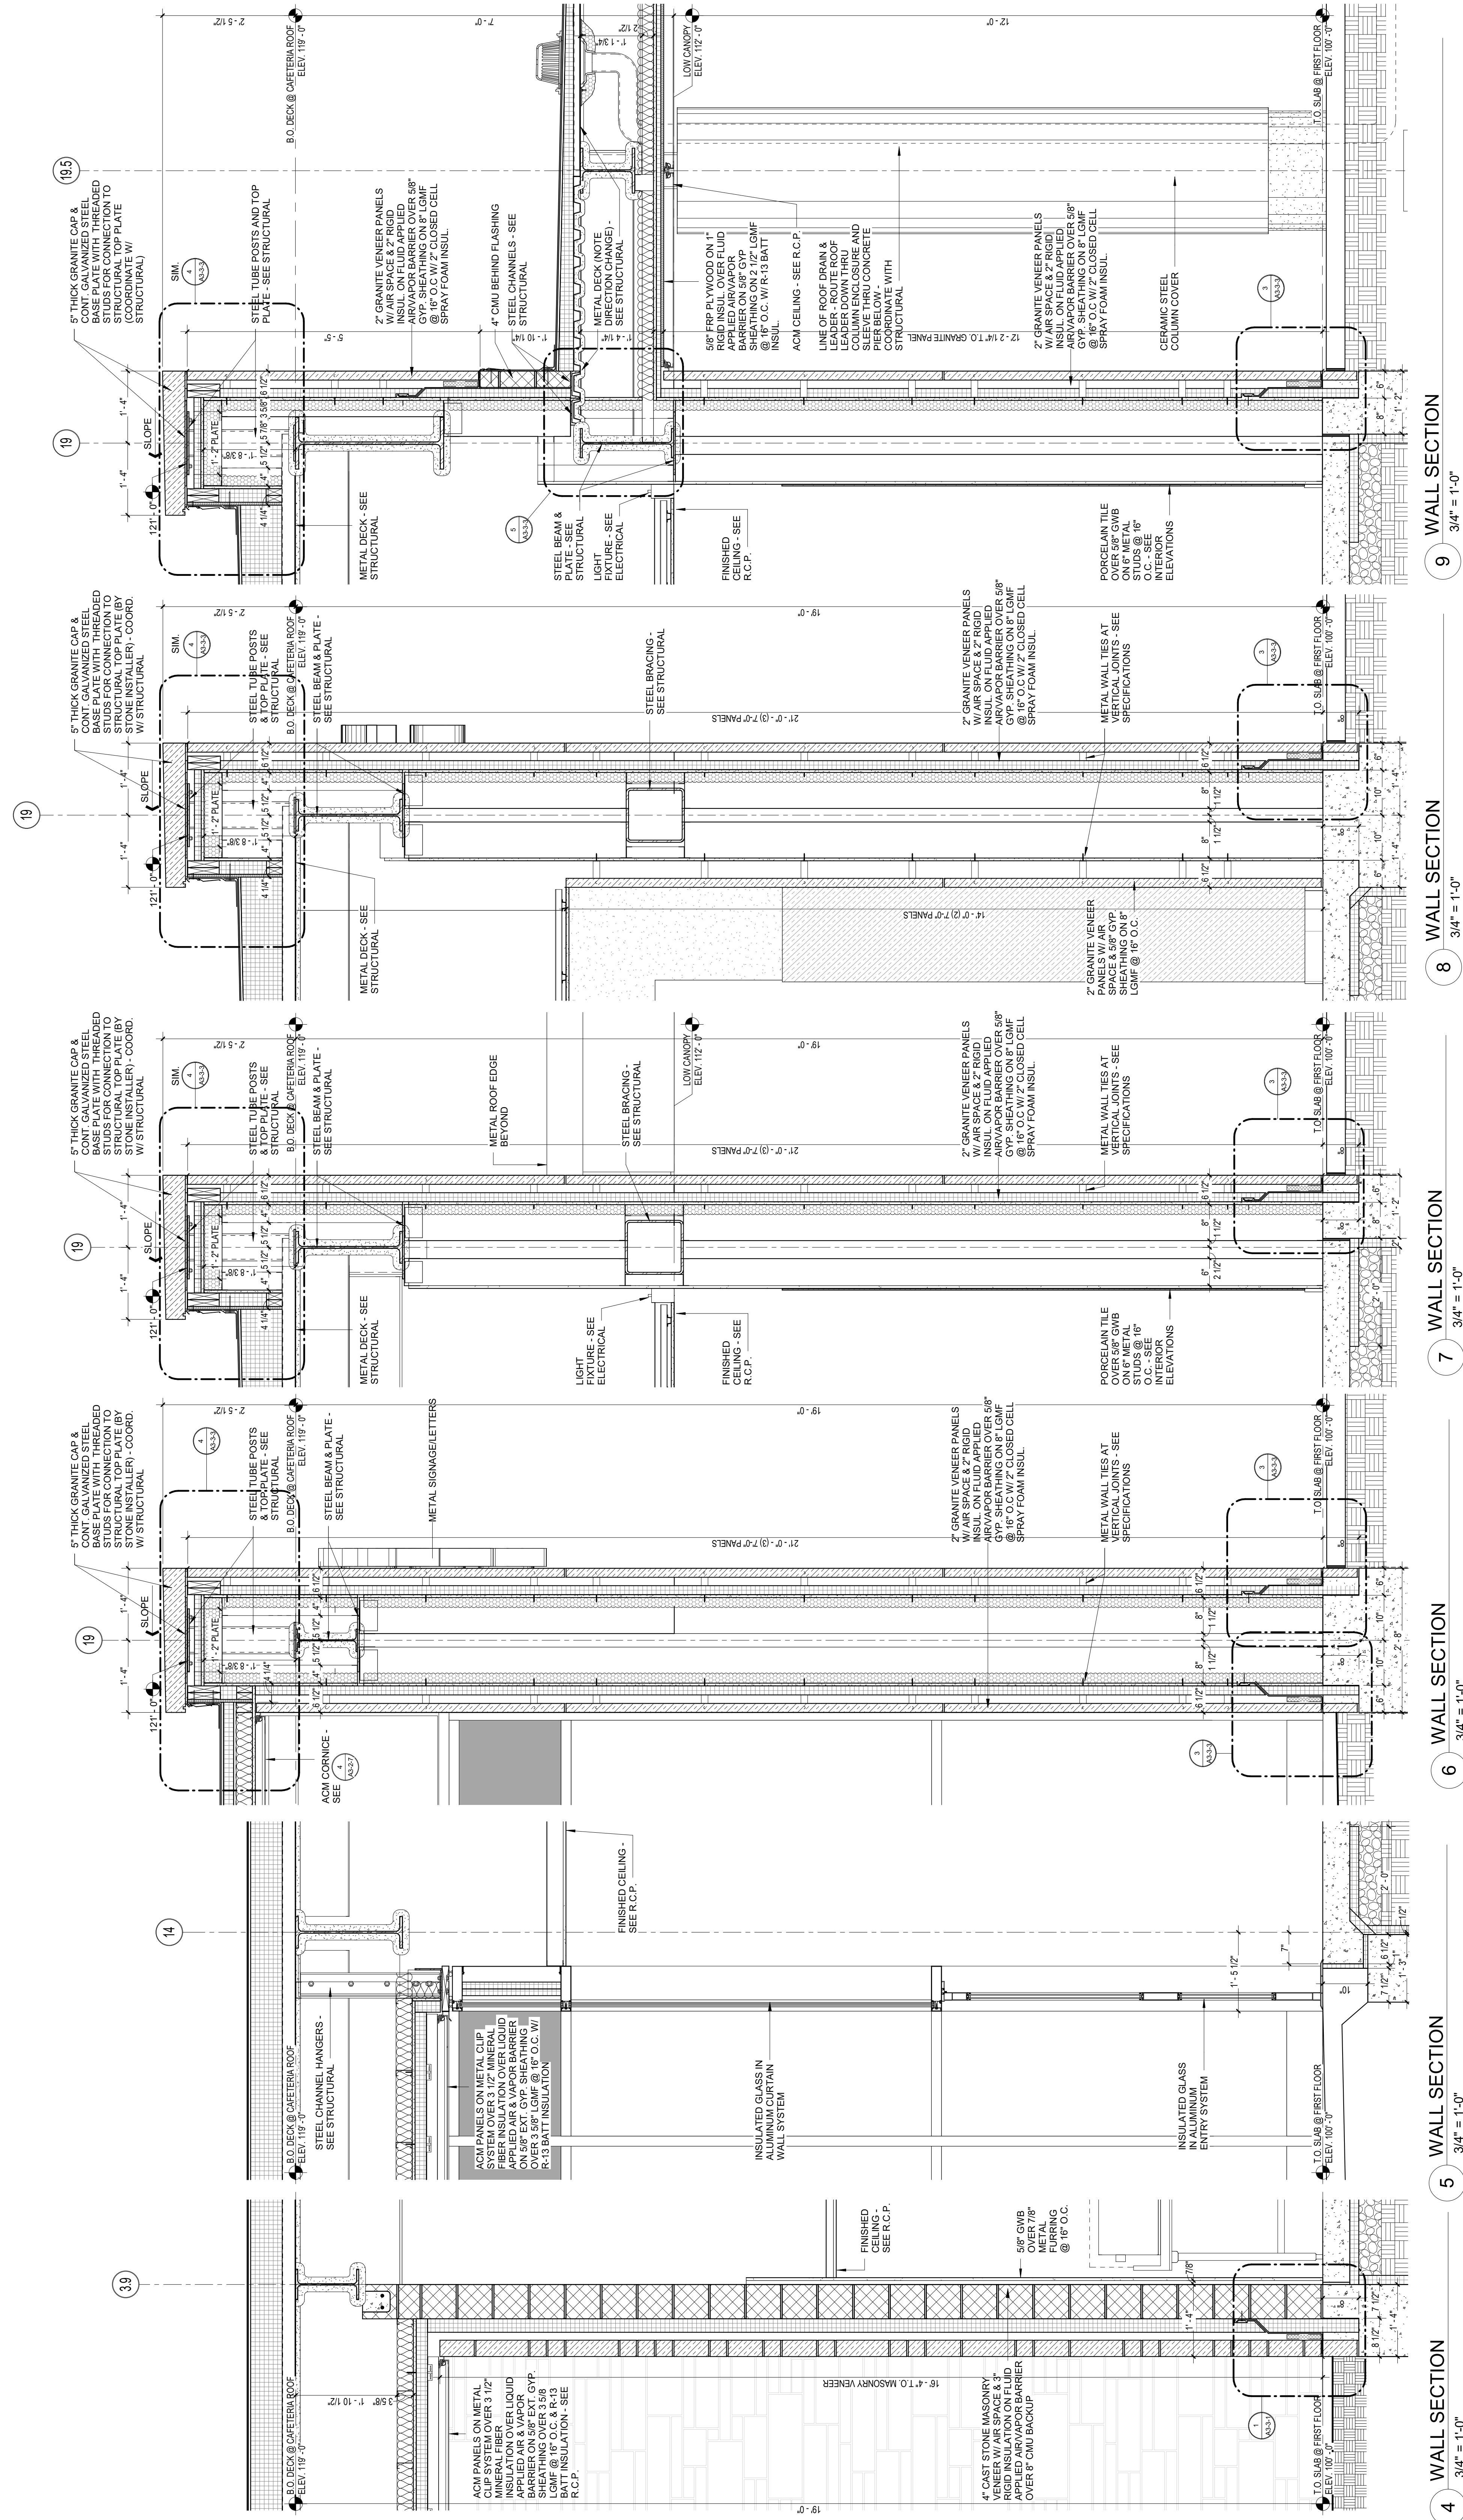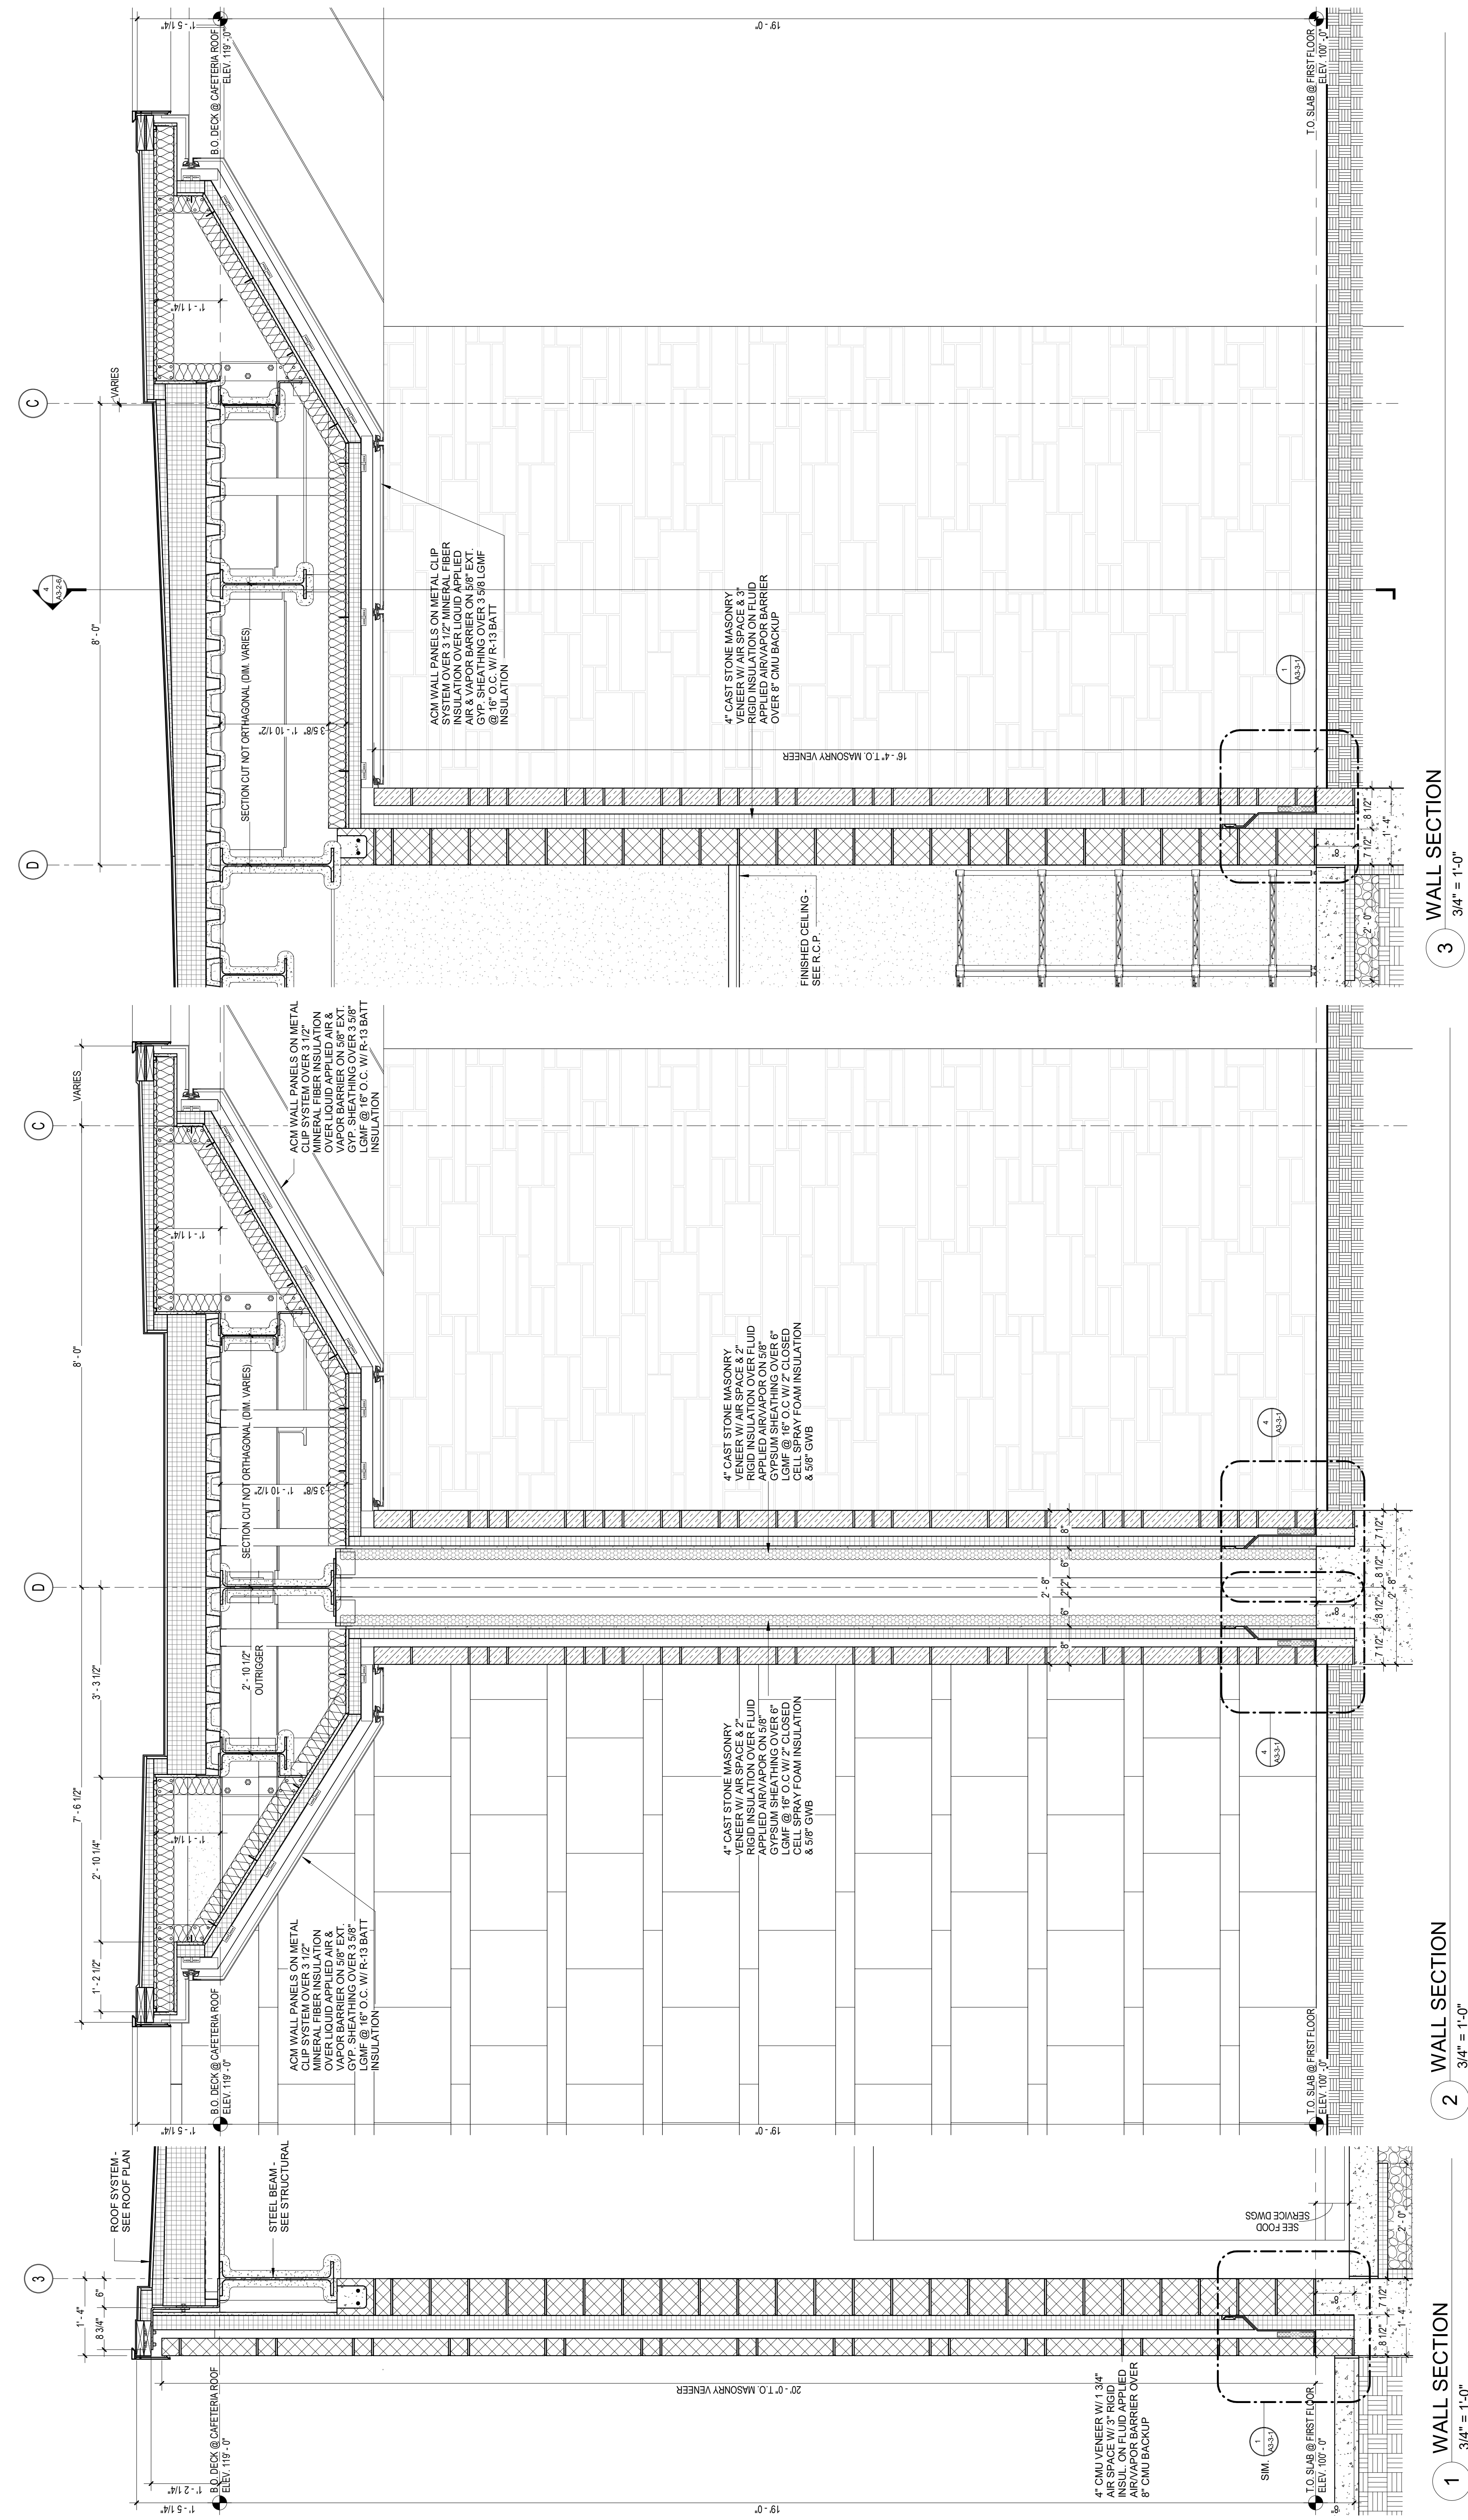

100 Hemlock Road,
Wakefield, MA 01880



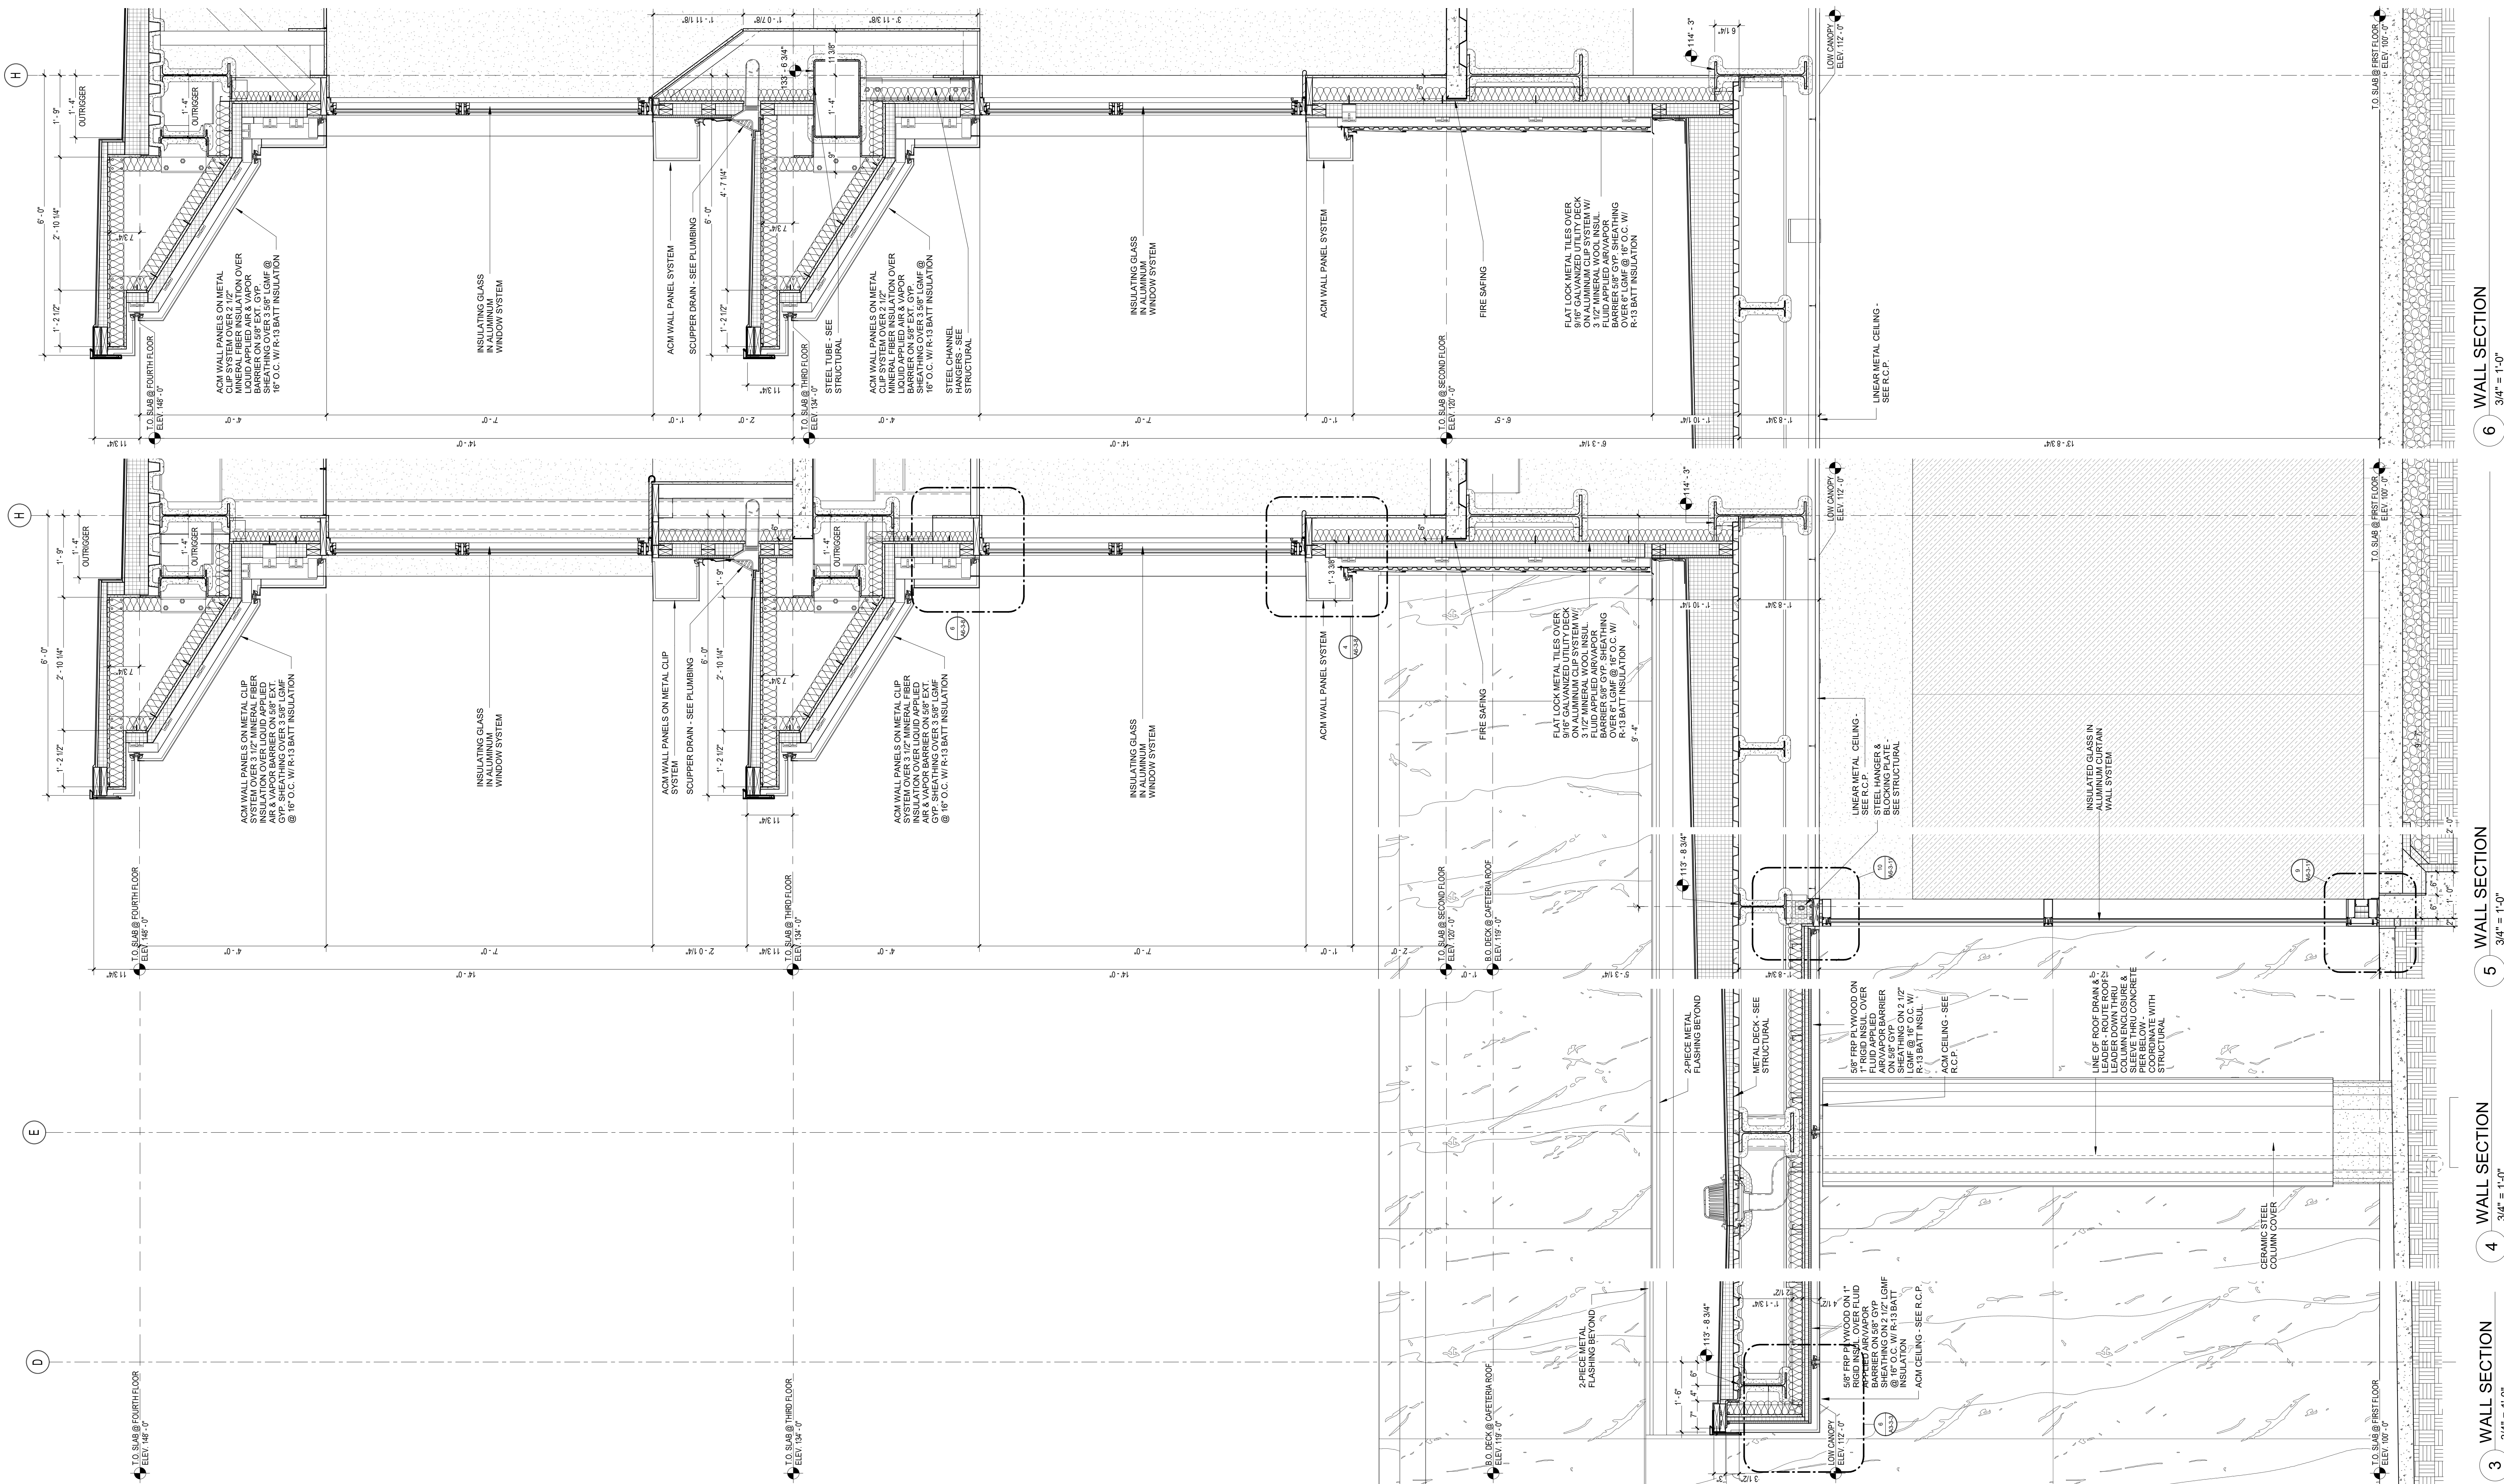

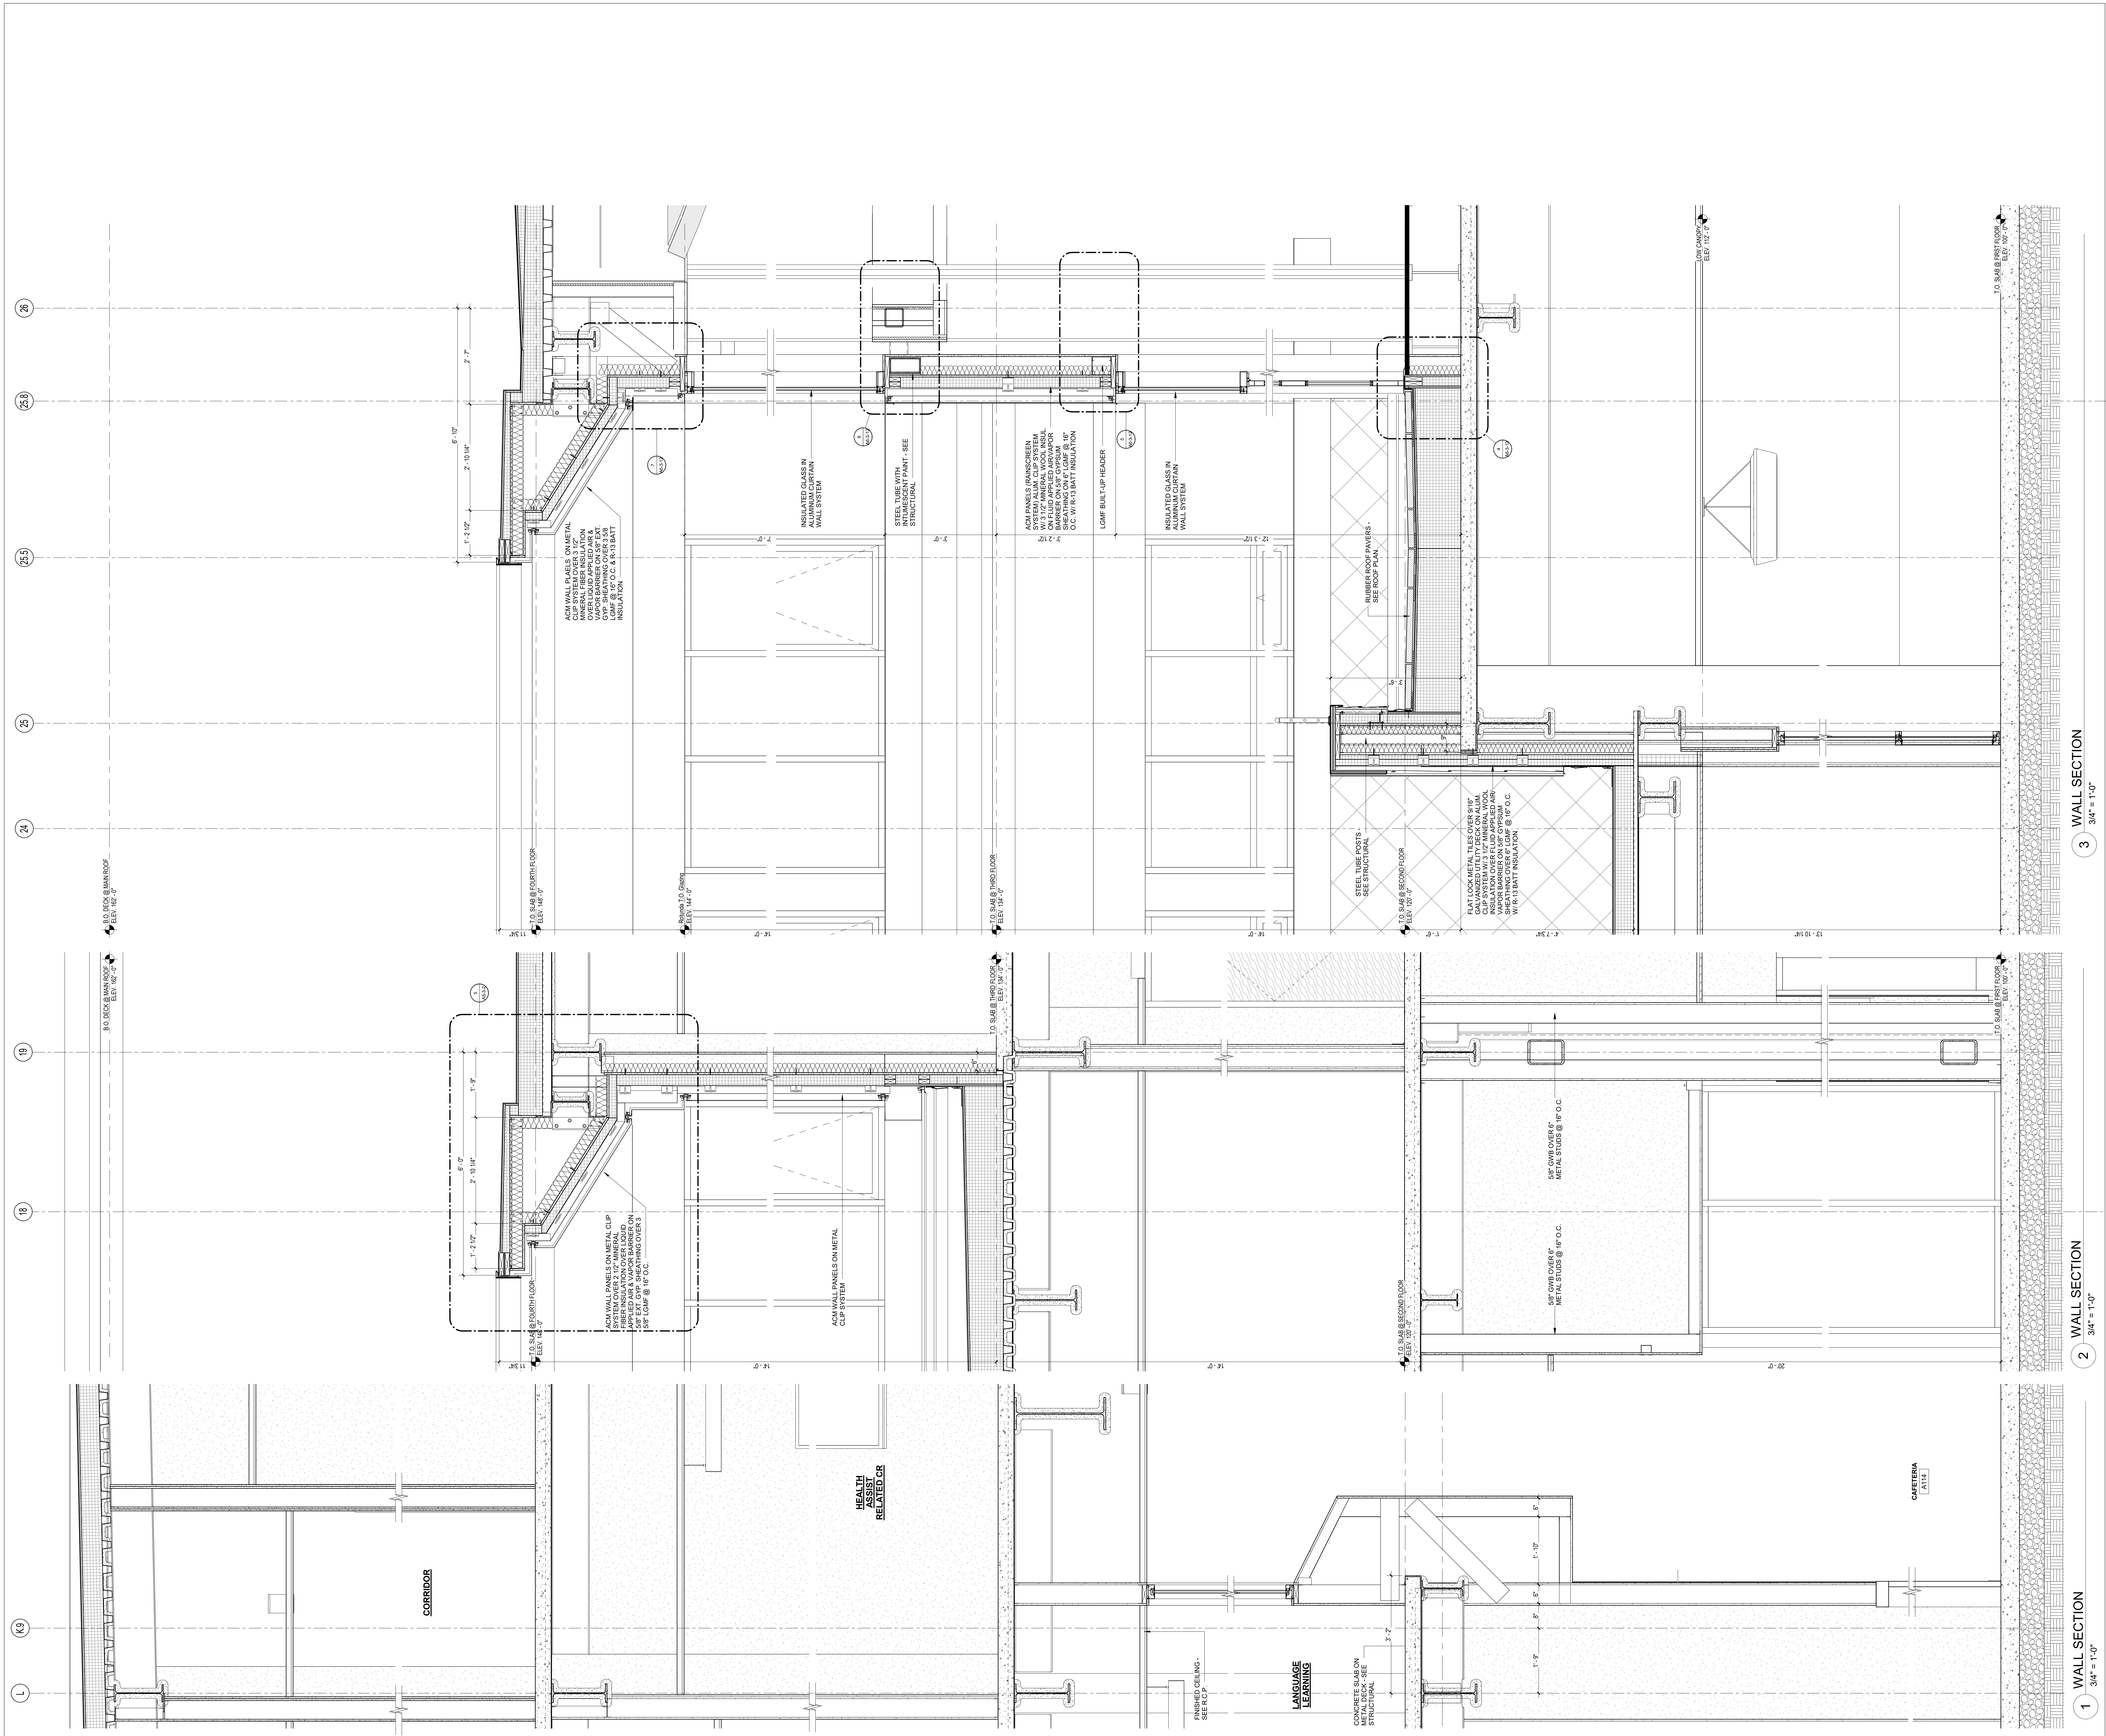

DRA

Drummeys Rosane Anderson, Inc.

225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Tel: 617.954.1702
www.dra.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

1 WALL SECTION


3/4" = 1'-0"

2 WALL SECTION

3/4" = 1'-0"

3 WALL SECTION

3/4" = 1'-0"

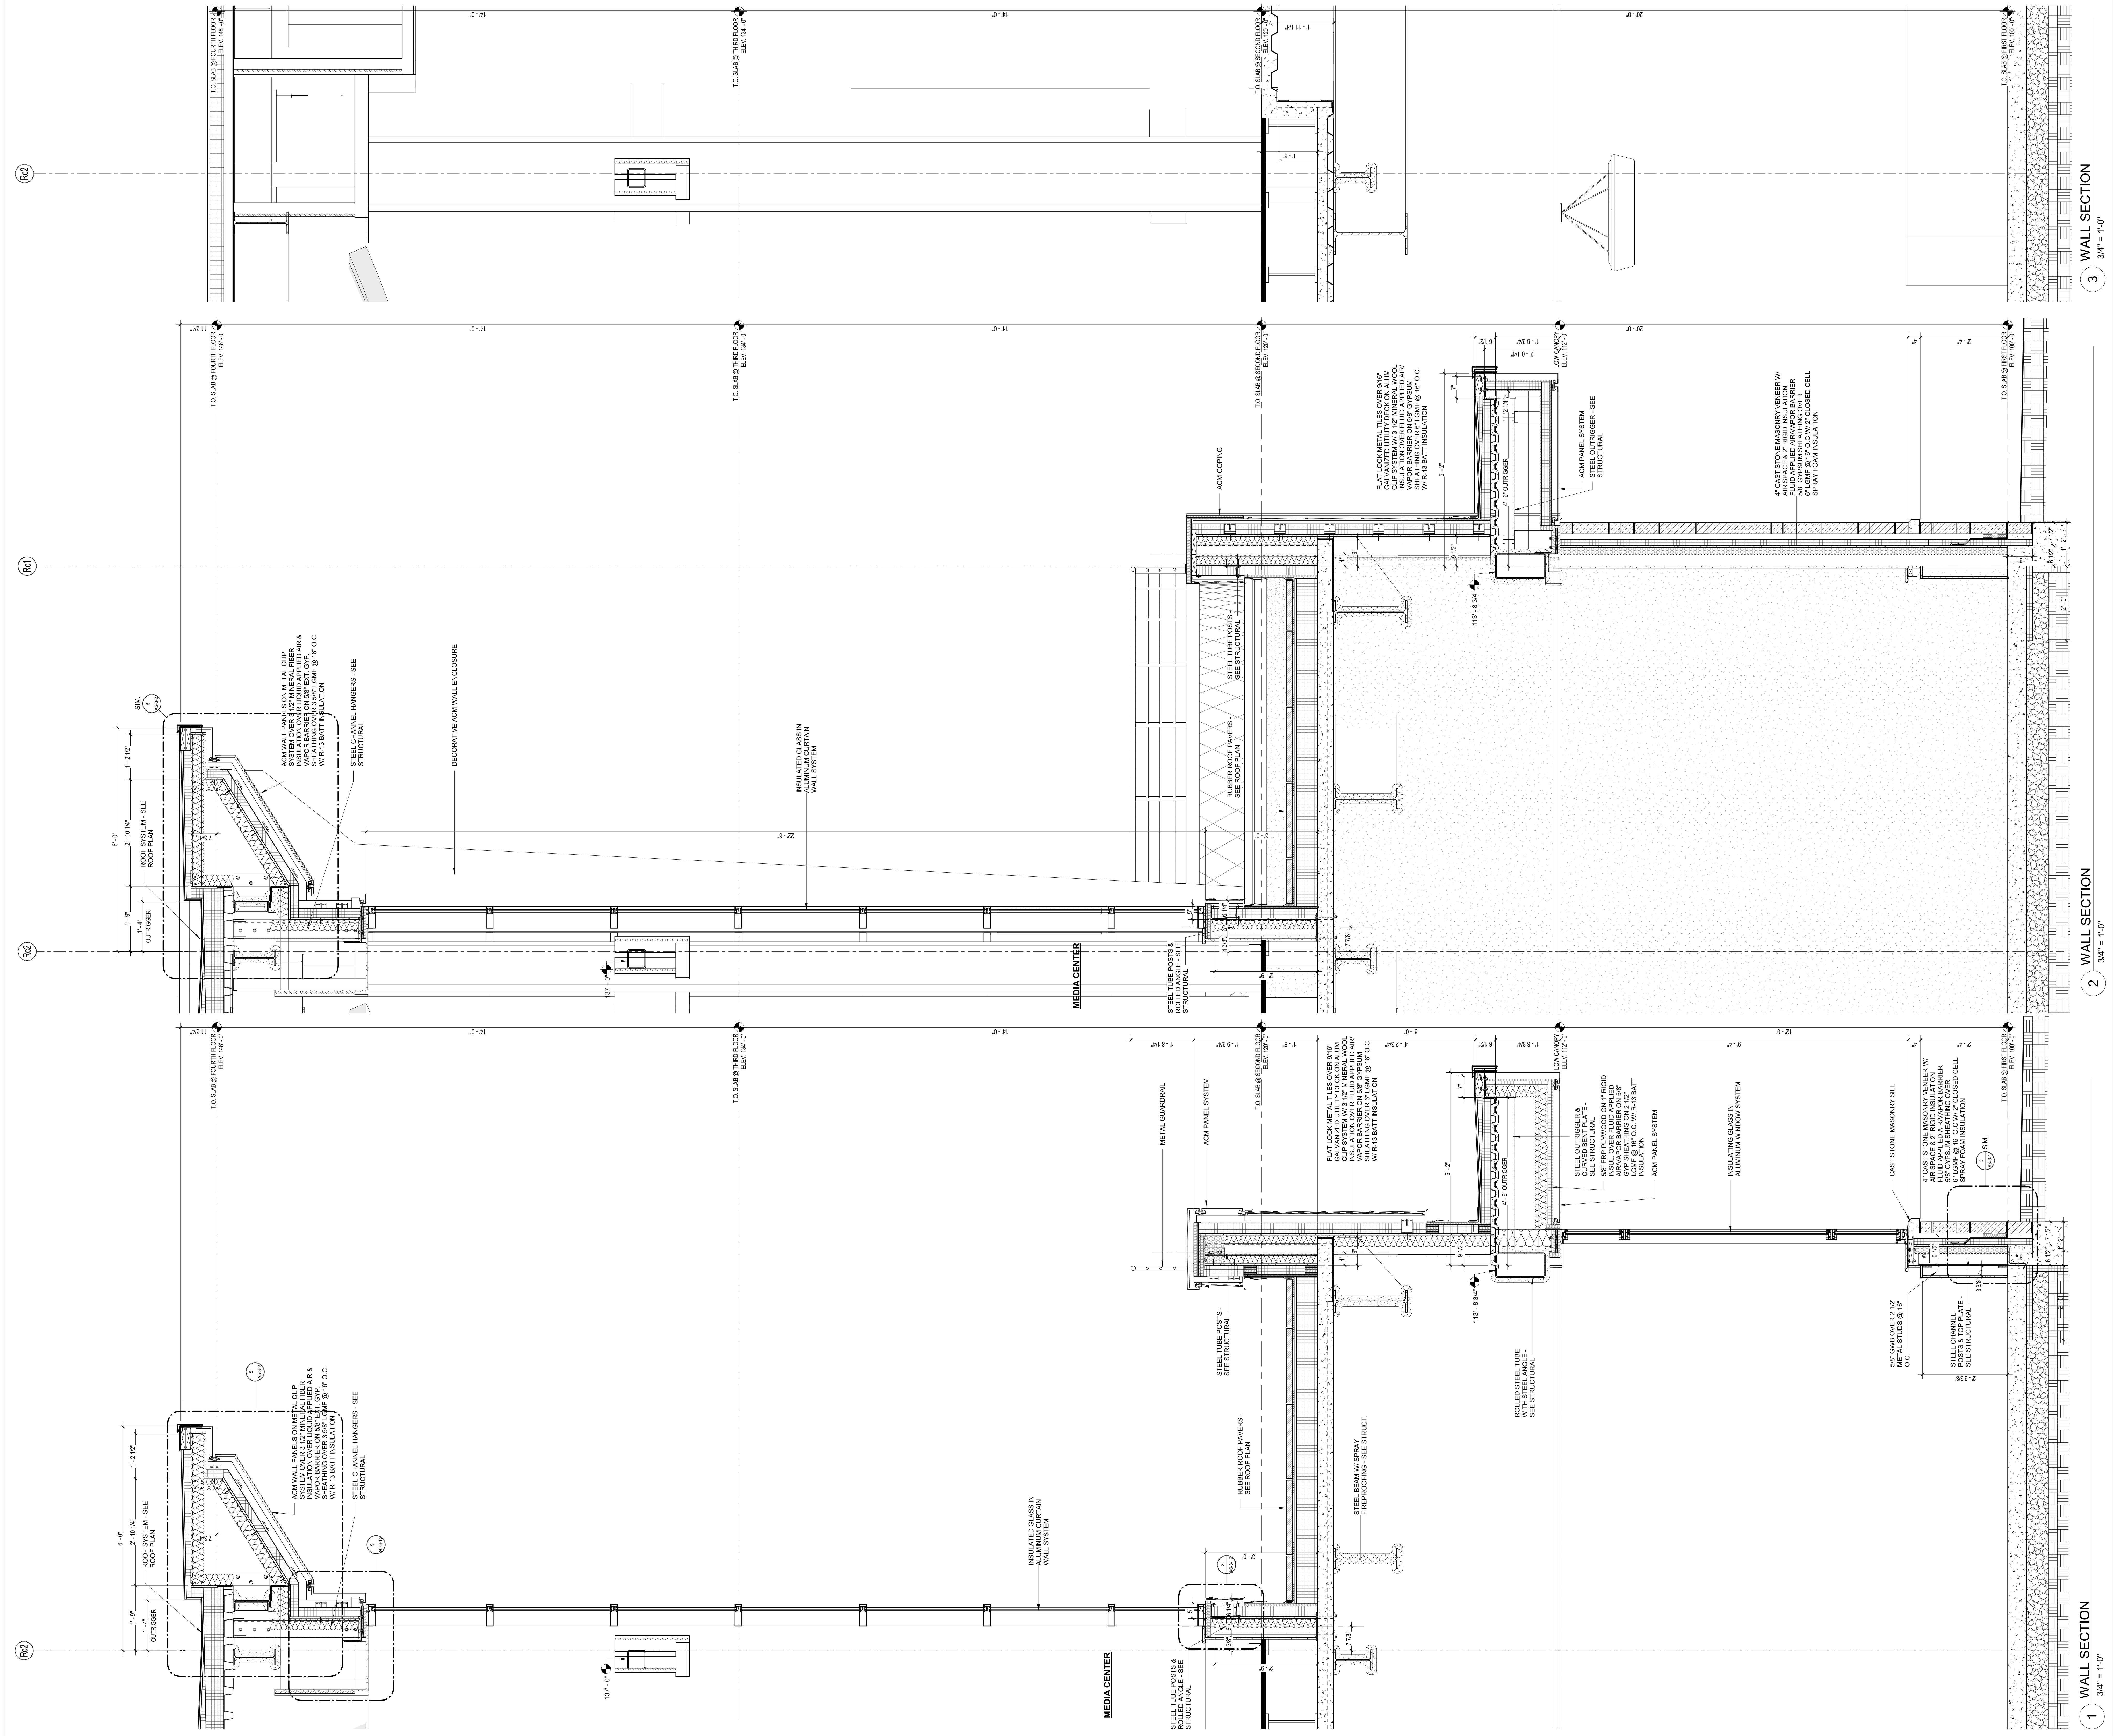

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

PROJECT NORTH

MAGNETIC NORTH

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-10

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN


A B C D

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

1 WALL SECTION 3/4" = 1'-0"

2 WALL SECTION 3/4" = 1'-0"

3 WALL SECTION 3/4" = 1'-0"

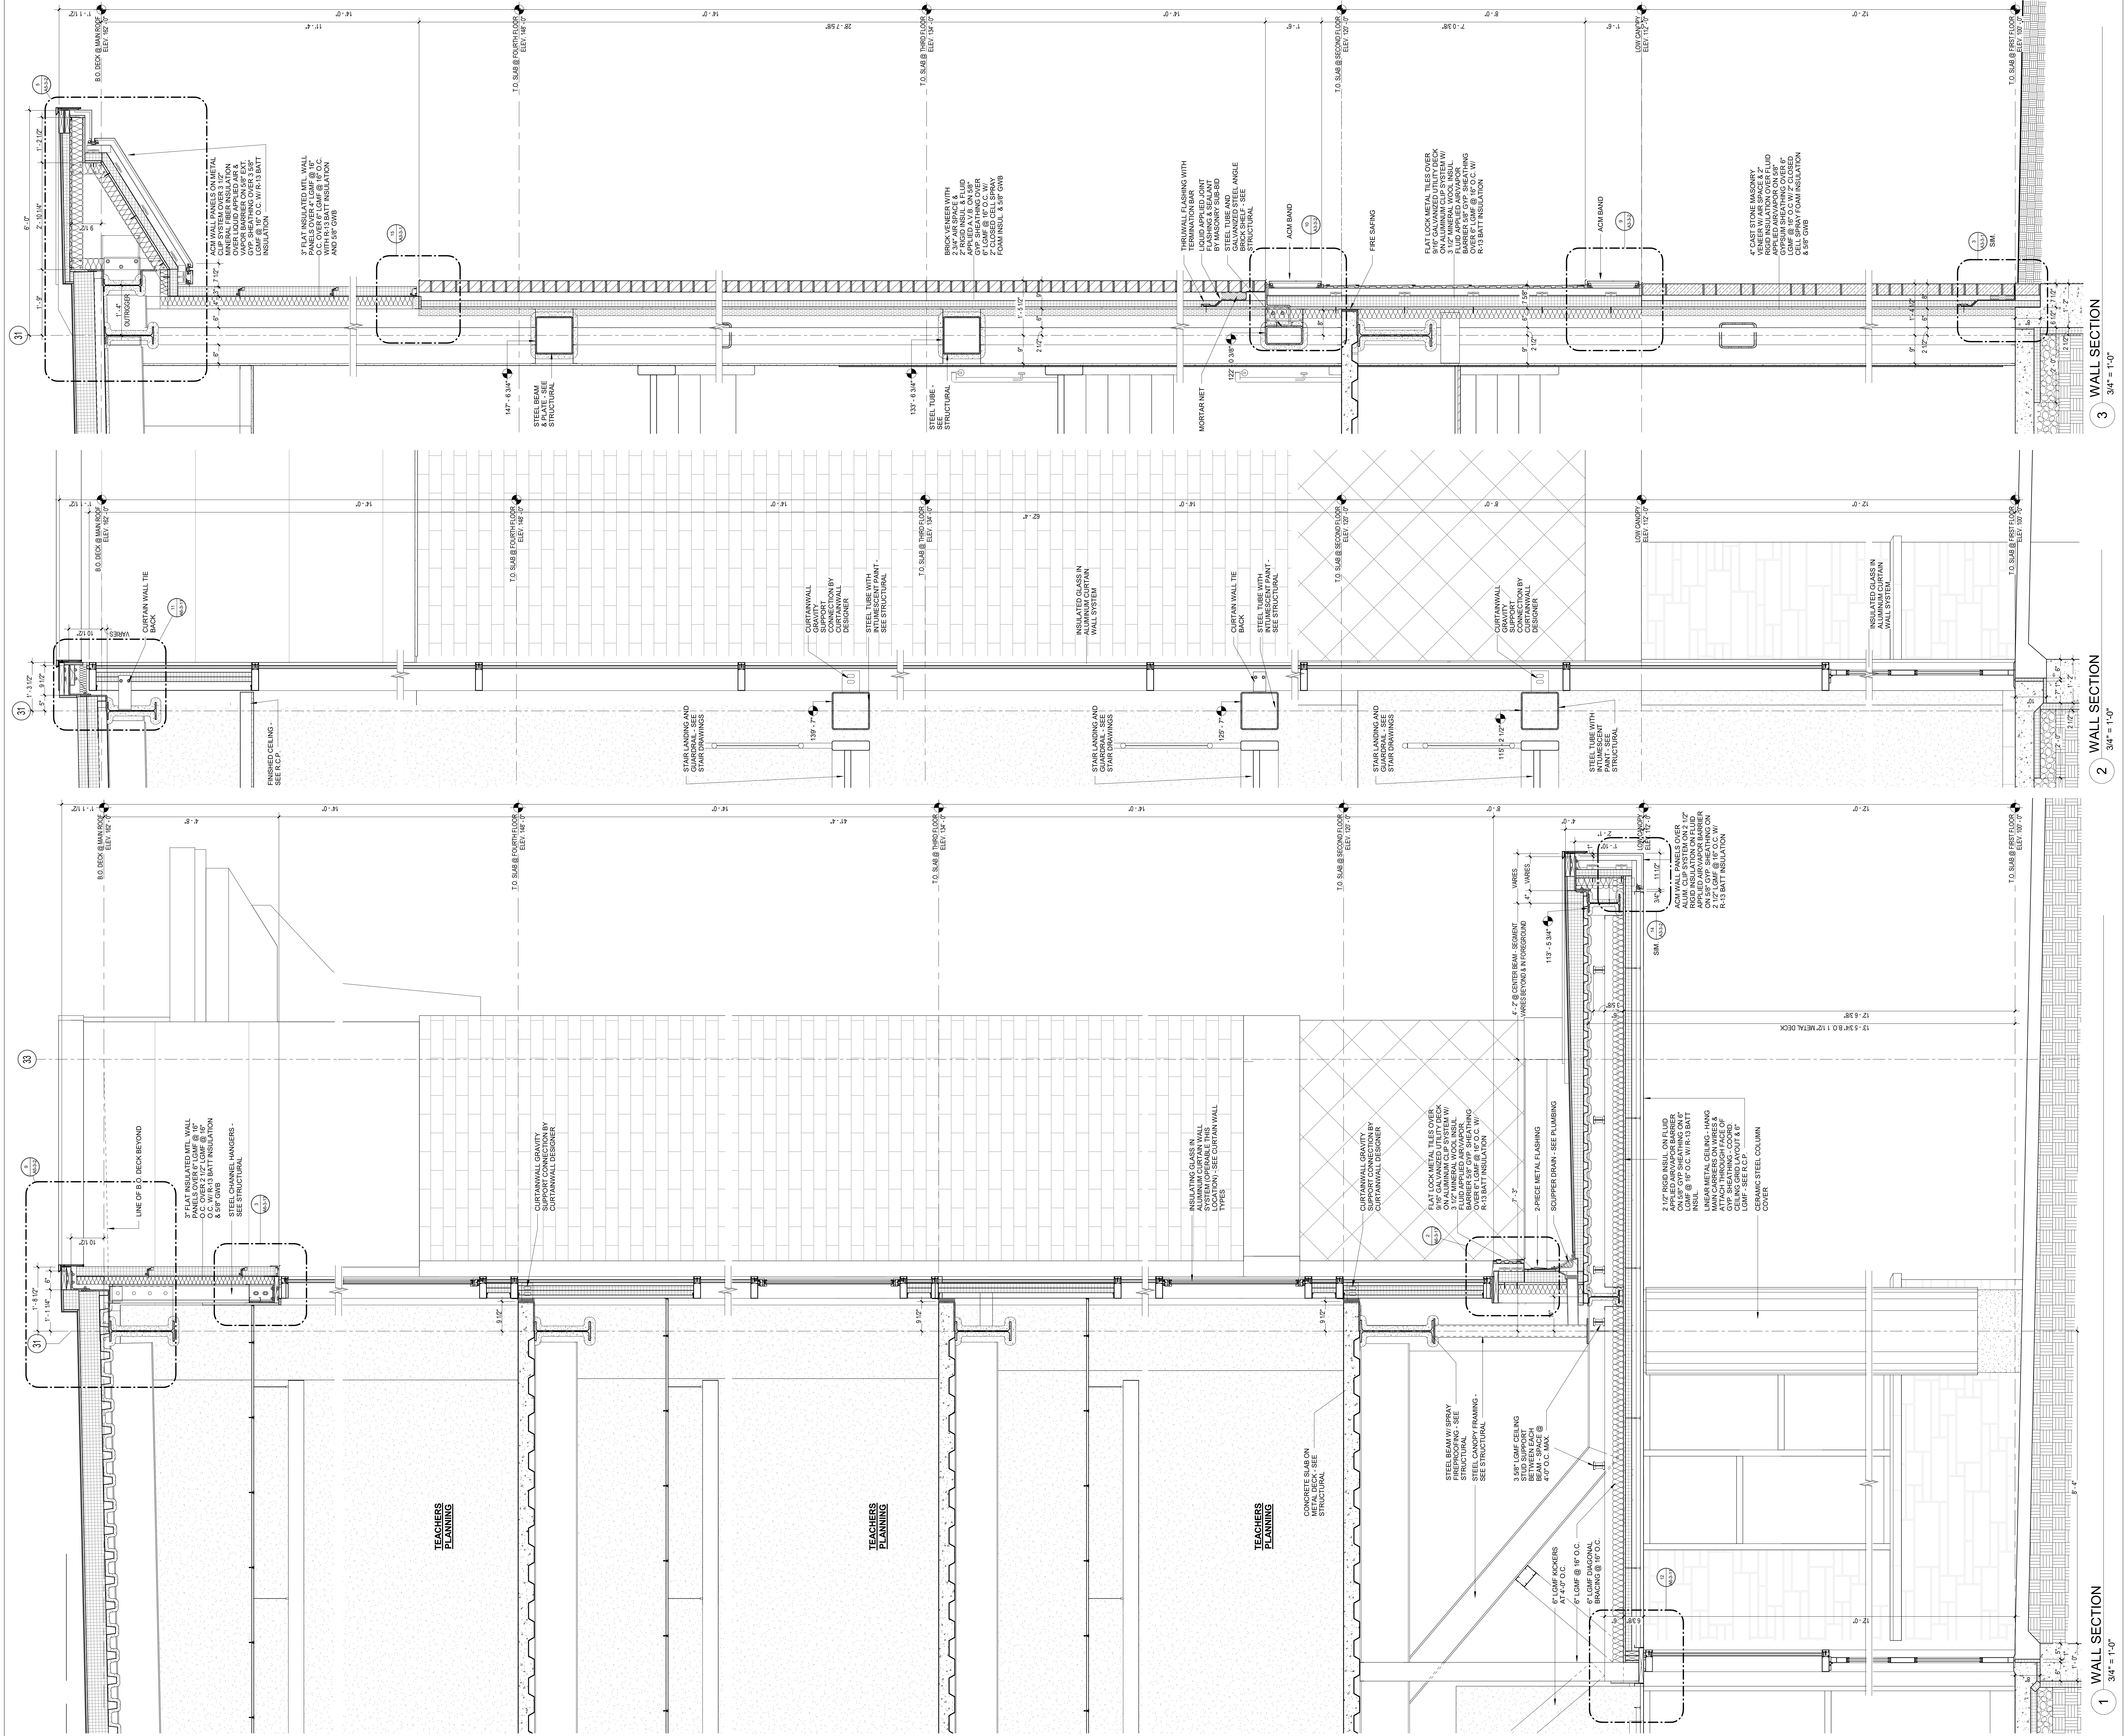

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.864.1702
www.drainc.com

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A

B

C

D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-11



DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.864.1702
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A B C D

KEY PLAN


PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023

A3-2-12
Volume 1 of 4

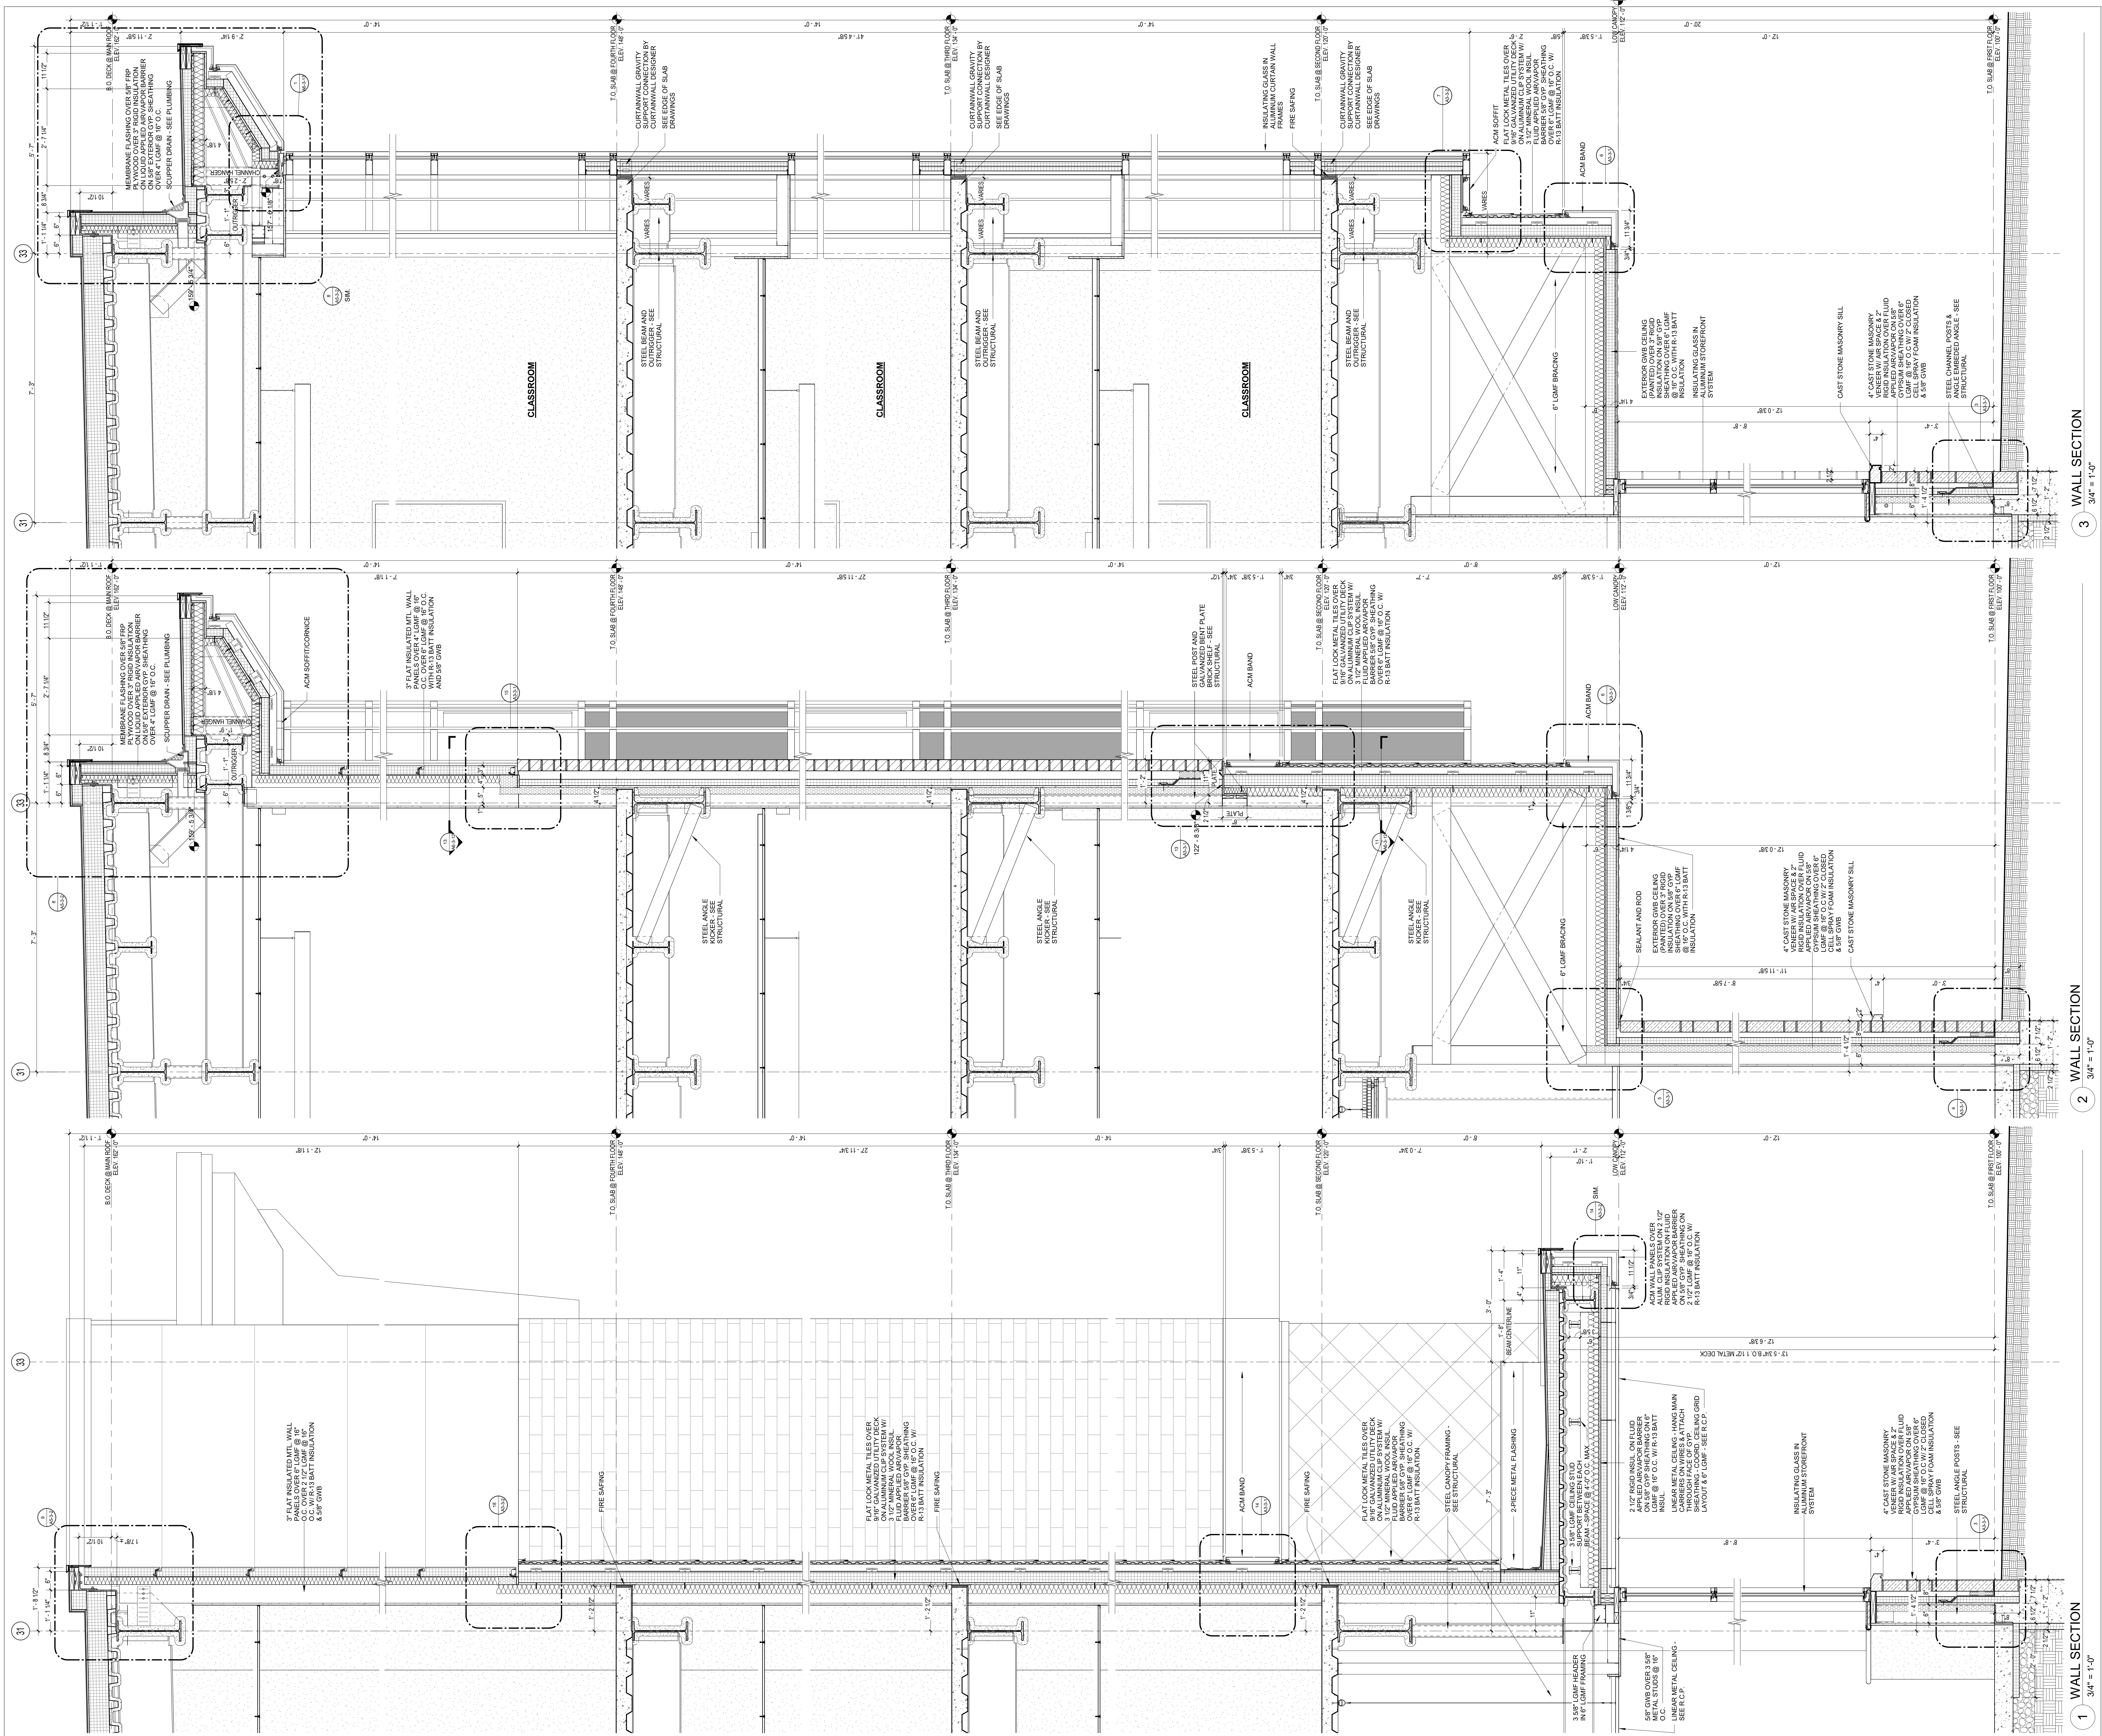

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.864.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

PROJECT NORTH

MAGNETIC NORTH

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN


A B C D

WALL SECTIONS

1 WALL SECTION
3/4" = 1'-0"

2 WALL SECTION
3/4" = 1'-0"

3 WALL SECTION
3/4" = 1'-0"

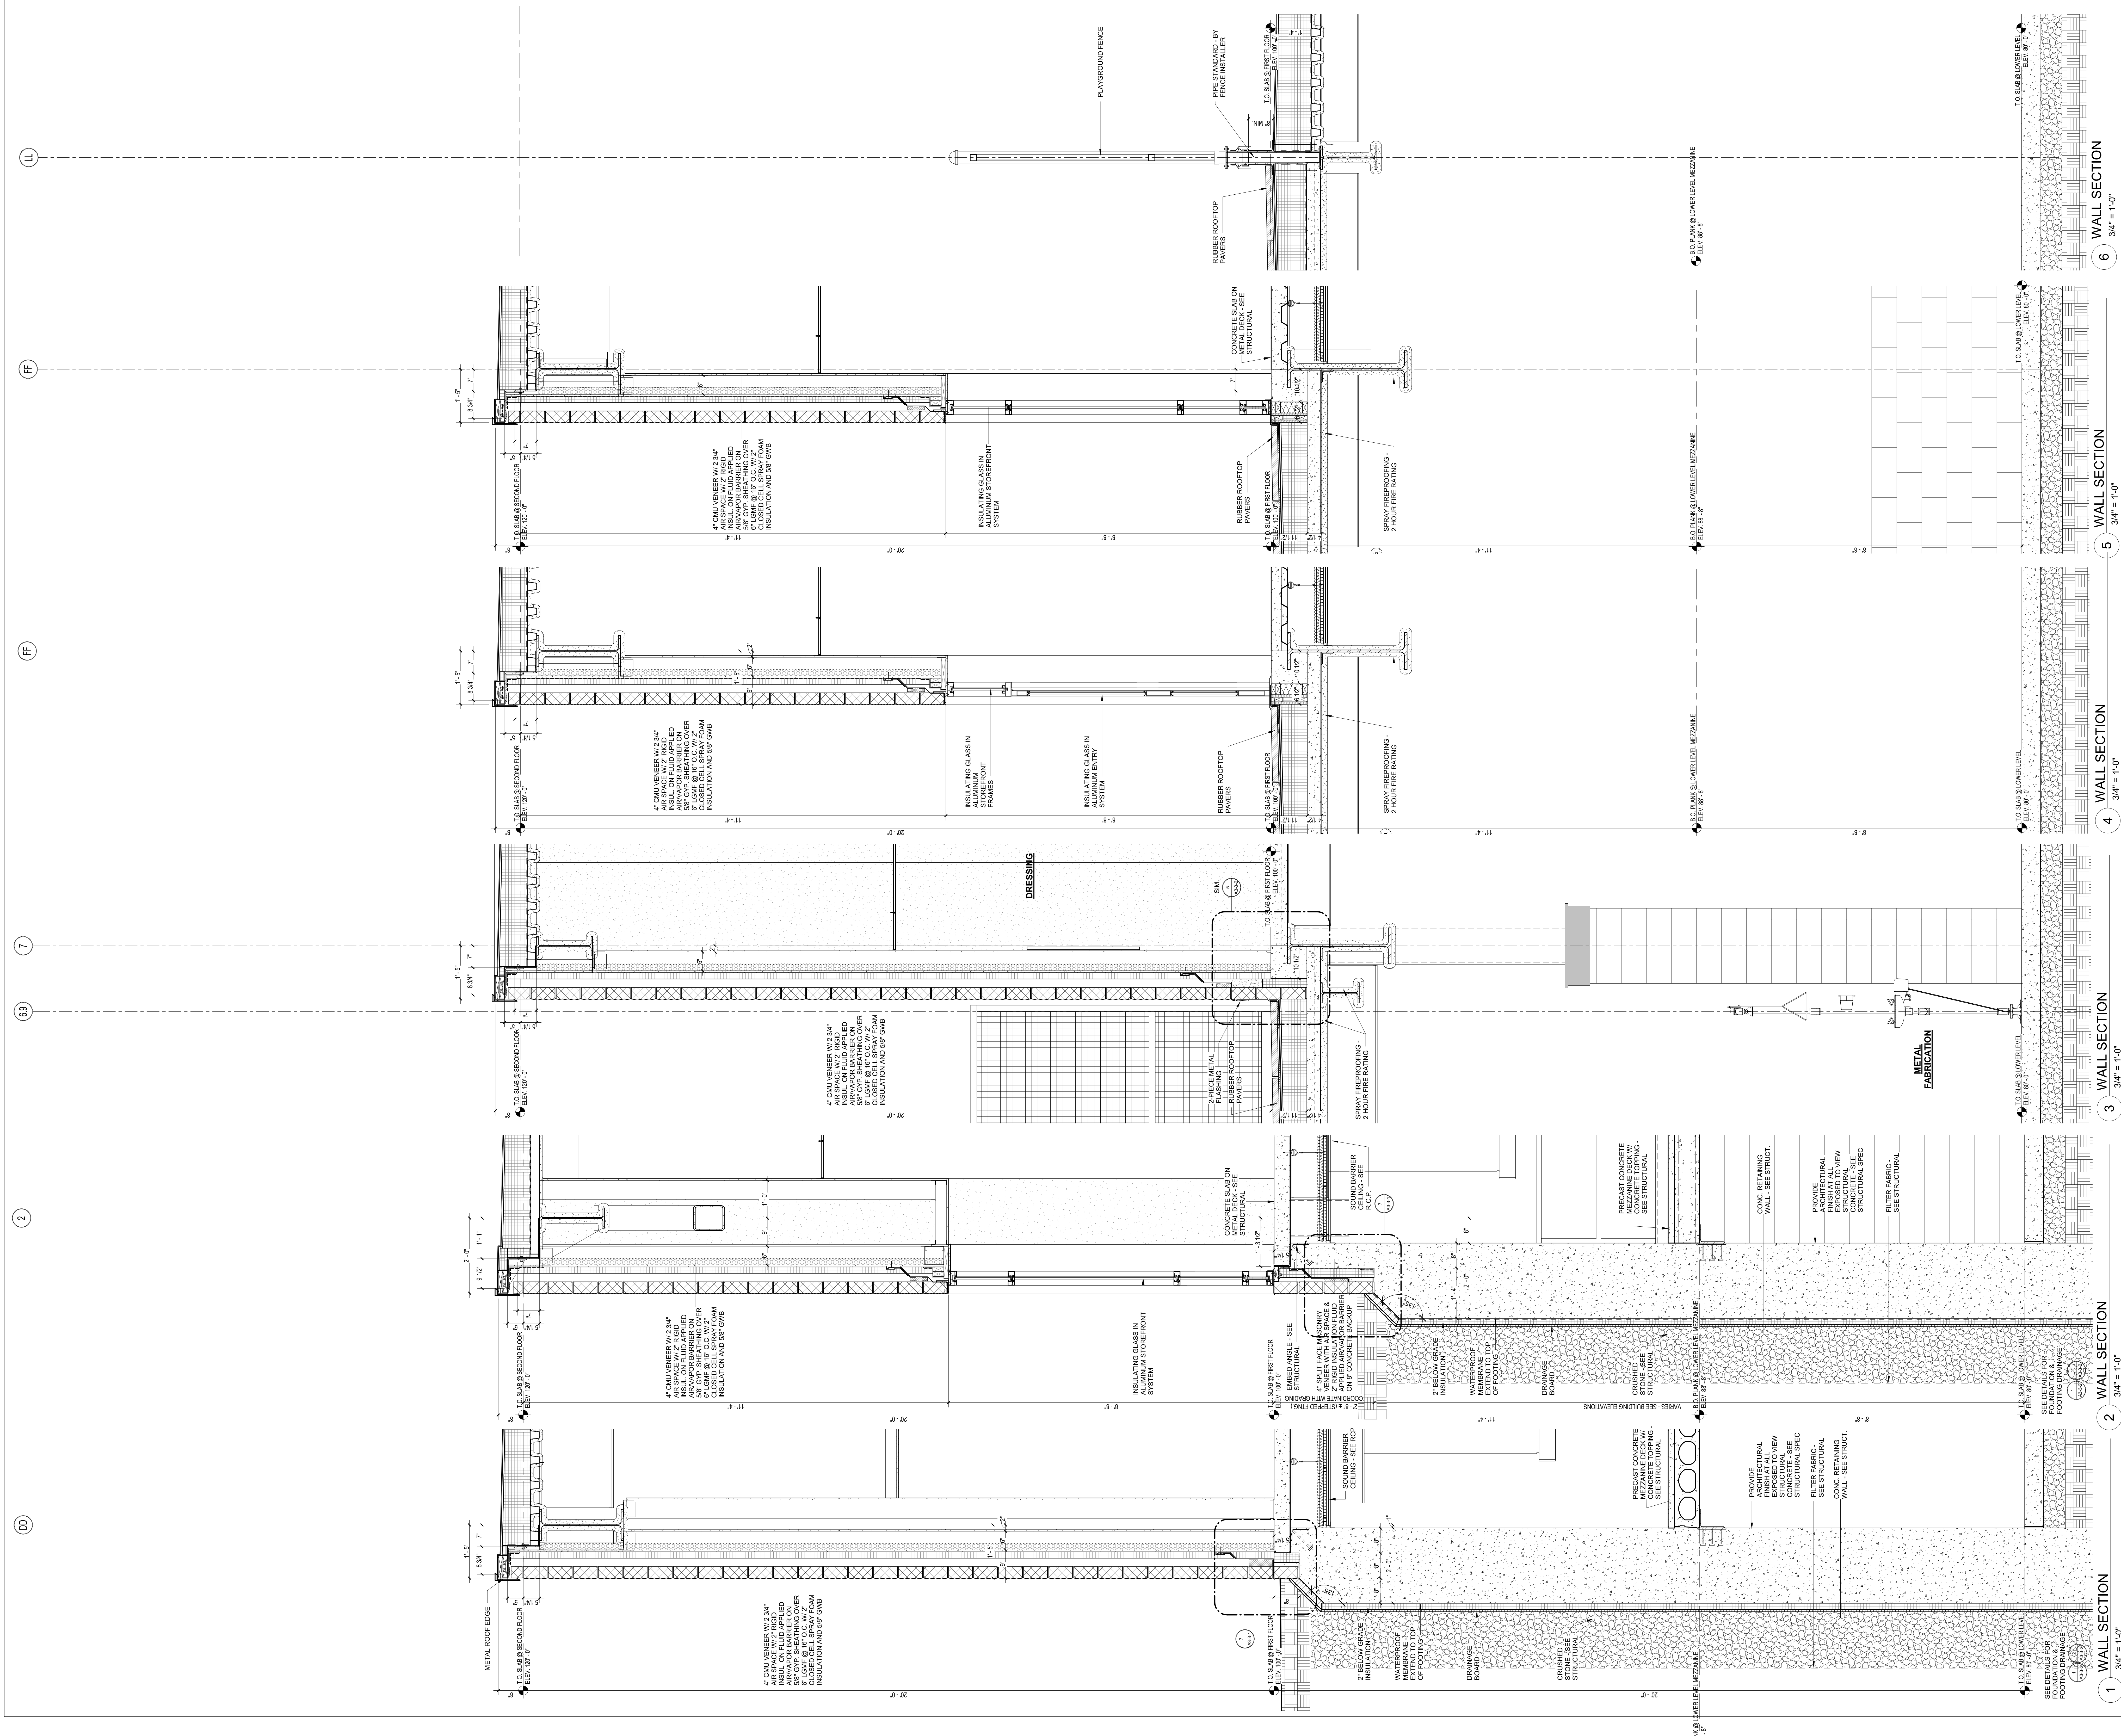


100 Hemlock Road,
Wakefield, MA 01880



Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A3-2-15

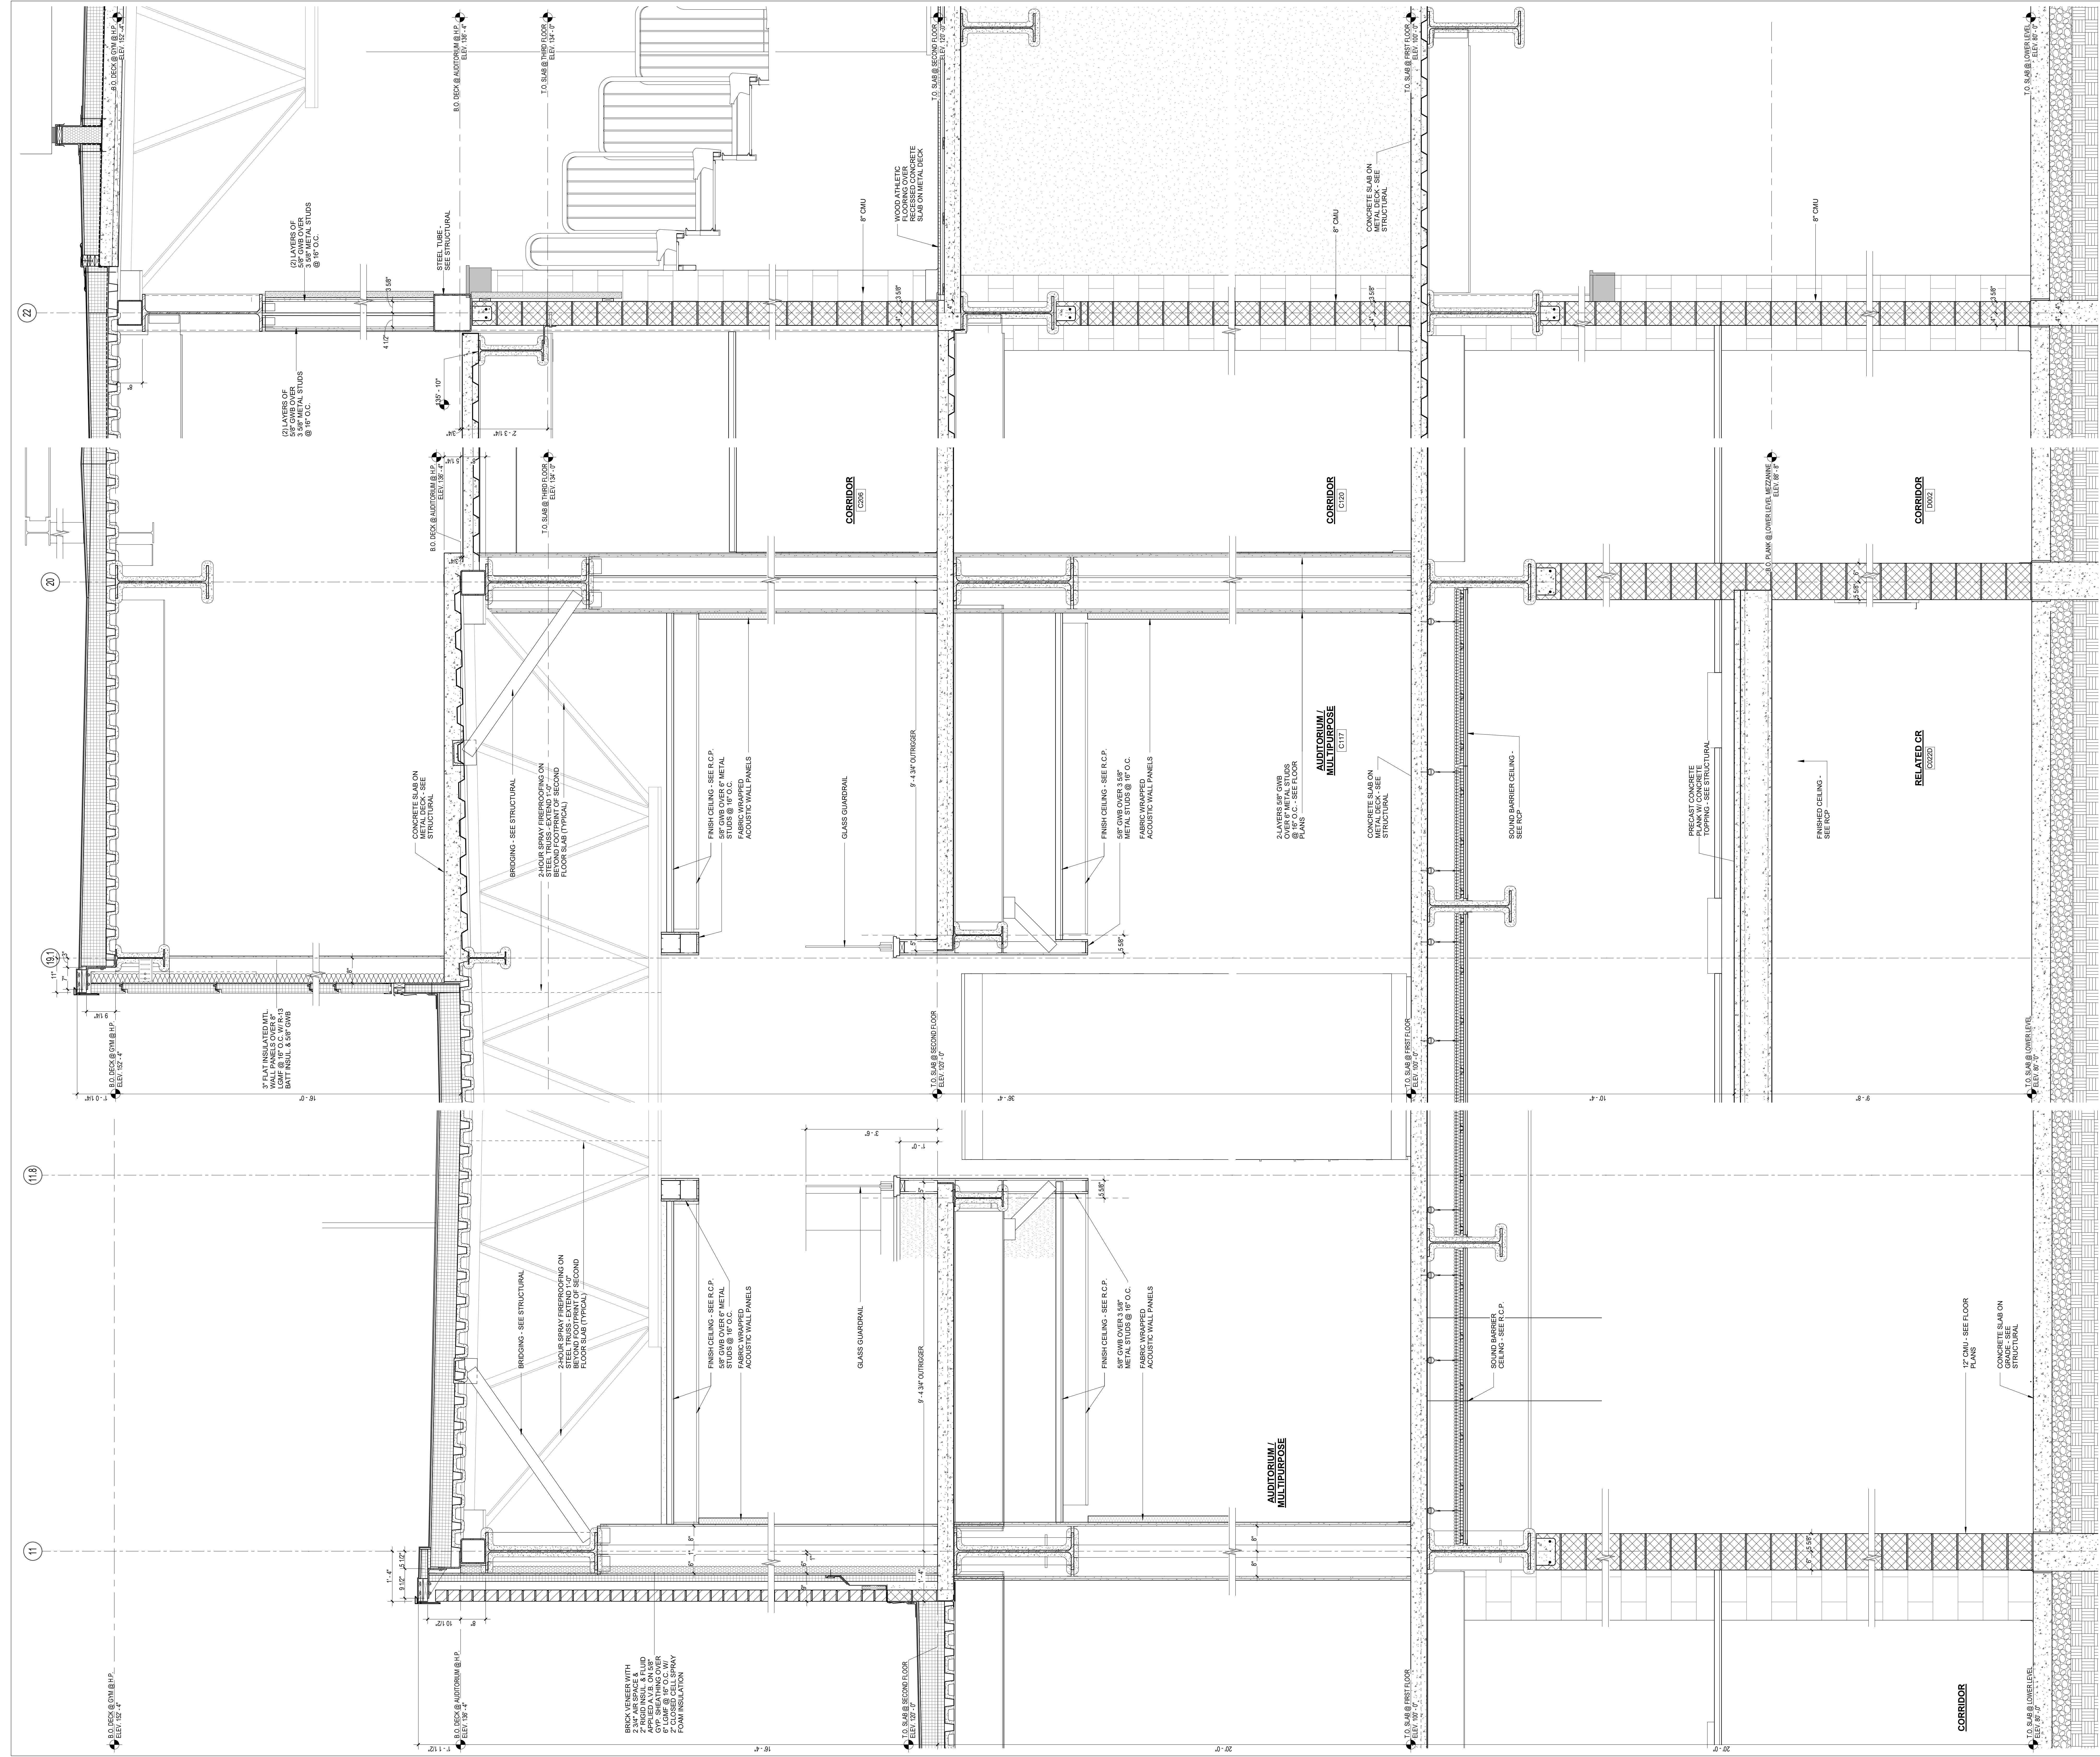

DRA

Drummeys Rosane Anderson, Inc.

225 Oakland Road
Studio 205
South Windsor, CT
06074

260 Charles Street
Studio 300
Waltham, MA
02453

Tel: 617.854.1700
www.drainc.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A

B

C

D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4

A3-2-16

Northeast Metropolitan Regional Vocational High School


100 Hemlock Road,
Wakefield, MA 01880

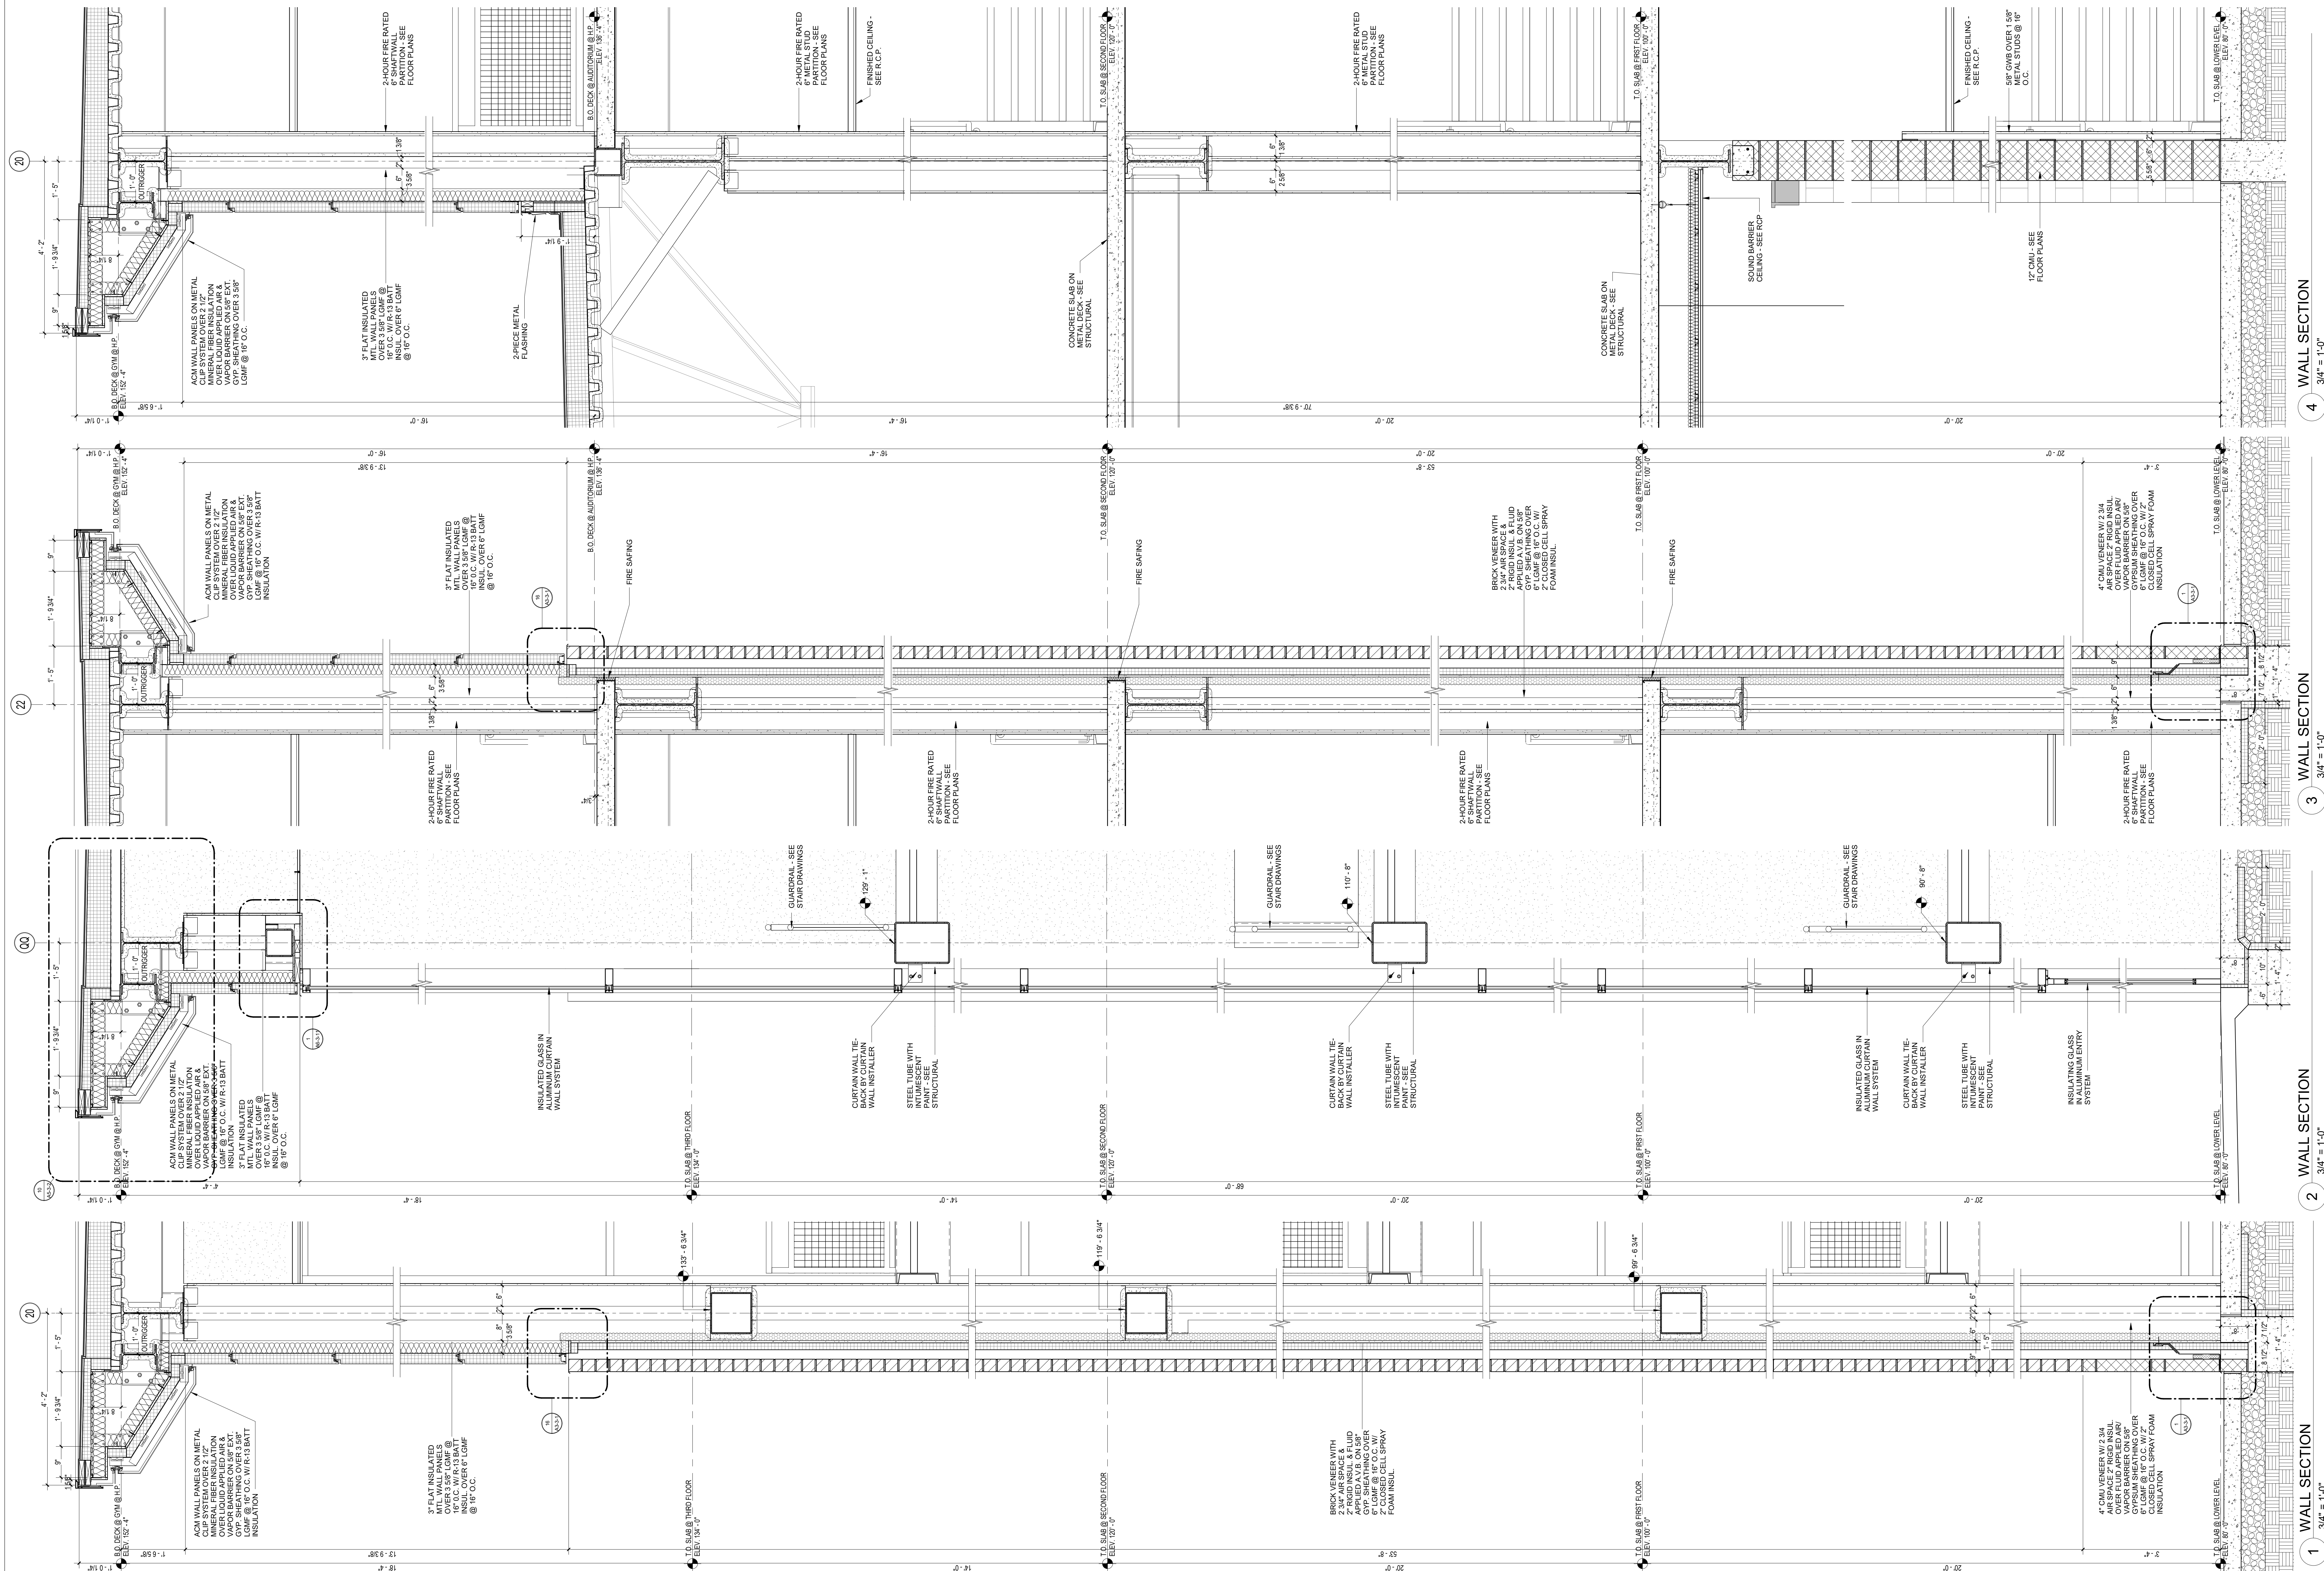

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

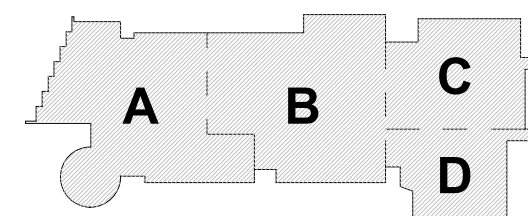


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



WALL SECTIONS

Scale: 3/4" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-17

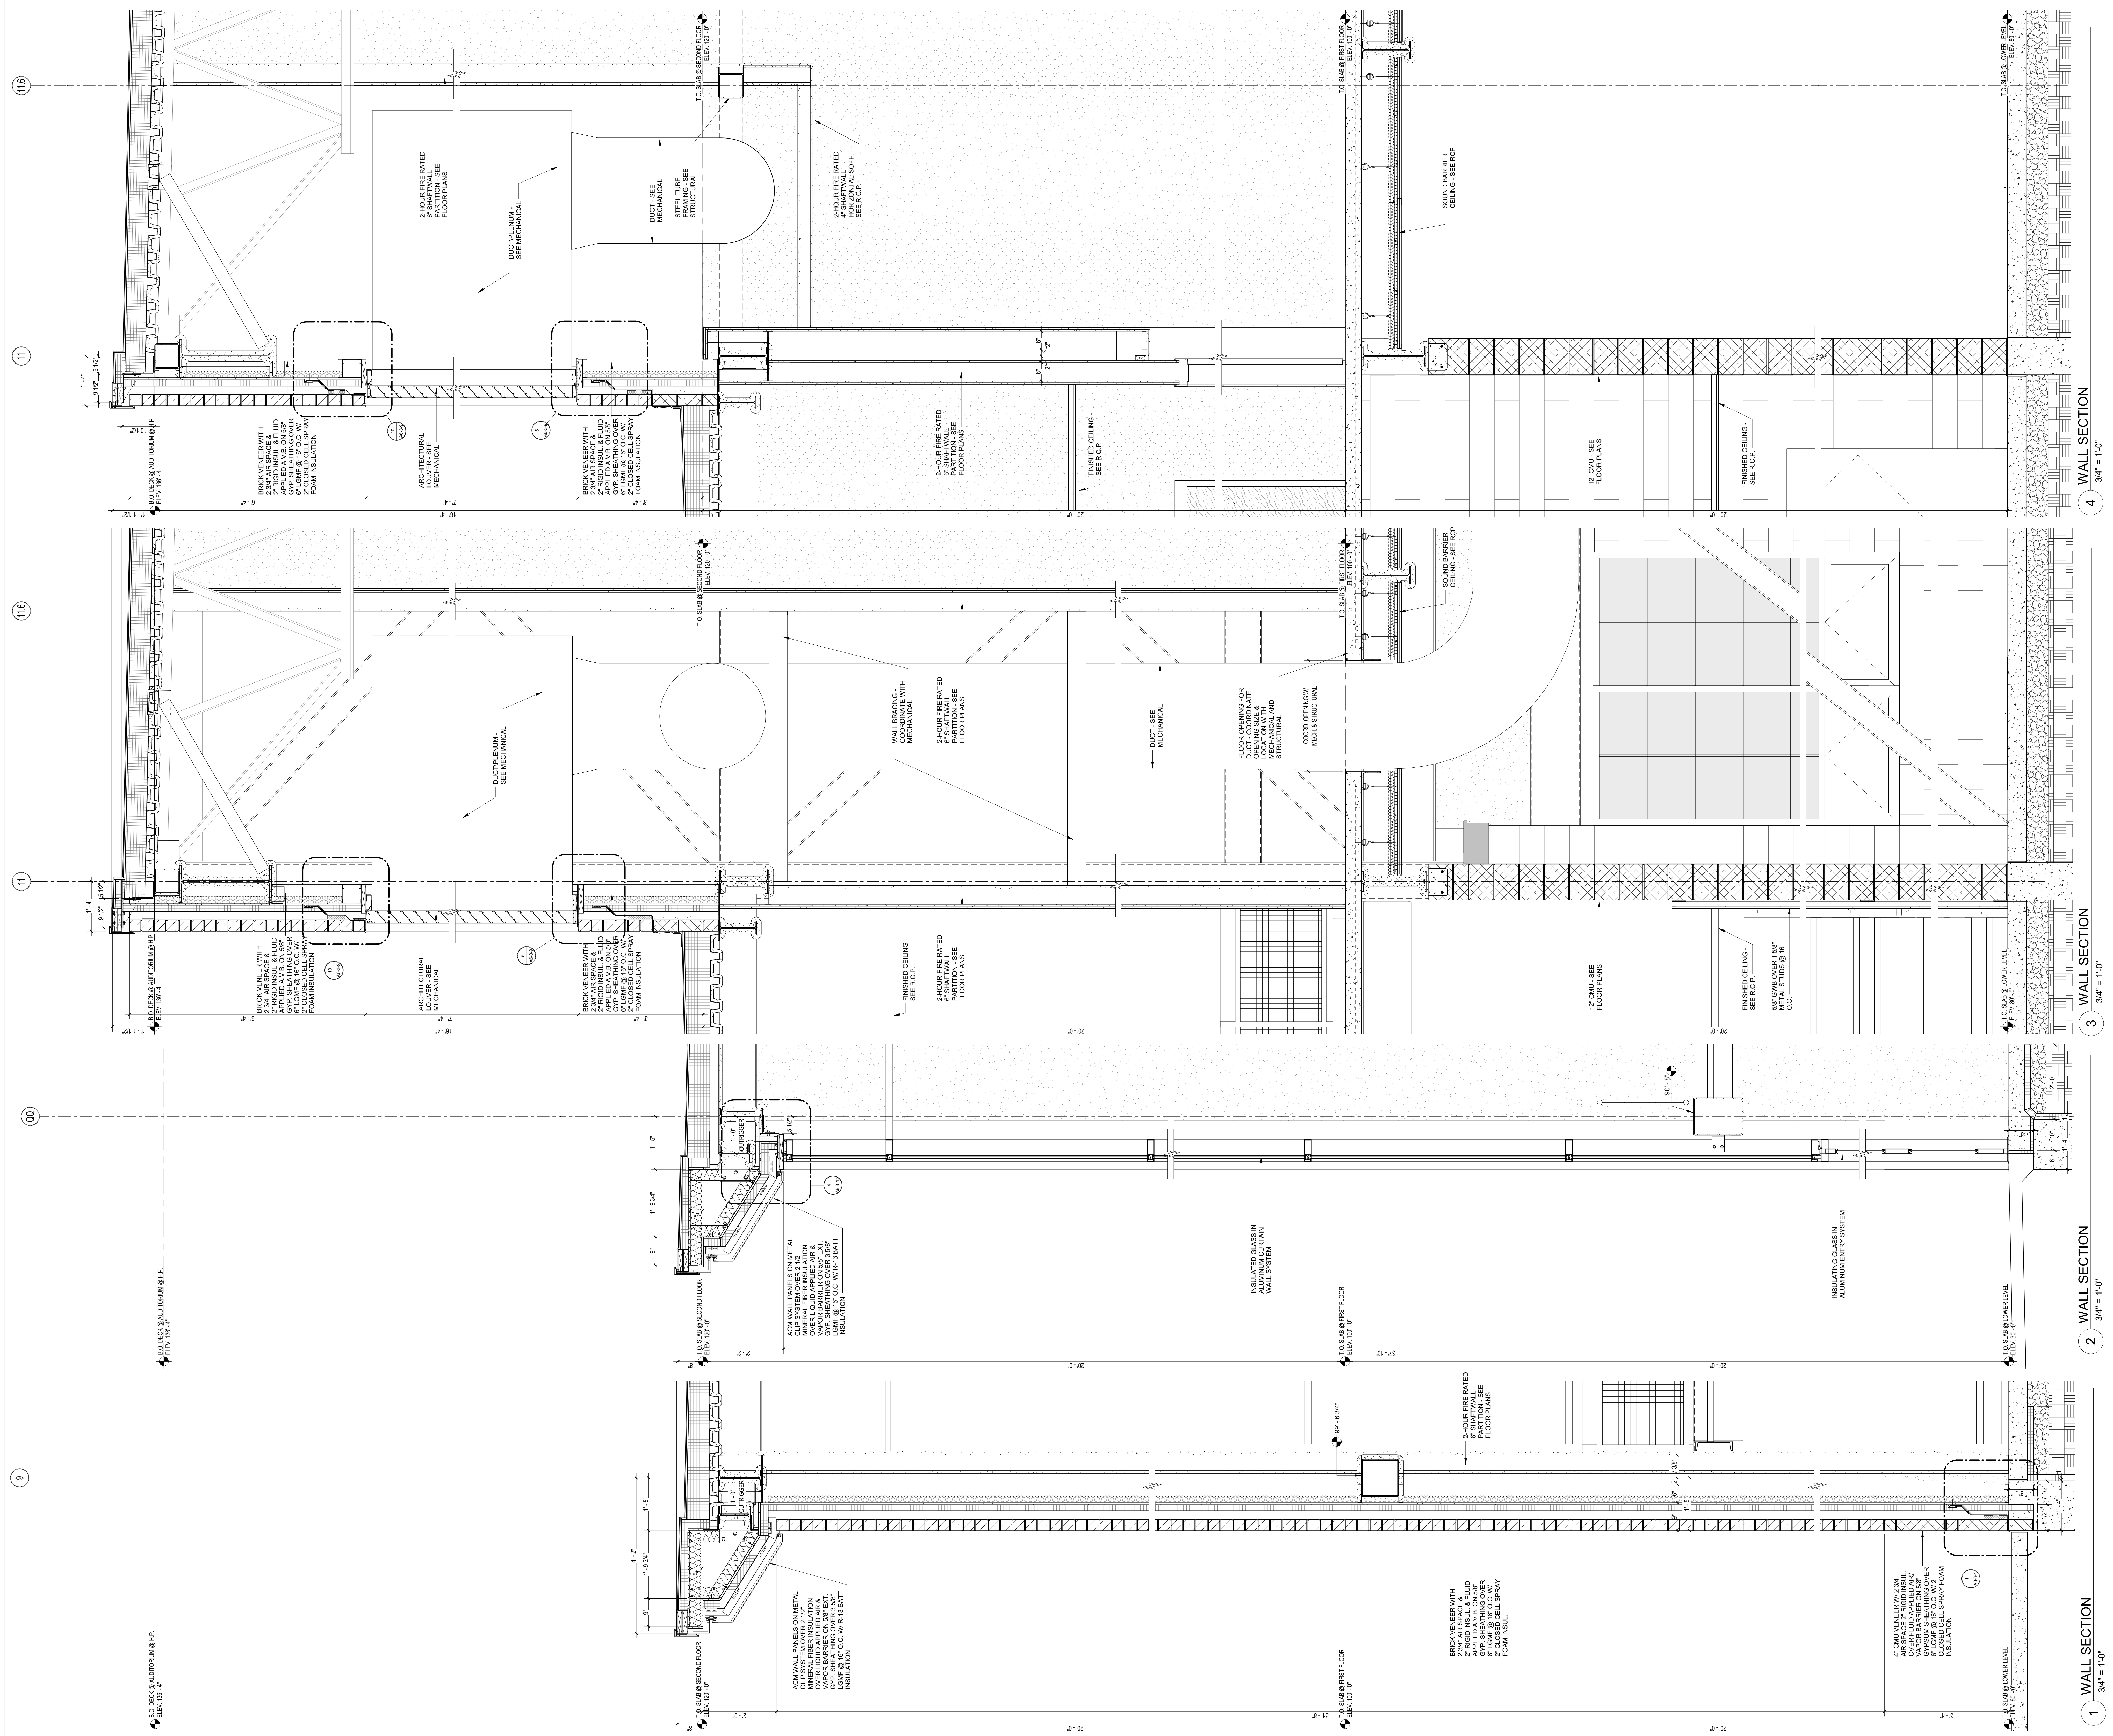

DRA

Drumme Rosane Anderson, Inc.

225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Tel: 617.854.1702
www.drainc.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH


MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A3-2-18

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

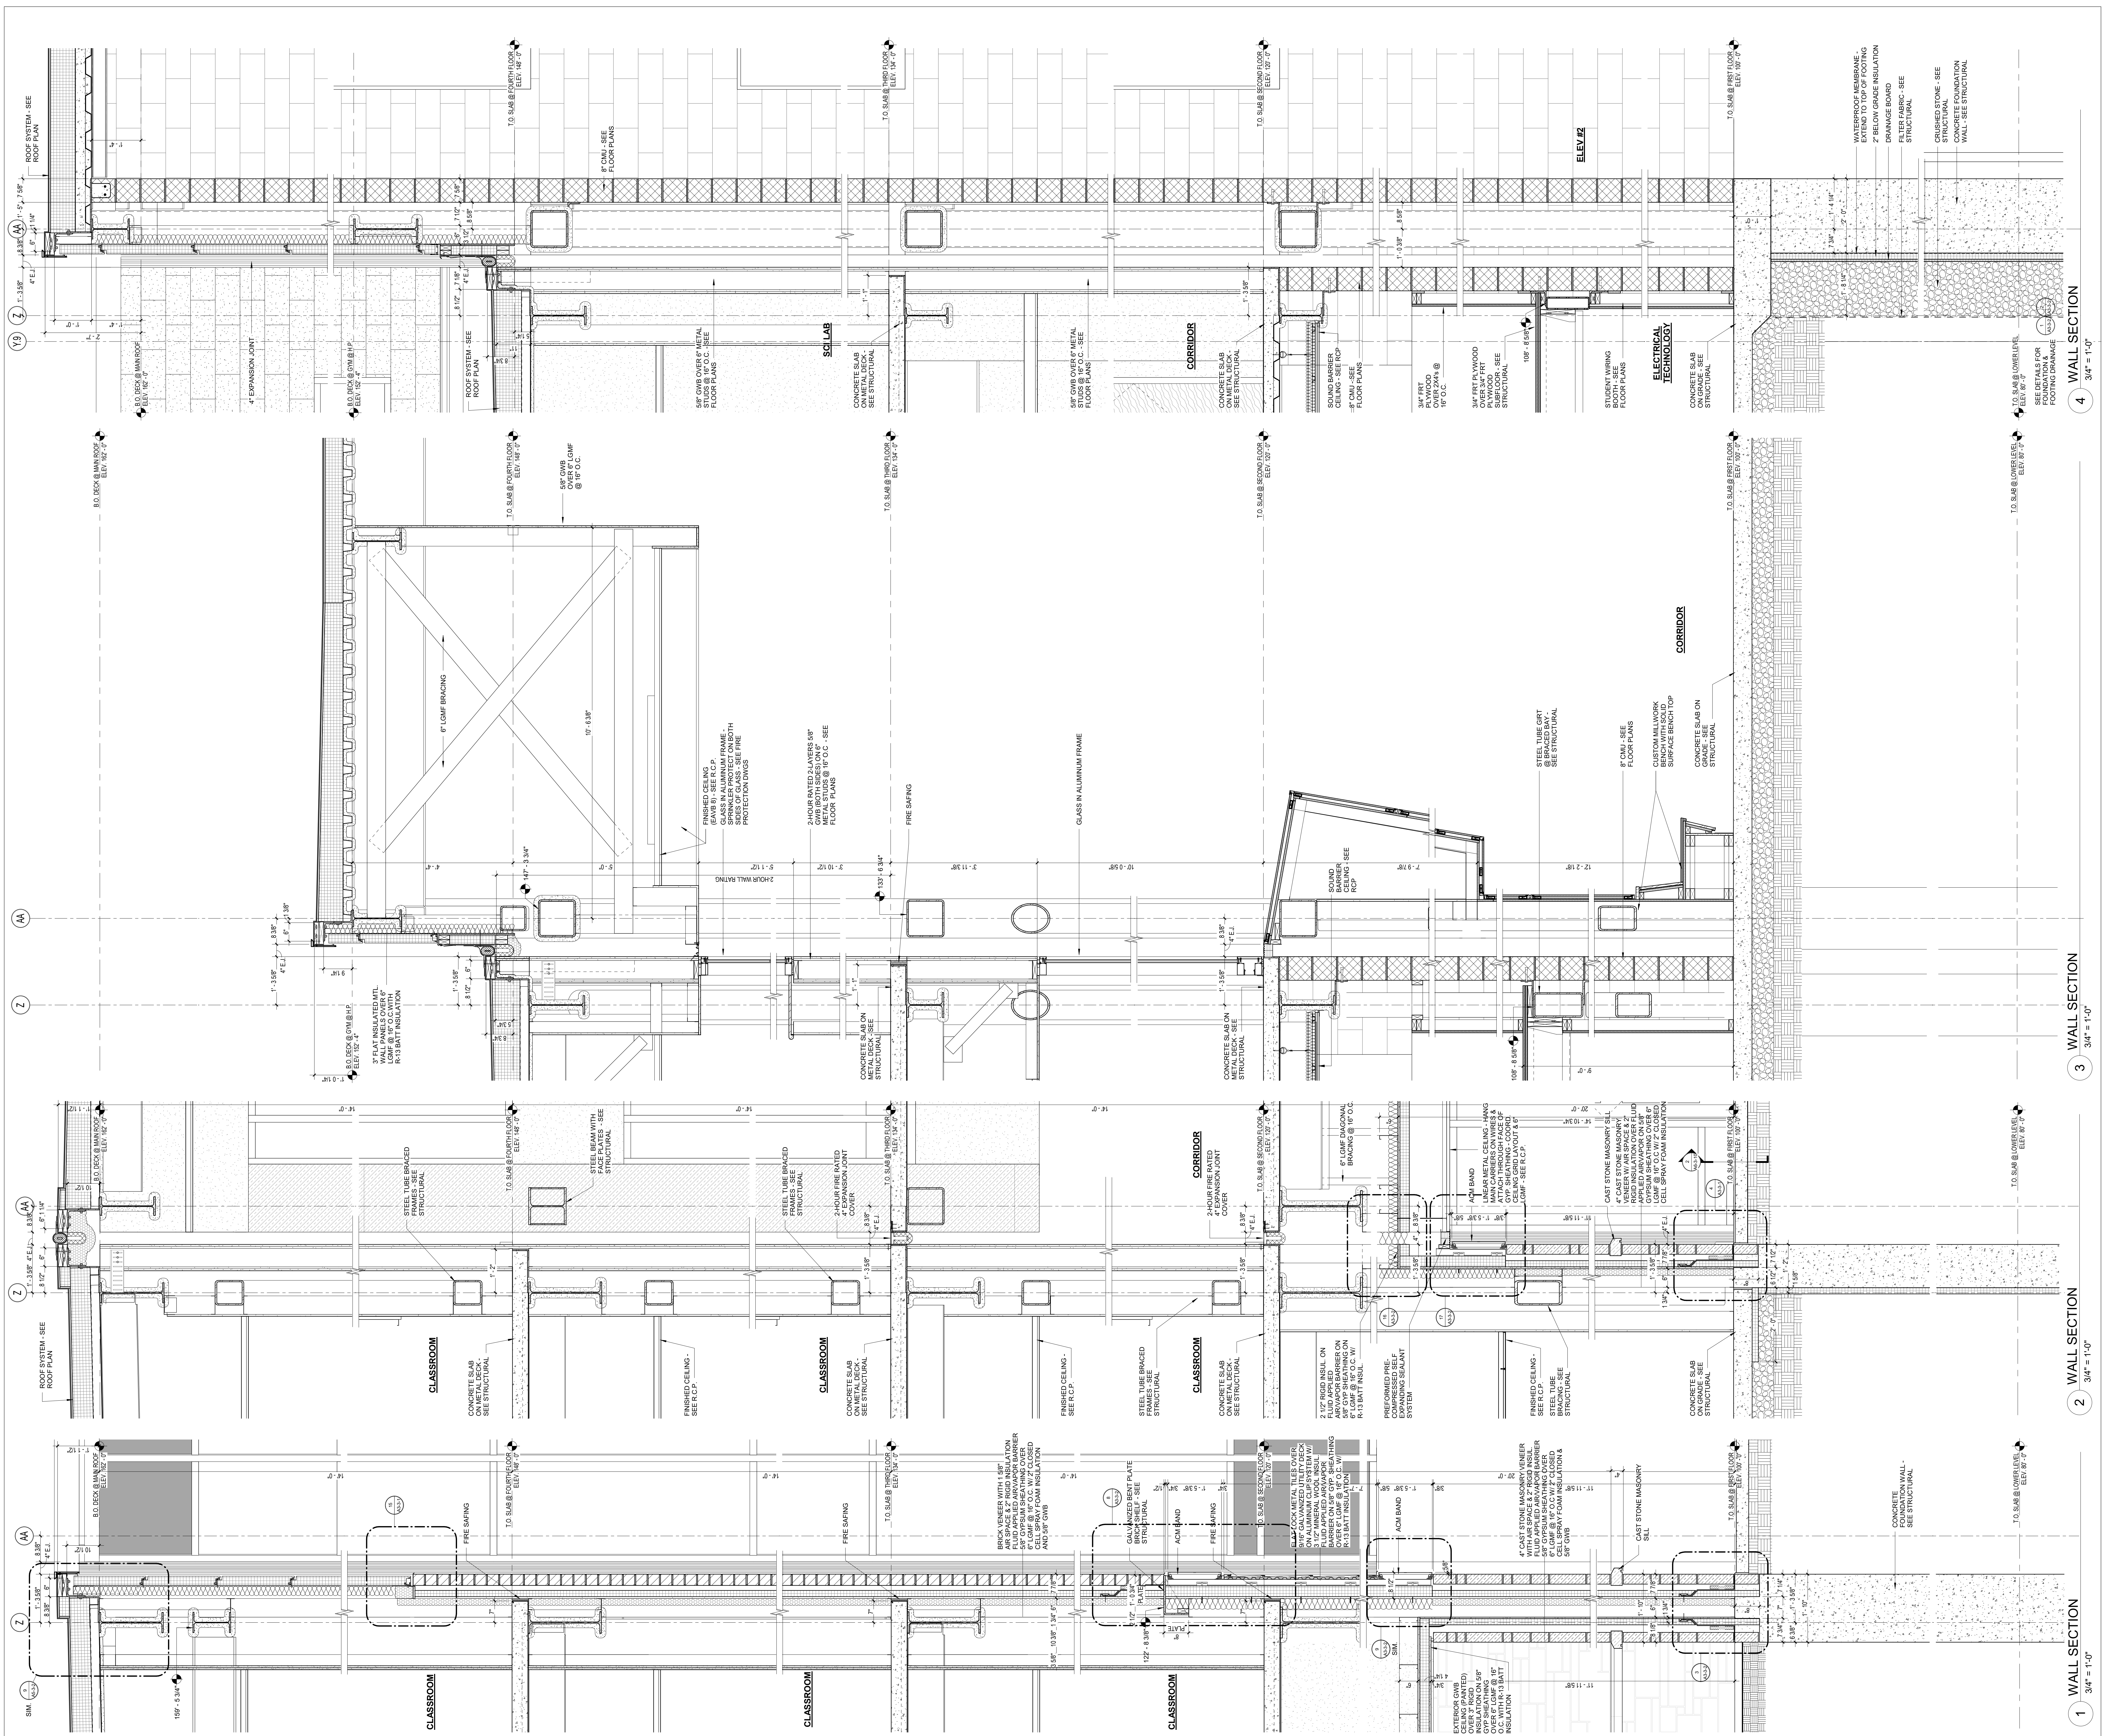

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.864.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453
Tel: 617.864.1702
www.dra.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023


KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A3-2-19

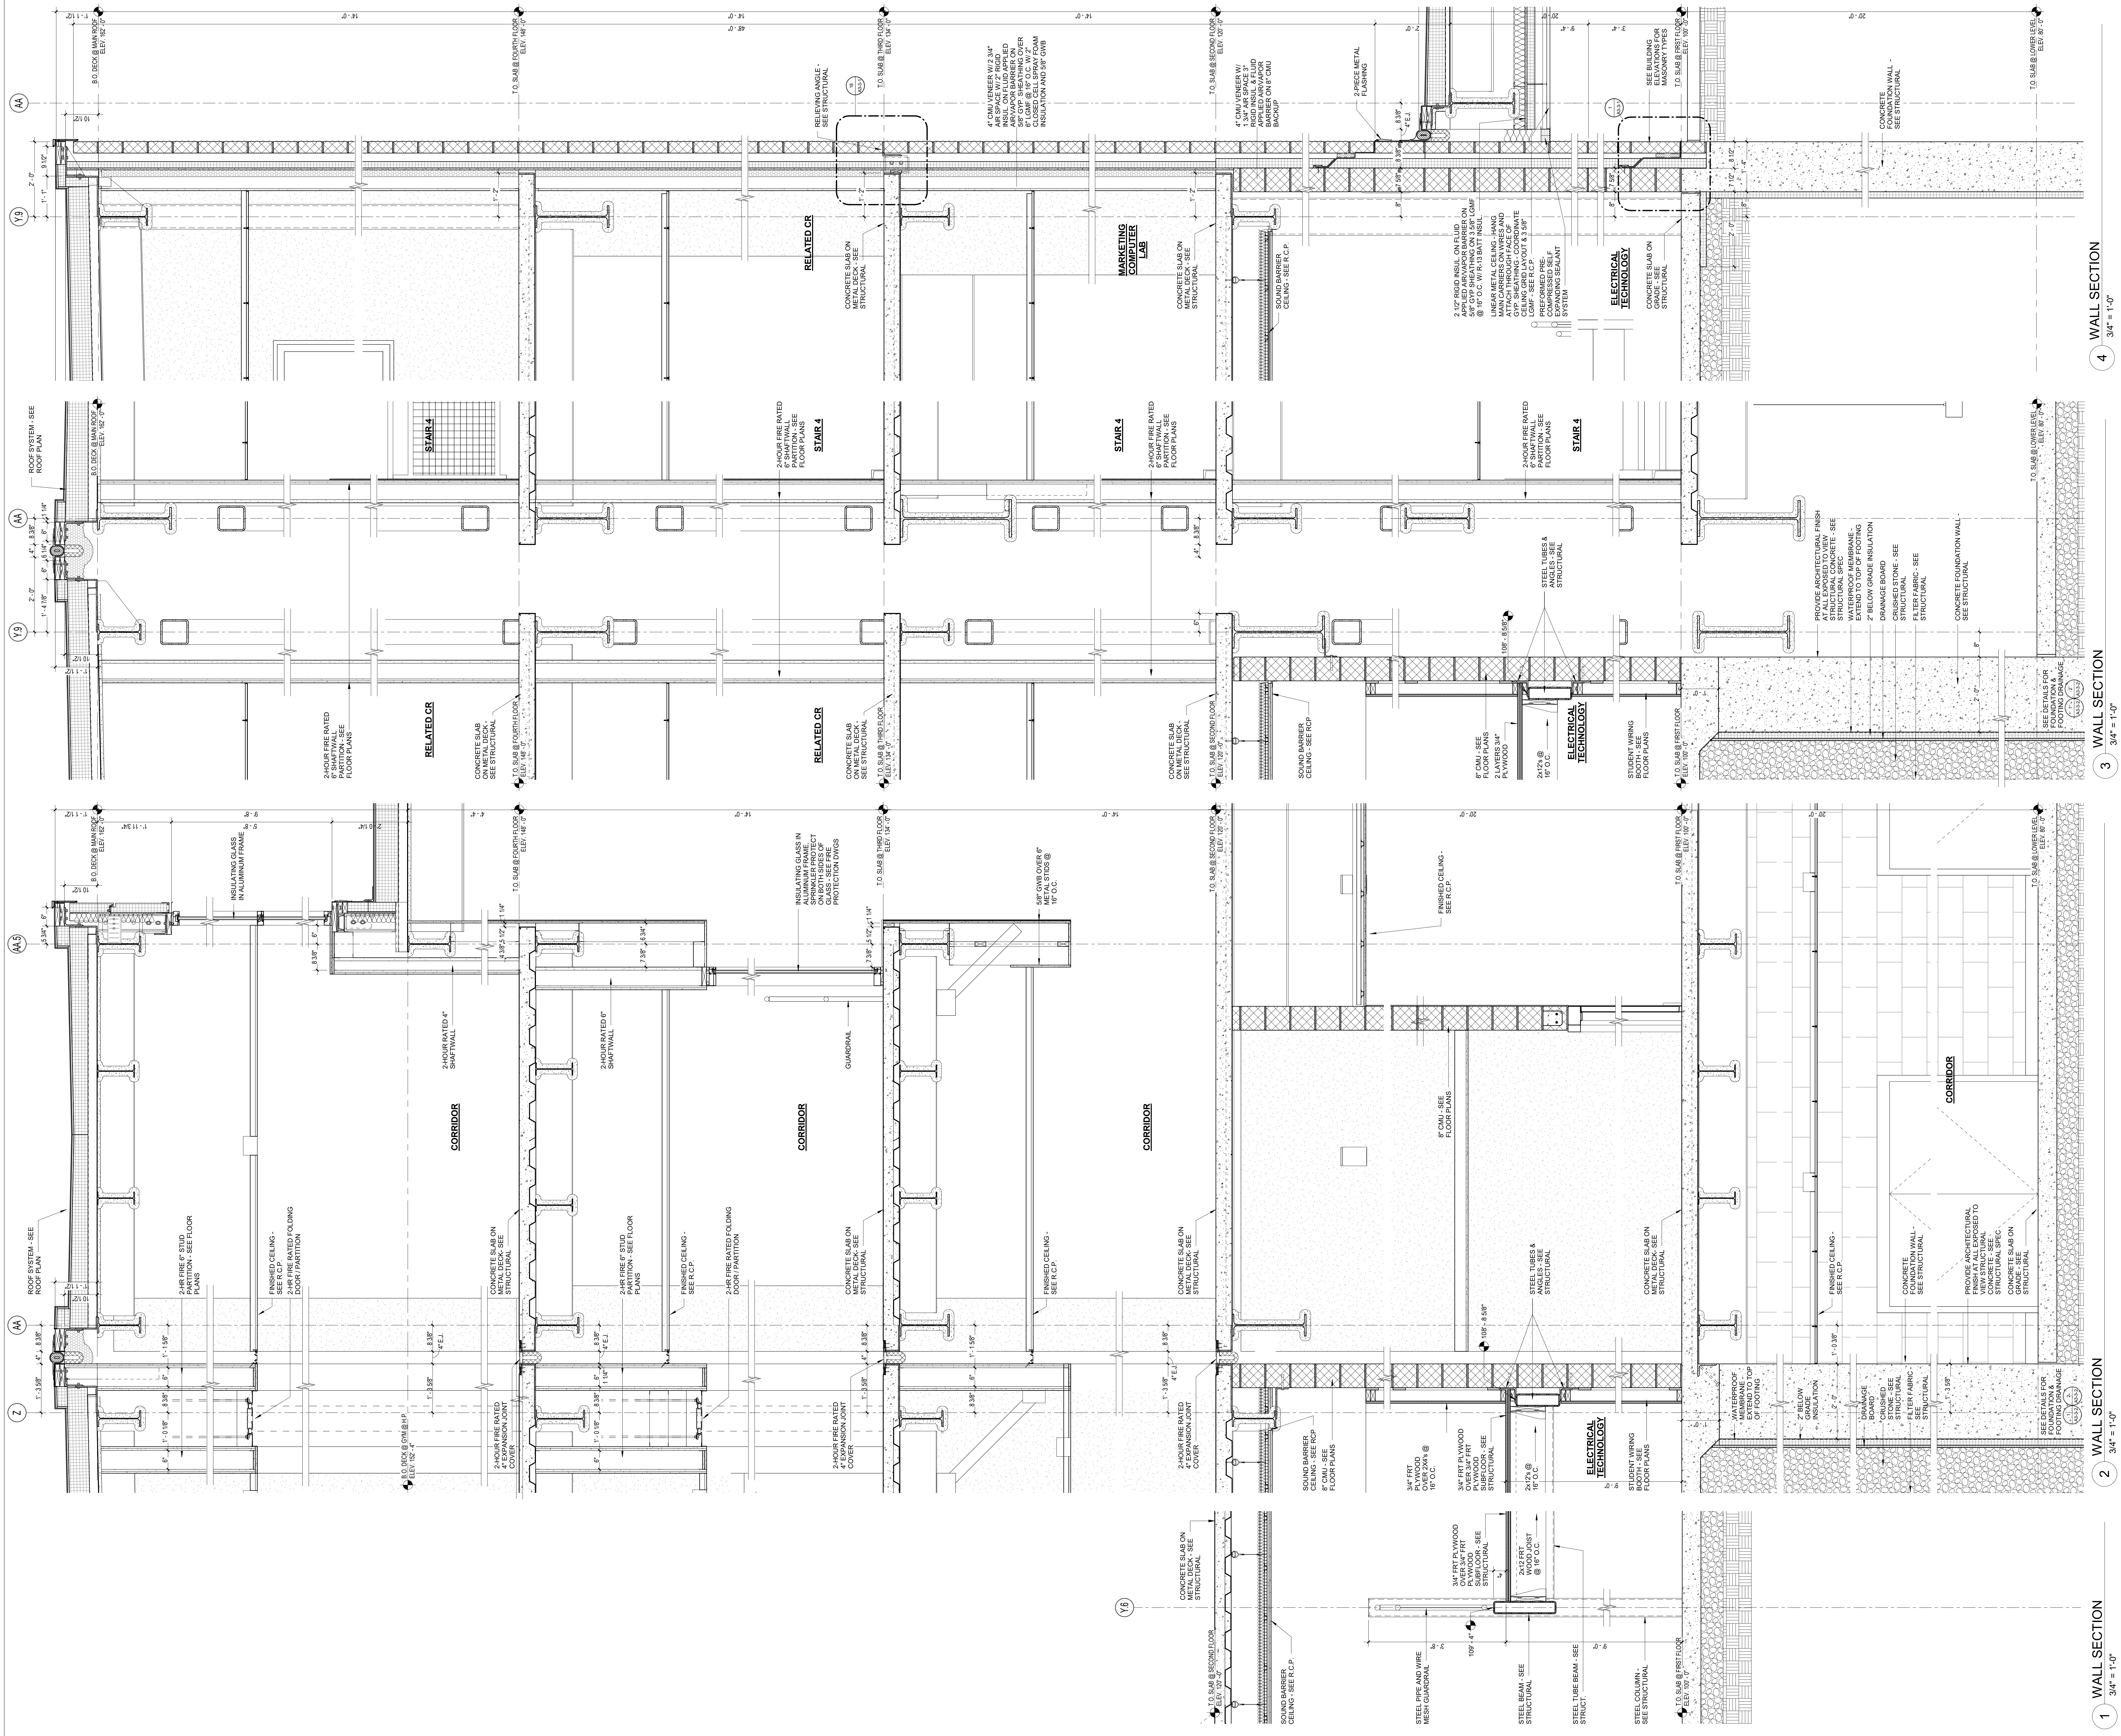

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 817.854.1700
www.dra.com

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road, Wakefield, MA 01880

MSBA 90% CD SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-20

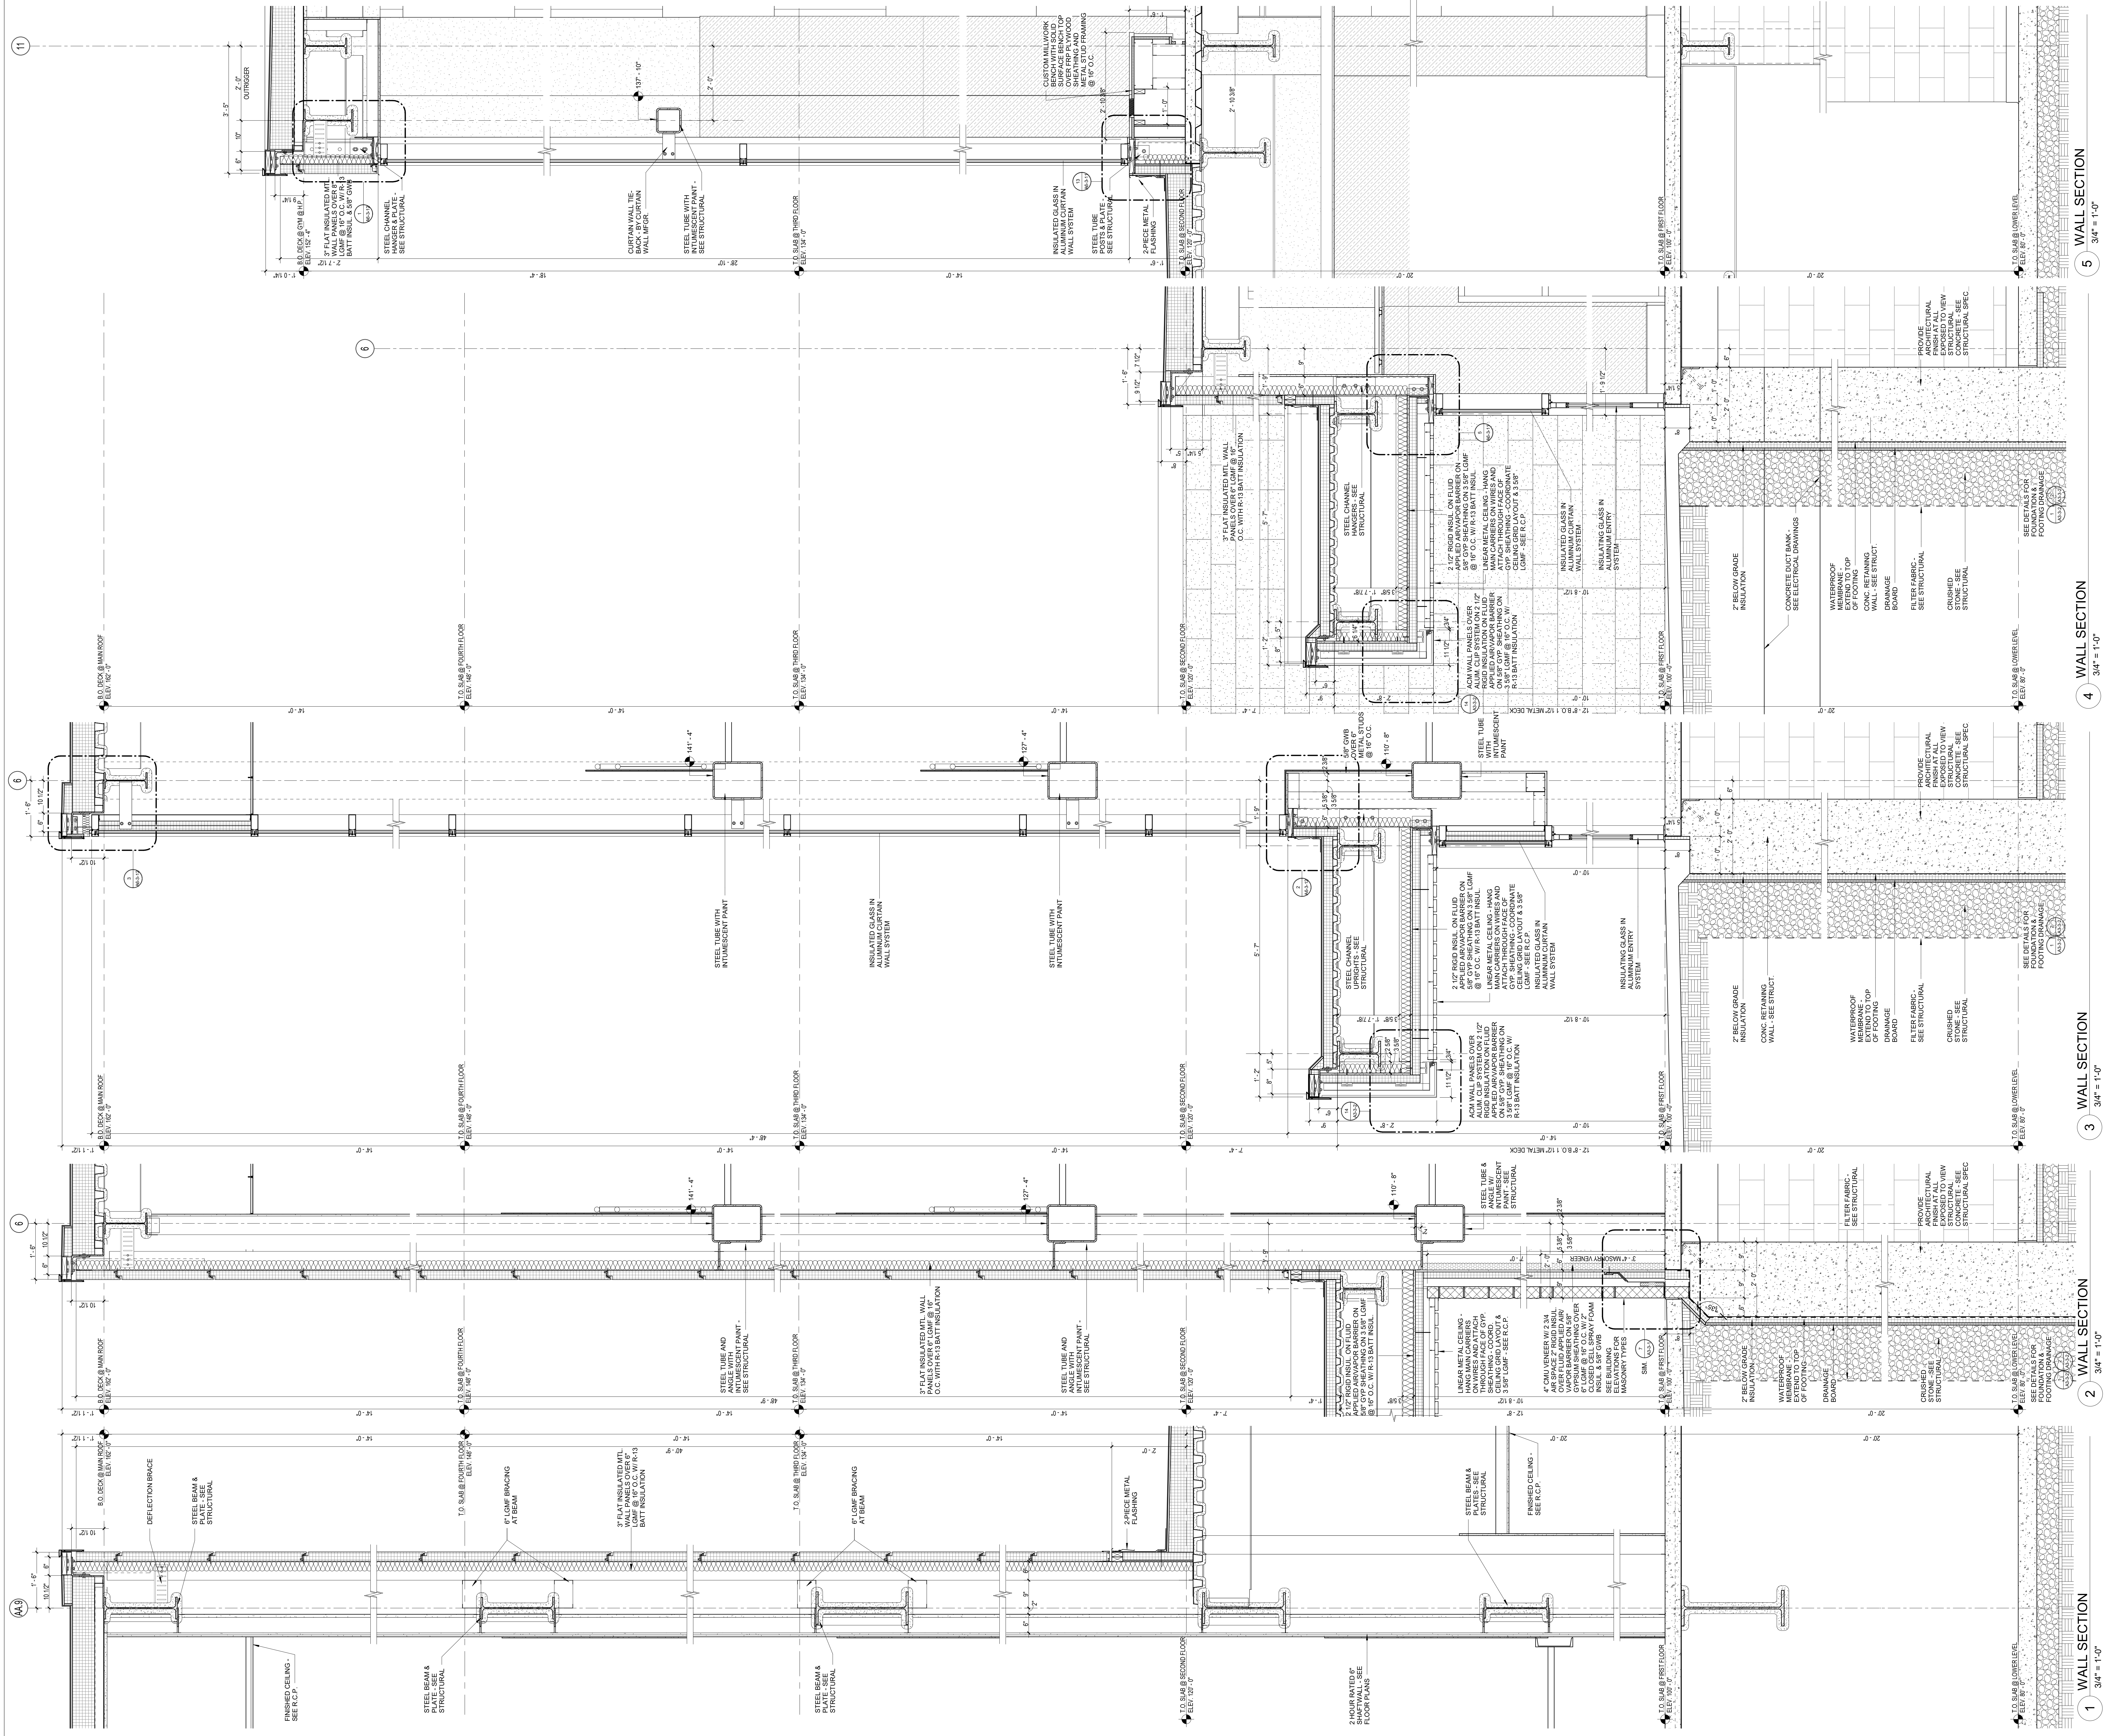

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.864.1700
www.draa.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.864.1700
www.draa.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

PROJECT NORTH

MAGNETIC NORTH

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

KEY PLAN

A B C D


MSBA 90% CD
SUBMISSION


May 12TH, 2023

WALL SECTIONS

A3-2-21

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

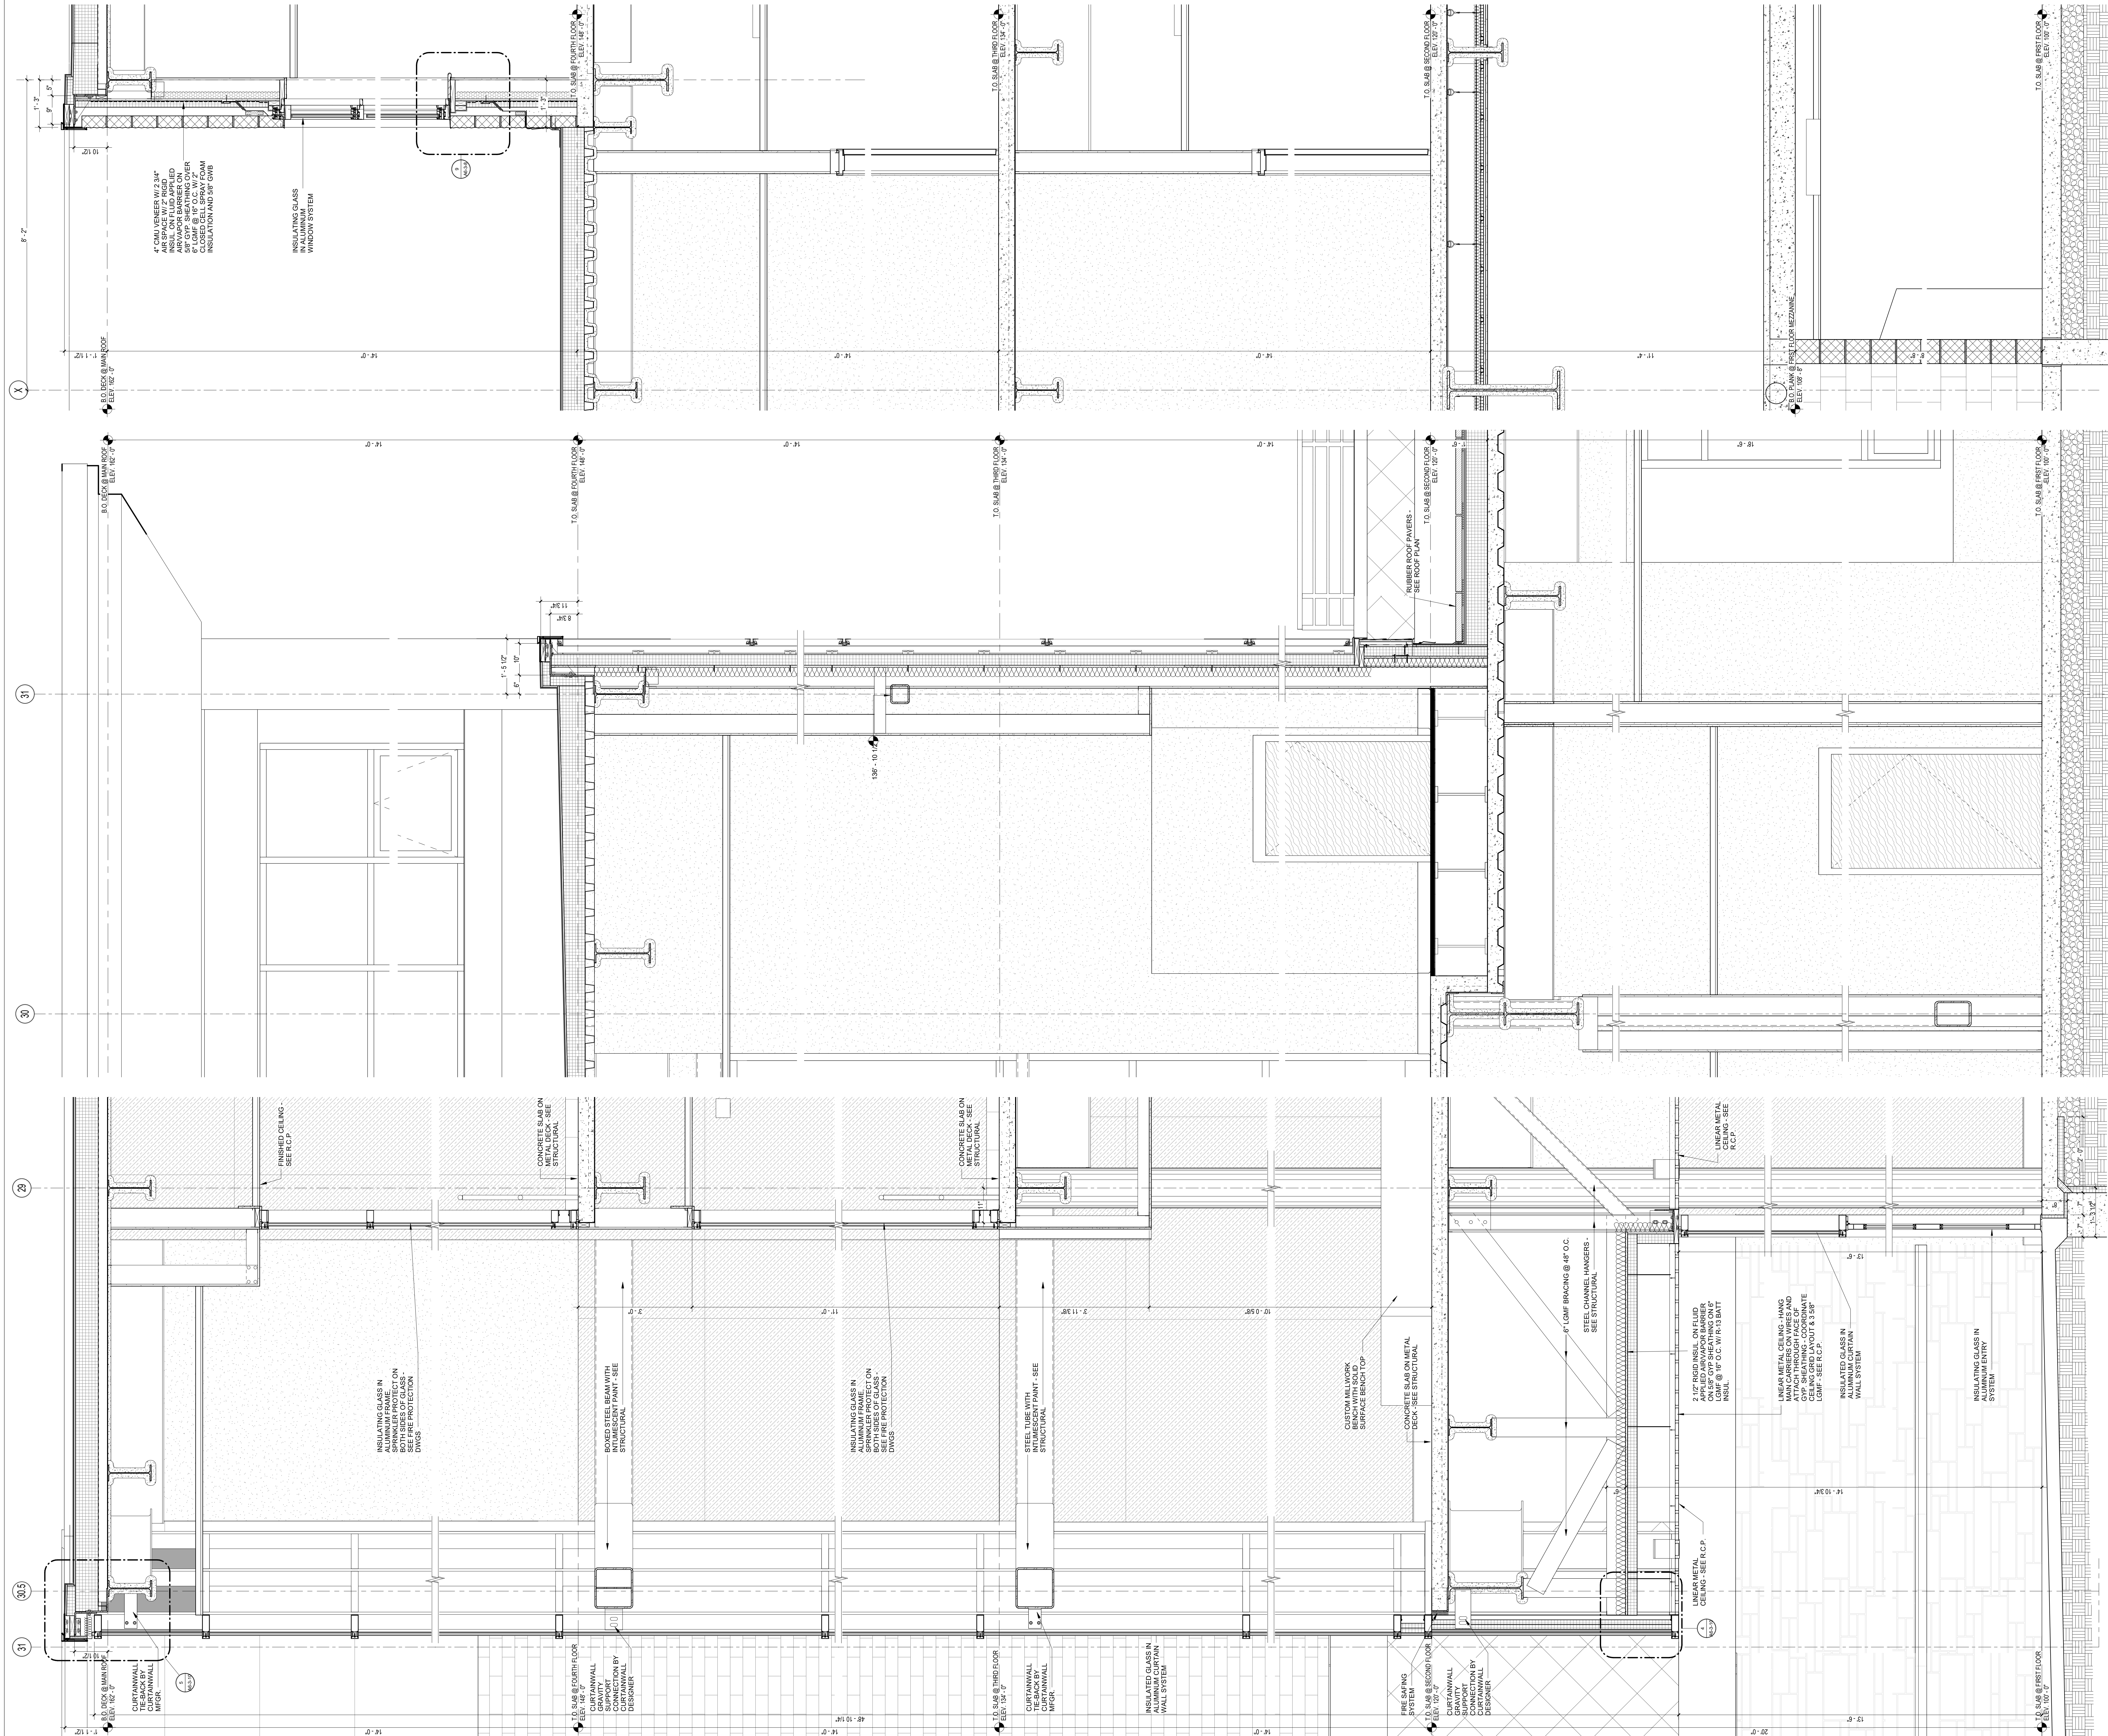

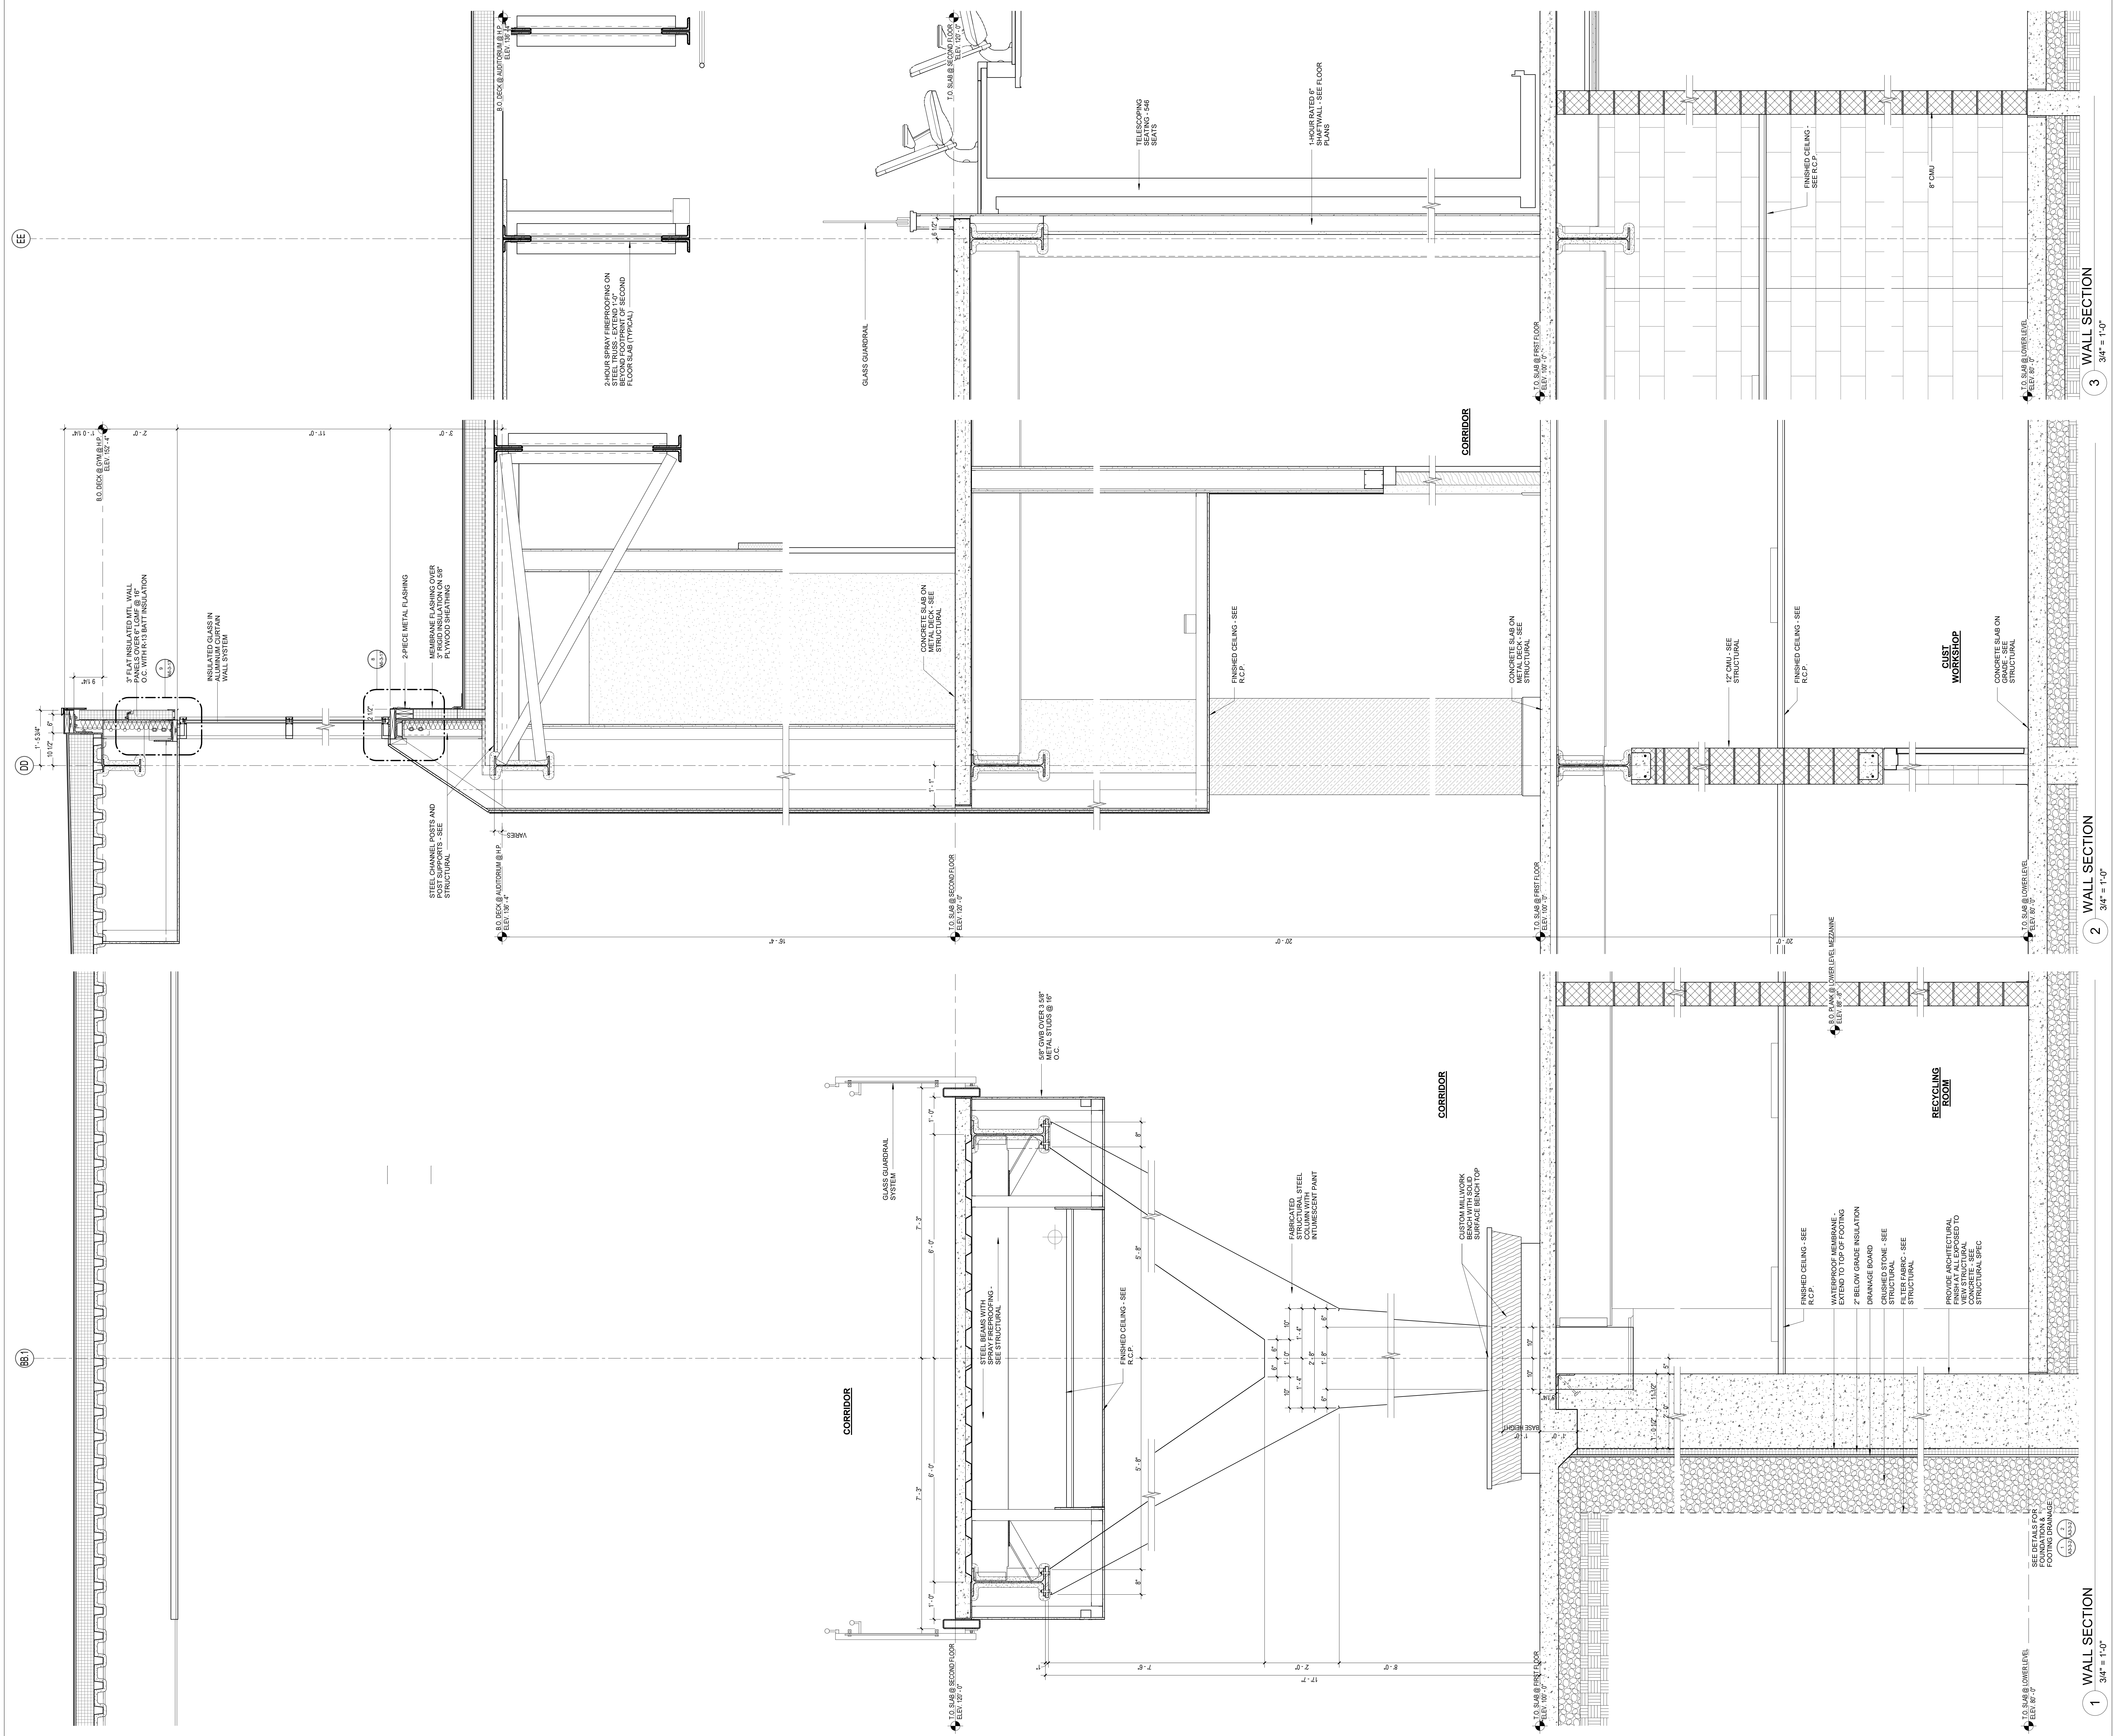

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road, Wakefield, MA 01880

MSBA 90% CD SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A3-2-23

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

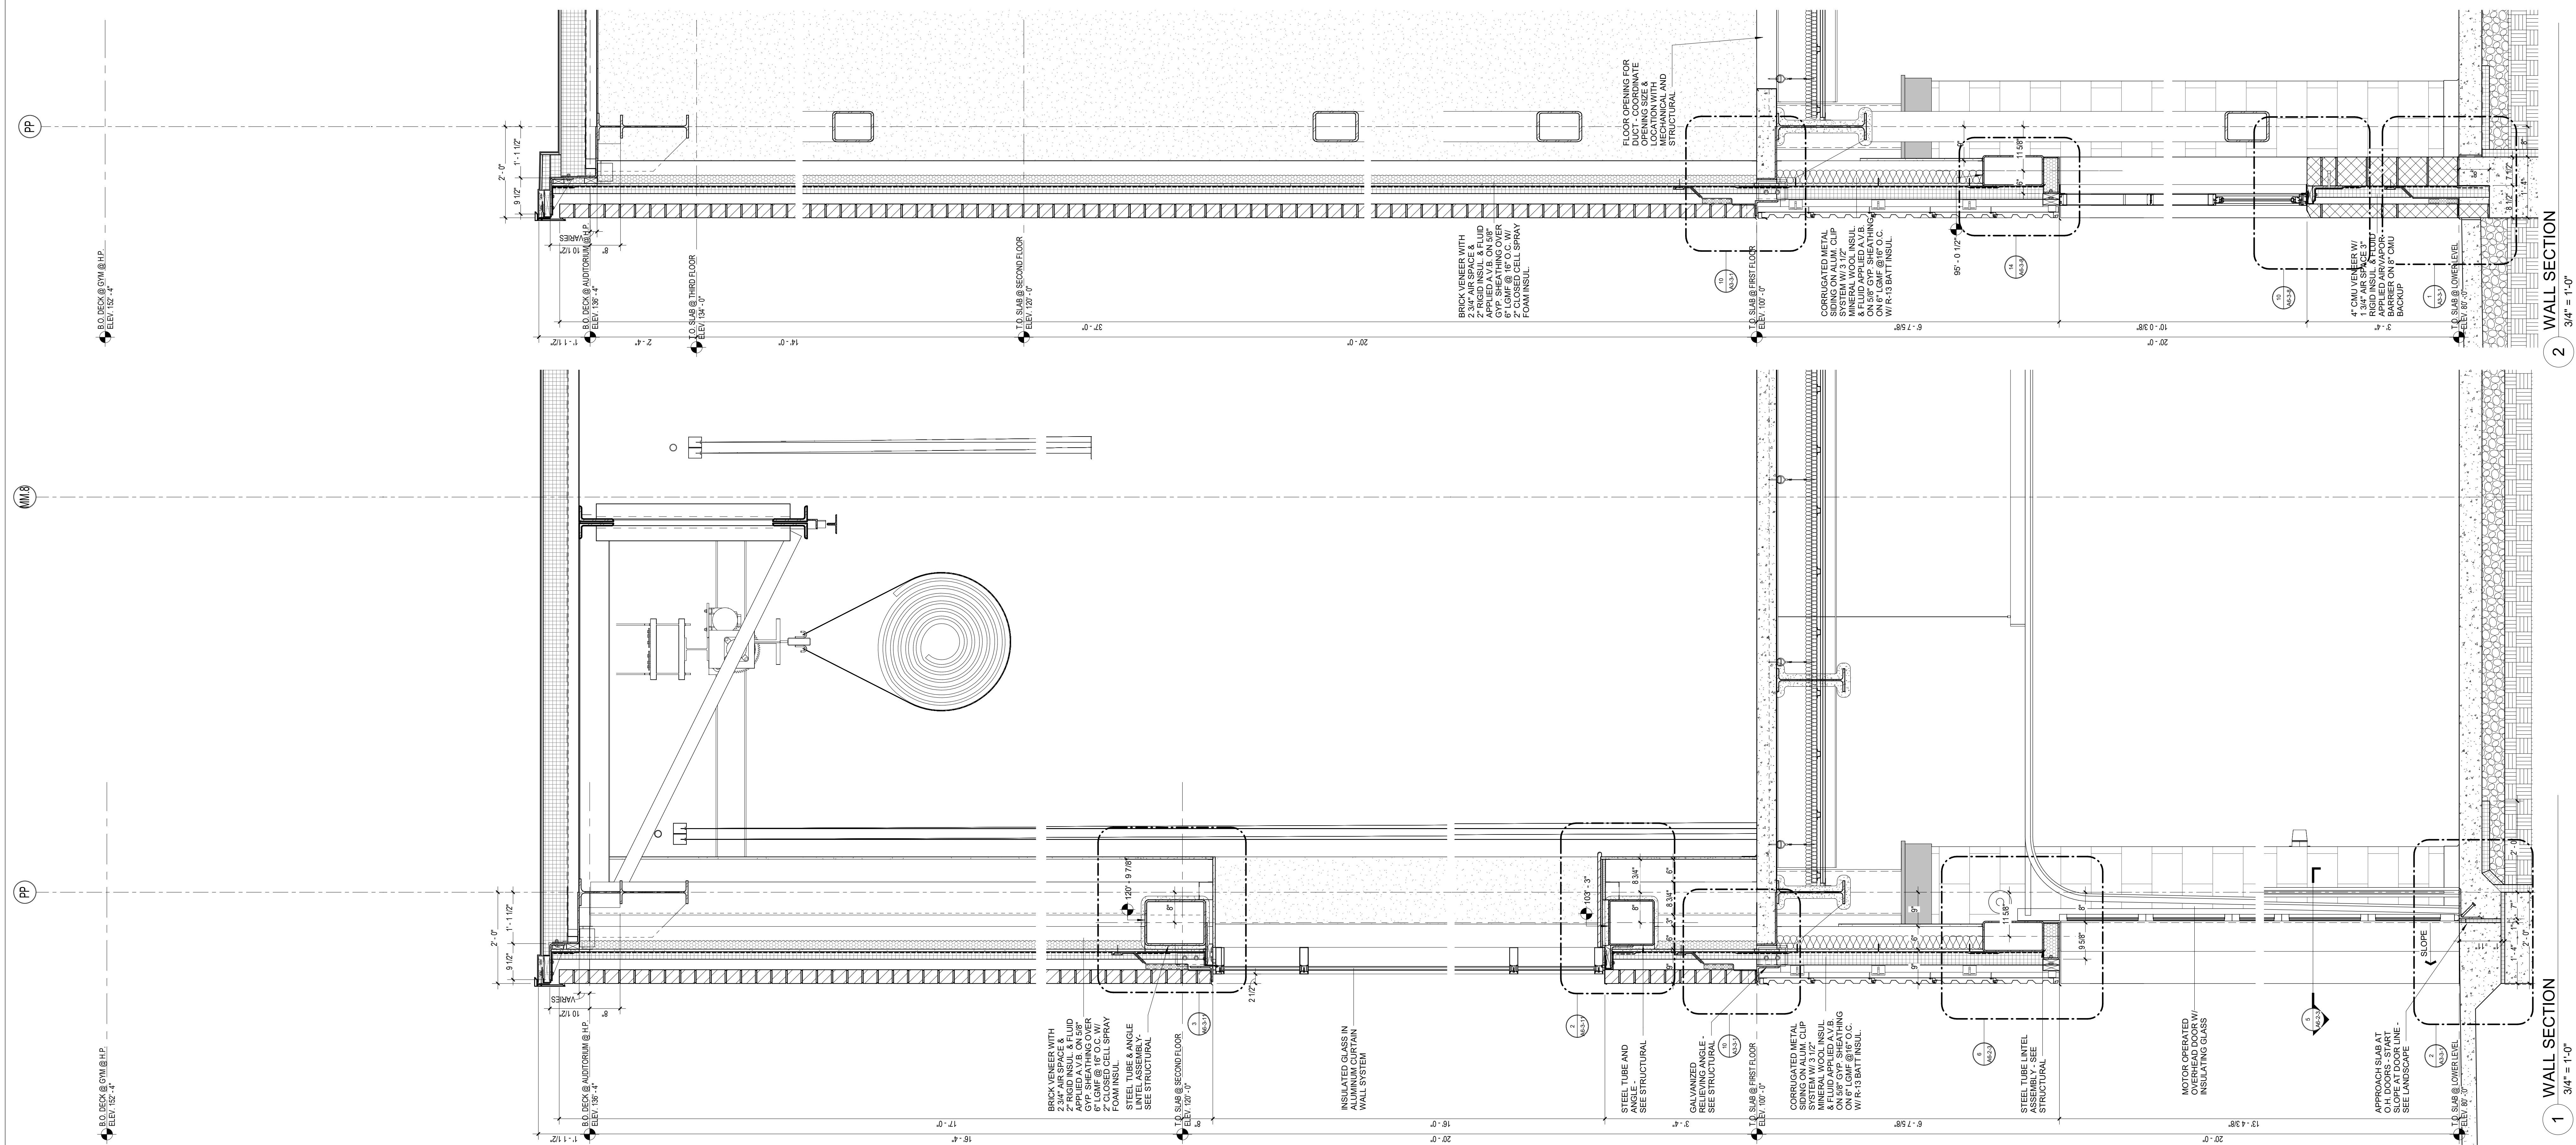MSBA 90% CD
SUBMISSION

May 12TH, 2023

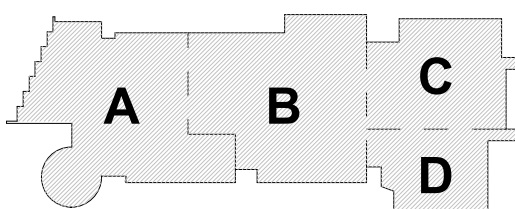

KEY PLAN



WALL SECTIONS


Scale: $3/4" = 1'-0"$

Job No.: 20202

Drawn By: DRA

Date: May 12T

A3-2-24

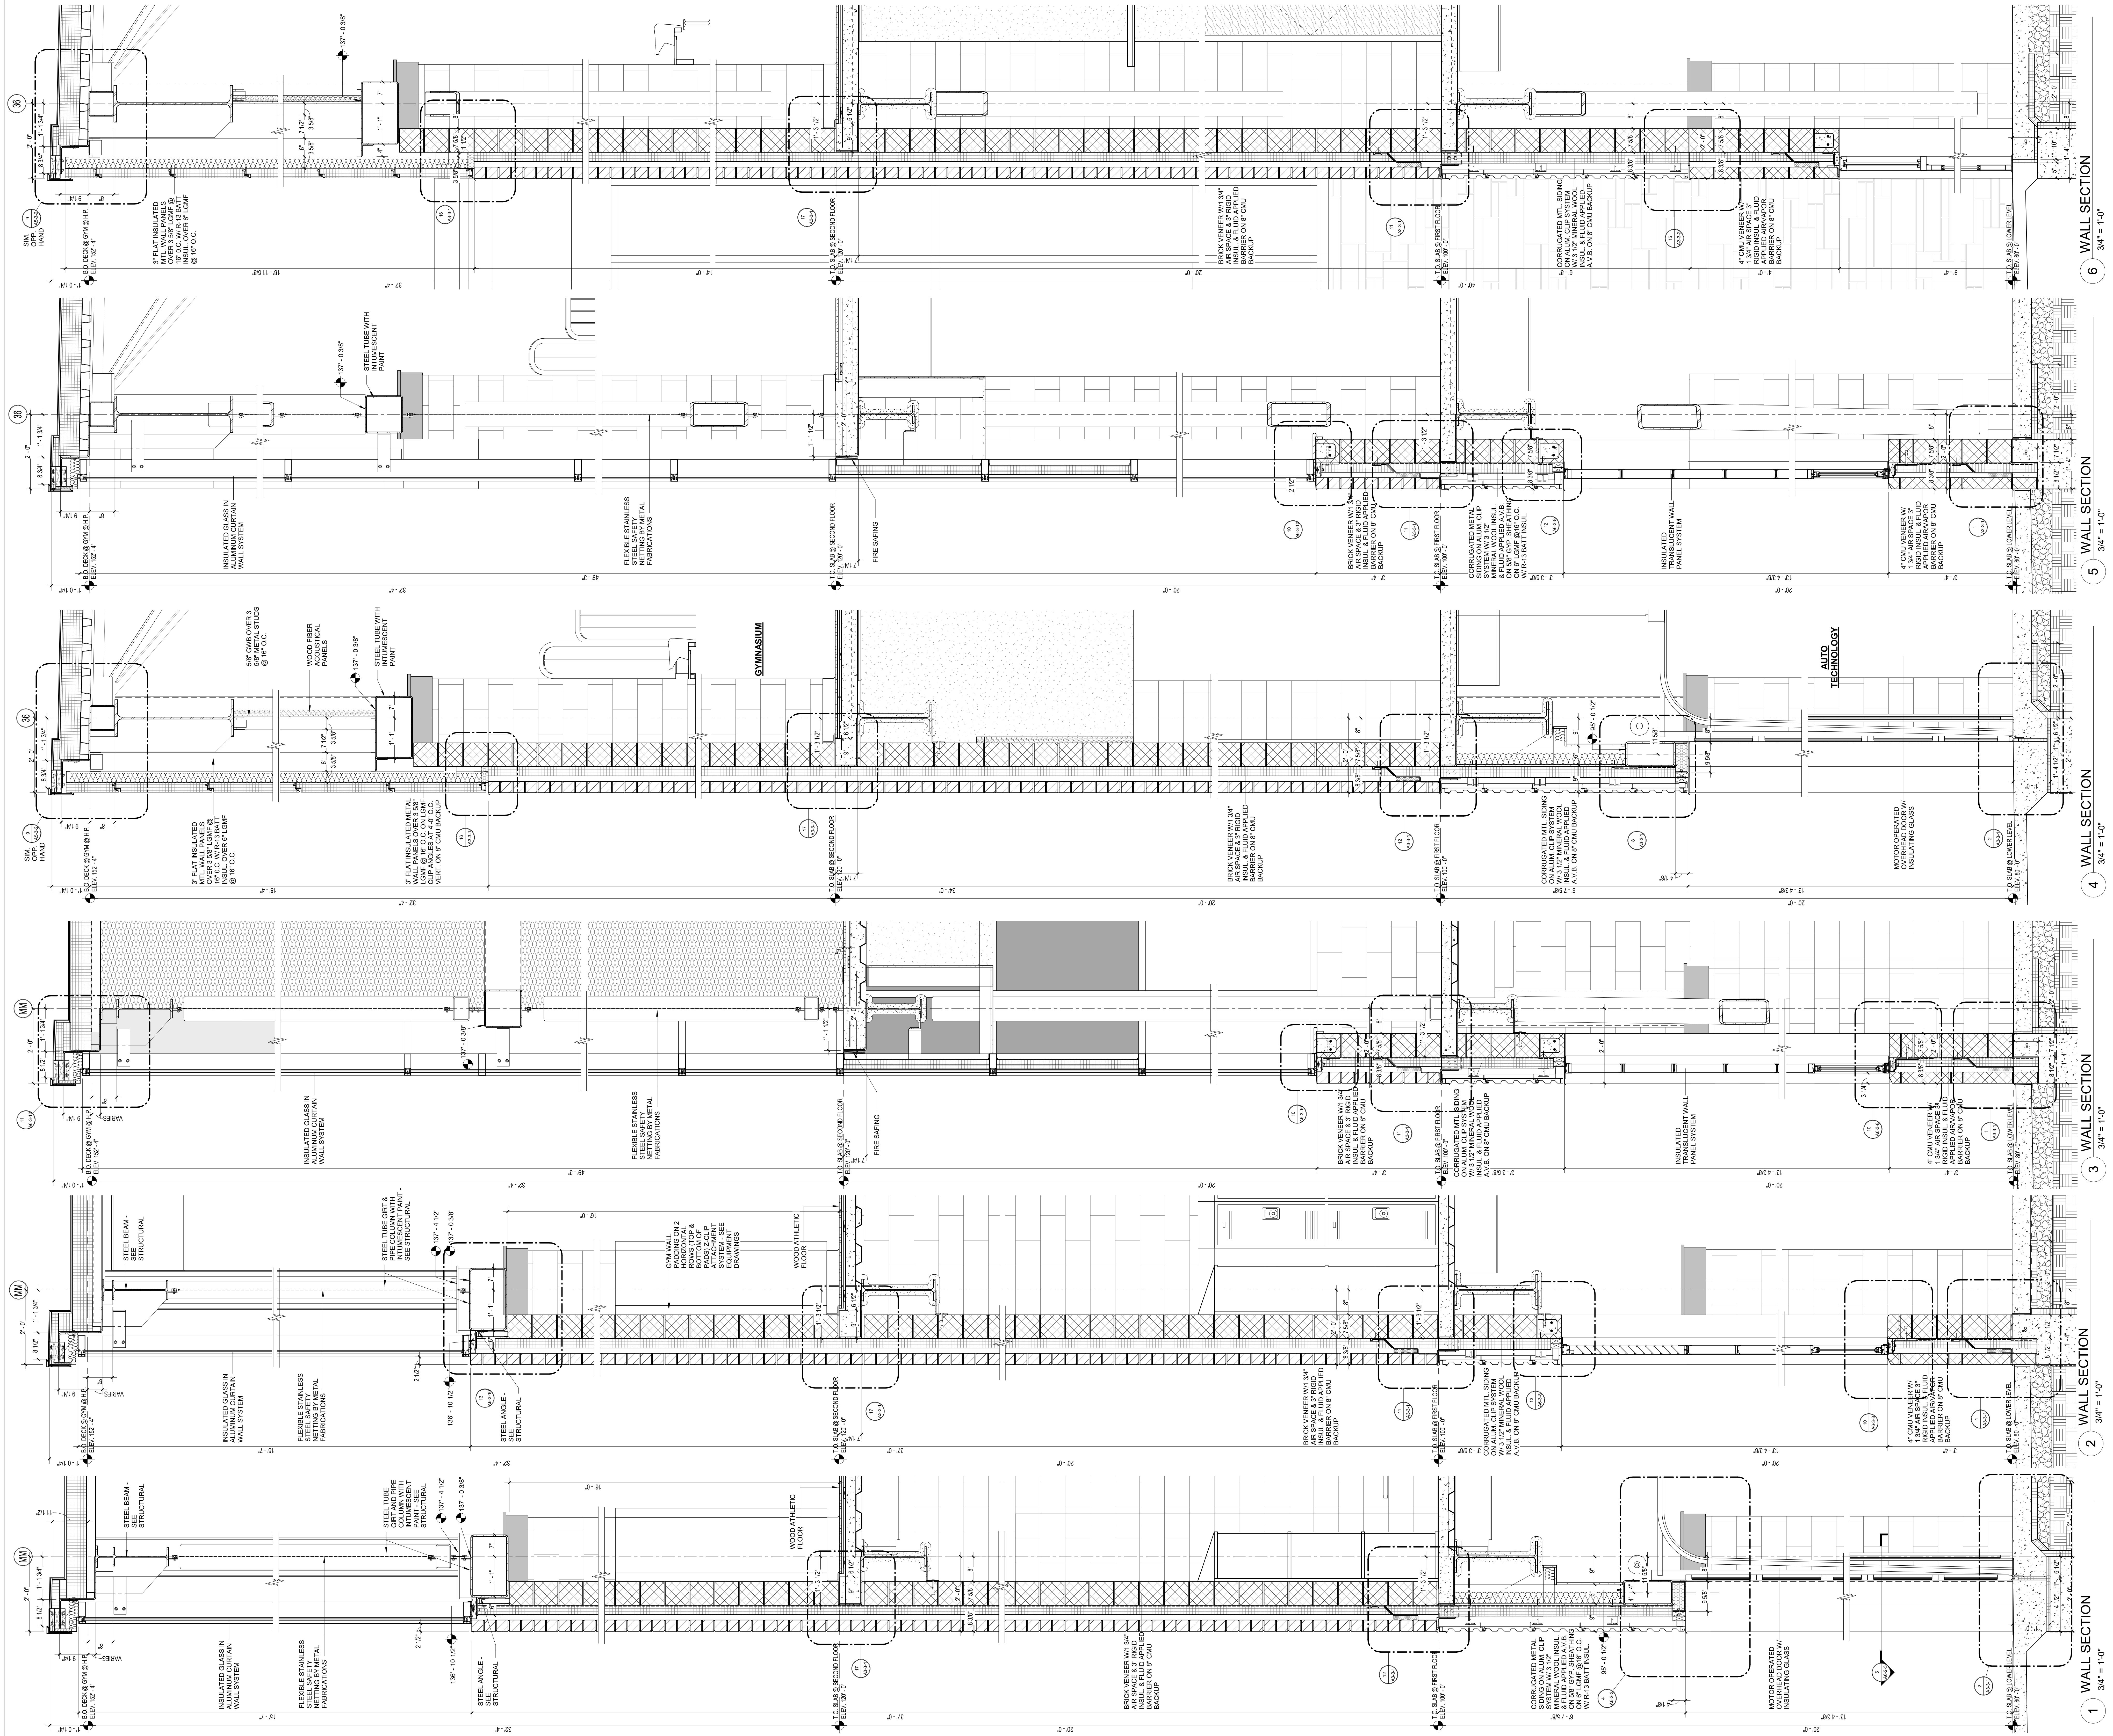

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.864.1702
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.864.1702
www.dra.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

PROJECT NORTH

MAGNETIC NORTH

KEY PLAN

A B C D

MSBA 90% CD
SUBMISSION

May 12TH, 2023

WALL SECTIONS

Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A3-2-25



DRA

Drumme Rosane Anderson, Inc.

225 Oakland Road
South Windsor, CT 06074

260 Charles Street
Studio 300
Waltham, MA 02453

Tel: 617.854.1700
www.draa.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

PROJECT NORTH

MAGNETIC NORTH

Scale: 3/4" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A3-2-26

1 WALL SECTION
3/4" = 1'-0"

2 WALL SECTION
3/4" = 1'-0"

3 WALL SECTION
3/4" = 1'-0"


4 WALL SECTION
3/4" = 1'-0"


5 WALL SECTION
3/4" = 1'-0"

6 WALL SECTION
3/4" = 1'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

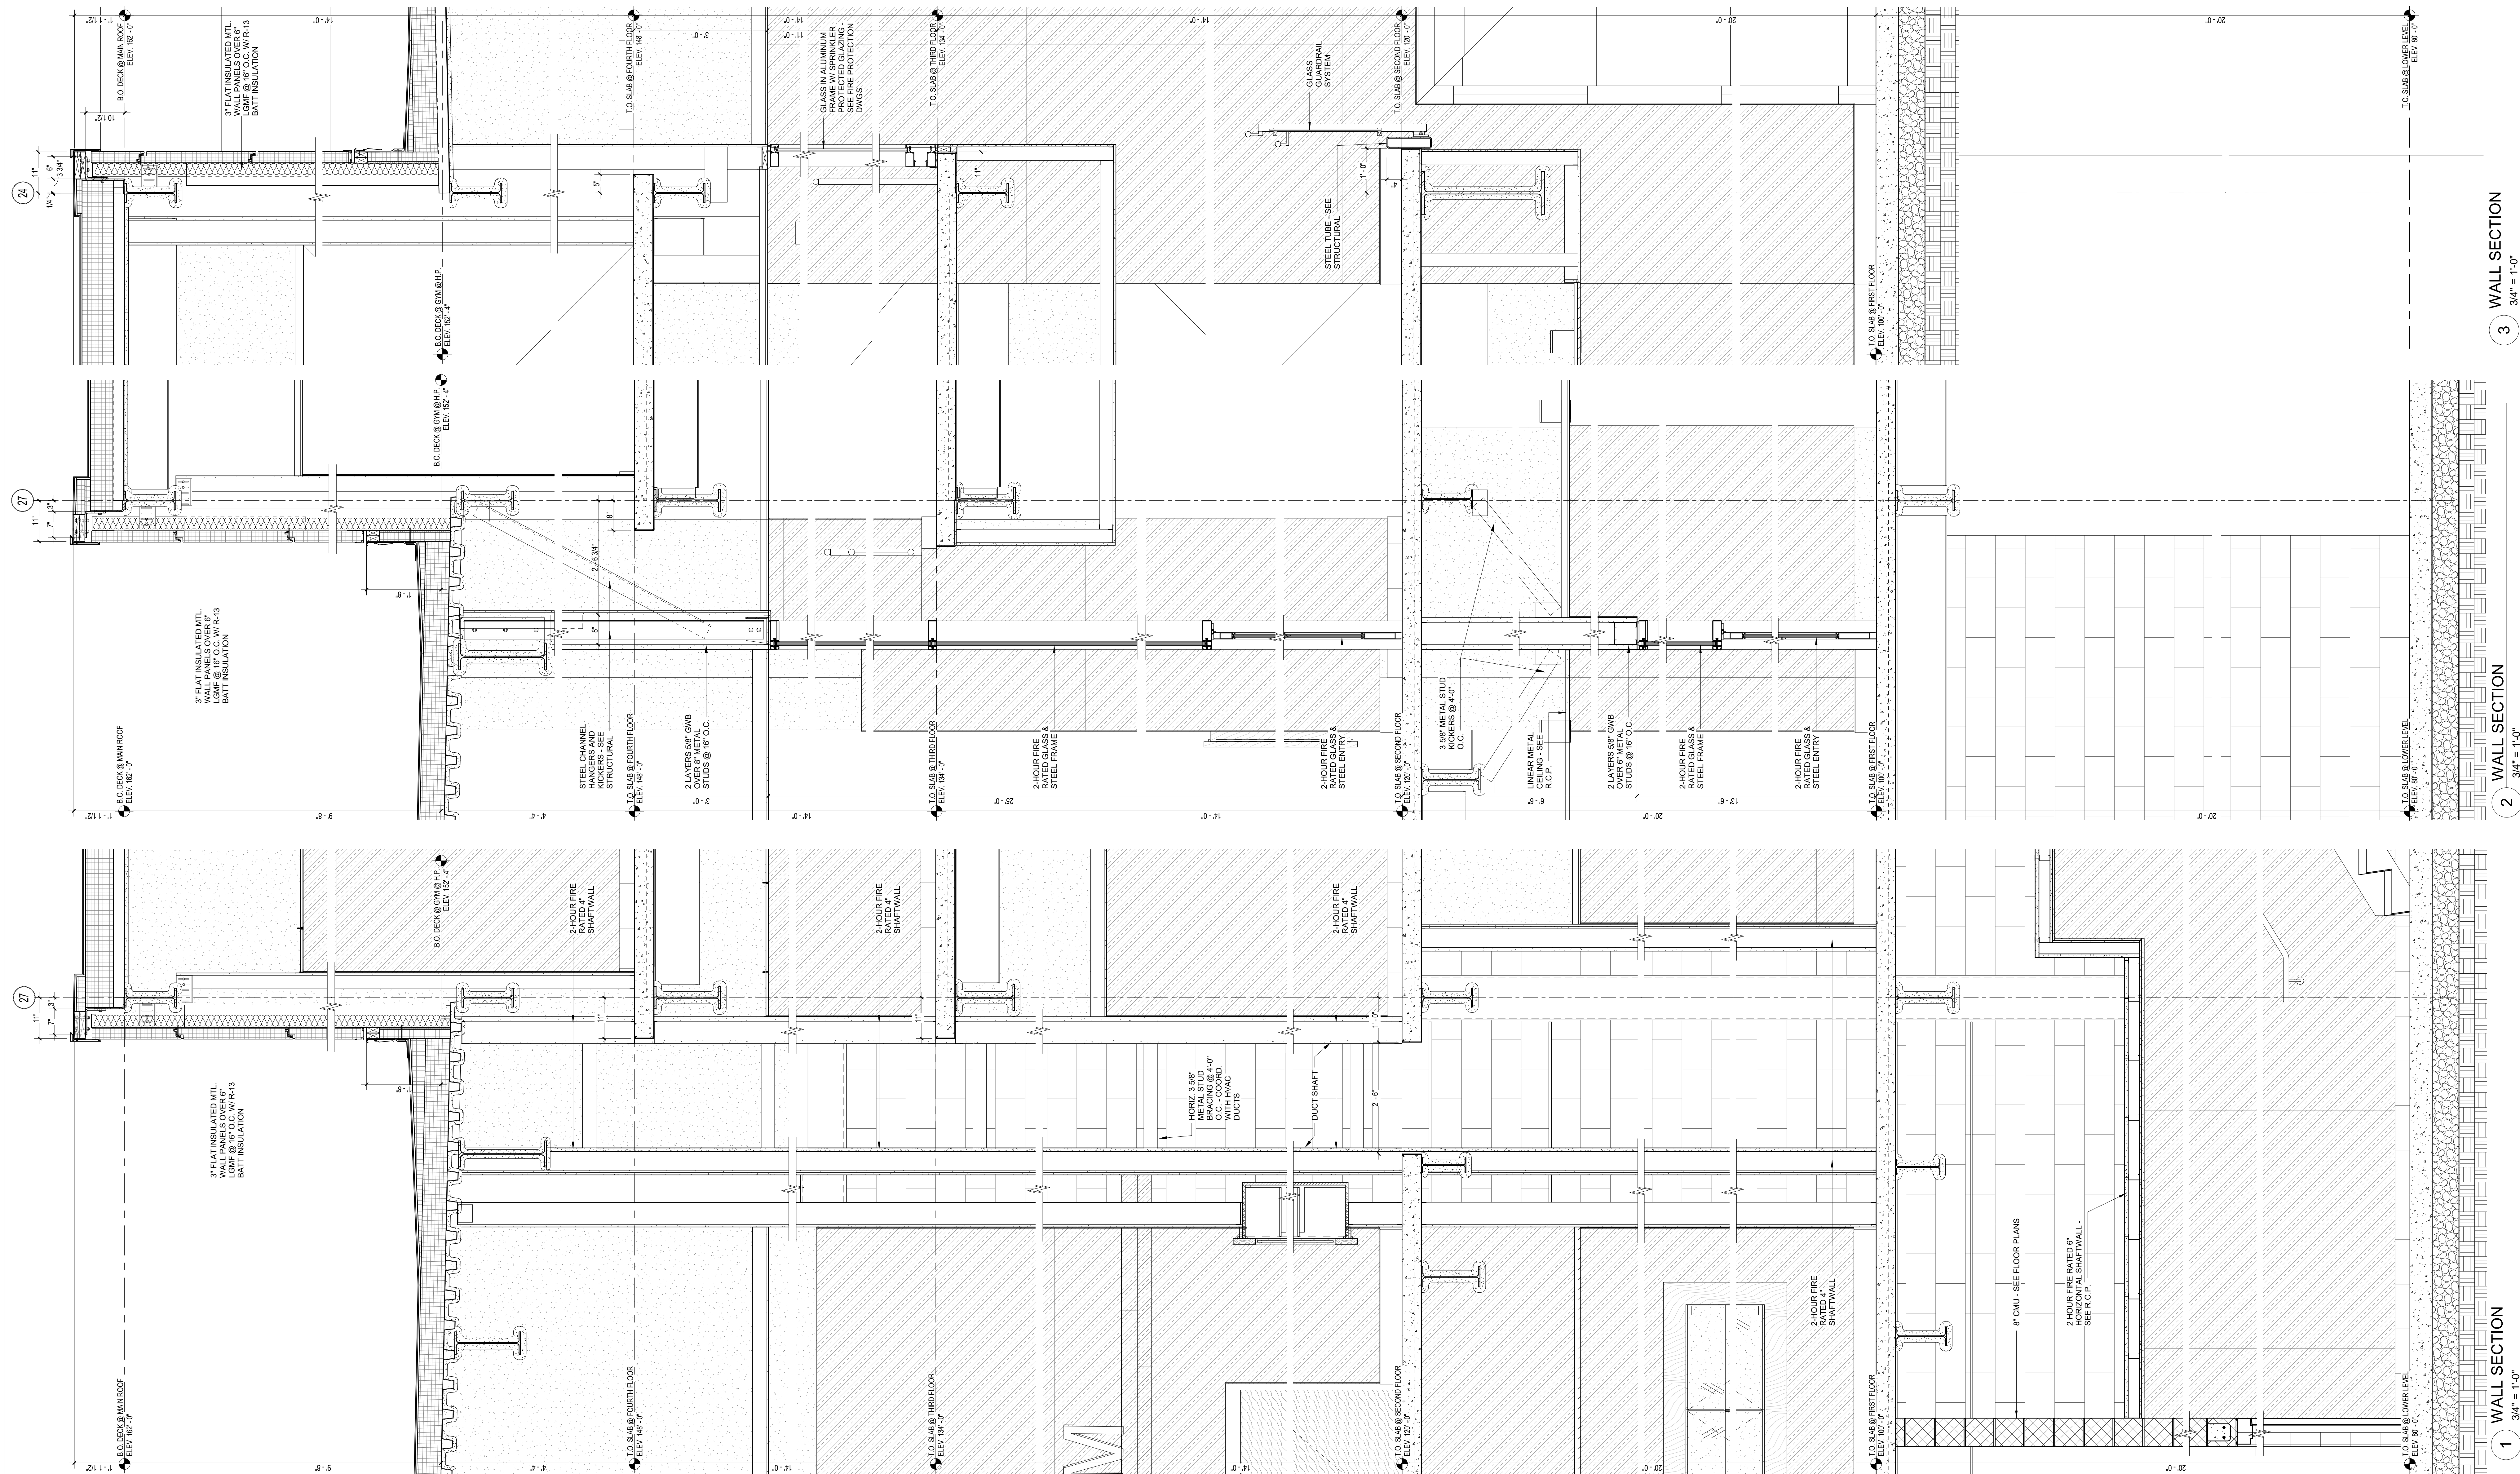

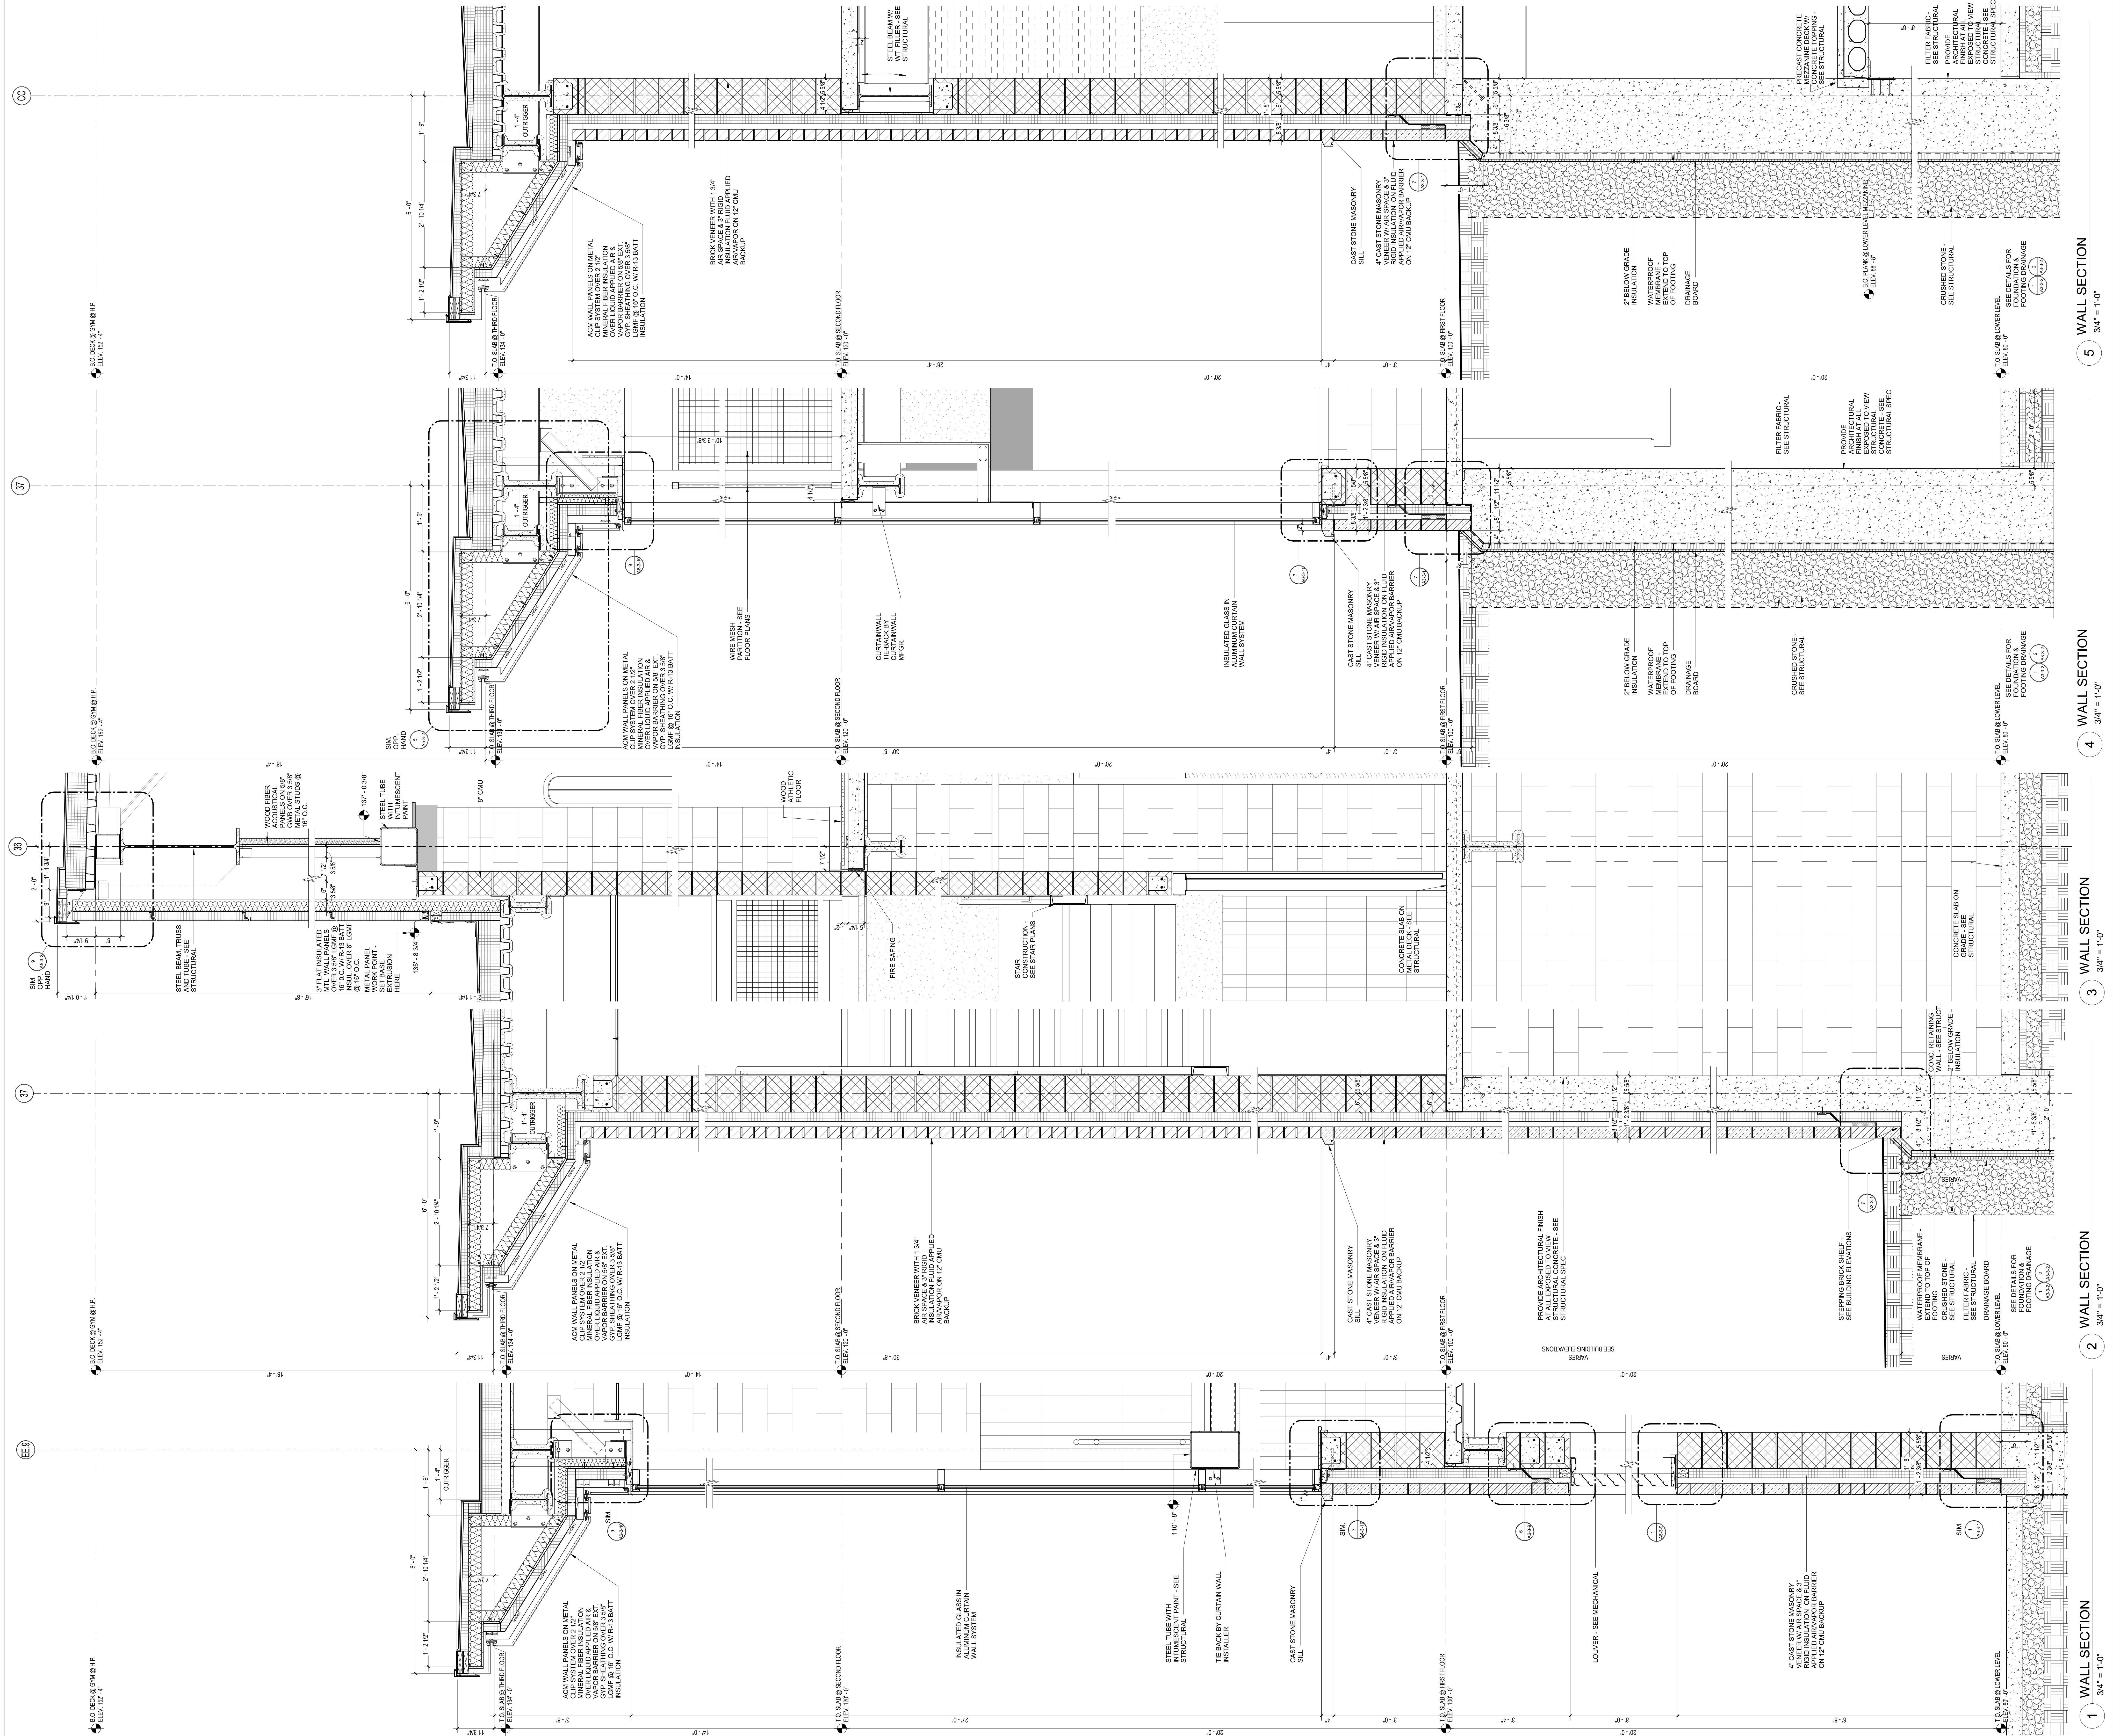

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.854.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.854.1700
www.dra.com

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023


KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

WALL SECTIONS

Scale: 3/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A3-2-28

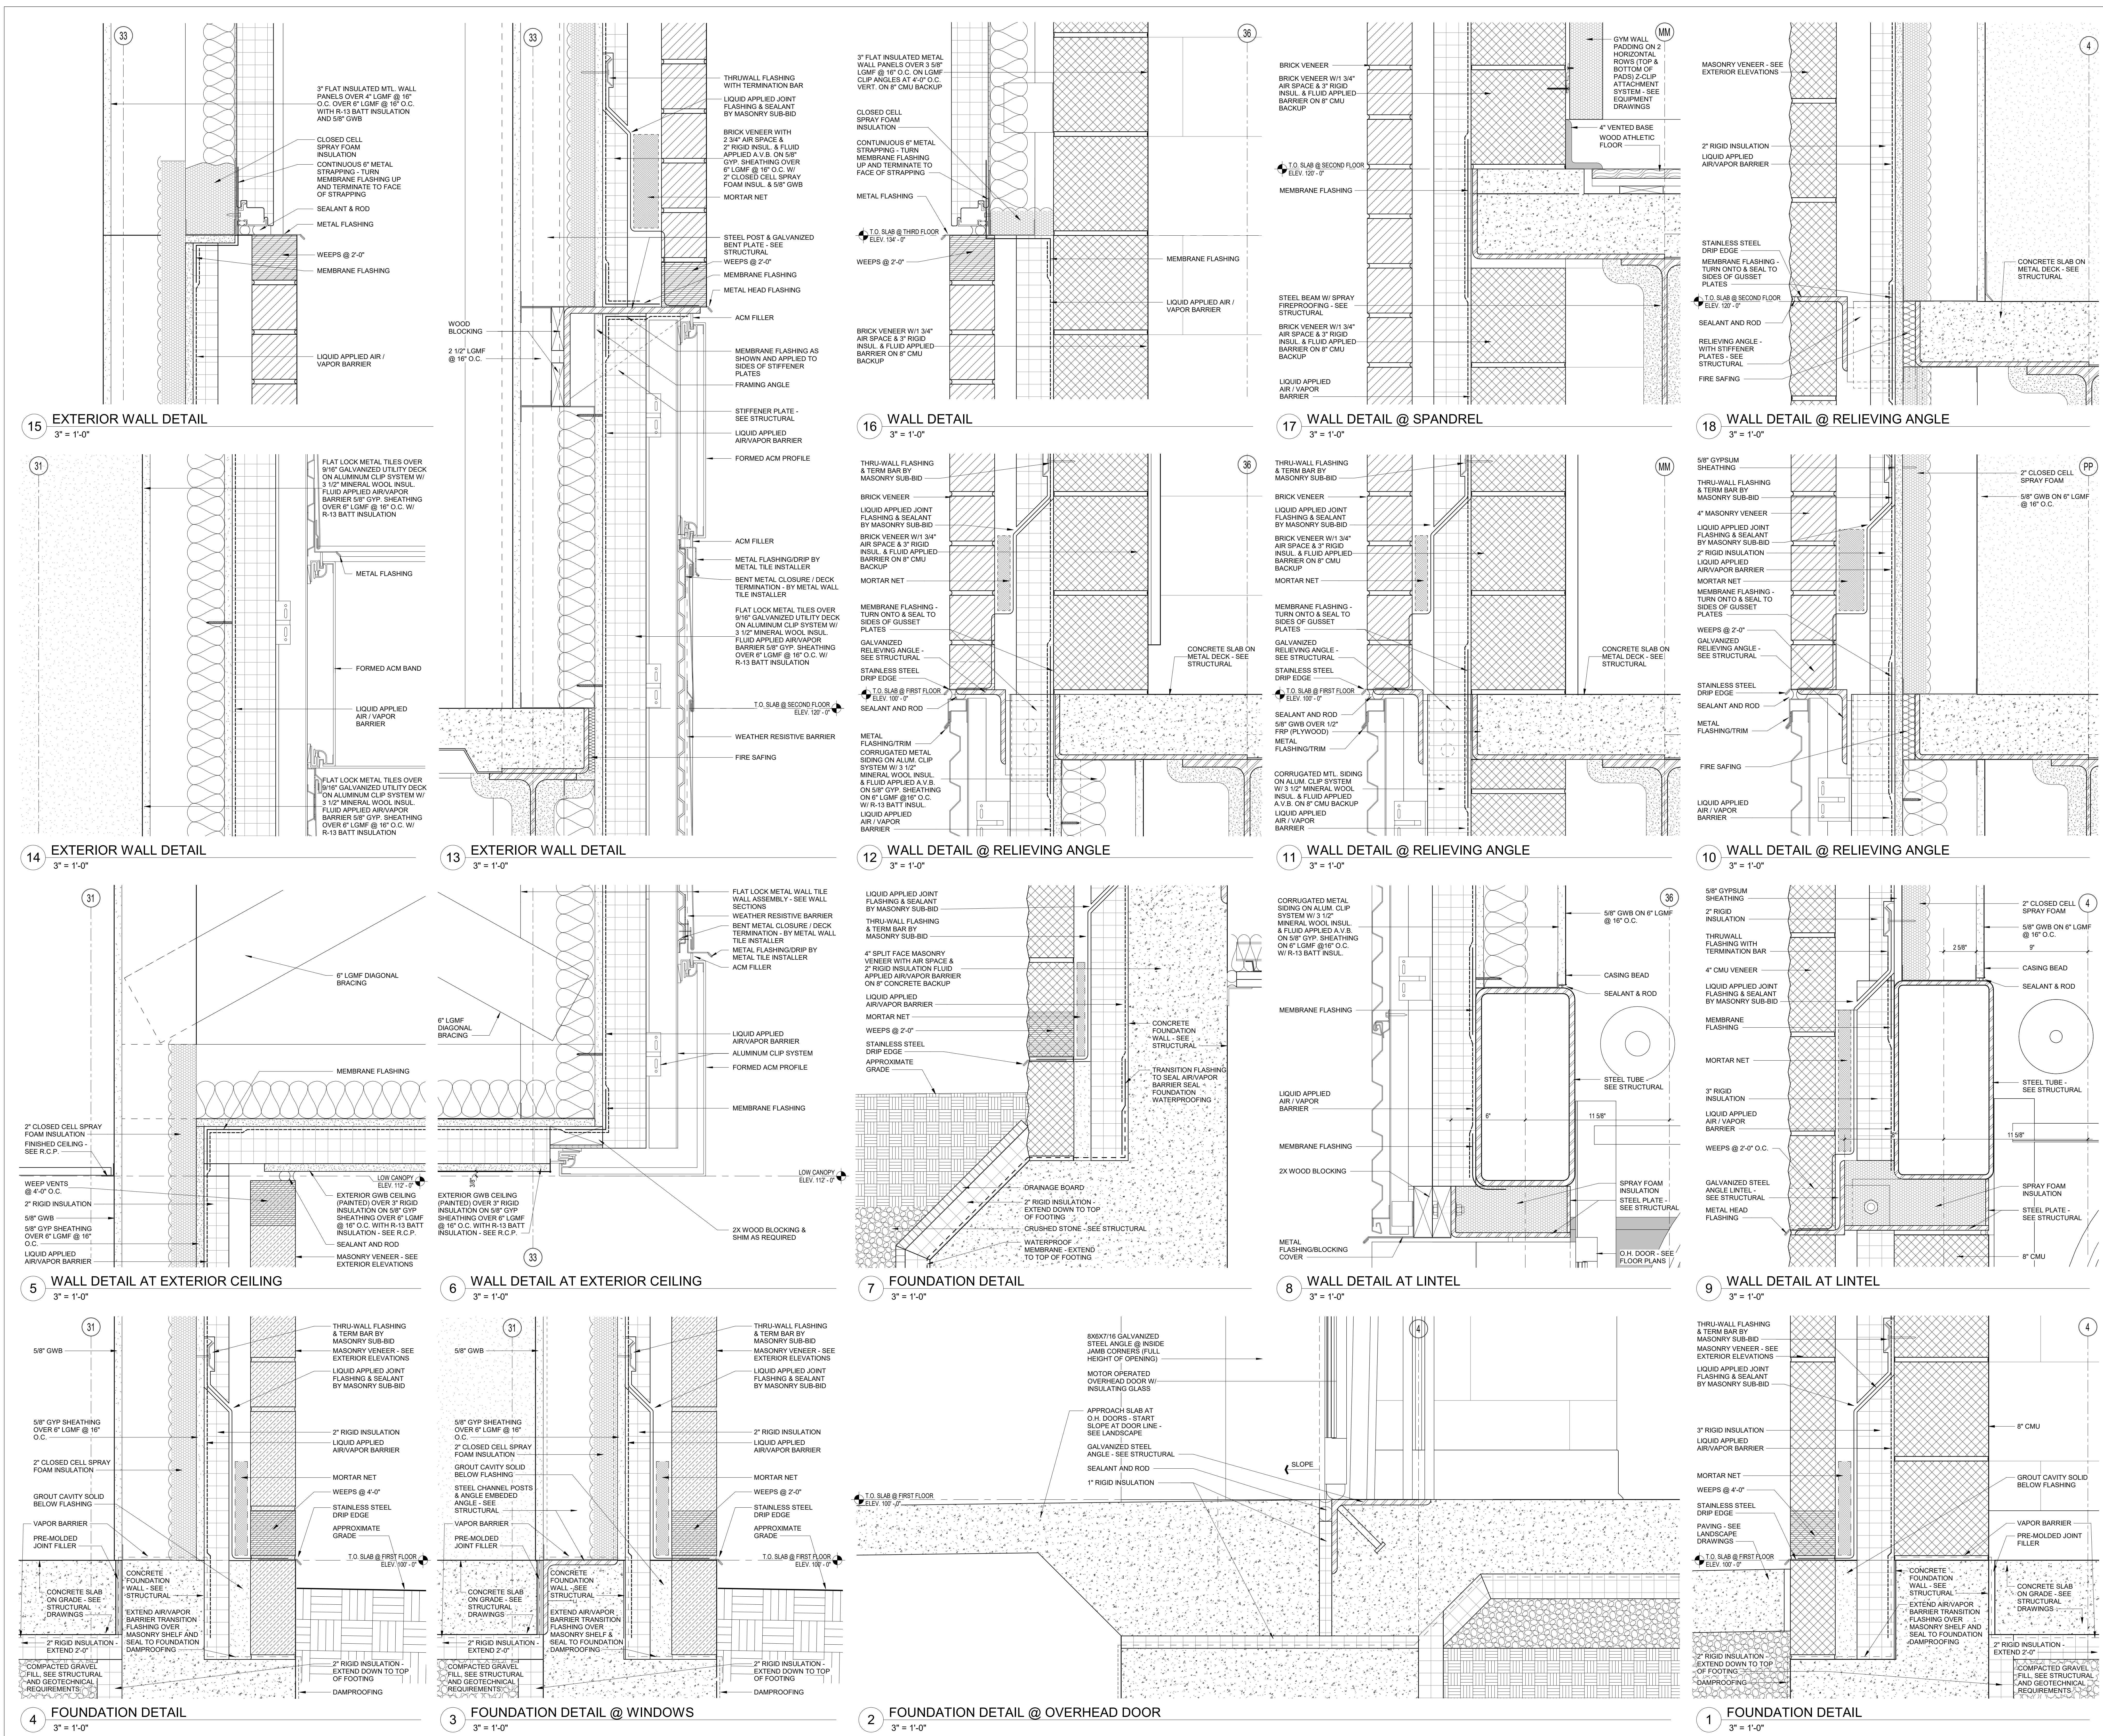

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1702
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A B C D


KEY PLAN

PROJECT NORTH
MAGNETIC NORTH


VERTICAL
DETAILS

Scale: 3" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A3-3-1

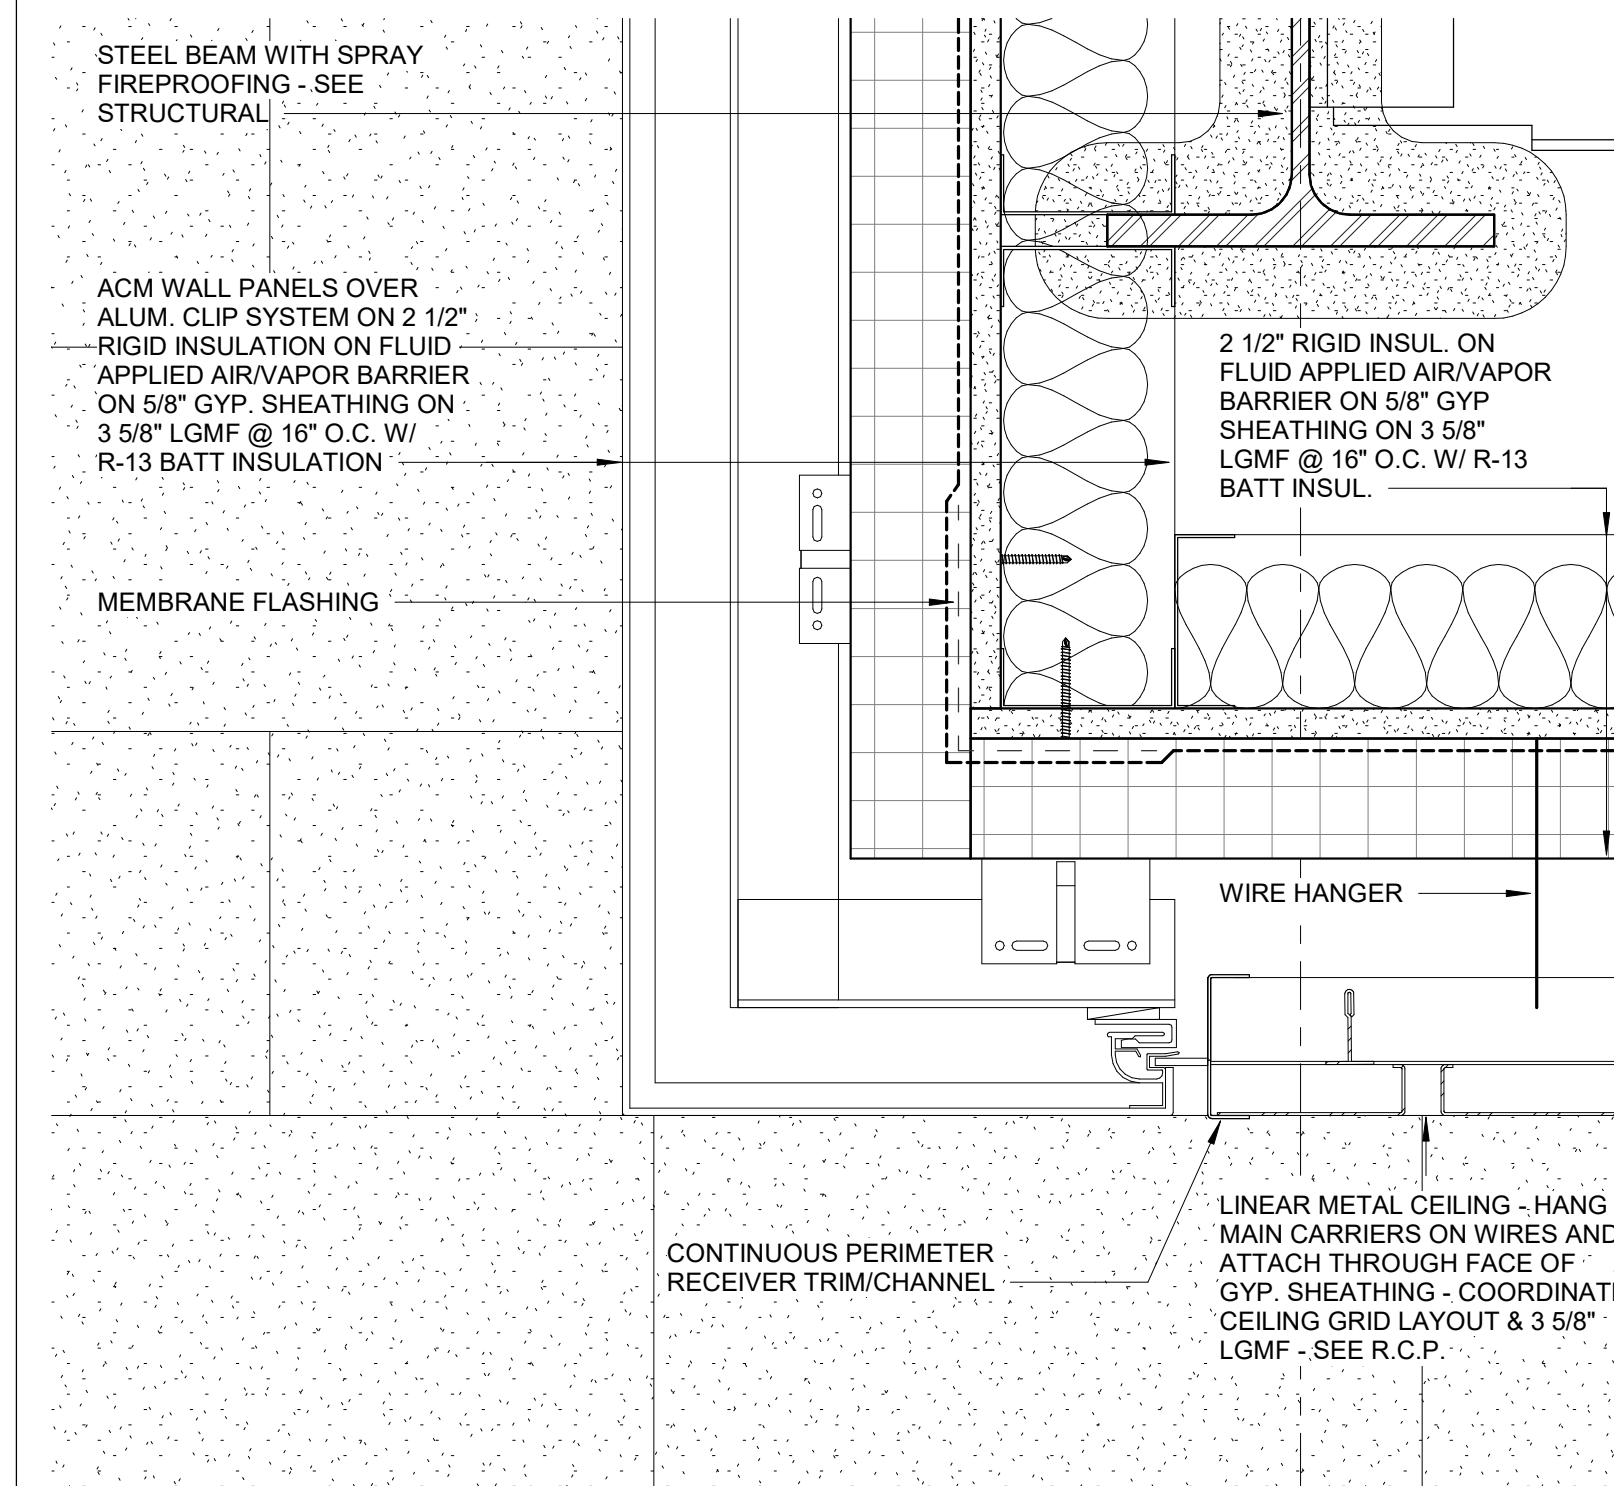


14 EXTERIOR WALL DETAIL
3" = 1'-0"

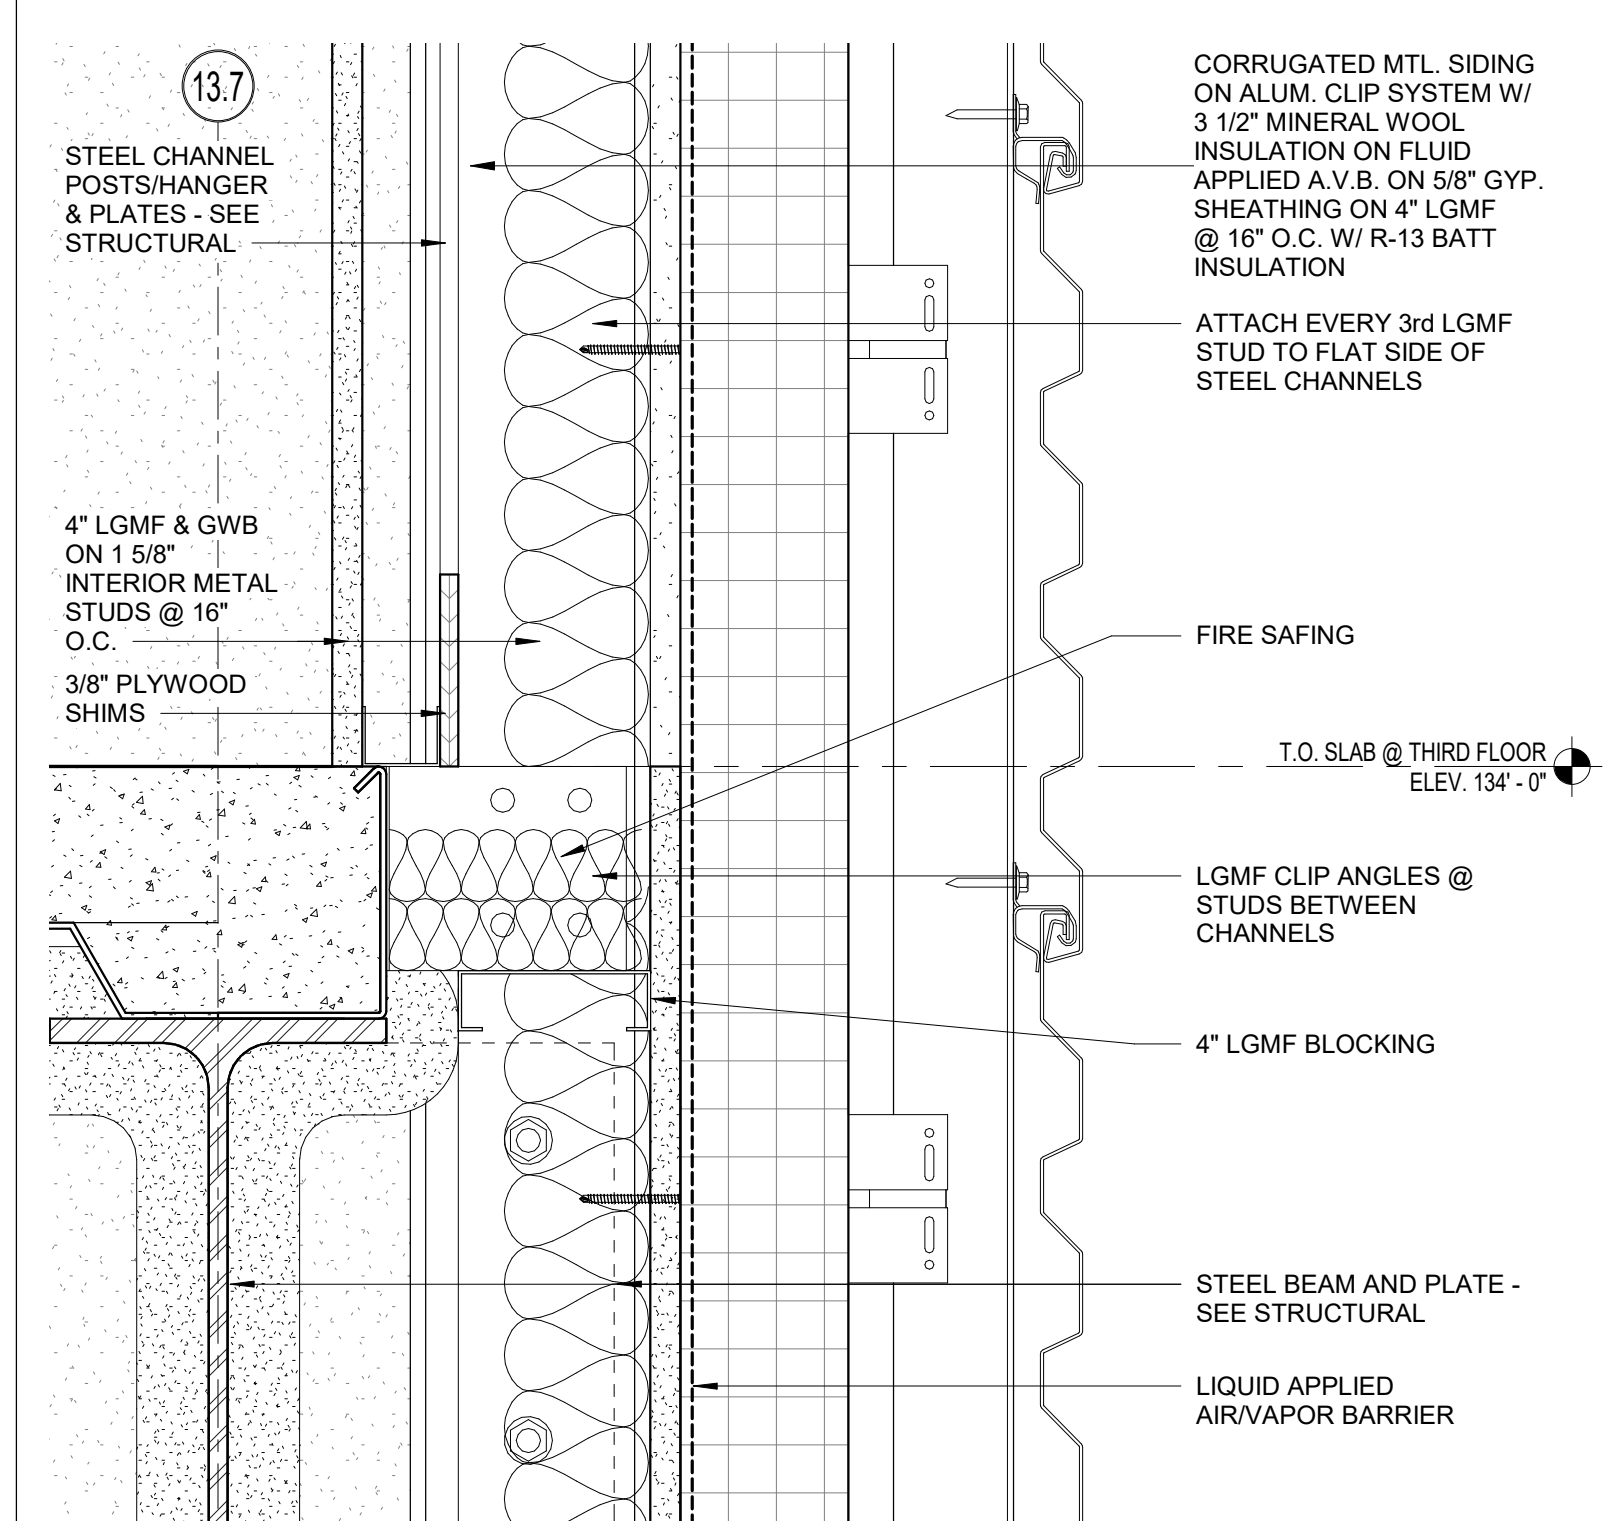


13 EXTERIOR WALL DETAIL
3" = 1'-0"

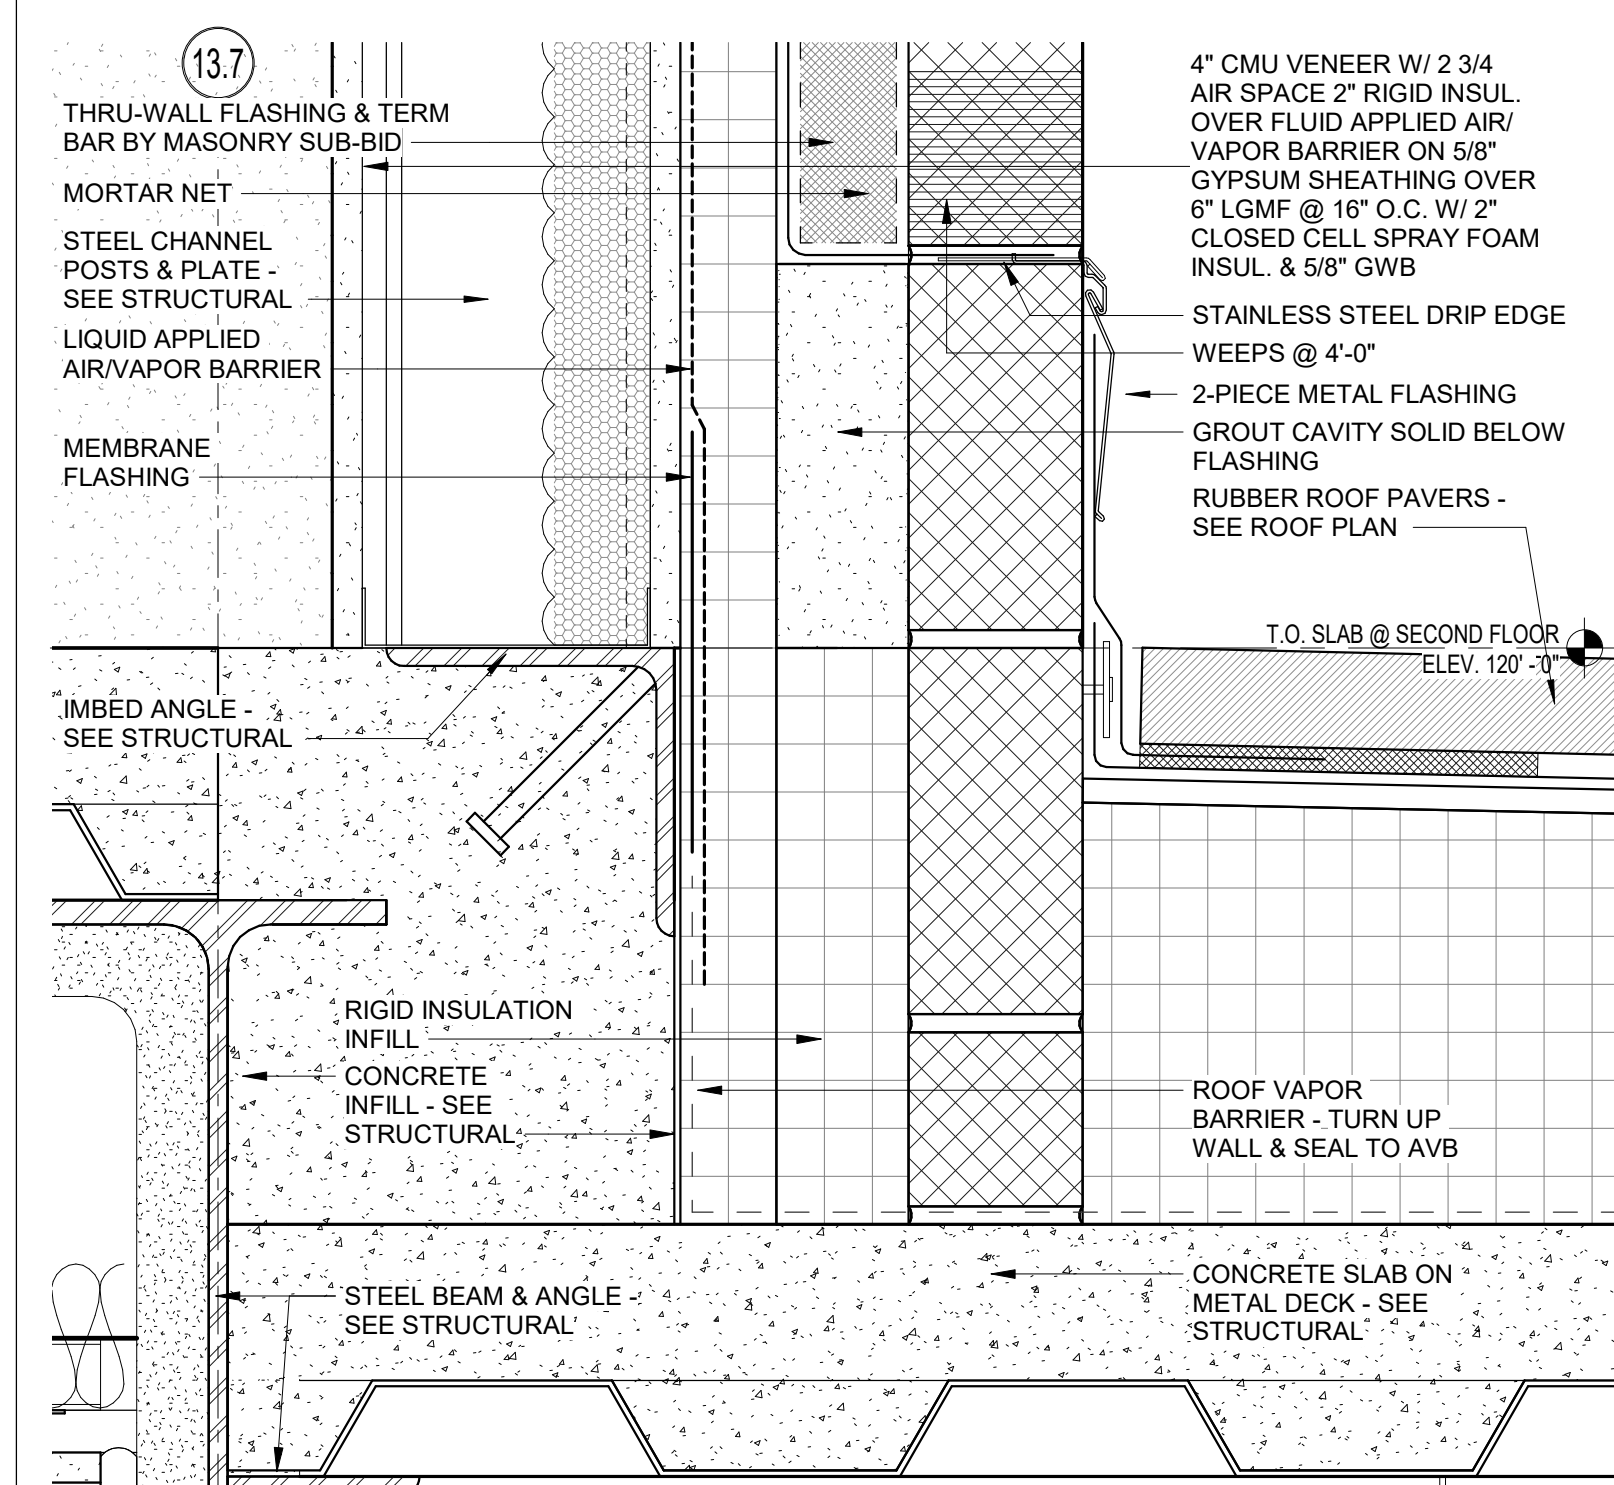


5 EXTERIOR WALL DETAIL
3" = 1'-0"

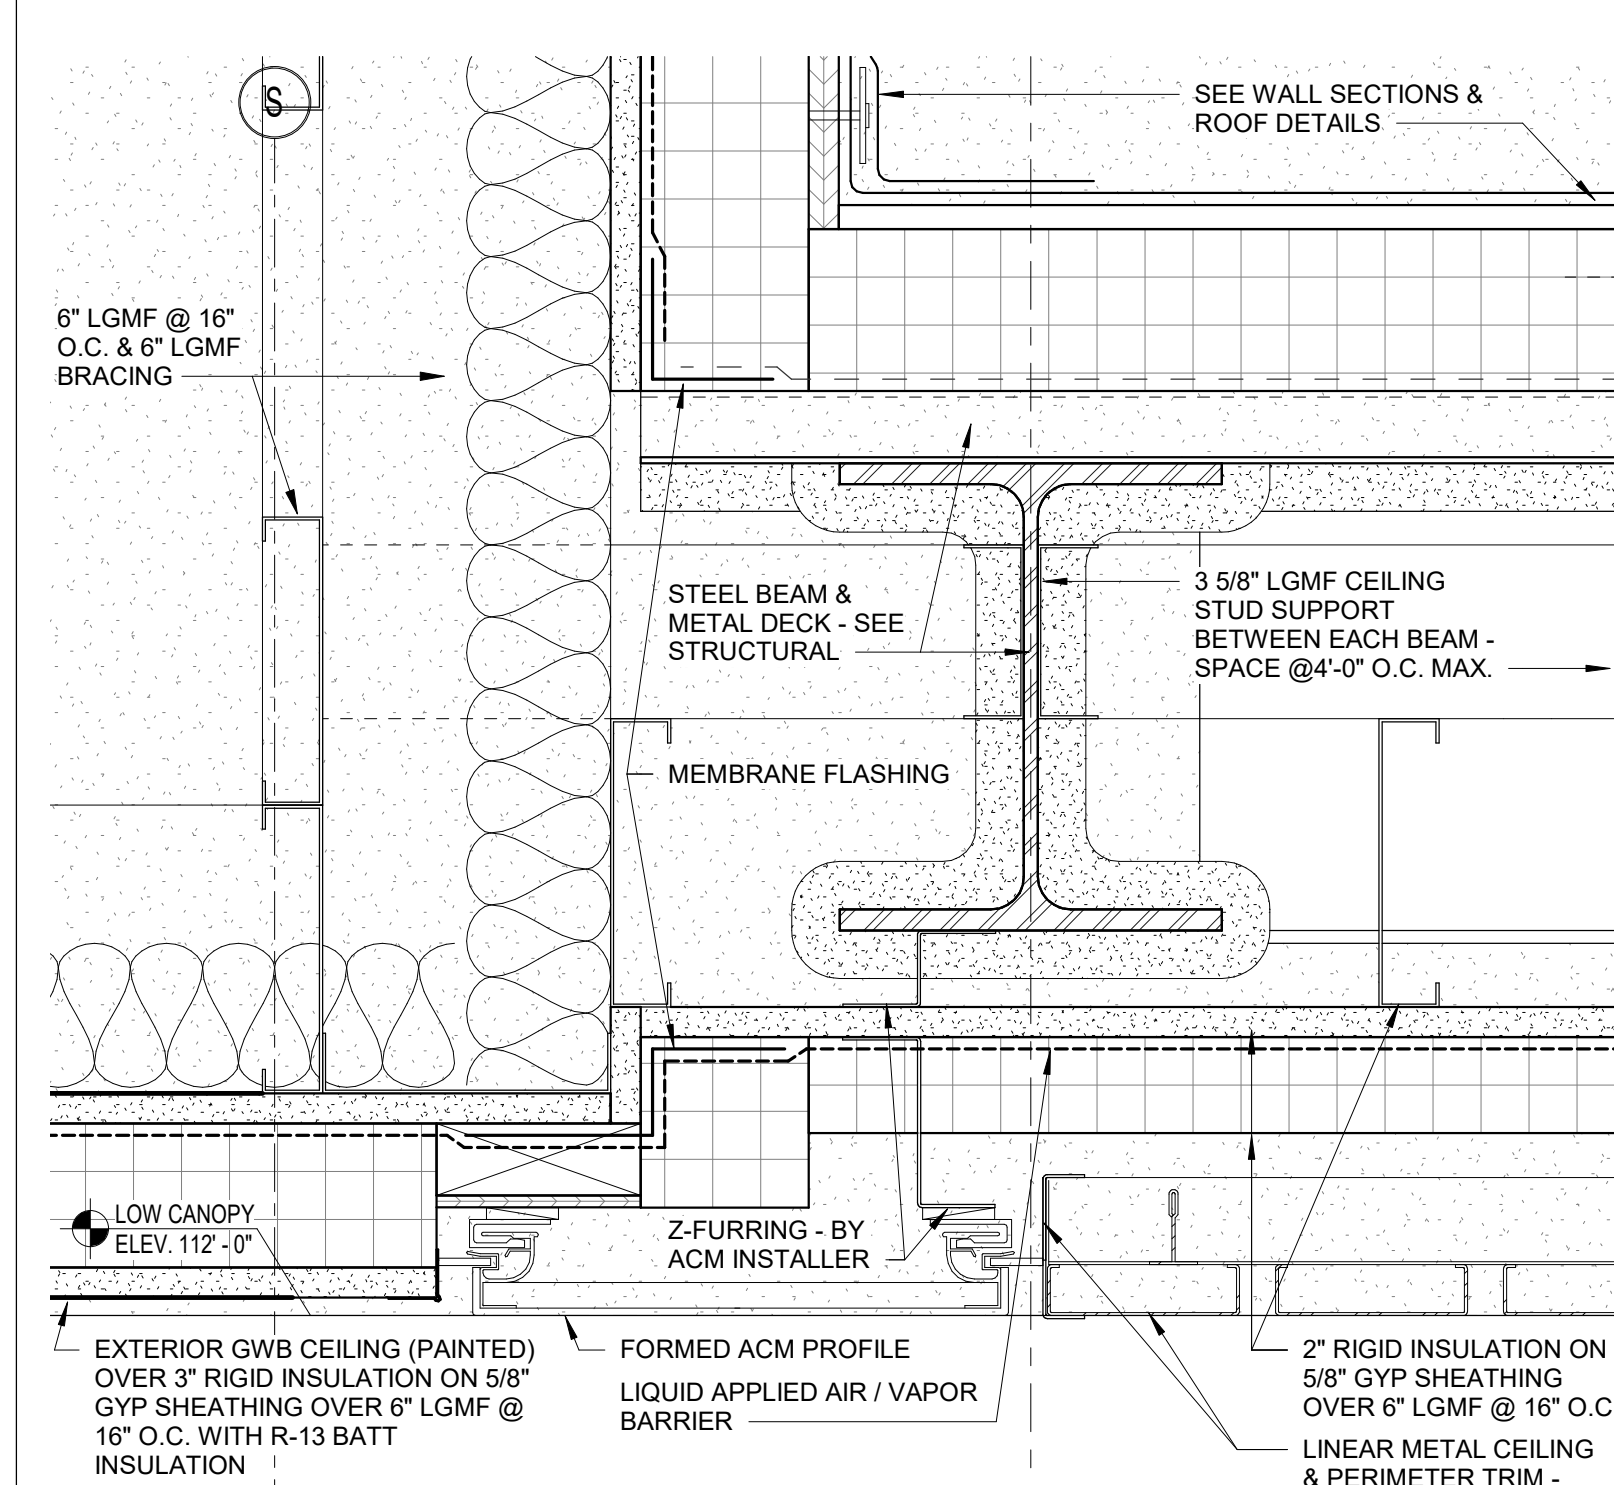


4 WALL DETAIL AT EXTERIOR CEILING
3" = 1'-0"

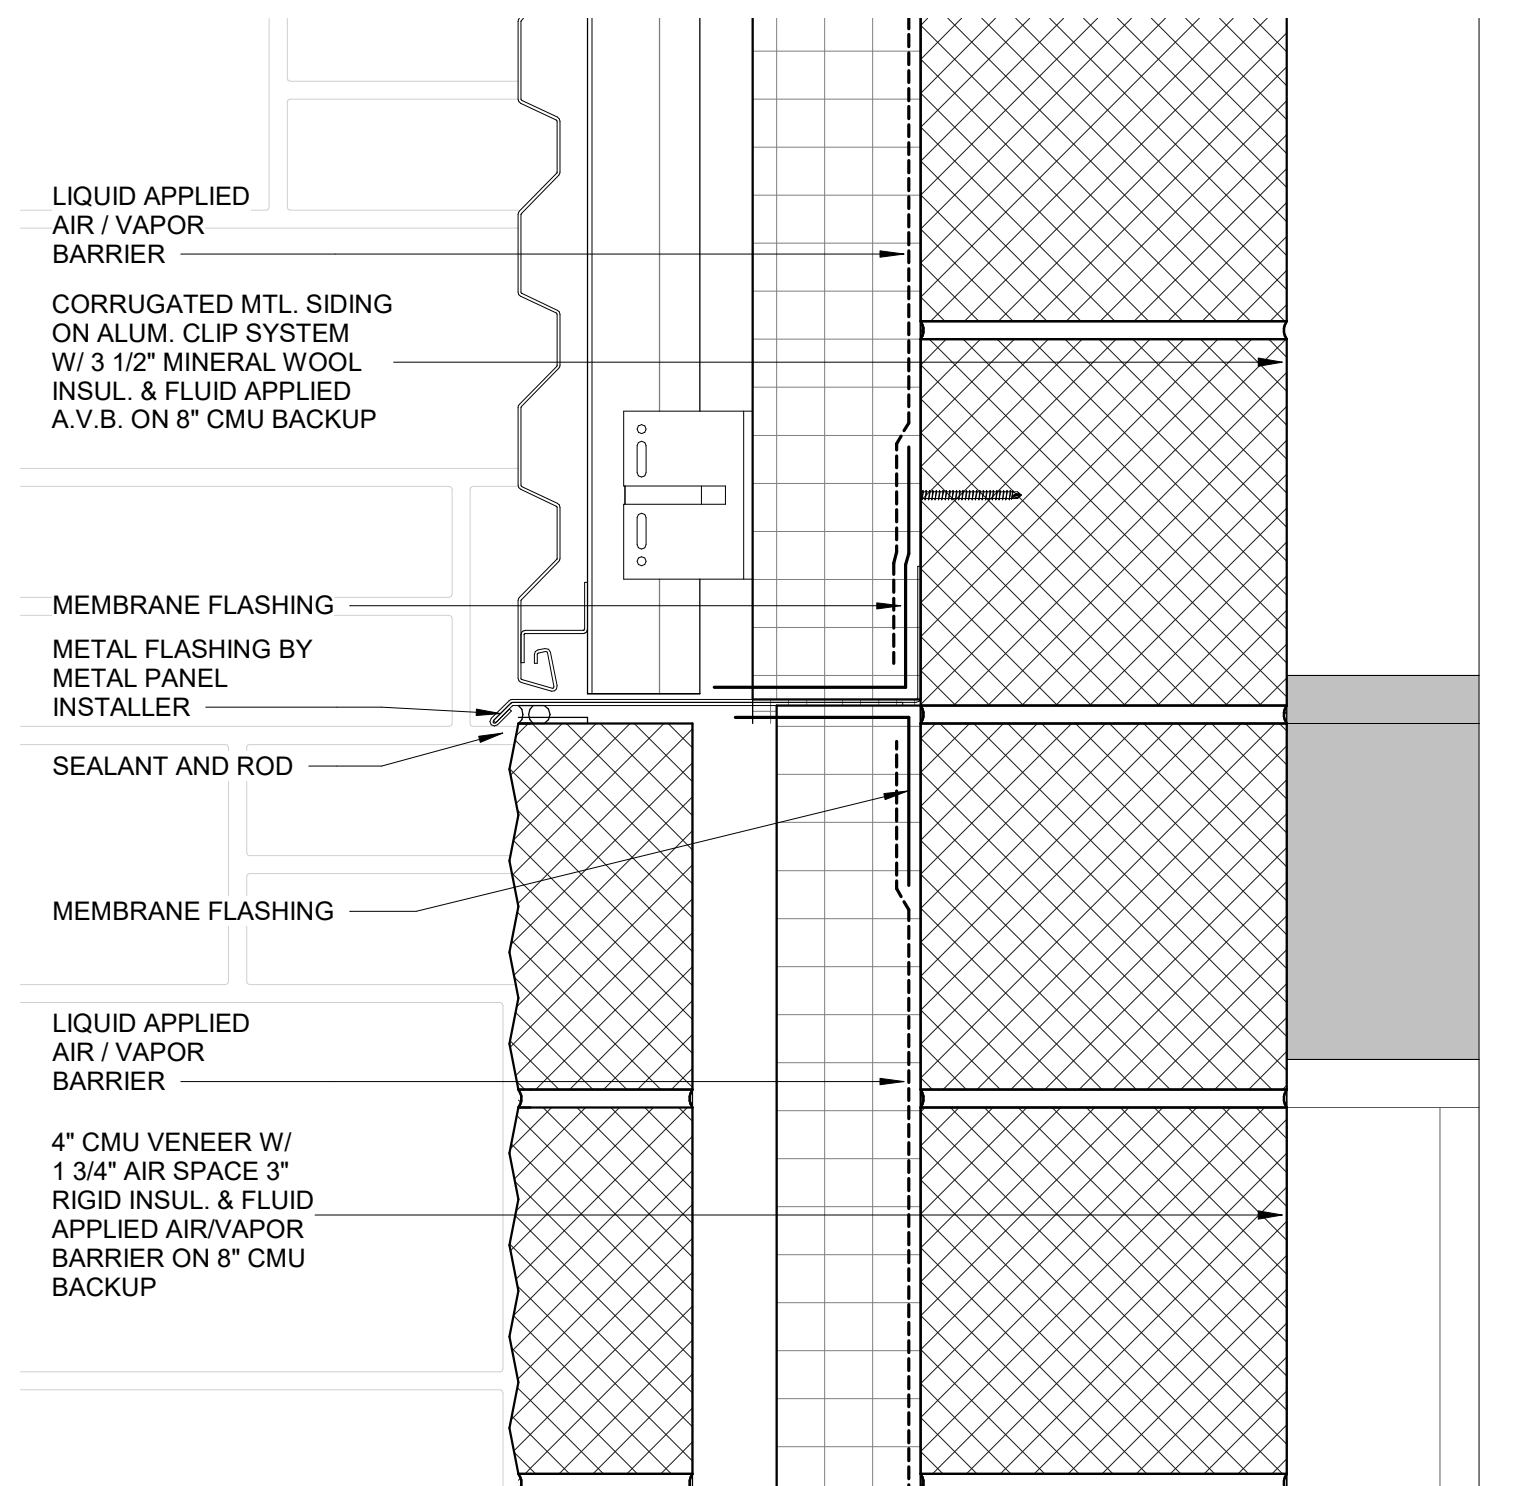


15 EXTERIOR WALL DETAIL
3" = 1'-0"

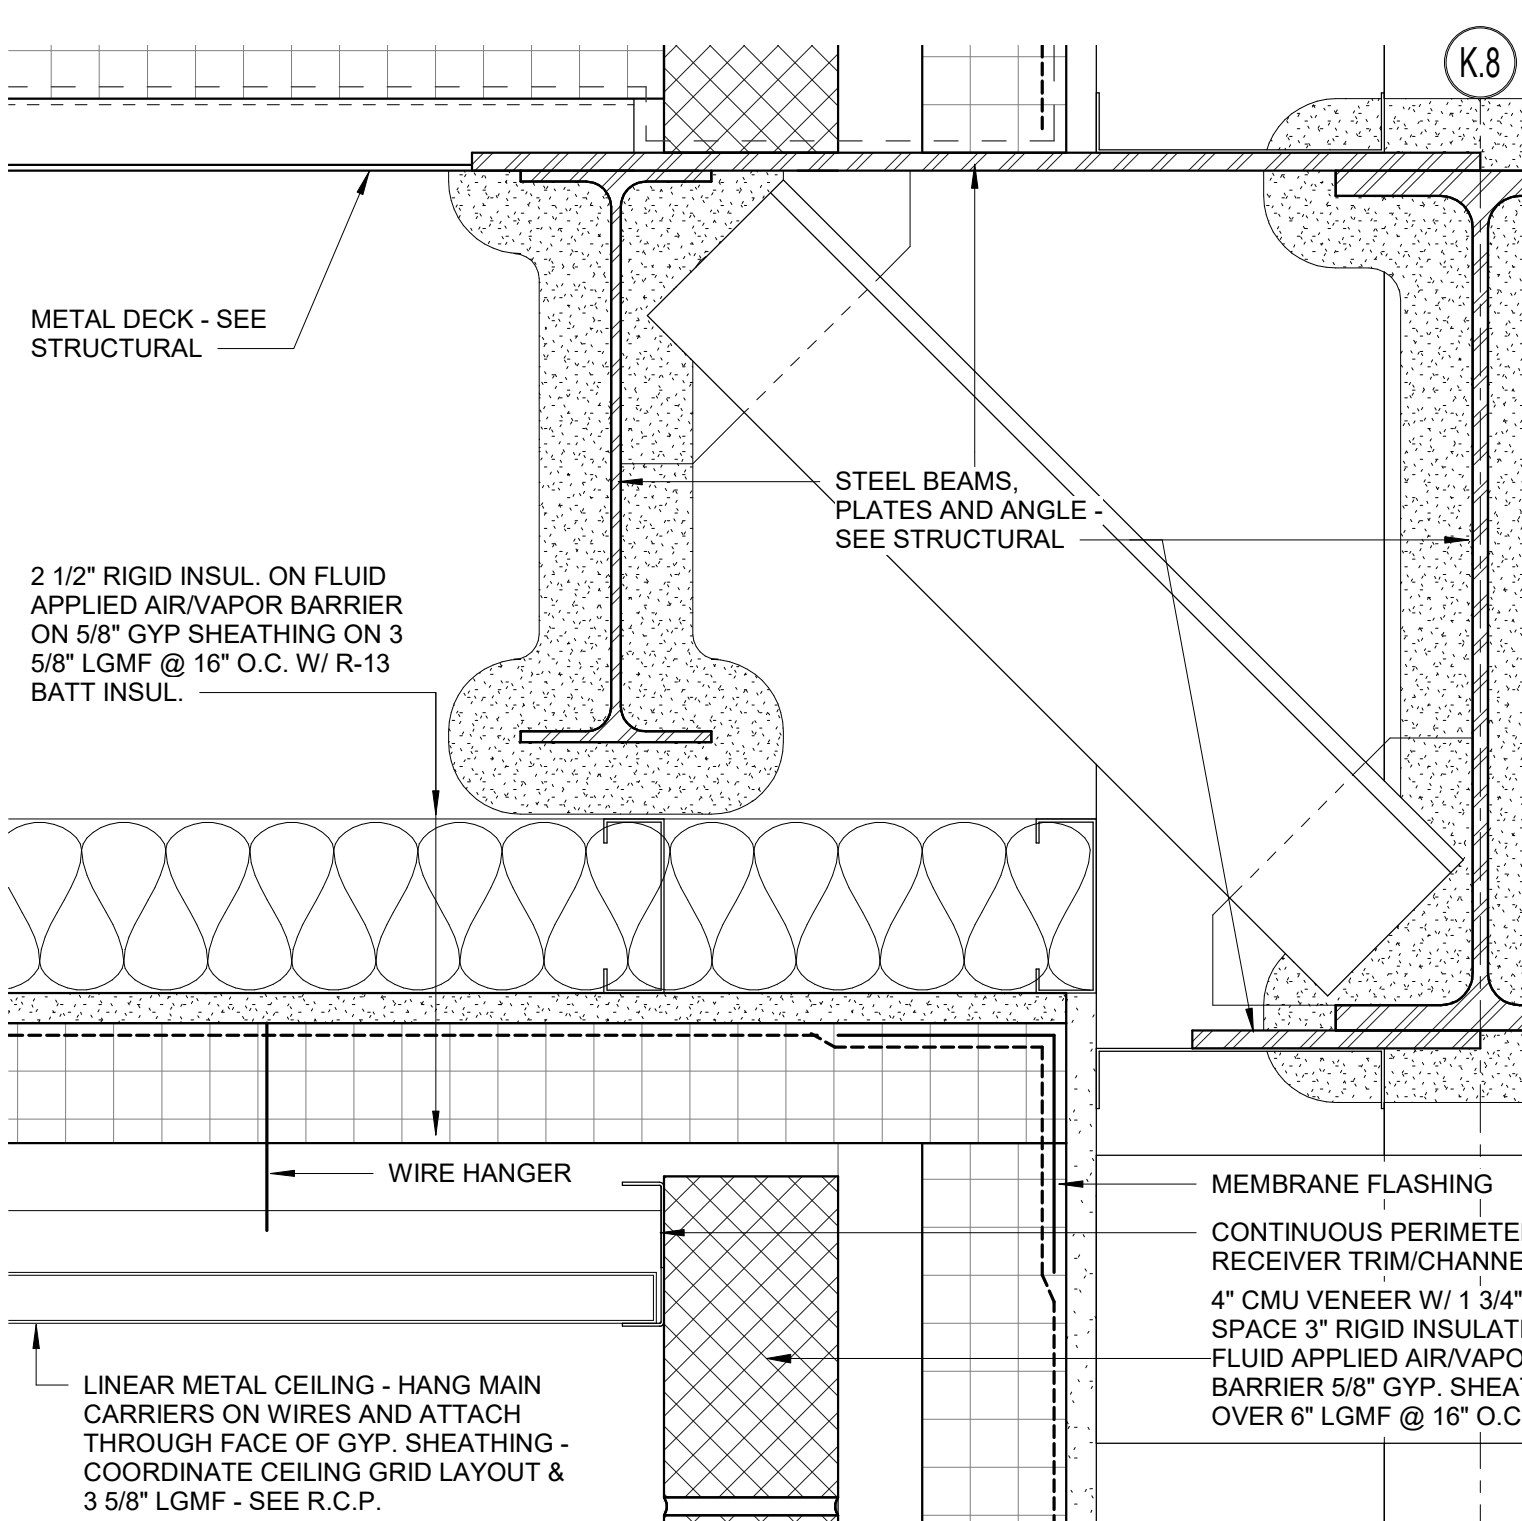


12 EXTERIOR WALL DETAIL
3" = 1'-0"

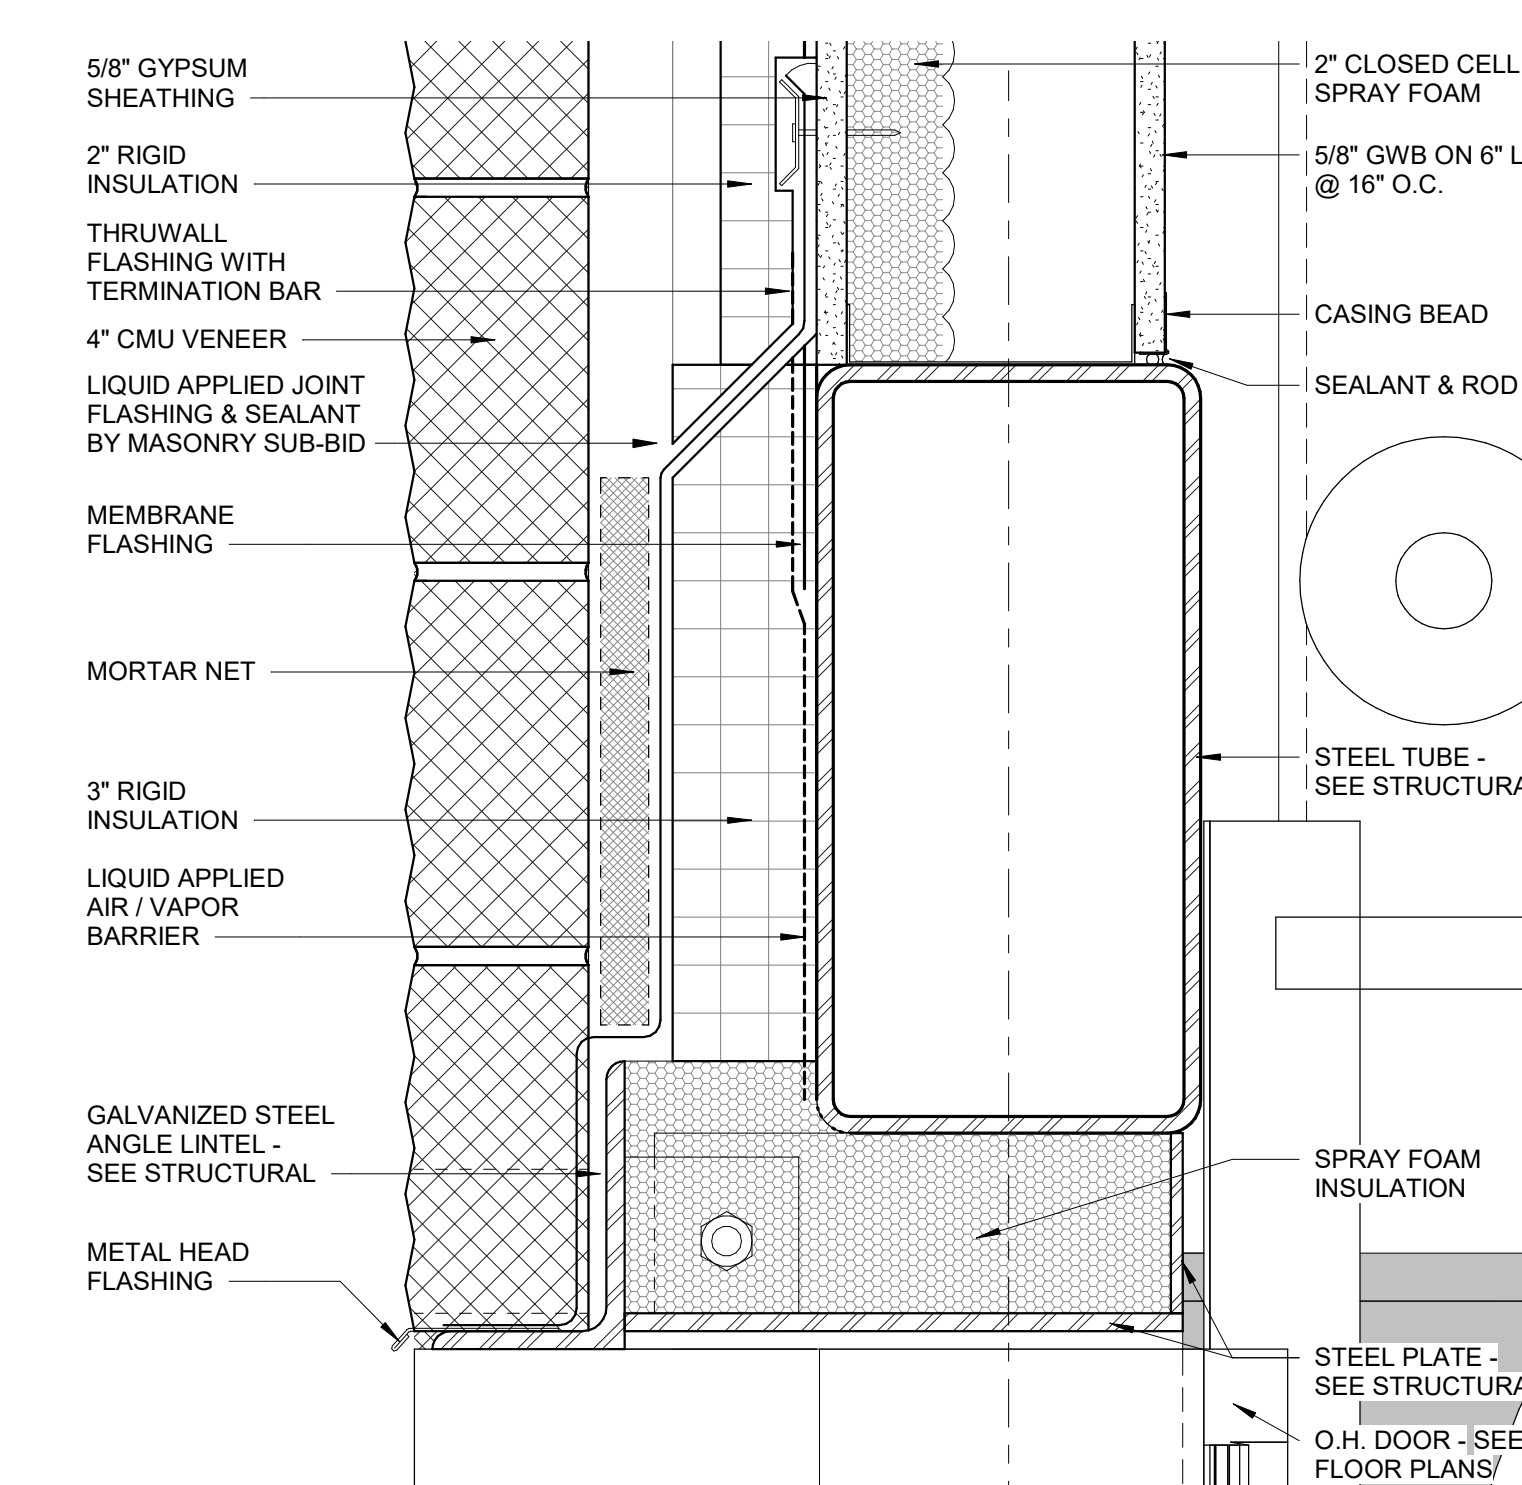


6 EXTERIOR WALL DETAIL
3" = 1'-0"

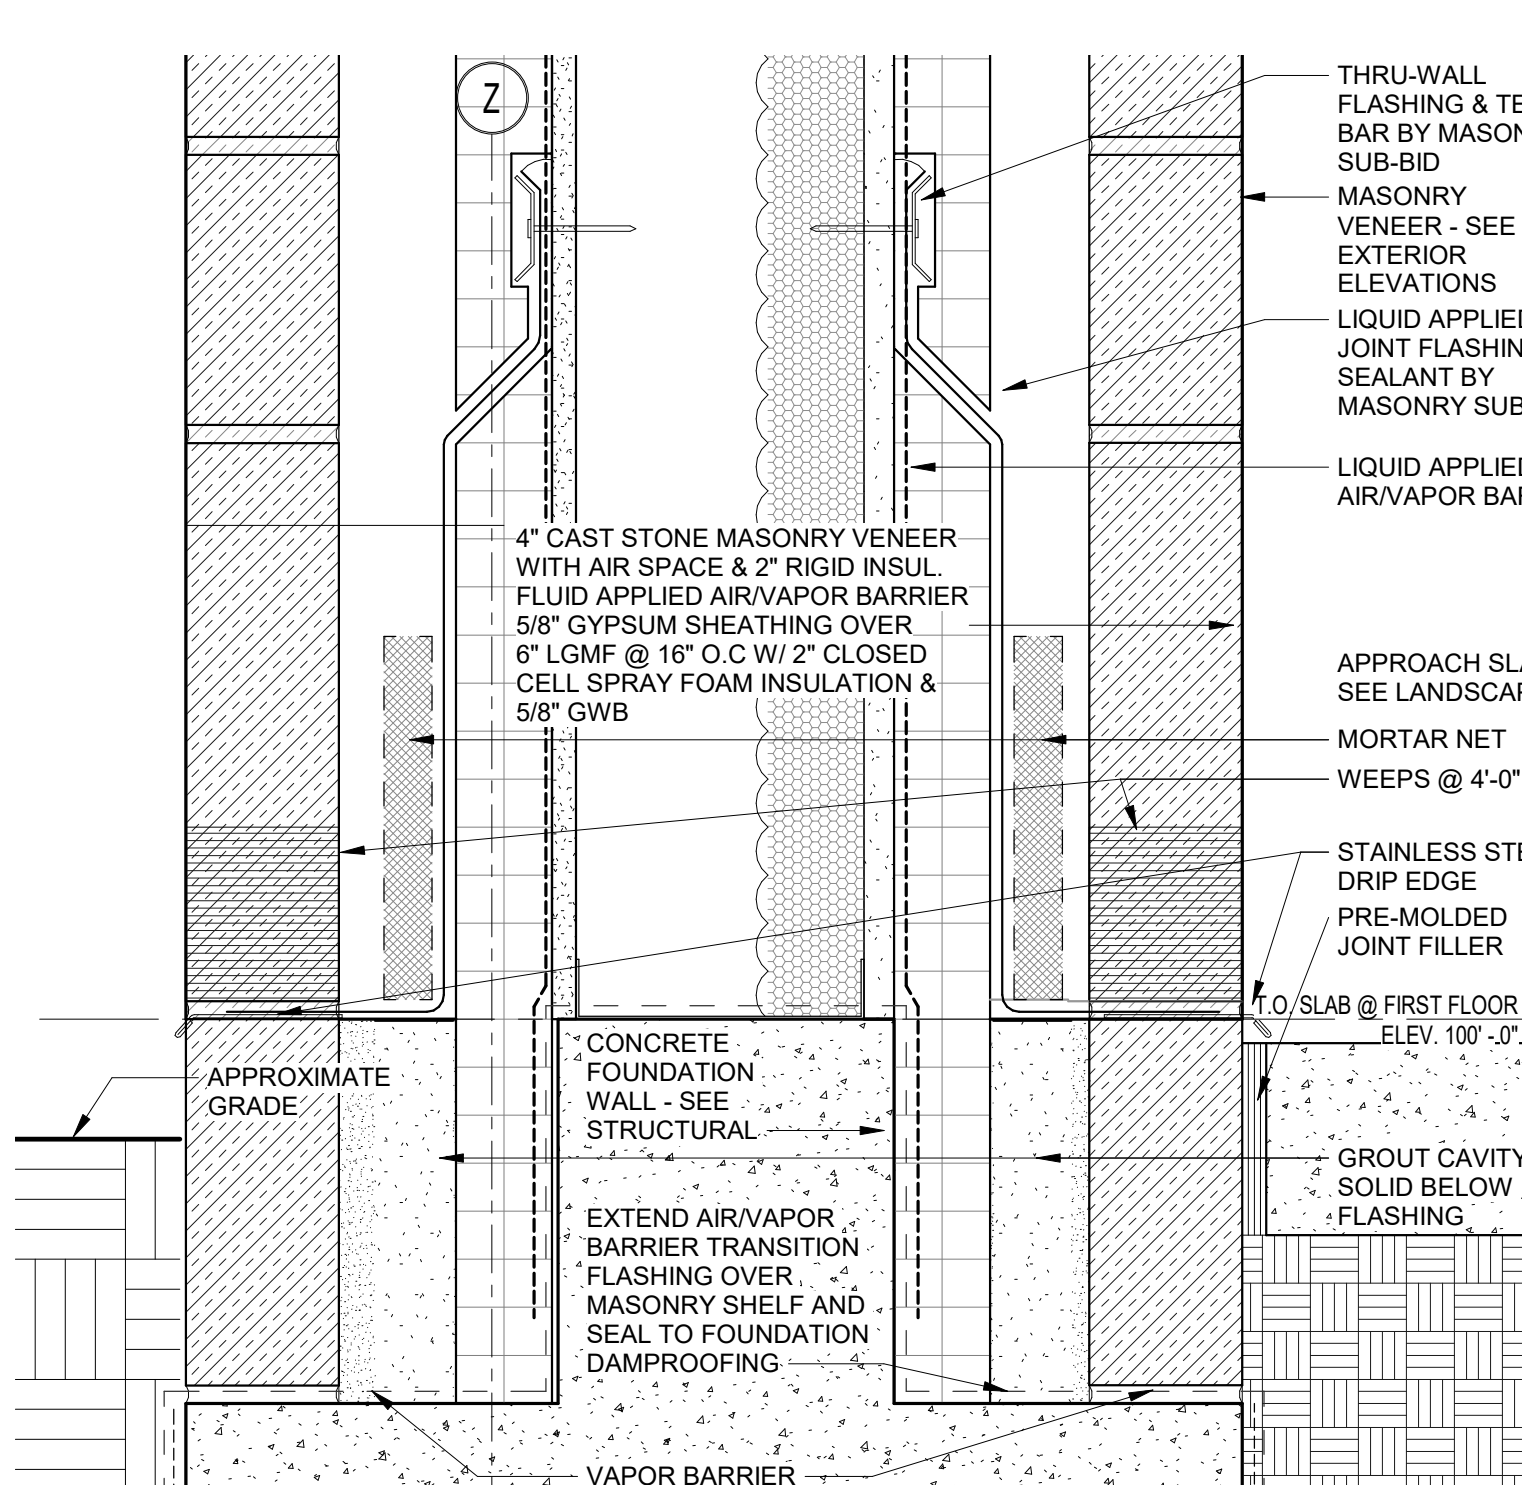


3 FOUNDATION DETAIL
3" = 1'-0"

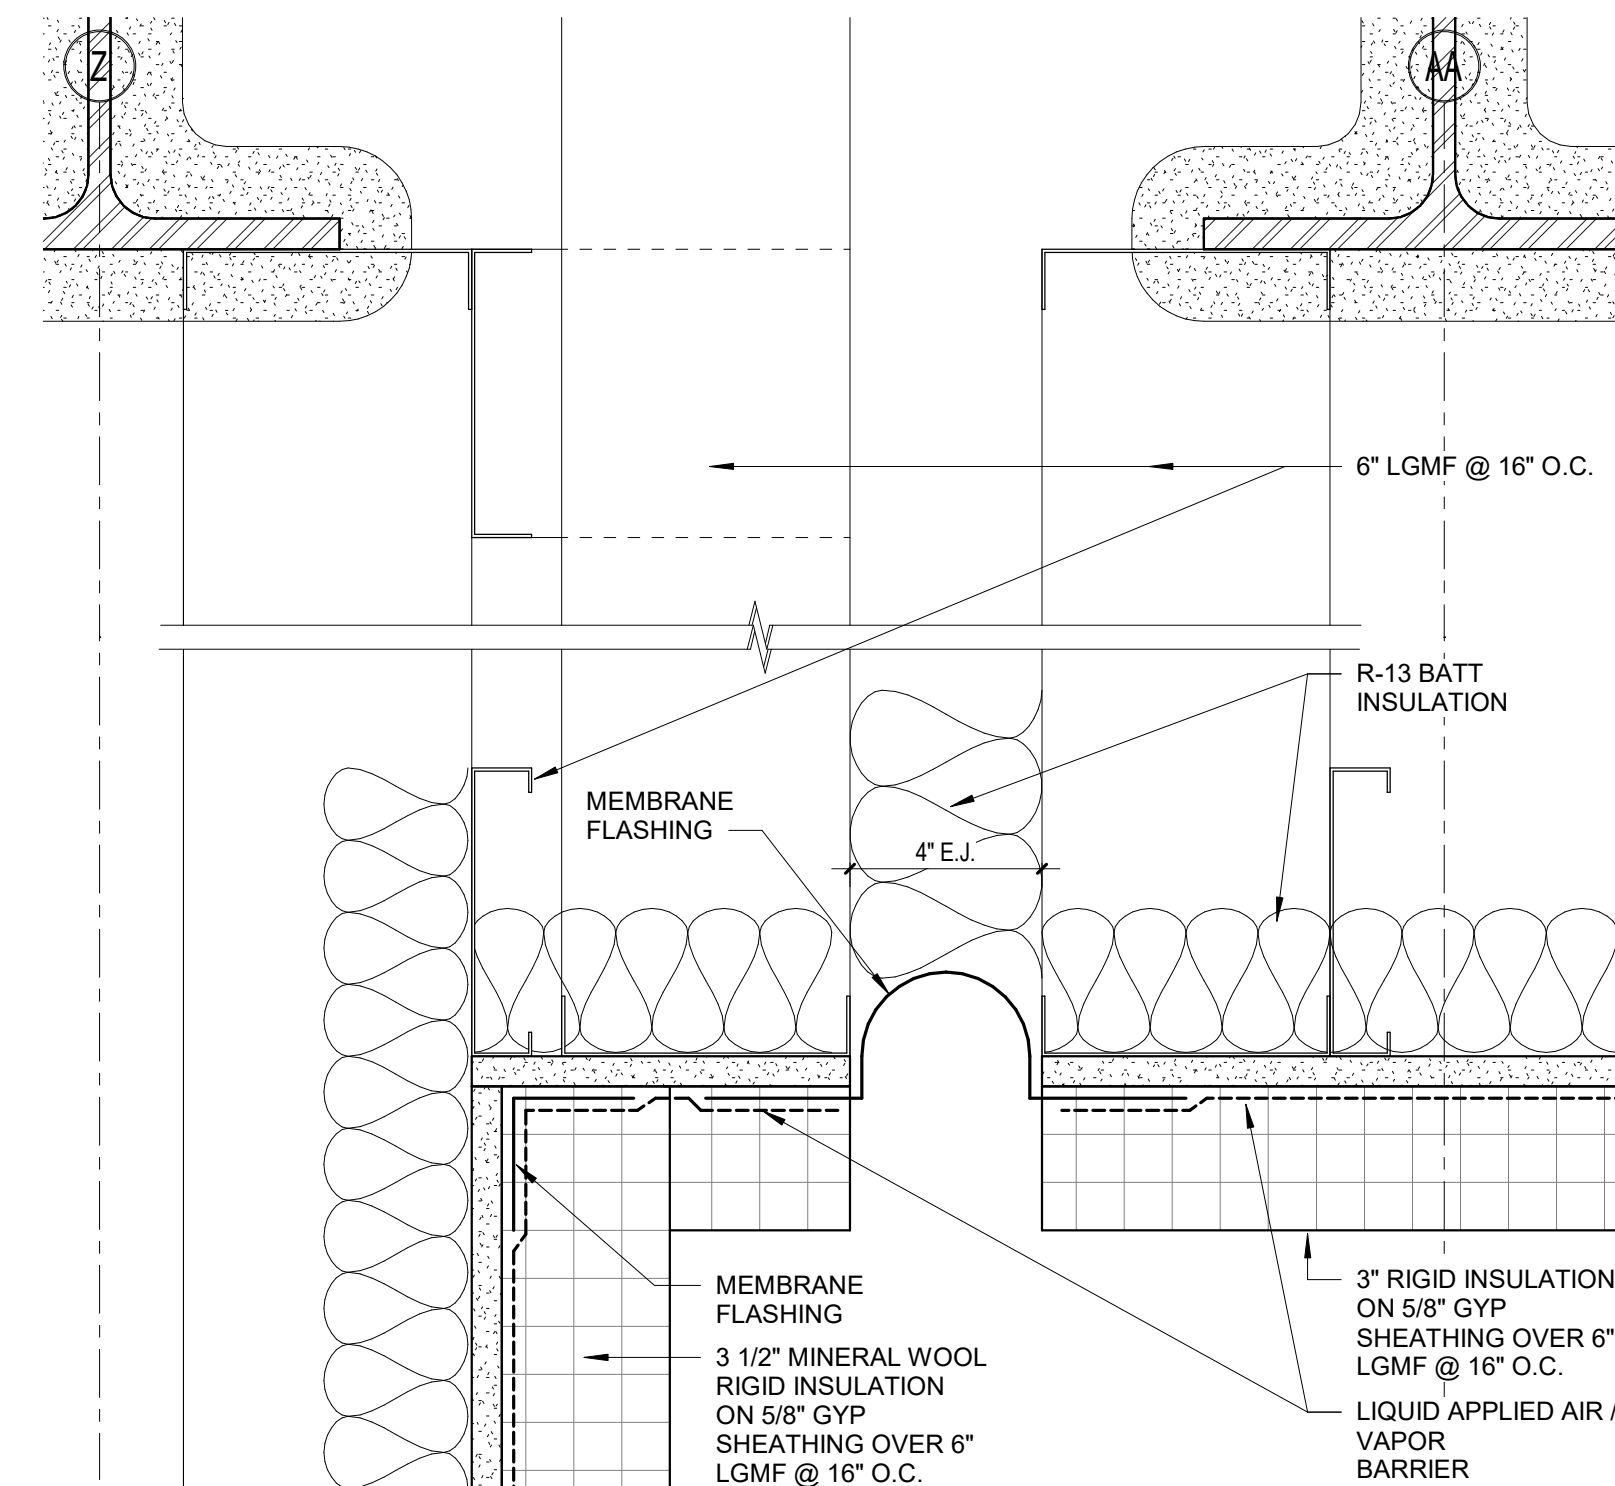


16 EXTERIOR WALL DETAIL
3" = 1'-0"

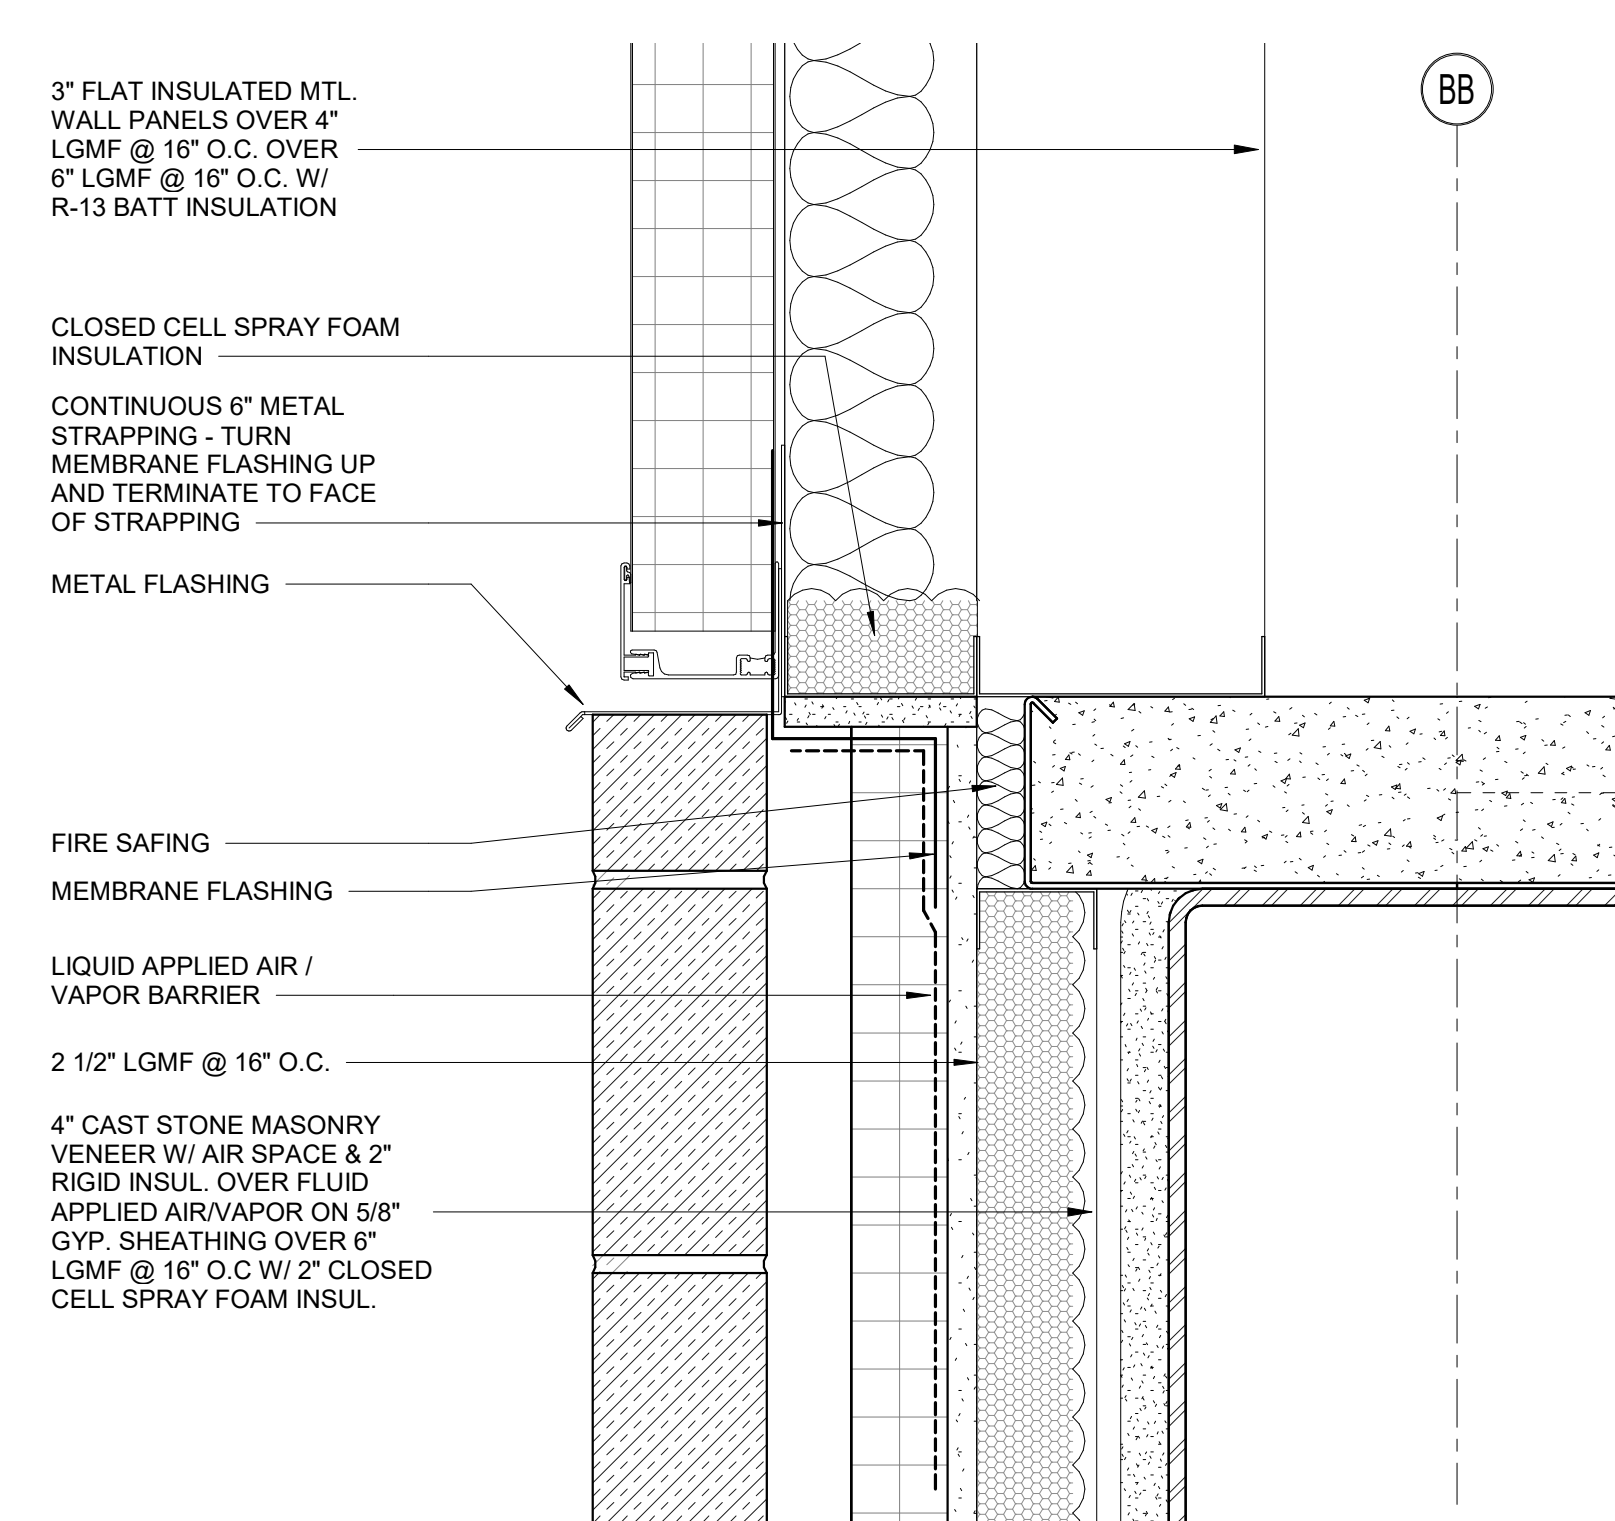


11 EXTERIOR WALL DETAIL
3" = 1'-0"

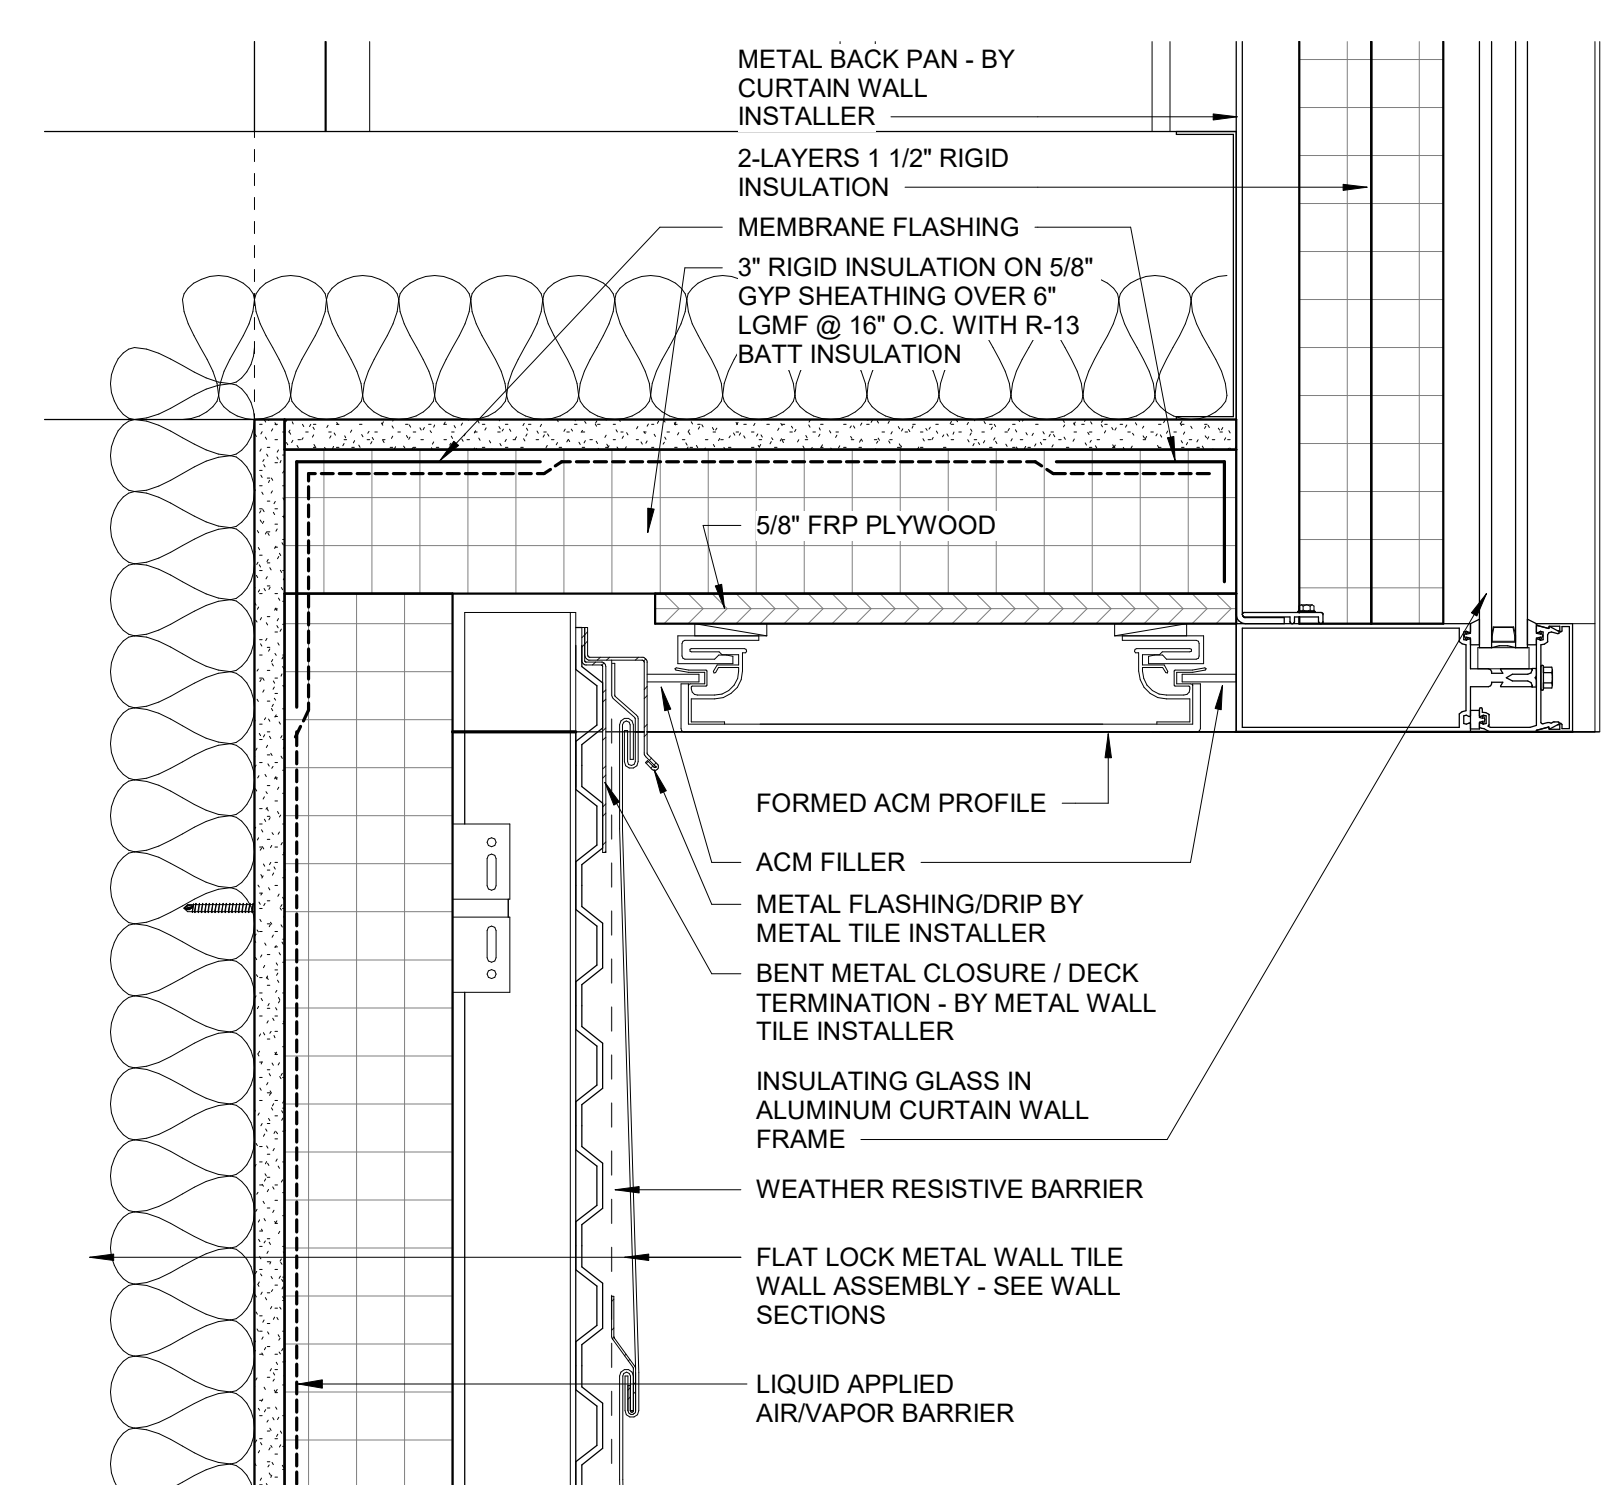


7 EXTERIOR WALL DETAIL
3" = 1'-0"

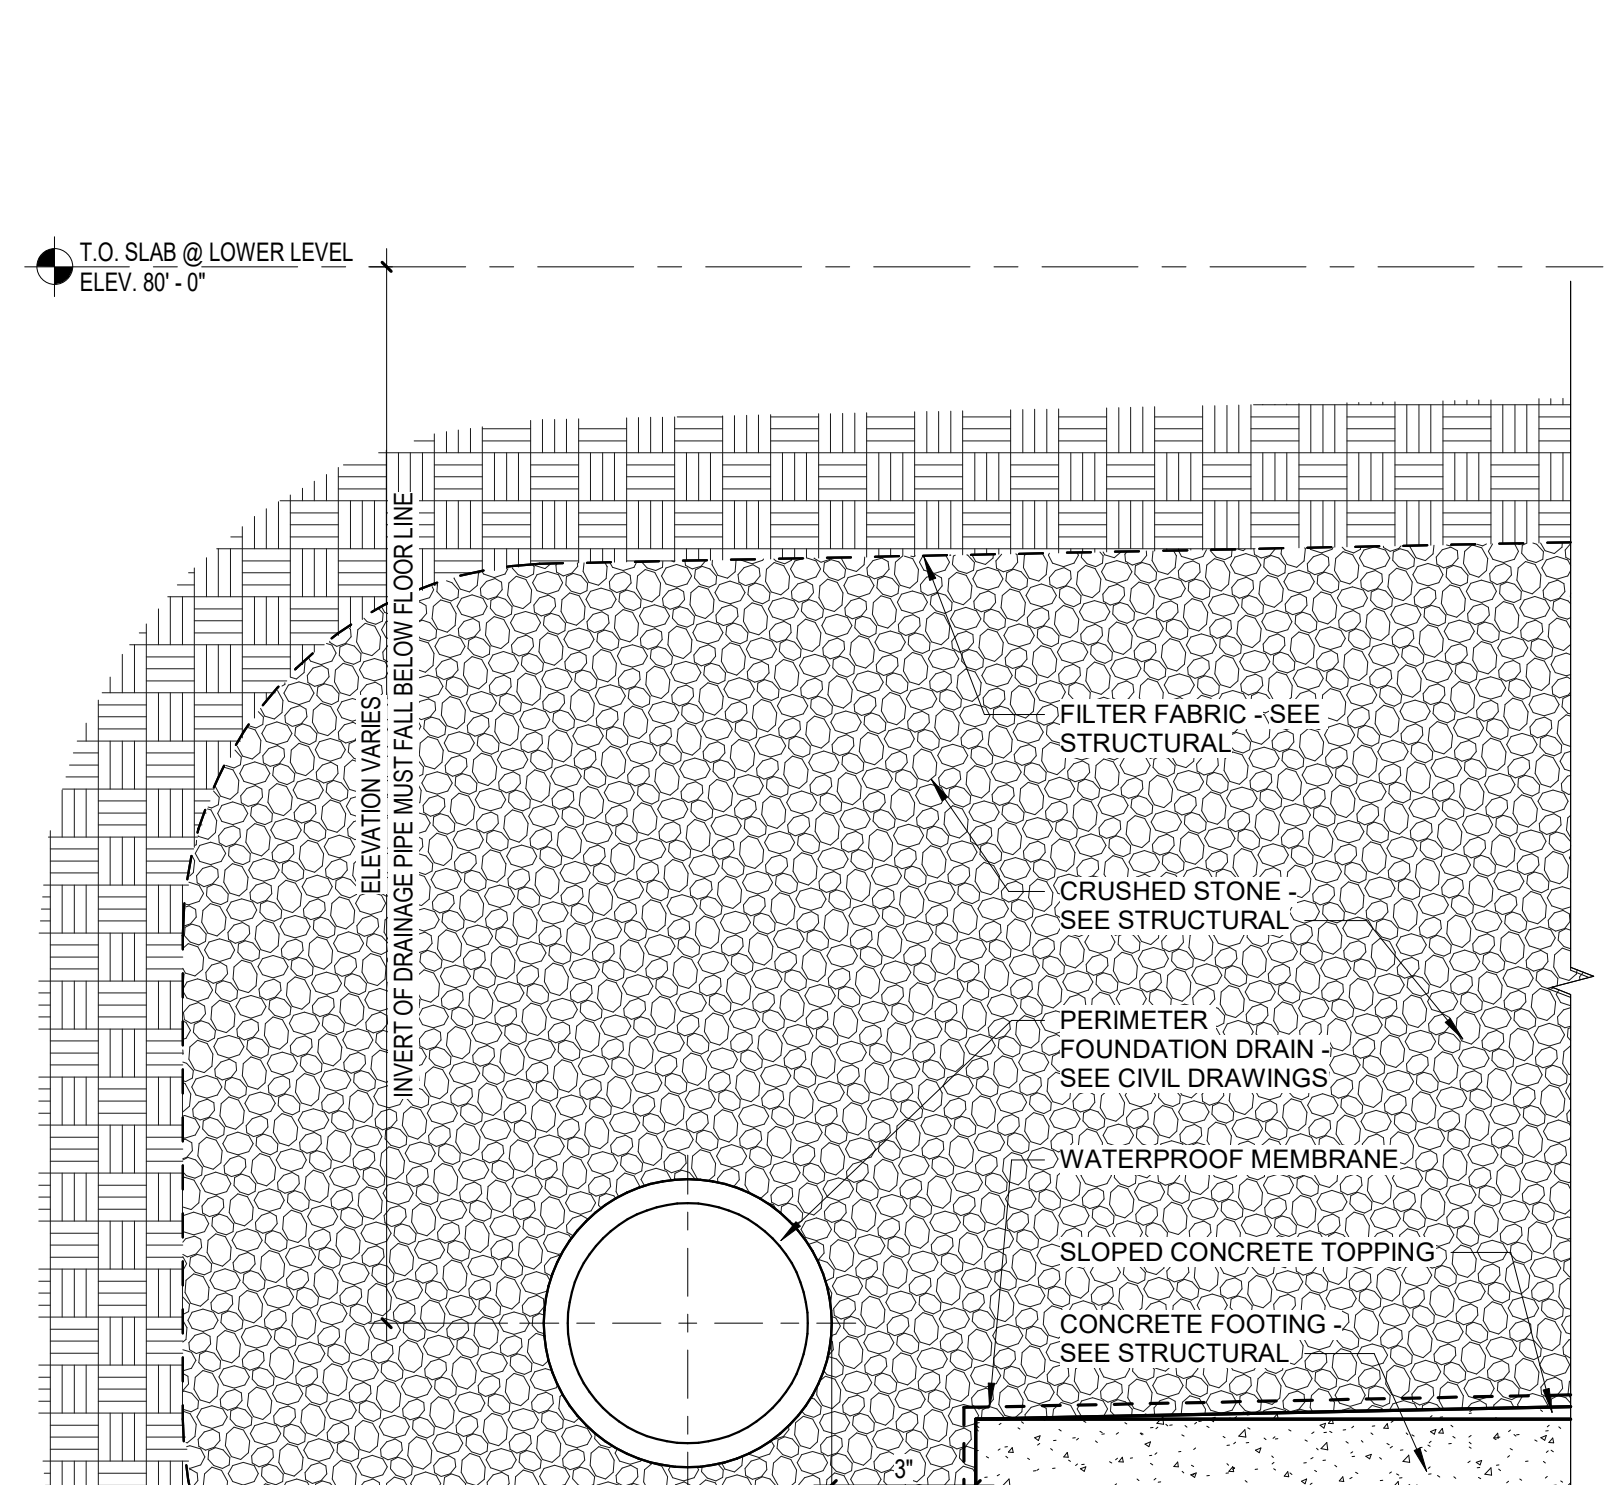


2 FOUNDATION DRAINAGE DETAIL
3" = 1'-0"

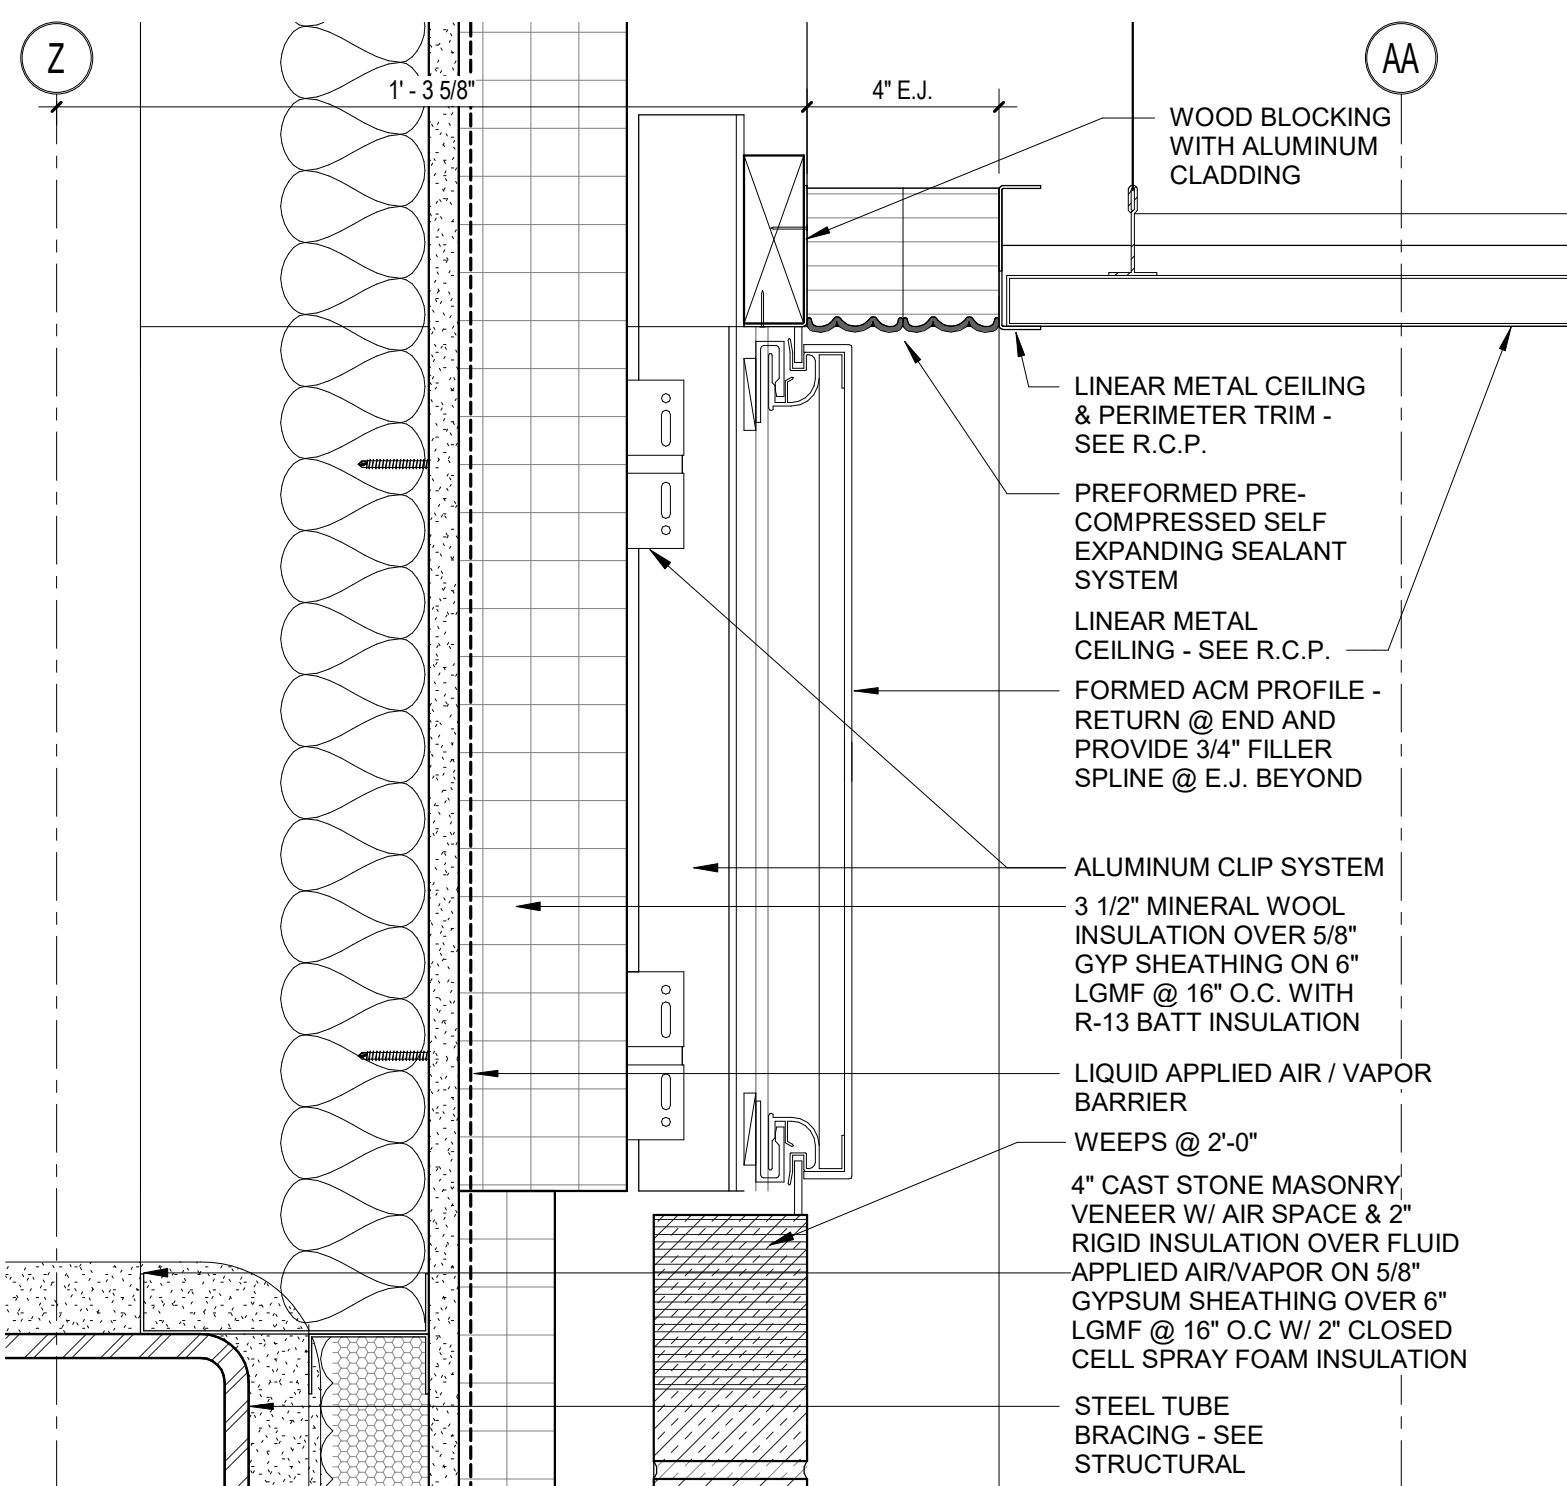


17 EXTERIOR WALL DETAIL
3" = 1'-0"

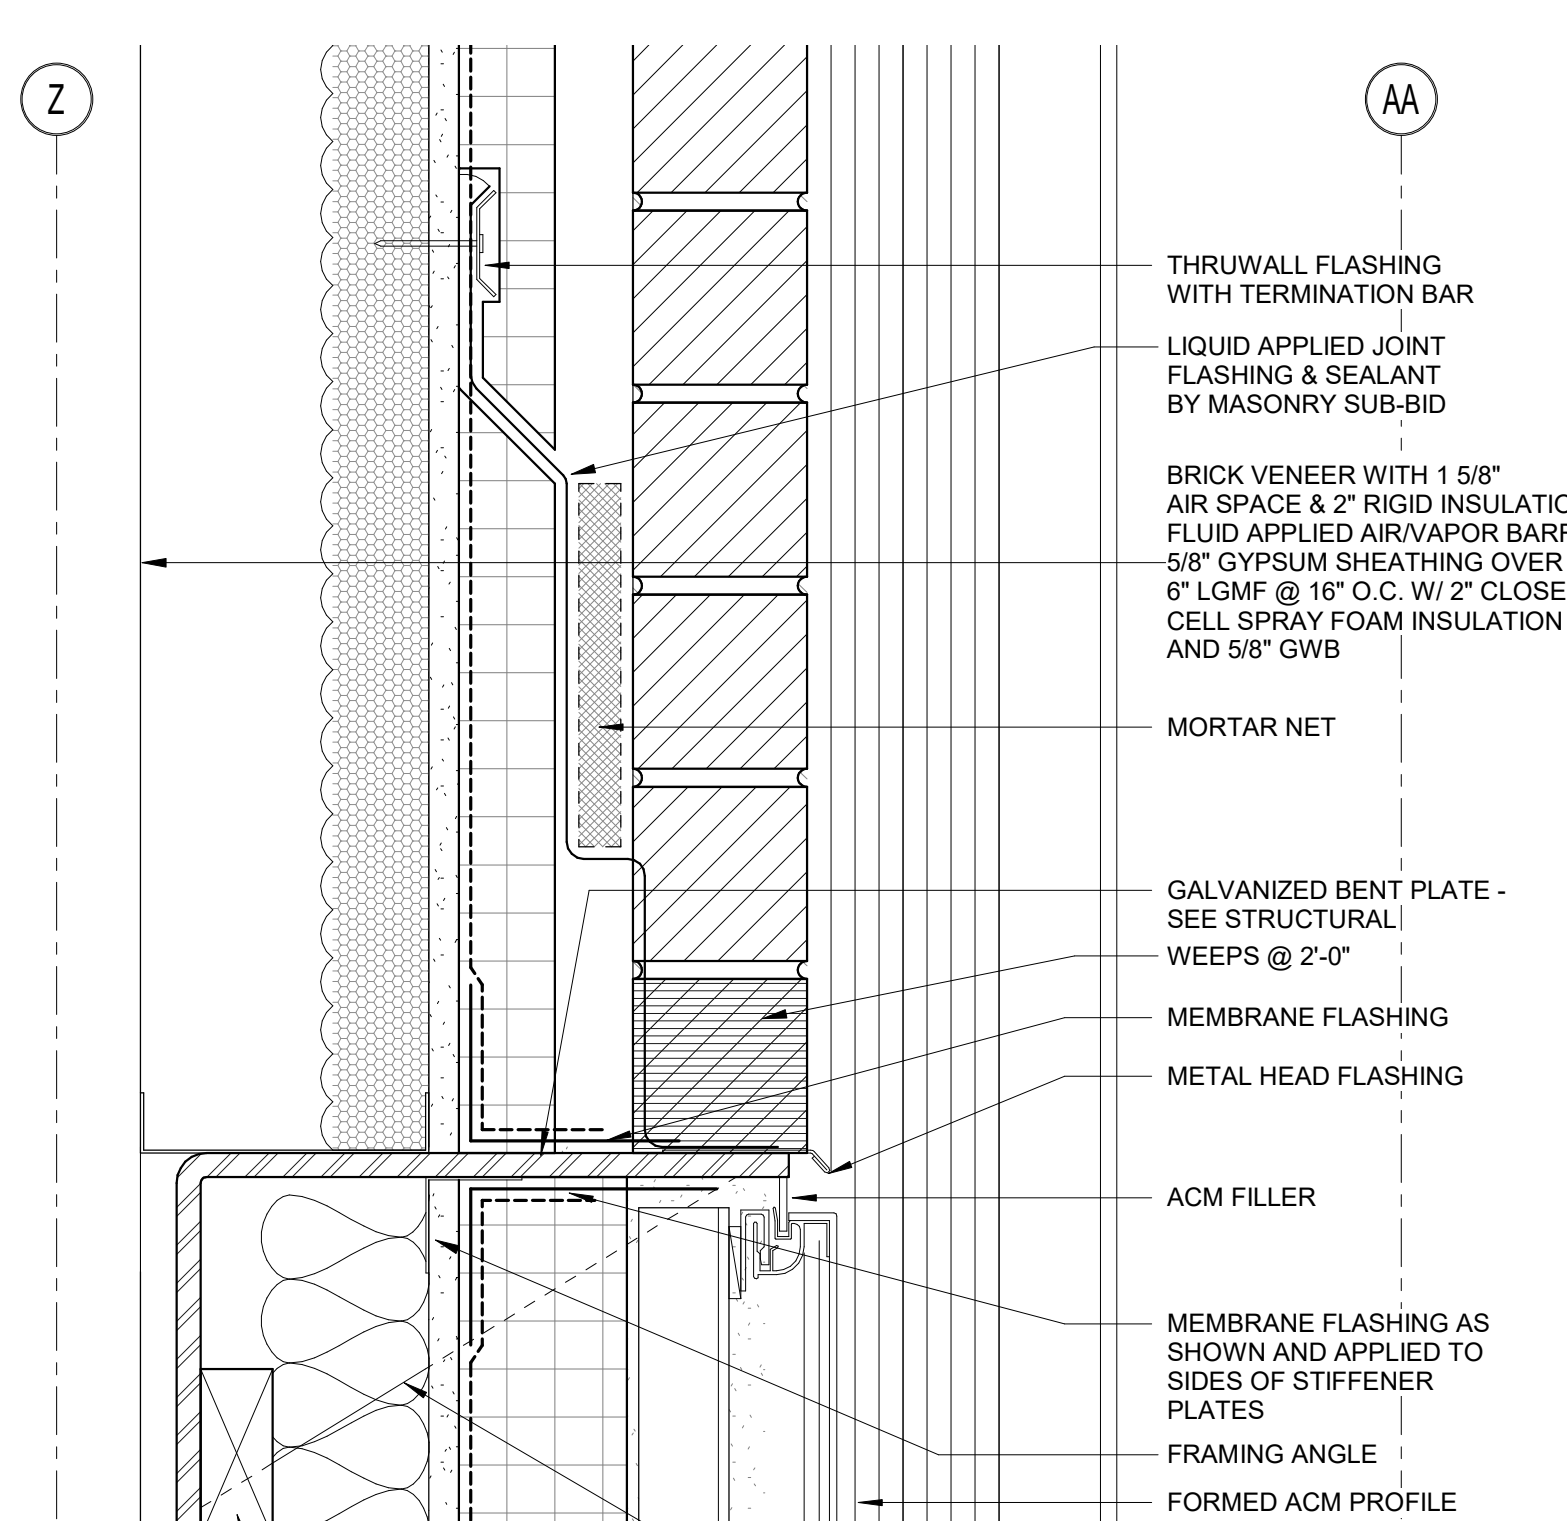


8 EXTERIOR WALL DETAIL
3" = 1'-0"

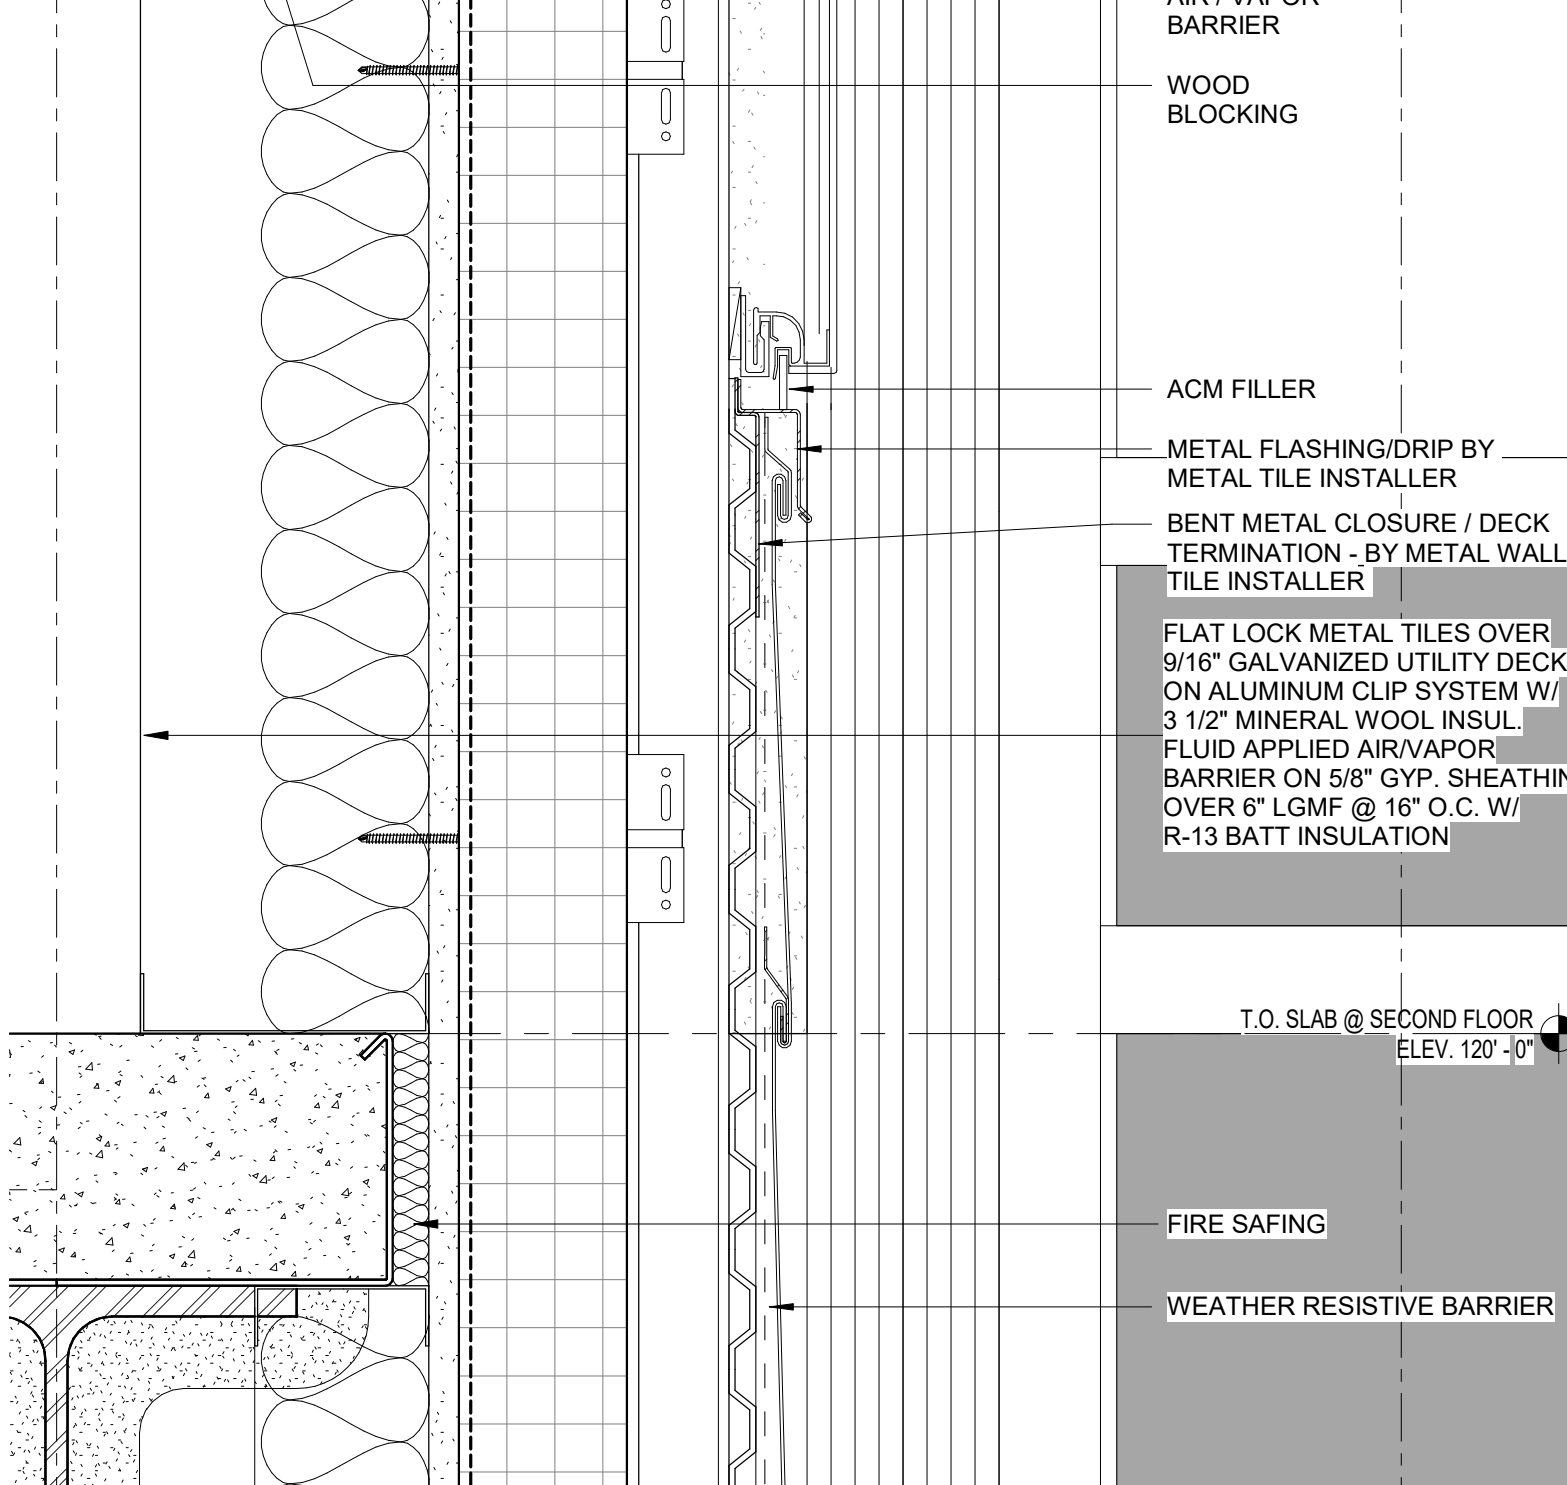


8 EXTERIOR WALL DETAIL
3" = 1'-0"

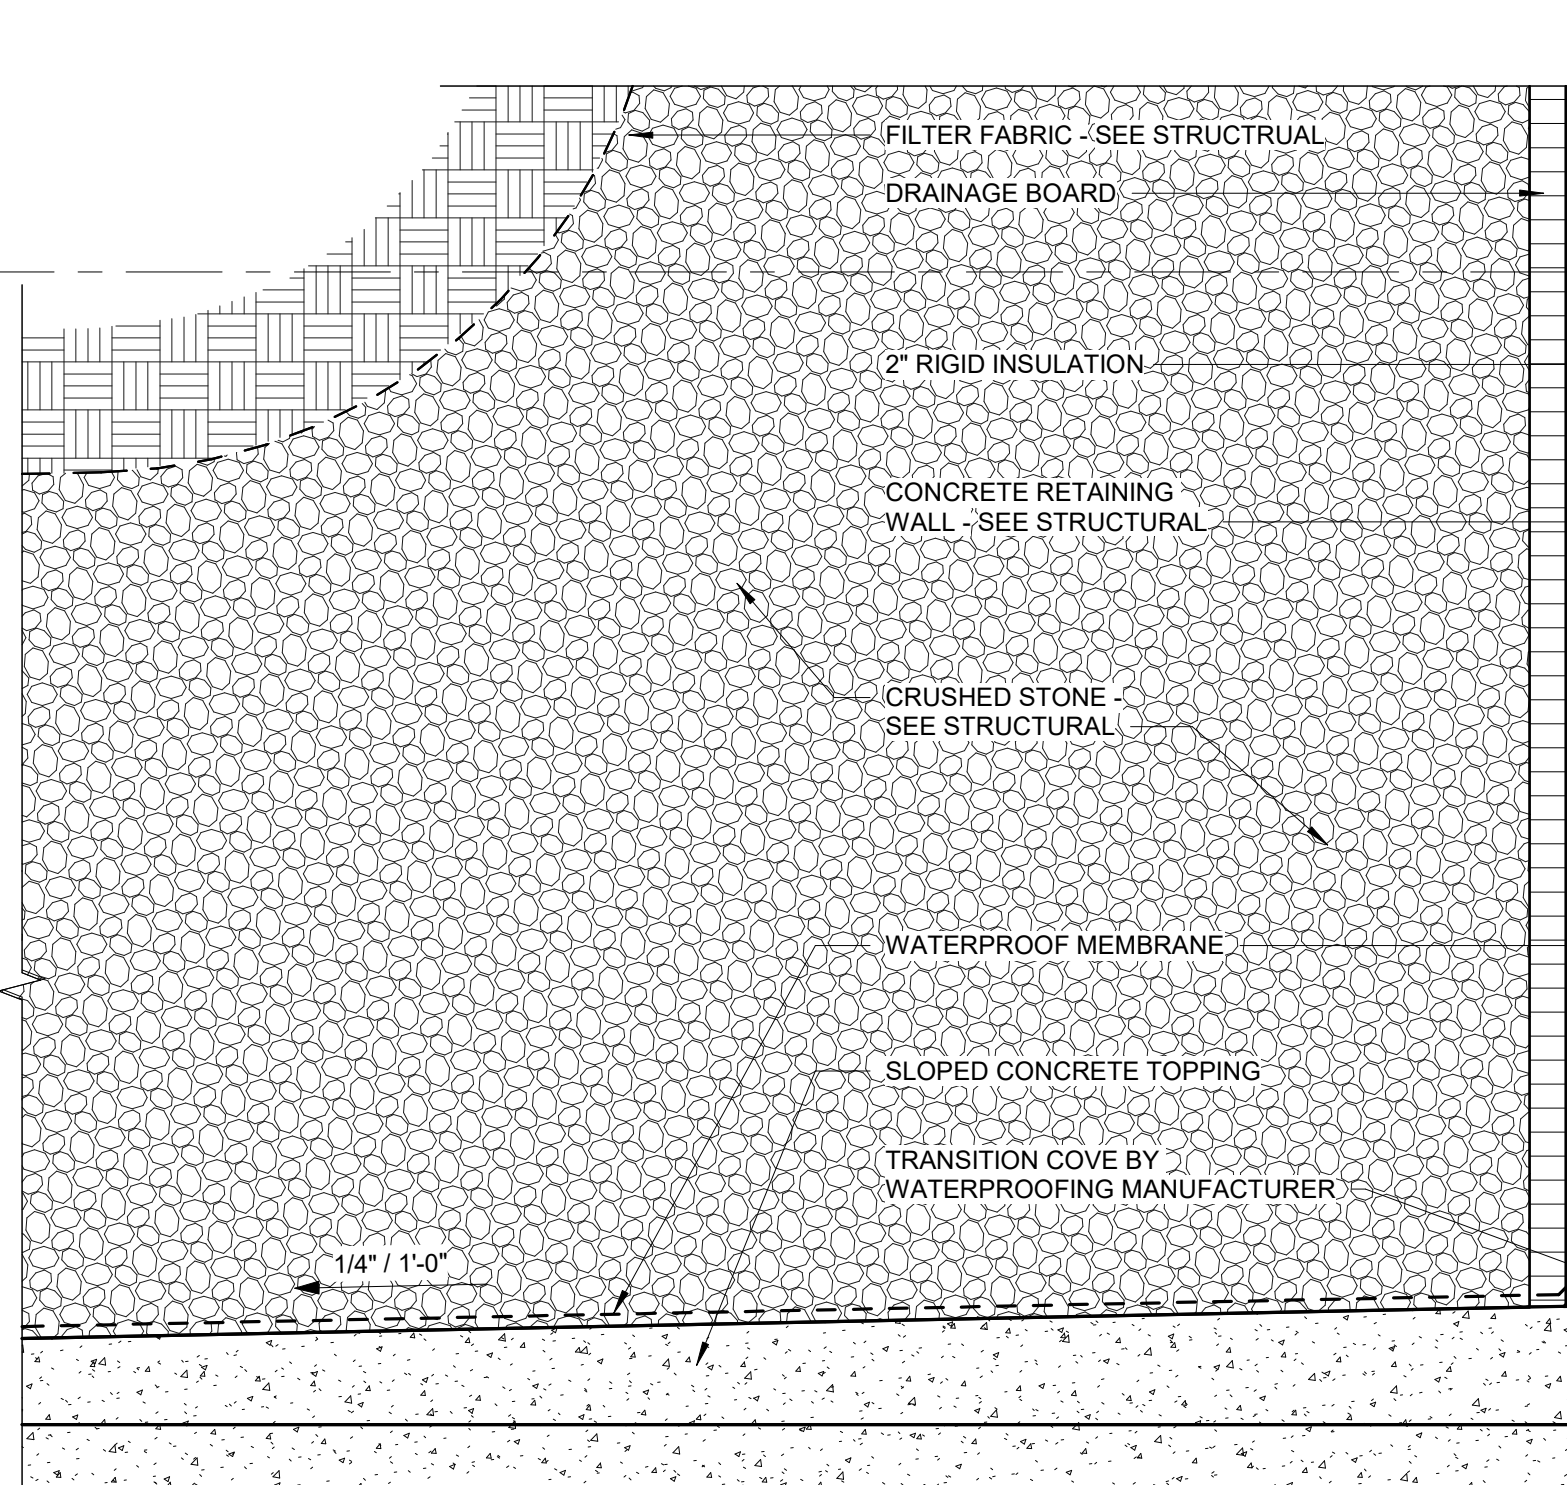


1 FOUNDATION DRAINAGE DETAIL
3" = 1'-0"

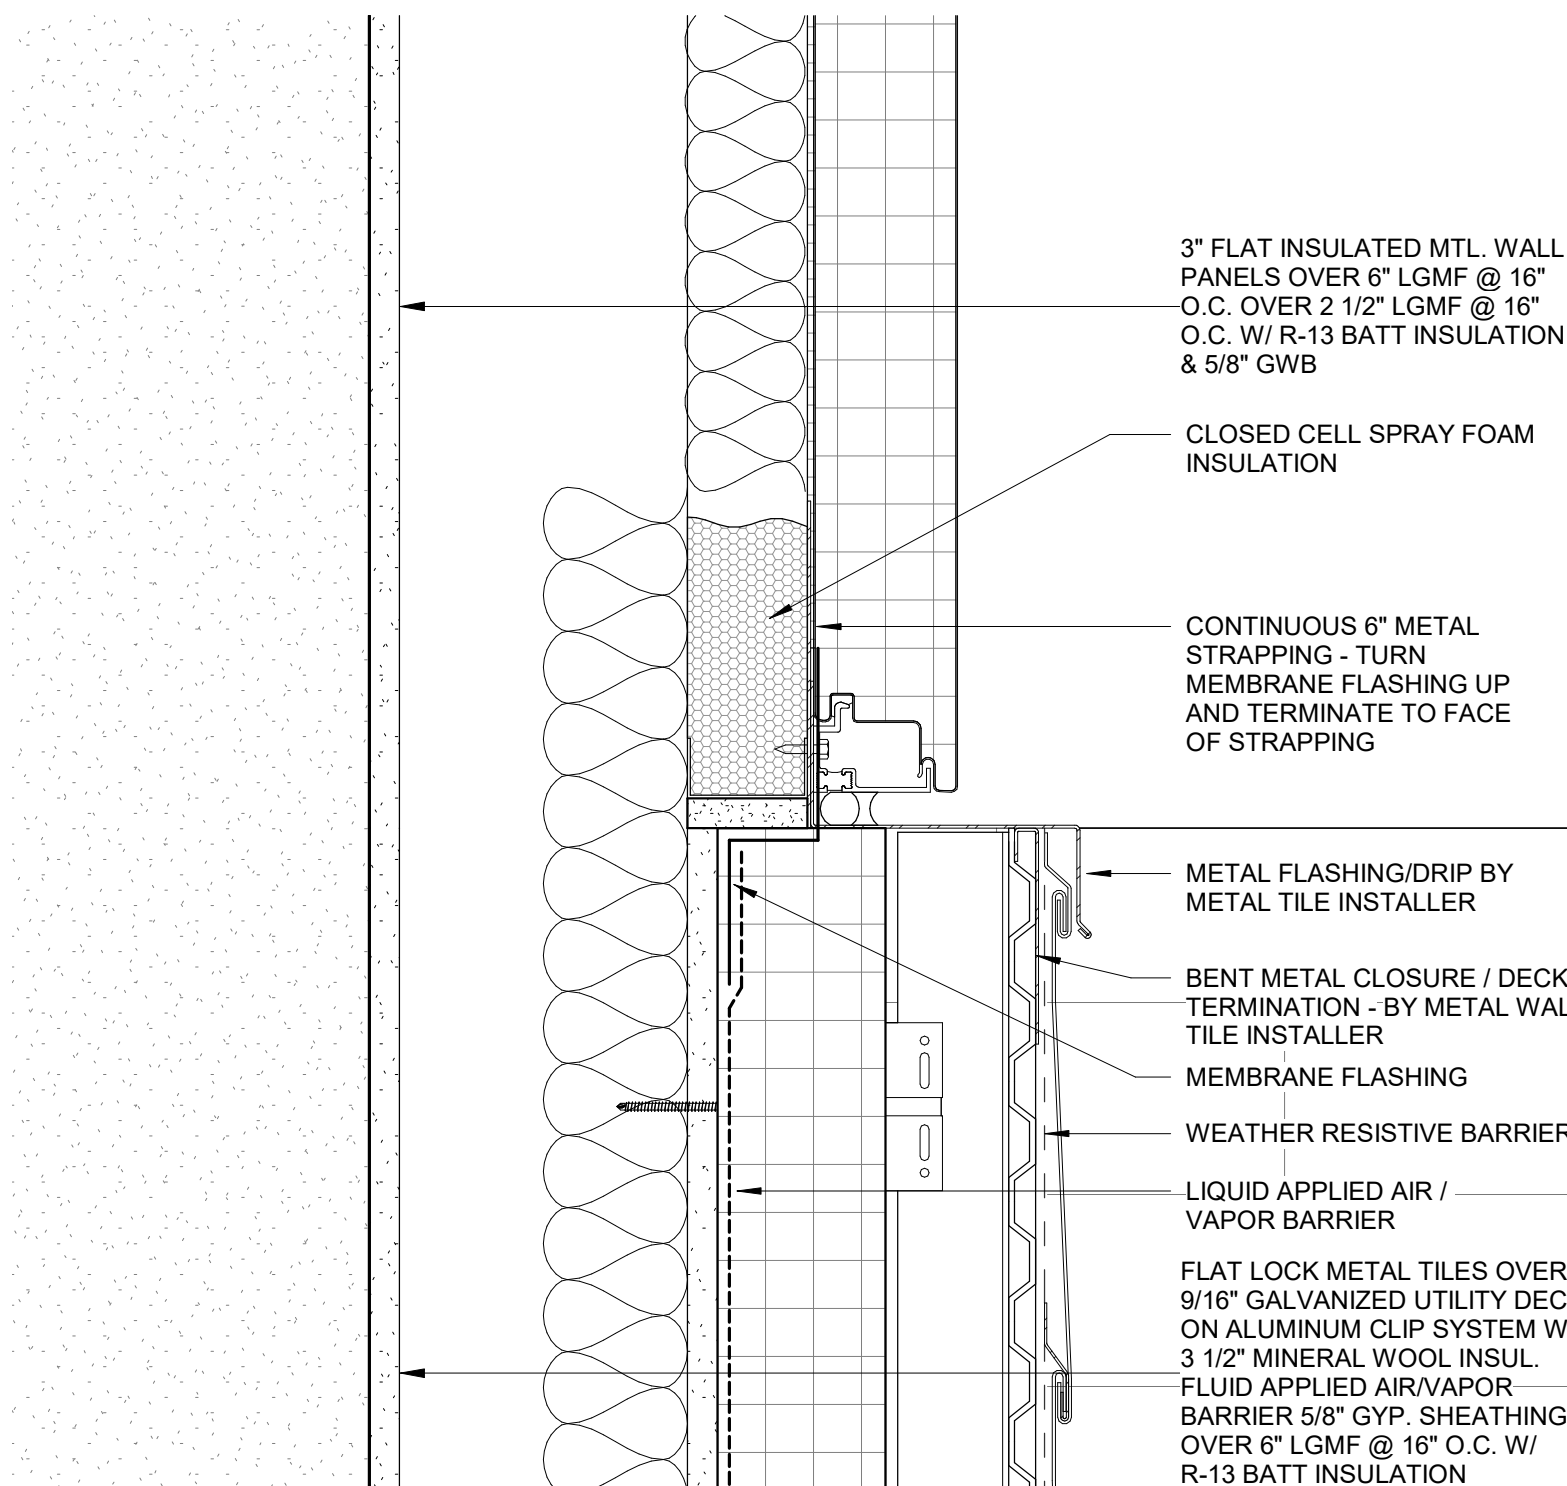







18 EXTERIOR WALL DETAIL
3" = 1'-0"

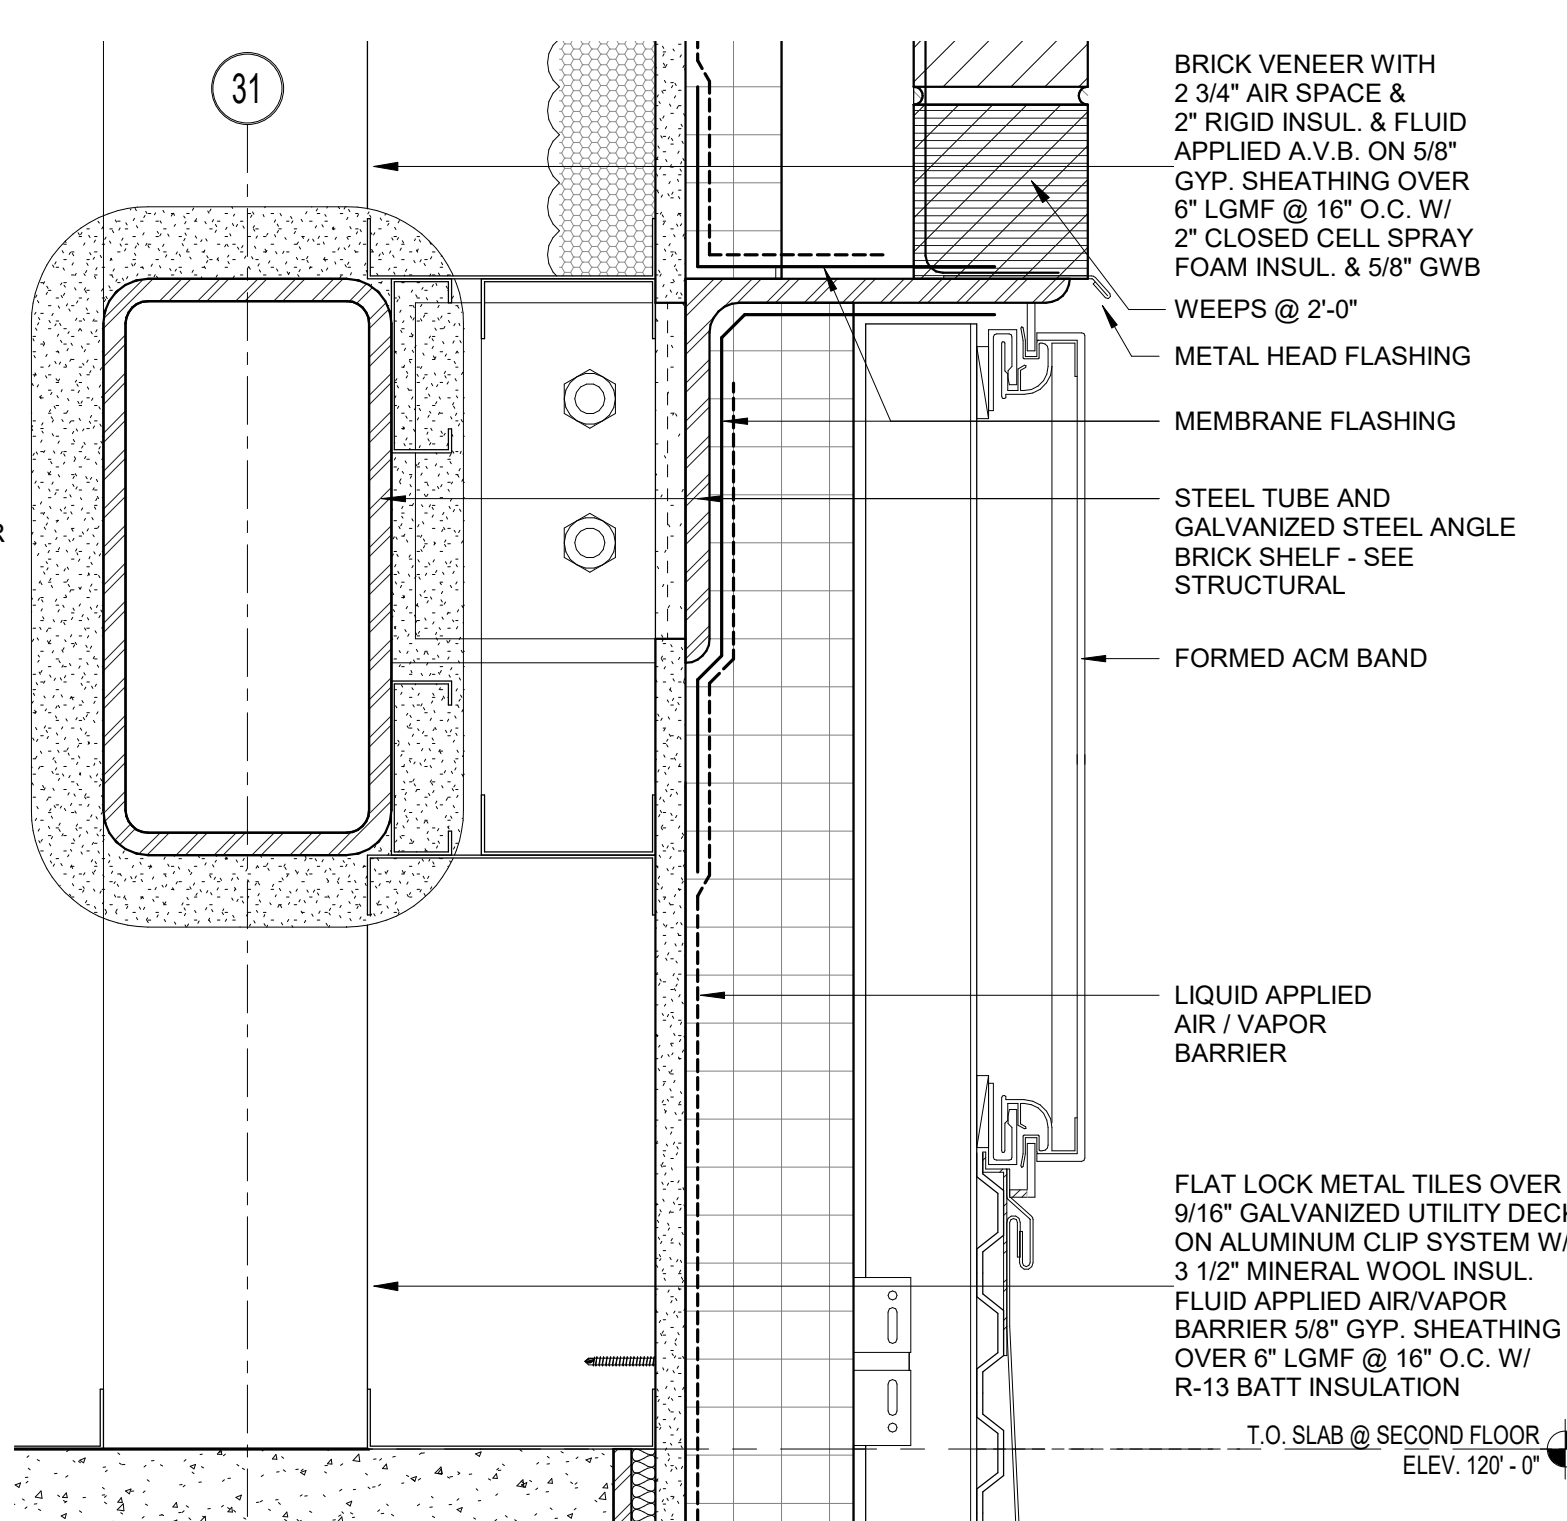


10 EXTERIOR WALL DETAIL
3" = 1'-0"

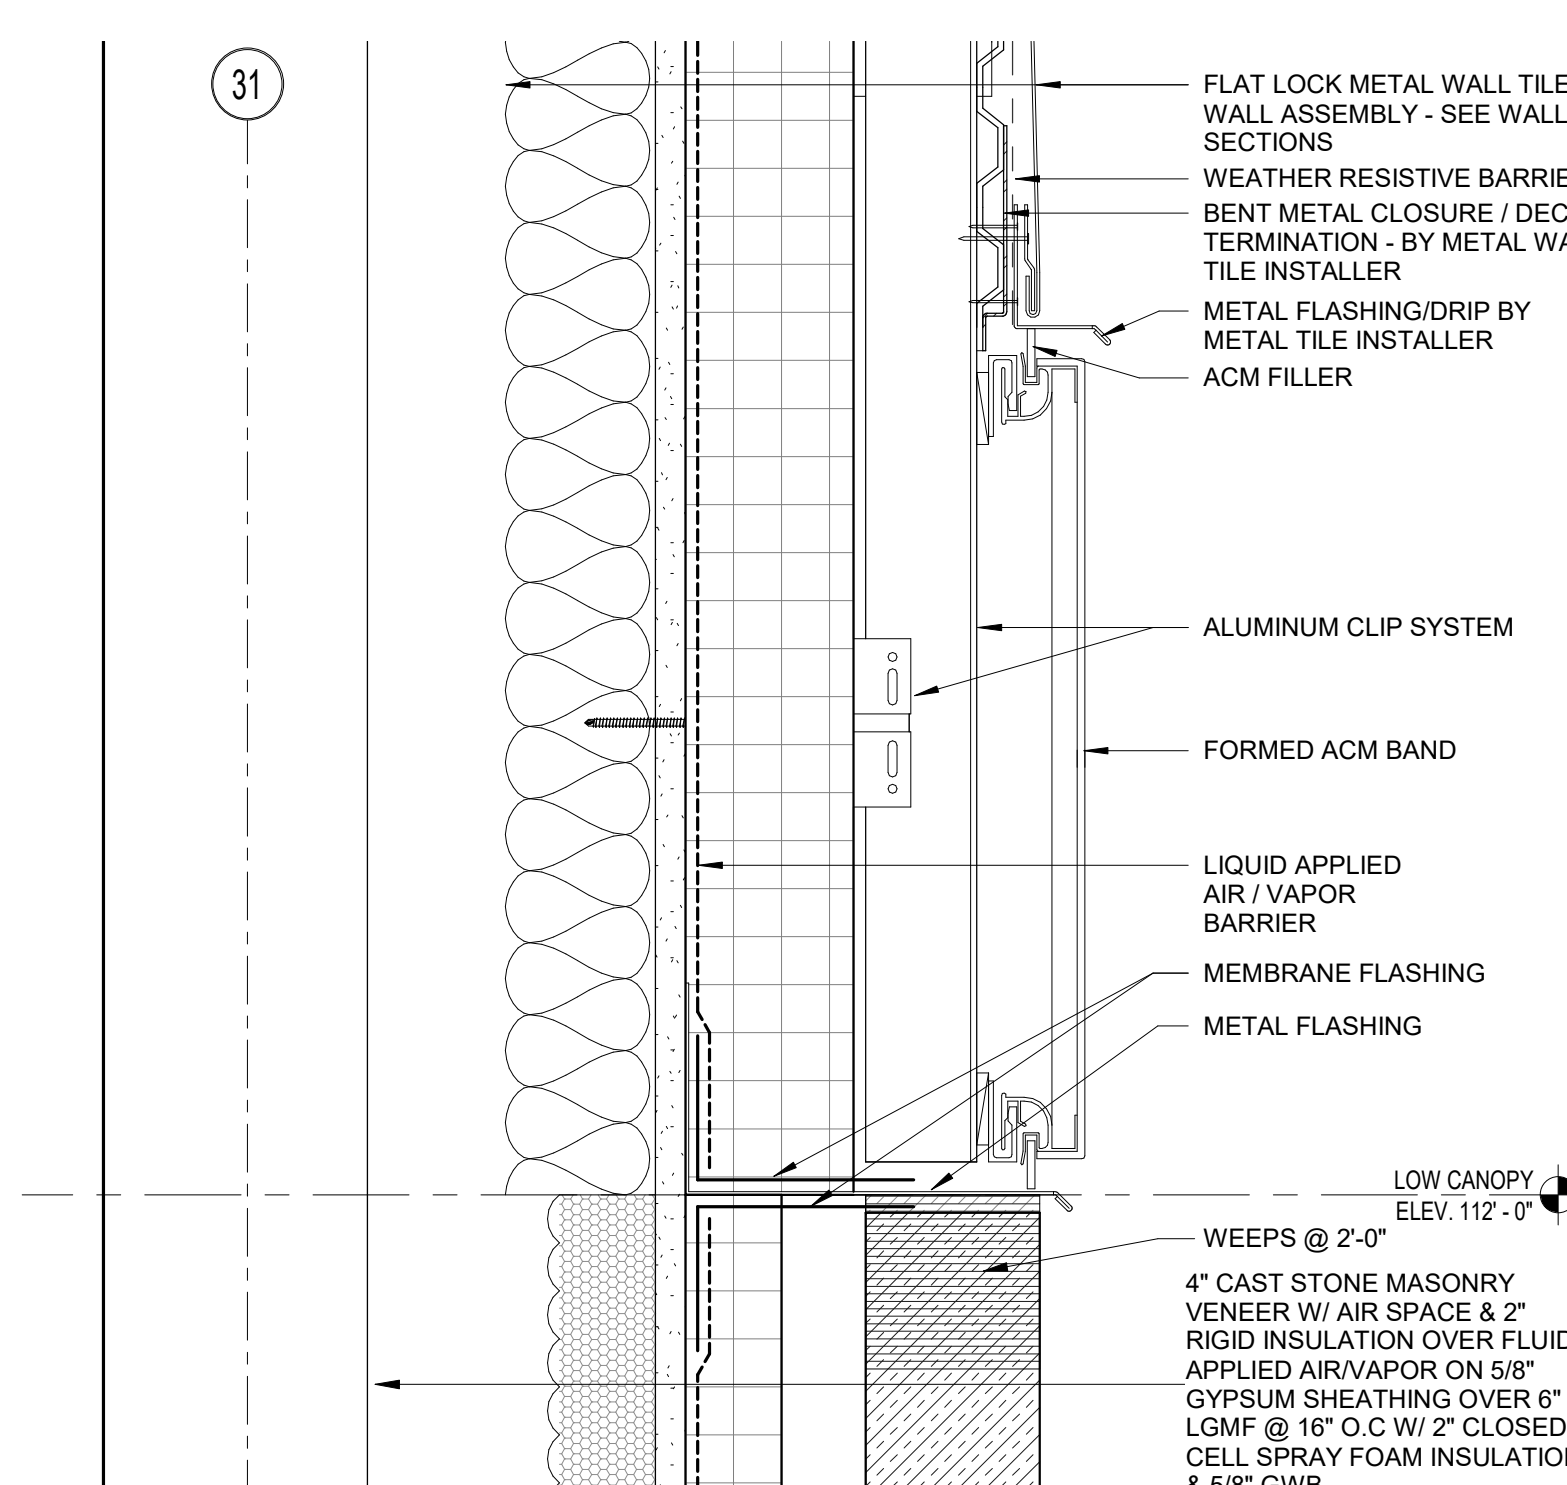

9 EXTERIOR WALL DETAIL
3" = 1'-0"

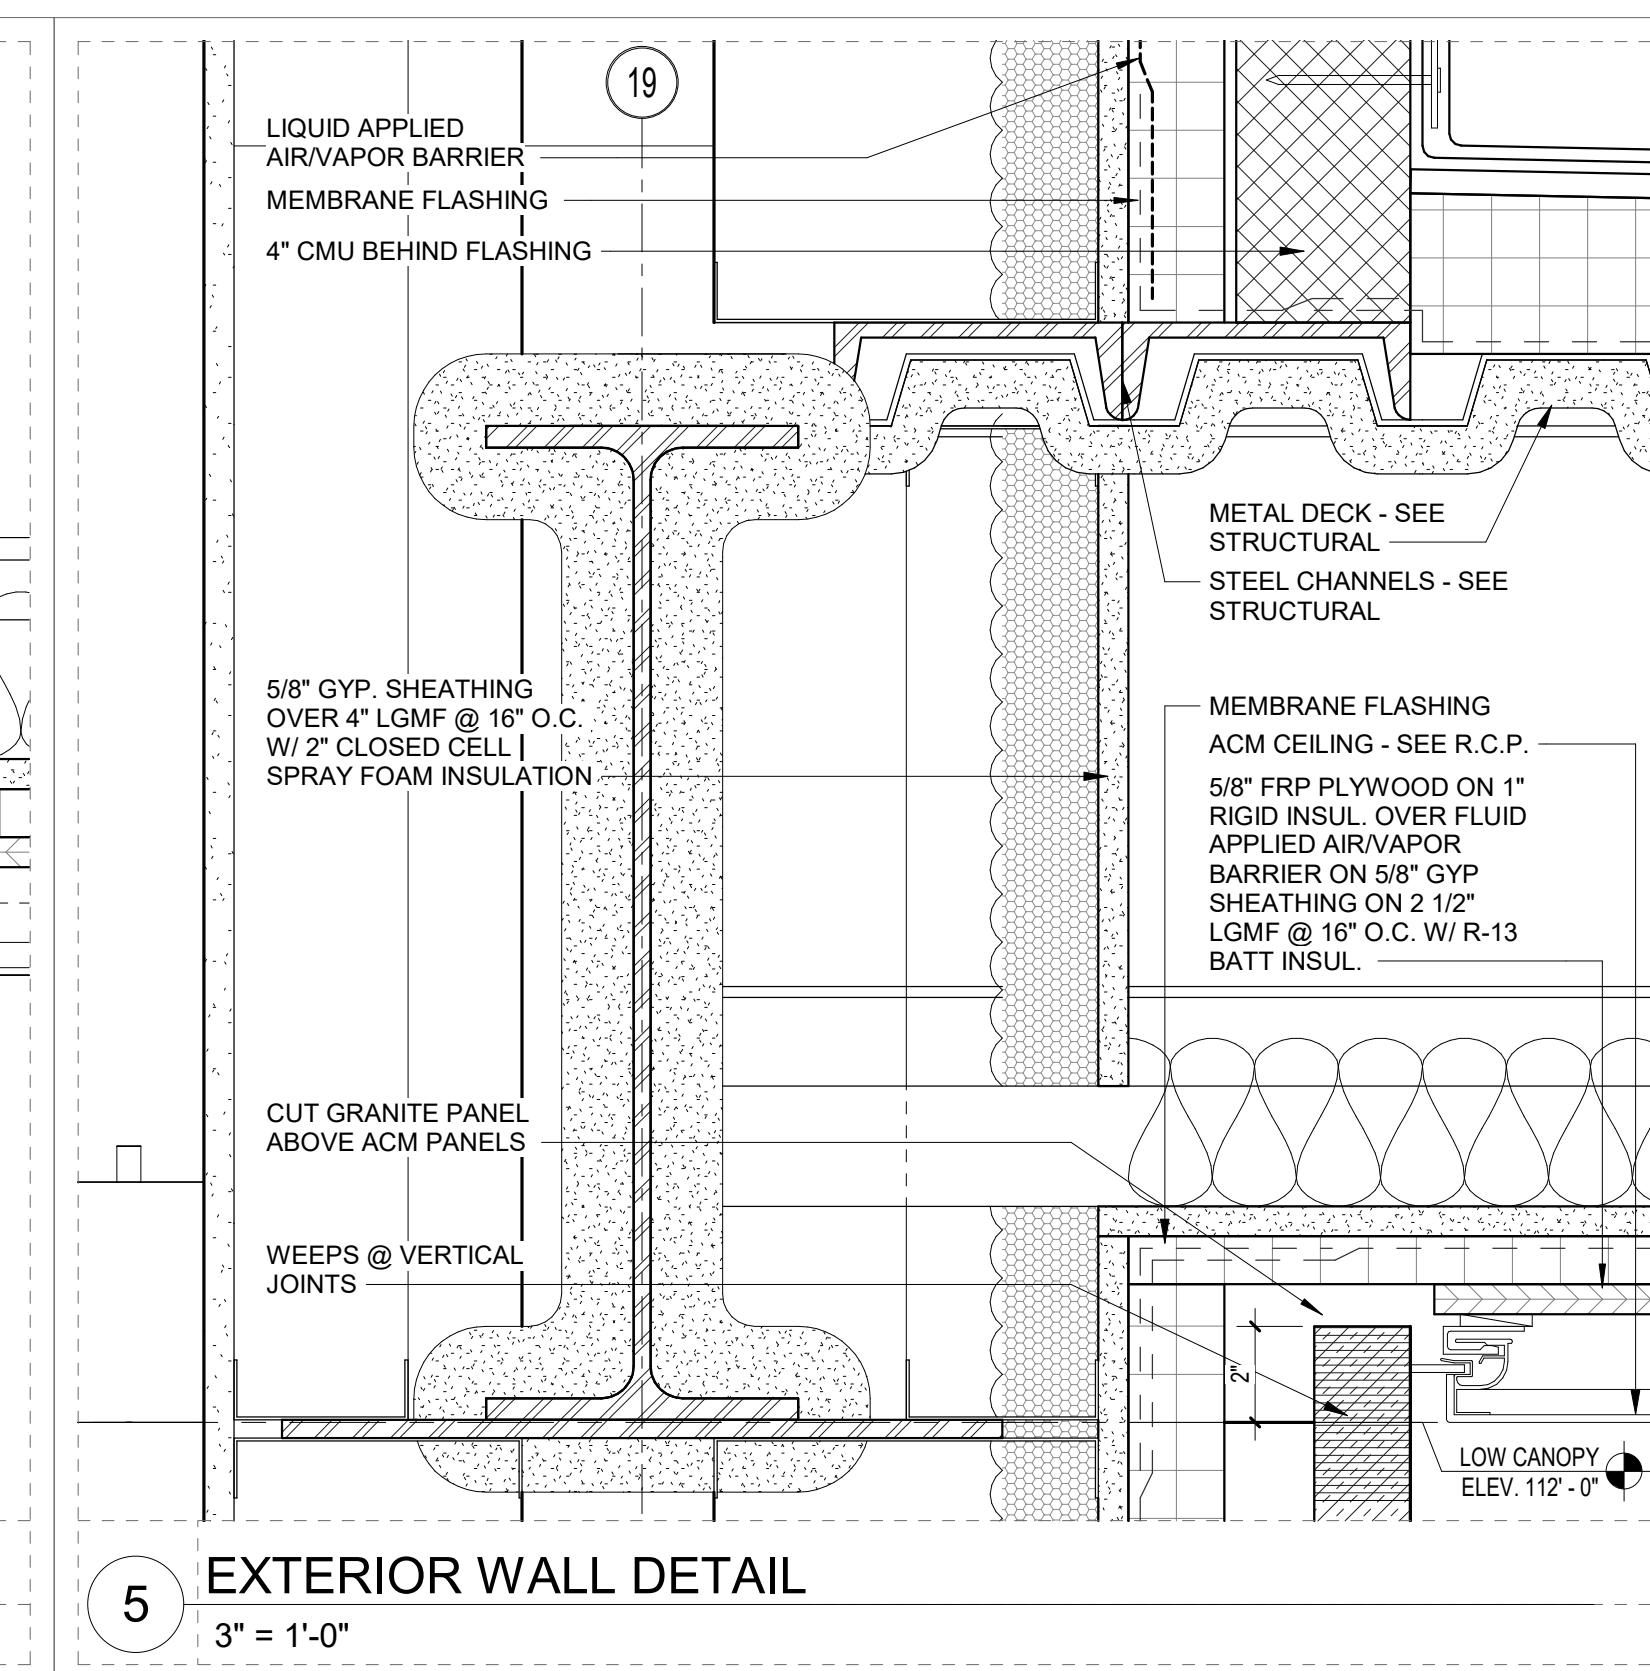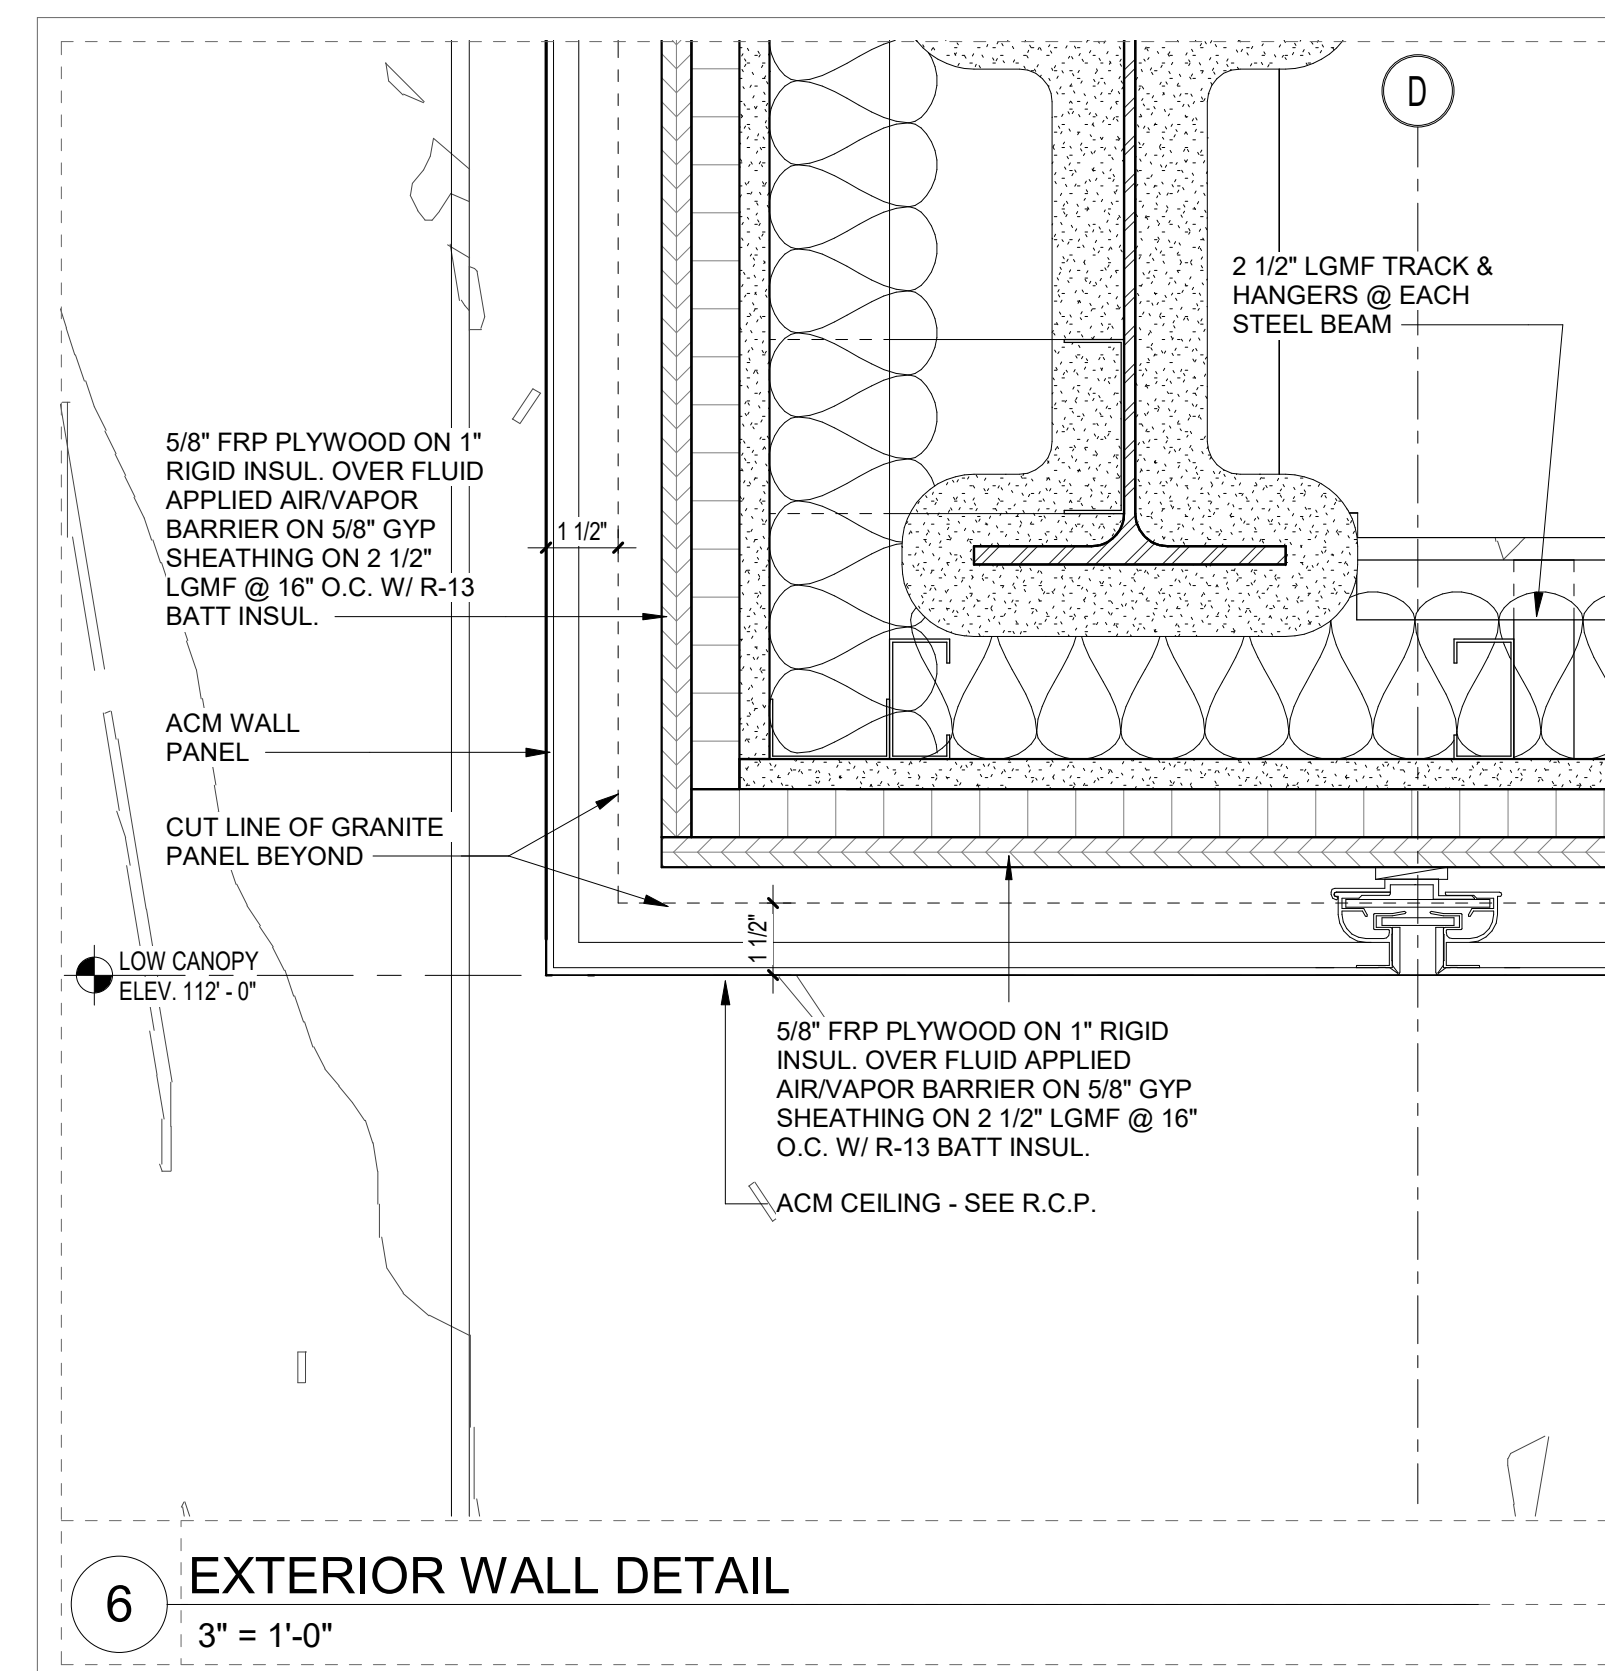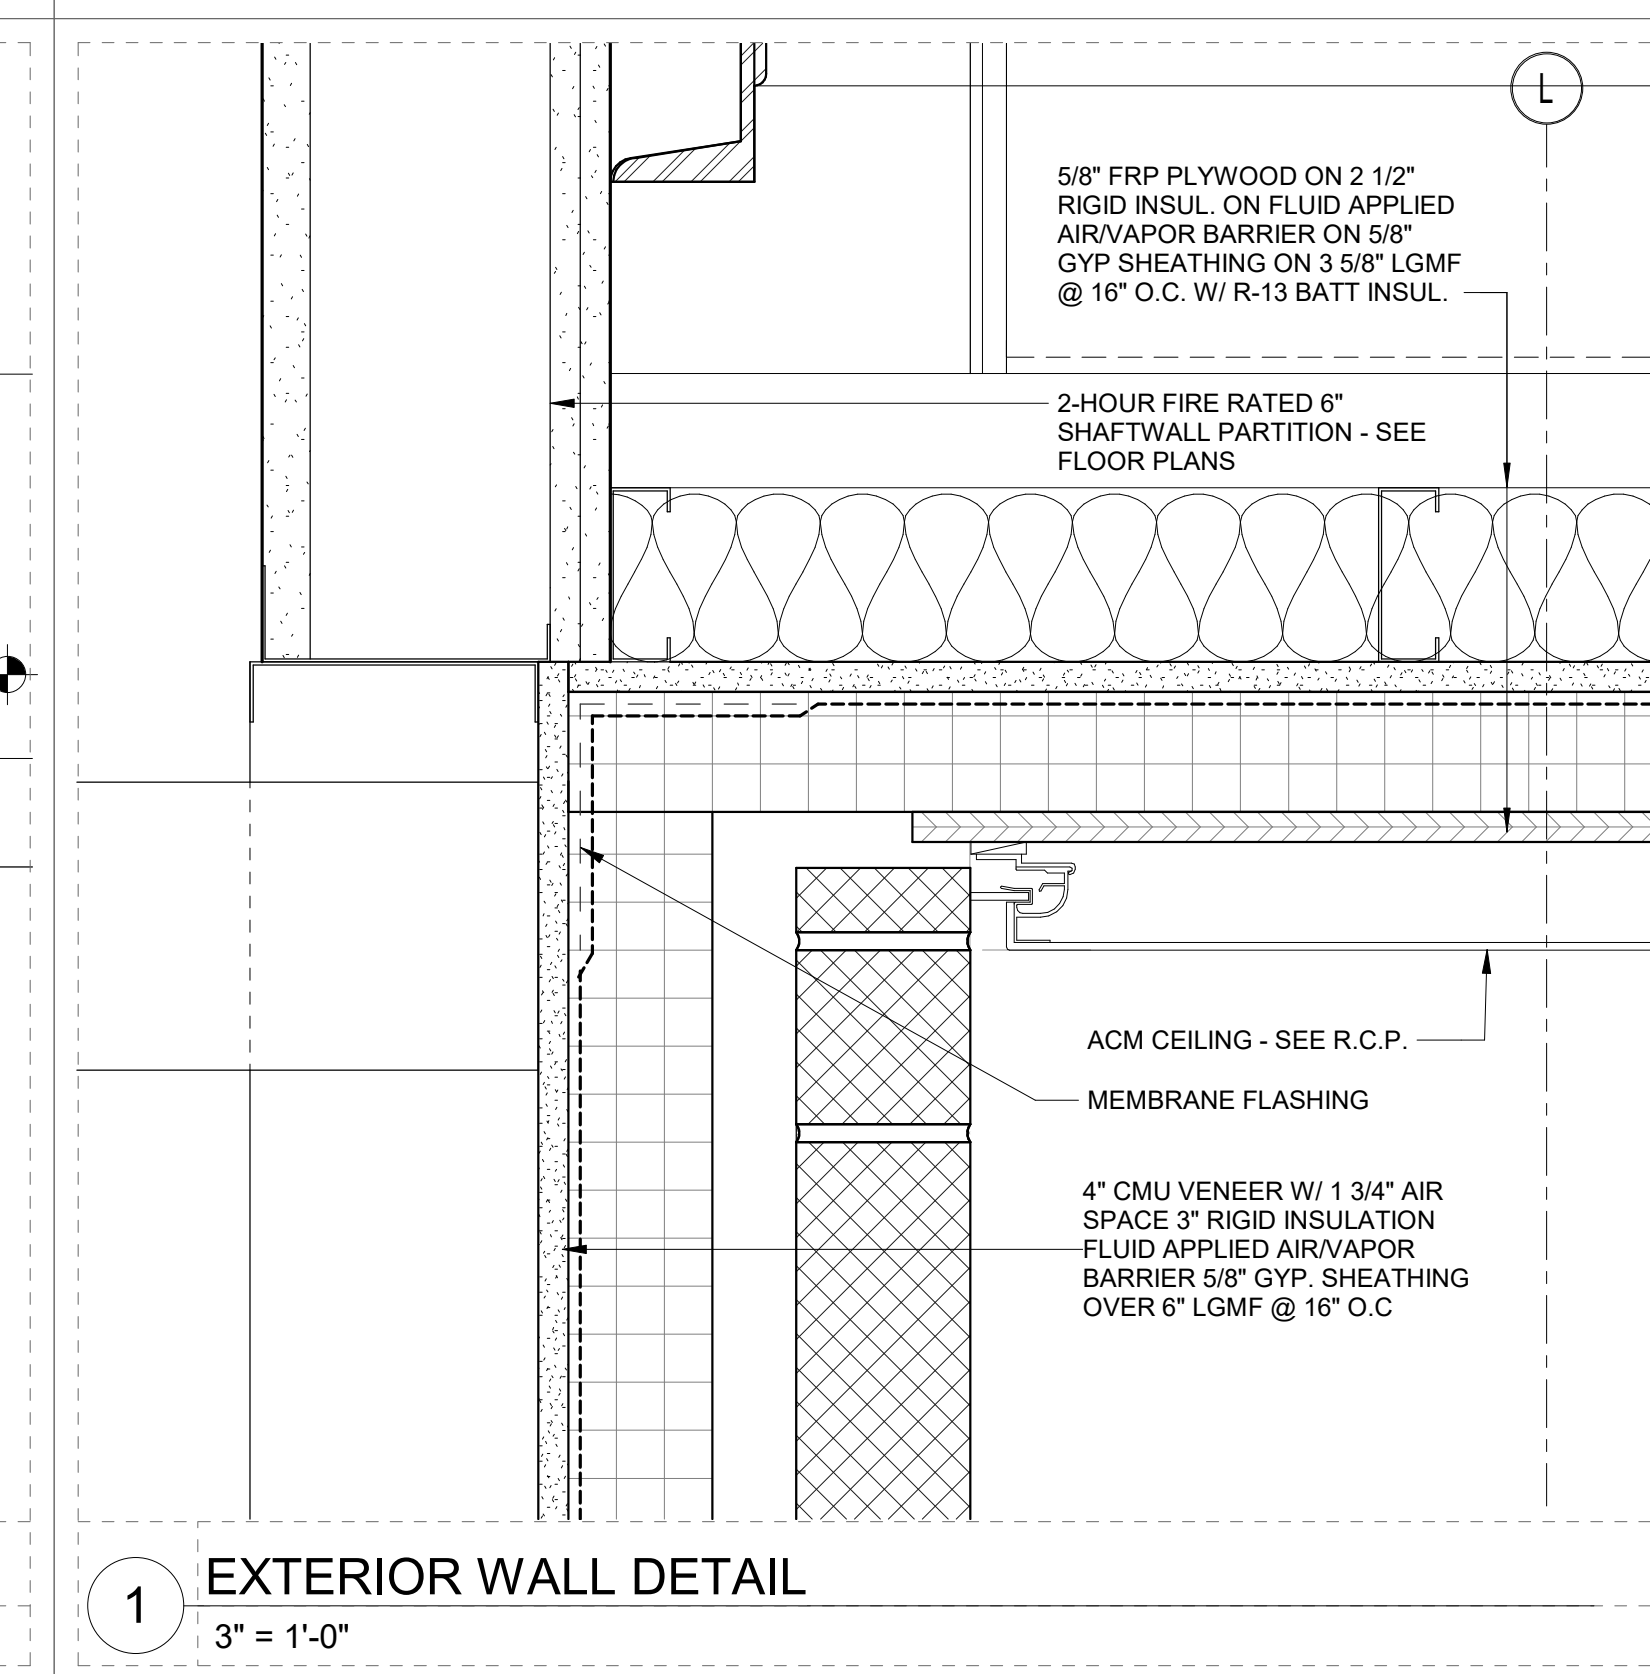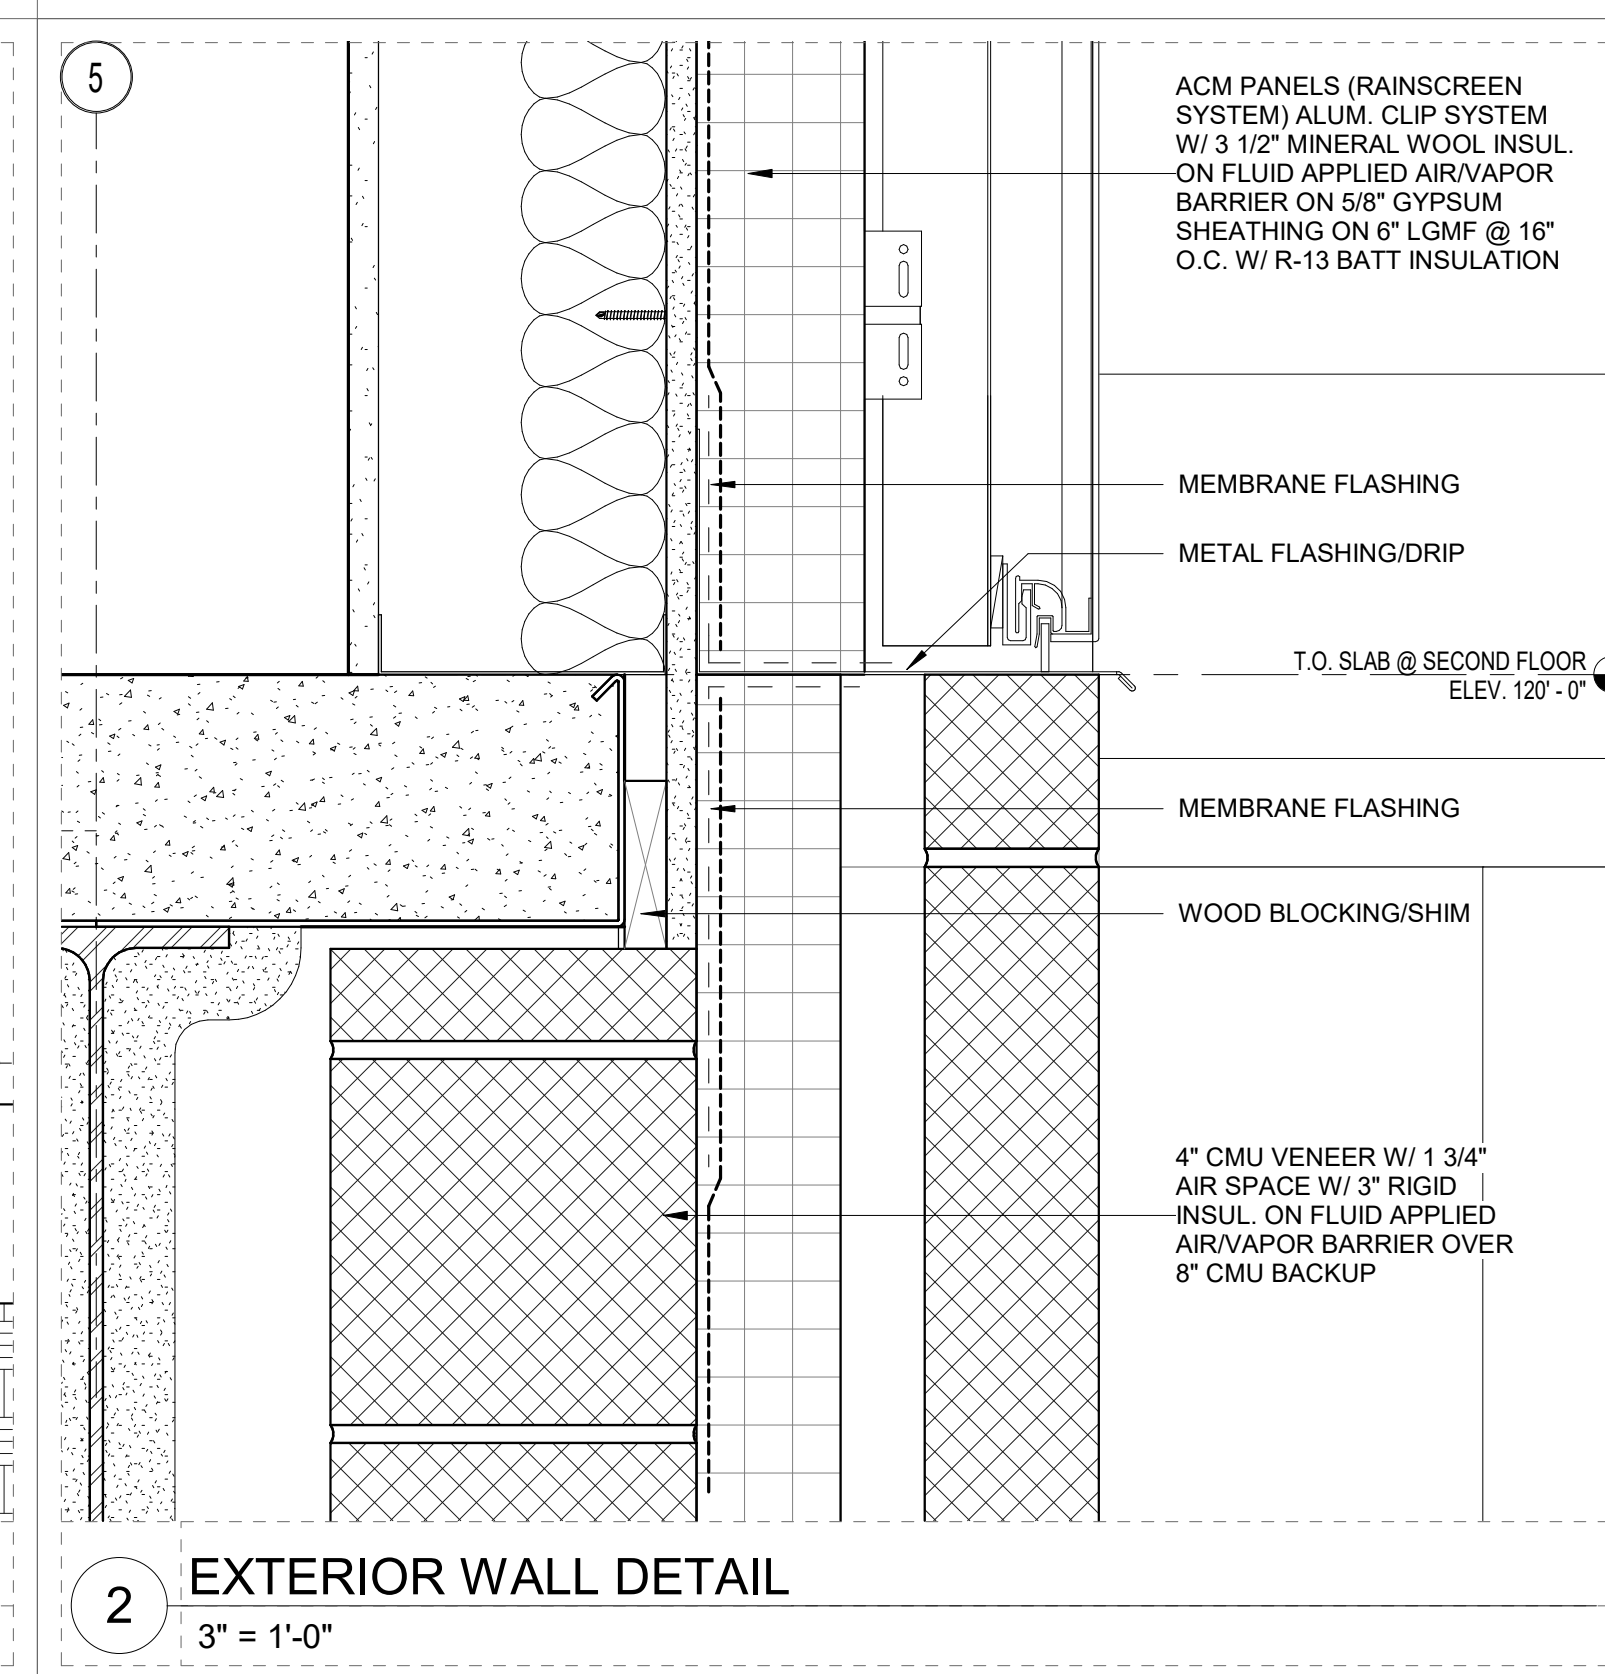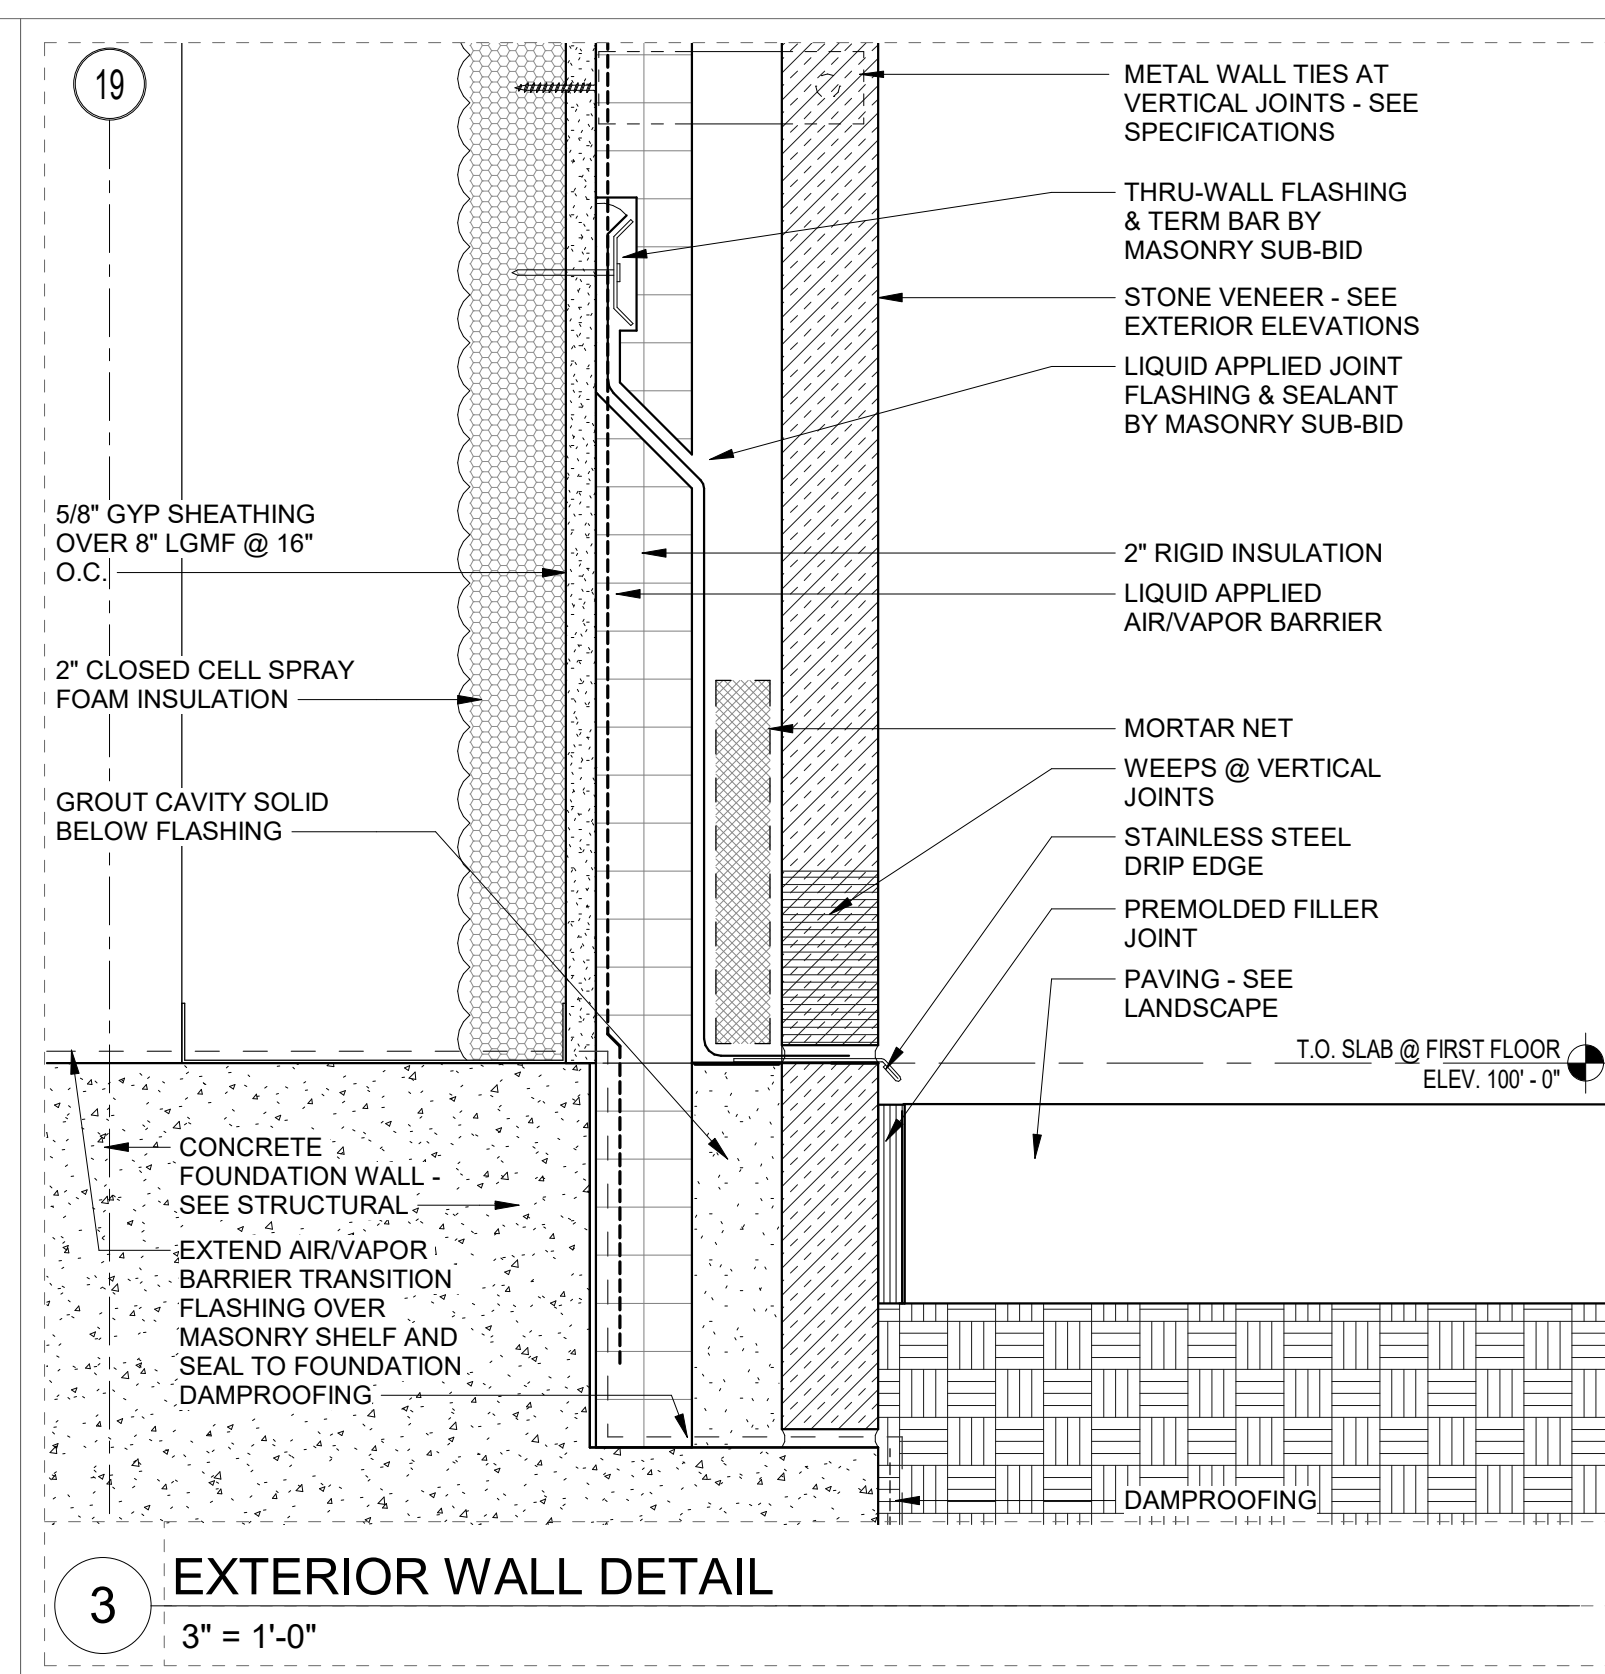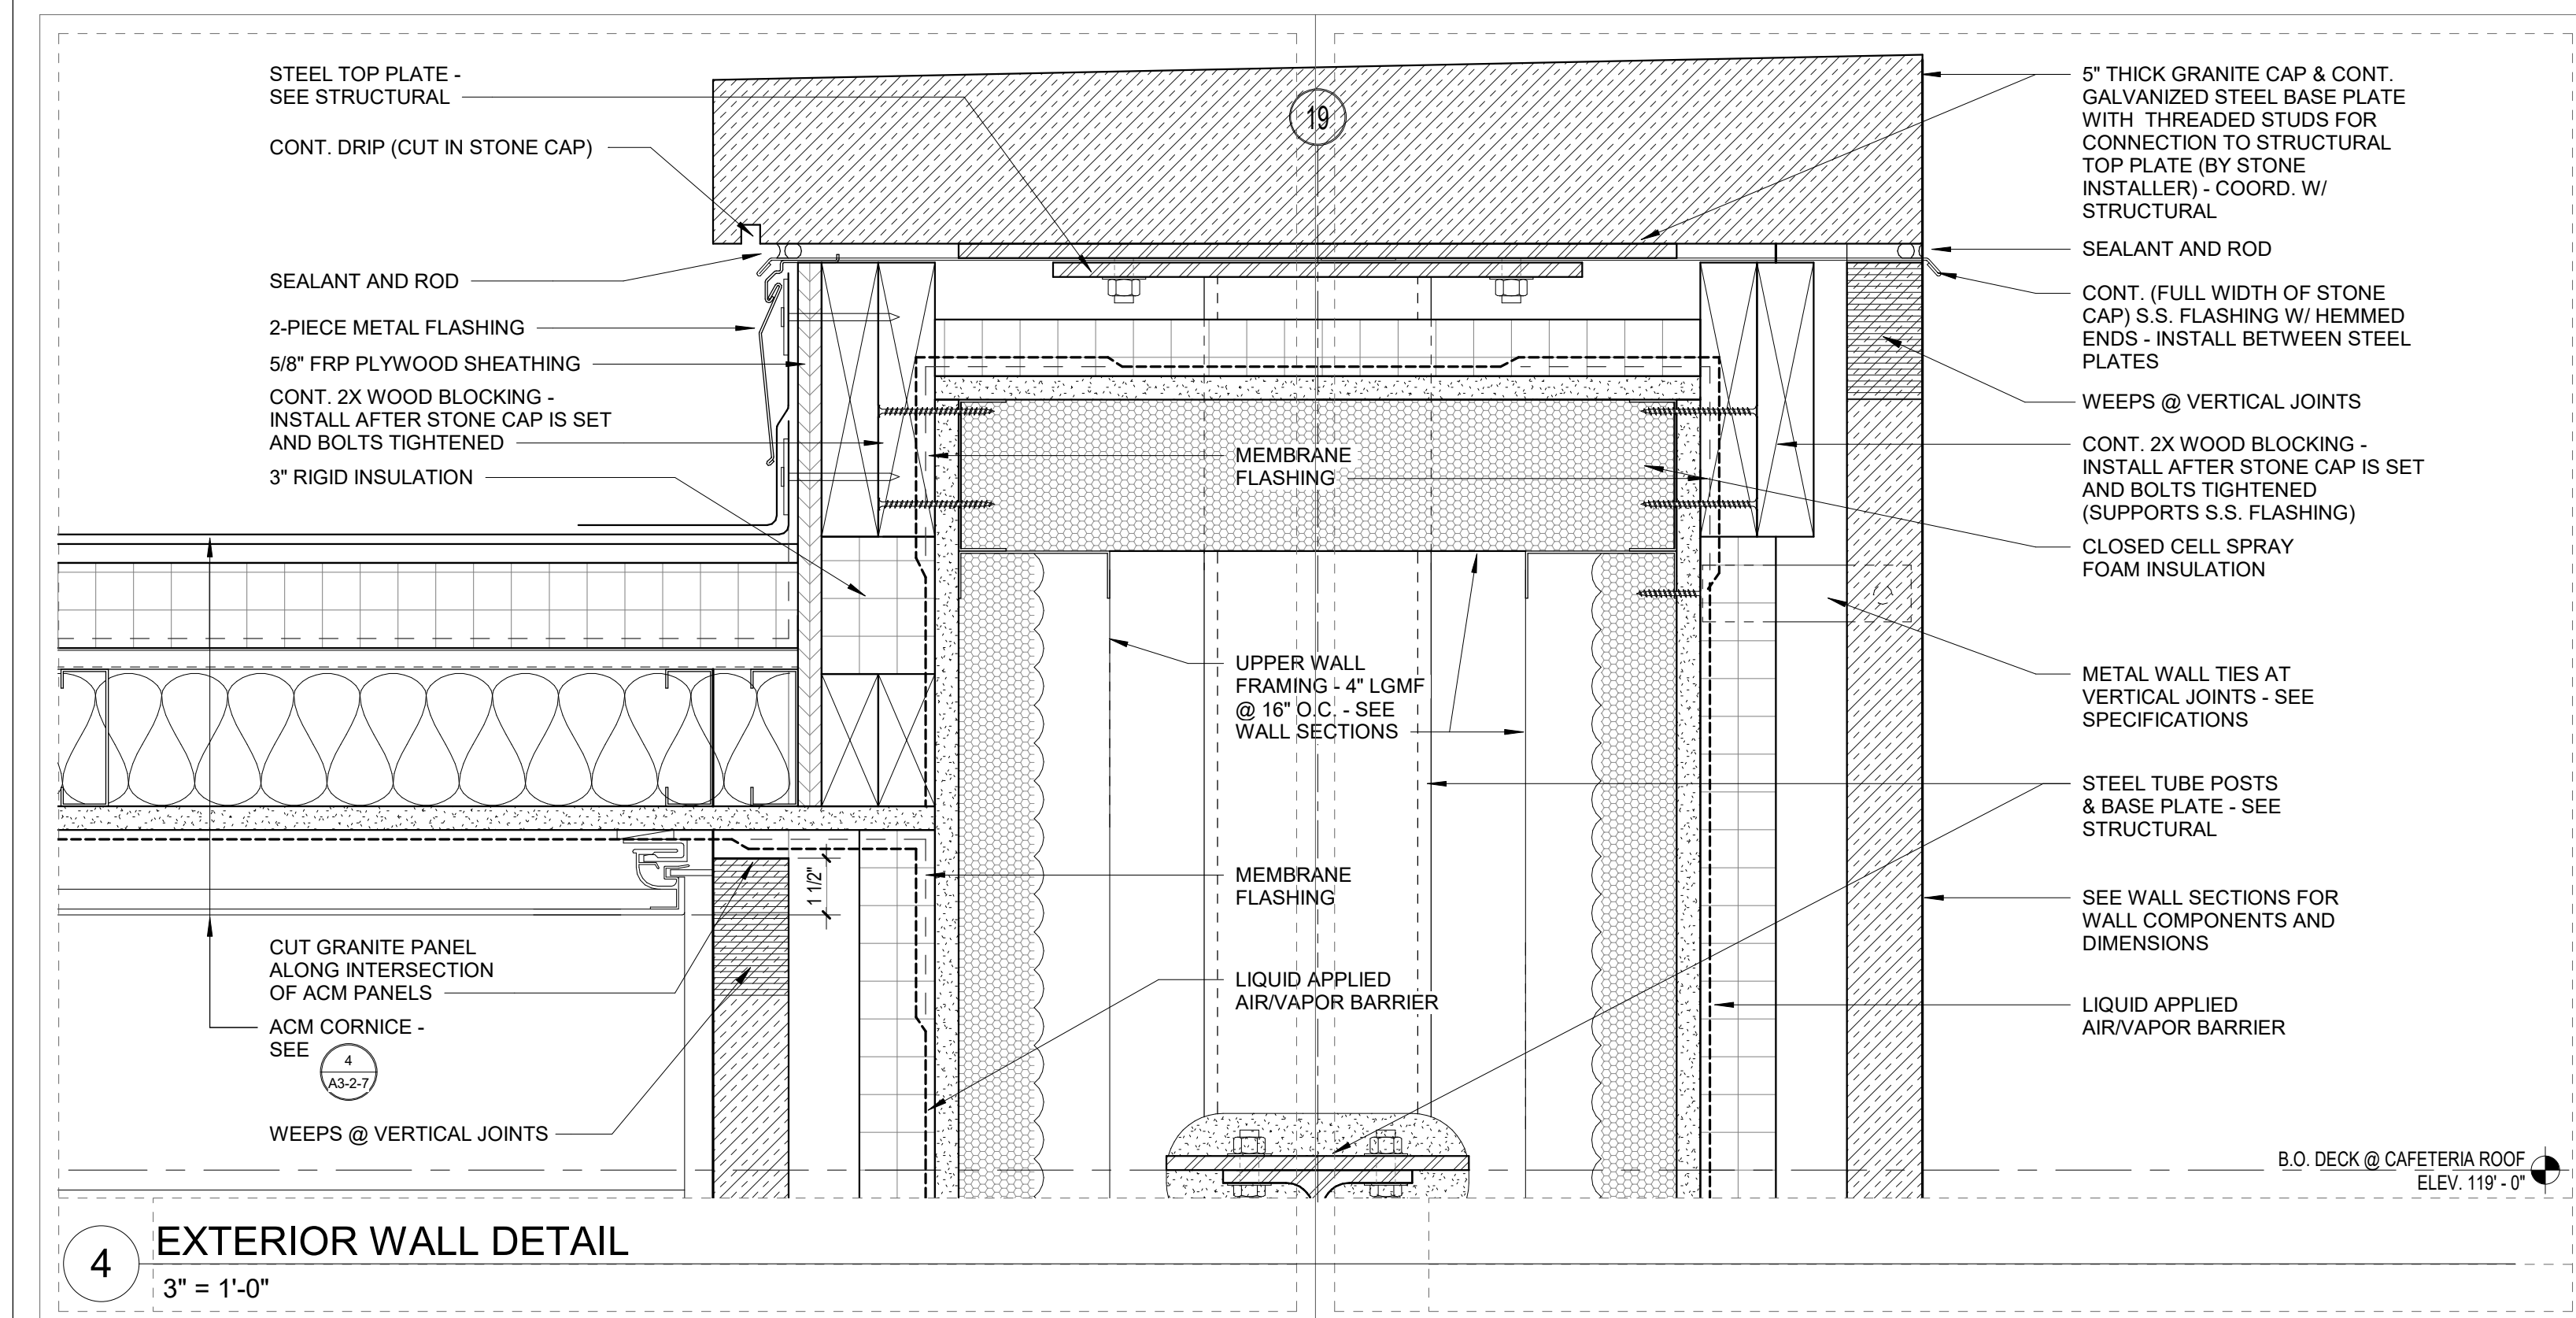**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880MSBA 90% CD
SUBMISSION

May 12TH, 2023

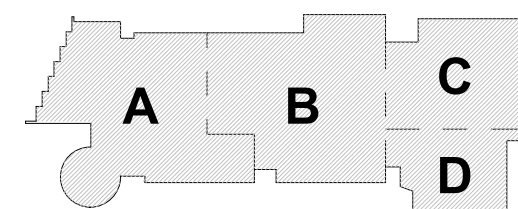

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

**VERTICAL
DETAILS**

Scale: 3" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A3-3-3

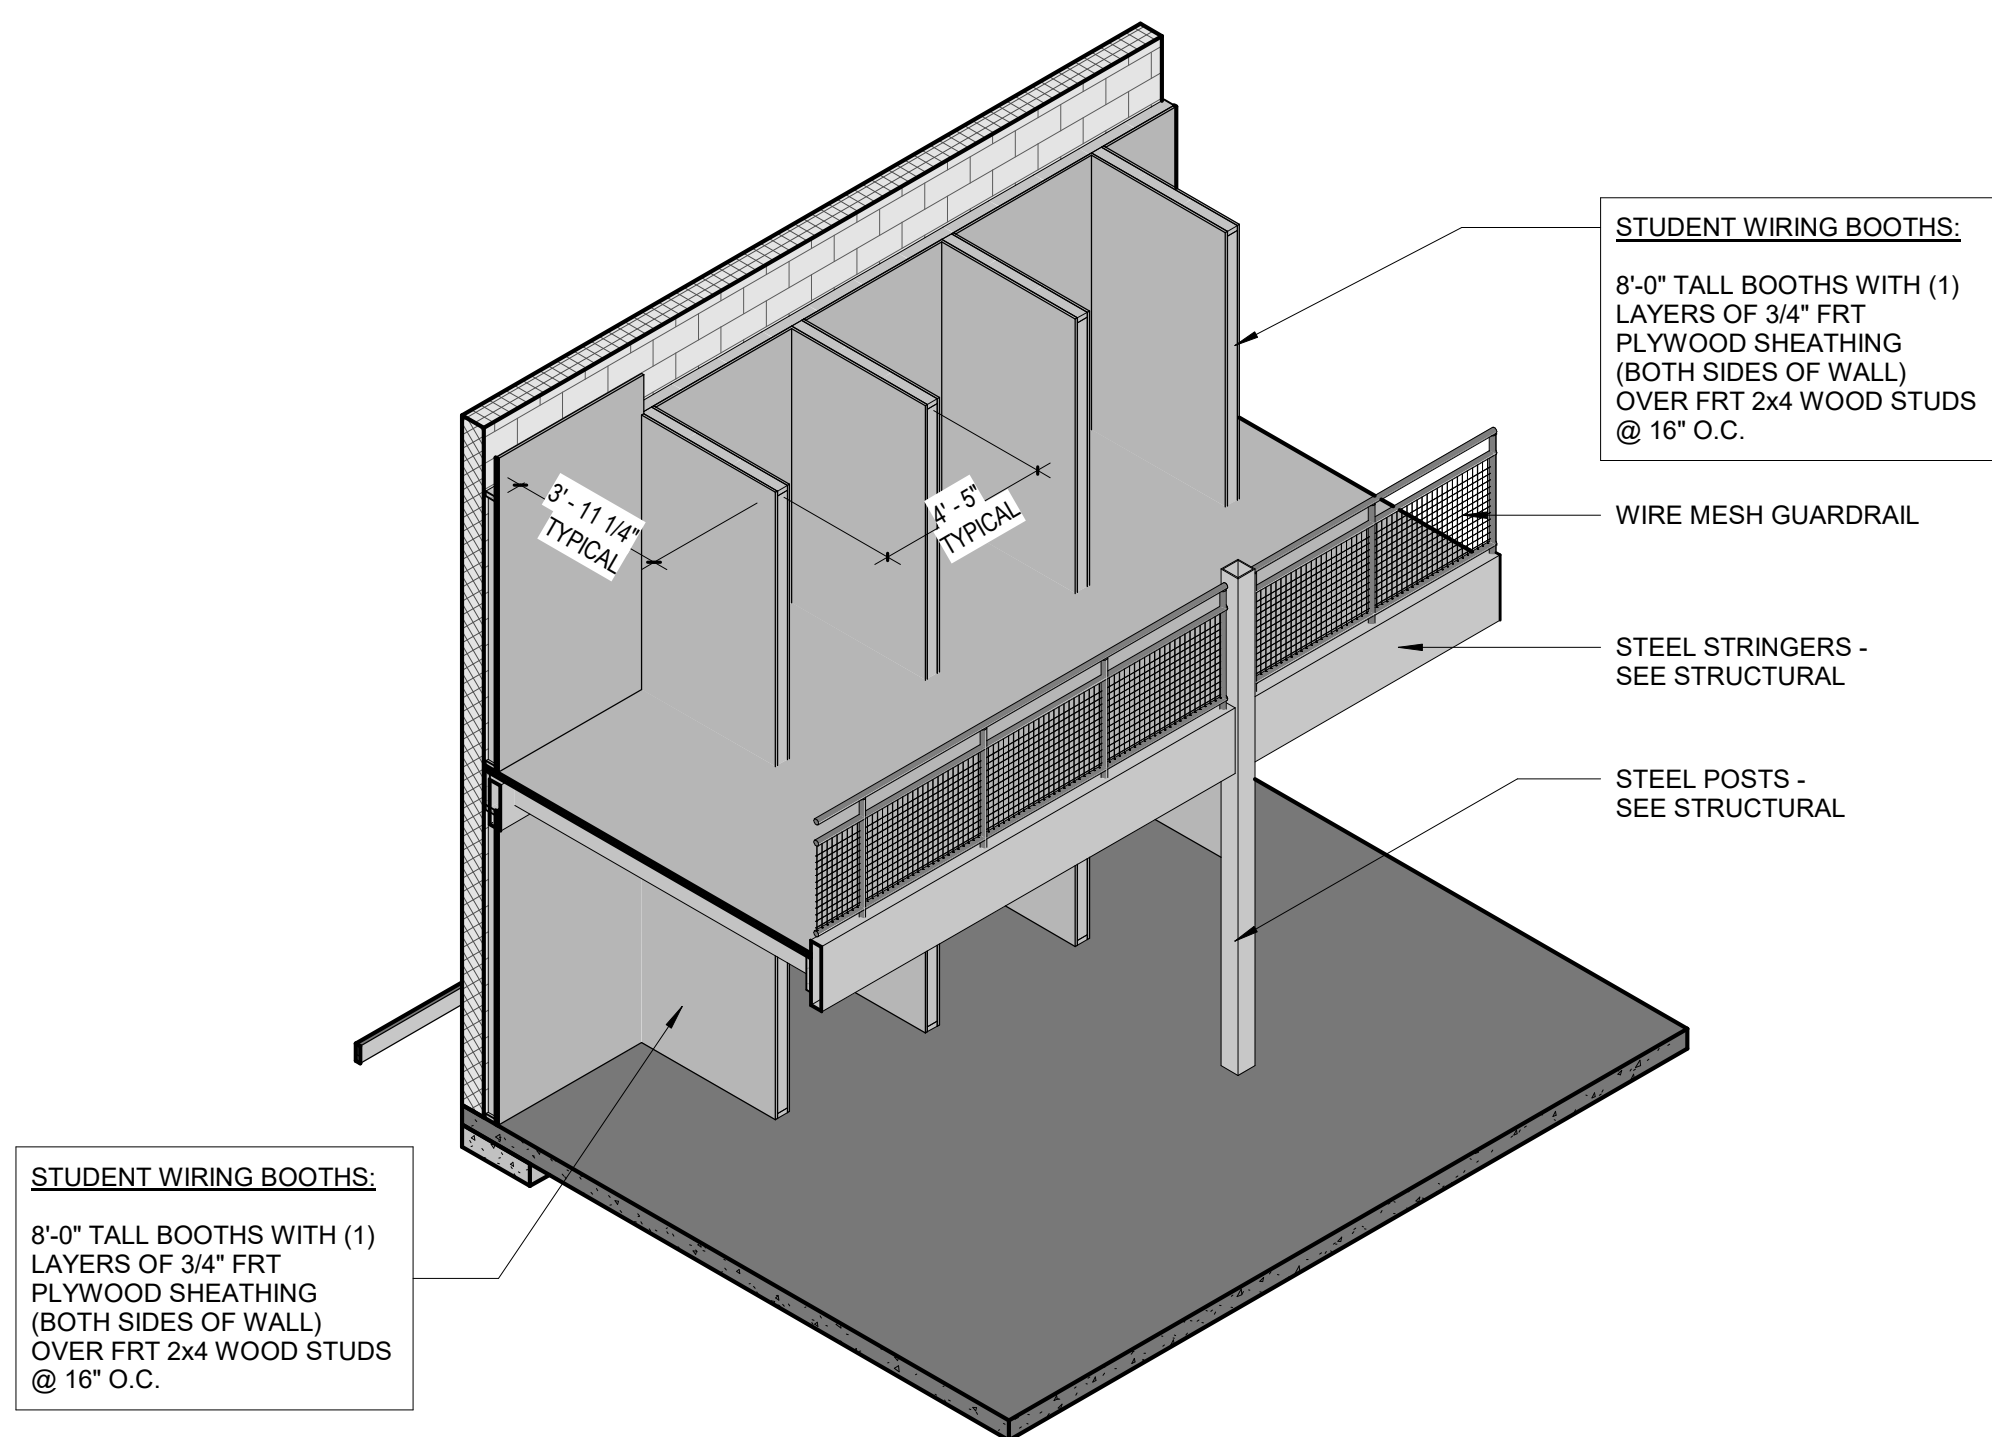


6 ELECTRICAL TECHNOLOGY STUDENT WIRING BOOTHS

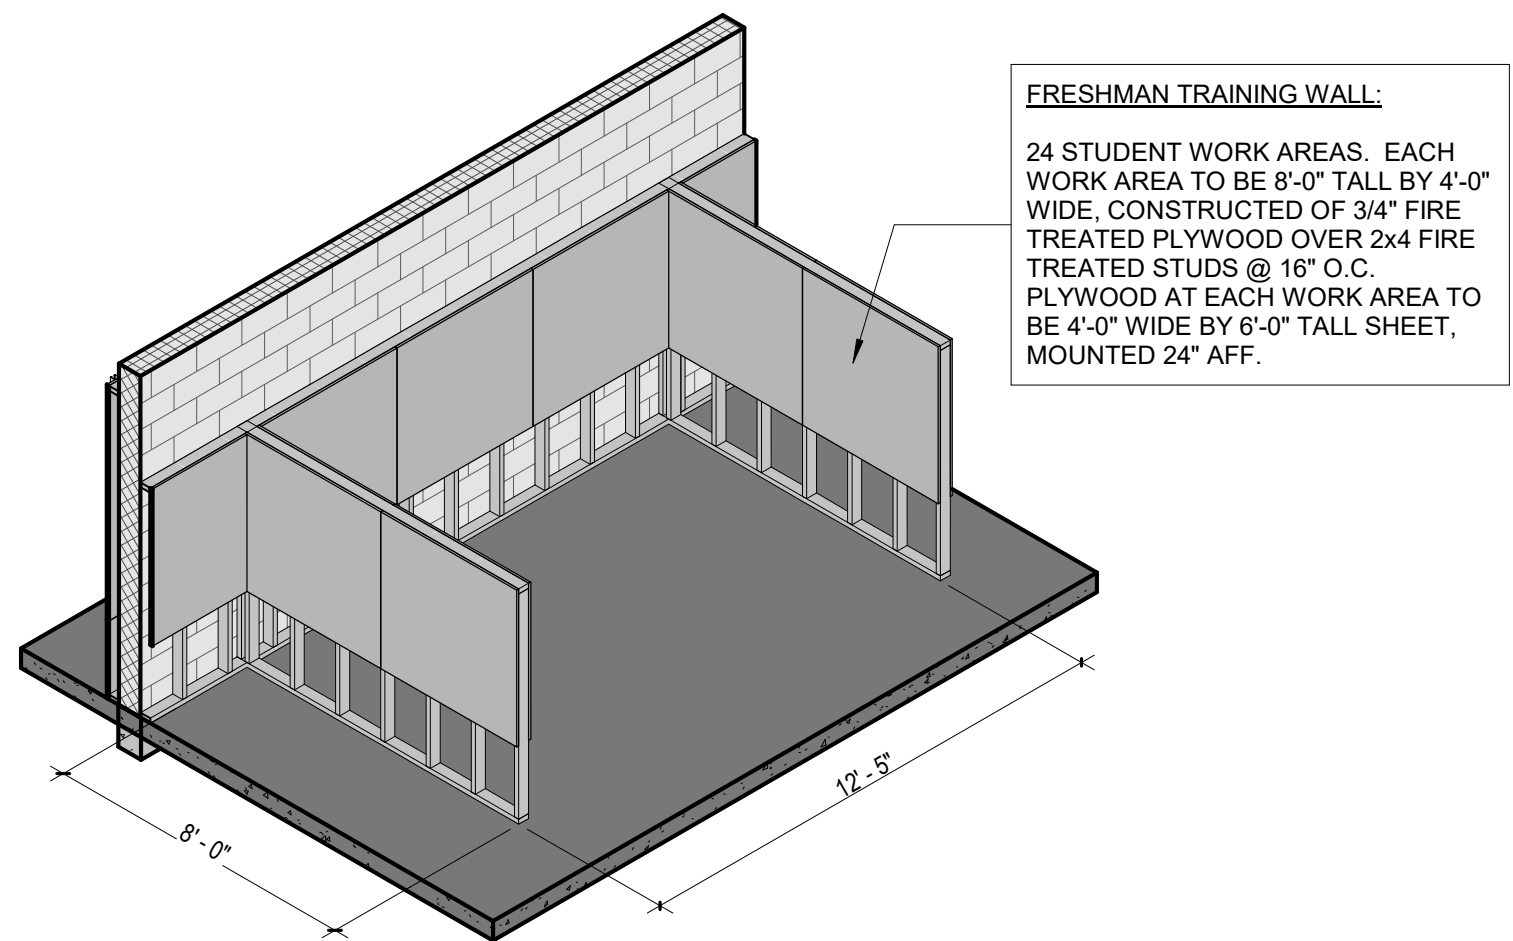


7 ELECTRICAL TECHNOLOGY STUDENT FRESHMEN TRAINING WALL

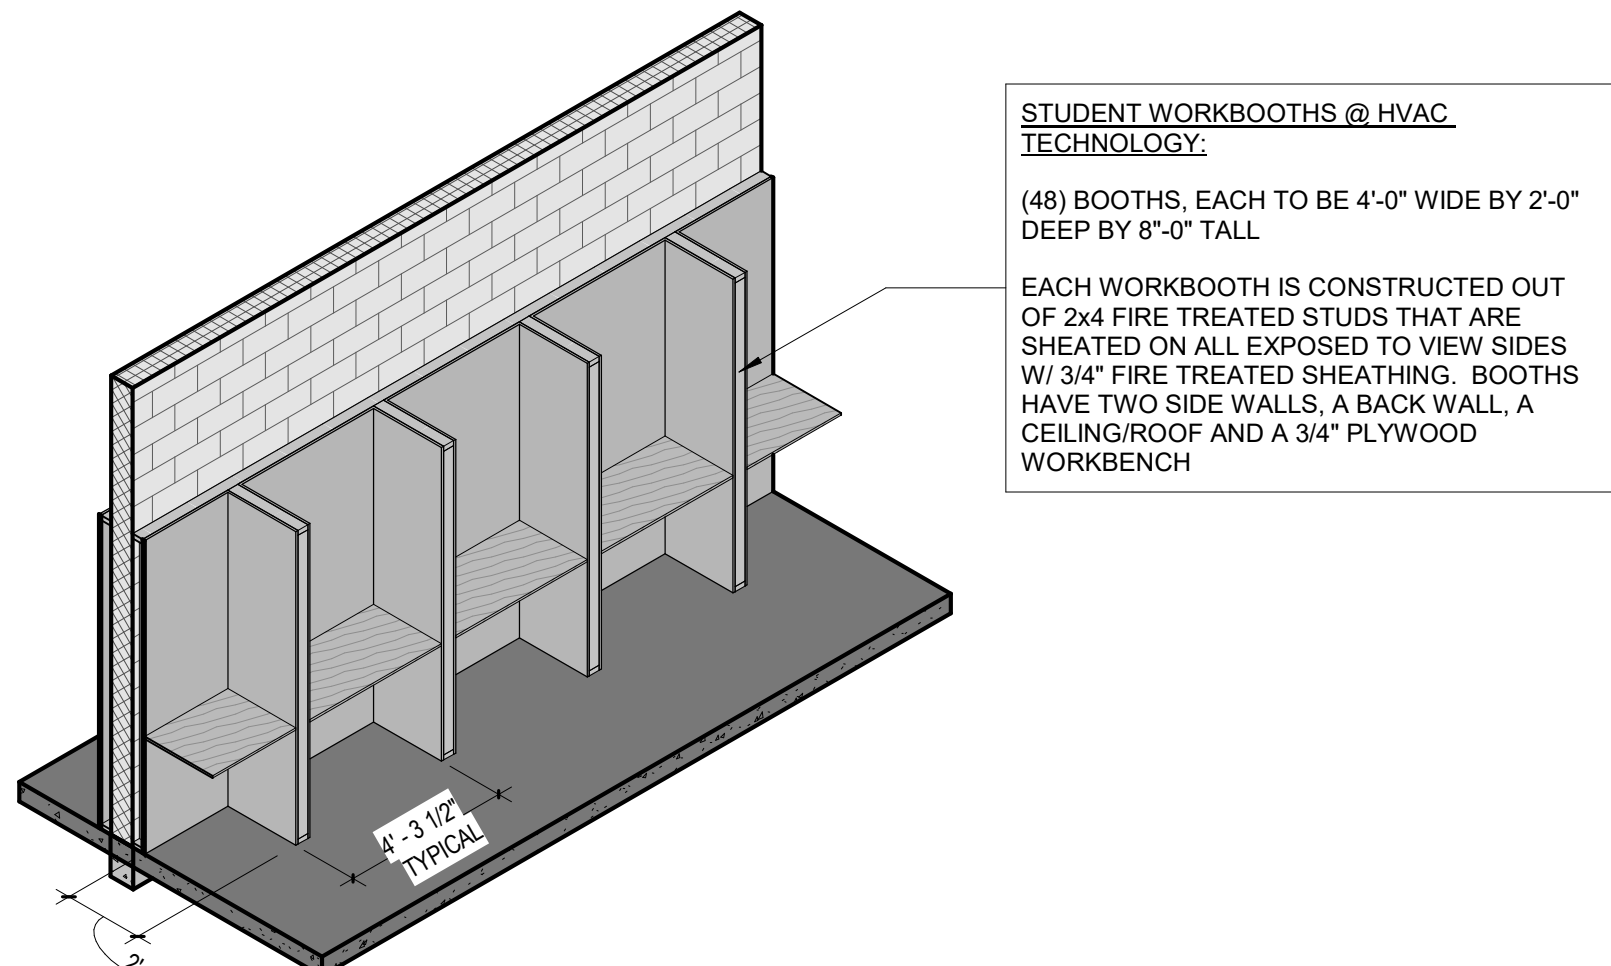


8 HVAC STUDENT WORKBOOTHS

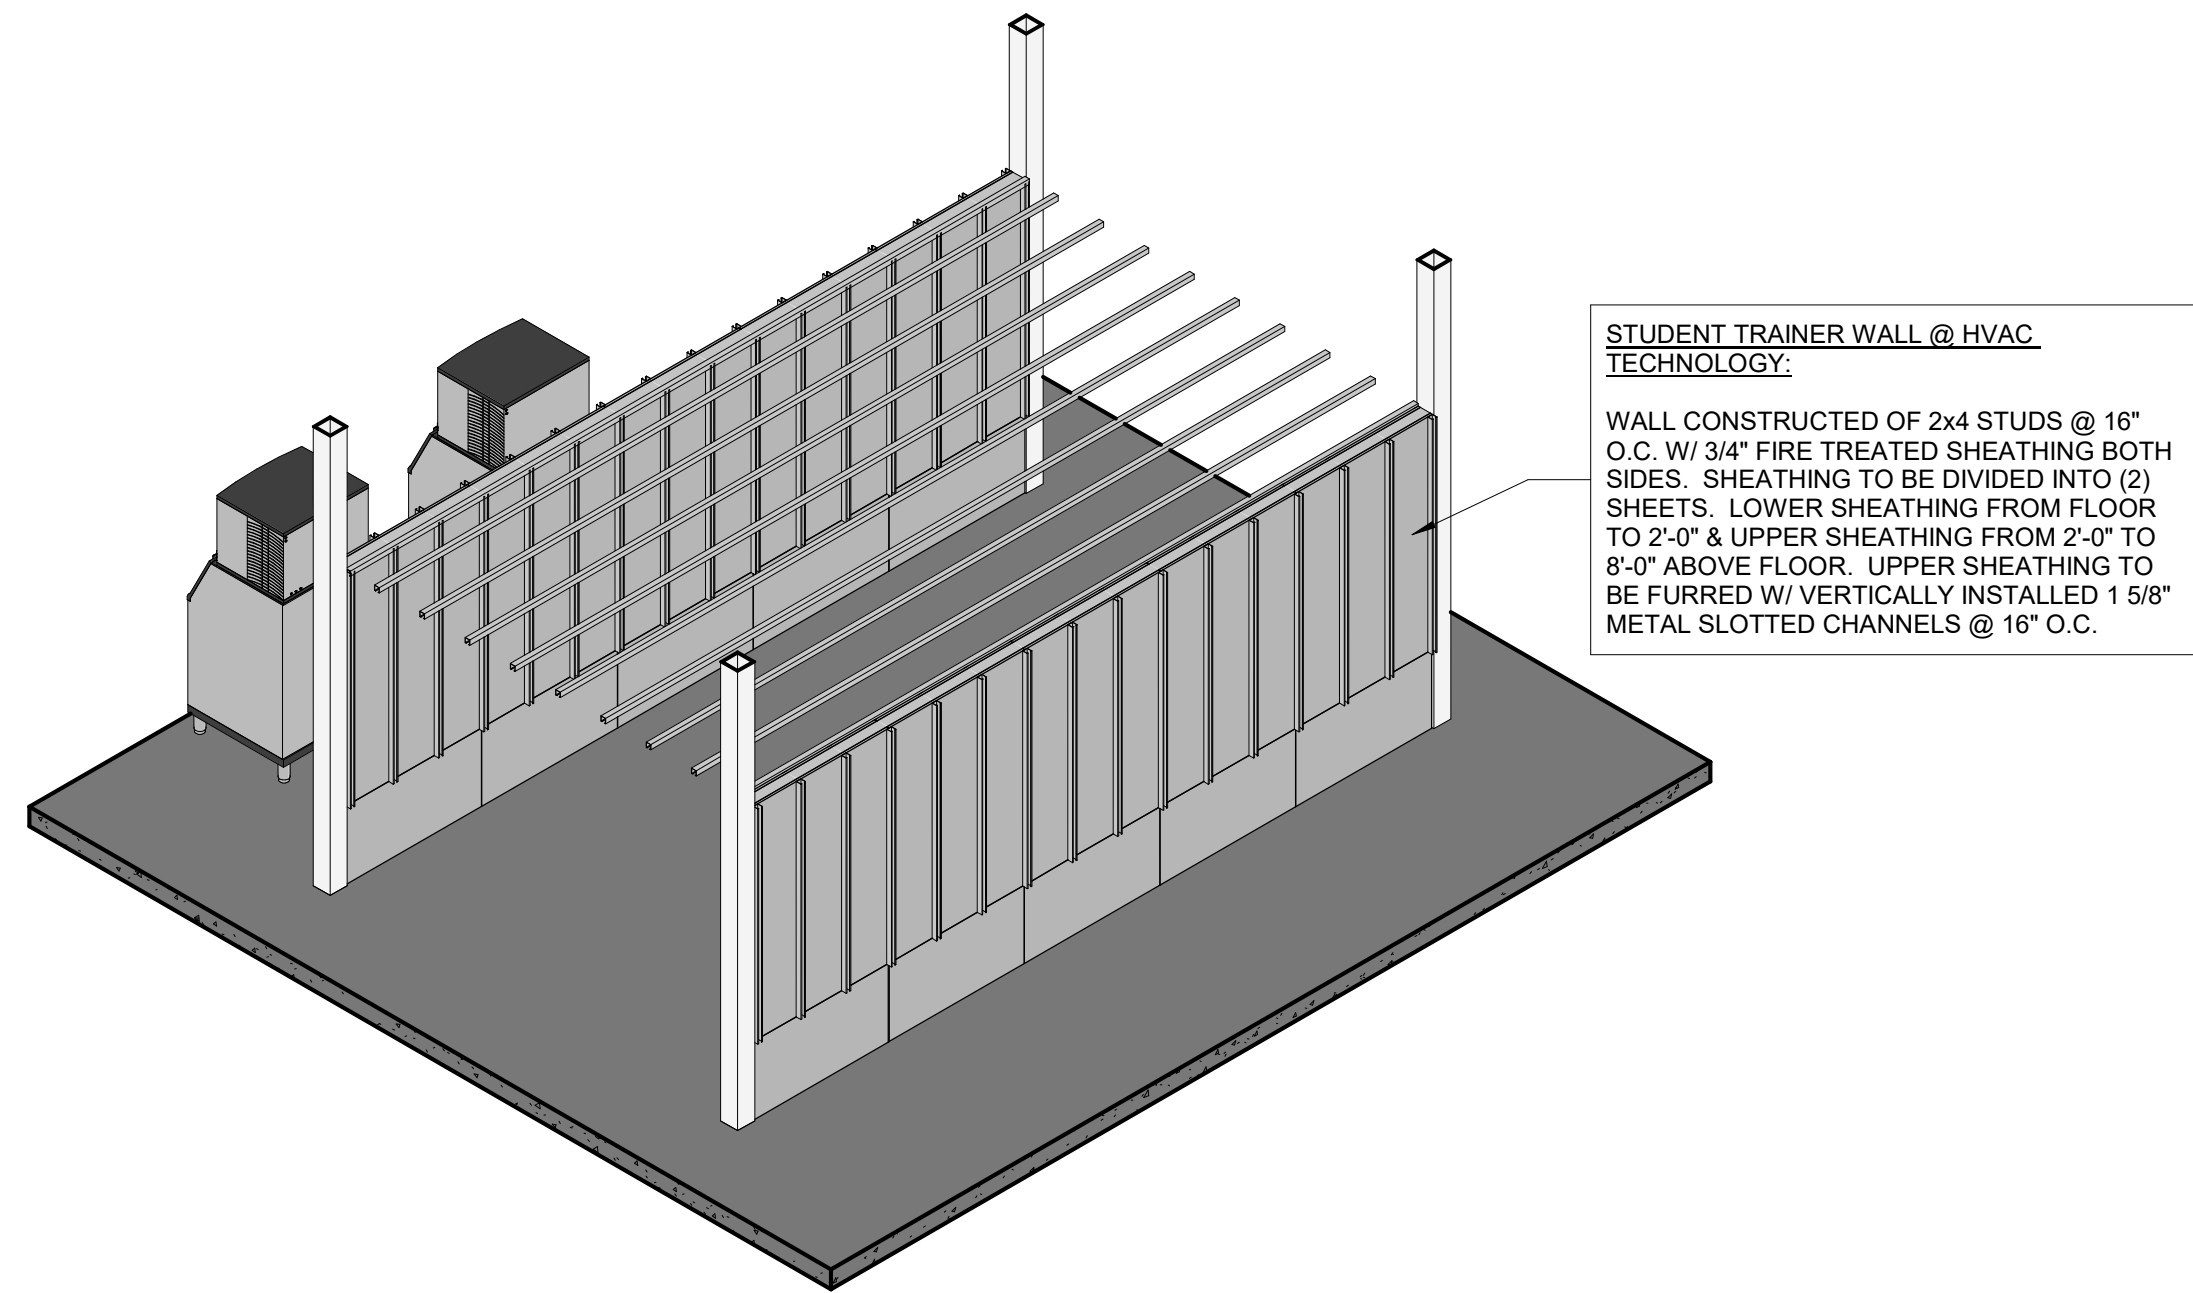


9 HVAC STUDENT TRAINER WALL

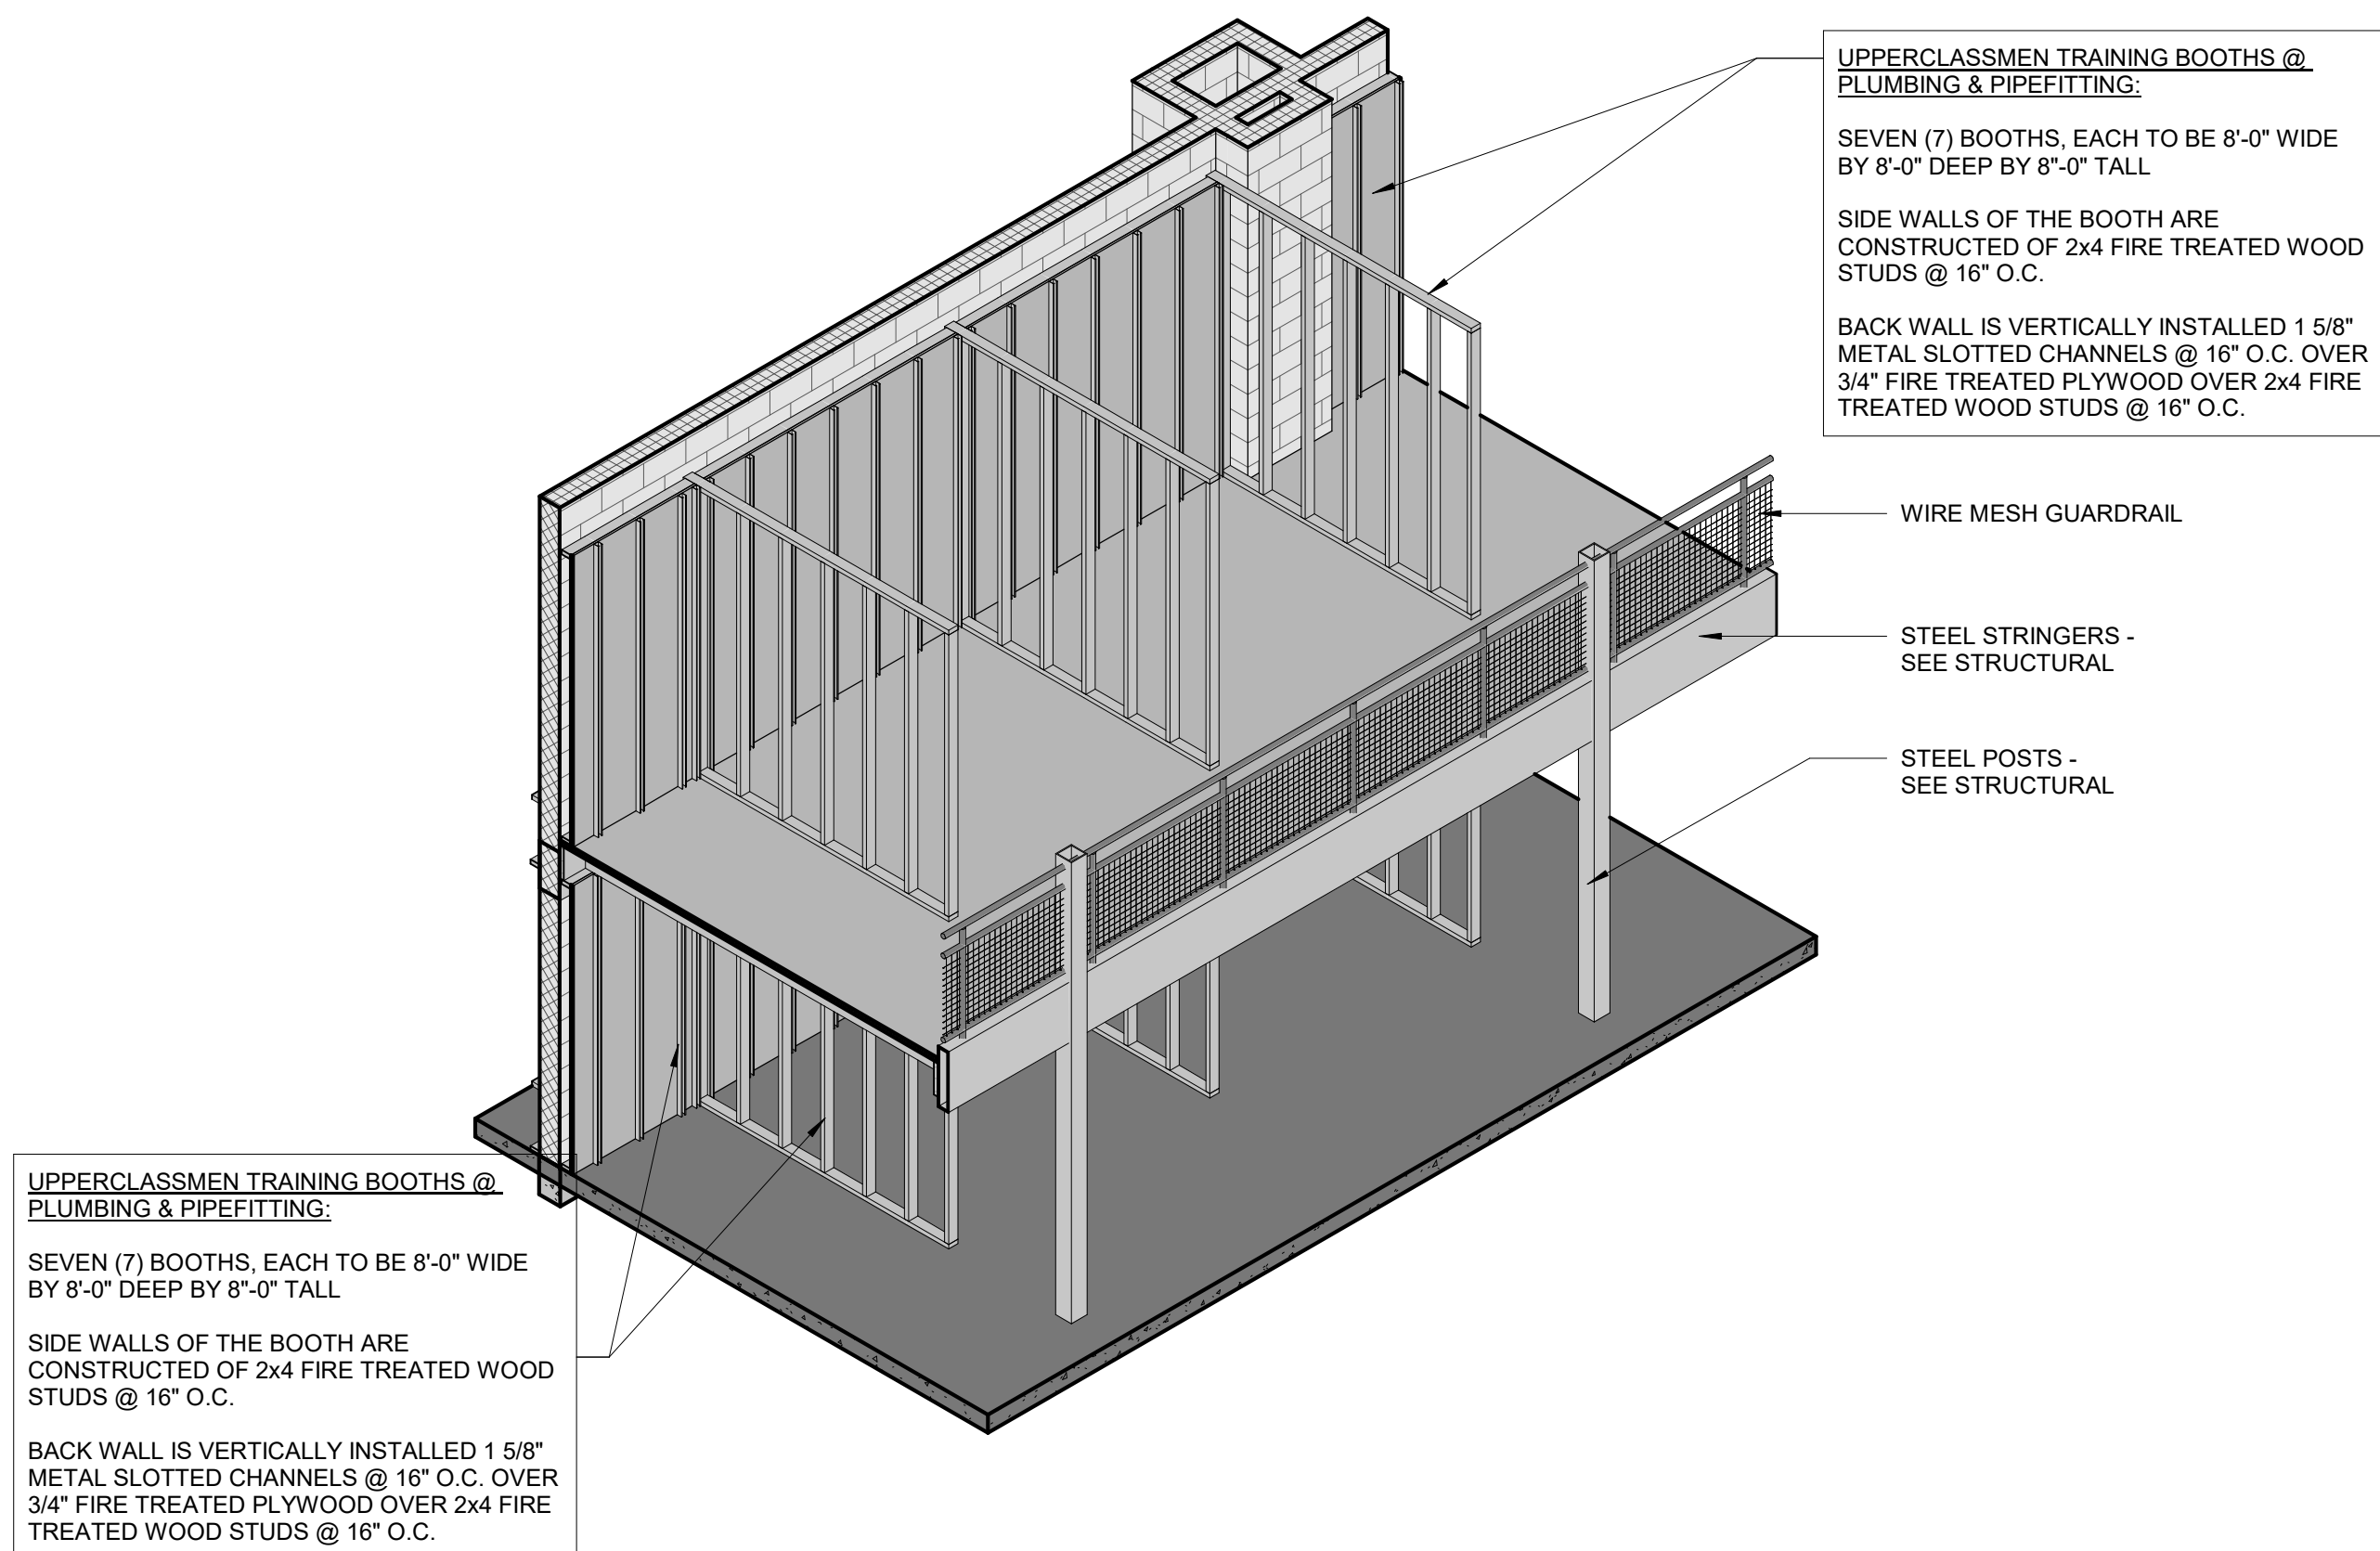


5 PLUMBING & PIPEFITTING UPPERCLASSMEN TRAINING BOOTHS

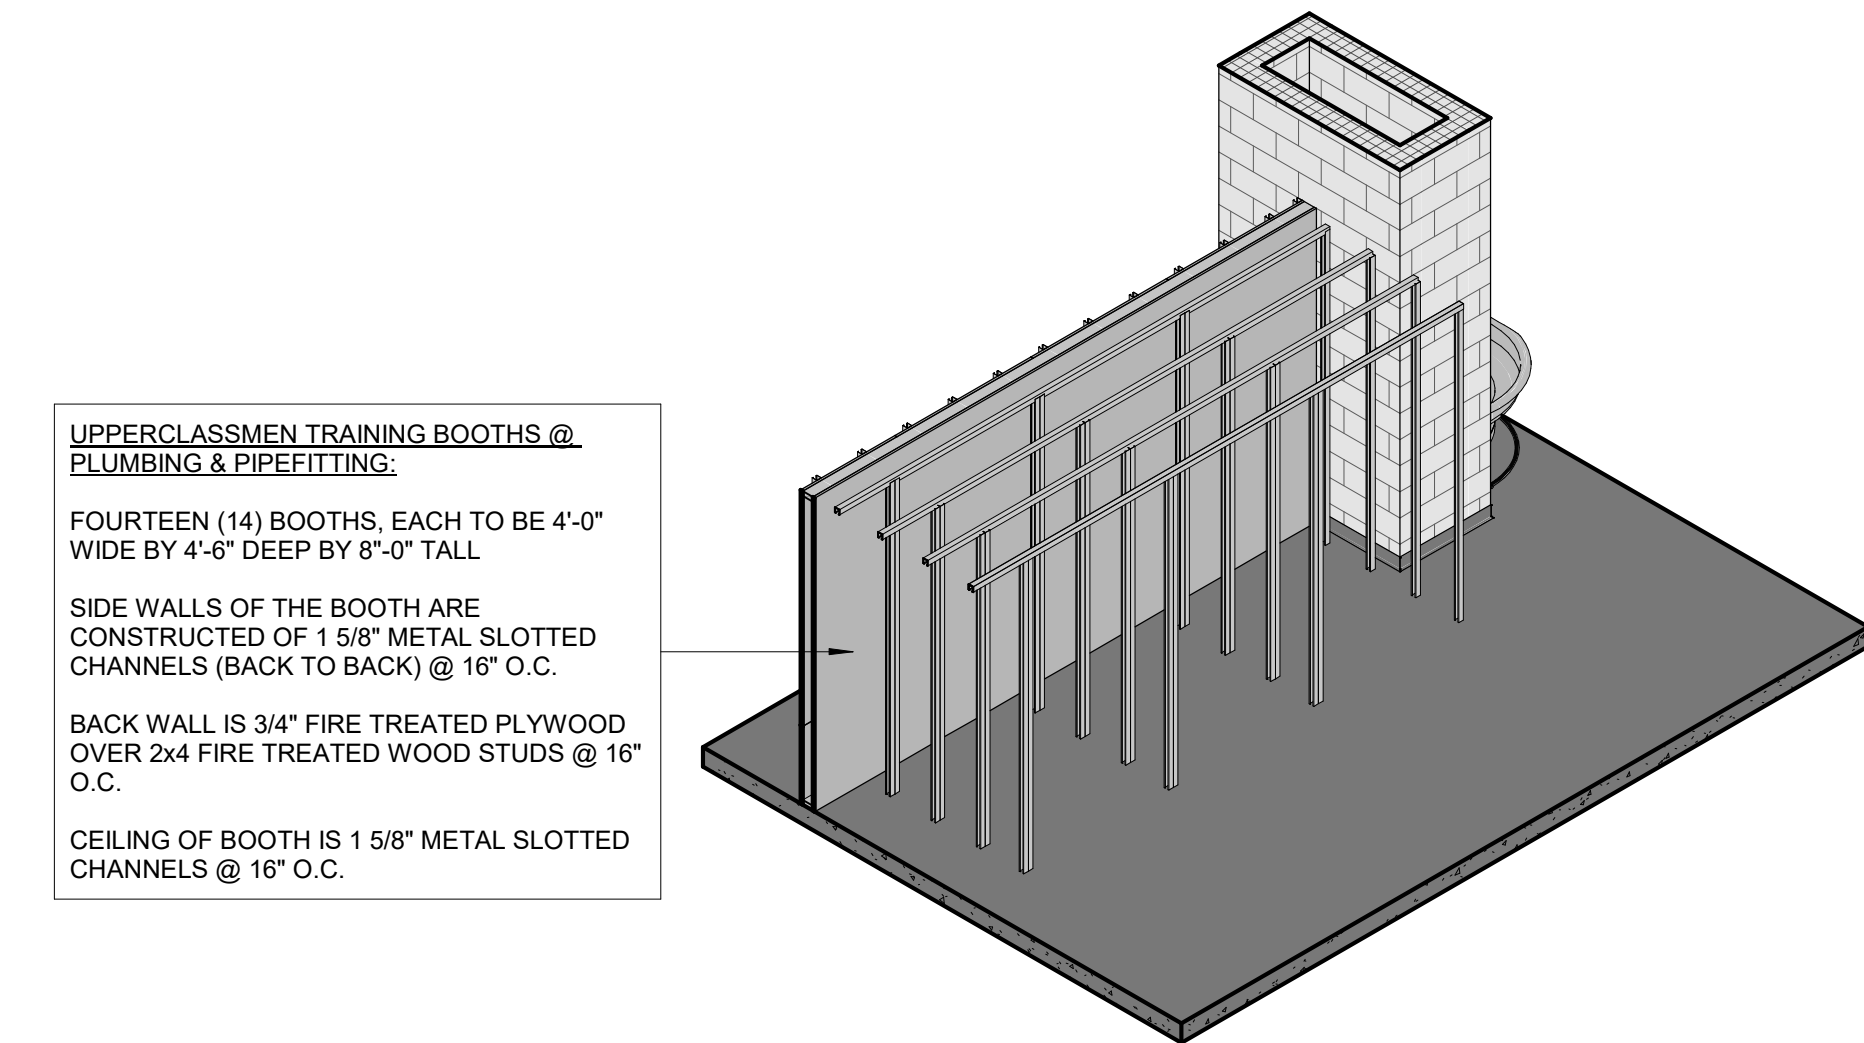


4 PLUMBING & PIPEFITTING UPPERCLASSMEN TRAINING BOOTHS - UNISTRUT

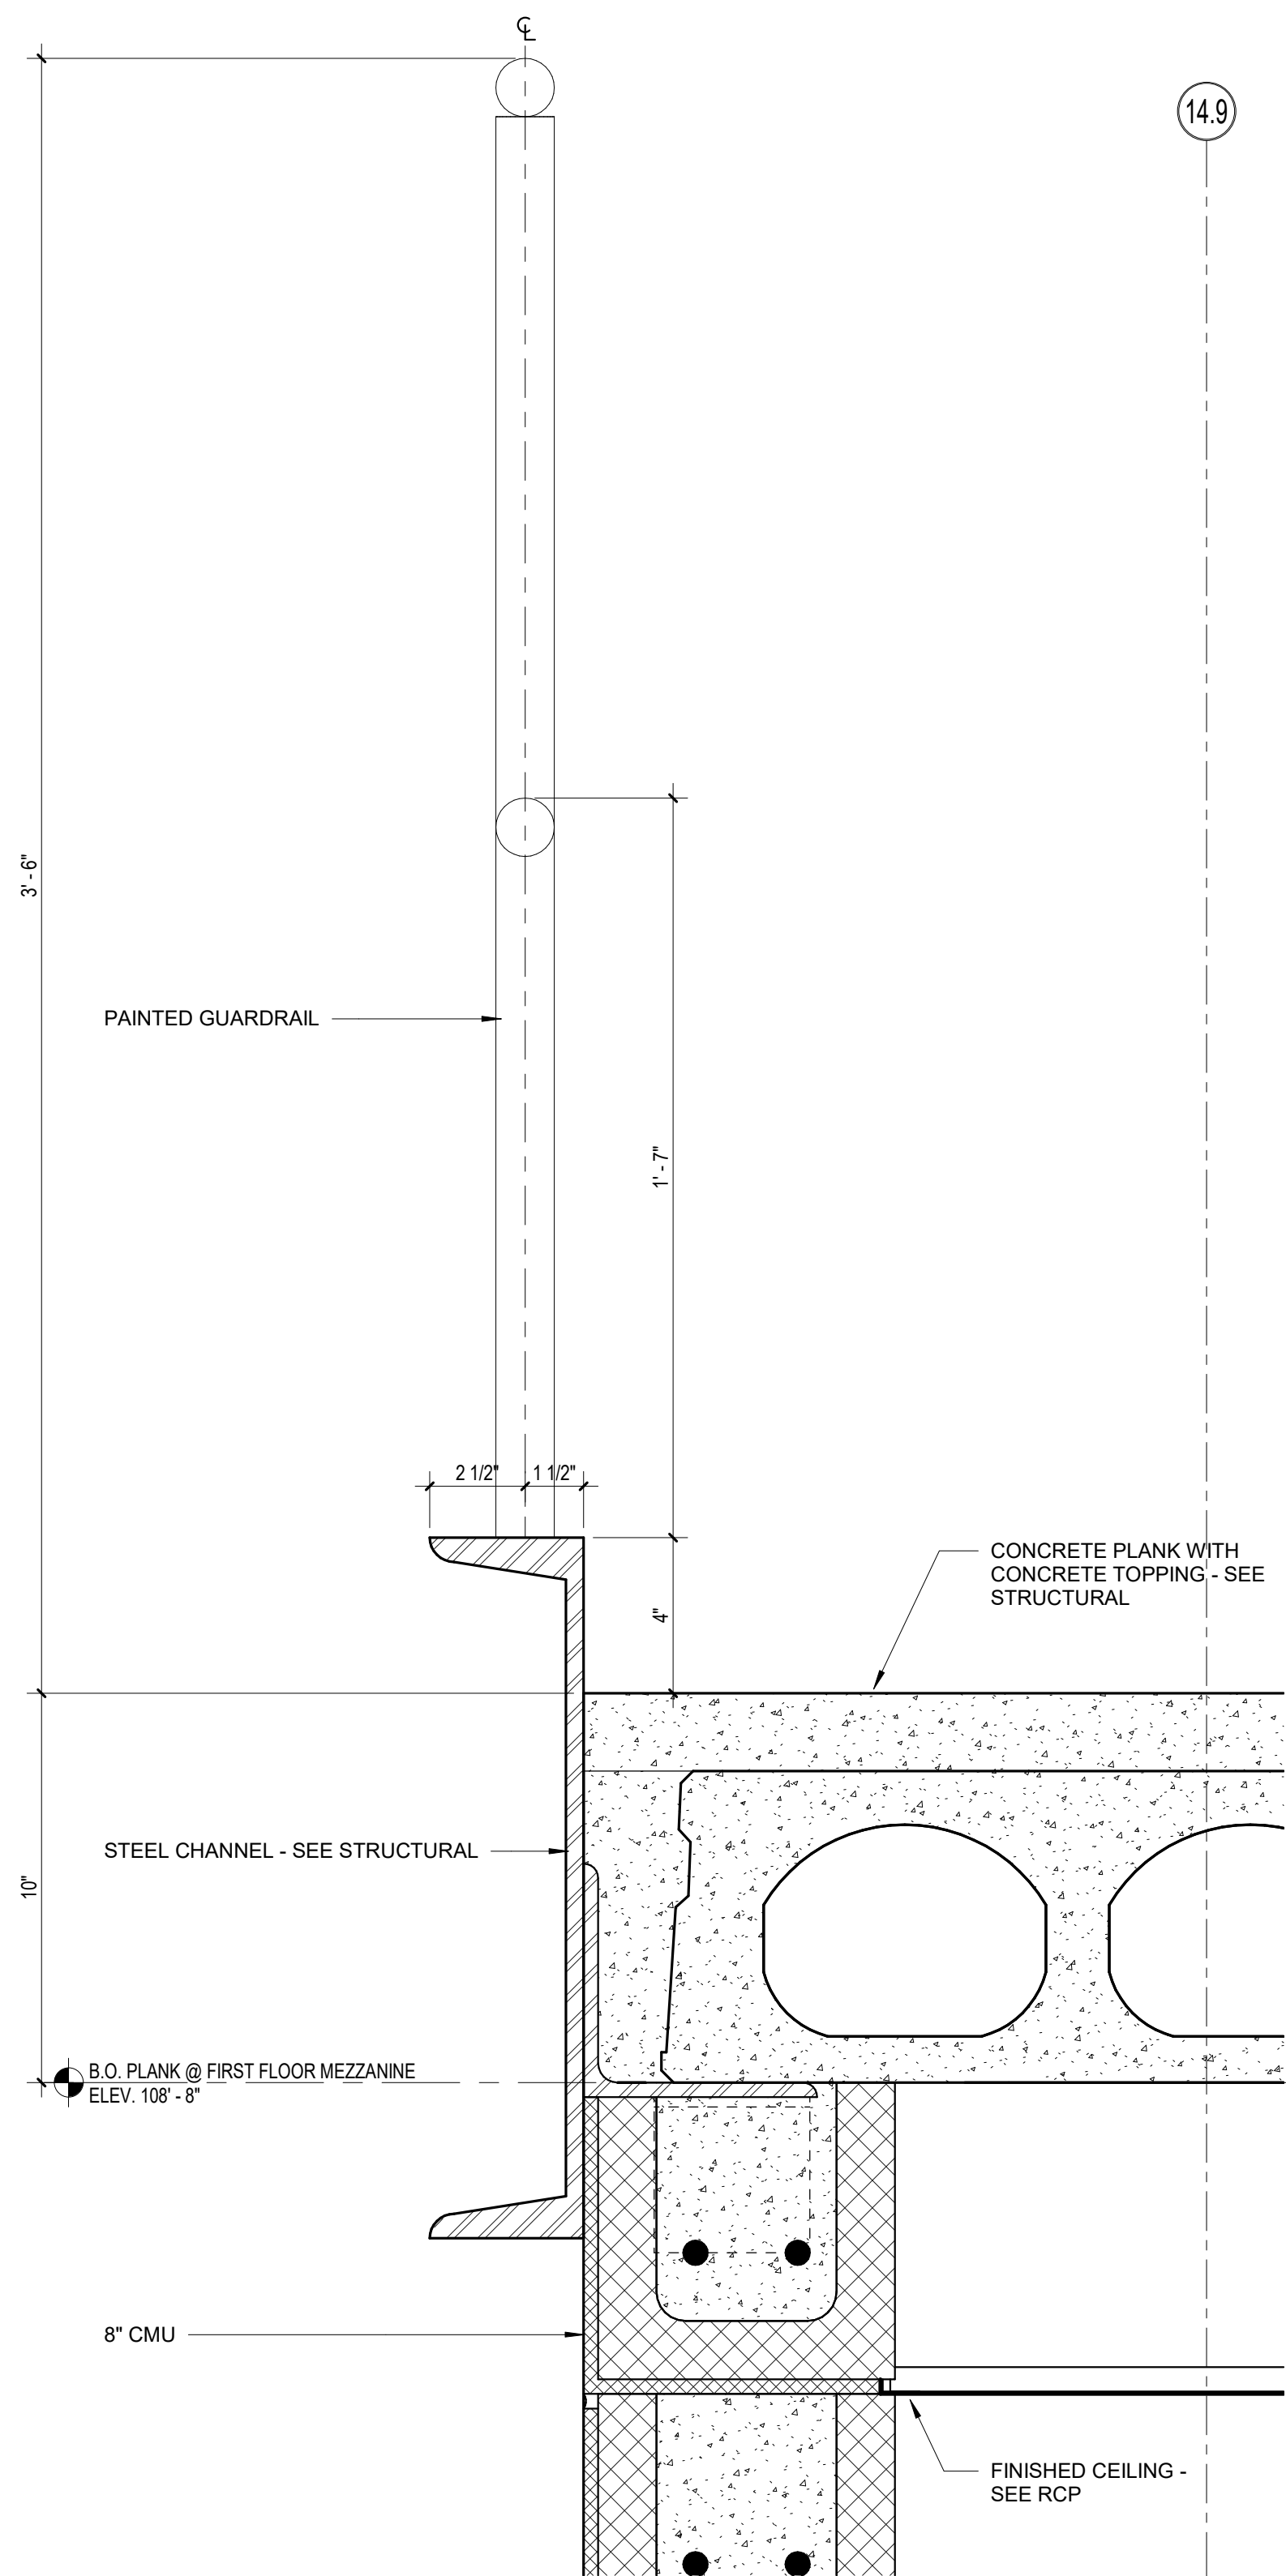

3 EDGE OF MEZZANINE DETAIL

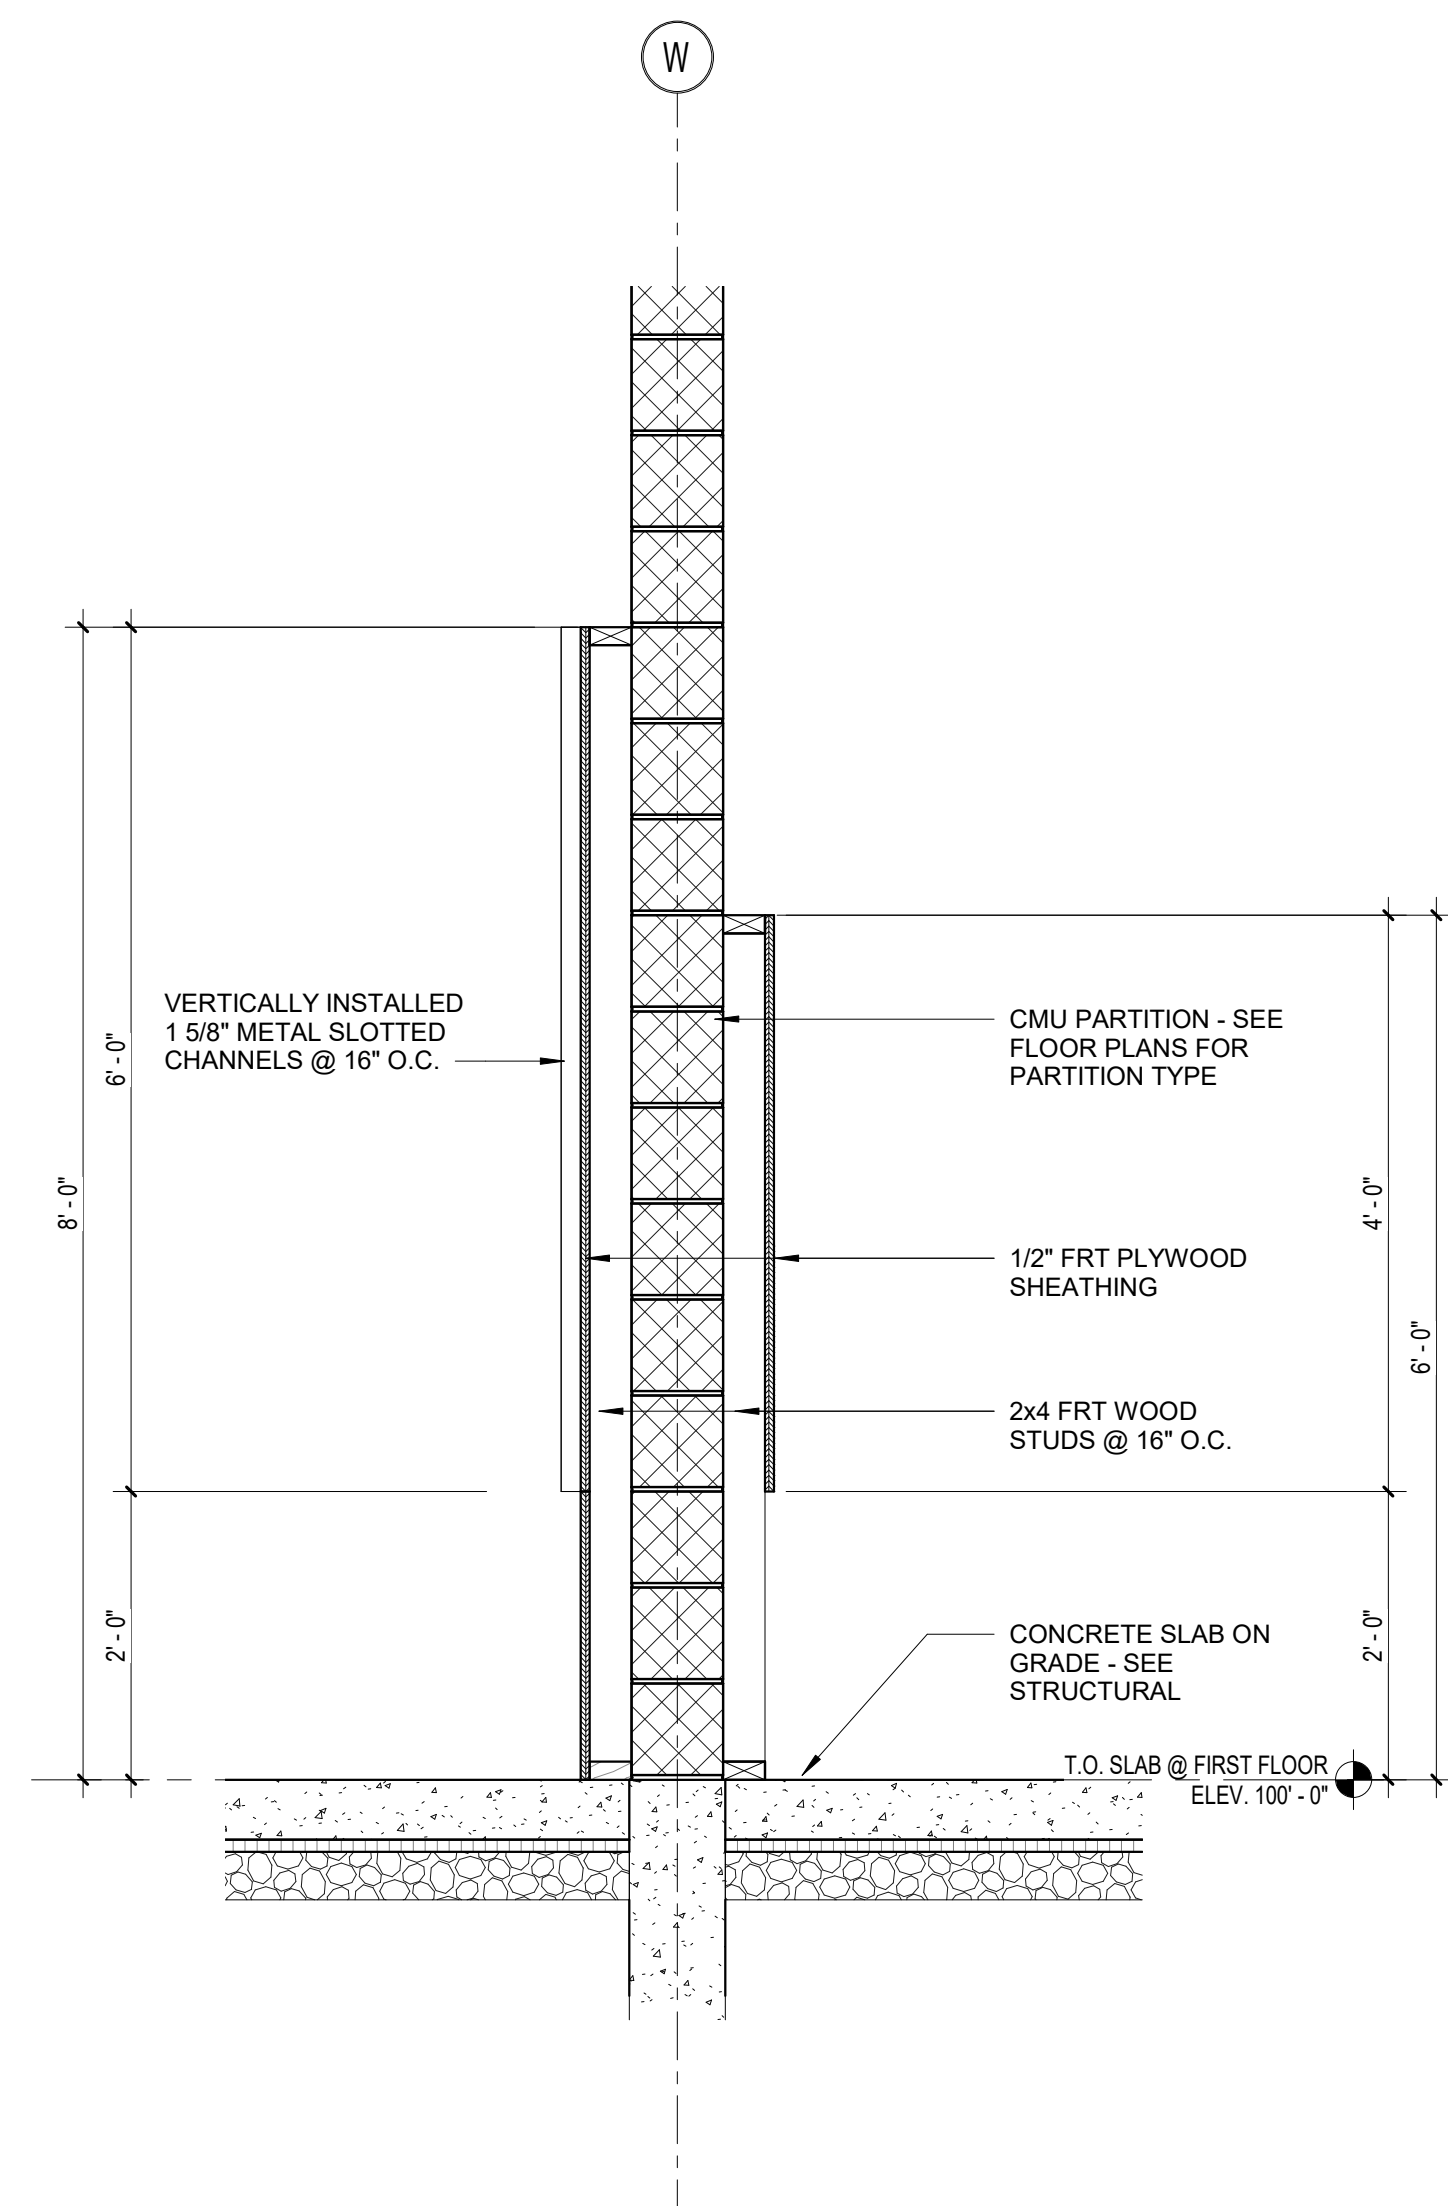


2 TRAINER WALL SECTION

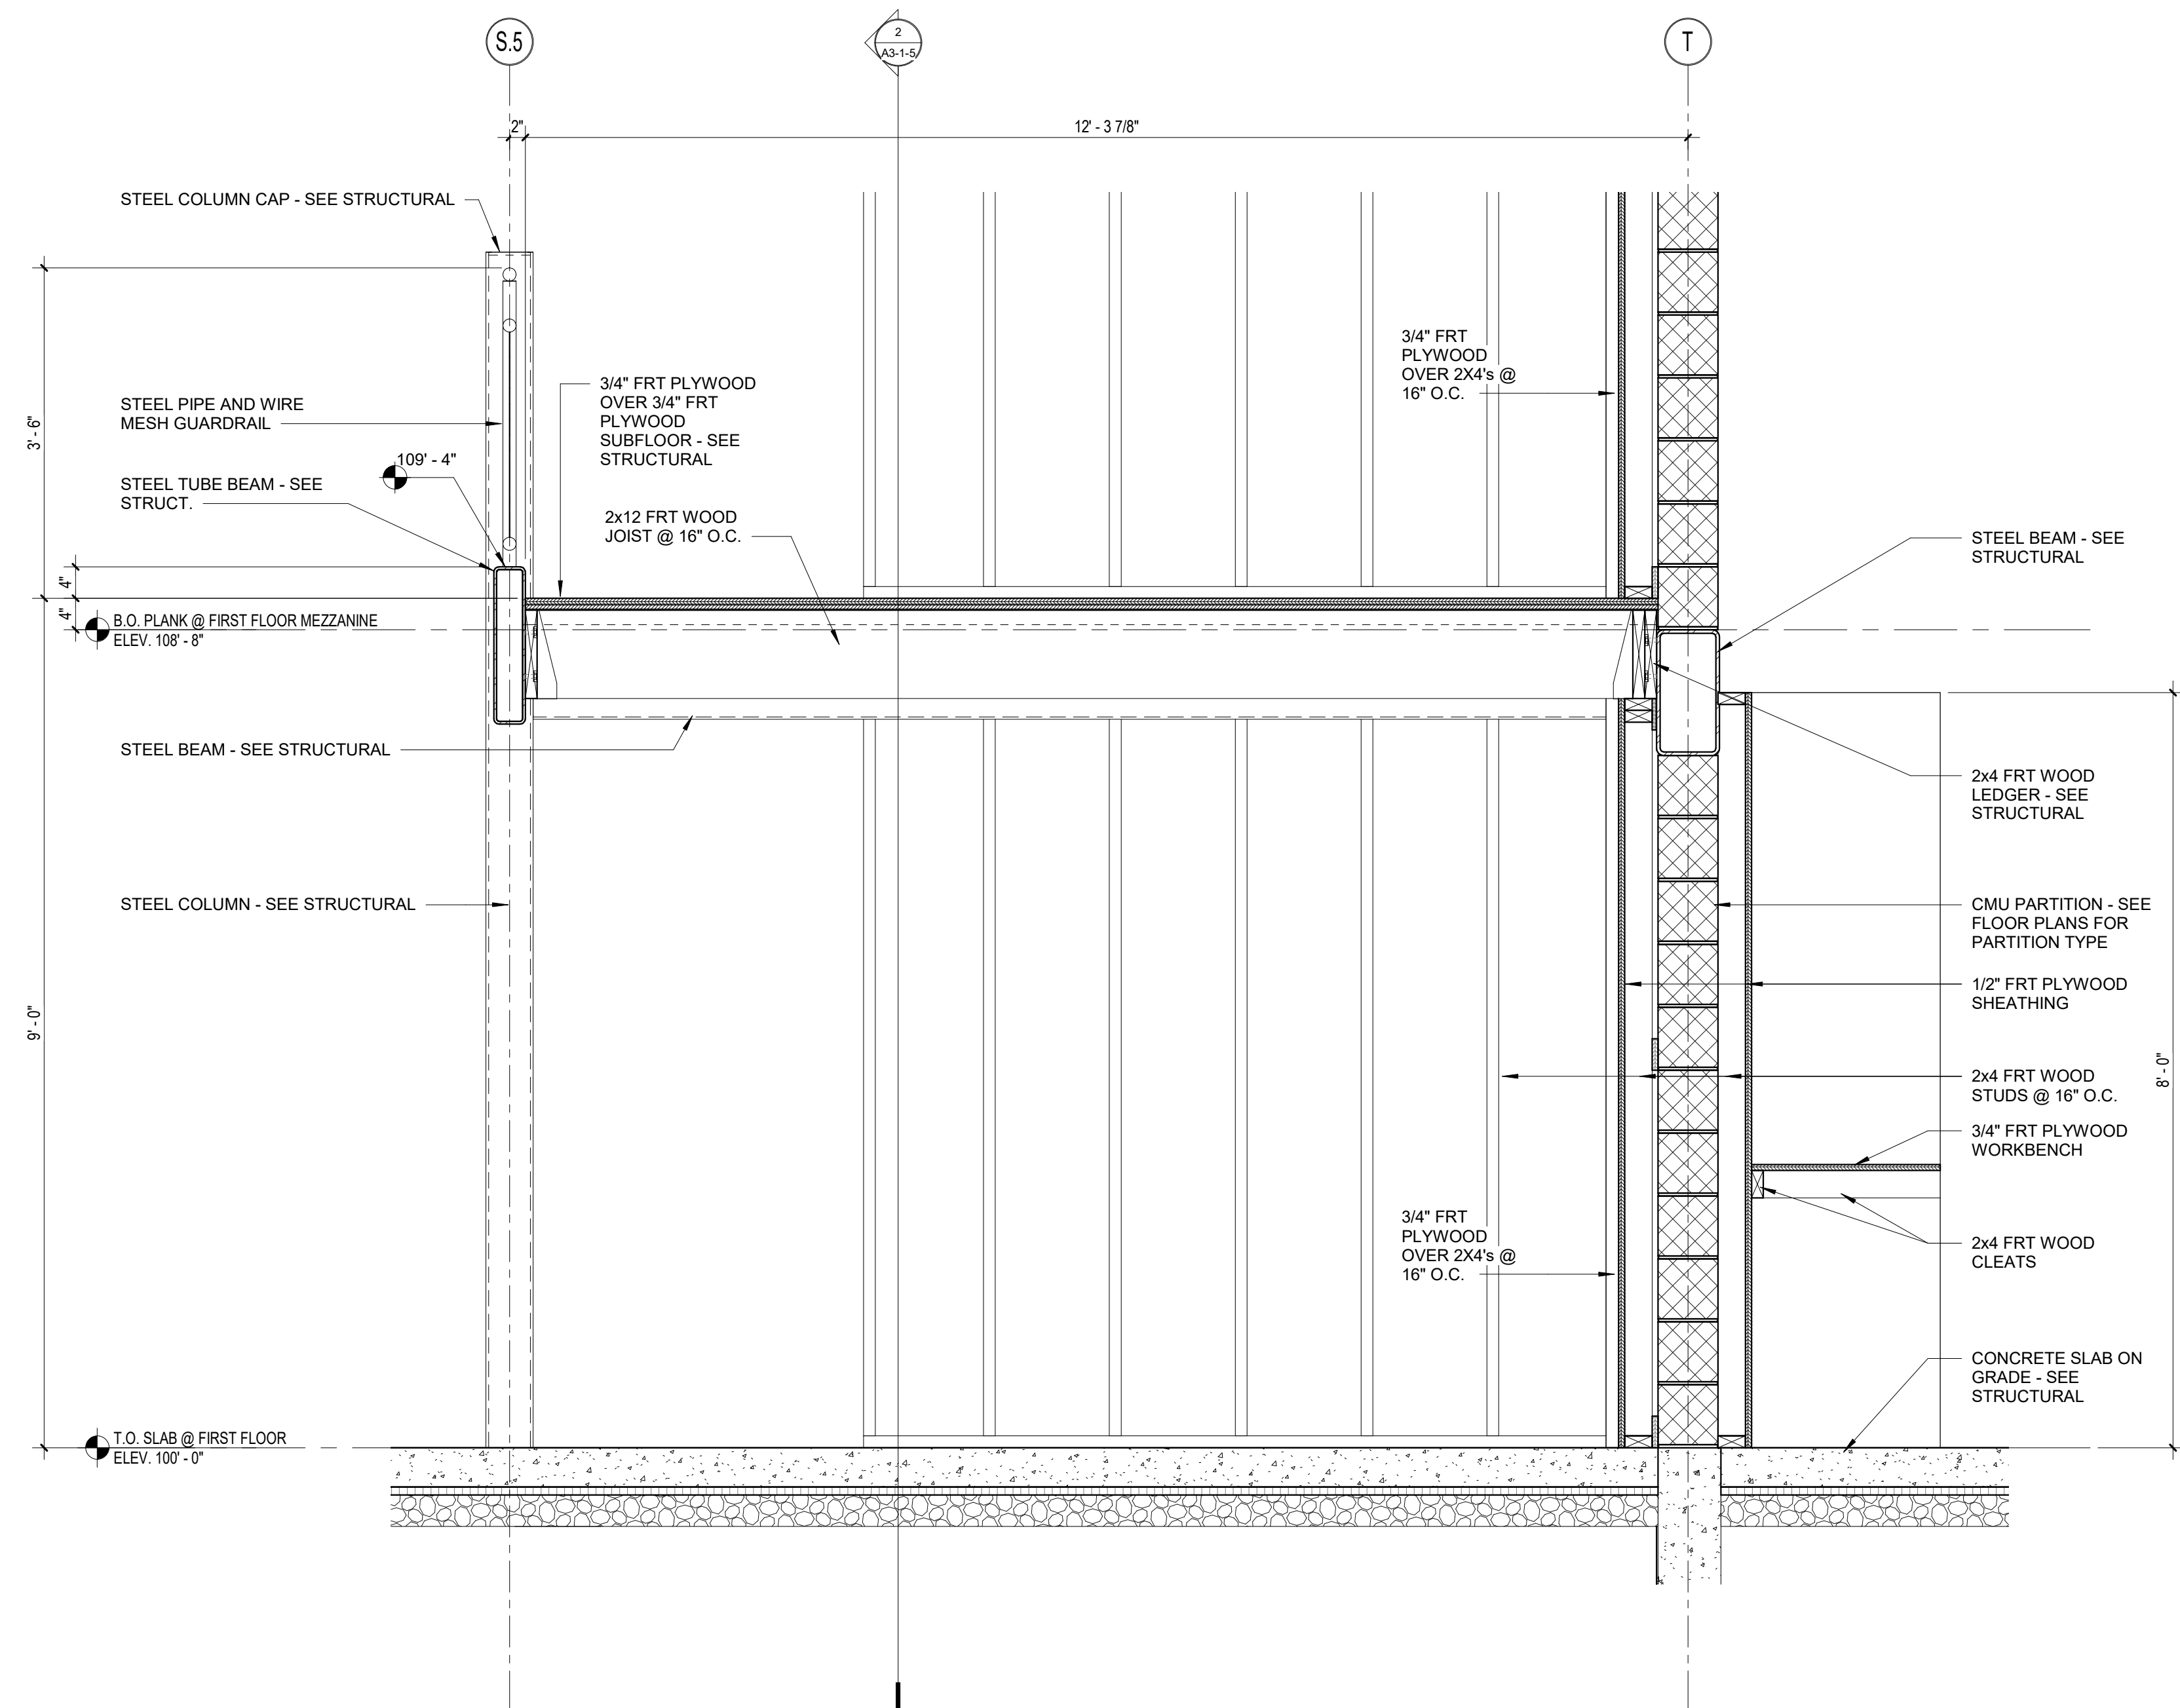


1 WOOD MEZZANINE SECTION

TOILET ACCESSORY SCHEDULE			
TYPE	DESCRIPTION	MOUNTING HEIGHT	REMARKS
CH	STAINLESS STEEL SURFACE MOUNTED COAT HOOK	4" - 6" MAX	PROVIDE ONE AT ALL SINGLE USER TOILET AND ALL OFFICE LOCATIONS. PROVIDE TWO AT ALL SHOWER LOCATIONS
SS1	FOLDING SHOWER SEAT	18" AFF TO SEAT SURFACE	OPPOSITE SIDE OF SHOWER WHERE INDICATED ON DRAWINGS.
SS2	SHOWER SEAT	20" AFF TO SEAT SURFACE	LOCKER ROOM SHOWERS WHERE INDICATED ON DRAWINGS.
GB1	1 1/2" DIA. x 42" STAINLESS STEEL HORIZONTAL GRAB BAR	3" - 0" AFF TO CENTER LINE OF BAR	1 1/2" CLEARANCE FROM WALL WITH CONCEALED MOUNTING
GB2	1 1/2" DIA. x 17" x 33" STAINLESS STEEL TWO-WALL HORIZONTAL SHOWER L-SHAPED GRAB BAR	3" - 0" AFF TO TOP OF BAR	1 1/2" CLEARANCE FROM WALL WITH CONCEALED MOUNTING
GB3	1 1/2" DIA. x 42"x24" STAINLESS STEEL TWO-WALL HORIZONTAL SHOWER GRAB BAR FOR 30" x 60" STALL	3" - 0" AFF TO TOP OF BAR	1 1/2" CLEARANCE FROM WALL WITH CONCEALED MOUNTING
M1	16" x 36" STAINLESS STEEL FRAMED MIRROR	3" - 4" AFF TO BOTTOM OF MIRROR	PROVIDE ONE AT ALL ACCESSIBLE LAVATORY LOCATIONS
SD1	SURFACE MOUNTED SOAP DISPENSER	3" - 6" AFF TO CONTROLS	FURNISHED BY OWNER. INSTALLED BY CM AT EACH SINK LOCATION THROUGHOUT BUILDING, INCLUDING ALL HAND SINKS IN KITCHEN AND CLASSROOMS.
SND	RECESSED SANITARY NAPKIN DISPOSAL	1" - 11" AFF TO TOP OF DISPOSAL	PROVIDE ONE AT ALL SINGLE USER TOILET AND ALL GIRLS GANG TOILET LOCATIONS
SC	SHOWER ROD AND CURTAIN	7" - 0" AFF	AT ALL SHOWER LOCATIONS
ST	SHOWER SOAP TRAY	12" AFF TO BOTTOM OF PANEL	AT ALL SHOWER LOCATIONS
TP	TOILET PARTITION PANEL SURFACE MOUNTED	1" - 6" AFF MAX TO BOTTOM OF SURFACE	-
TW	PAPER TOWEL DISPENSER	42" AFF MAX TO CONTROL HANDLE OR TOWEL OPENING	DISPENSER FURNISHED BY THE OWNER, INSTALLED BY THE CM. INSTALL ONE AT EACH SINGLE STALL TOILET ROOM, INSTALL TWO AT EACH GANG TOILET. INSTALL ONE AT EACH HAND SINK.
TT	SURFACE MOUNTED MULTI-ROLL TOILET TISSUE DISPENSER	24" AFF TO CENTER LINE OF DISPENSER	INSTALL ONE AT EACH TOILET


NOTE:
1) SEE PLUMBING DRAWINGS FOR PLUMBING FIXTURE MOUNTING HEIGHT VERIFICATION
4) PROVIDE PAPER TOWEL DISPENSER AT ALL SINK LOCATIONS, INCLUDING BUT NOT LIMITED TO TOILET ROOMS, SHOWERS, LOCKER ROOMS, WORK ROOMS, KITCHEN, CLASSROOMS, ETC.)
5) PROVIDE SHIM TO ALIGN MIRROR WITH CERAMIC TILE PLANE. APPLY CLEAR SEALANT AT ALL PERIMETER TO CLOSE THE GAP BETWEEN THE WALL AND THE MIRROR.

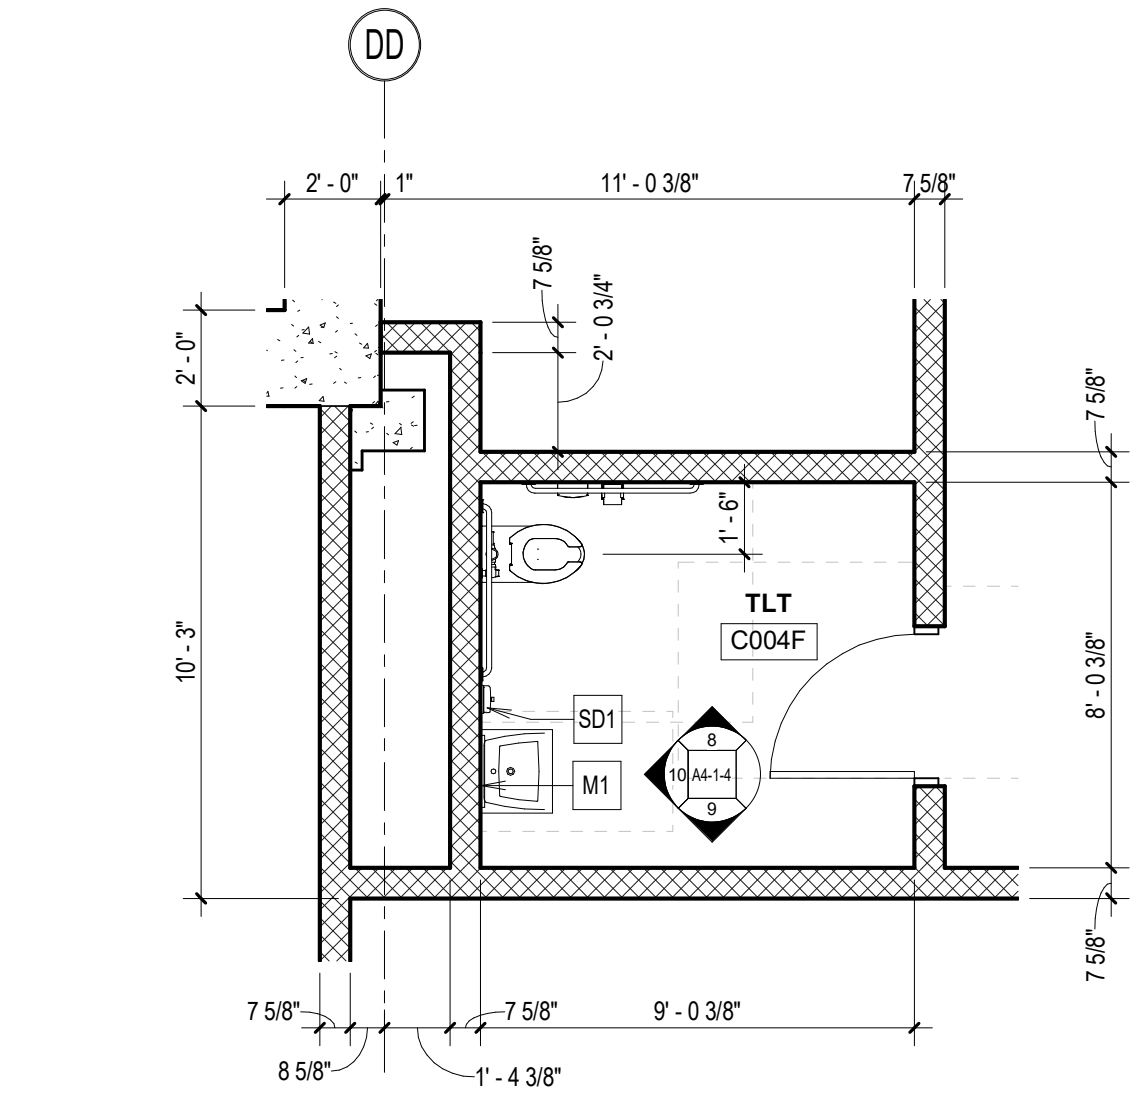


4 LOCKER C004C
1/4" = 1'-0"

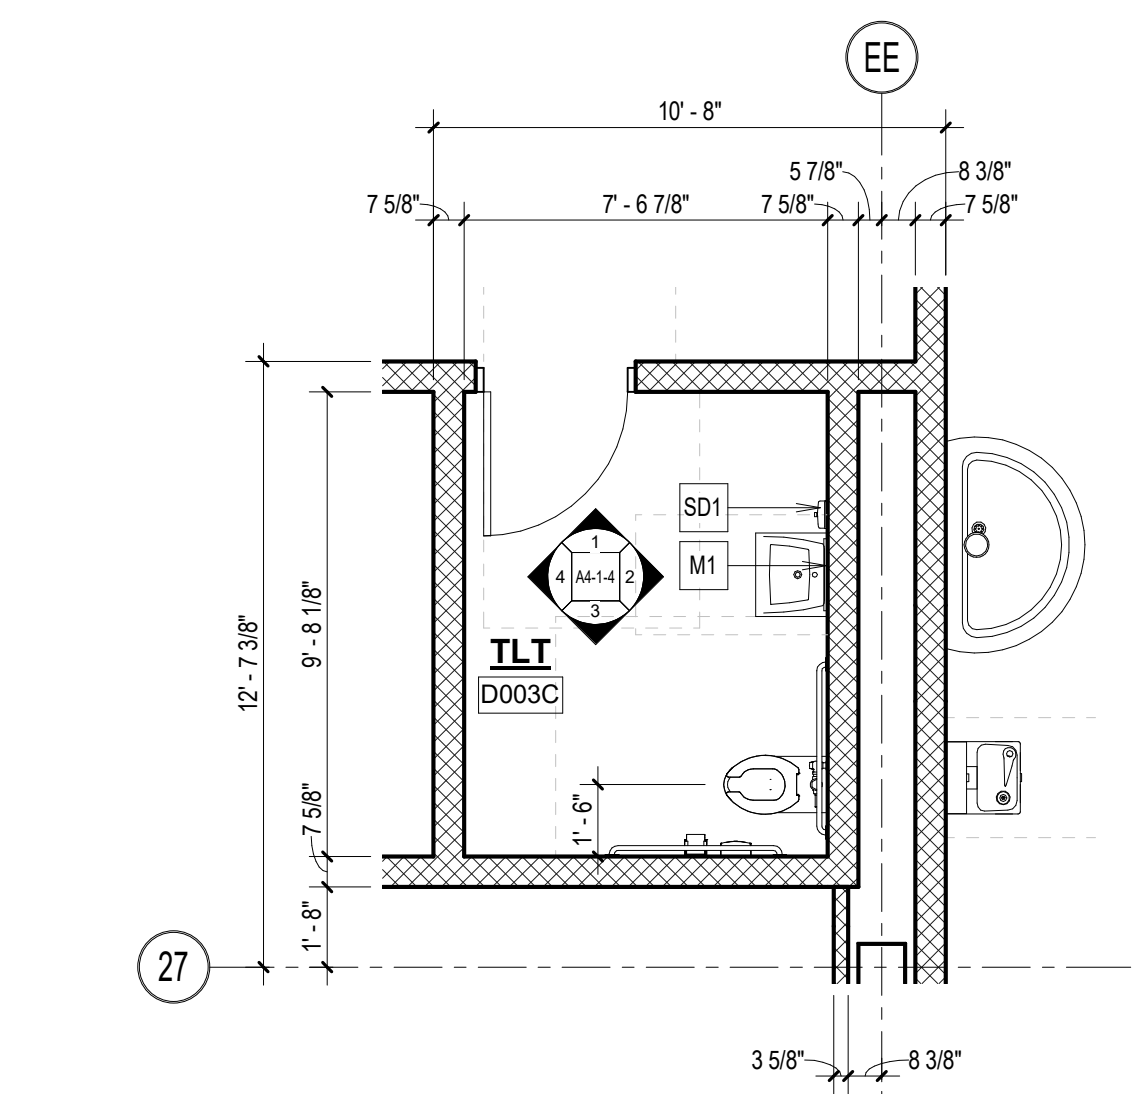


2 TOILET PLAN D003C
1/4" = 1'-0"

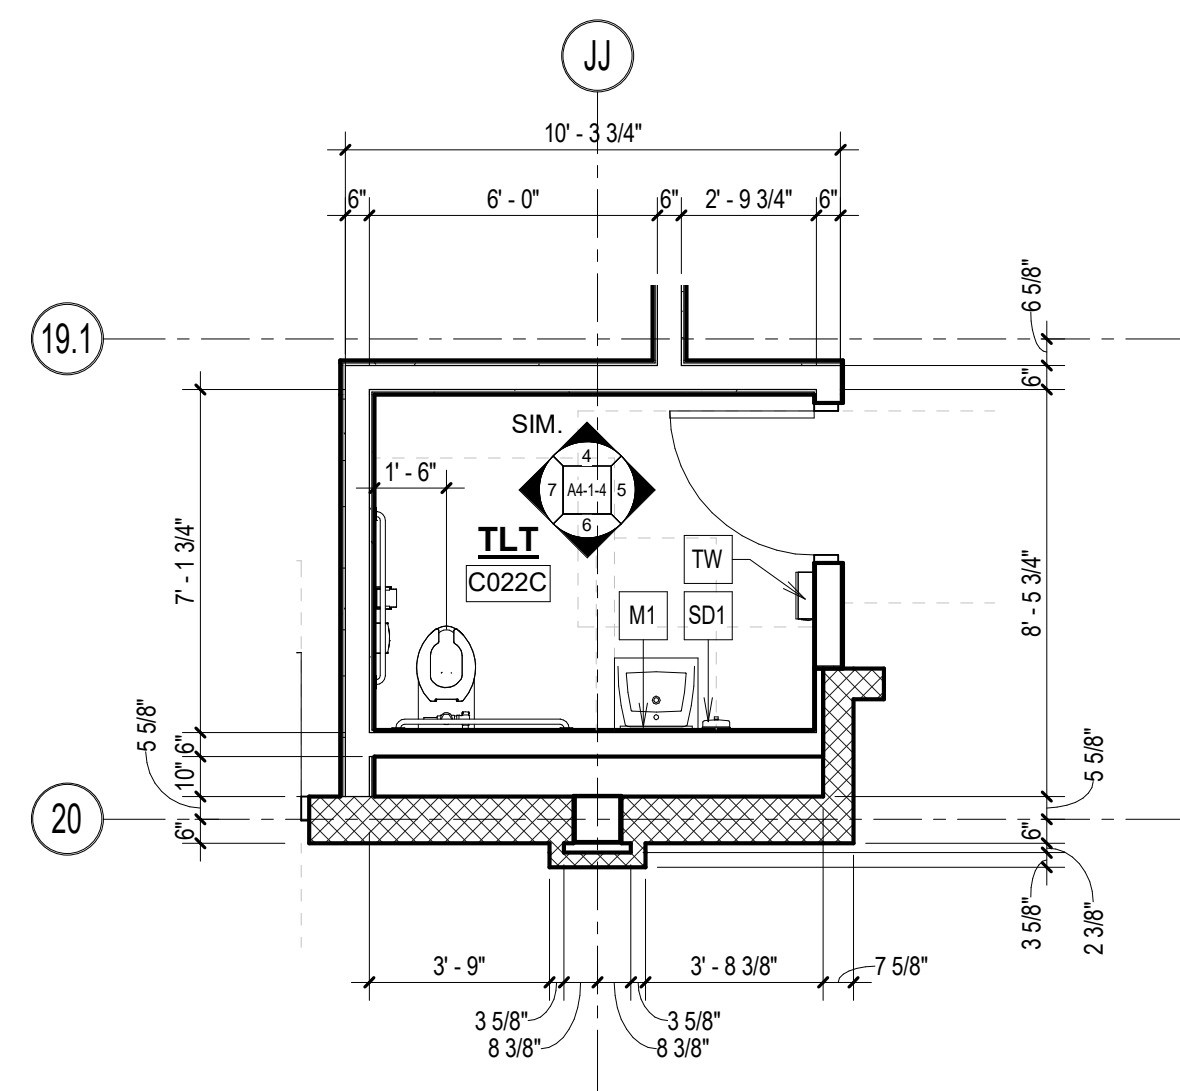

3 TOILET PLAN C002C
1/4" = 1'-0"

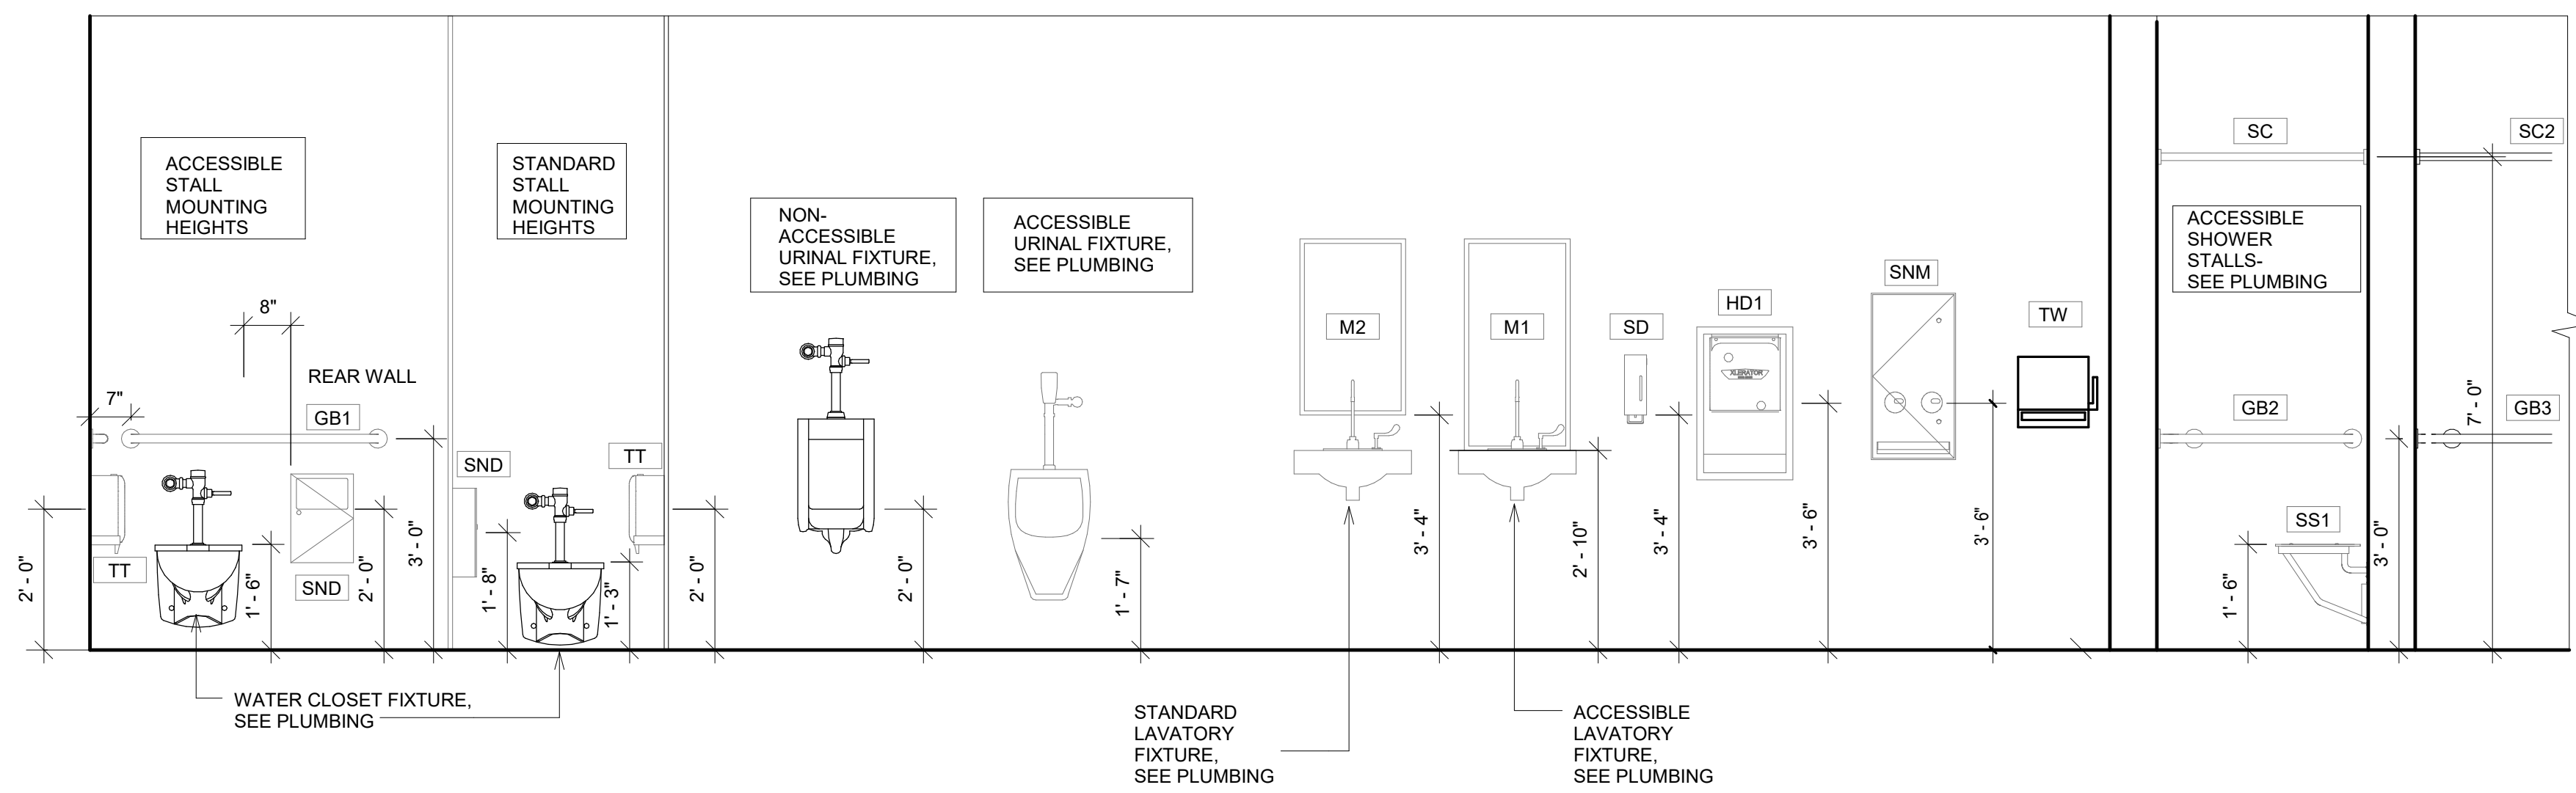

1 TYPICAL TOILET MOUNTING HEIGHTS
1/2" = 1'-0"

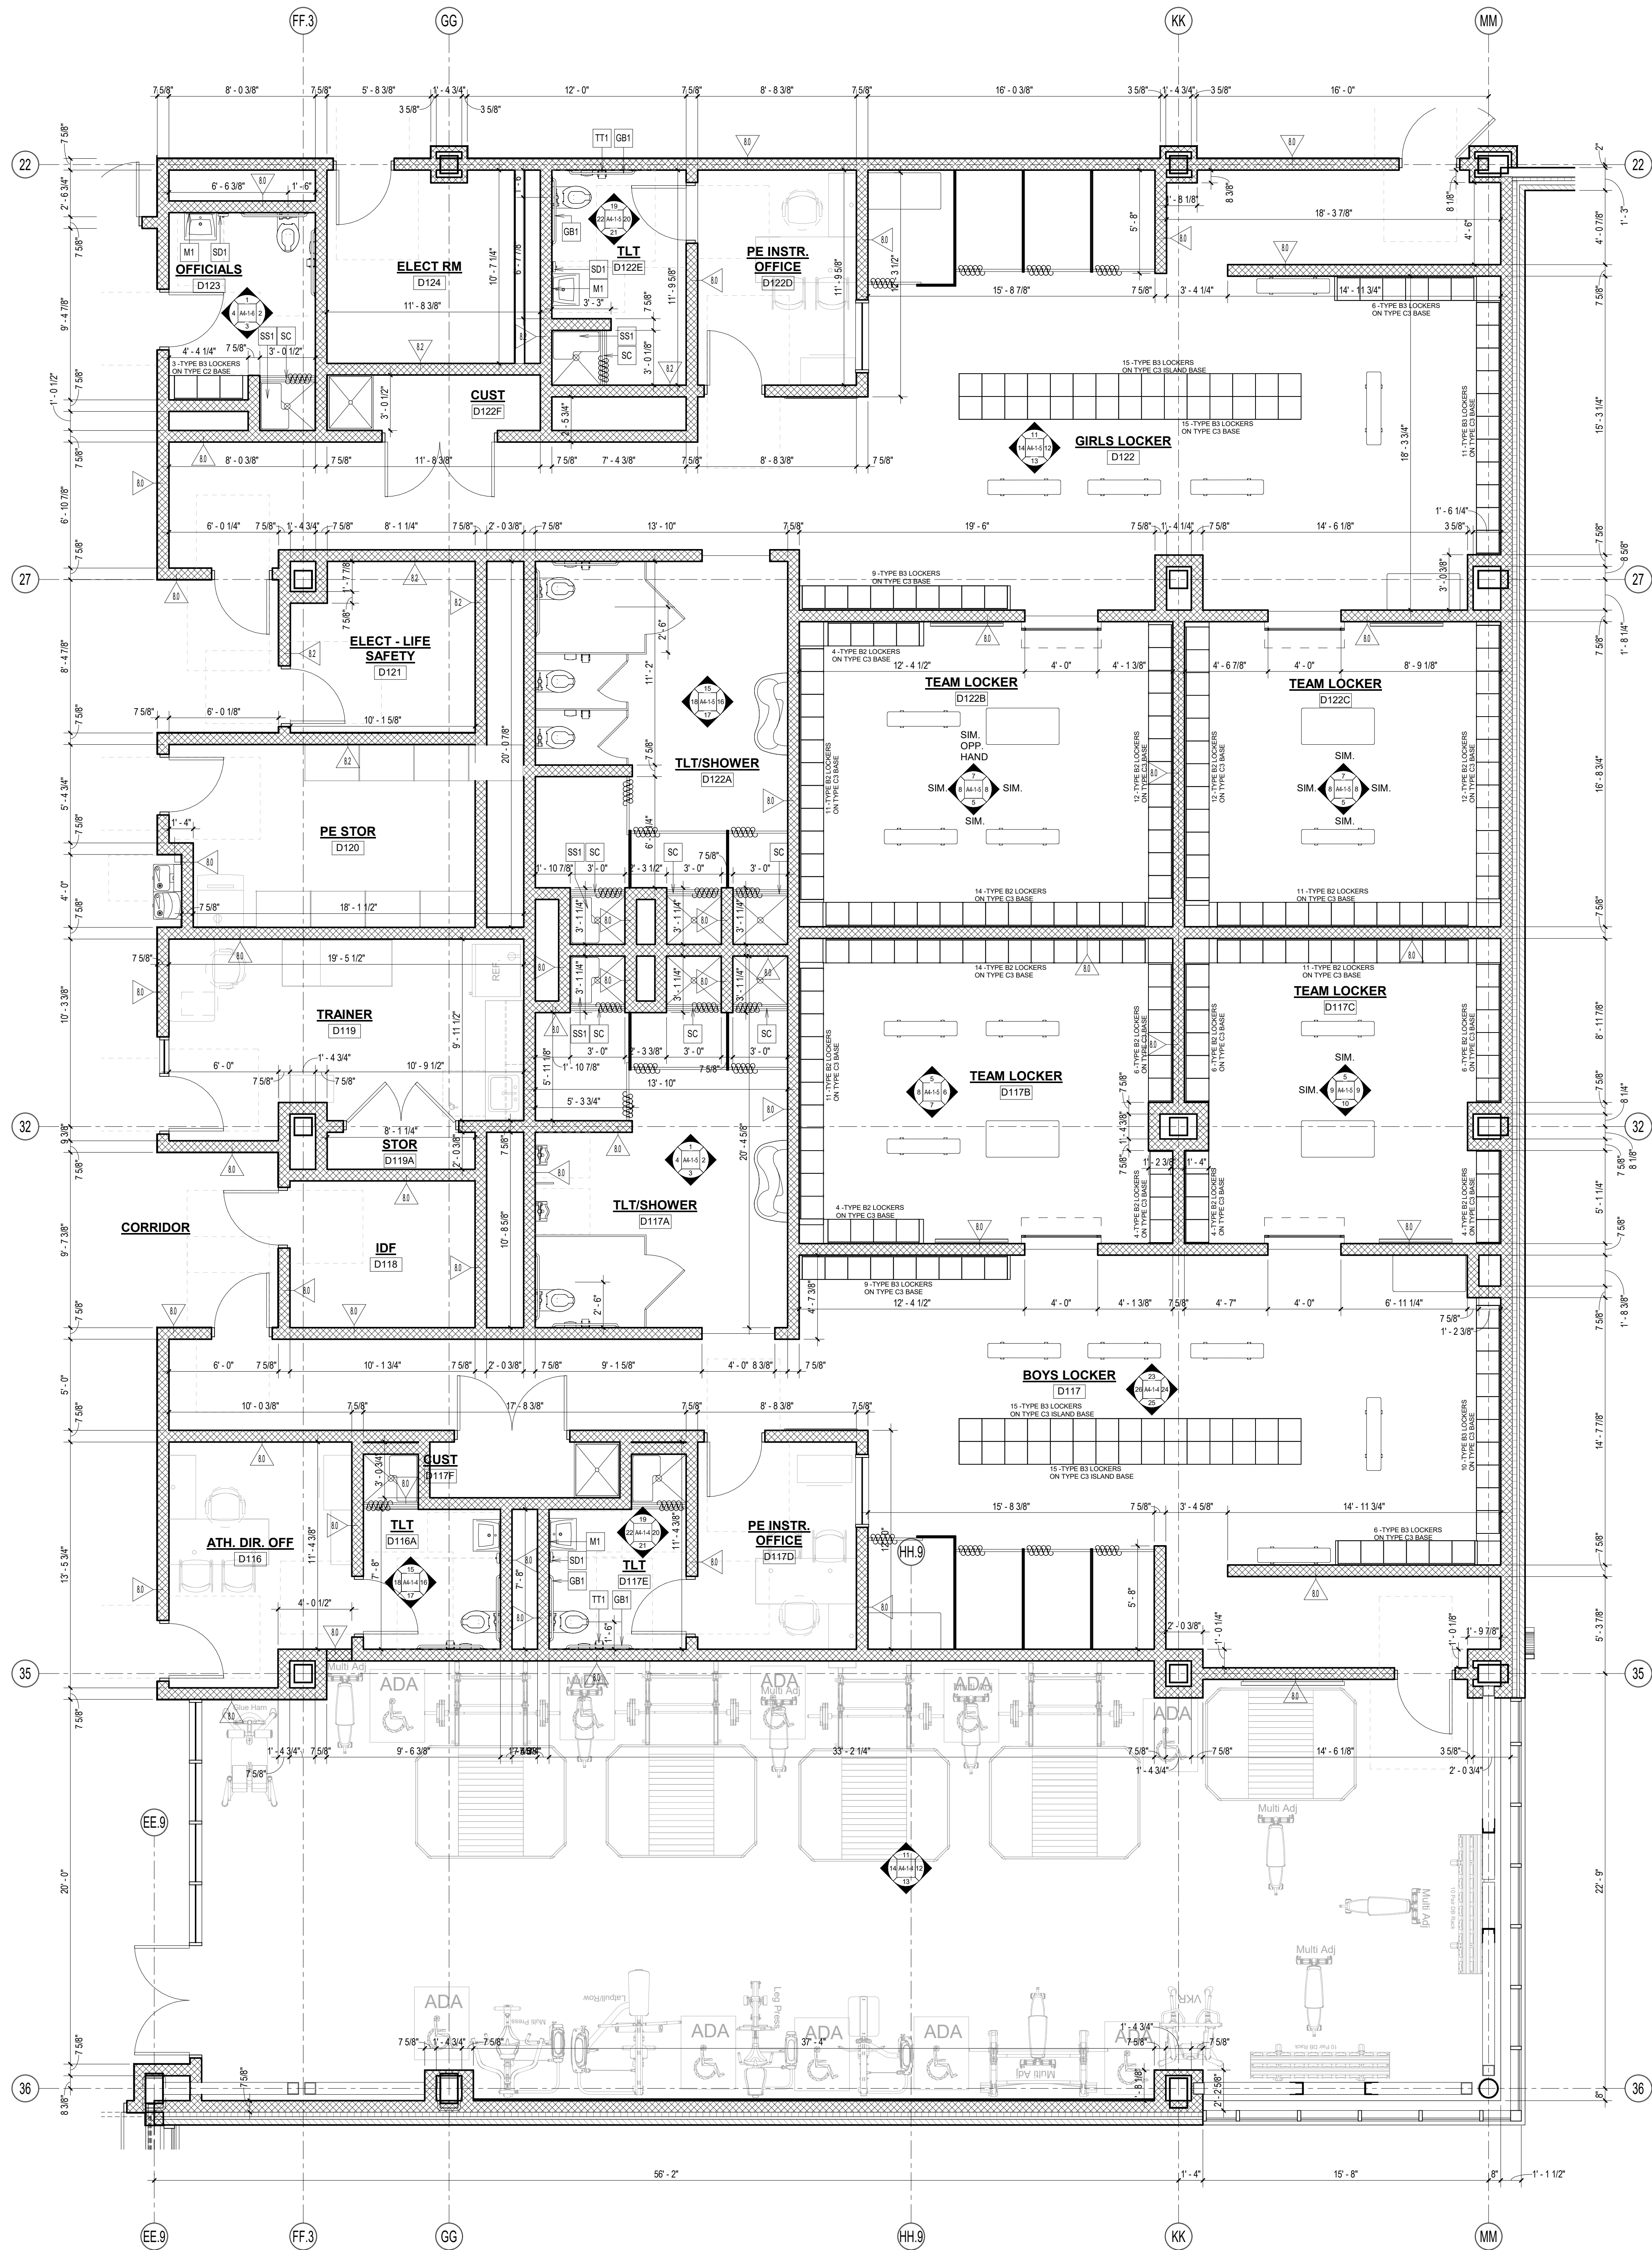

5 GIRLS LOCKER D115 AND BOYS LOCKER D116
1/4" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.864.1702
www.dra.com


260 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School
100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

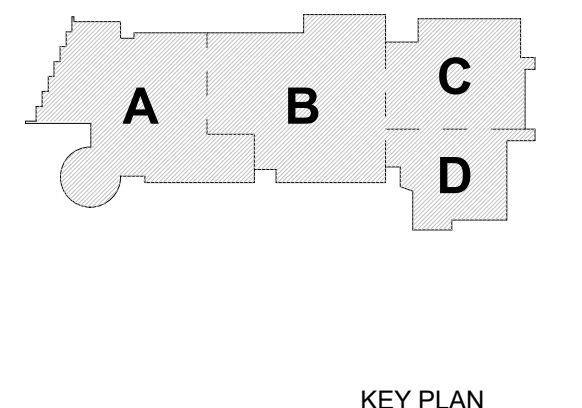

TOILET AND
LOCKER ROOM
PLANS

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A4-1-1

DRA


Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.864.1700
www.dra-inc.com

260 Charles Street
Studio 300
Waltham, MA
02453


Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

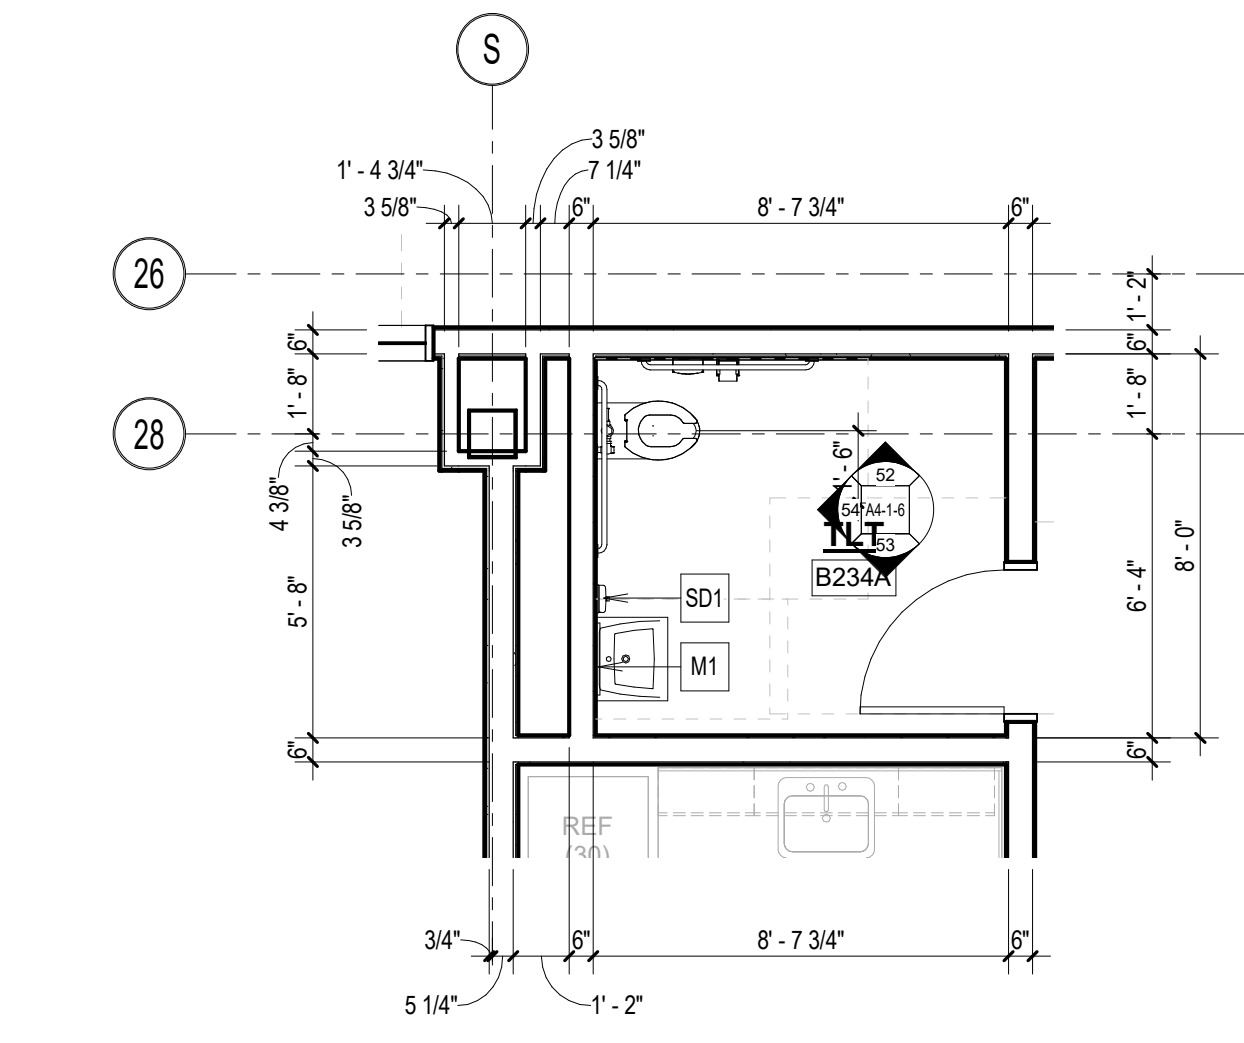


18 TOILET PLAN B234A
1/4" = 1'-0"

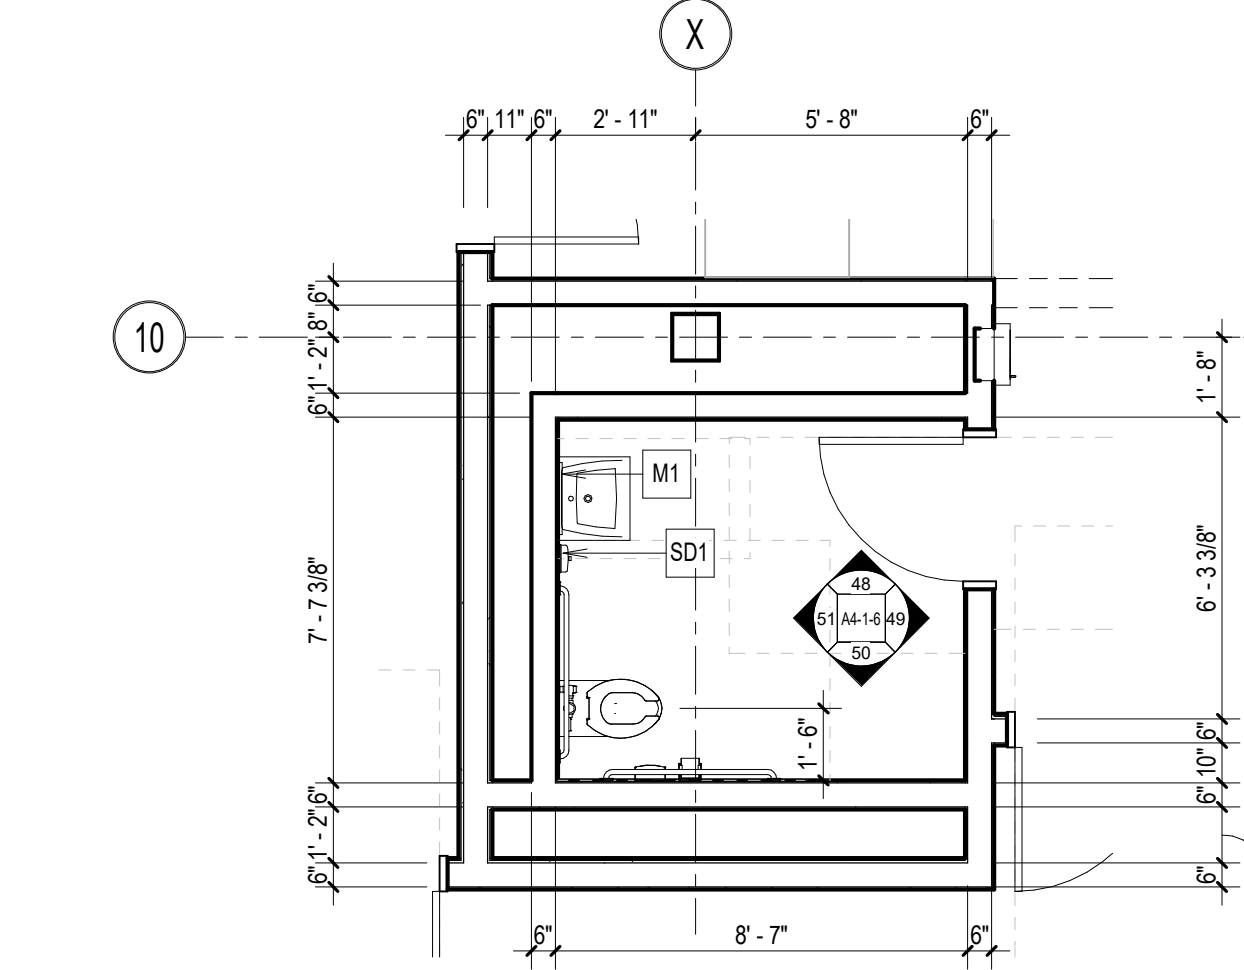


17 TOILET PLAN B203F
1/4" = 1'-0"

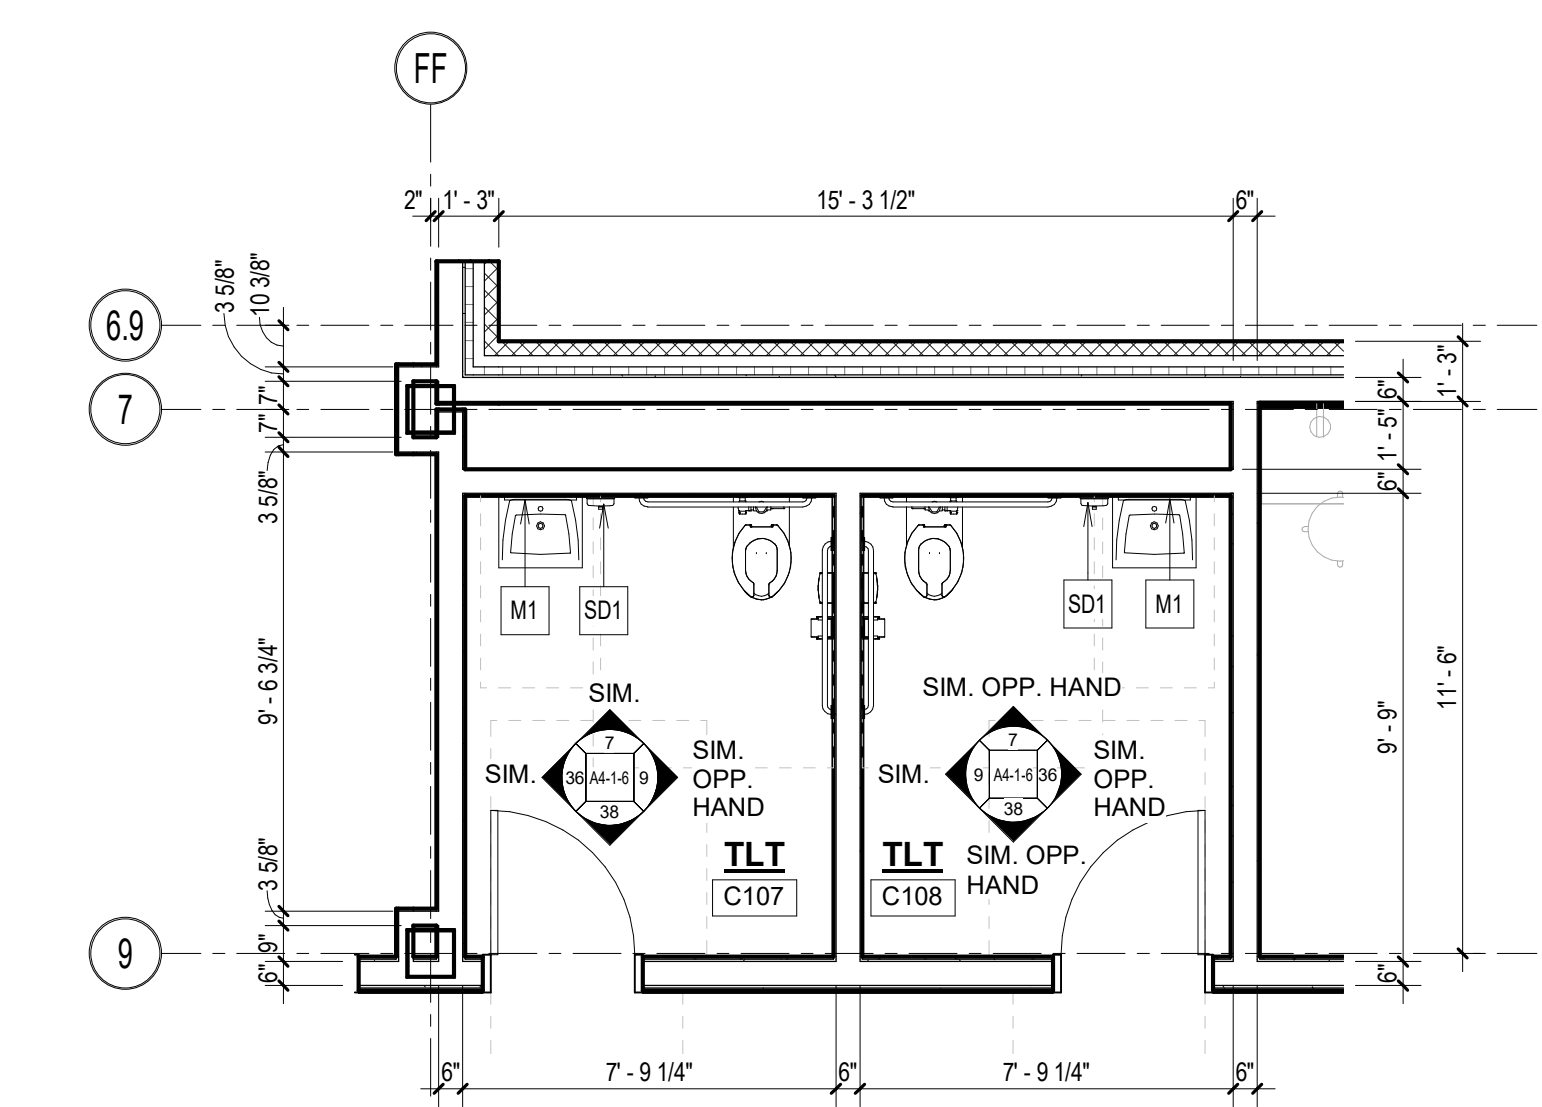


11 TOILET PLAN C107 AND C108
1/4" = 1'-0"

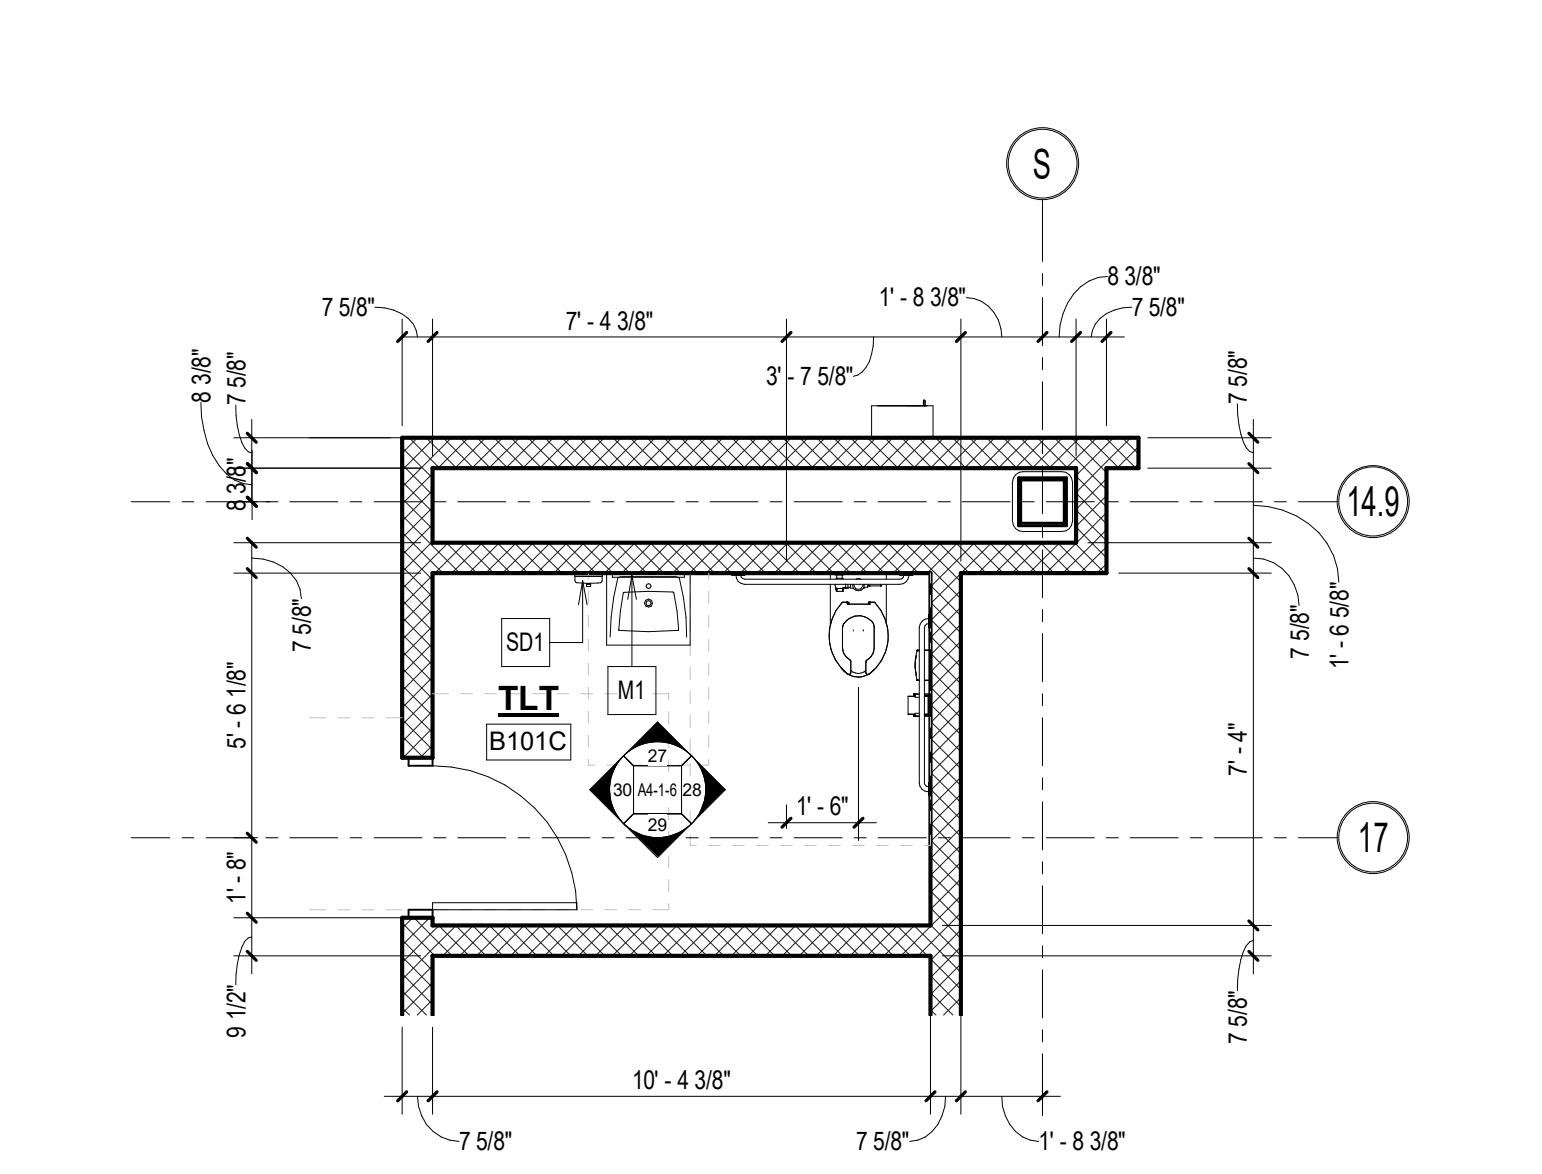


6 TOILET PLAN B101C
1/4" = 1'-0"

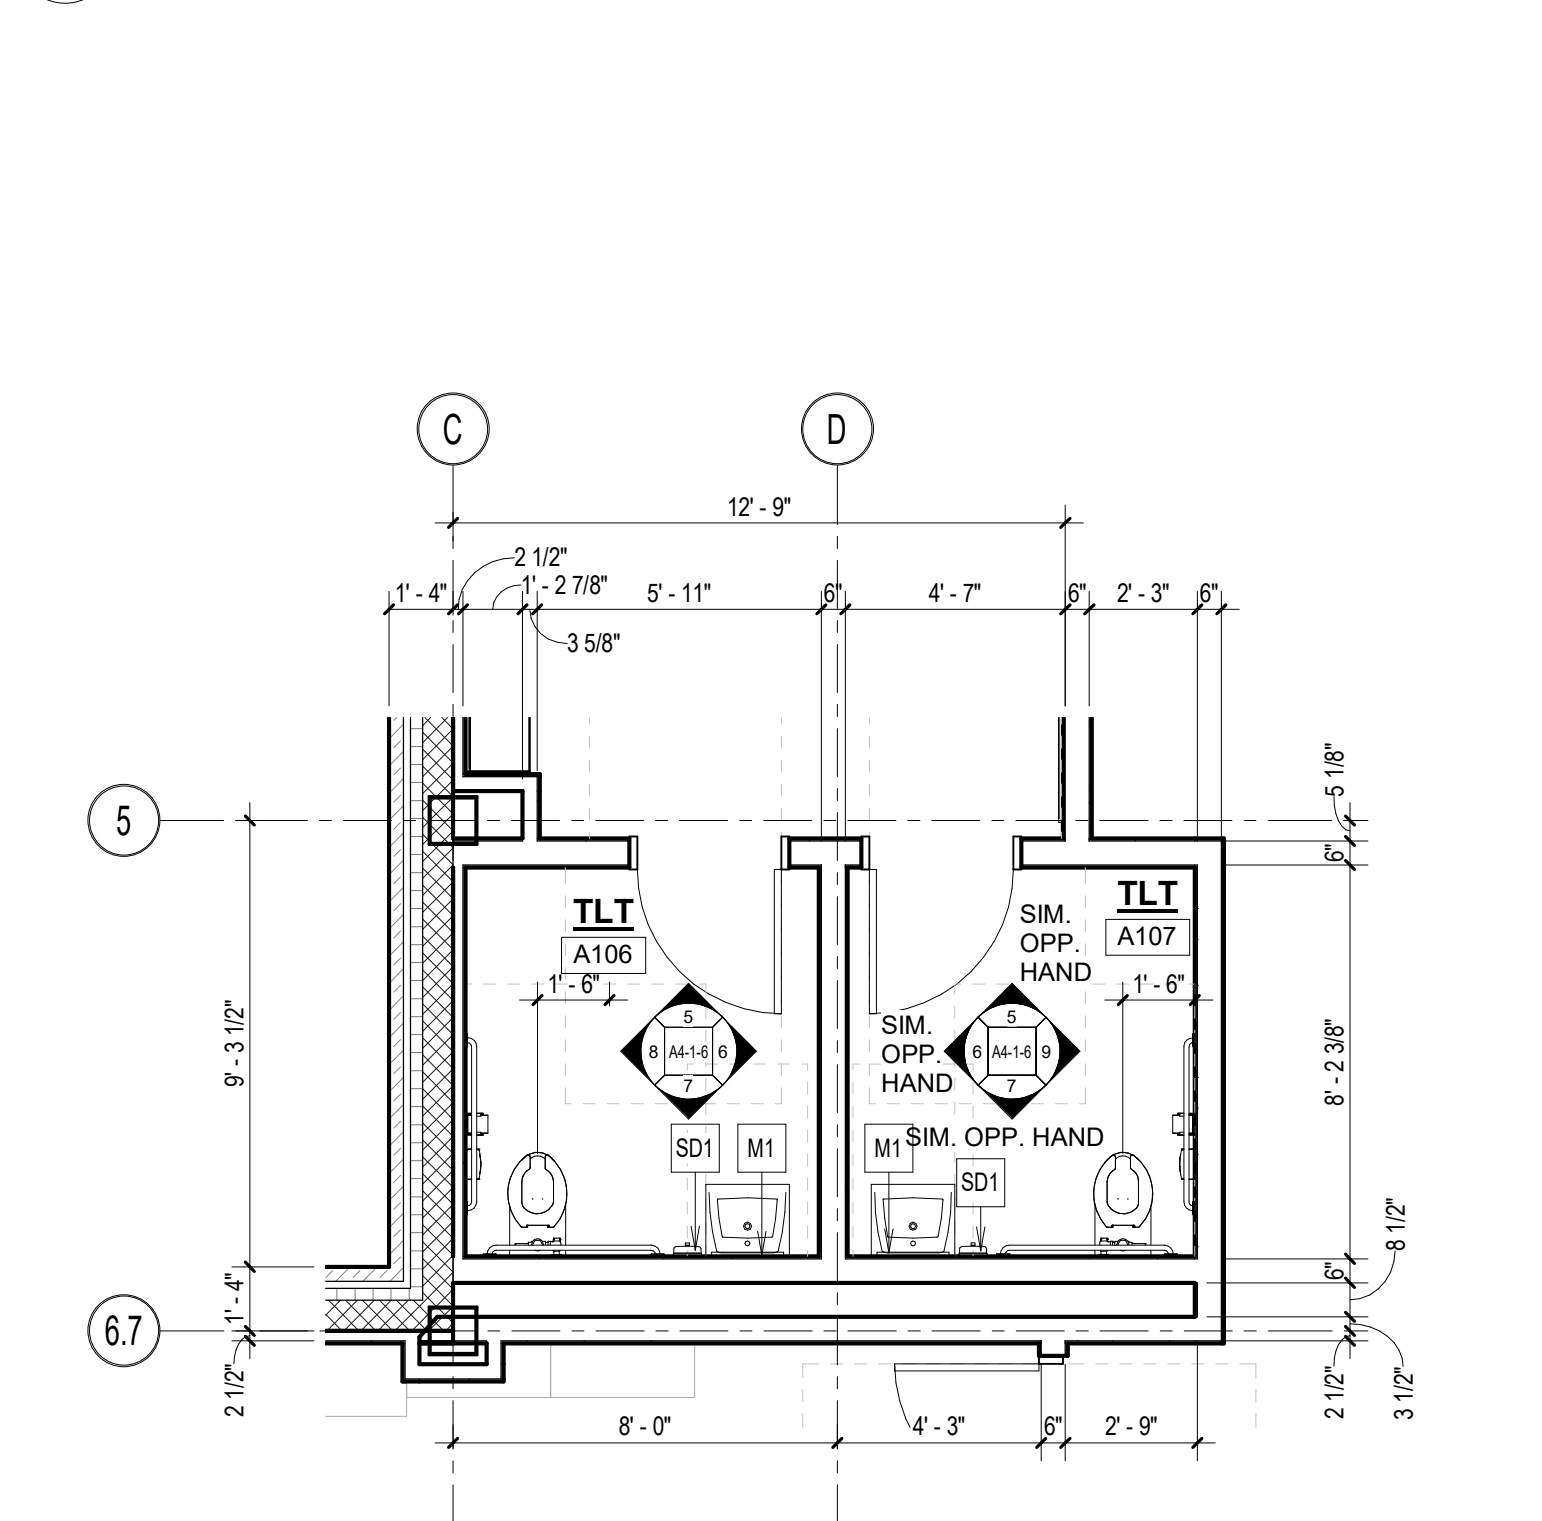


1 TOILET PLAN A106 AND A107
1/4" = 1'-0"

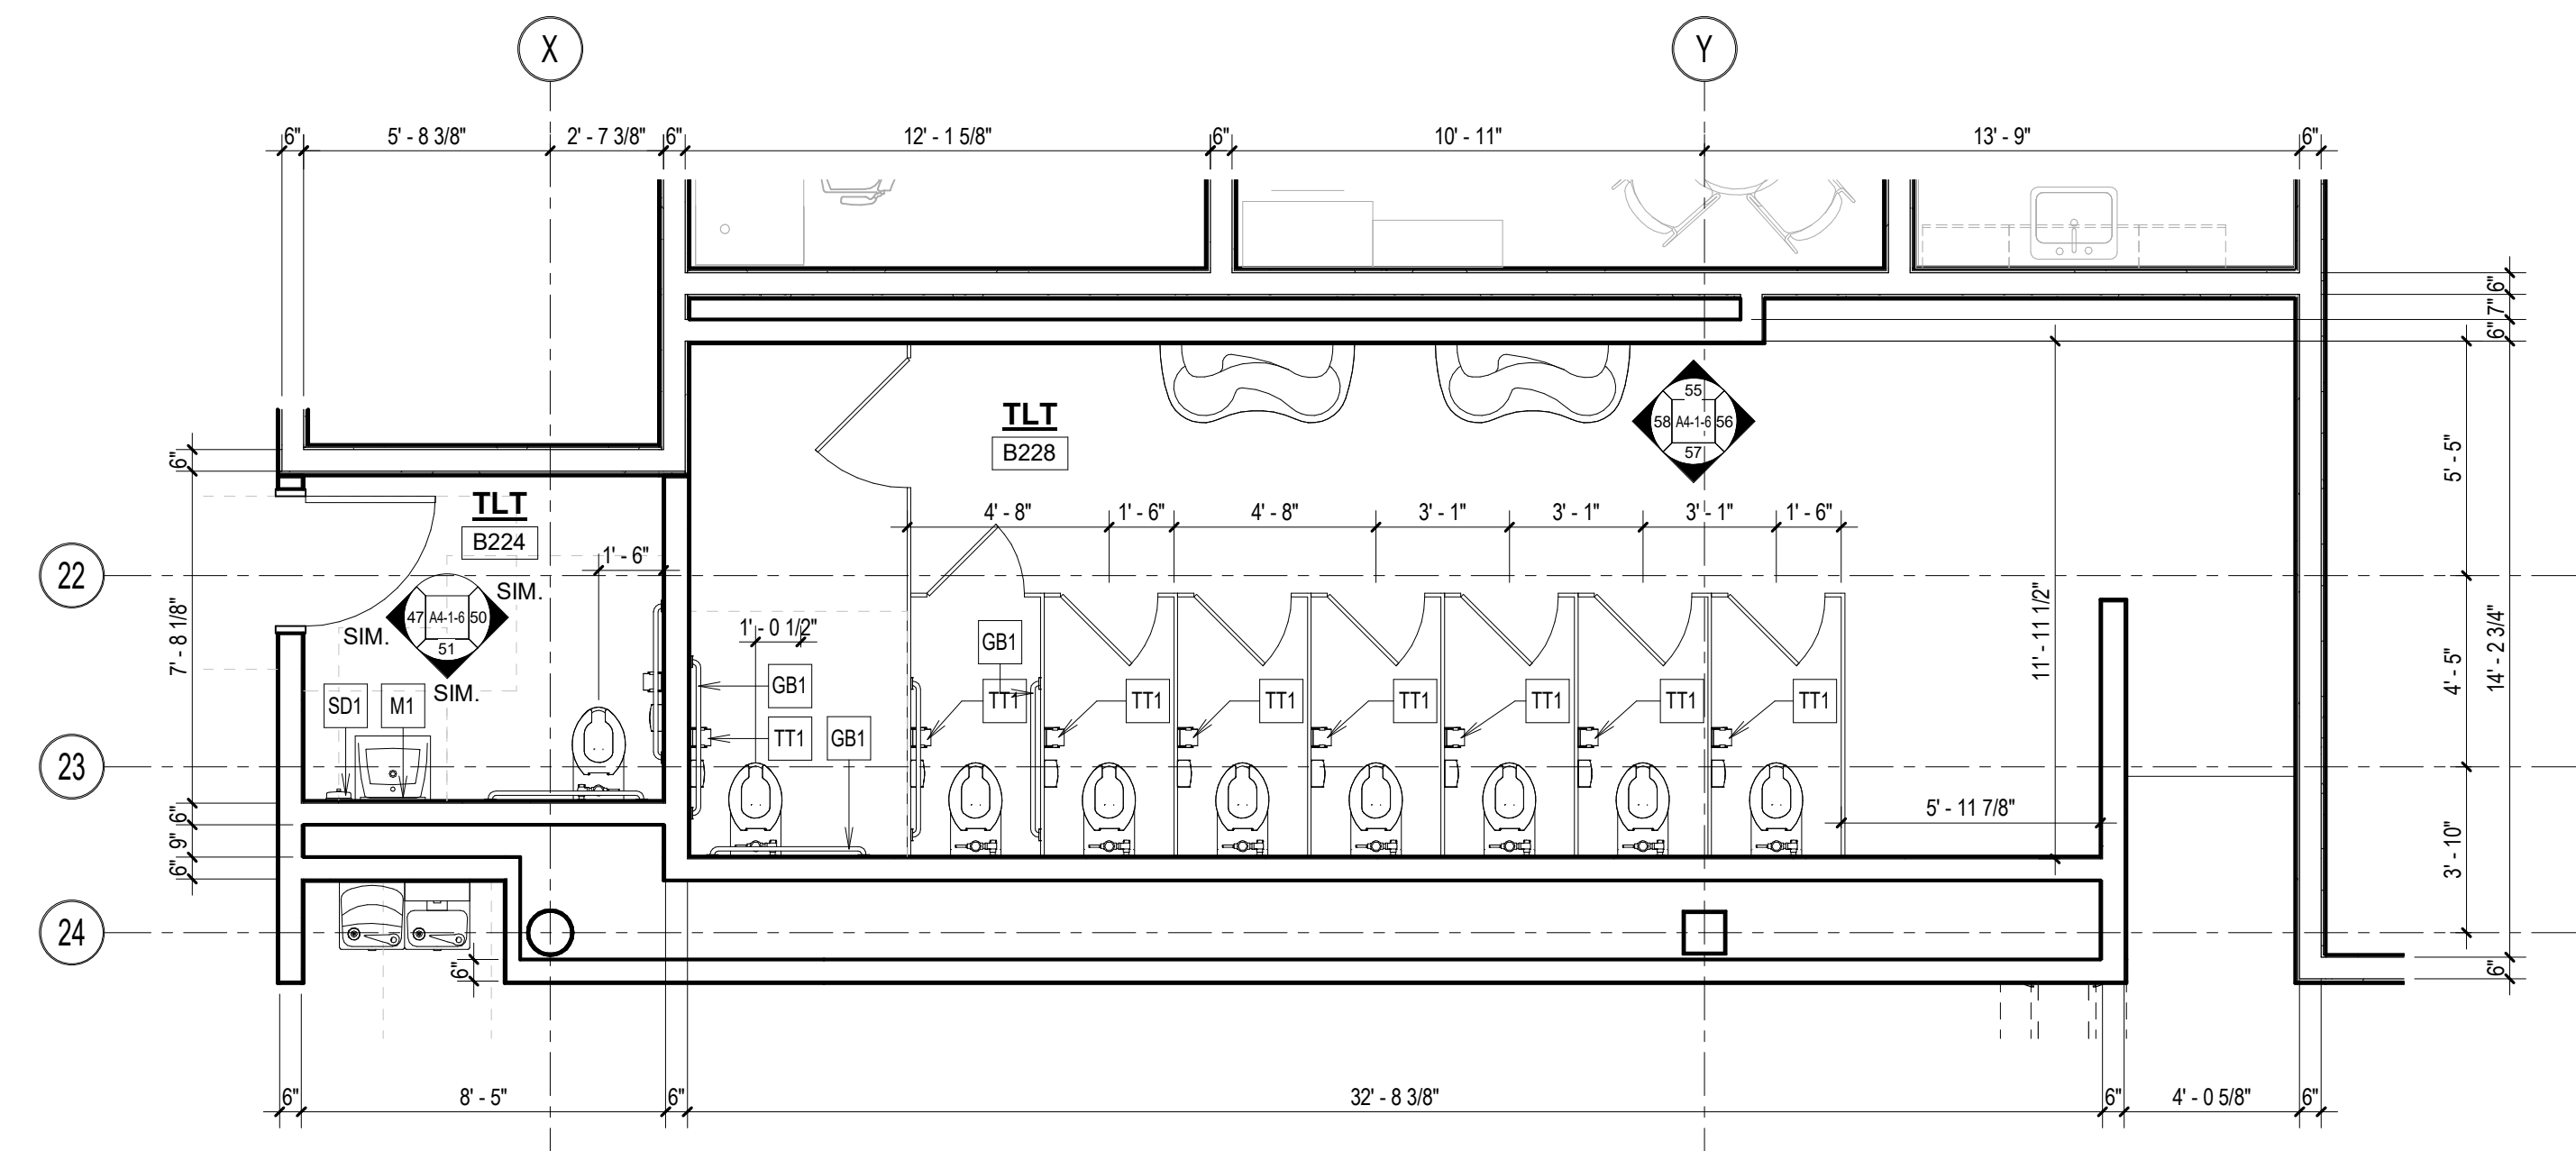


19 TOILET PLAN B228
1/4" = 1'-0"

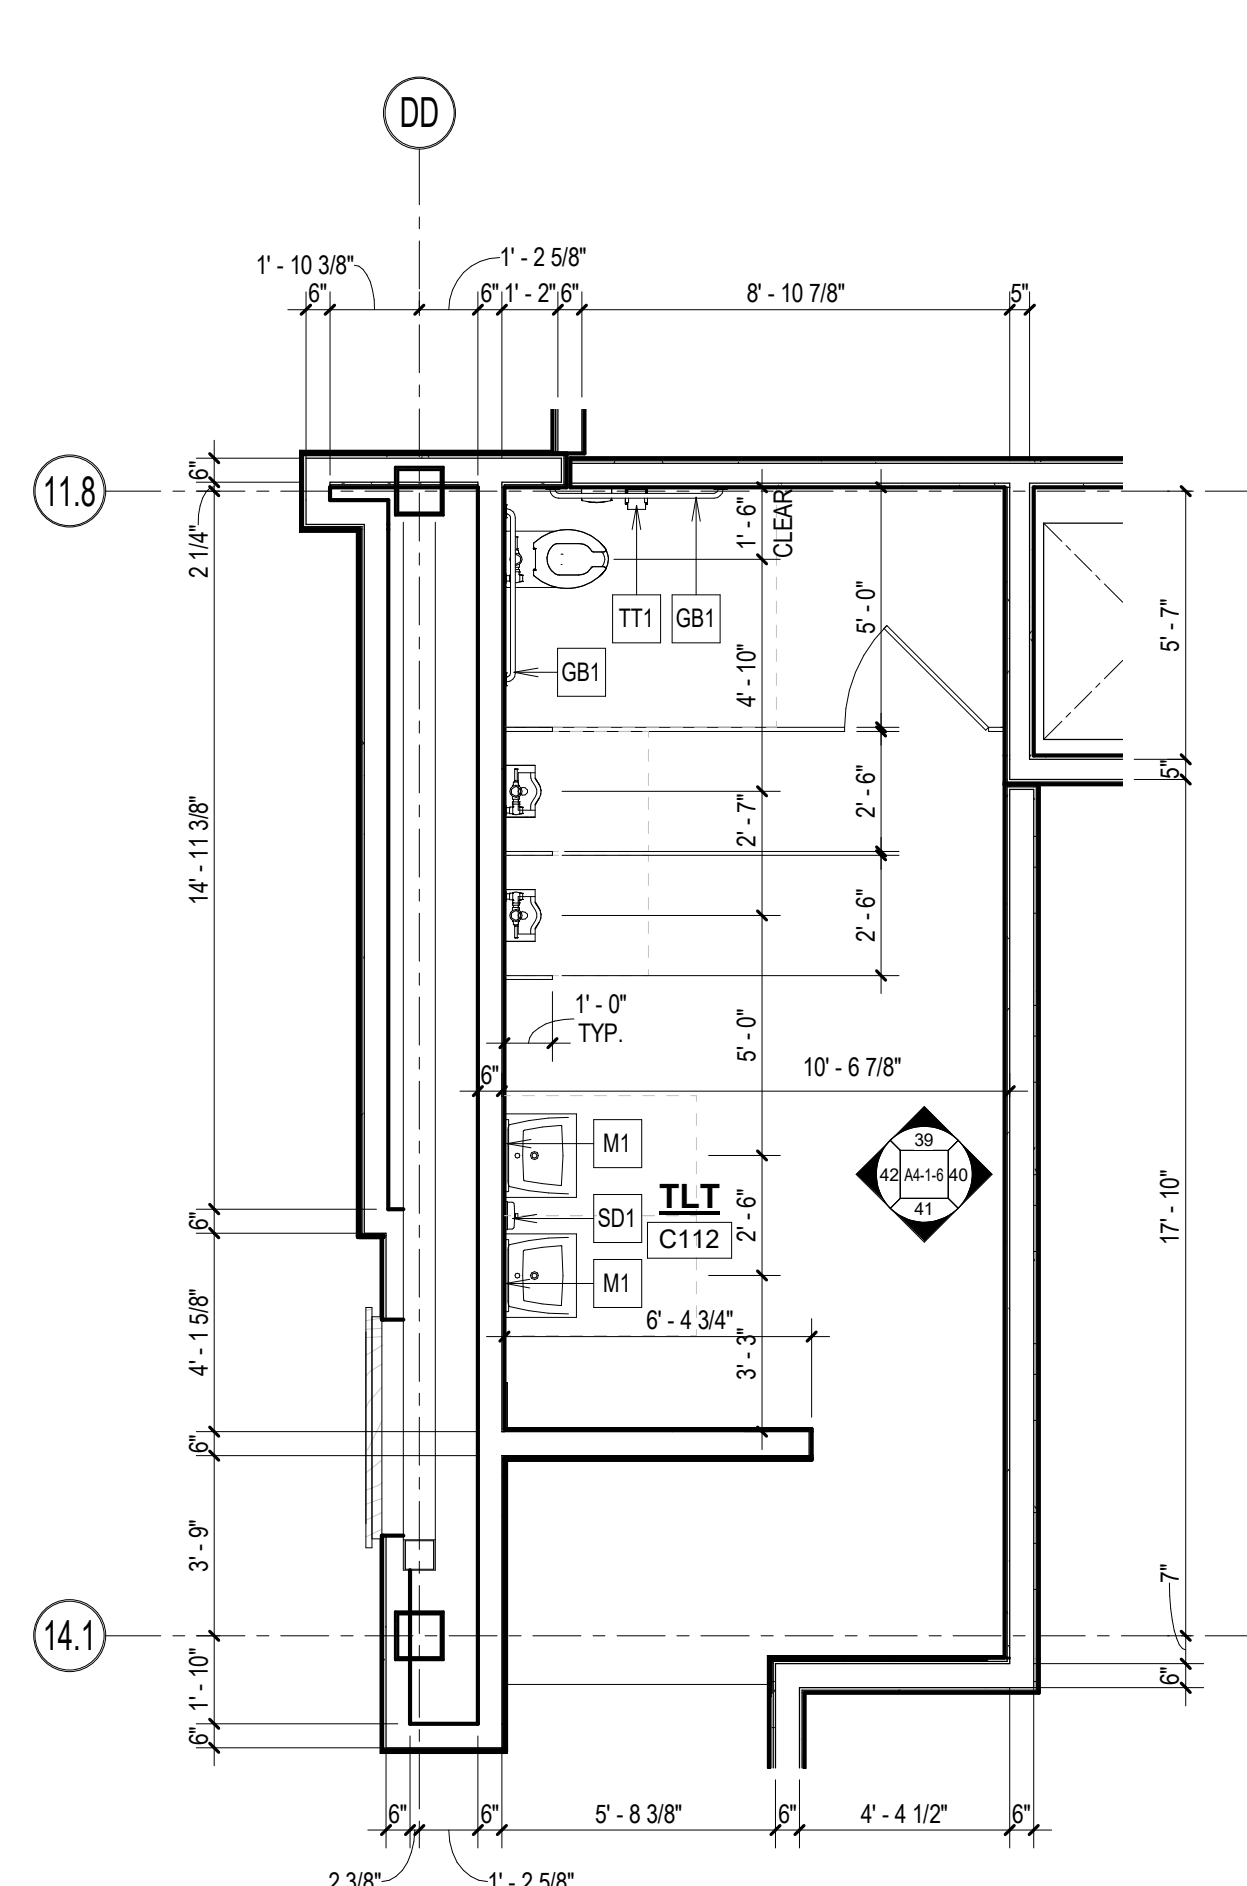


12 TOILET PLAN C112
1/4" = 1'-0"

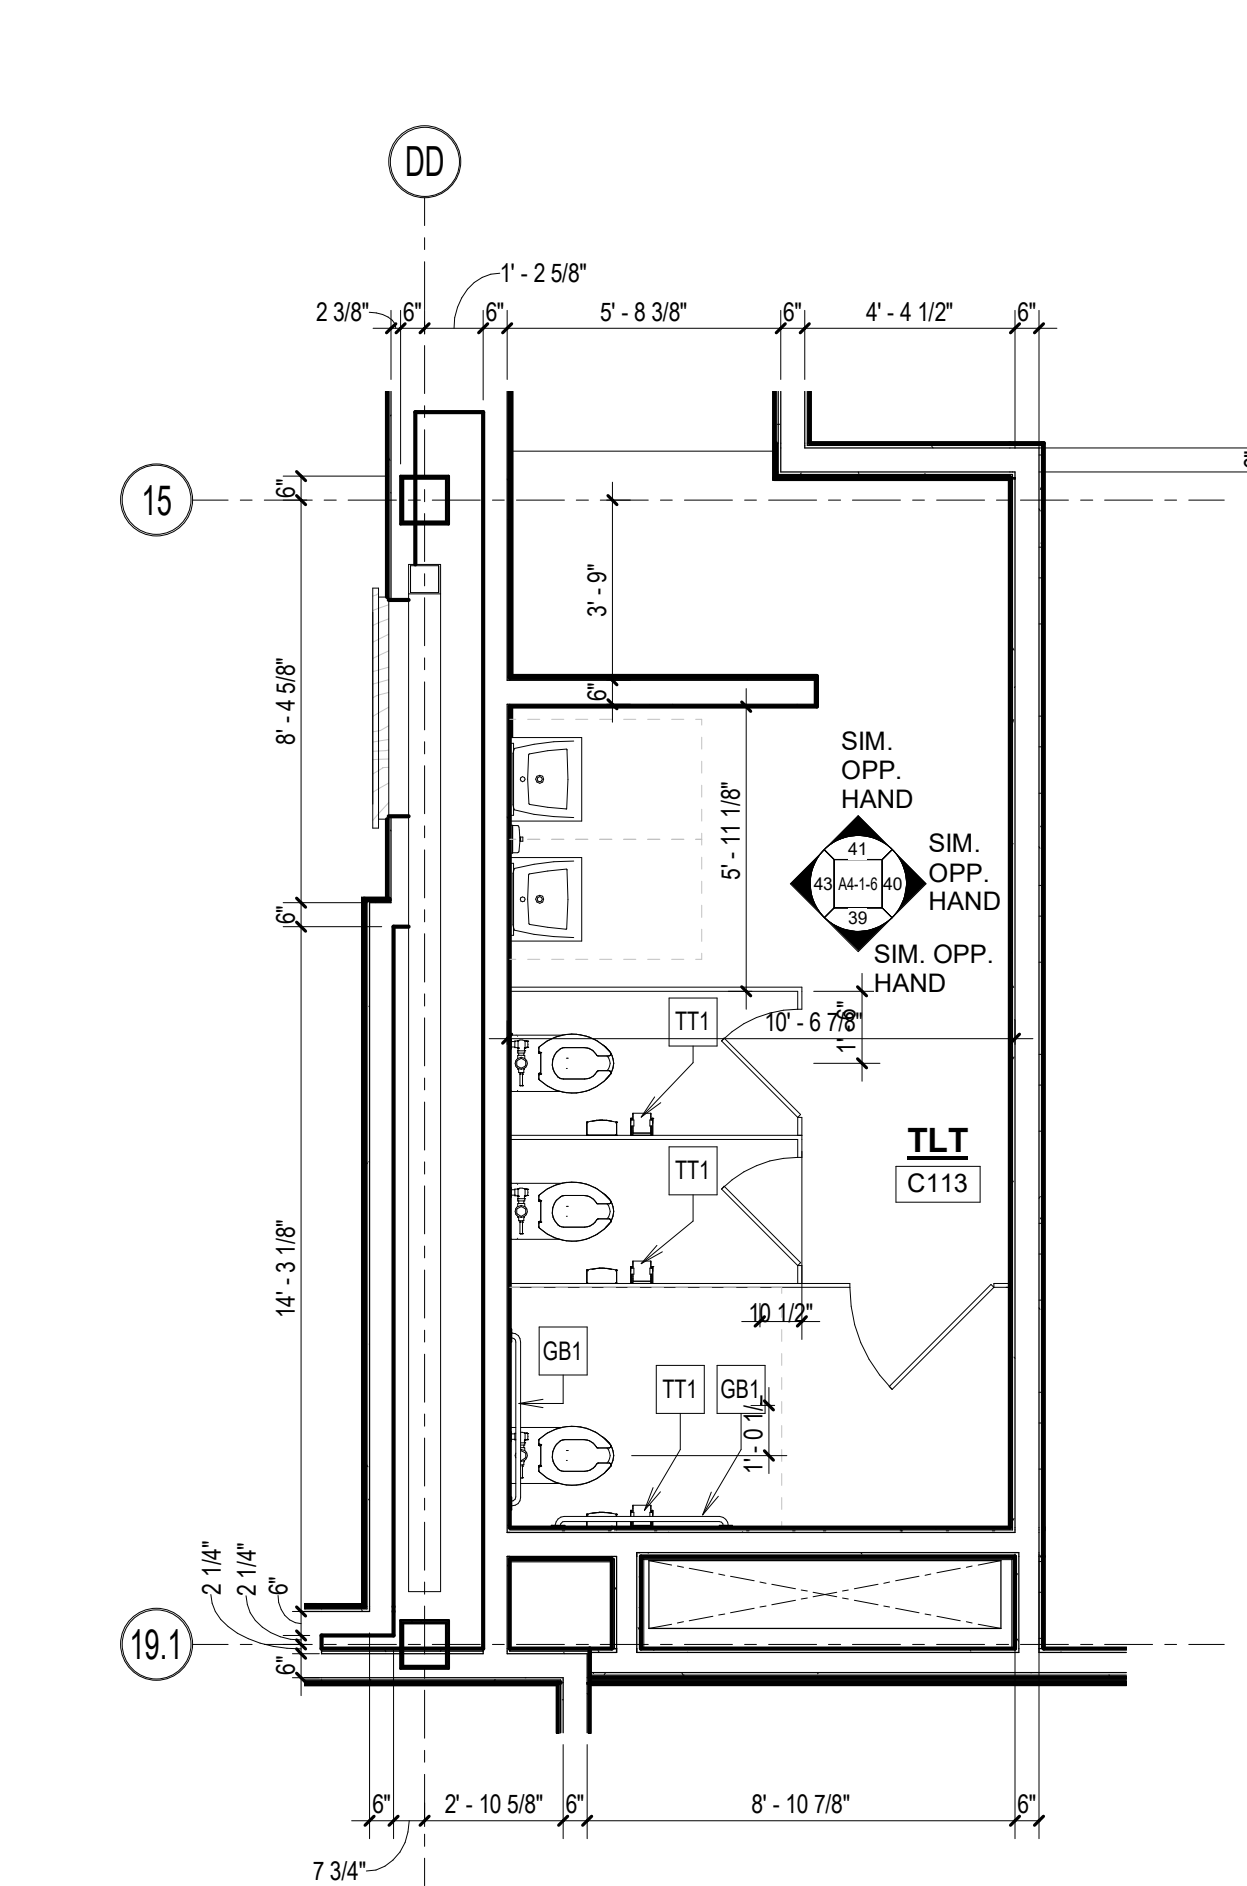


13 TOILET PLAN C113
1/4" = 1'-0"

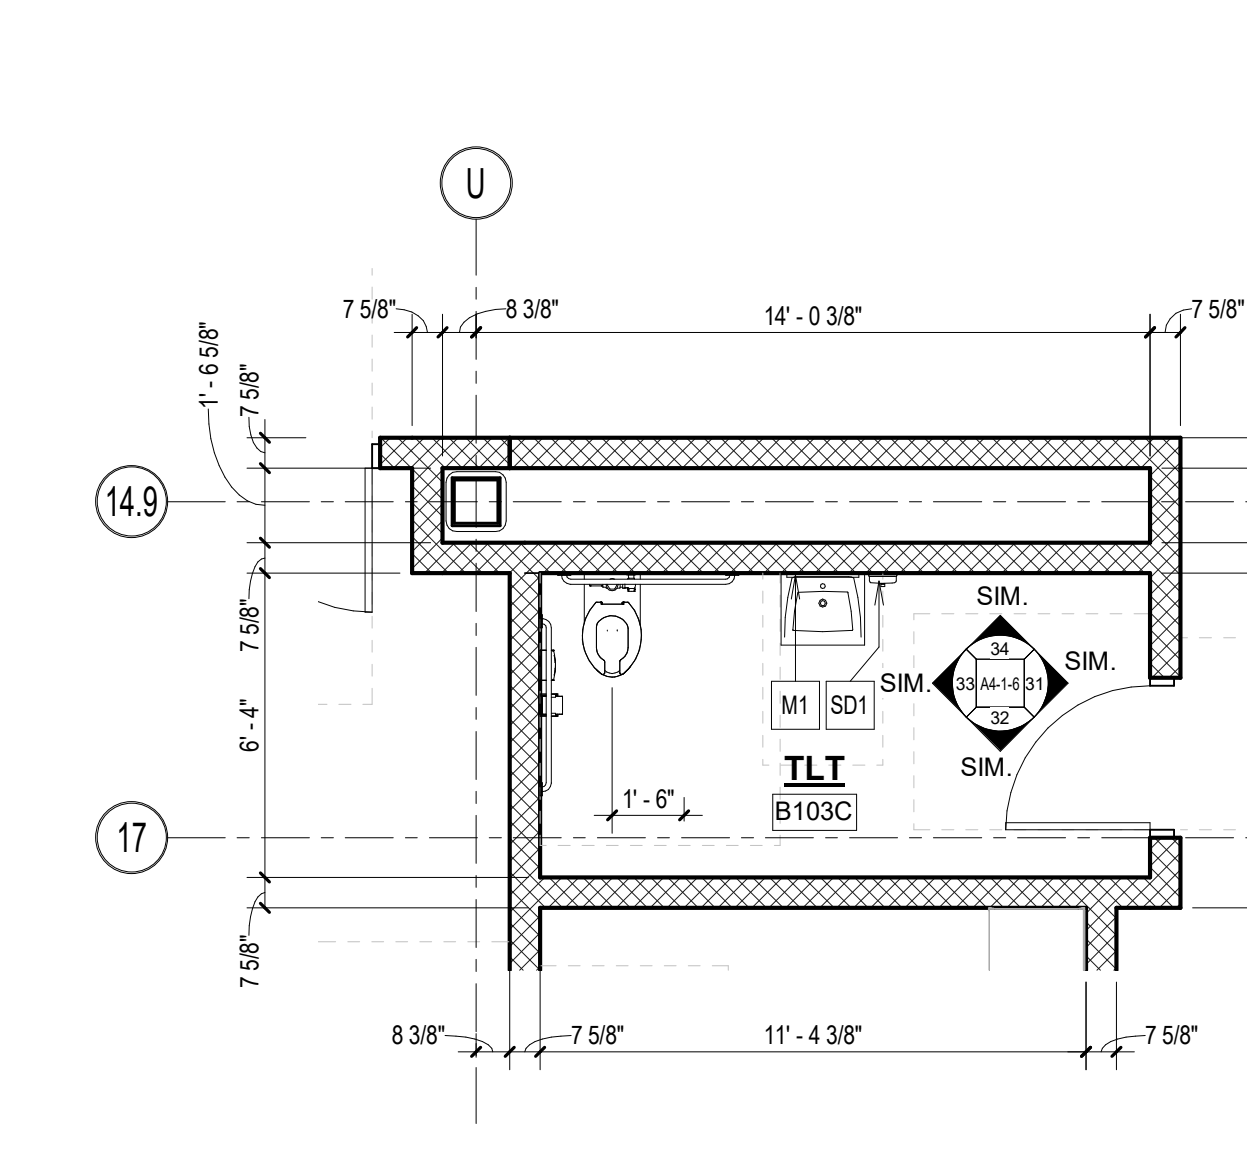


8 TOILET PLAN B103C
1/4" = 1'-0"

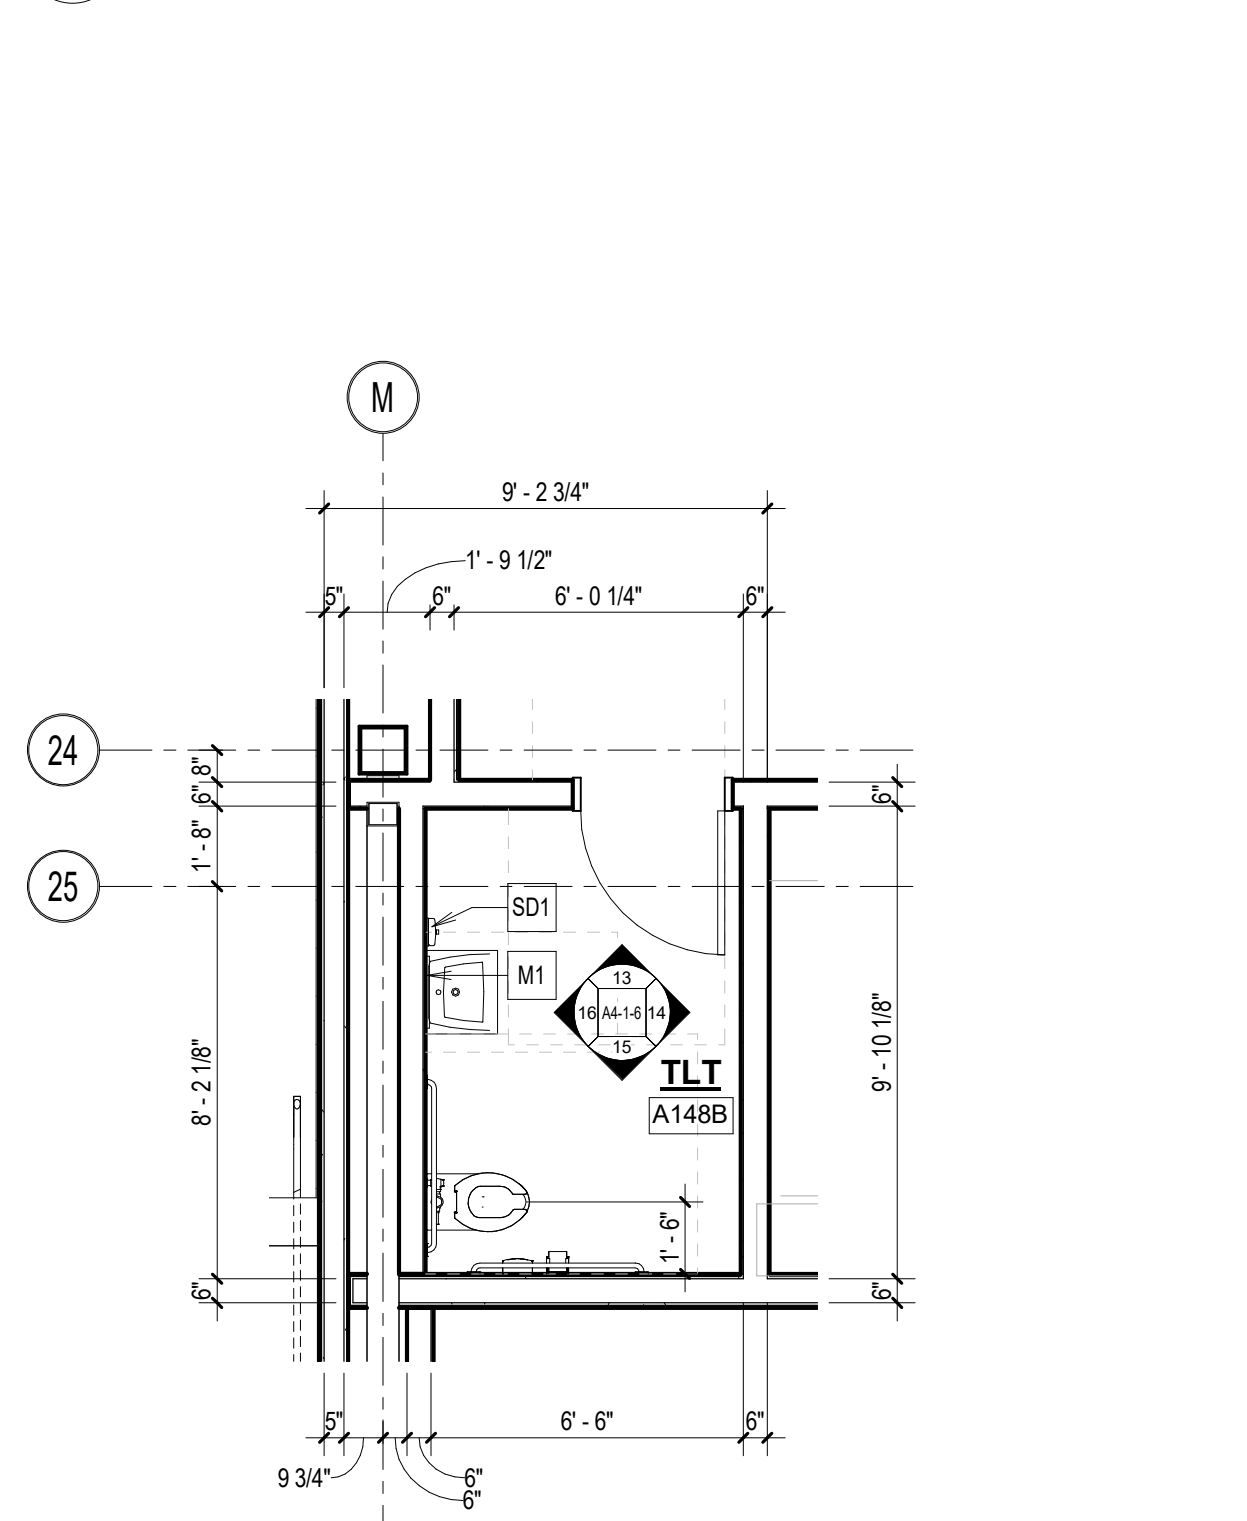


3 TOILET PLAN A148B
1/4" = 1'-0"

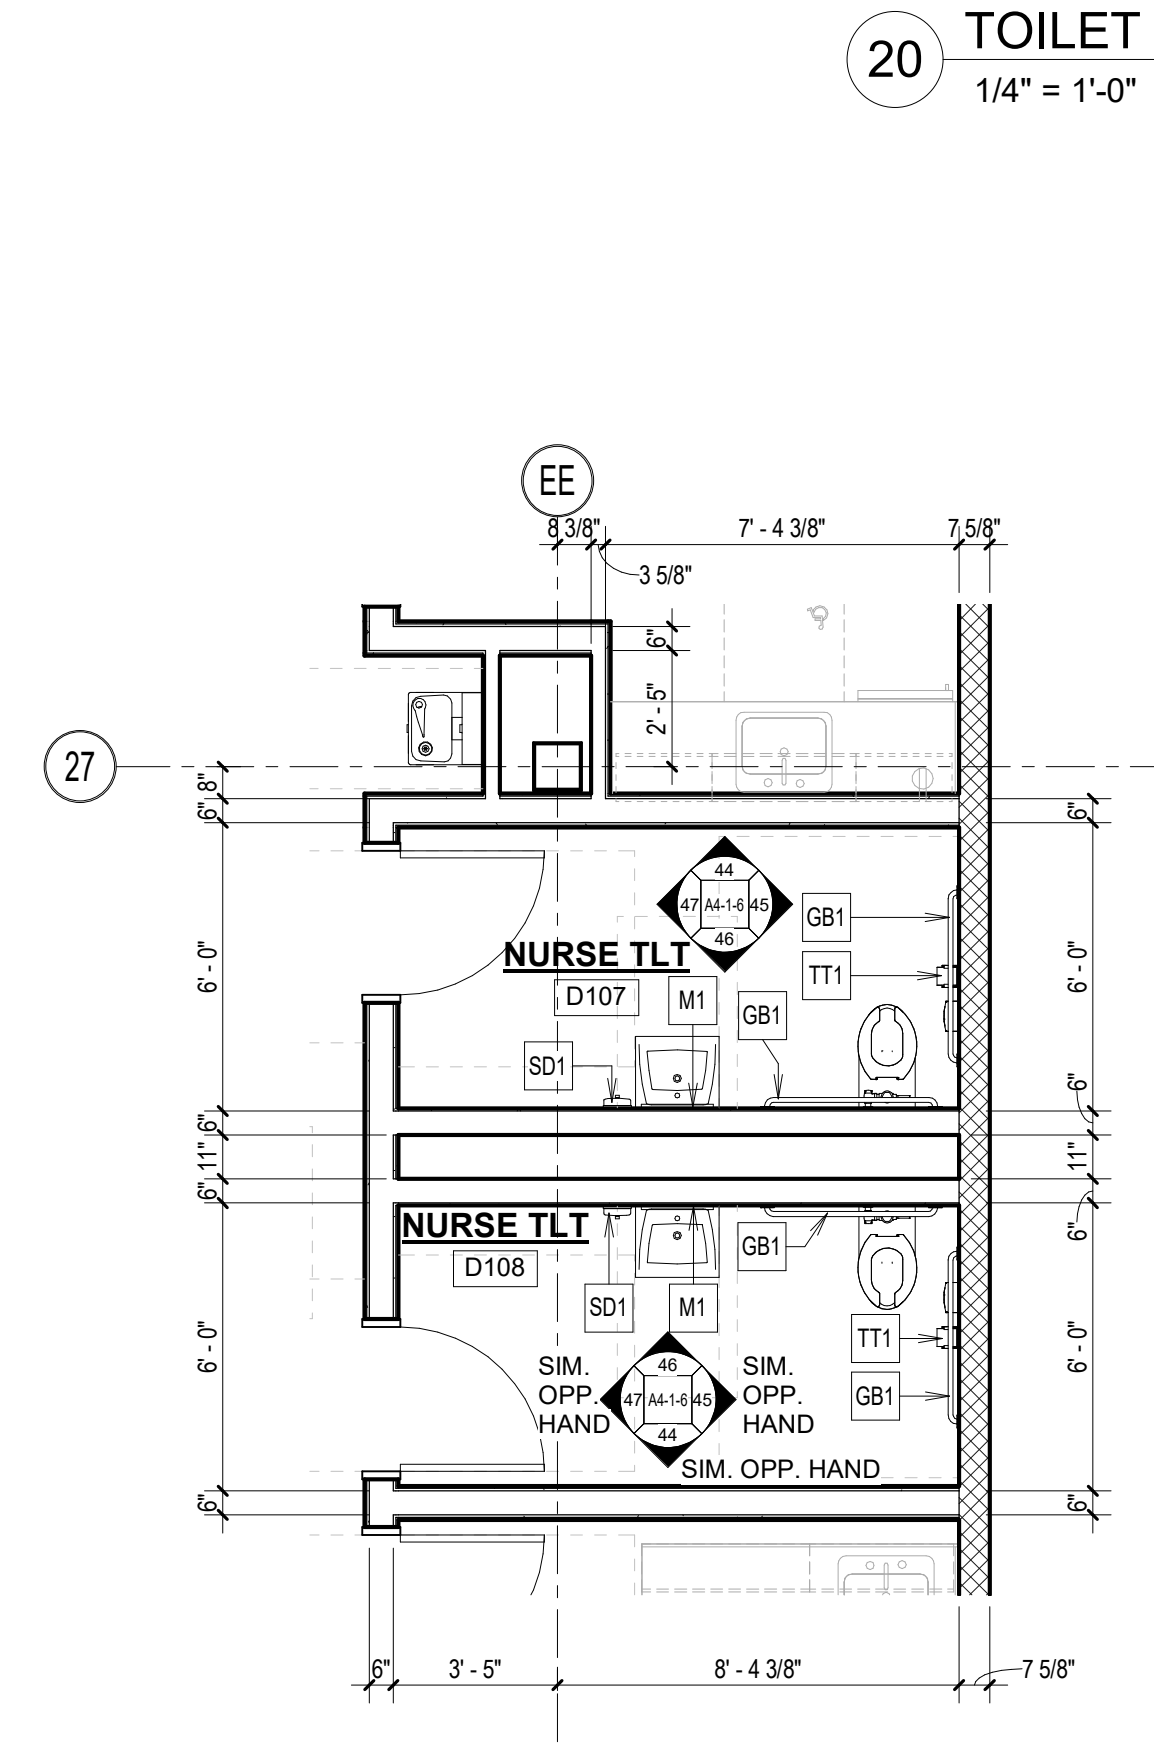


14 TOILET PLAN - NURSE TLT D107 AND D108
1/4" = 1'-0"

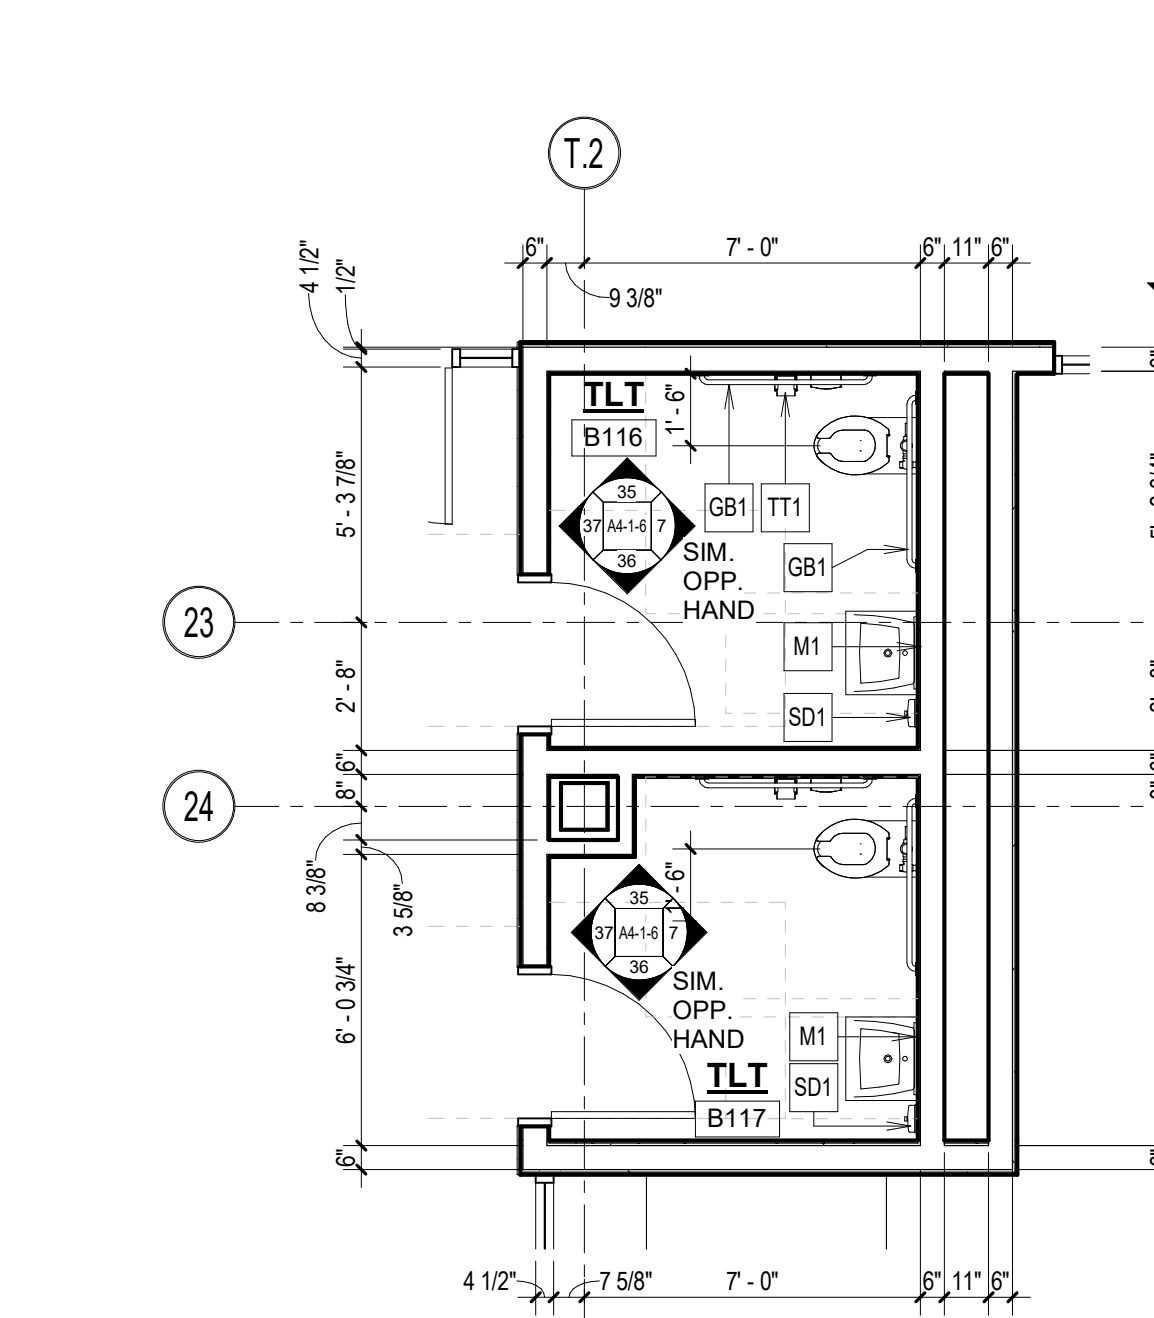


9 TOILET PLAN B116 AND B117
1/4" = 1'-0"

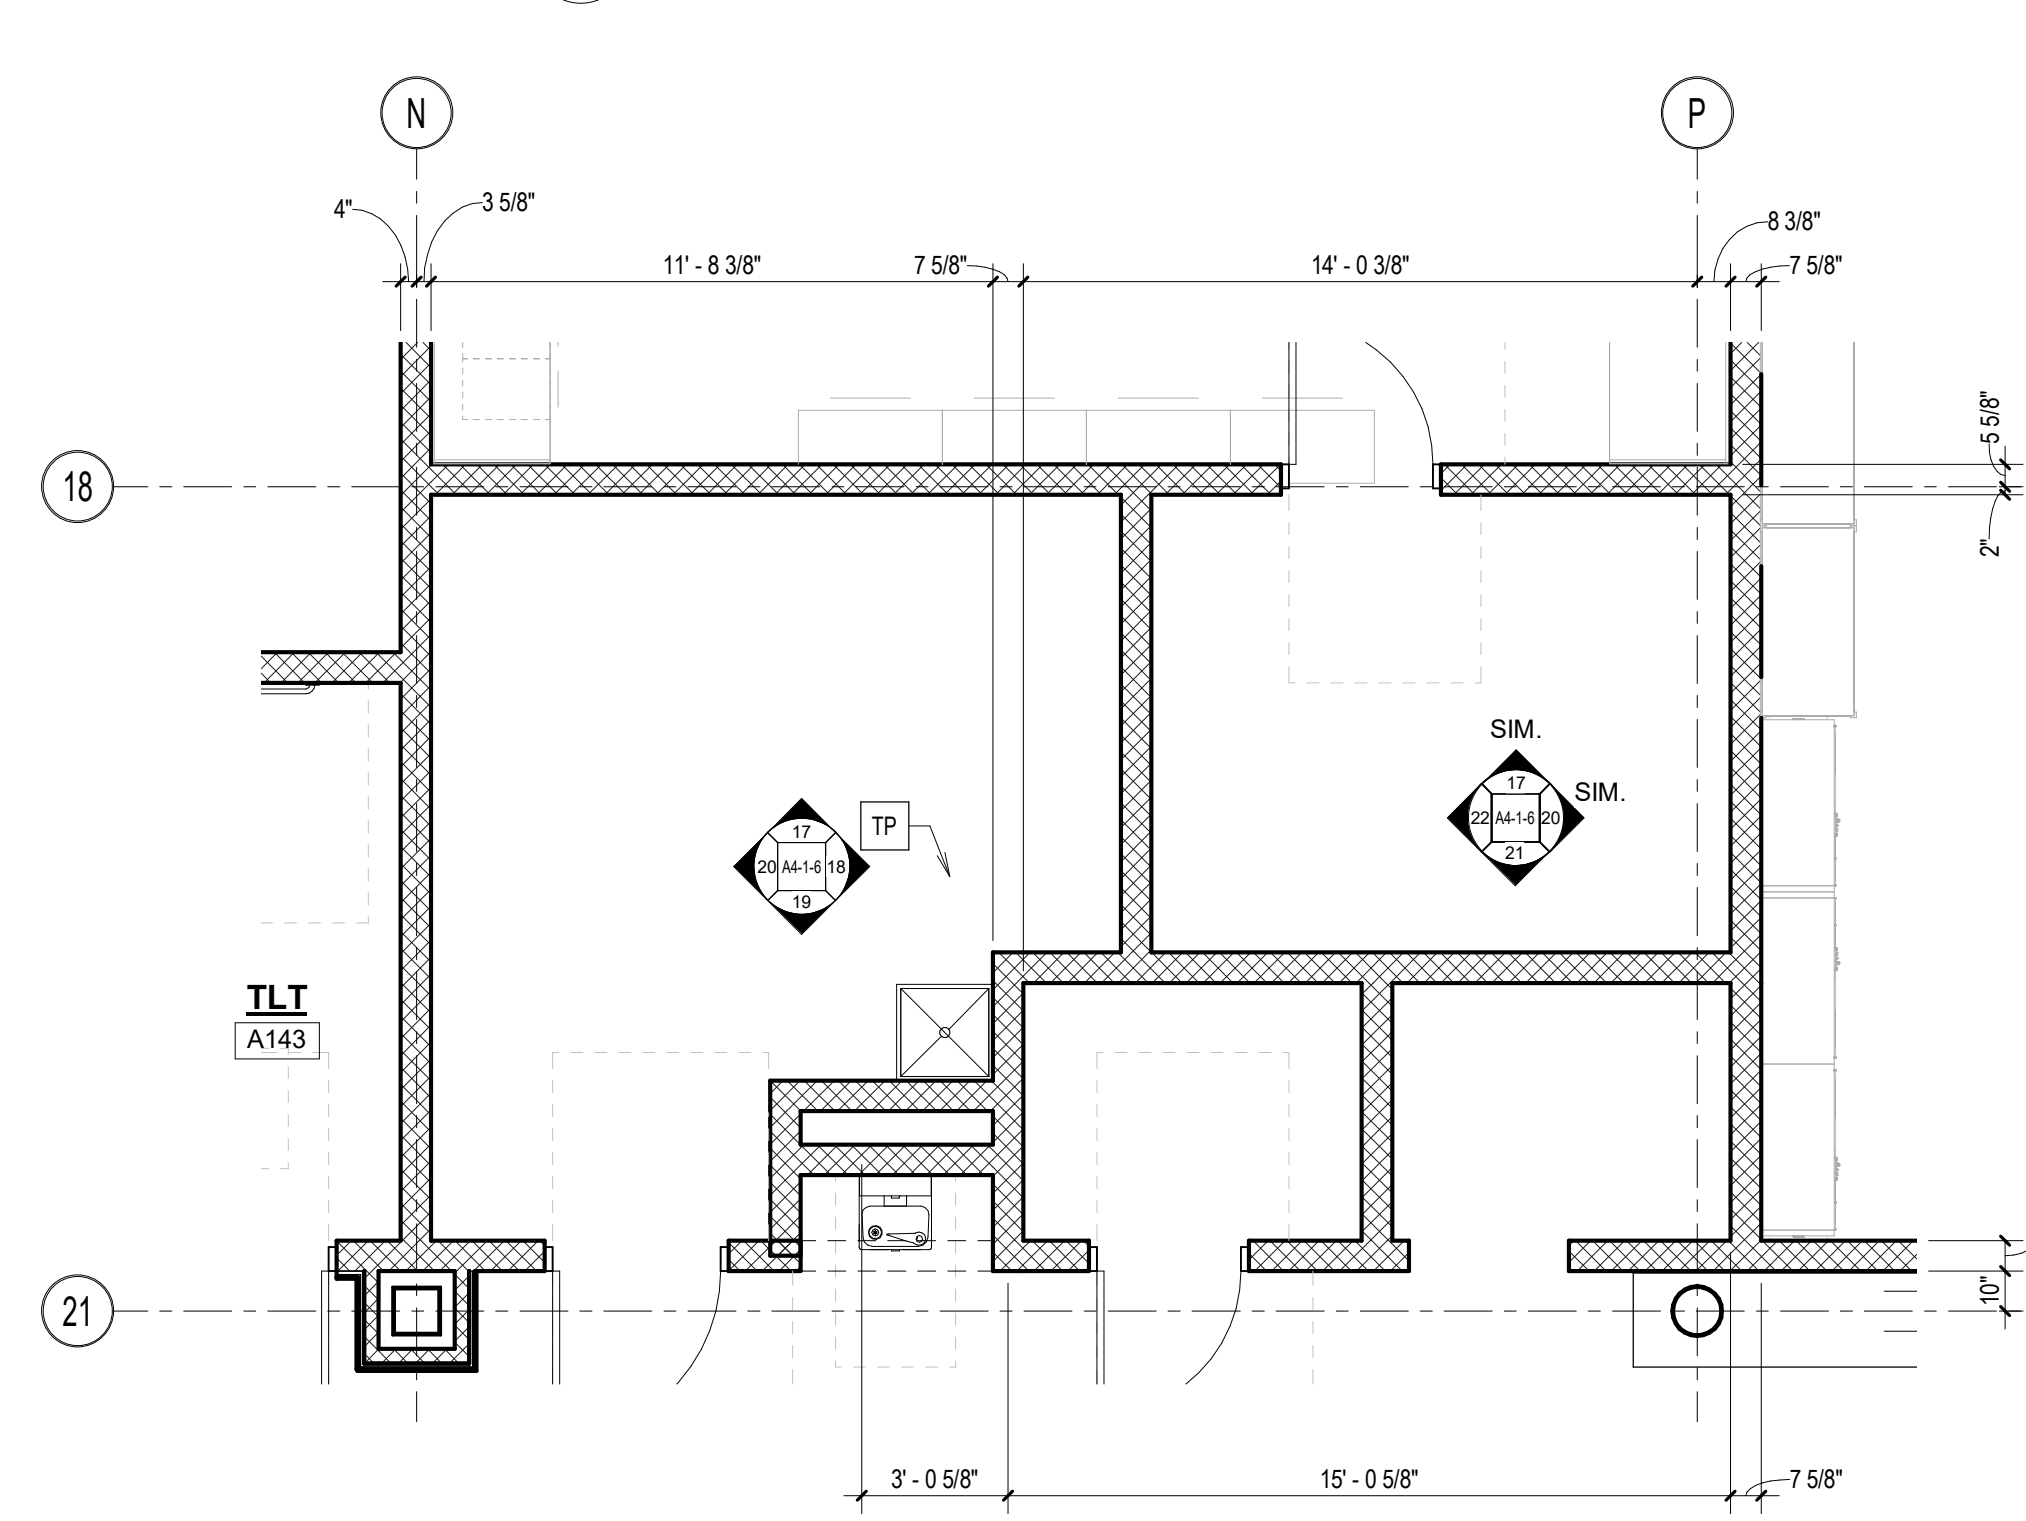


4 TOILET PLAN A142 AND A143
1/4" = 1'-0"

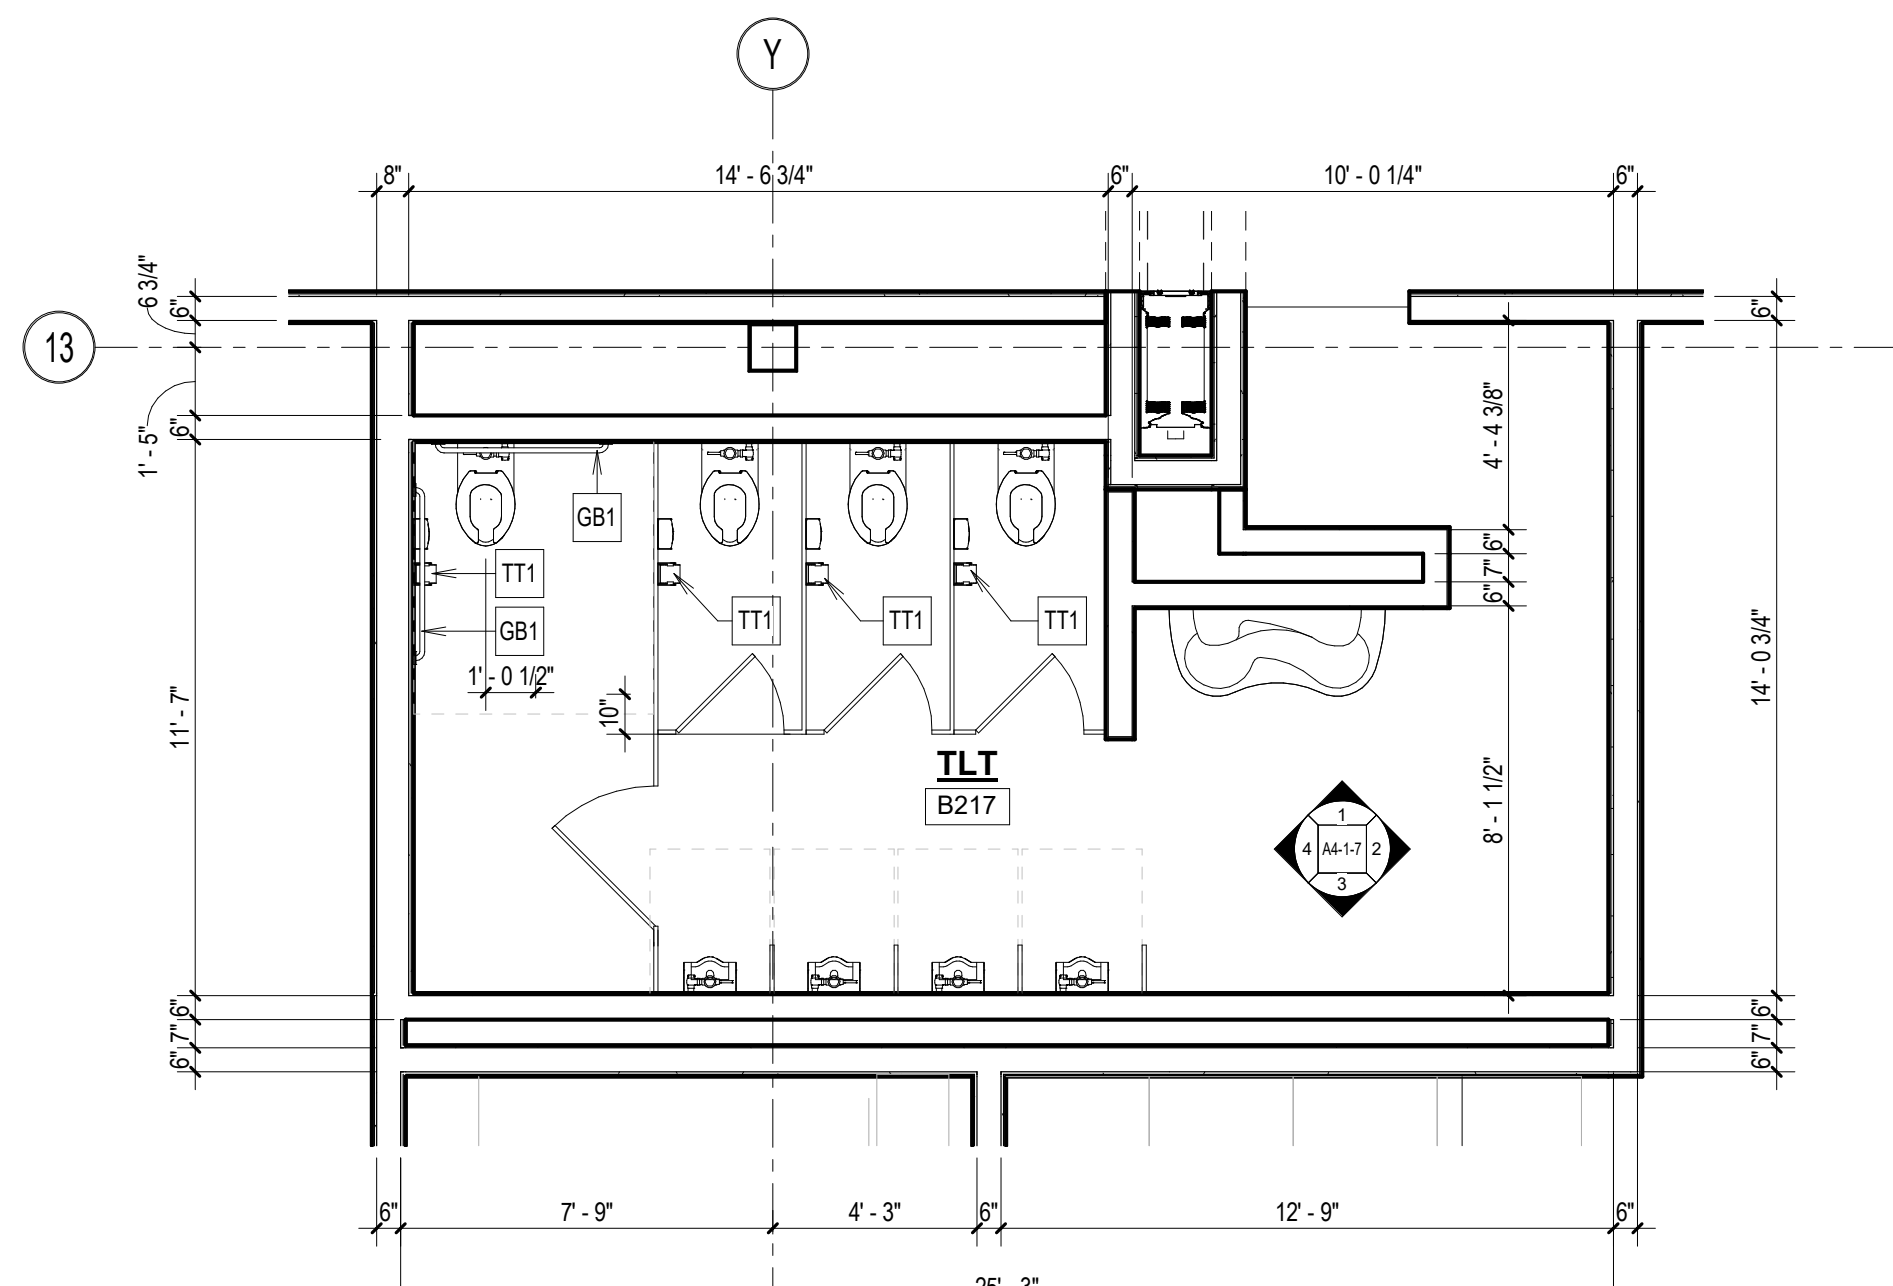


20 TOILET PLAN B217
1/4" = 1'-0"

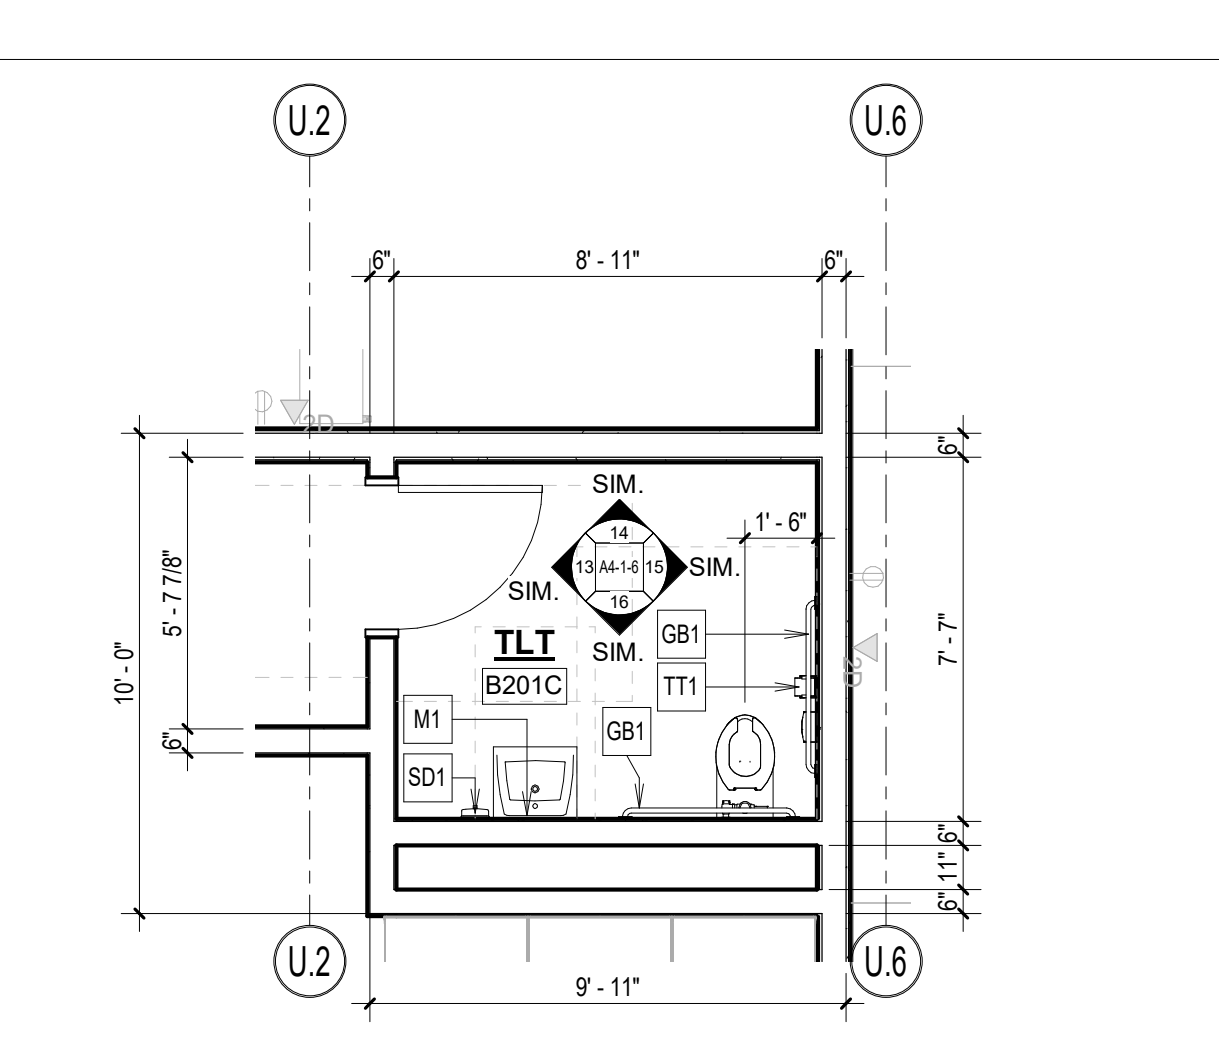


16 TOILET PLAN B201C
1/4" = 1'-0"

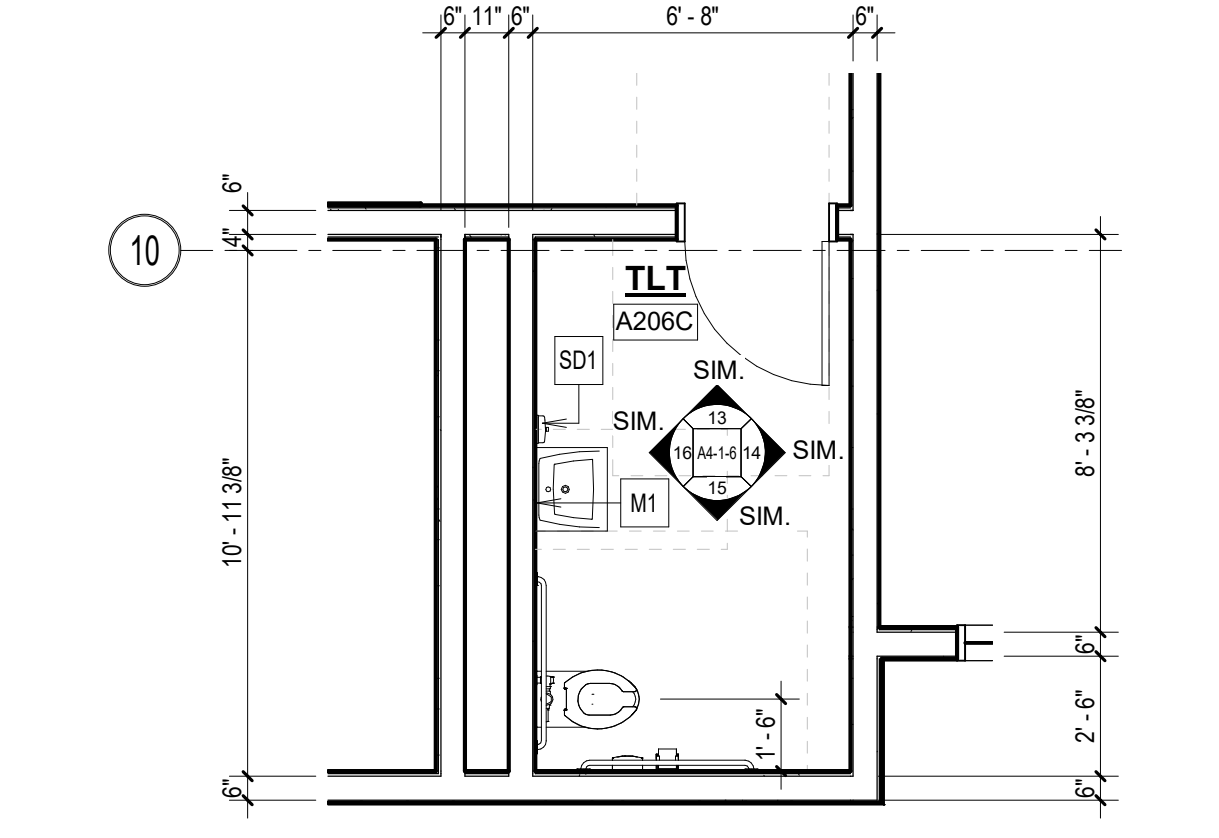

15 TOILET PLAN A206C
1/4" = 1'-0"

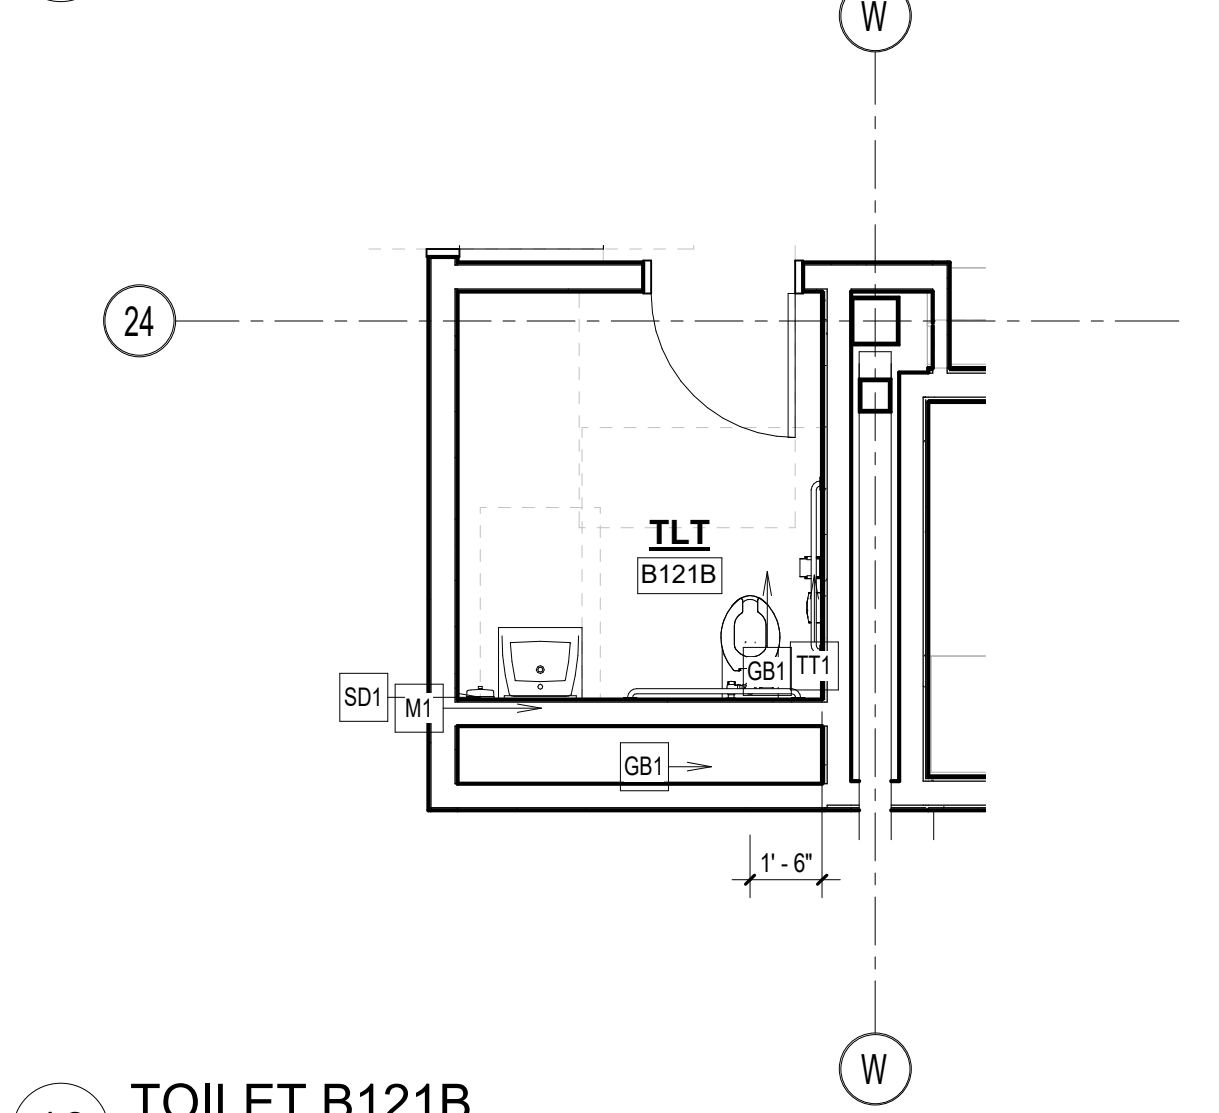

10 TOILET B121B
1/4" = 1'-0"

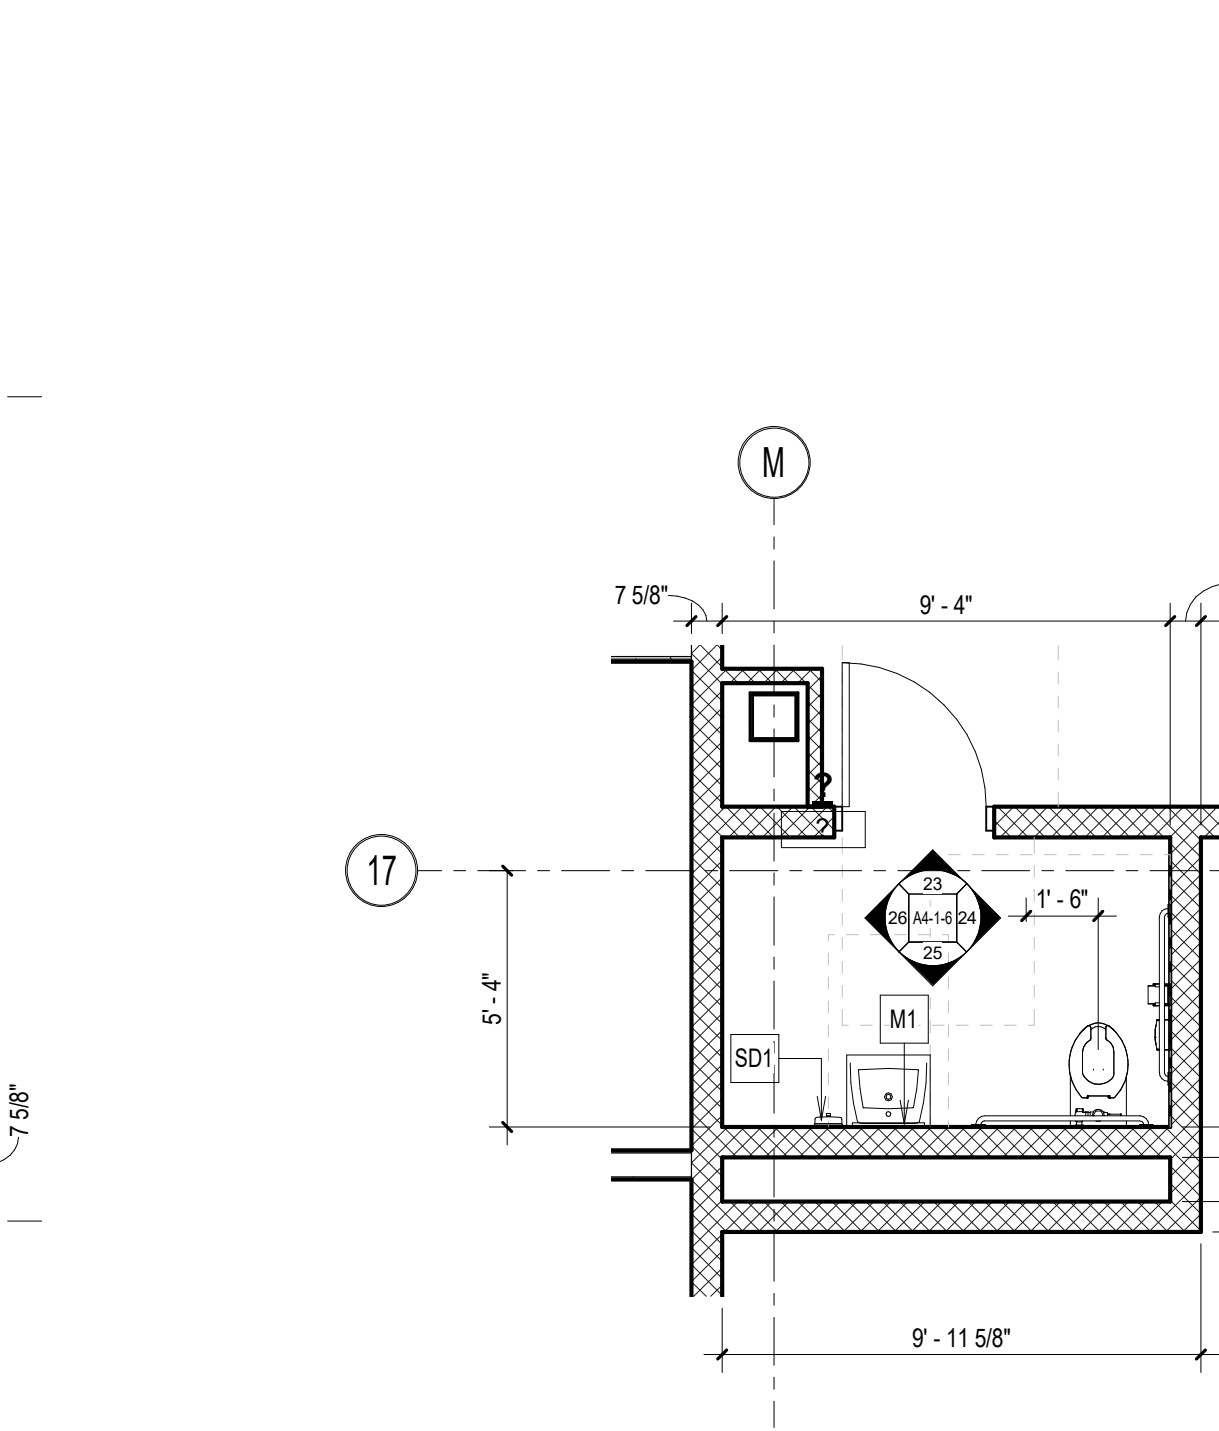


5 TOILET PLAN A141H
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

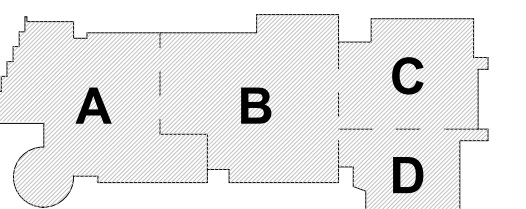


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



TOILET PLANS

Scale: 1/4" = 1'-0"










Job No.: 20202


Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

A4-1-2

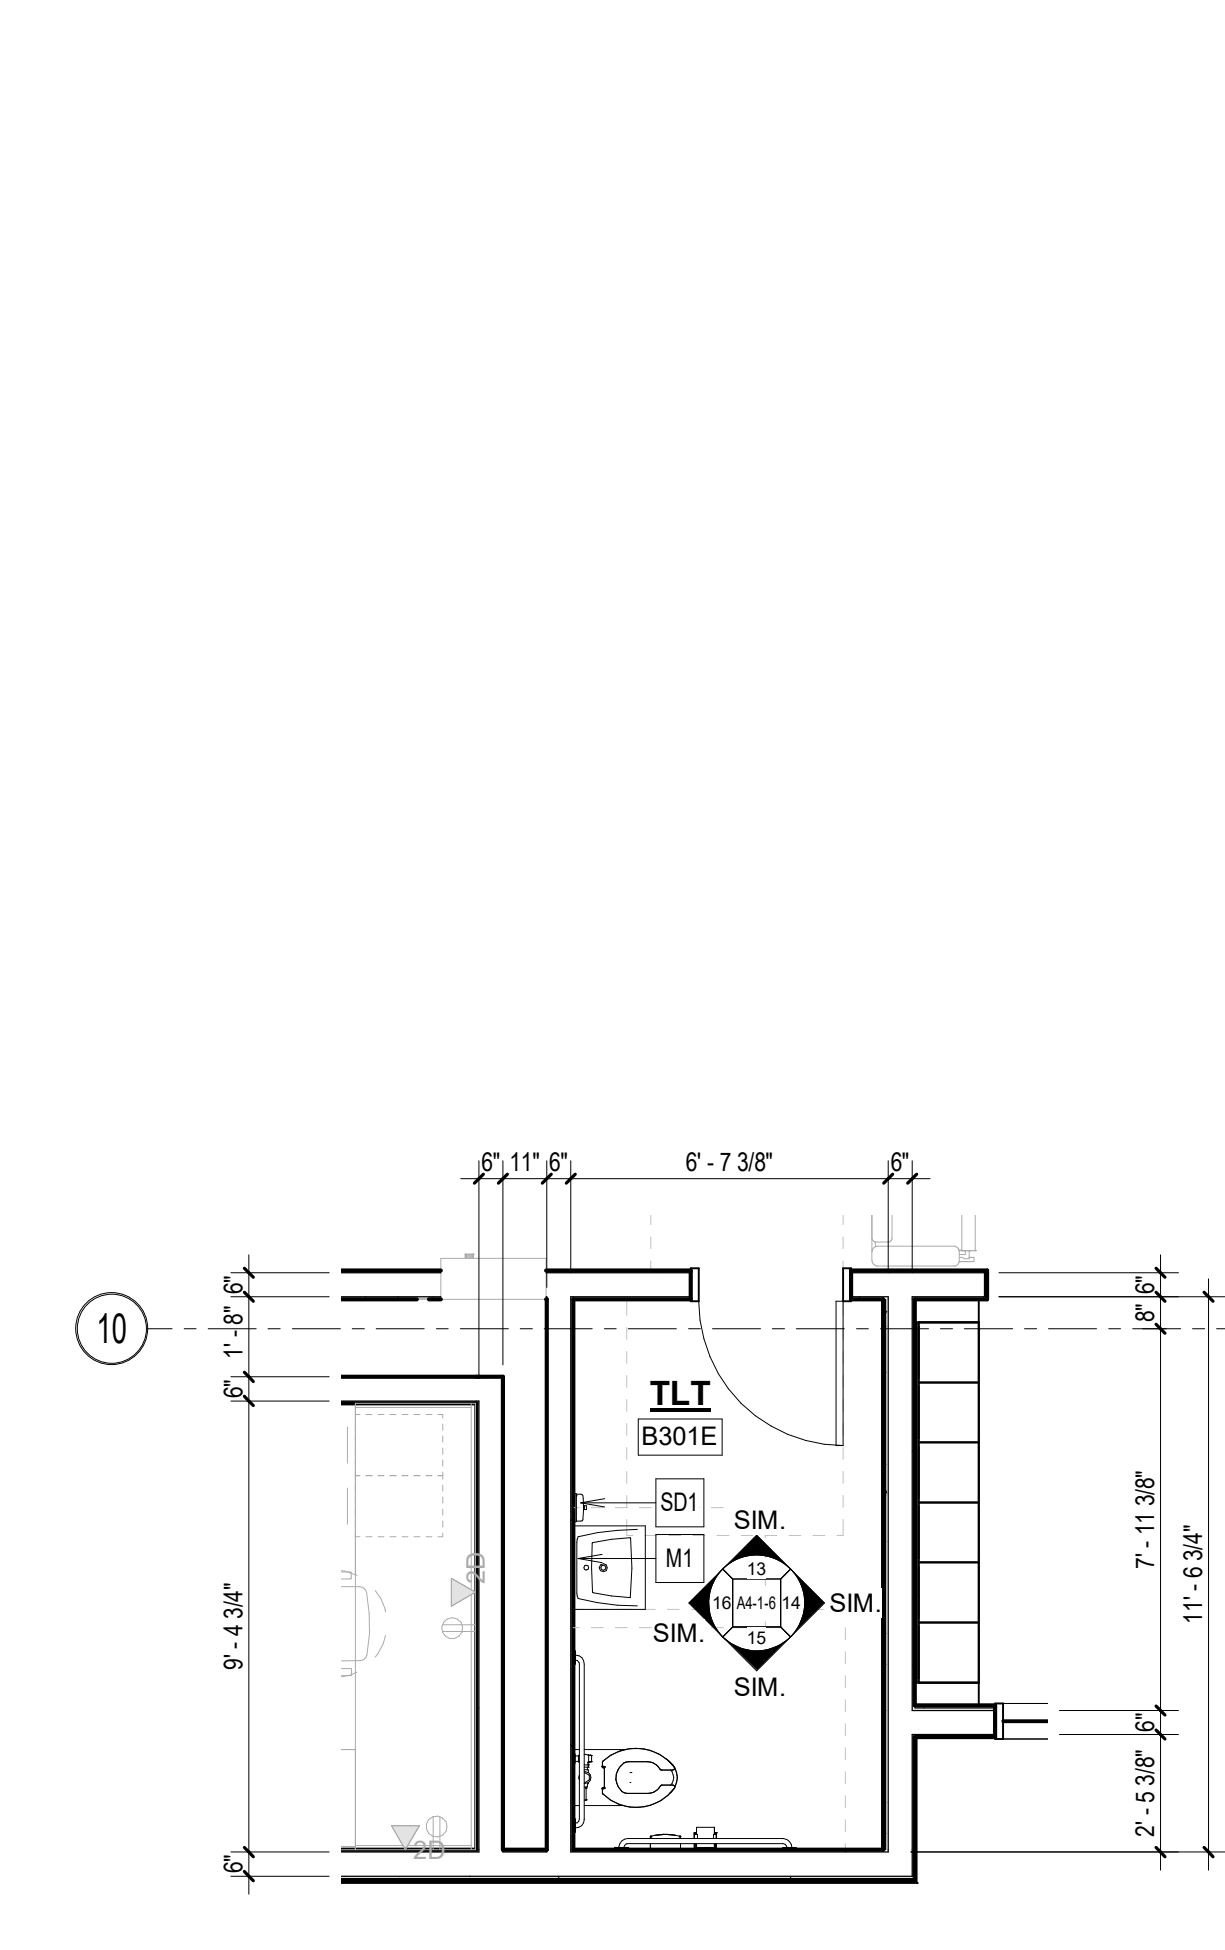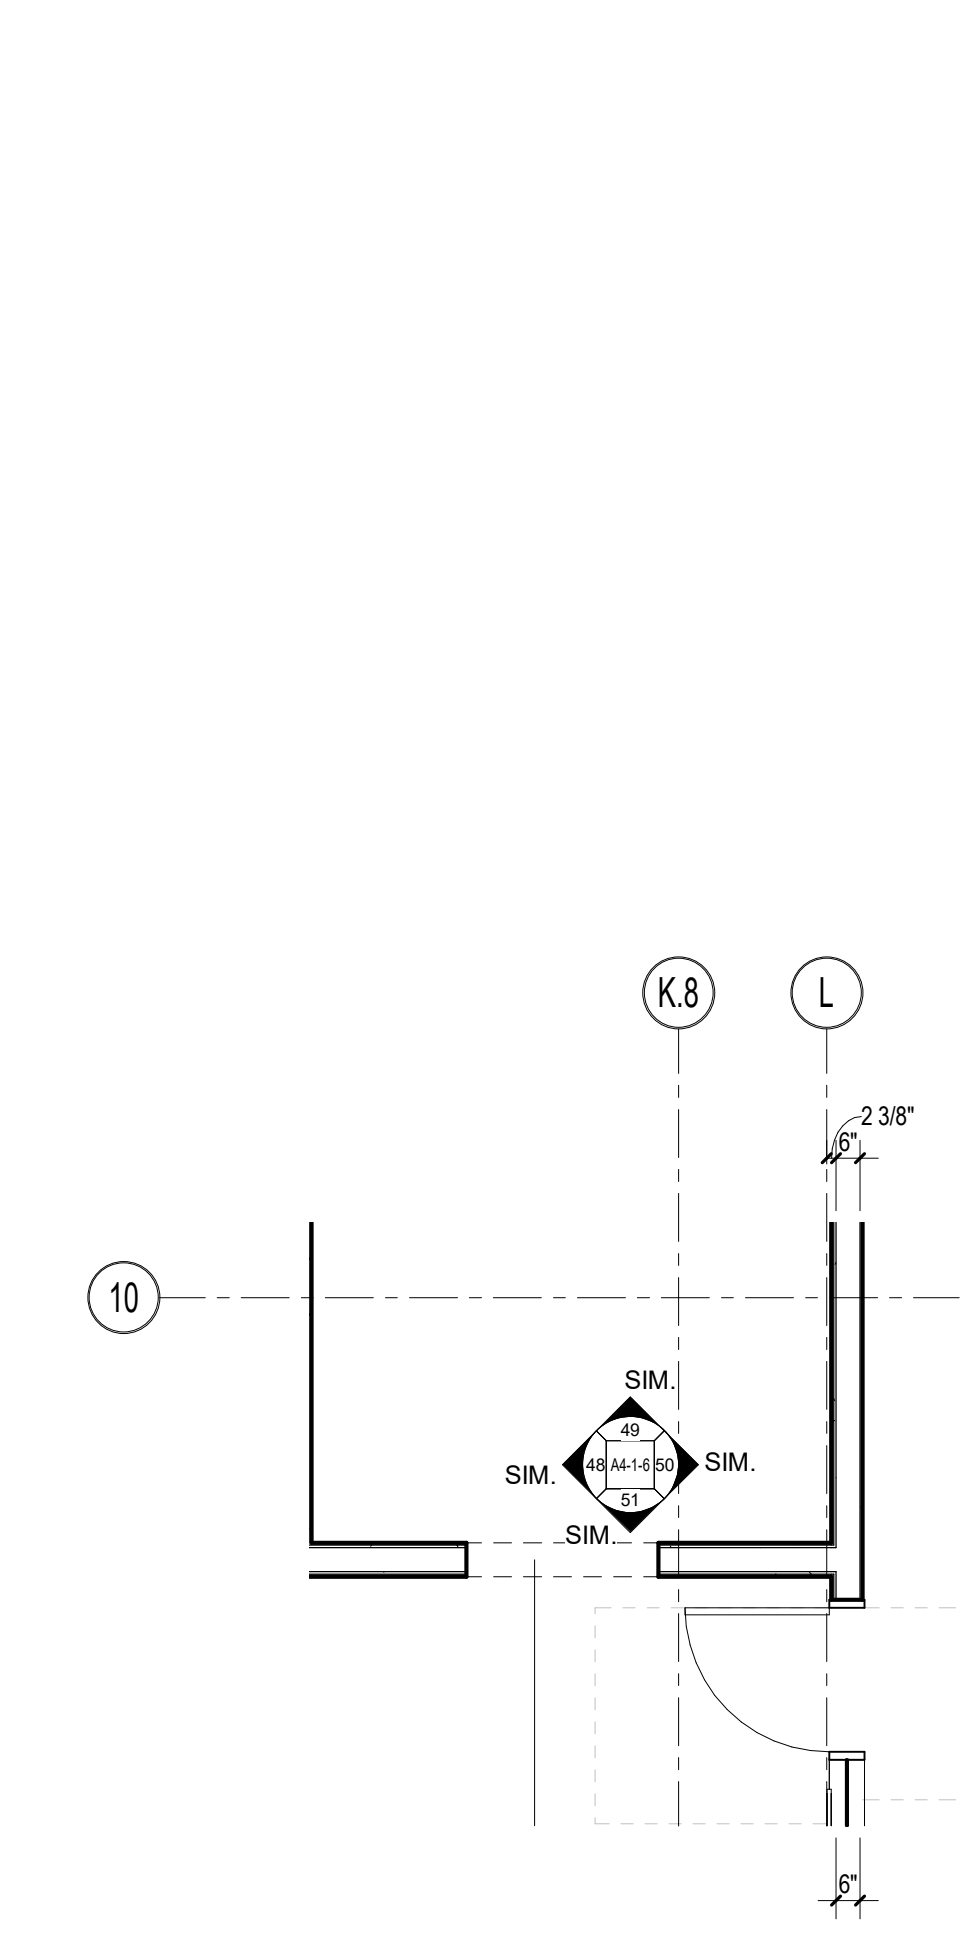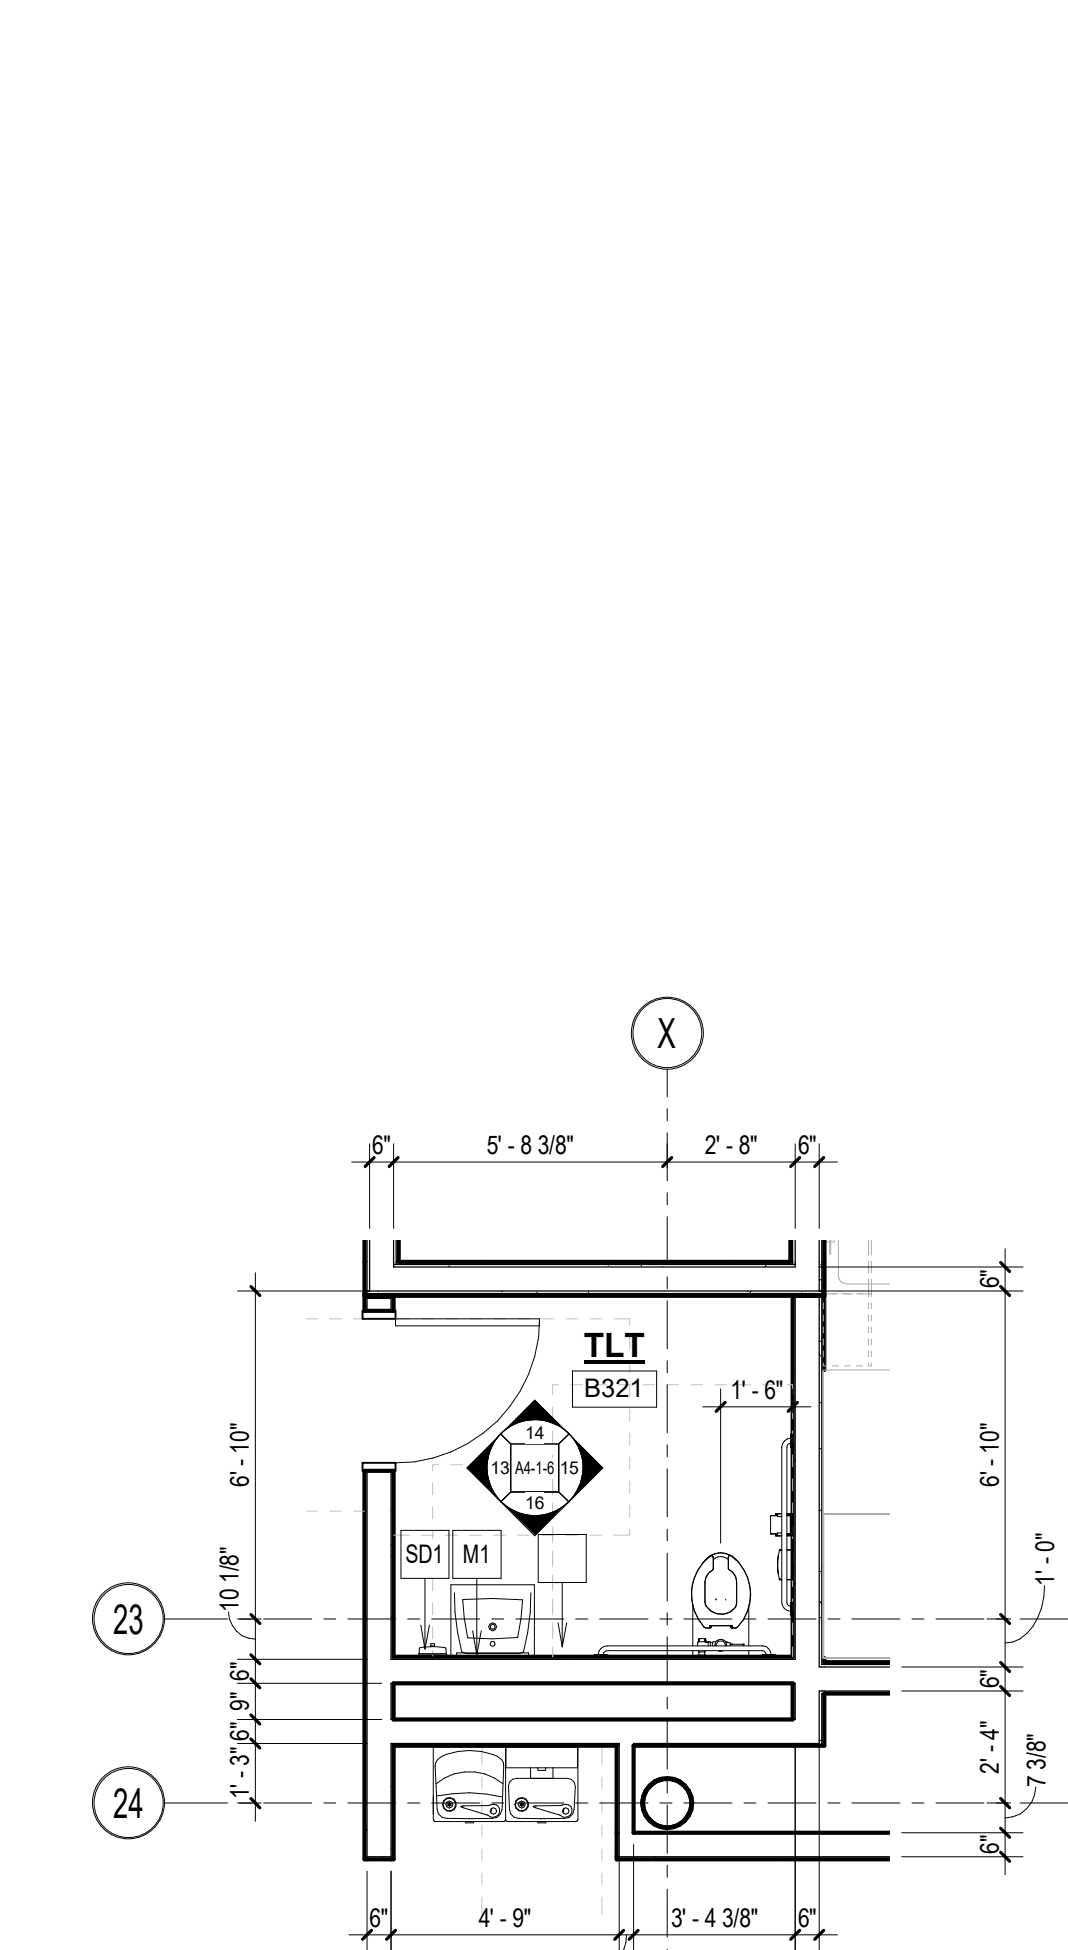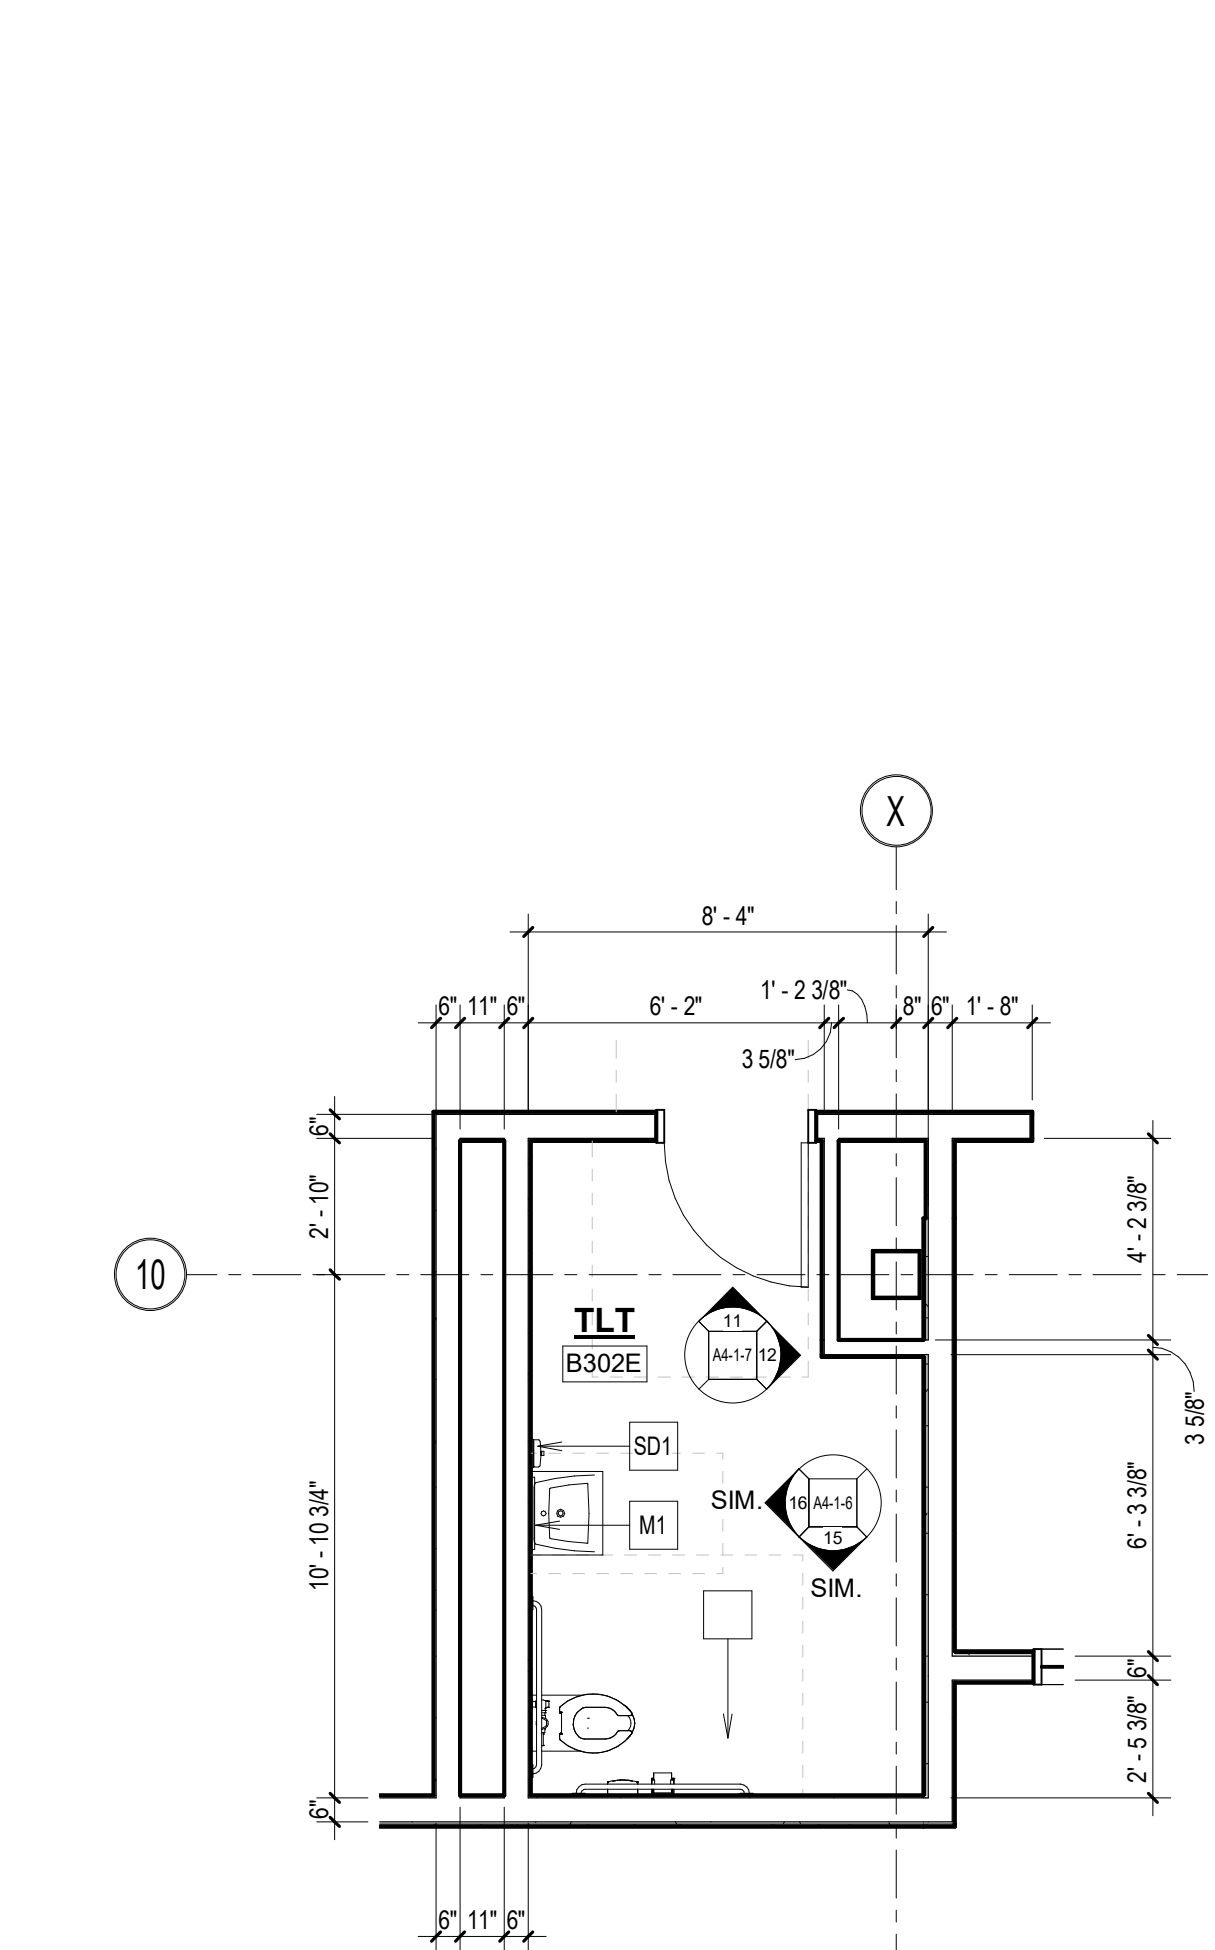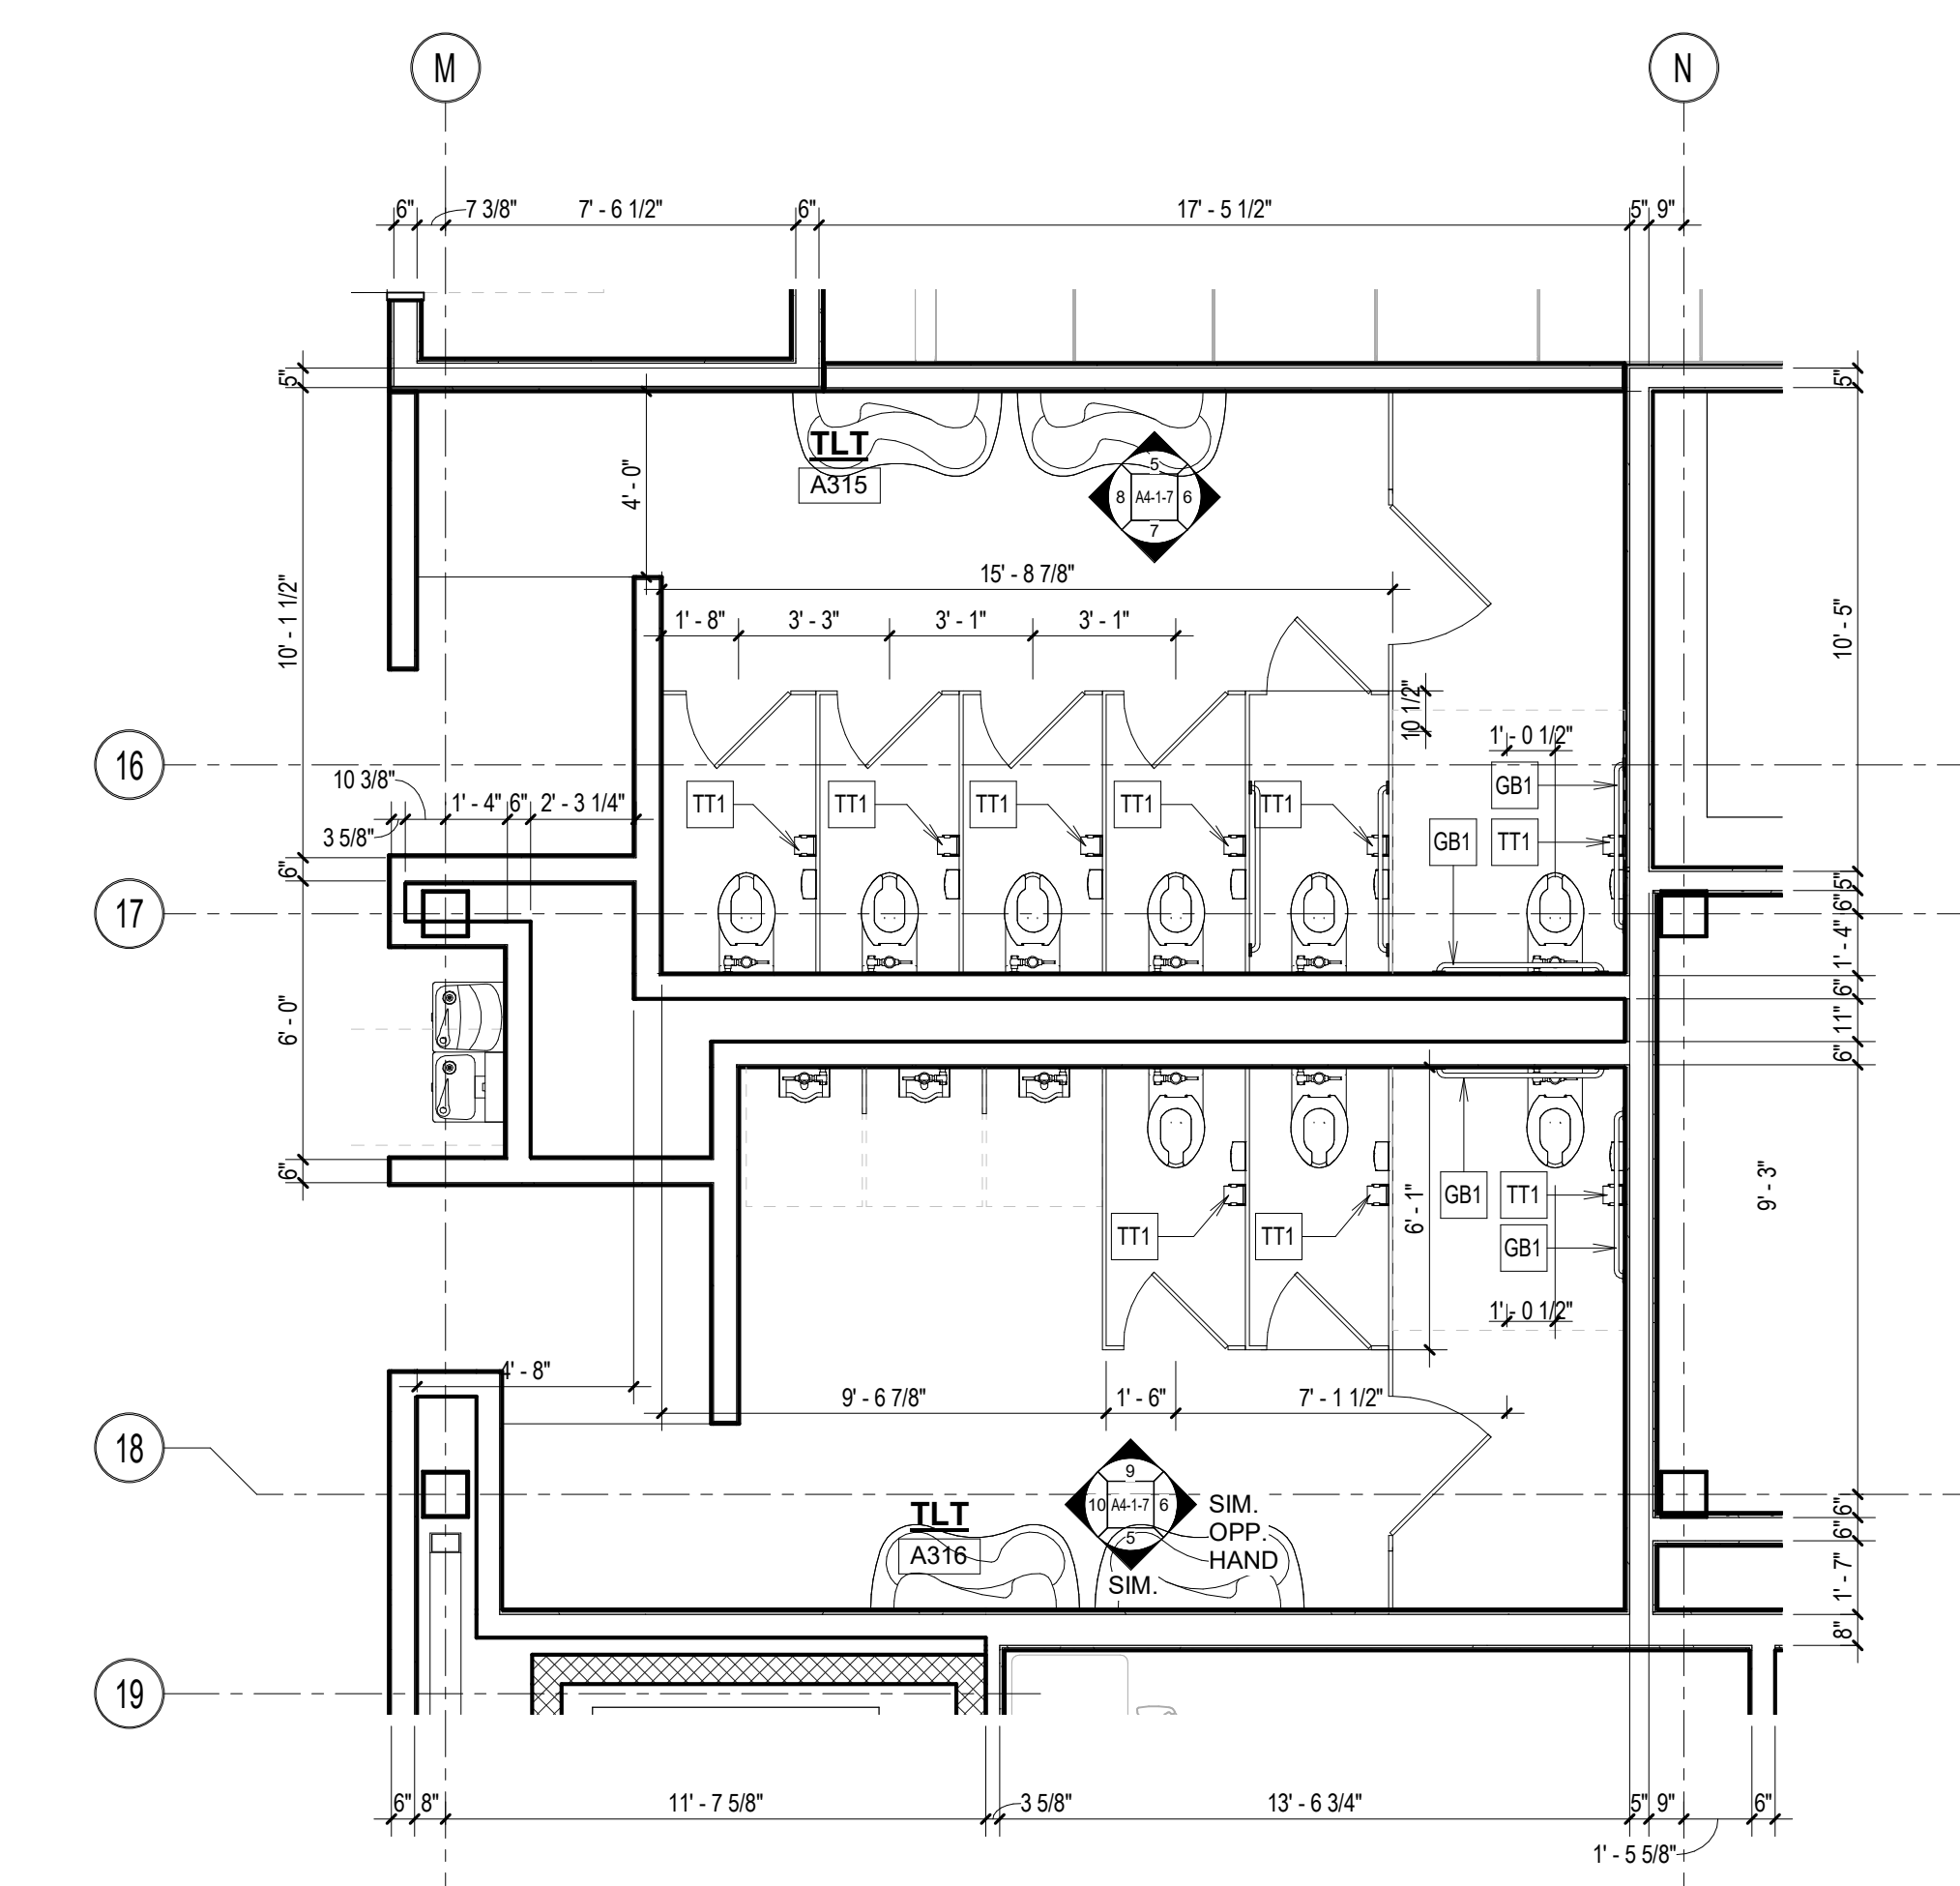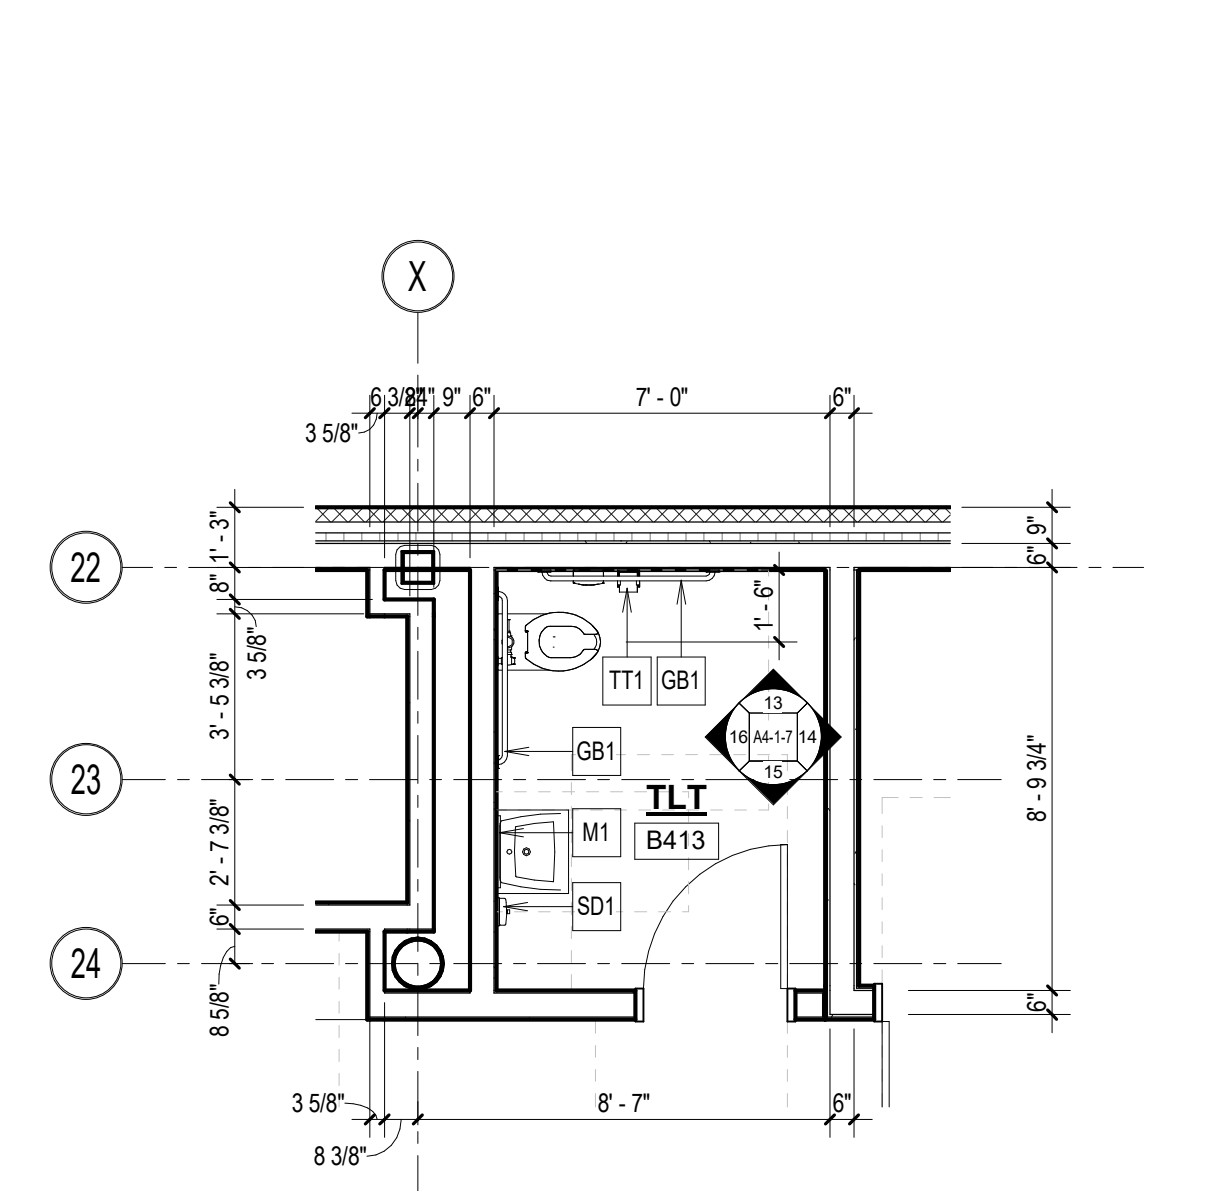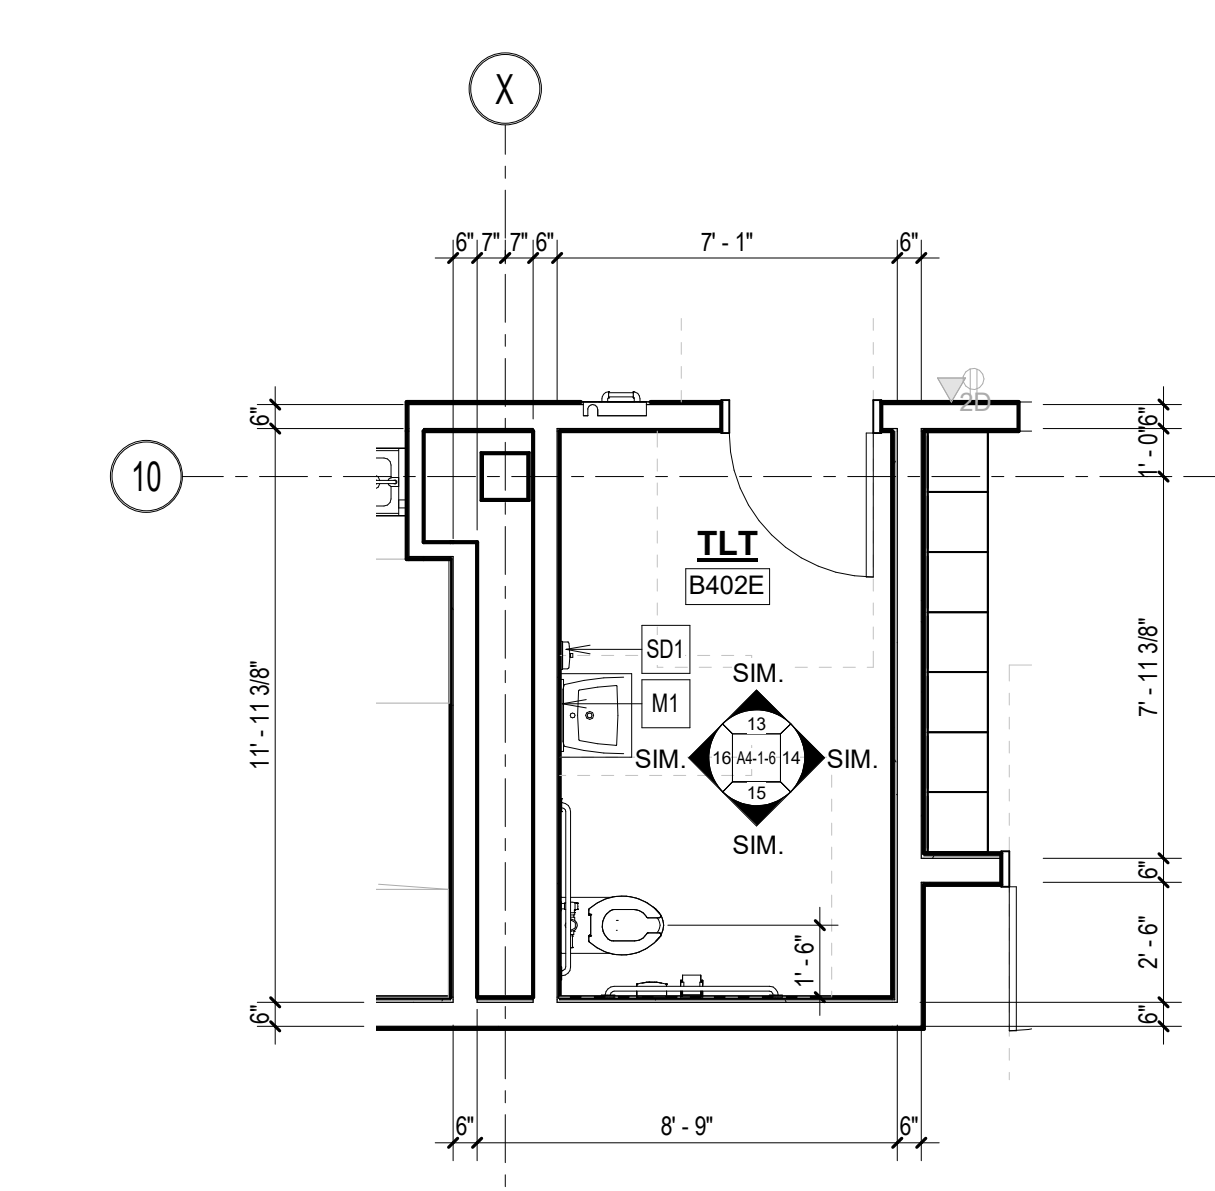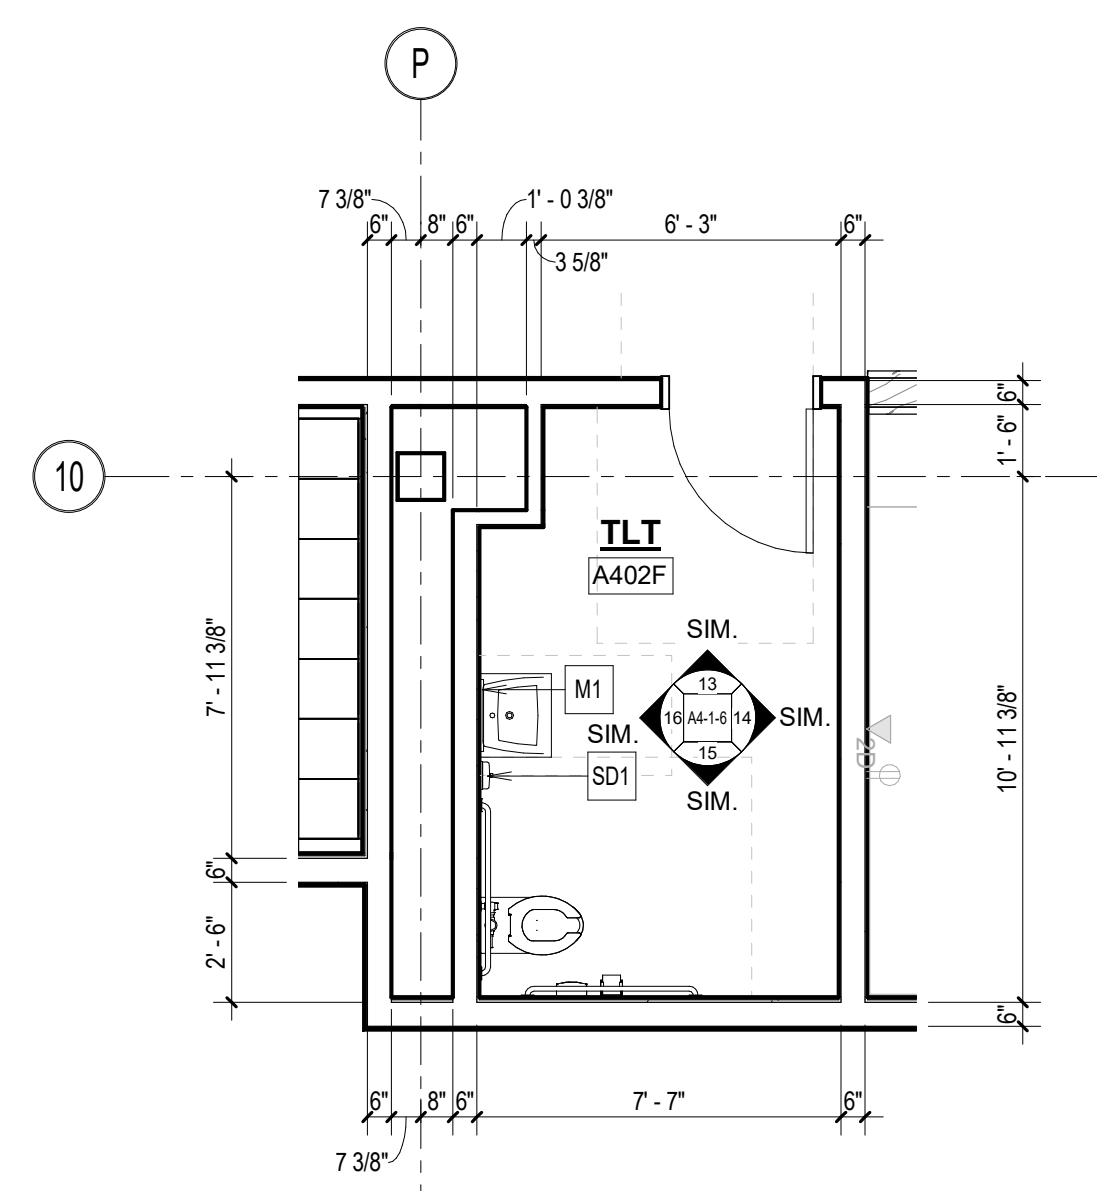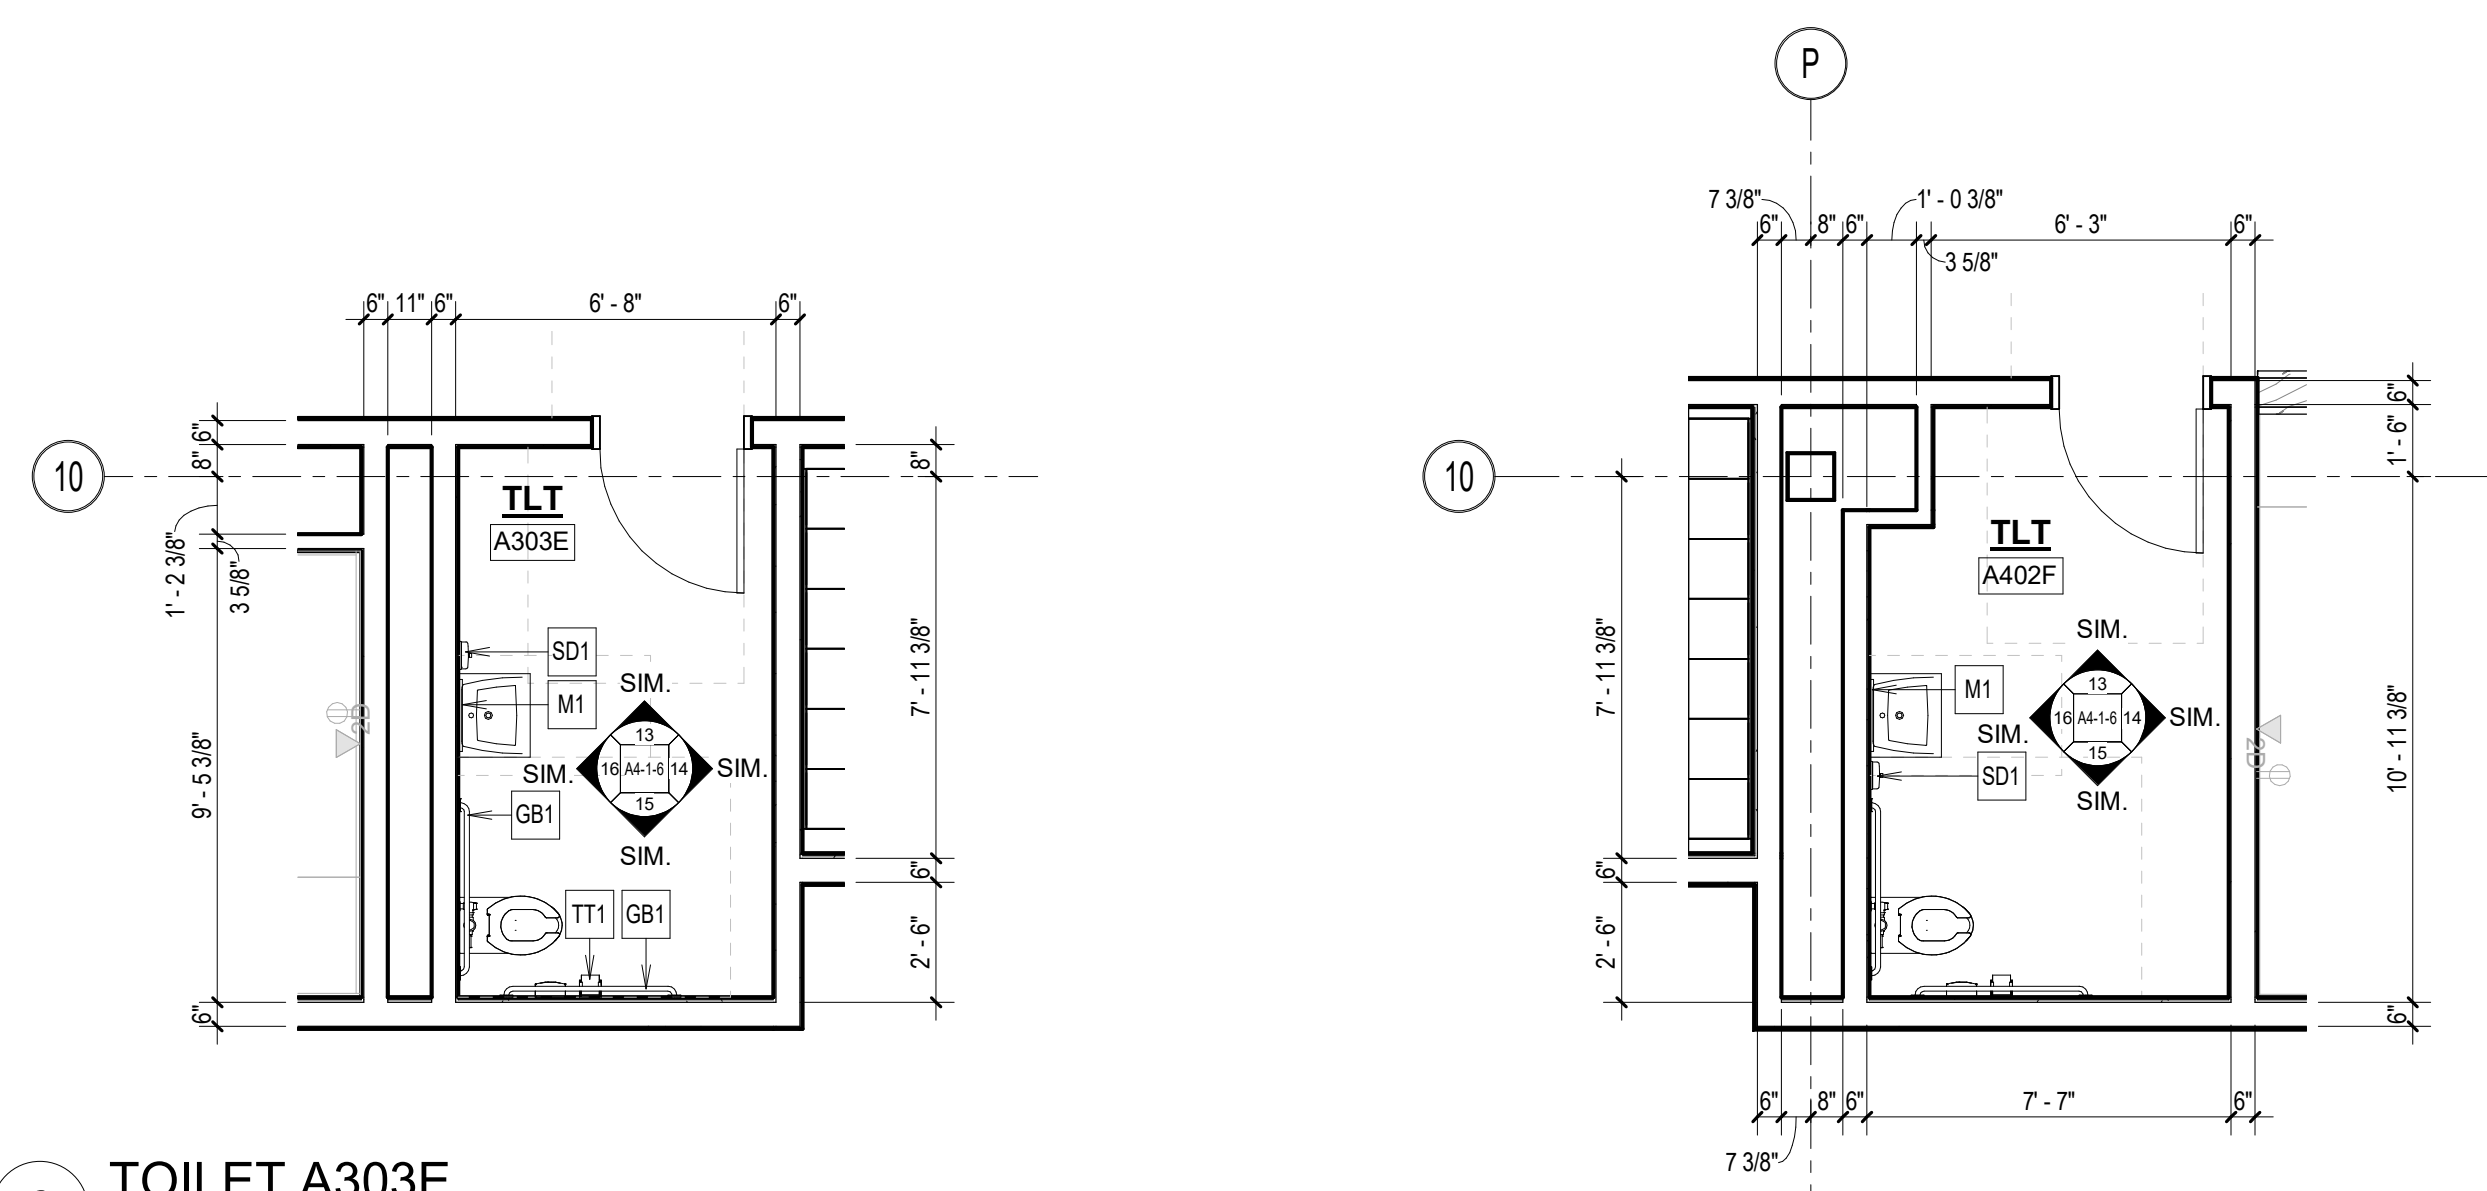


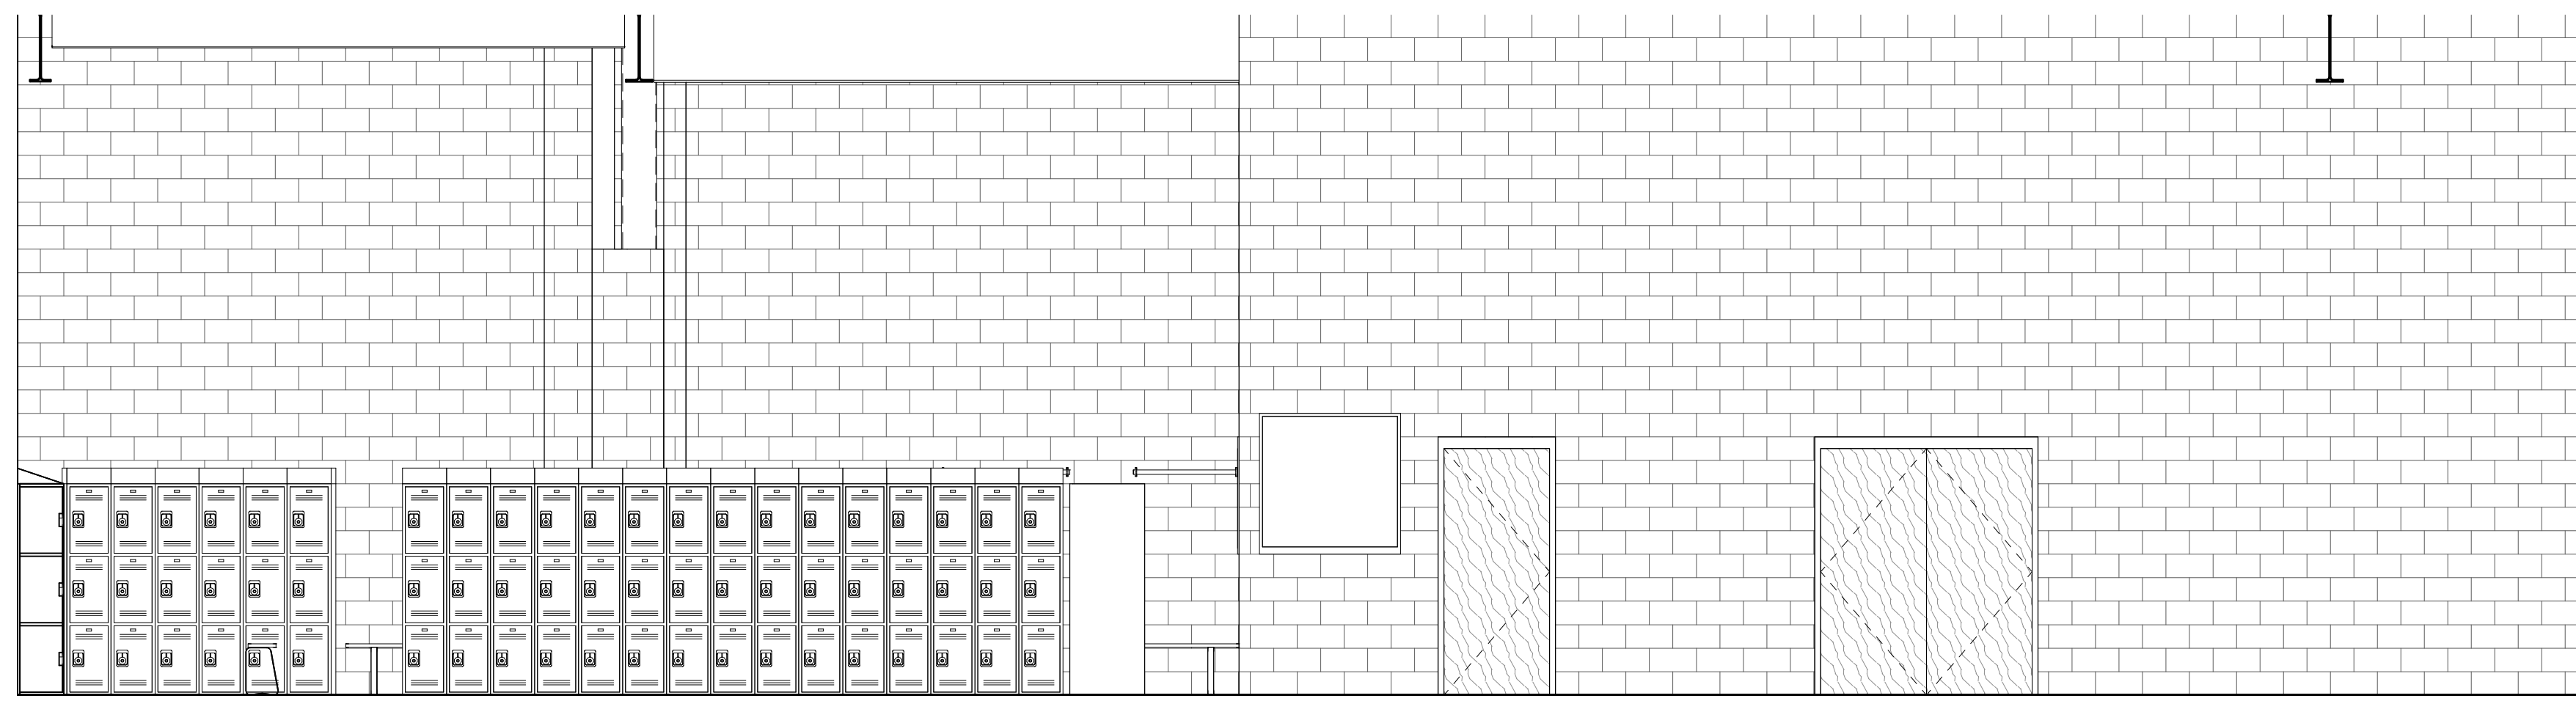


25 BOYS LOCKER D117 - SOUTH
1/4" = 1'-0"

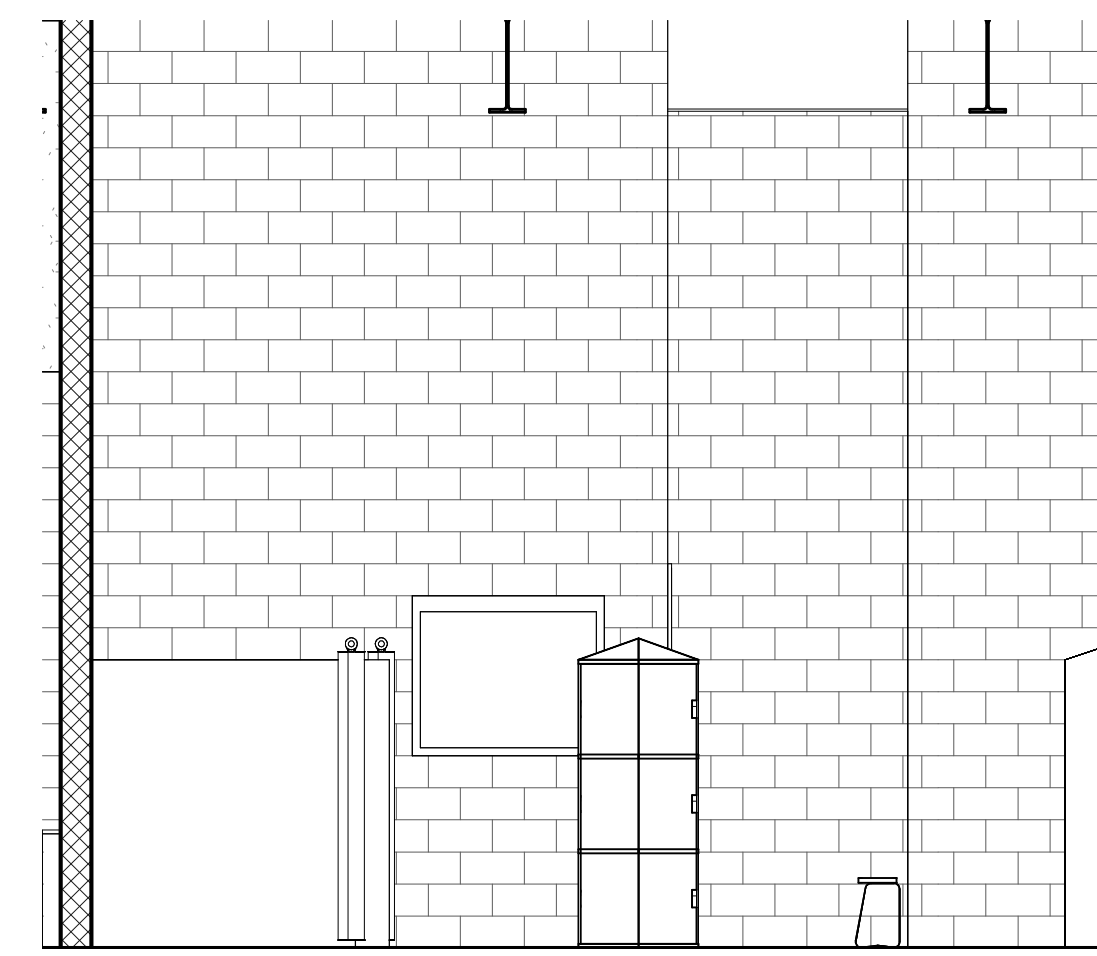


26 BOYS LOCKER D117 - WEST
1/4" = 1'-0"

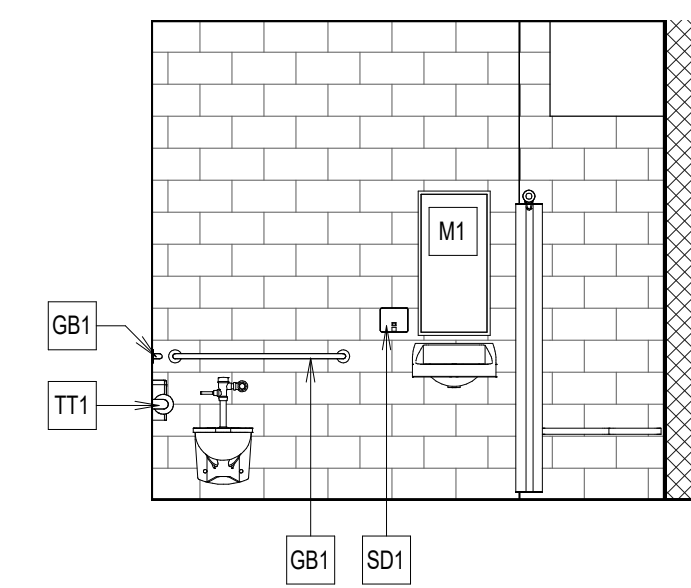


22 TLT / SHOWER D117E - WEST
1/4" = 1'-0"

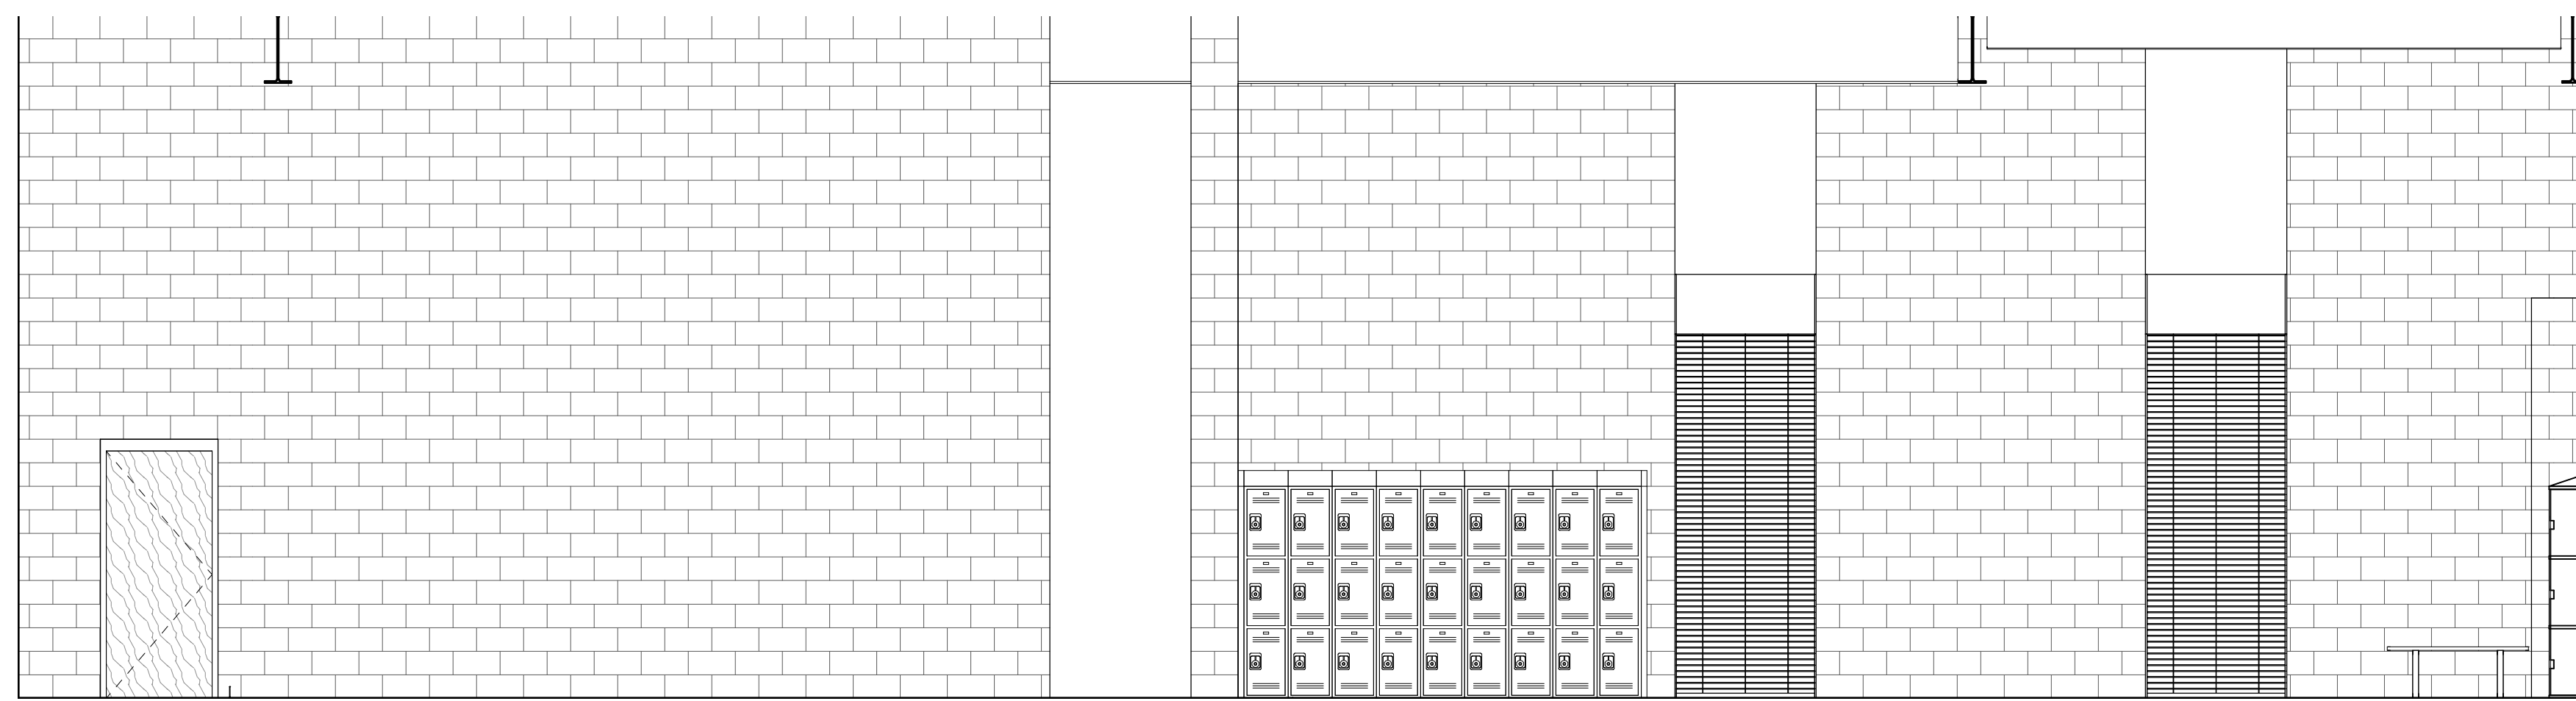


23 BOYS LOCKER D117 - NORTH
1/4" = 1'-0"

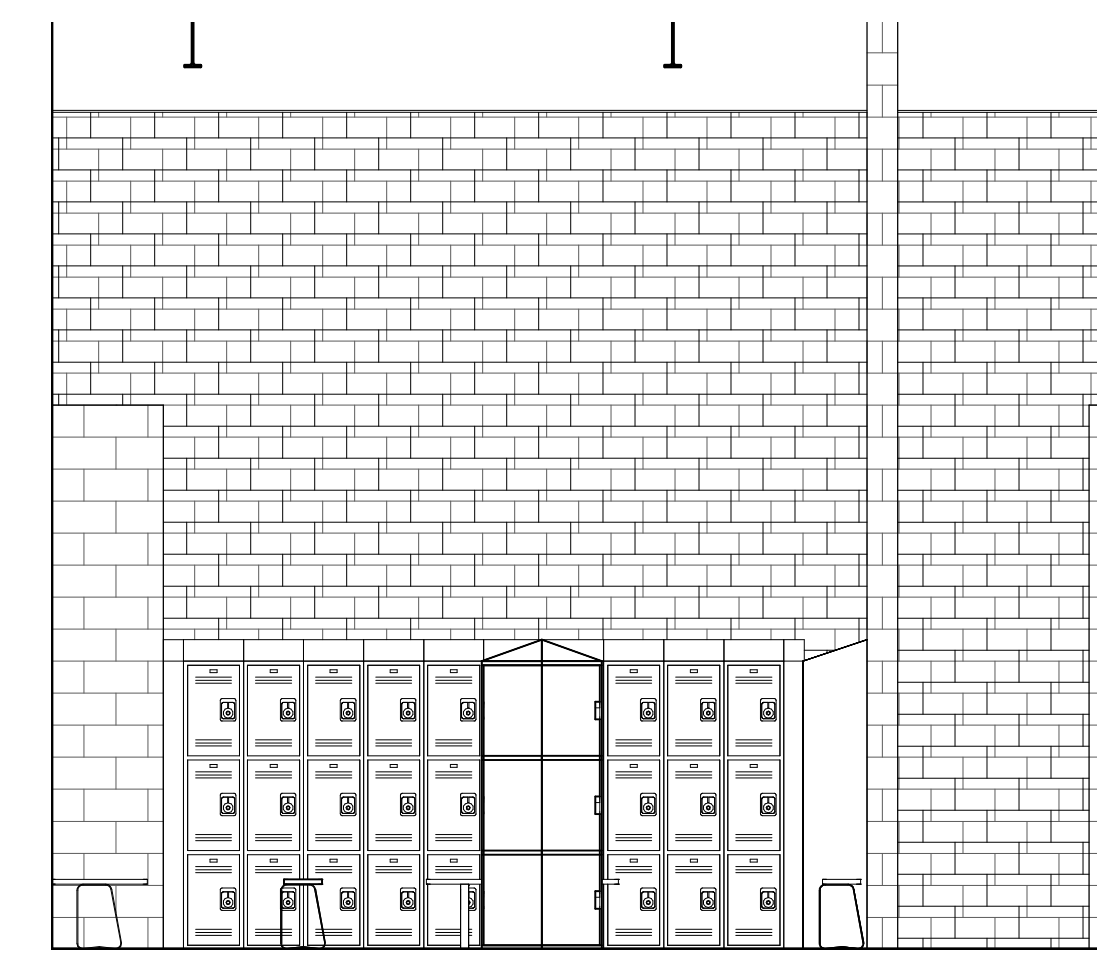


24 BOYS LOCKER D117 - EAST
1/4" = 1'-0"

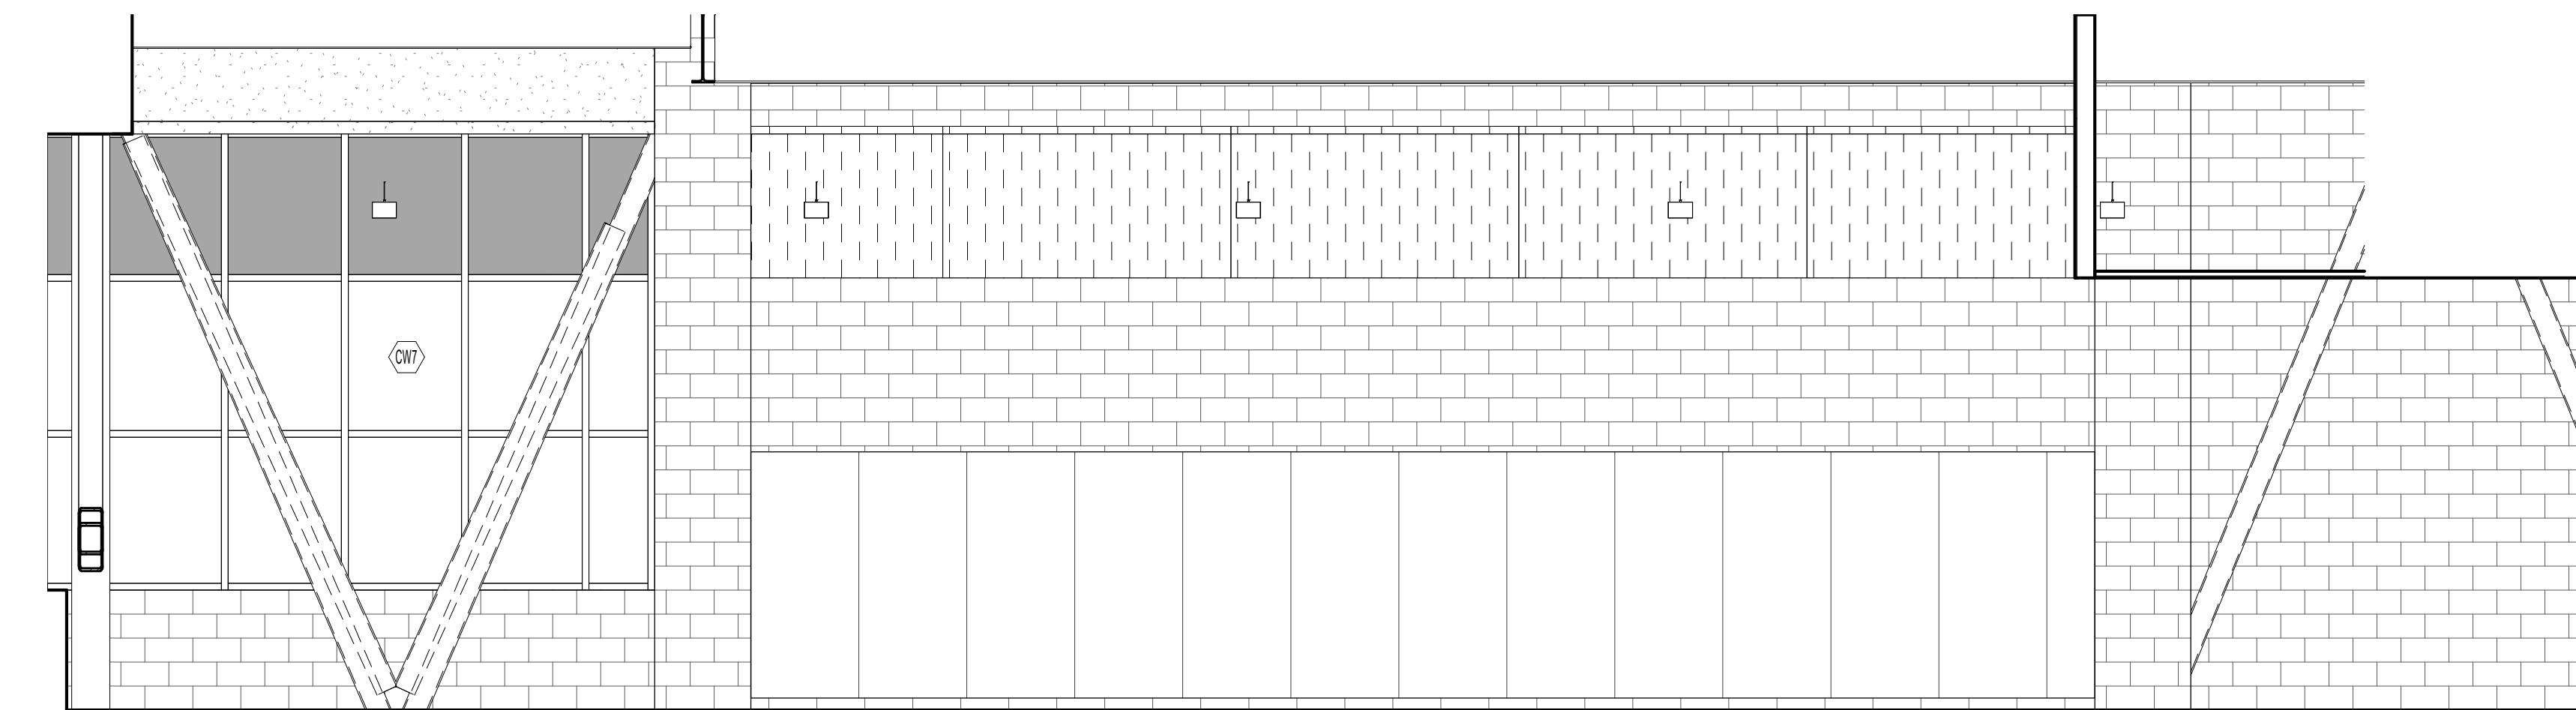


13 WEIGHTS D115 - SOUTH
1/4" = 1'-0"

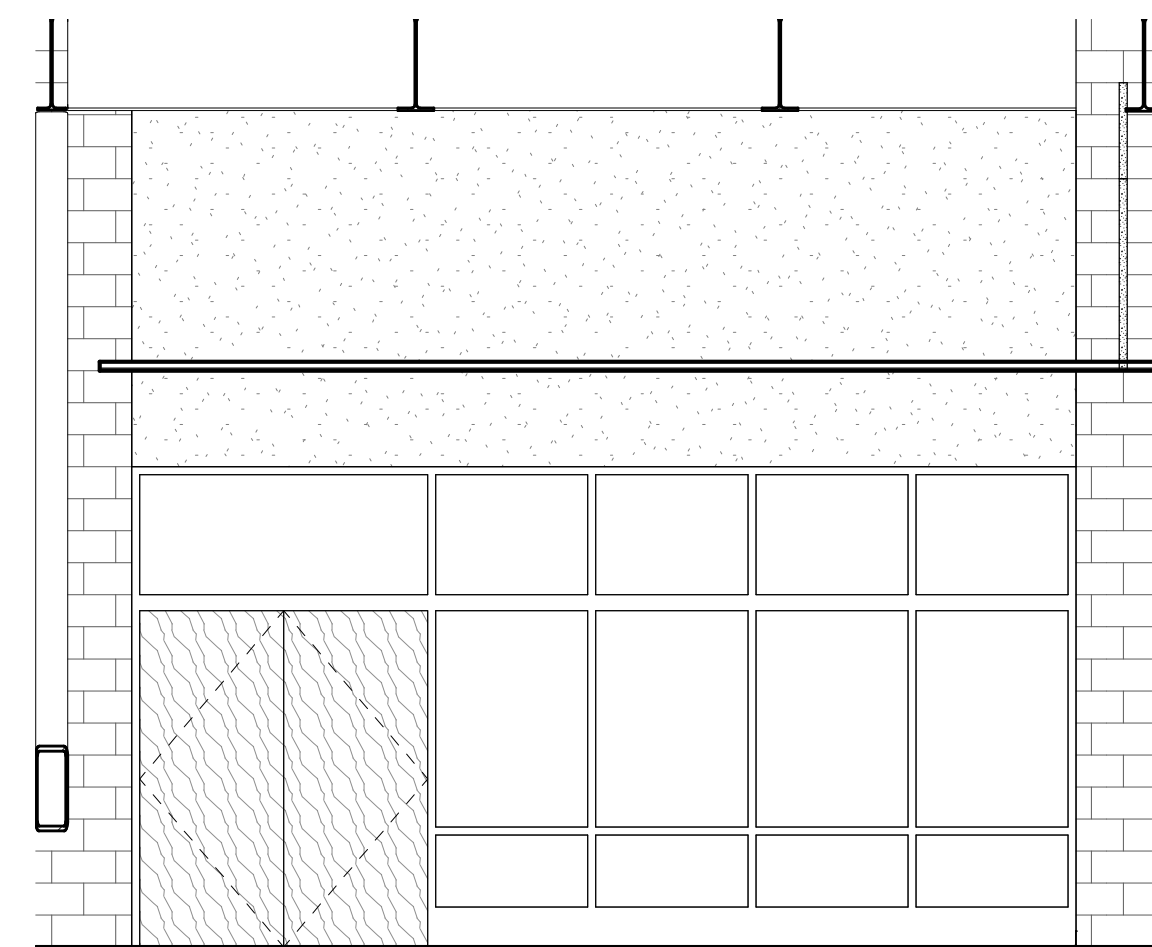


14 WEIGHTS D115 - WEST
1/4" = 1'-0"

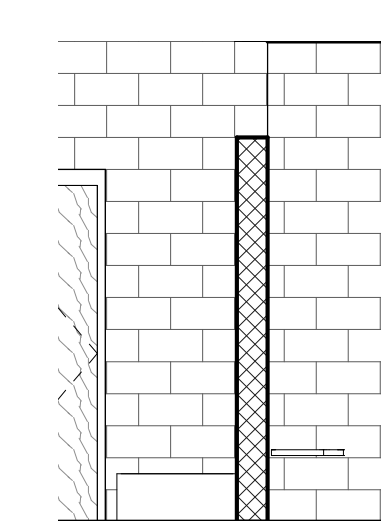


19 TLT / SHOWER D117E - NORTH
1/4" = 1'-0"

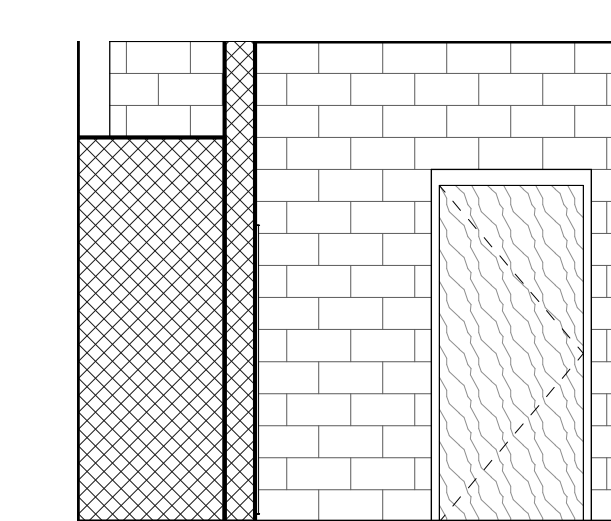


20 TLT / SHOWER D117E - EAST
1/4" = 1'-0"

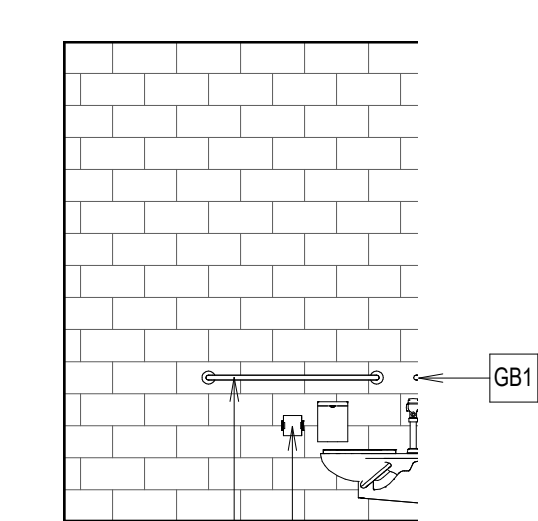


21 TLT / SHOWER D117E - SOUTH
1/4" = 1'-0"

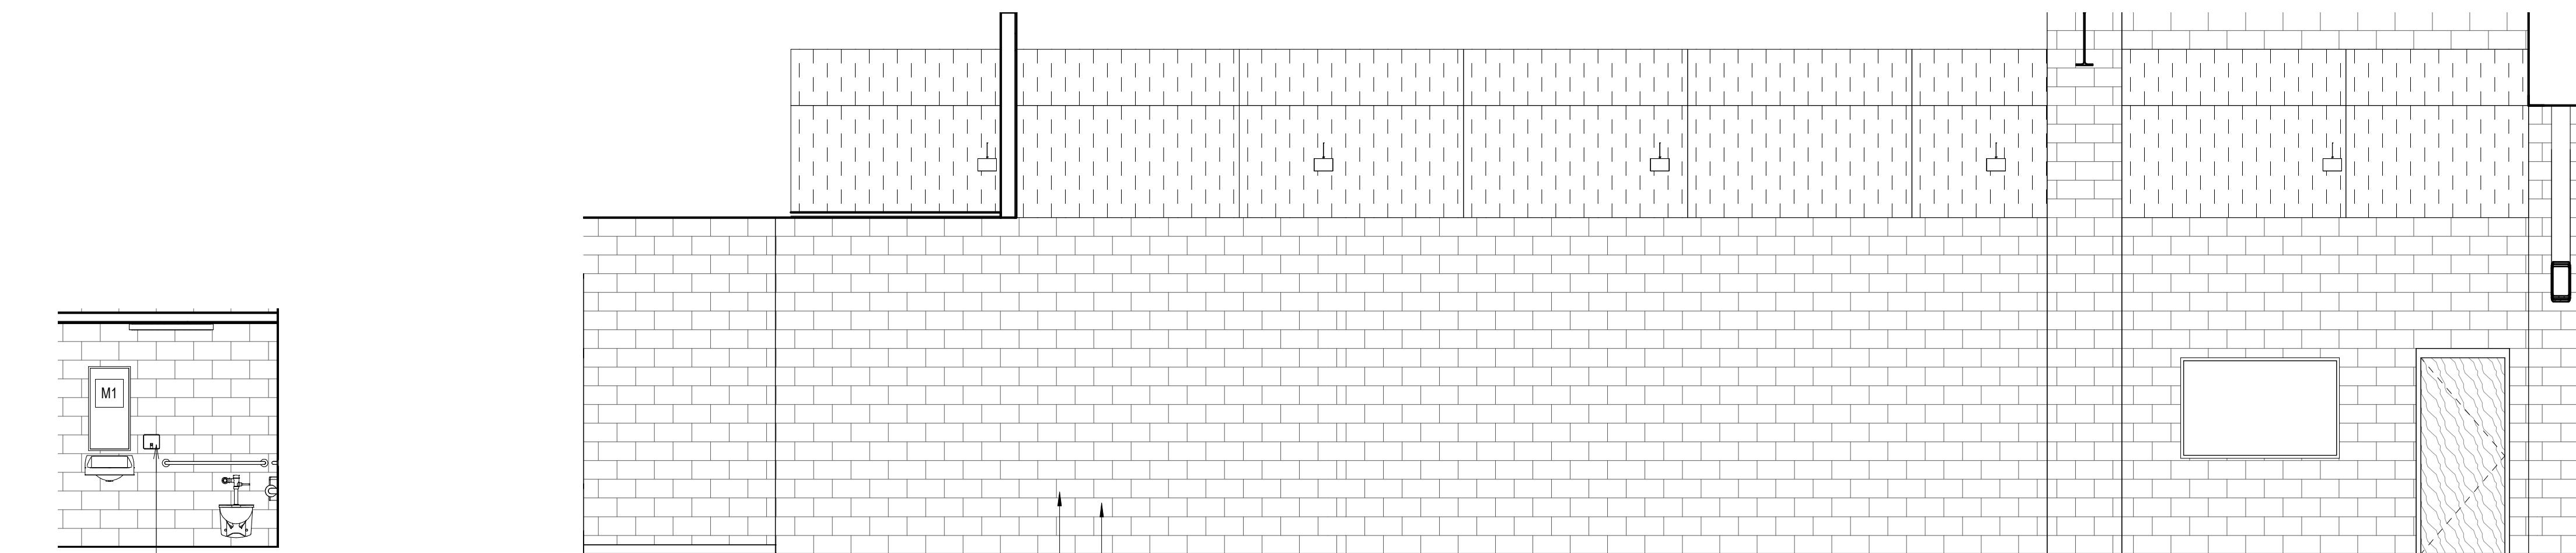


11 WEIGHTS D115 - NORTH
1/4" = 1'-0"

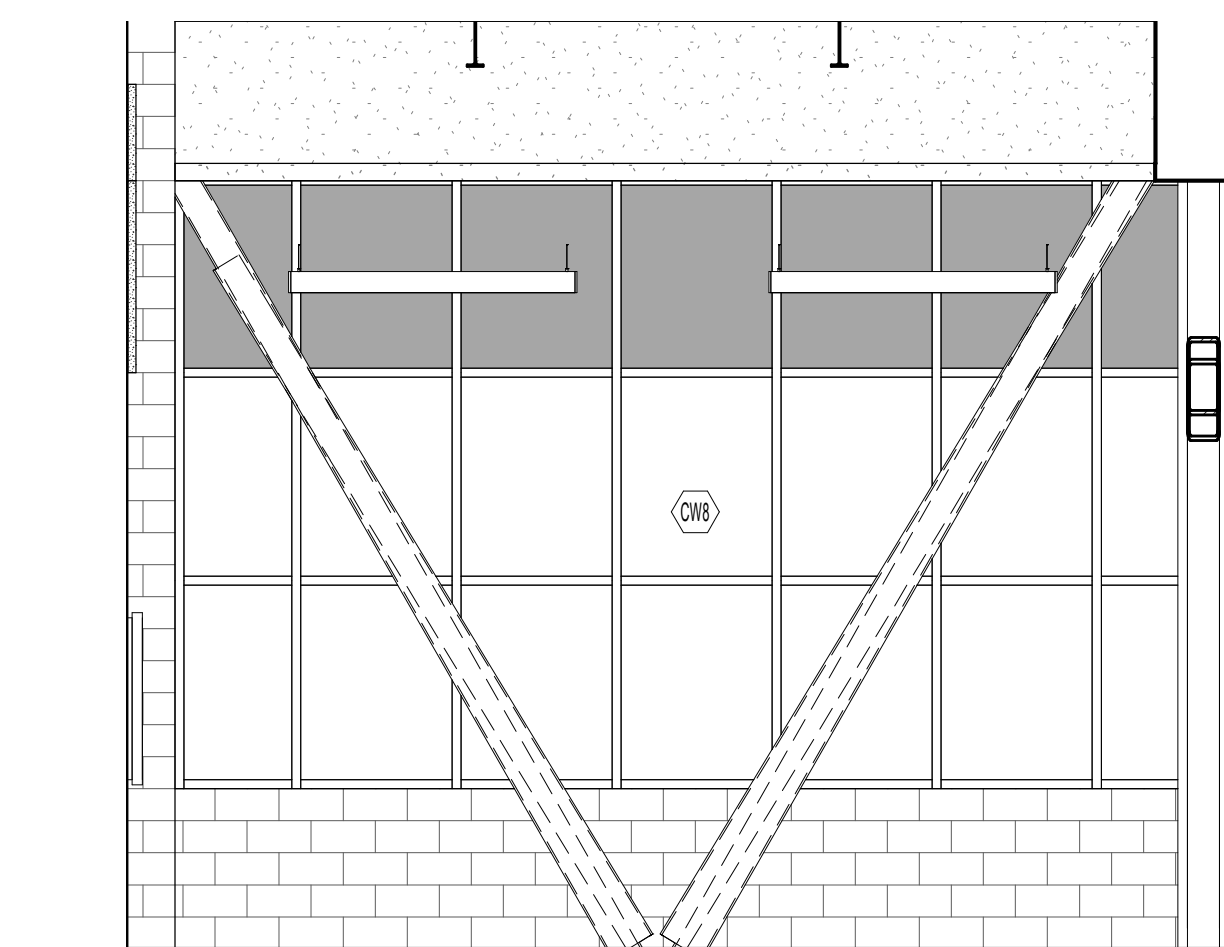


12 WEIGHTS D115 - EAST
1/4" = 1'-0"

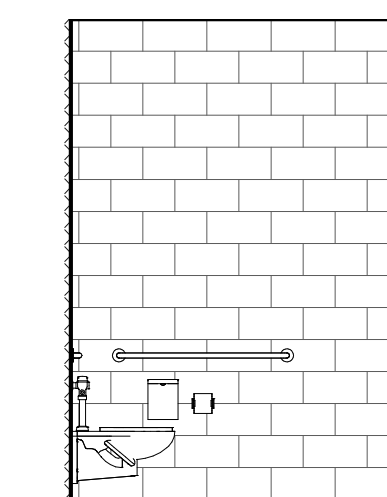


17 TOILET D116A - SOUTH
1/4" = 1'-0"

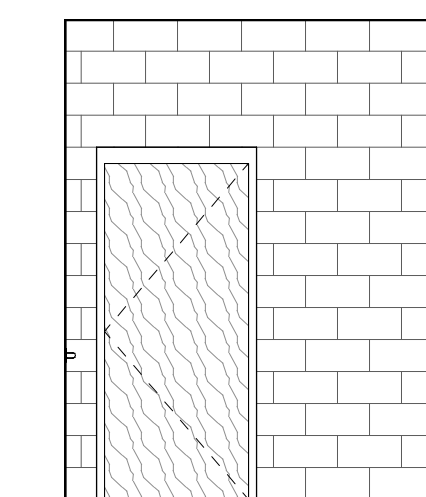


18 TOILET D116A - WEST
1/4" = 1'-0"

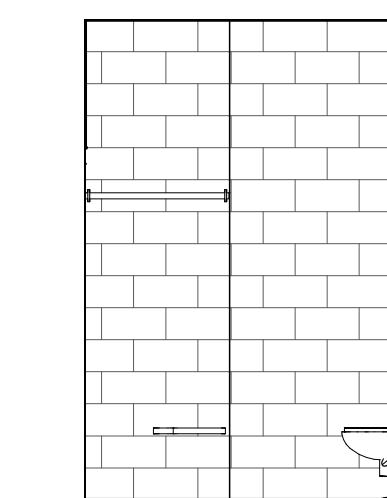


15 TOILET D116A - NORTH
1/4" = 1'-0"

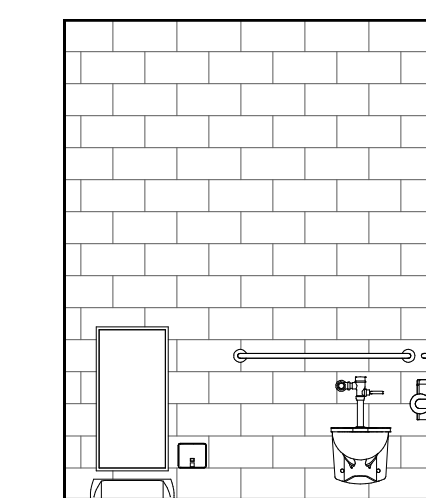


16 TOILET D116A - EAST
1/4" = 1'-0"

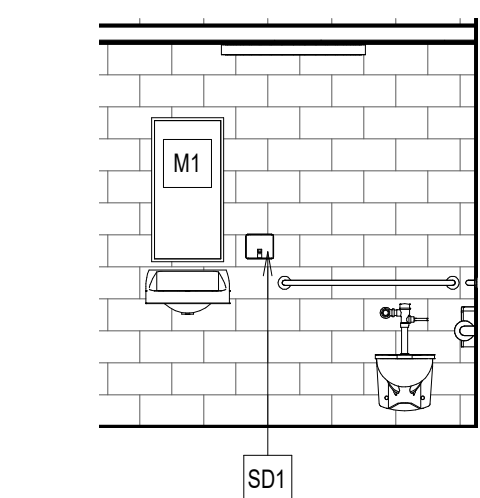


10 LOCKER C004C - WEST
1/4" = 1'-0"

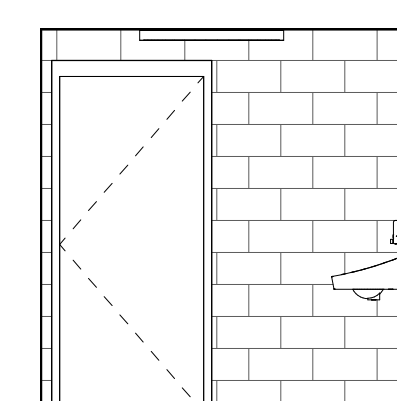


1 TOILET D003C - NORTH
1/4" = 1'-0"

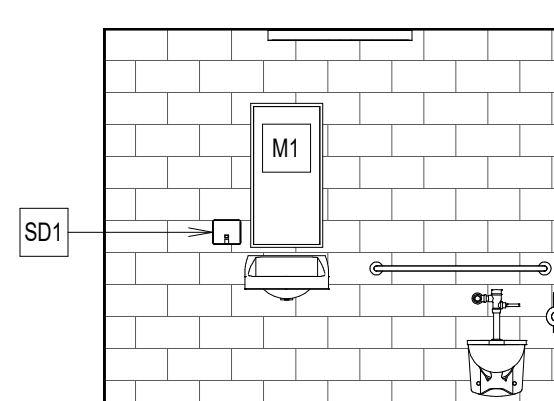


2 TOILET D003C - EAST
1/4" = 1'-0"

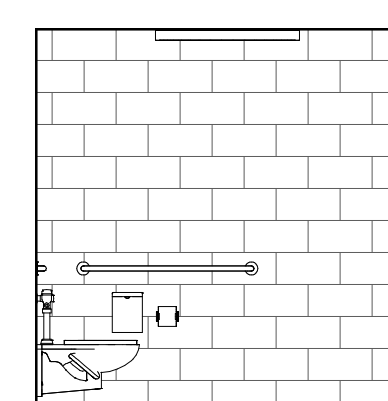


3 TOILET D003C - SOUTH
1/4" = 1'-0"

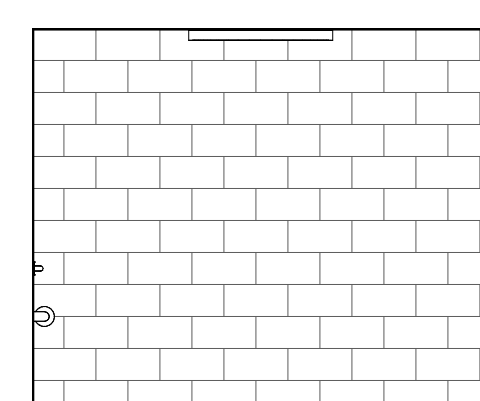


4 TOILET D003C - WEST
1/4" = 1'-0"

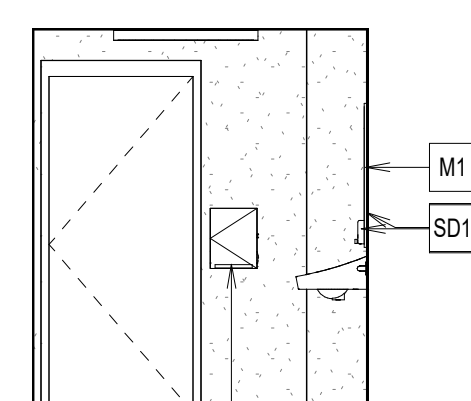


5 TOILET C022C - EAST
1/4" = 1'-0"

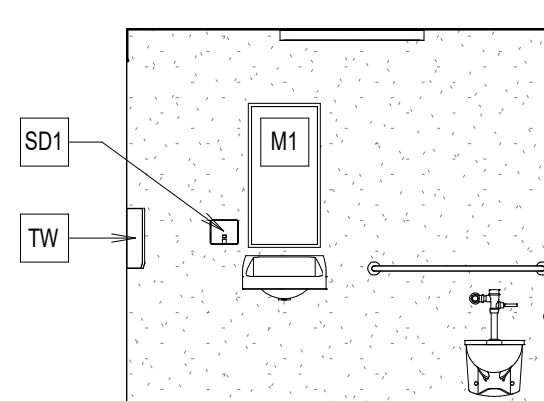


6 TOILET C022C - SOUTH
1/4" = 1'-0"

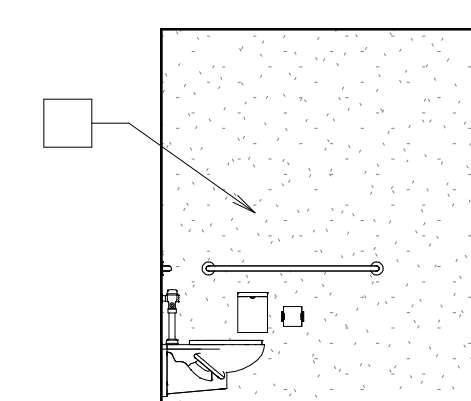


7 TOILET C022C - WEST
1/4" = 1'-0"

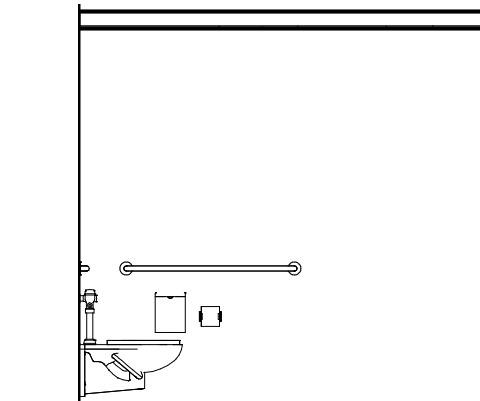


8 LOCKER C004C - NORTH
1/4" = 1'-0"

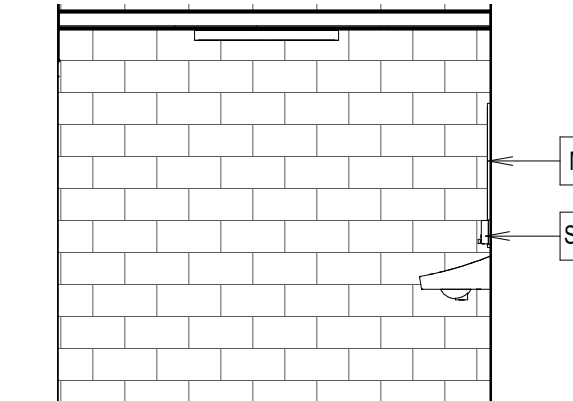


9 LOCKER C004C - SOUTH
1/4" = 1'-0"

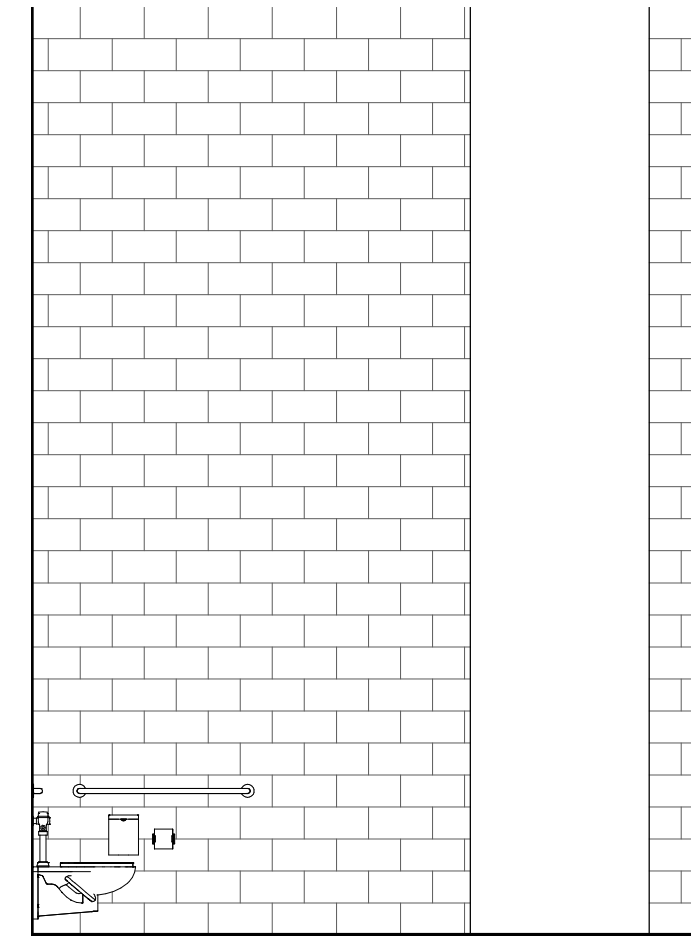


15 TLT / SHOWER D122A - NORTH
1/4" = 1'-0"

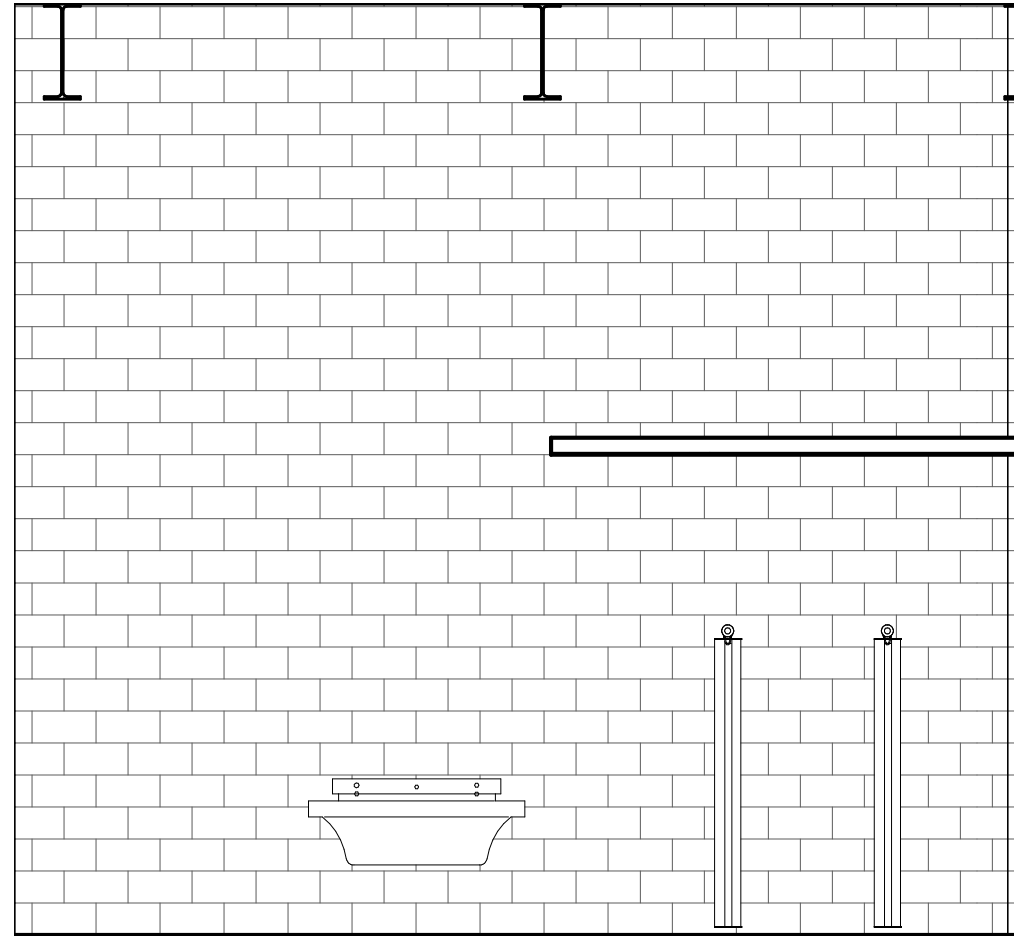


16 TLT / SHOWER D122A - EAST
1/4" = 1'-0"

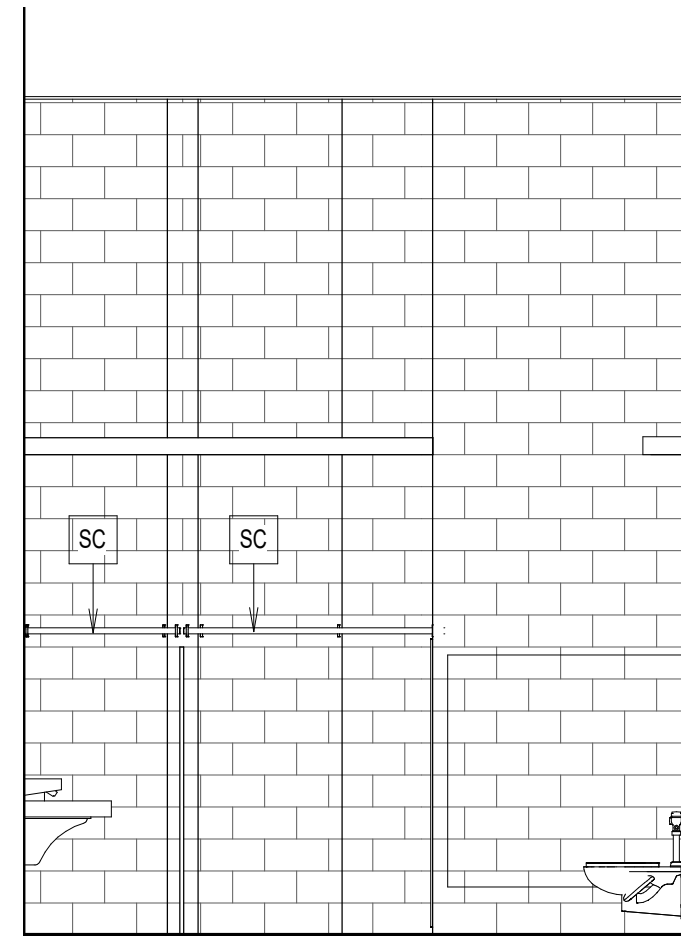


17 TLT / SHOWER D122A - SOUTH
1/4" = 1'-0"

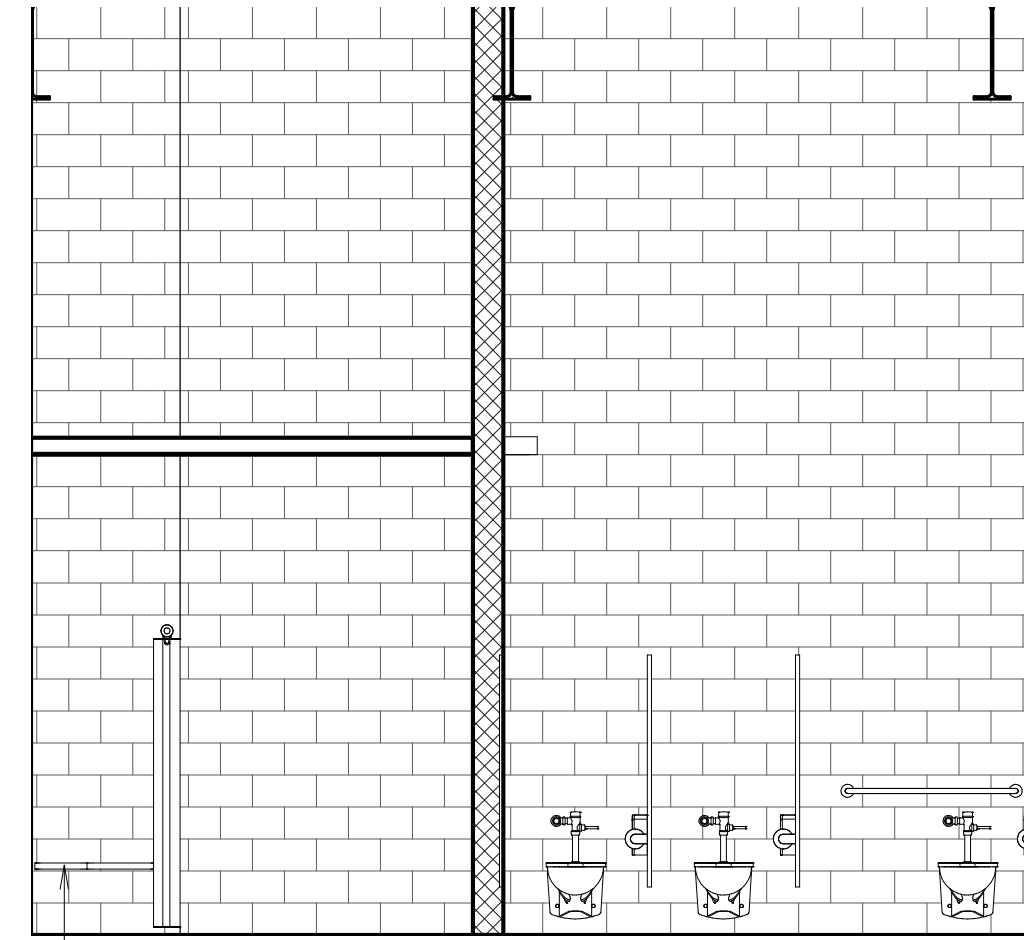


18 TLT / SHOWER D122A - WEST
1/4" = 1'-0"

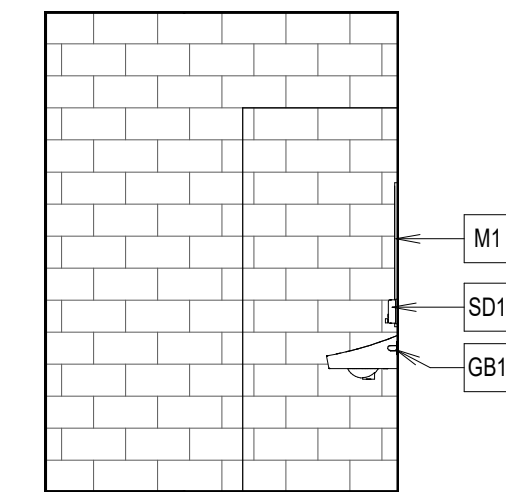


21 TOILET D122E - SOUTH
1/4" = 1'-0"

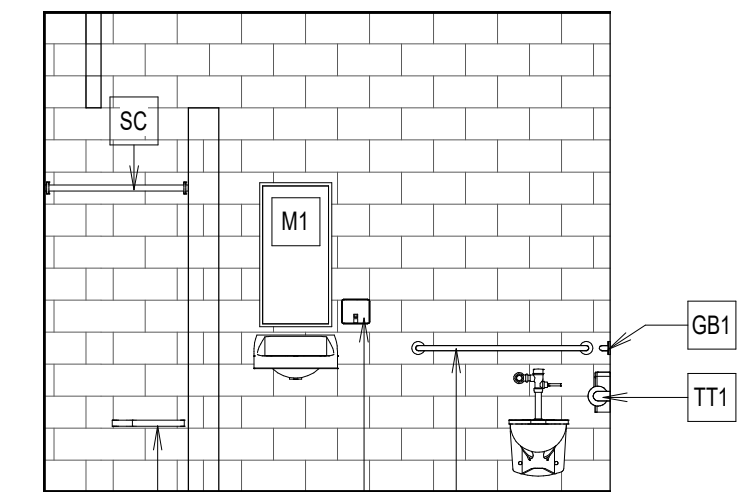


22 TOILET D122E - WEST
1/4" = 1'-0"

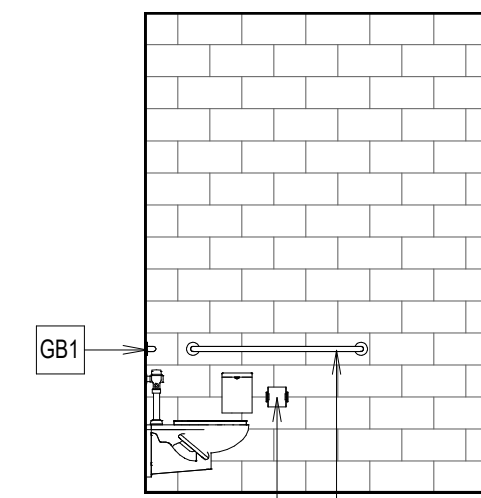


19 TOILET D122E - NORTH
1/4" = 1'-0"

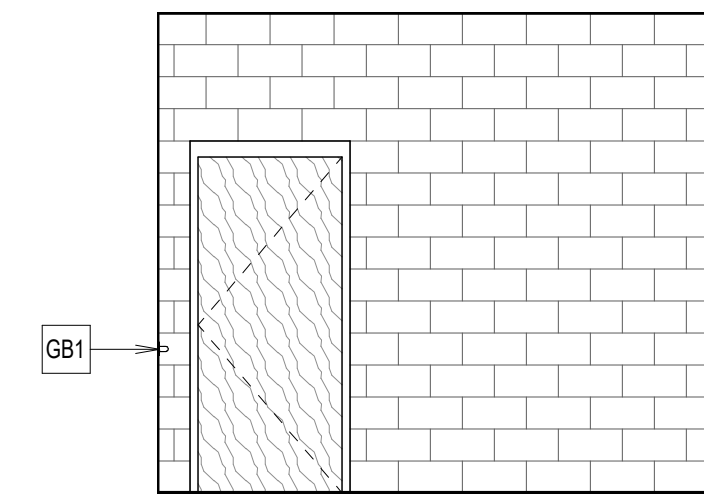


20 TOILET D122E - EAST
1/4" = 1'-0"

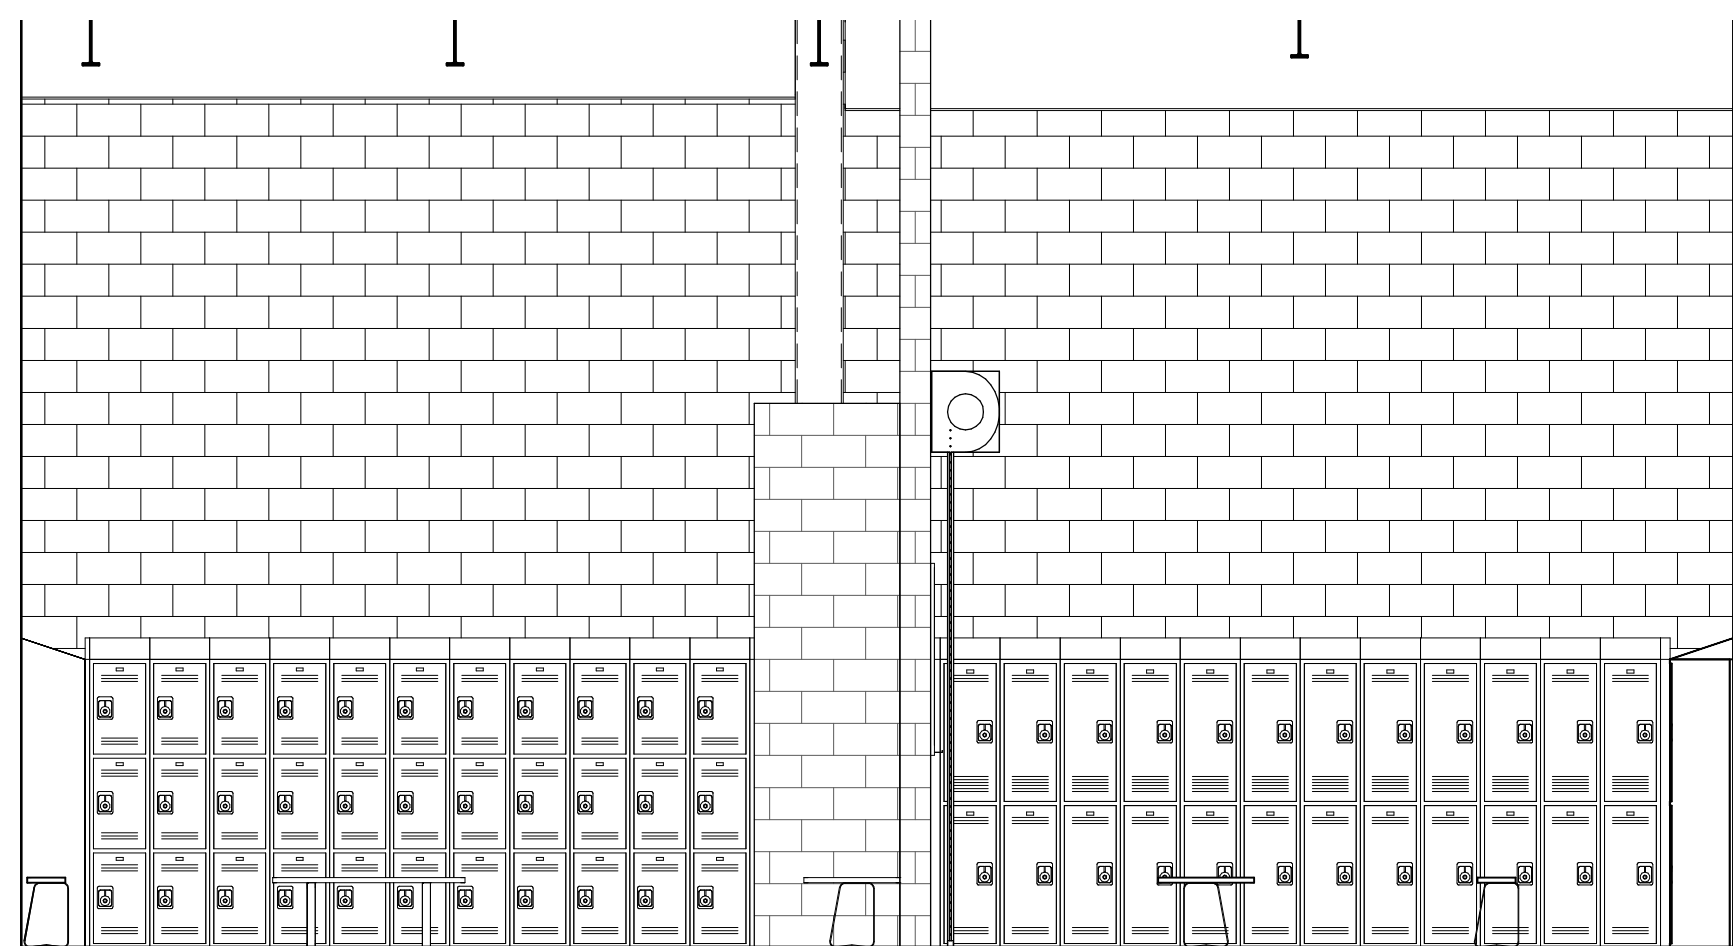


12 GIRLS LOCKER D122 - EAST
1/4" = 1'-0"

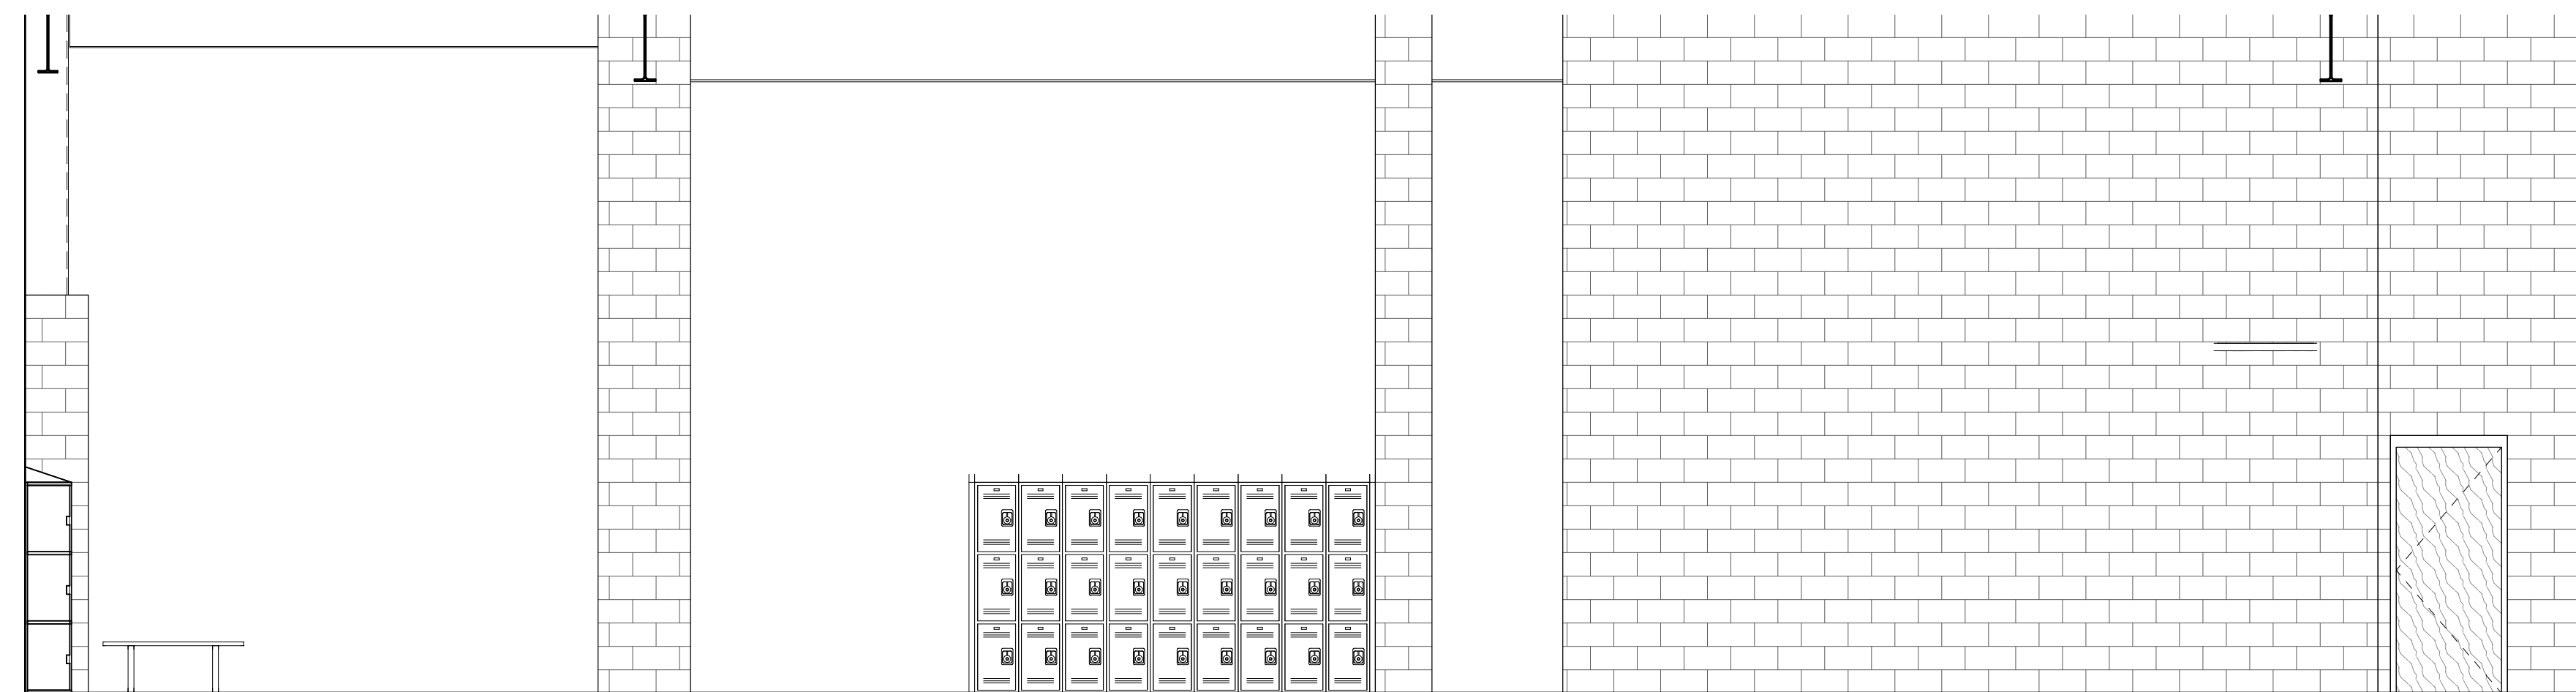


13 GIRLS LOCKER D122 - SOUTH
1/4" = 1'-0"

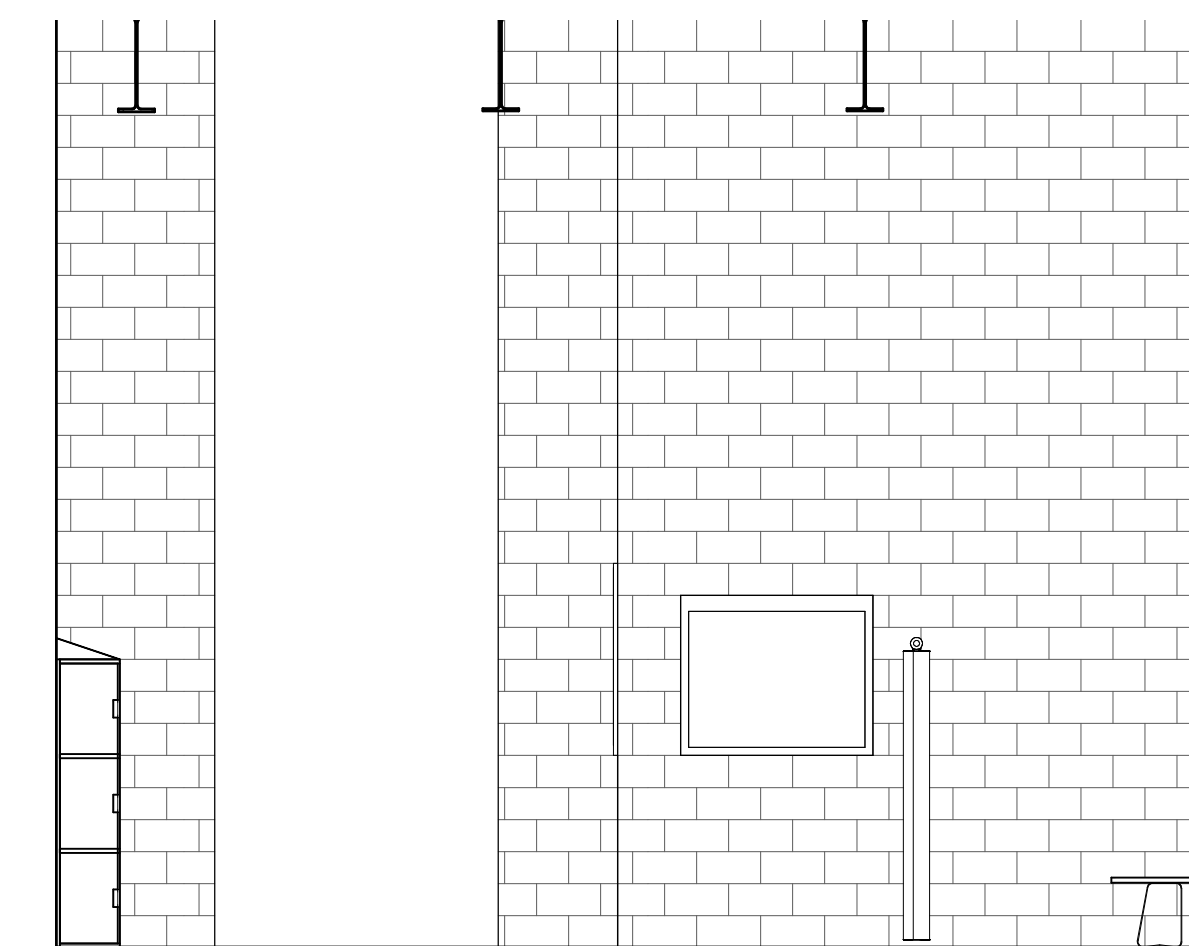


14 GIRLS LOCKER D122 - WEST
1/4" = 1'-0"

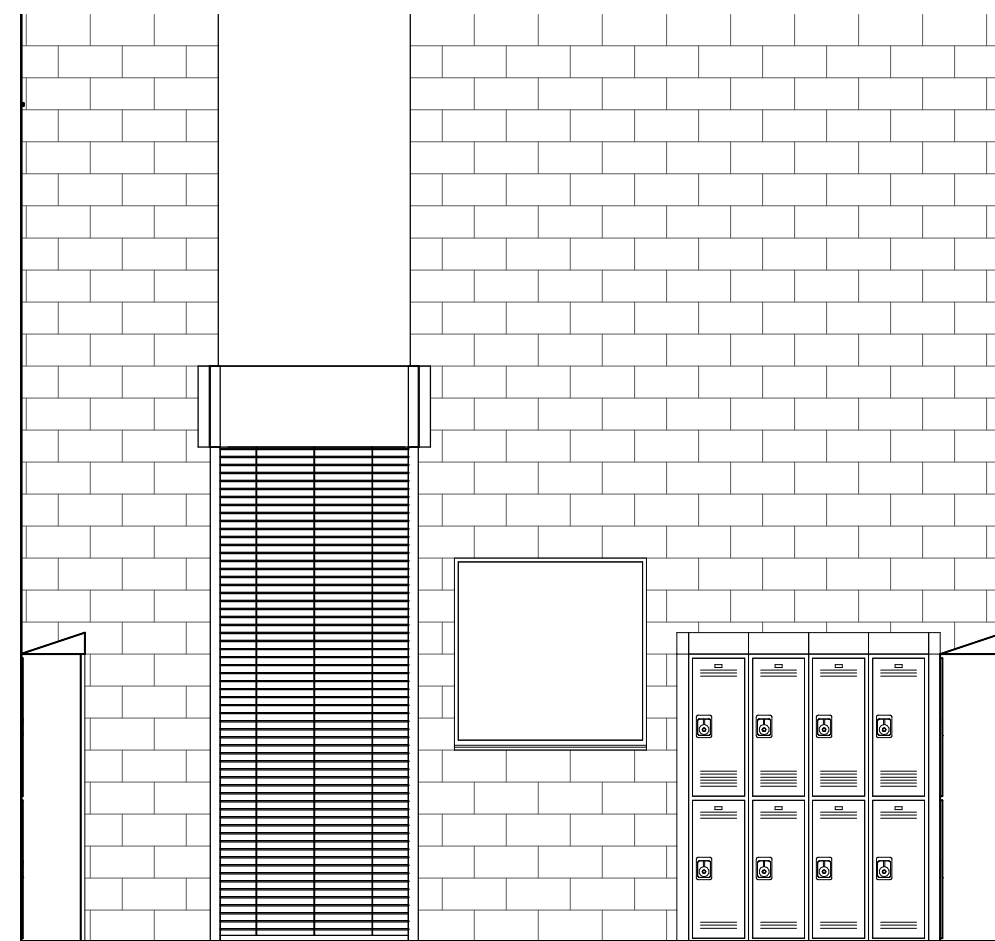


7 TEAM LOCKER D117B - SOUTH
1/4" = 1'-0"

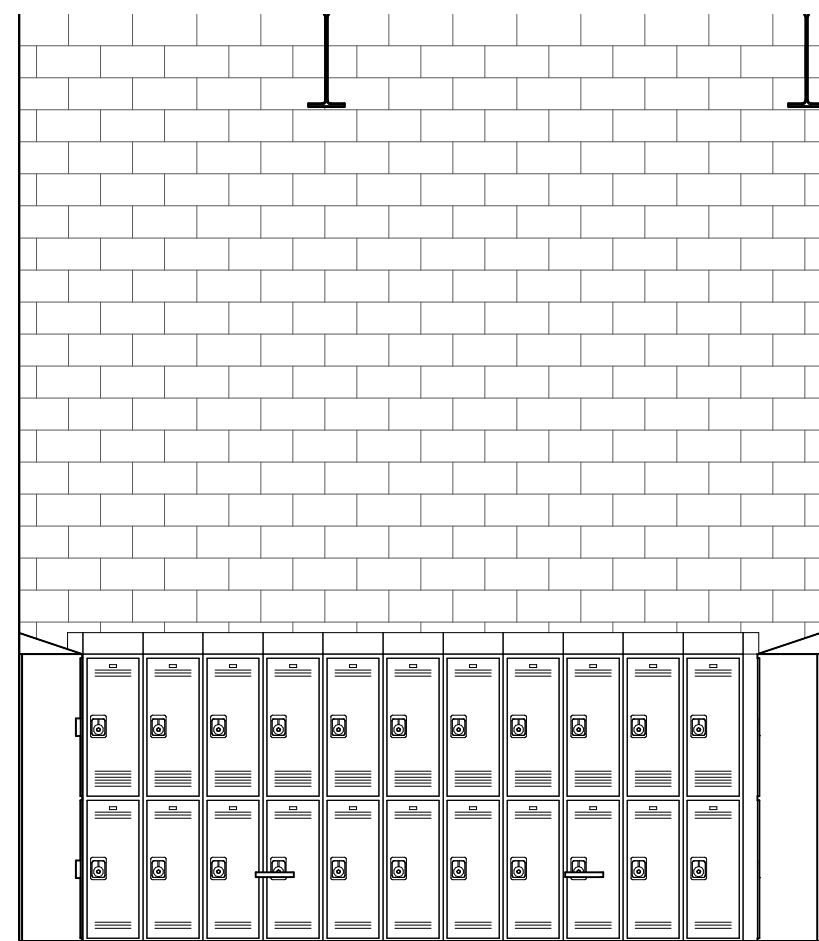


8 TEAM LOCKER D117B - WEST
1/4" = 1'-0"

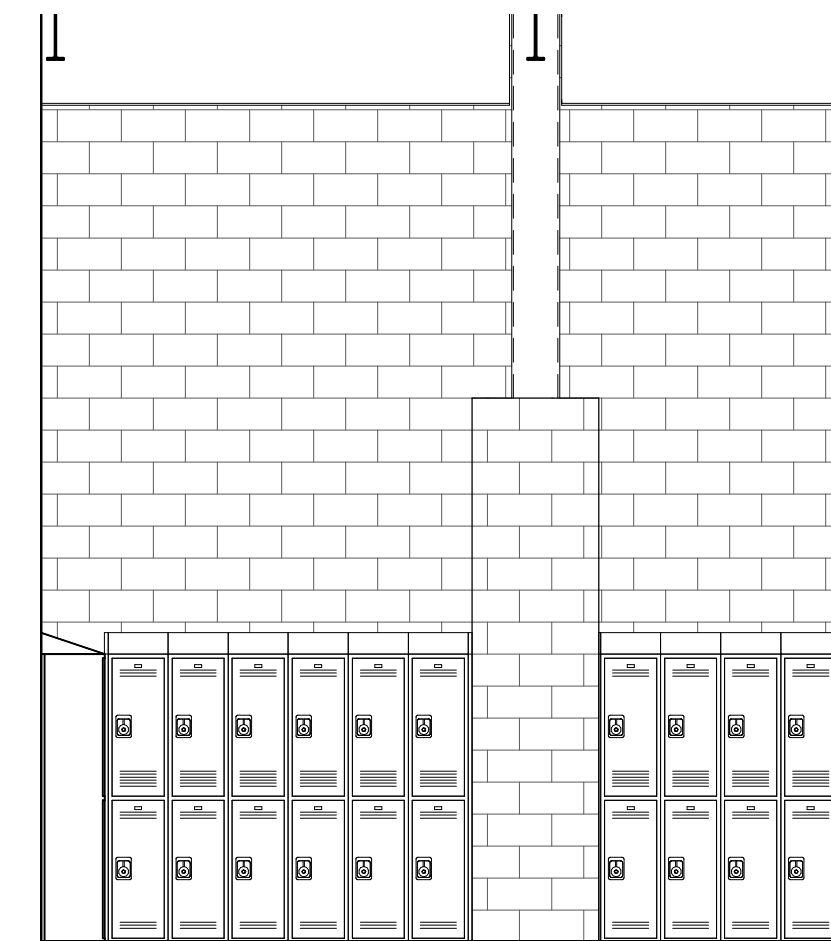


9 TEAM LOCKER D117C - EAST
1/4" = 1'-0"

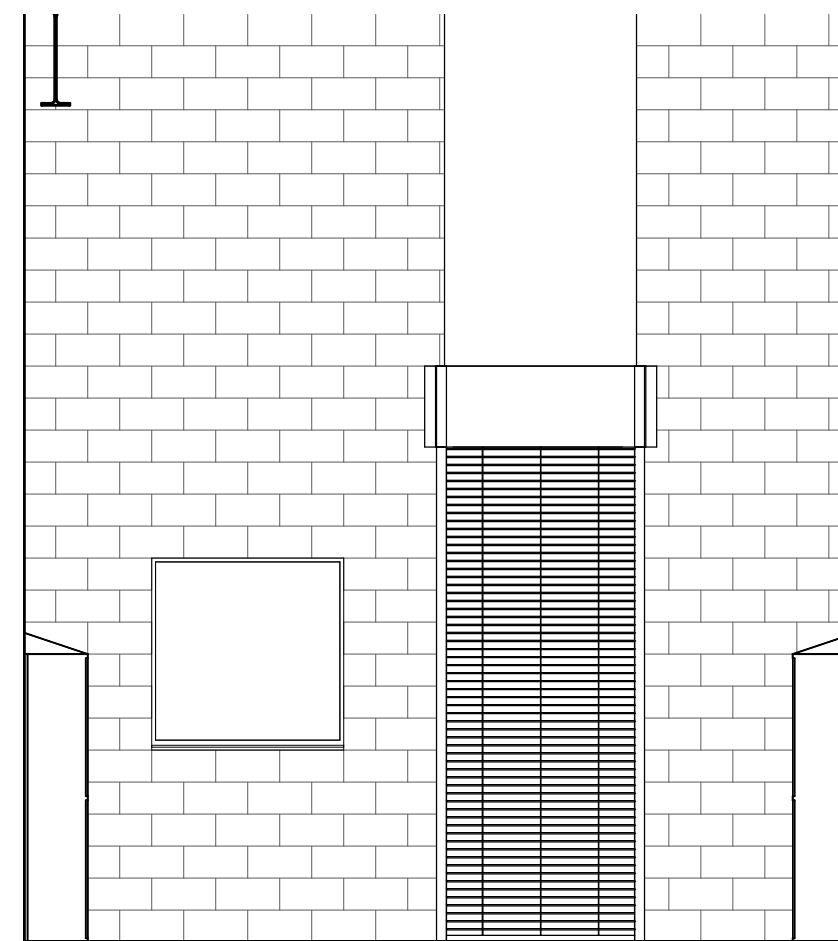


10 TEAM LOCKER D117C - SOUTH
1/4" = 1'-0"

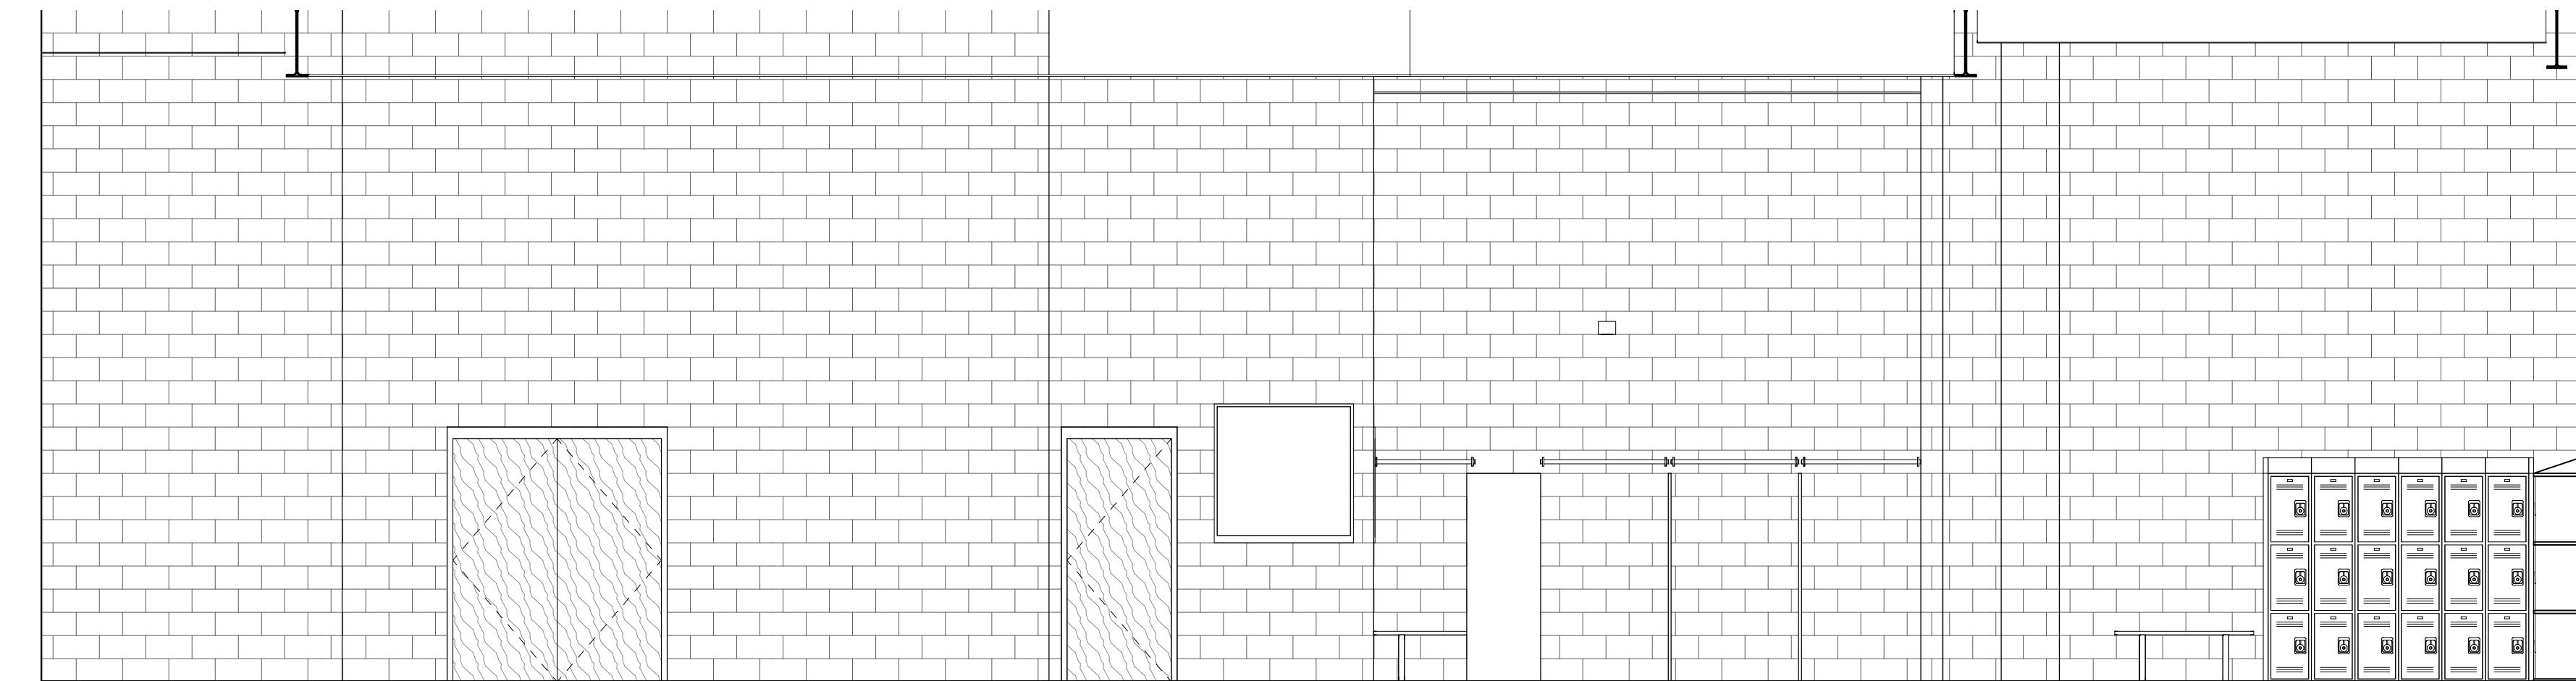


11 GIRLS LOCKER D122 - NORTH
1/4" = 1'-0"

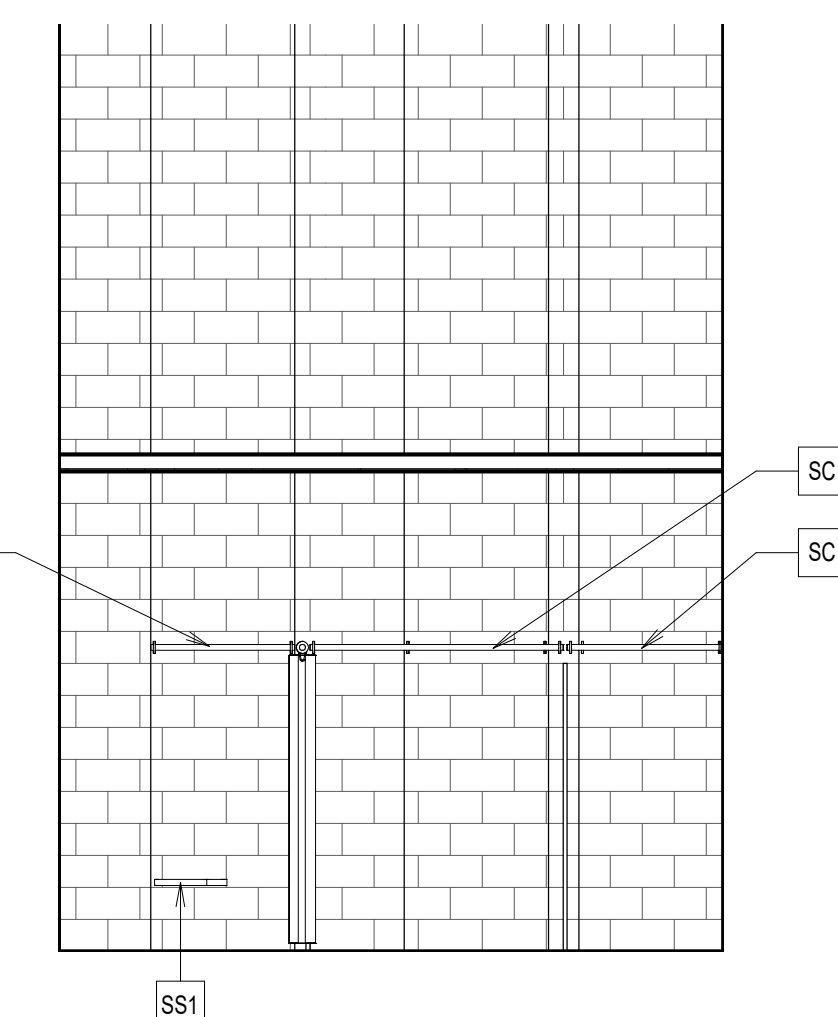


1 TLT / SHOWER D117A - NORTH
1/4" = 1'-0"

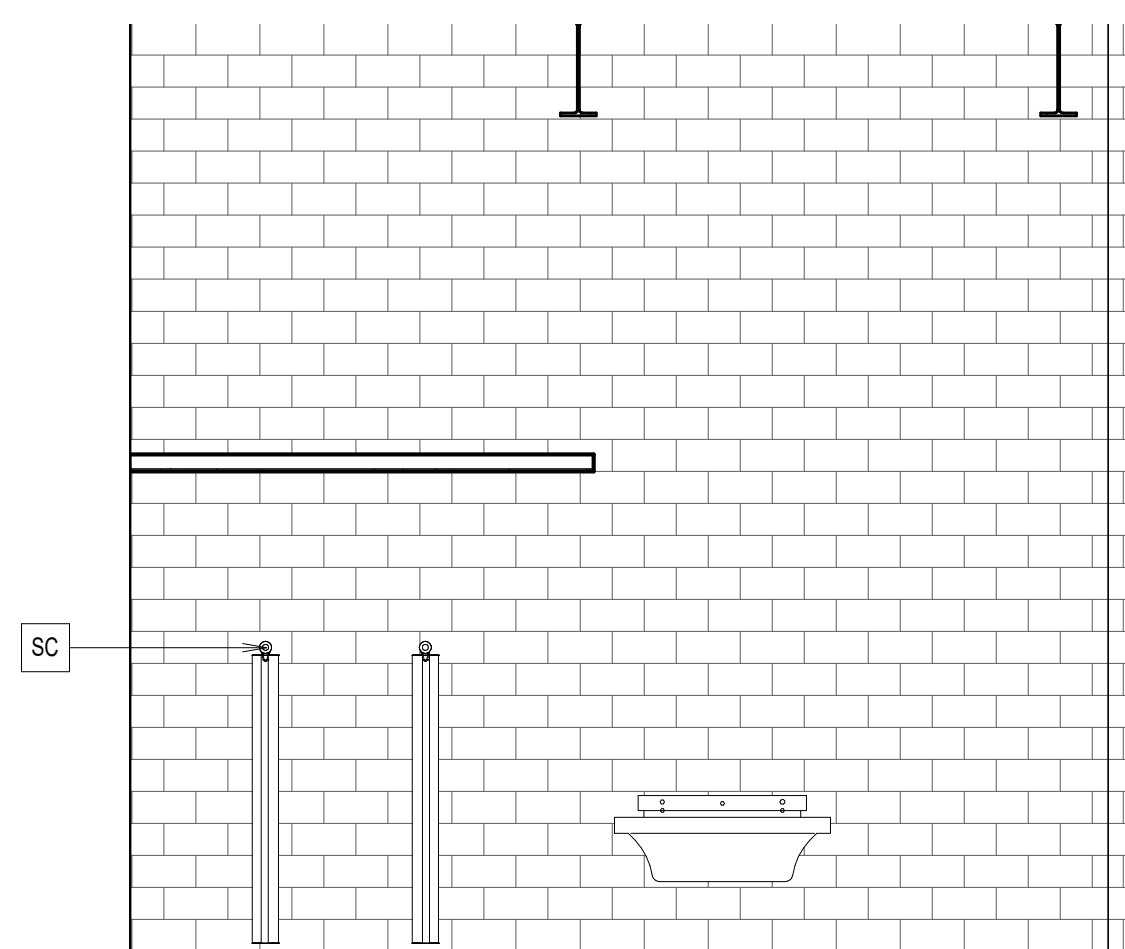


2 TLT / SHOWER D117A - EAST
1/4" = 1'-0"

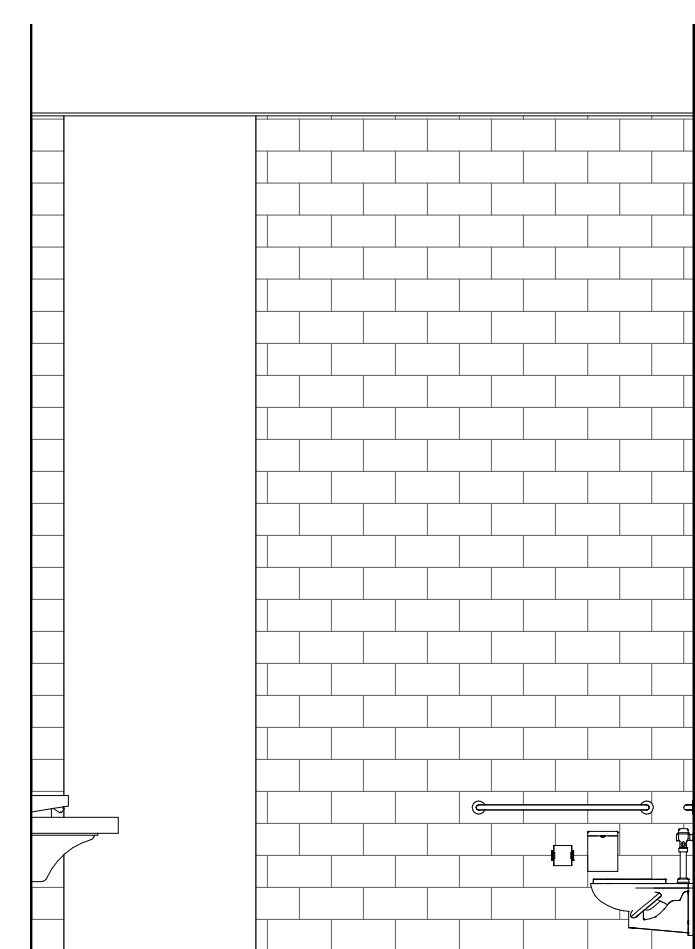


3 TLT / SHOWER D117A - SOUTH
1/4" = 1'-0"

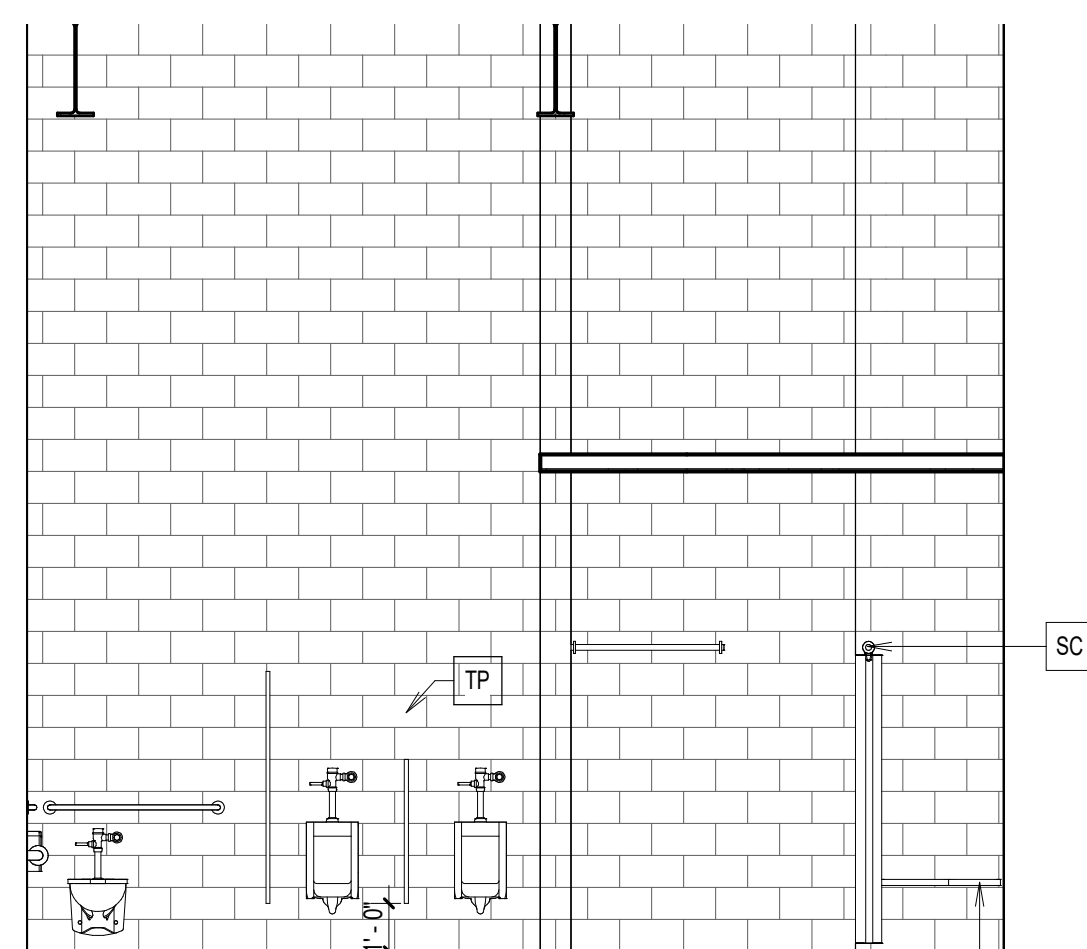

4 TLT / SHOWER D117A - WEST
1/4" = 1'-0"

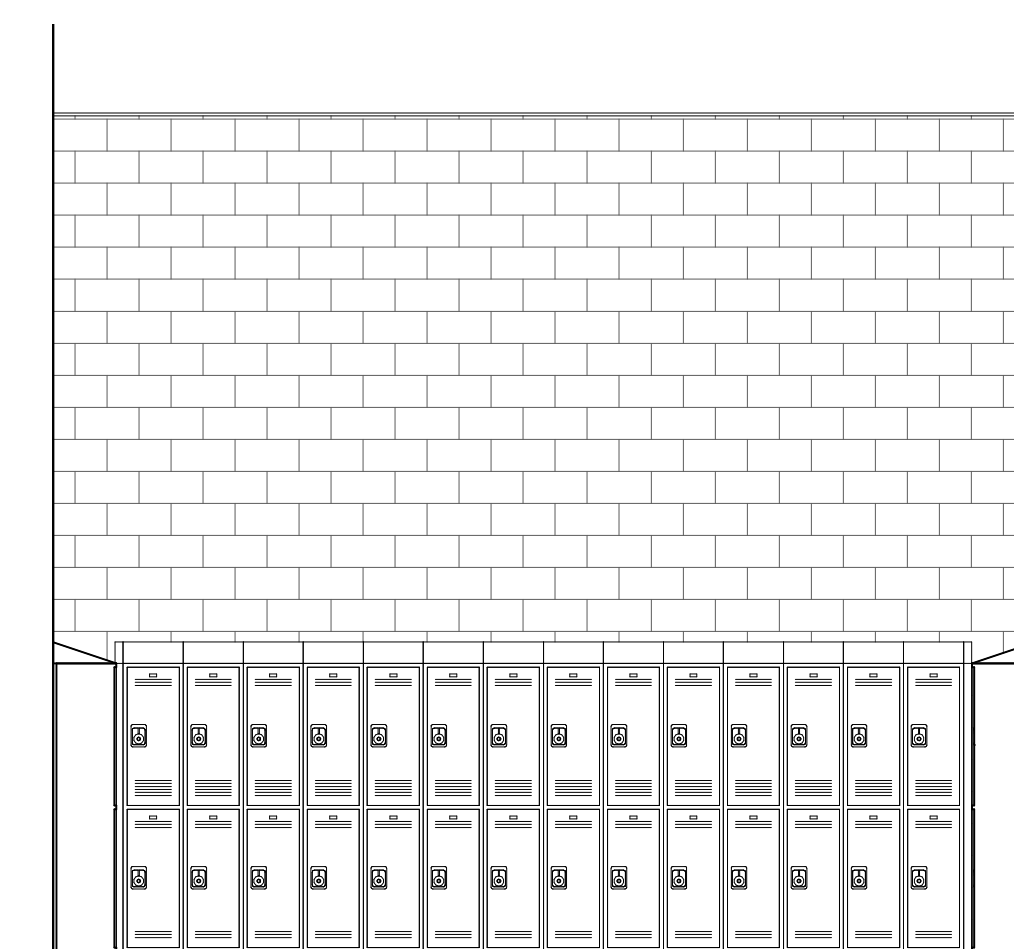

5 TEAM LOCKER D117B - NORTH
1/4" = 1'-0"

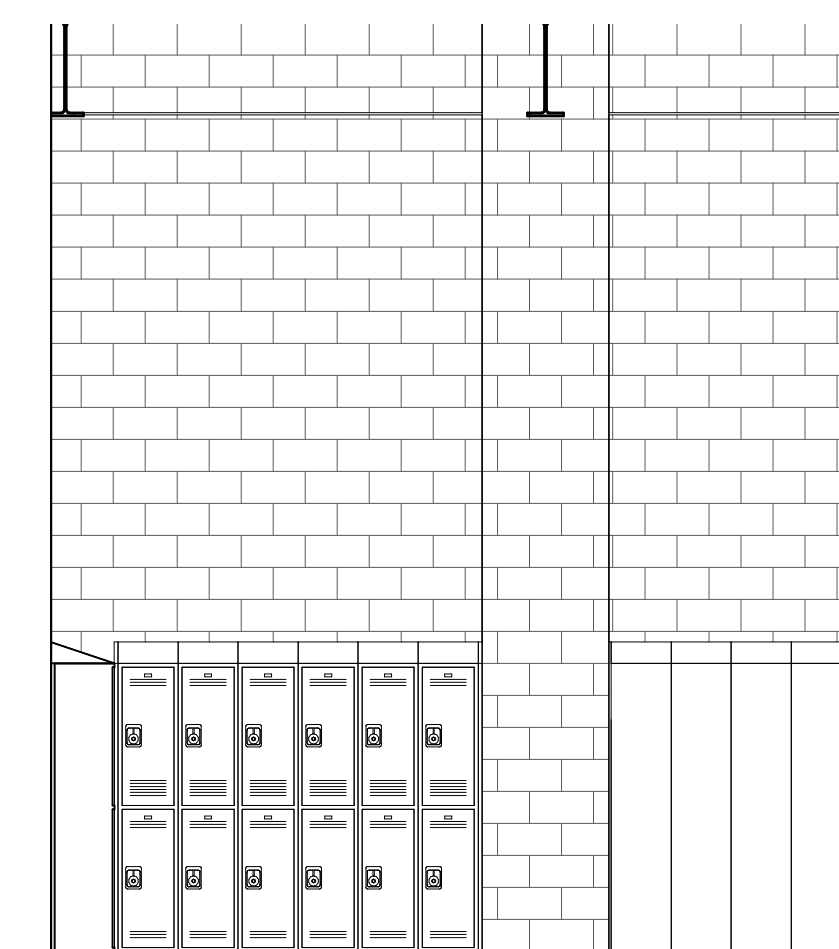


6 TEAM LOCKER D117B - EAST
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

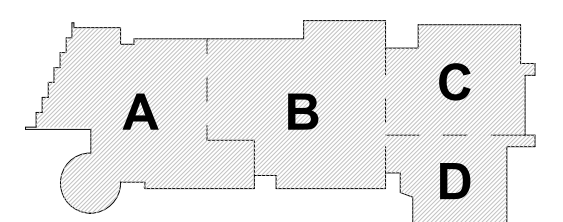


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**TOILET AND
LOCKER ROOM
ELEVATIONS**

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A4-1-5

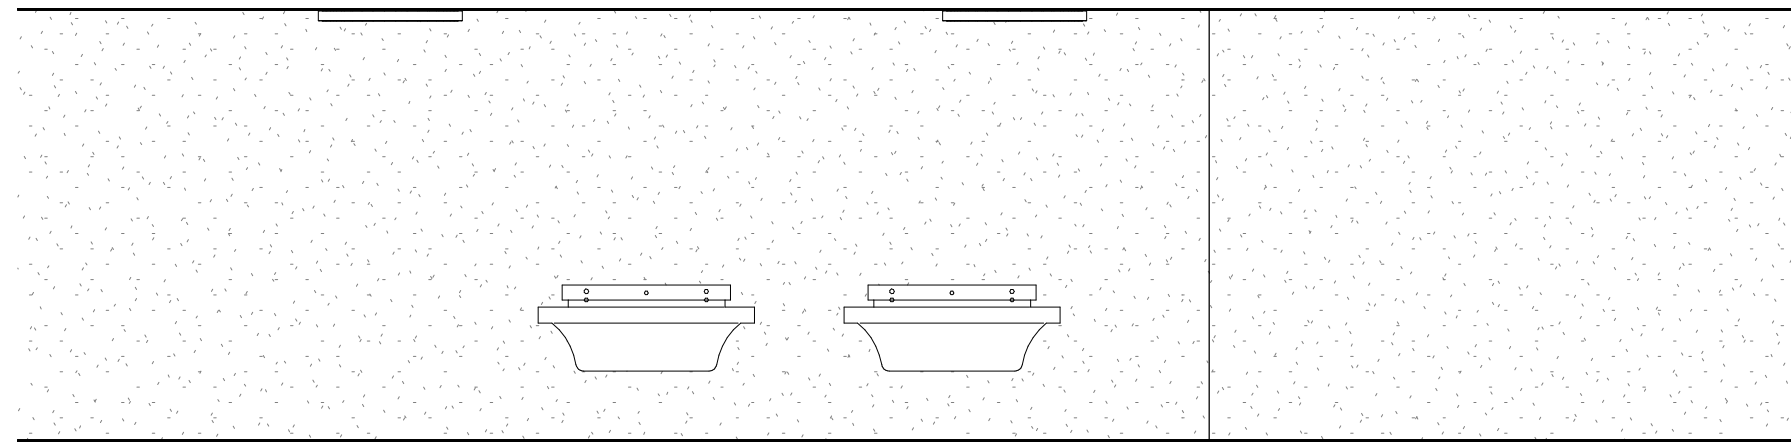


55 TLT B228 - NORTH
1/4" = 1'-0"

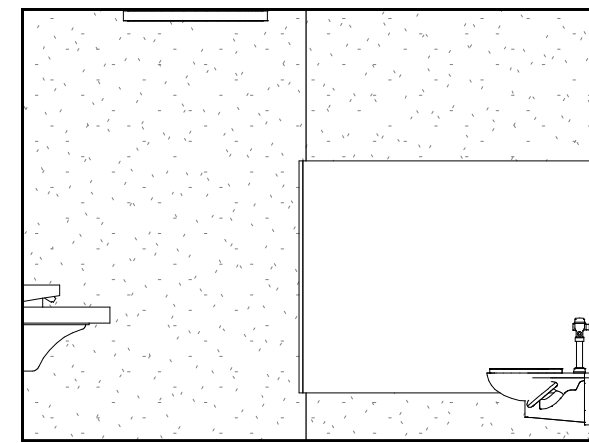


56 TLT B228 - EAST
1/4" = 1'-0"

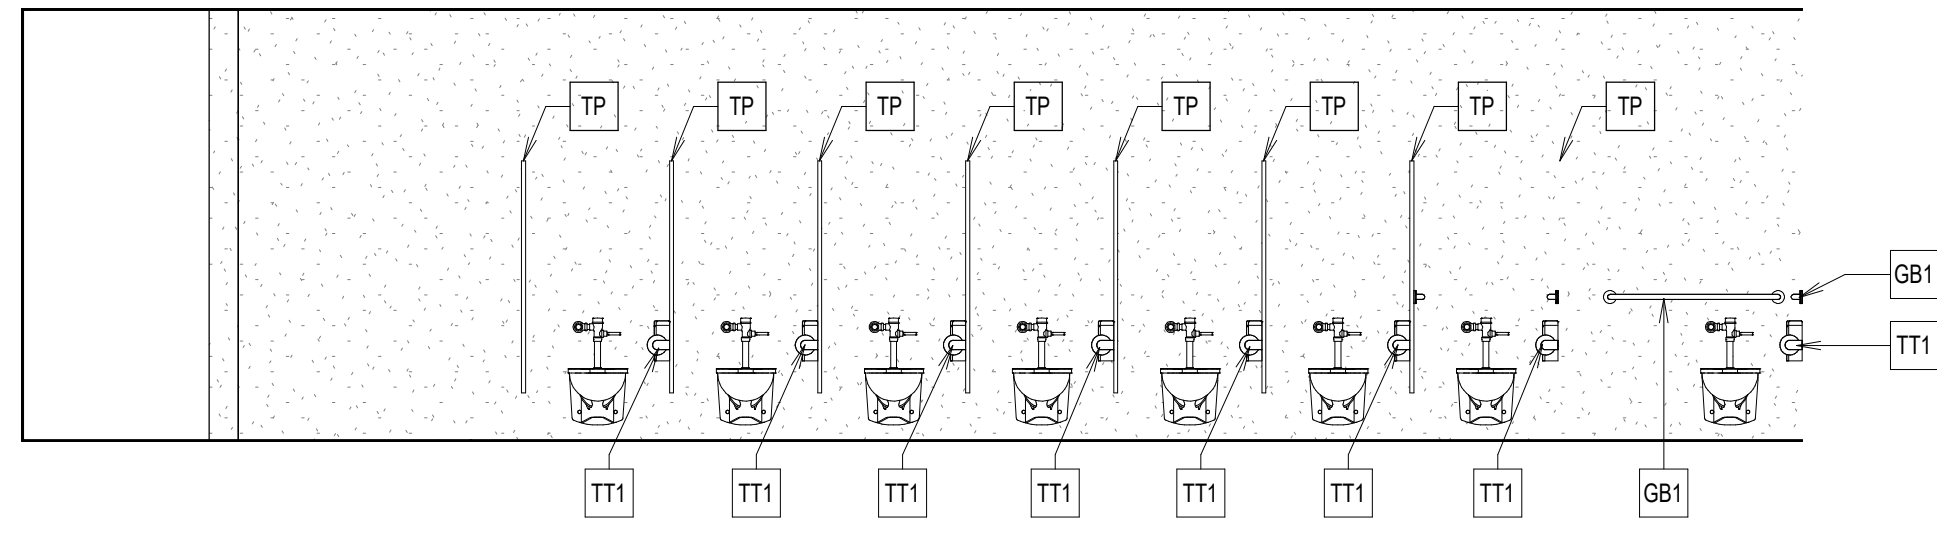


57 TLT B228 - SOUTH
1/4" = 1'-0"

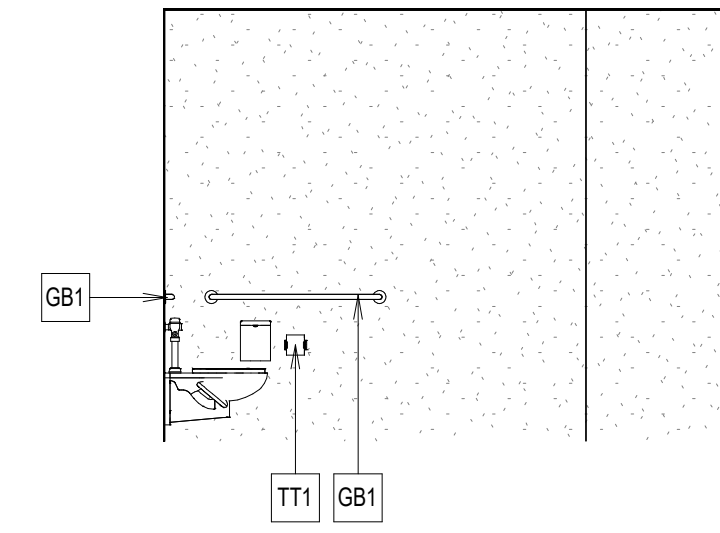


58 TLT B228 - WEST
1/4" = 1'-0"

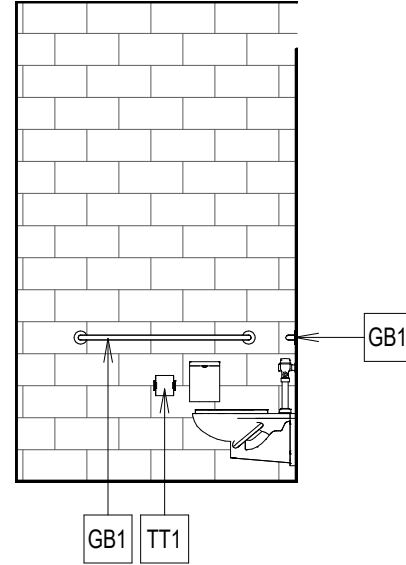


45 NURSE TLT D107 - EAST
1/4" = 1'-0"

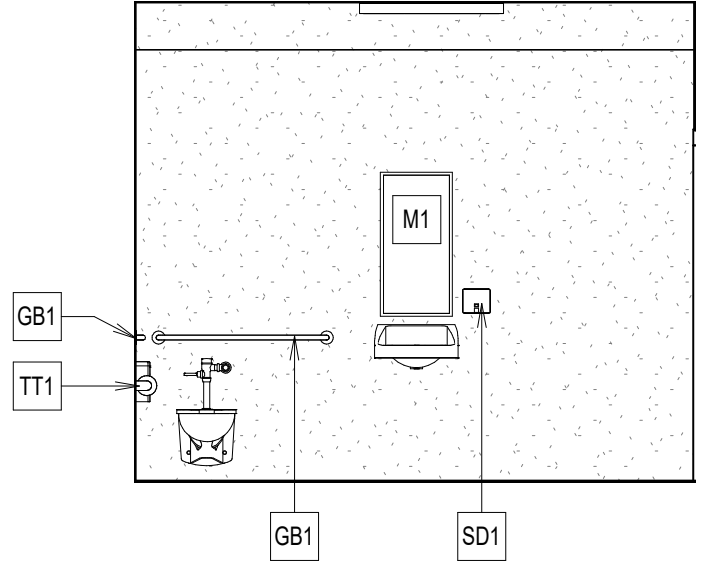


46 NURSE TLT D107 - SOUTH
1/4" = 1'-0"

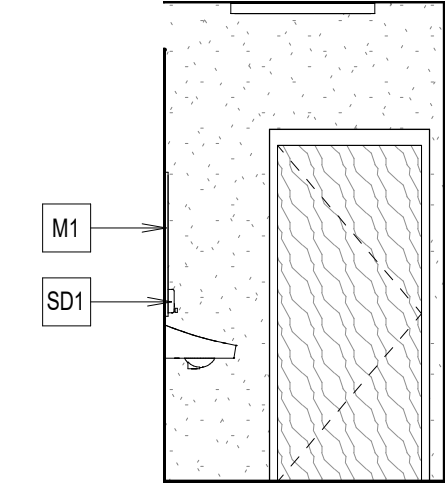


47 NURSE TLT D107 - WEST
1/4" = 1'-0"

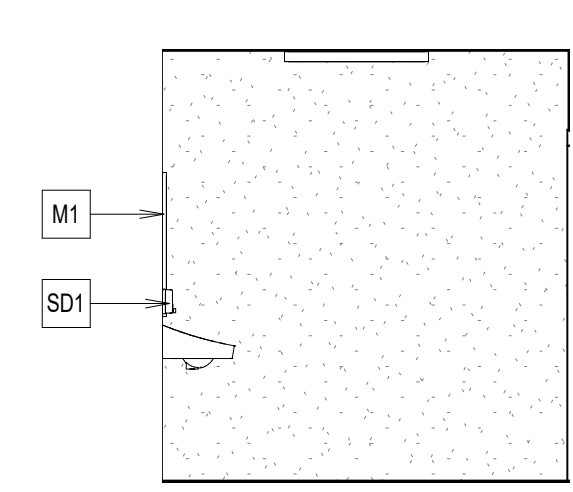


48 TLT B203F - NORTH
1/4" = 1'-0"

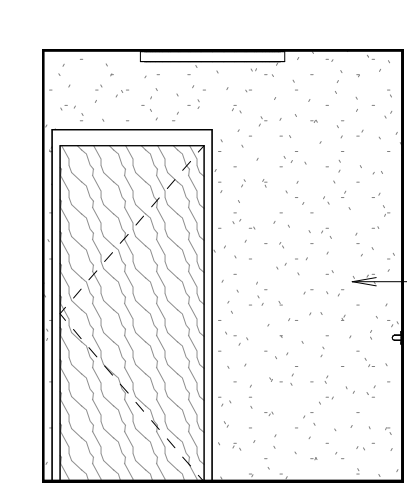


49 TLT B203F - EAST
1/4" = 1'-0"

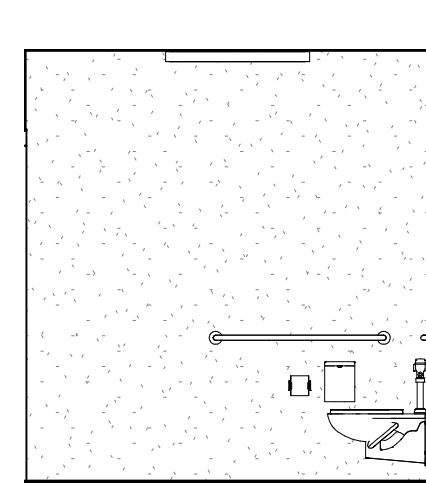


50 TLT B203F - SOUTH
1/4" = 1'-0"

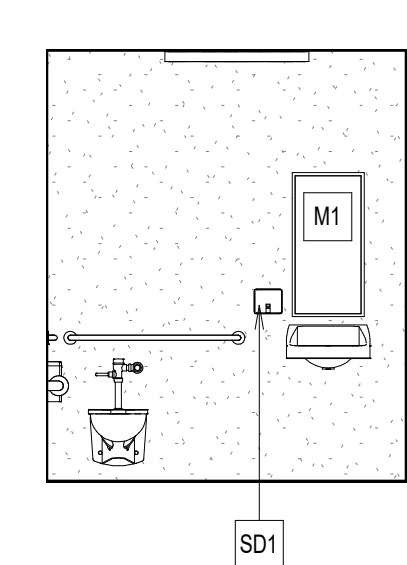


51 TLT 203F - WEST
1/4" = 1'-0"

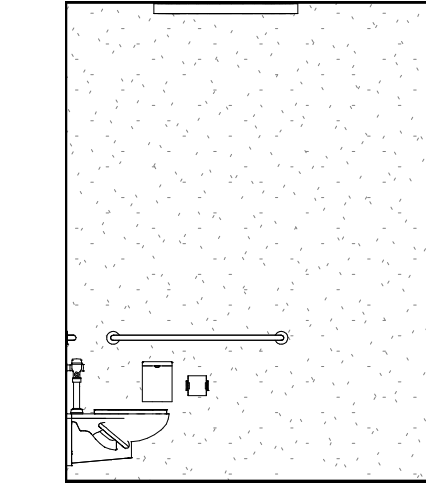


52 TLT B234A - NORTH
1/4" = 1'-0"

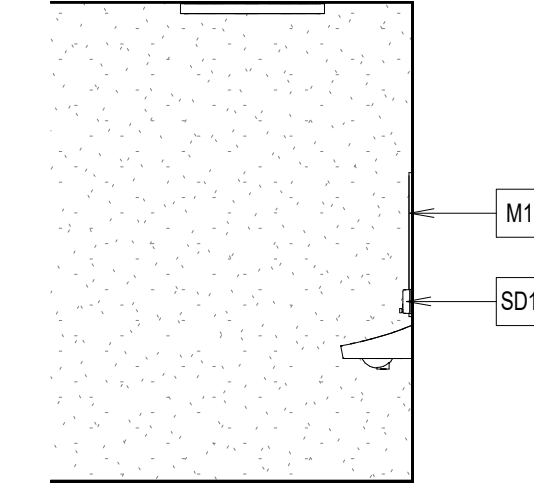


53 TLT B234A - SOUTH
1/4" = 1'-0"

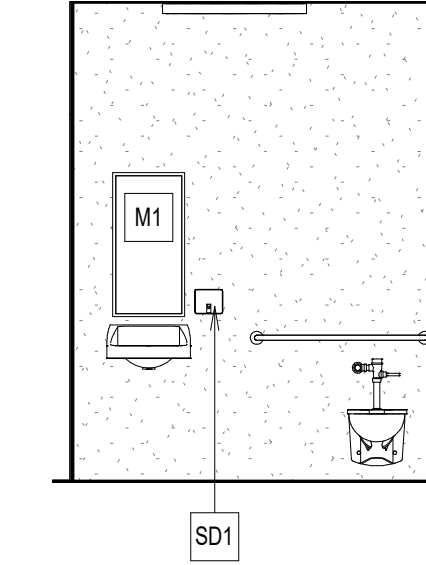


54 TLT B234A - WEST
1/4" = 1'-0"

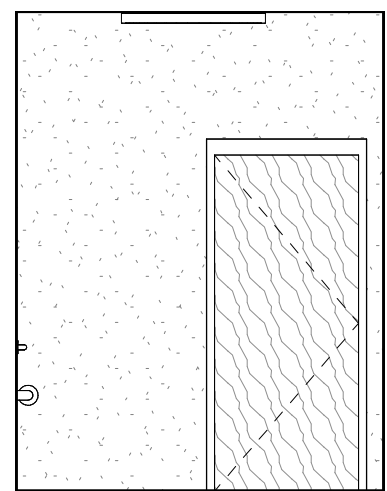


38 TLT C107 - SOUTH
1/4" = 1'-0"

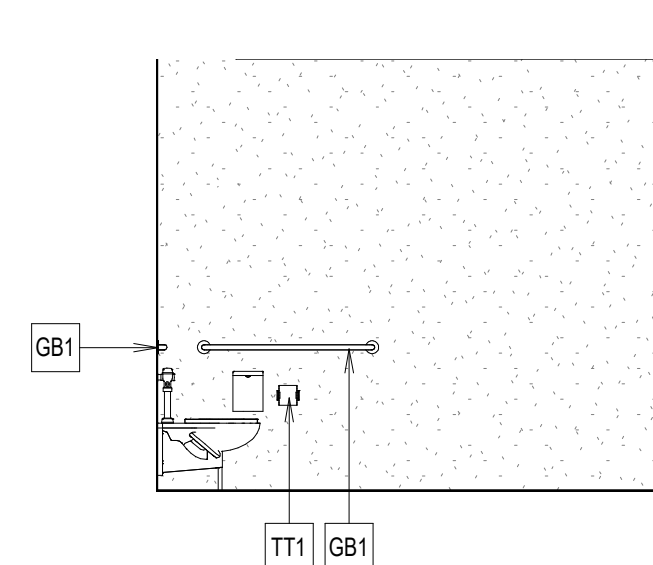


39 TLT C112 - NORTH
1/4" = 1'-0"

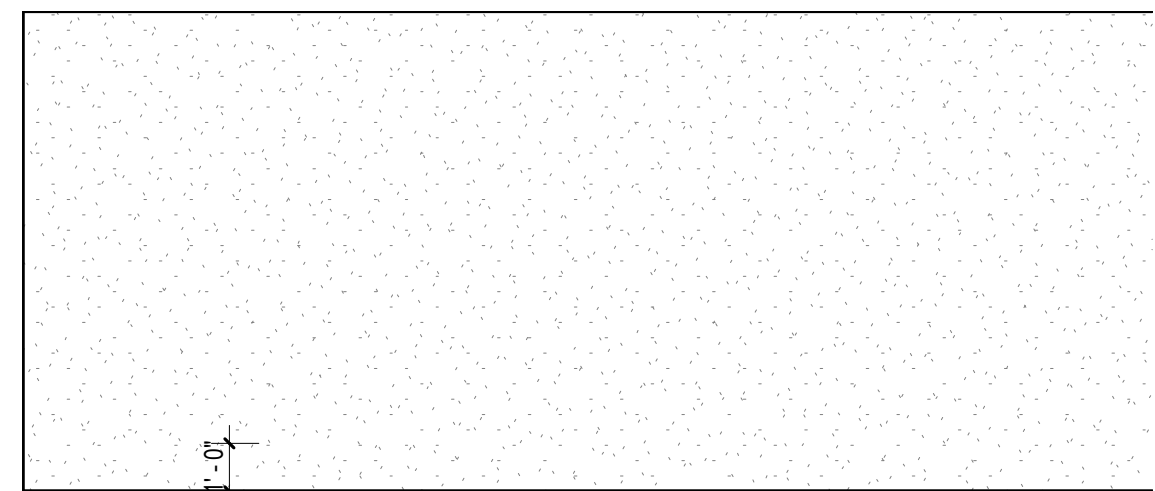


40 TLT C112 - EAST
1/4" = 1'-0"

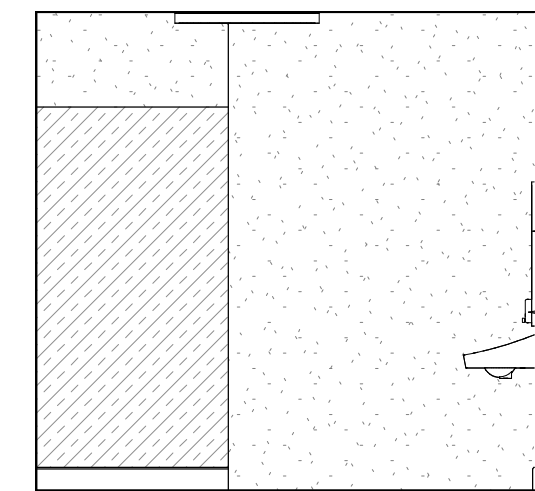


41 TOILET C112 - SOUTH
1/4" = 1'-0"

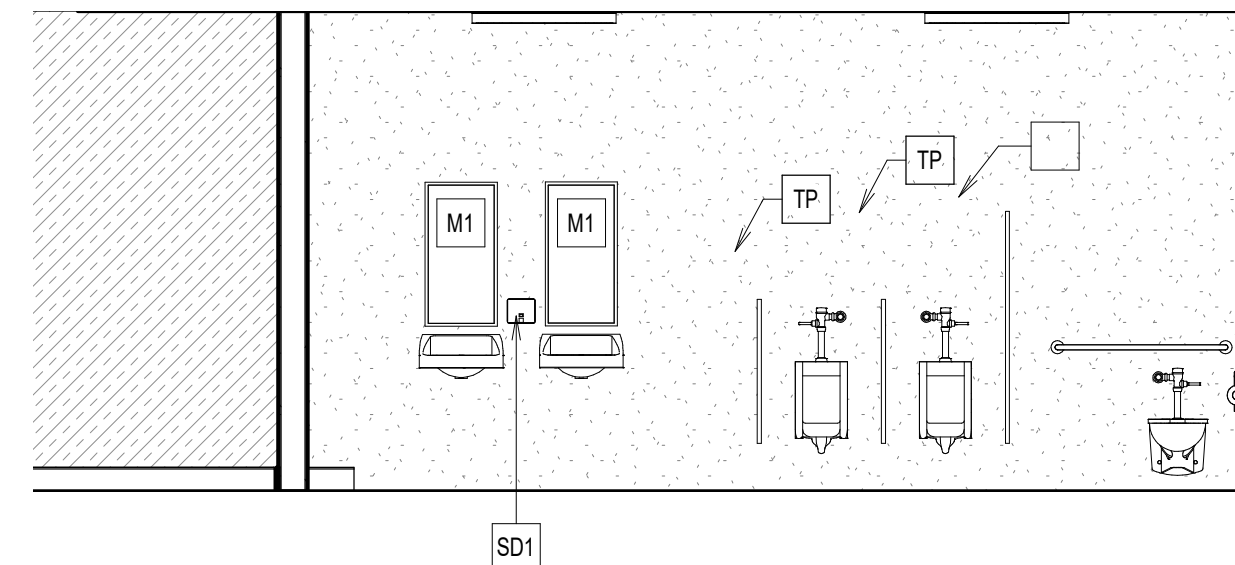


42 TOILET C112 - WEST
1/4" = 1'-0"

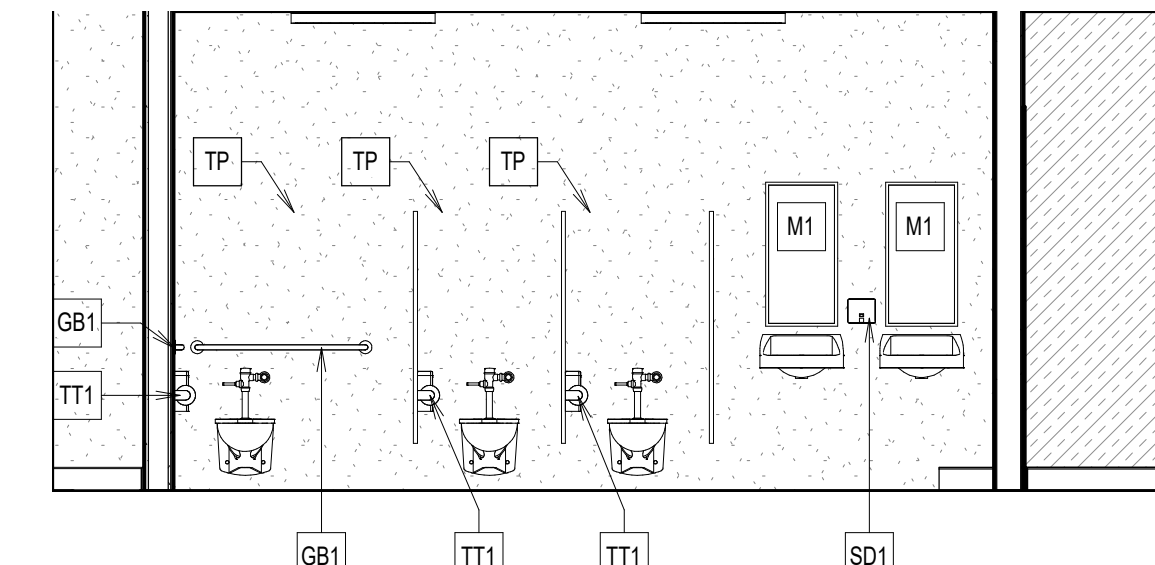


43 TLT C113 - WEST
1/4" = 1'-0"

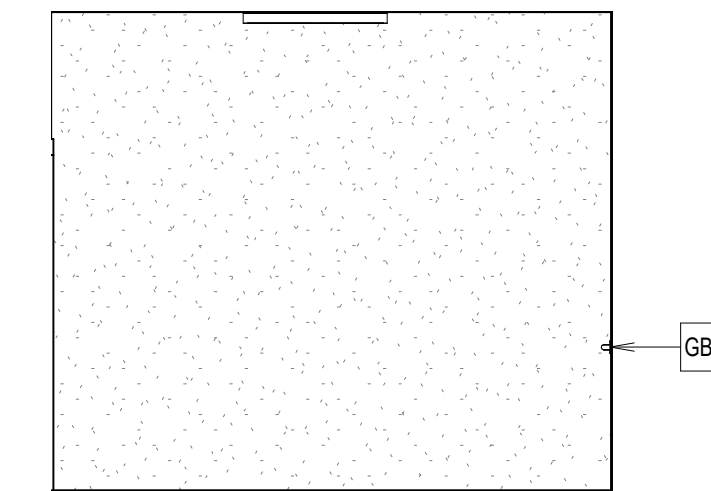


44 NURSE TLT D107 - NORTH
1/4" = 1'-0"

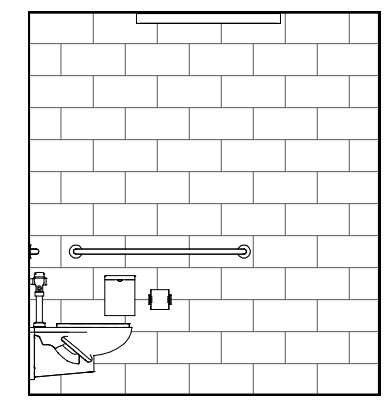


28 TLT B101C - EAST
1/4" = 1'-0"

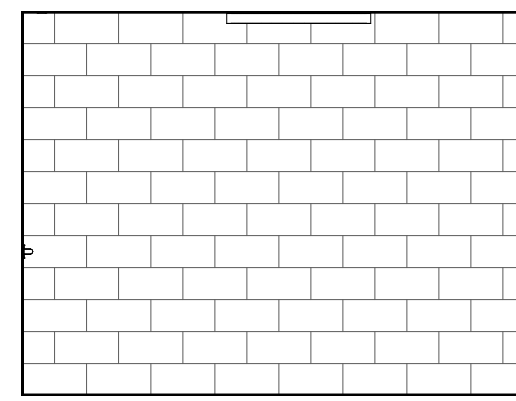


29 TLT B101C - SOUTH
1/4" = 1'-0"

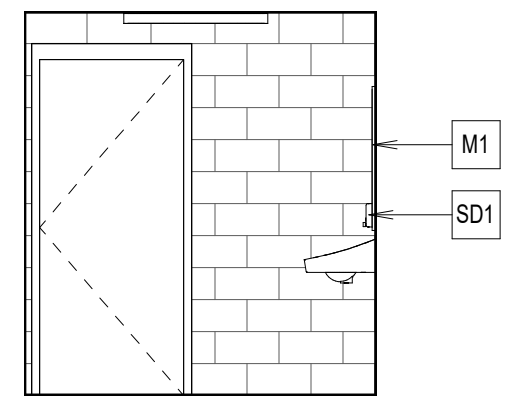


30 TLT B101C - WEST
1/4" = 1'-0"

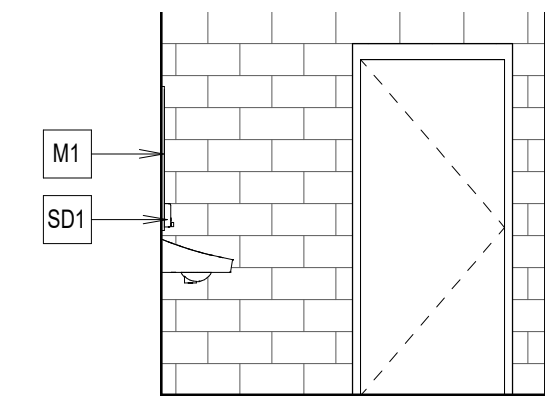


31 TOILET B104E - NORTH
1/4" = 1'-0"

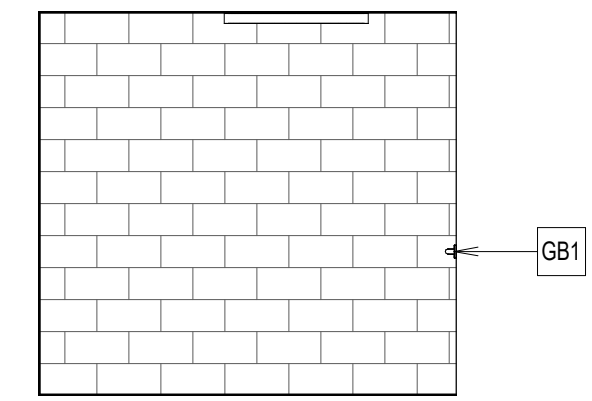


32 TOILET B104E - EAST
1/4" = 1'-0"

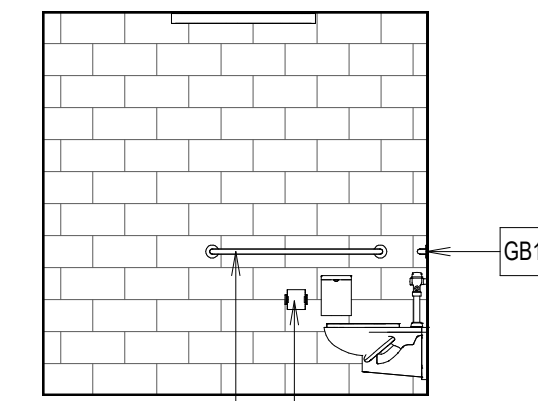


33 TOILET B104E - SOUTH
1/4" = 1'-0"

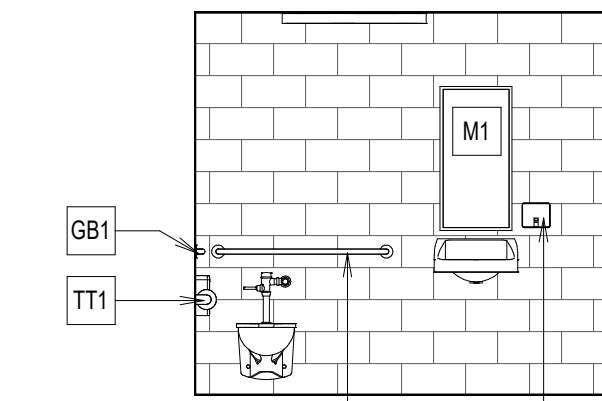


34 TOILET B104E - WEST
1/4" = 1'-0"

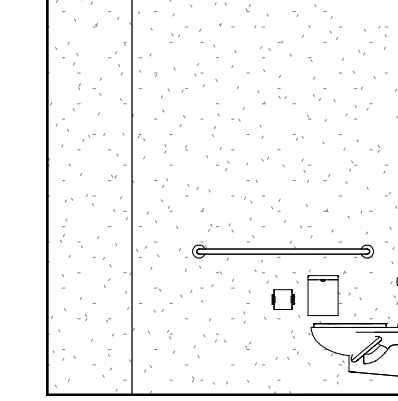


35 TLT B117 - NORTH
1/4" = 1'-0"

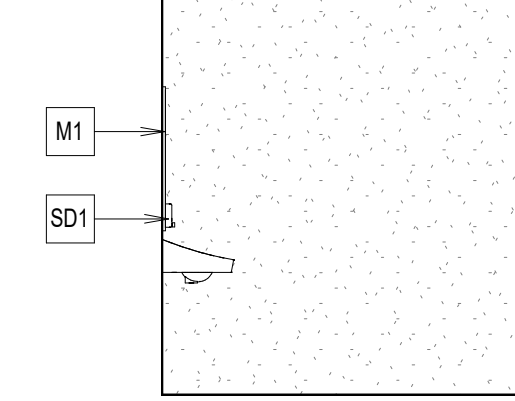


36 TLT B117 - SOUTH
1/4" = 1'-0"

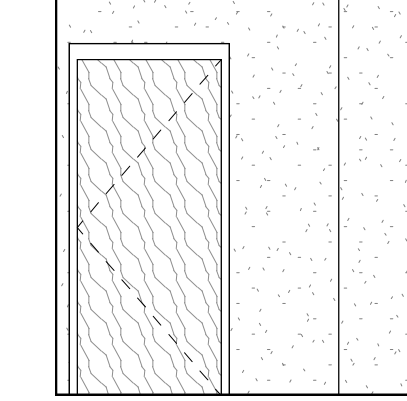


37 TLT B117 - WEST
1/4" = 1'-0"

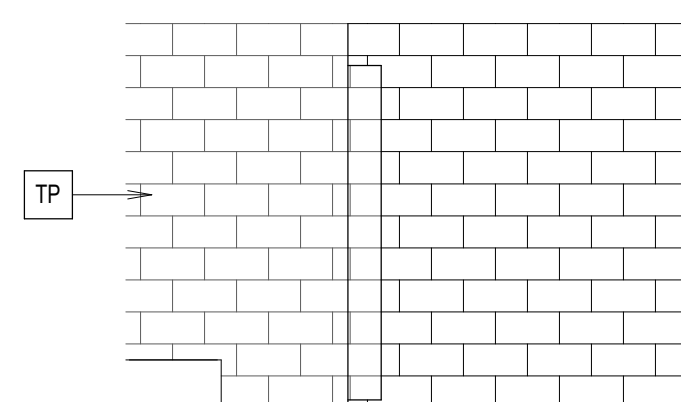


19 TOILET A142 - SOUTH
1/4" = 1'-0"

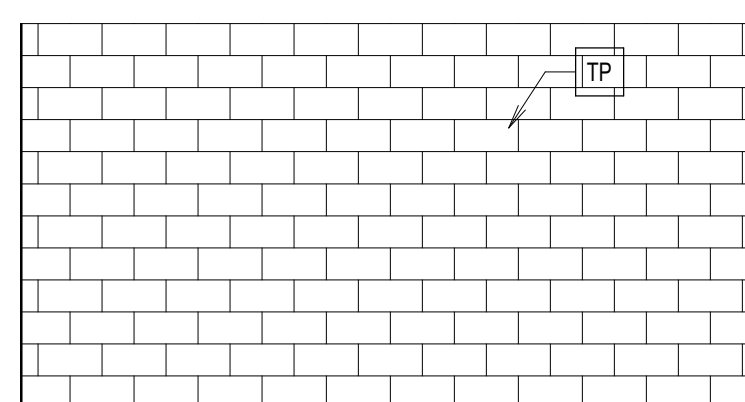


20 TOILET A142 - WEST
1/4" = 1'-0"

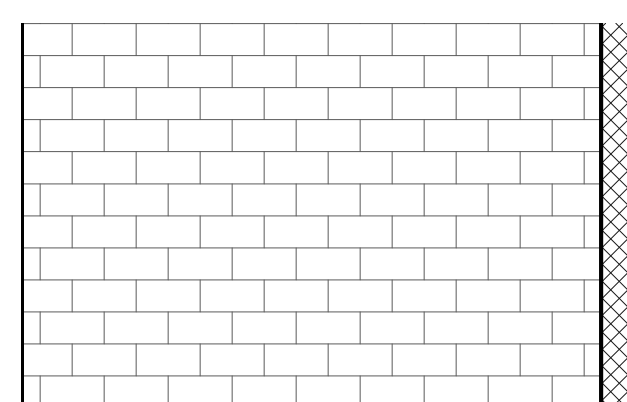


21 TOILET A143 - SOUTH
1/4" = 1'-0"

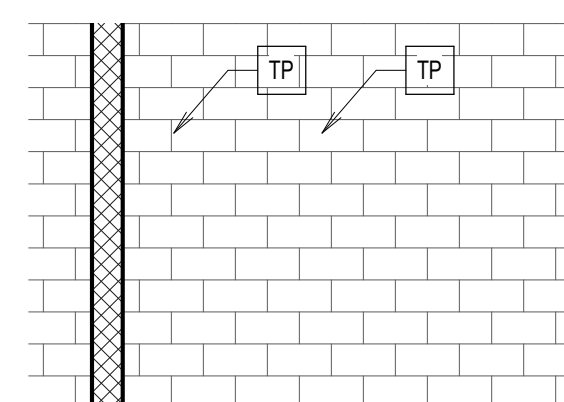


22 TOILET A143 - WEST
1/4" = 1'-0"

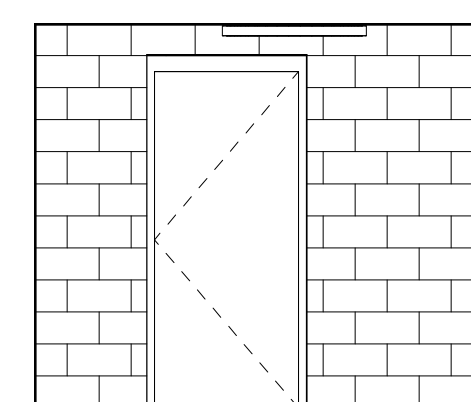


23 TLT A141H - NORTH
1/4" = 1'-0"

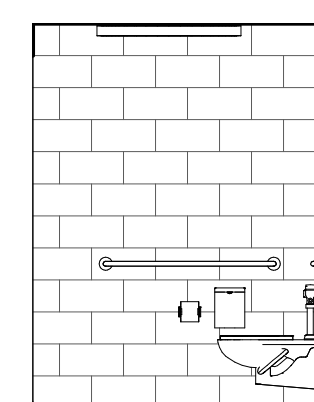


24 TLT A141H - EAST
1/4" = 1'-0"

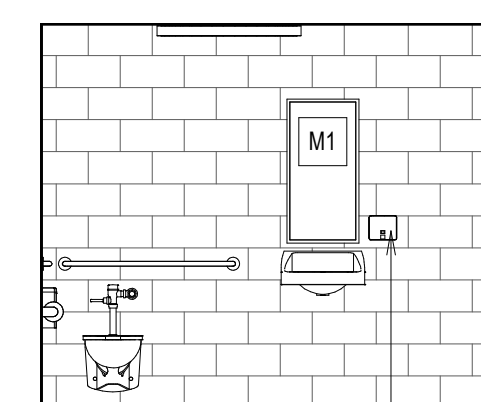


25 TLT A141H - SOUTH
1/4" = 1'-0"

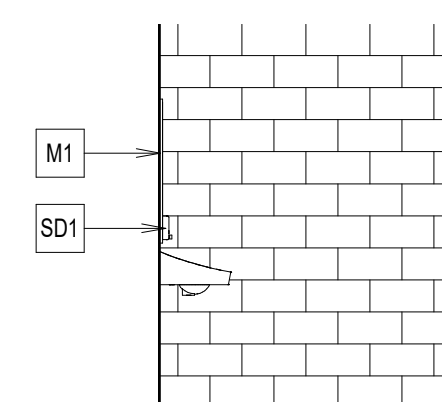


26 TLT A141H - WEST
1/4" = 1'-0"

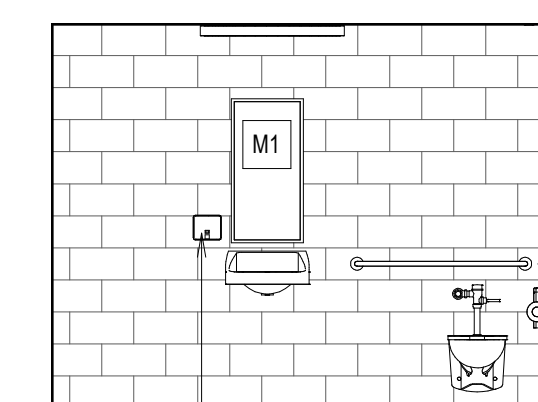


27 TLT B101C - NORTH
1/4" = 1'-0"

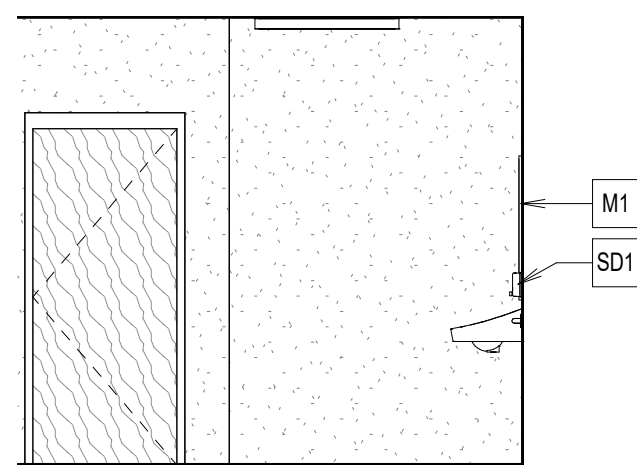


10 TLT A133 - EAST
1/4" = 1'-0"

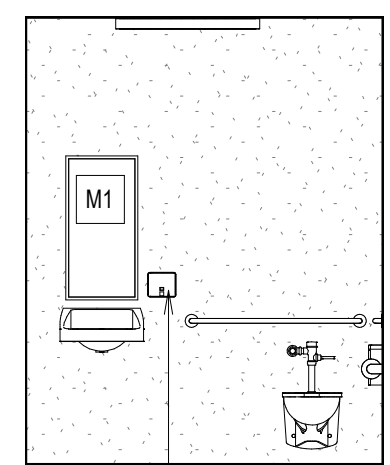


11 TLT A133 - SOUTH
1/4" = 1'-0"

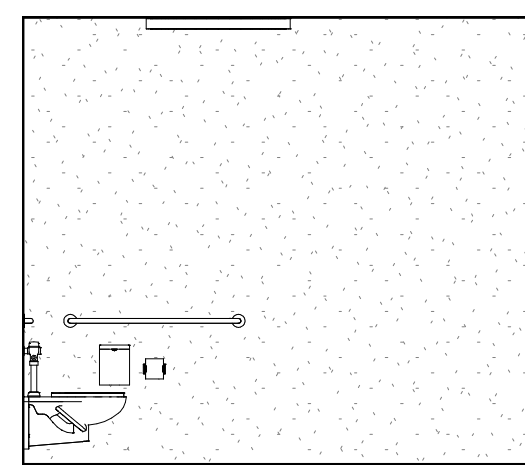


12 TLT A133 - WEST
1/4" = 1'-0"

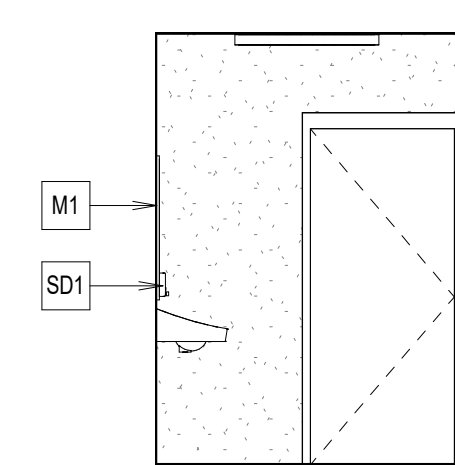


13 TOILET 148B - NORTH
1/4" = 1'-0"

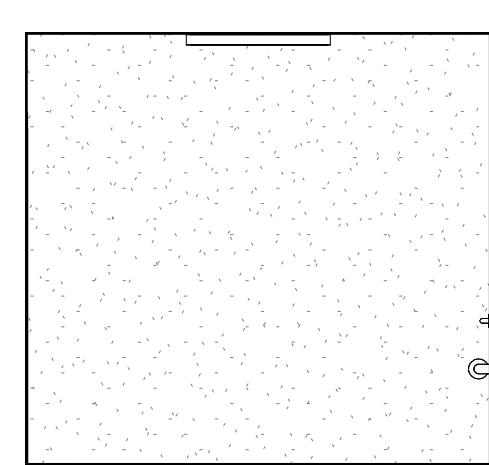


14 TOILET A148B - EAST
1/4" = 1'-0"

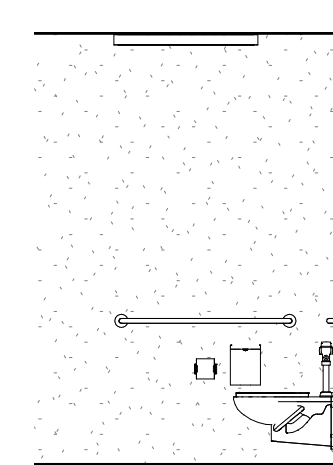


15 TOILET 148B - SOUTH
1/4" = 1'-0"

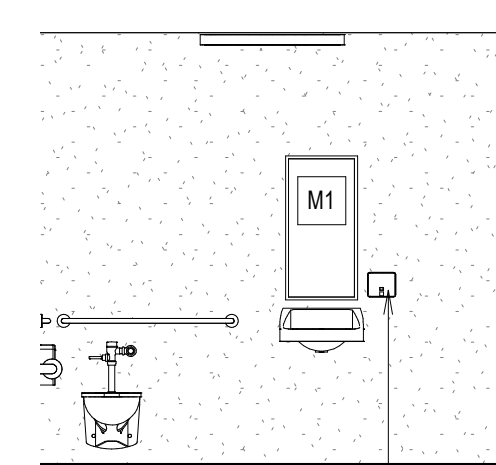


16 TOILET 148B - WEST
1/4" = 1'-0"

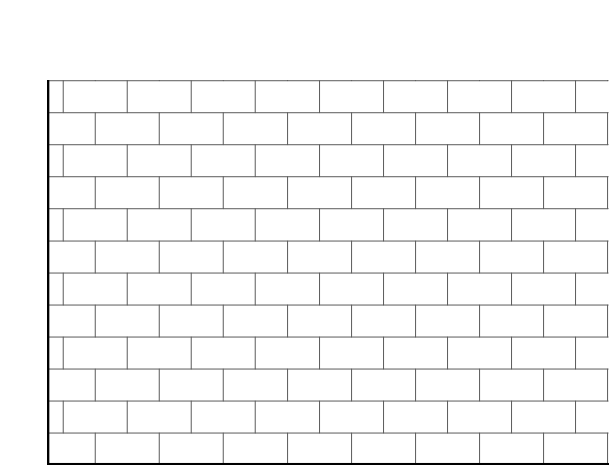


17 TOILET A142 - NORTH
1/4" = 1'-0"

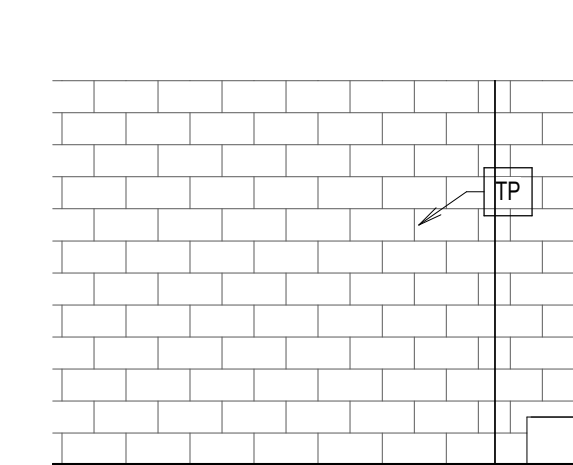


18 TOILET A142 - EAST
1/4" = 1'-0"

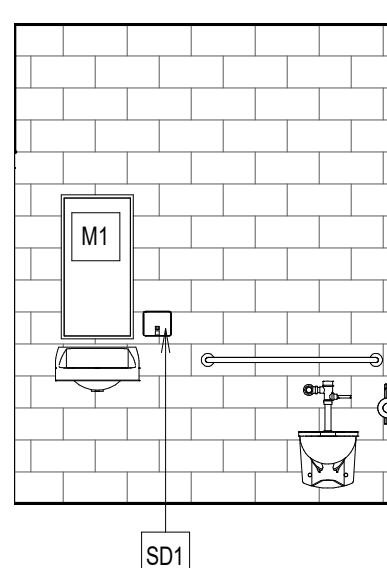


1 OFFICIALS D123 - NORTH
1/4" = 1'-0"

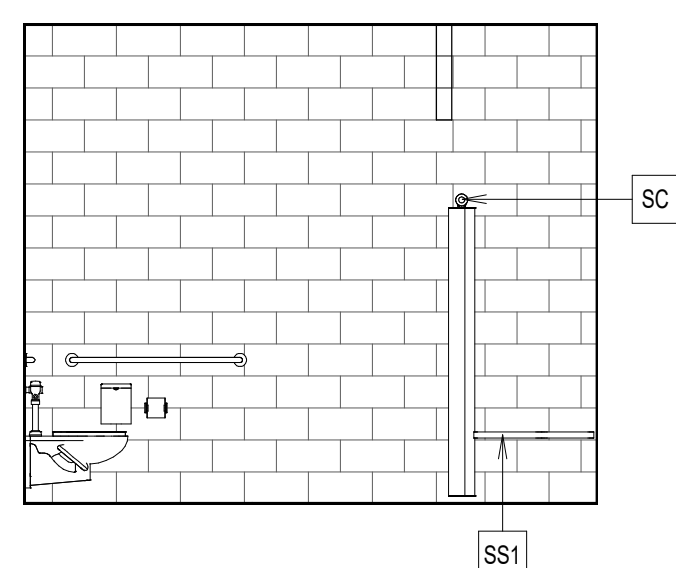


2 OFFICIALS D123 - EAST
1/4" = 1'-0"

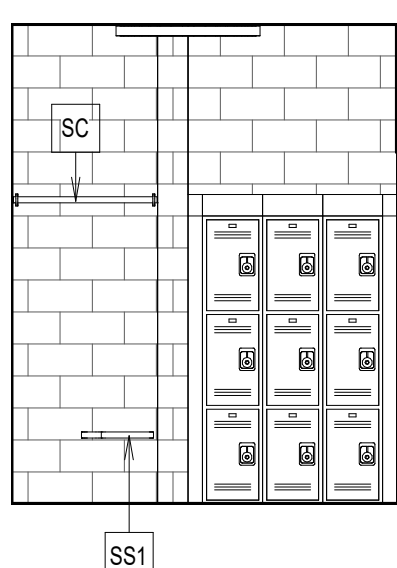


3 OFFICIALS D123 - SOUTH
1/4" = 1'-0"

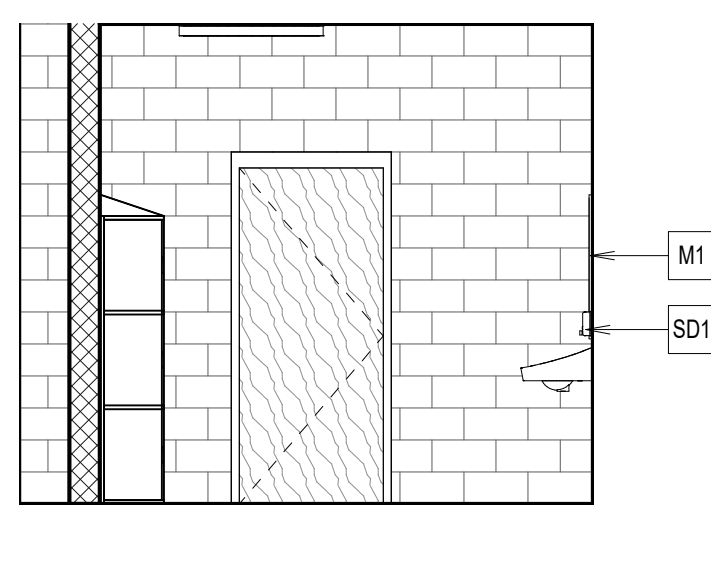


4 OFFICIALS D115D - WEST
1/4" = 1'-0"

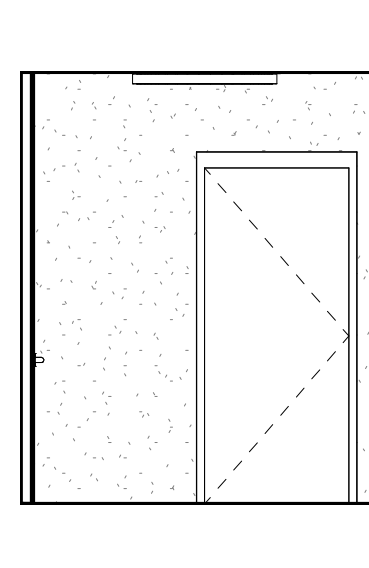


5 TLT A106 - NORTH
1/4" = 1'-0"

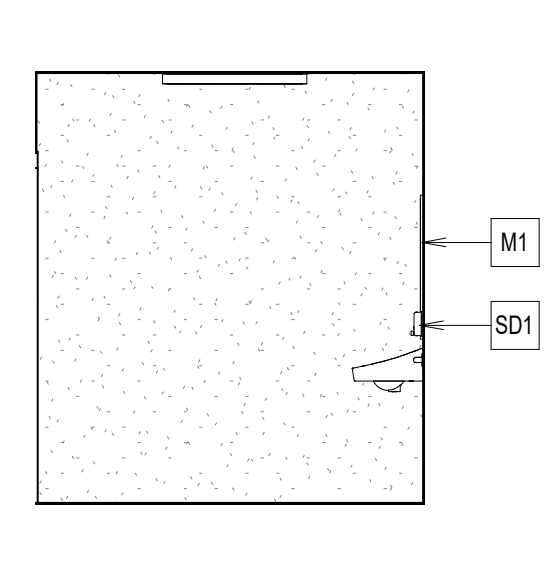


6 TLT A106 - EAST
1/4" = 1'-0"

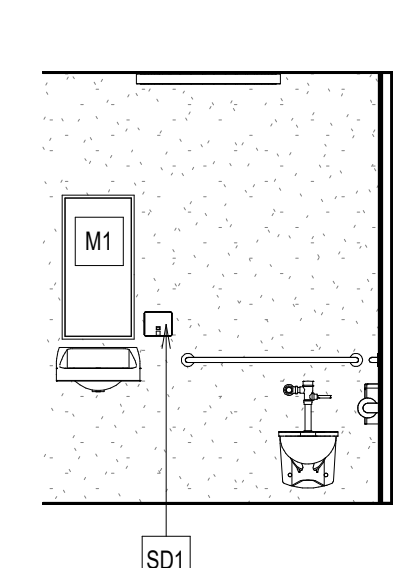


7 TLT A106 - SOUTH
1/4" = 1'-0"

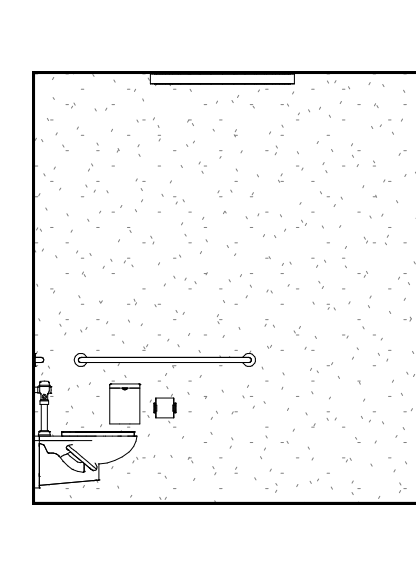


8 TLT A106 - WEST
1/4" = 1'-0"

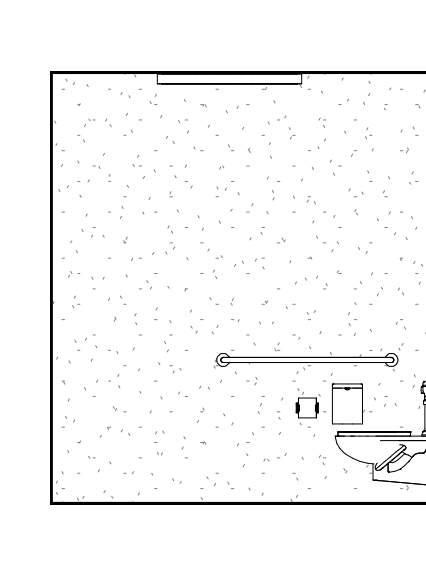


9 TLT A107 - EAST
1/4" = 1'-0"

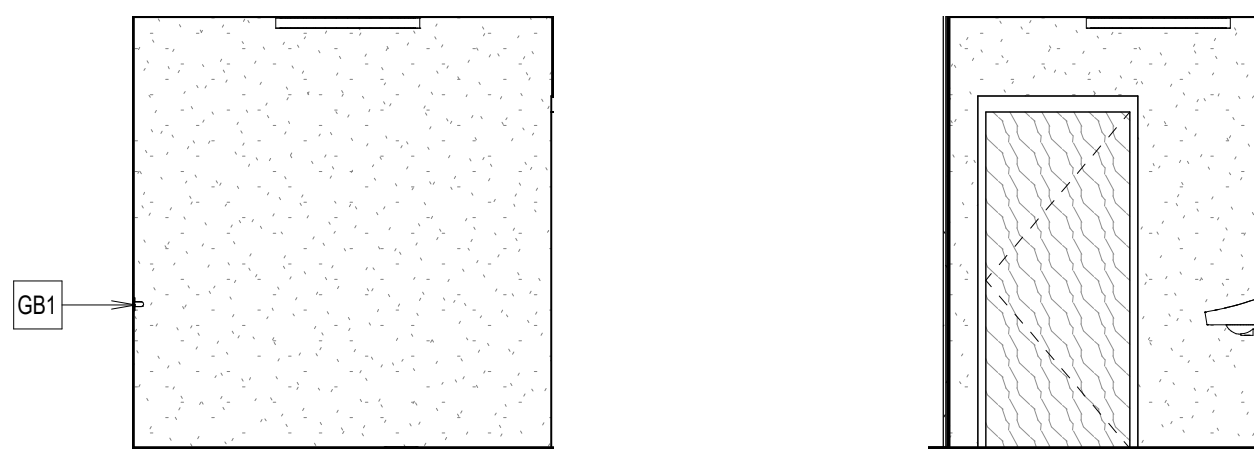


14 TLT B413 - EAST
1/4" = 1'-0"

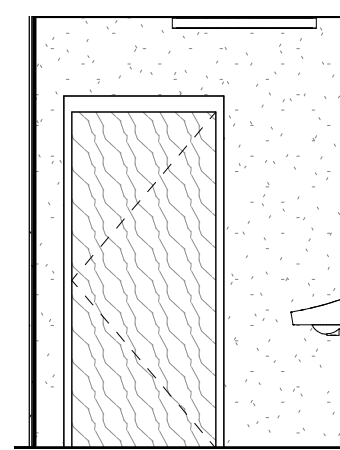


15 TLT B413 - SOUTH
1/4" = 1'-0"

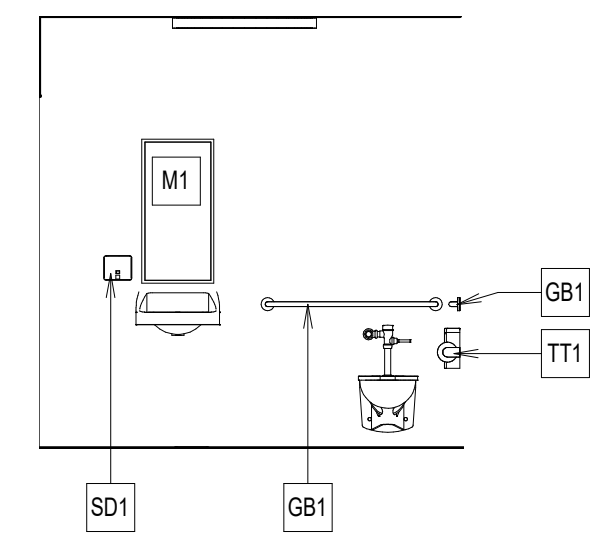


16 TLT B413 - WEST
1/4" = 1'-0"

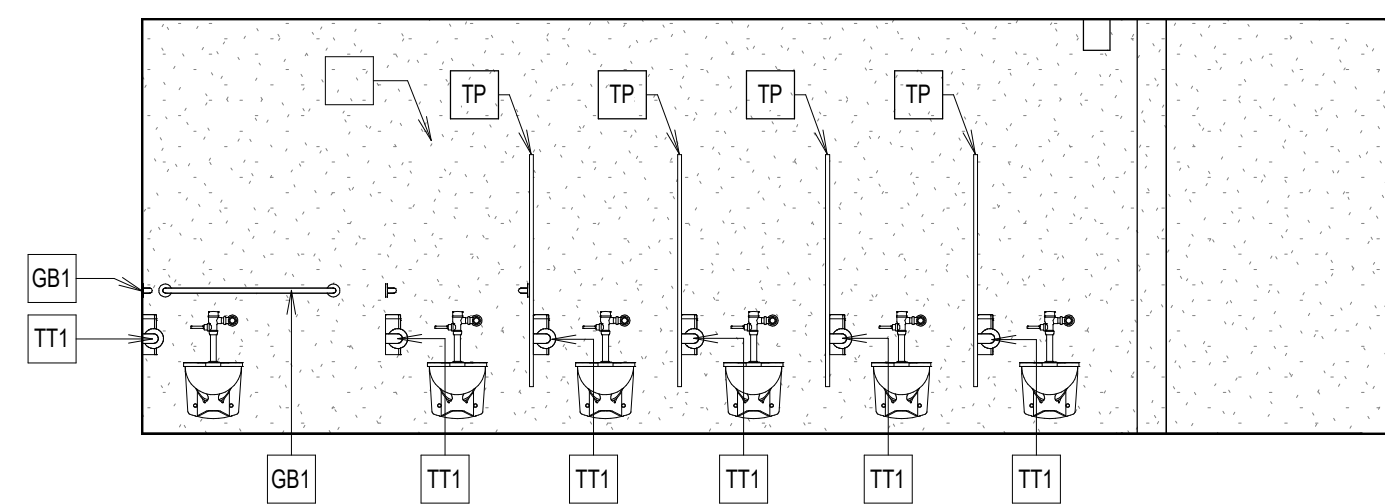


7 TLT A315 - SOUTH
1/4" = 1'-0"

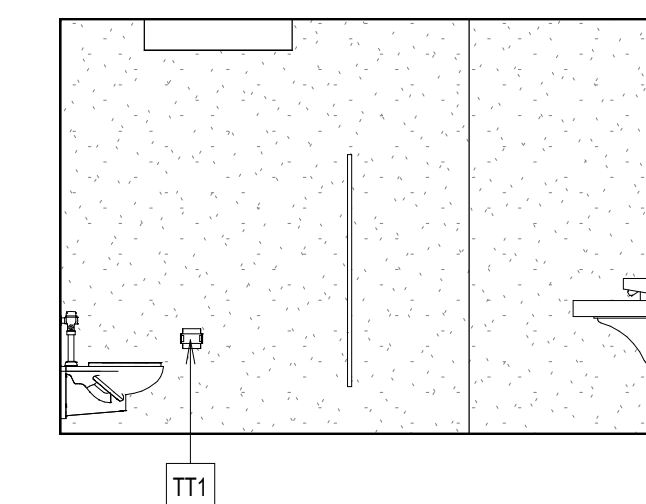


8 TLT A315 - WEST
1/4" = 1'-0"

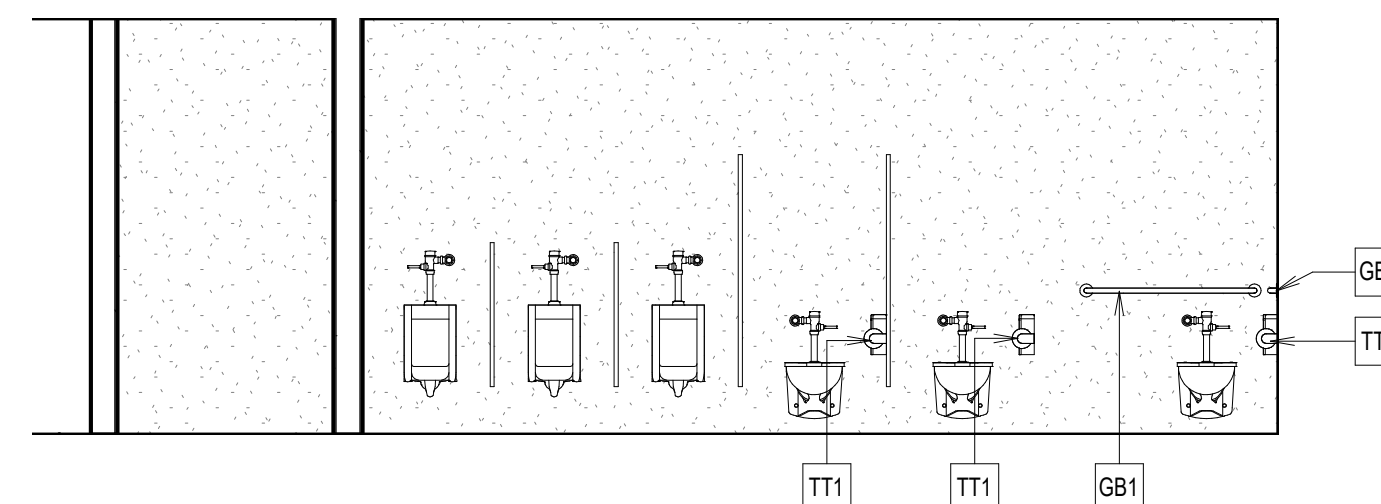


9 TLT A316 - NORTH
1/4" = 1'-0"

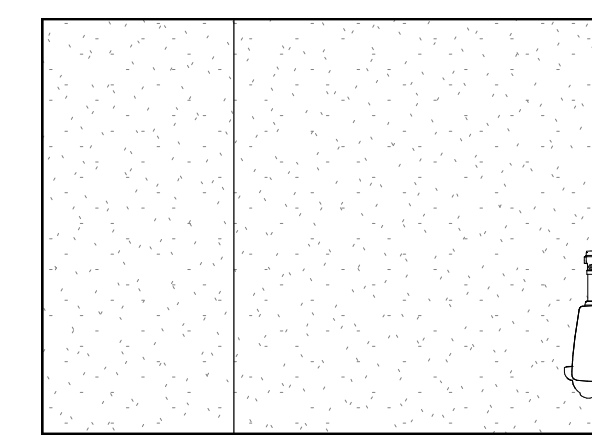


10 TLT A316 - WEST
1/4" = 1'-0"

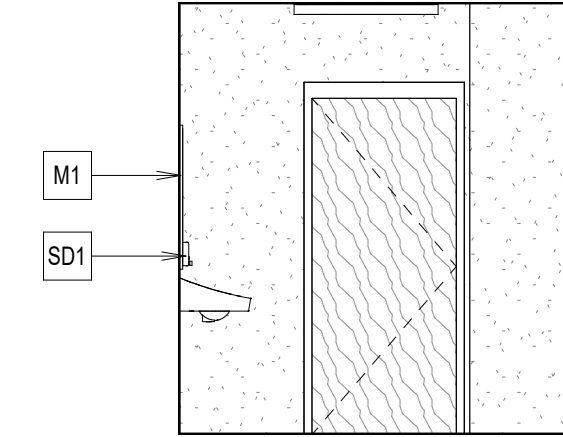


11 TLT B302E - NORTH
1/4" = 1'-0"

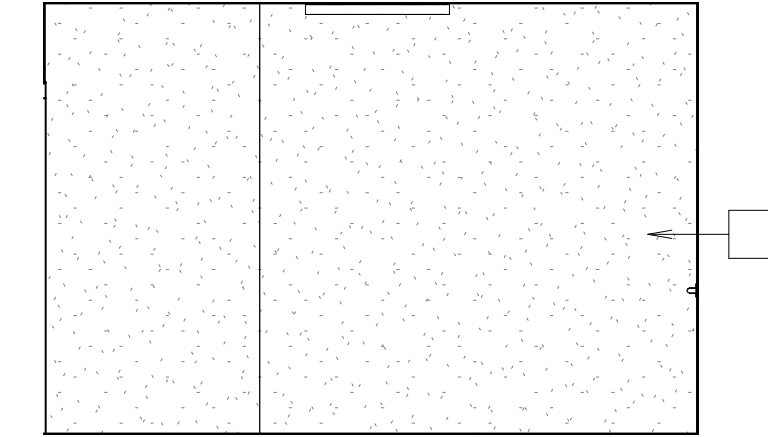


12 TLT B302E - EAST
1/4" = 1'-0"

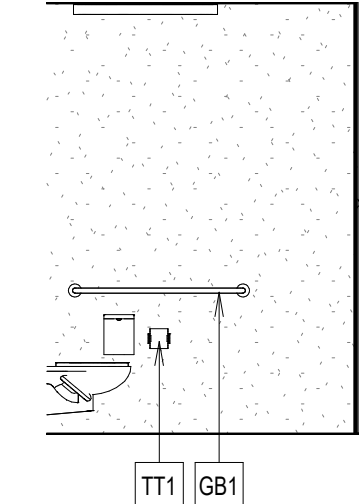


13 TLT B413 - NORTH
1/4" = 1'-0"

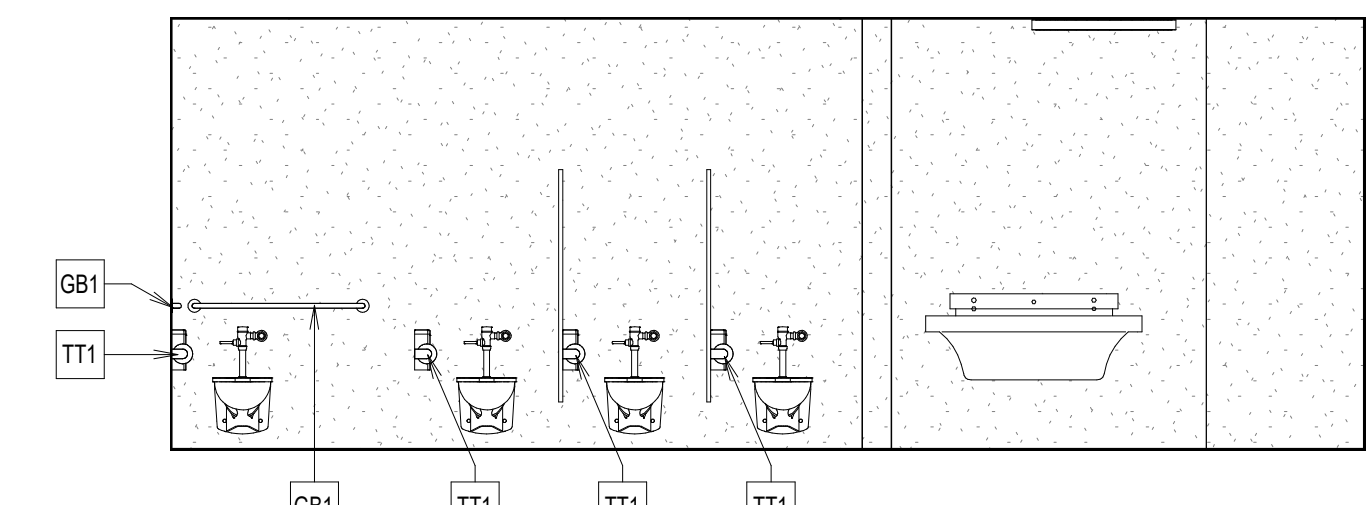


1 TLT B217 - NORTH
1/4" = 1'-0"

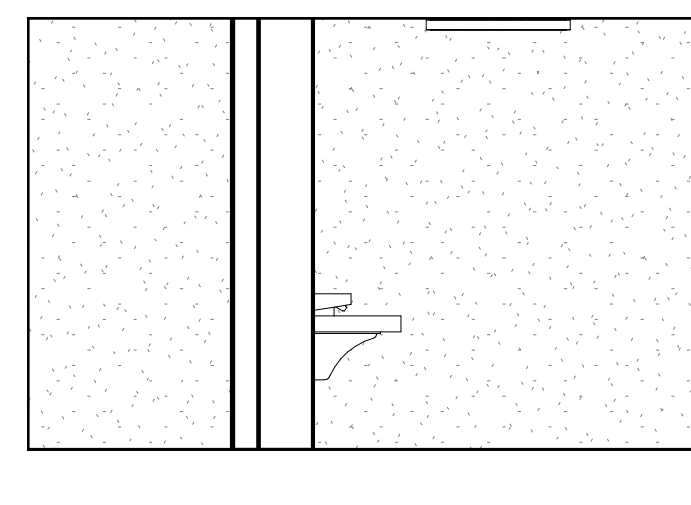


2 TLT B217 - EAST
1/4" = 1'-0"

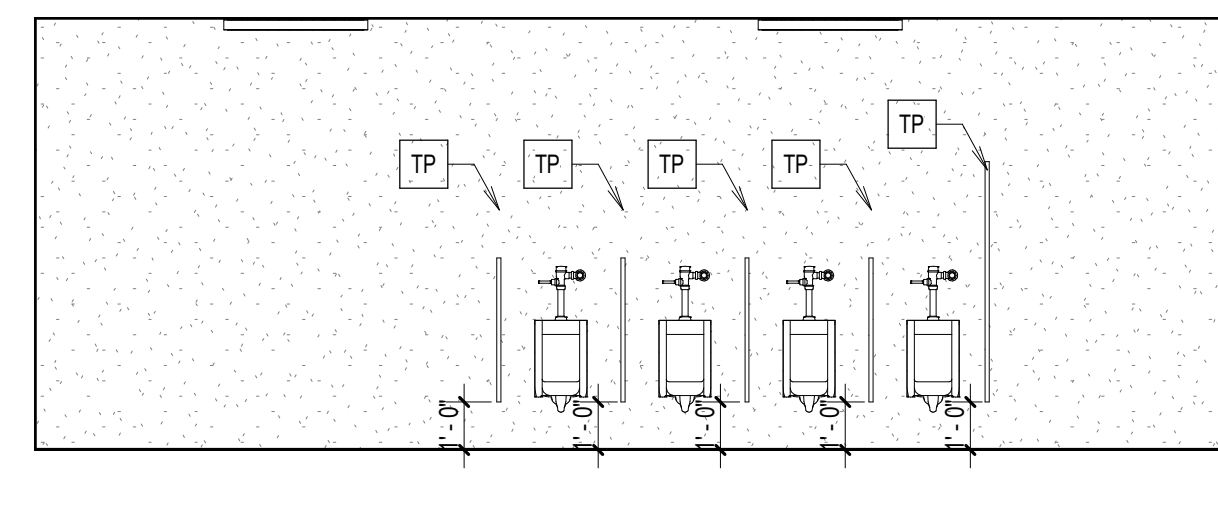


3 TLT B217 - SOUTH
1/4" = 1'-0"

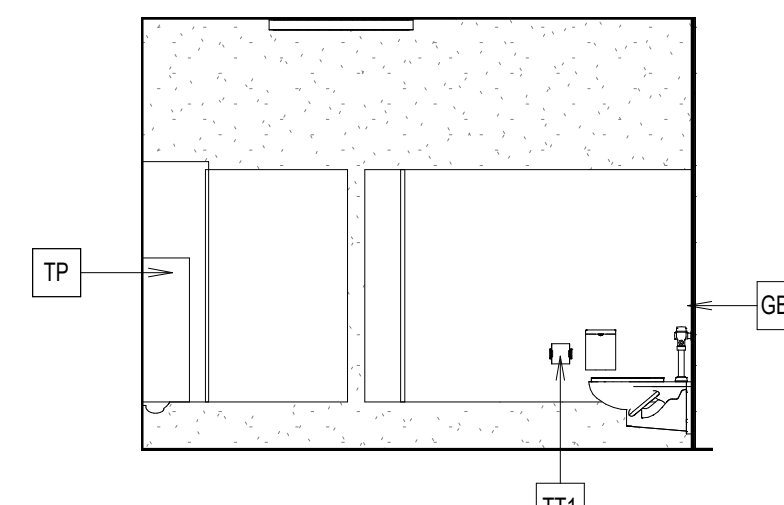

4 TLT B217 - WEST
1/4" = 1'-0"

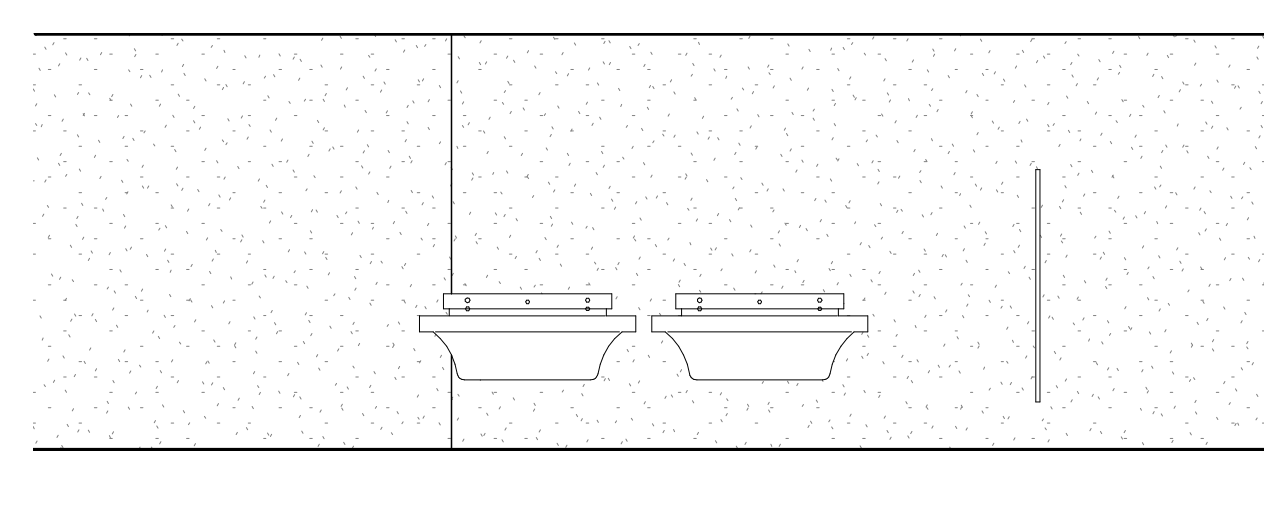

5 TLT A315 - NORTH
1/4" = 1'-0"

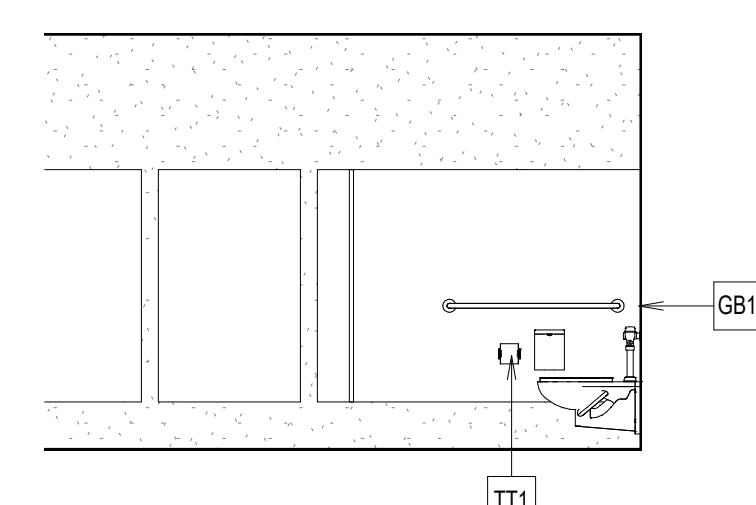

6 TLT A315 - EAST
1/4" = 1'-0"

DRA


Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06094
Tel: 817.864.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

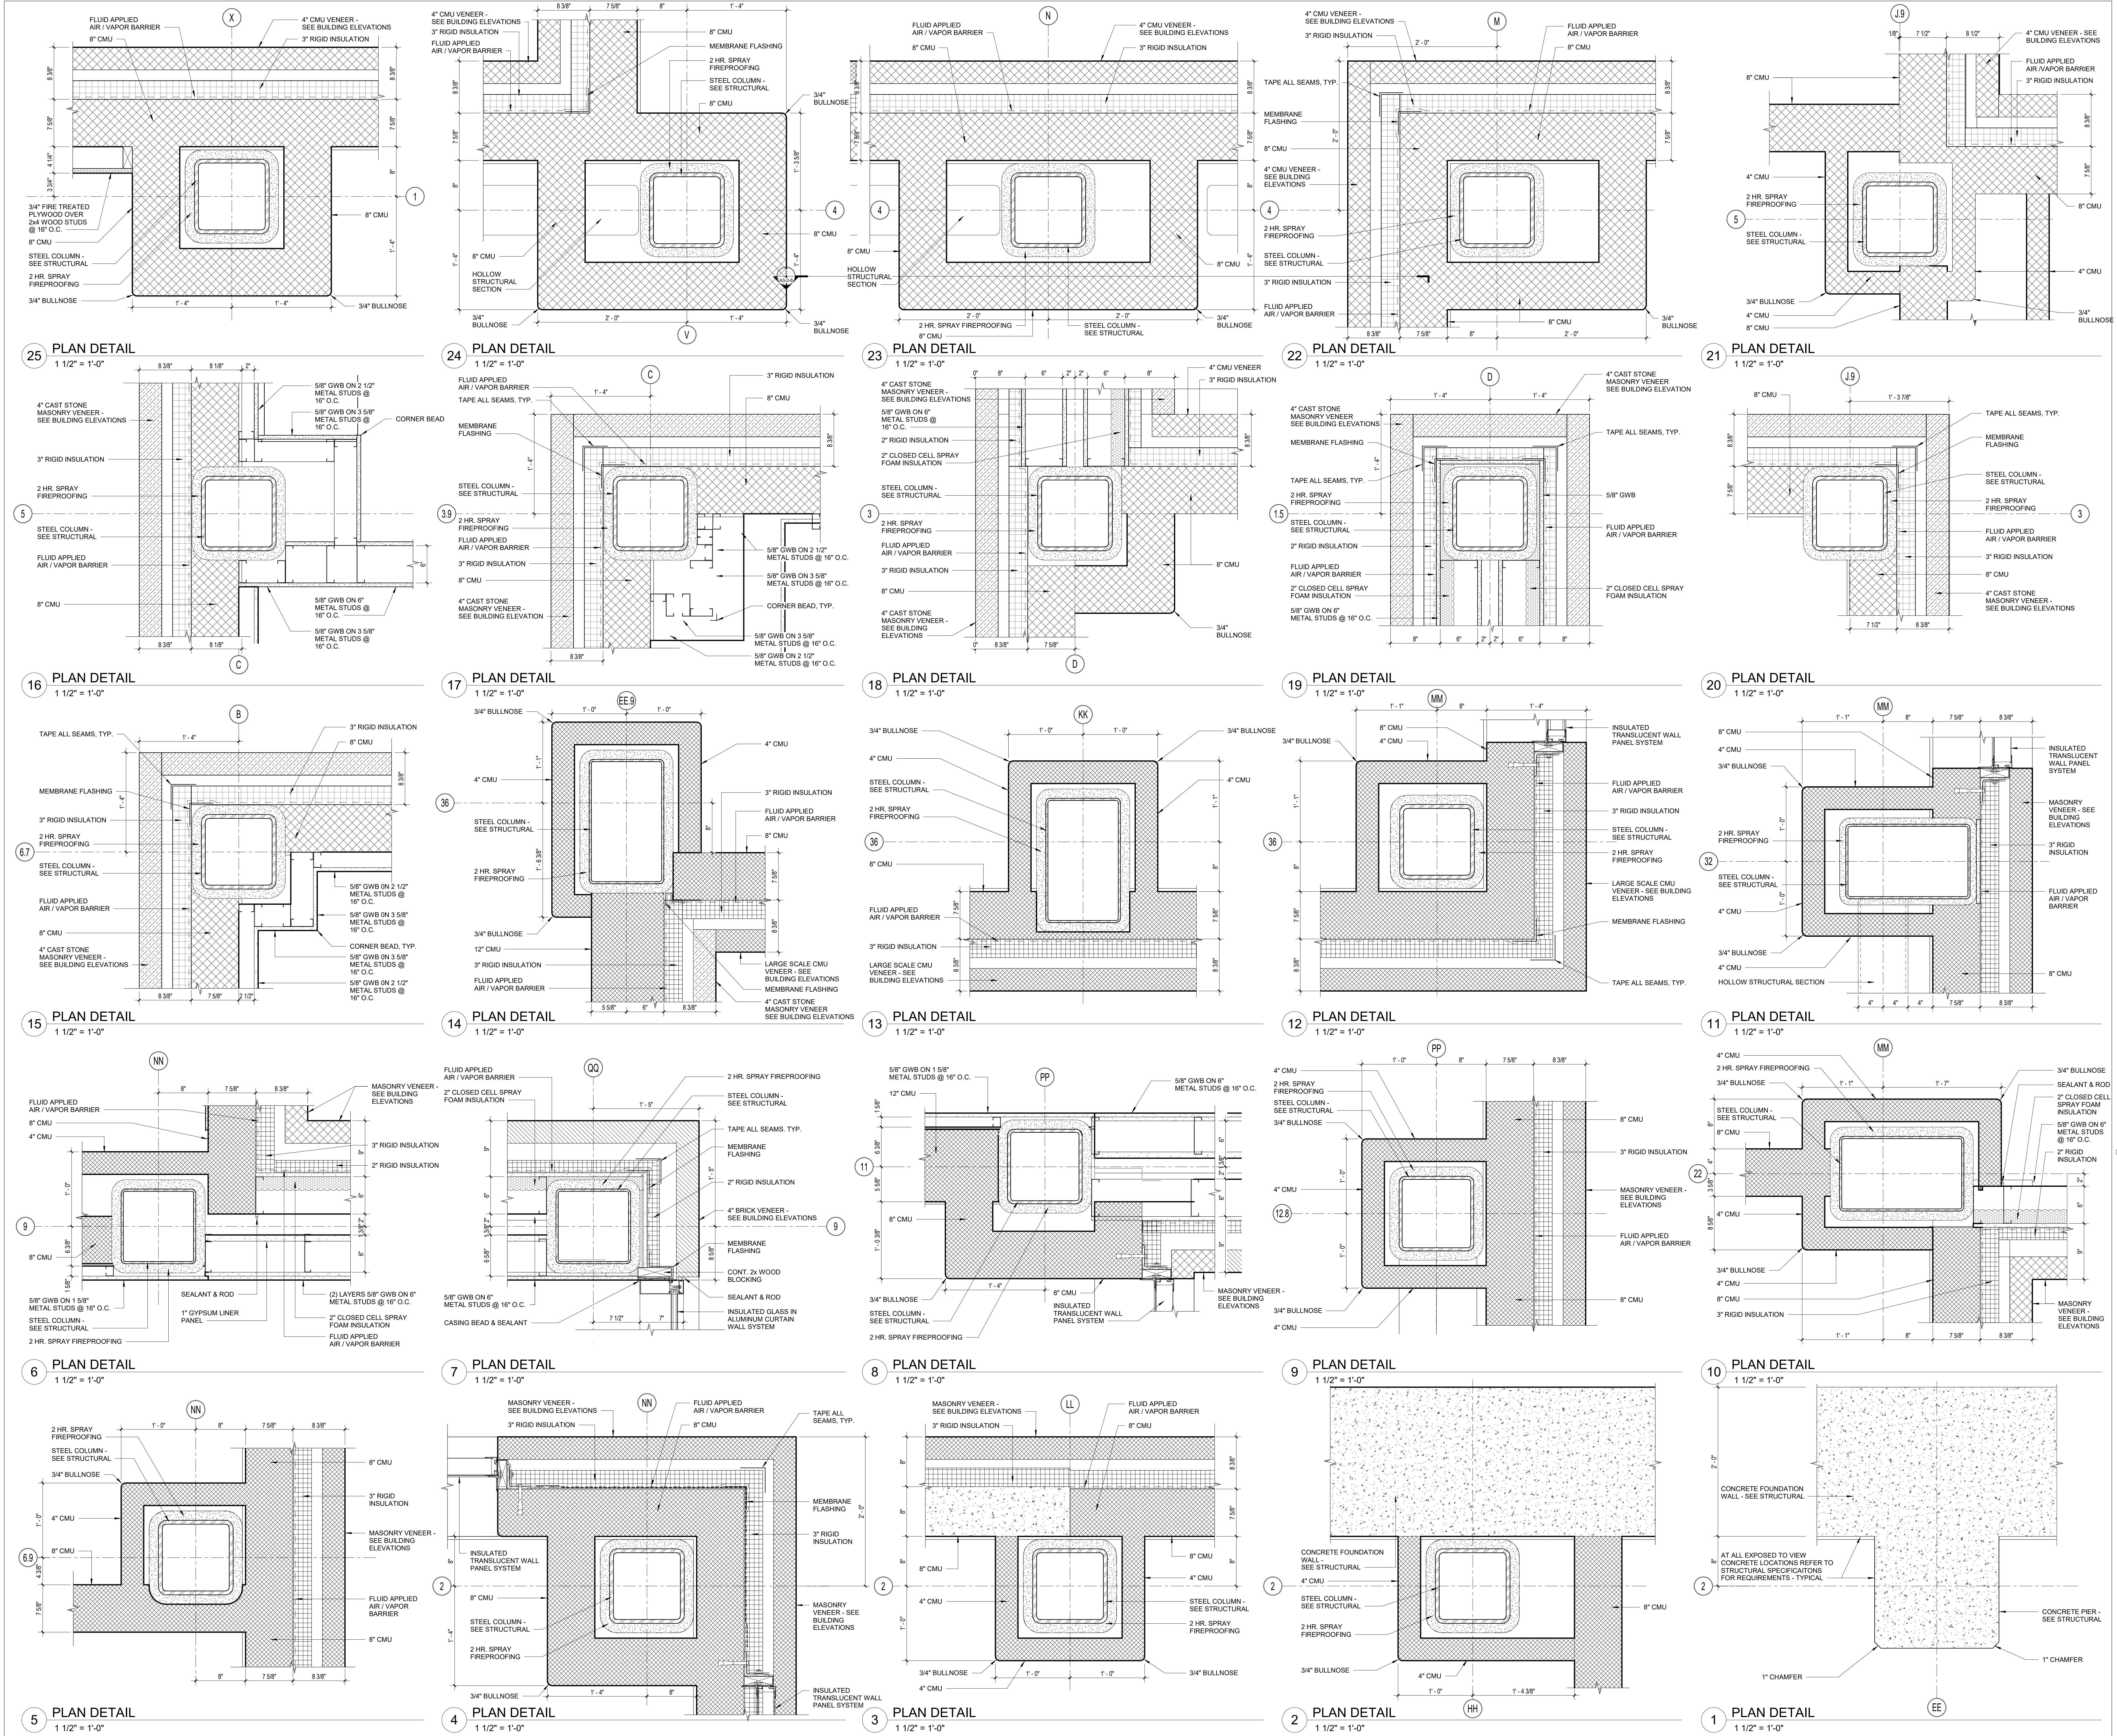

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

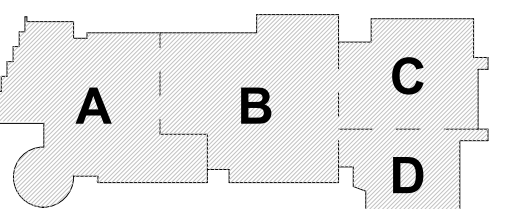

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

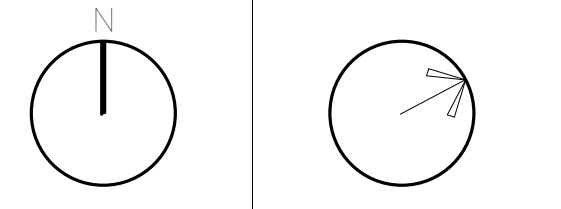

**EXTERIOR PLAN
DETAILS**

Scale: 1 1/2" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


A5-1-1

100 Hemlock Road,
Wakefield, MA 01880

DRA



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Planning | Architecture | Interior Design
Tel: 617.854.1700
www.dra.com

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

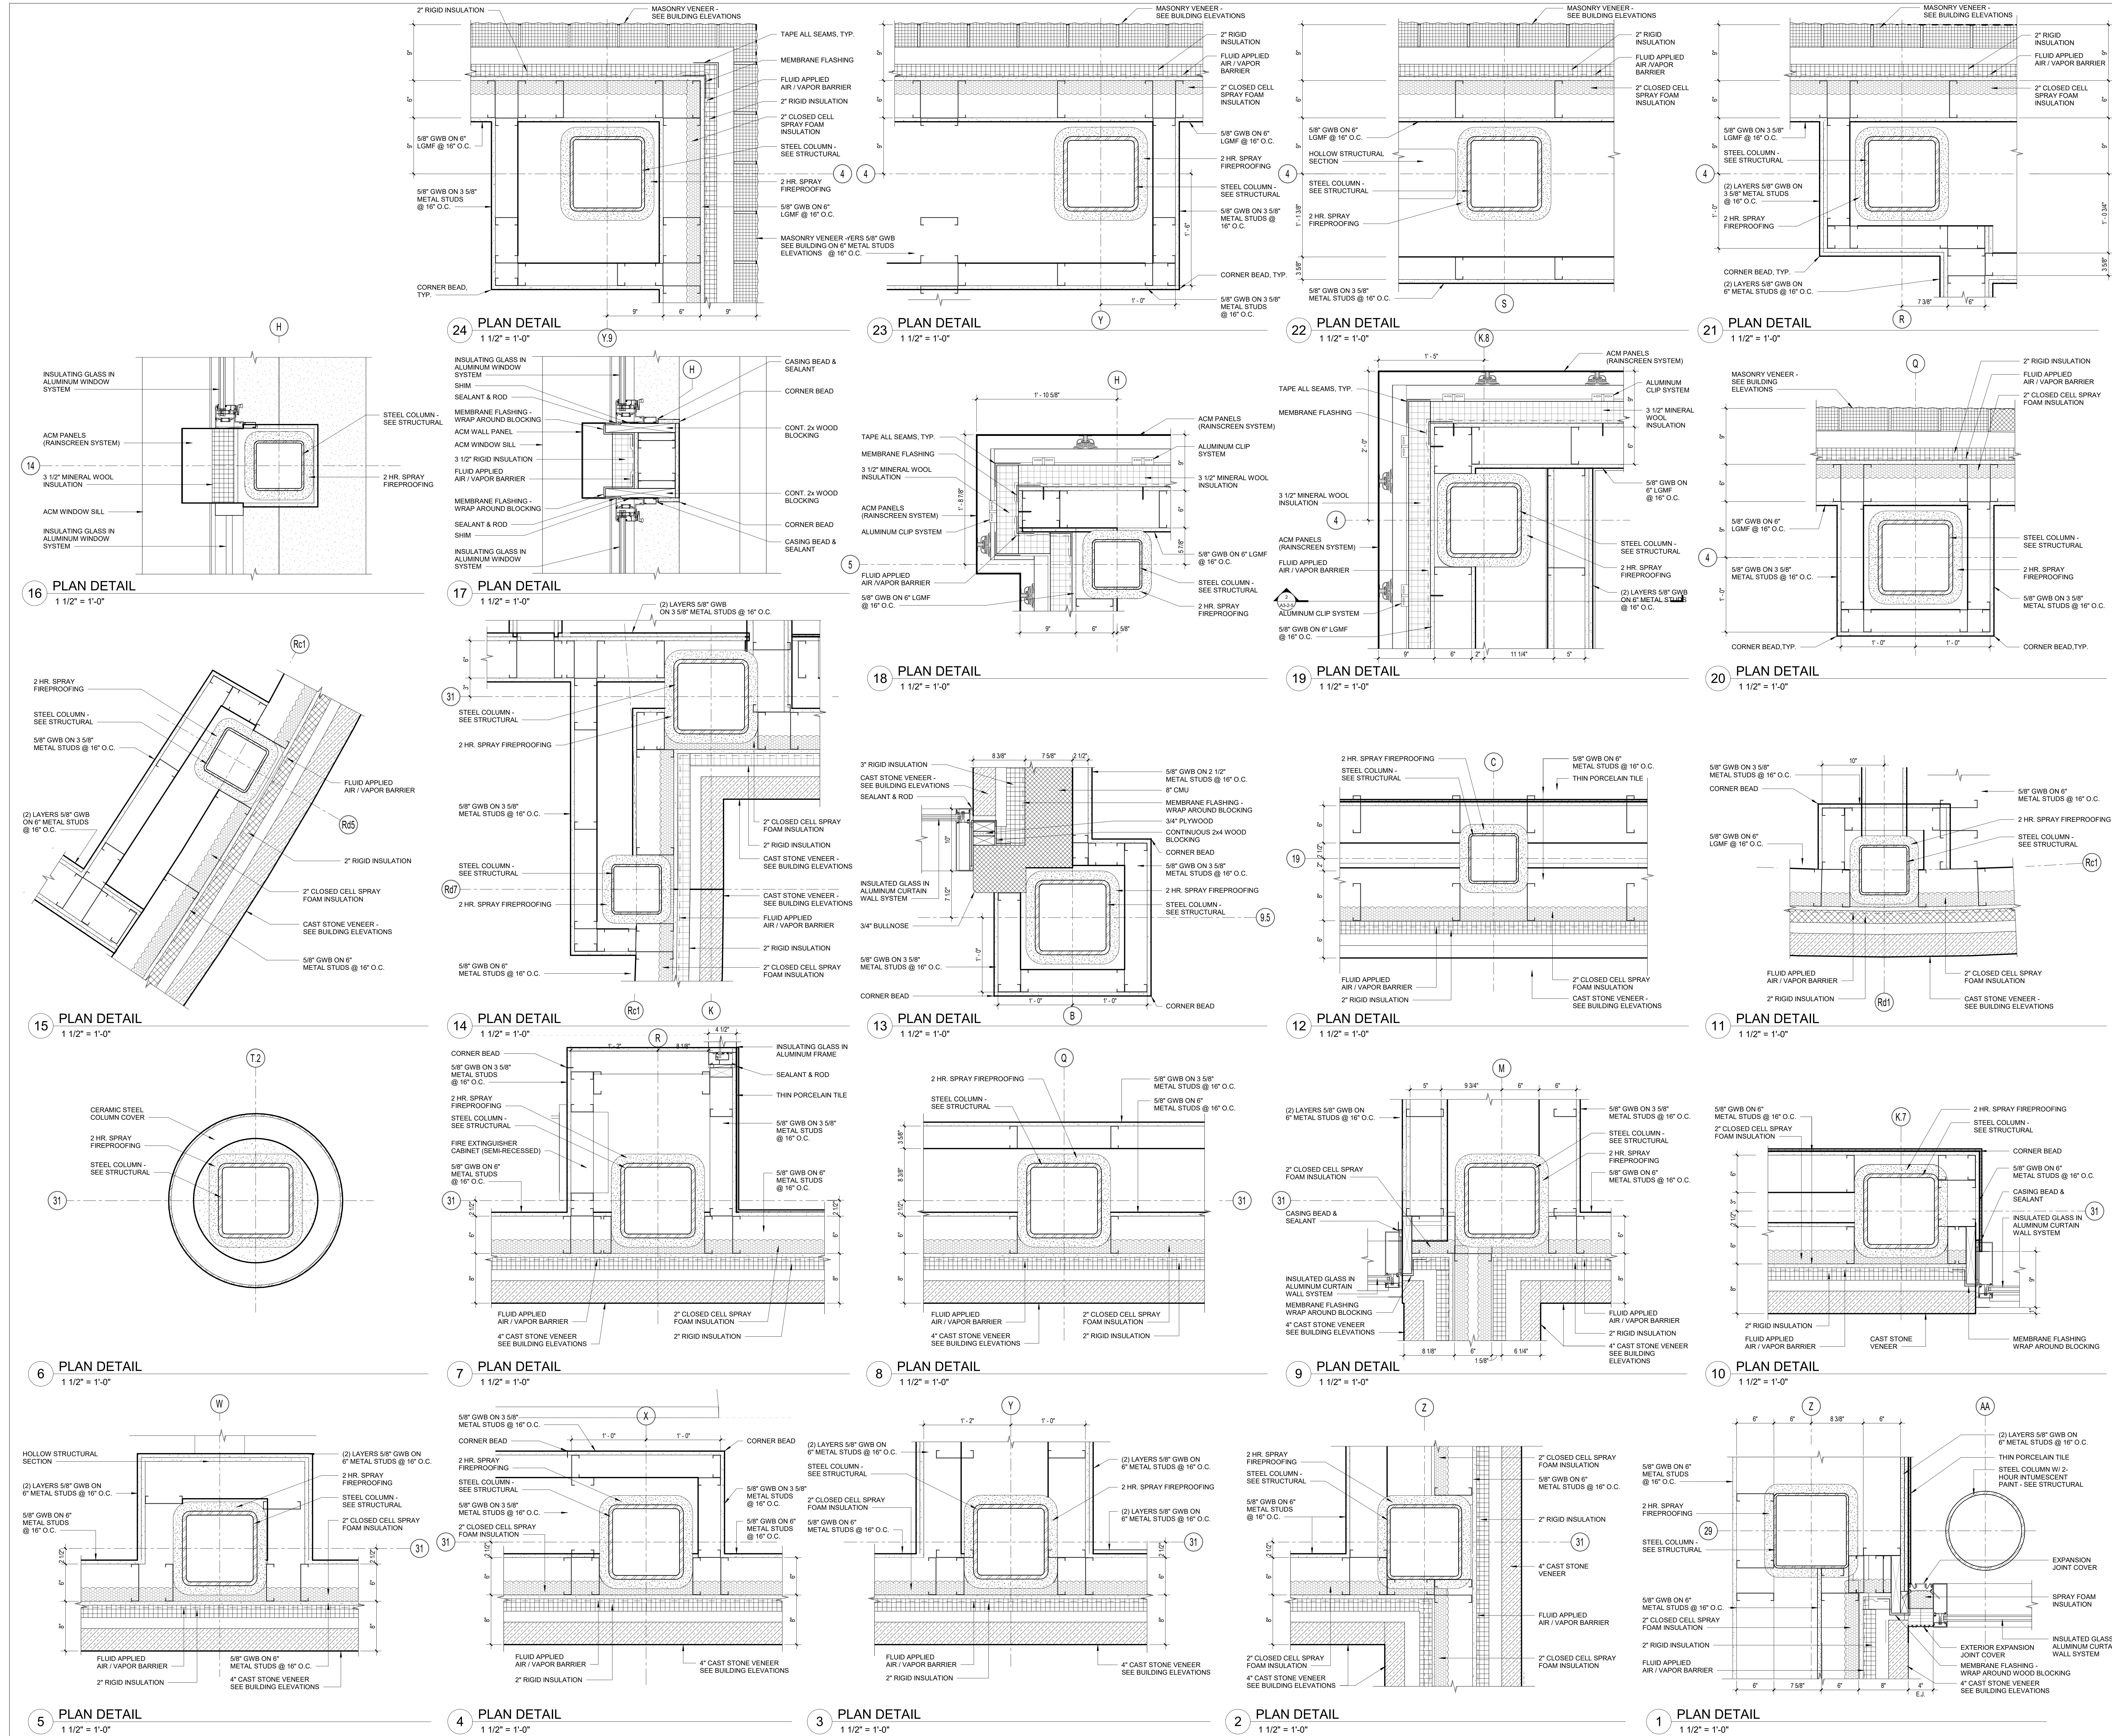

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

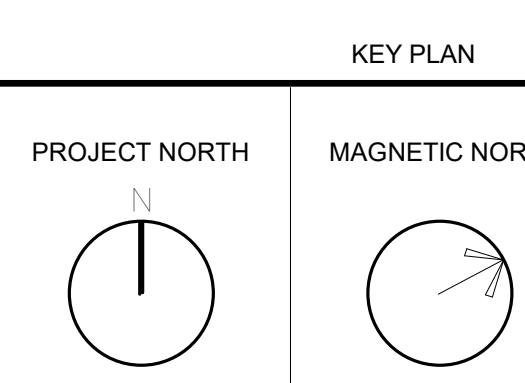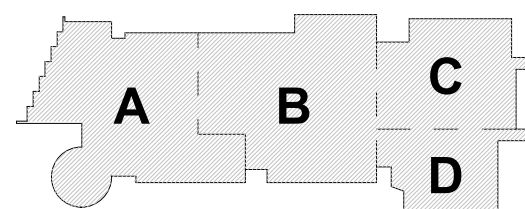


**EXTERIOR PLAN
DETAILS**


Scale: 1 1/2" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4
A5-1-3

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

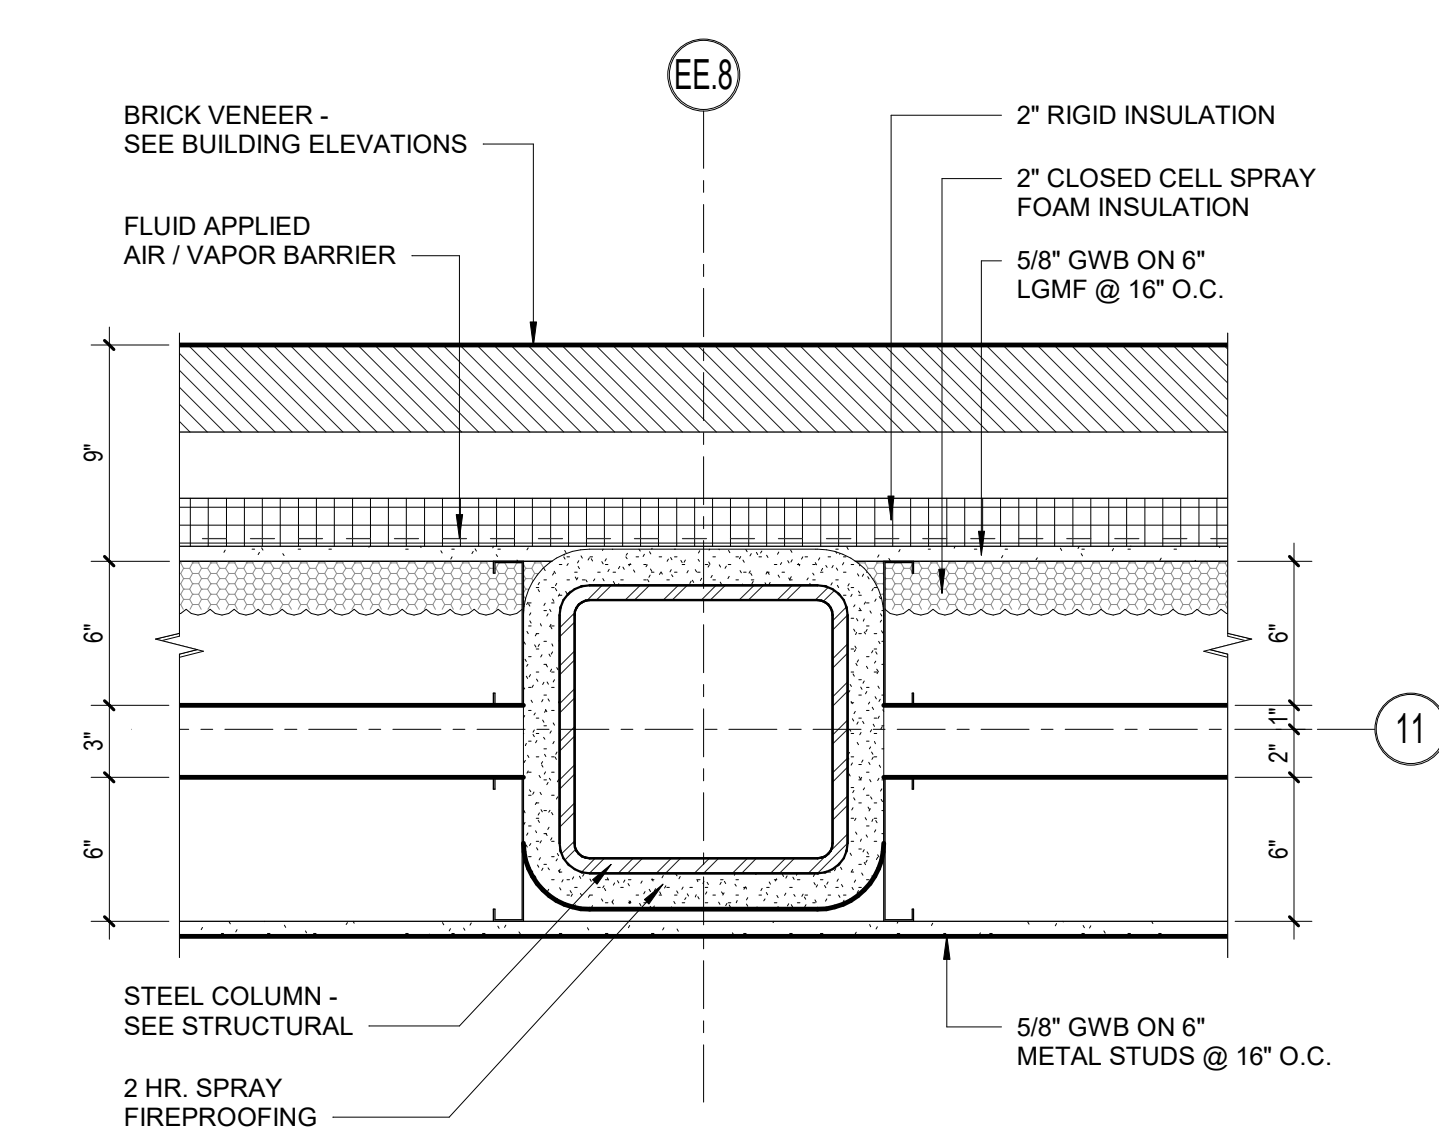


4 PLAN DETAIL
1 1/2" = 1'-0"

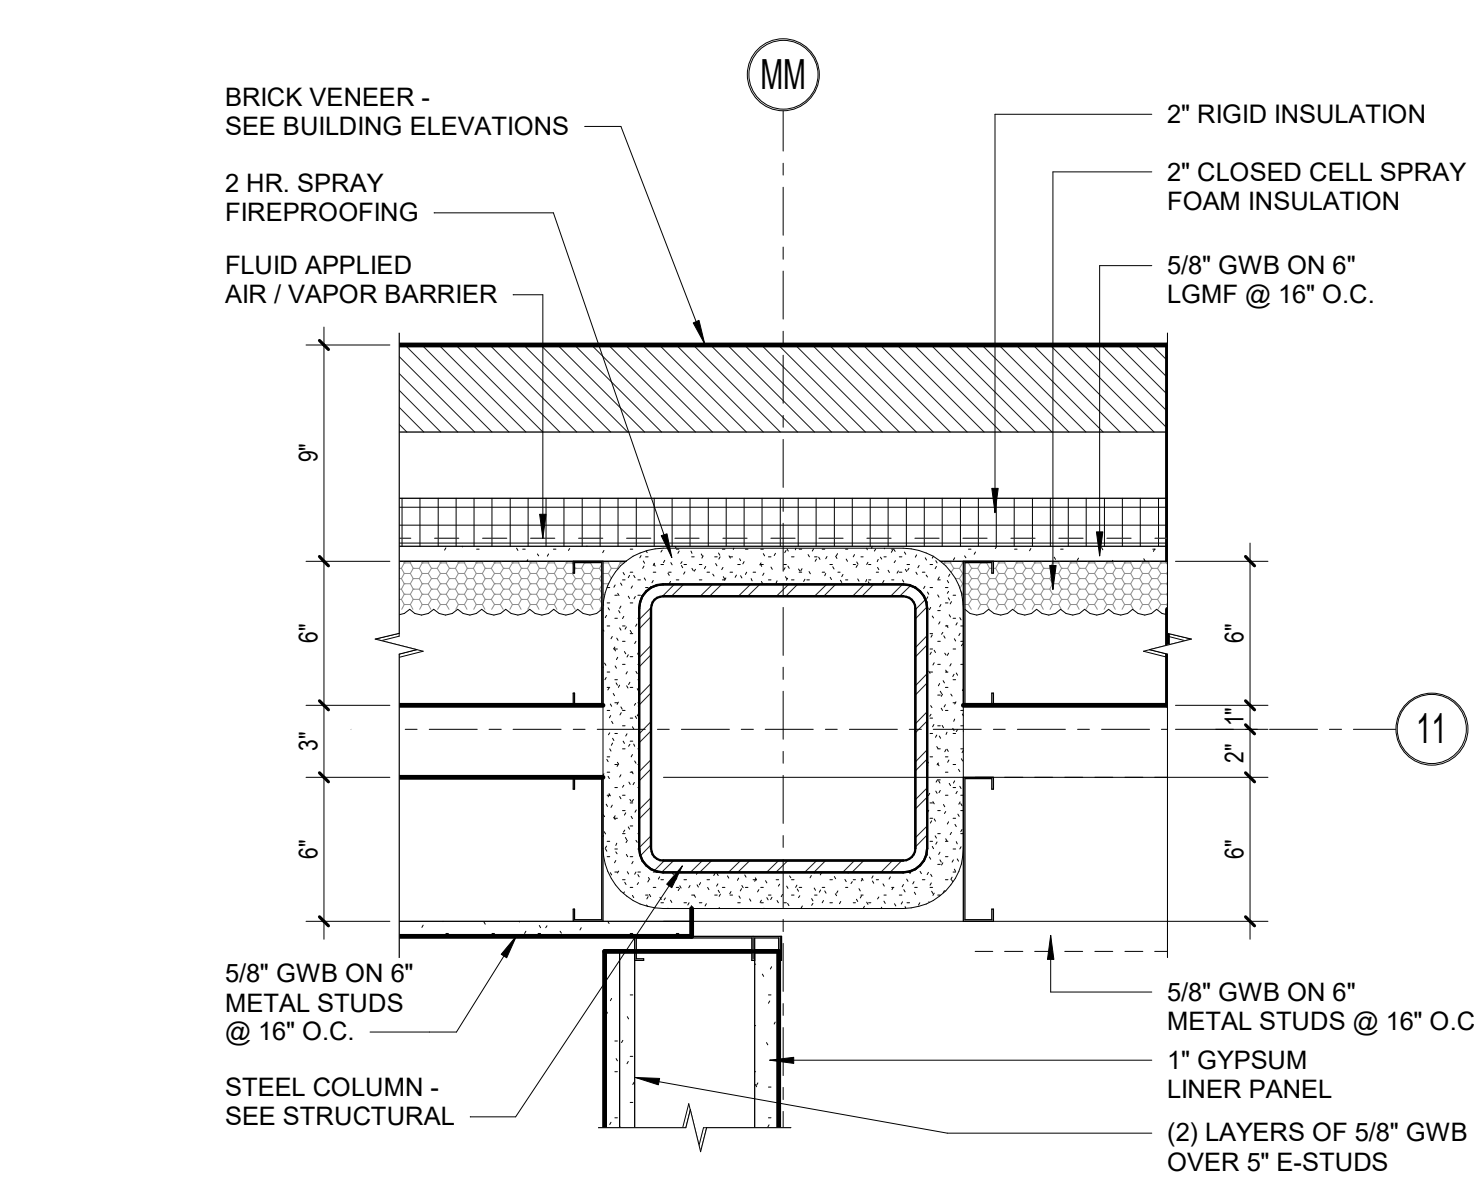


5 PLAN DETAIL
1 1/2" = 1'-0"

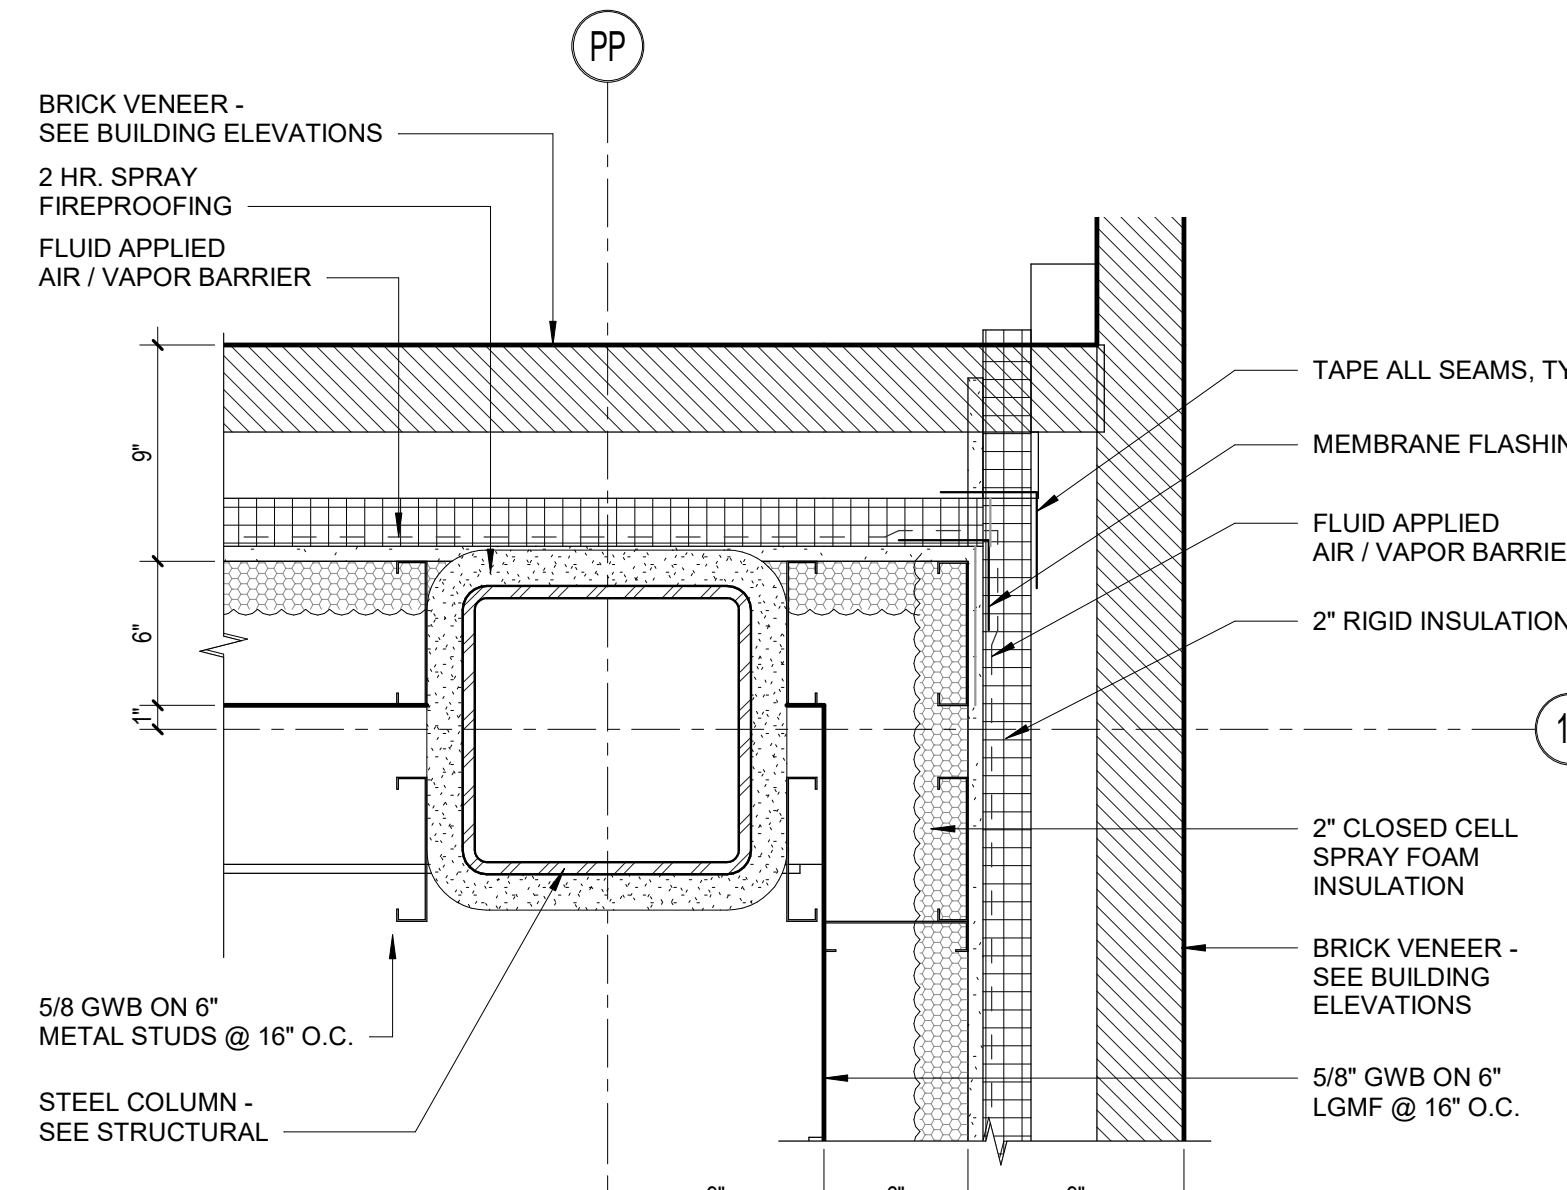


6 PLAN DETAIL
1 1/2" = 1'-0"

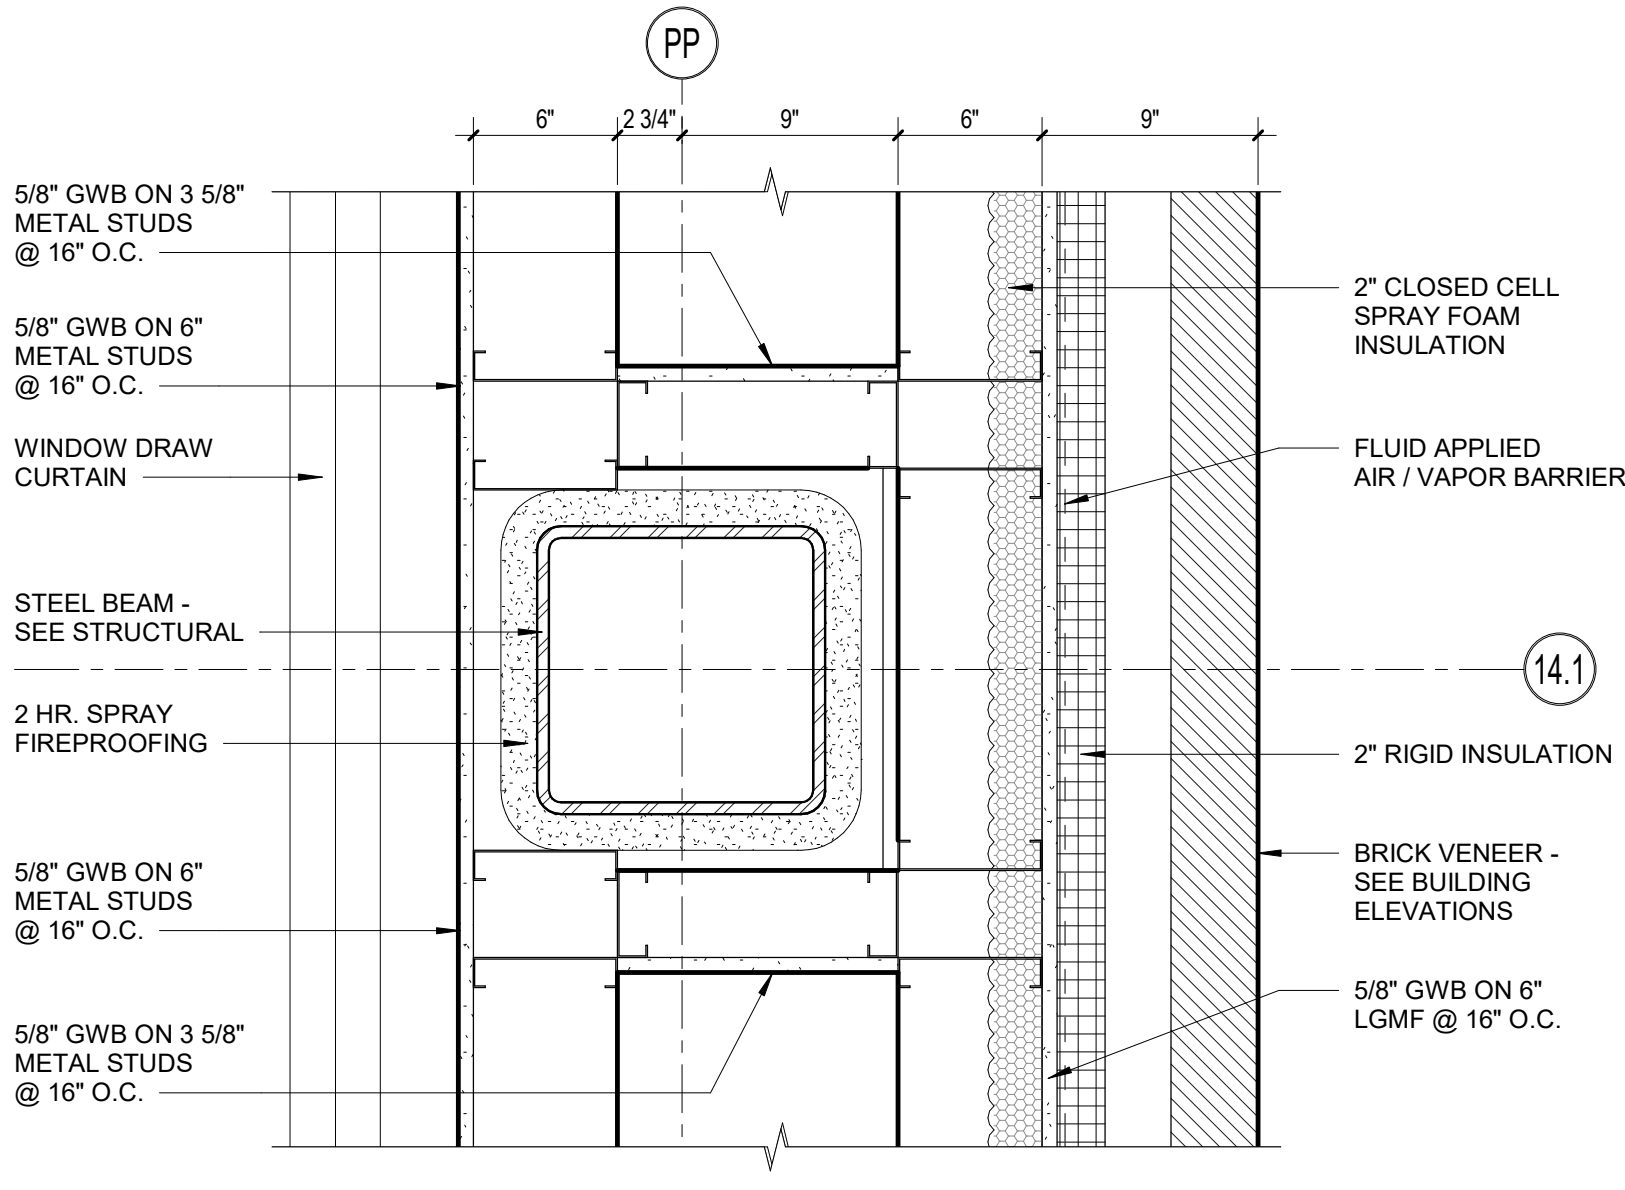


7 PLAN DETAIL
1 1/2" = 1'-0"

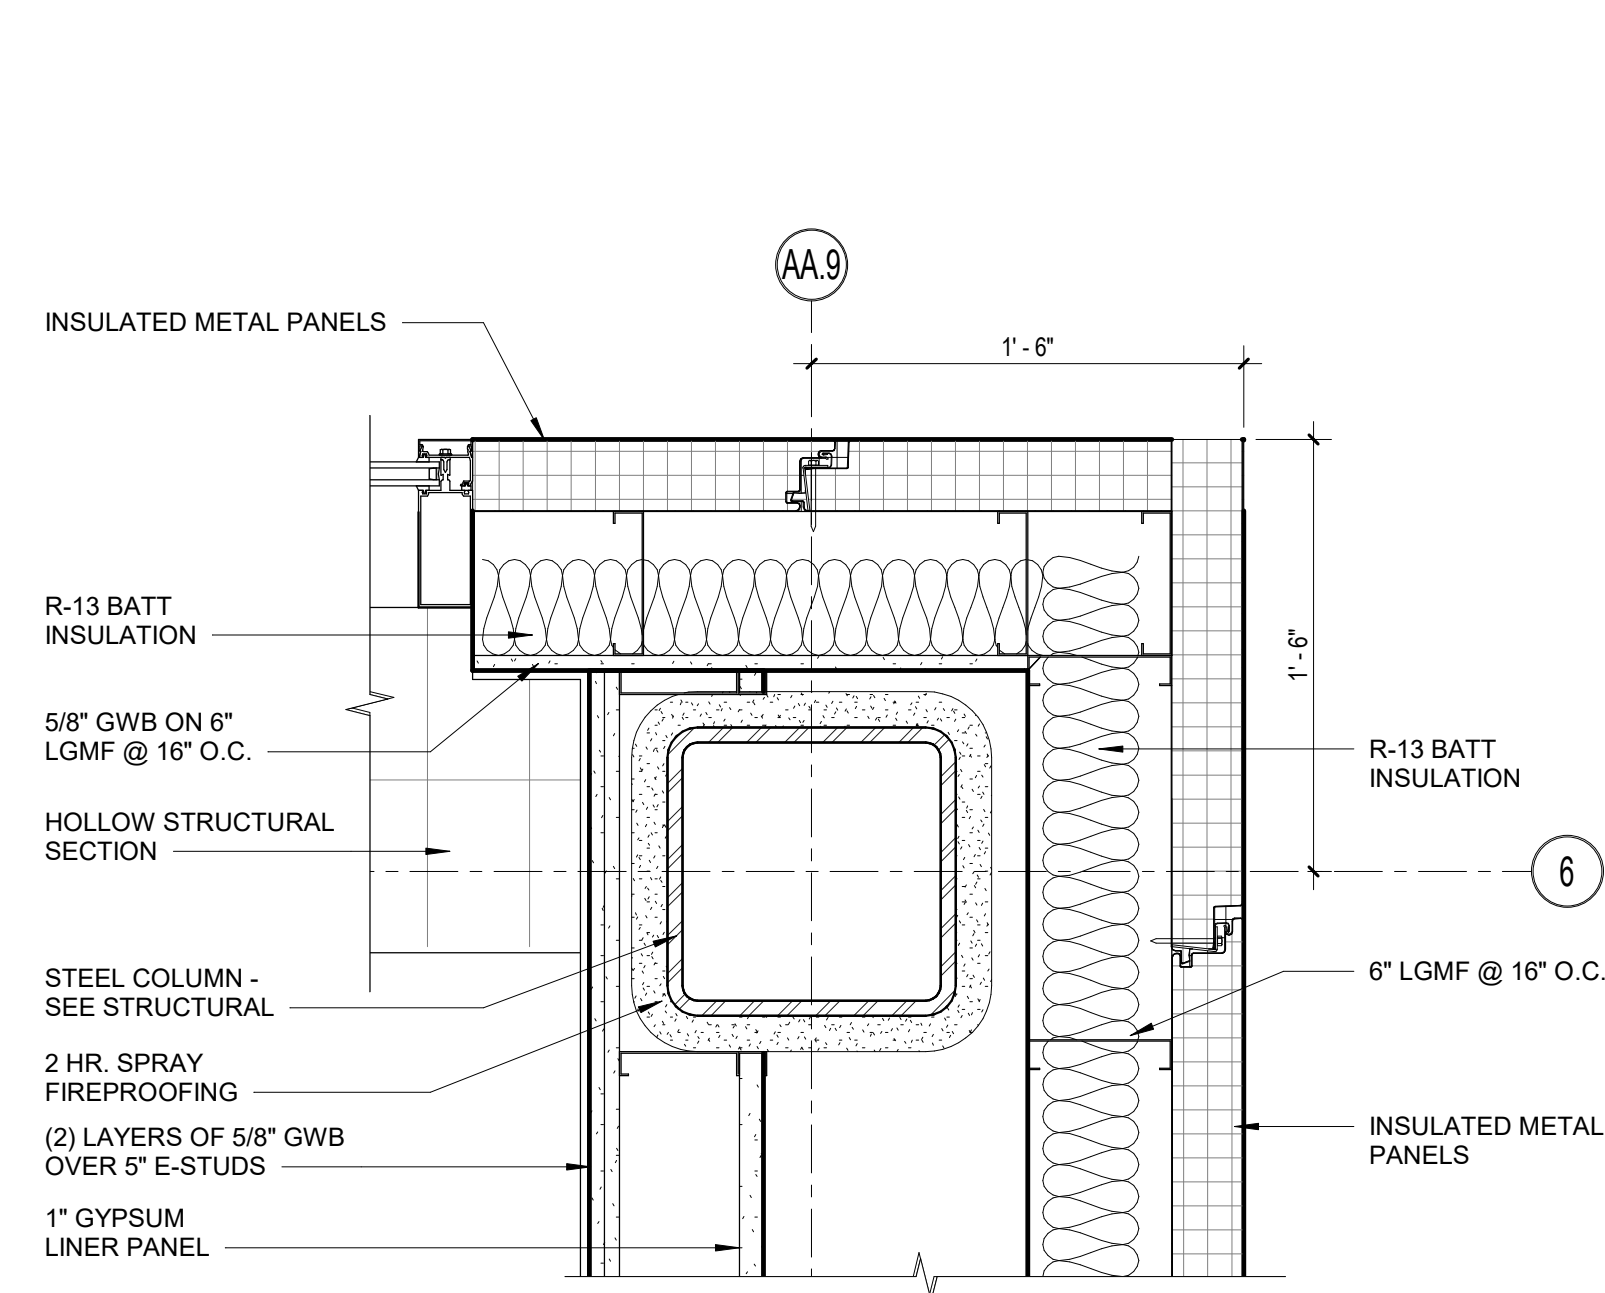

3 PLAN DETAIL
1 1/2" = 1'-0"

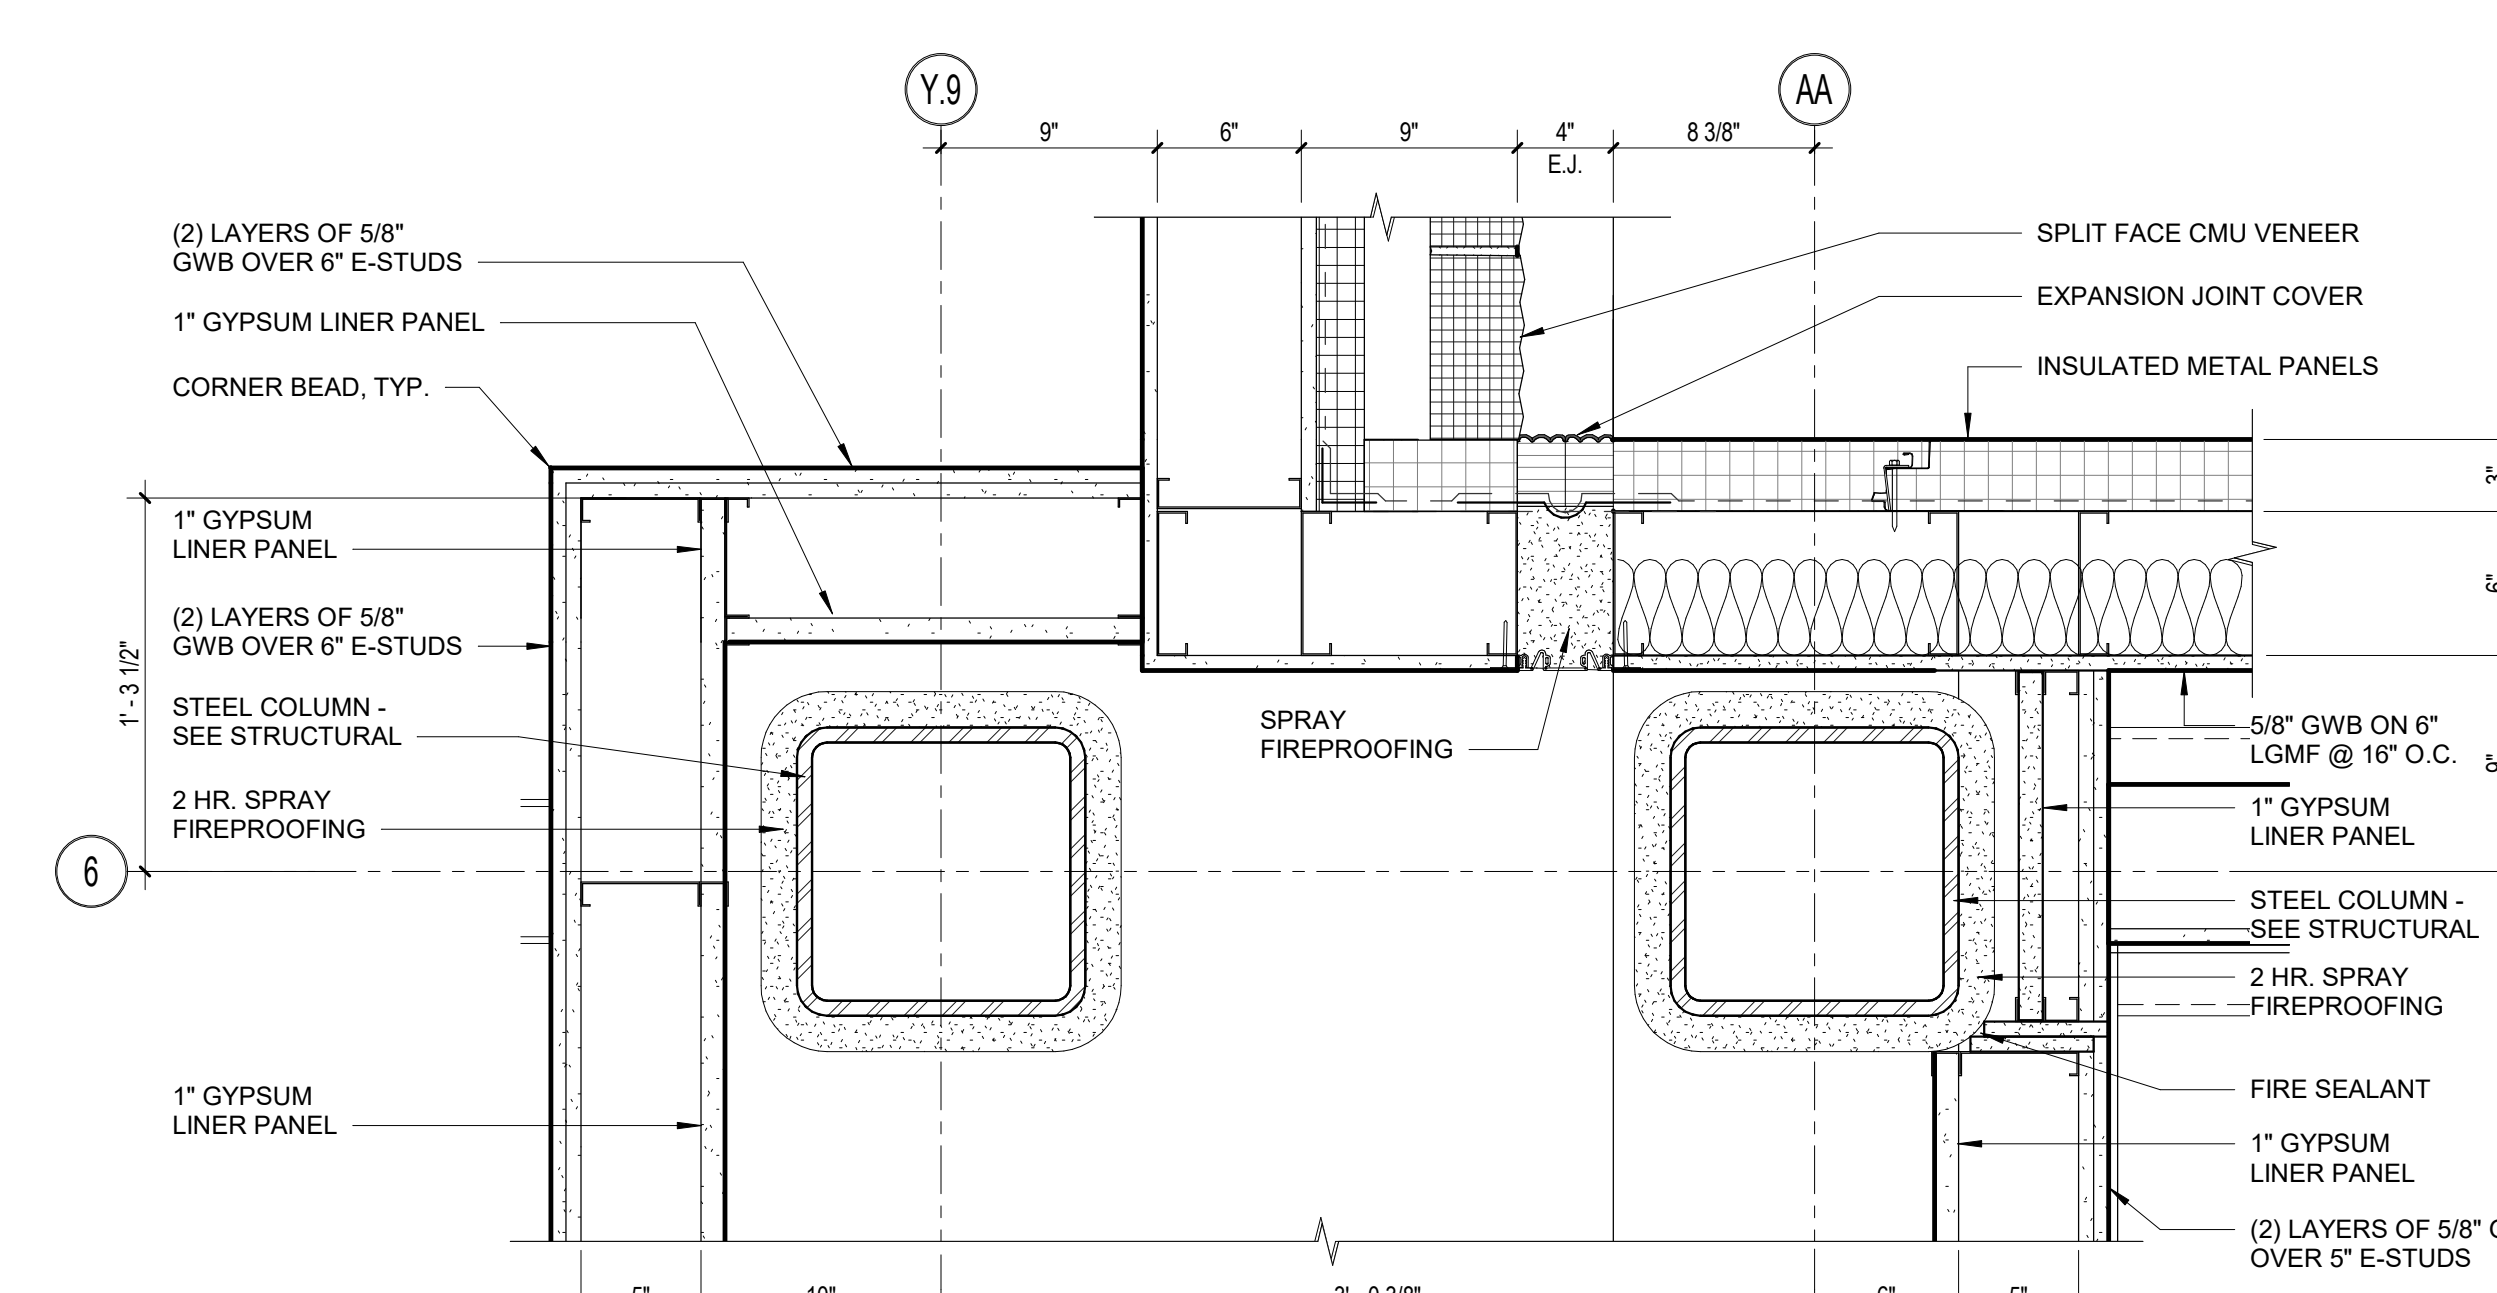

2 PLAN DETAIL
1 1/2" = 1'-0"

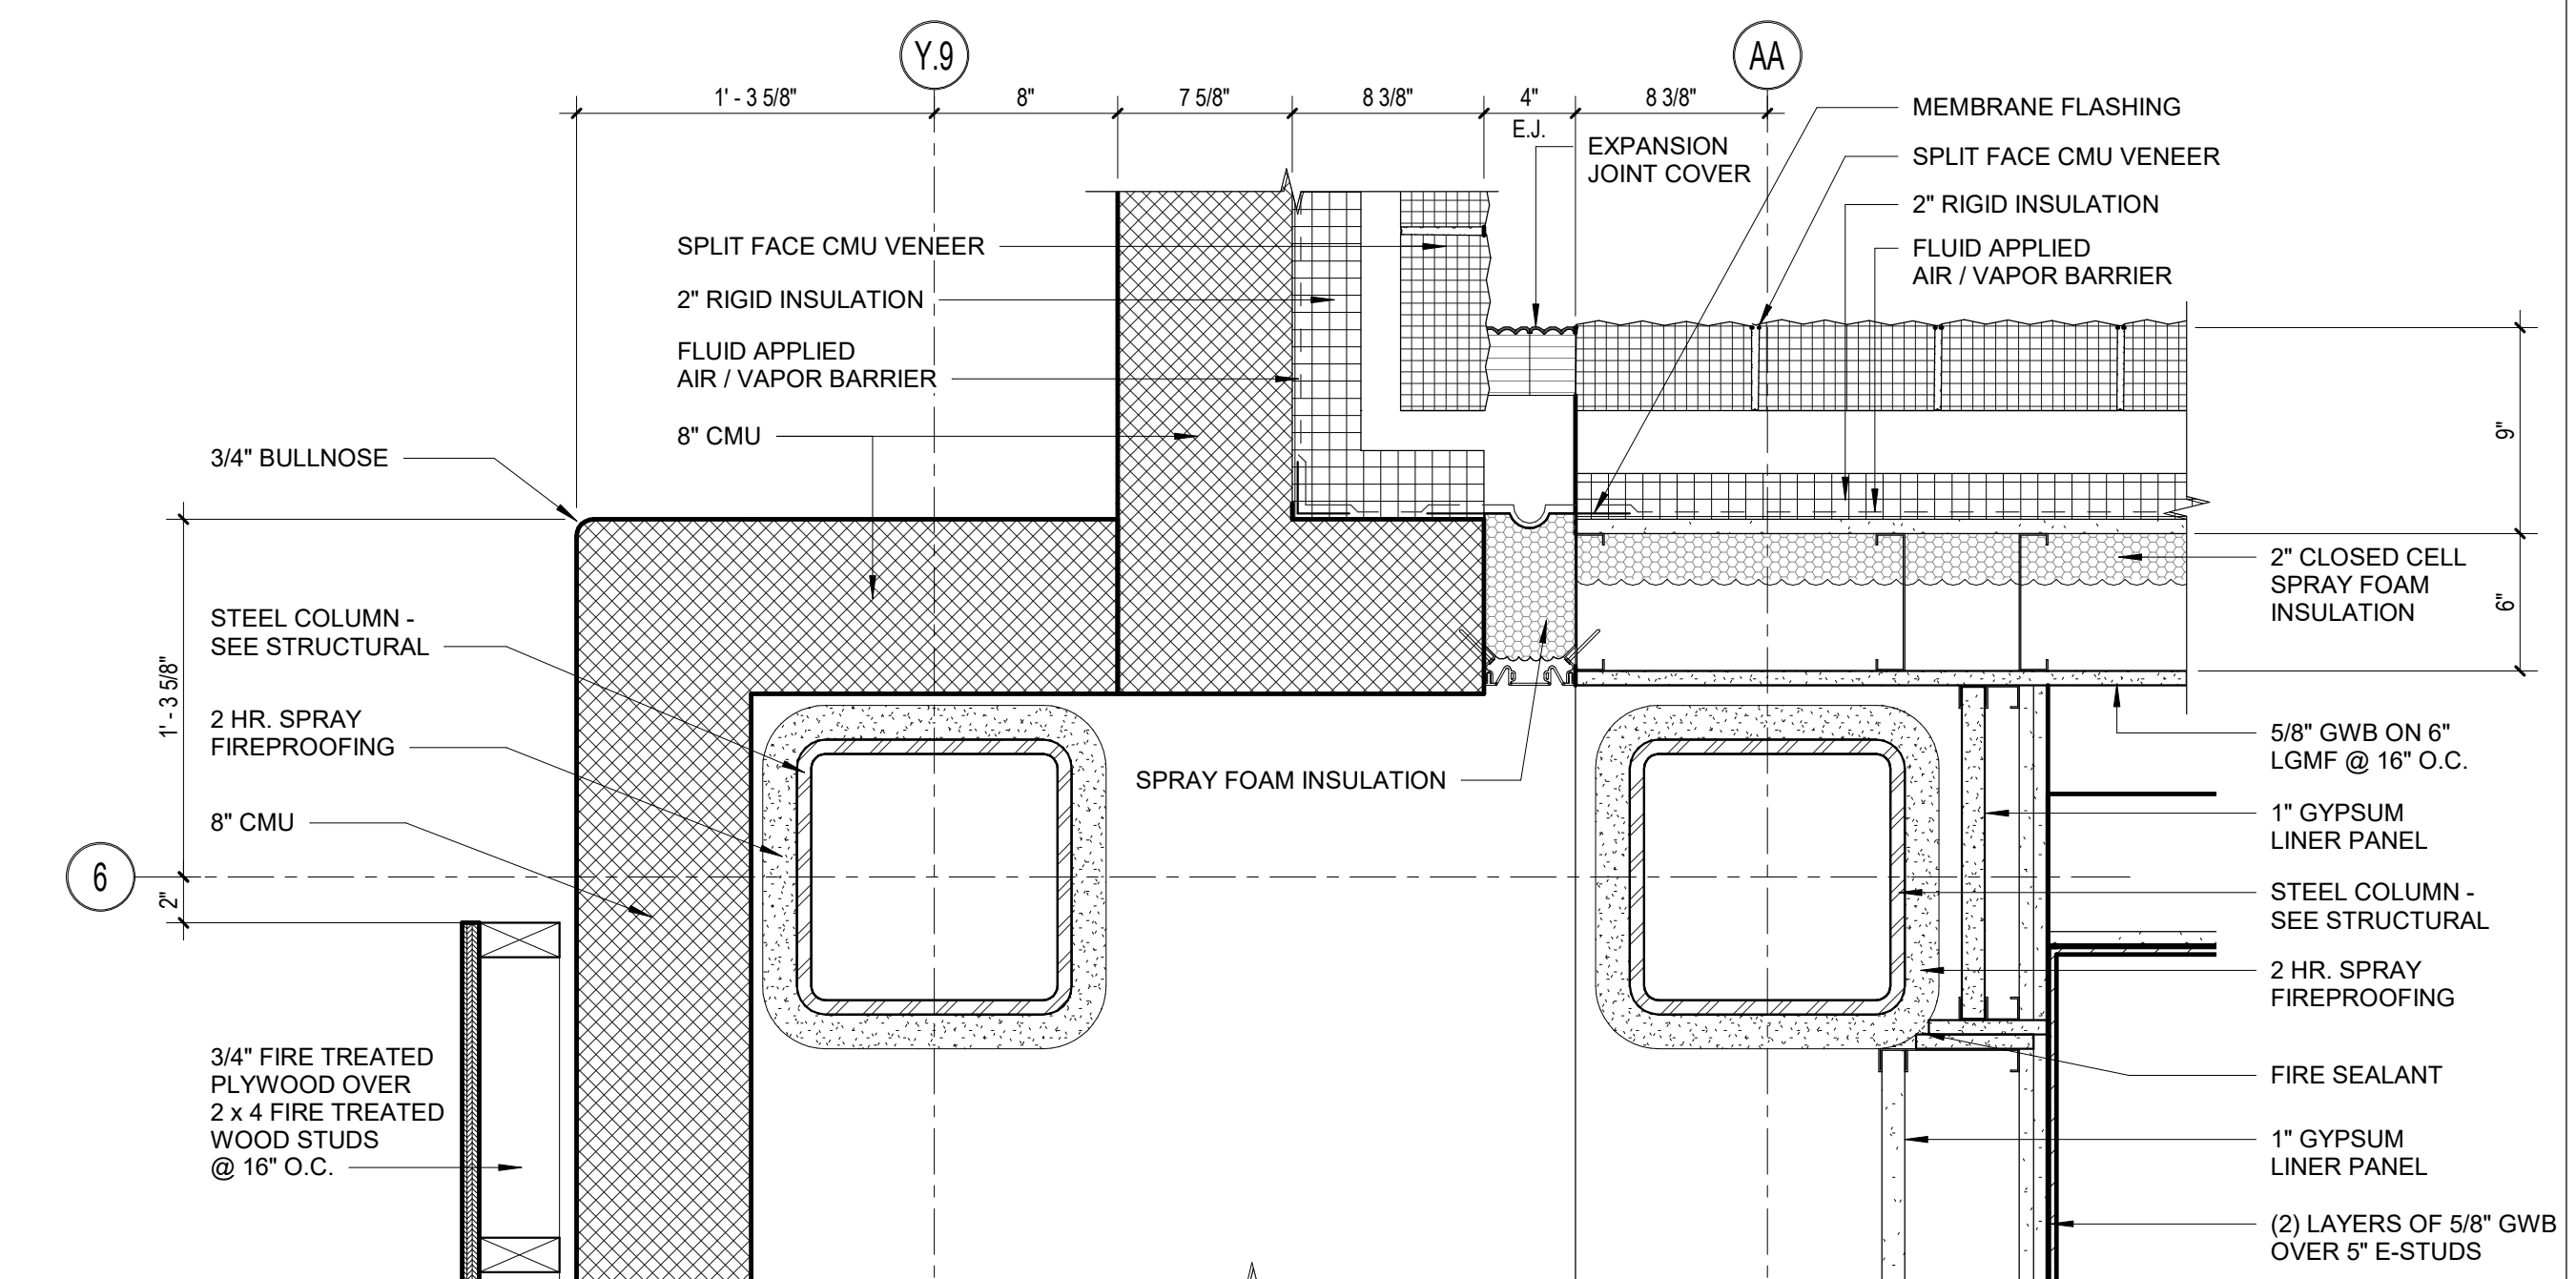


1 PLAN DETAIL
1 1/2" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION


May 12TH, 2023

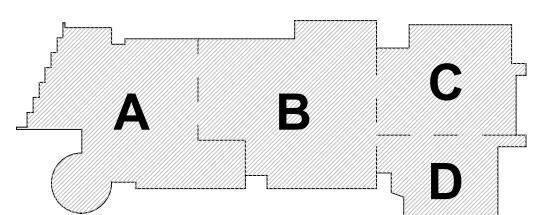

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH



**EXTERIOR PLAN
DETAILS**

Scale: 1 1/2" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A5-1-4

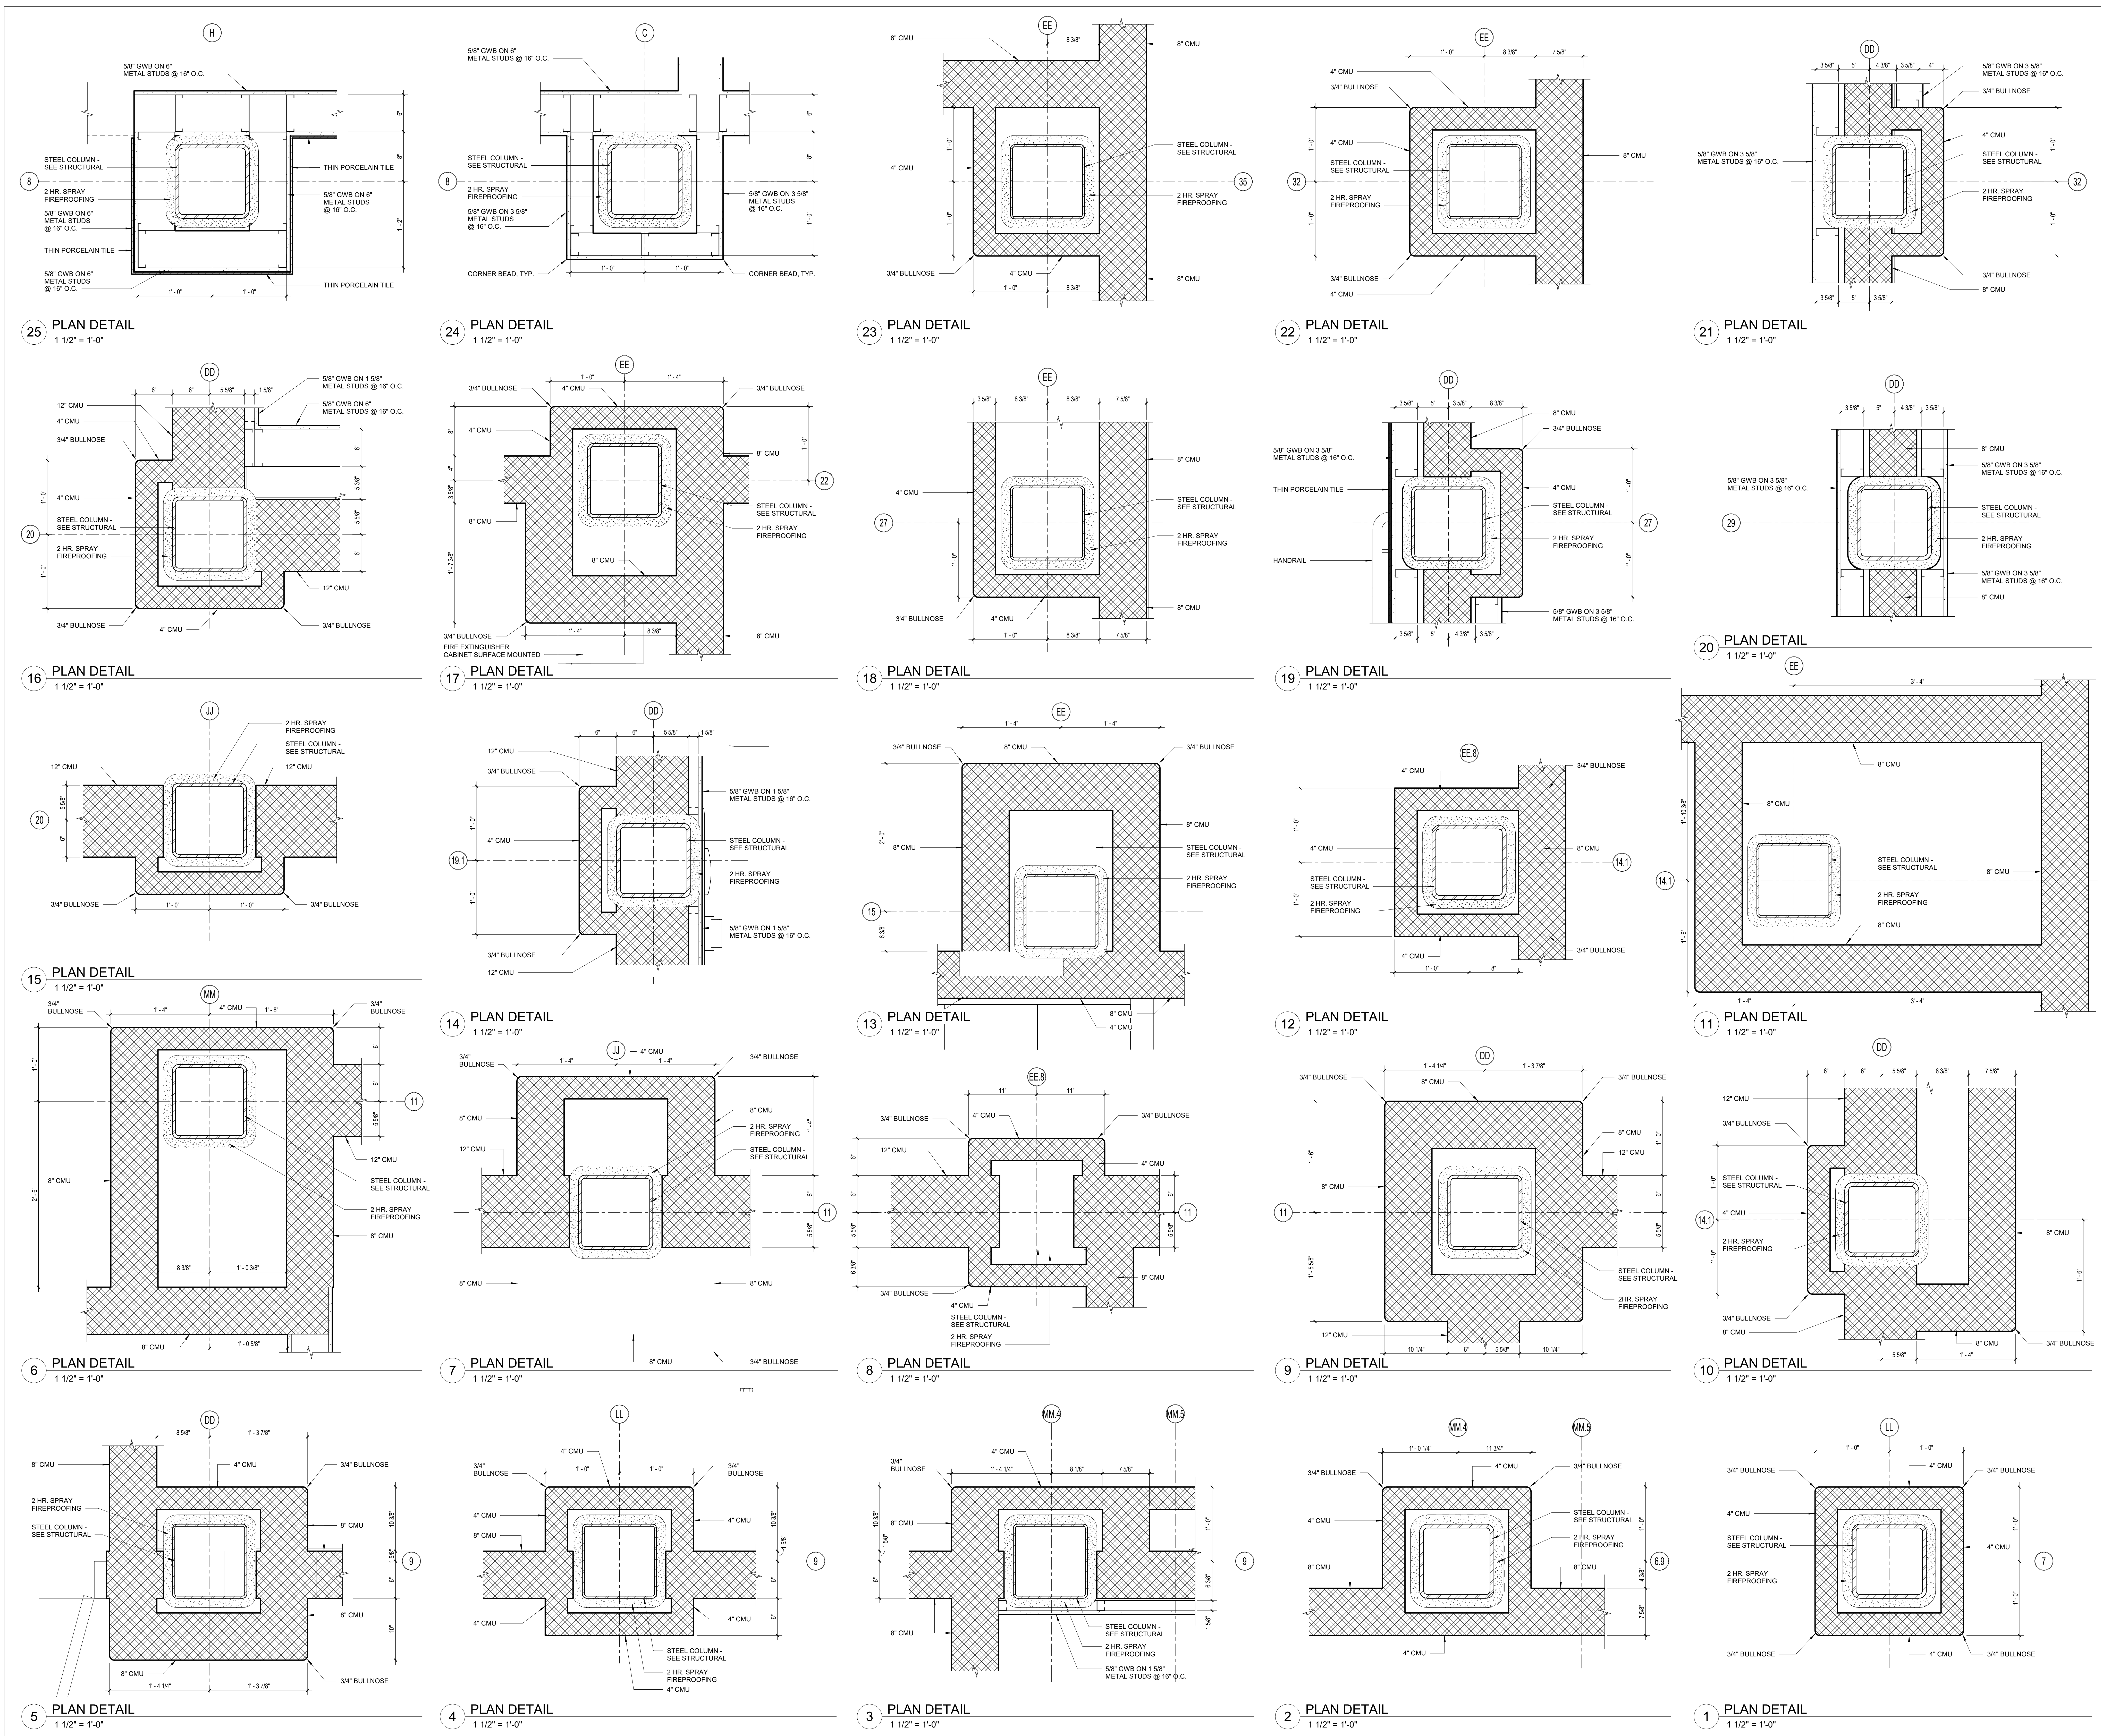

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

MSBA 90% CD
SUBMISSION

May 12TH, 2023

A

B

C

D

KEY PLAN


PROJECT NORTH

MAGNETIC NORTH

INTERIOR PLAN
DETAILS

Scale: 1 1/2" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A5-2-1

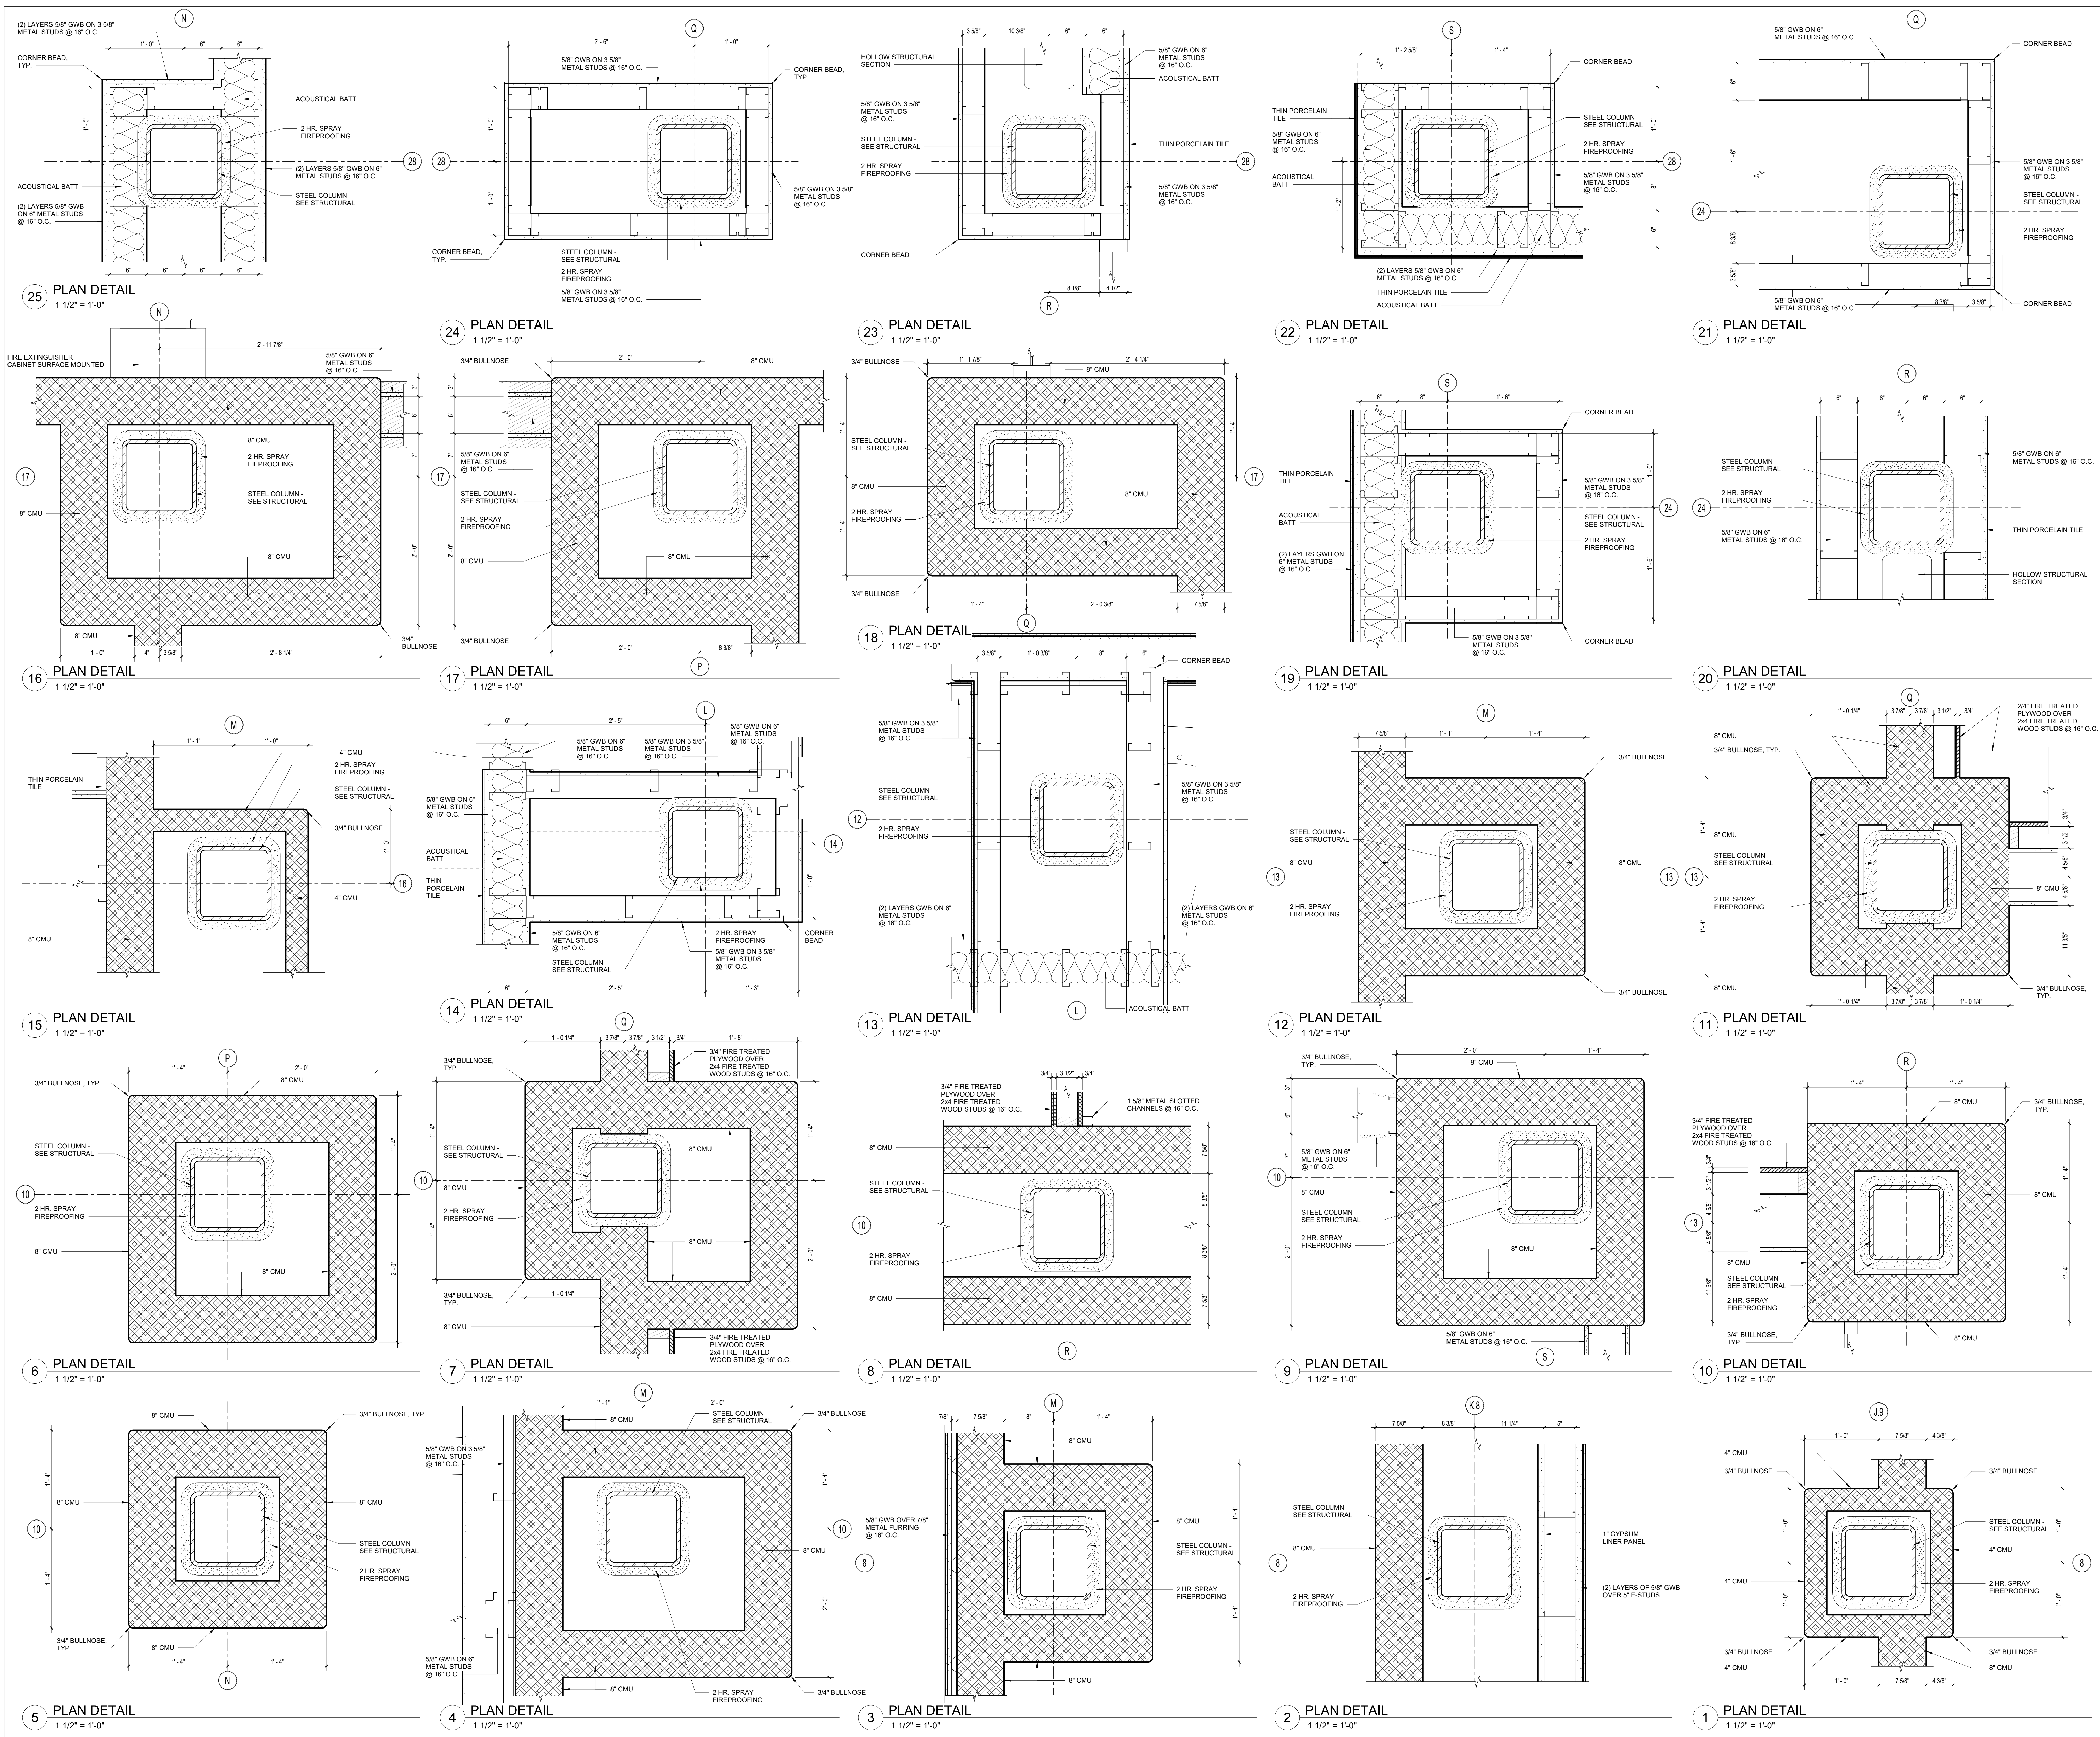

DRA

Drummeys Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 617.864.1700
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453
Tel: 617.864.1700
www.dra.com

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road, Wakefield, MA 01880

MSBA 90% CD SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

INTERIOR PLAN DETAILS

Scale: 1 1/2" = 1'-0"


Job No.: 20202


Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4

A5-2-2

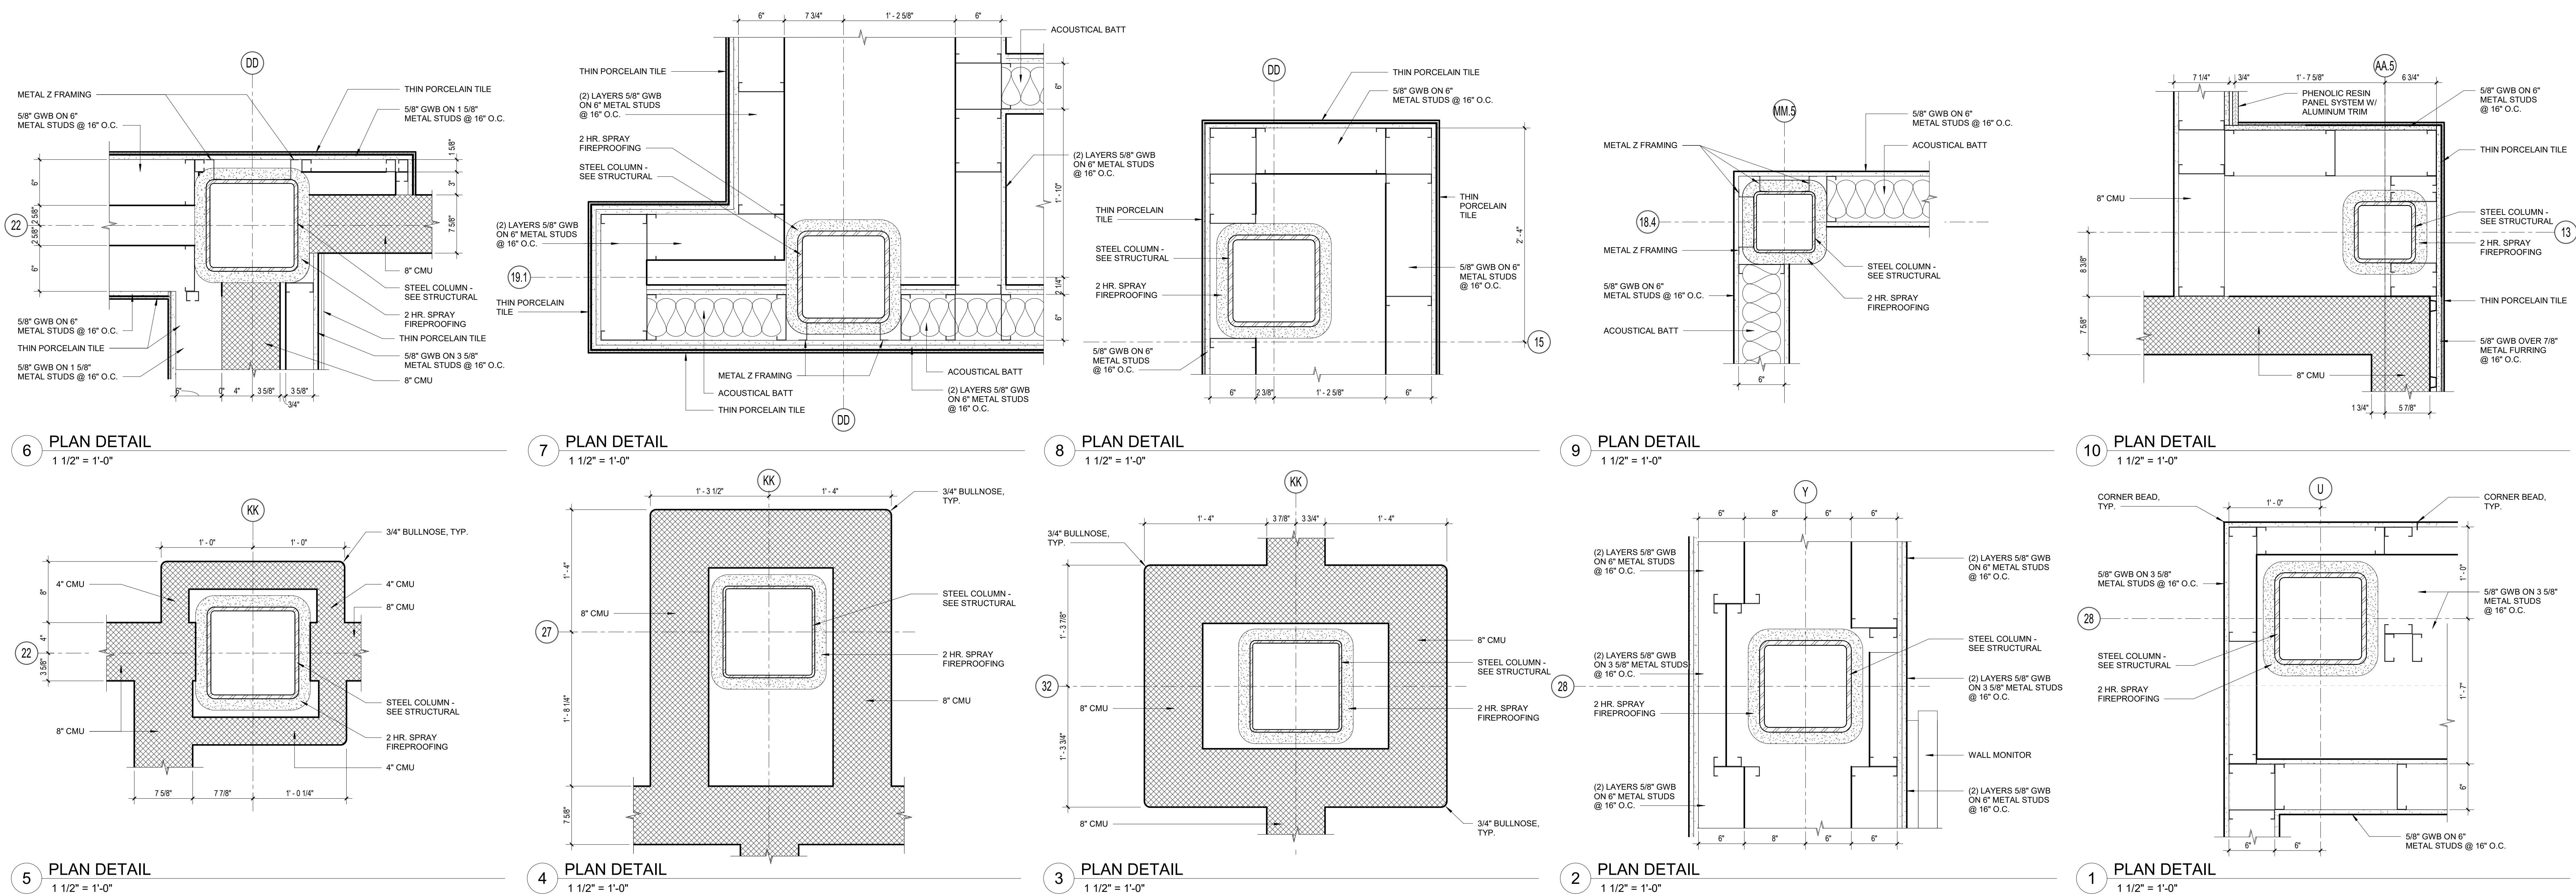

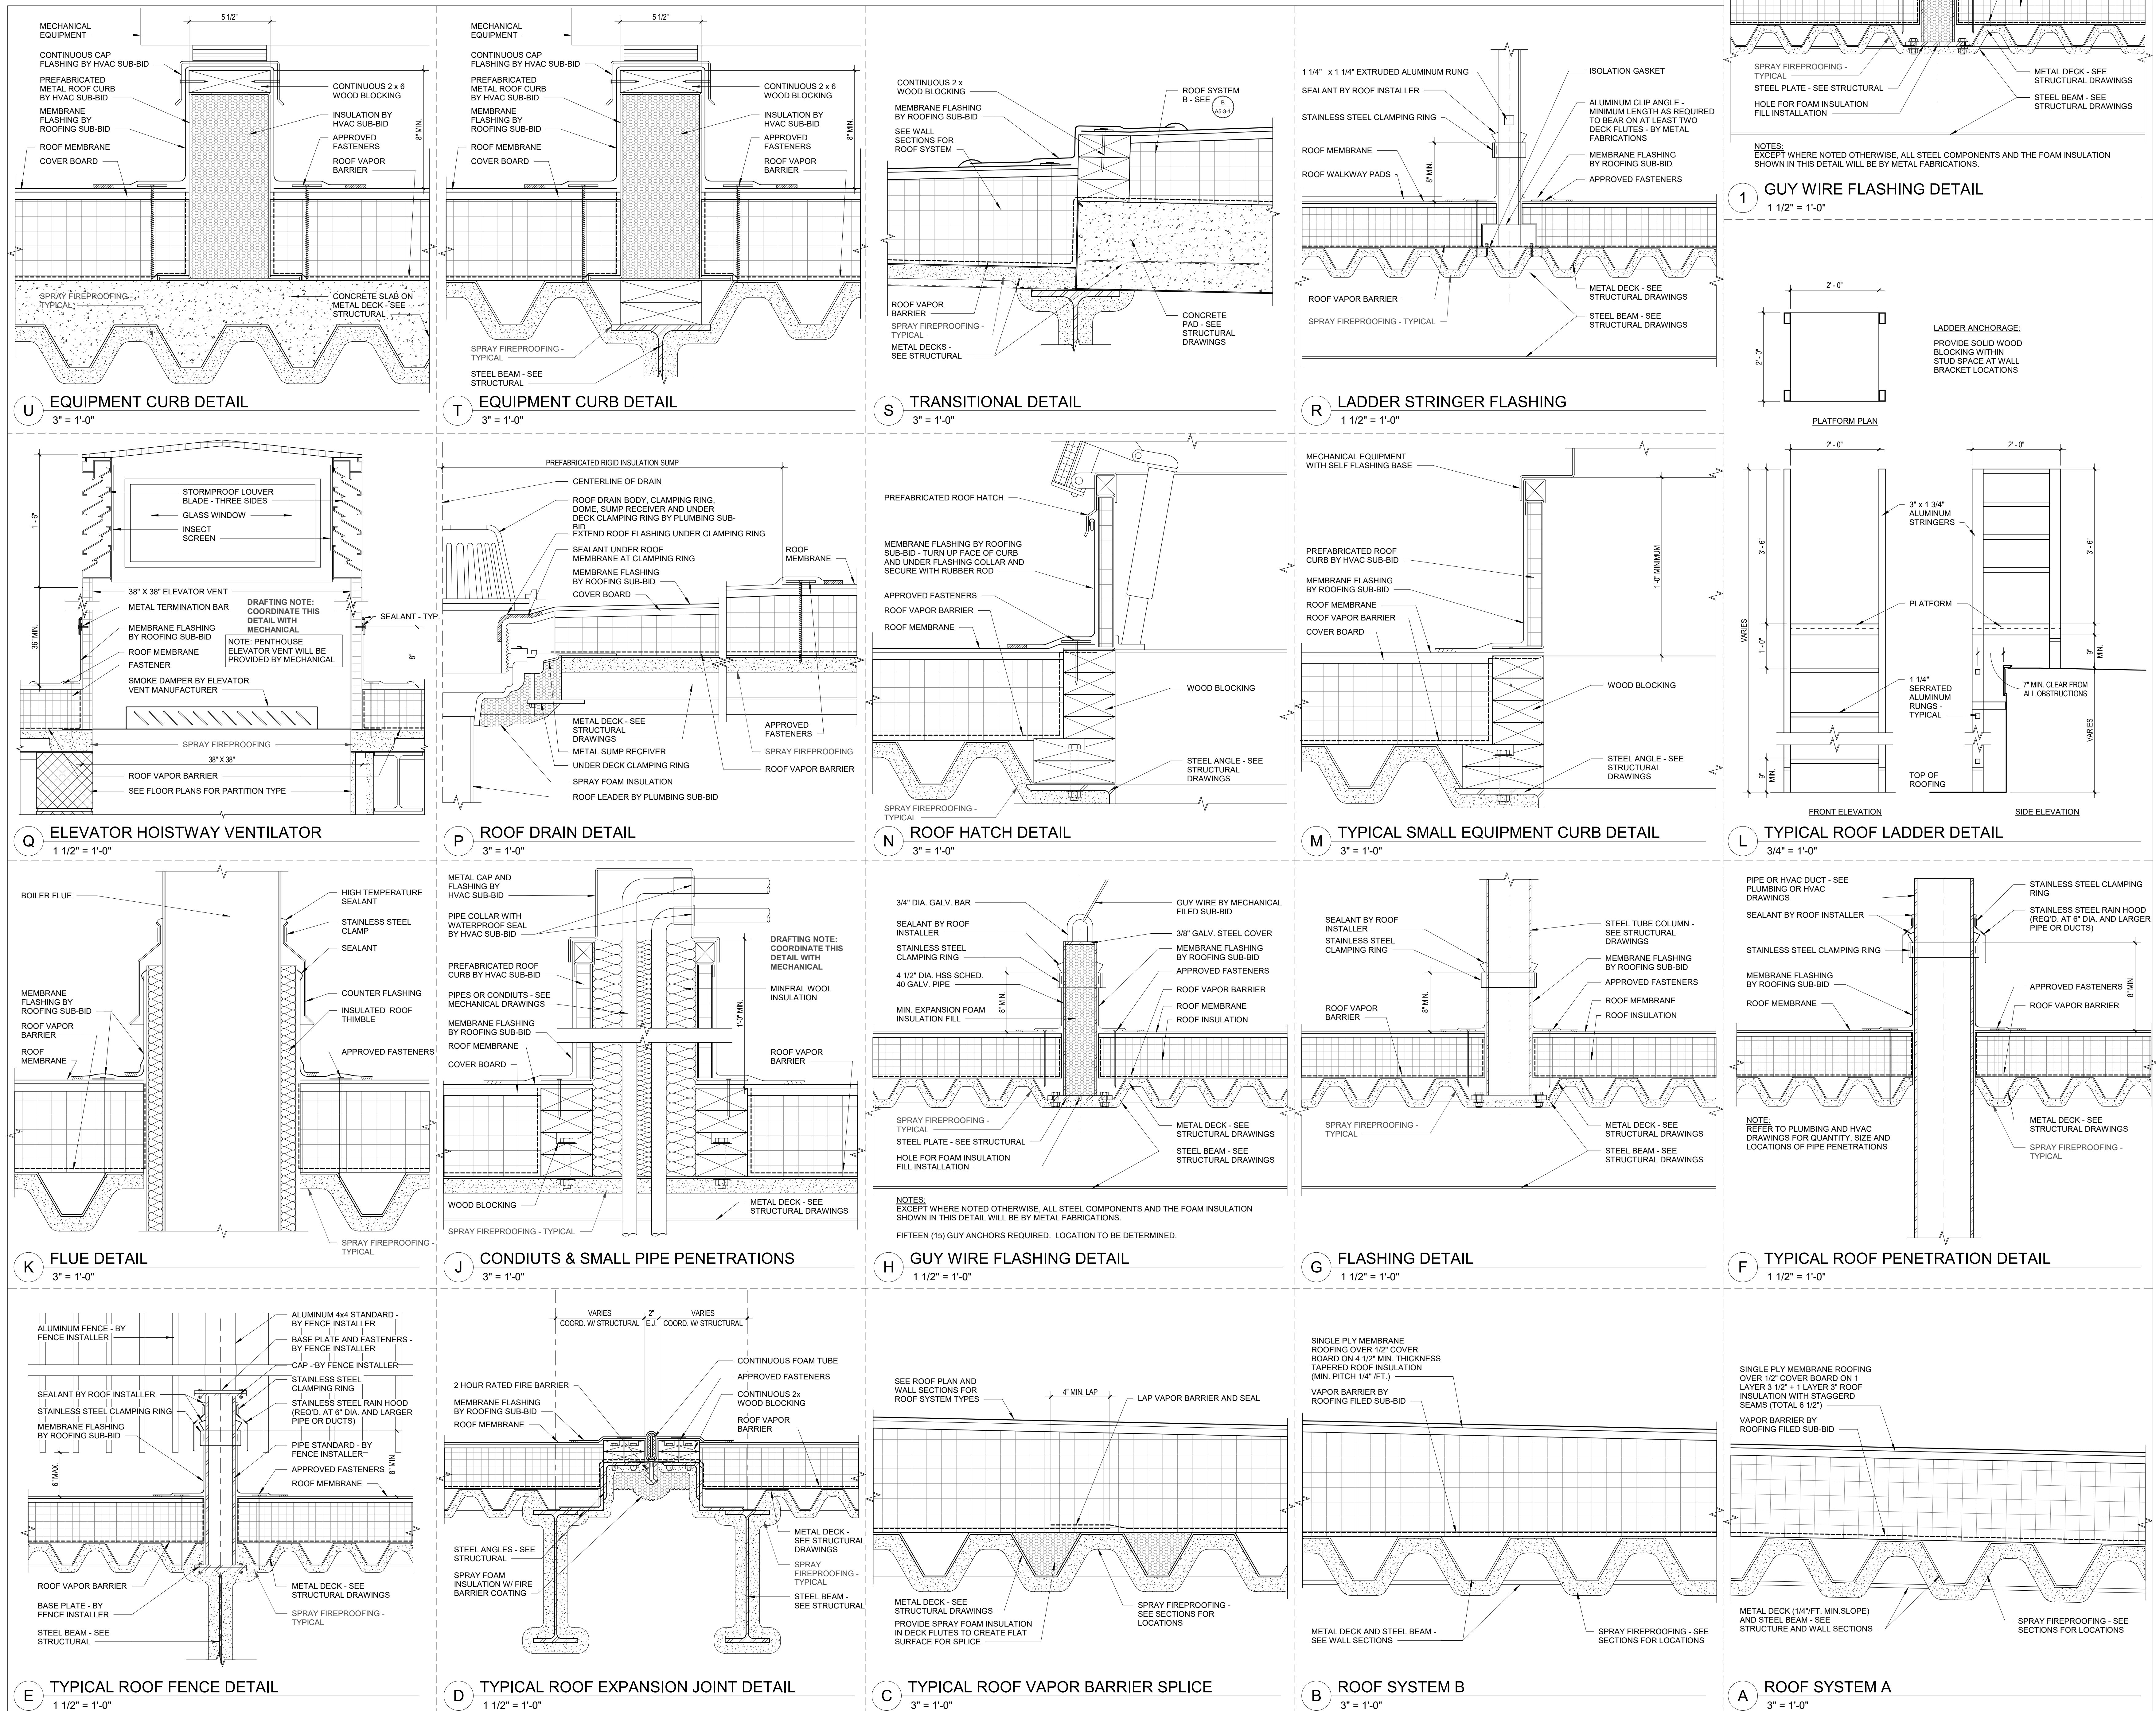**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880

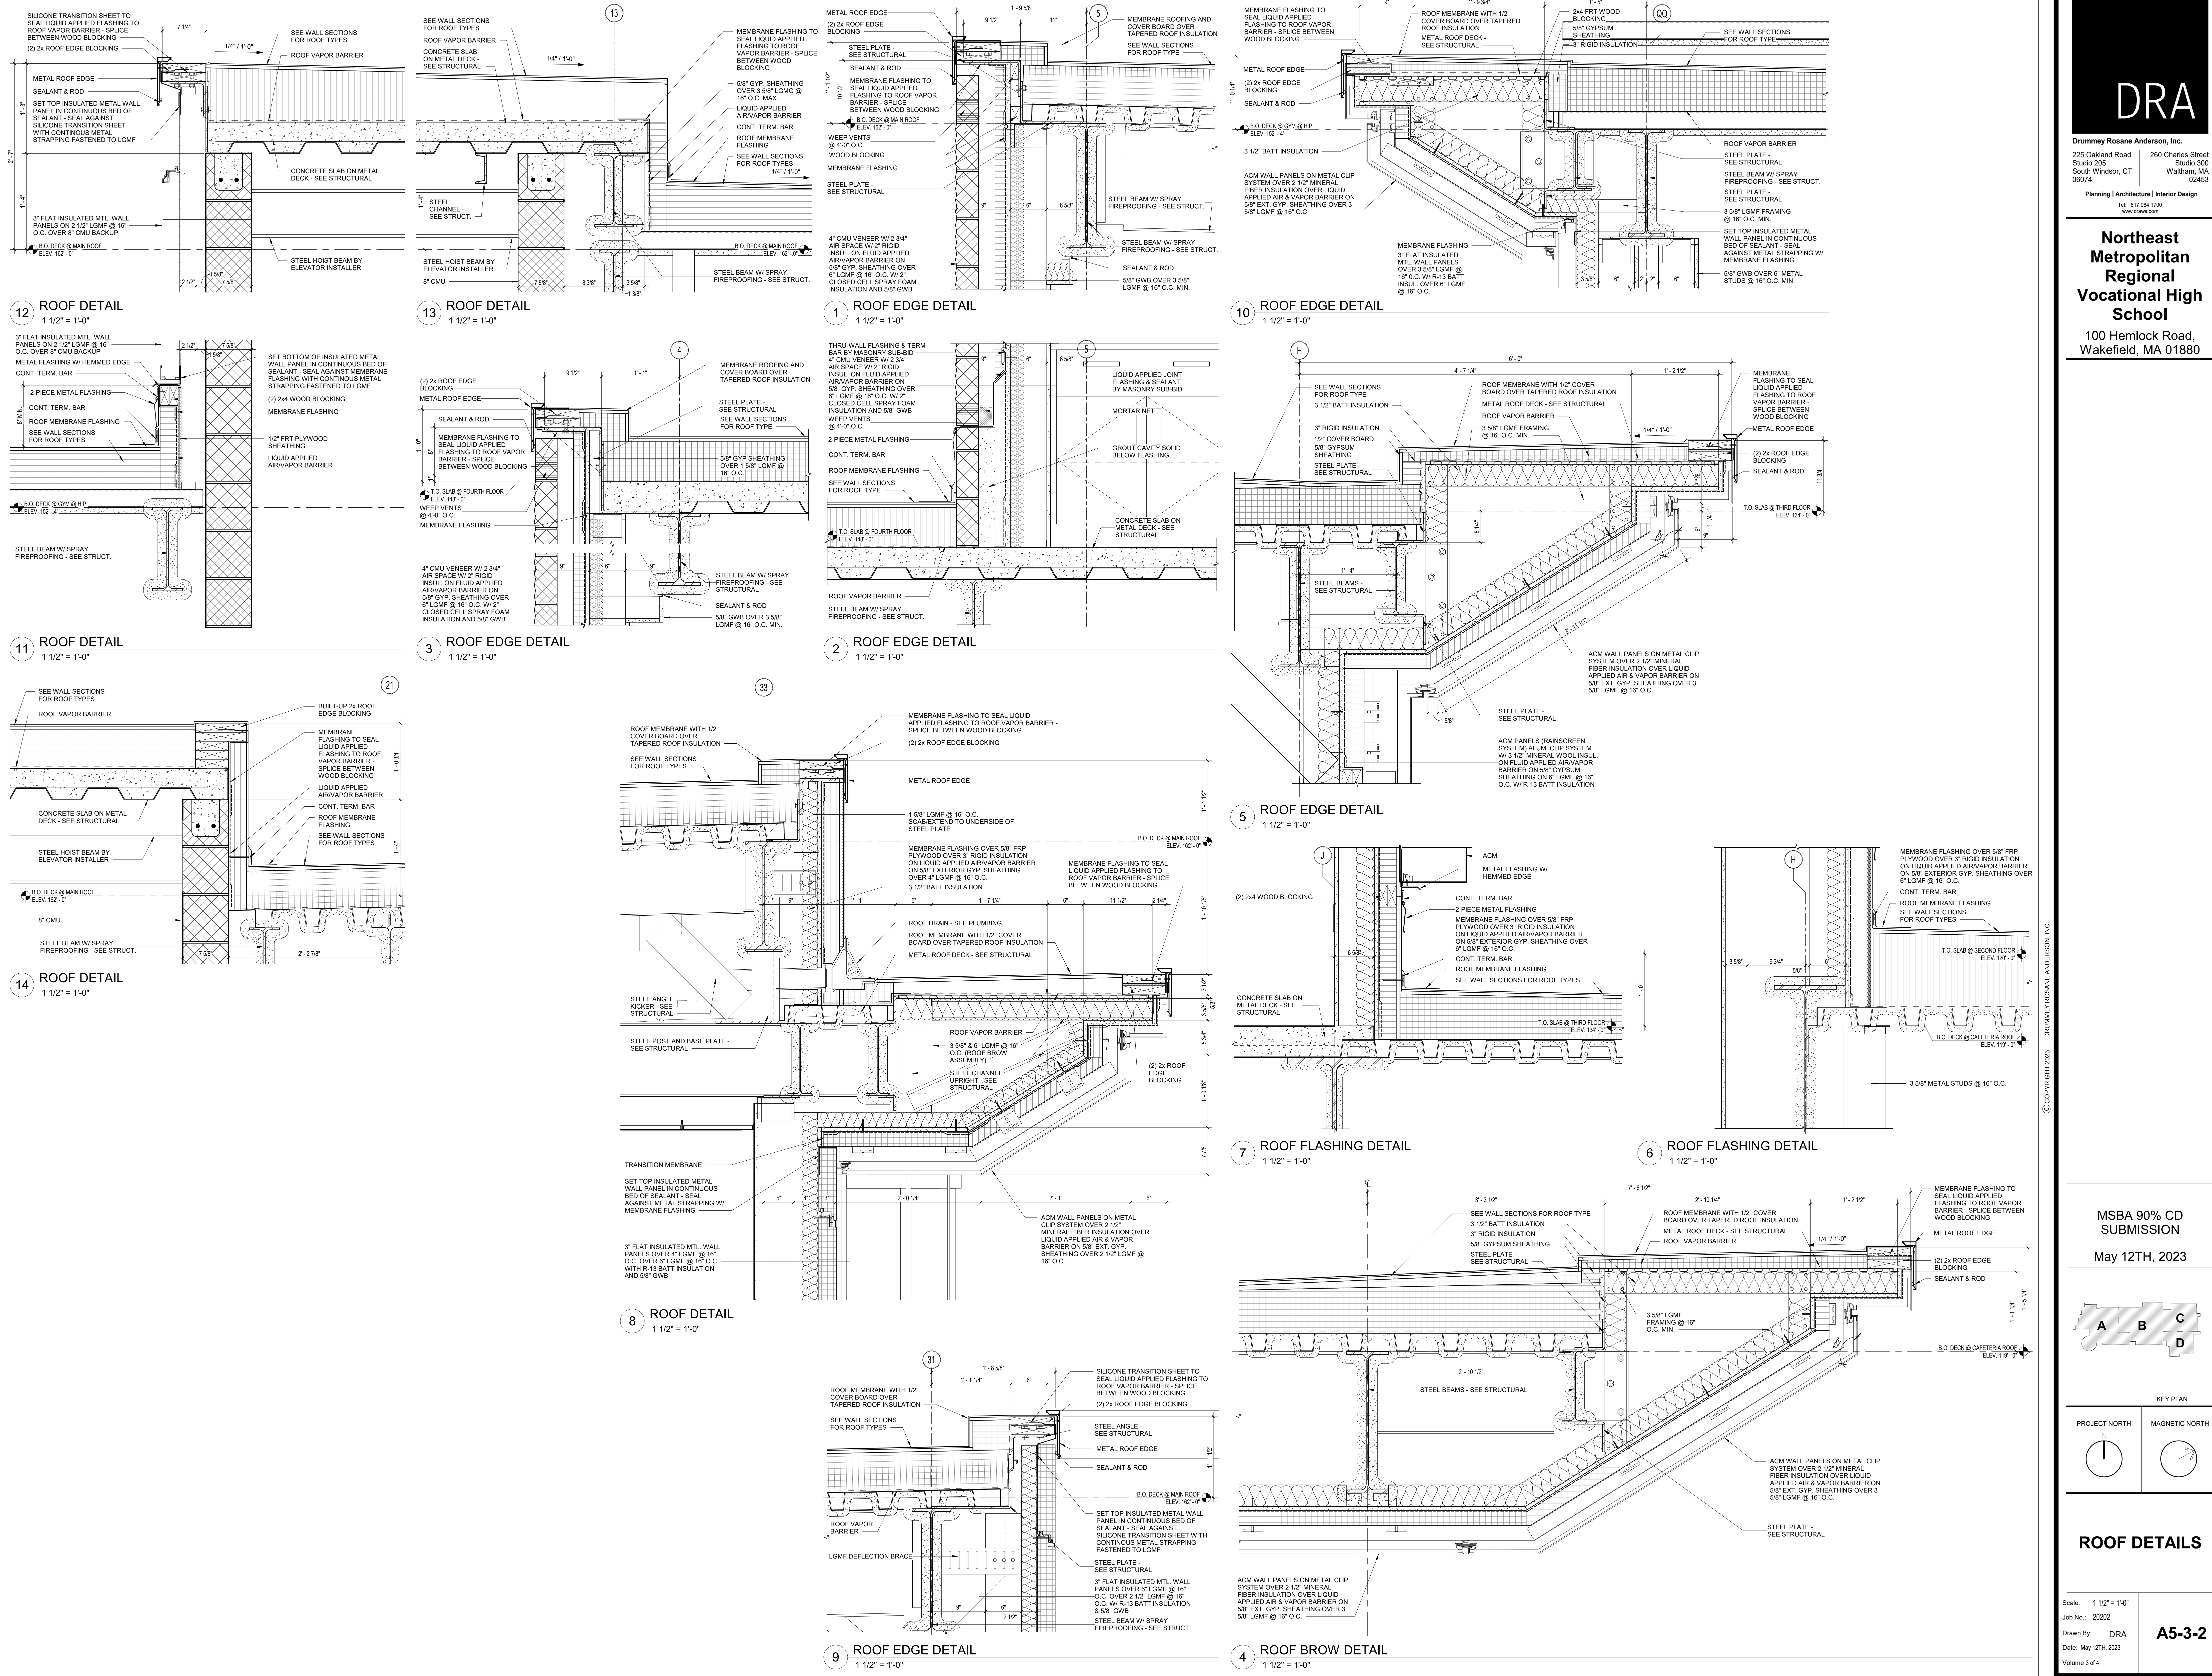

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1702
www.dra.com

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School
100 Hemlock Road, Wakefield, MA 01880




DrummeY Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Planning | Architecture | Interior Design
Tel: 617.854.1700
www.draai.com


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

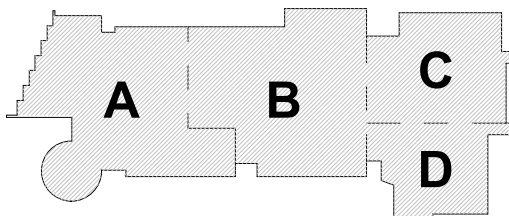

KEY PLAN

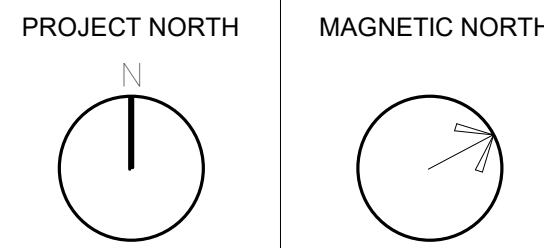

ROOF DETAILS

Scale:
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A5-3-3




DrummeY Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
260 Charles Street
Studio 300
Waltham, MA
02453
Planning | Architecture | Interior Design
Tel: 617.854.1700
www.draai.com


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

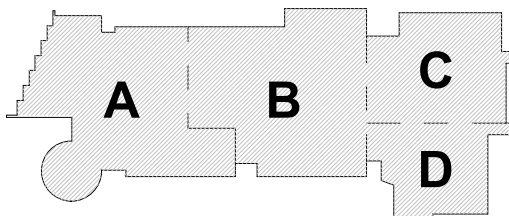

KEY PLAN

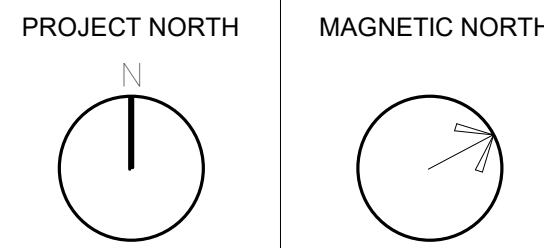


ROOF DETAILS


Scale:
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A5-3-4


DOOR NO	TO	NO.	NAME	DOORS		SIZE		FRAMES		SADDLE		HARD WARE	REMARKS	
				FROM	NAME	WIDTH	HEIGHT	THICK	TYPE	MAT.	LOUVER			
									TYPE	MAT.	JAMB DTL.	HEAD DTL.		
T.O. SLAB @ LOWER LEVEL														
A063.3	C0208	STORAGE	C0208	STOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	2/6-2.4	3/6-2.4	45 MIN	
C001.1	C001	ELECT - MAIN ELECT	C017	CORRIDOR	3'-10"	3'-10"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	1 1/2 HR
C001.2	C008	PLUMBING ROOM	C011	ELECT - MAIN ELECT	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C004.1	C004	METAL FABRICATION	C010	ELECT - VOG	3'-0"	3'-0"	7'-0"	1.34"	FW2	1	MTL	2/6-2.4	45 MIN	
C004.2	C004	METAL FABRICATION	C010	ELECT - VOG	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	5	MTL	1/6-2.4	10/6-2.4
C004.3	C004	METAL FABRICATION	C004	STOR	14'-0"	13'-4"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
C004.4	C004	METAL FABRICATION	C004	STOR	3'-6"	3'-6"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C004B	C004	METAL FABRICATION	C004B	STOR	3'-6"	3'-6"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C004D	C004D	TOOL CRIB	C004D	TOOL CRIB	3'-2 7/8"	3'-2 7/8"	7'-0"	1.34"	WM	ALUM	-	ALUM	-	-
C004E	C004E	TOOL CRIB	C004E	TOOL CRIB	3'-2 7/8"	3'-2 7/8"	7'-0"	1.34"	WM	ALUM	-	ALUM	-	-
C004F	C004C	LOCKER	C004C	TLT	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C005	C011	CORRIDOR	C005	ELECT - MAIN STANDBY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C005A	C011	CORRIDOR	C005A	ELECT - VOG	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C006	C017	CORRIDOR	C006	ELECT - LIFE SAFETY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C007	C008	PLUMBING ROOM	C007	GENERATOR PANELS	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C008	C011	CORRIDOR	C008	ELECT - VOG	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C009	C017	CORRIDOR	C009	IDF	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C012	C011	CORRIDOR	C012	ELEV MACH	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C013	C013	CUST OFF	C017	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3	MTL	2/6-2.4	3/6-2.4
C014	C017	CORRIDOR	C014	RECYCLING ROOM	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C015	C017	CORRIDOR	C015	GENERAL SUPPLY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C015B	C017	CORRIDOR	C015B	CLUST	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C018	C018	METAL FAB RELATED CR	C010	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3A	MTL	2/6-2.4	3/6-2.4
C019	C010	GENERAL SUPPLY	C019	GENERAL SUPPLY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C020	C020	CUST WORKSHOP	C017	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C021	C017	CORRIDOR	C021	STORAGE	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C021A	C022F	STOR	C019	GENERAL SUPPLY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C022	C010	CORRIDOR	C022	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C022.2	C022	AUTO COLLISION	C002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	FW2	1	MTL	2/6-2.4	3/6-2.4	
C022.3	C022	AUTO COLLISION	C002	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	5	MTL	1/6-2.4	10/6-2.4
C022.4	C022	AUTO COLLISION	C002	AUTO COLLISION	12'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
C022.5	C022	AUTO COLLISION	C022	AUTO COLLISION	12'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
C022.6	C022	AUTO COLLISION	C022	AUTO COLLISION	12'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
C022.7	C022	AUTO COLLISION	C022	AUTO COLLISION	12'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
C022.8	C010	CORRIDOR	C022	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C022.10	C019	GENERAL SUPPLY	C022	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C022.11	C019	GENERAL SUPPLY	C022	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C022.12	C022	AUTO COLLISION	C022	AUTO COLLISION	3'-6"	3'-6"	7'-7"	1.34"	WM	ALUM	-	ALUM	-	-
C022B	C0208	STORAGE	C022	AUTO COLLISION	3'-0"	3'-0"	7'-10"	1.34"	WM	ALUM	-	ALUM	-	-
C022C	C02	AUTO COLLISION	C022C	TLT	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
C022D.1	C022	AUTO COLLISION	C022D	RELATED CR	3'-10"	3'-10"	7'-0"	1.34"	FW1	MTL	1	MTL	1/6-2.4	1/6-2.4
C022D.2	C002	CORRIDOR	C022D	RELATED CR	3'-0"	3'-0"	7'-0"	1.34"	FW2	MTL	1	MTL	2/6-2.4	3/6-2.4
C022D.3	C0208	STORAGE	C022D	AUTO COLLISION	3'-0"	3'-0"	7'-0"	1.34"	FW2	MTL	1	MTL	2/6-2.4	3/6-2.4
C023	C023	TEAM LOCKER	C017	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C024.1	C024	COACH OFF	C002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C024.2	C024	COACH OFF	C002	TEAM LOCKER	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C025	C025	SHOWER	C002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C026.1	C026	COACH OFF	C002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C026.2	C027	TEAM LOCKER	C002	COACH OFF	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C027	C002	CORRIDOR	C027	TEAM LOCKER	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
C001	C002	CORRIDOR	C001	CUST STORAGE	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
D003.1.1	D003	AUTO TECHNOLOGY	D003	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3A	MTL	2/6-2.4	3/6-2.4
D003.2	D003	AUTO TECHNOLOGY	D003	AUTO TECHNOLOGY	14'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
D003.3	D003	AUTO TECHNOLOGY	D003	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	5	MTL	1/6-2.4	10/6-2.4
D003.4	D003	AUTO TECHNOLOGY	D003	AUTO TECHNOLOGY	16'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
D003.5	D003	AUTO TECHNOLOGY	D003	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	5	MTL	1/6-2.4	10/6-2.4
D003.6	D002	CORRIDOR	D003	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3A	MTL	2/6-2.4	3/6-2.4
D003C	D003C	TLT	D003C	LOCKER	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
D003D.1	D003D	RELATED CR	D003	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3	MTL	2/6-2.4	3/6-2.4
D003D.2	D003	AUTO TECHNOLOGY	D003D	RELATED CR	3'-10"	3'-10"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
D003D.3	D002	CORRIDOR	D003D	RELATED CR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	2	MTL	2/6-2.4	3/6-2.4
D003D.4	D003E	STOR	D003D	RELATED CR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
D003F	D003F	TOOL CRIB	D003D	AUTO TECHNOLOGY	3'-0"	3'-0"	7'-2"	1.34"	WM	ALUM	-	ALUM	-	-
D003G	D003G	STOR	D003G	TOOL CRIB	3'-0"	3'-0"	7'-2"	1.34"	WM	ALUM	-	ALUM	-	-
D003H	D003	AUTO TECHNOLOGY	D003H	SMALL ENGINES	3'-6"	3'-6"	7'-4"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
D003J	D003H	SMALL ENGINES	D003H	STOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
E2.1	E2	ELEV #2	C011	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
S3.1	S3	STAIR 3	D002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	FW1	MTL	1	MTL	2/6-2.4	3/6-2.4
S6.1	S6	STAIR 6	D002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	FW1	MTL	1	MTL	2/6-2.4	3/6-2.4
S6.2	S6	STAIR 6	D002	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	FW1	MTL	1	MTL	2/6-2.4	3/6-2.4
S7.1	S7	STAIR 7	C010	CORRIDOR	3'-10"	3'-10"	8'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
S7.2	S7	STAIR 7	C010	CORRIDOR	3'-0"	3'-0"	7'-0"	1.34"	FW1	MTL	1	MTL	2/6-2.4	3/6-2.4
B.O. PLANK @ LOWER LEVEL MEZZANINE														
M002A	M002A	ELECT RM	M002	MEZZANINE	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
M003A	M003	MEZZANINE	M003A	ELECT RM	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
T.O. SLAB @ FIRST FLOOR														
A103	A108	KITCHEN	A104	DRY STOR	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
A104	A108	KITCHEN	A104	OFF	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	3	MTL	1/6-2.4	1/6-2.4
A105A	A105	STAFF LOCKER RM	A105A	CL	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
A106	A106	TLT	A106	STAFF LOCKER RM	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
A107	A105	STAFF LOCKER RM	A107	TLT	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	1/6-2.4	1/6-2.4
A108A	A114	CAFETERIA	A108A	DISH WASHING	14'-0"	13'-4 3/8"	1.34"	0H2	ALUM	-	MTL	5/6-2.3	4/6-2.3	
A108B	A108	KITCHEN	A108B	CL	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
A108C	A108	RECEIVING	A108C	CL	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
A109	A110	RECEIVING	A109	RECYCLING ROOM	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
A110	A110	RECEIVING	A110	RECEIVING	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
A110.2	A110	RECEIVING	A108	KITCHEN	3'-0"	3'-0"	7'-0"	1.34"	F	MTL	1	MTL	2/6-2.4	3/6-2.4
A110.3	A110.3	RECEIVING	A110.3	RECEIVING	3'-0"	3'-0"	7'-0"	1.34"	FW2	MTL	1	MTL	2/6-2.4	3/6-2.4
A110.4	A110.4	RECEIVING	A110	RECEIVING	8'-0"	10'-0"	3"	R	MTL	-	MTL	1/6-2.4	23/6-2.4	
A111.1	A111	STAFF LUNCH RM	A114	CAFETERIA	3'-0"	3'-0"	7'-0"	1.34"	AL2	ALUM	CW	ALUM	-	-
A111.2	A111	STAFF LUNCH RM	A111	STAFF LUNCH RM	3'-0"	3'-0"	7'-0"	1.34"	AL2	ALUM	CW	ALUM	-	-
A112.1	A112	SERVRY	A114	CAFETERIA	6'-0"	10'-0"	2"	RG	MTL	-	MTL	15/6-2.4	22/6-2.4	
A112.2	A112	SERVRY	A114	CAFETERIA	6'-0"	10'-0"	2"	RG	MTL	-	MTL	15/6-2.4	22/6-2.4	
A112.3	A112	SERVRY	A114											

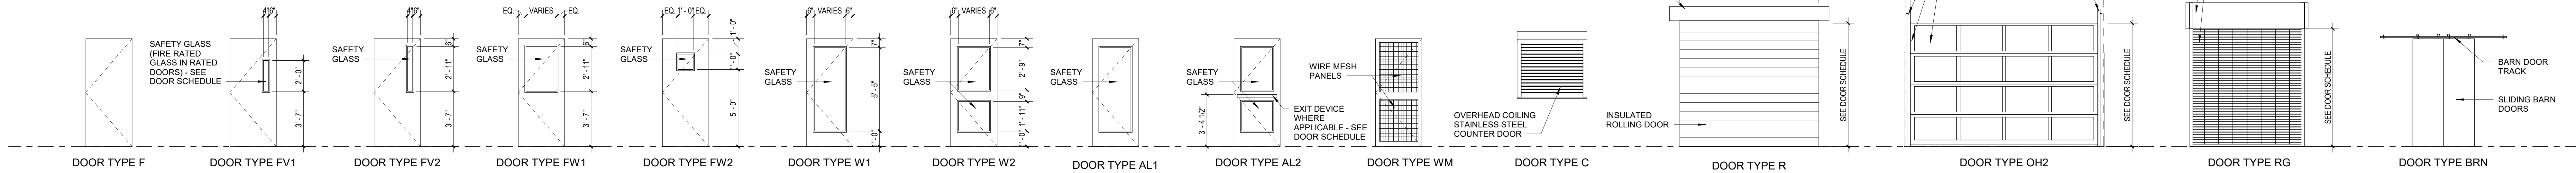


1 DOOR TYPES
1/4" = 1'-0"

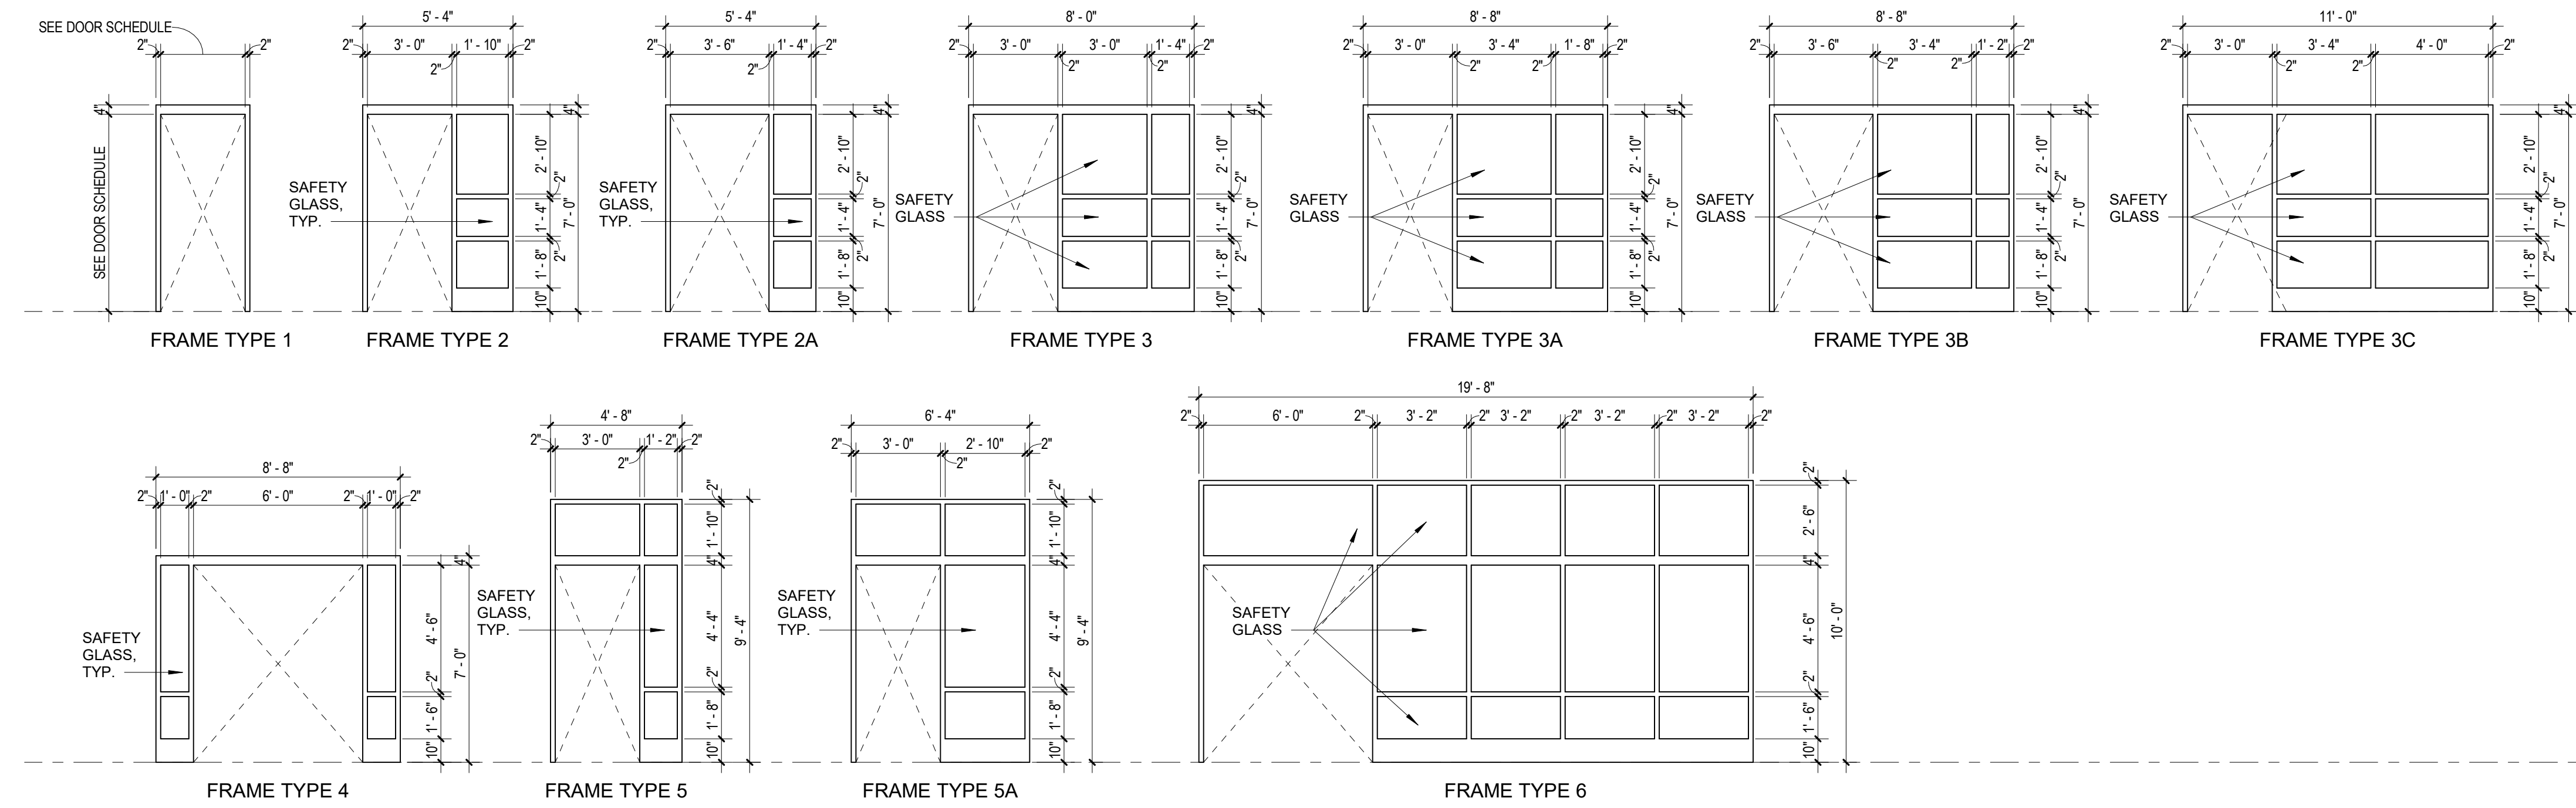


2 FRAME TYPES
1/4" = 1'-0"

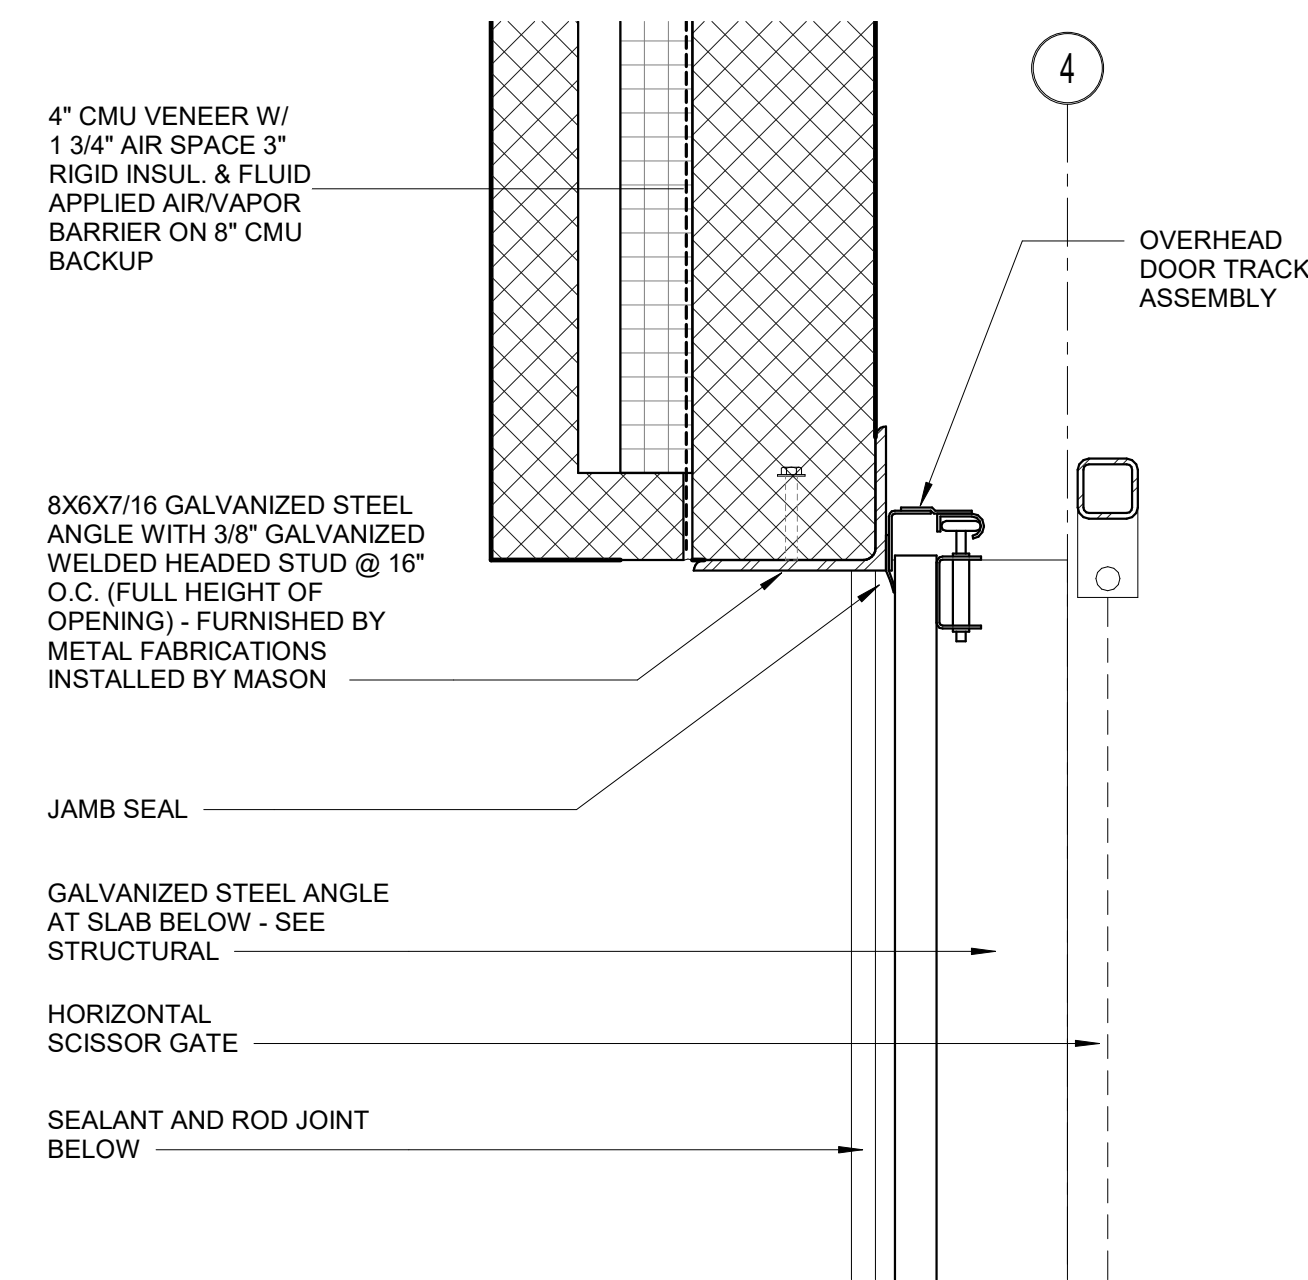


3 OVERHEAD DOOR JAMB DETAIL
1 1/2" = 1'-0"

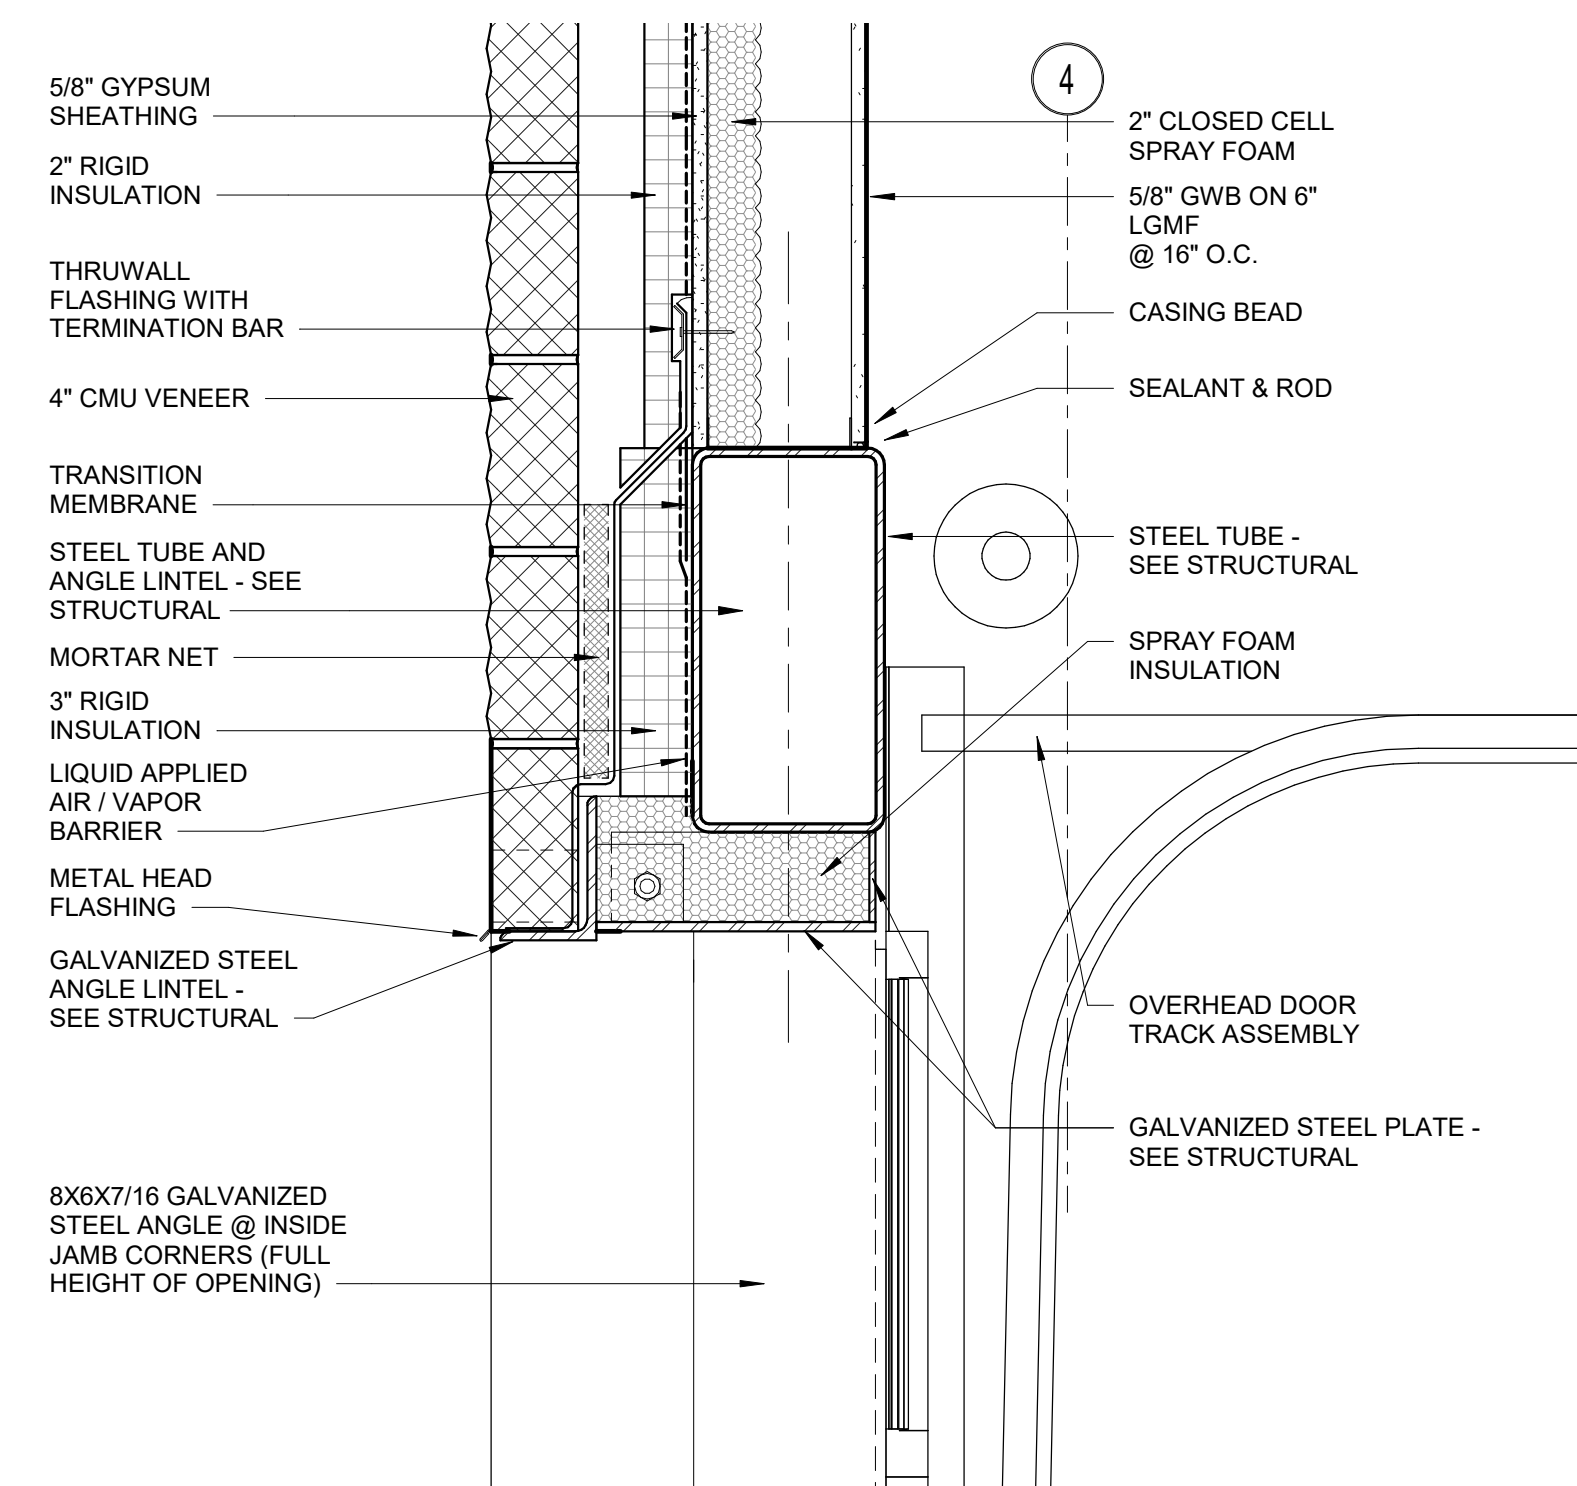


4 OVERHEAD DOOR HEAD DETAIL
1 1/2" = 1'-0"

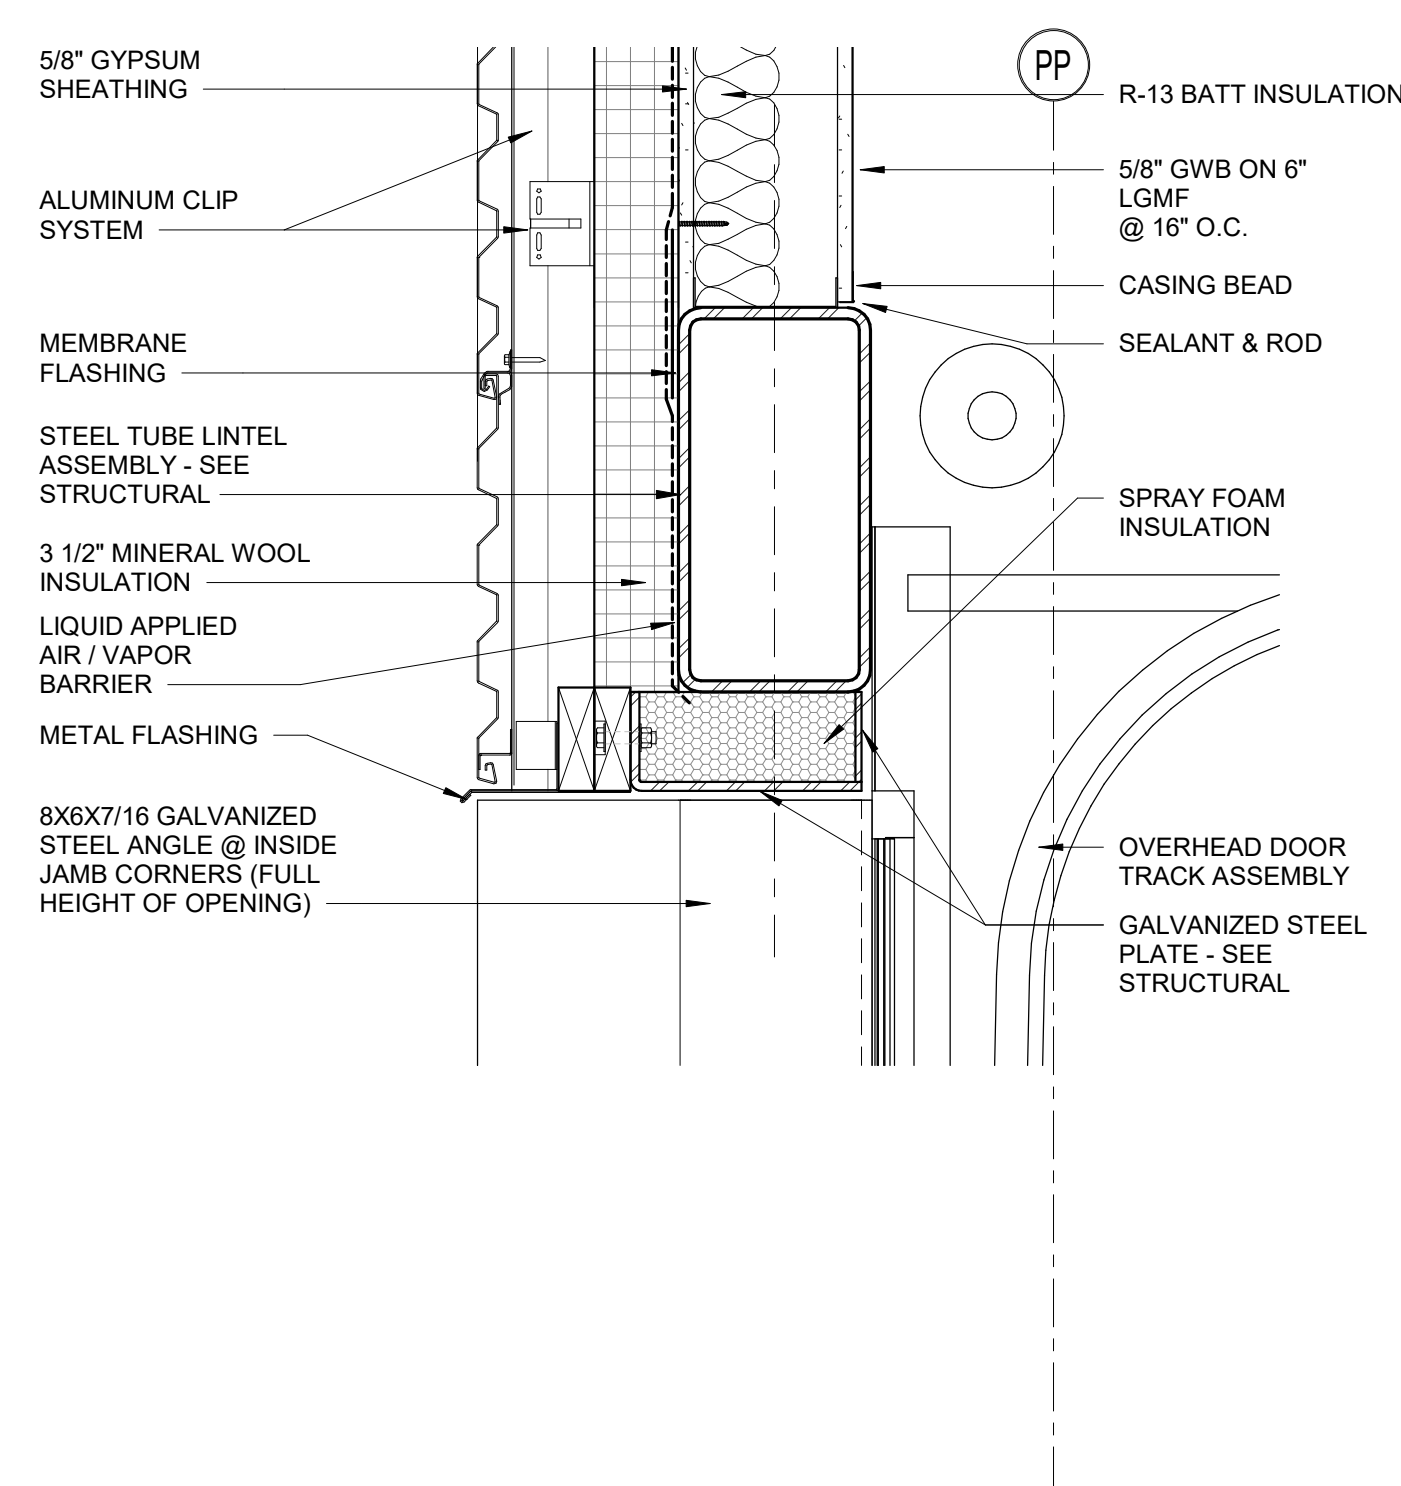


5 OVERHEAD DOOR HEAD DETAIL
1 1/2" = 1'-0"

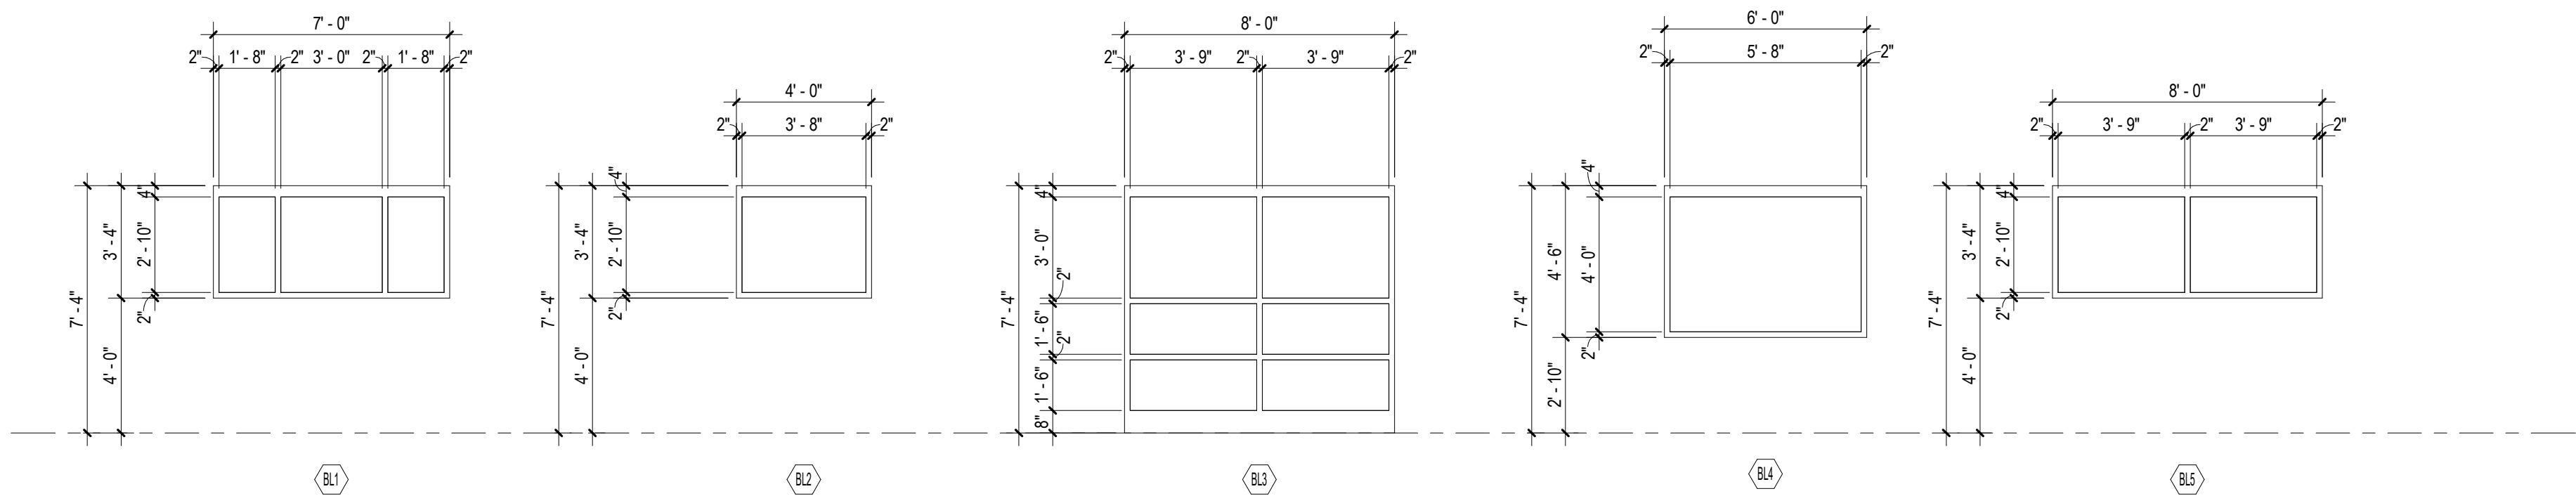

6 BORROWED LIGHT TYPES
1/4" = 1'-0"

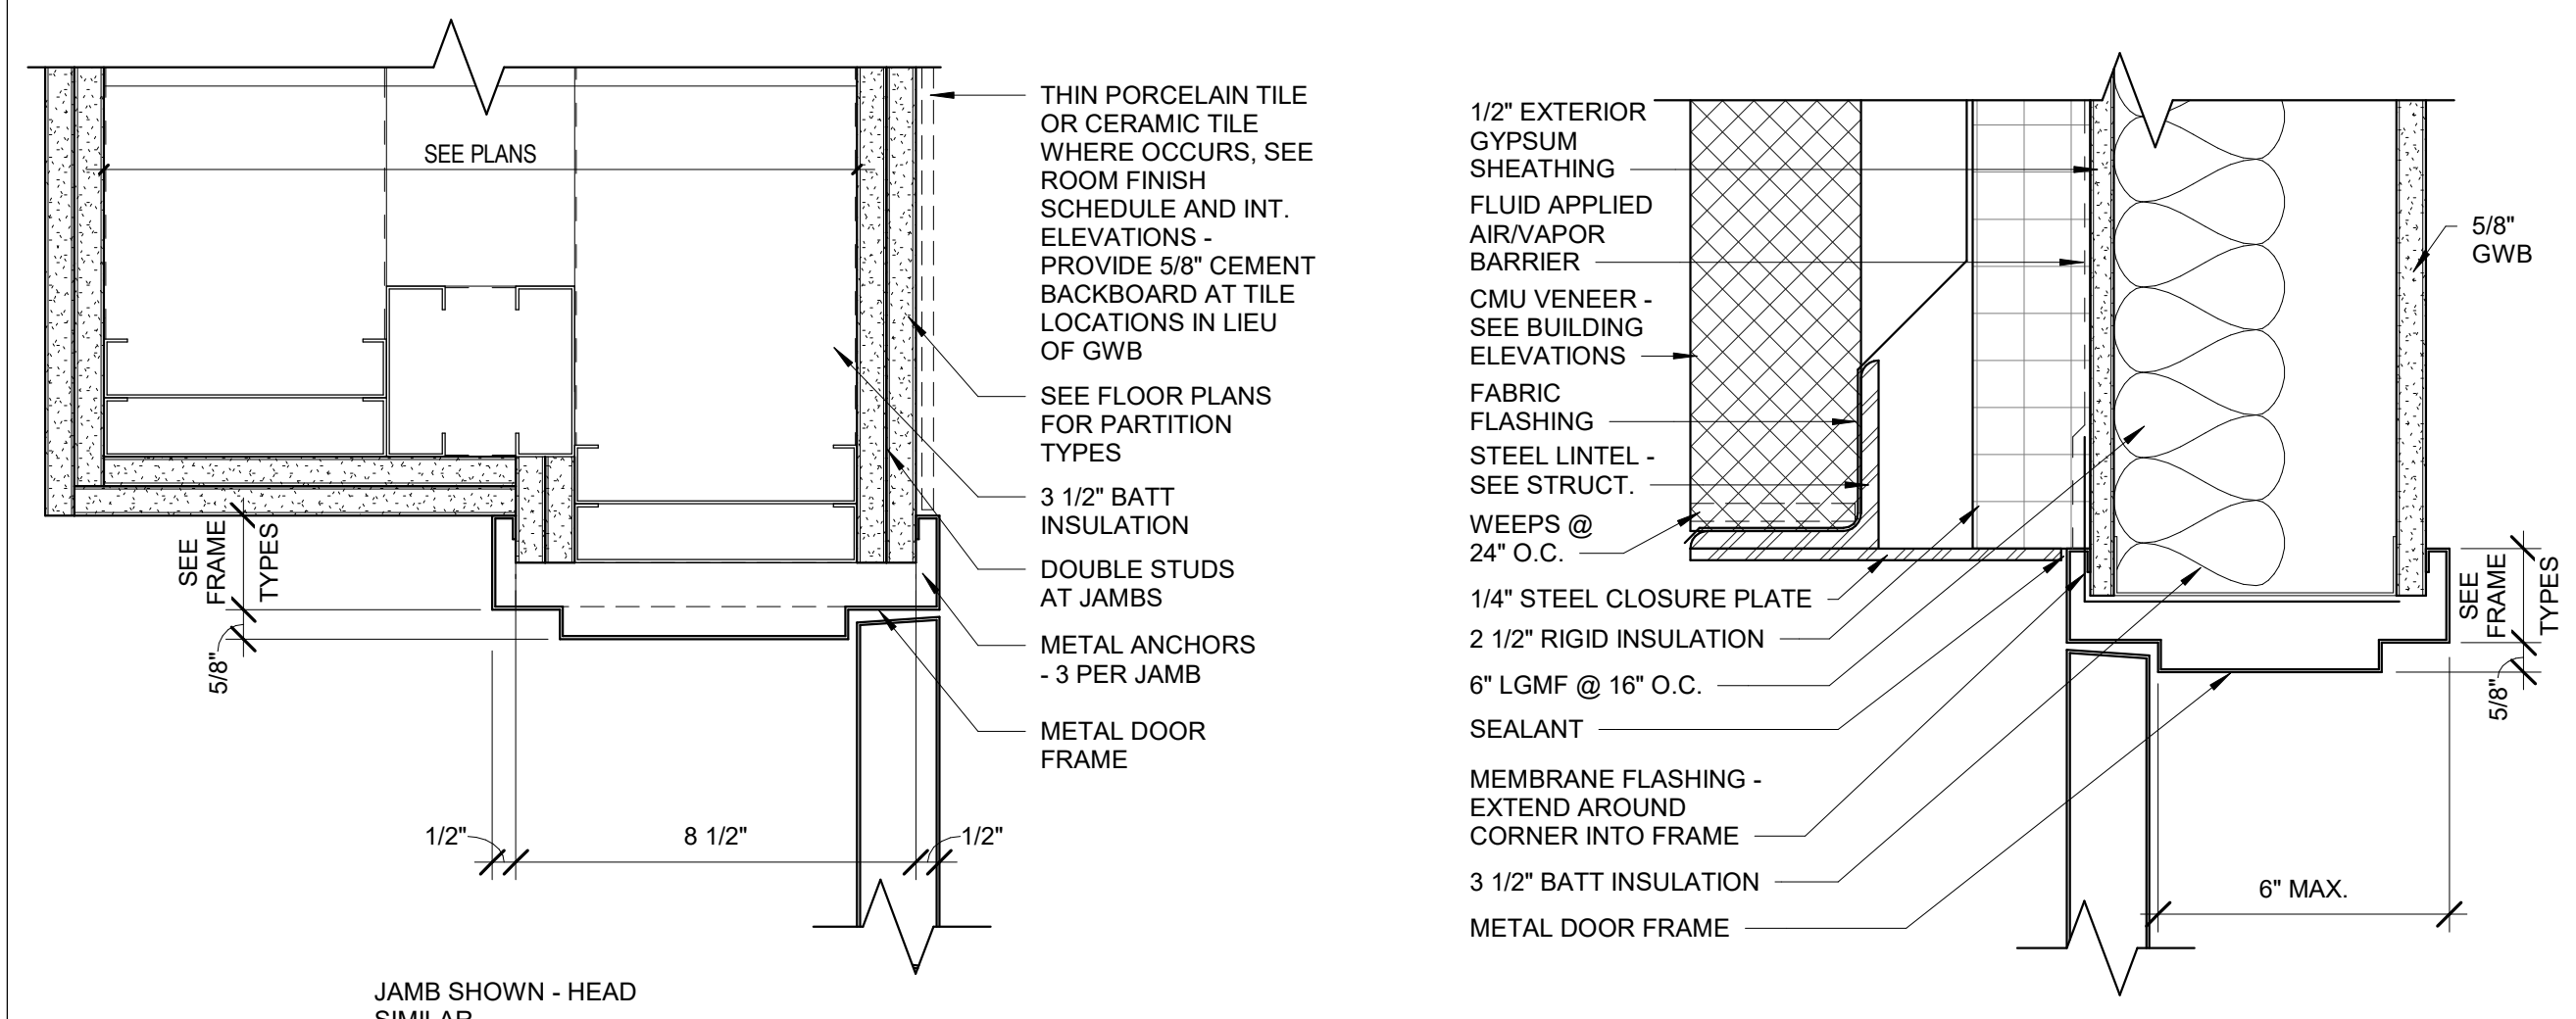


25 DOOR JAMB DETAIL
3" = 1'-0"

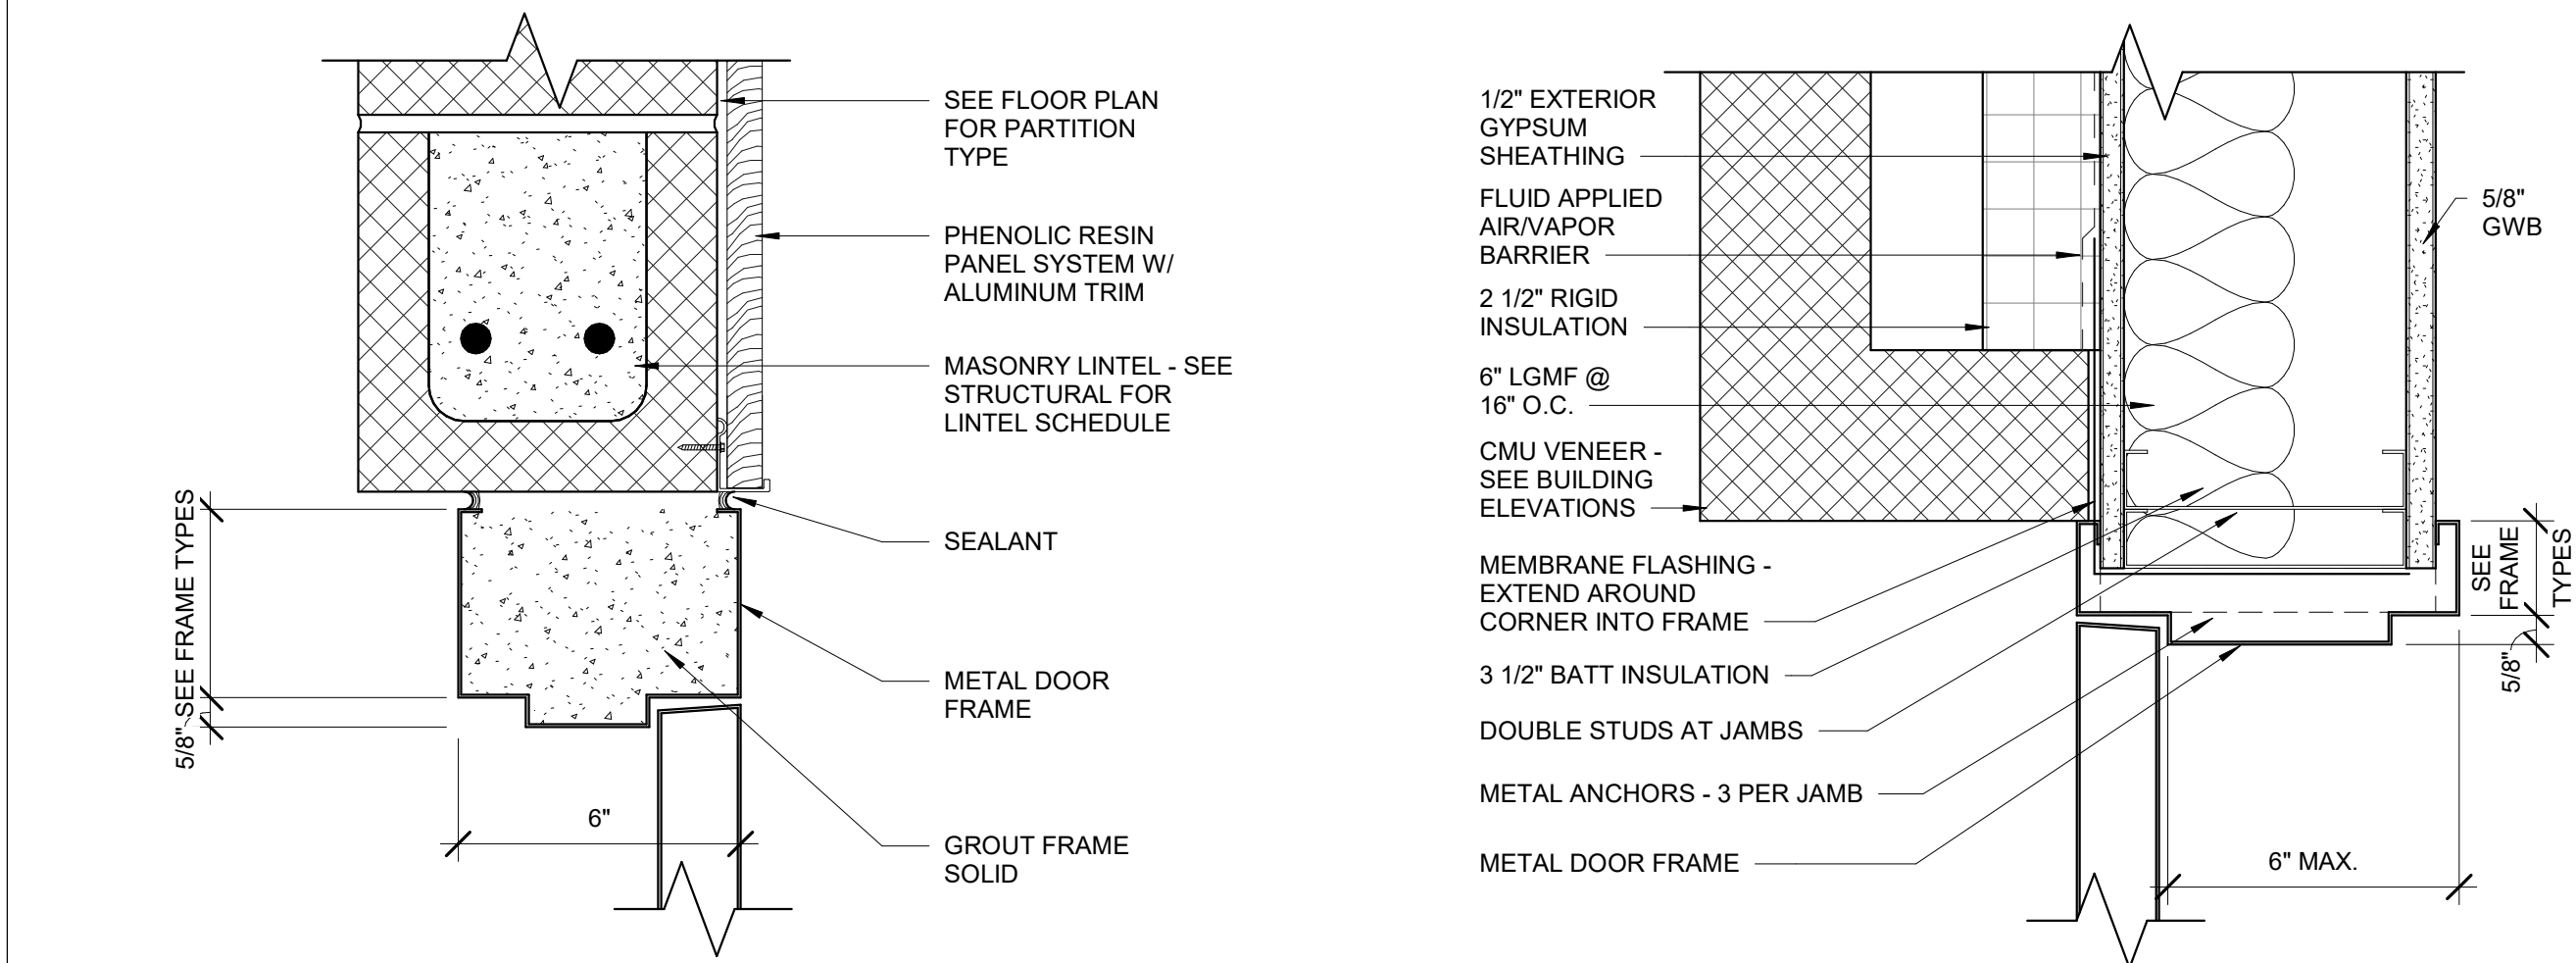


21 DOOR HEAD DETAIL
3" = 1'-0"

19 DOOR HEAD DETAIL
3" = 1'-0"

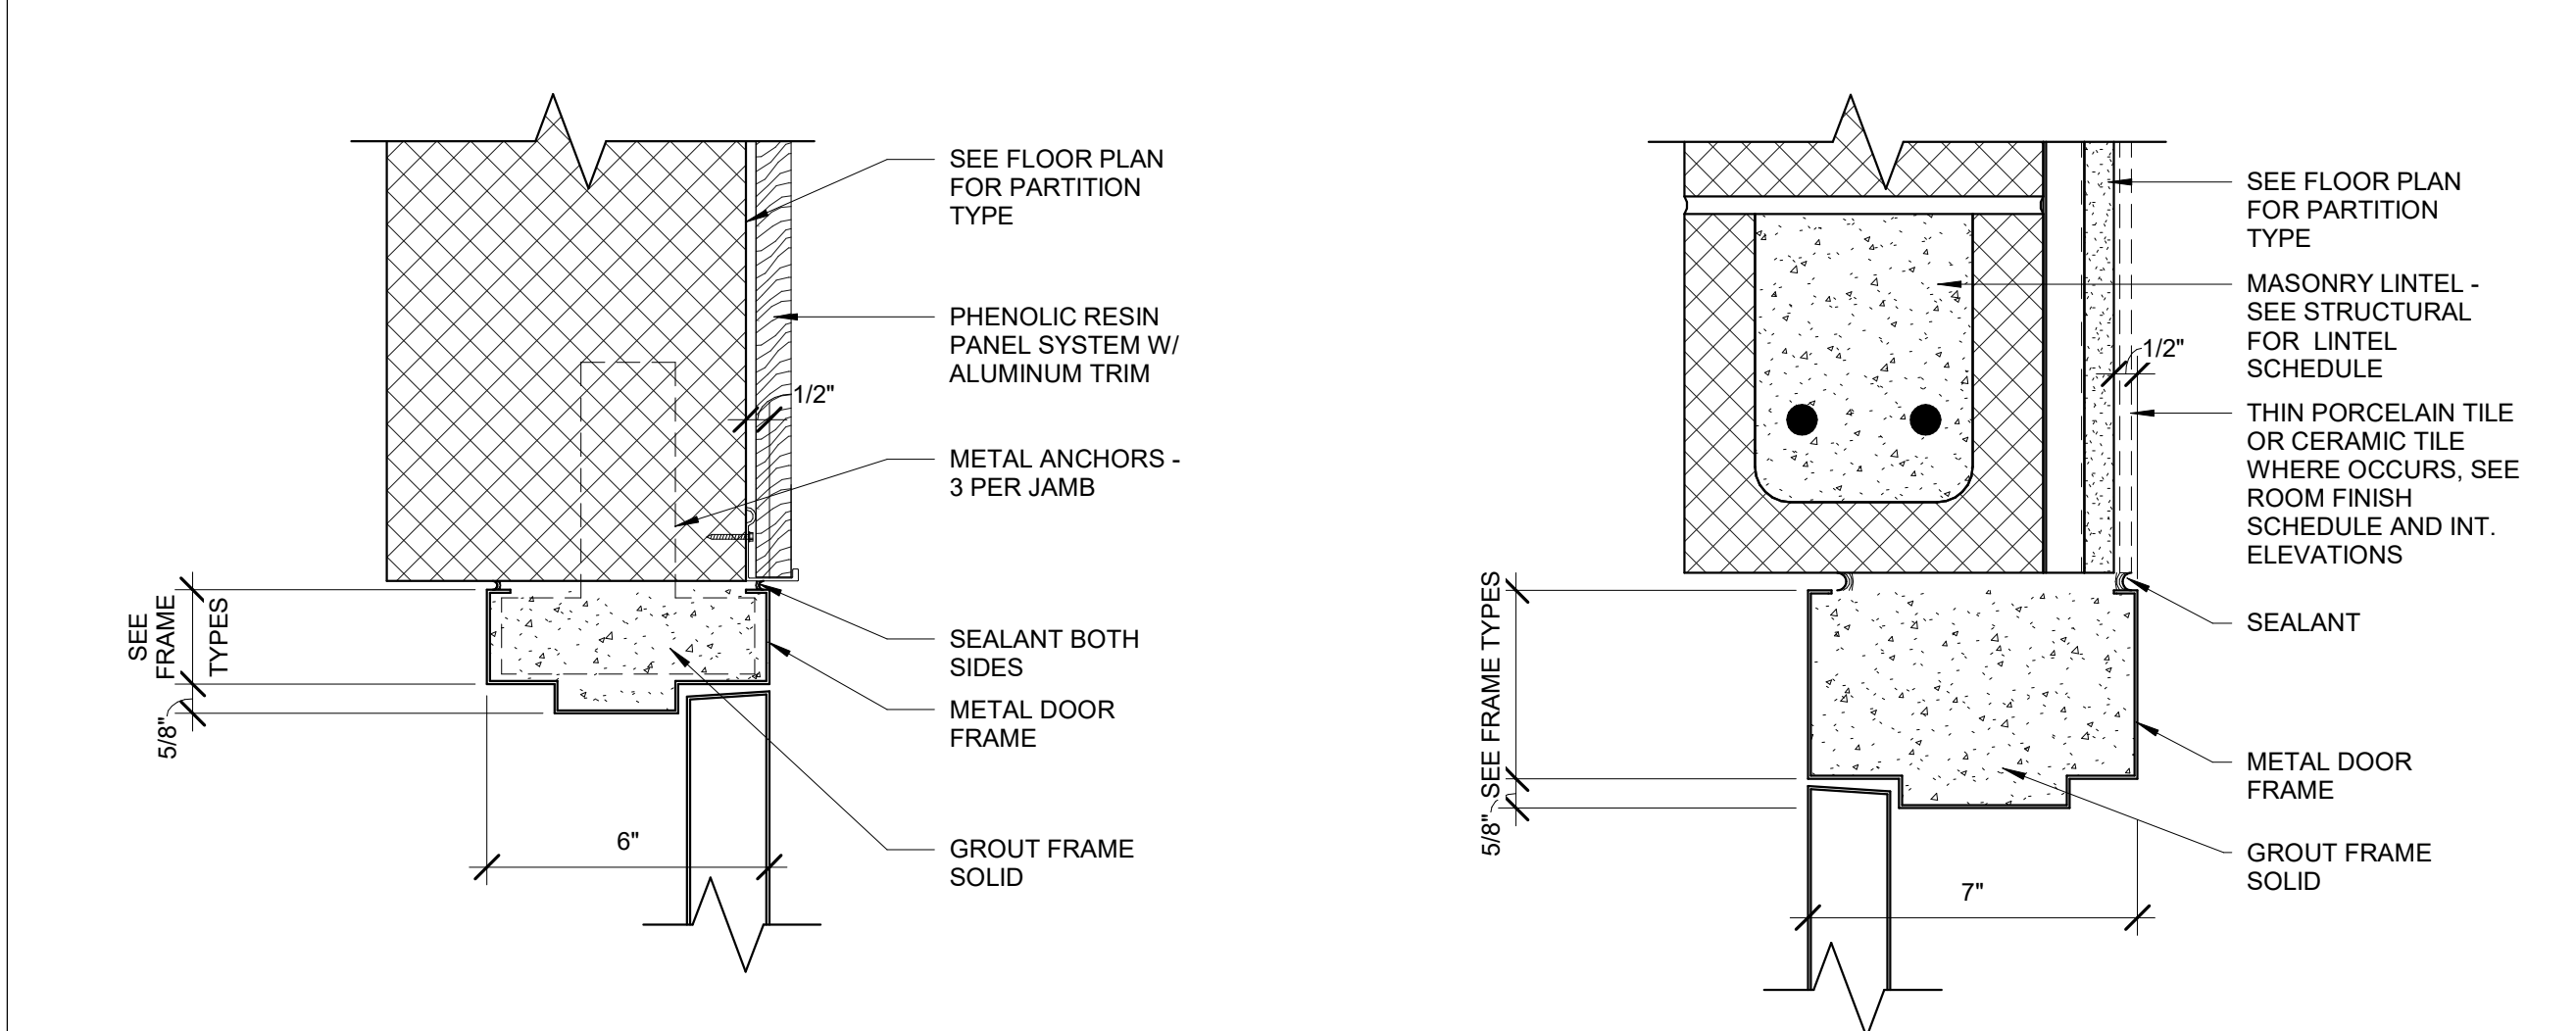


18 DOOR JAMB DETAIL
3" = 1'-0"

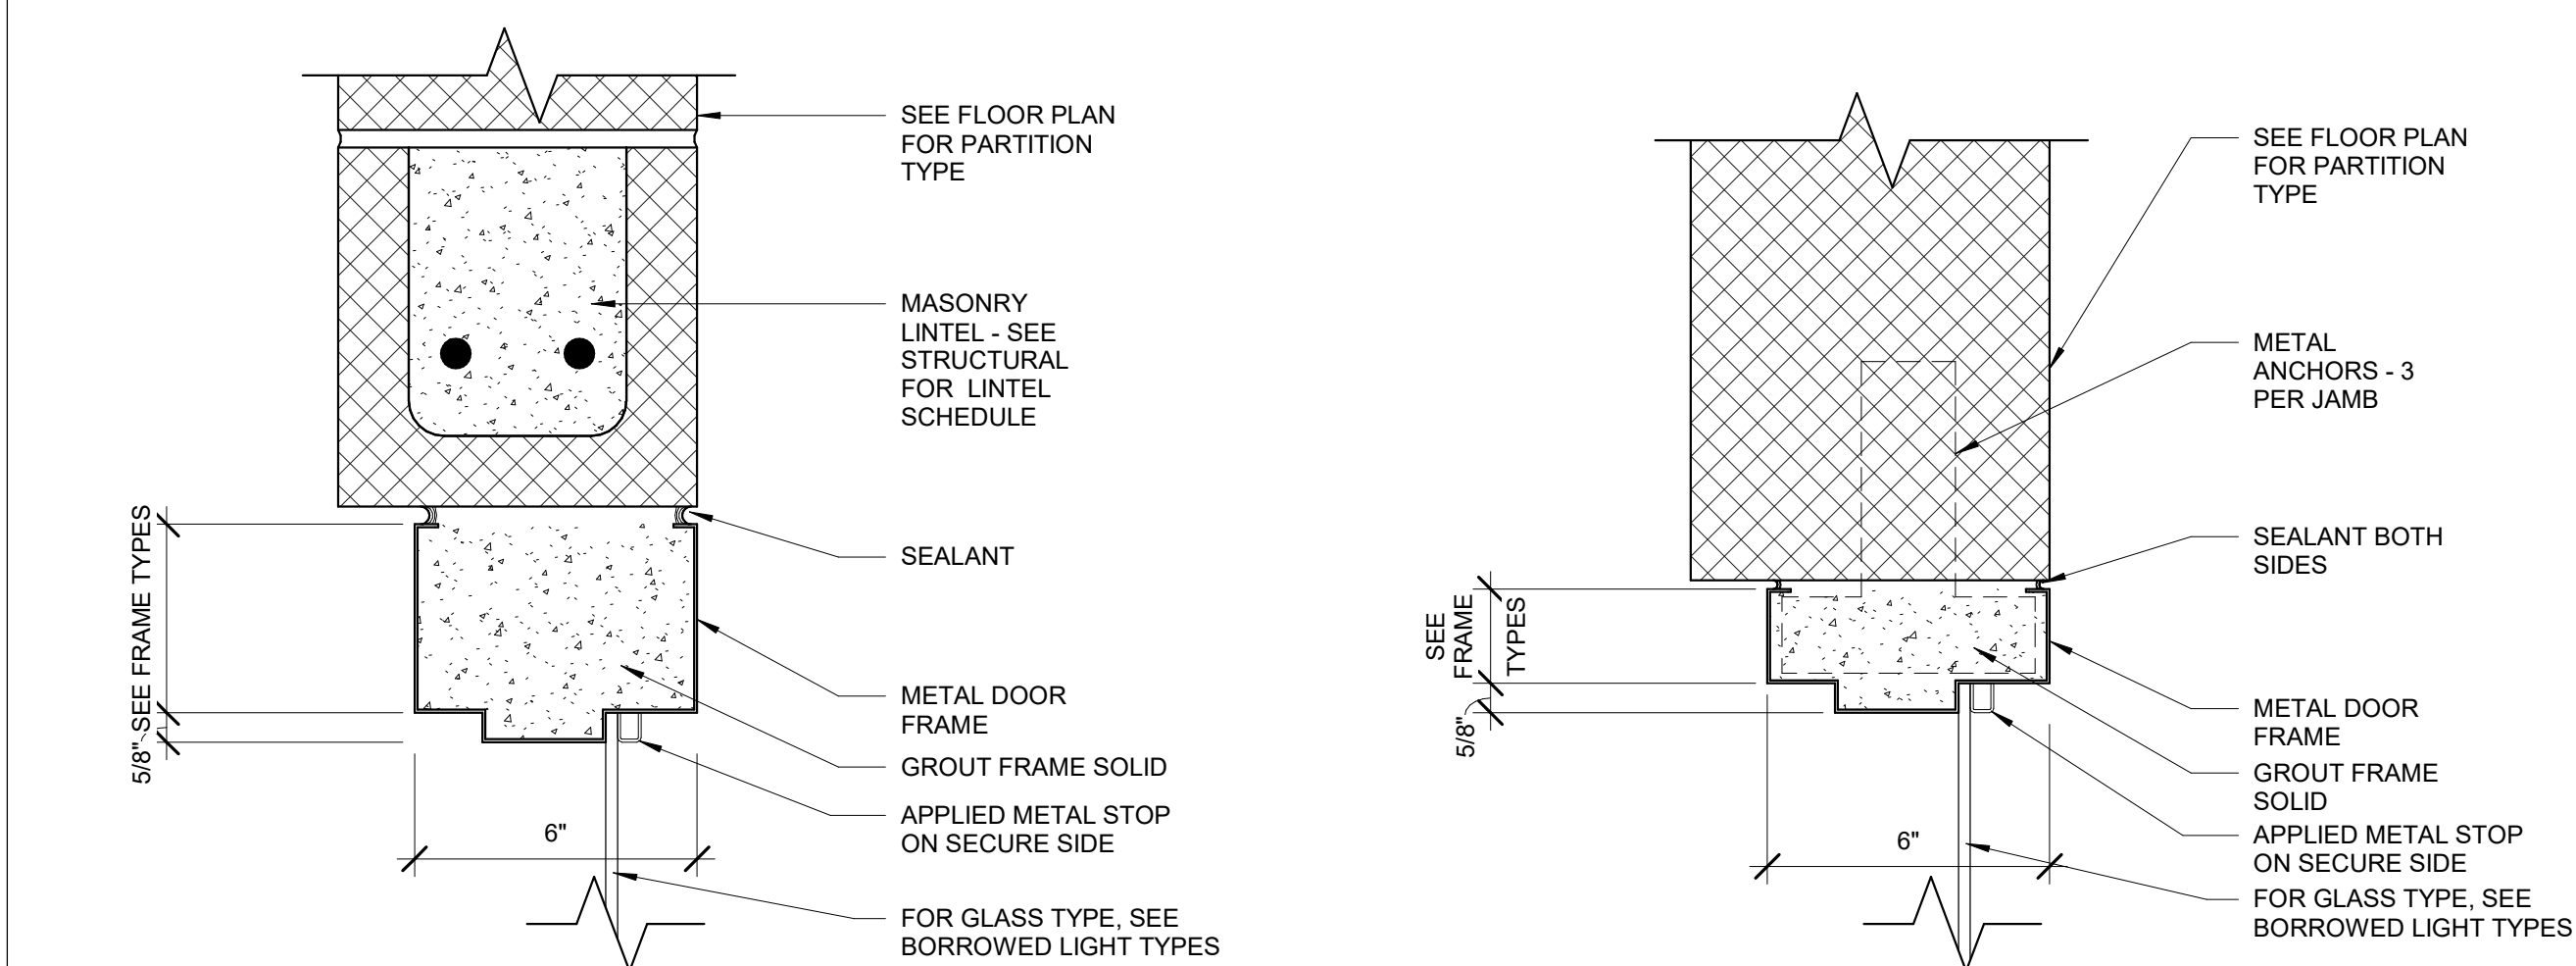


17 DOOR HEAD DETAIL
3" = 1'-0"

7 BORROWED LIGHT HEAD-CMU
3" = 1'-0"

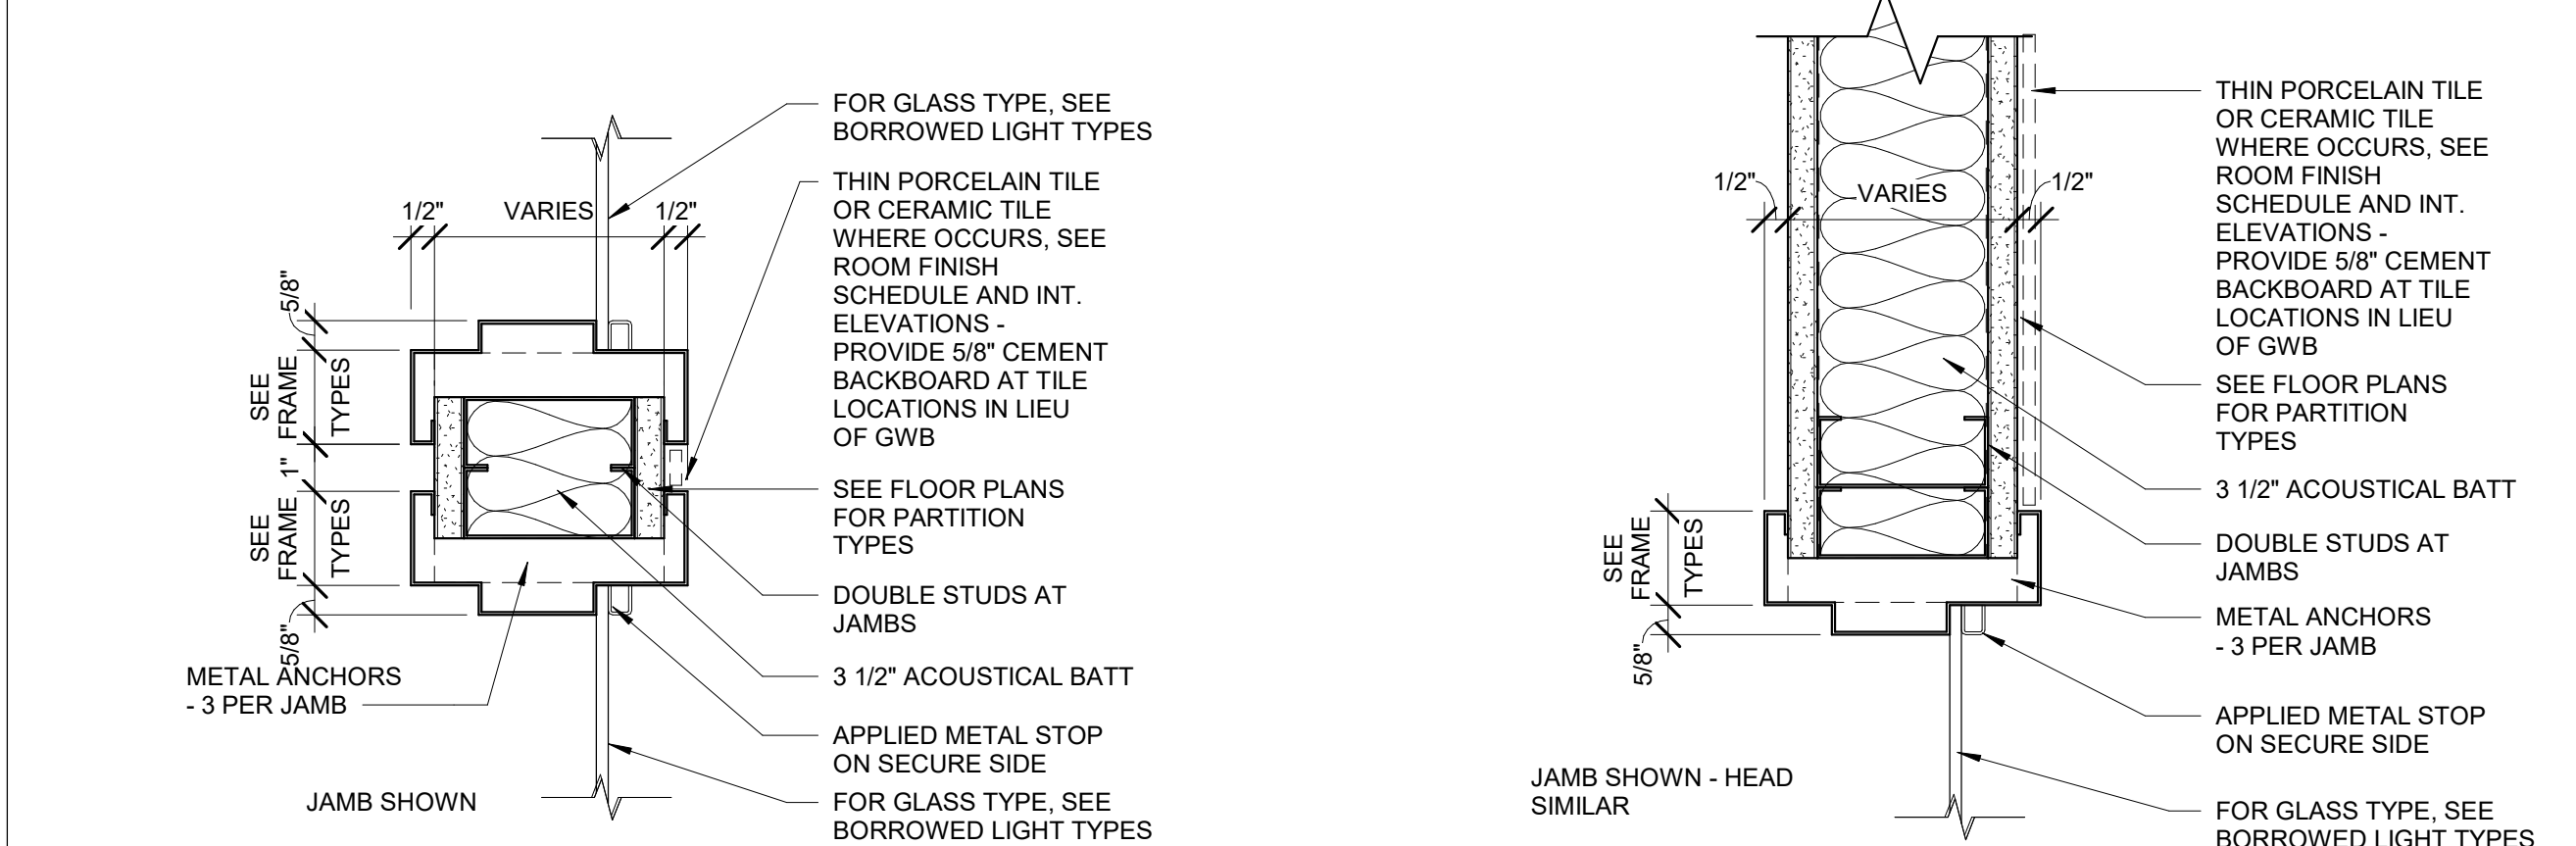


6 BORROWED LIGHT JAMB DETAIL
3" = 1'-0"


8 BORROW LIGHT JAMB DETAIL-CMU
3" = 1'-0"

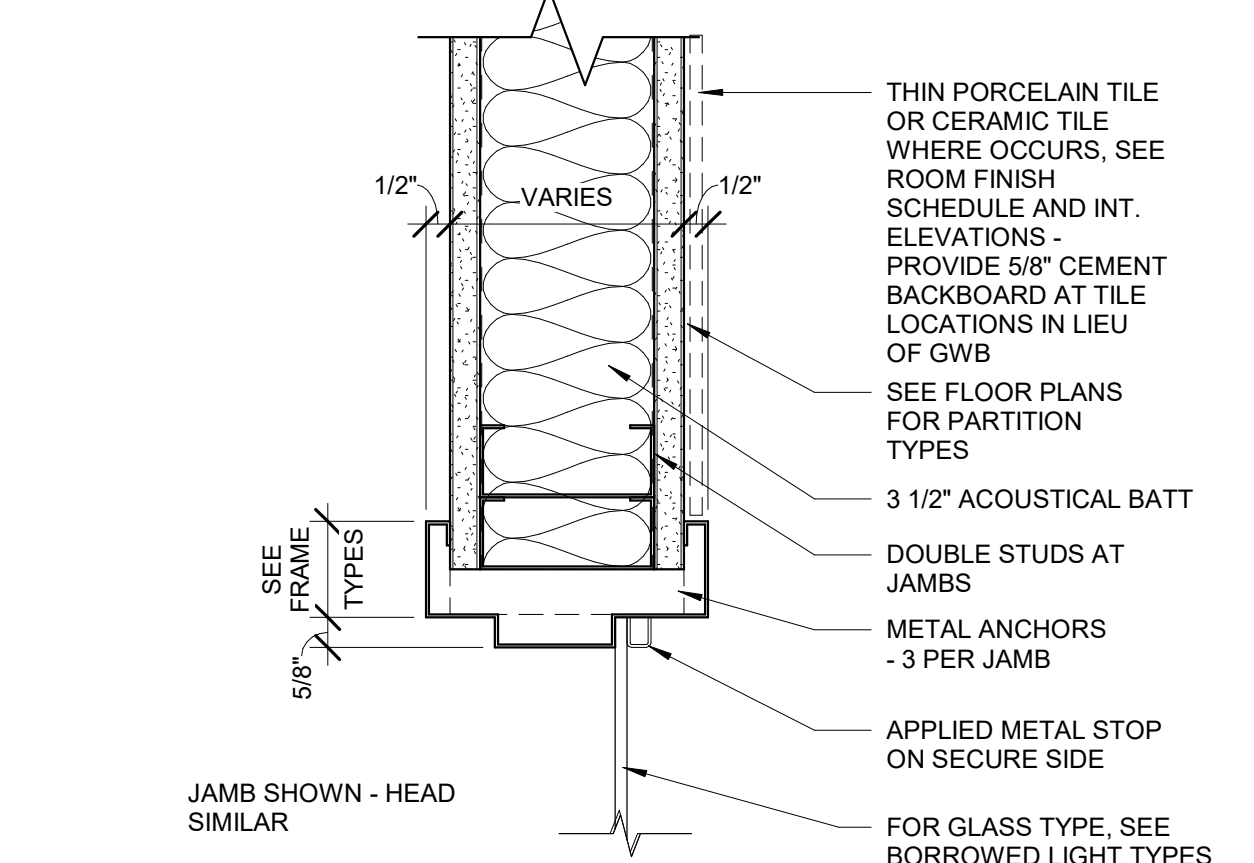


5 BORROWED LIGHT JAMB DETAIL
3" = 1'-0"

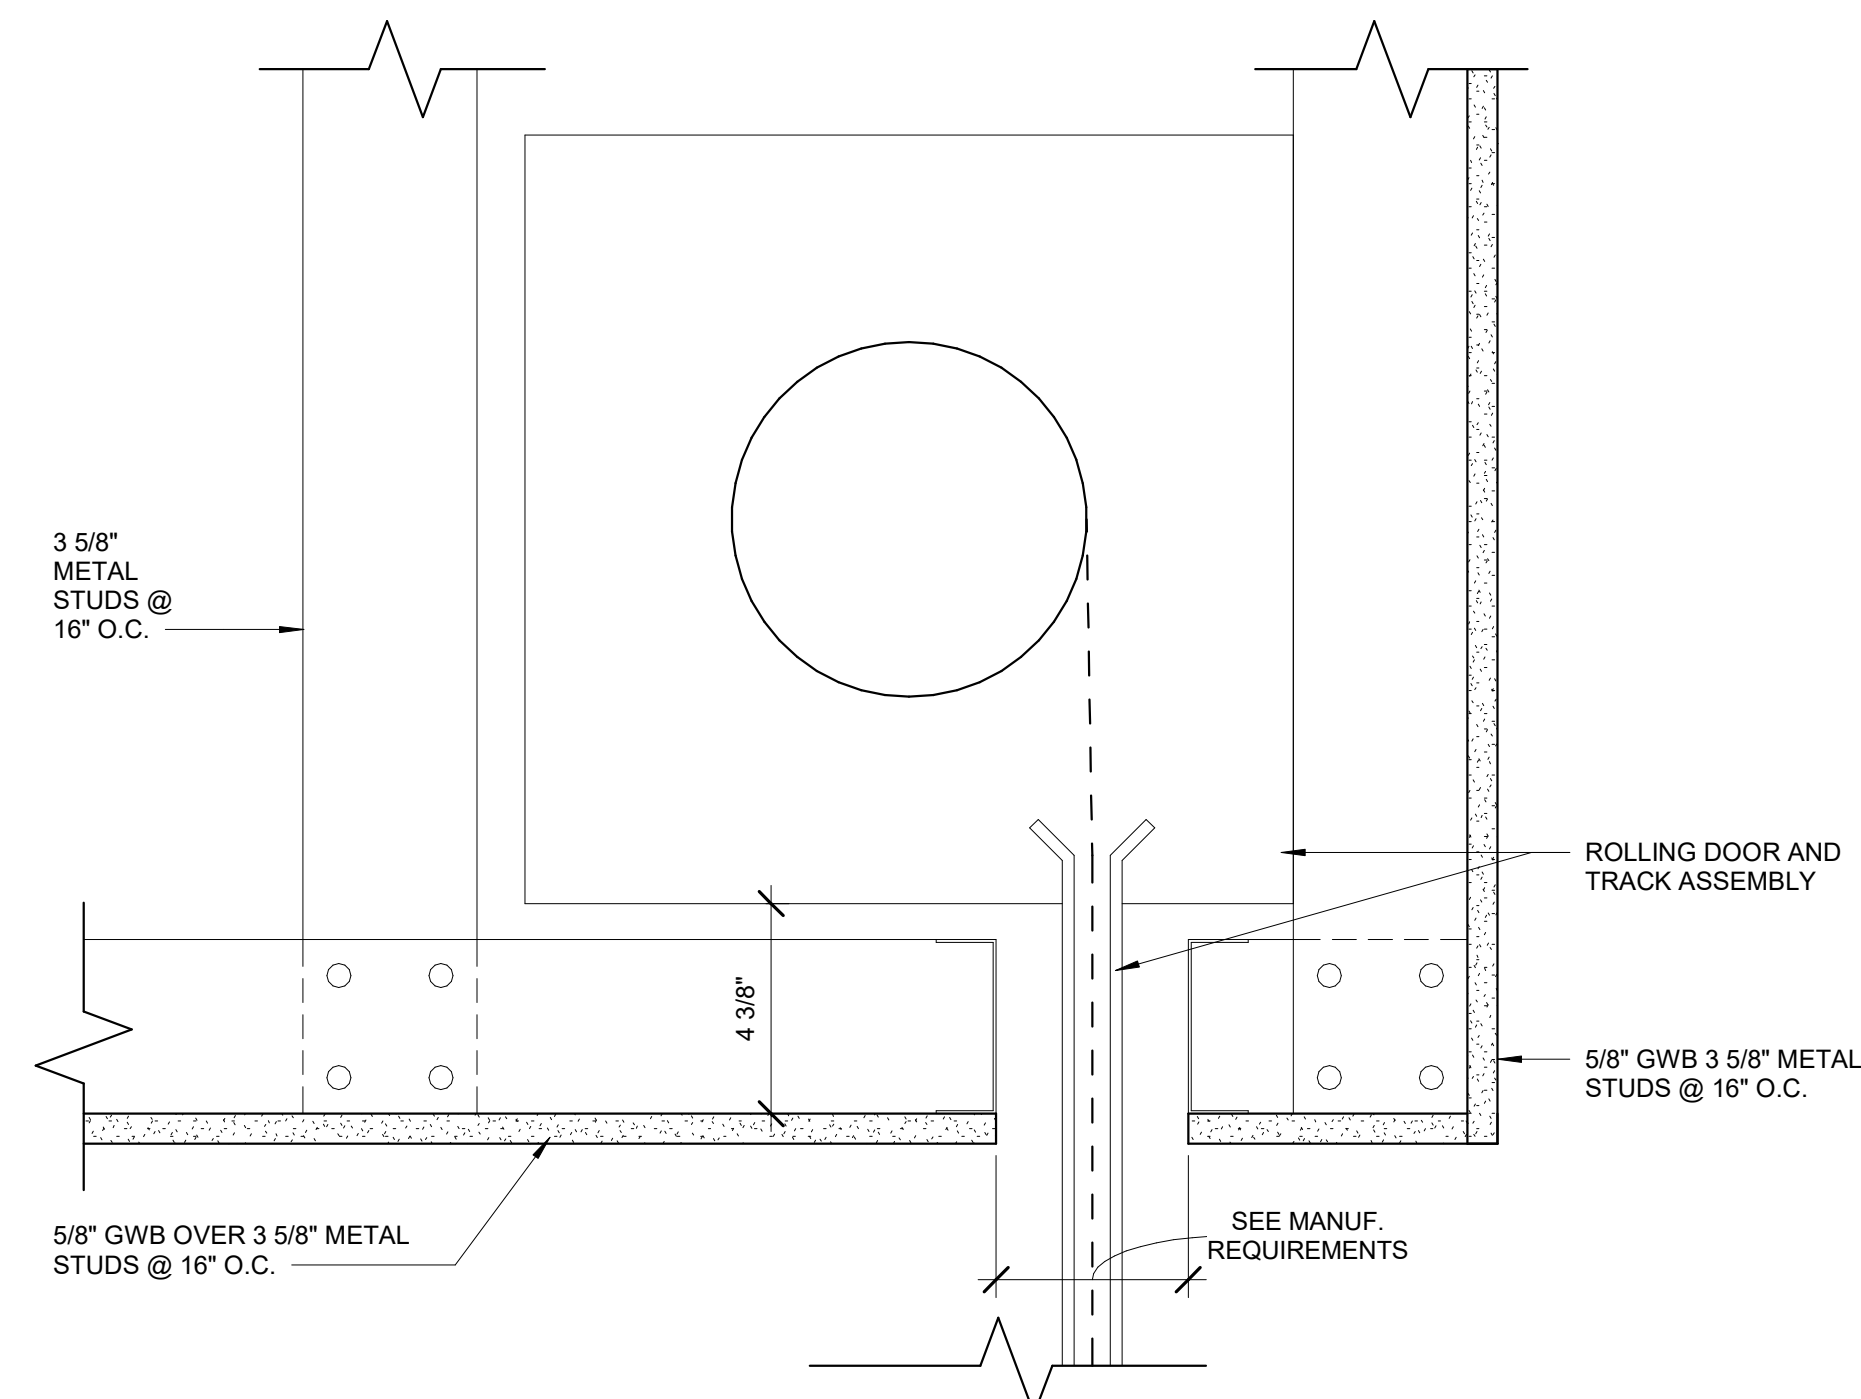


22 DOOR HEAD DETAIL
3" = 1'-0"

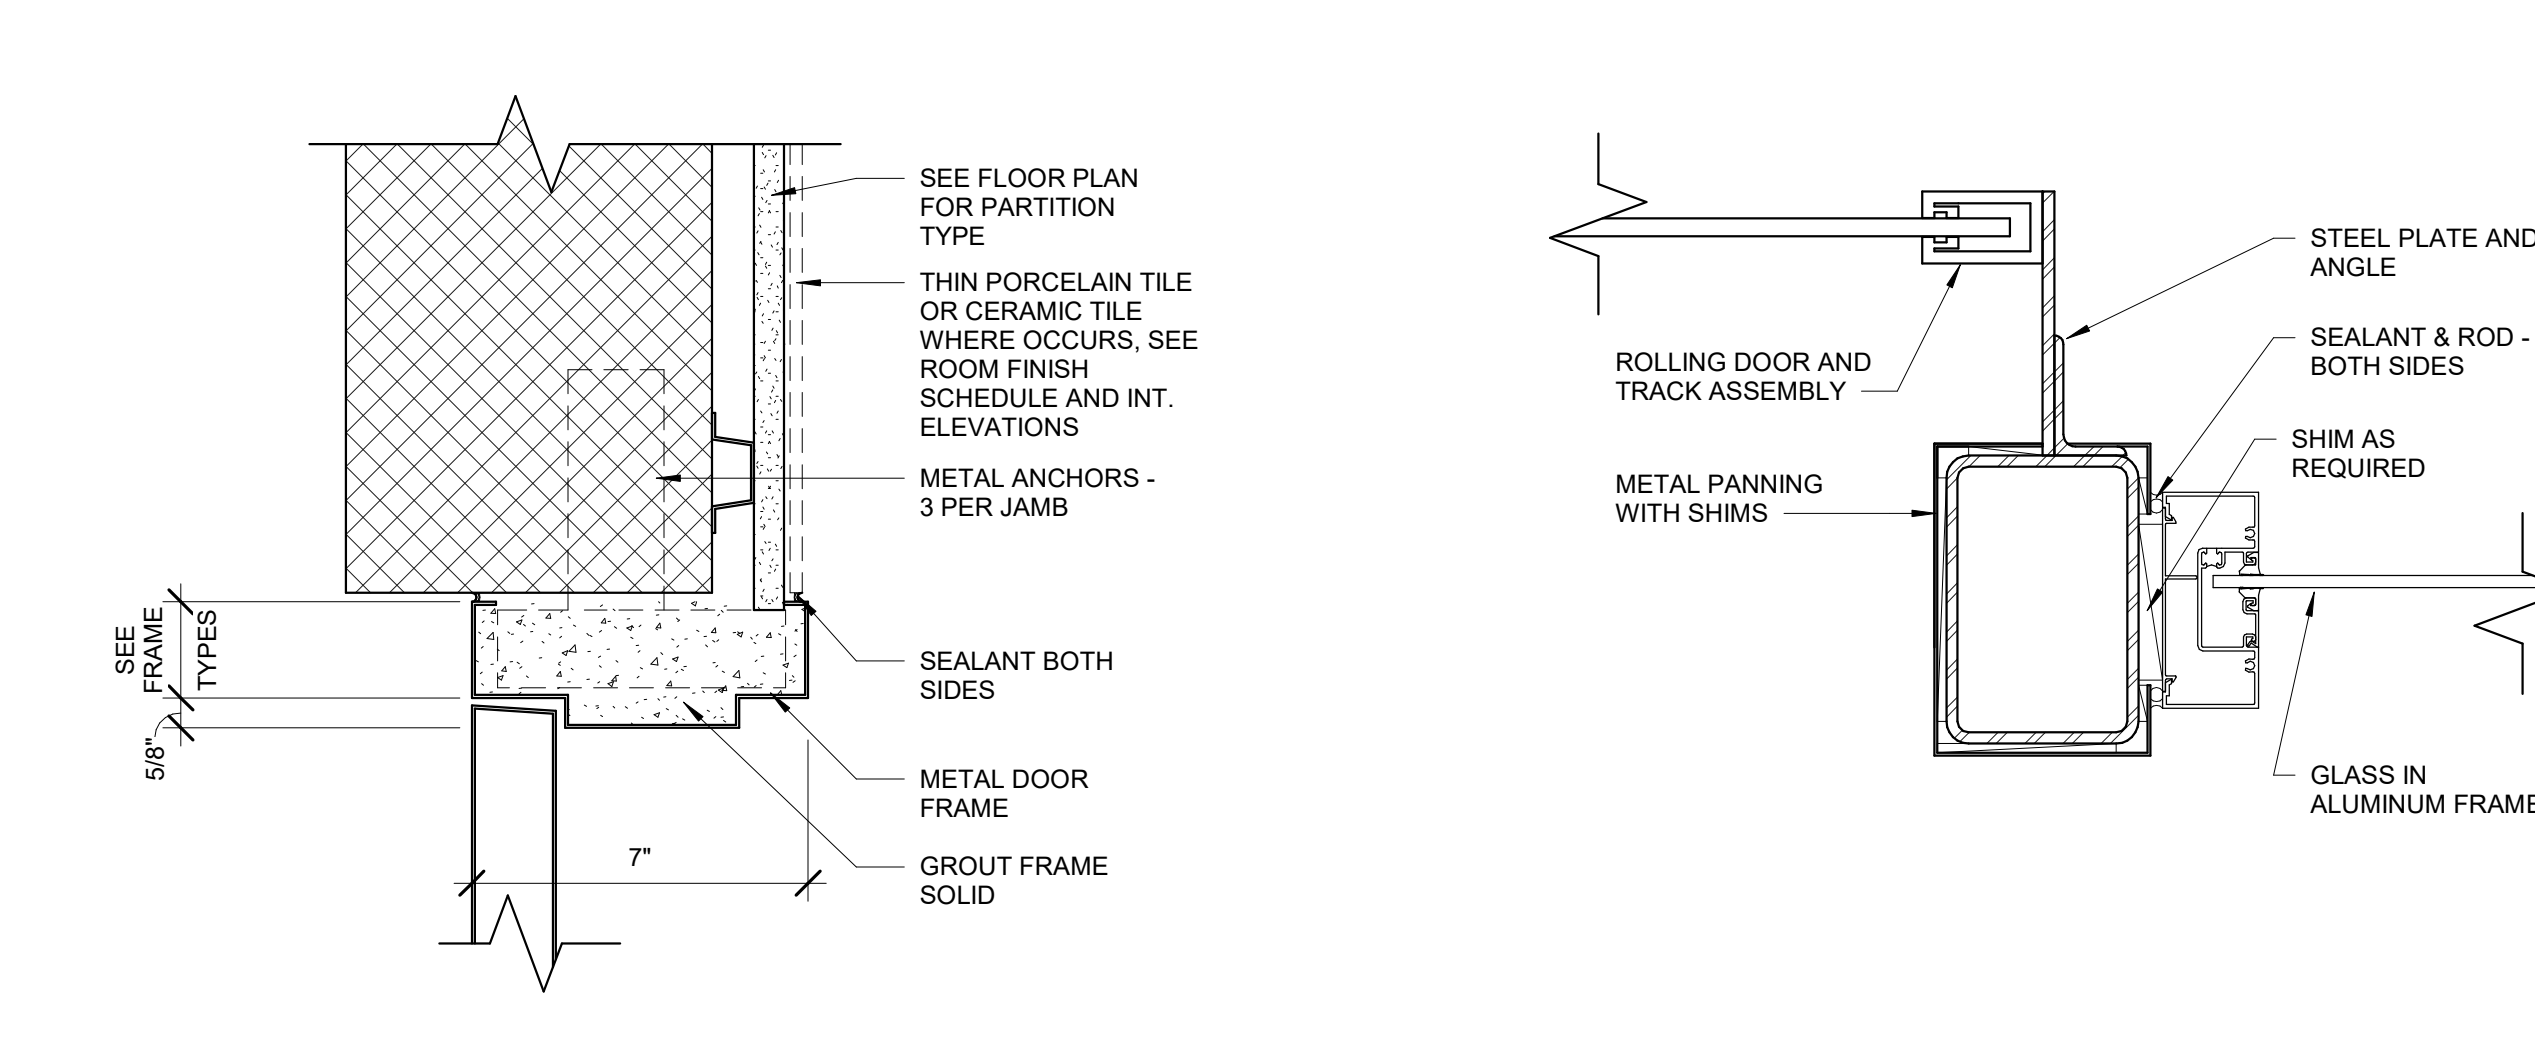


16 DOOR JAMB DETAIL
3" = 1'-0"

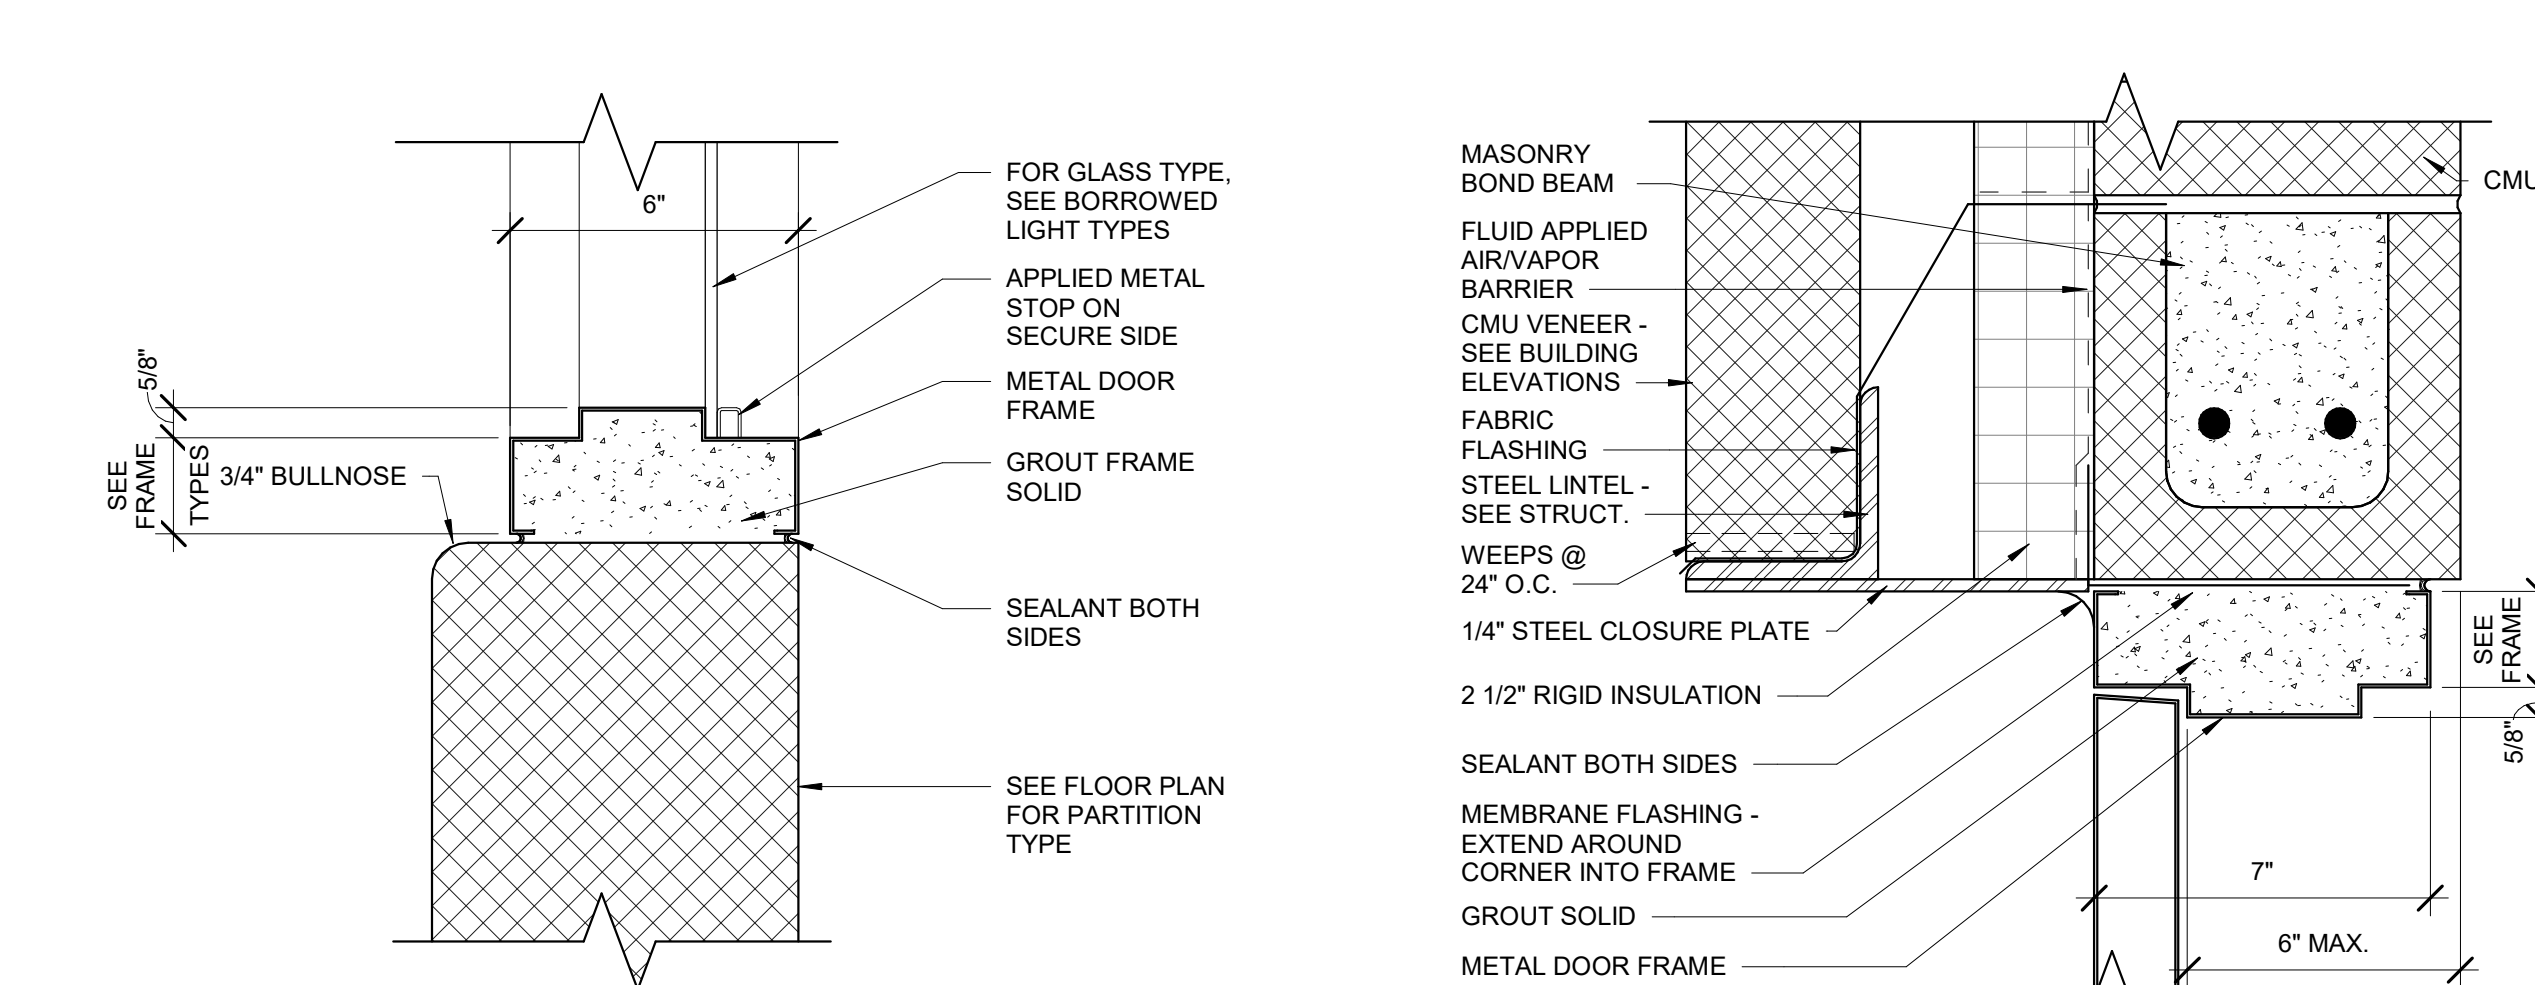


9 BORROWED LIGHT SILL-CMU
3" = 1'-0"

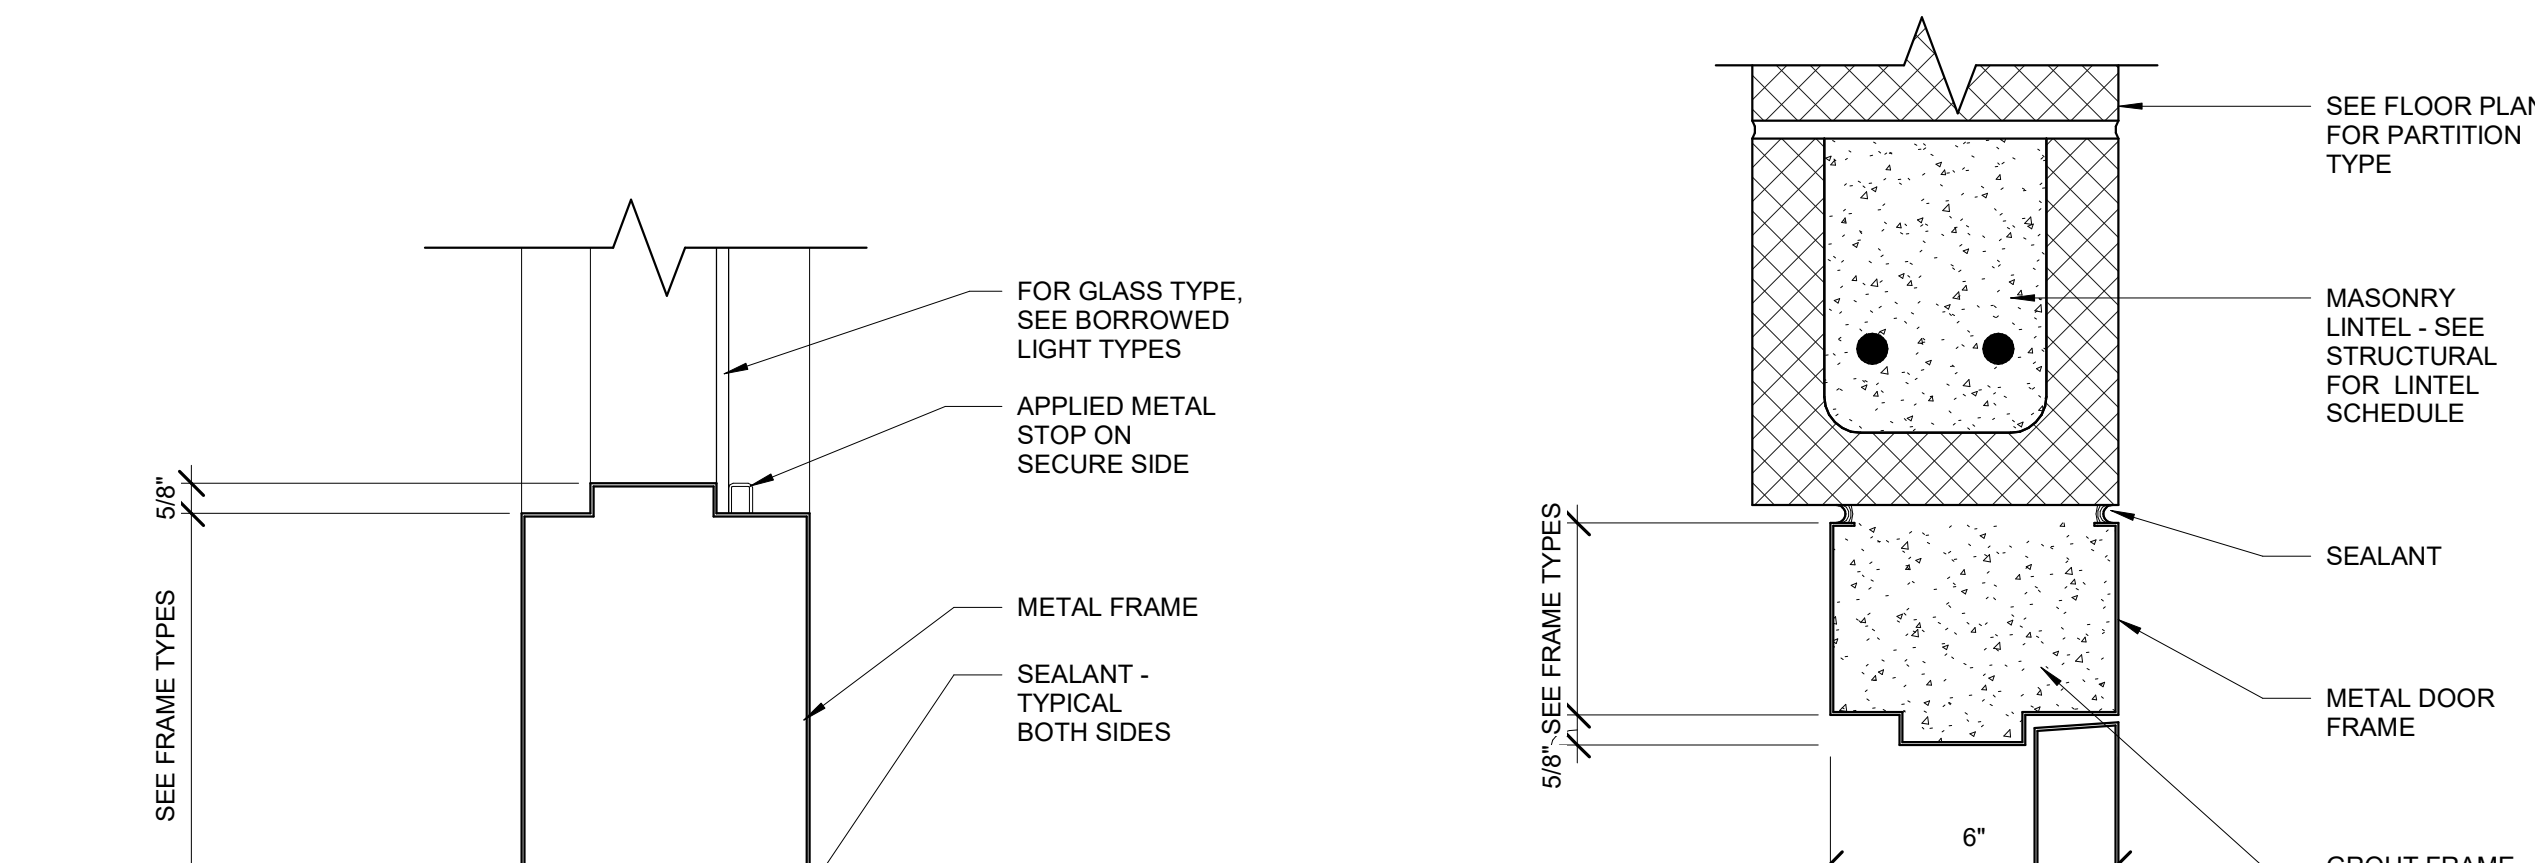


4 BORROWED LIGHT FLOOR SILL-CMU
3" = 1'-0"

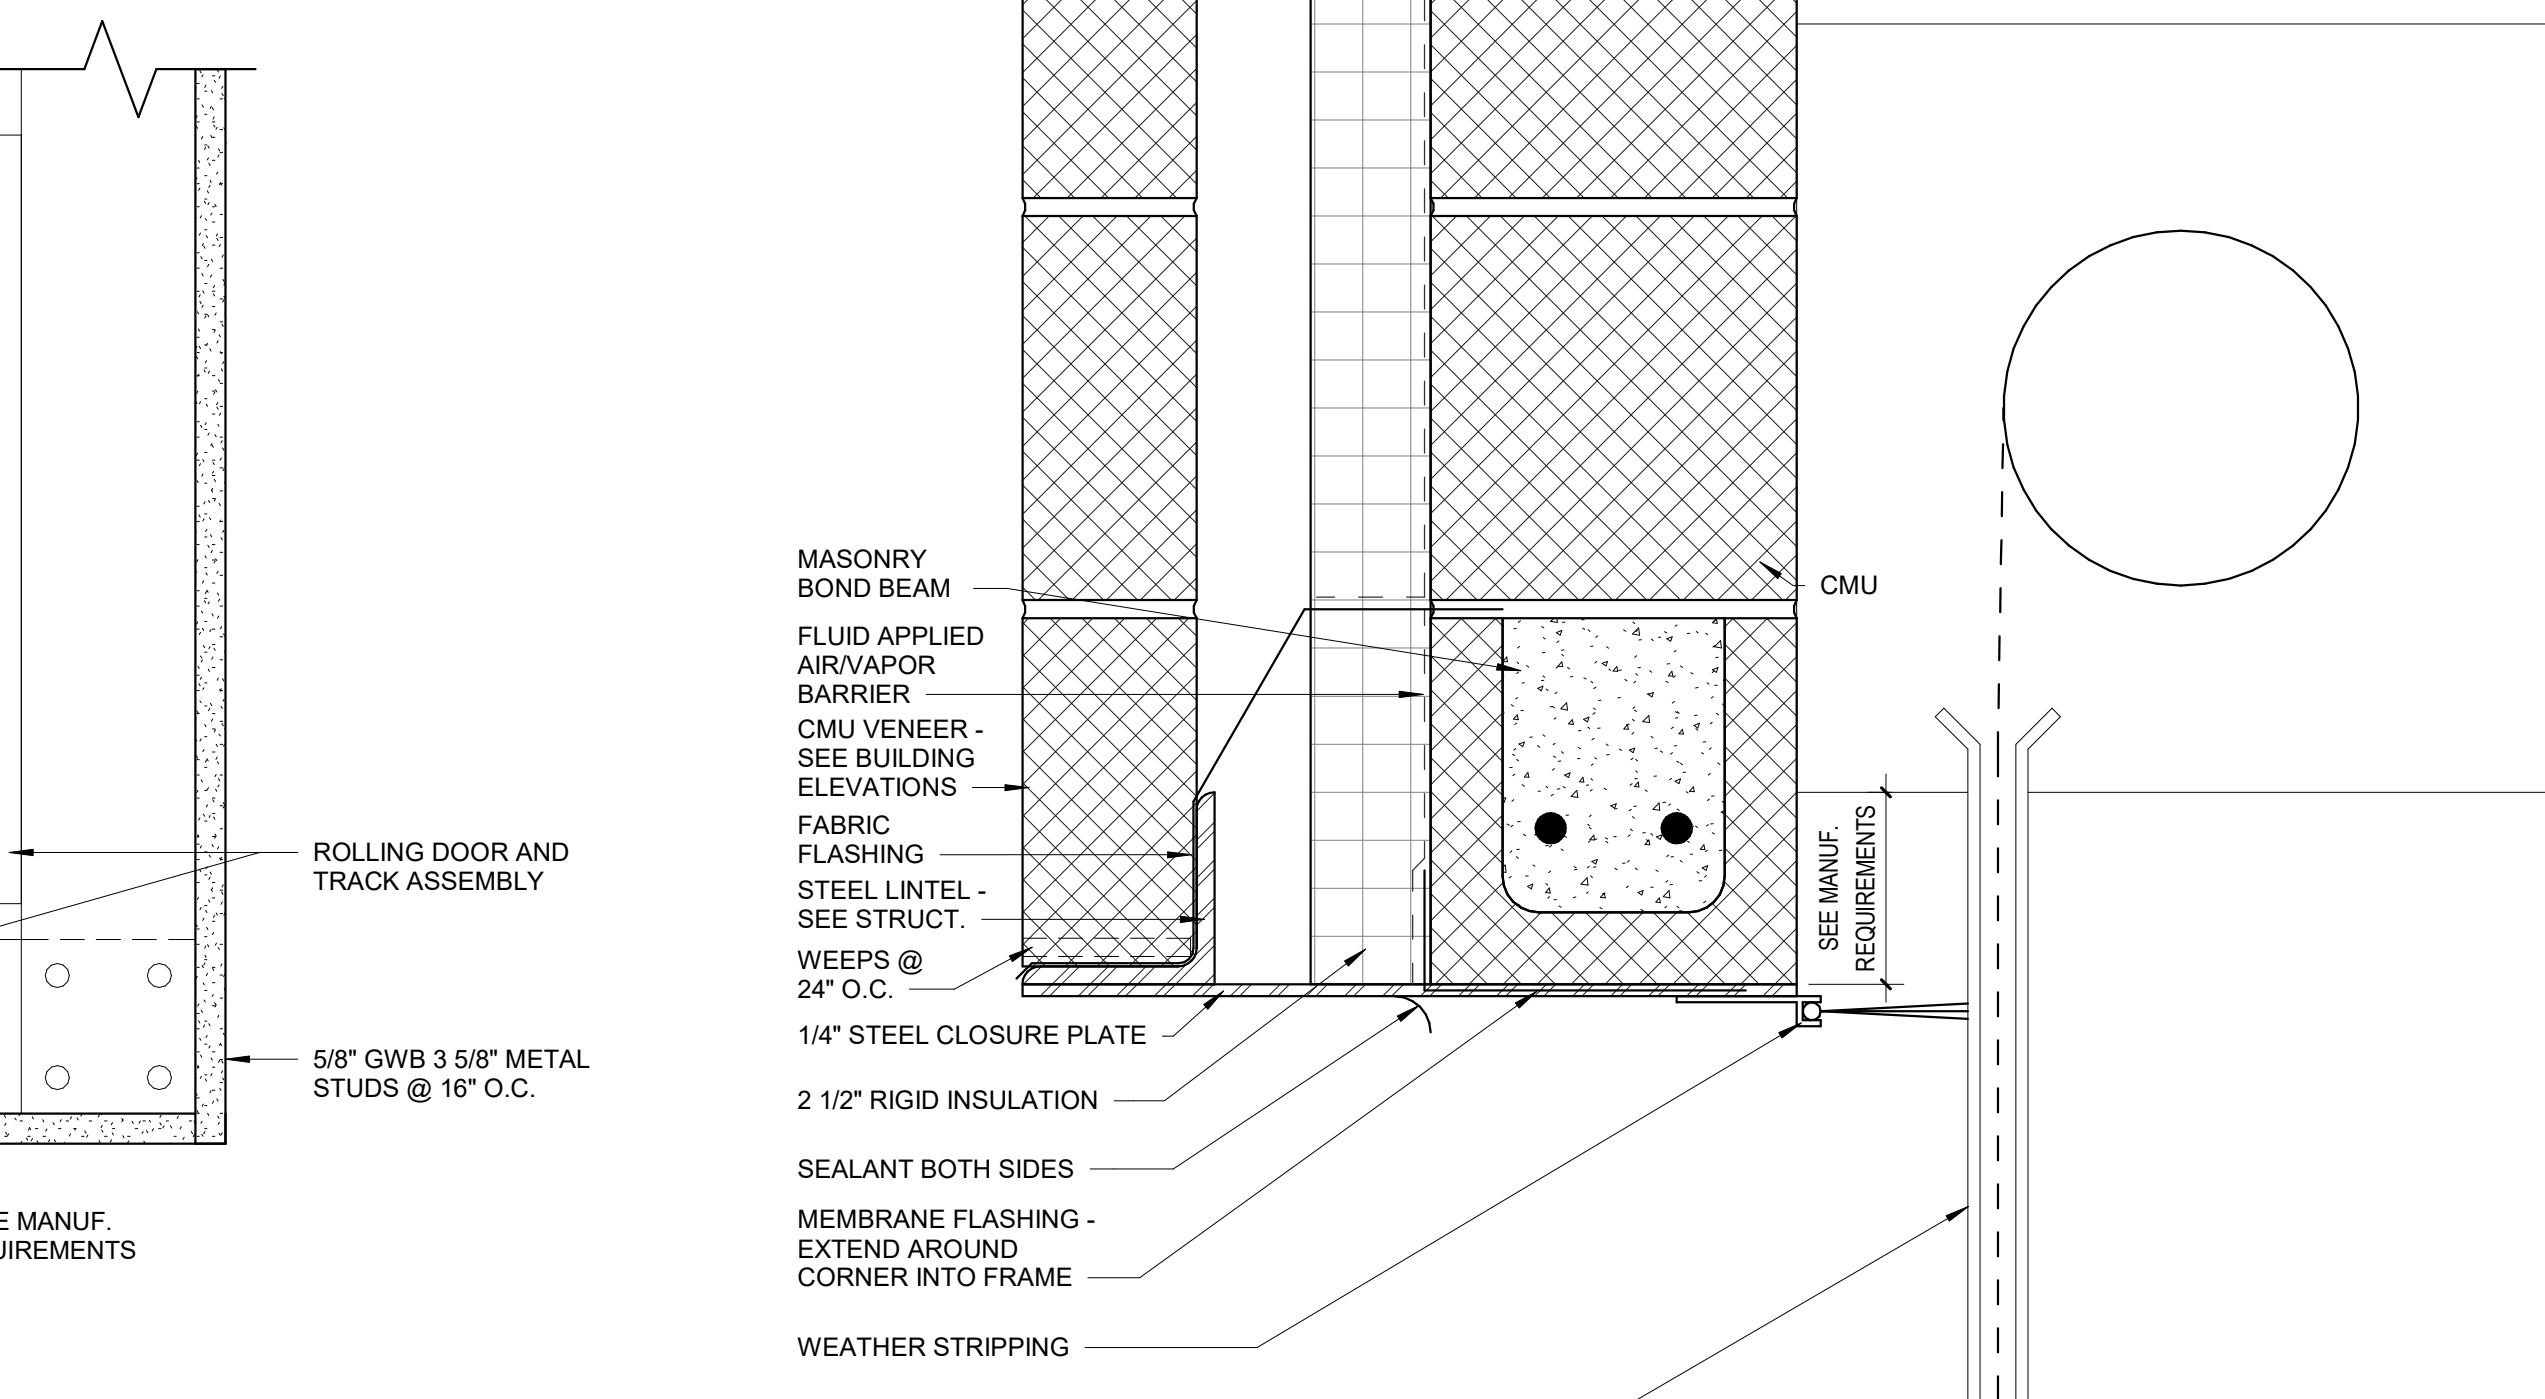


23 ROLLING DOOR HEAD DETAIL
3" = 1'-0"

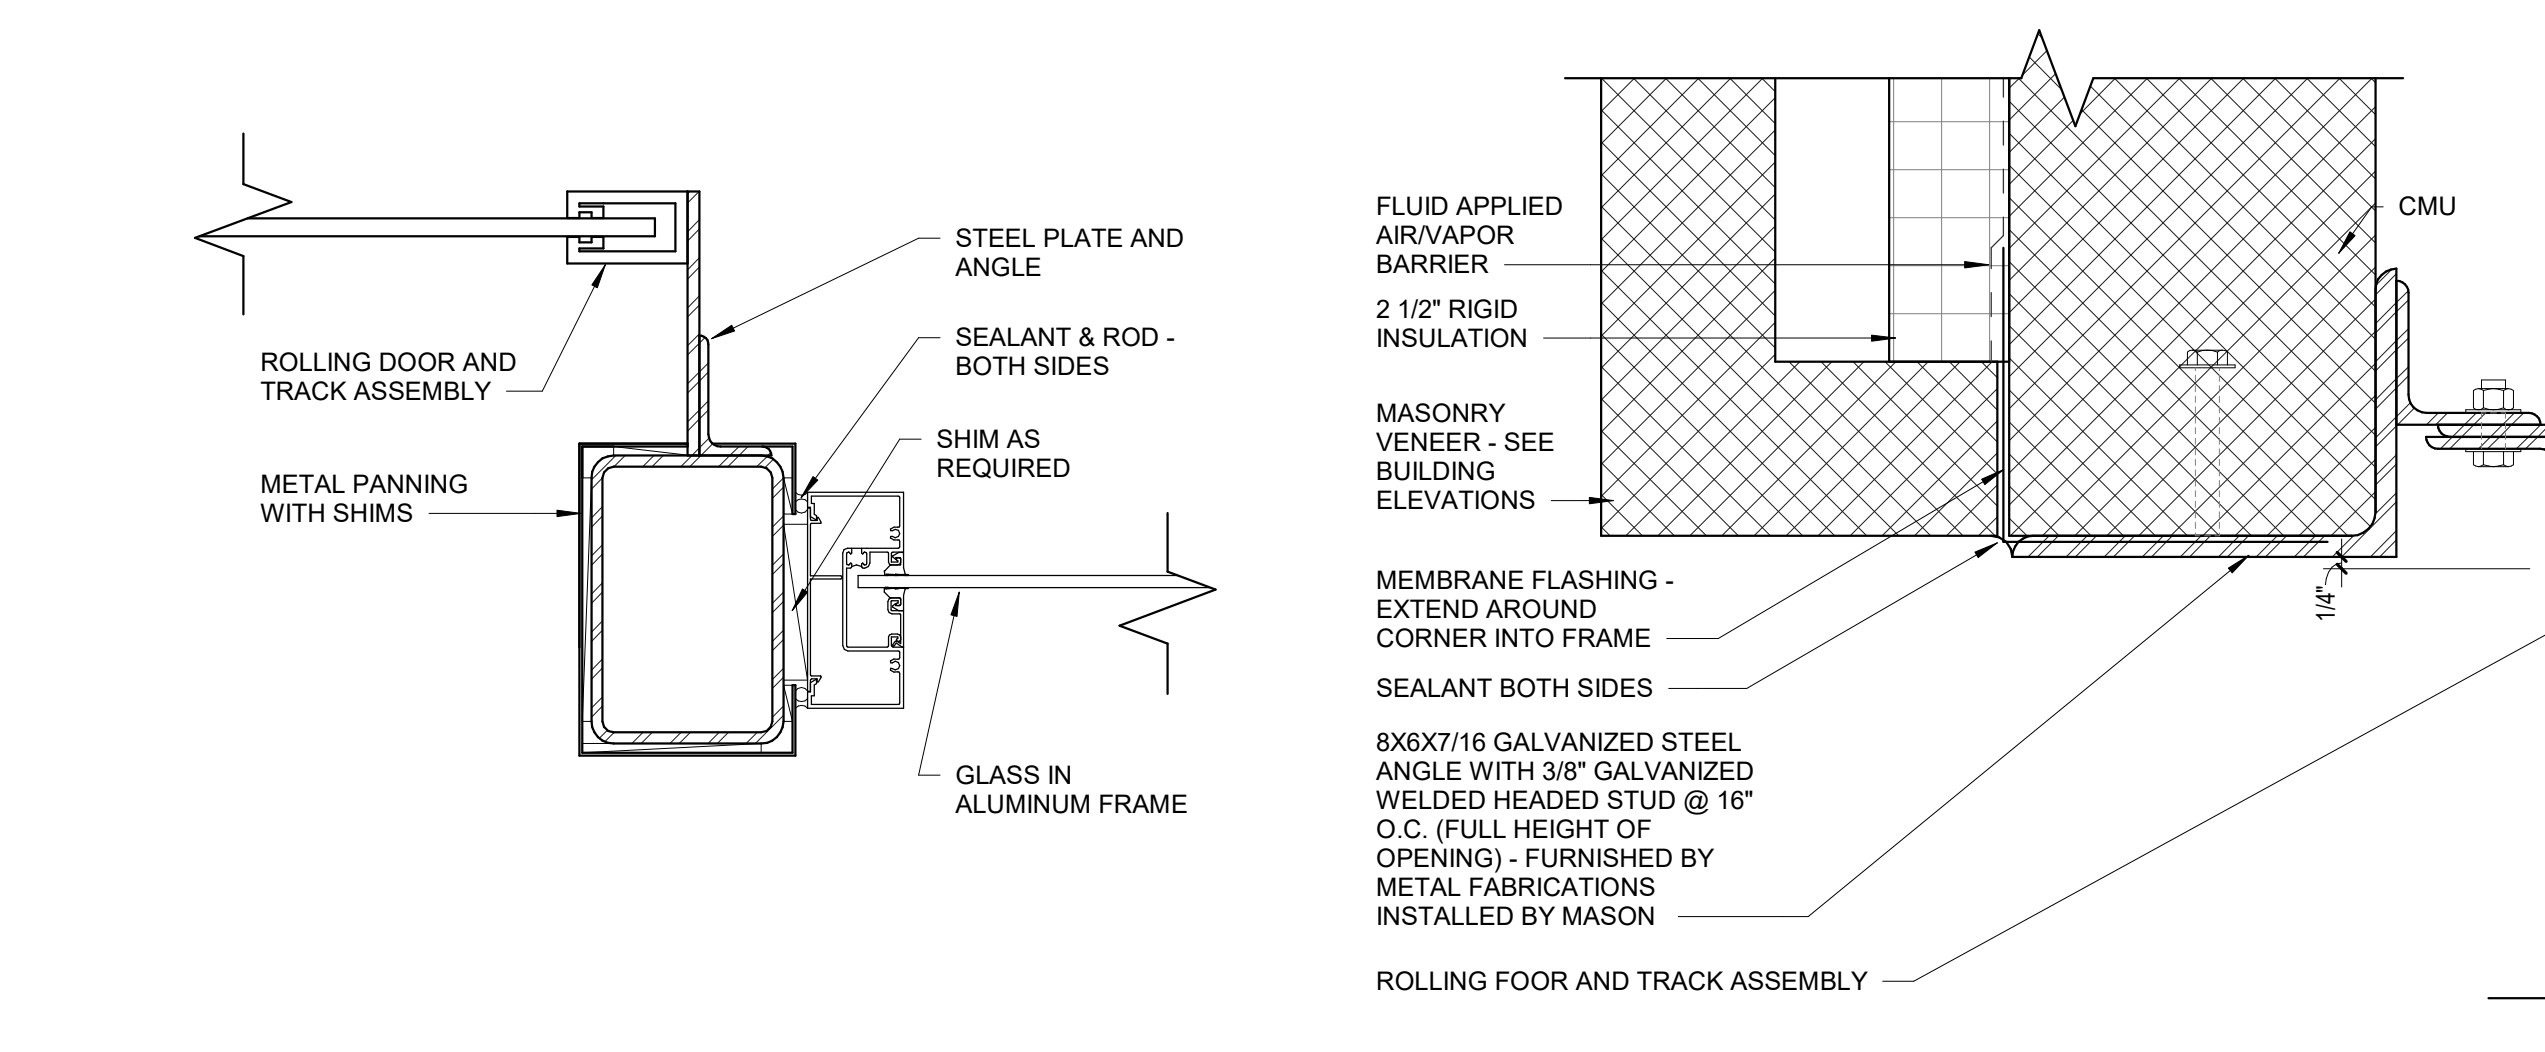


15 DOOR JAMB DETAIL
3" = 1'-0"

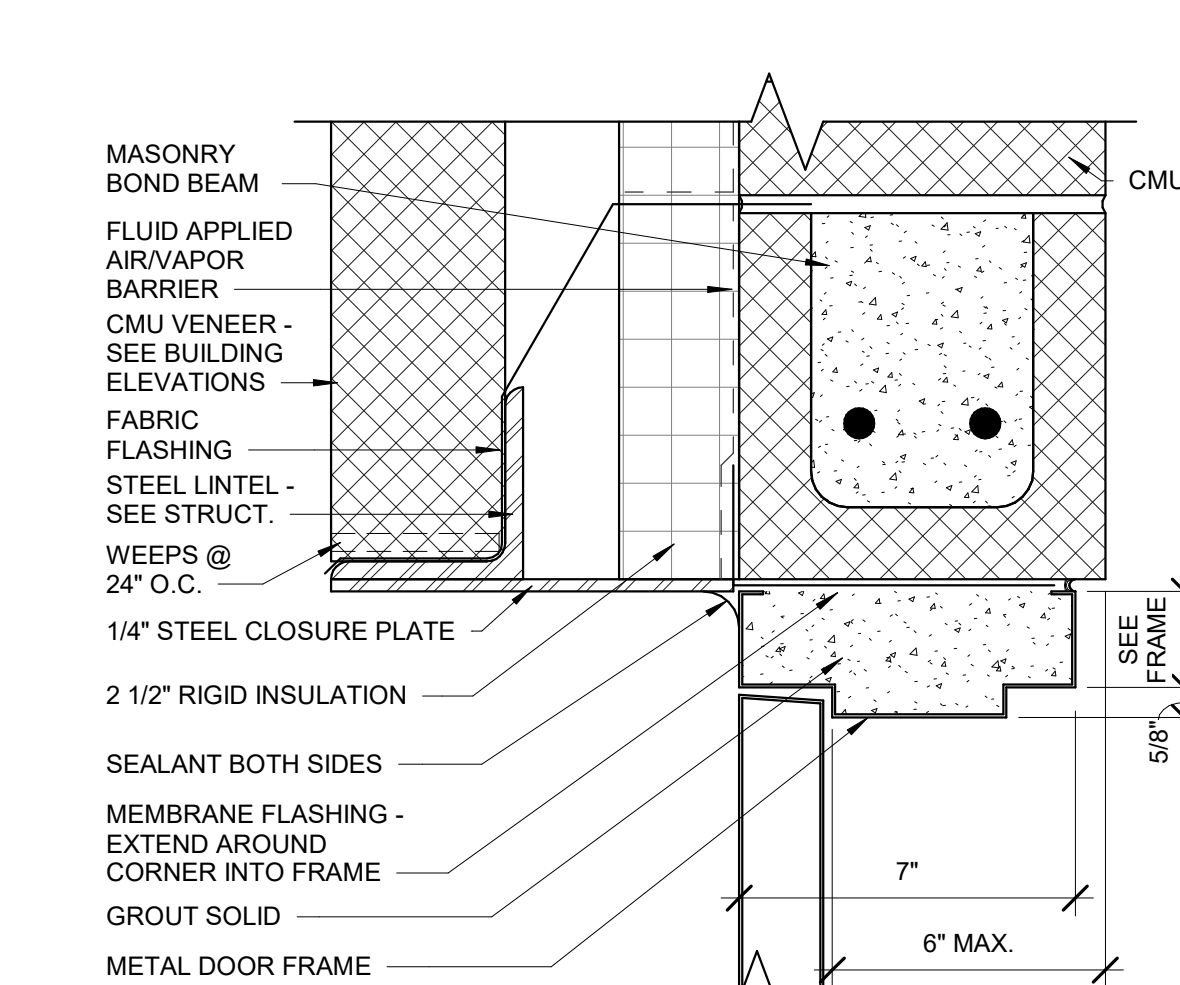


10 DOOR HEAD DETAIL
3" = 1'-0"

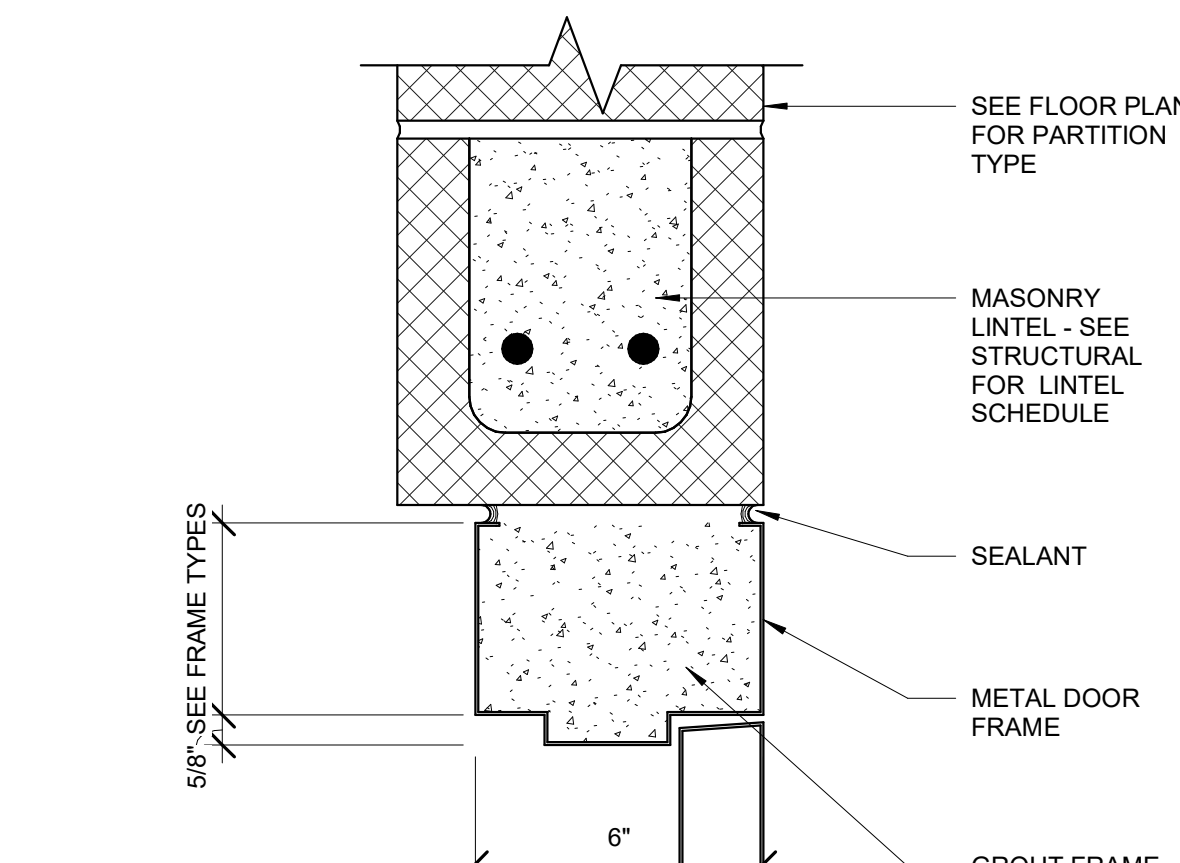


3 DOOR HEAD DETAIL
3" = 1'-0"

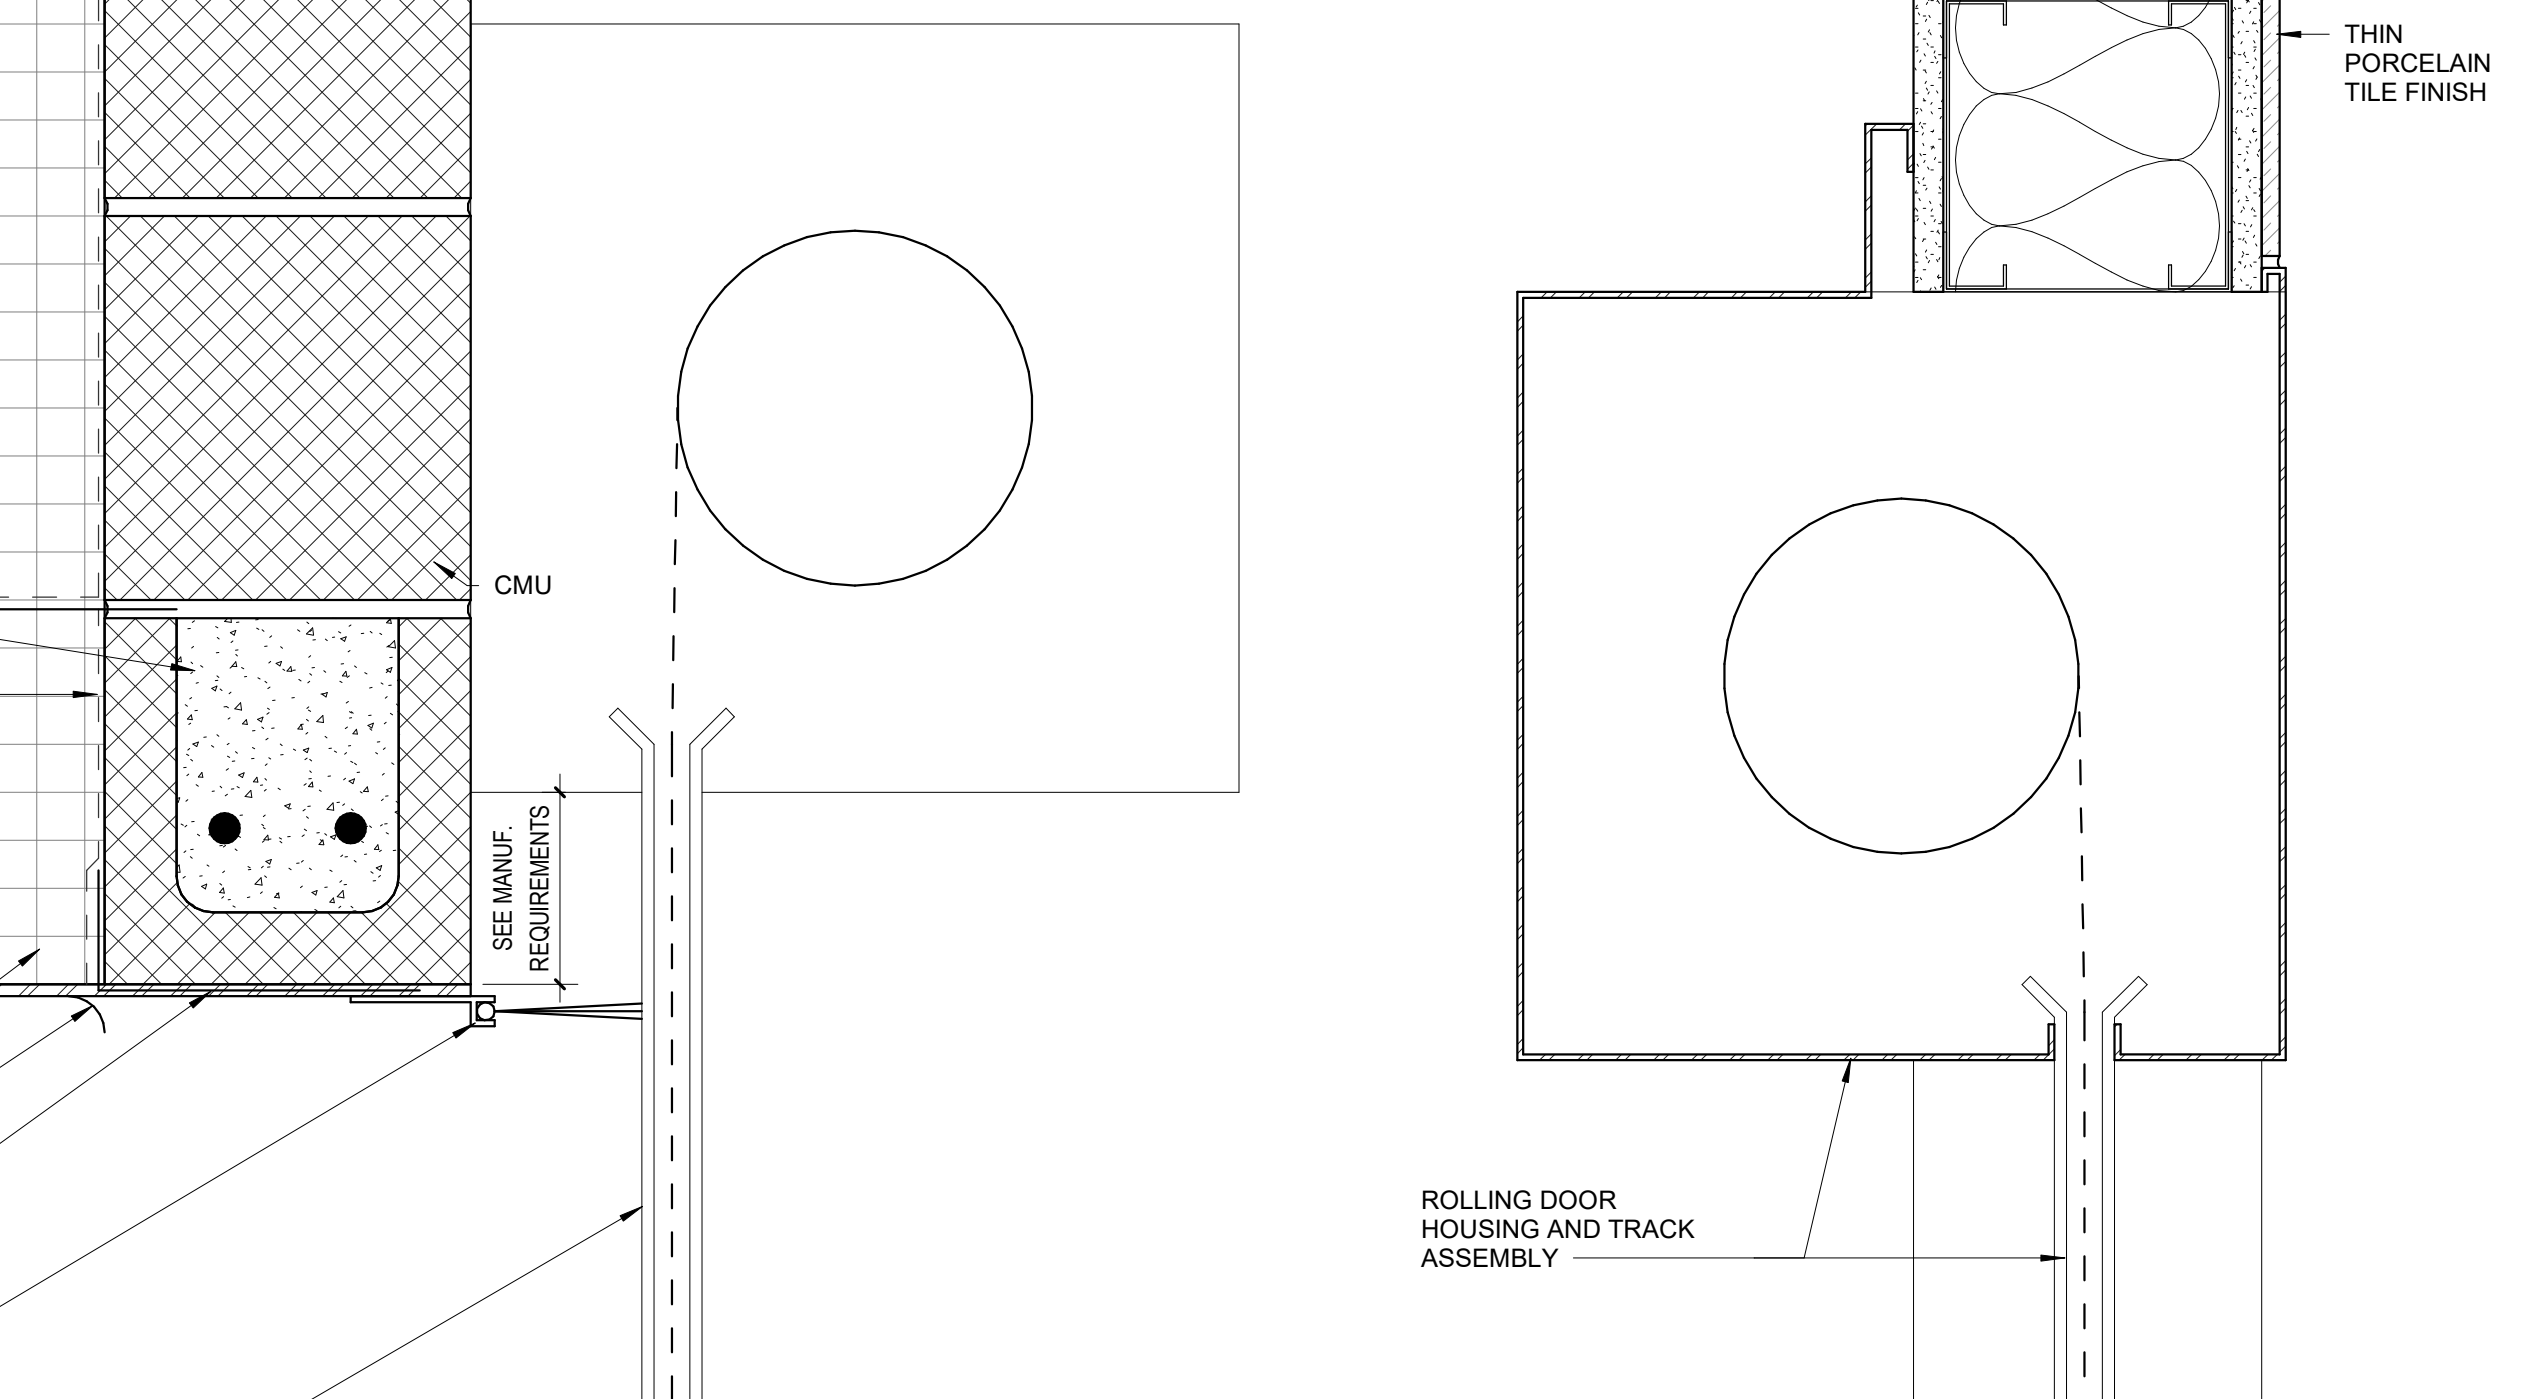


24 DOOR HEAD DETAIL
3" = 1'-0"

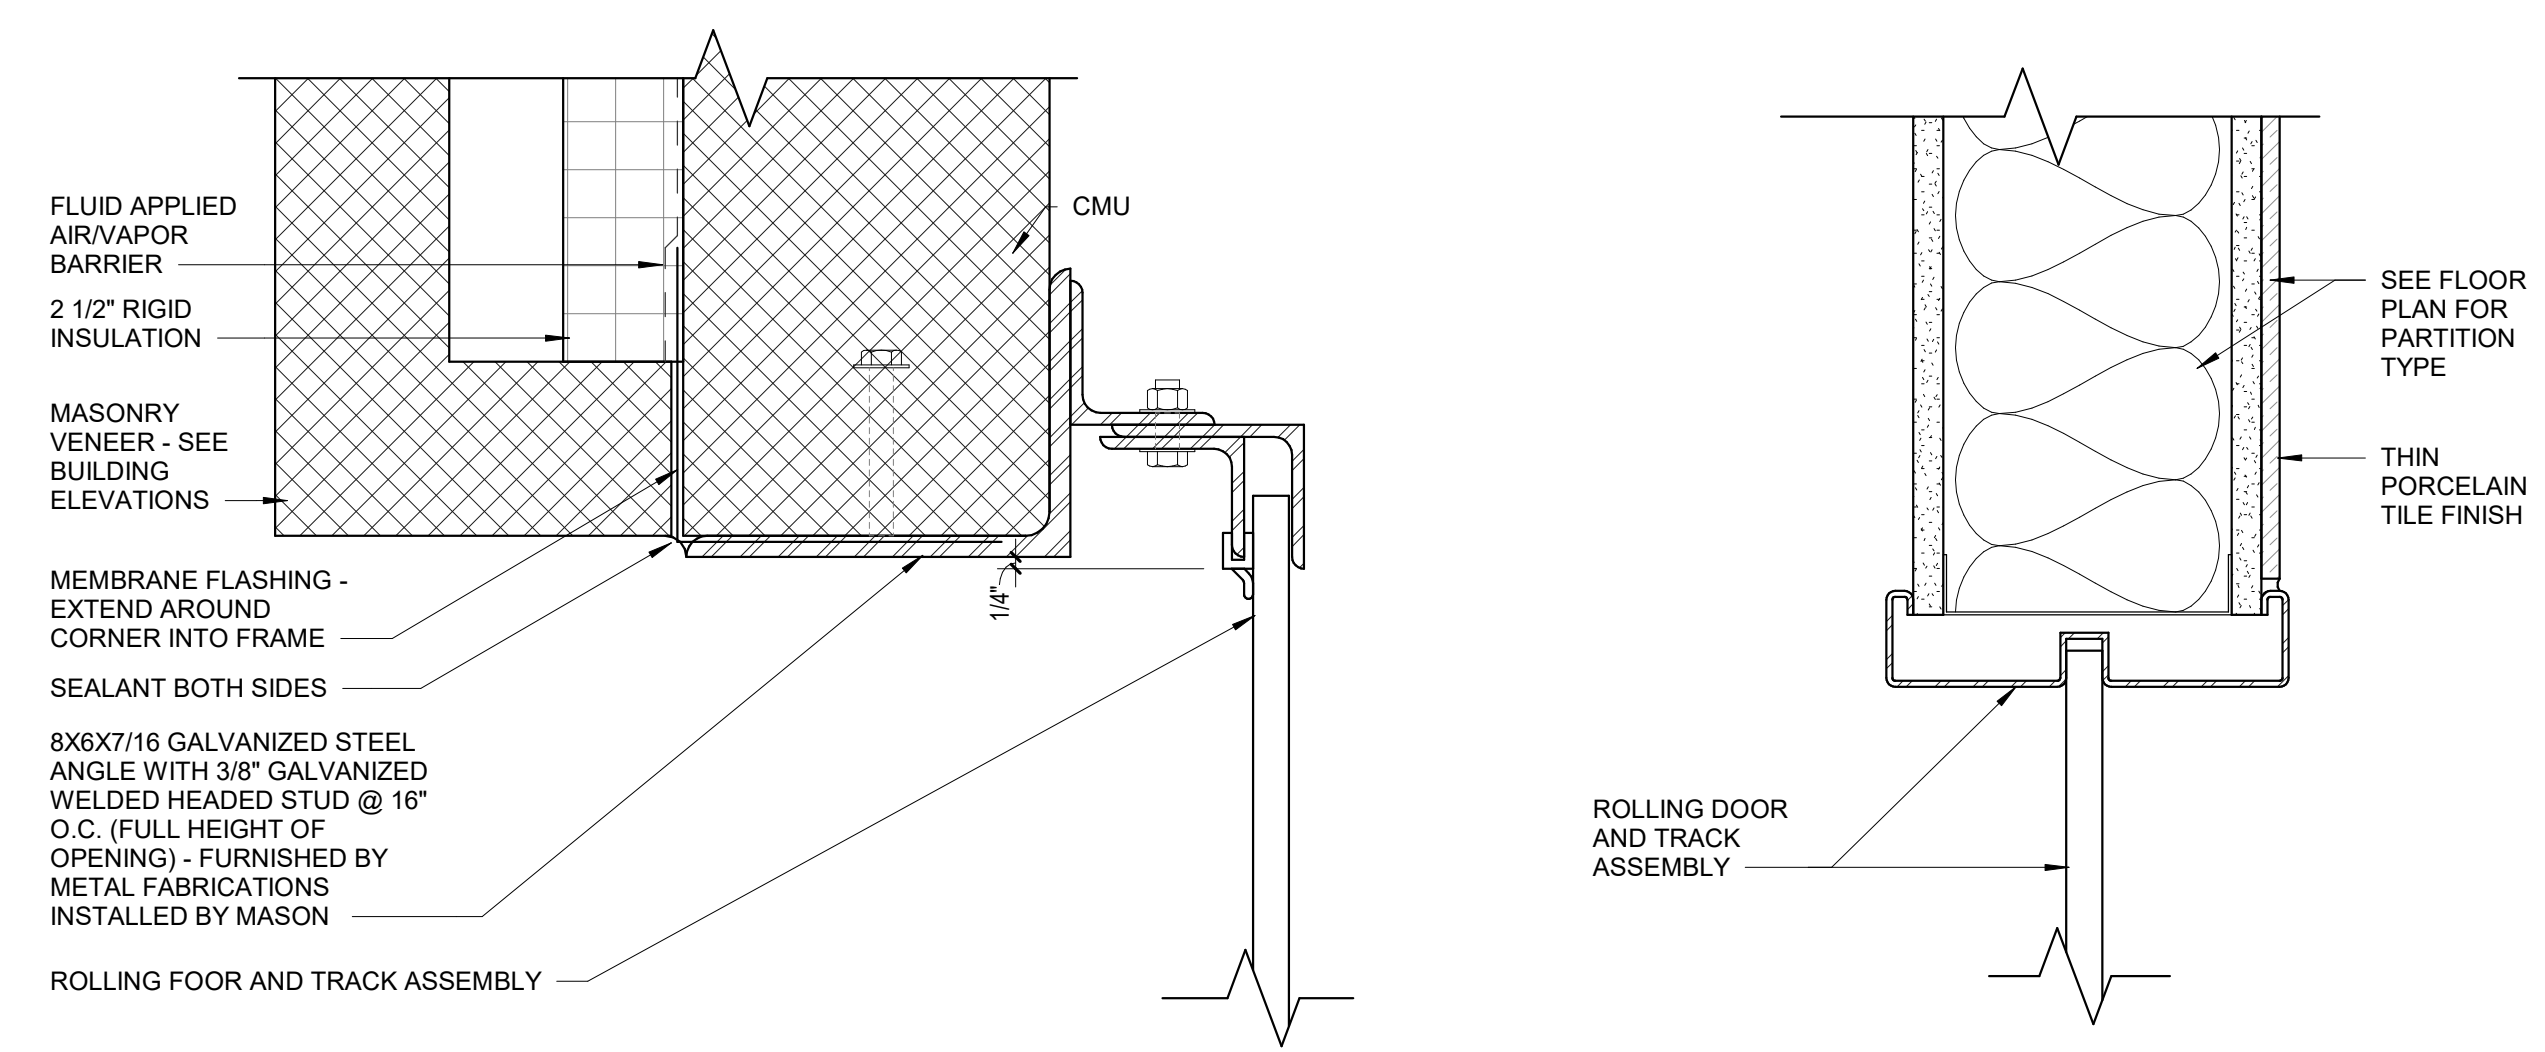


14 ROLLING DOOR JAMB DETAIL
3" = 1'-0"

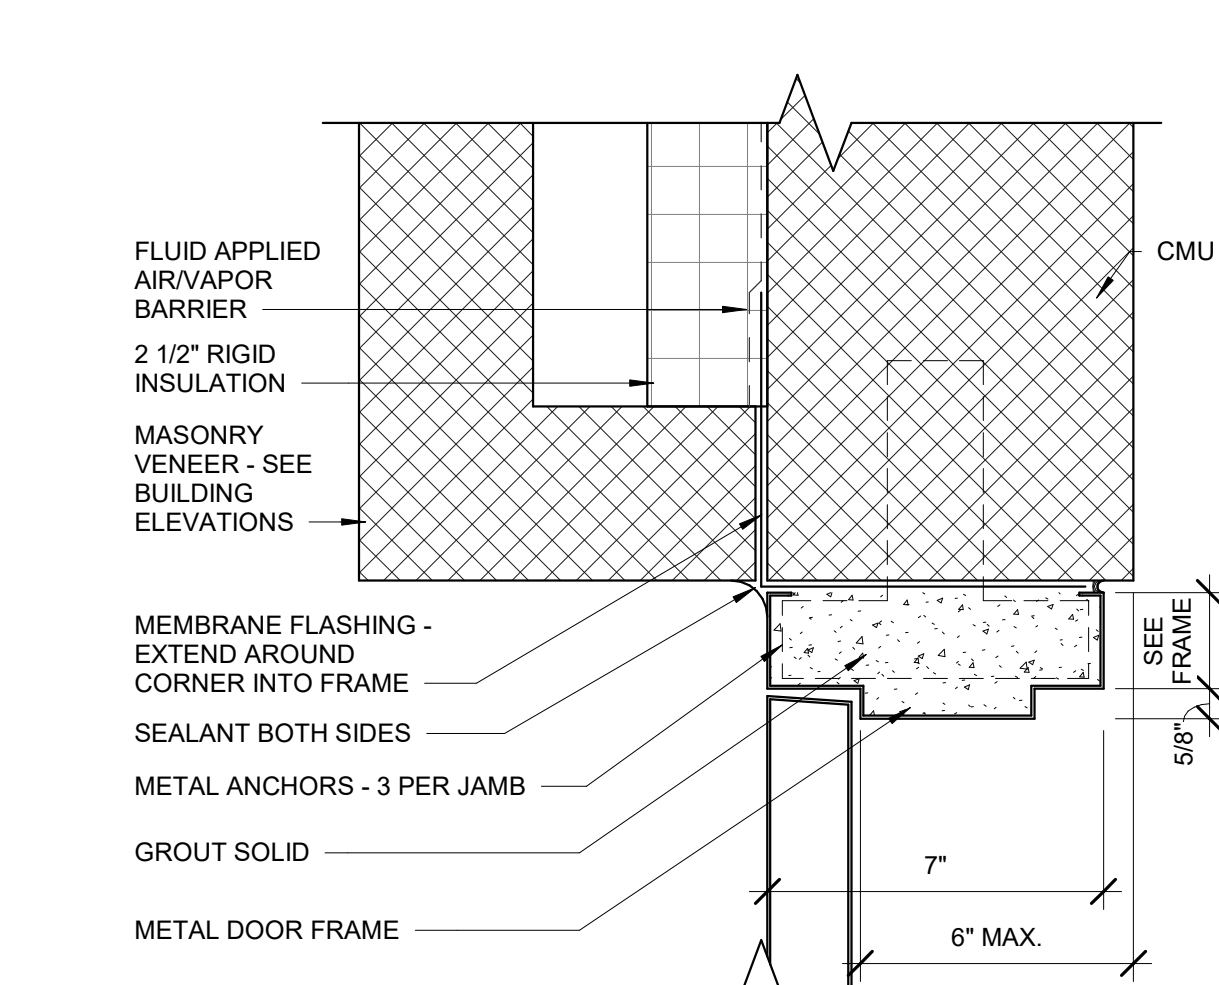


11 DOOR JAMB DETAIL
3" = 1'-0"

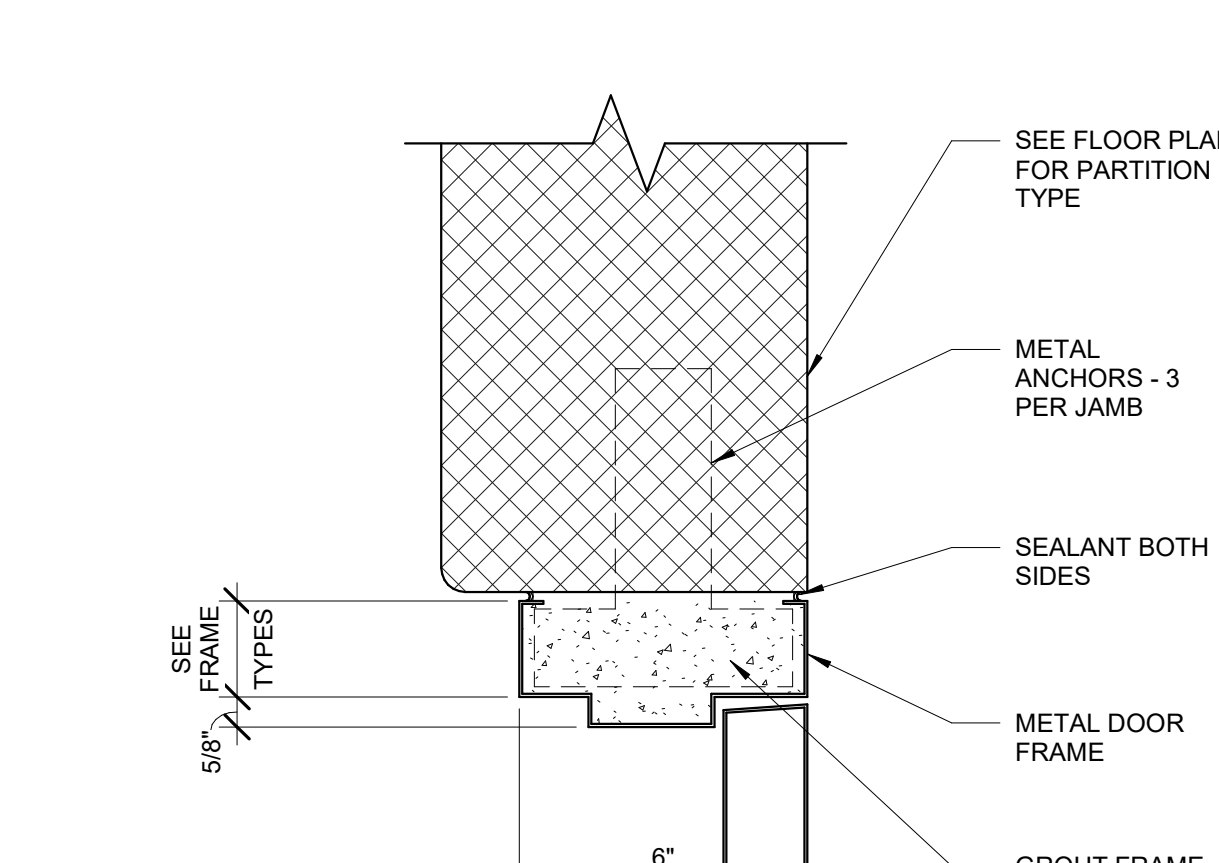


2 DOOR JAMB DETAIL
3" = 1'-0"

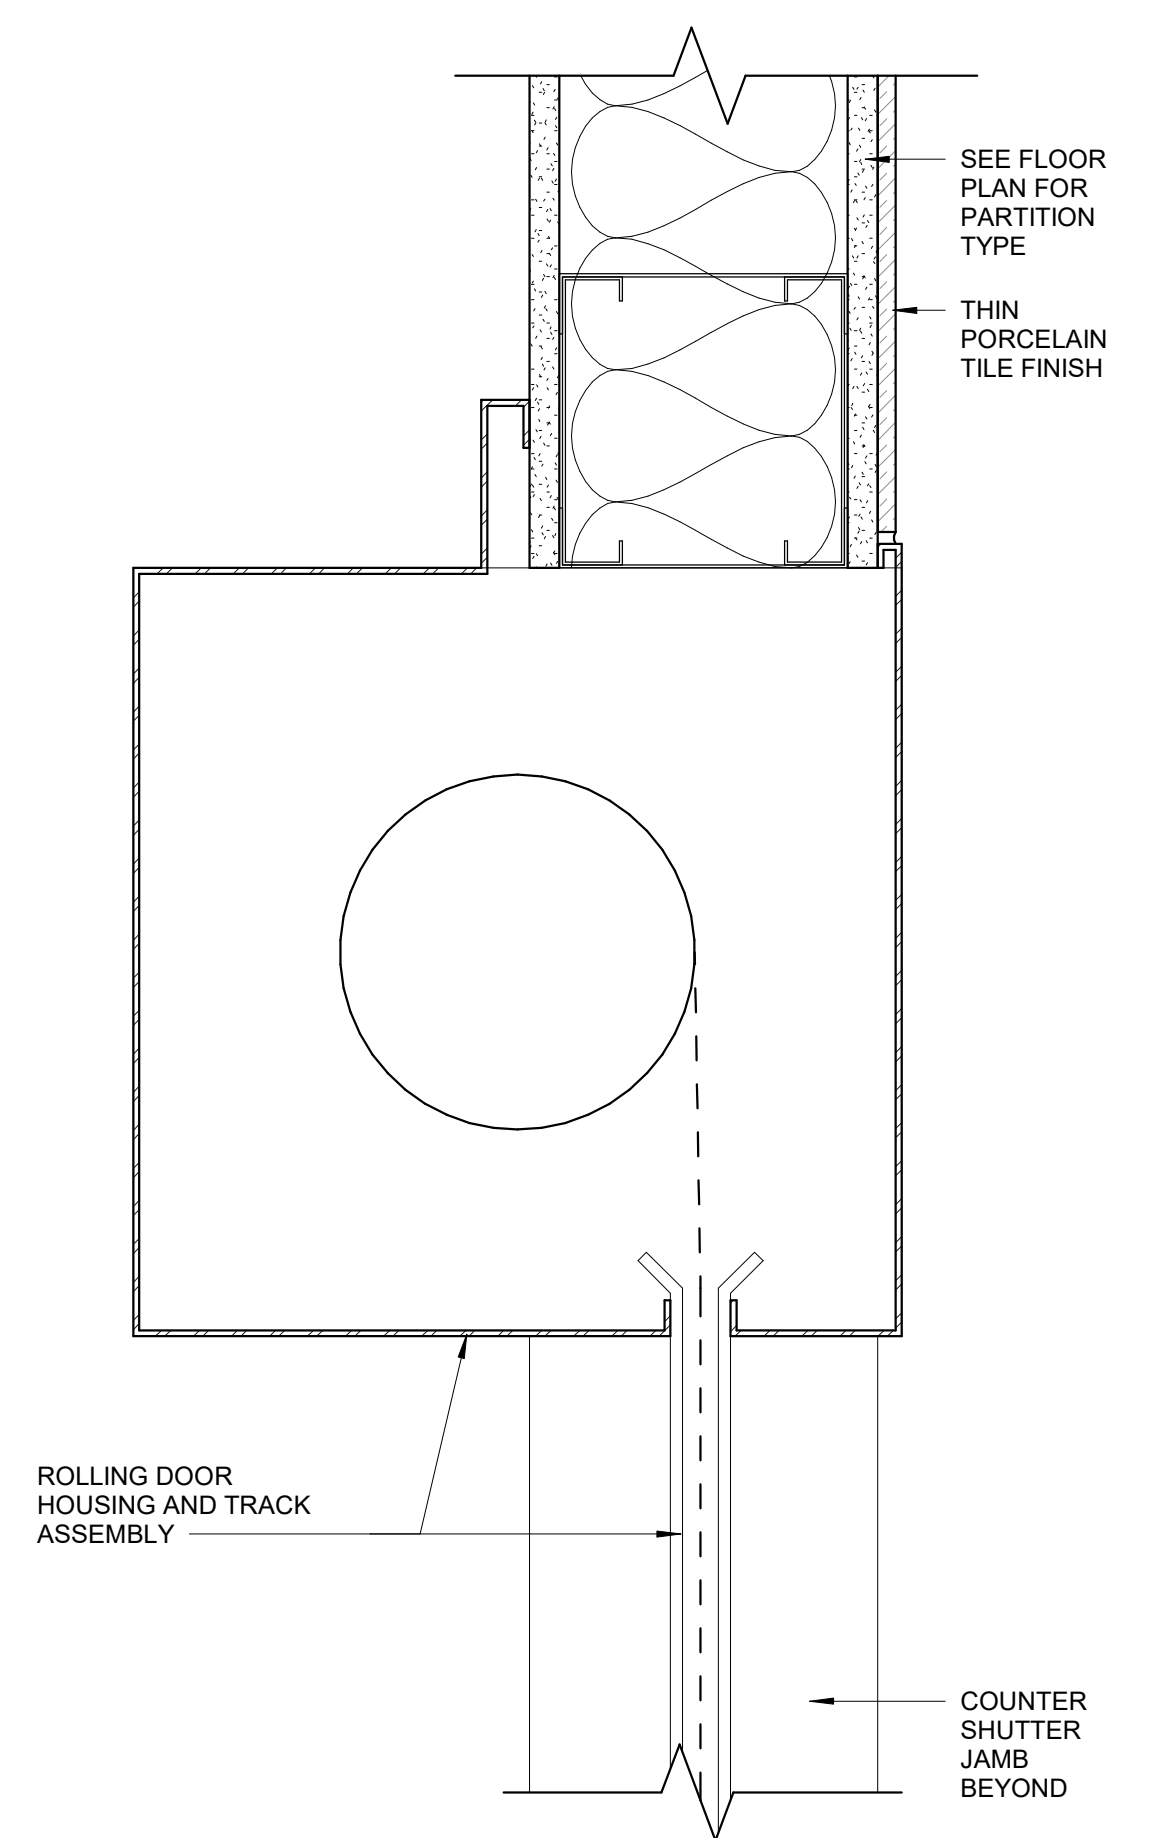


24 DOOR HEAD DETAIL
3" = 1'-0"

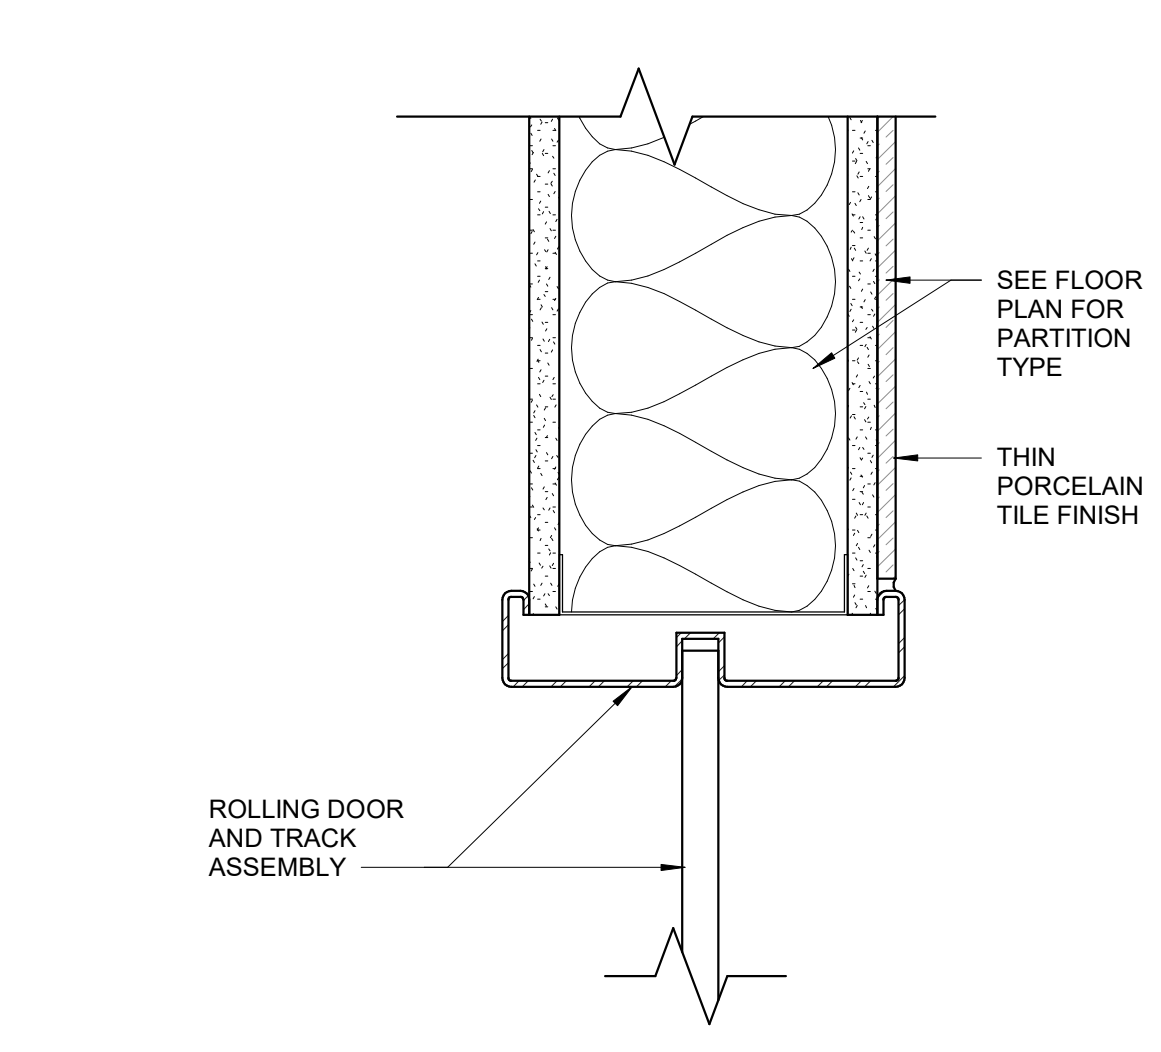

13 DOOR JAMB DETAIL
3" = 1'-0"

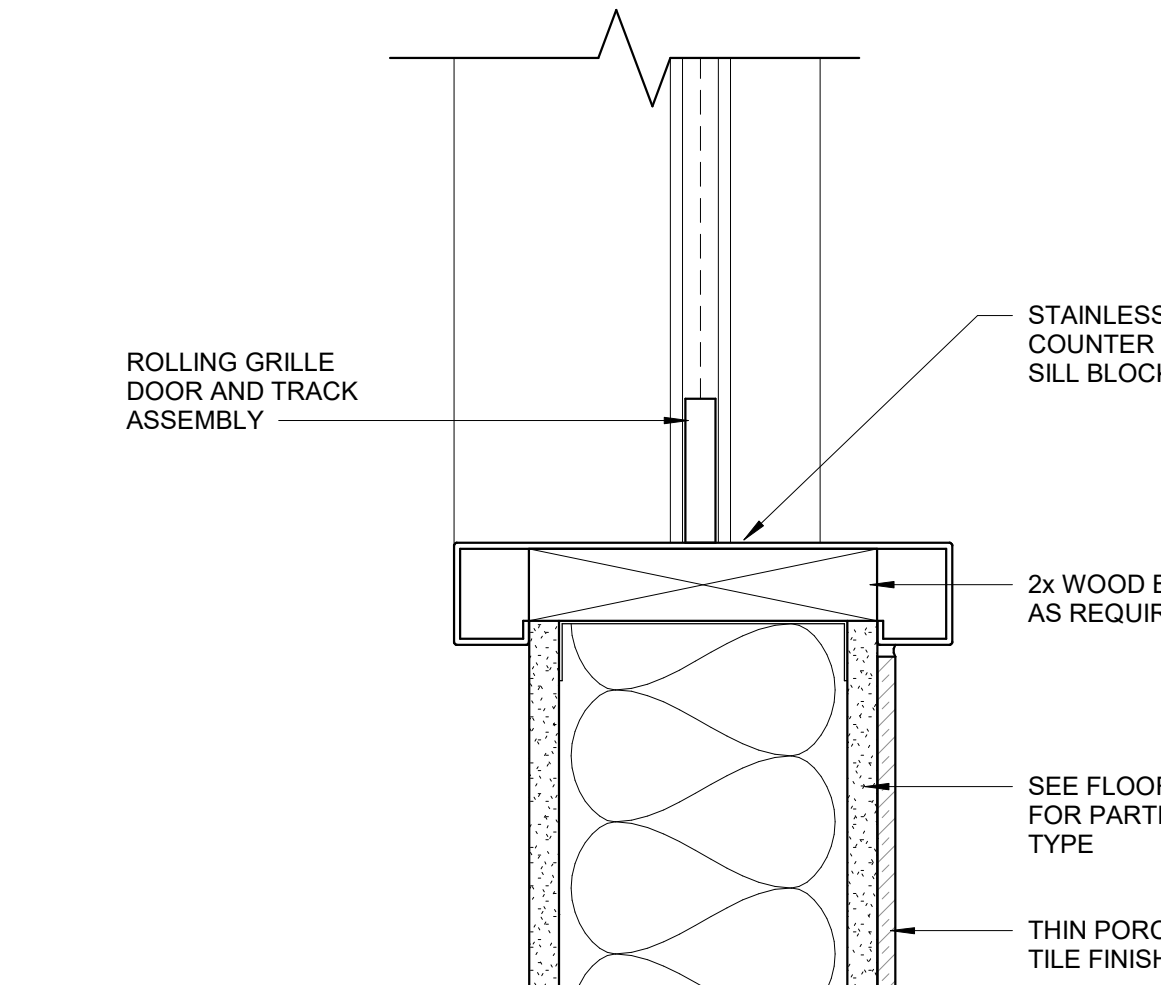











12 DOOR SILL DETAIL
3" = 1'-0"

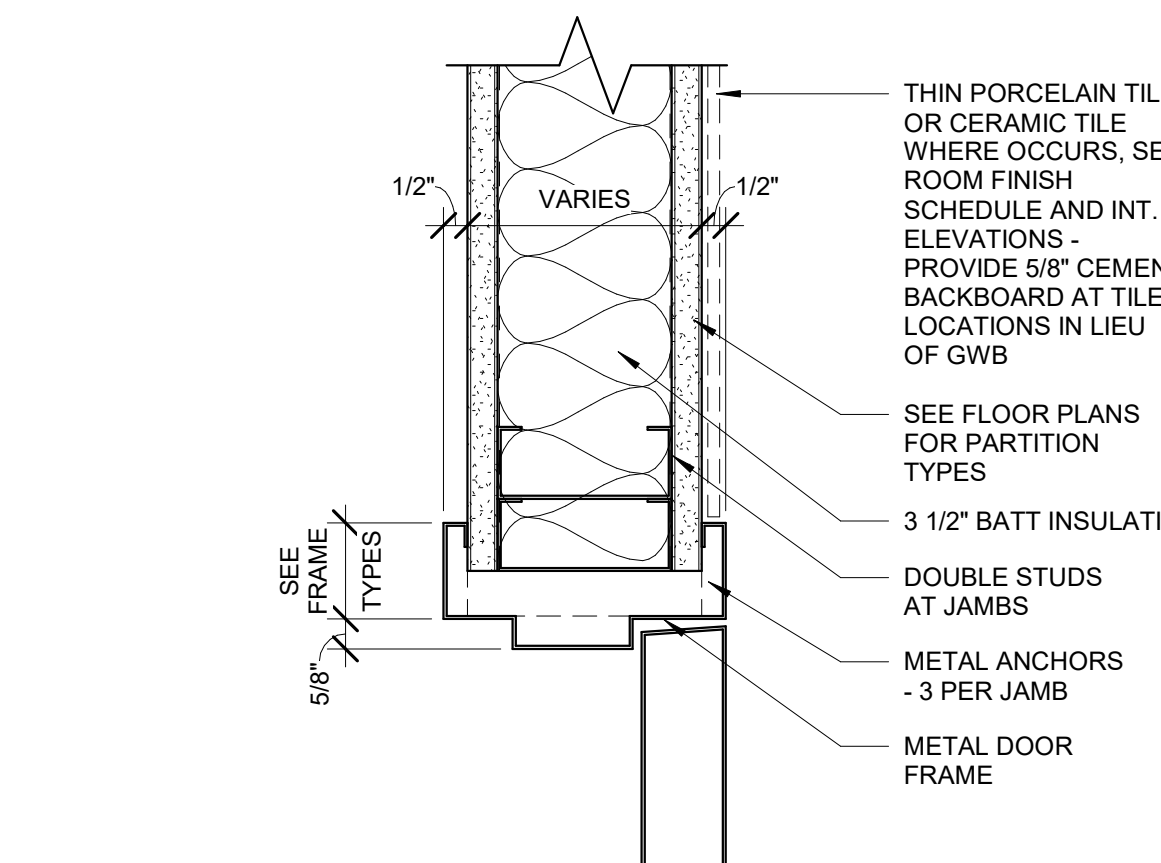

1 DOOR JAMB DETAIL
3" = 1'-0"

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

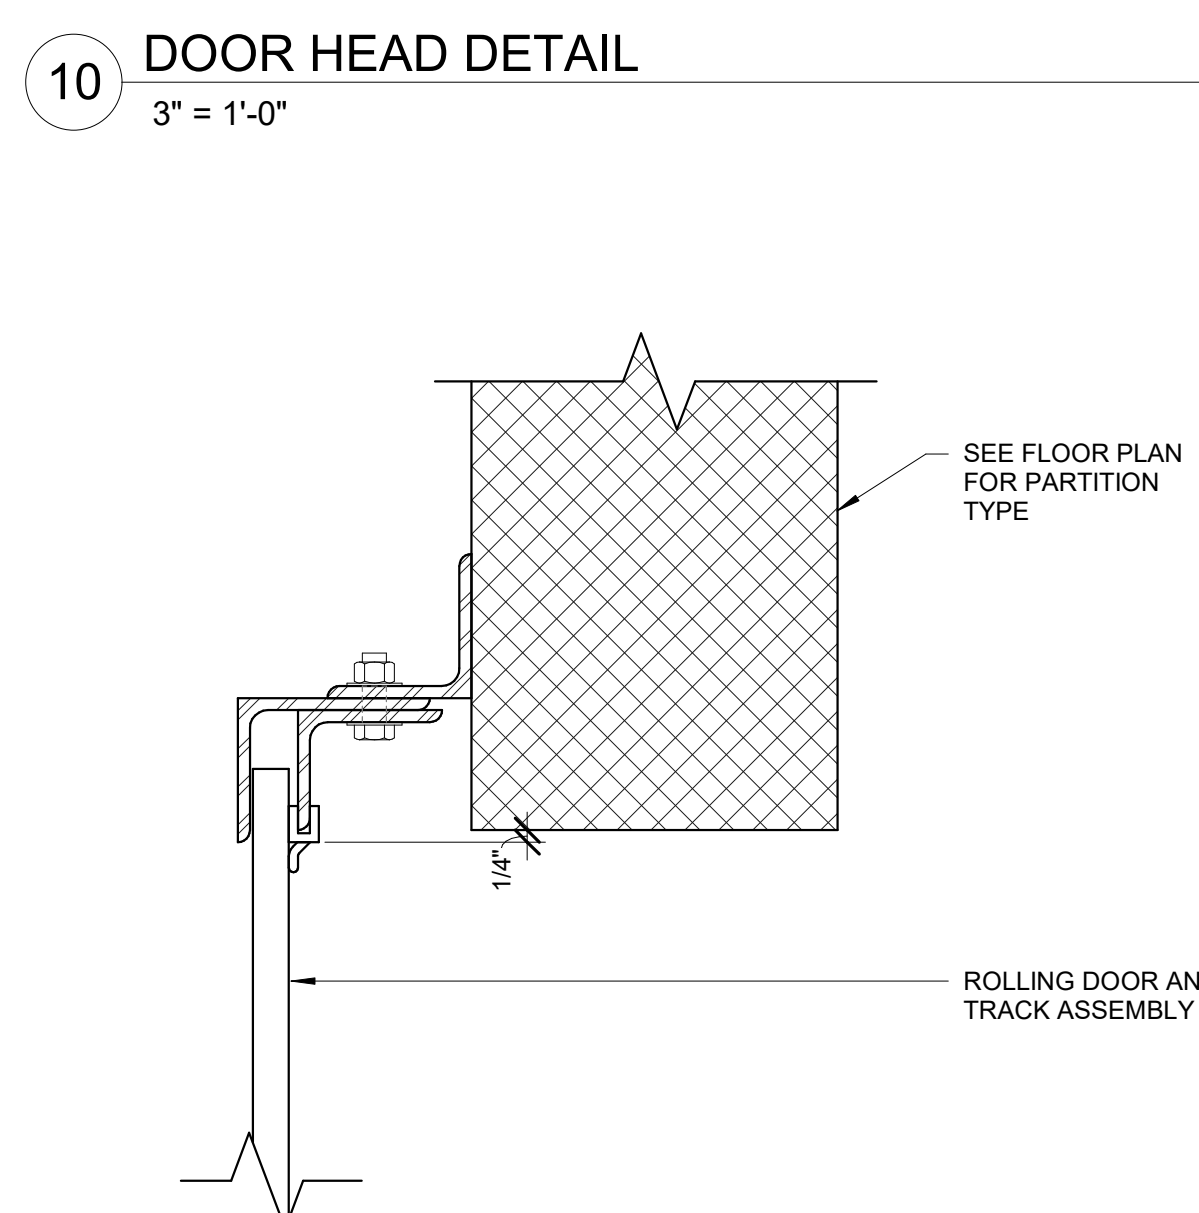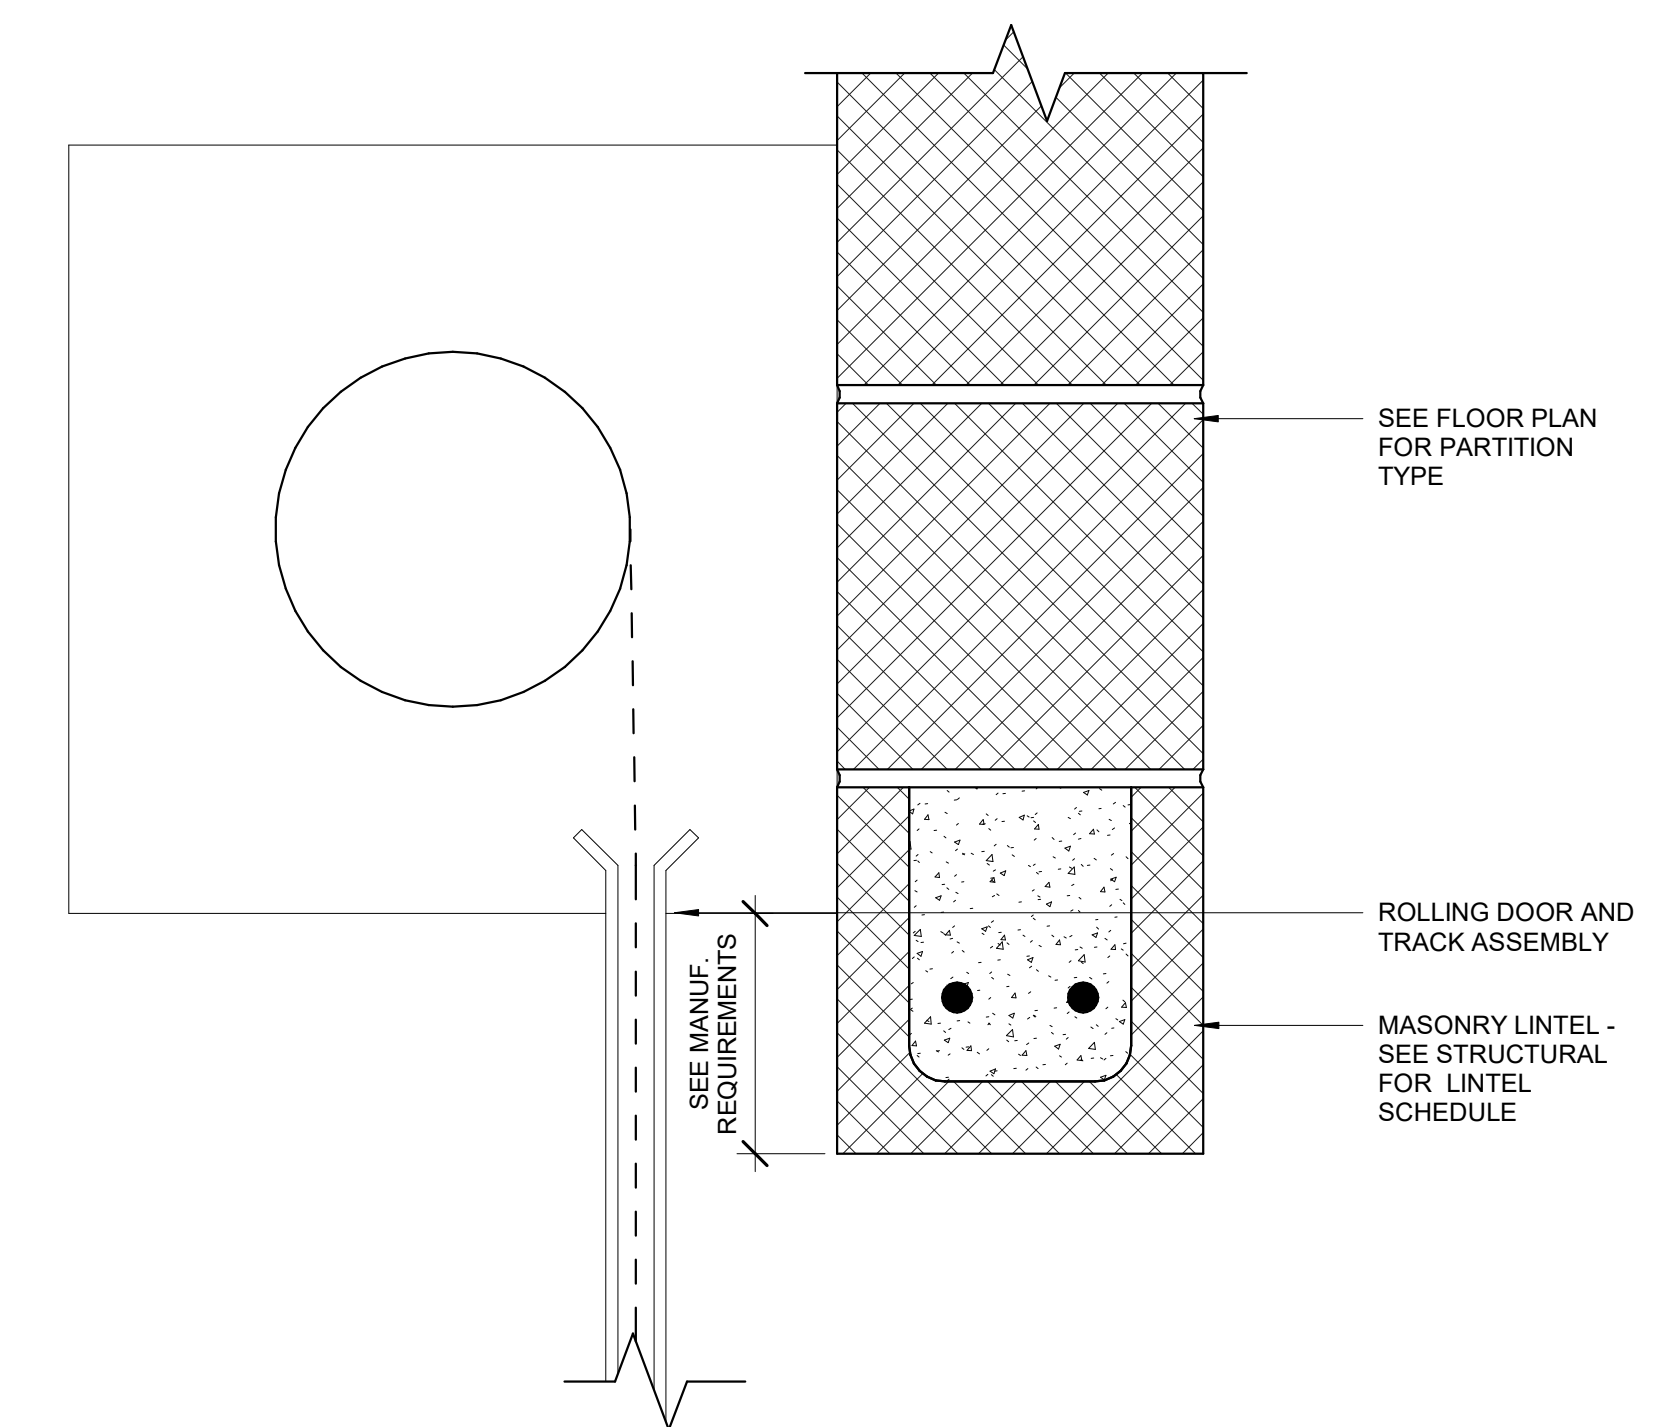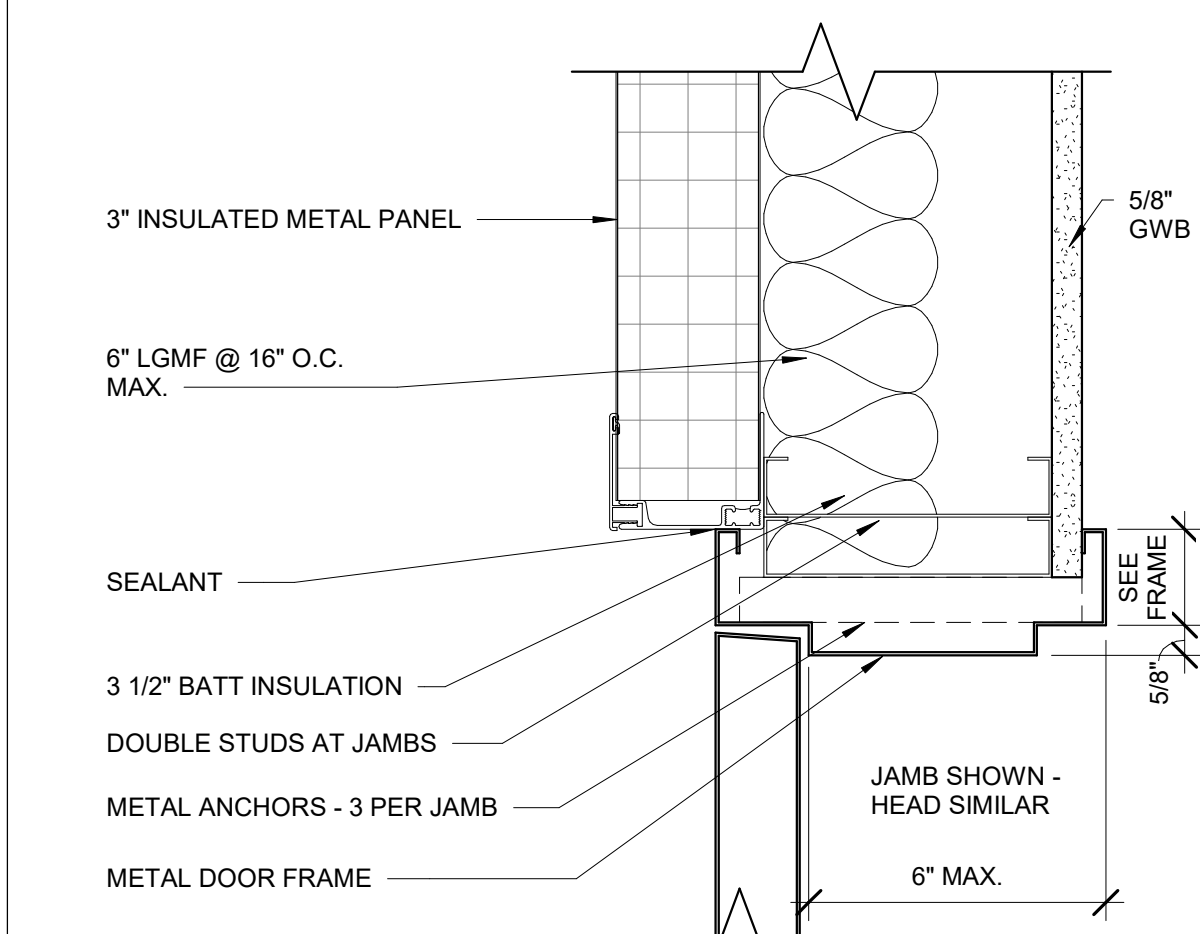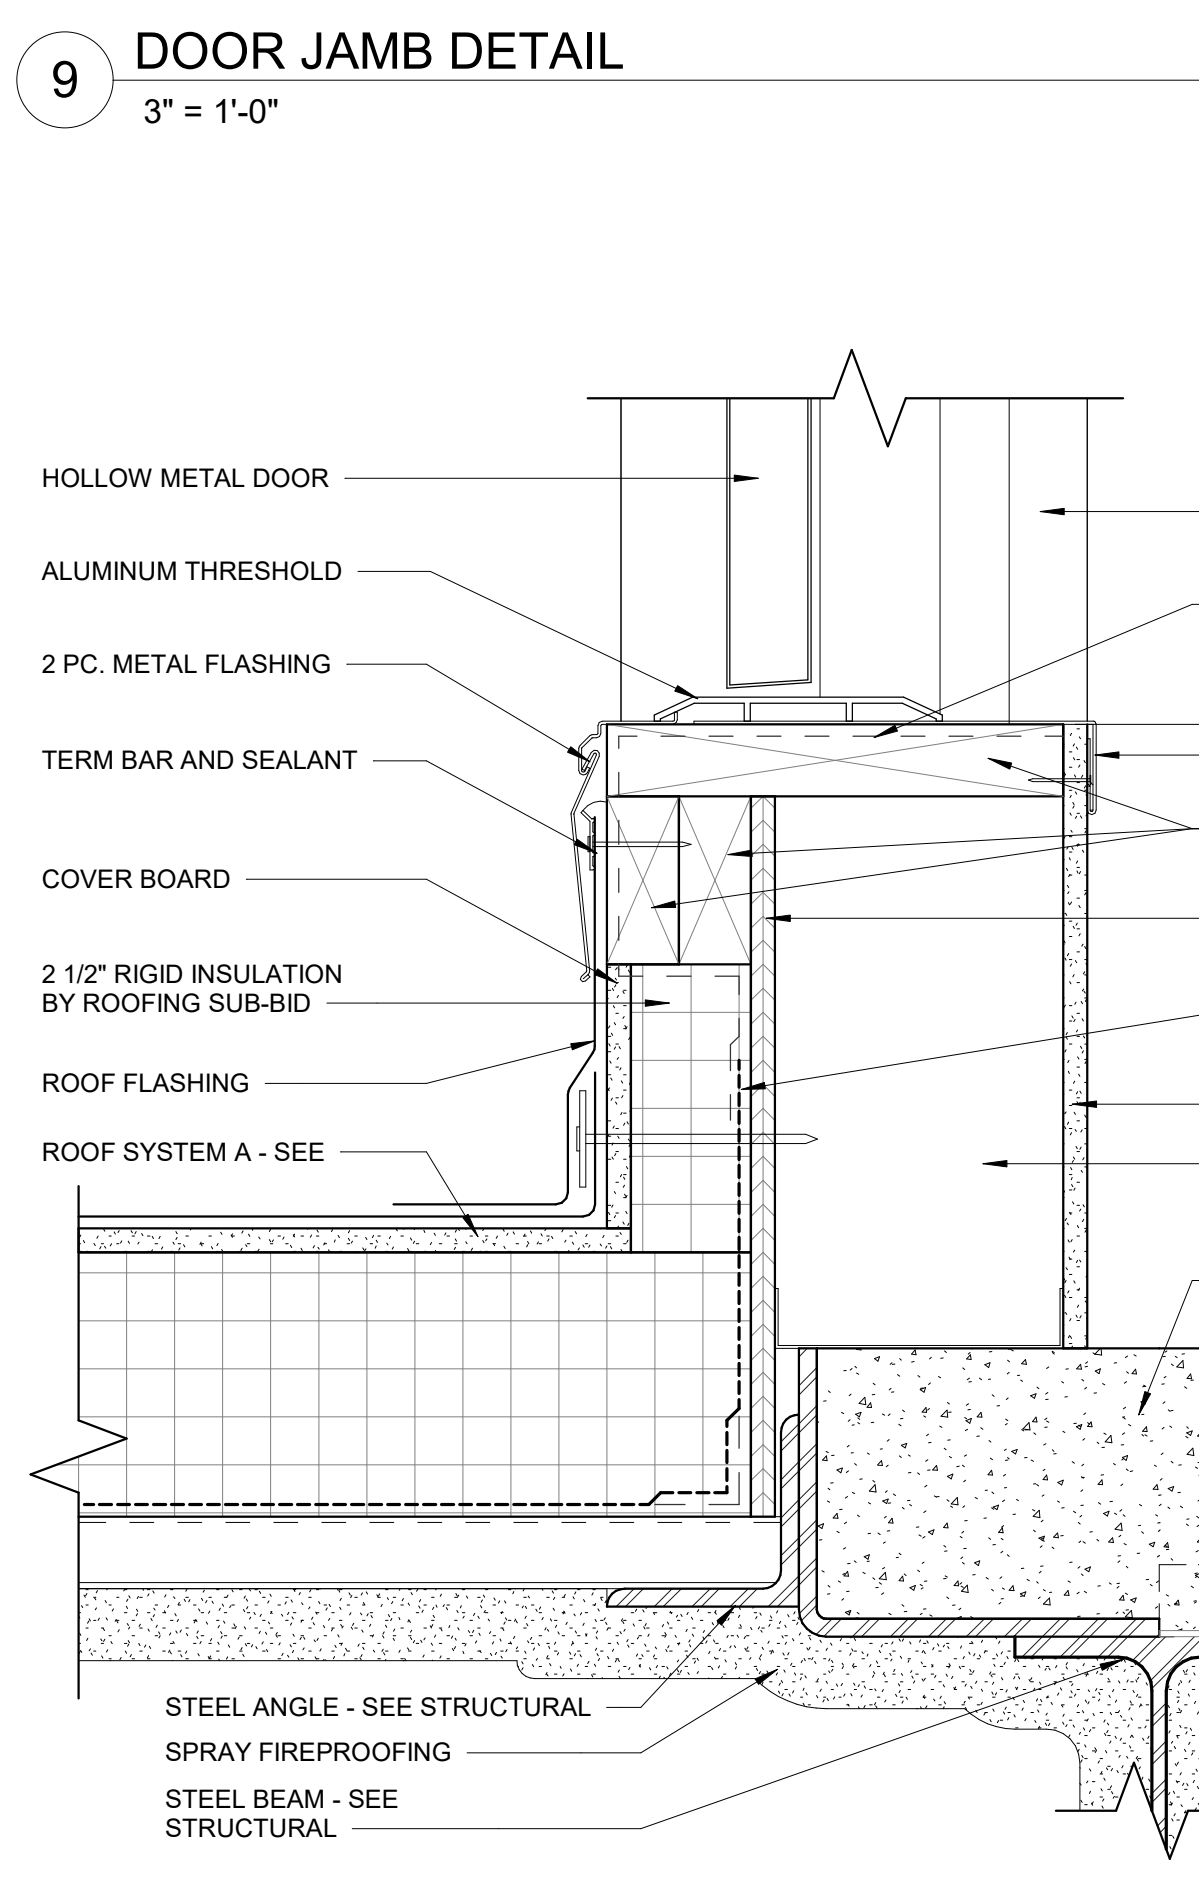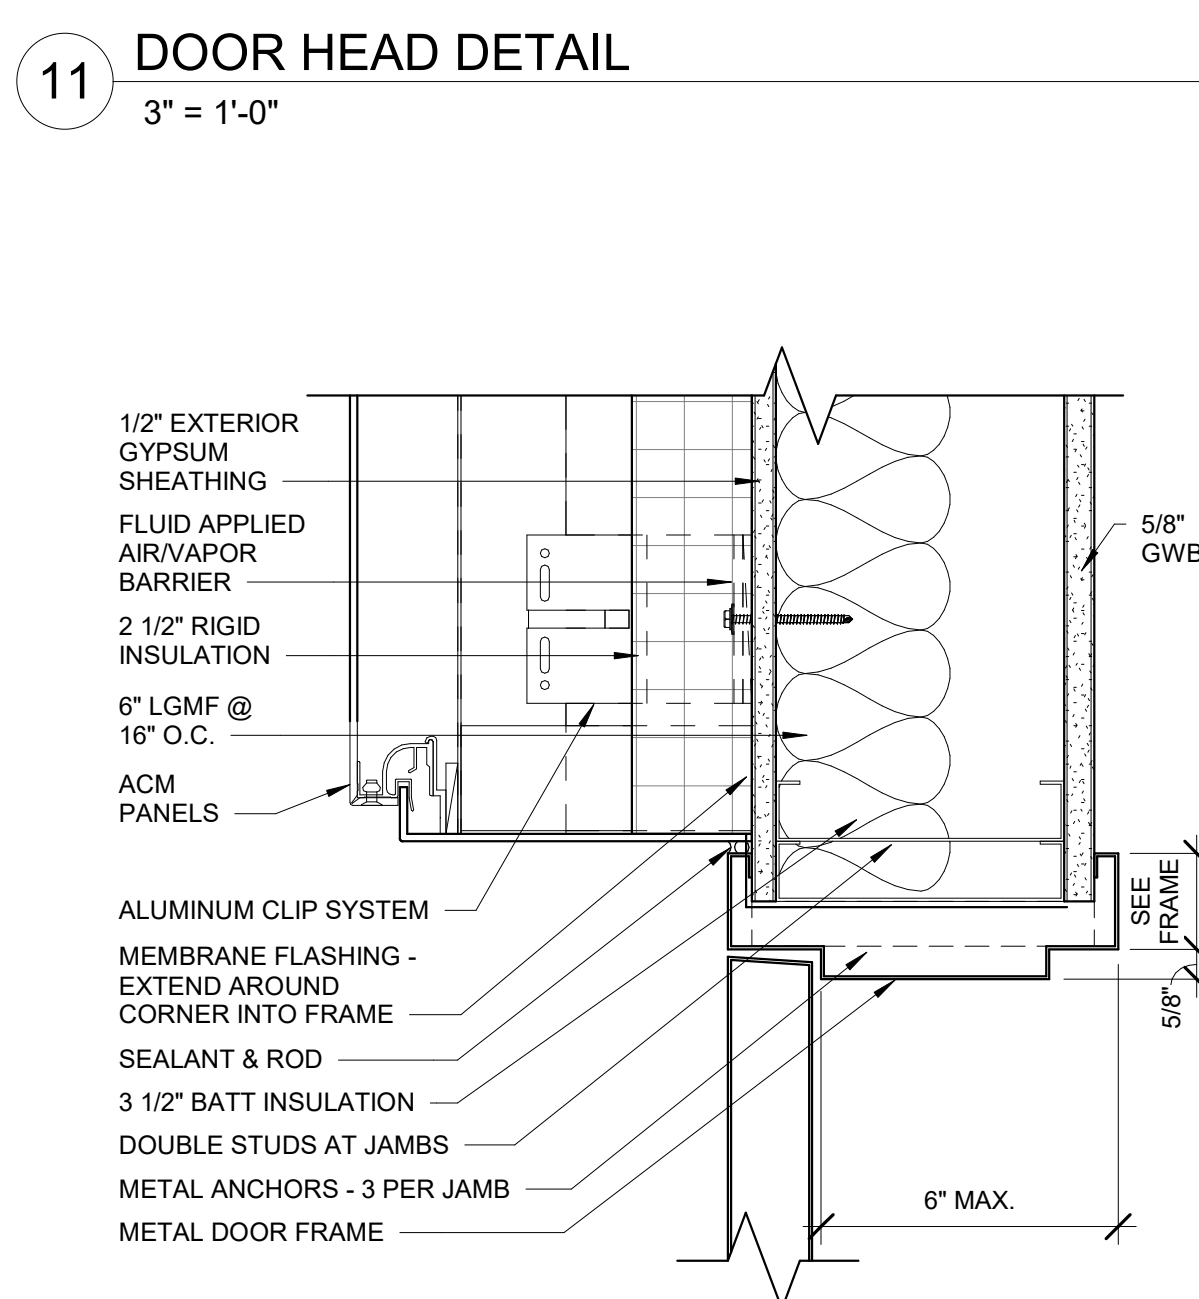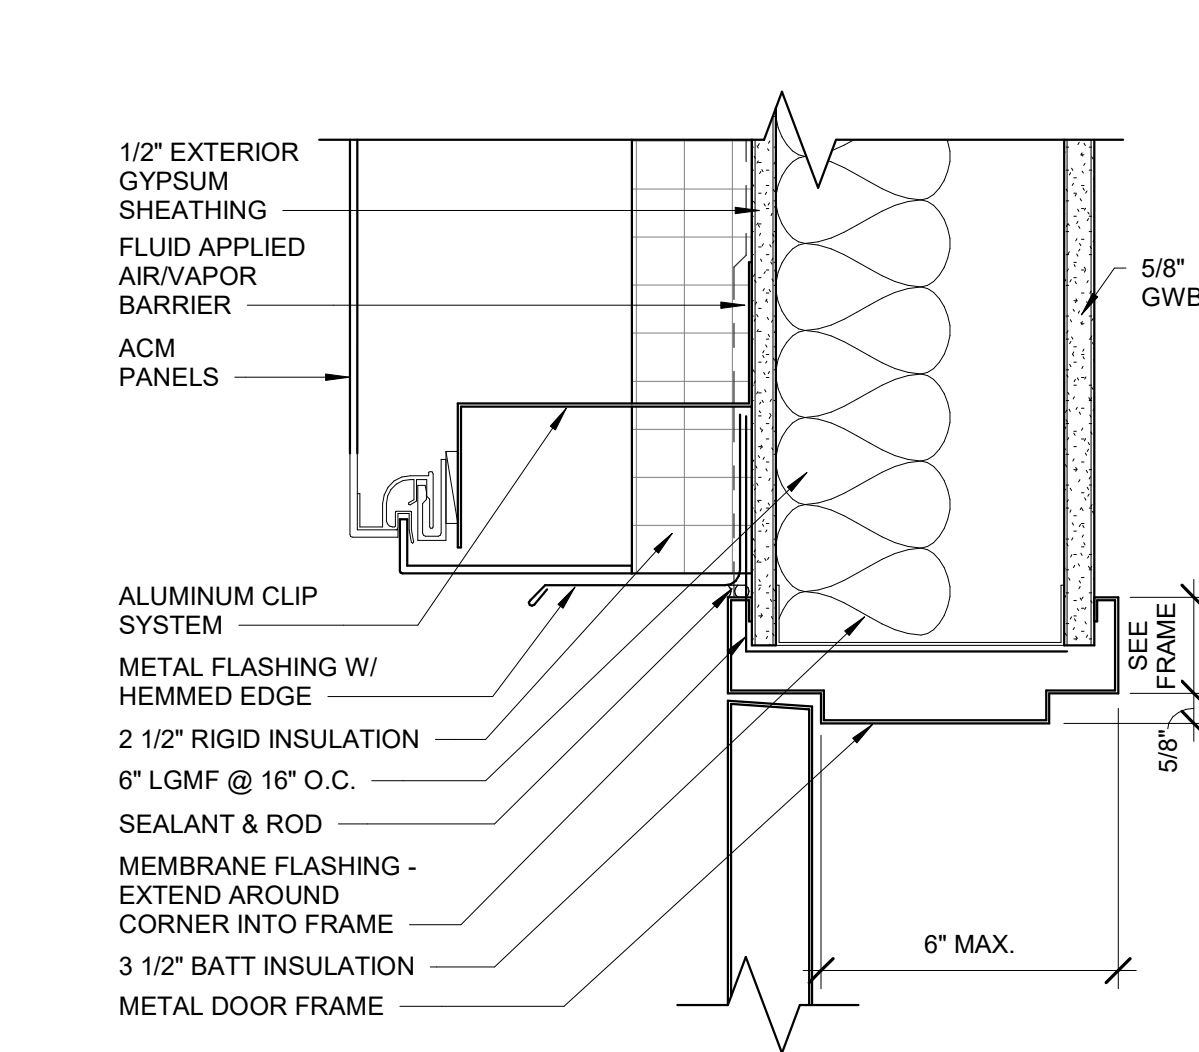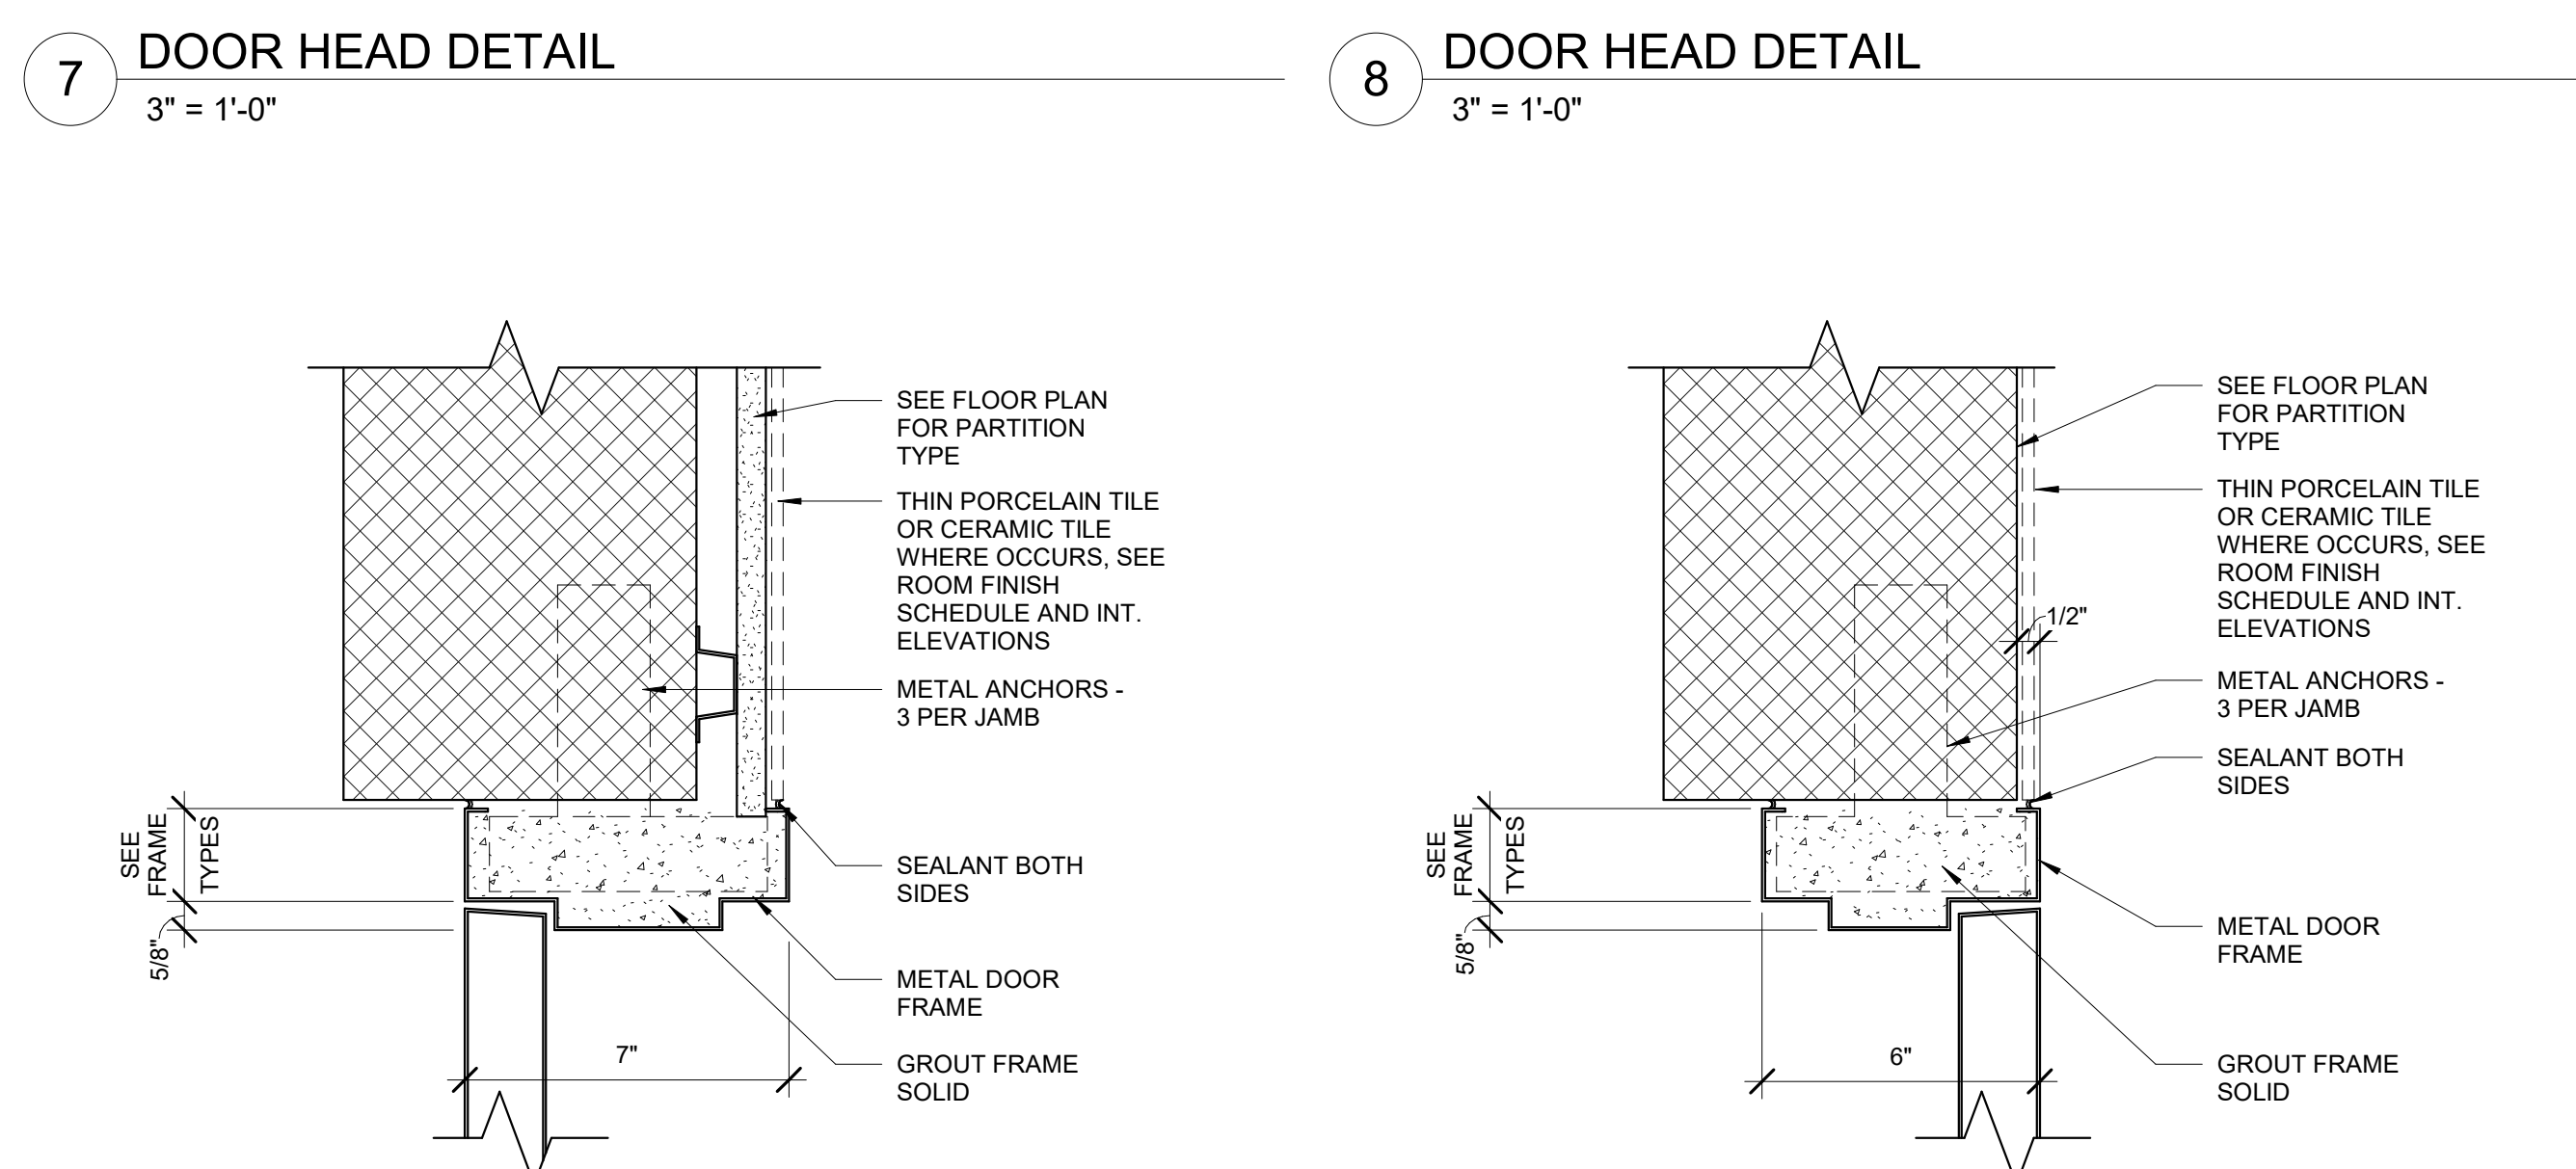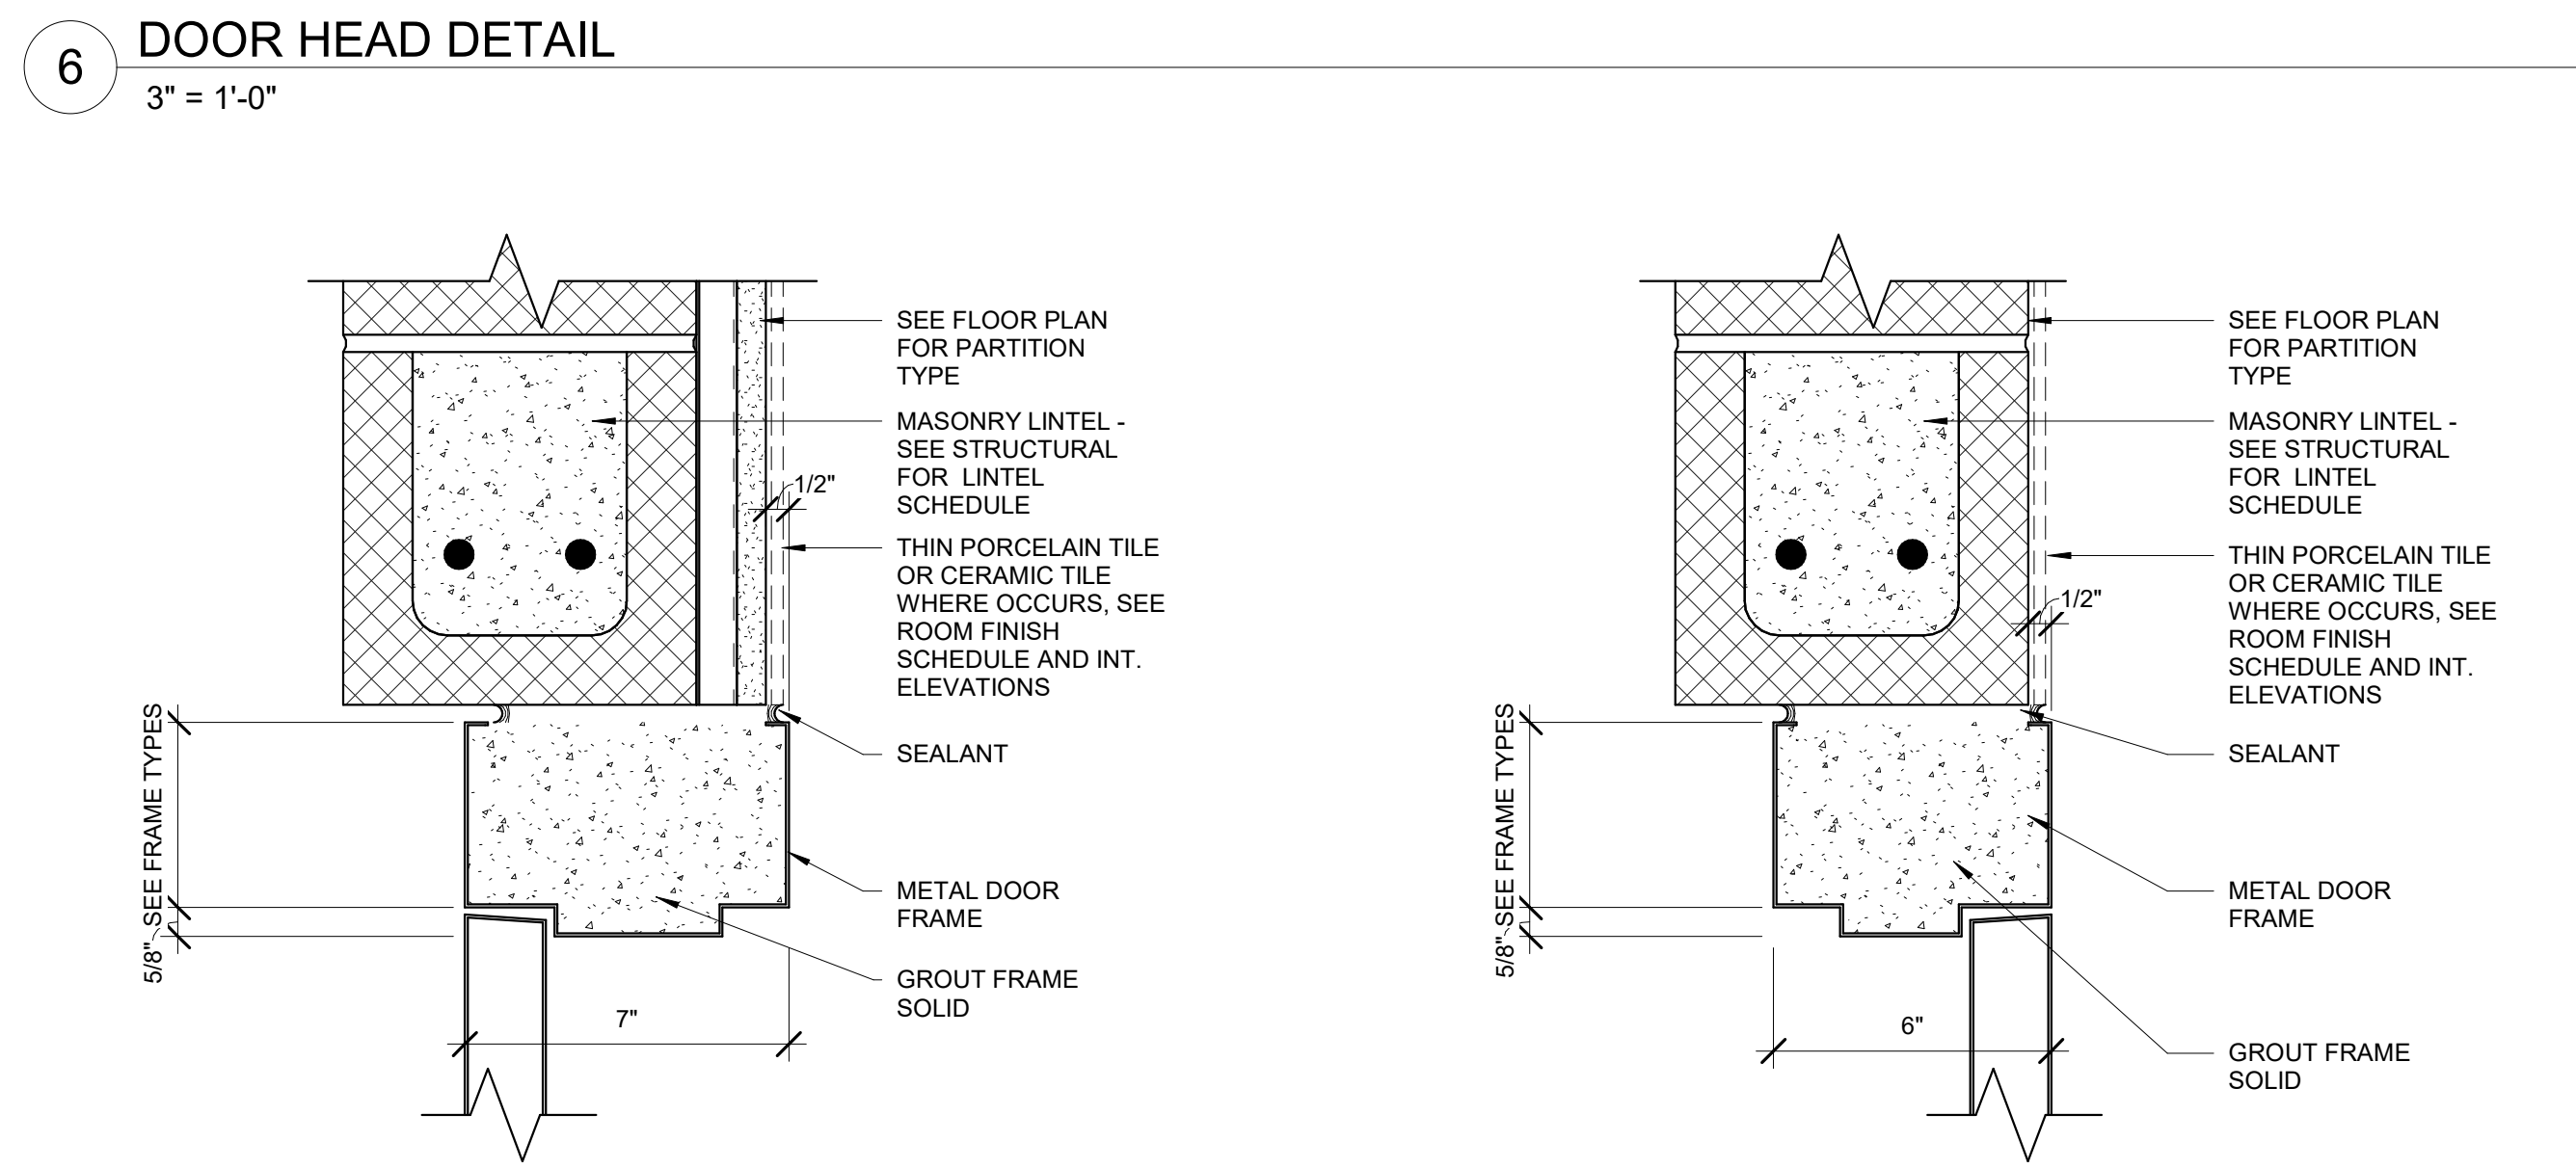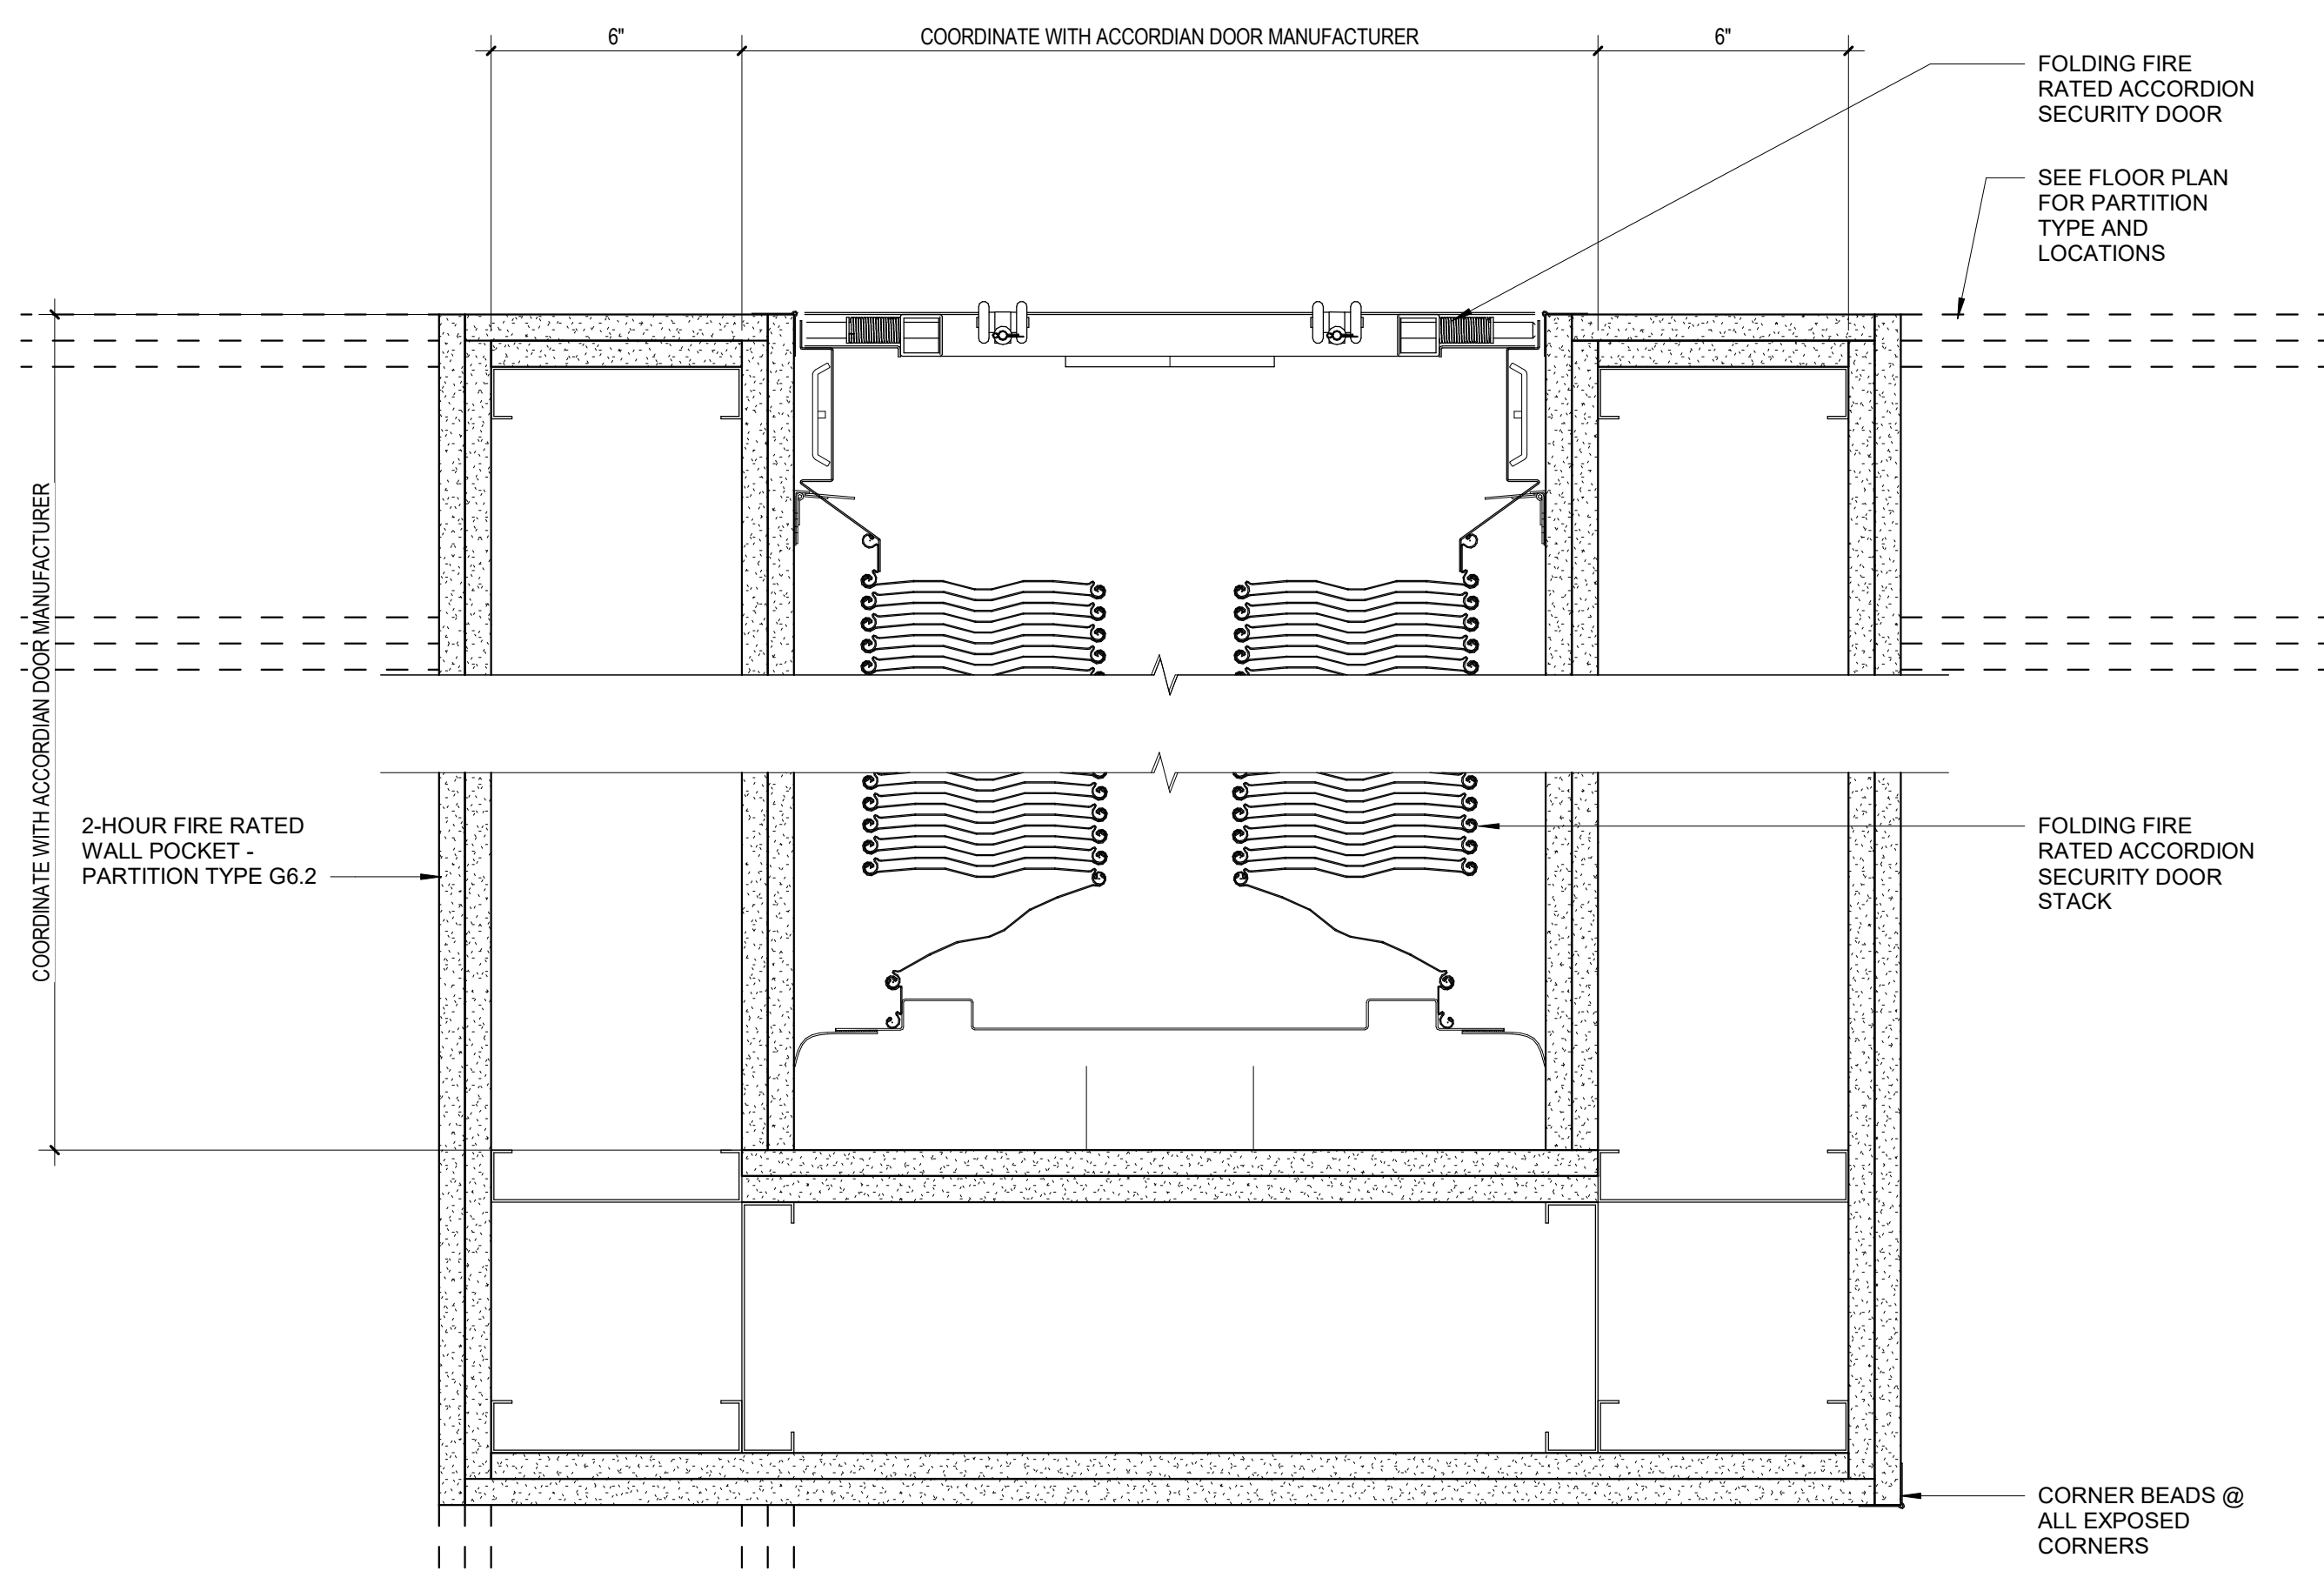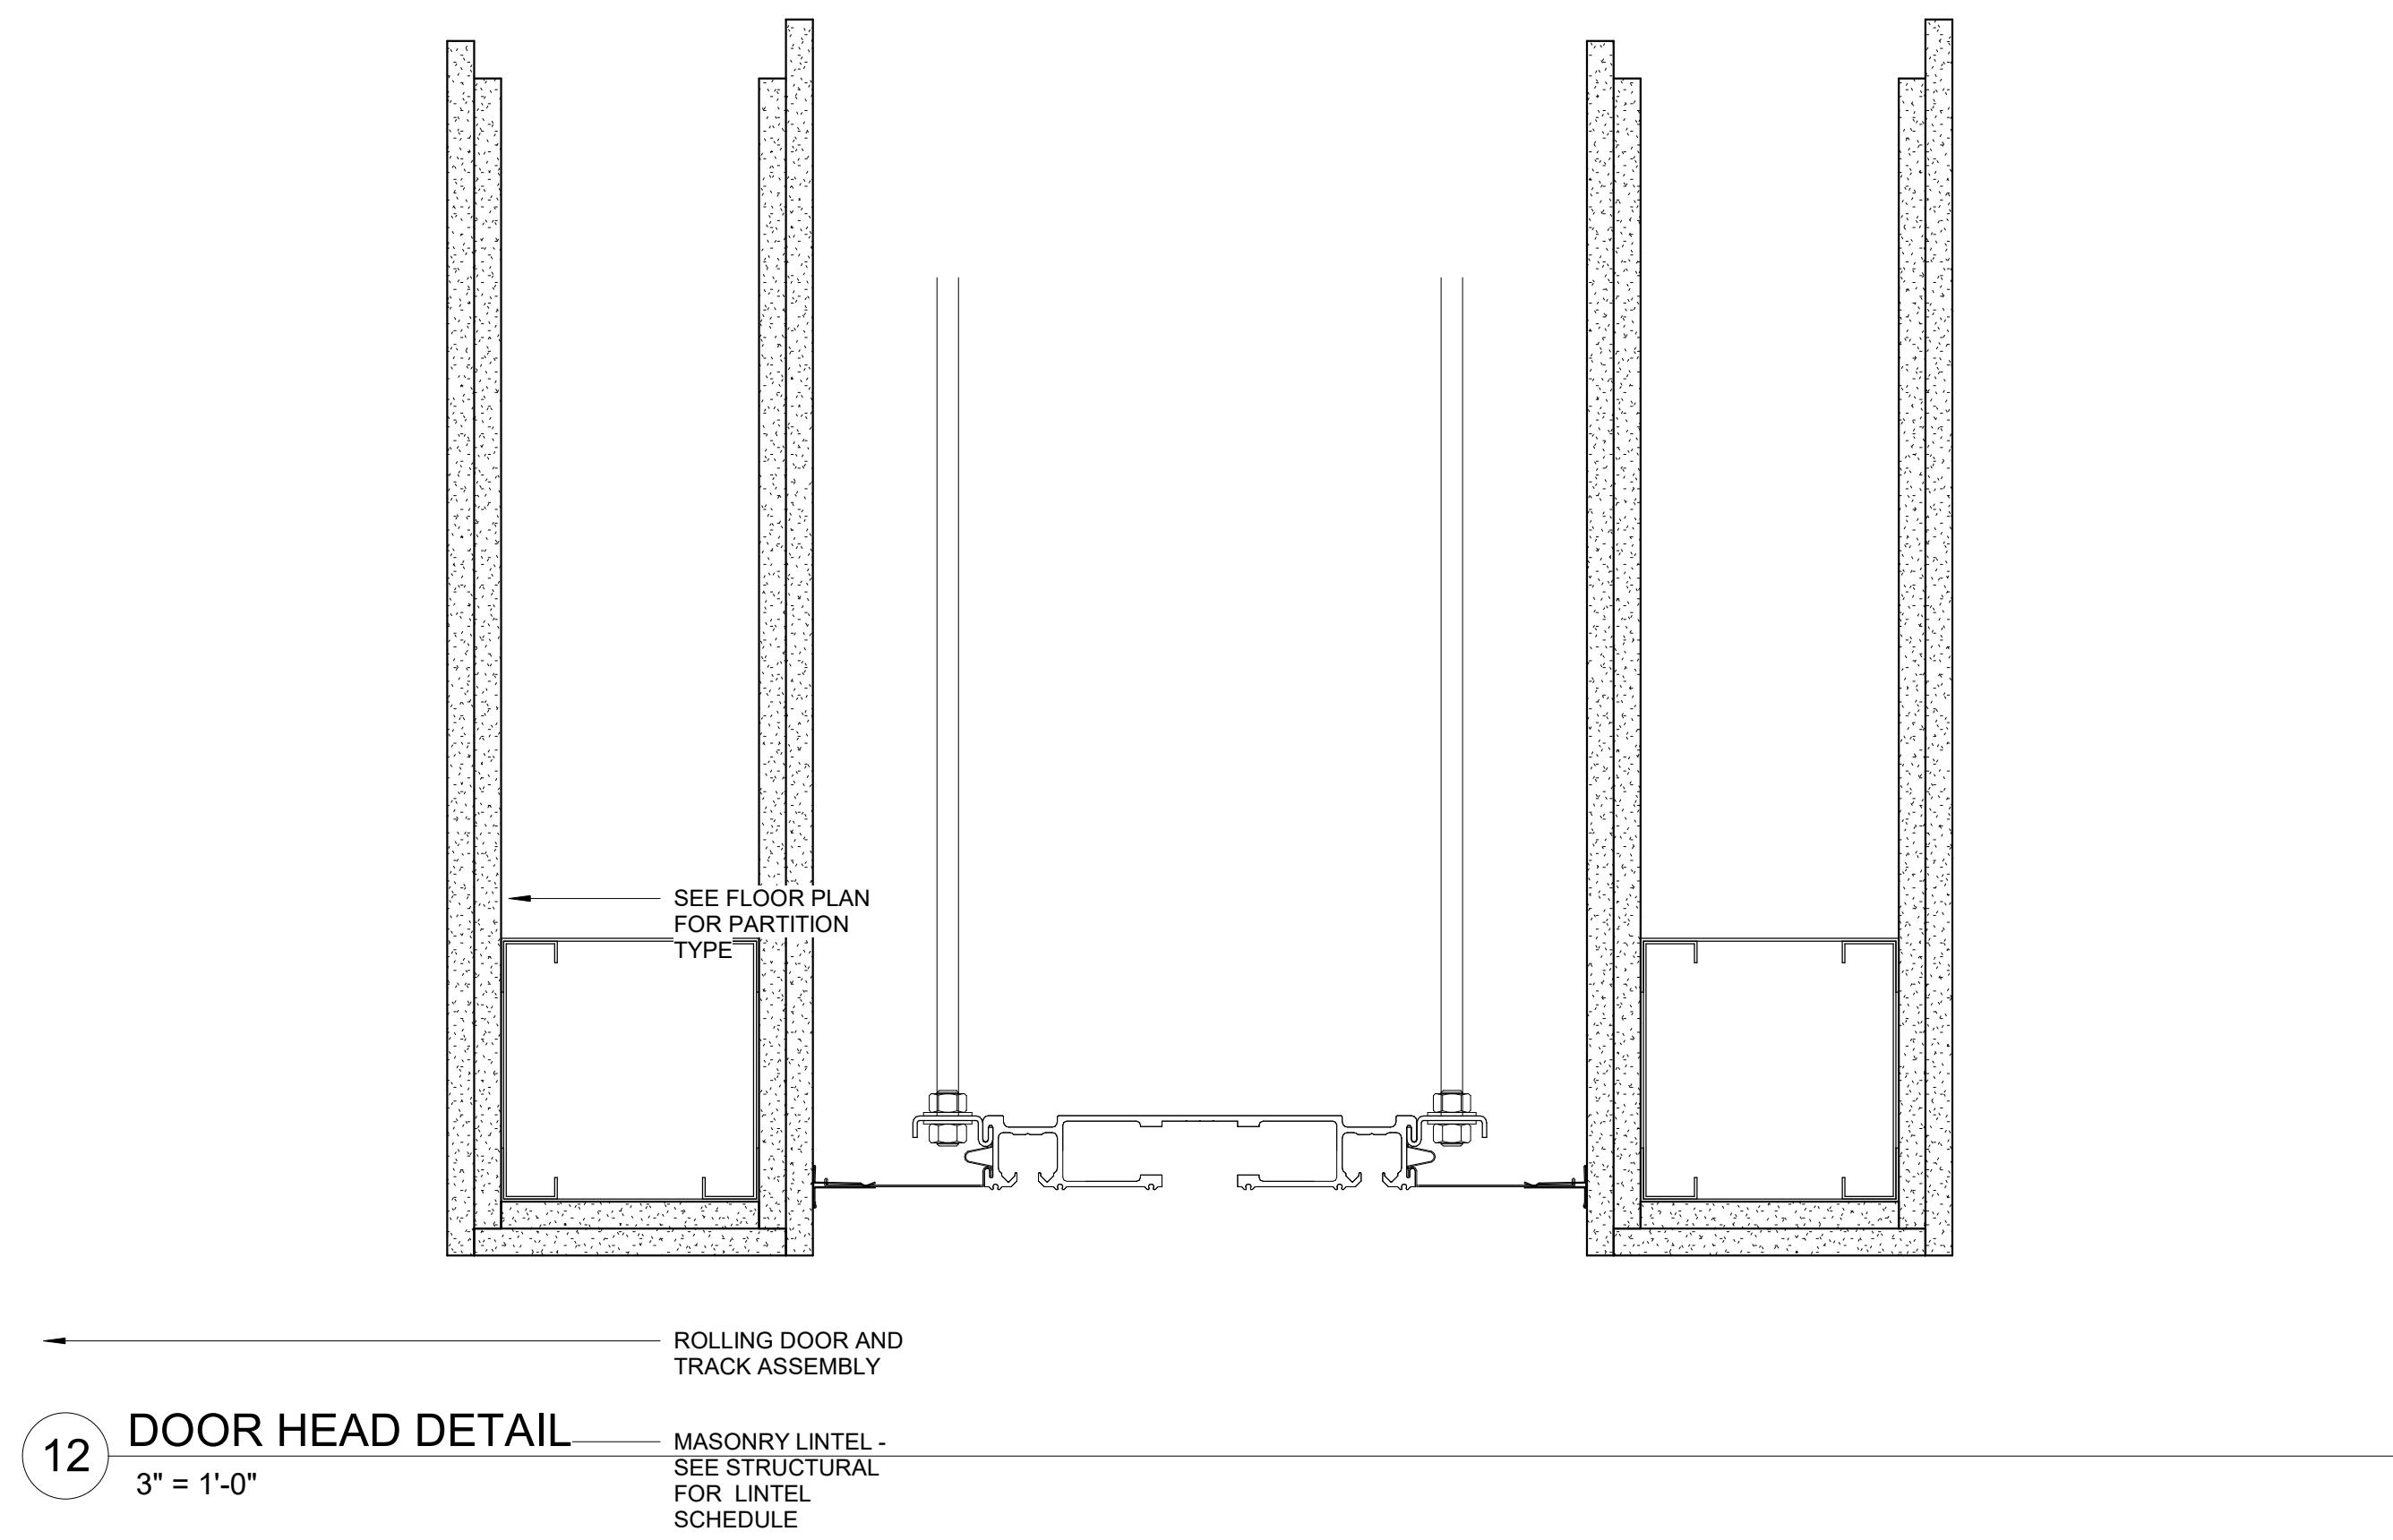

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023



KEY PLAN

PROJECT NORTH

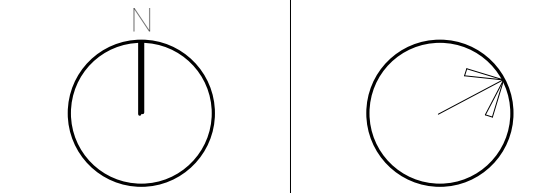

**DOOR AND
BORROWED LITE
DETAILS**

Scale: 3" = 1'-0"

Job No.: 20202




Drawn By: DRA

Date: May 12TH, 2023










Volume 3 of 4

A6-2-5









- GENERAL NOTES – STOREFRONT / CURTAIN WALL TYPES
- INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
 - EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE GX1
 - AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION BEHIND ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
 - PROVIDE SAFETY GLAZING AT ALL LOCATIONS IDENTIFIED AS HAZARDOUS LOCATIONS PER THE 9TH EDITION OF THE MASSACHUSETTS STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
 - PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS
 - "SG" DENOTES LOCATION OF SAFETY GLAZING
 - SEE DOOR SCHEDULE FOR DOOR TYPES

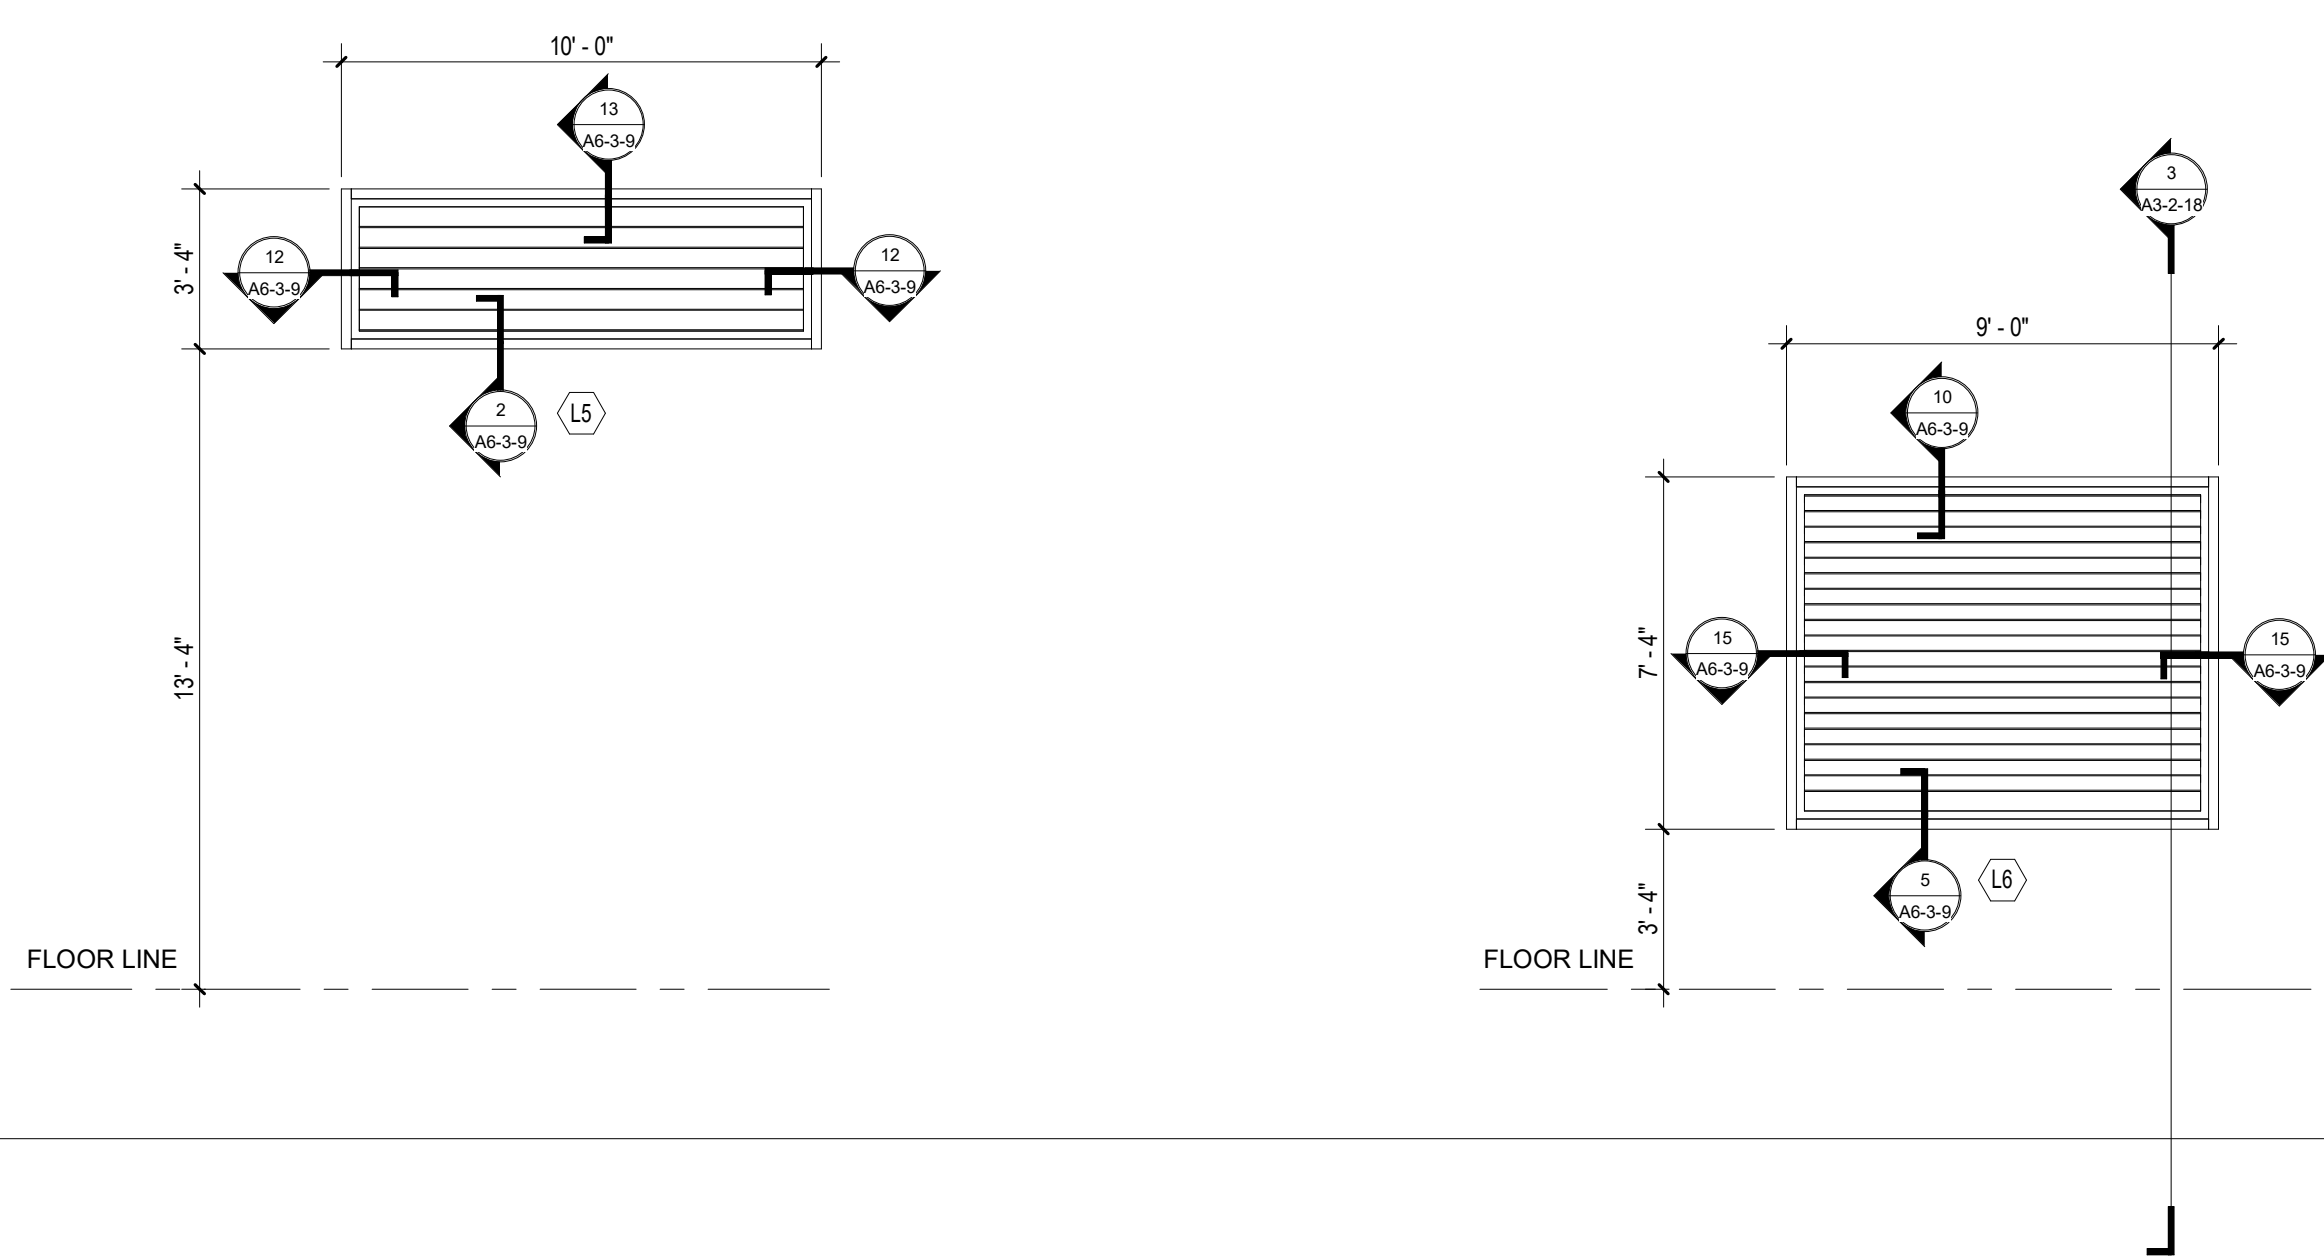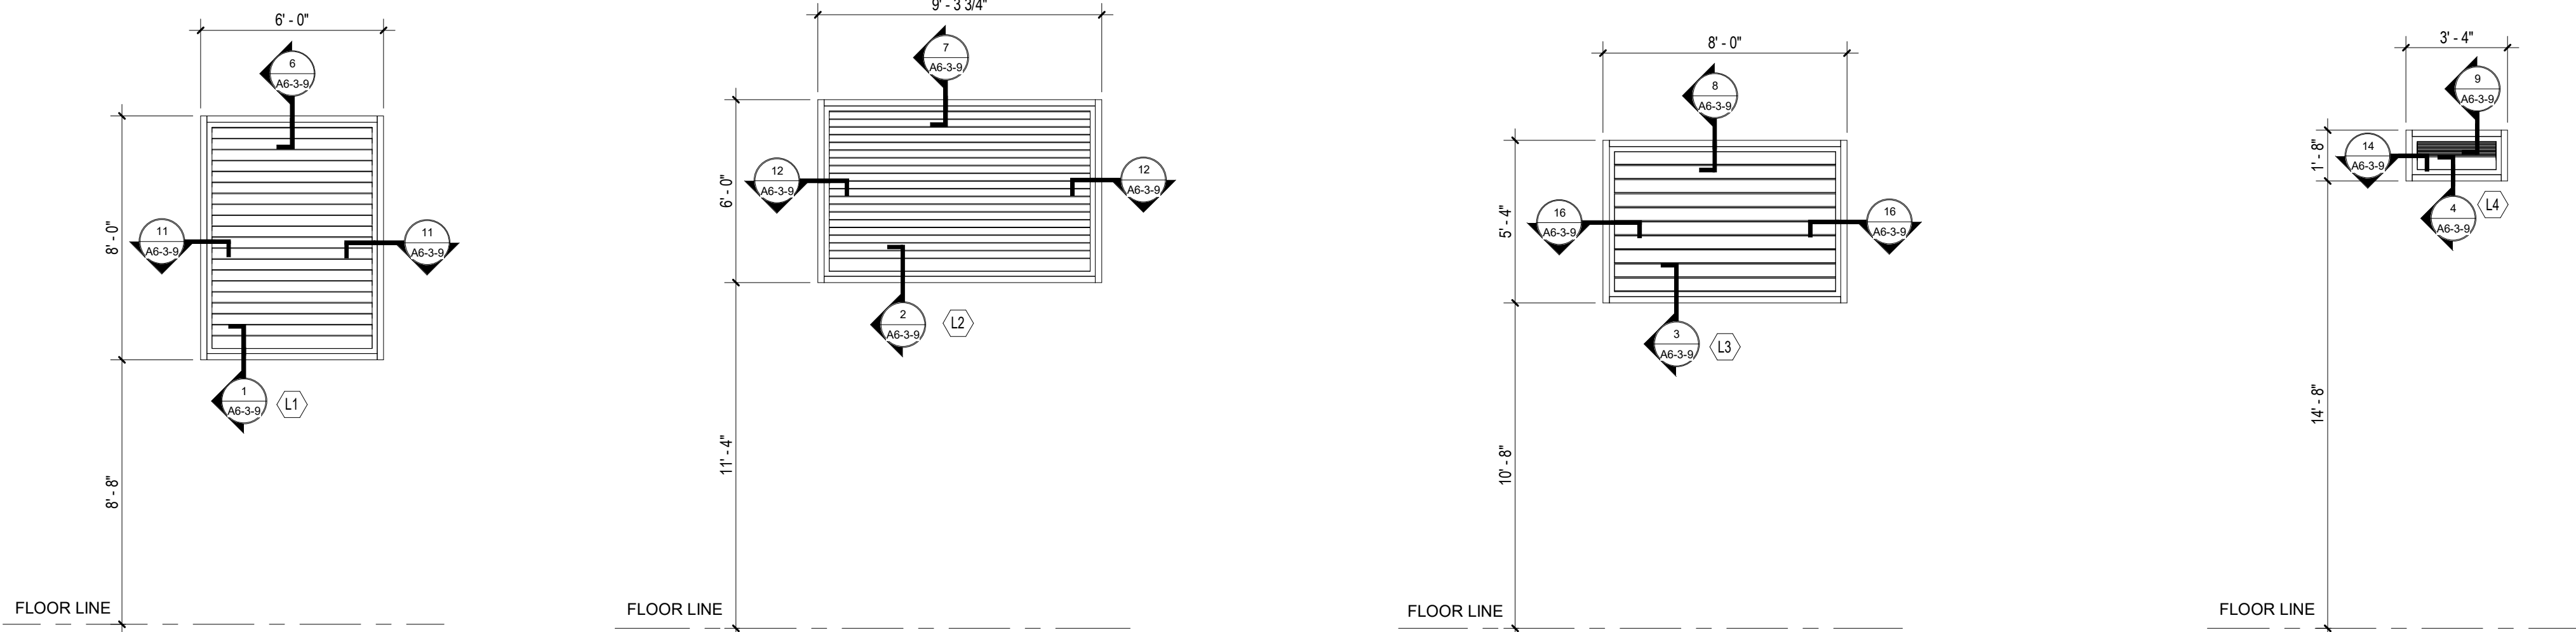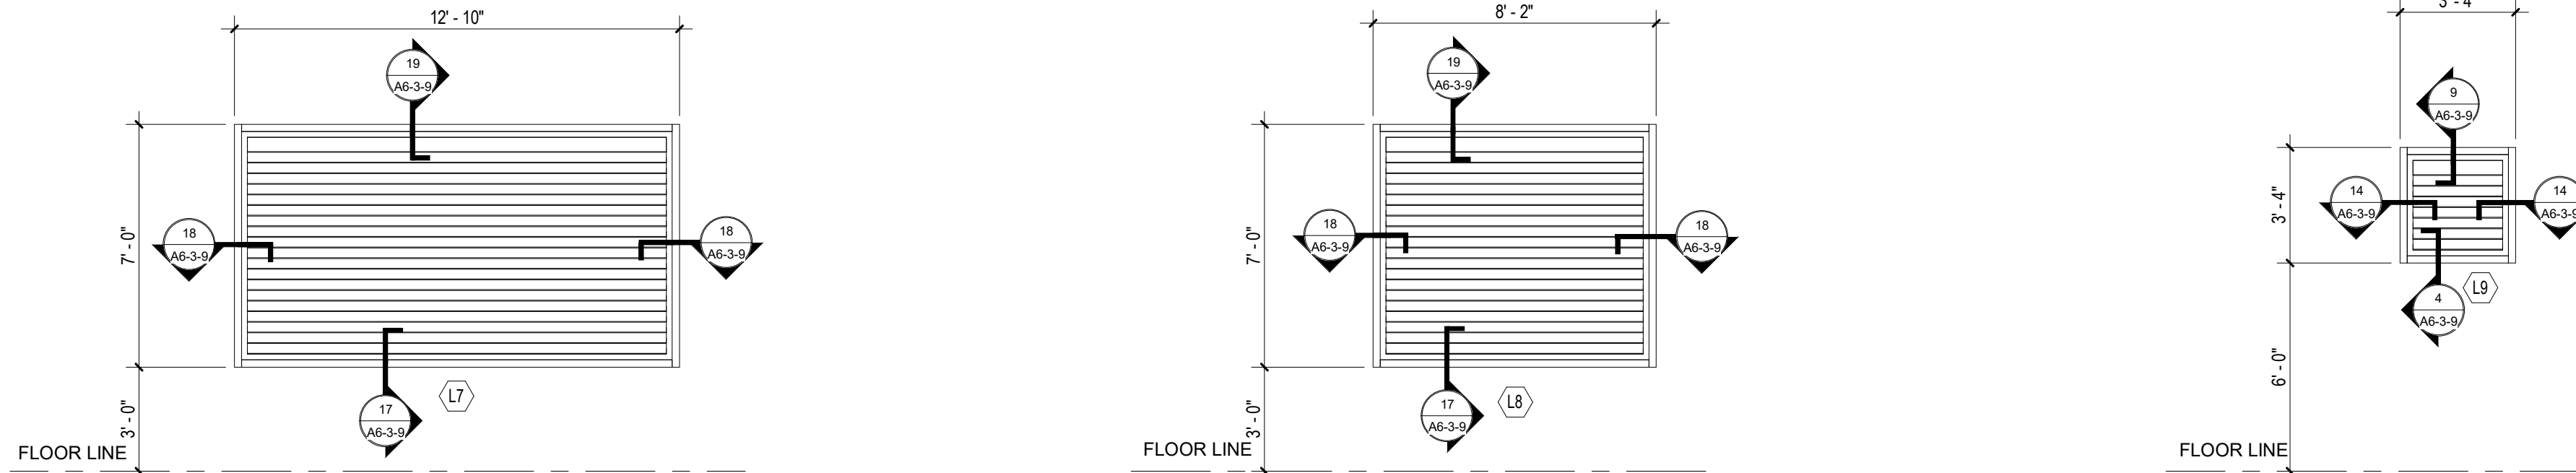

3 LOUVER TYPES
1/4" = 1'-0"

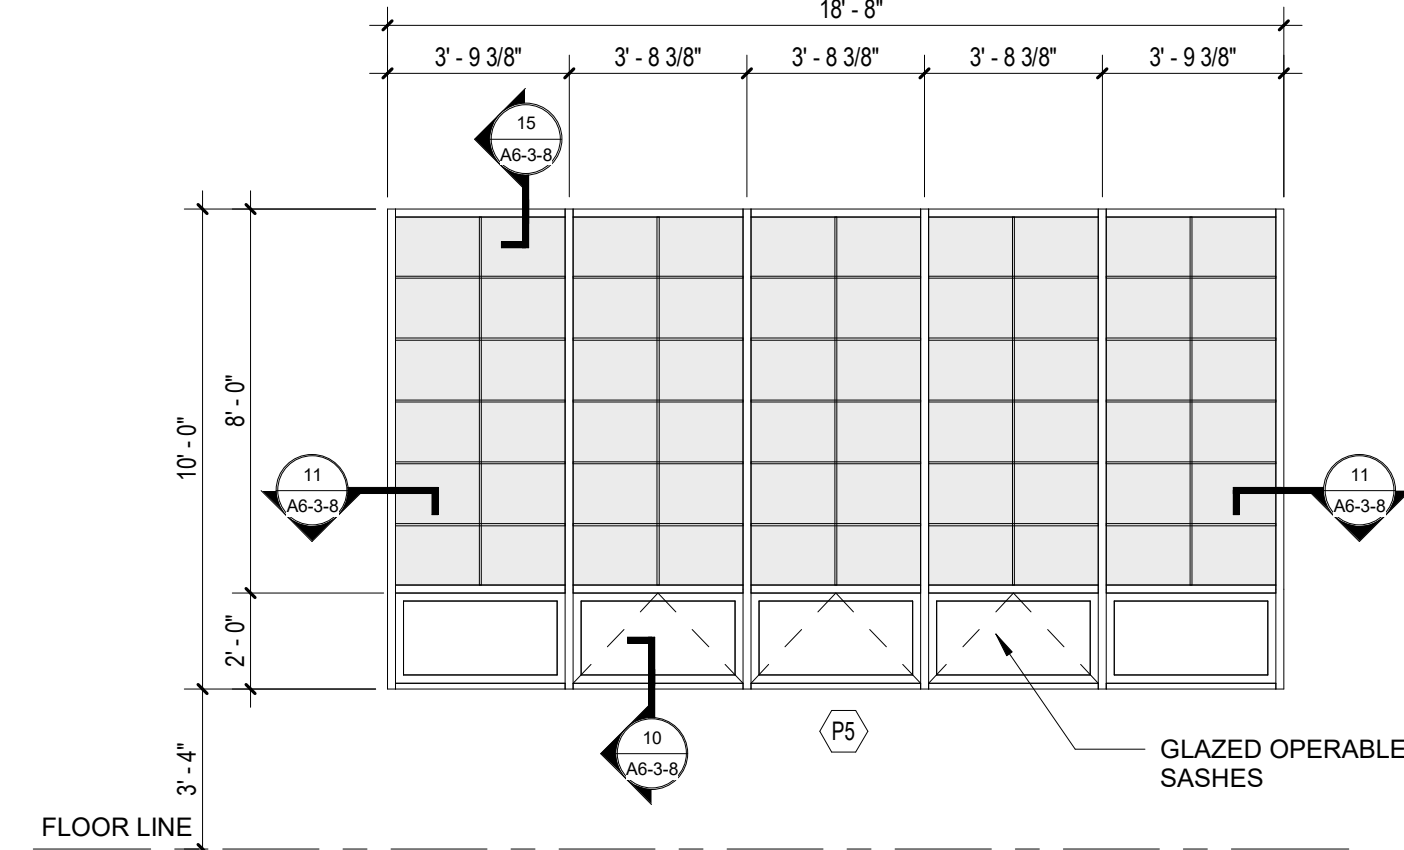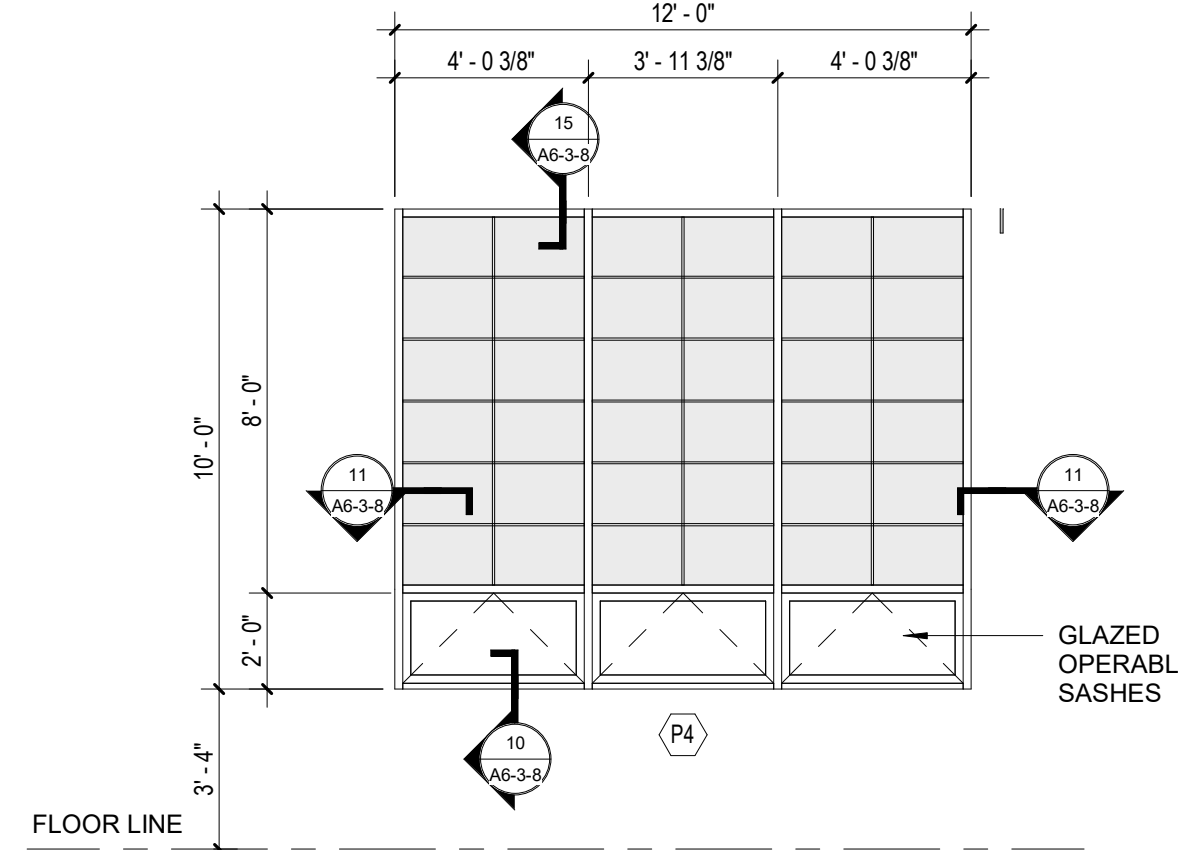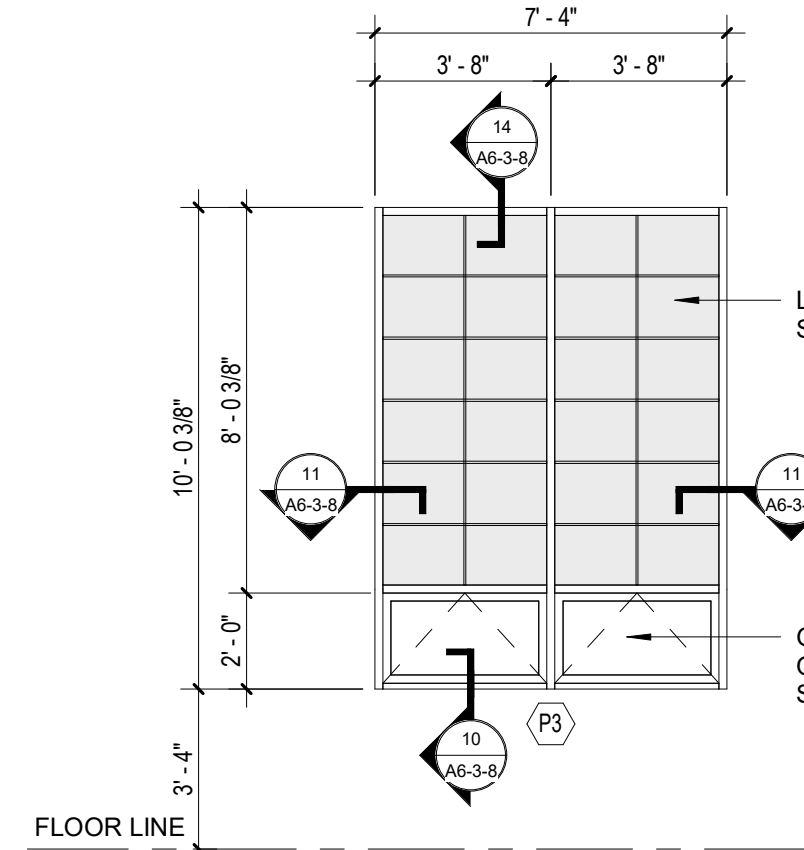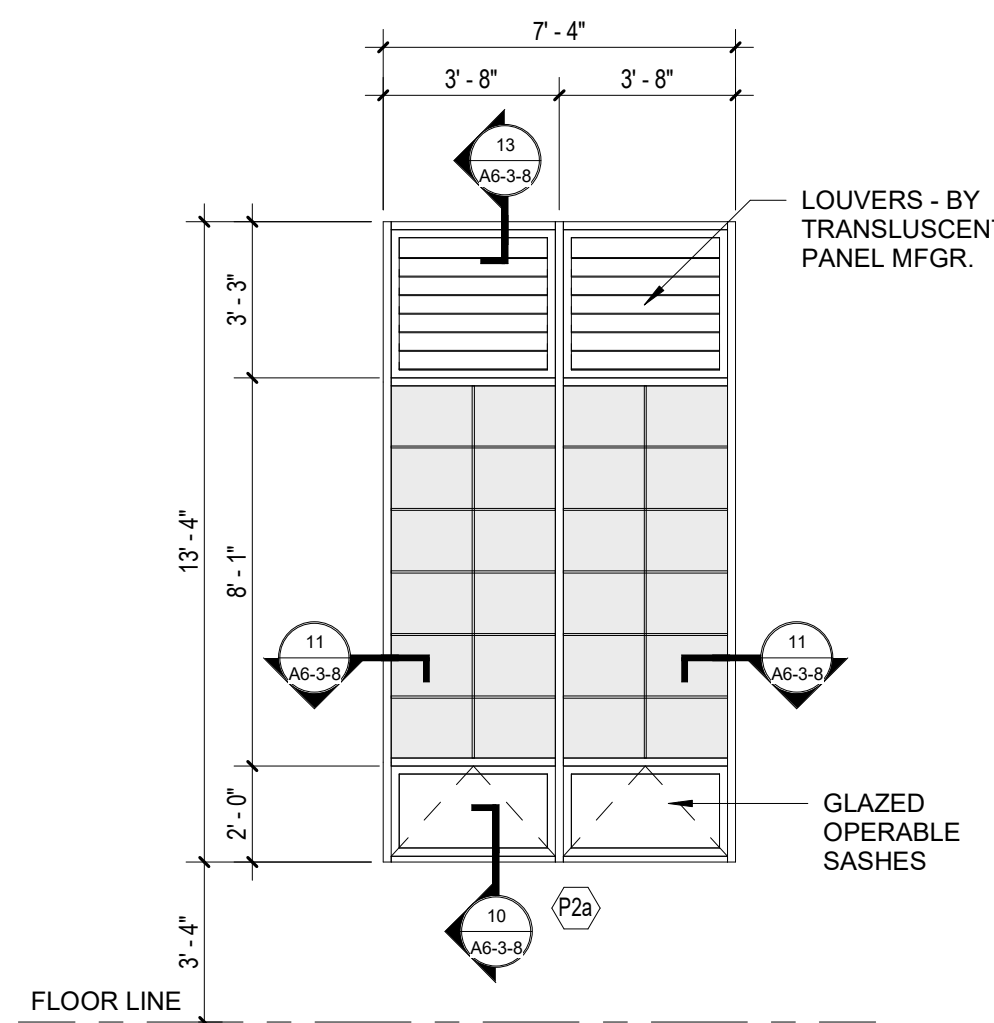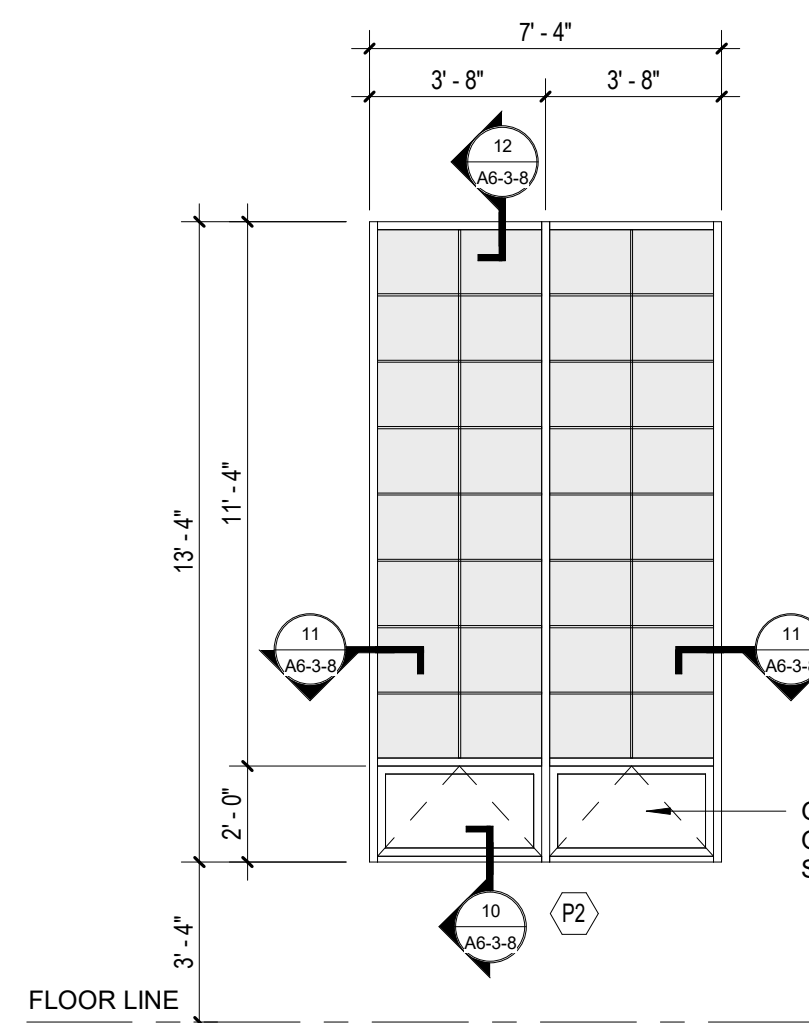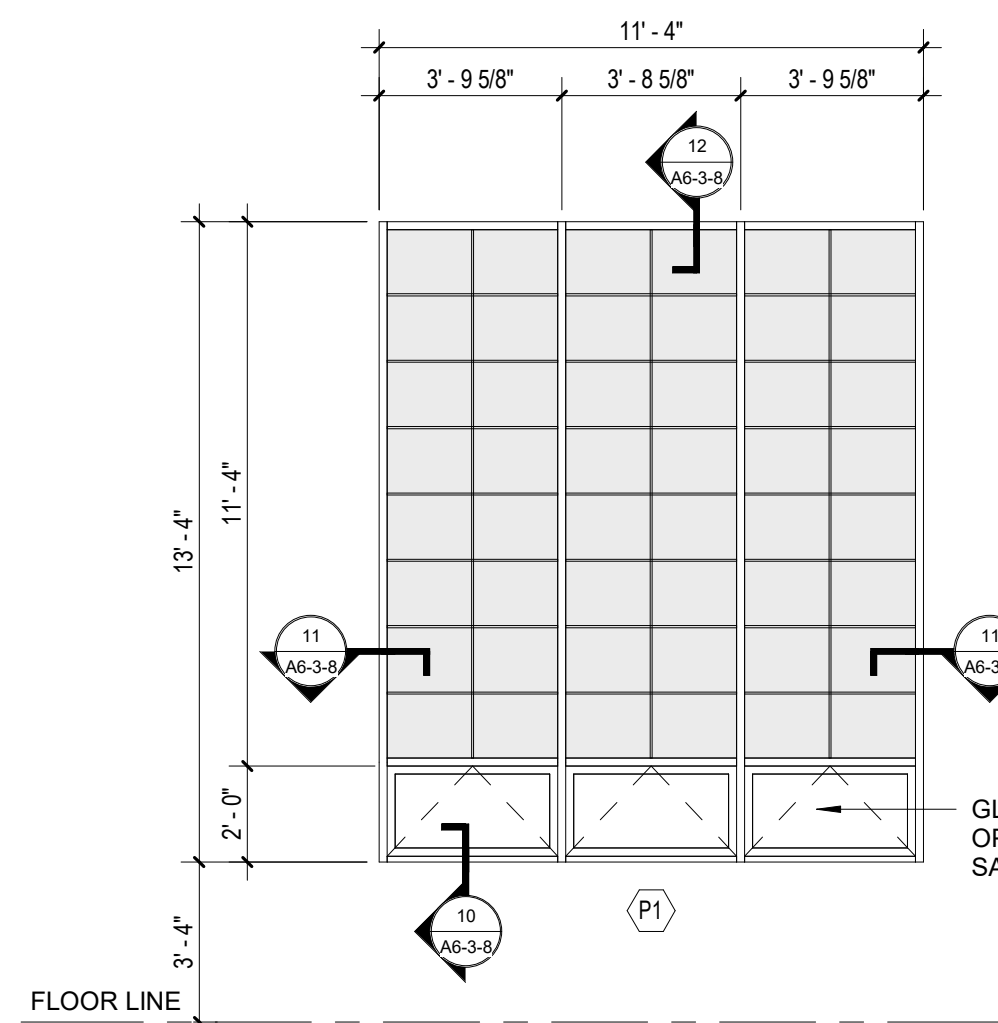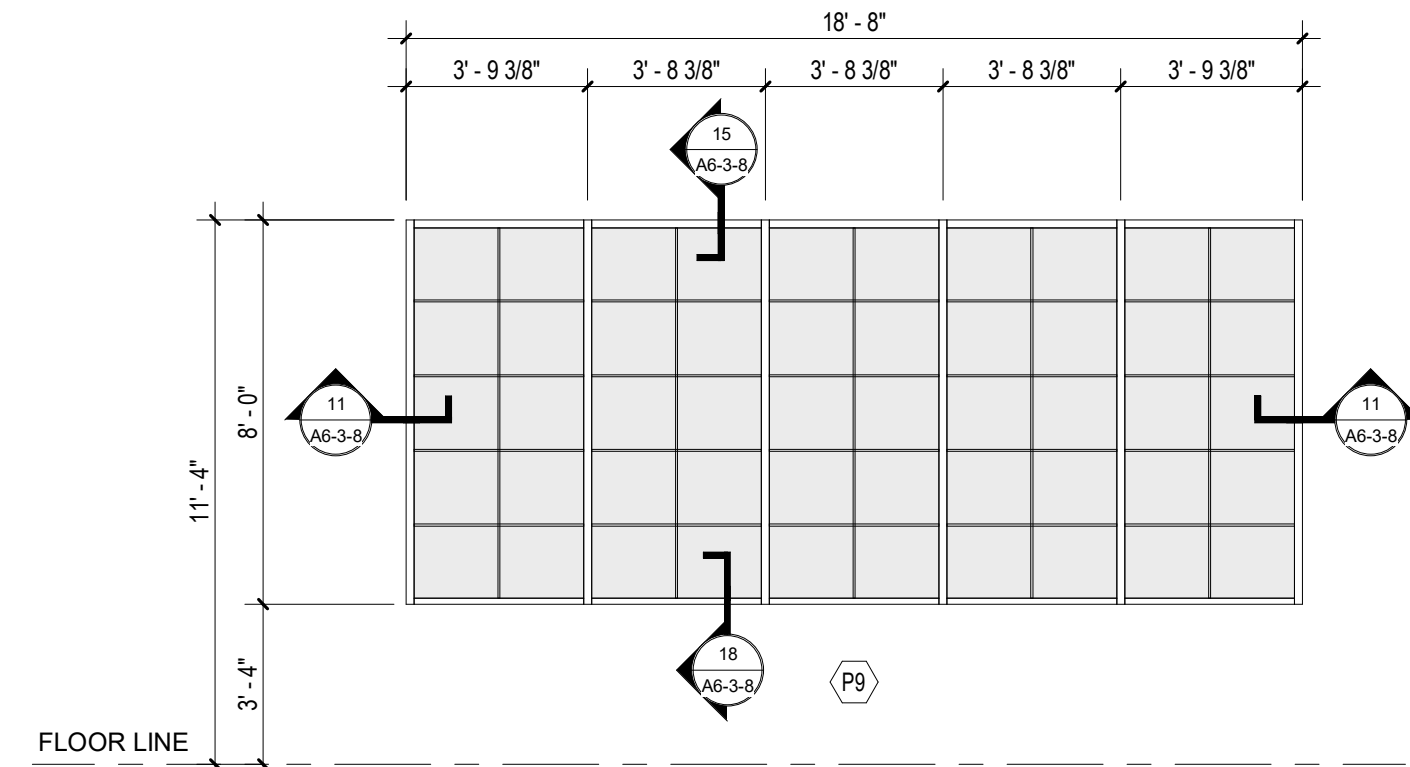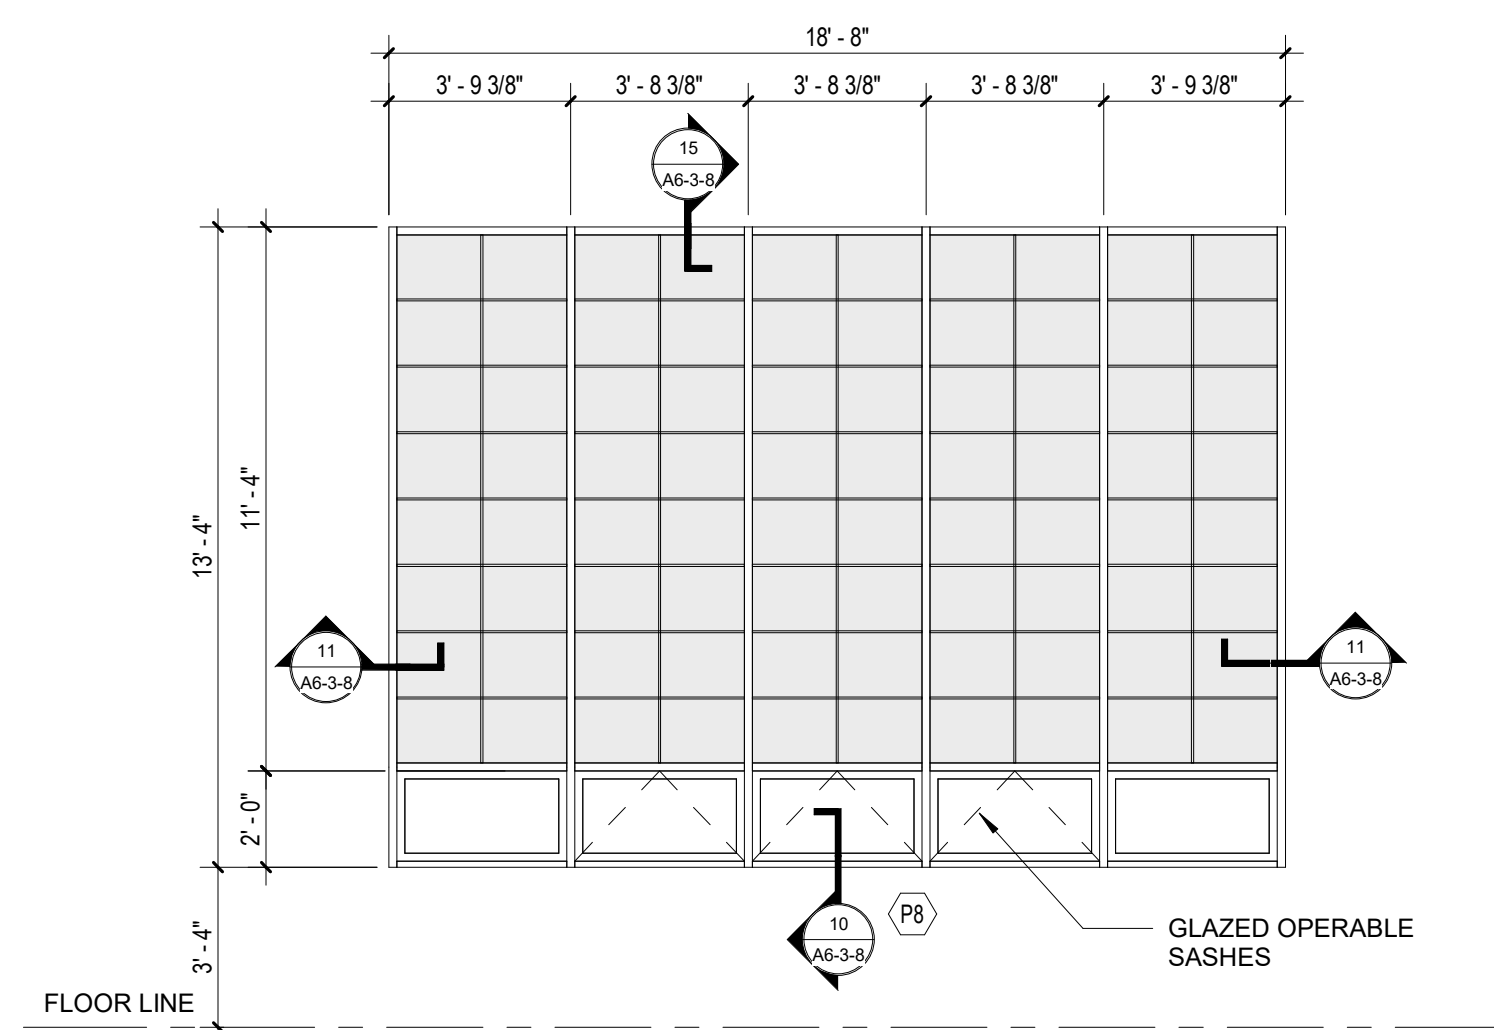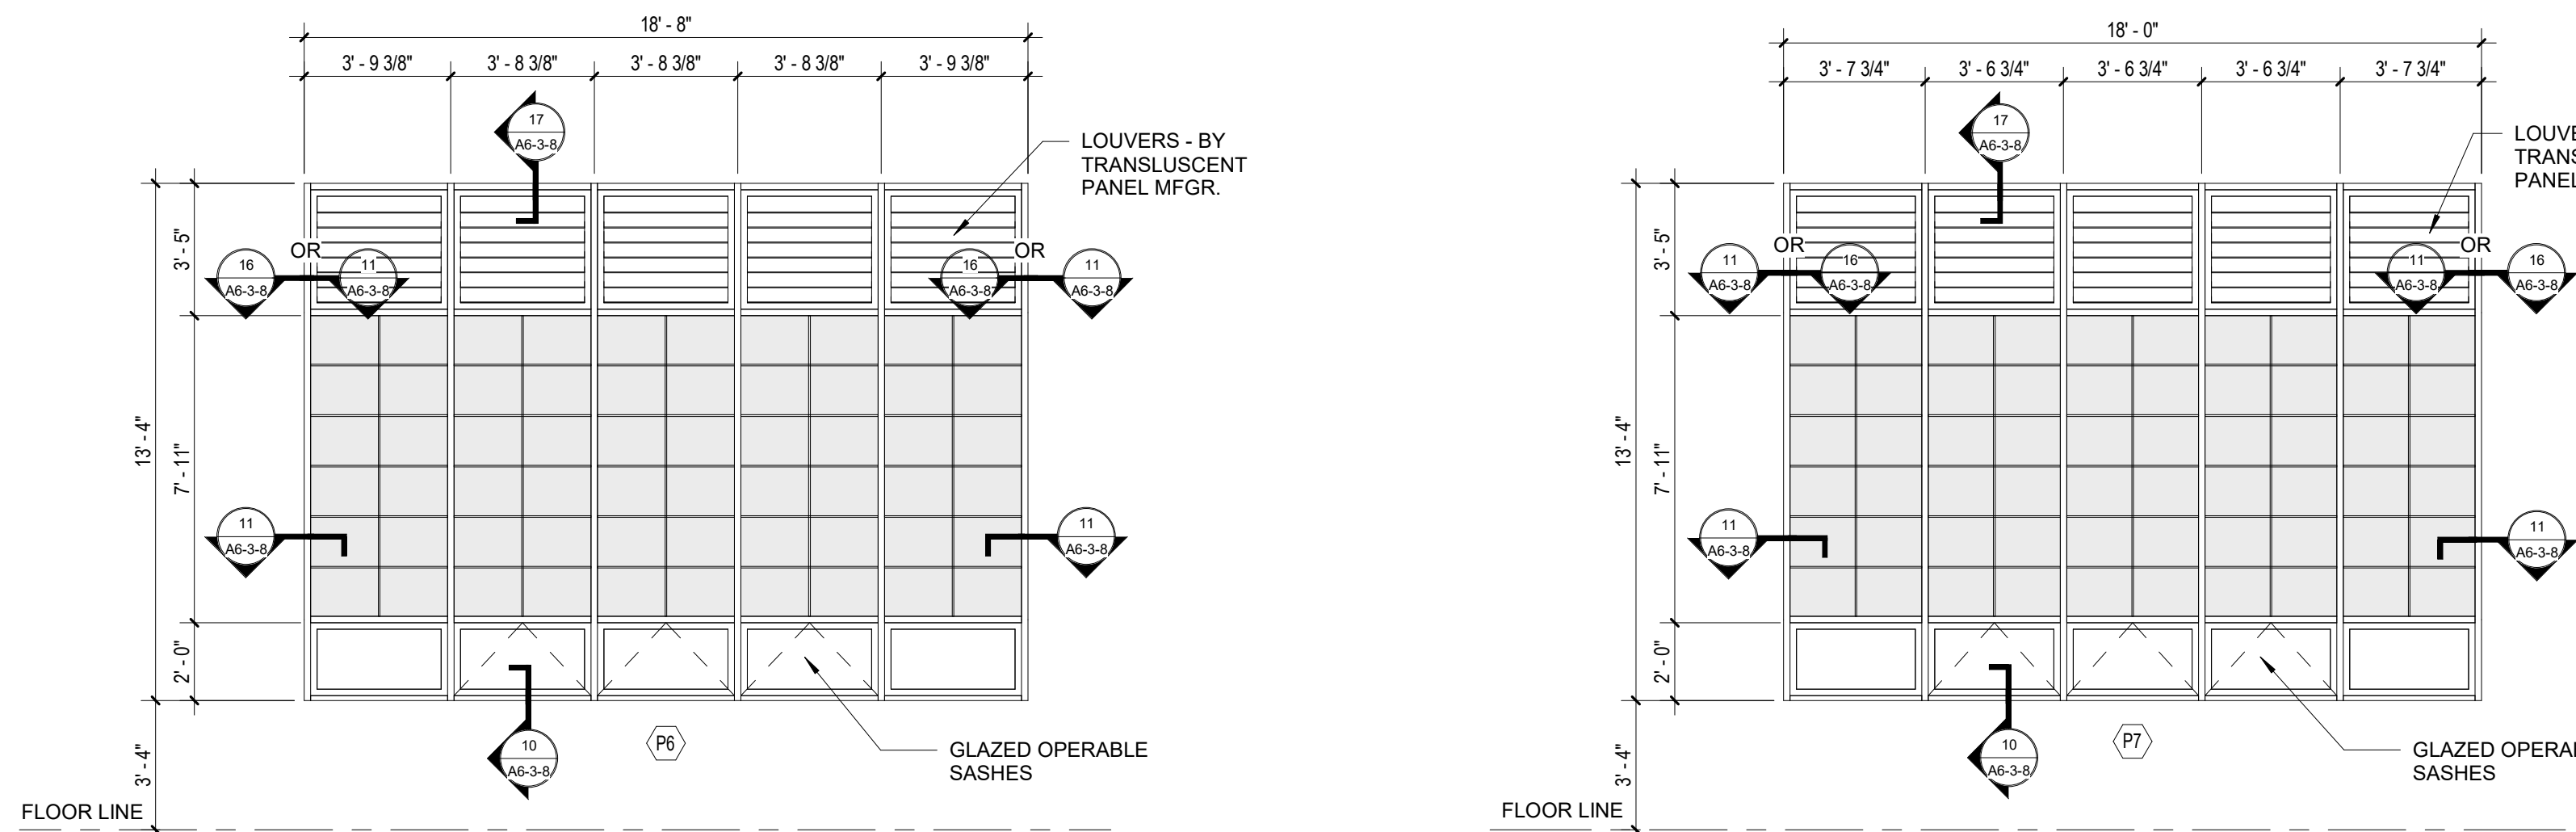


2 TRANSLUCENT WALL PANEL TYPES
1/4" = 1'-0"

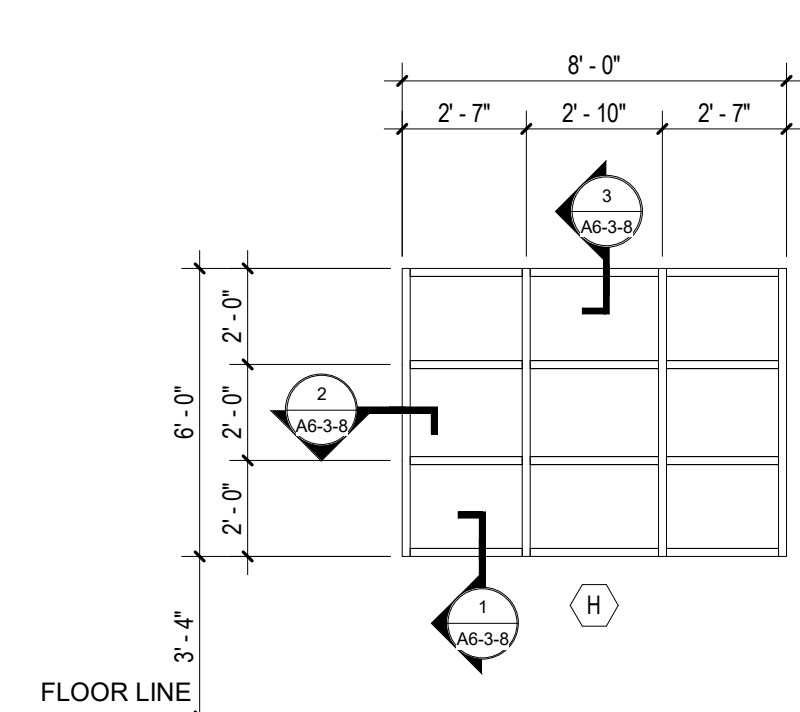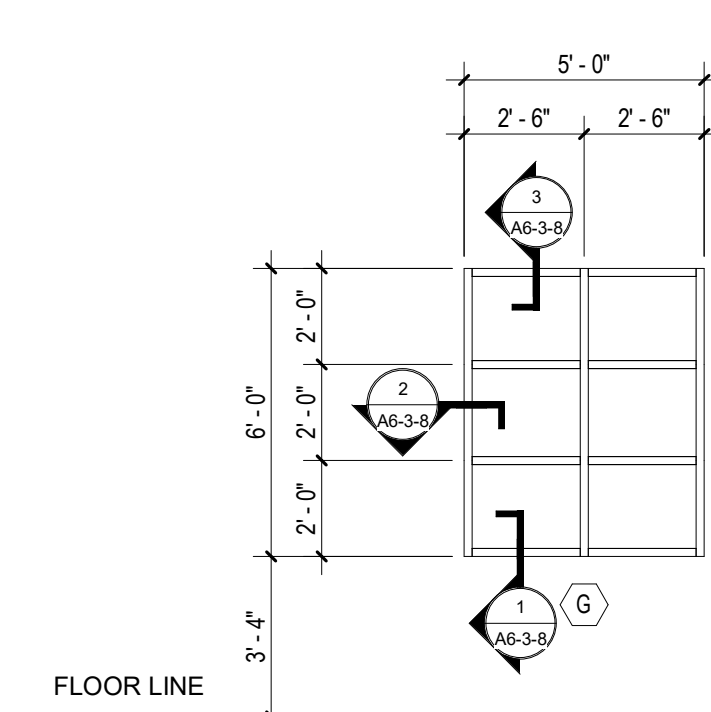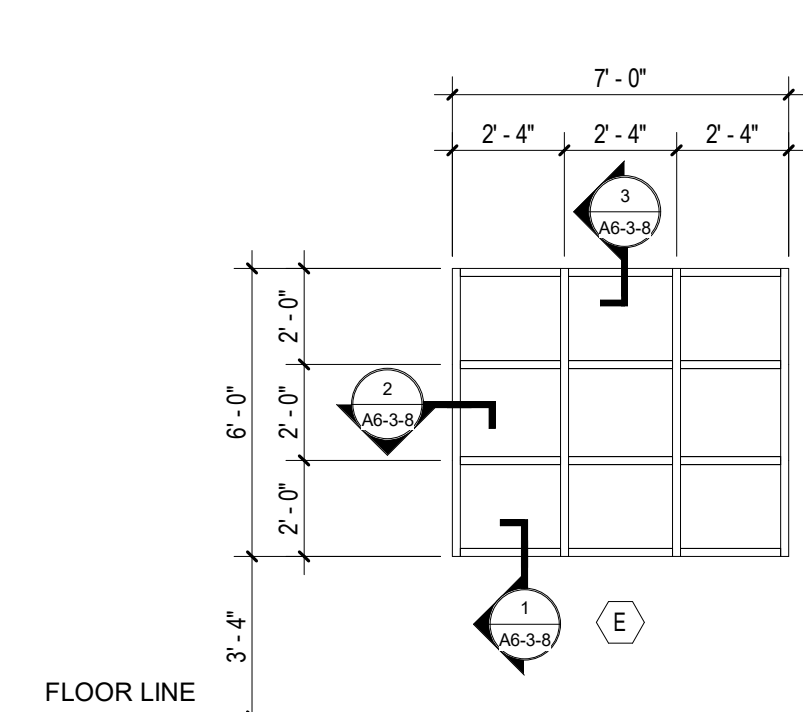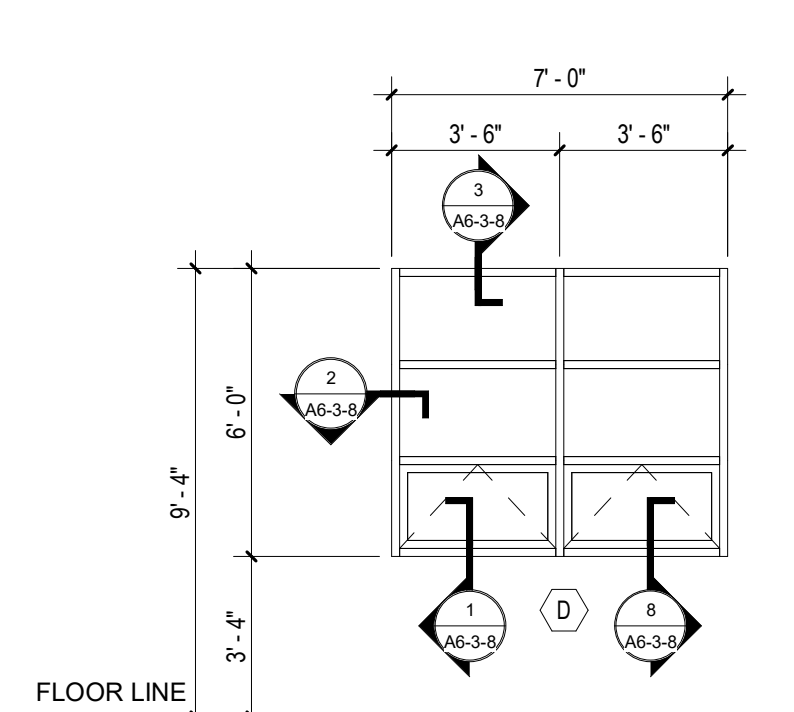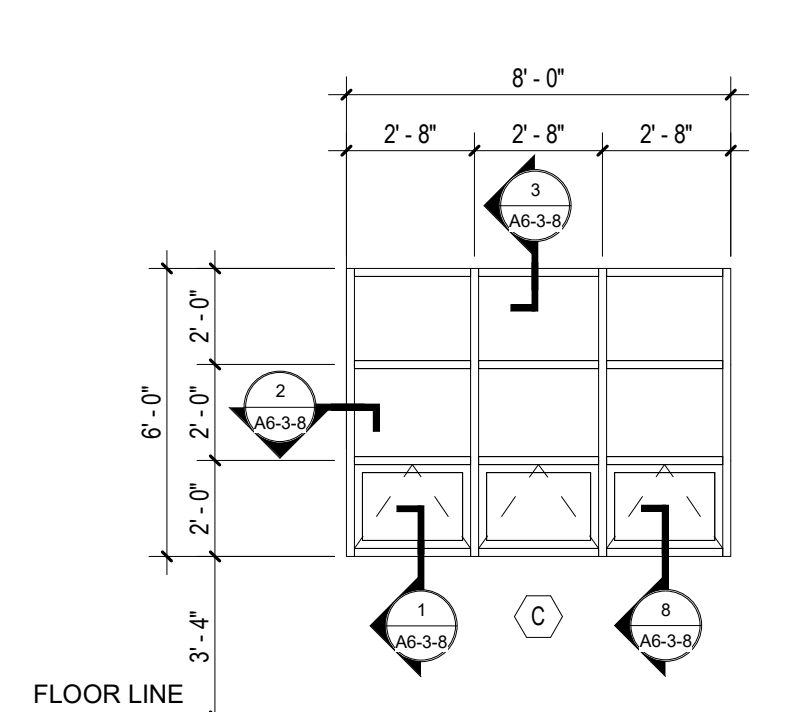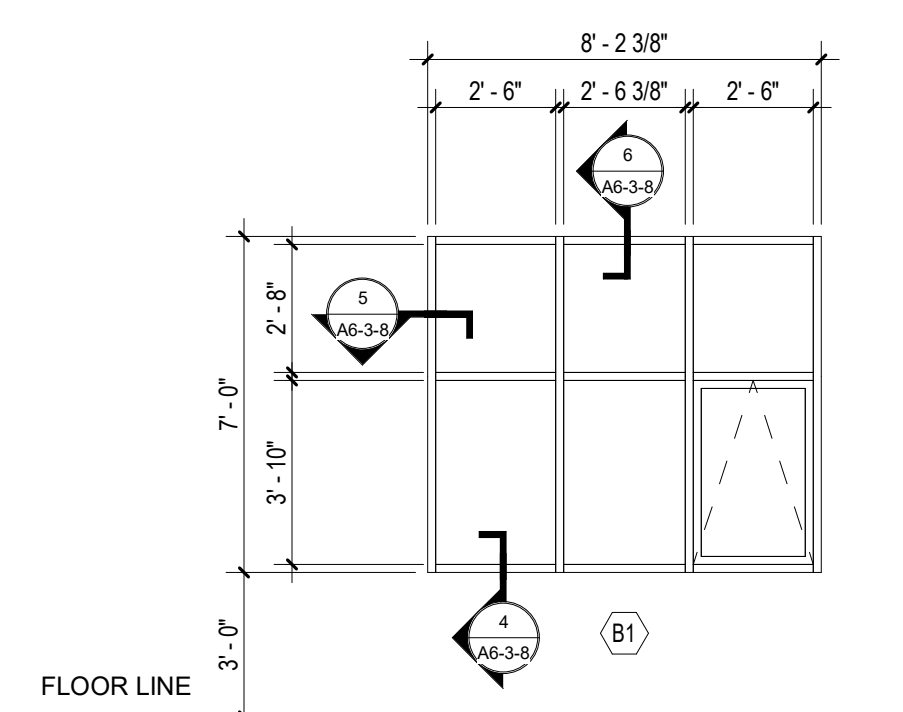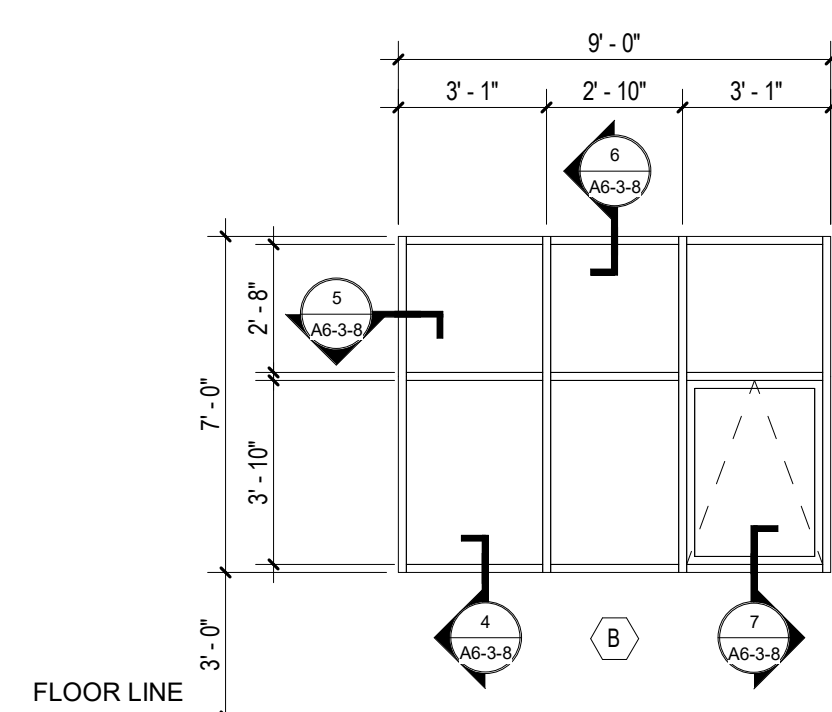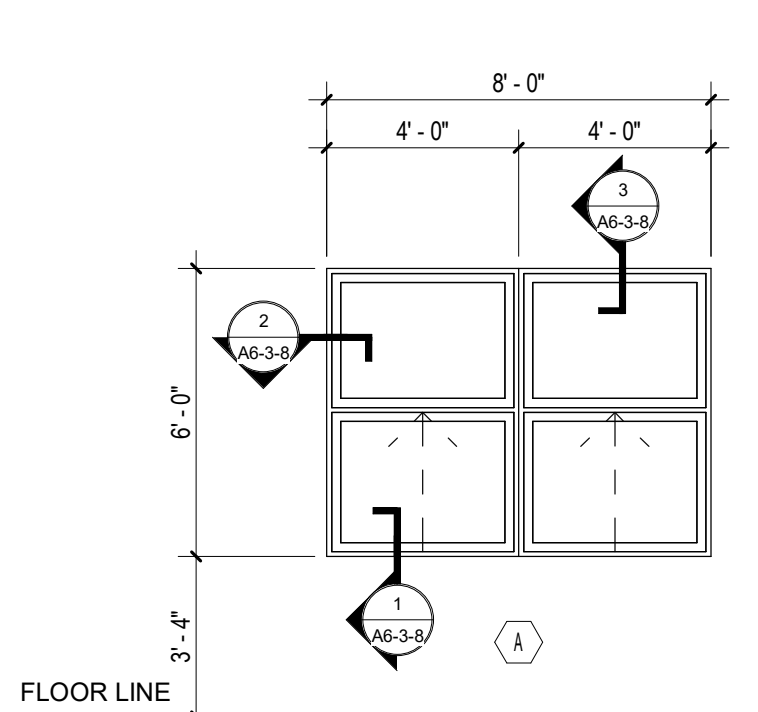

1 WINDOW TYPES
1/4" = 1'-0"

MSBA 90% CD
SUBMISSION
May 12TH, 2023

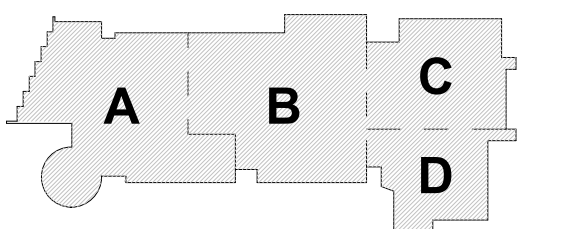

KEY PLAN
PROJECT NORTH
MAGNETIC NORTH

**WINDOW,
TRANSLUCENT
WALL PANEL
AND LOUVER
TYPES**


Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A6-3-1


- GENERAL NOTES - STOREFRONT / CURTAIN WALL TYPES
- INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
 - EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
 - AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION BEHIND ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
 - PROVIDE SAFETY GLAZING AT ALL LOCATIONS IDENTIFIED AS HAZARDOUS LOCATIONS PER THE 9TH EDITION OF THE MASSACHUSETTS STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
 - PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS.
 - "SG" DENOTES LOCATION OF SAFETY GLAZING.
 - SEE DOOR SCHEDULE FOR DOOR TYPES.

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

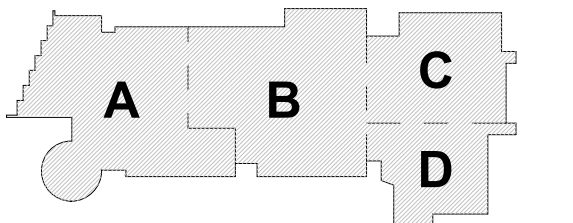









KEY PLAN













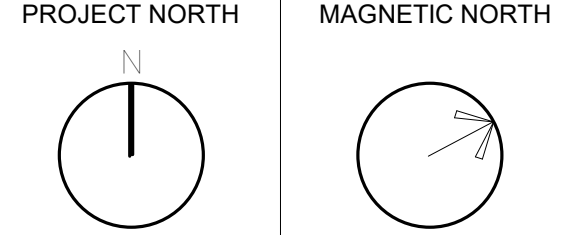


**CURTAIN WALL
TYPES**

Scale: As Indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A6-3-2

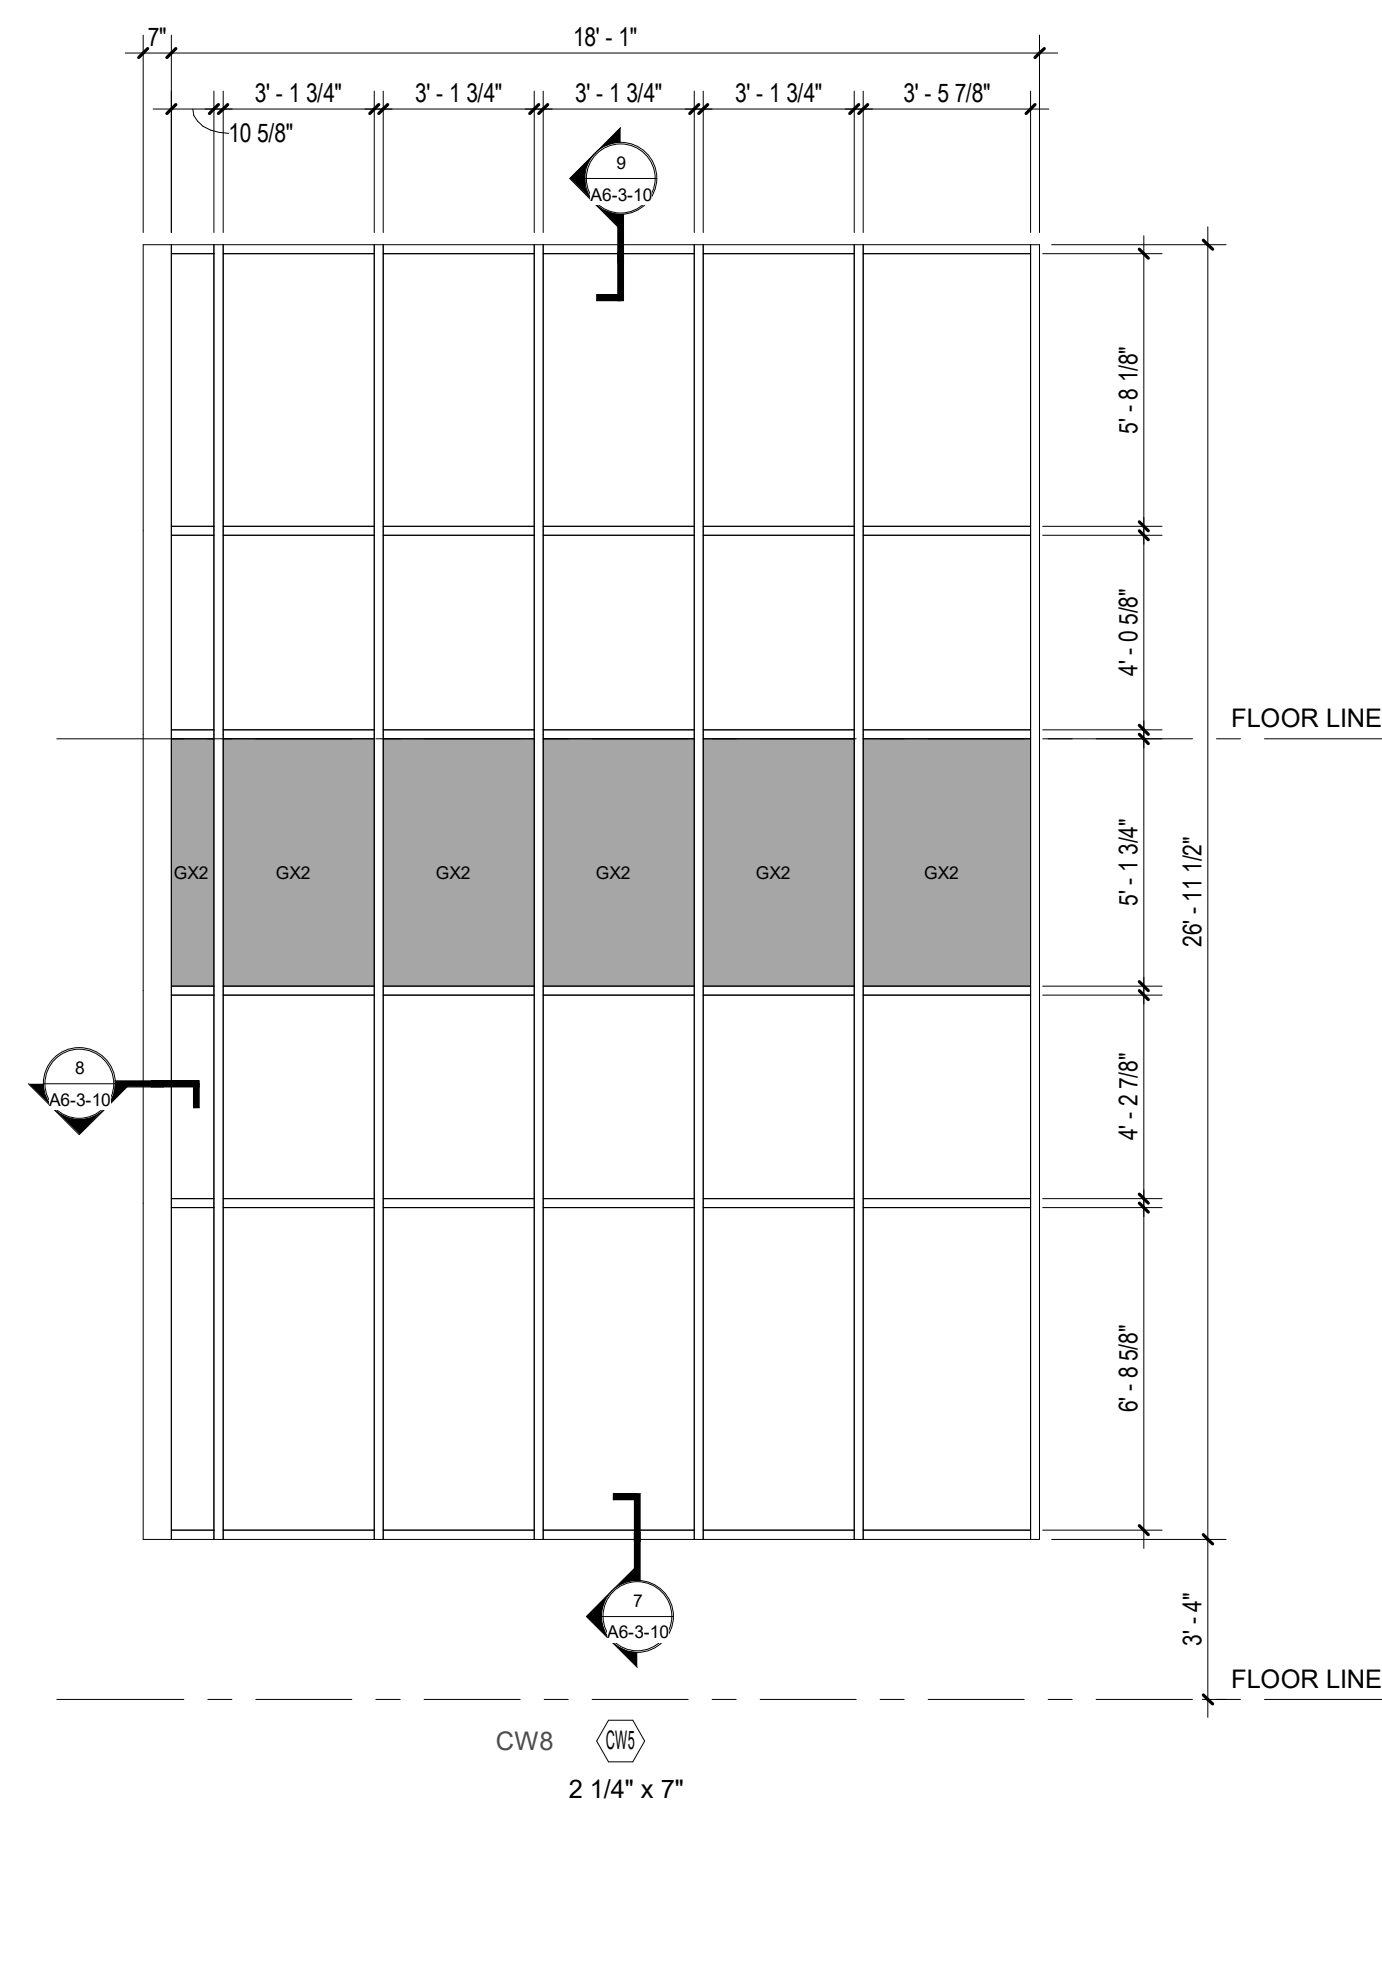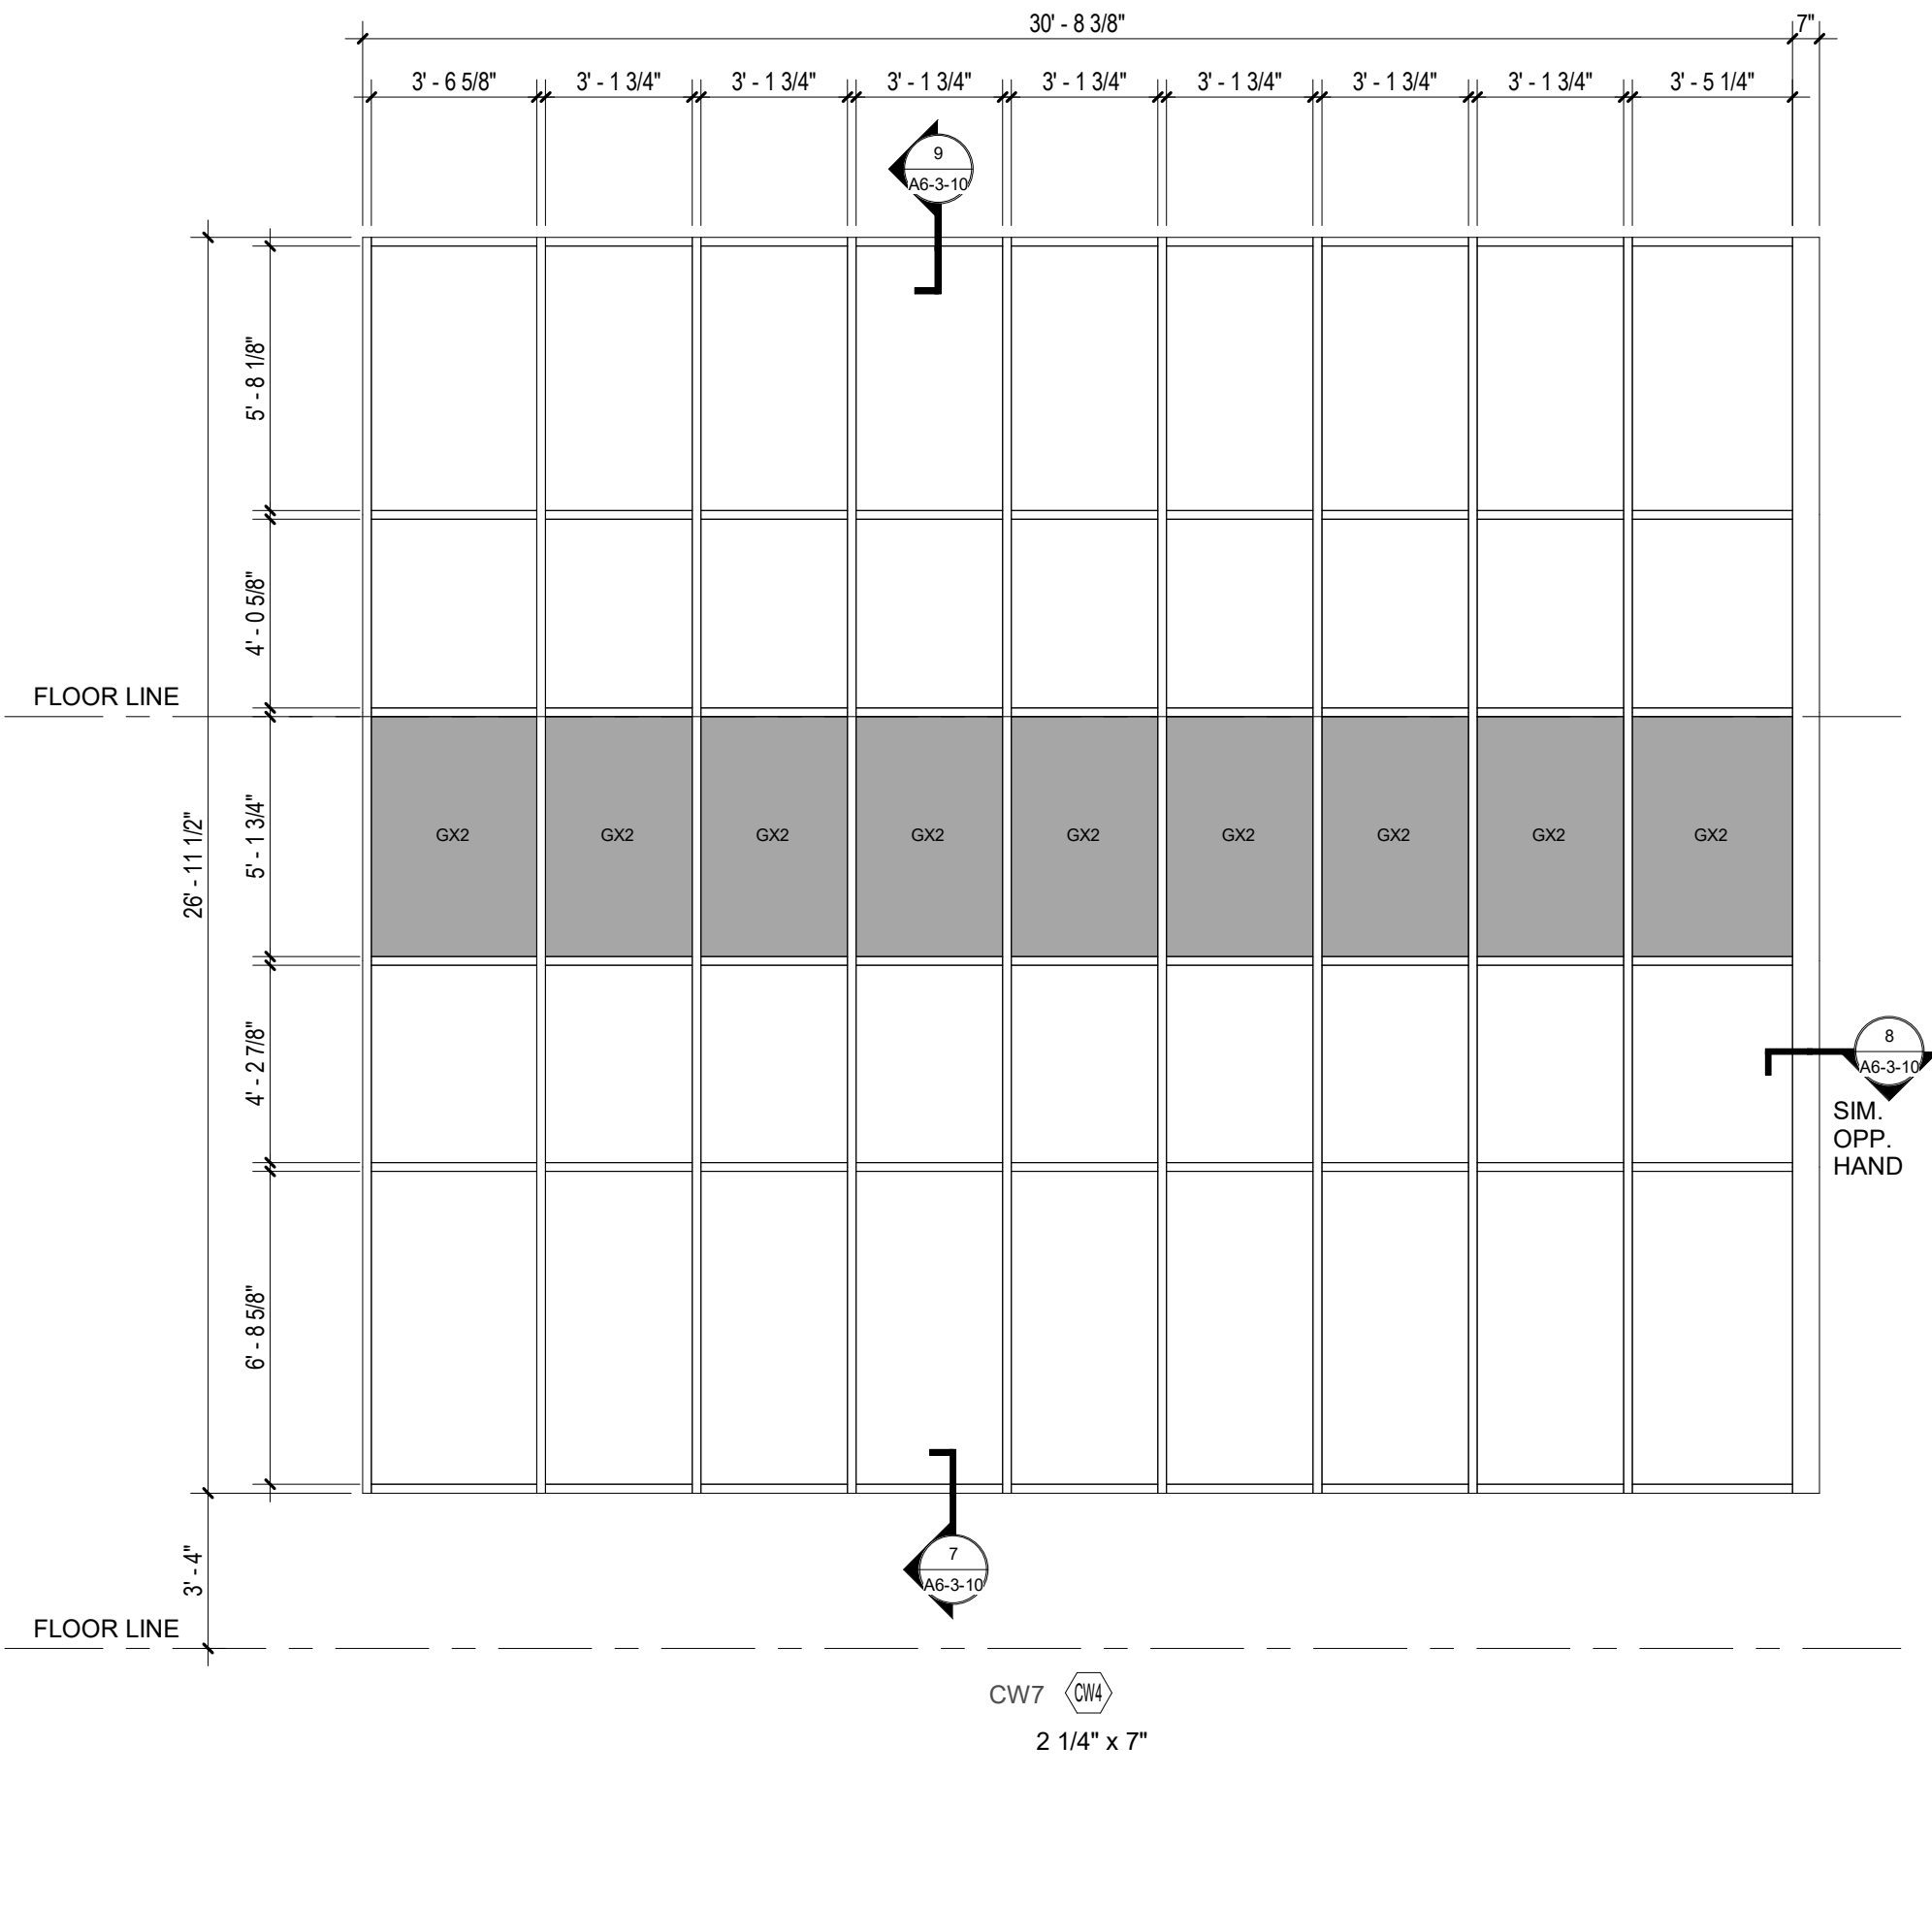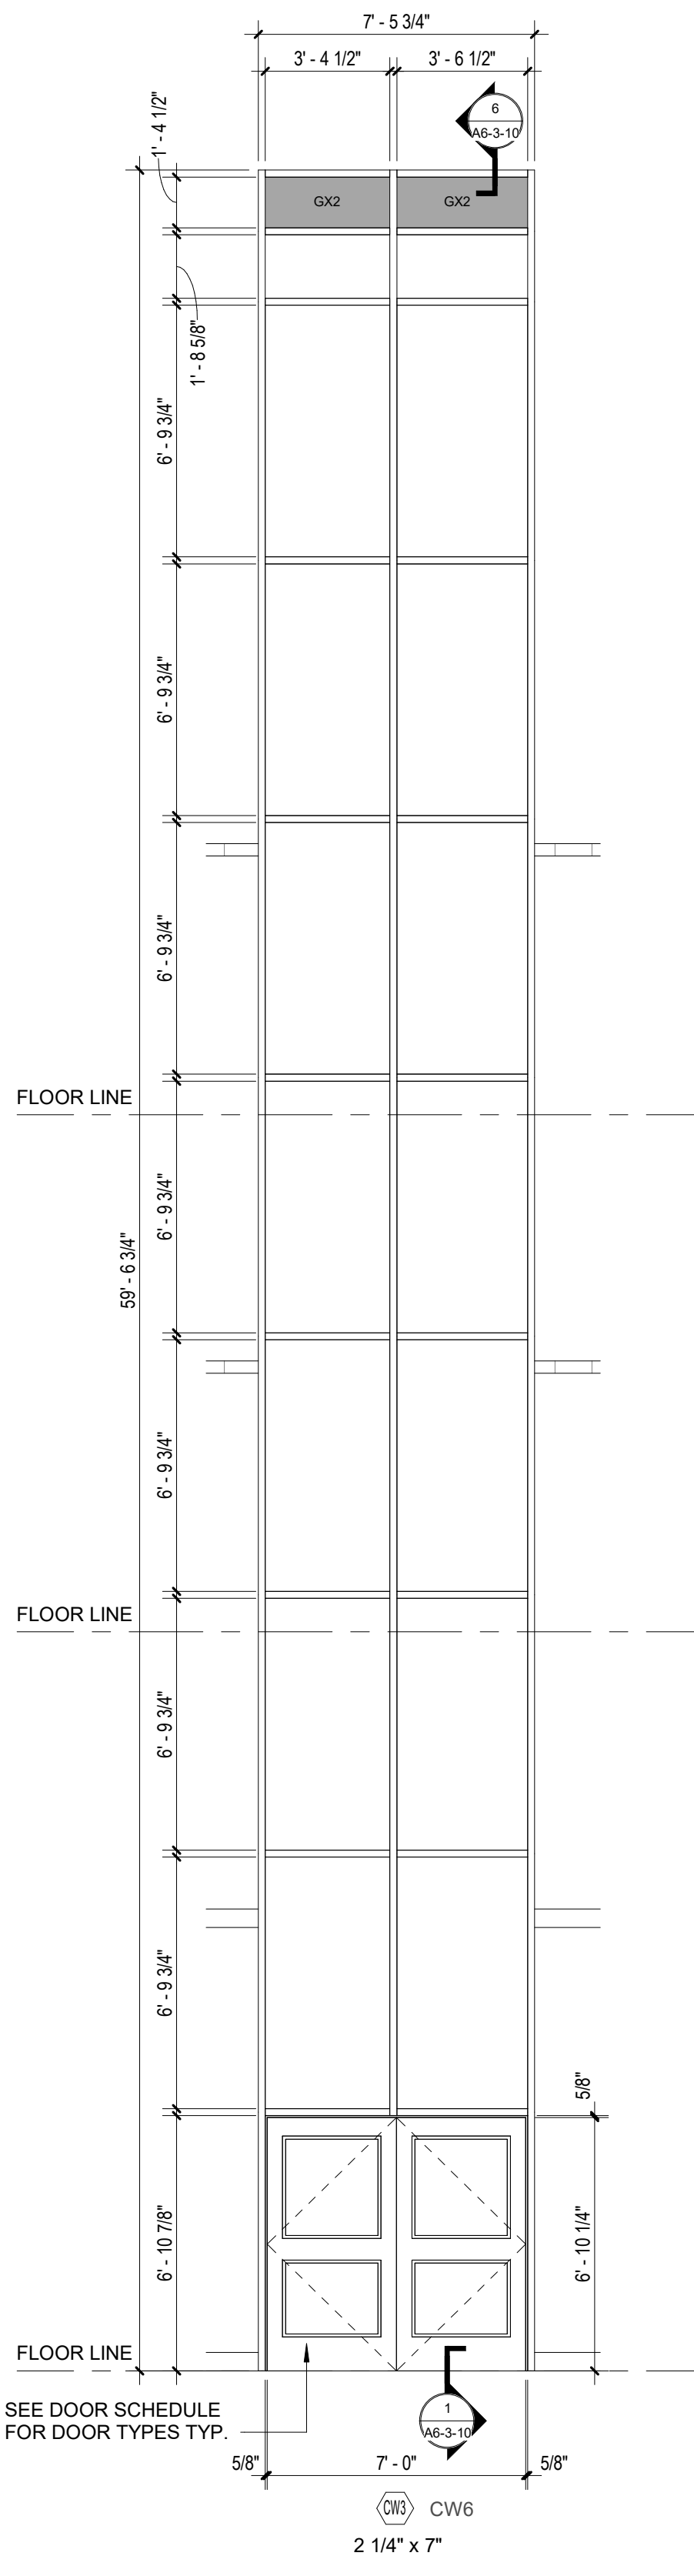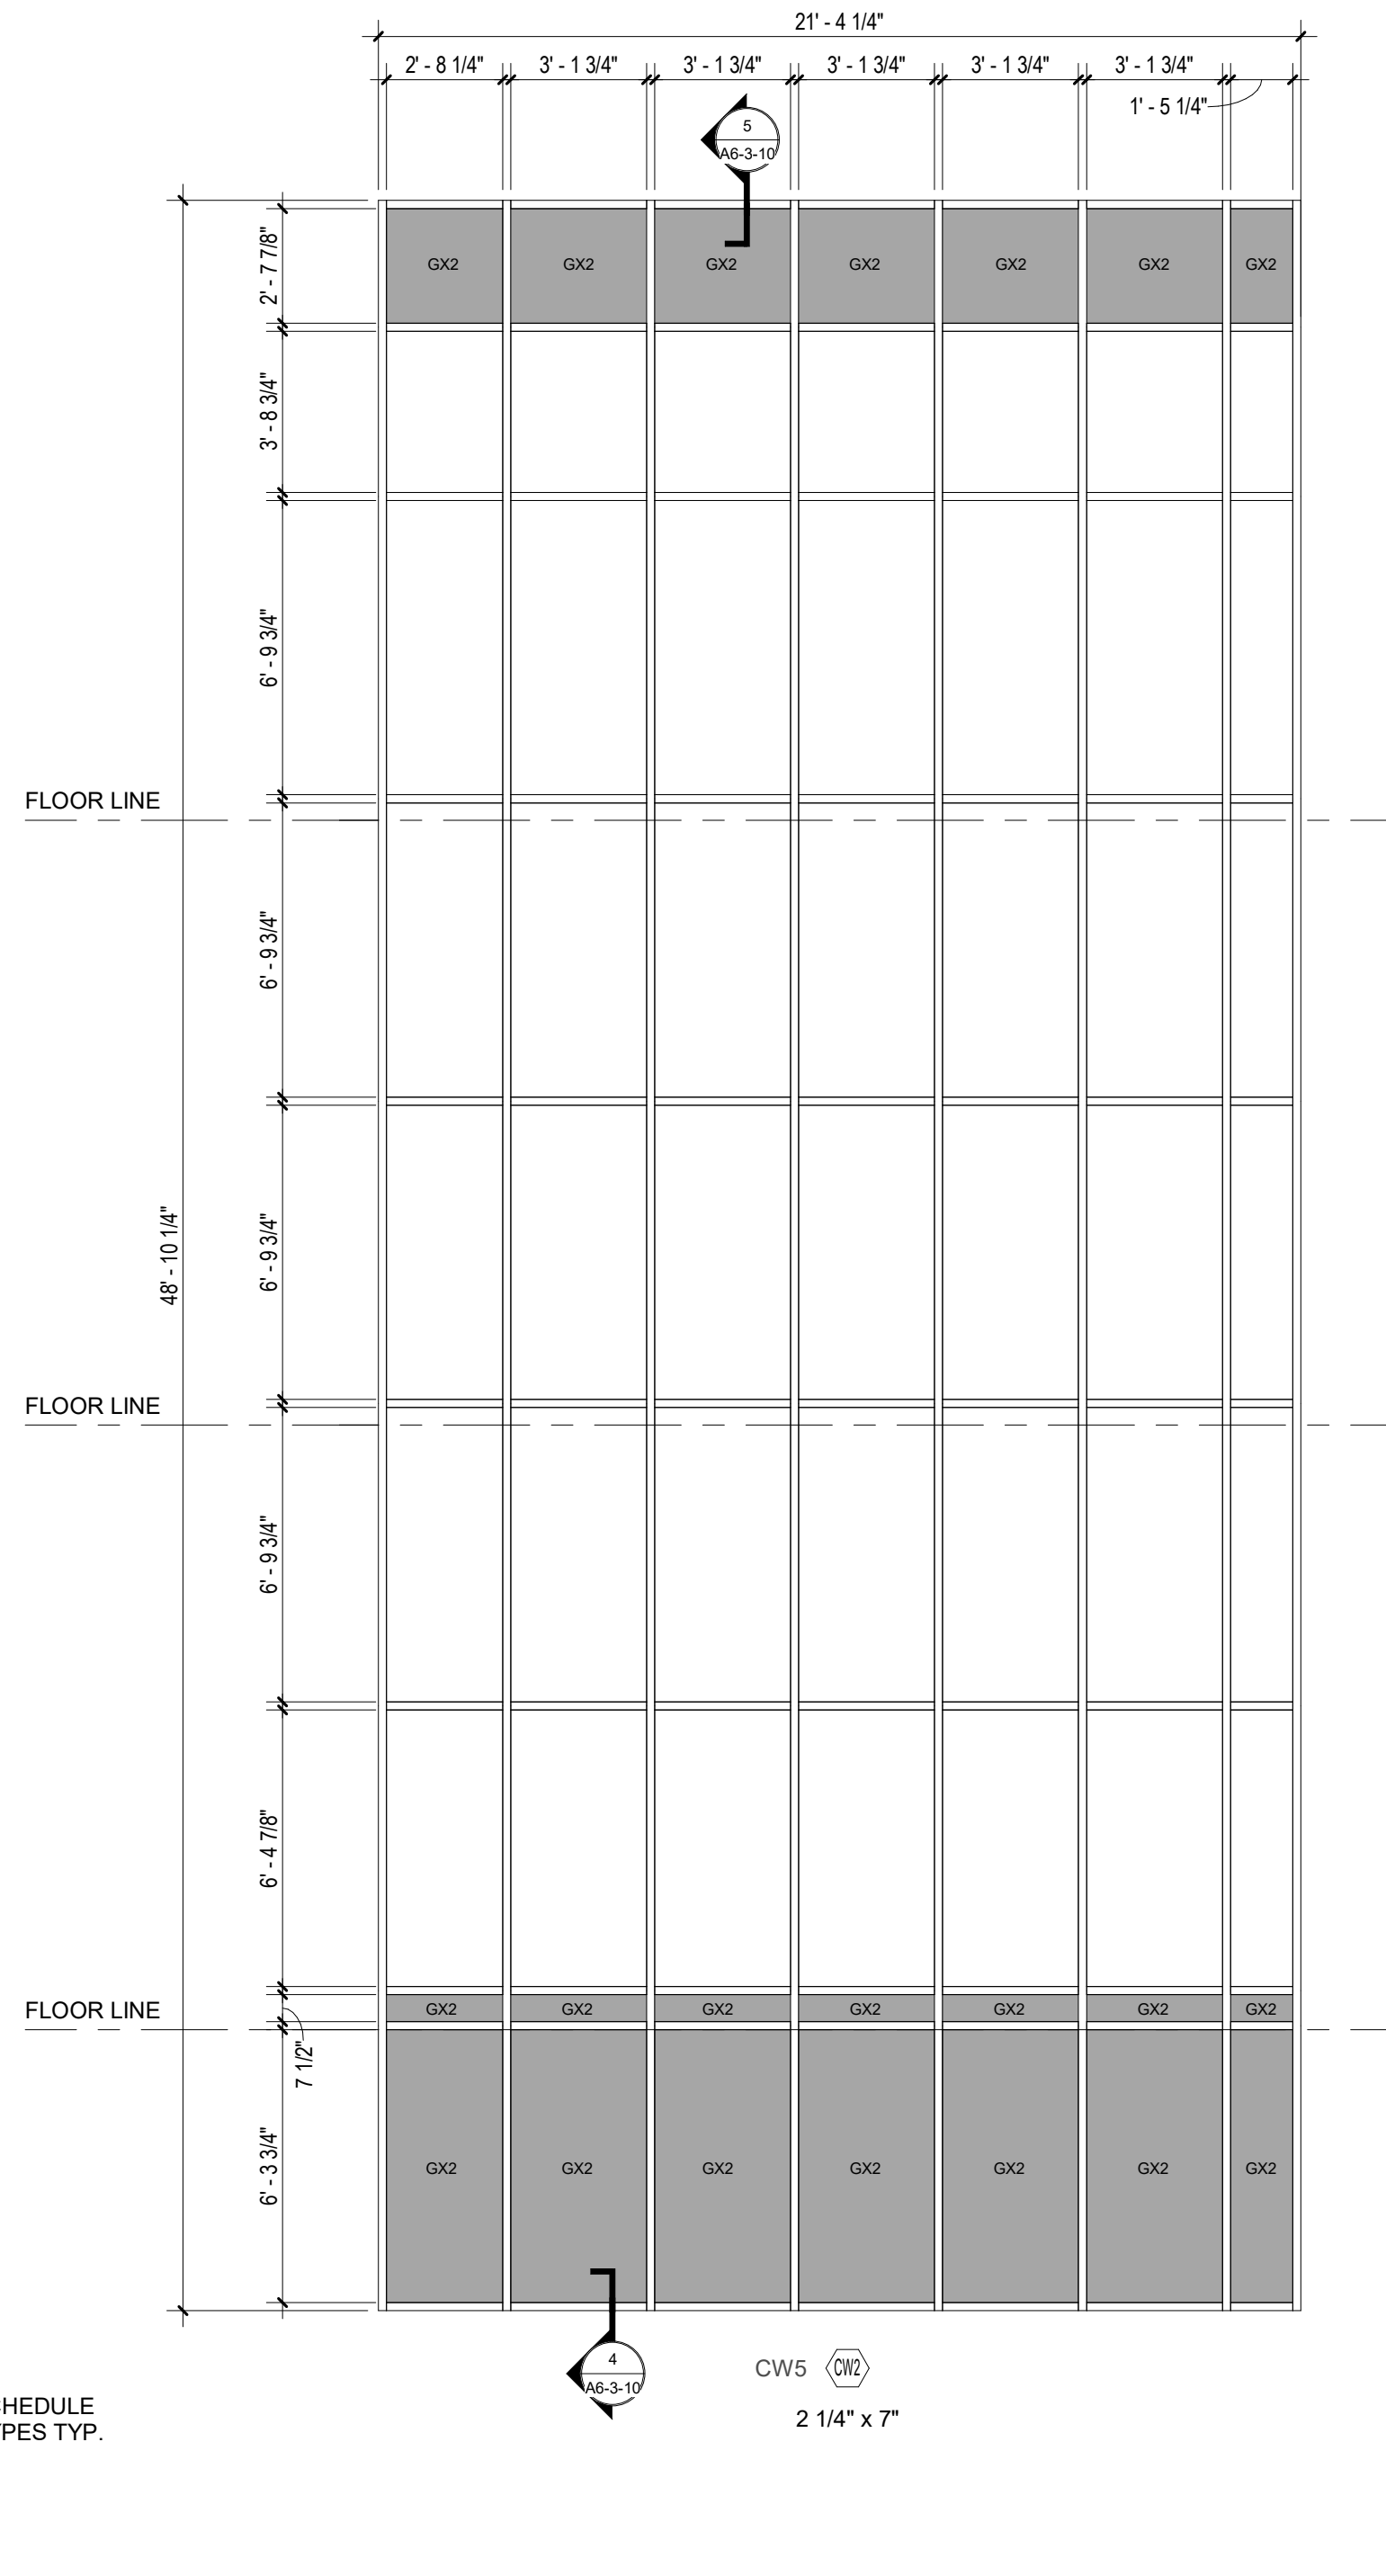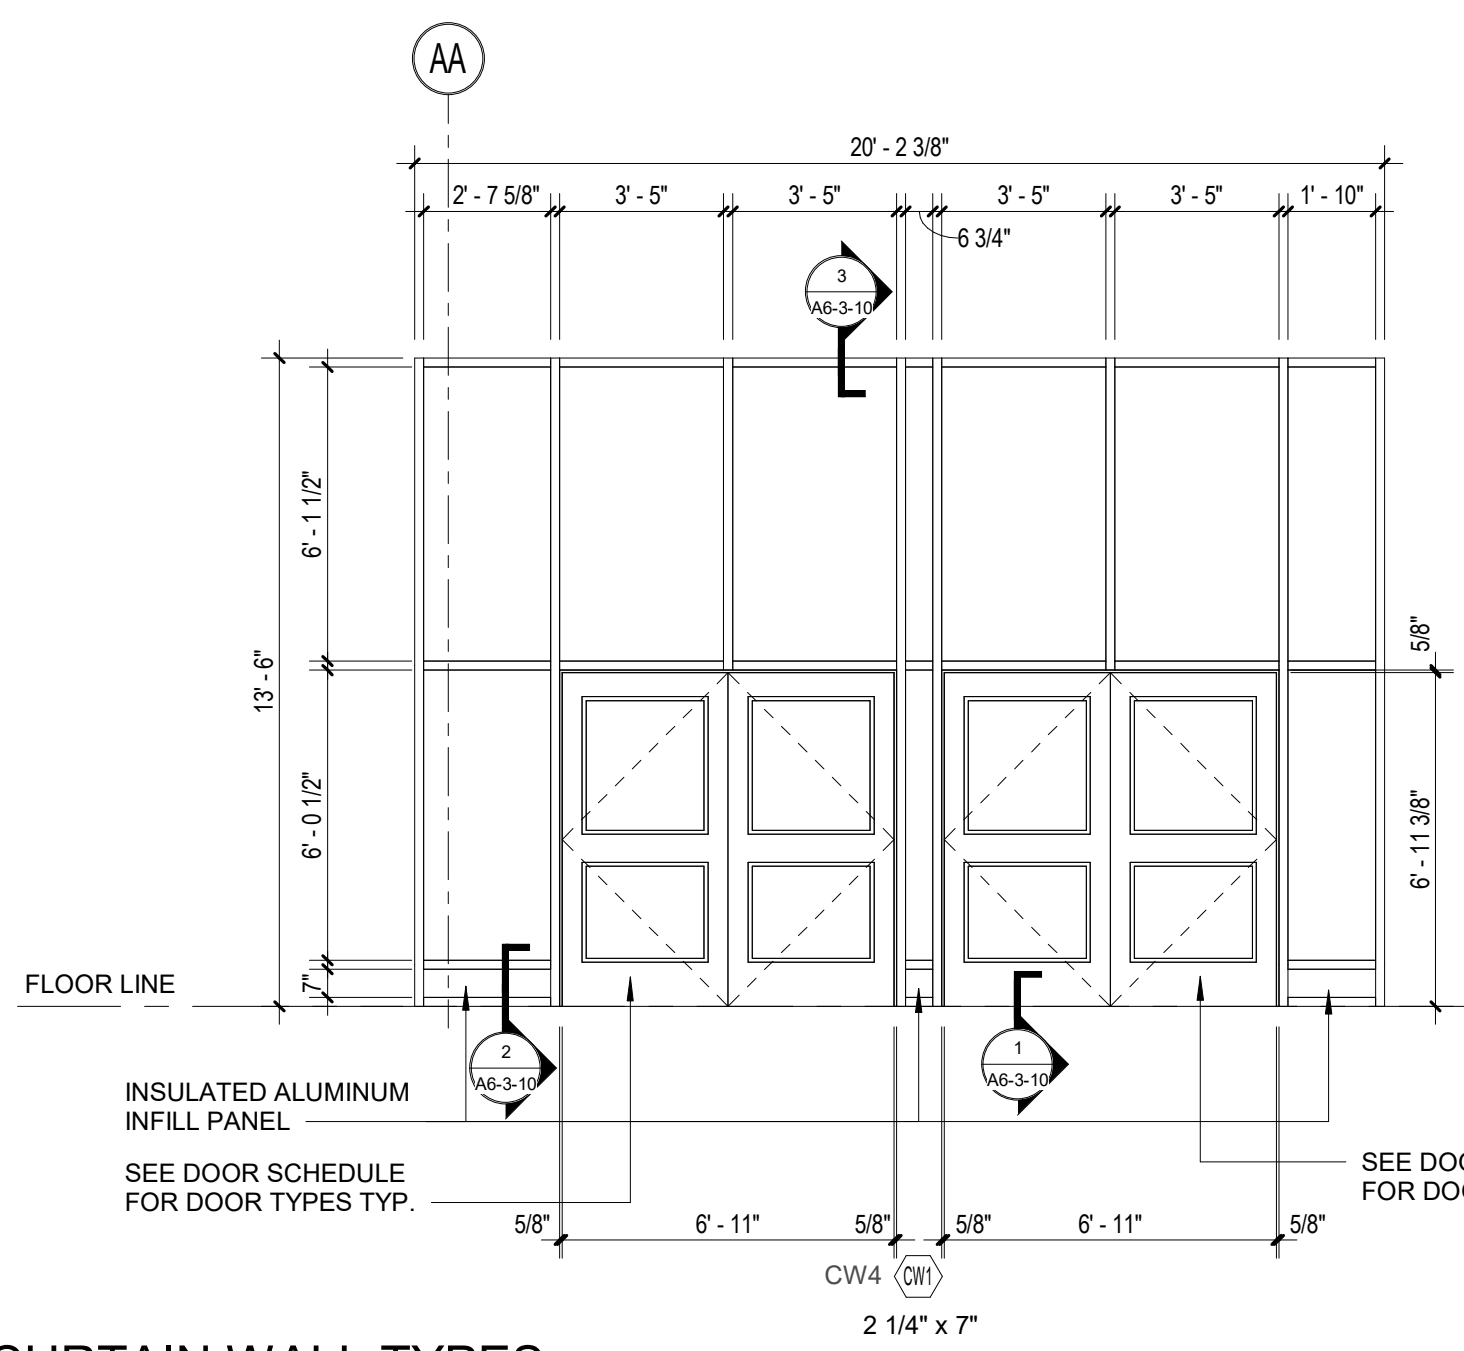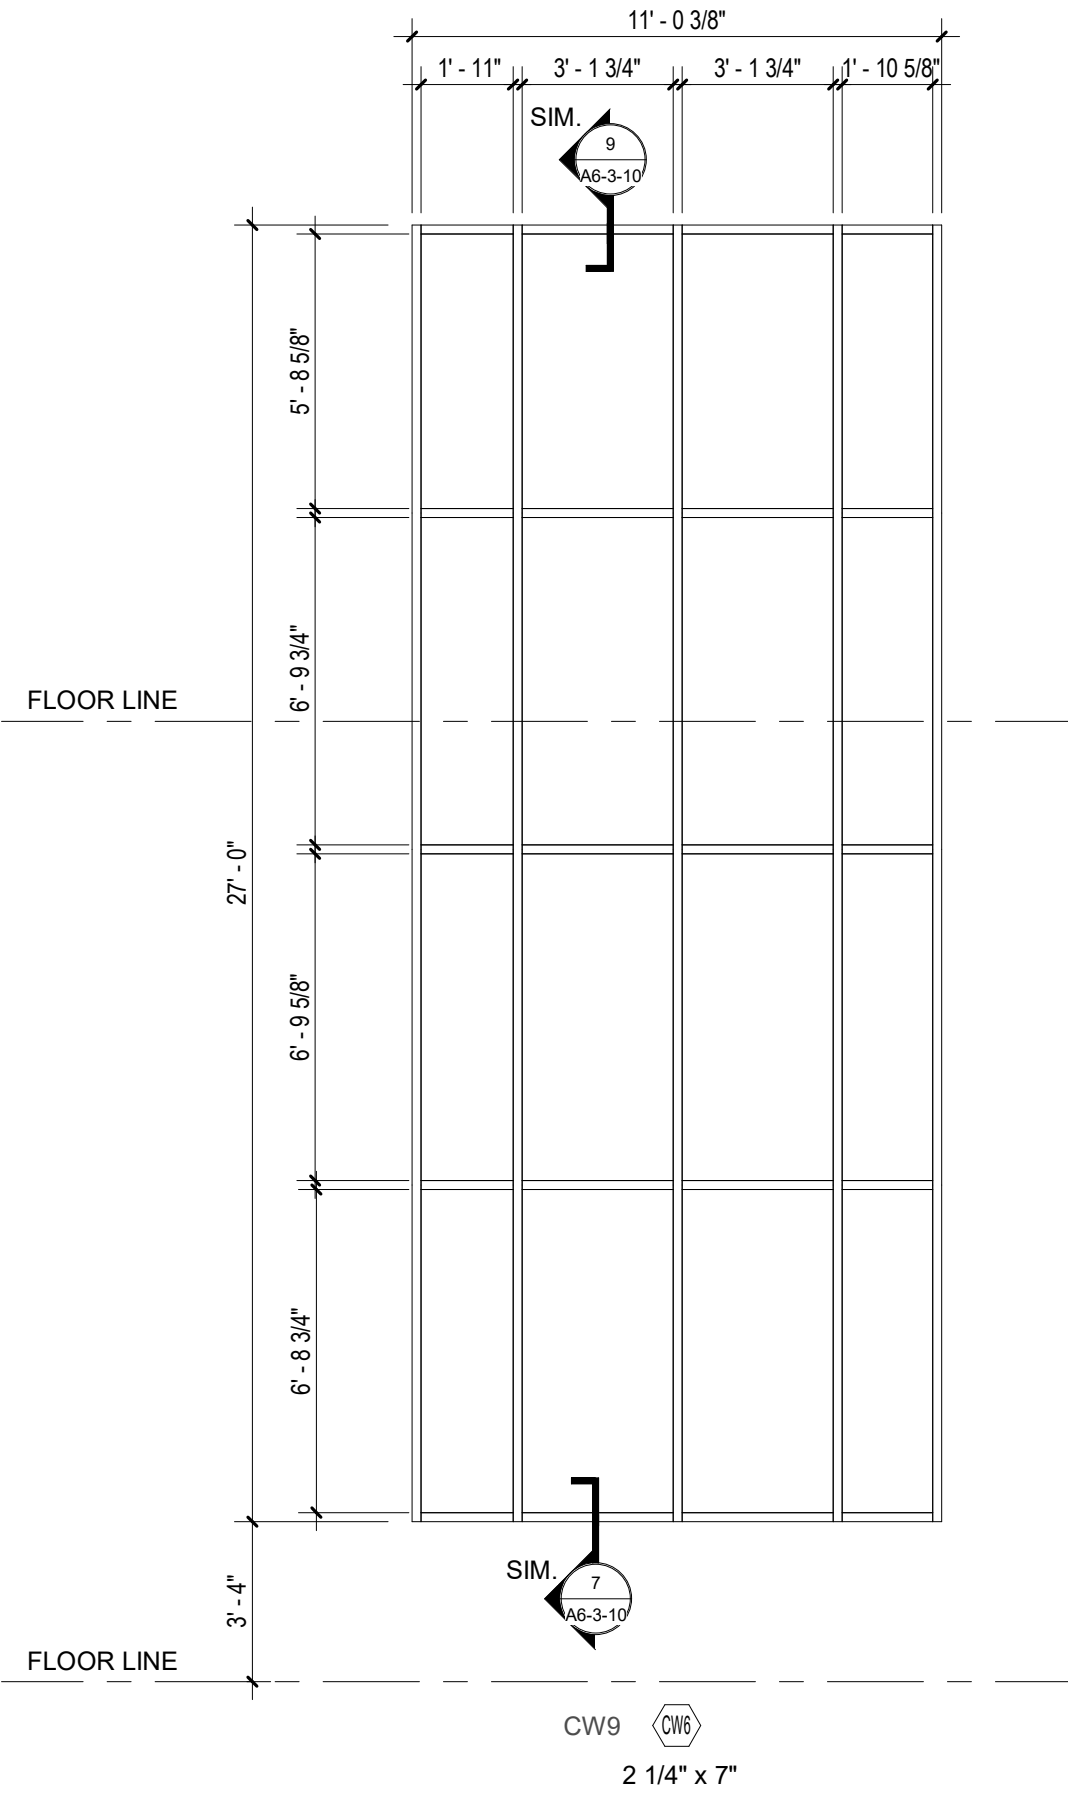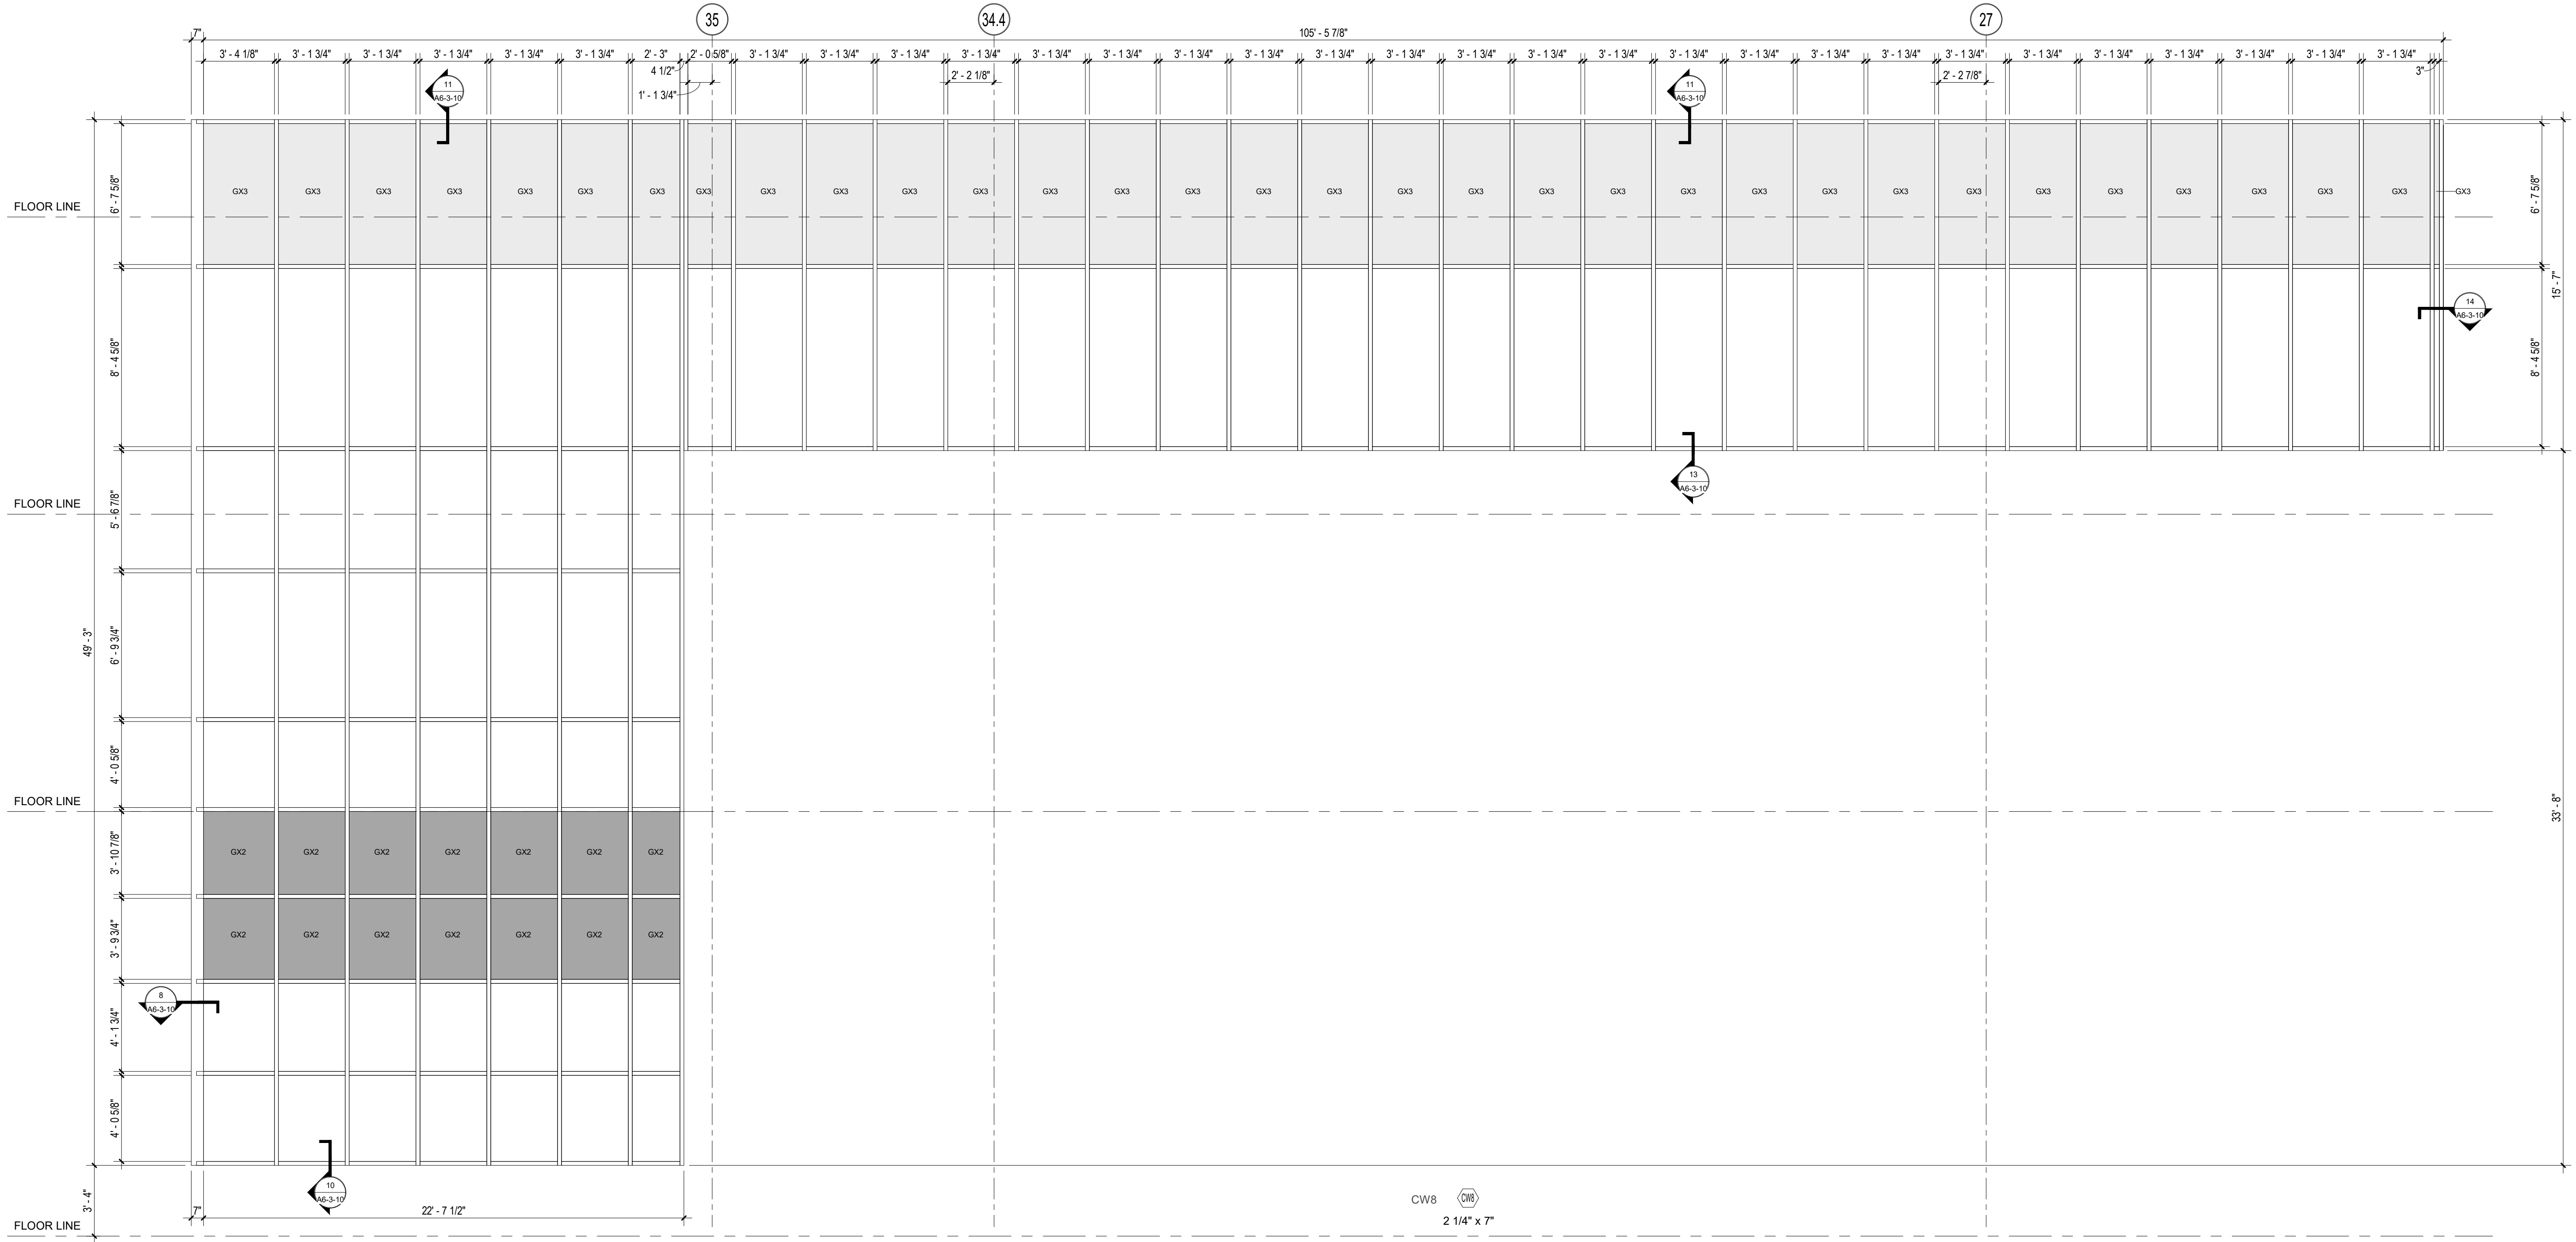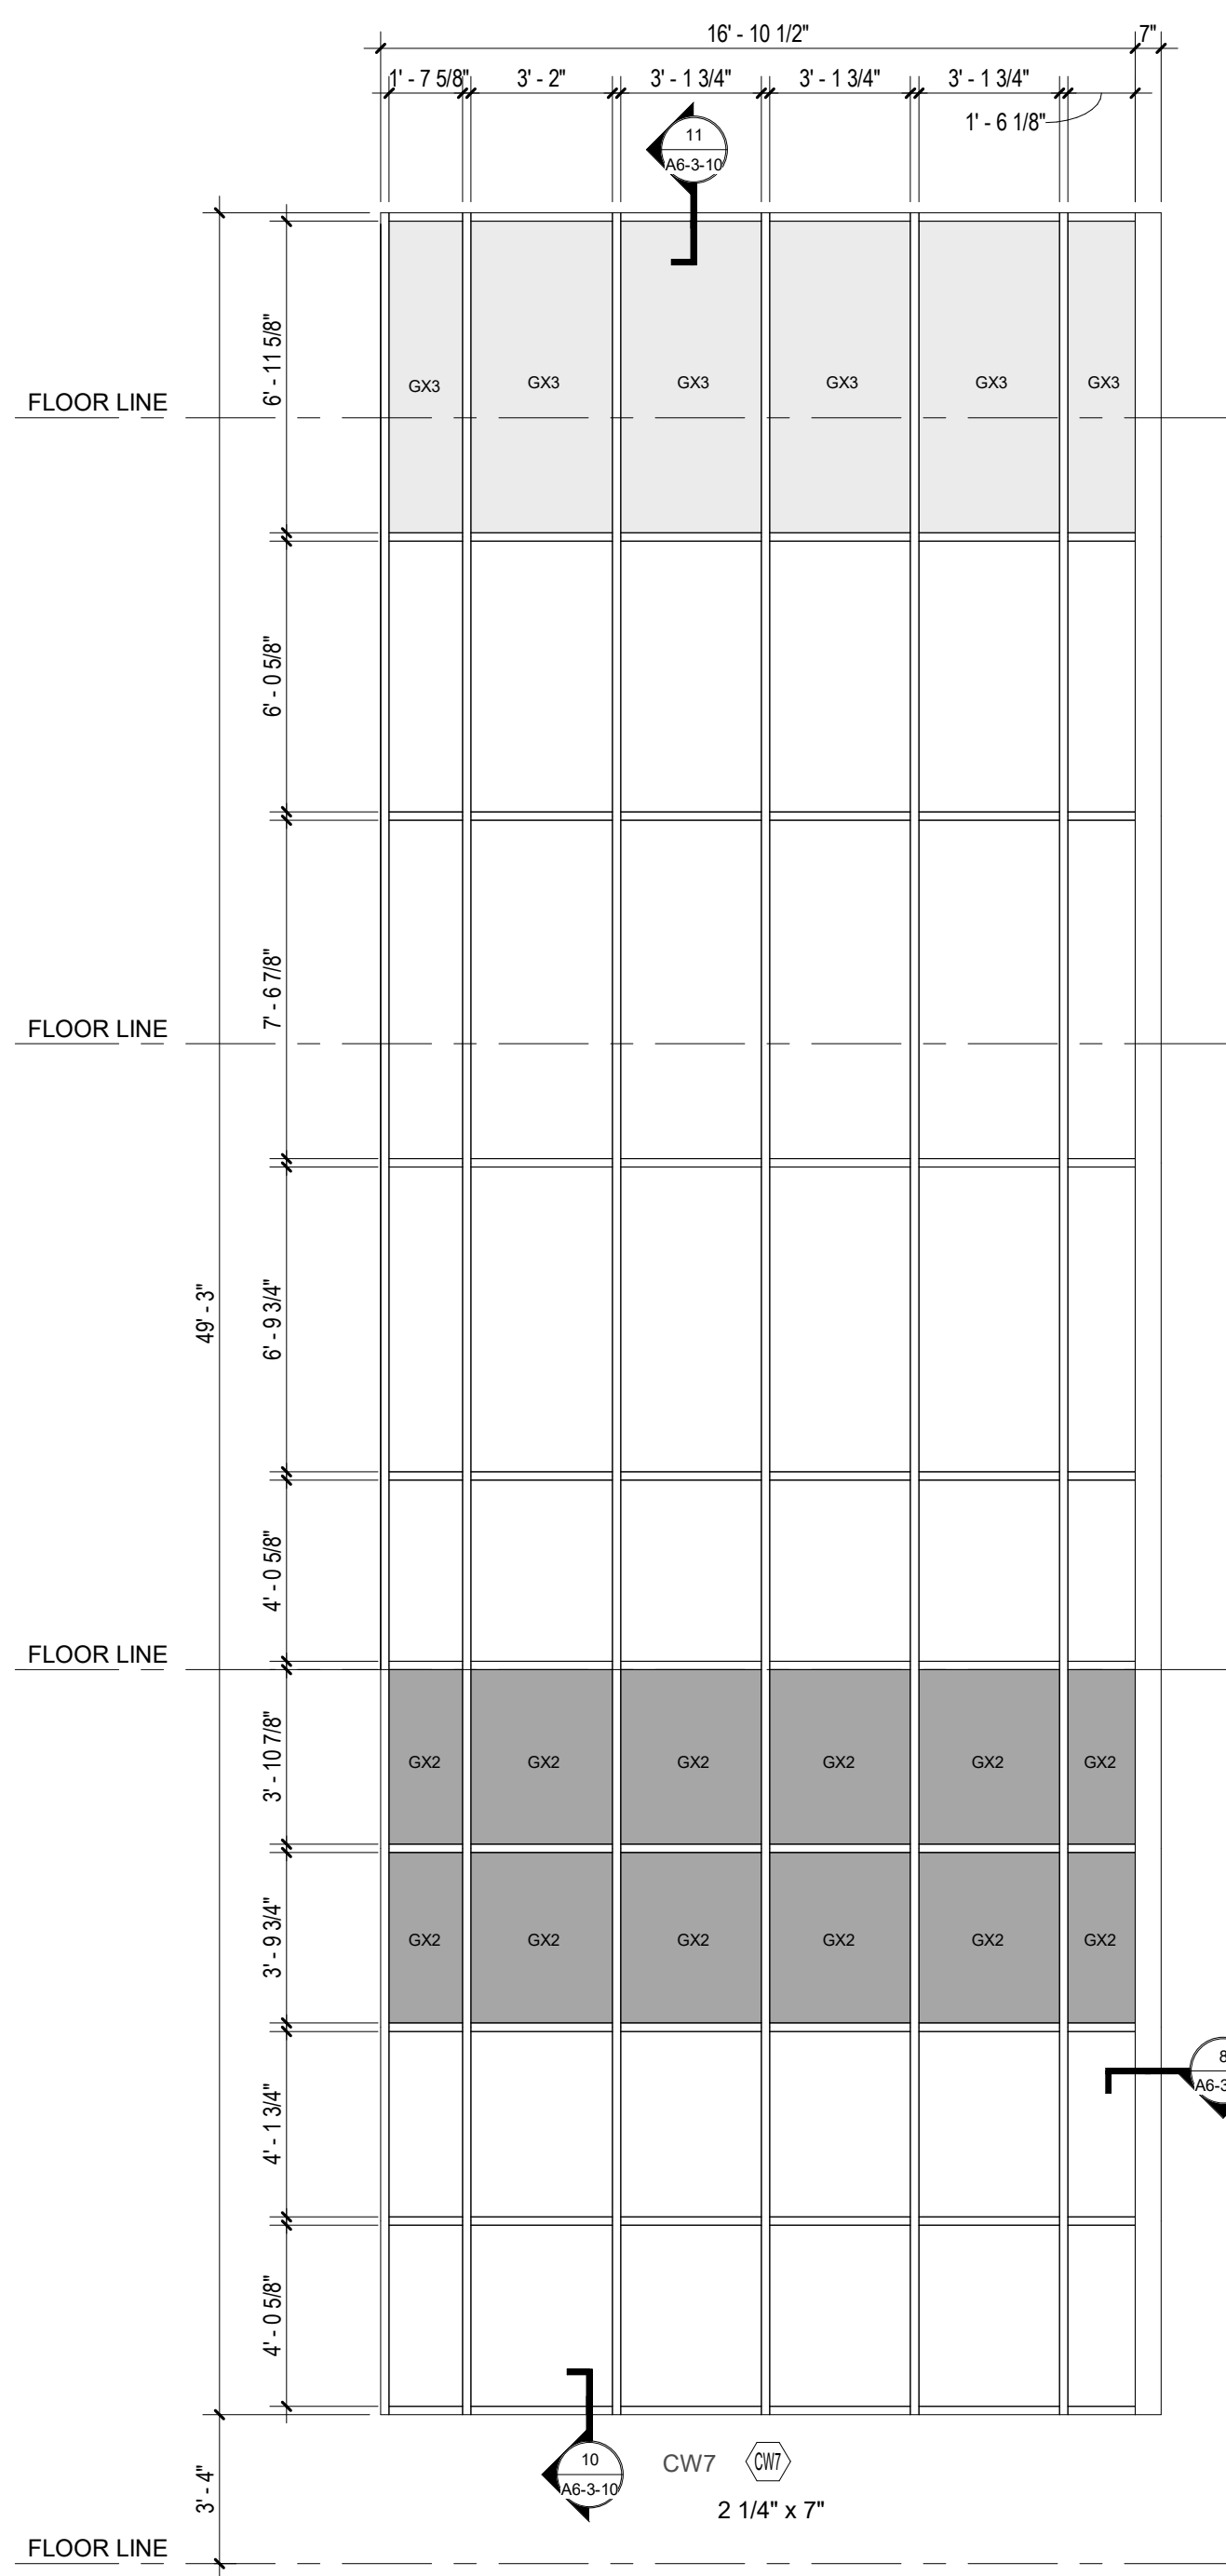

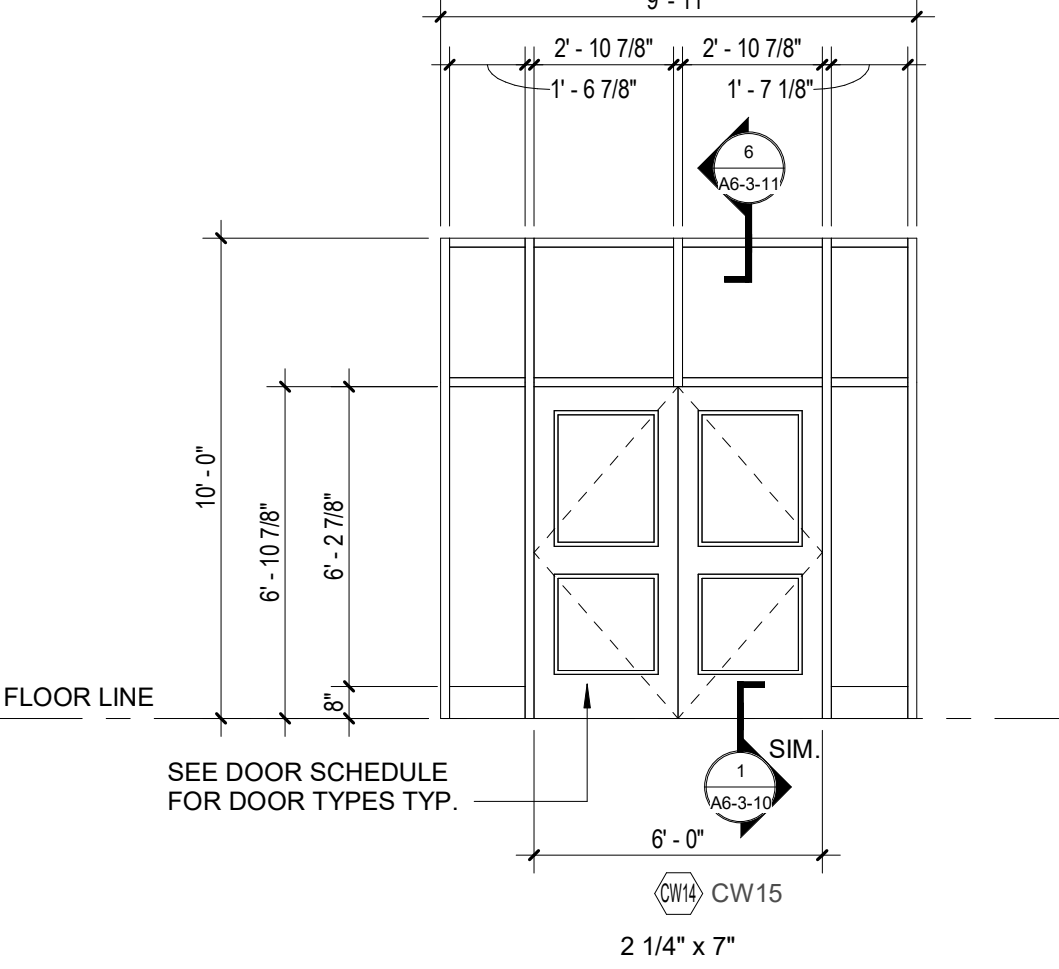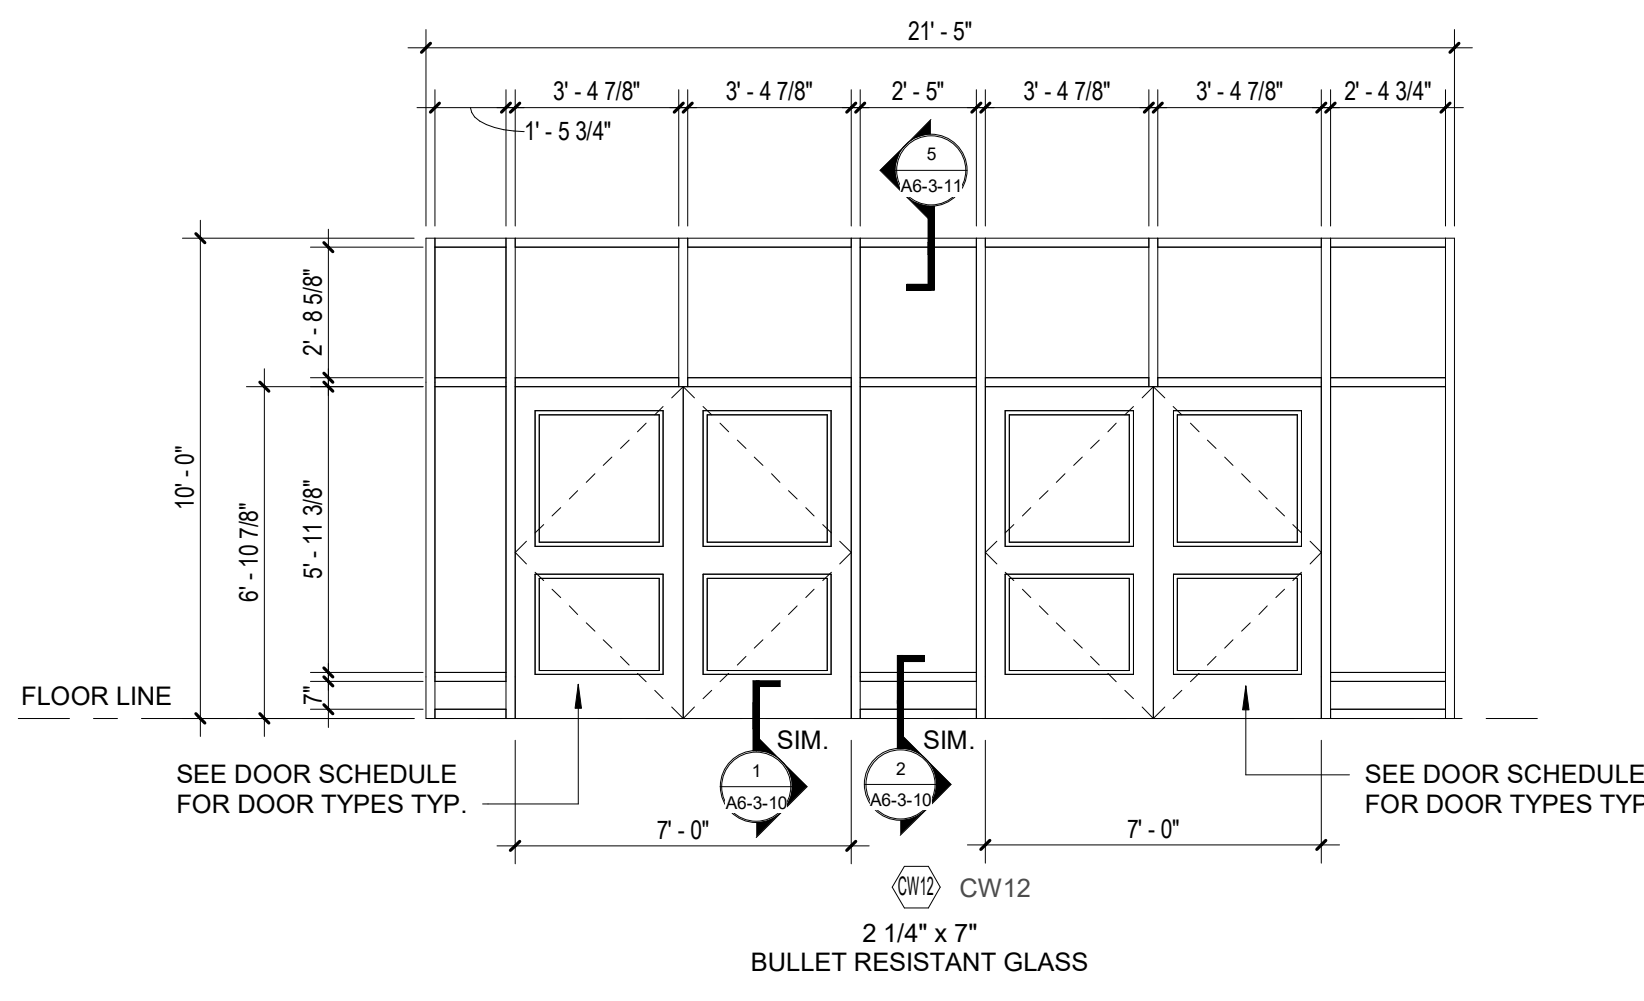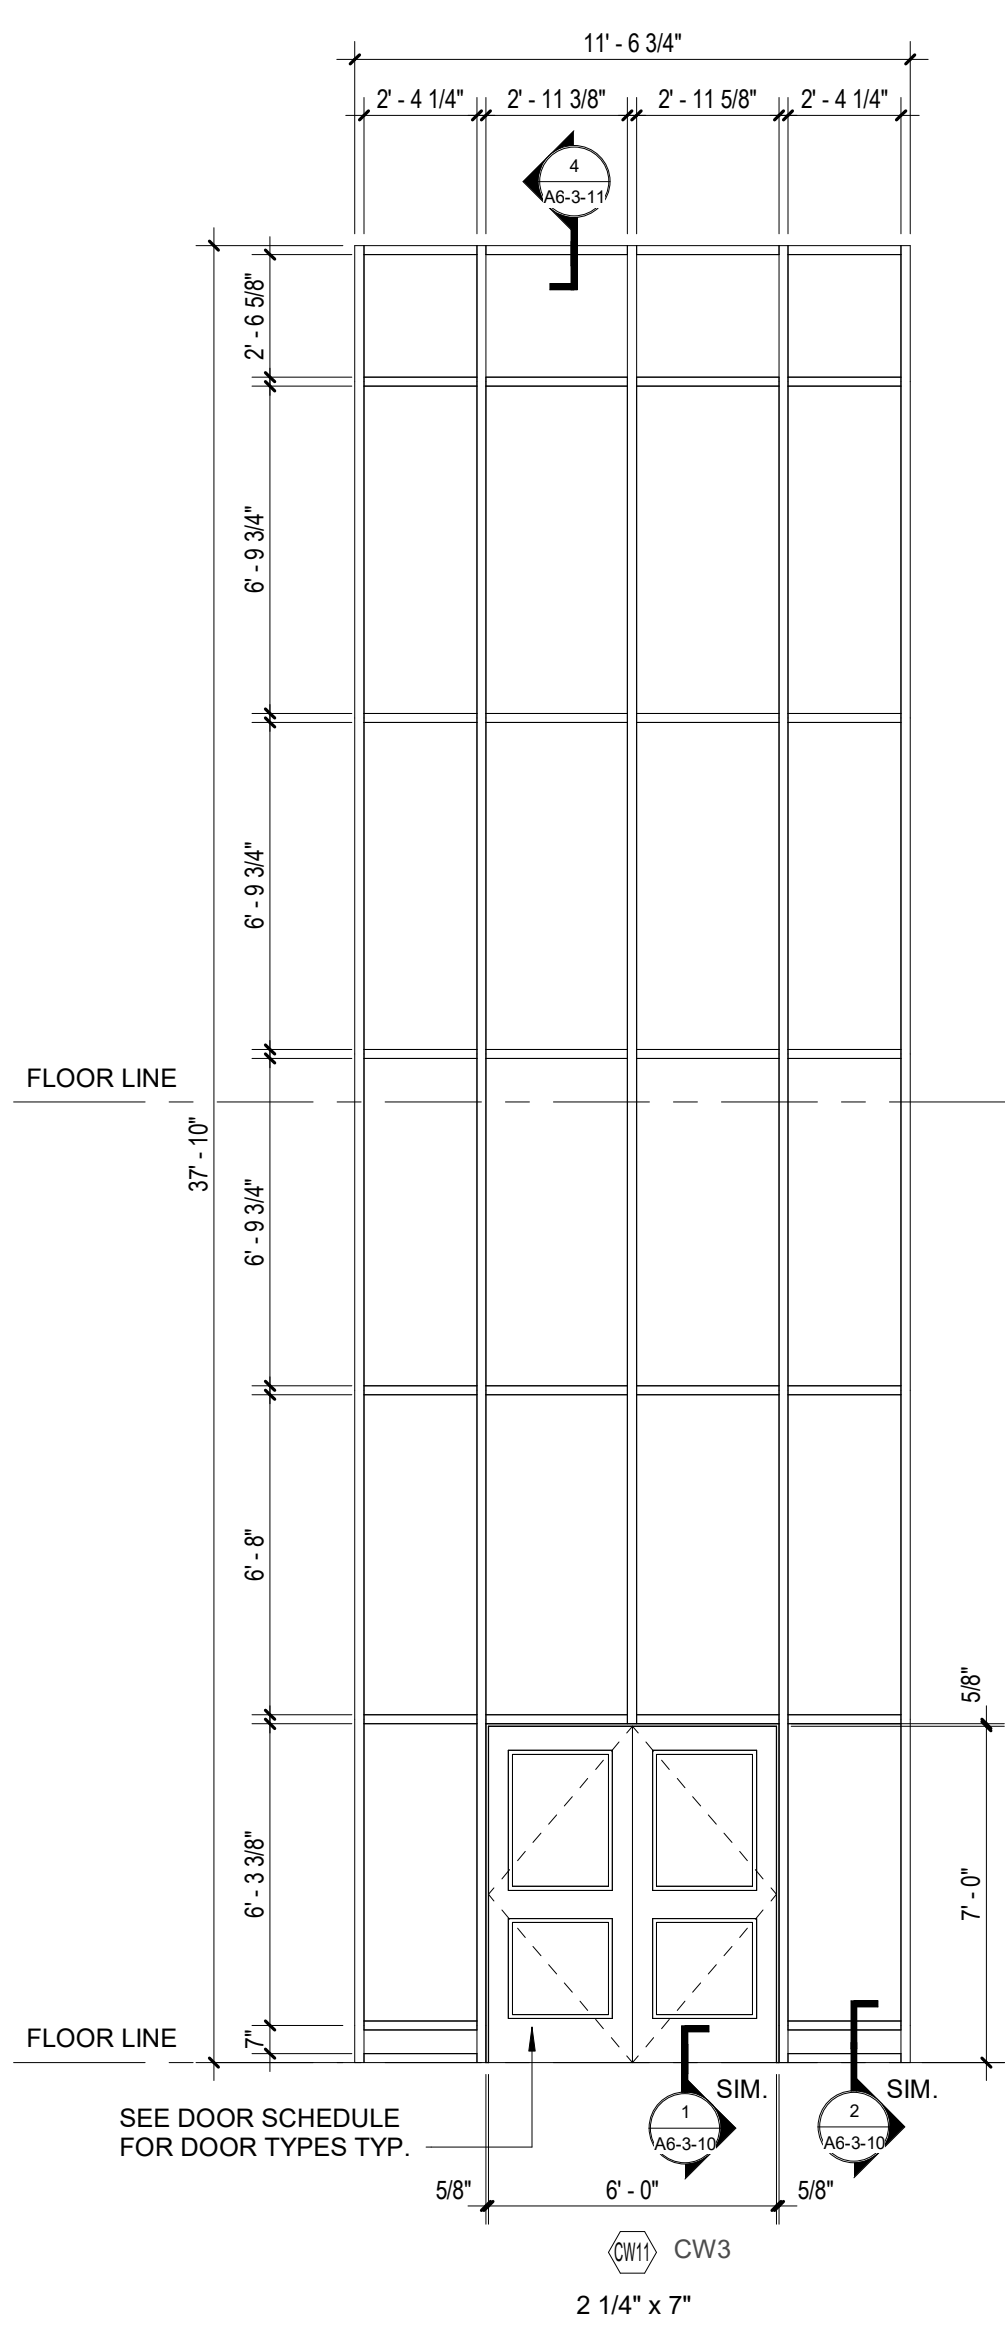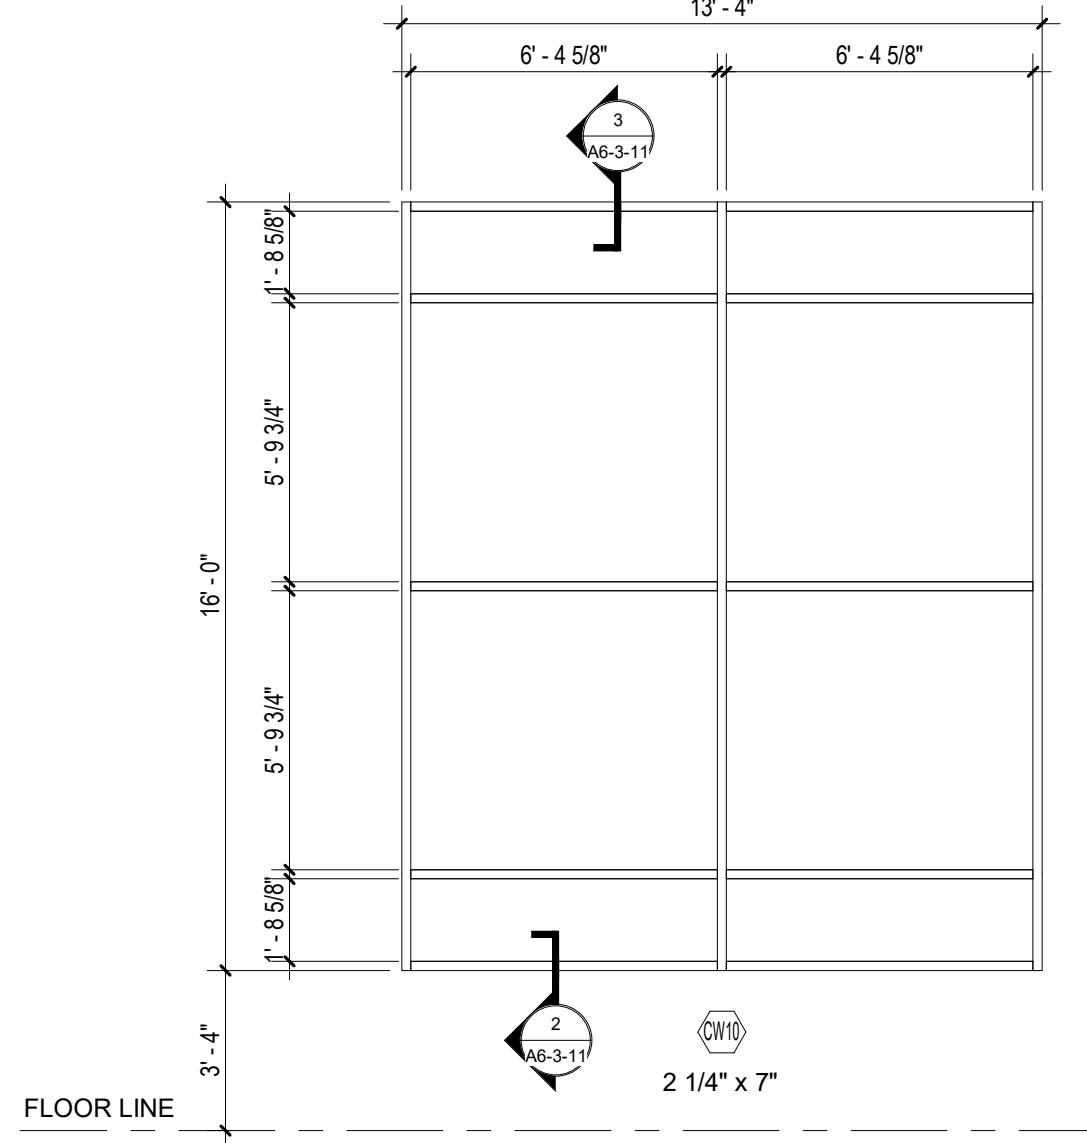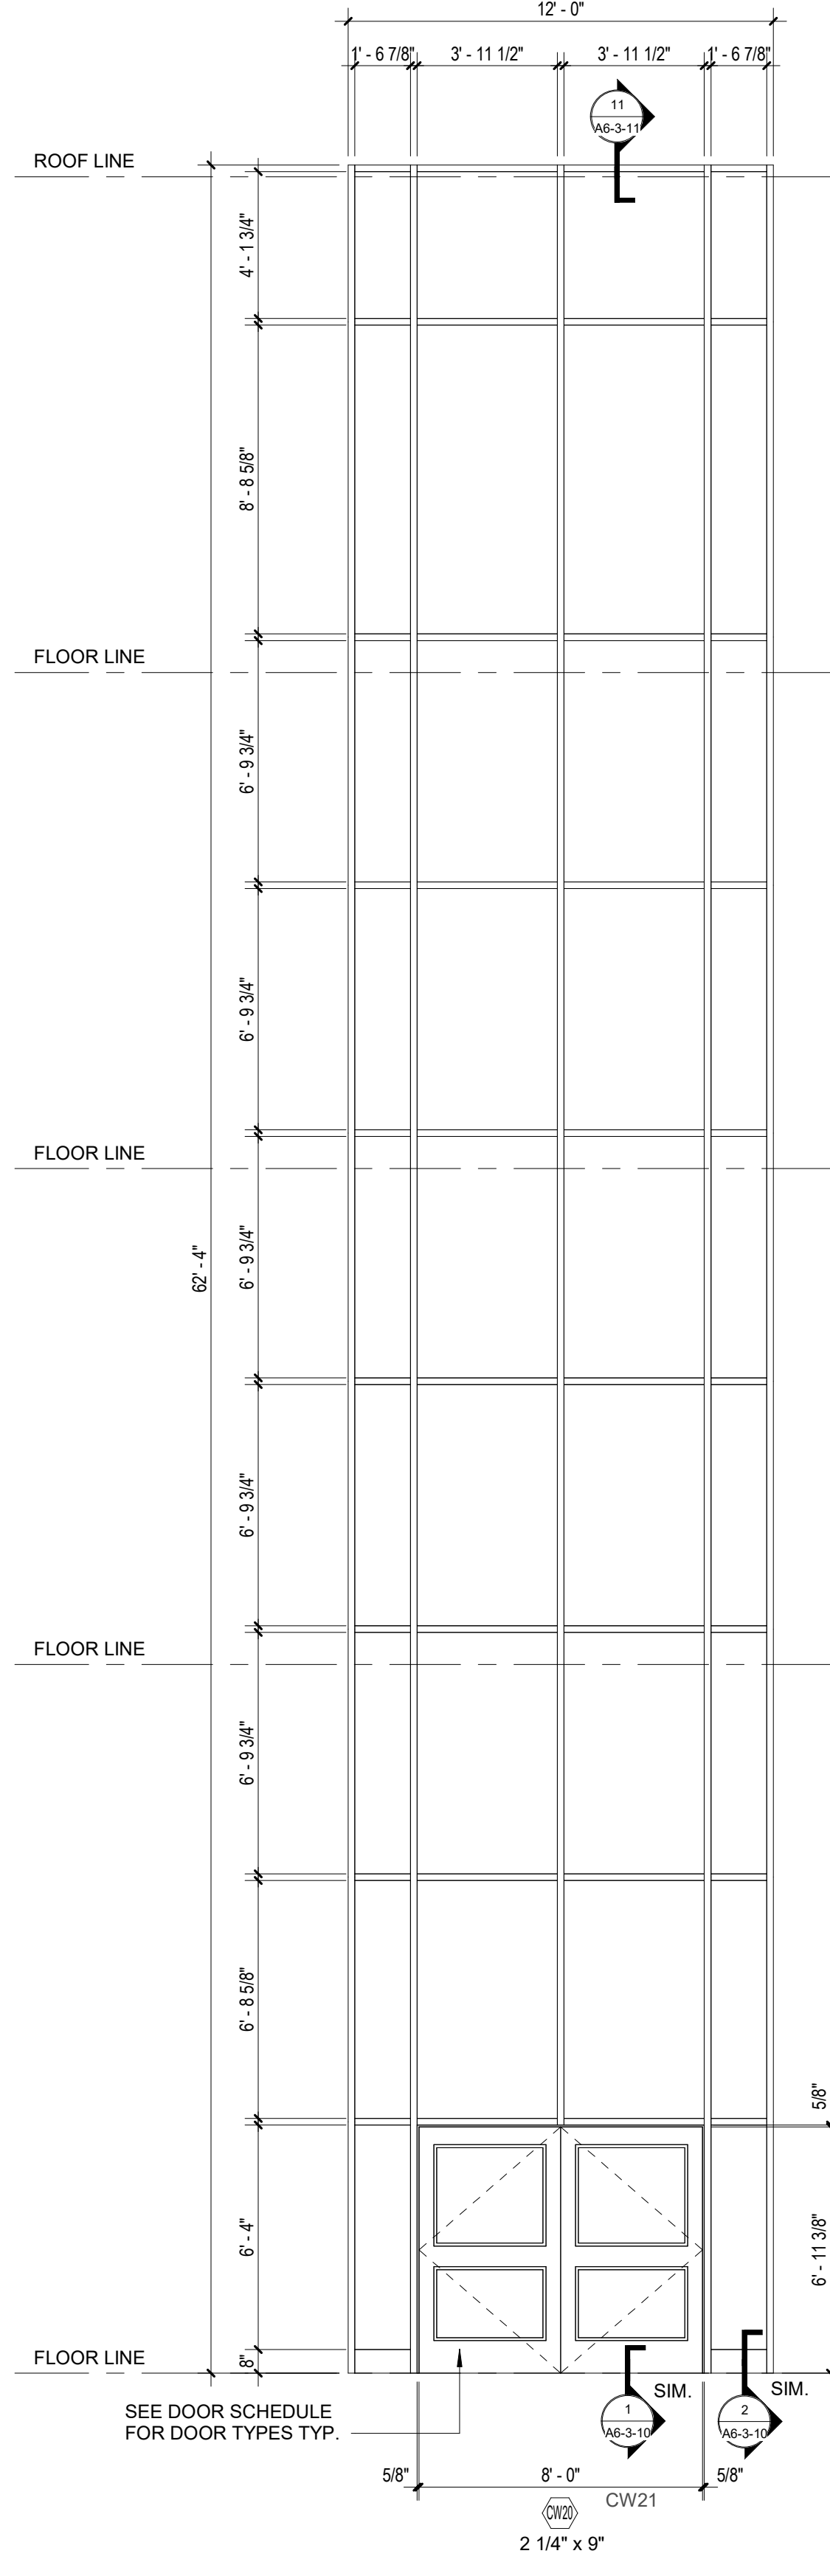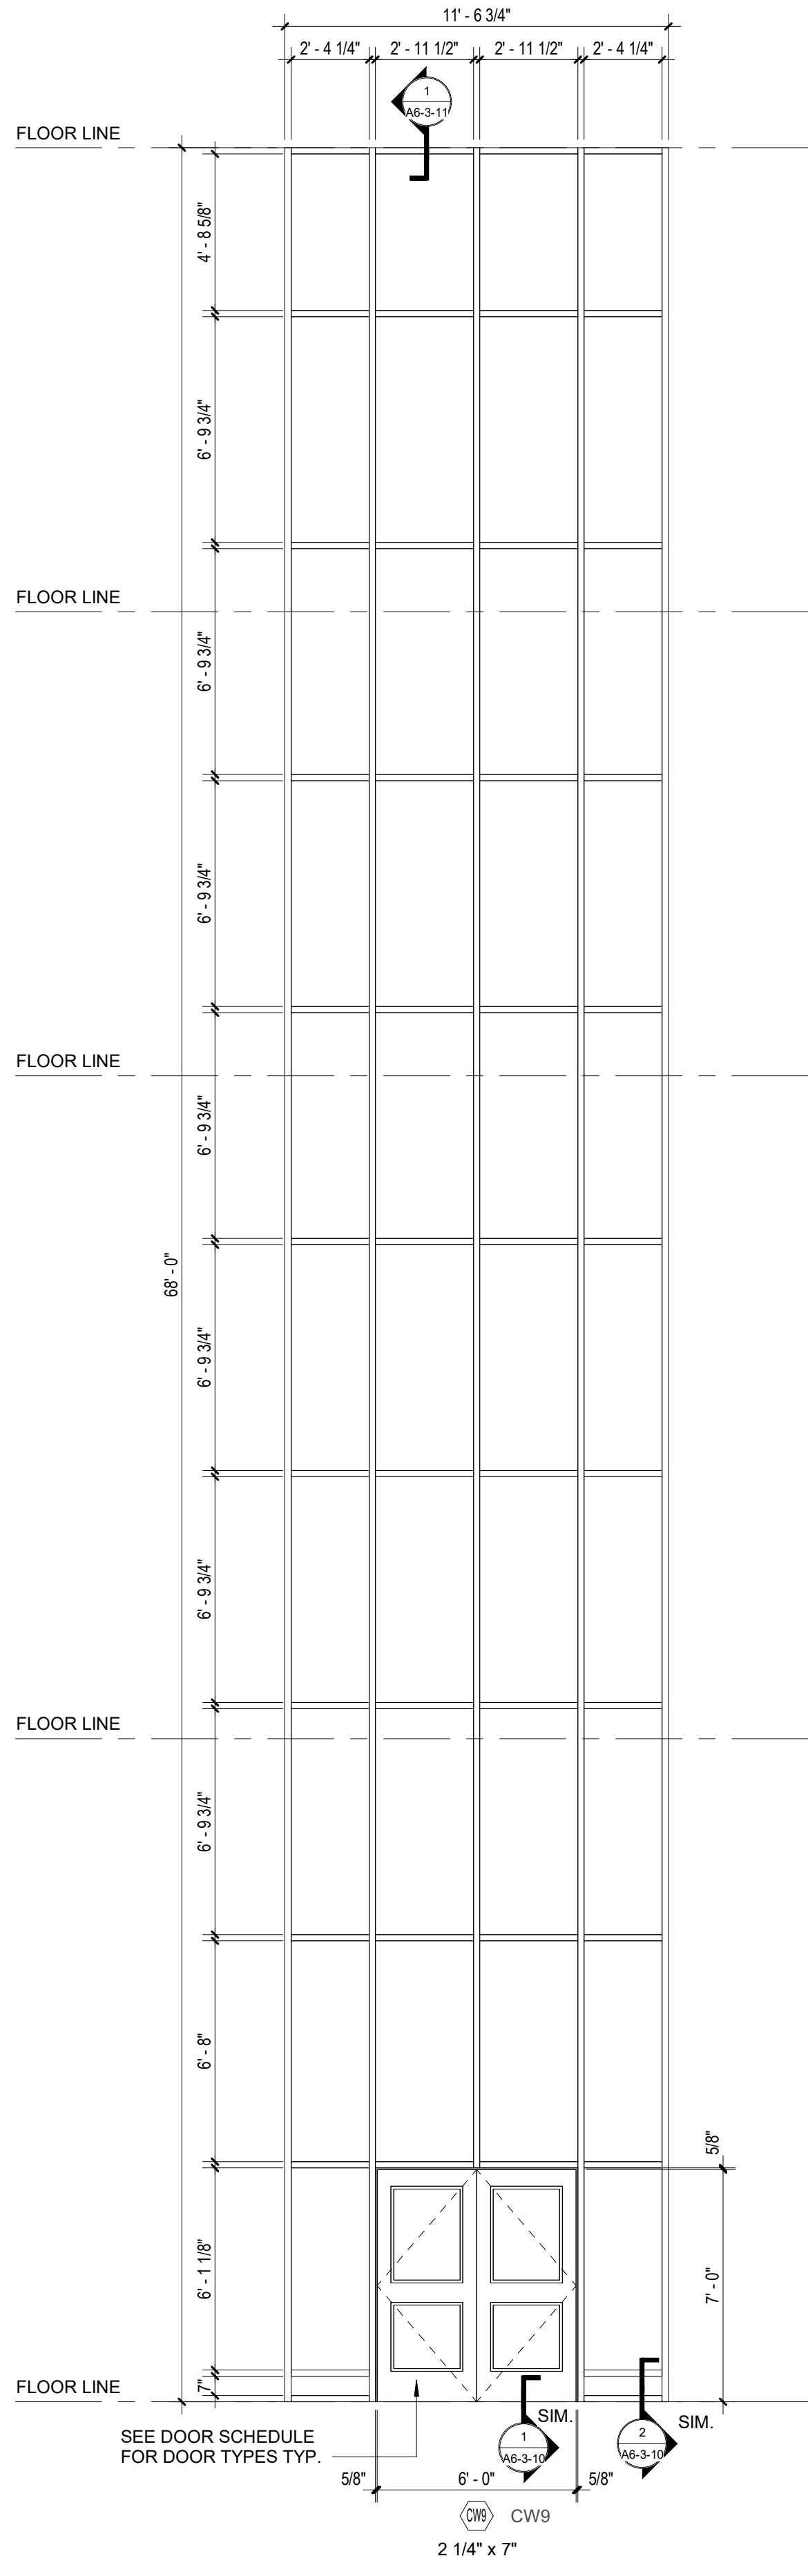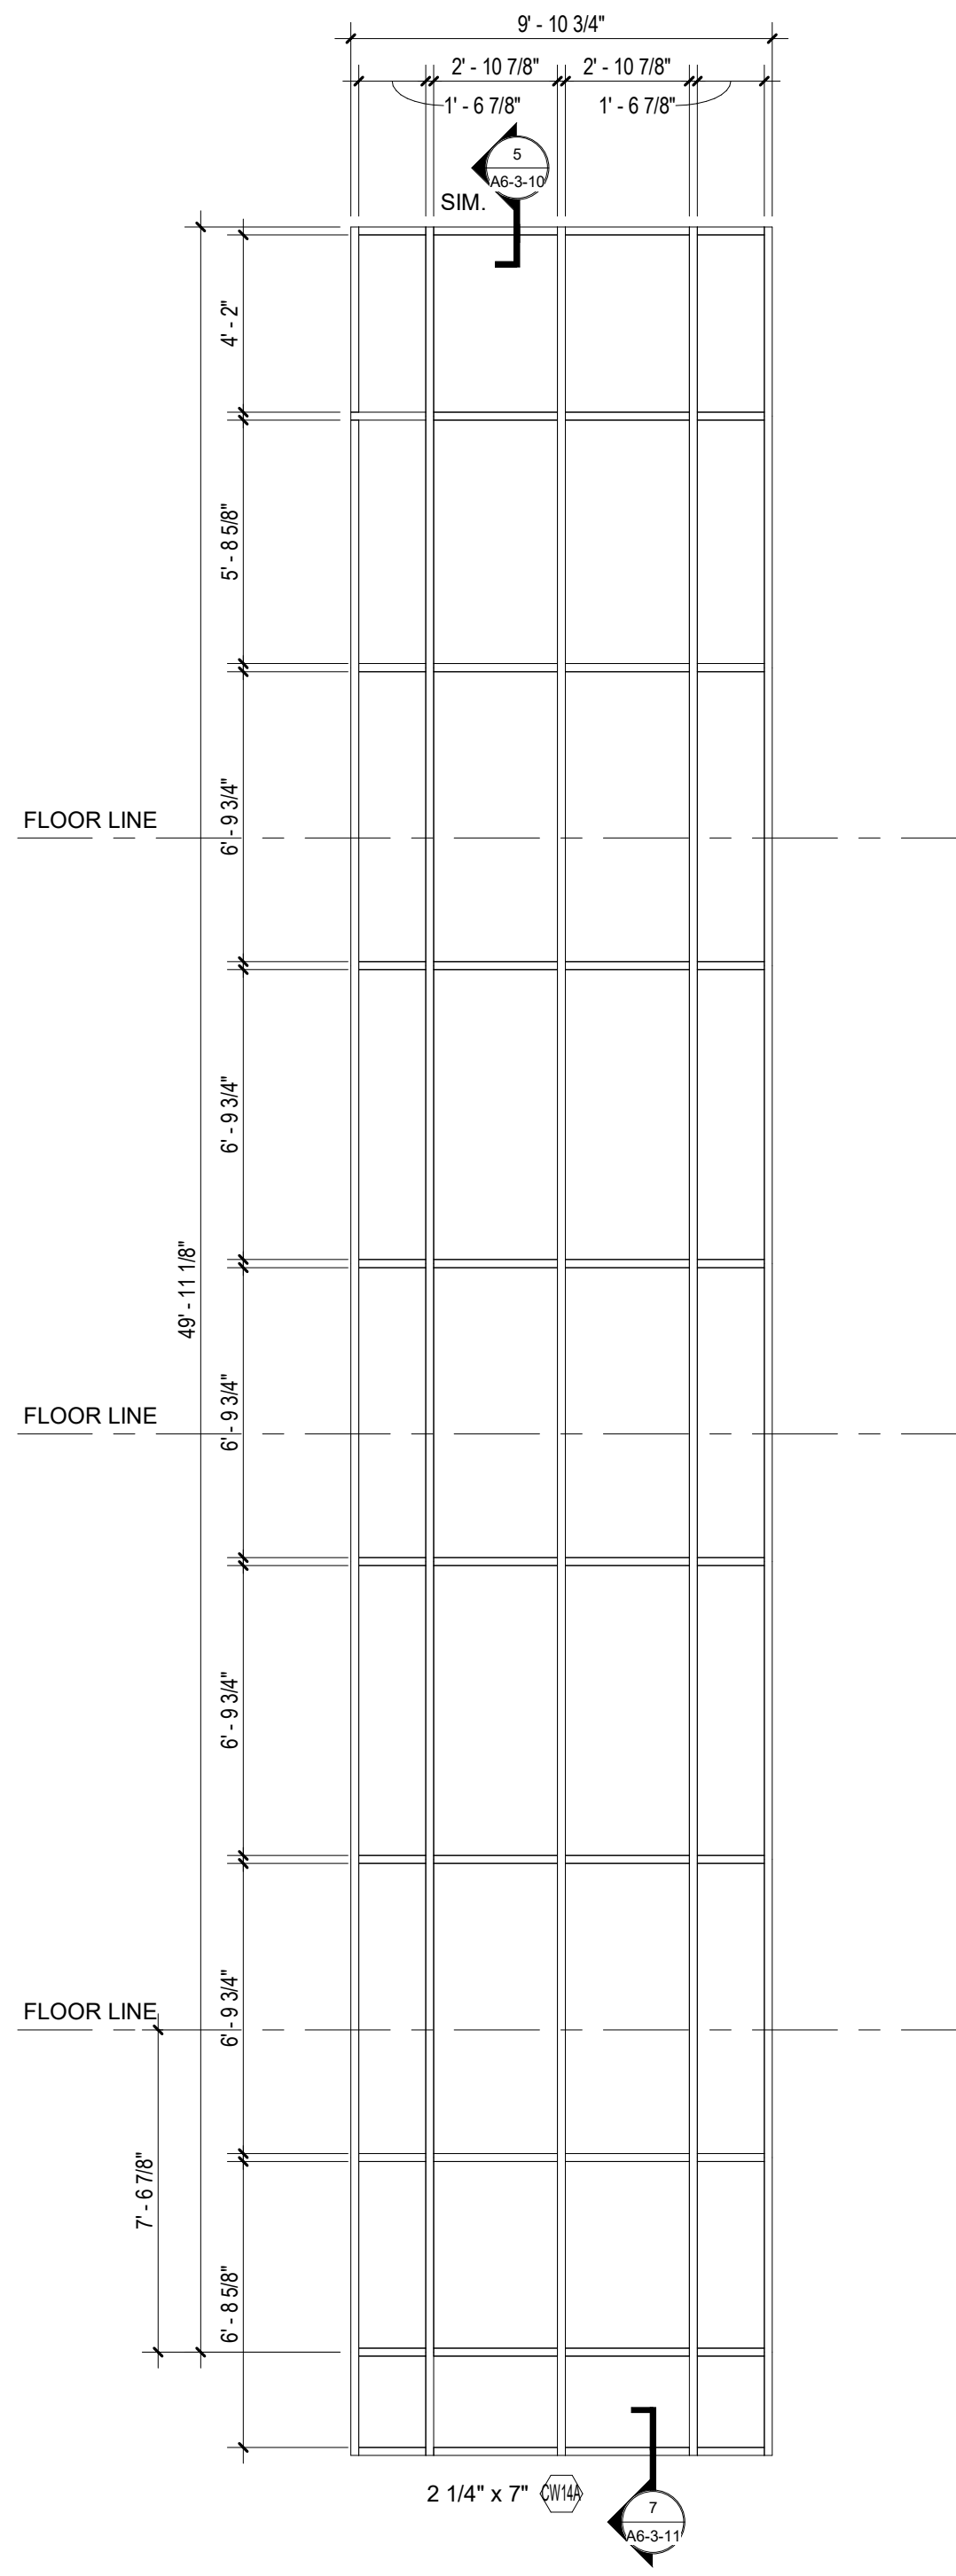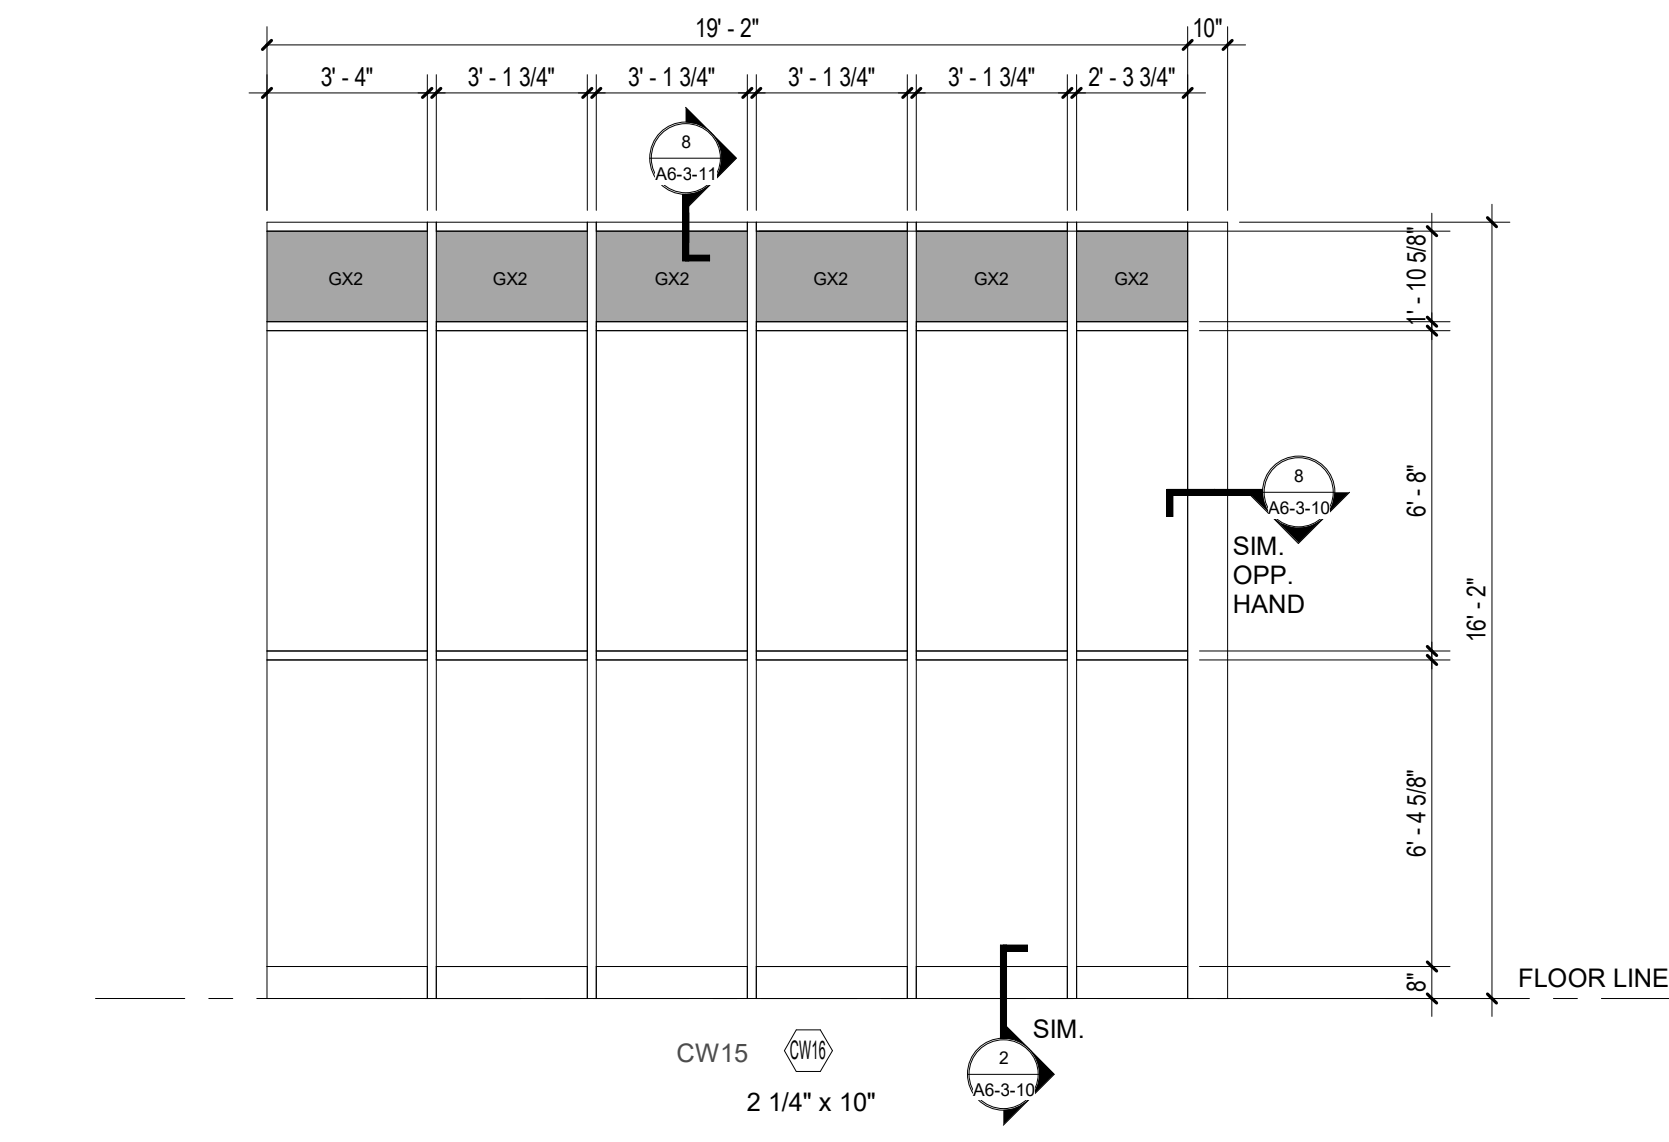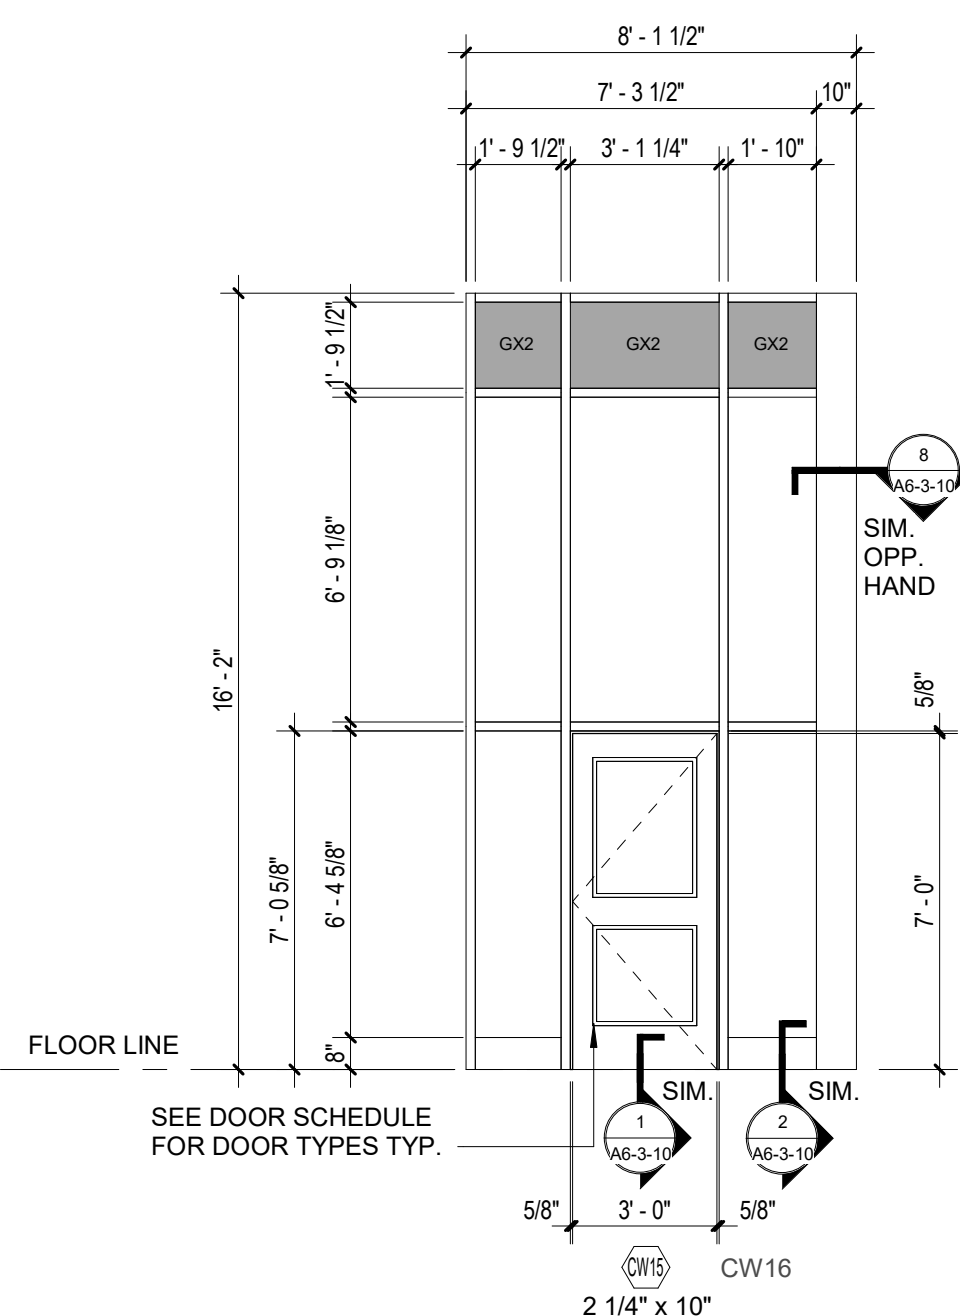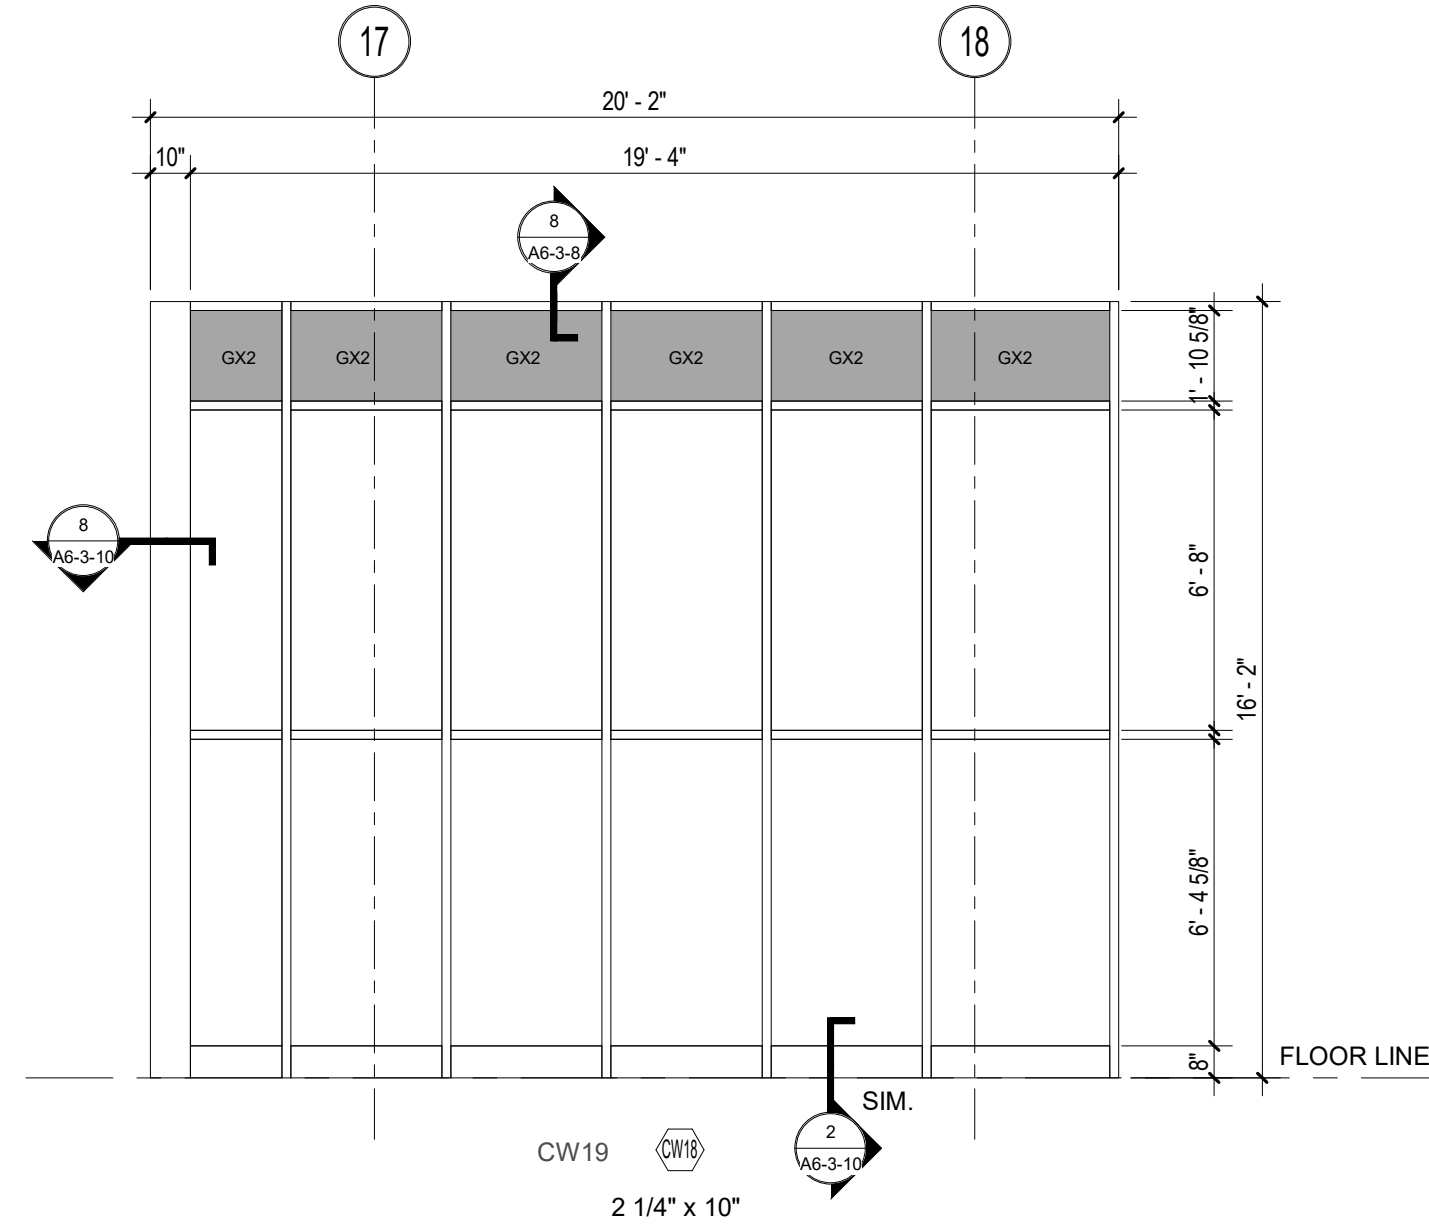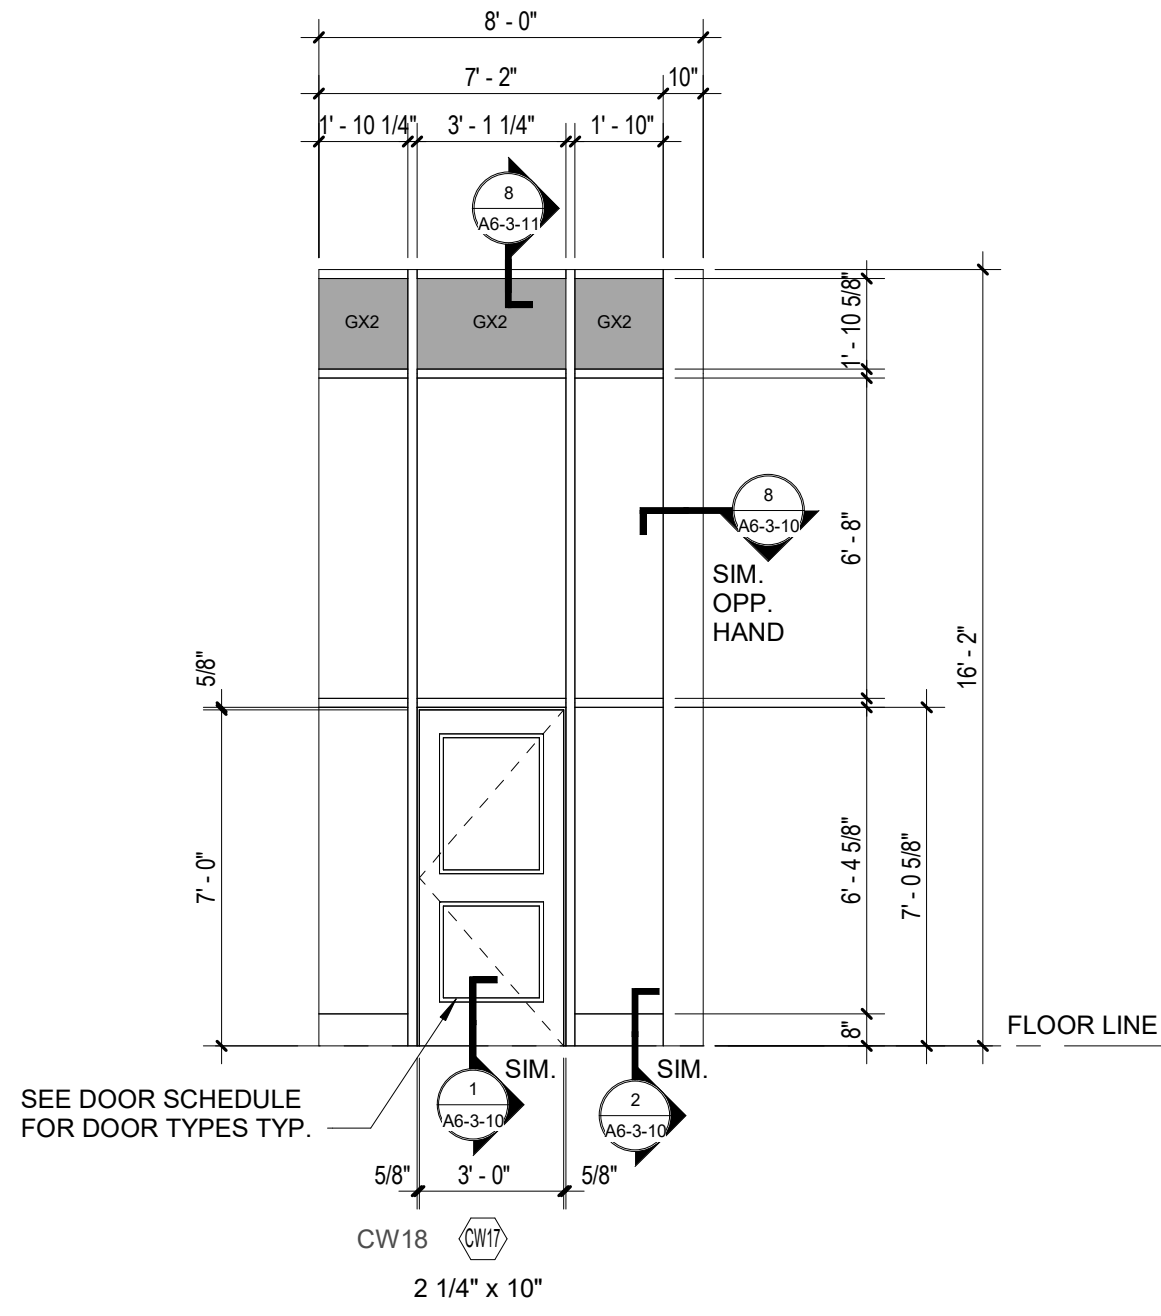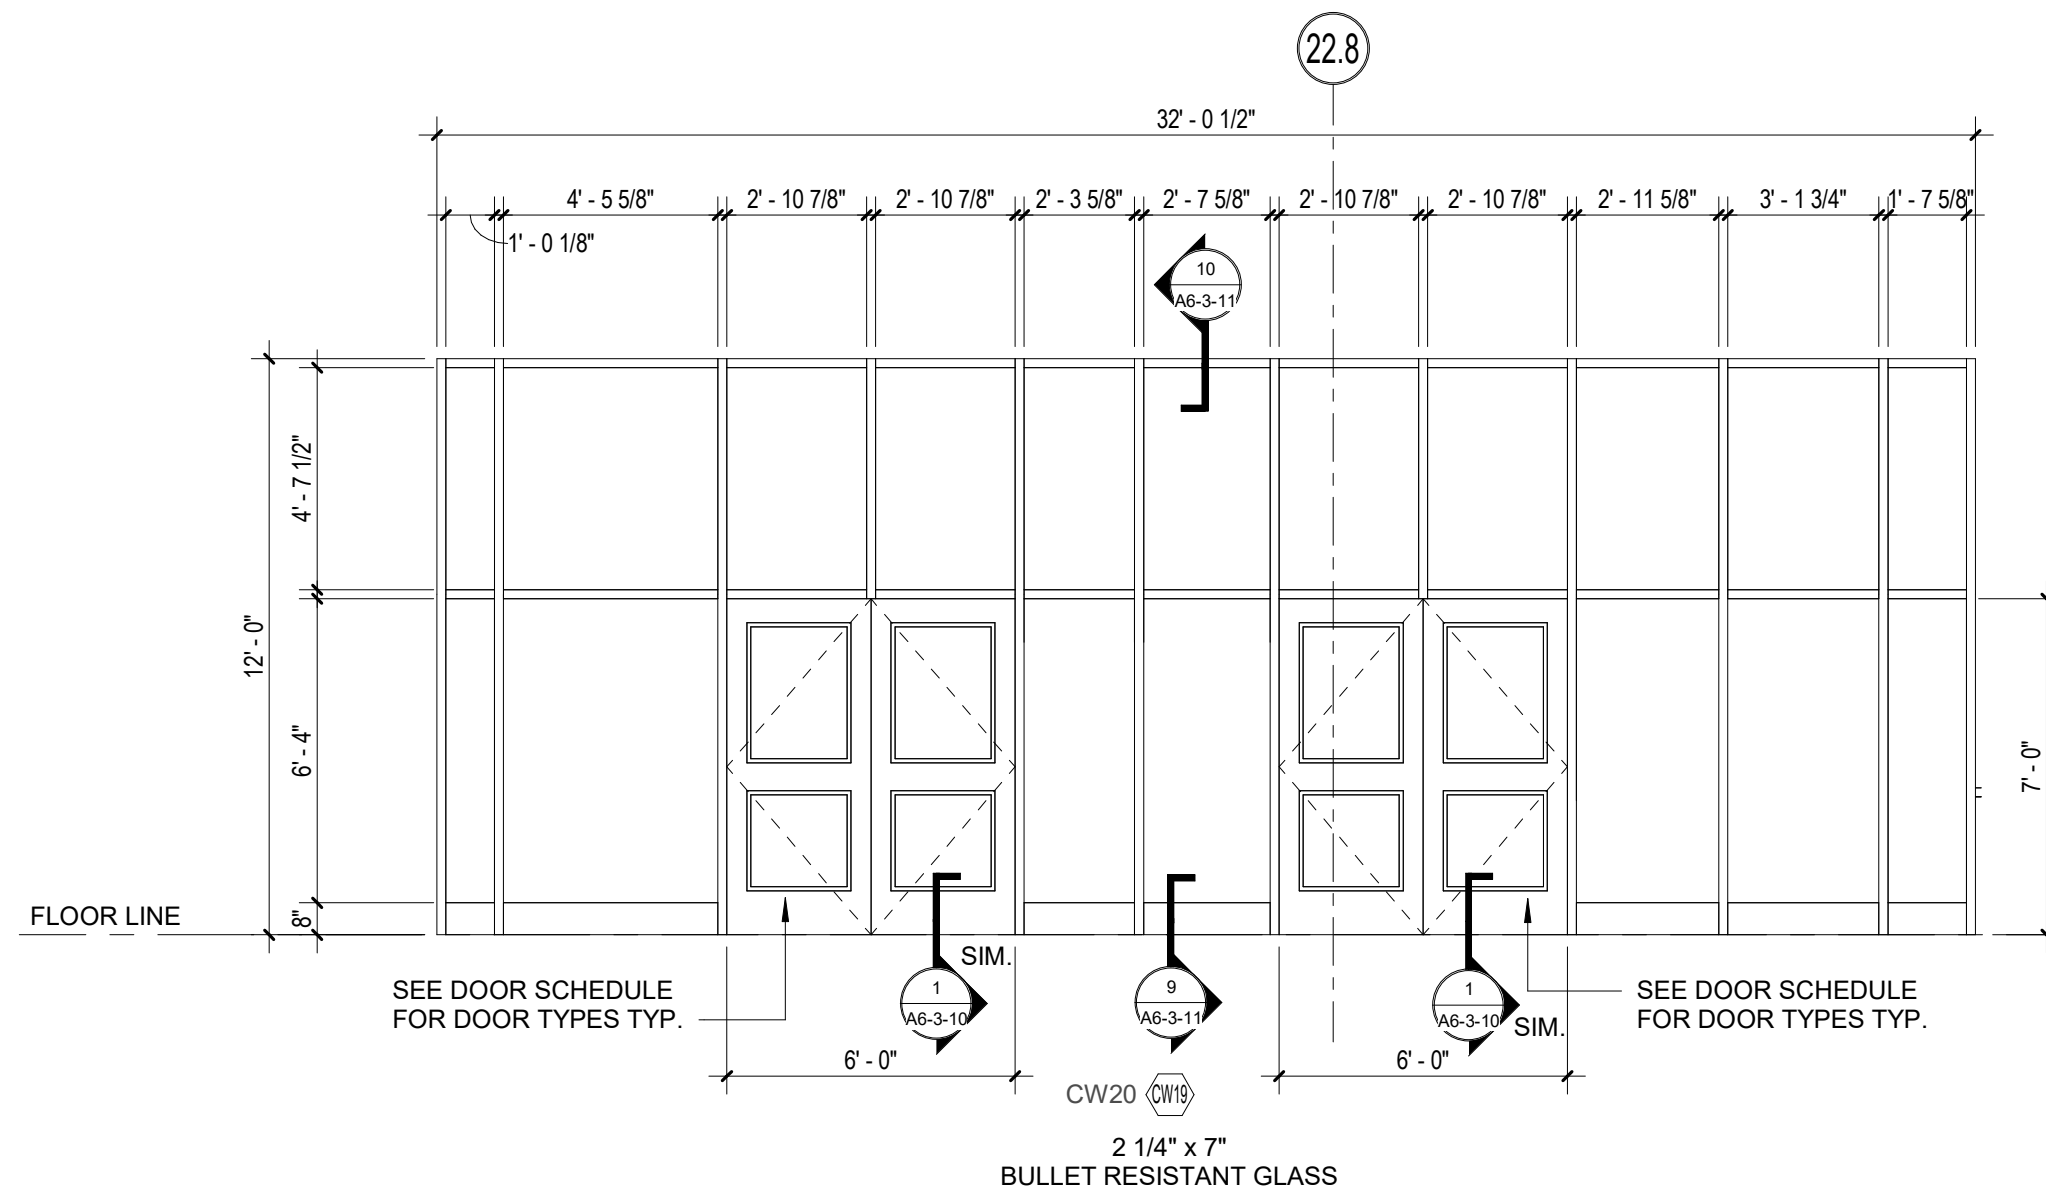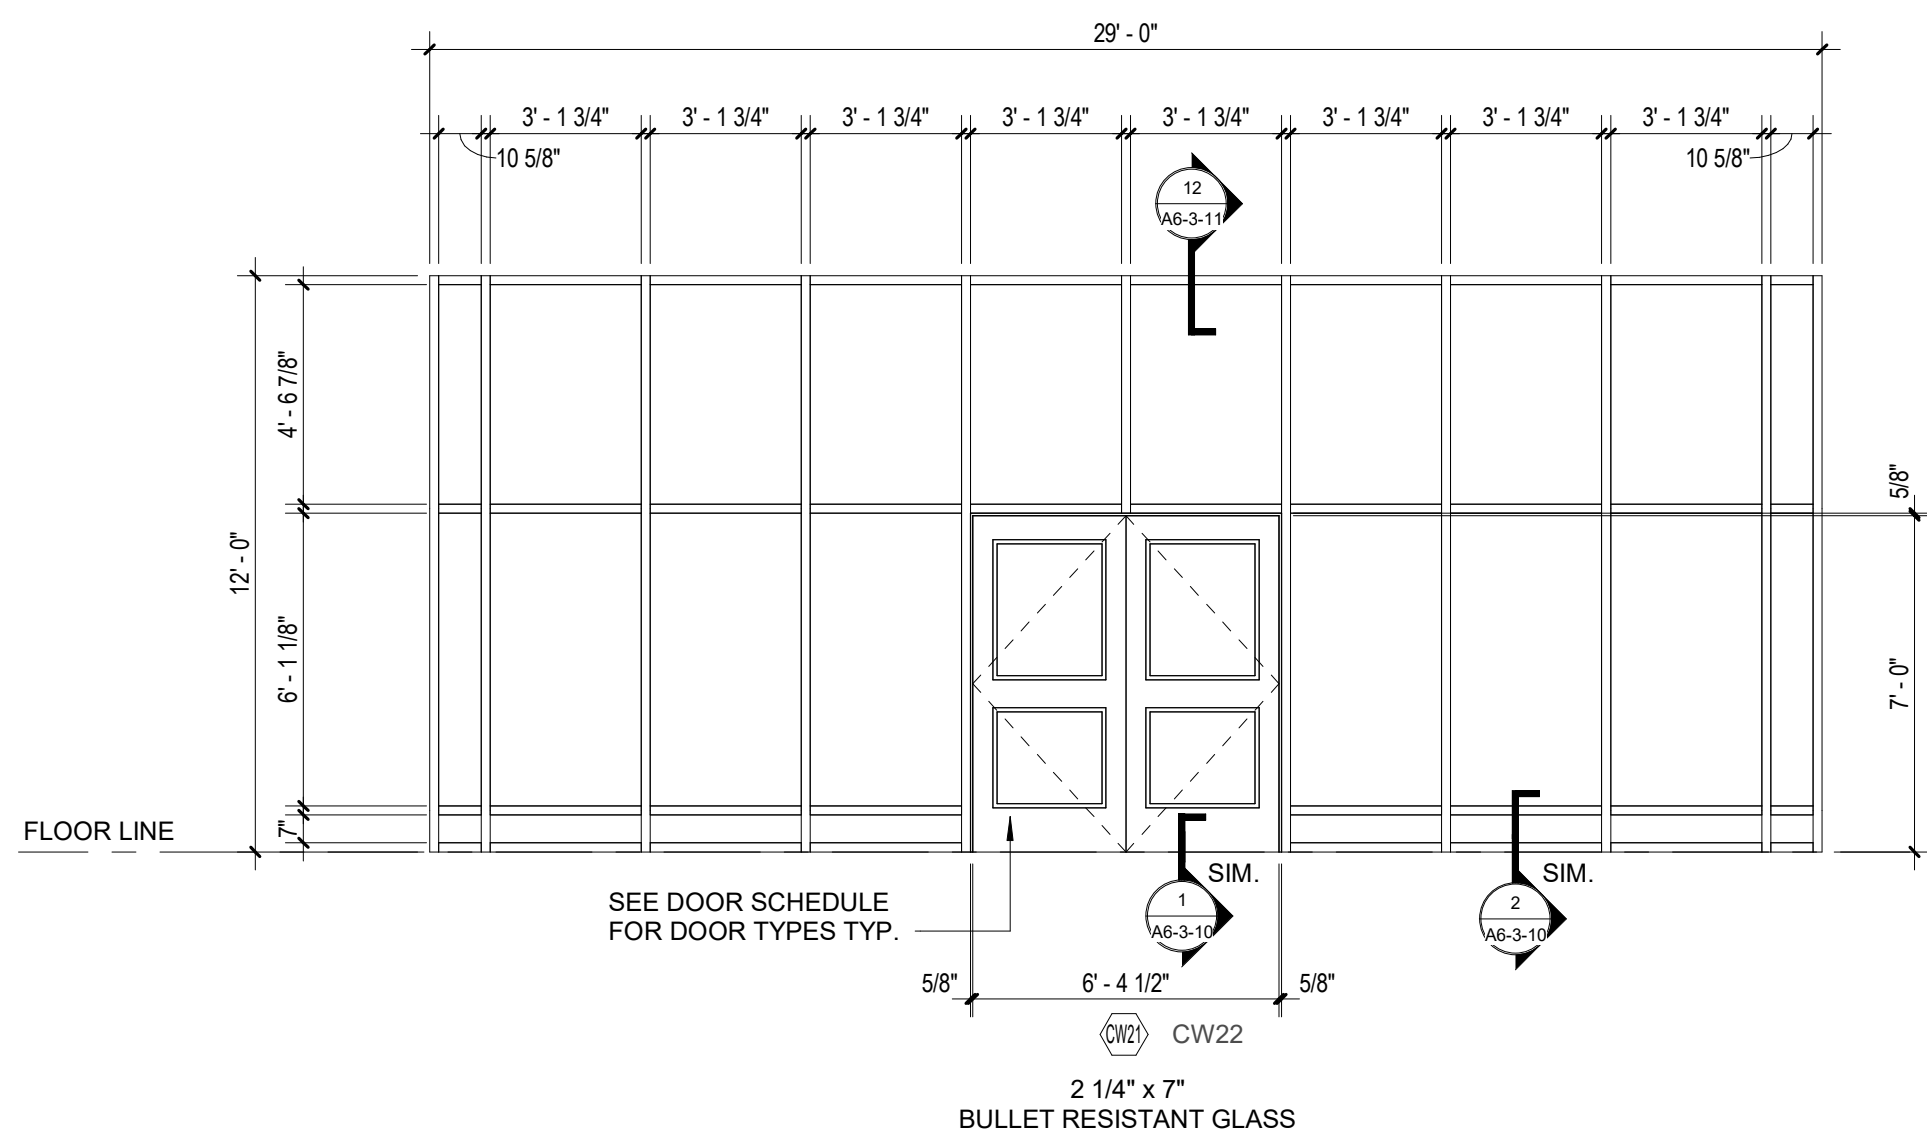

DRA

Drummeys Rosane Anderson, Inc.

225 Oakland Road
Studio 205
South Windsor, CT 06074

260 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Tel: 617.864.1702
www.drainc.com


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

- GENERAL NOTES – STOREFRONT / CURTAIN WALL TYPES
- INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
 - EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE GX1
 - AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION BEHIND ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
 - PROVIDE SAFETY GLAZING AT ALL LOCATIONS IDENTIFIED AS HAZARDOUS LOCATIONS PER THE 9TH EDITION OF THE MASSACHUSETTS STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
 - PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS
 - "SG" DENOTES LOCATION OF SAFETY GLAZING
 - SEE DOOR SCHEDULE FOR DOOR TYPES

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.




MSBA 90% CD
SUBMISSION
May 12TH, 2023

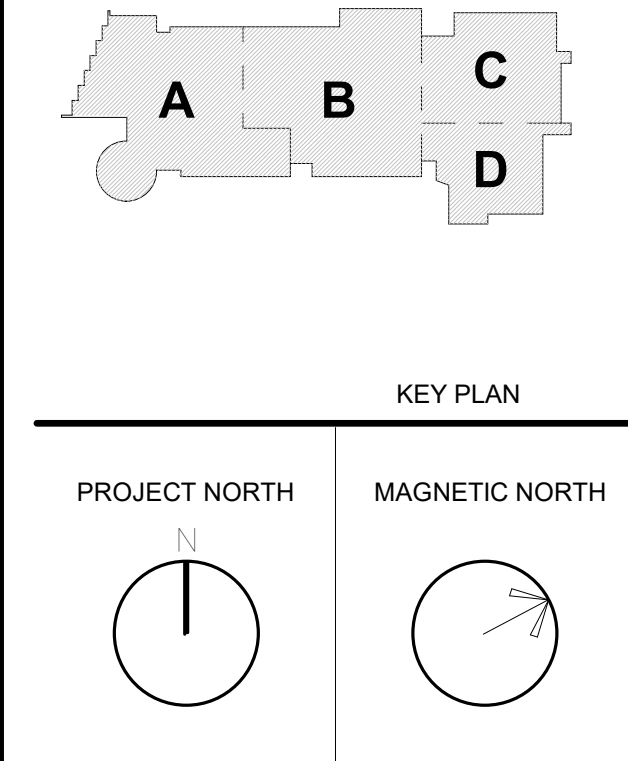

**CURTAIN WALL
TYPES**

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A6-3-3

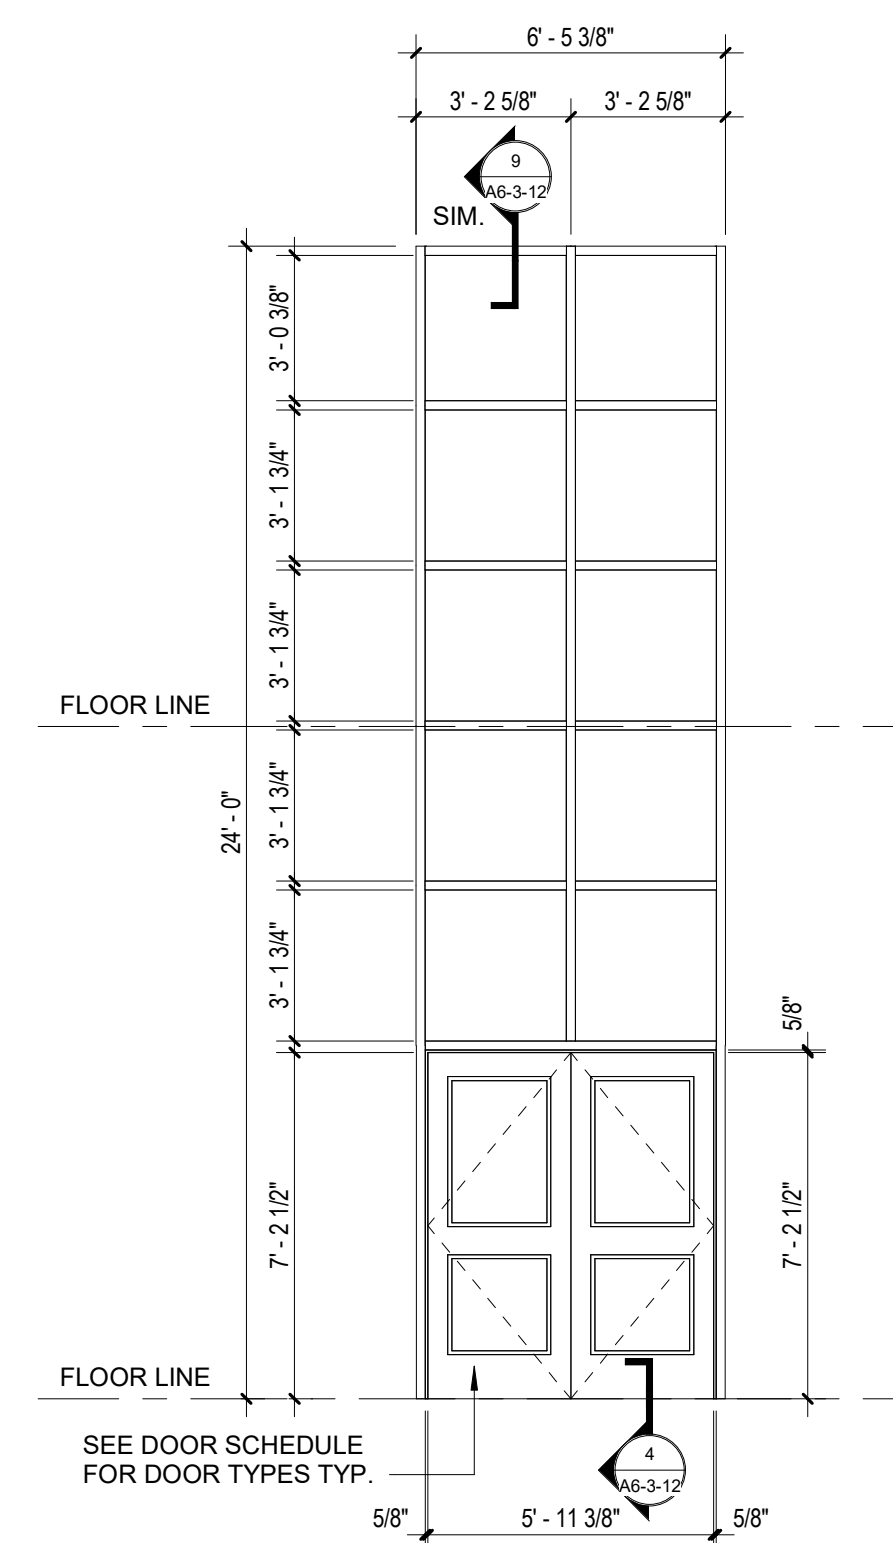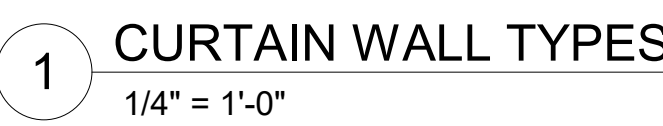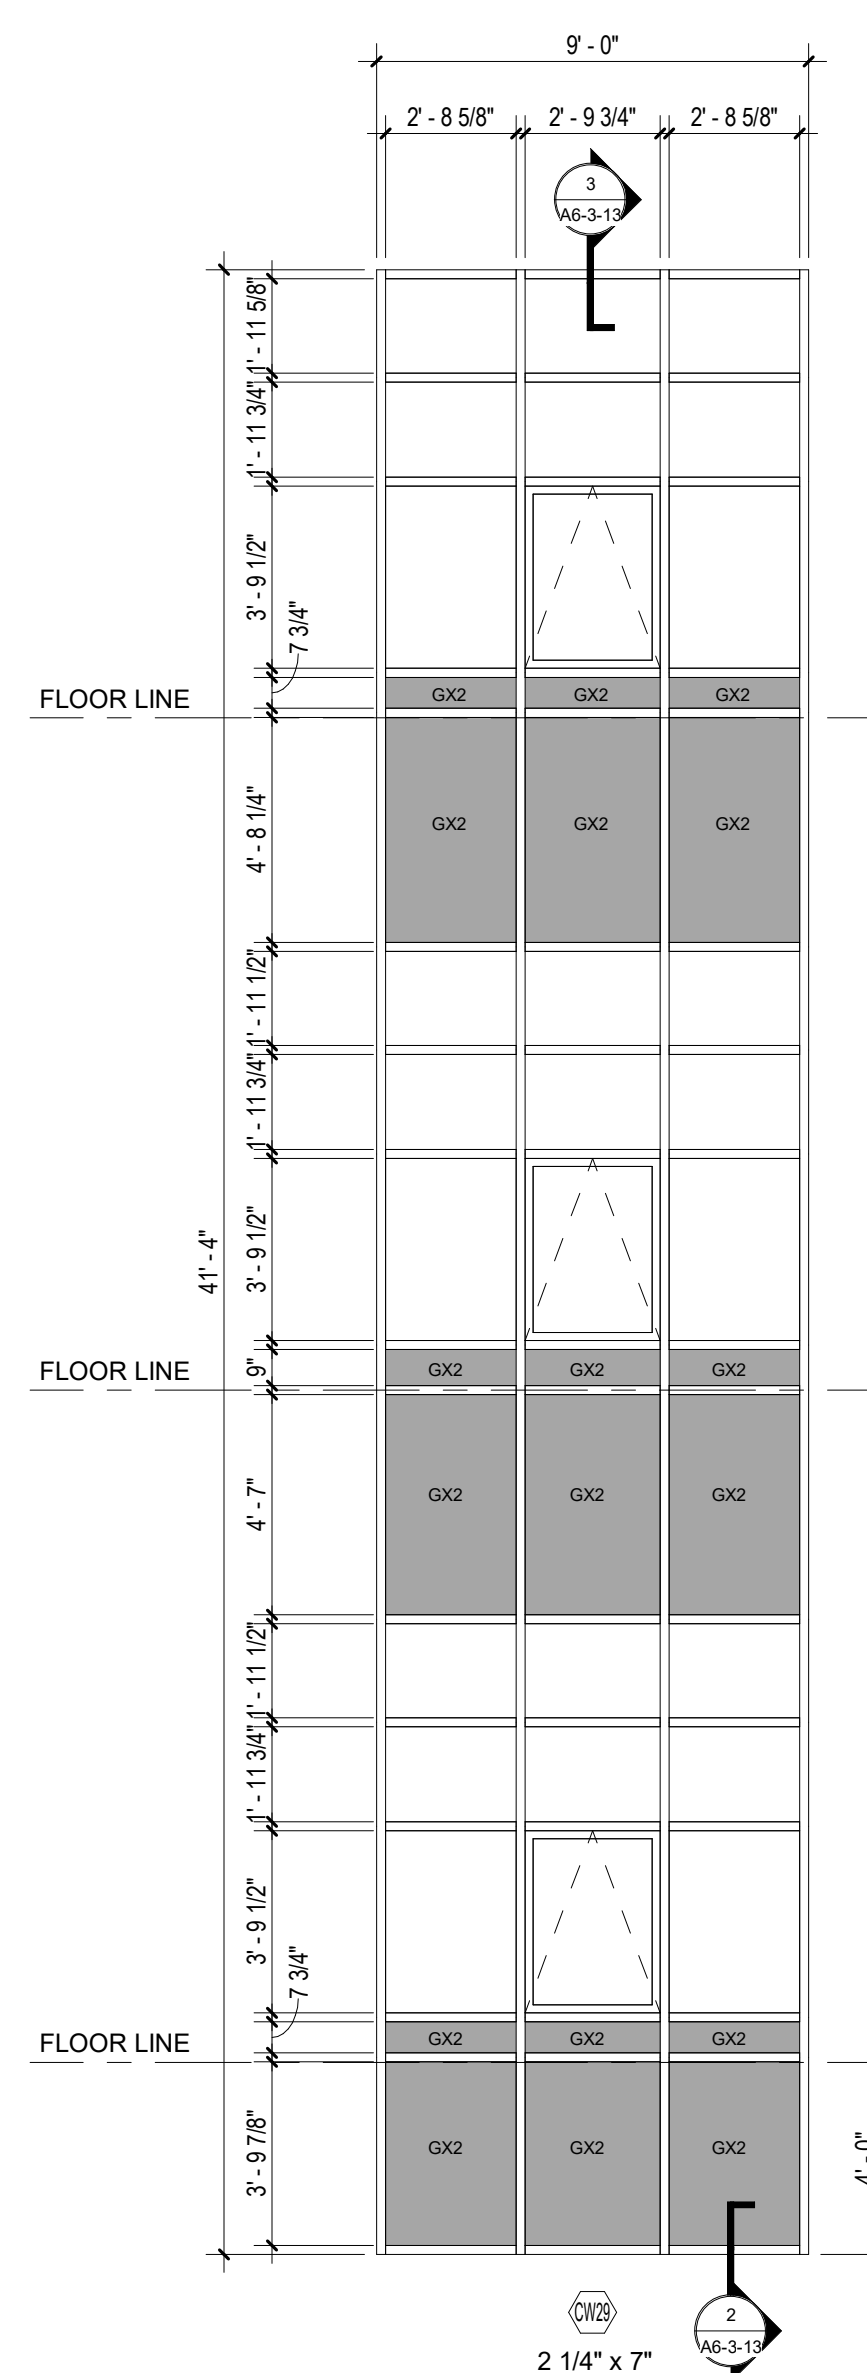

MSBA 90% CD
SUBMISSION

May 12TH, 2023



PROJECT NORTH	MAGNETIC NORTH
---------------	----------------

CURTAIN WALL TYPES

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

100 Hemlock Road,
Wakefield, MA 01880


GENERAL NOTES – STOREFRONT / CURTAIN WALL TYPES

1. INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
2. EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE GX1
3. AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION BEHIND ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
4. PROVIDE SAFETY GLAZING AT ALL LOCATIONS IDENTIFIED AS HAZARDOUS LOCATIONS PER THE 2015 IBC AND THE 2015 CALIFORNIA STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
5. PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS
6. "SG" DENOTES LOCATION OF SAFETY GLAZING
7. SEE DOOR SCHEDULE FOR DOOR TYPES

May 12TH, 2023




MAGNETIC NORTH



Date: May 12
Volume 3 of 4

A6-3-5

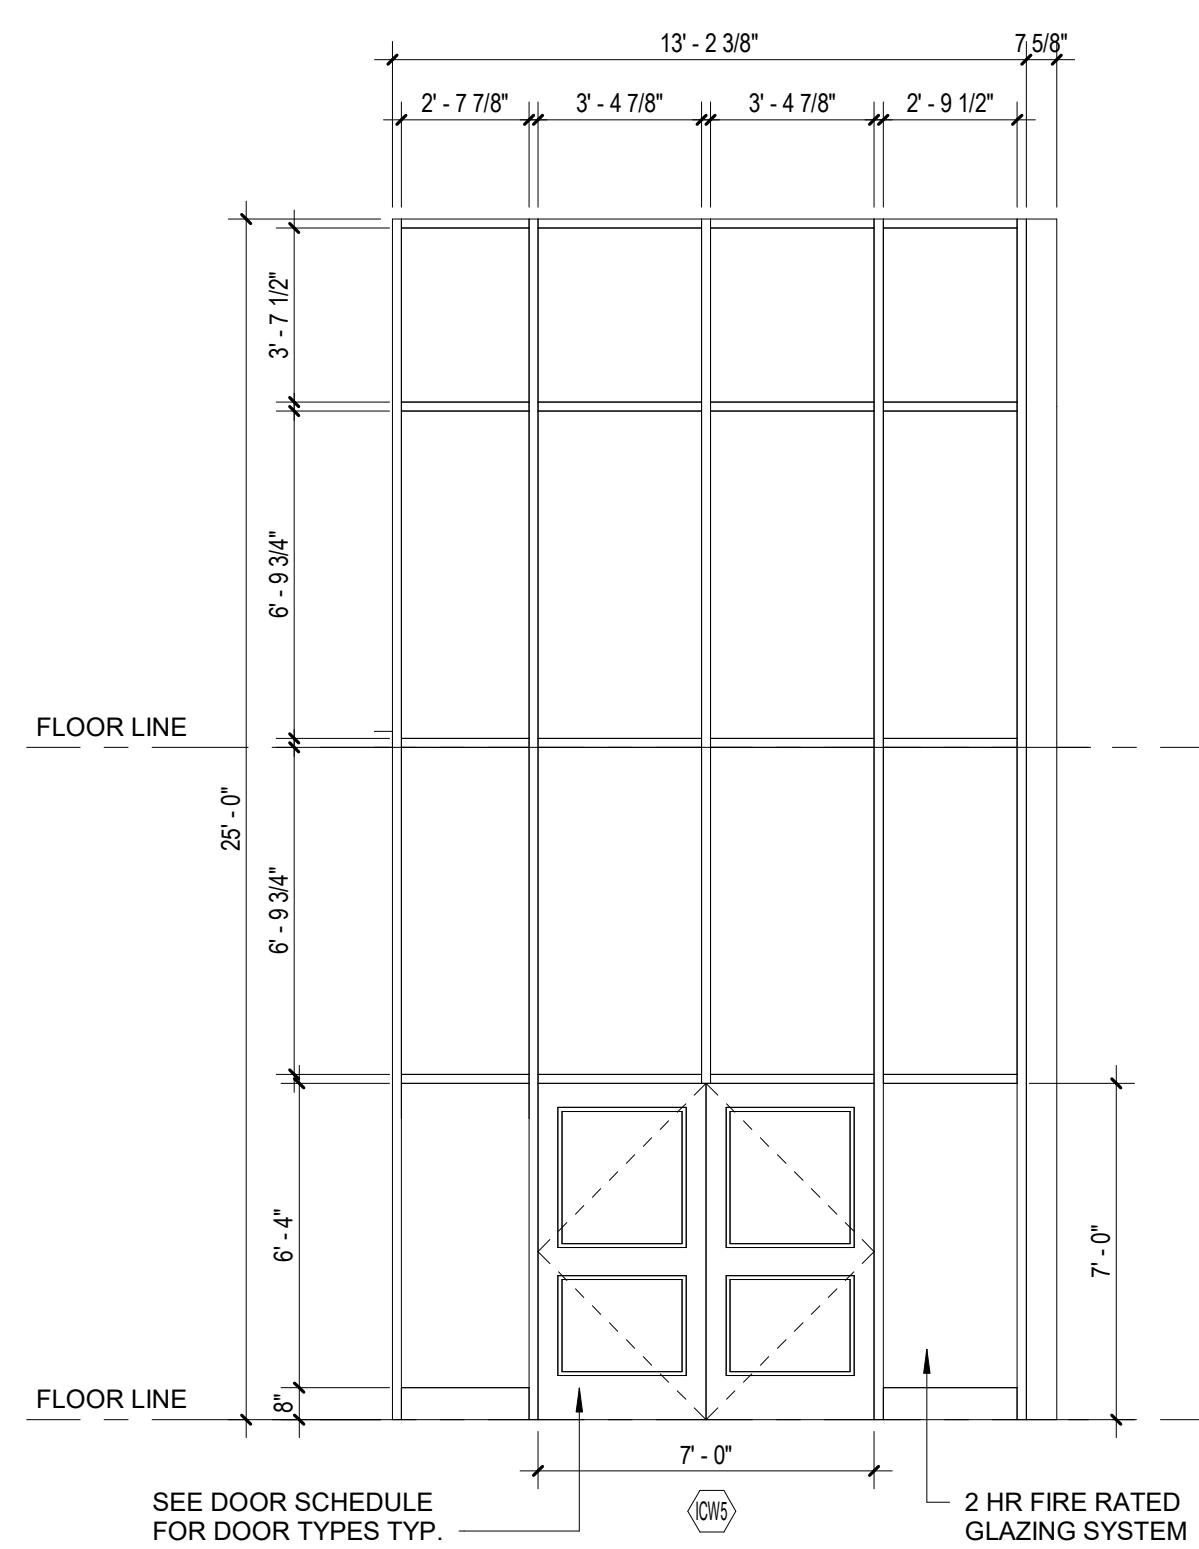

1 INTERIOR CURTAIN WALL TYPES

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

GENERAL NOTES – STOREFRONT / CURTAIN WALL TYPES

1. INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
2. EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE GX1
3. AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION MINIMUM ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
4. PROVIDE SAFETY GLAZING AT ALL LOCATIONS WHERE THERE IS A HAZARD TO PERSONS PER THE 8TH EDITION OF THE MASSACHUSETTS STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
5. PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS.
6. "SG" DENOTES LOCATION OF SAFETY GLAZING
7. SEE DOOR SCHEDULE FOR DOOR TYPES

[illegible][illegible]

The diagram shows a cross-section of a wall above a floor line. The total height from the floor line to the top of the wall is 8'-0". The width of the wall at the base is 3'-8 1/2". At the top, there are two horizontal segments, each 2'-4" wide, separated by a gap of 4'-0". A circular feature with a diameter of 6'-7 1/2" is centered above the gap. Below the main wall section, there is a lower section with a height of 4'-0" and a width of 2'-5 1/2". The distance from the floor line to the bottom of this lower section is 3'-4". A dimension line indicates a distance of 2'-5 1/2" from the floor line to the start of the lower section.

[illegible]

Figure 10 is a technical drawing showing the elevation of a window unit. The overall dimensions are 6'-4" in height and 6'-1 1/2" in width. The unit is composed of several rectangular sections. The top section has a width of 2'-4" and a height of 2'-4". The bottom section has a width of 2'-4" and a height of 2'-4". The middle section has a width of 2'-4" and a height of 2'-4". The unit is also divided into sections with widths of 2'-6" and 2'-4". The unit is shown with a dashed line indicating the floor line below it.


Architectural elevation drawing of a building facade. The drawing shows a series of vertical columns and horizontal beams. Key dimensions are labeled: overall height is 8'-0", overall width is 31'-0", and a section cut is indicated at the top right. A floor line is shown at the bottom. The drawing is oriented horizontally on the page.

Figure 1 shows the elevation view of a window unit. The unit is 3'-6" wide and 9'-4" high. It features a double-hung design with two main sashes. The top sash is 1'-5" high, and the bottom sash is 5'-6" high. The bottom sash has a 1'-5" high section at the bottom. The unit is shown above a dashed line labeled "FLOOR LINE".

[illegible]

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

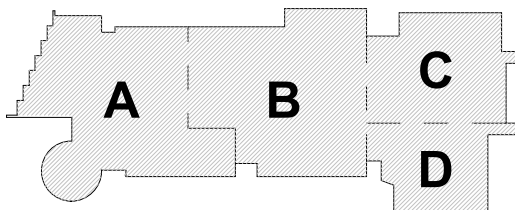

KEY PLAN

PROJECT NORT

MAGNETIC NORTH

STOREFRONT AND INTERIOR STOREFRONT TYPES

Scale: As indicated

Job No.: 20202

















Drawn By: DRA

Date: May 12TH, 2023

A6-3-6

Volume 3 of 4

- GENERAL NOTES - STOREFRONT / CURTAIN WALL TYPES
- INTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE G1.
 - EXTERIOR SYSTEMS: UNLESS NOTED OTHERWISE GLAZING SHALL BE TYPE GX1
 - AT ALL EXTERIOR CURTAIN WALLS AND STOREFRONTS PROVIDE MINIMUM 2" RIGID INSULATION BEHIND ALL SPANDREL GLASS AND OTHER OPAQUE GLAZING. INSULATION IS NOT SHOWN IN SOME CASES FOR CLARITY.
 - PROVIDE SAFETY GLAZING AT ALL LOCATIONS IDENTIFIED AS HAZARDOUS LOCATIONS PER THE 9TH EDITION OF THE MASSACHUSETTS STATE BUILDING CODE AND THE 2015 EDITION OF THE INTERNATIONAL BUILDING CODE.
 - PROVIDE INSECT SCREENS AT ALL OPERABLE SASH LOCATIONS
 - "SG" DENOTES LOCATION OF SAFETY GLAZING
 - SEE DOOR SCHEDULE FOR DOOR TYPES

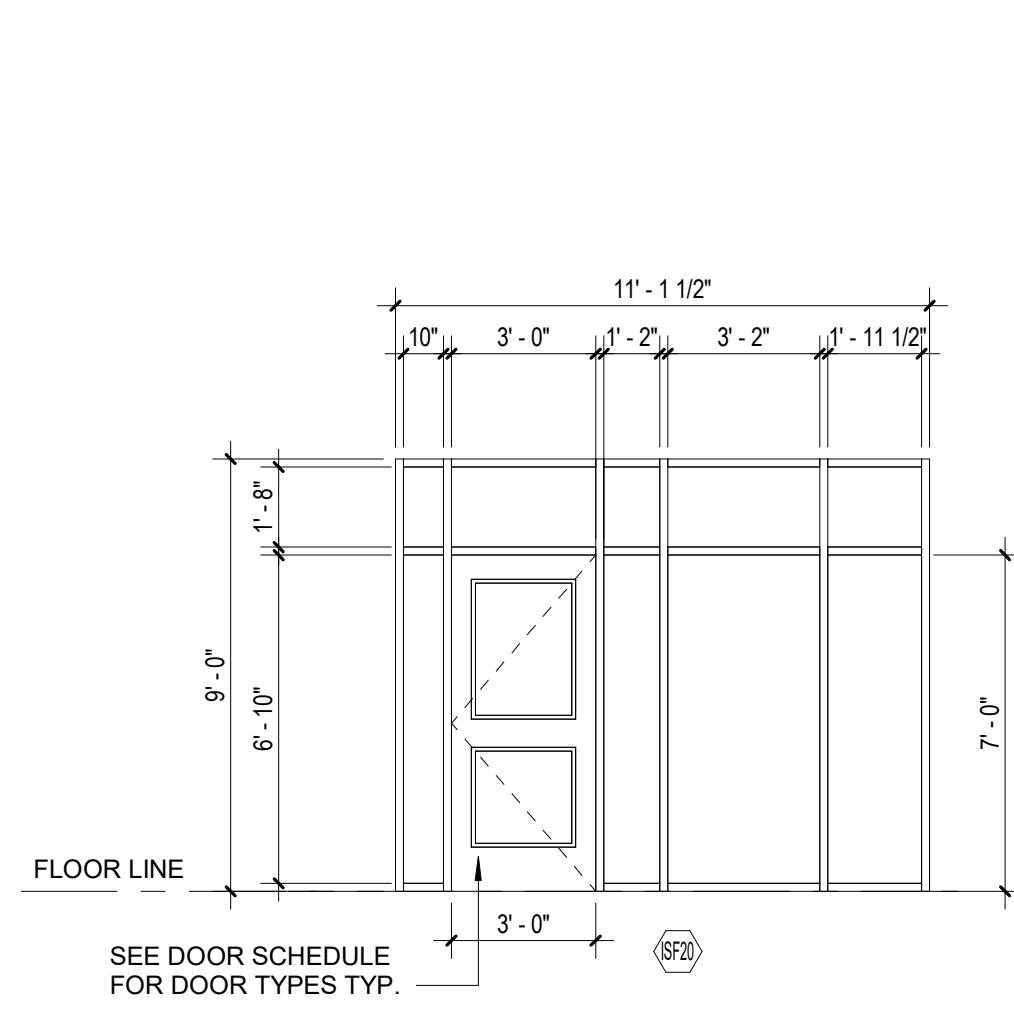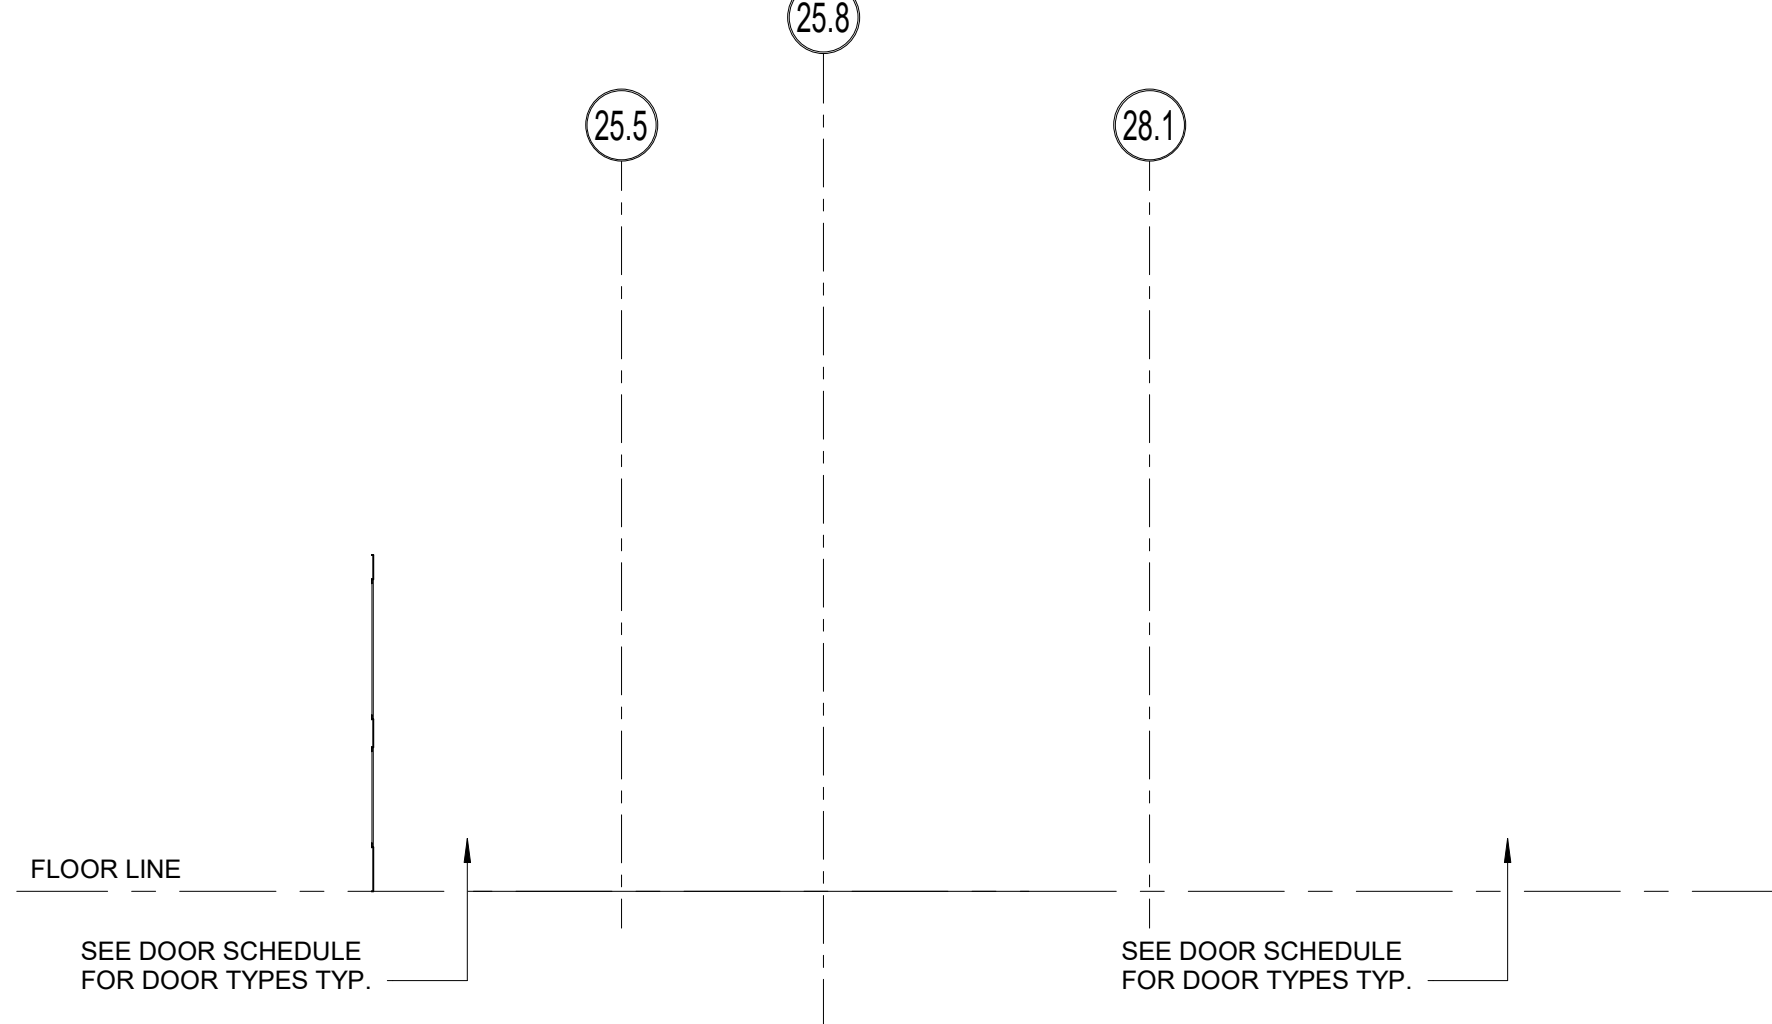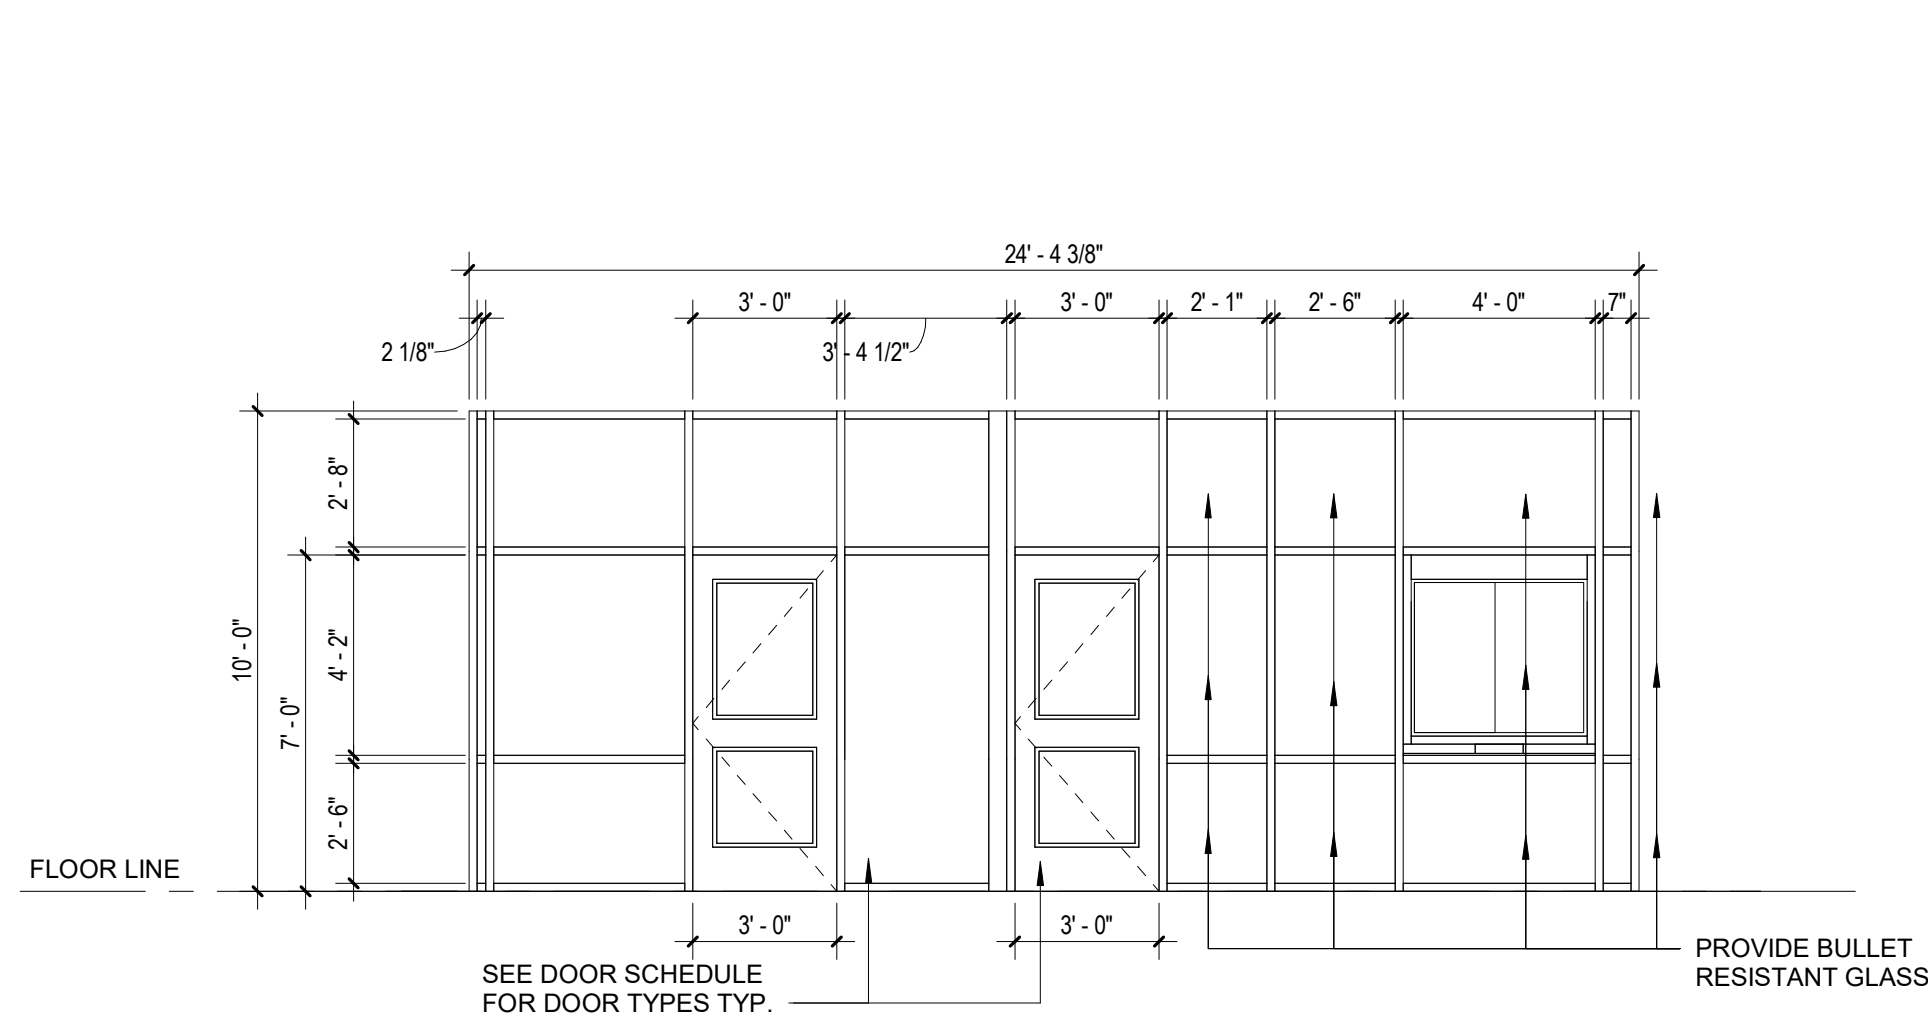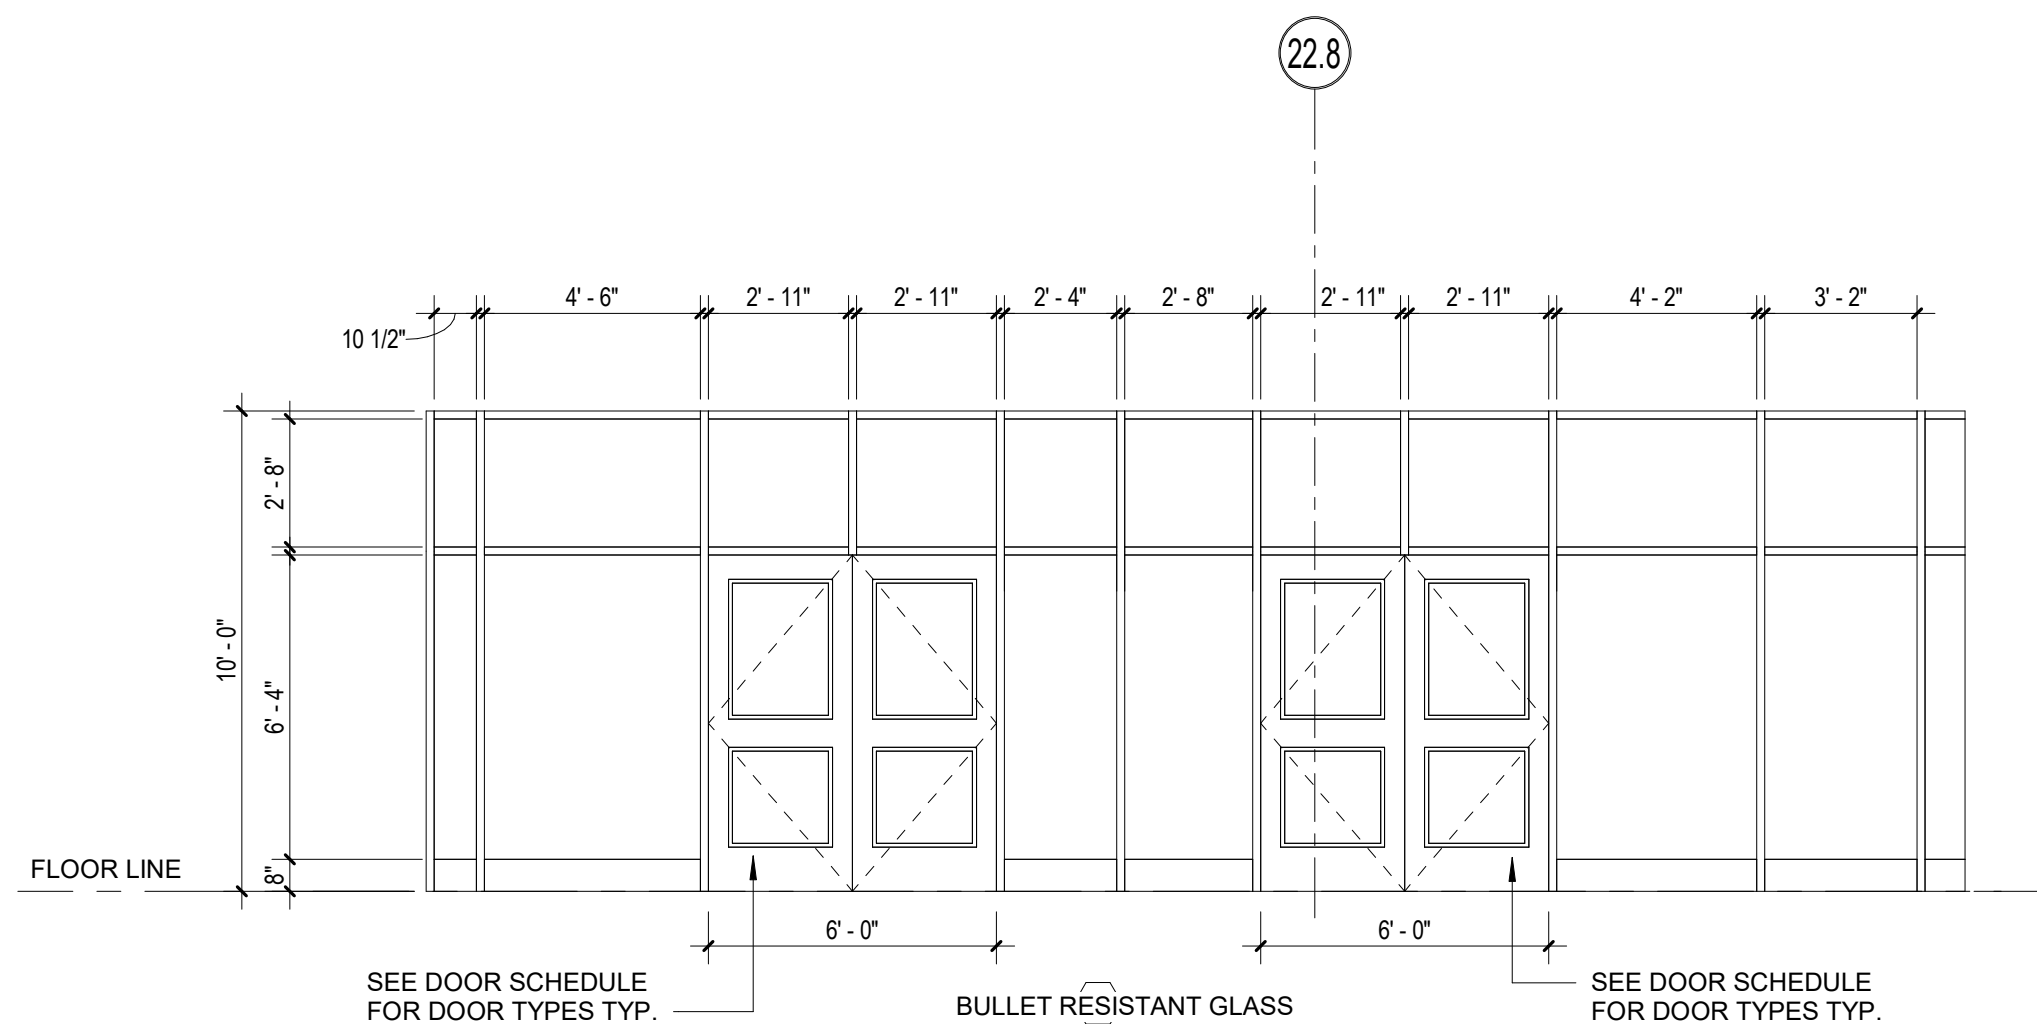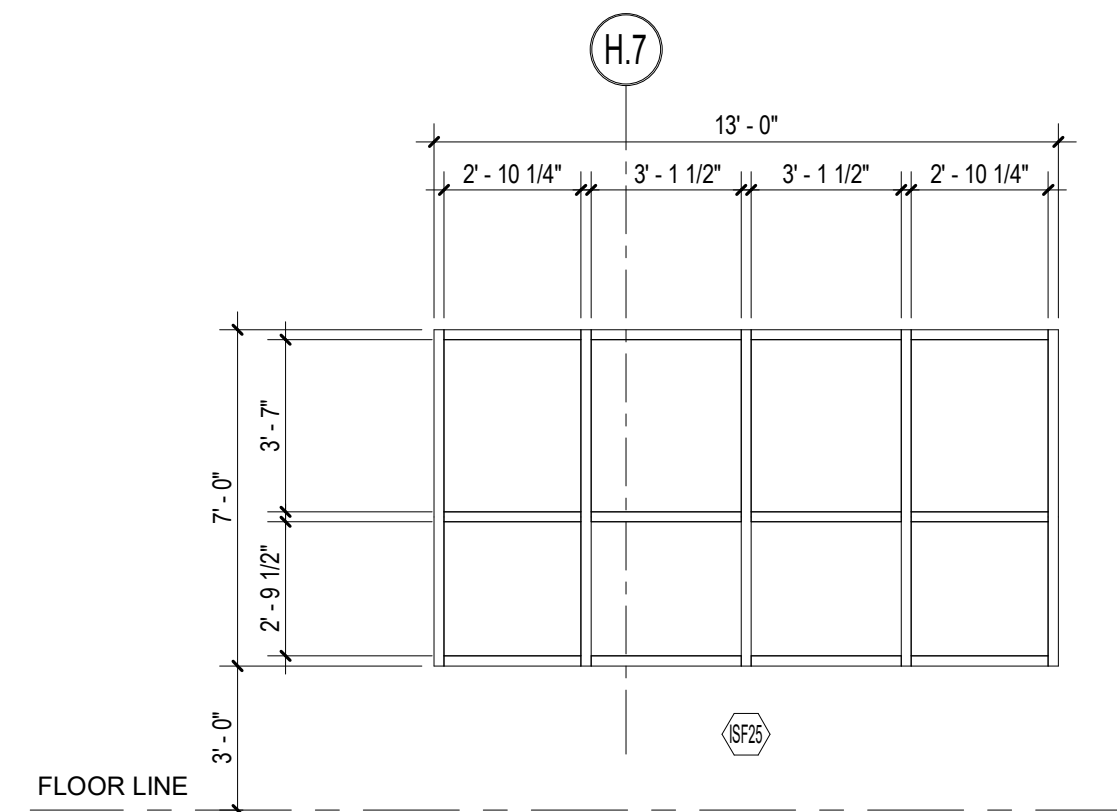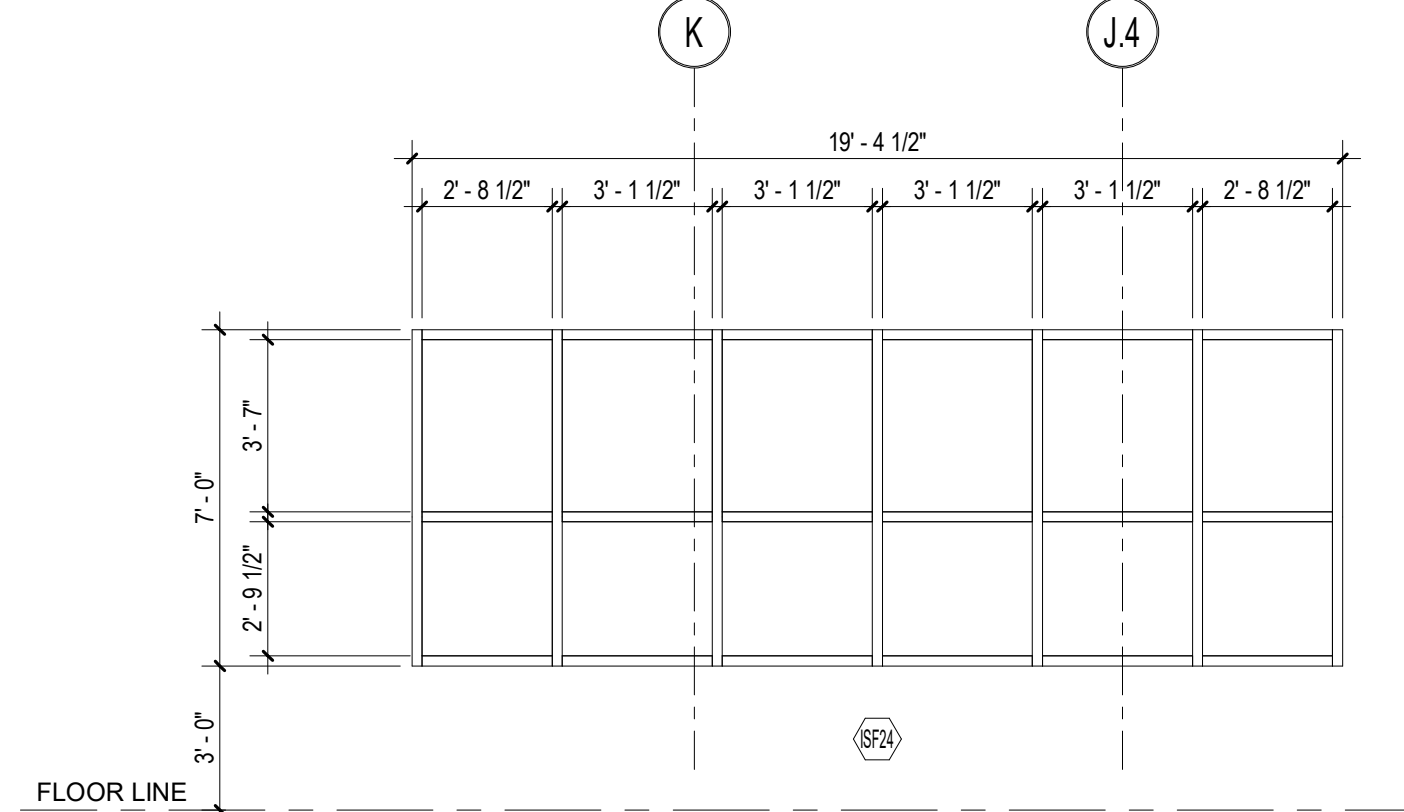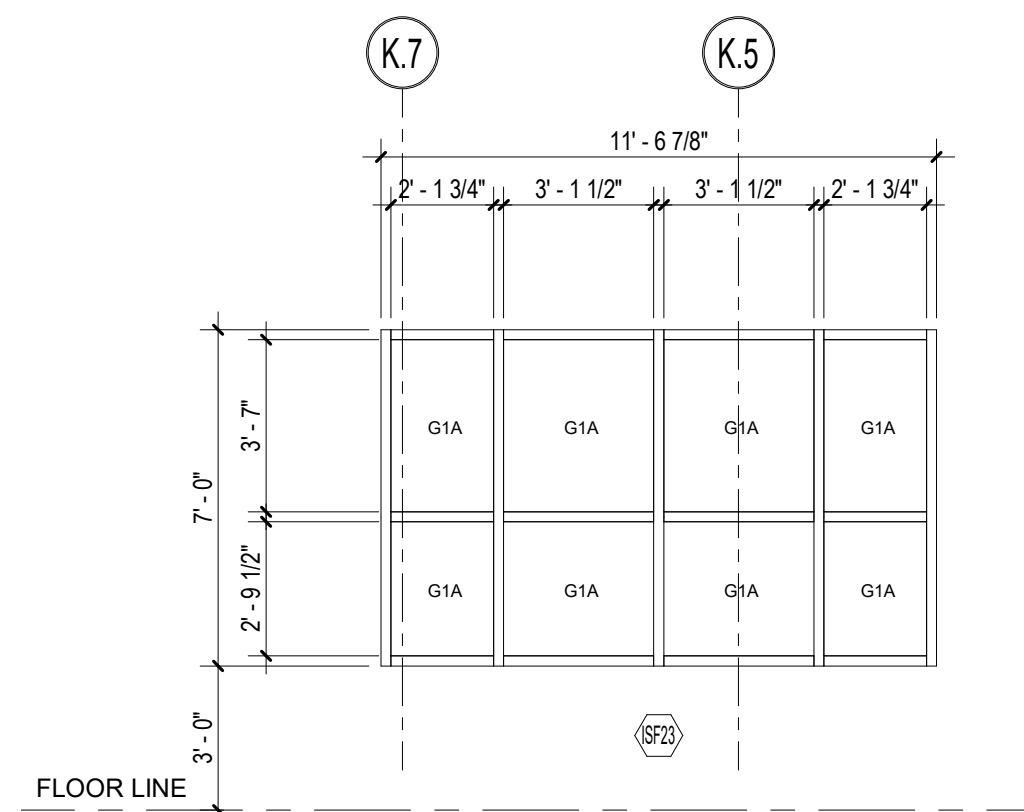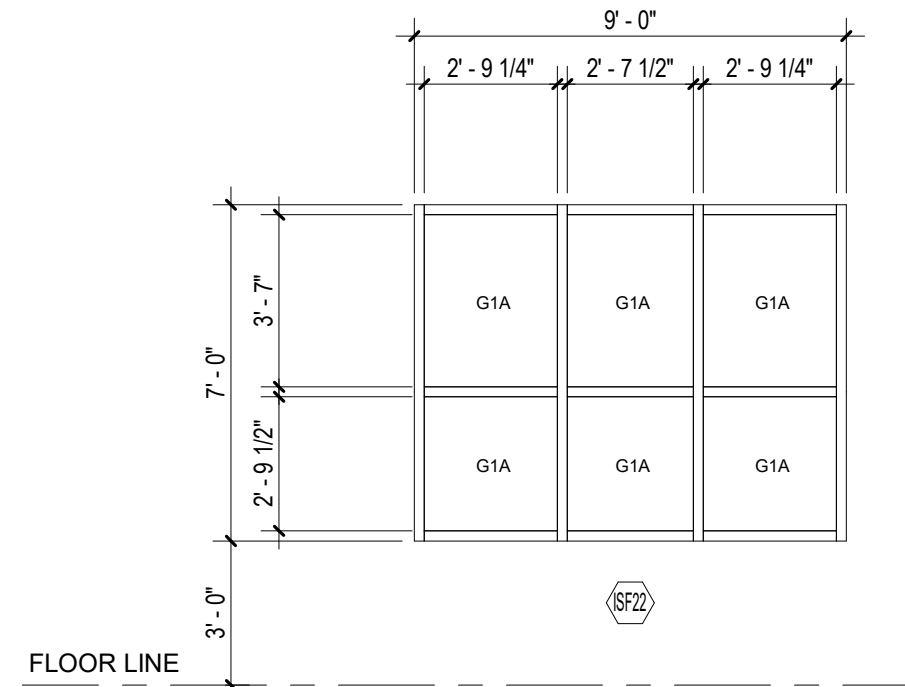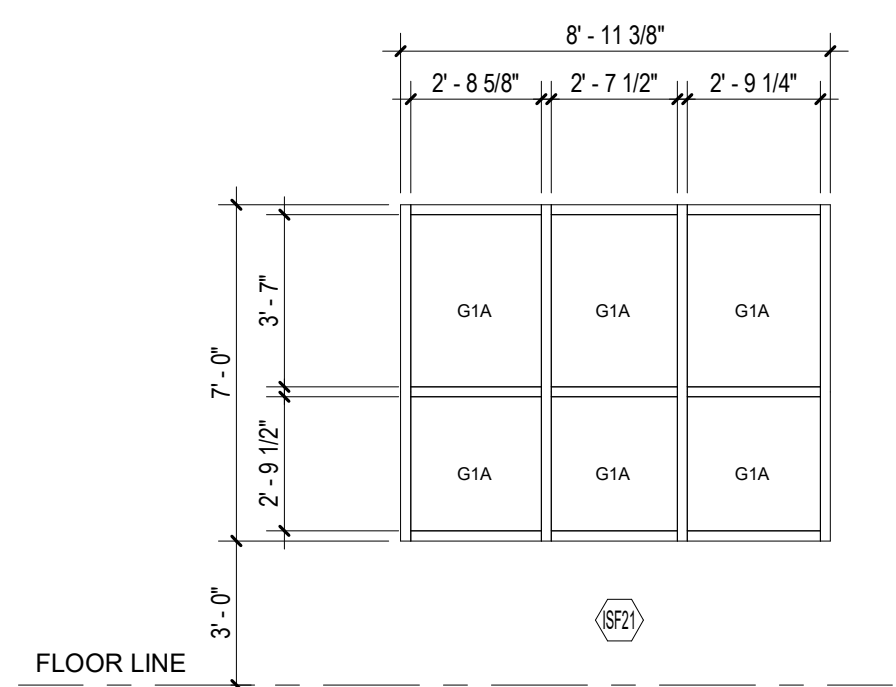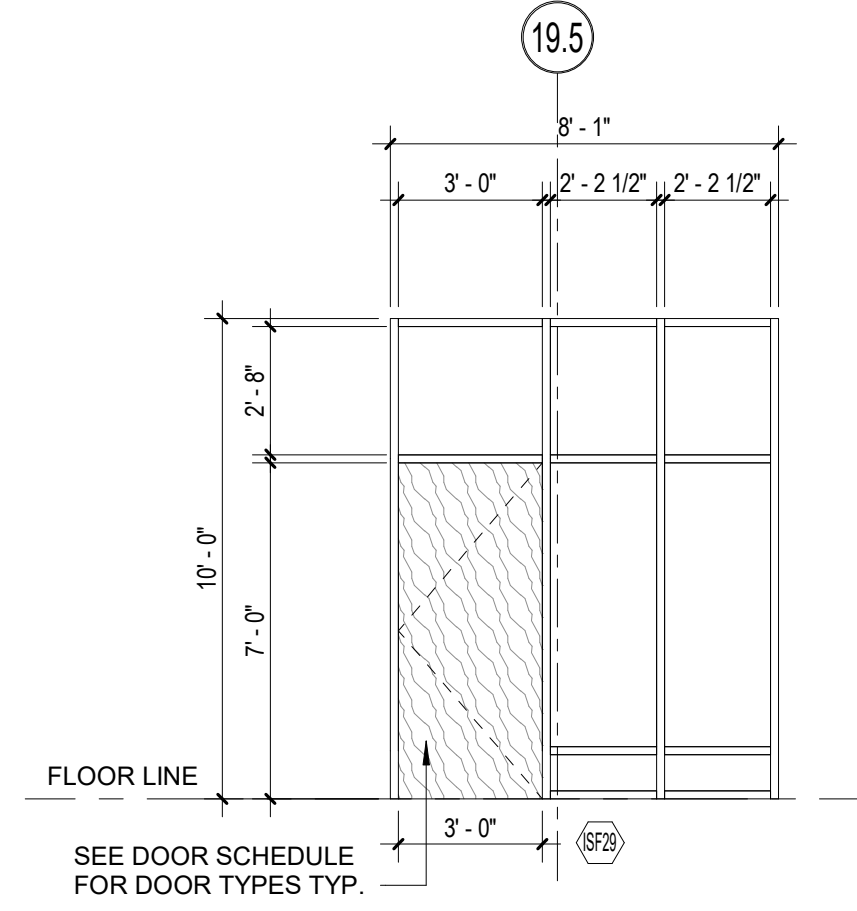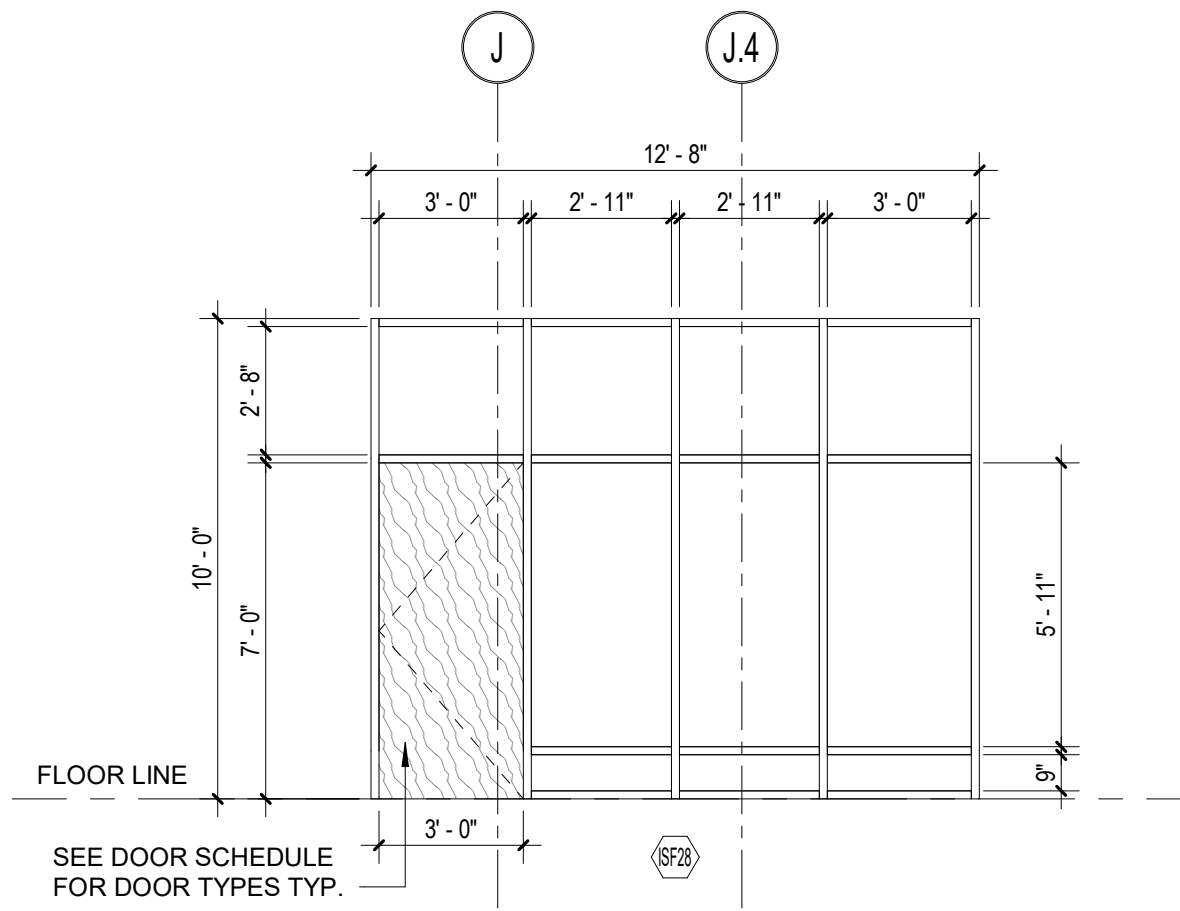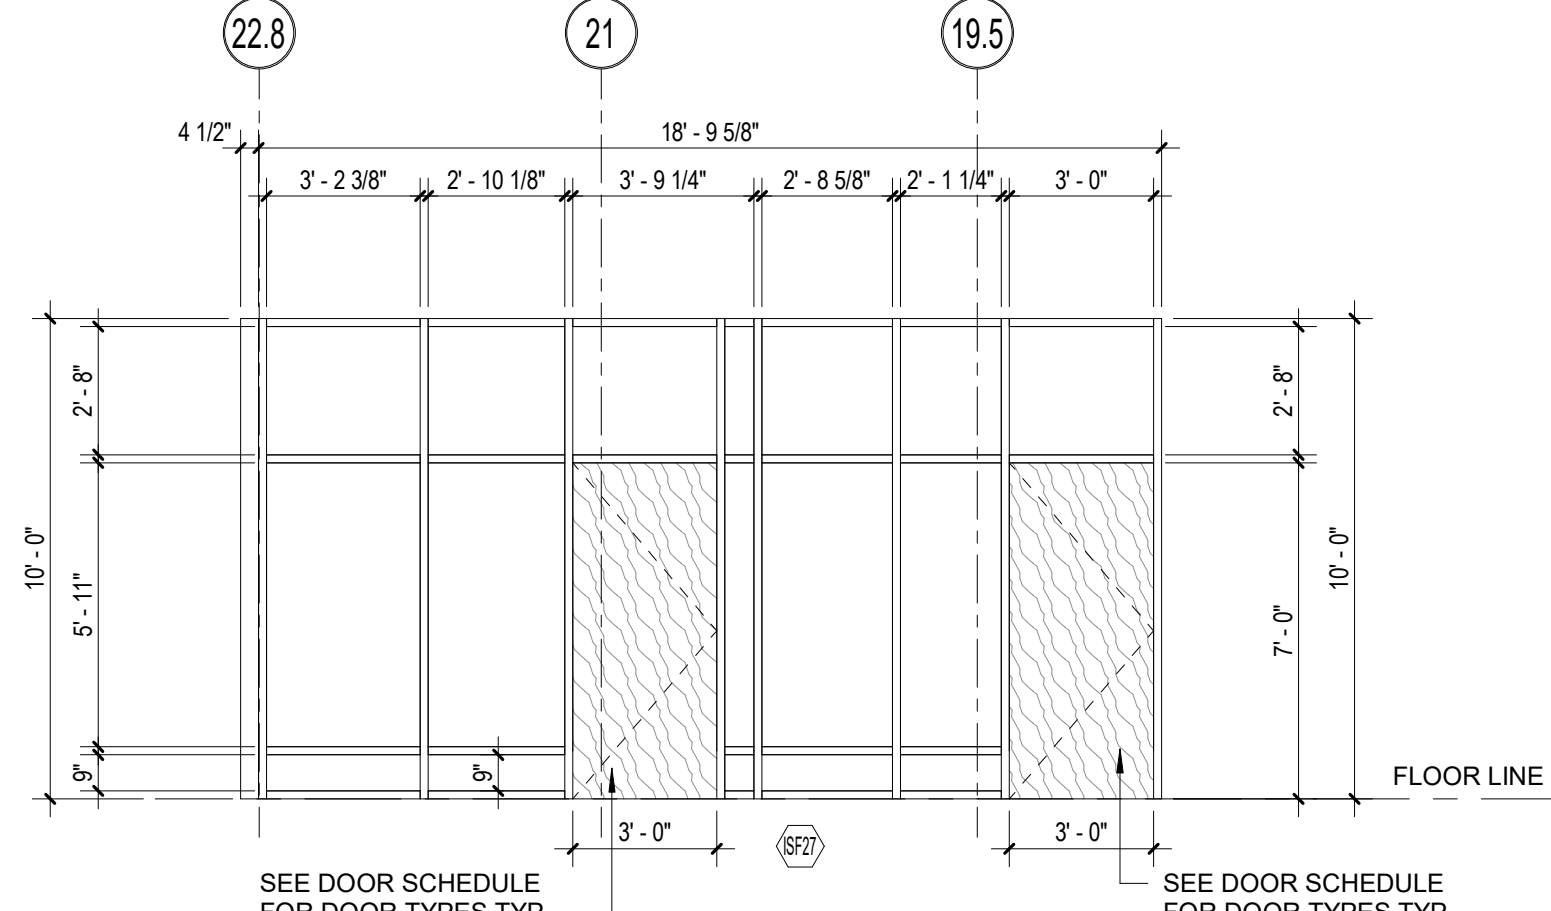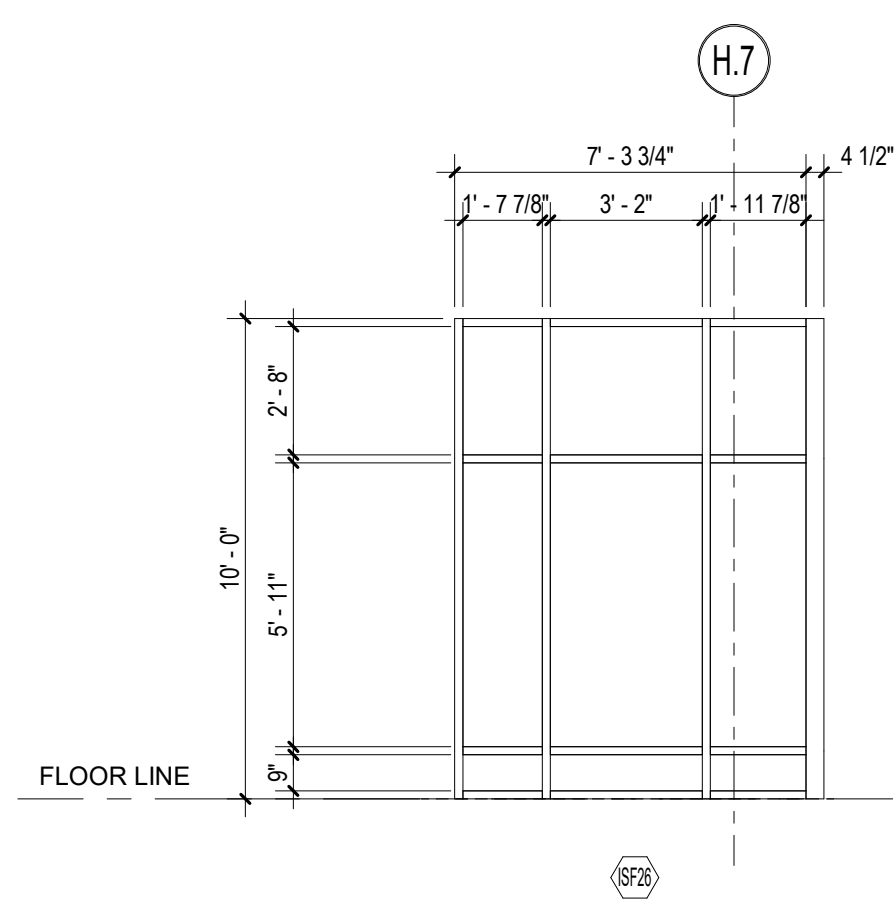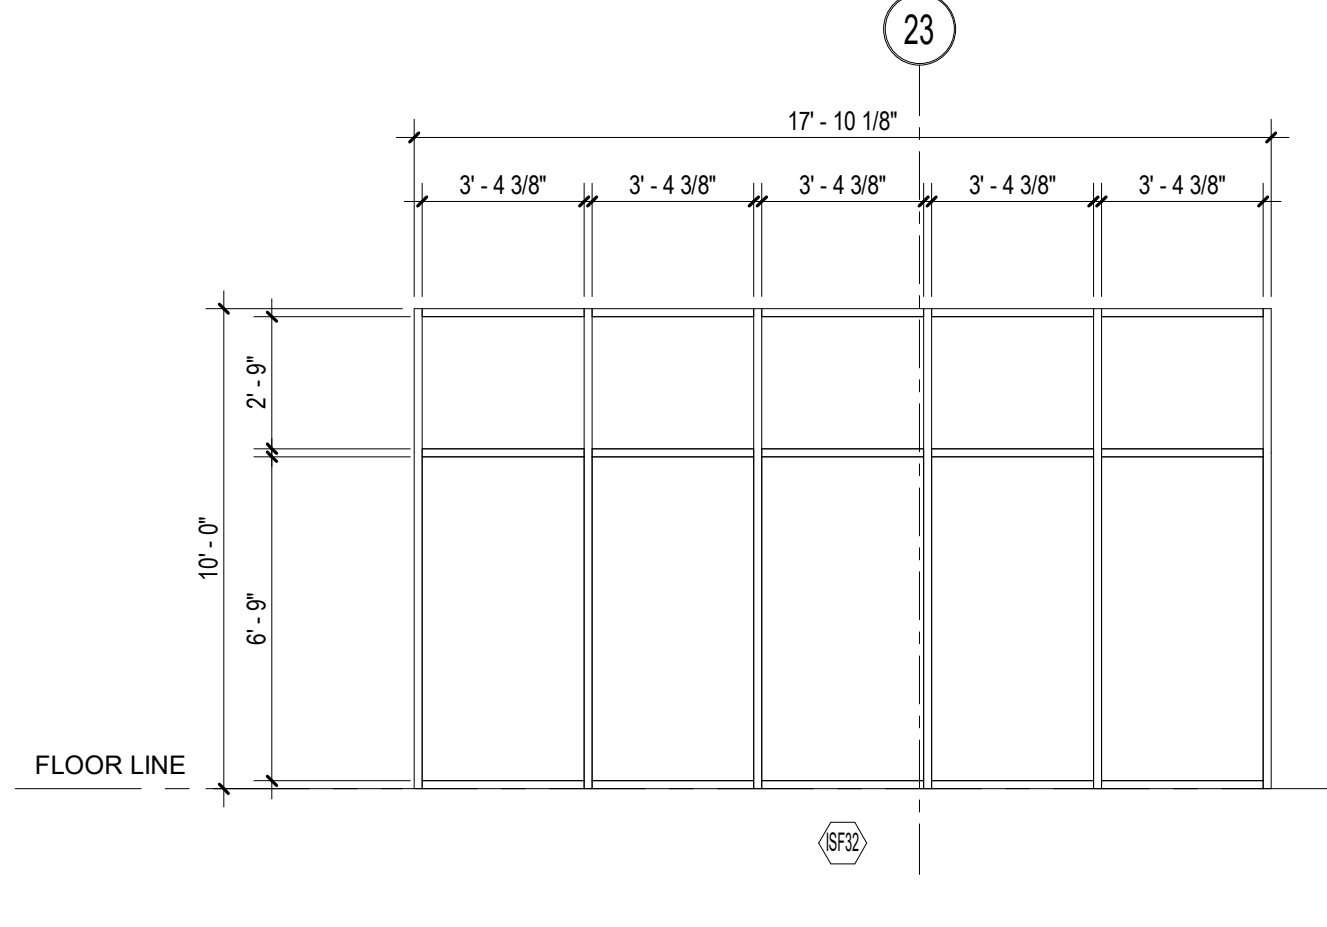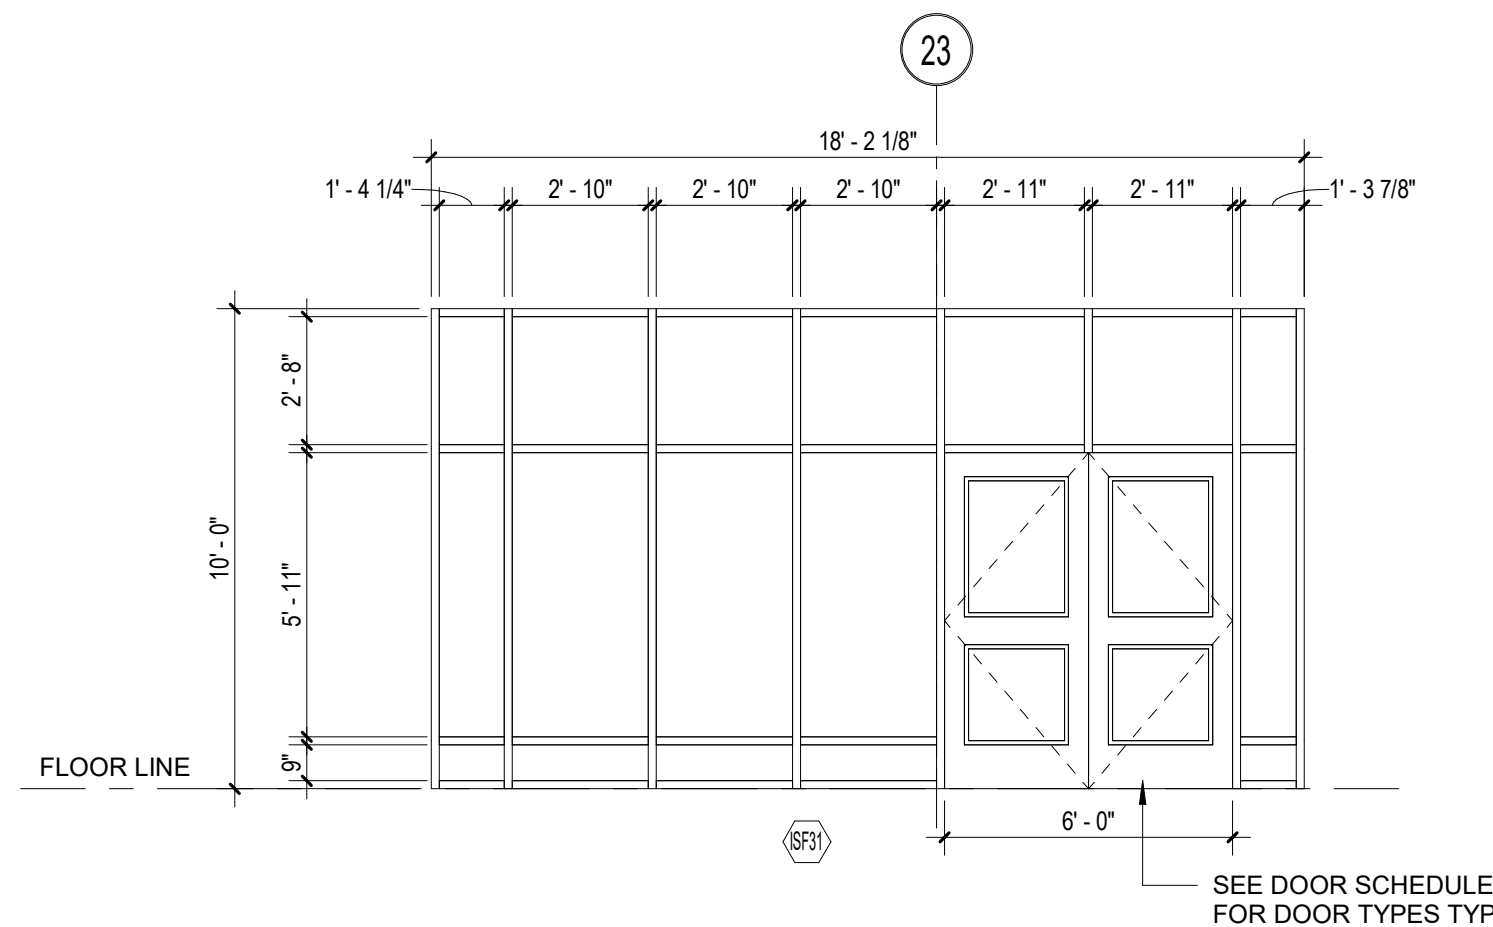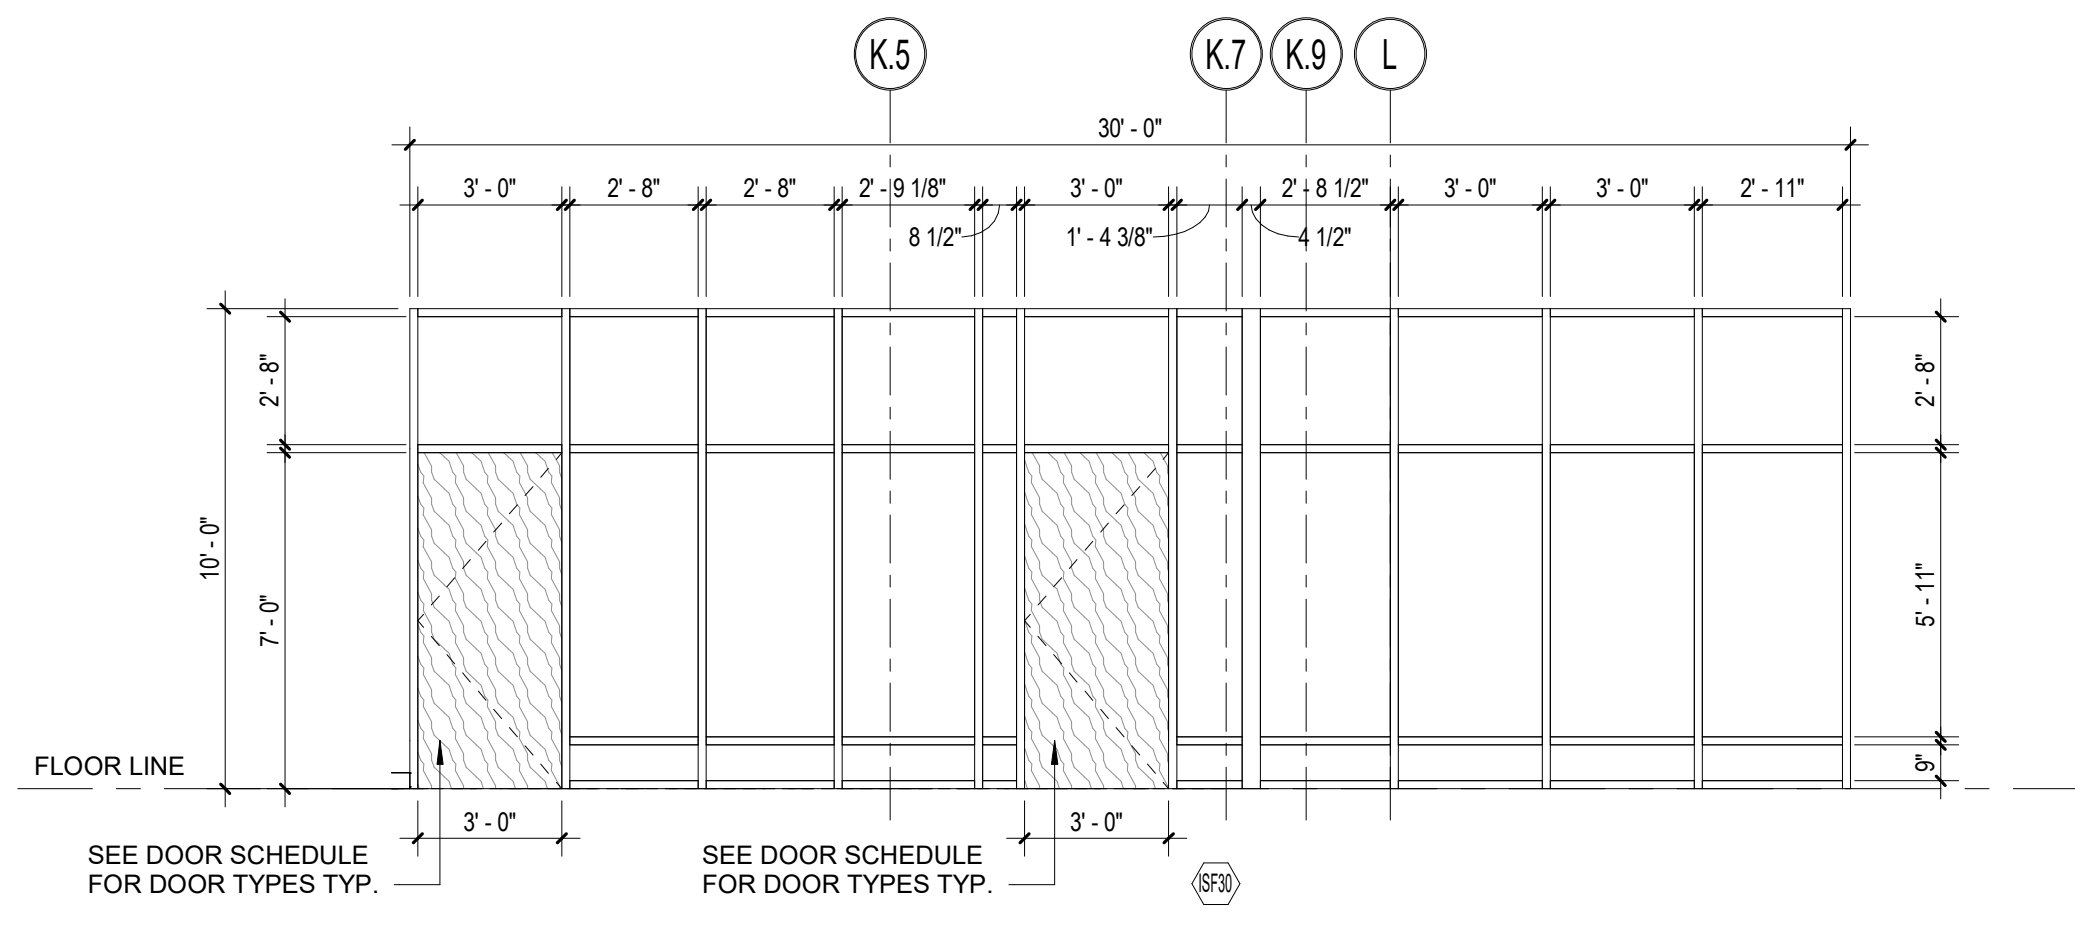

DRA


Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 817.854.1700
www.draa.com

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

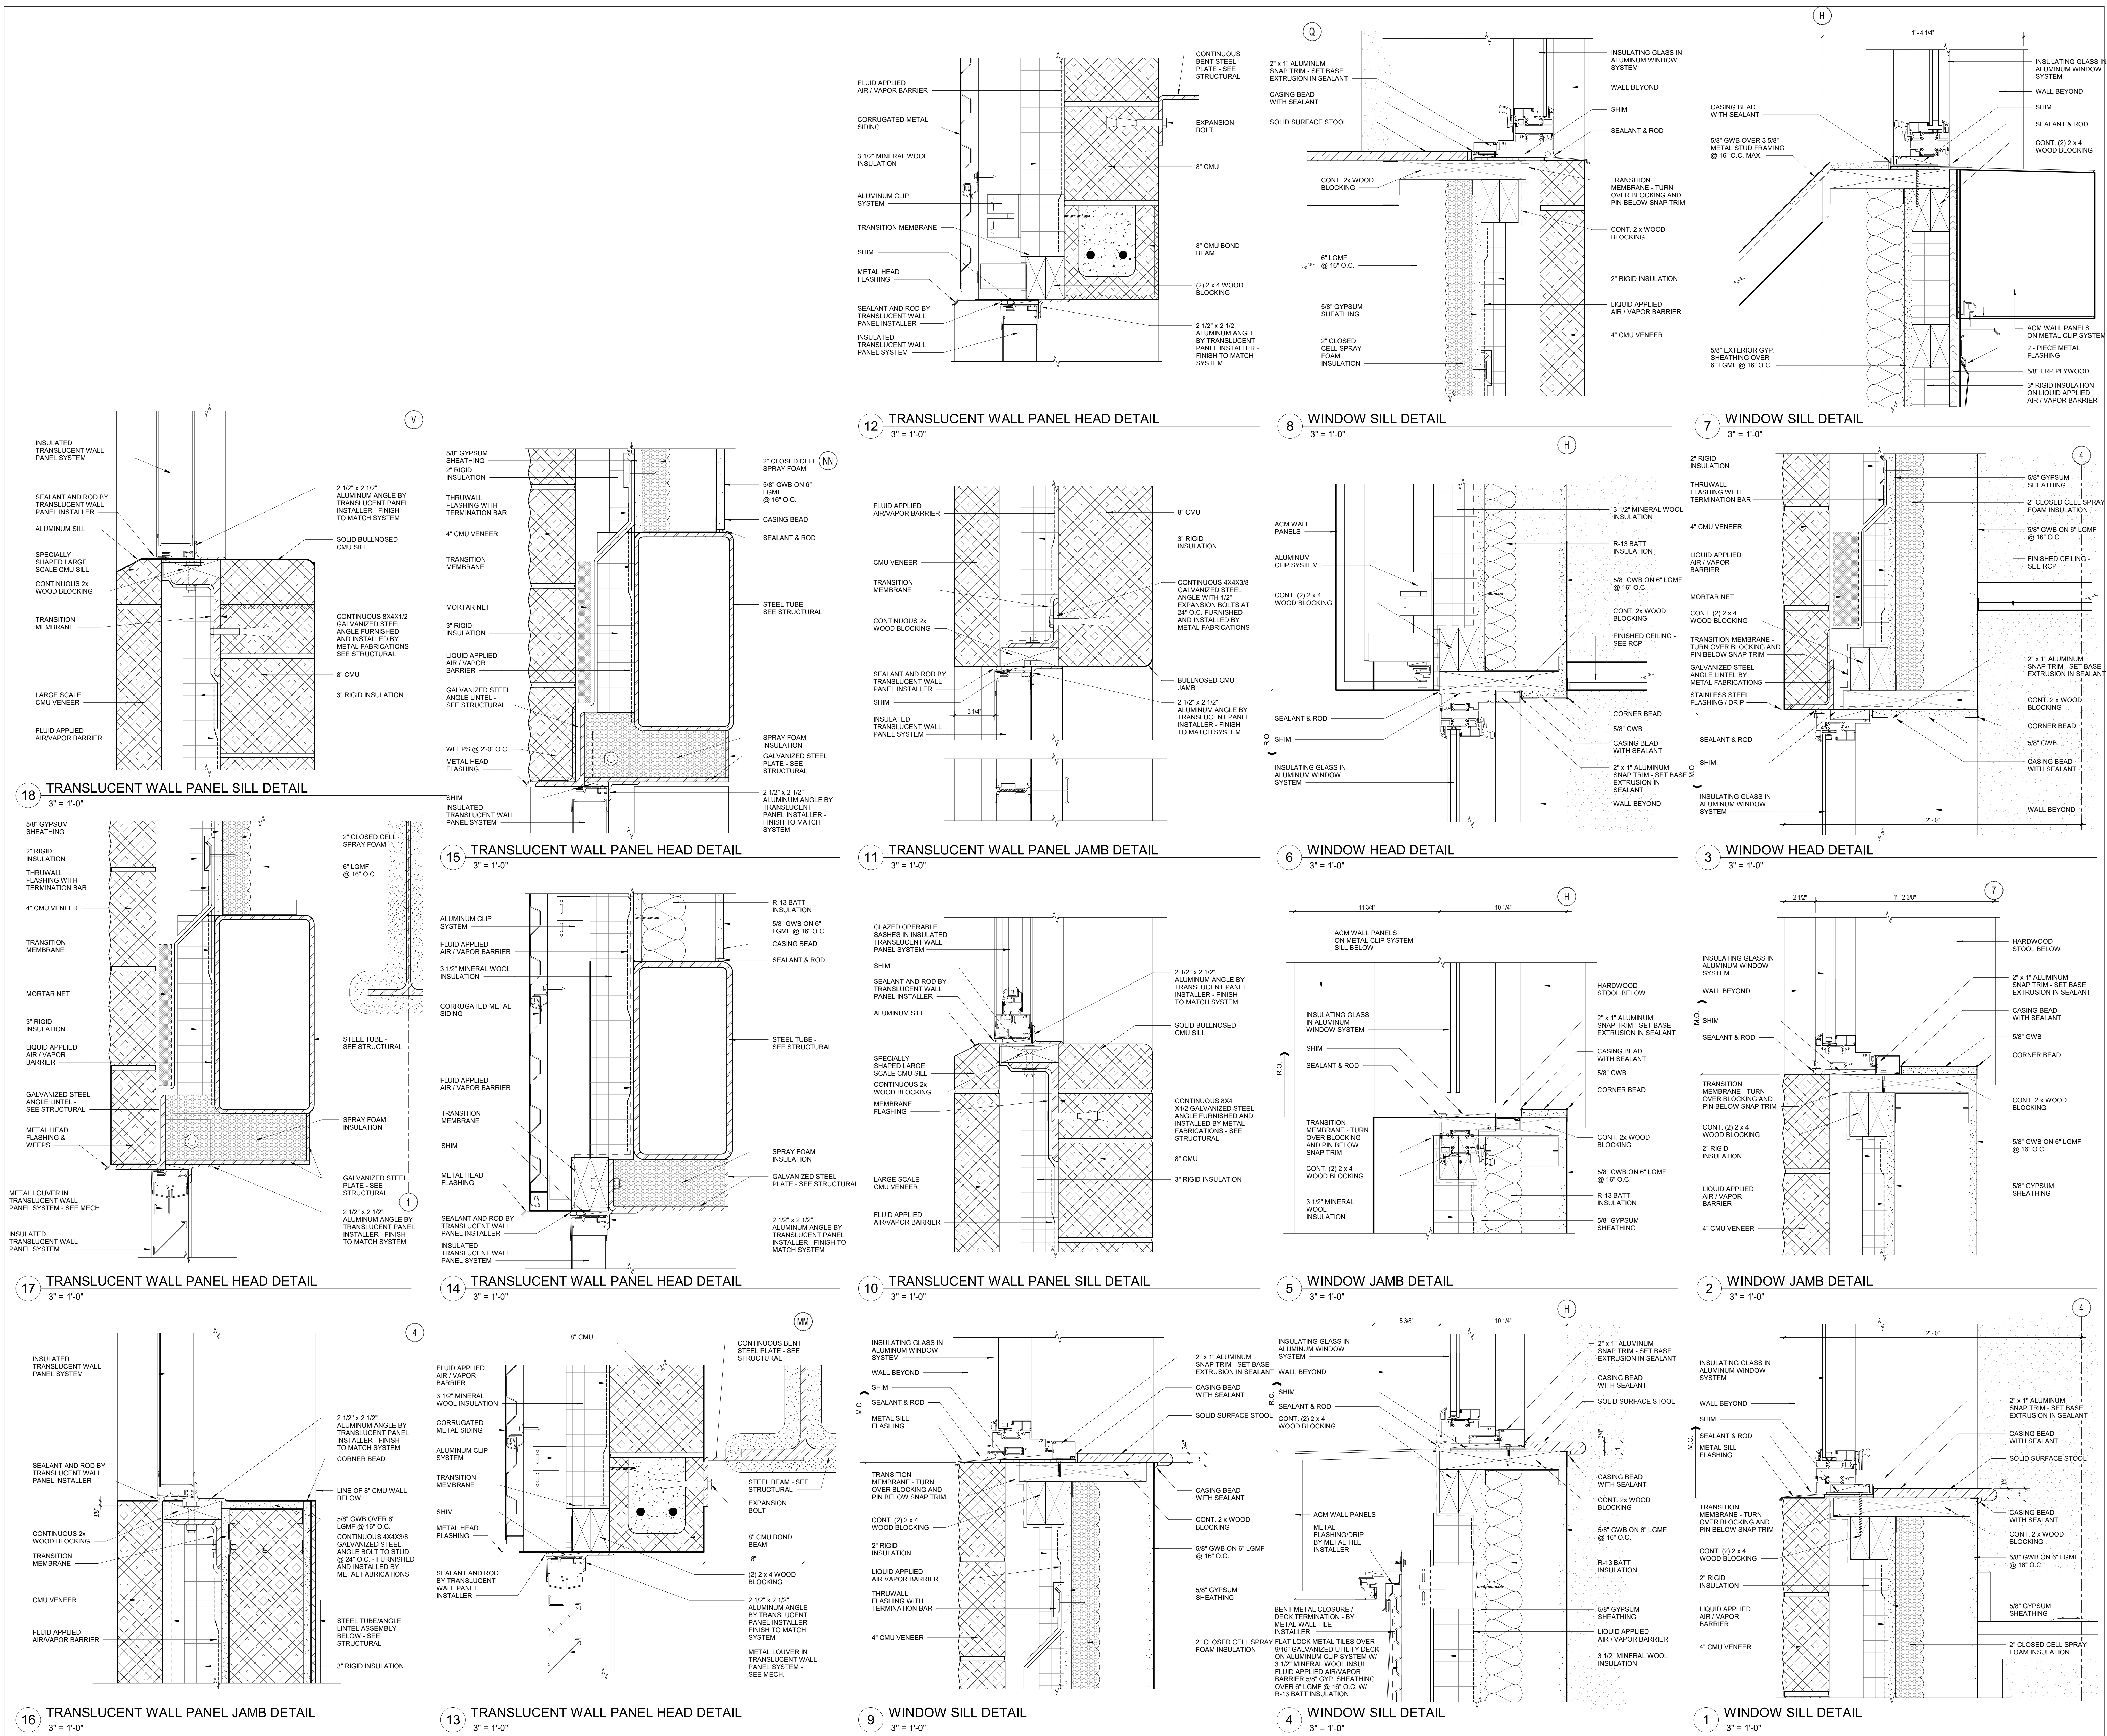

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

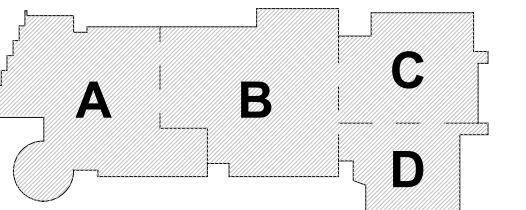

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH

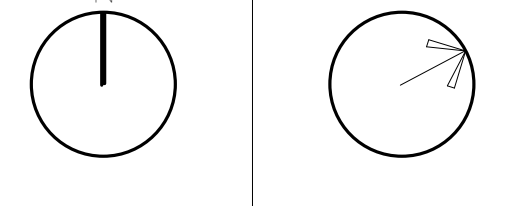

**WINDOW AND
TRANSLUCENT
WALL PANEL
DETAILS**

Scale: 3" = 1'-0"

Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A6-3-8

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

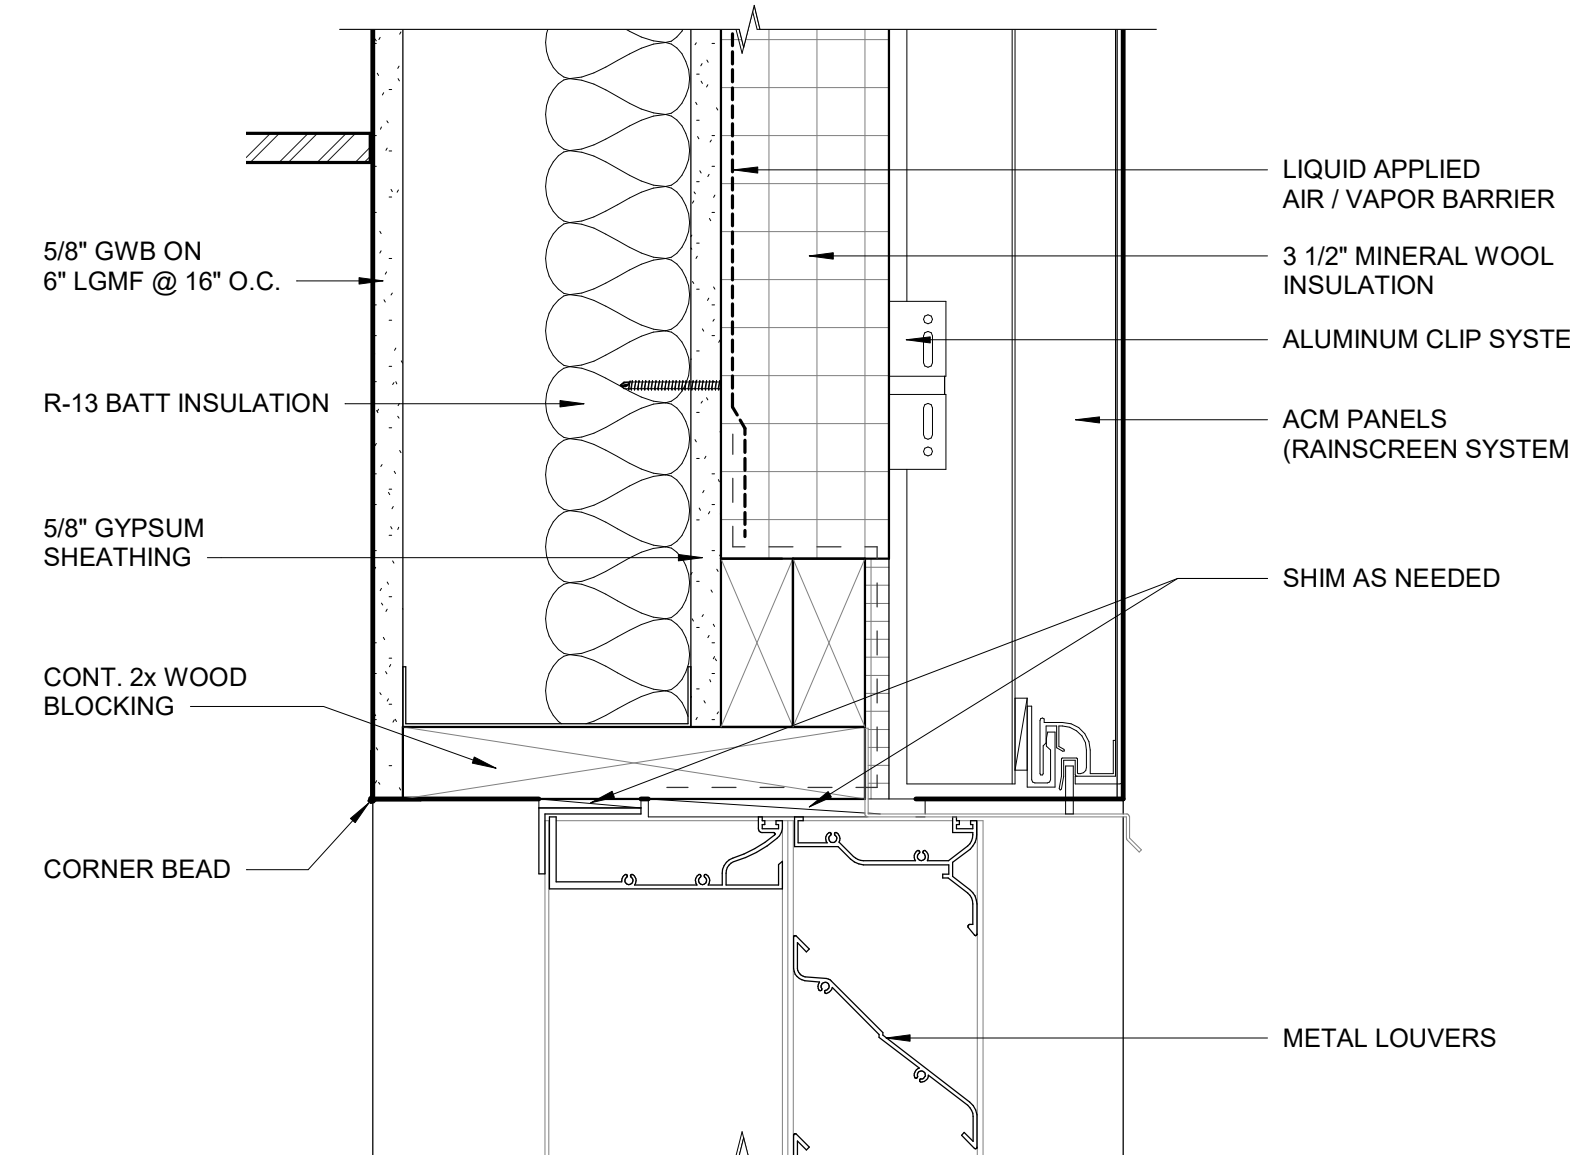


19 LOUVER - HEAD DETAIL
3" = 1'-0"

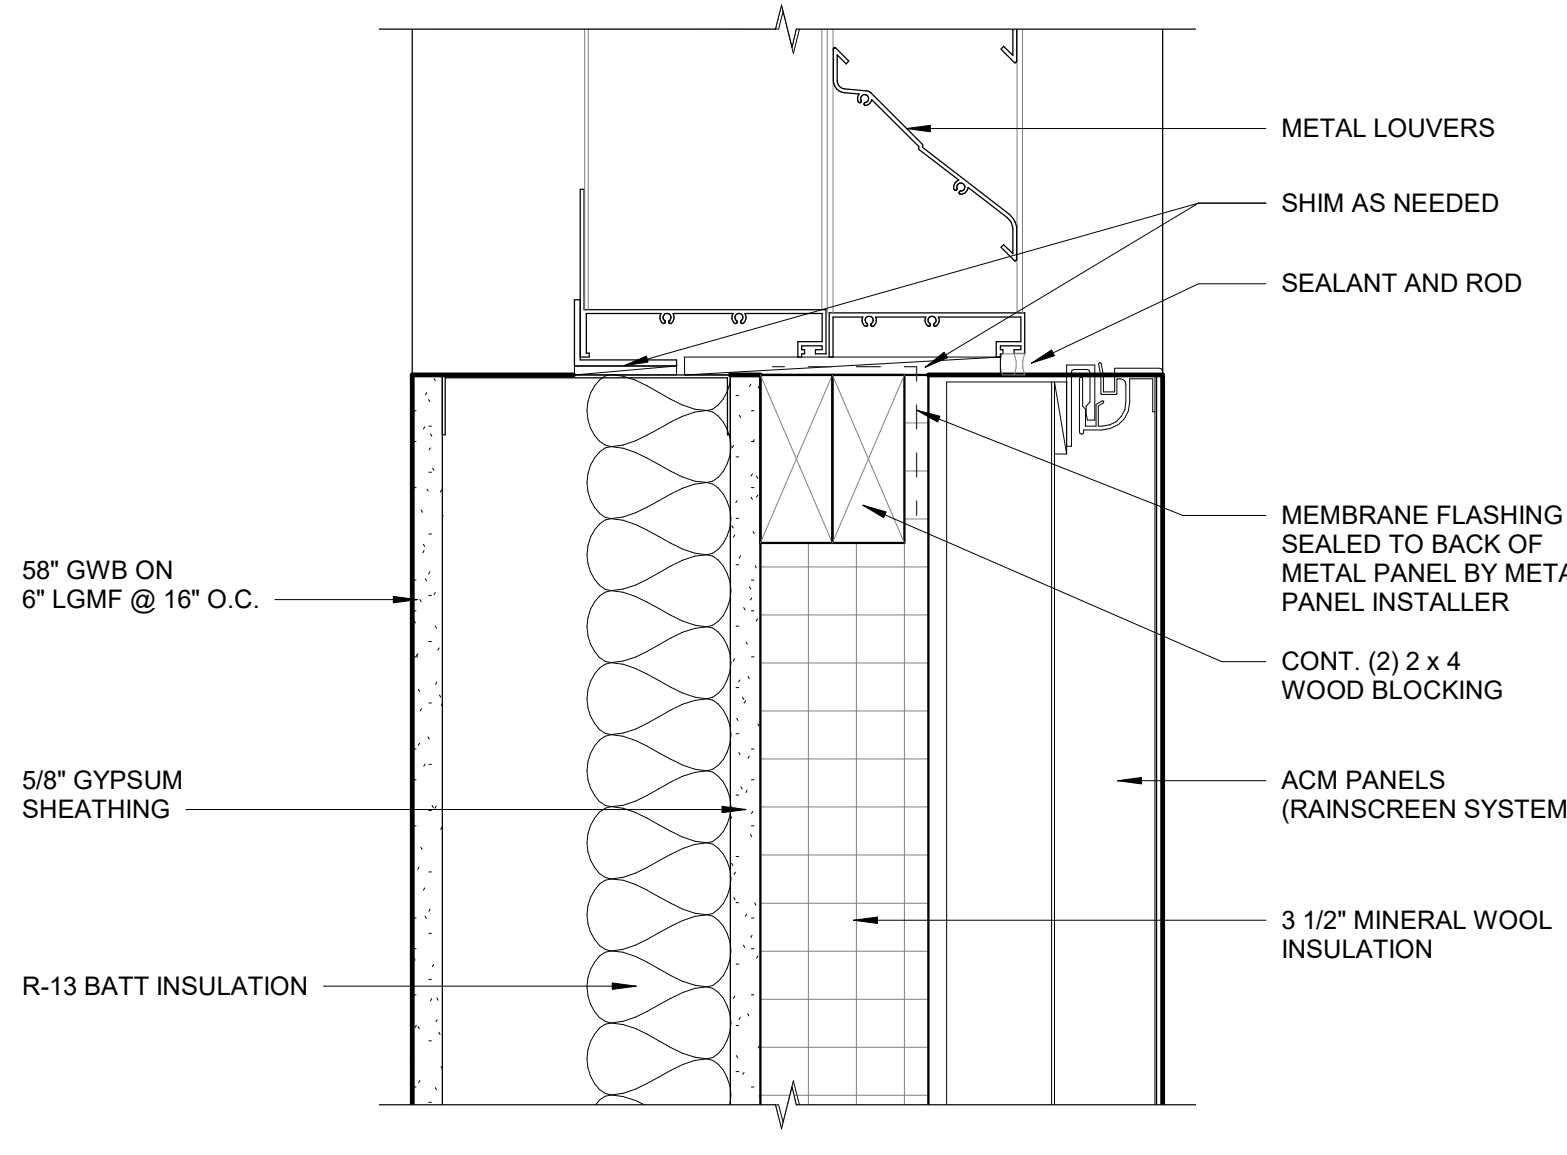


18 LOUVER - JAMB DETAIL
3" = 1'-0"

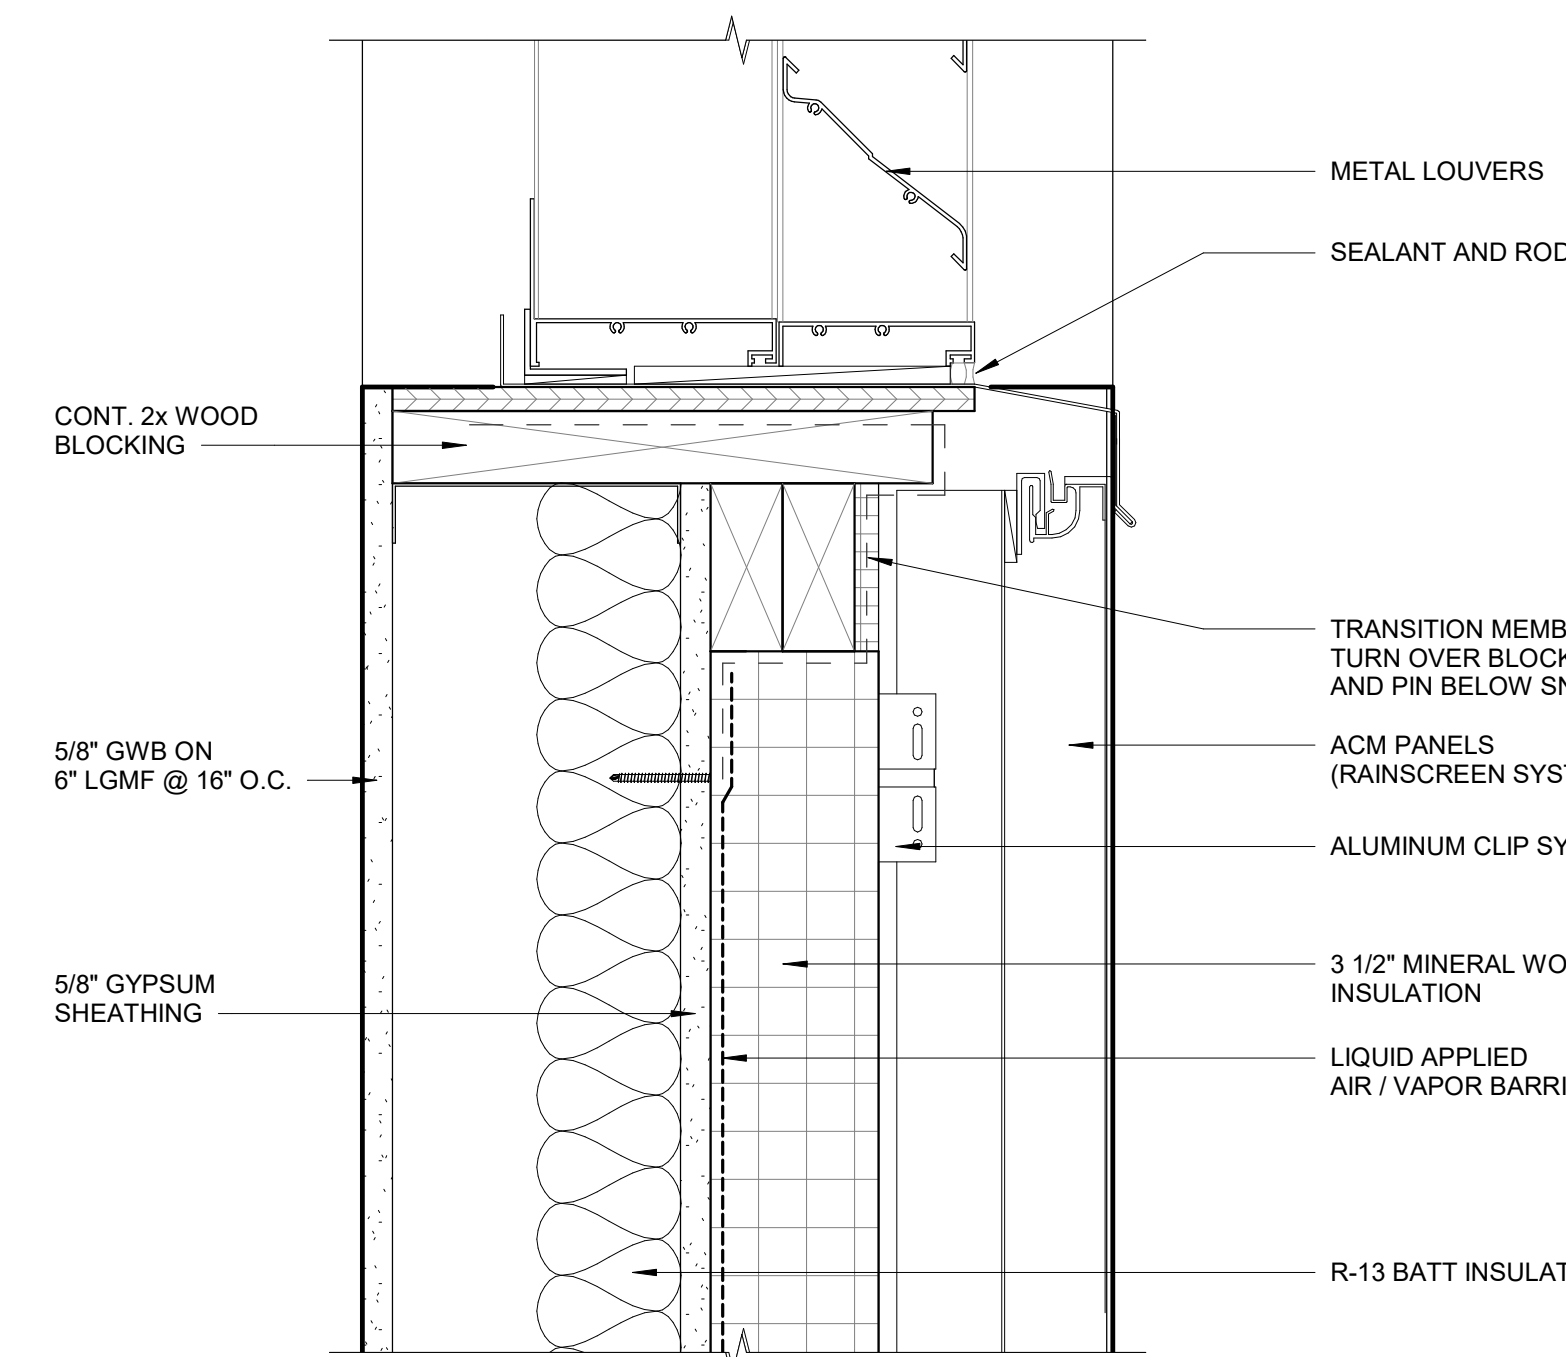


17 LOUVER - SILL DETAIL
3" = 1'-0"

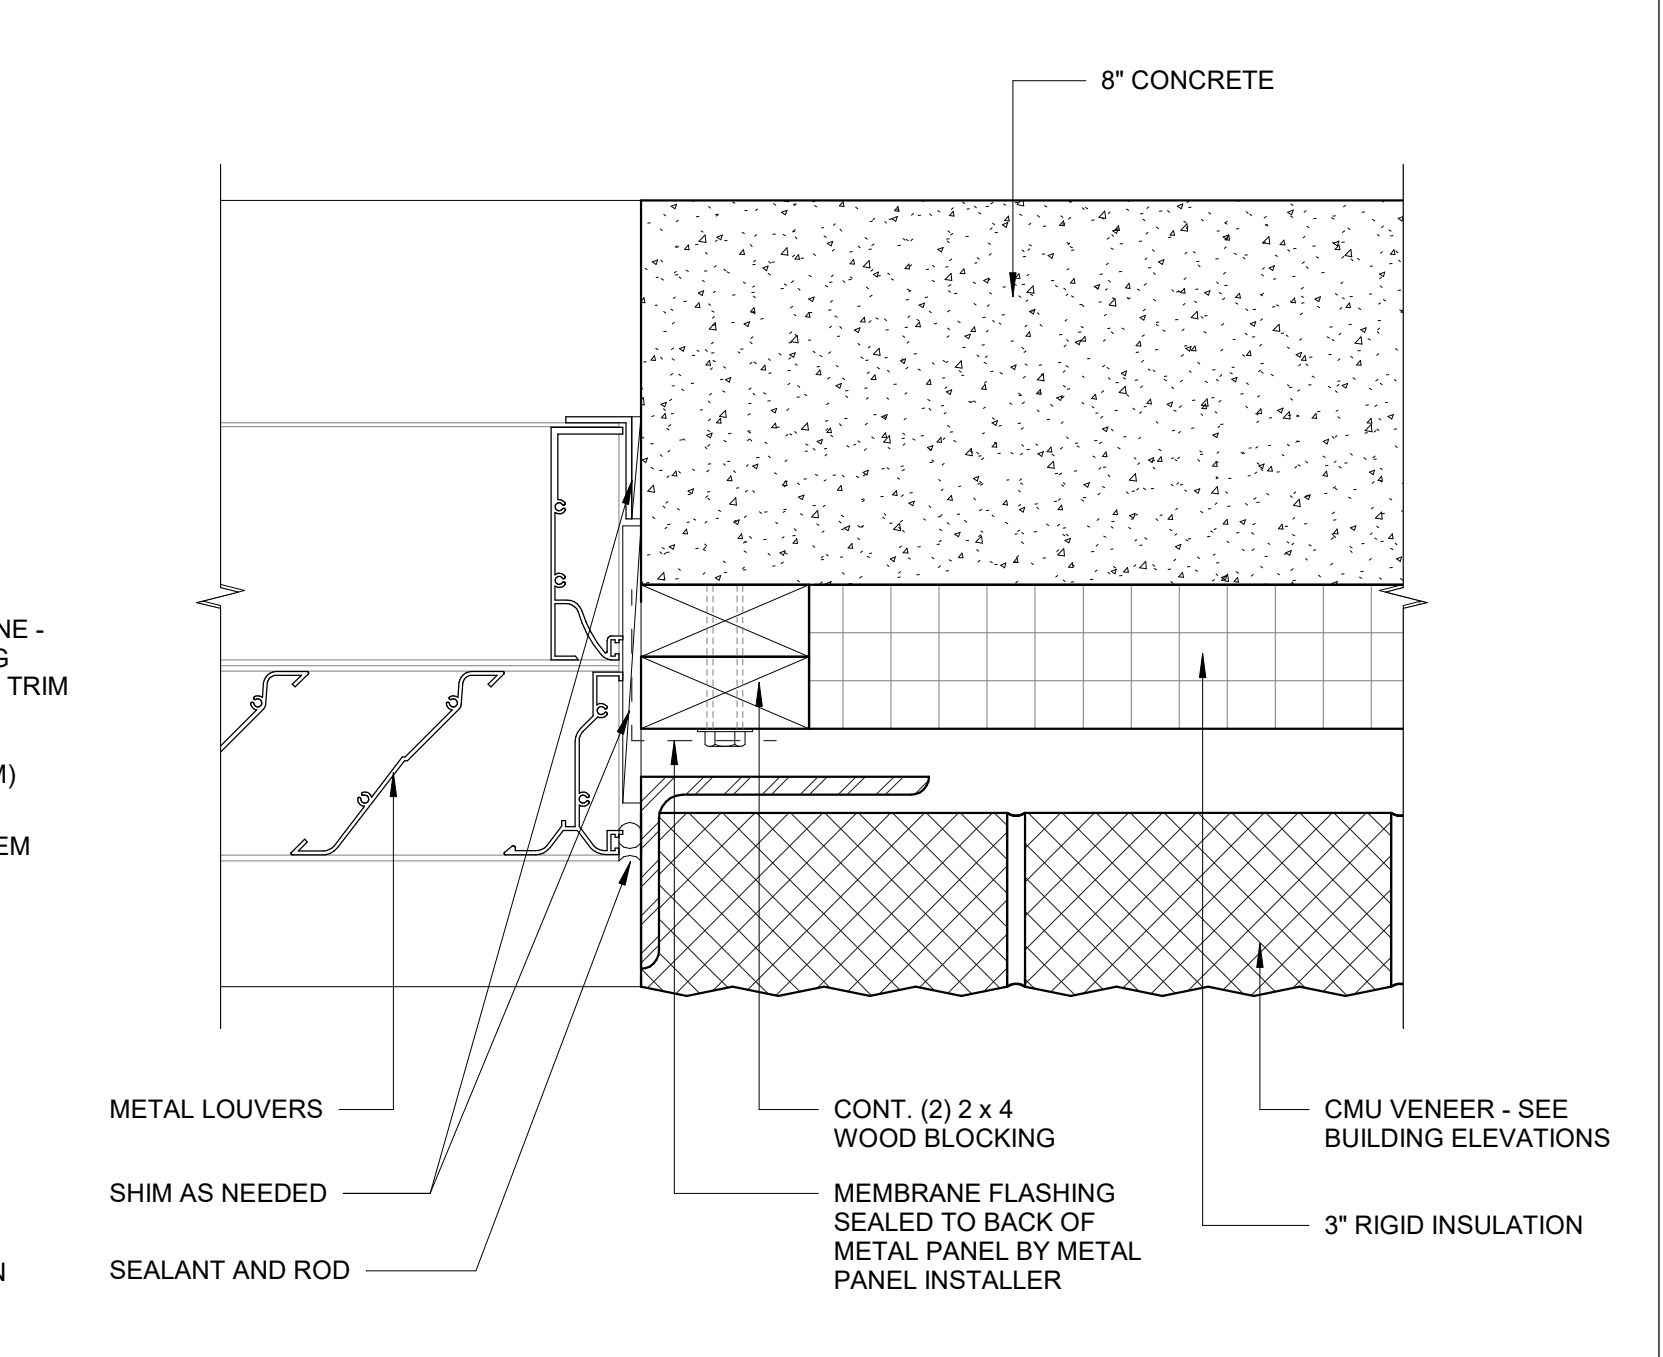


16 LOUVER - JAMB DETAIL 8" CONCRETE
3" = 1'-0"

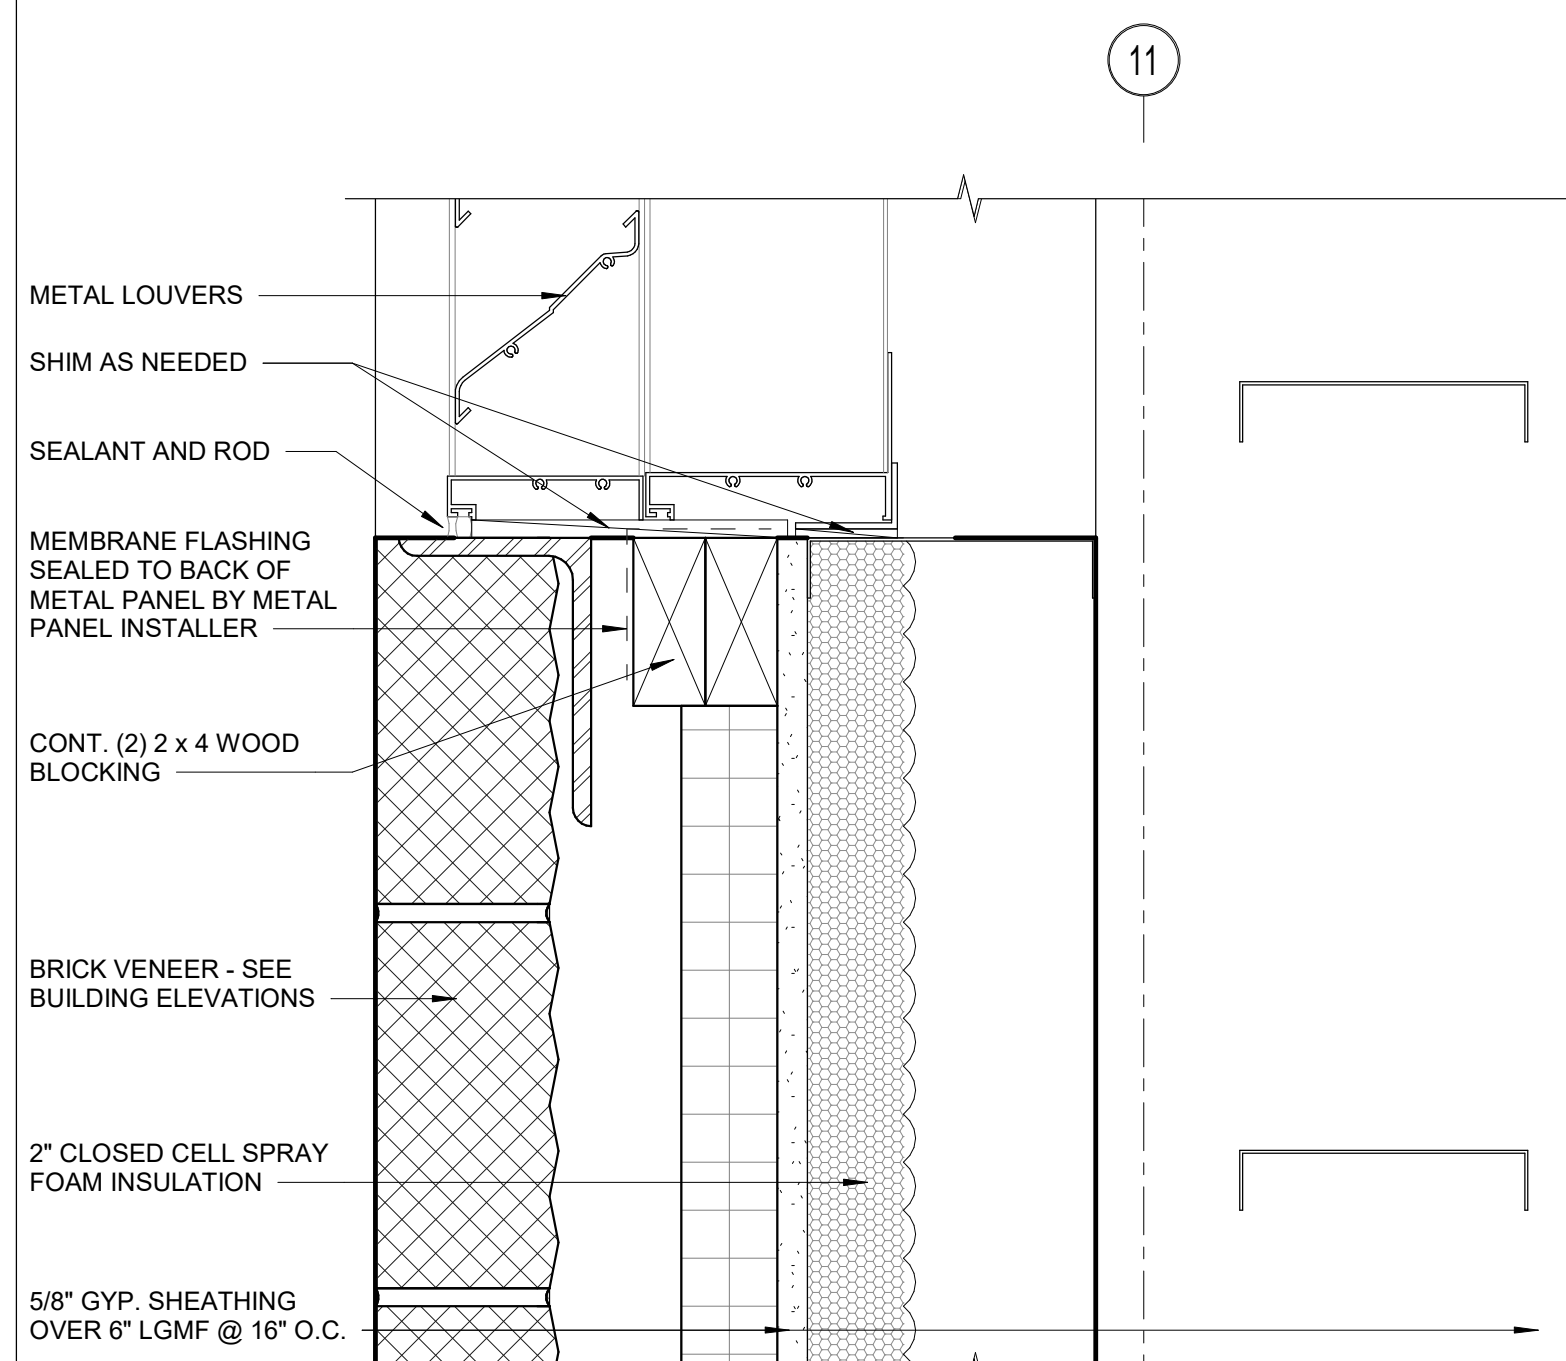


15 LOUVER - JAMB DETAIL
3" = 1'-0"

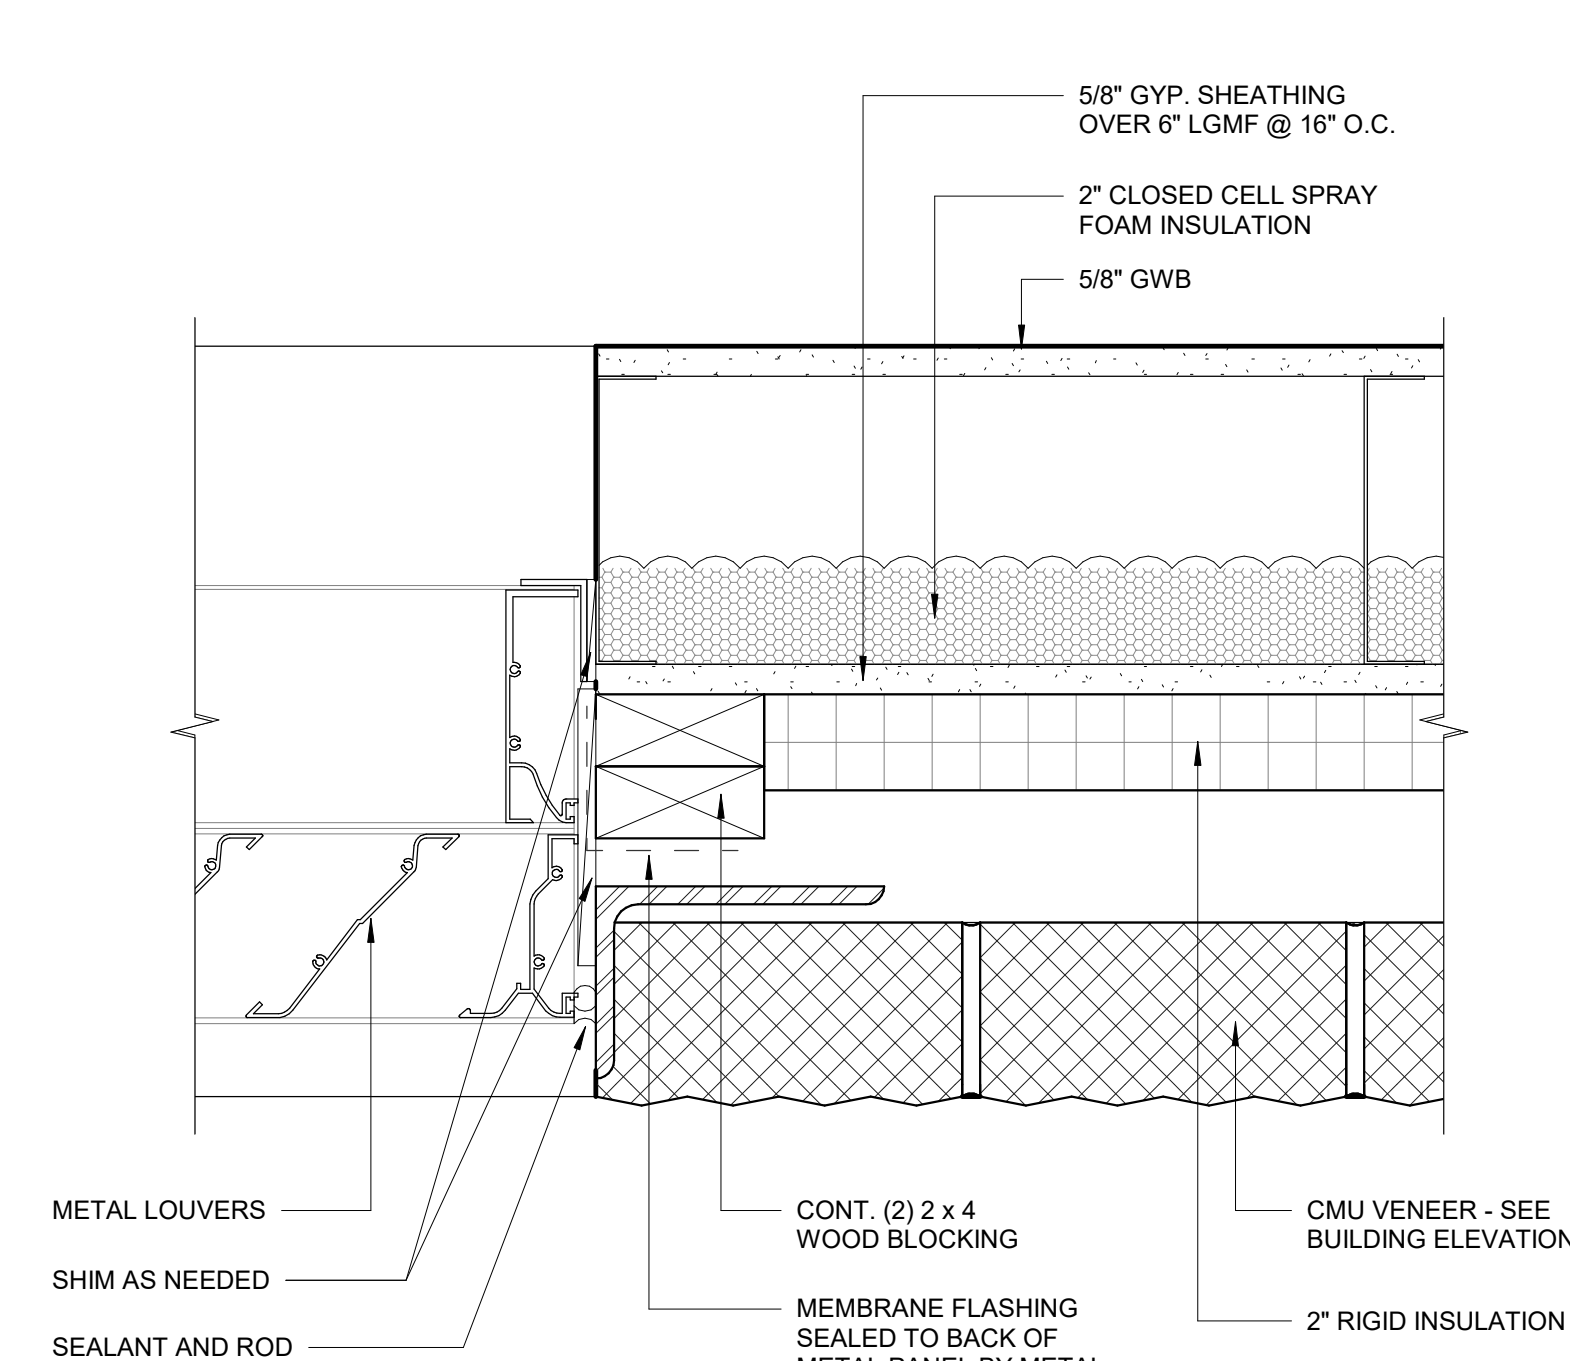


14 LOUVER - JAMB DETAIL
3" = 1'-0"

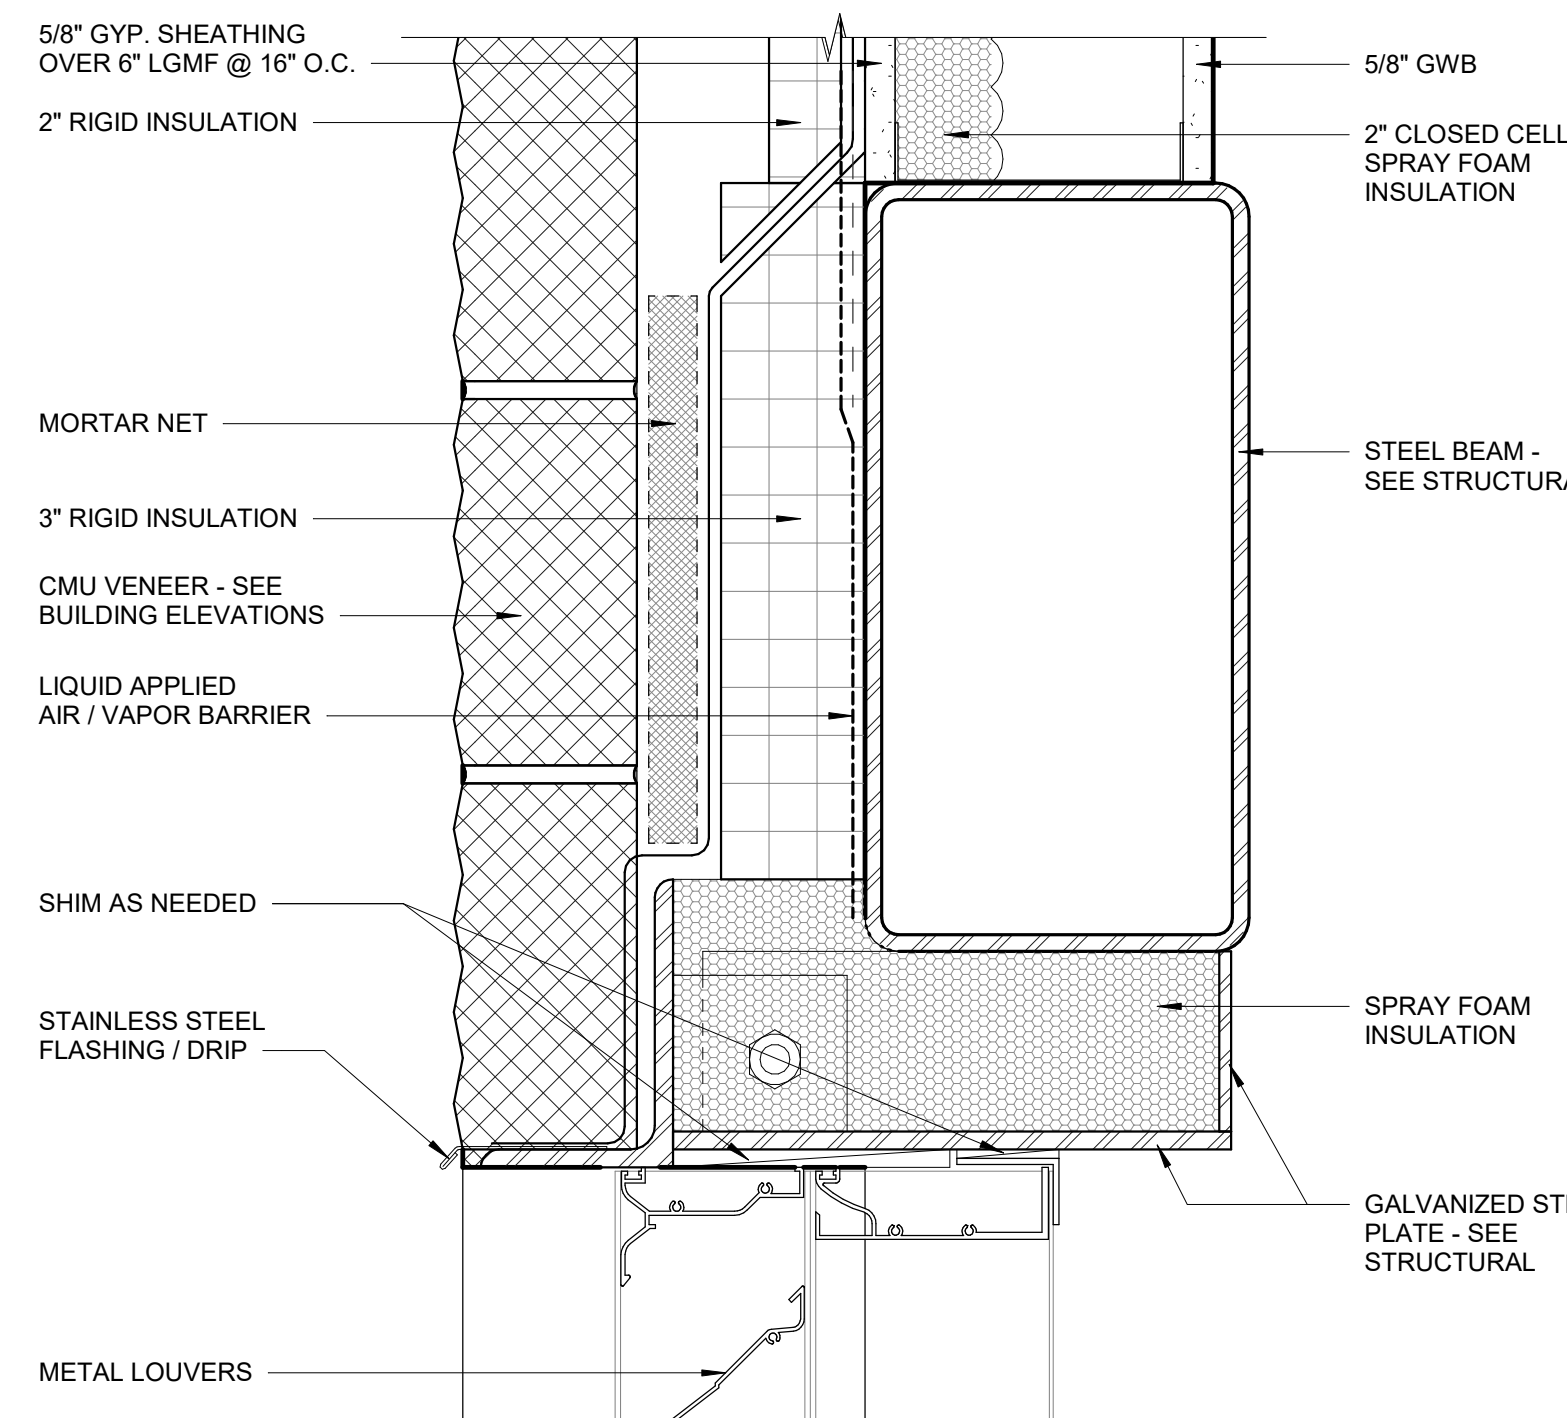


13 LOUVER - HEAD DETAIL
3" = 1'-0"

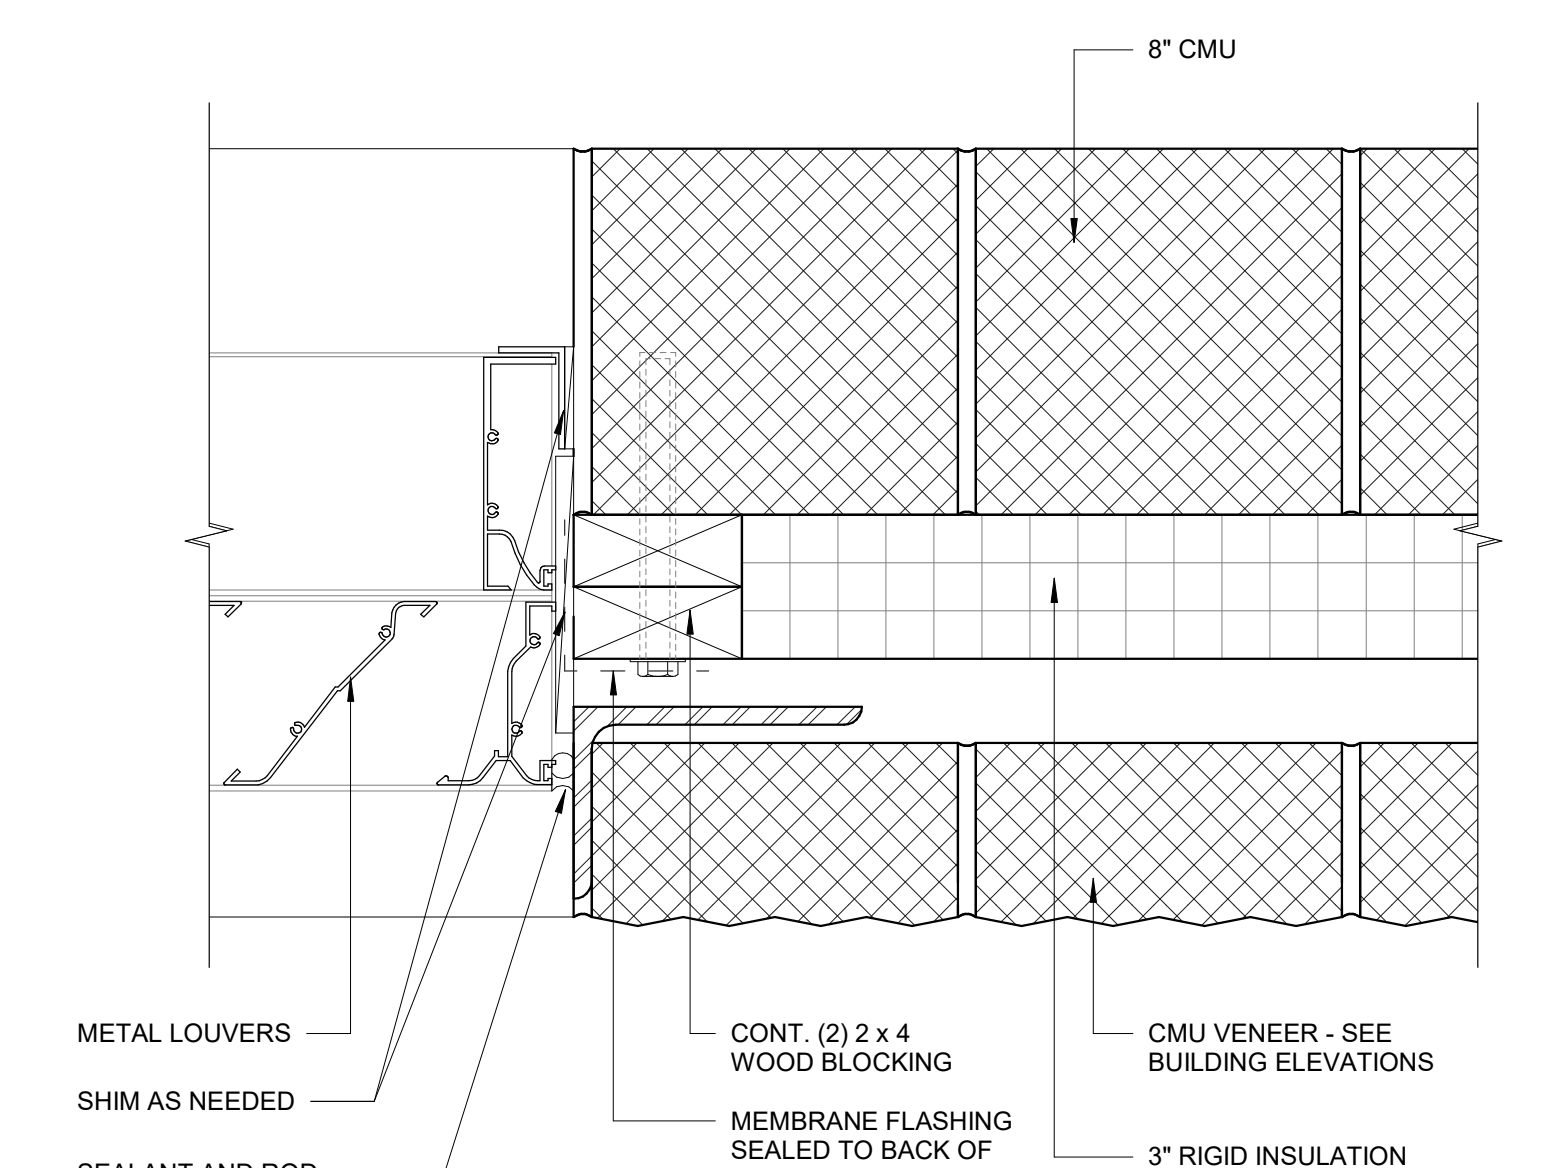


12 LOUVER - JAMB DETAIL CMU 8"
3" = 1'-0"

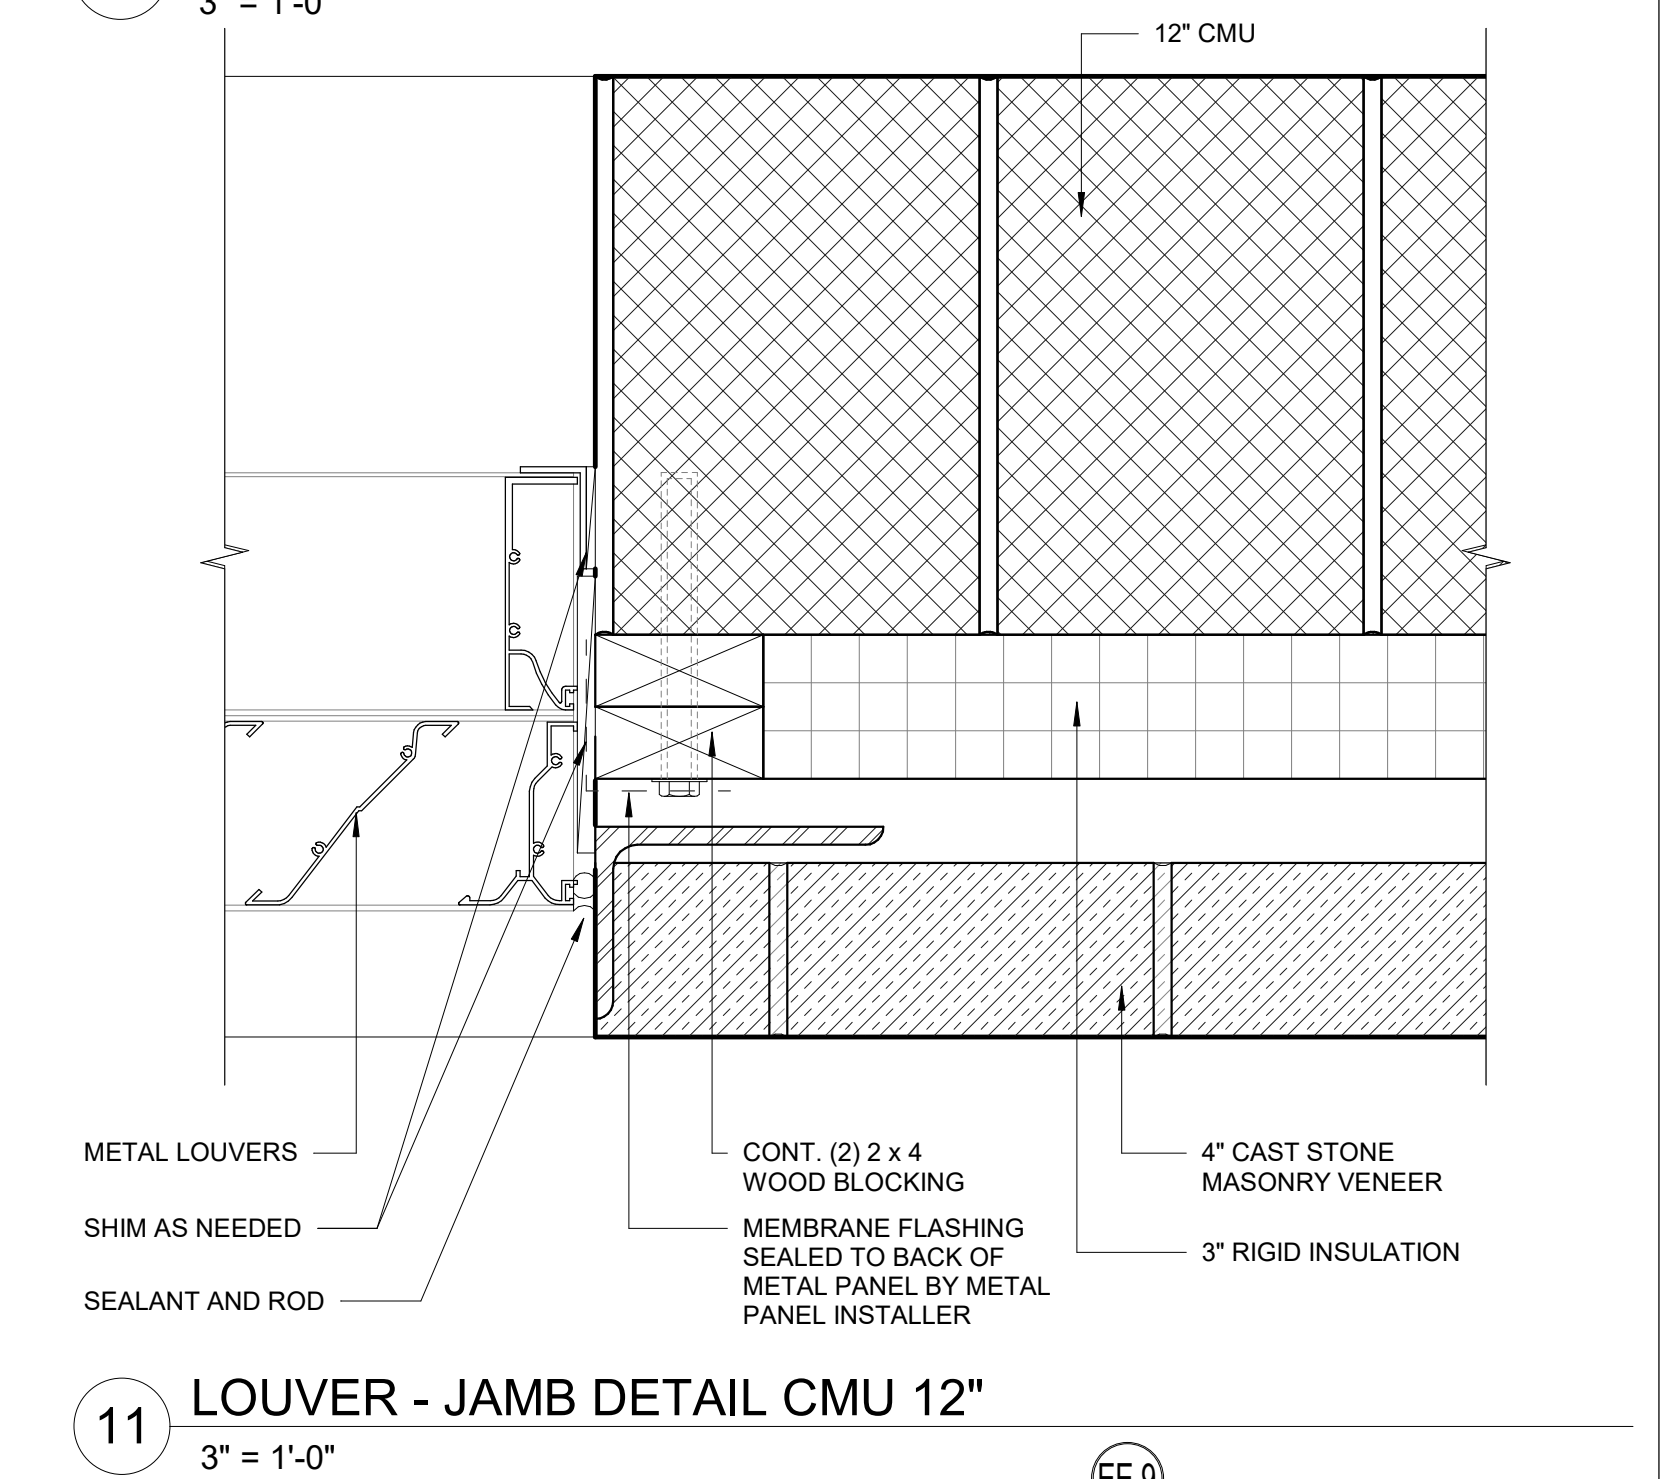


11 LOUVER - JAMB DETAIL CMU 12"
3" = 1'-0"

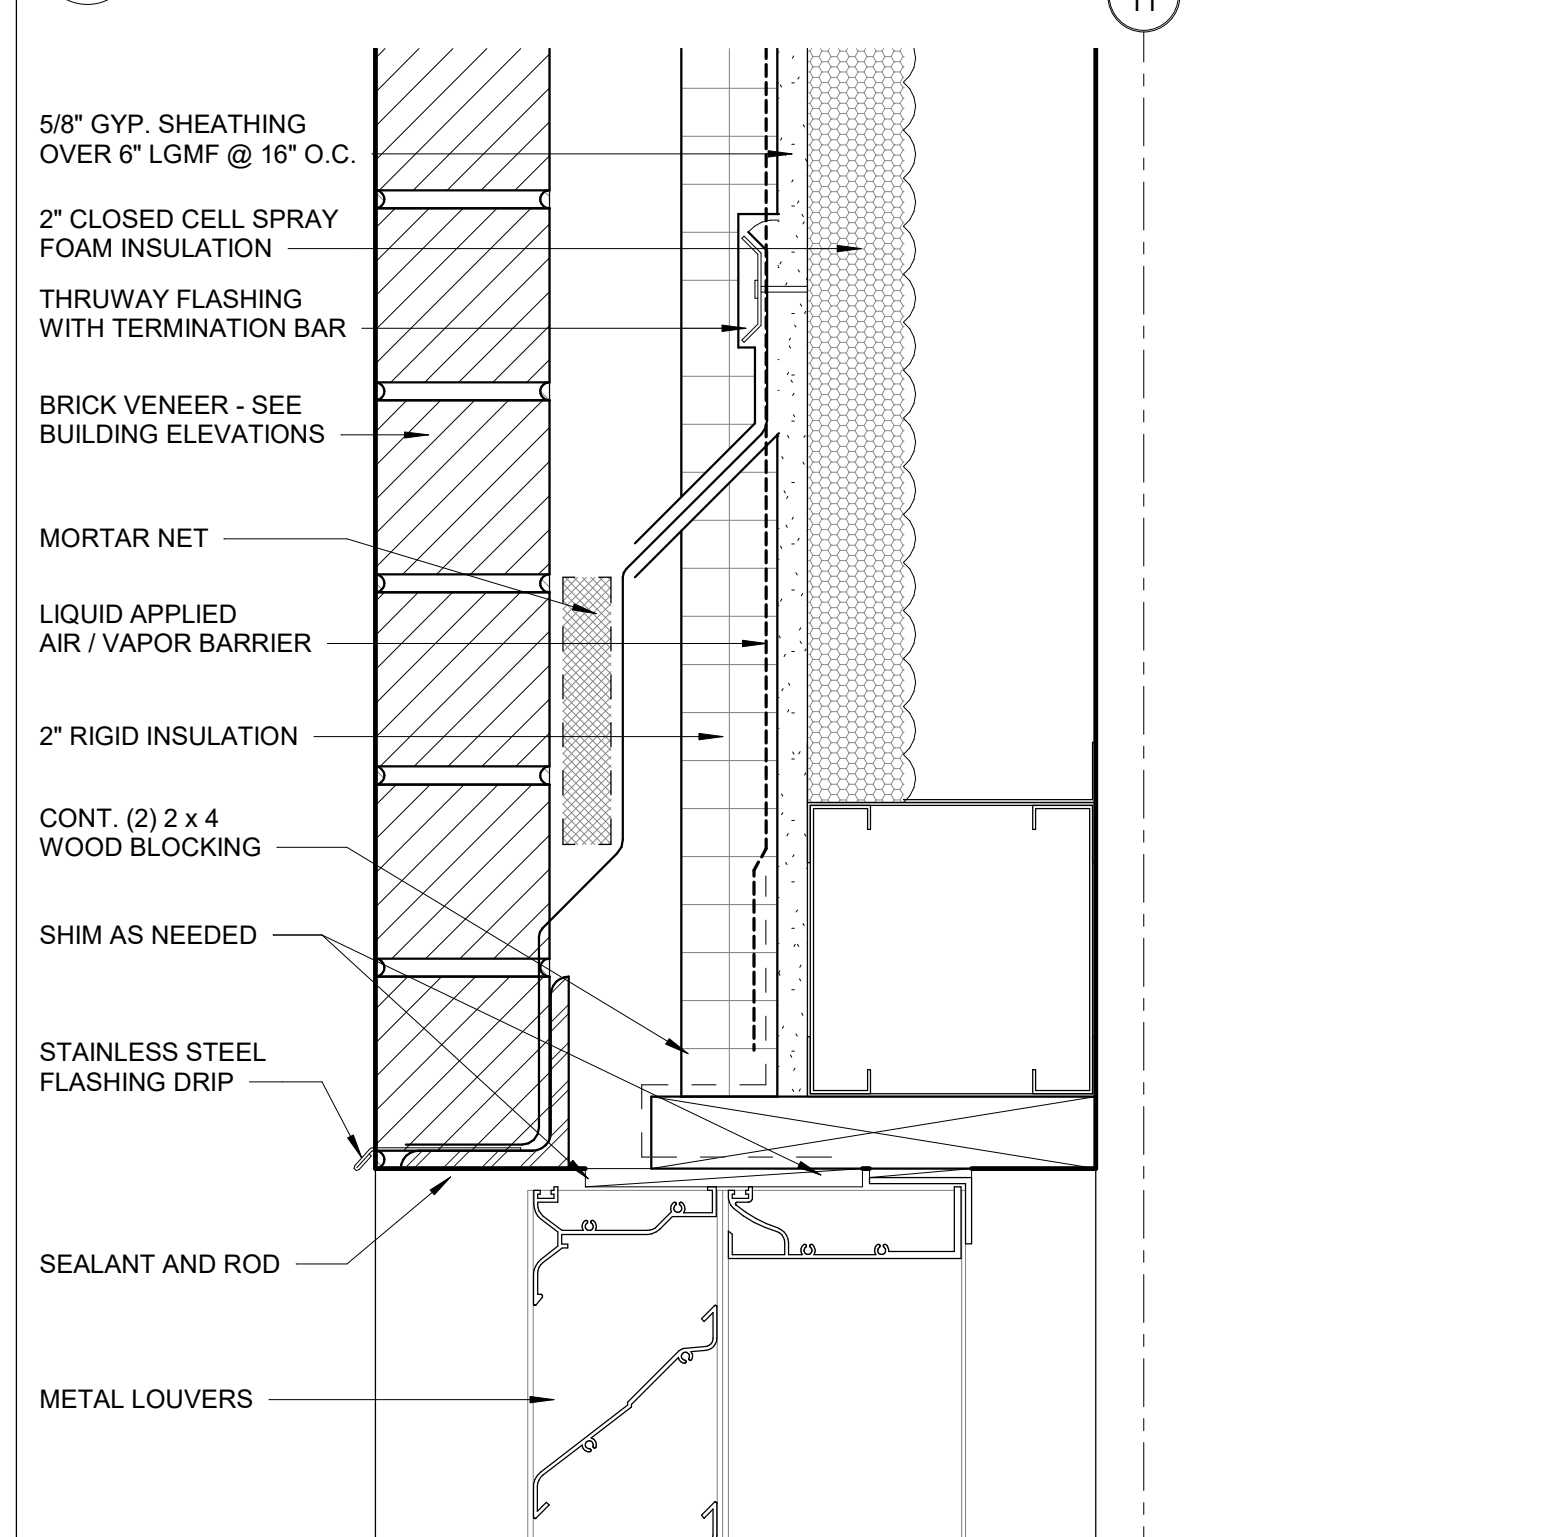


10 LOUVER - HEAD DETAIL
3" = 1'-0"

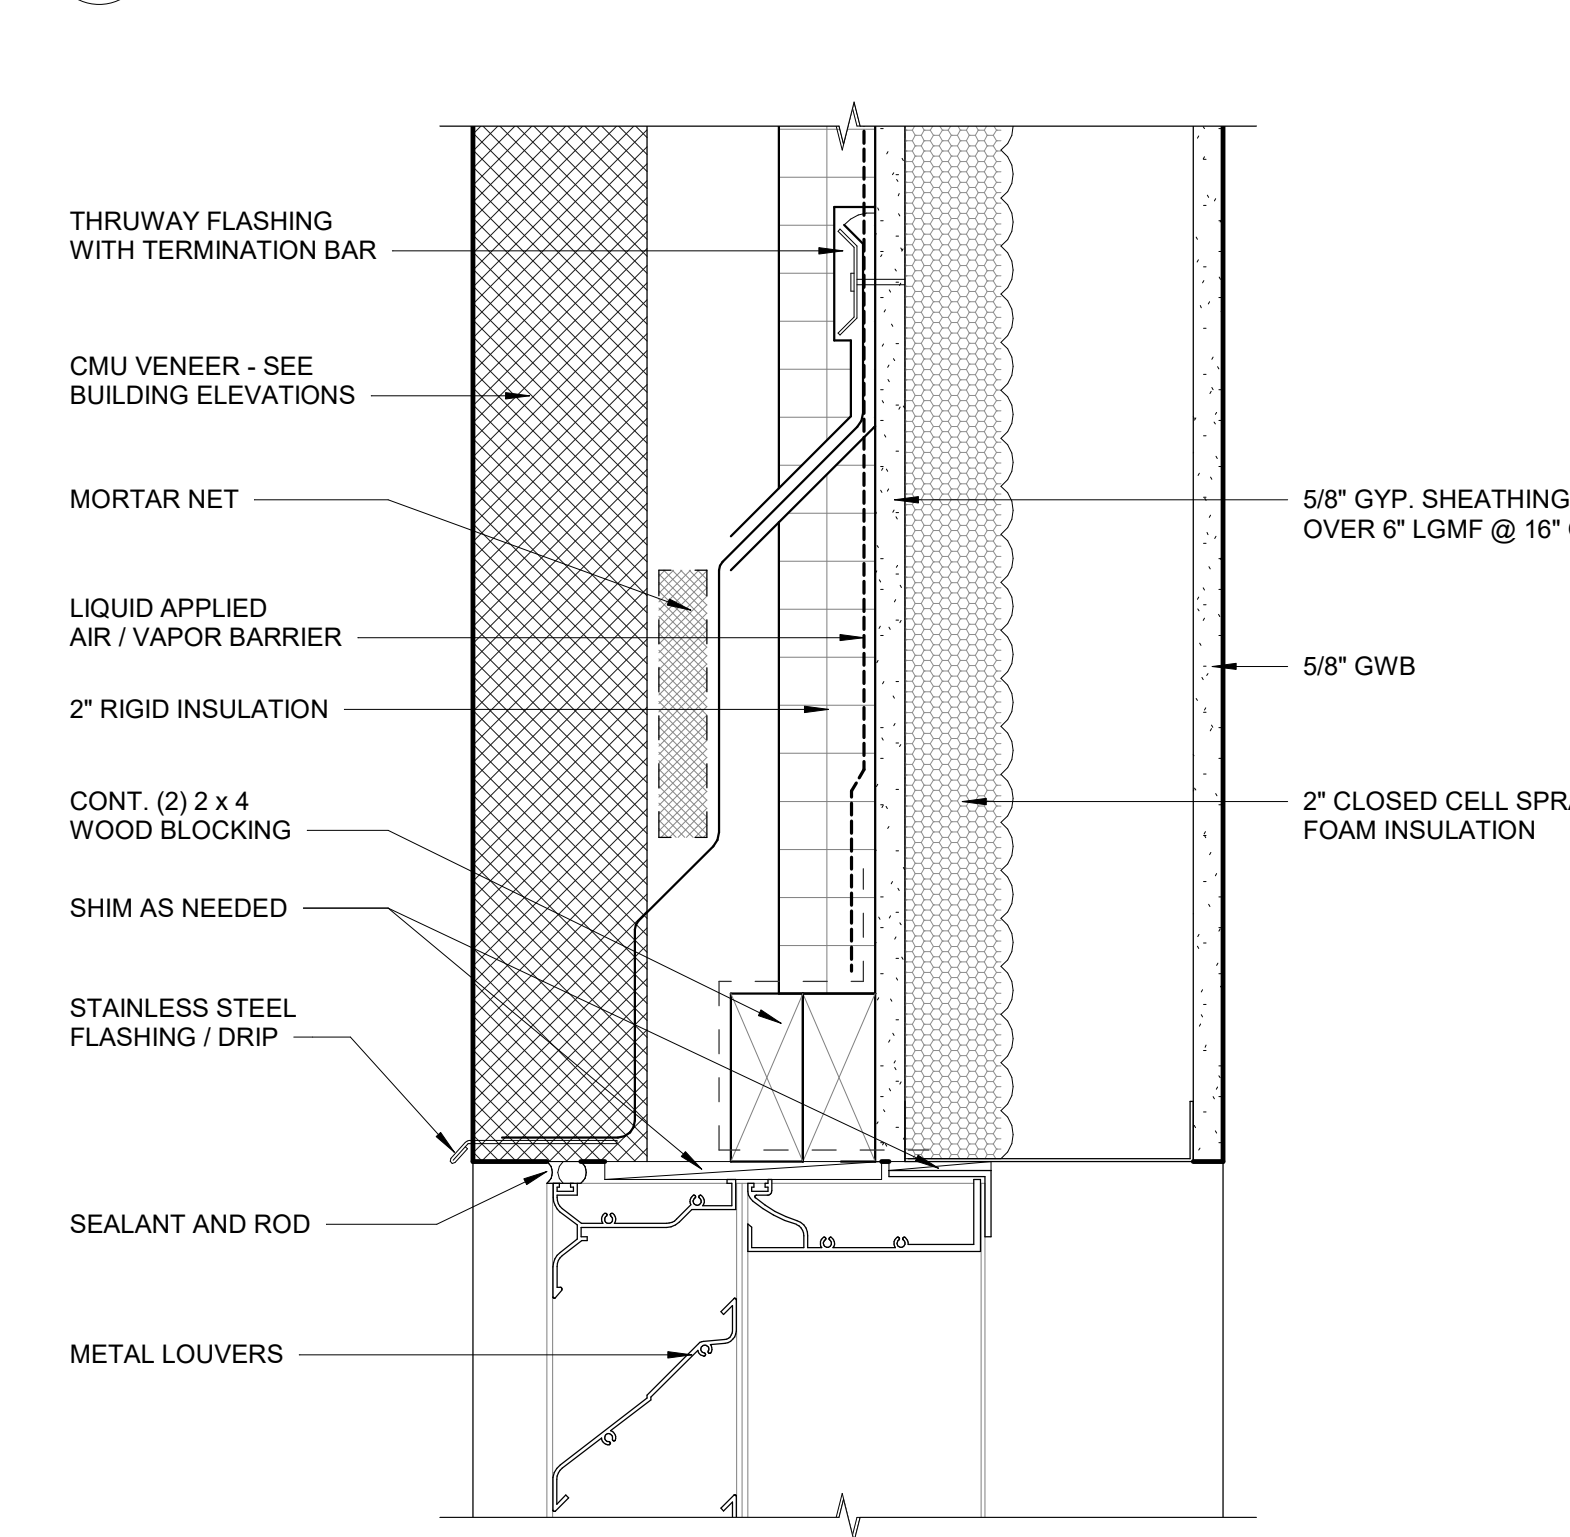


9 LOUVER - HEAD DETAIL
3" = 1'-0"

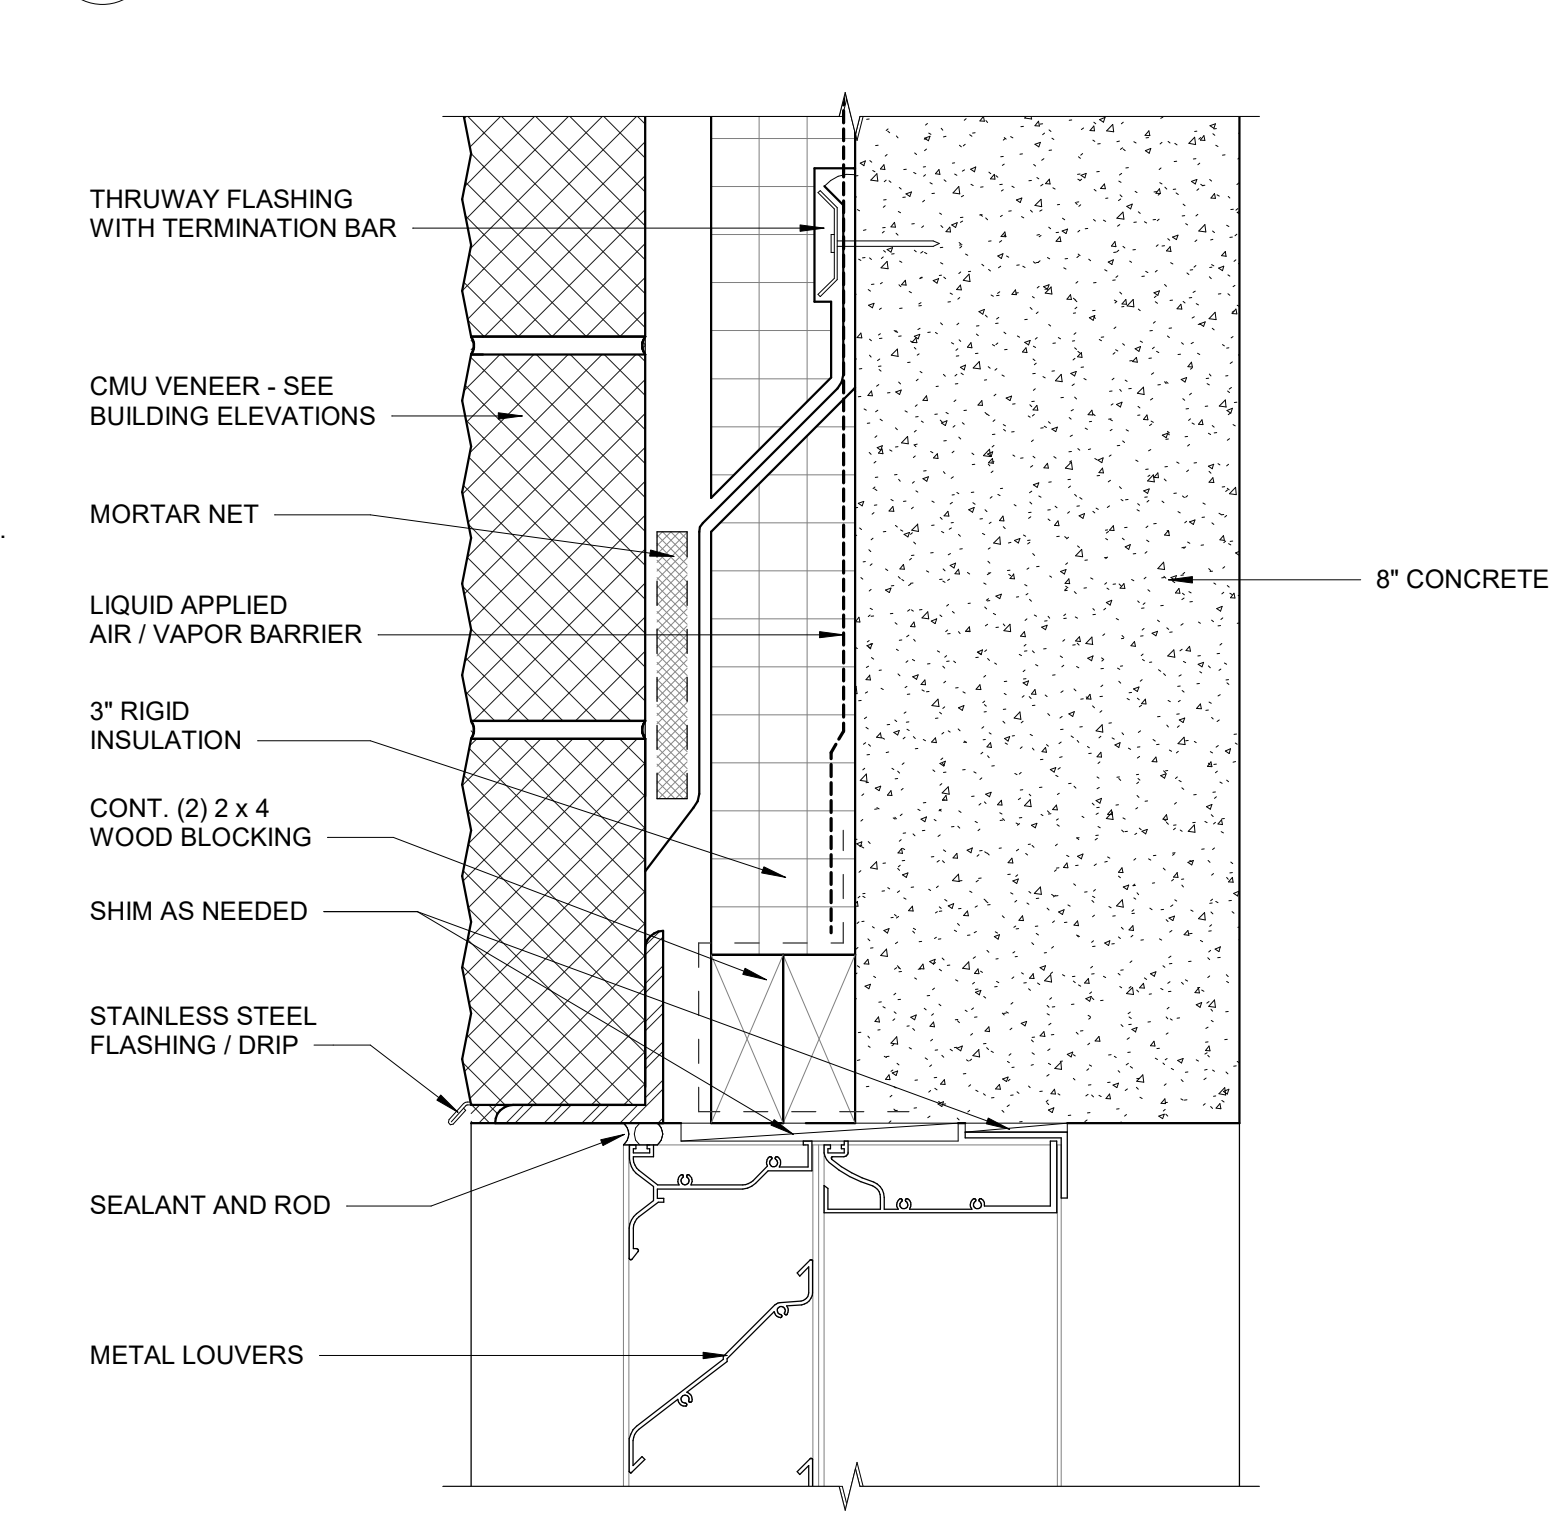


8 LOUVER - HEAD DETAIL 8" CONCRETE
3" = 1'-0"

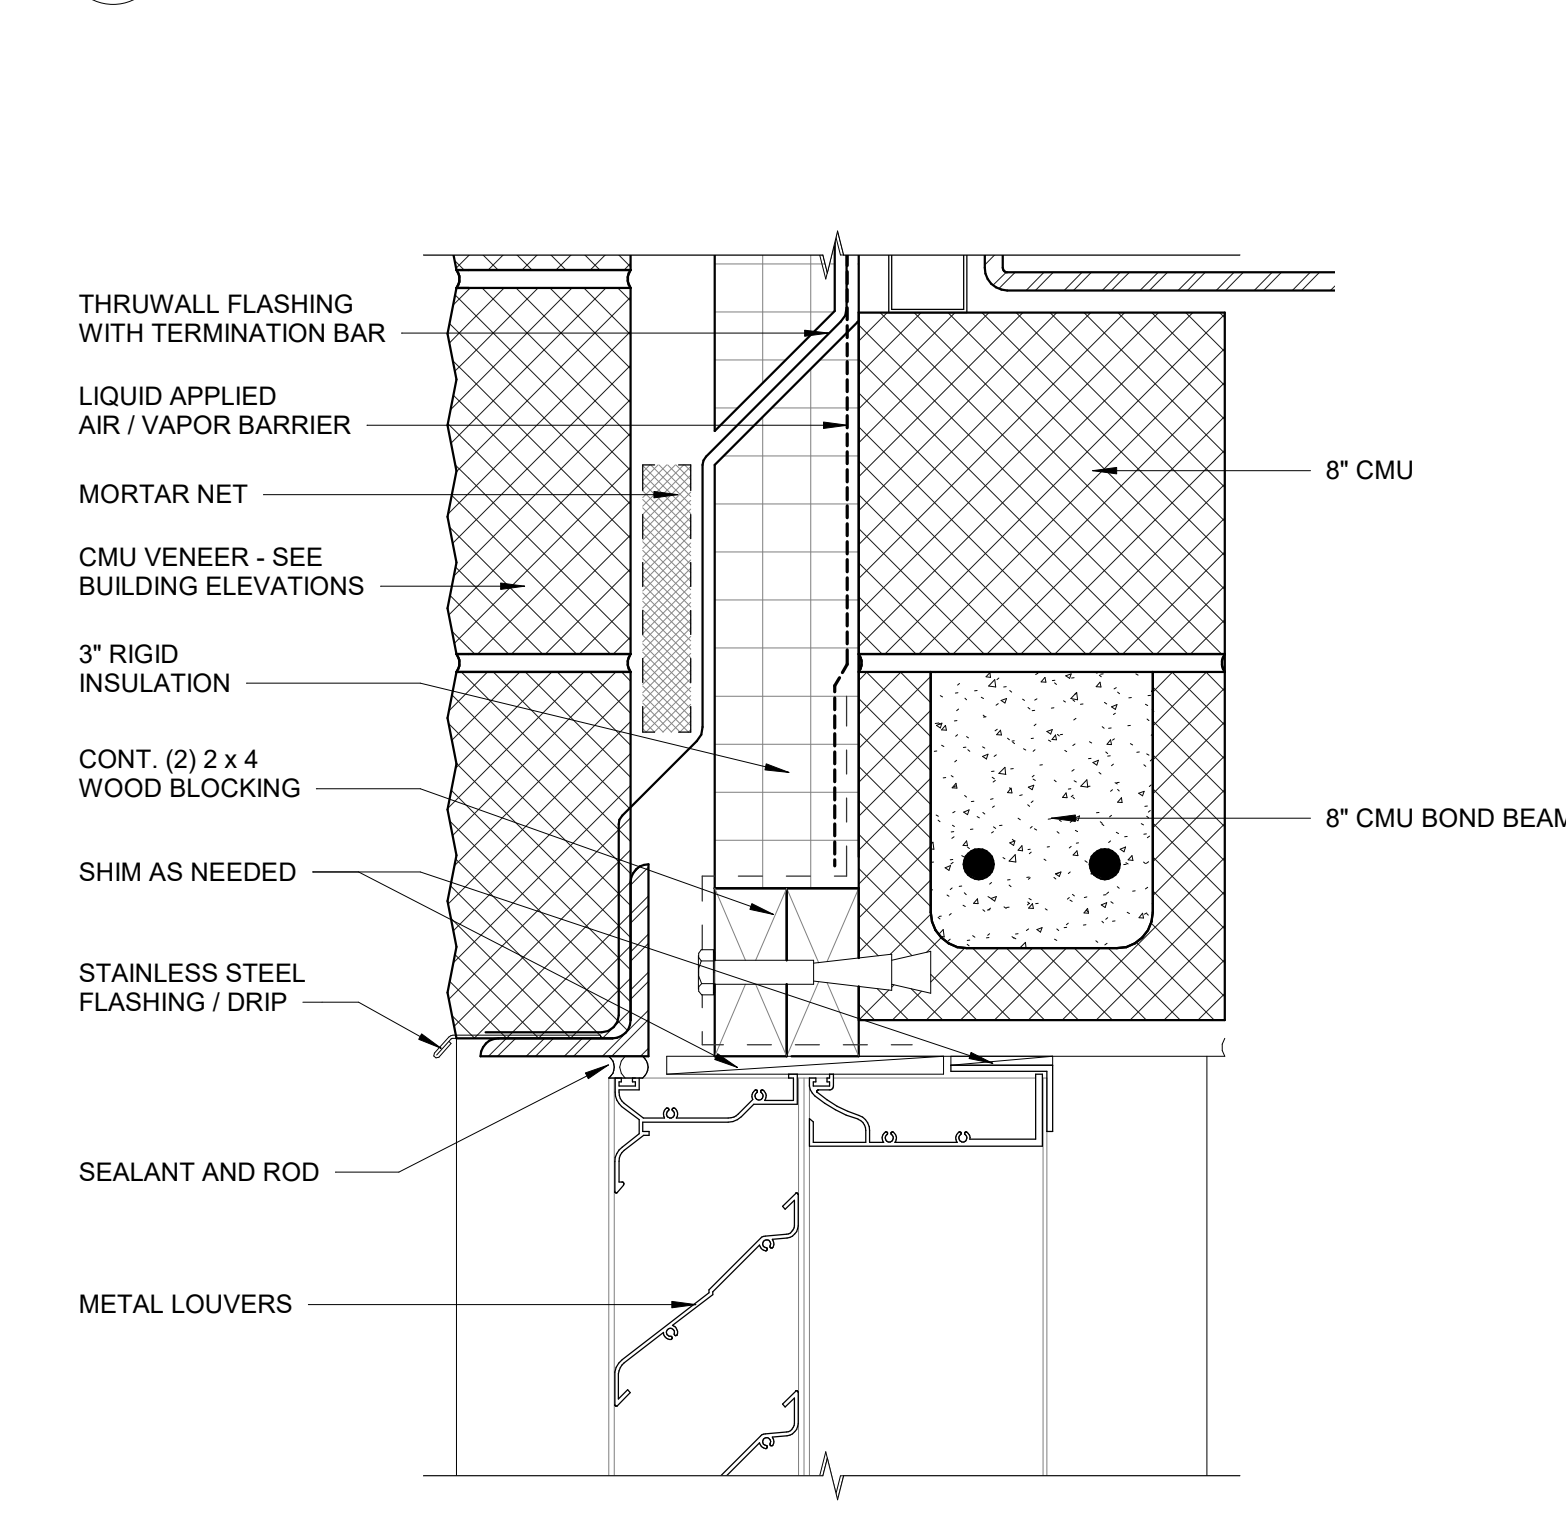


7 LOUVER - HEAD DETAIL CMU 8"
3" = 1'-0"

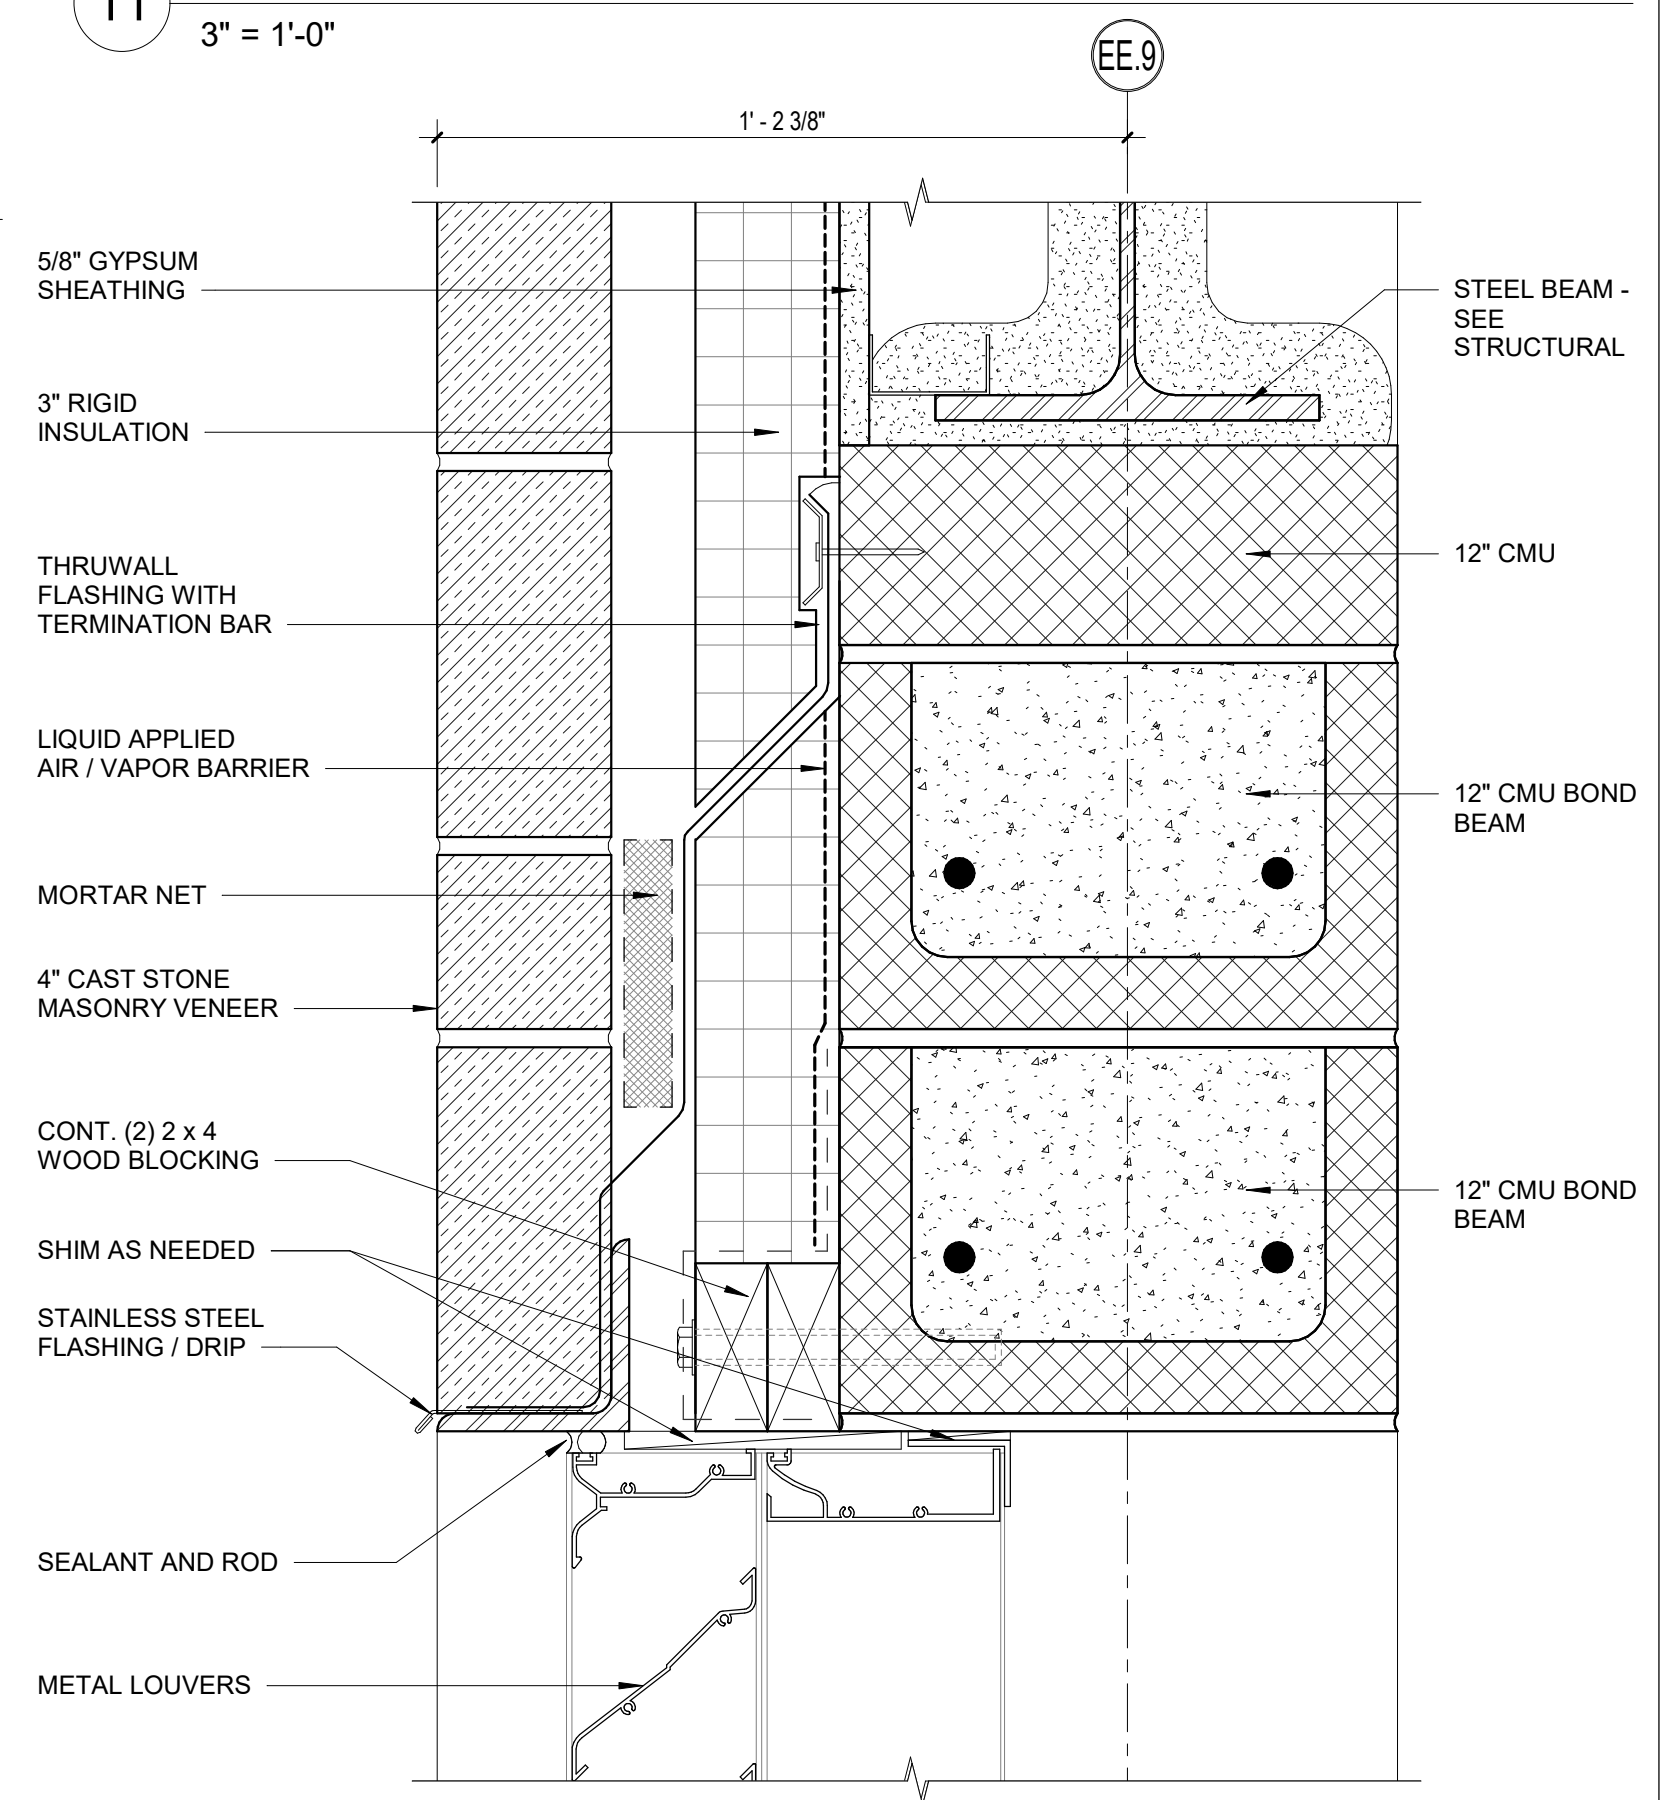


6 LOUVER - HEAD DETAIL CMU 12"
3" = 1'-0"

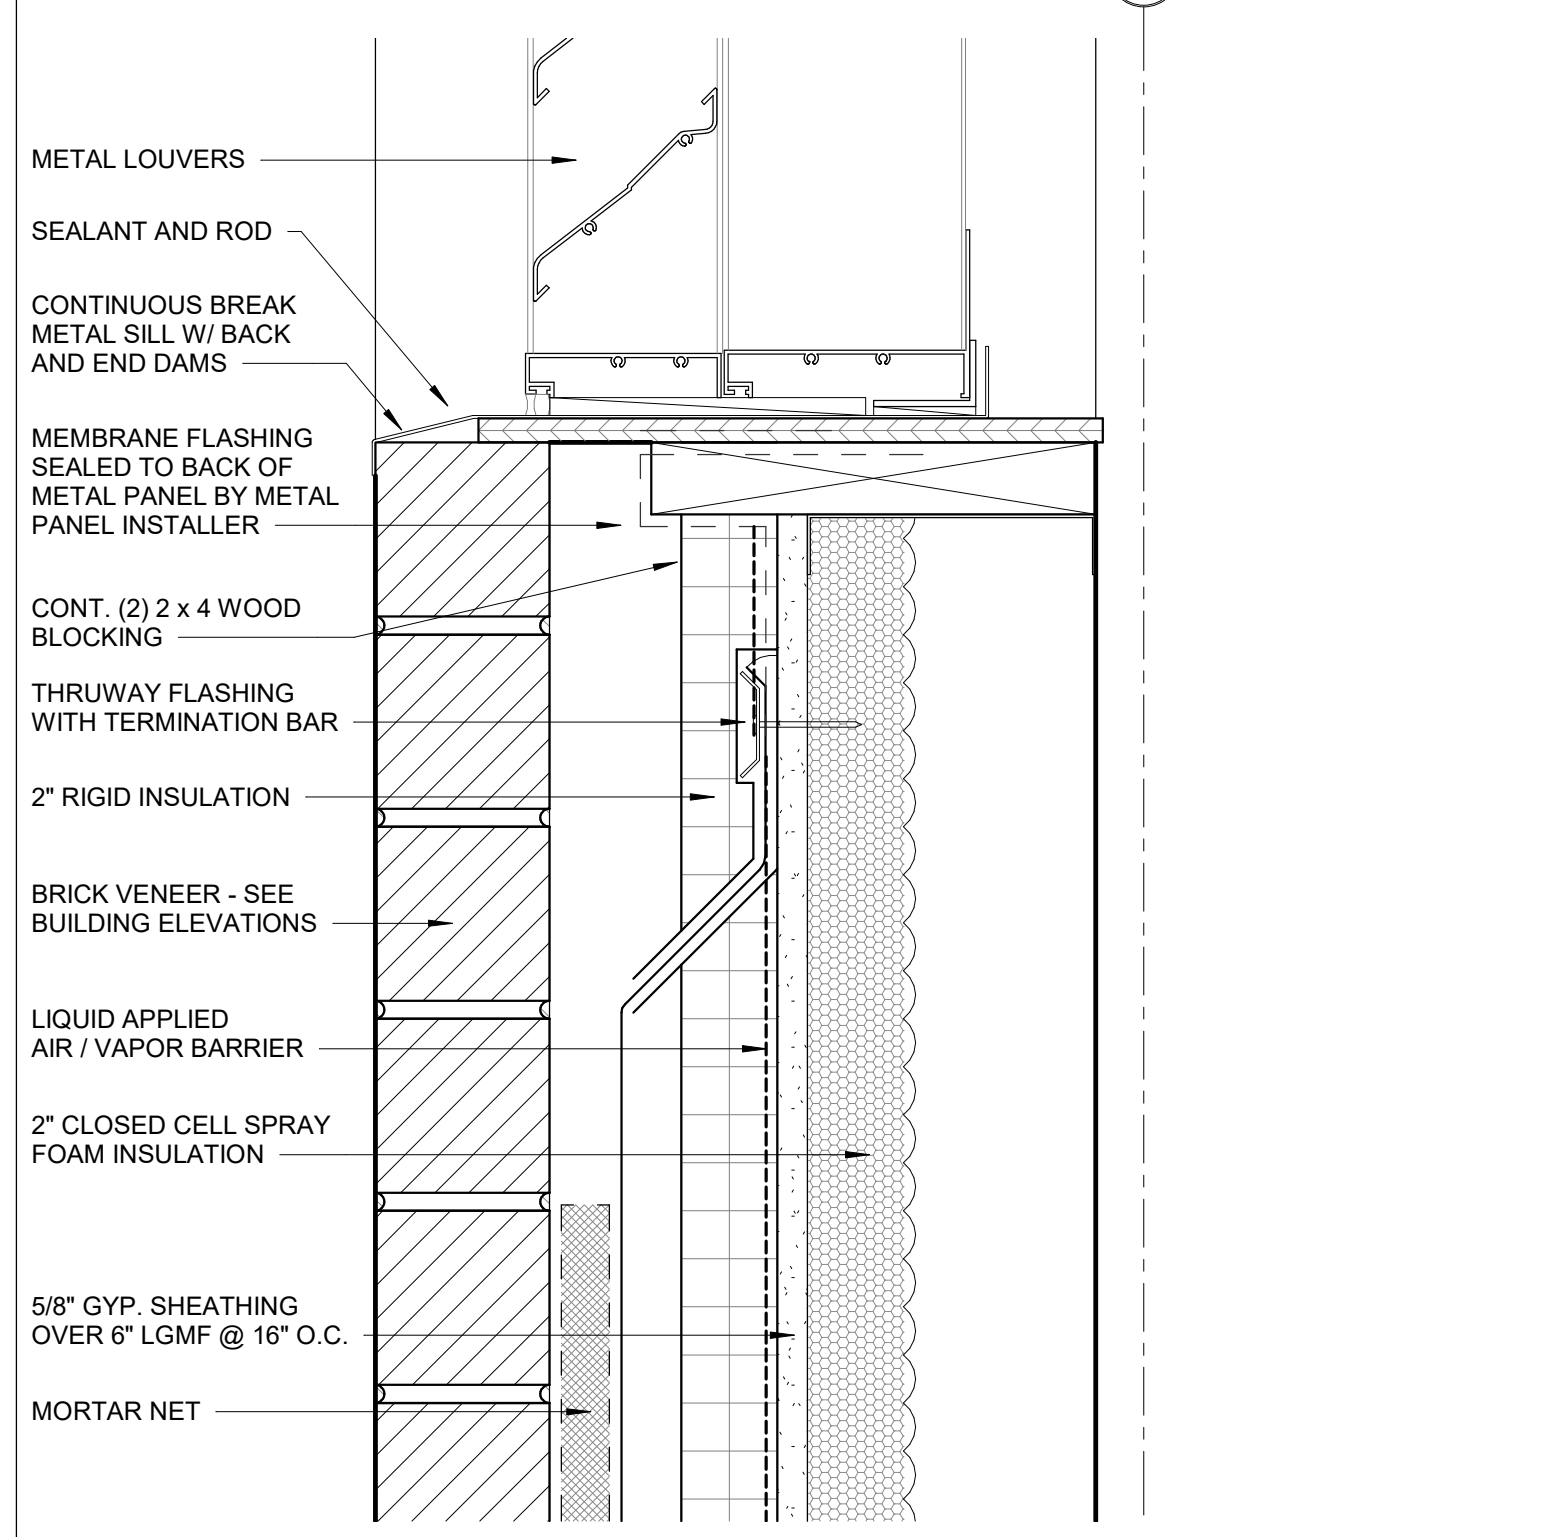


5 LOUVER - SILL DETAIL
3" = 1'-0"

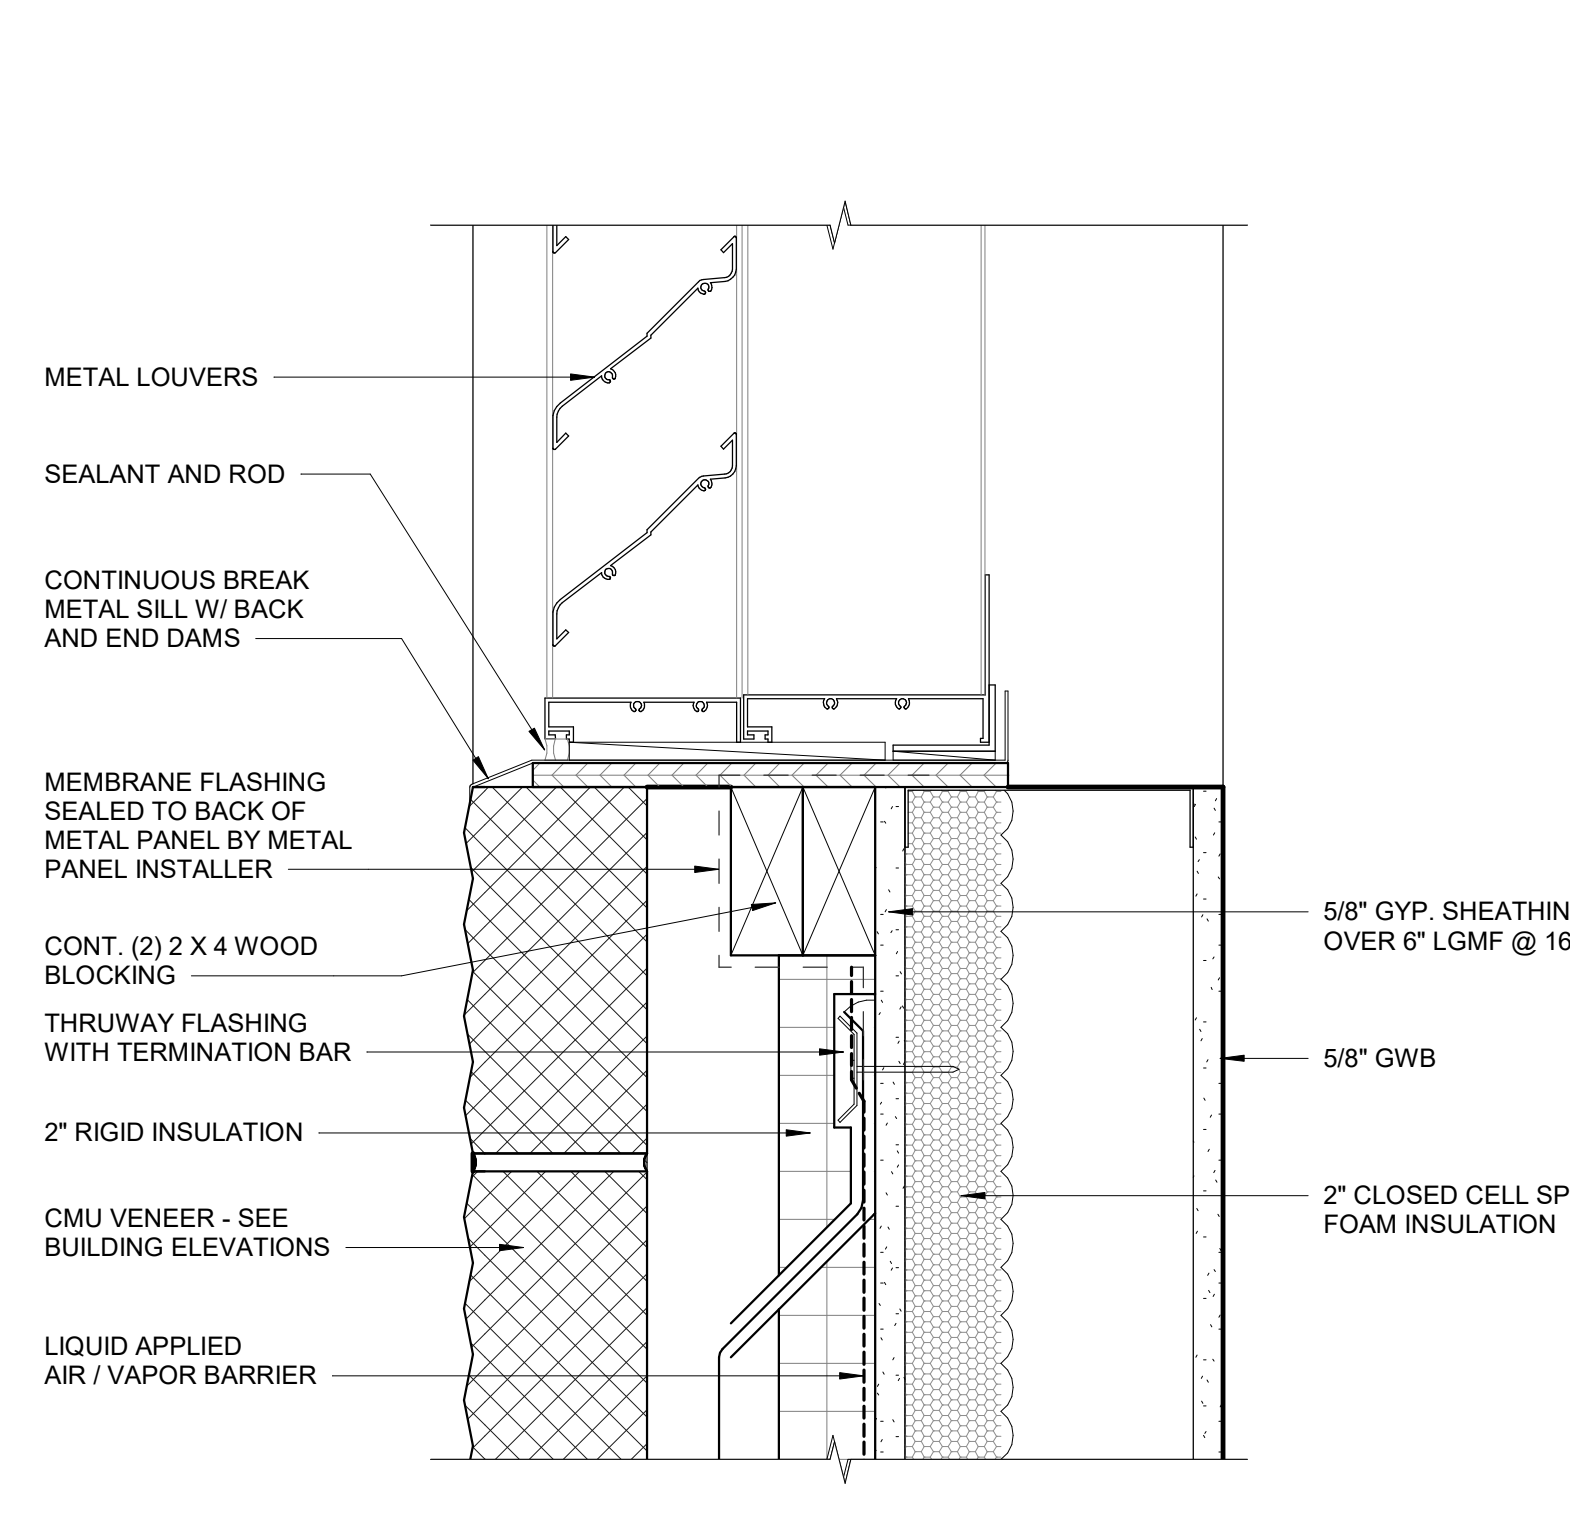


4 LOUVER - SILL DETAIL
3" = 1'-0"

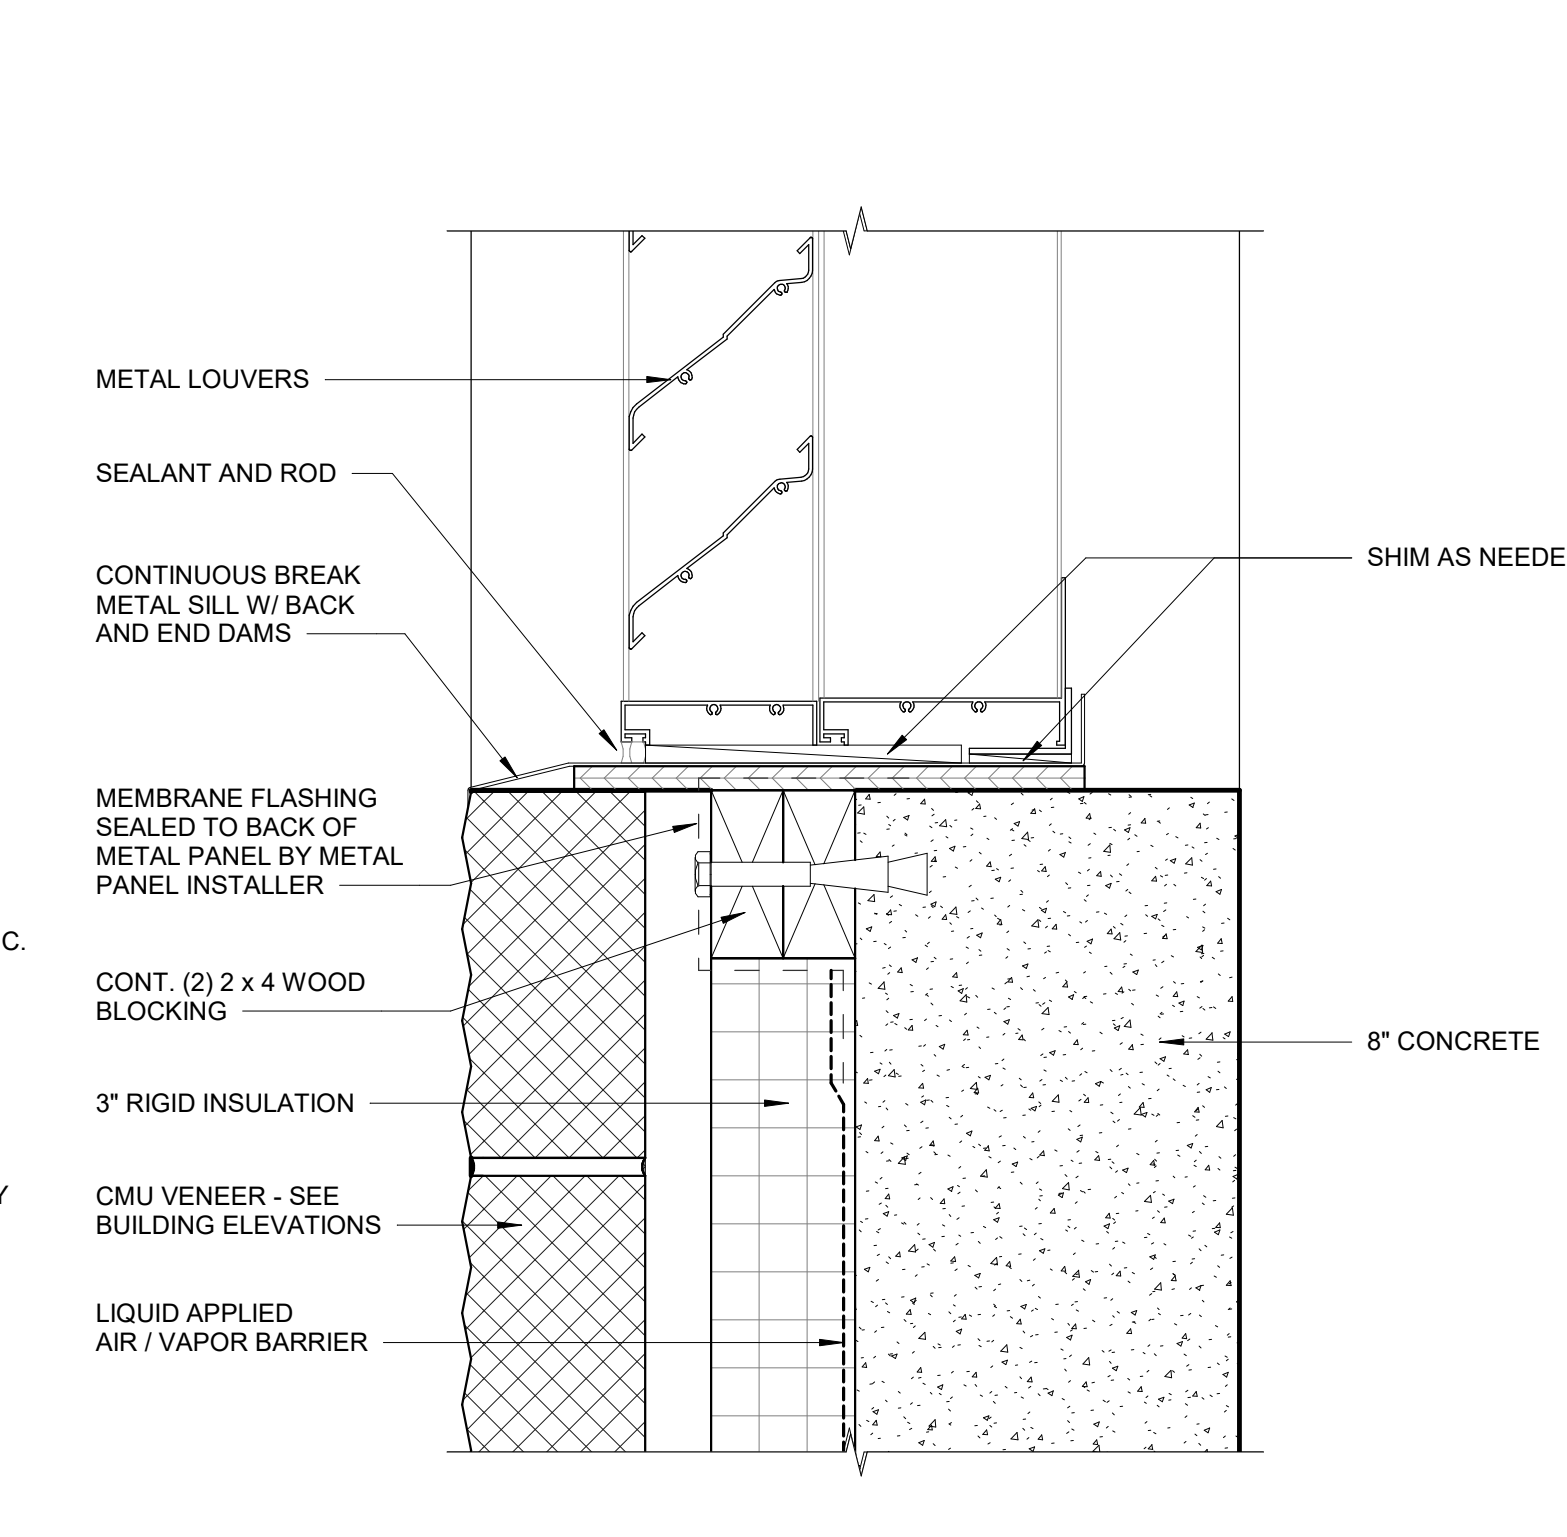

3 LOUVER - SILL DETAIL 8" CONCRETE
3" = 1'-0"

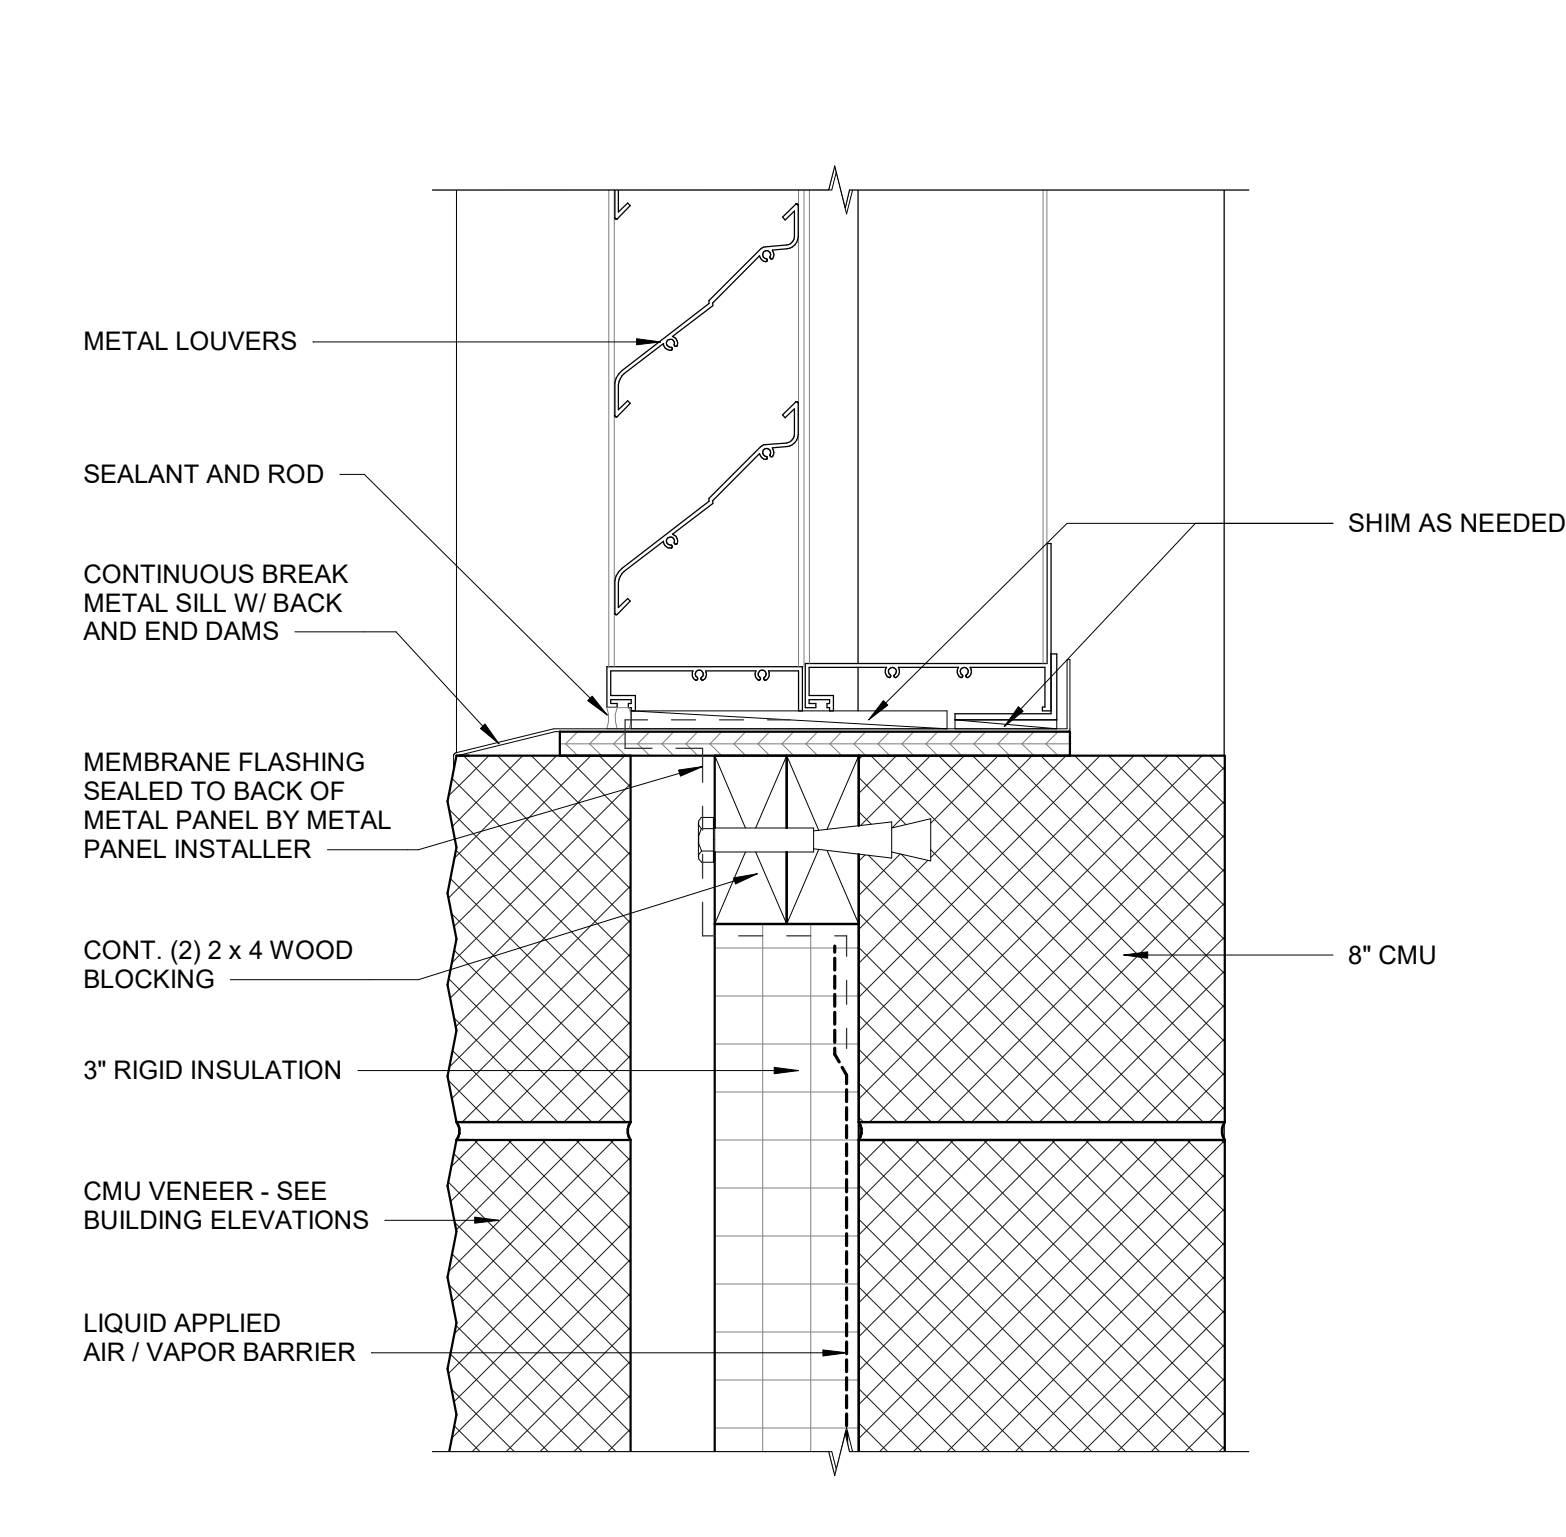

2 LOUVER - SILL DETAIL CMU 8"
3" = 1'-0"

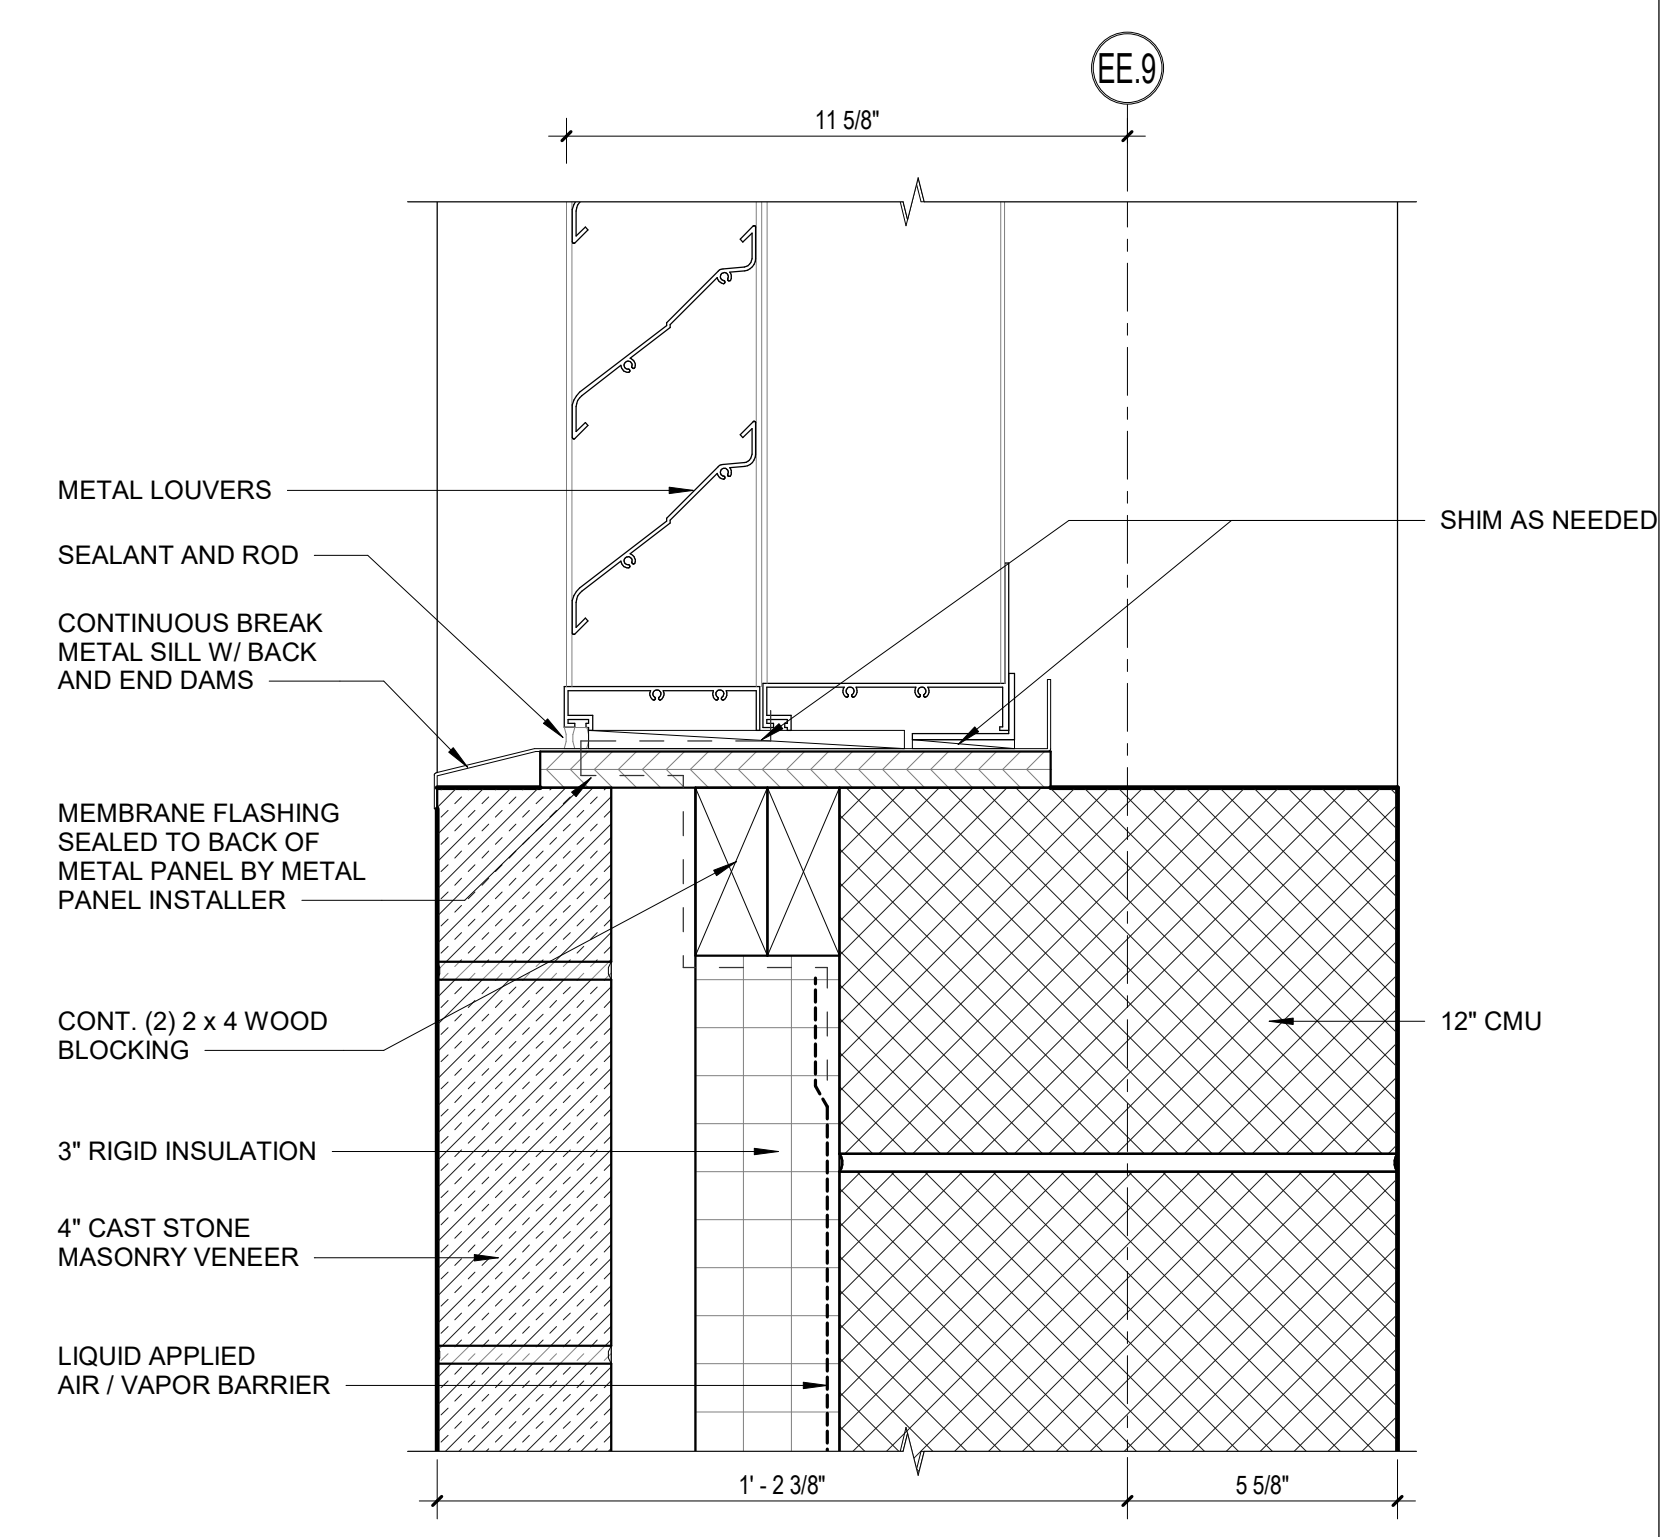


1 LOUVER - SILL DETAIL CMU 12"
3" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

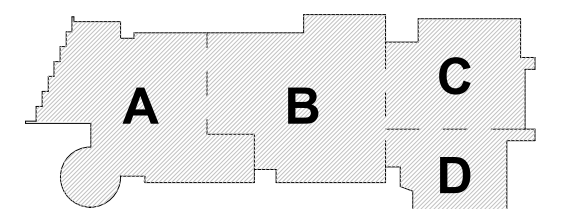


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**LOUVER
DETAILS**

Scale: 3" = 1'-0"

Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A6-3-9

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

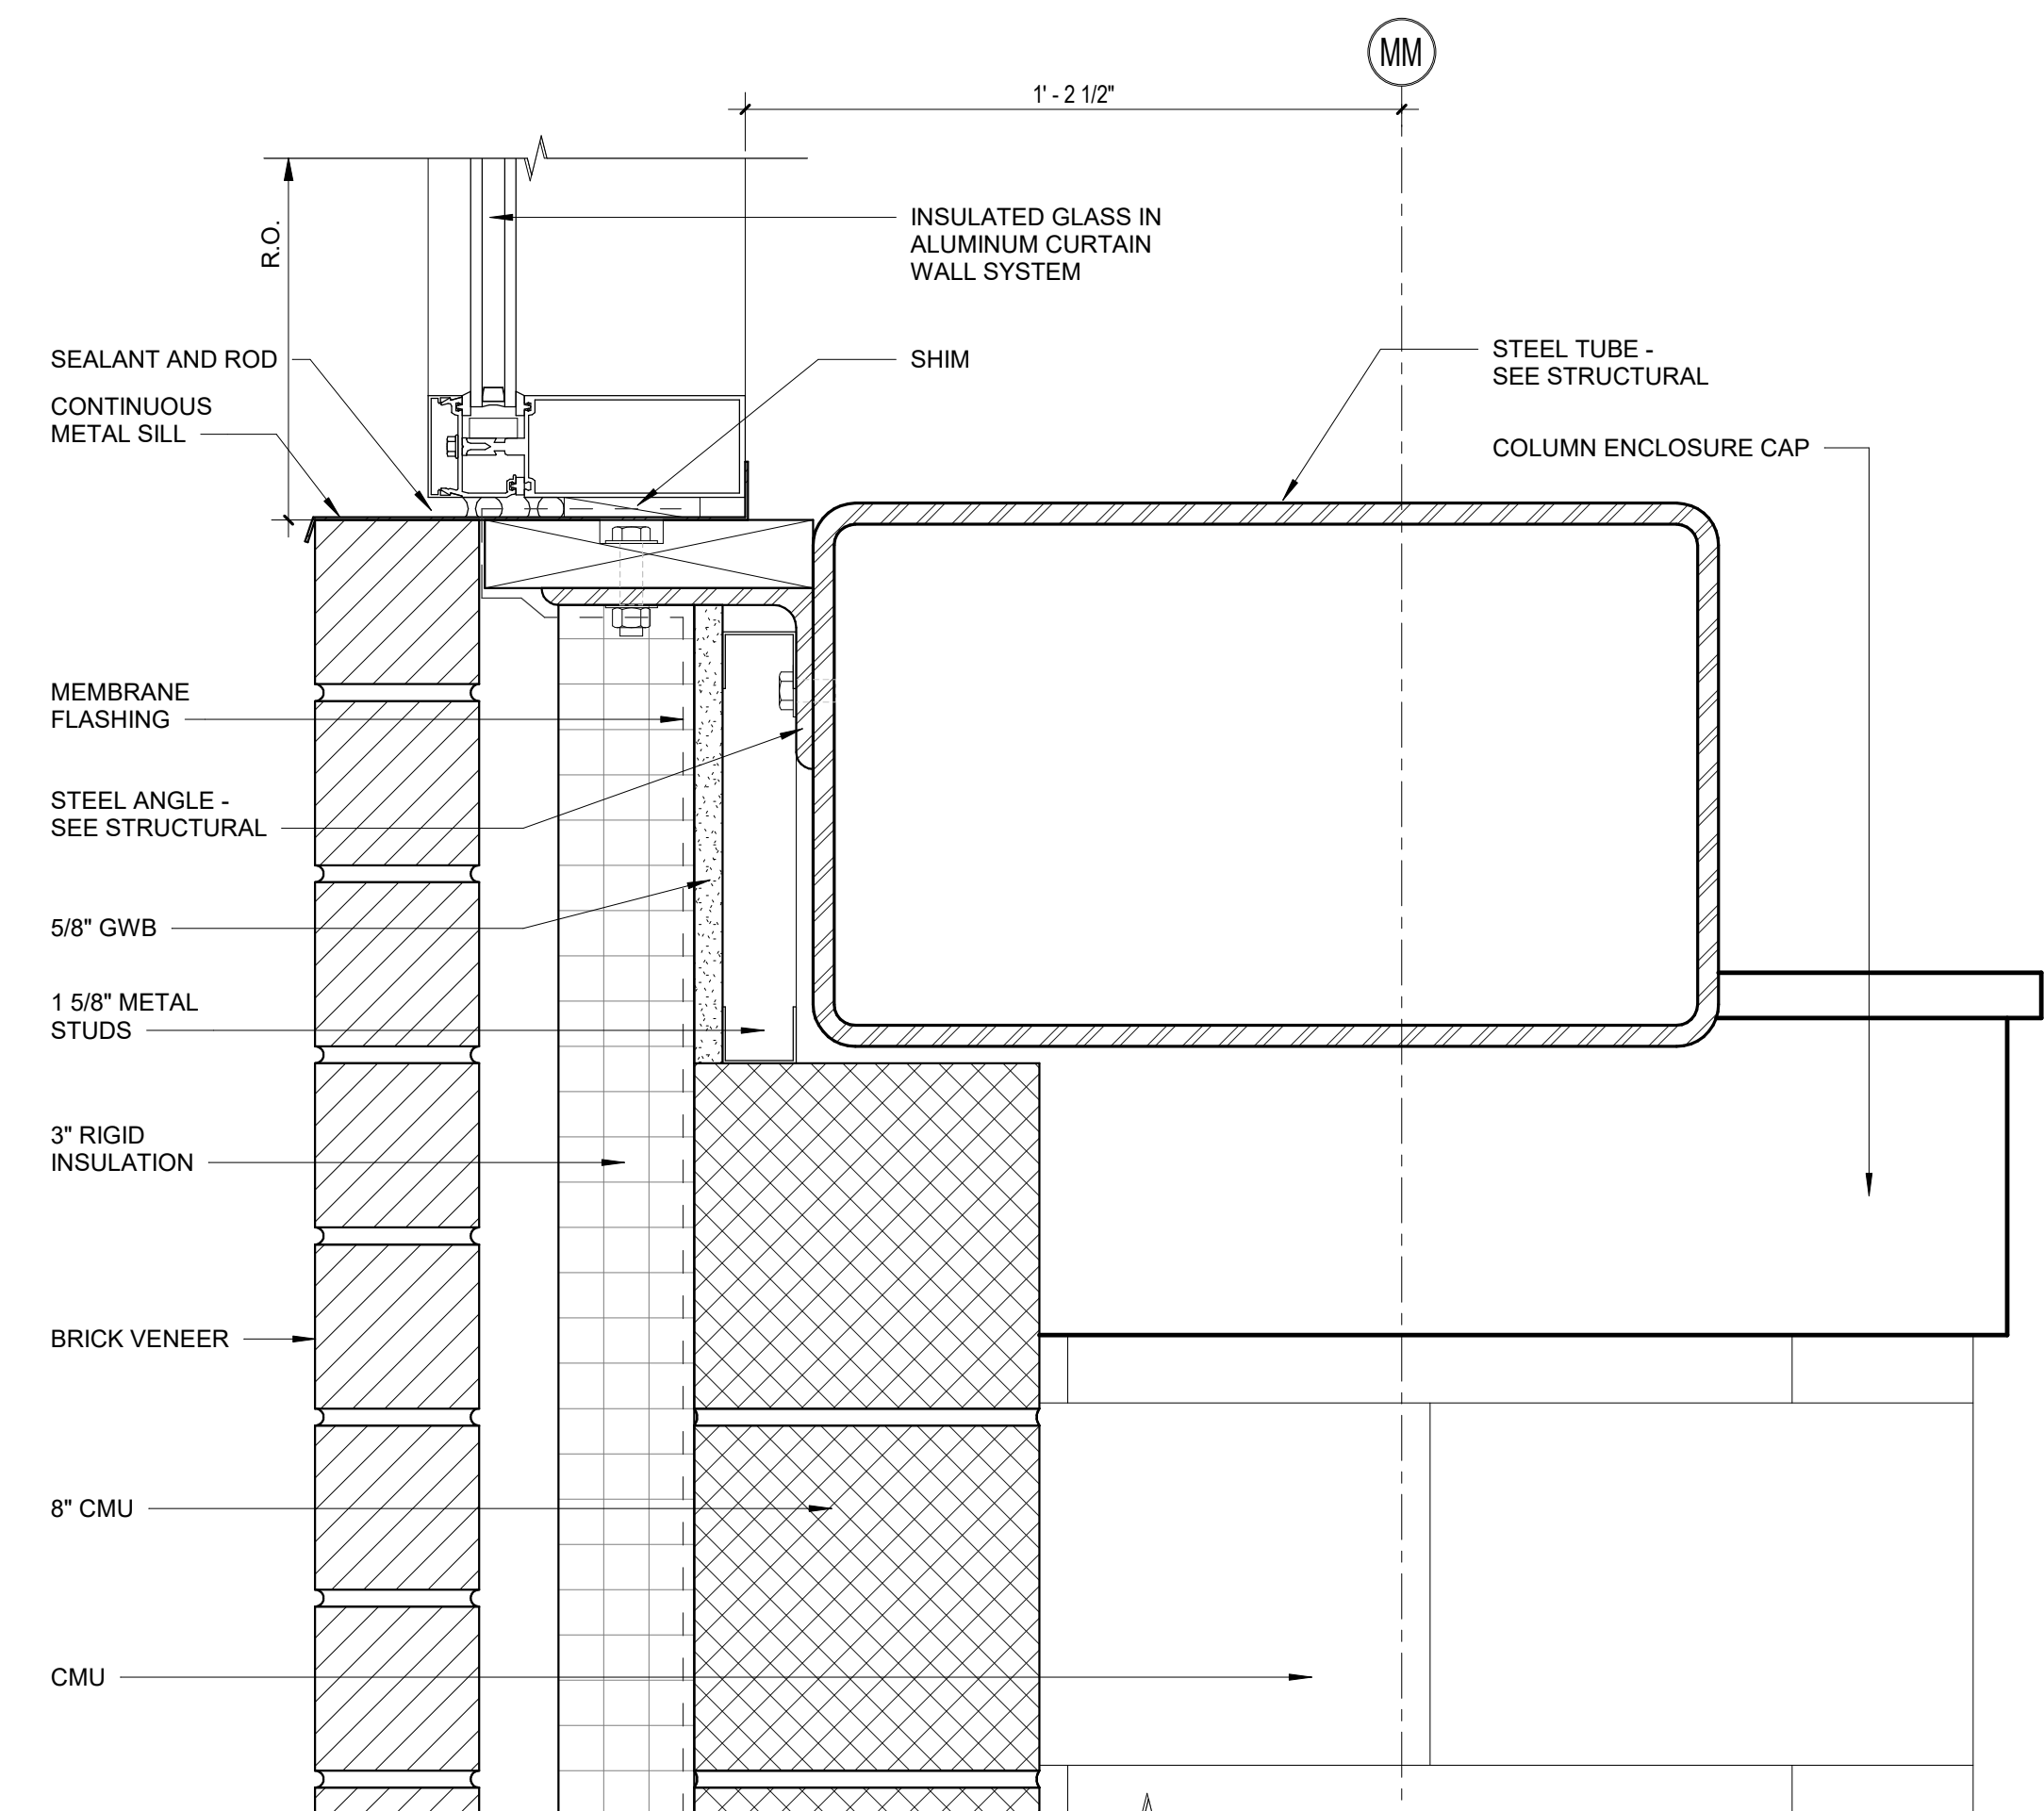

13 CURTAIN WALL SILL DETAIL
3" = 1'-0"

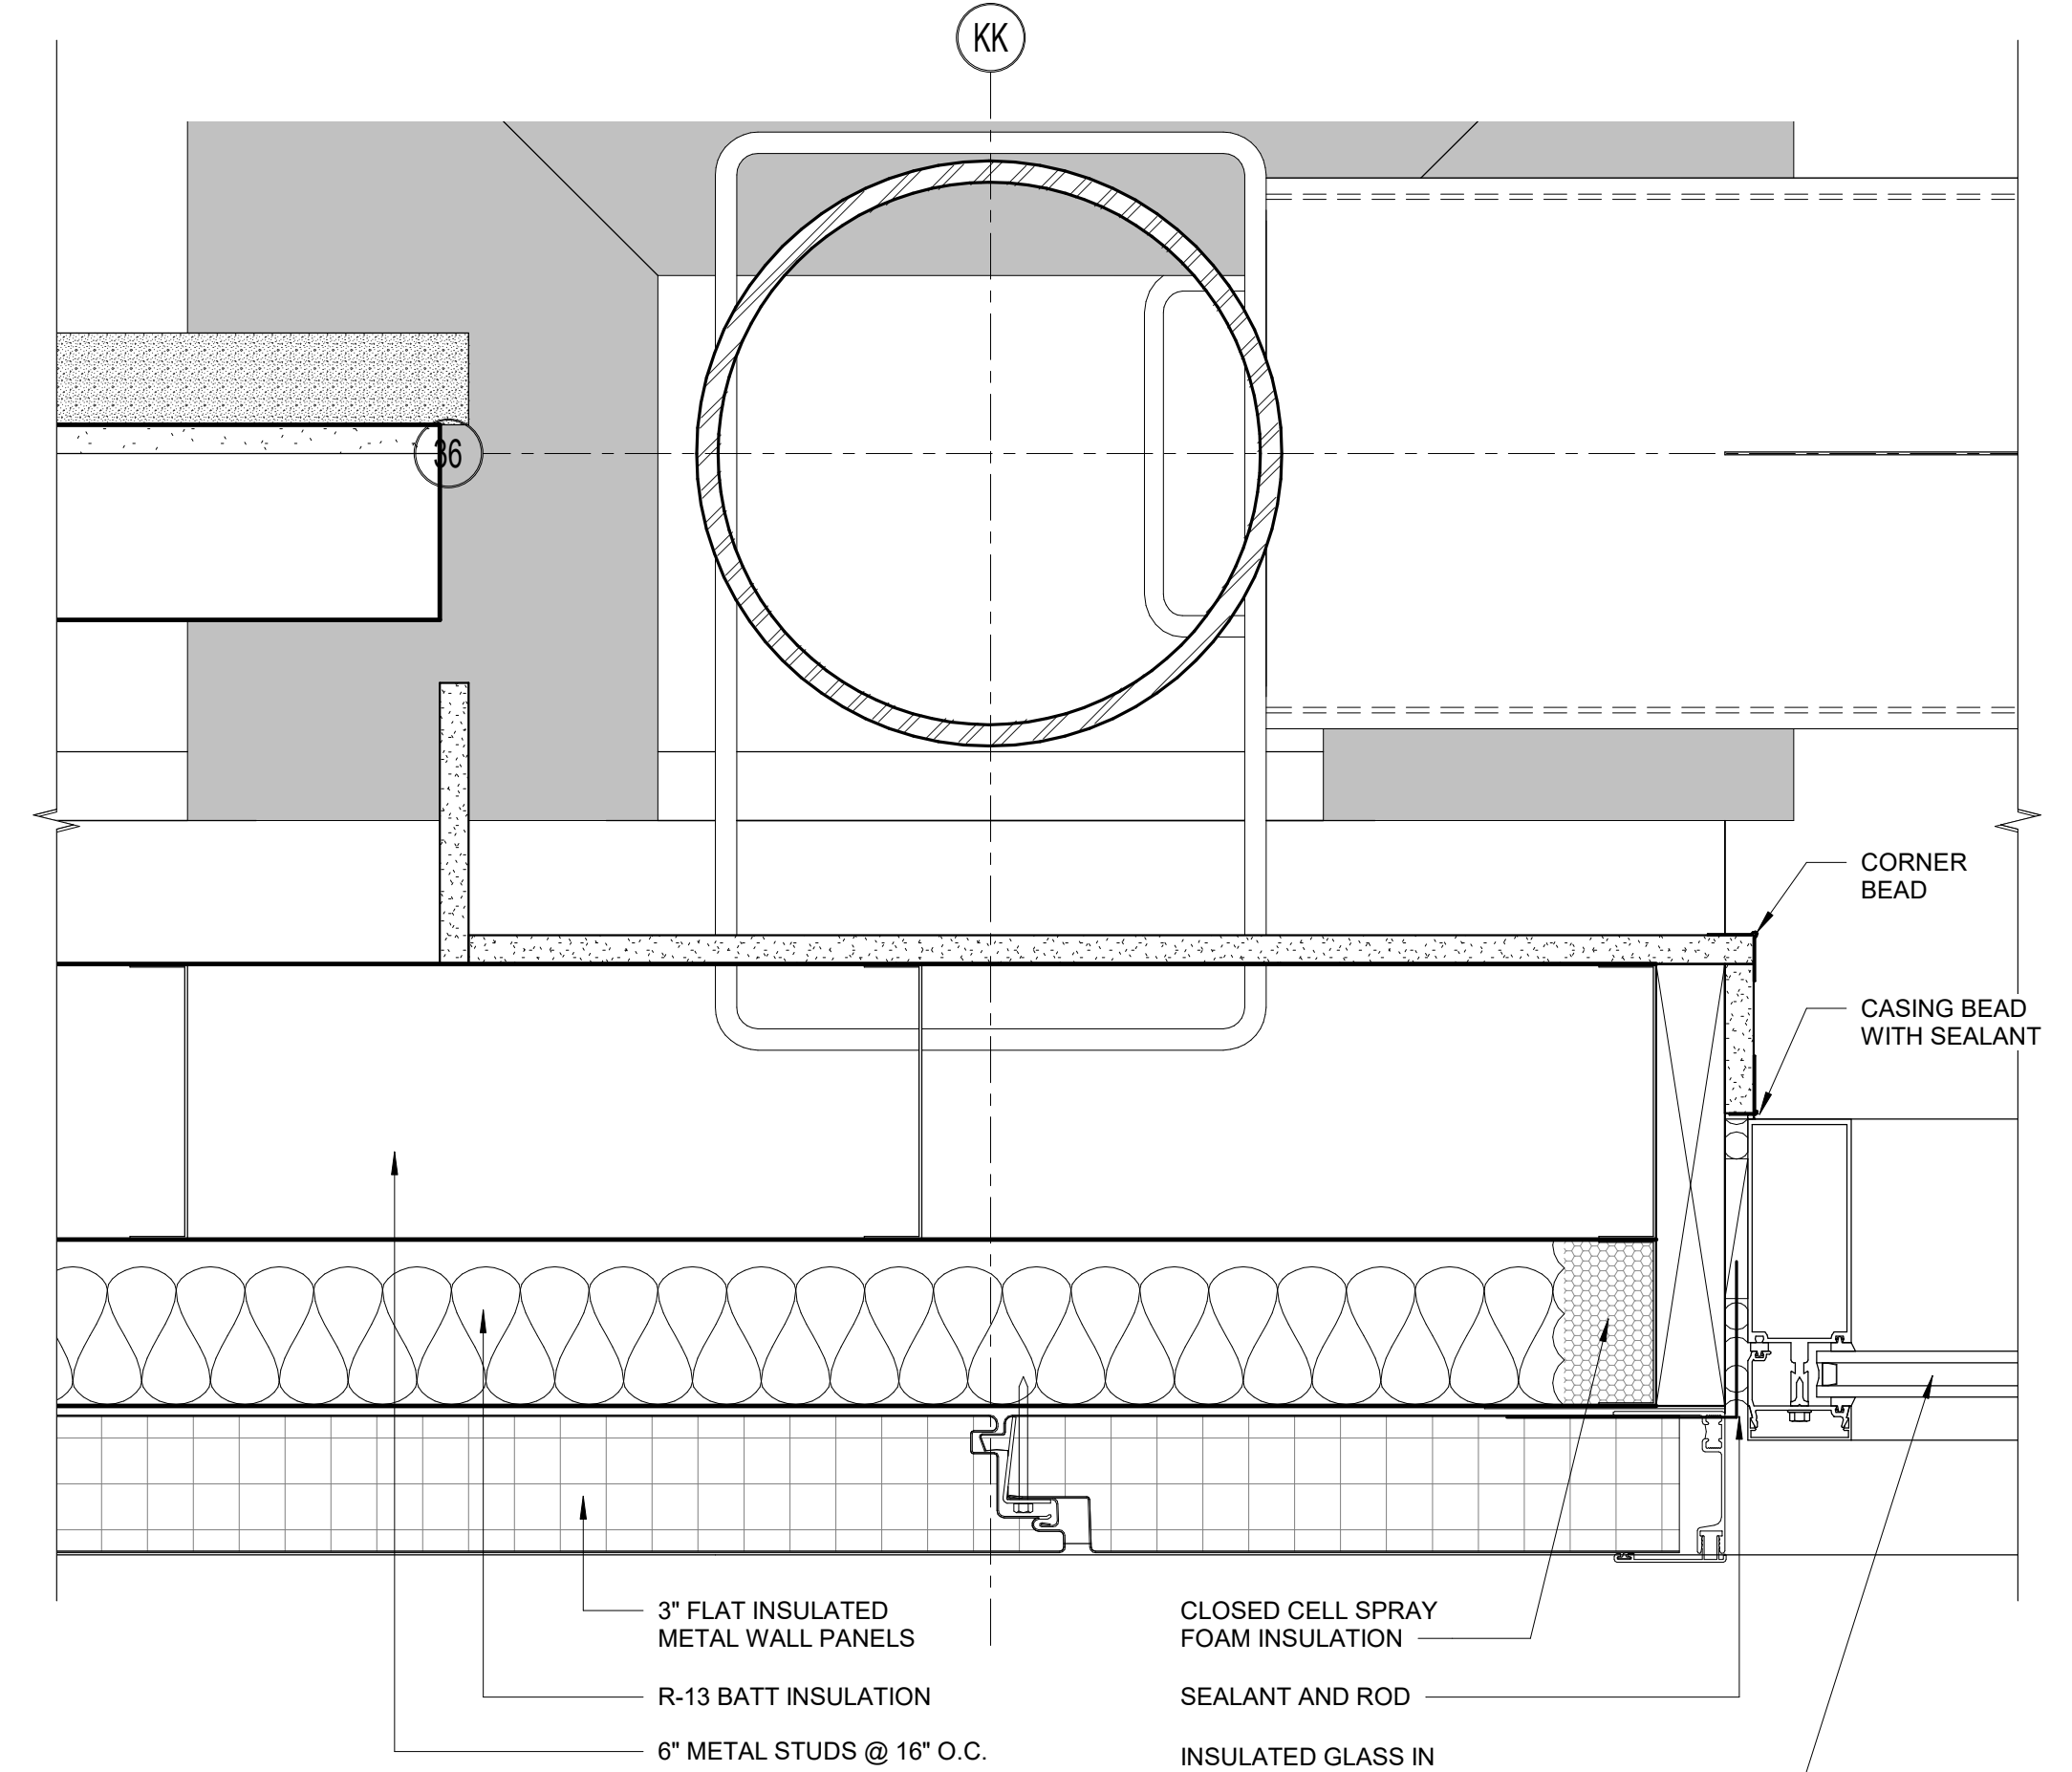


12 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

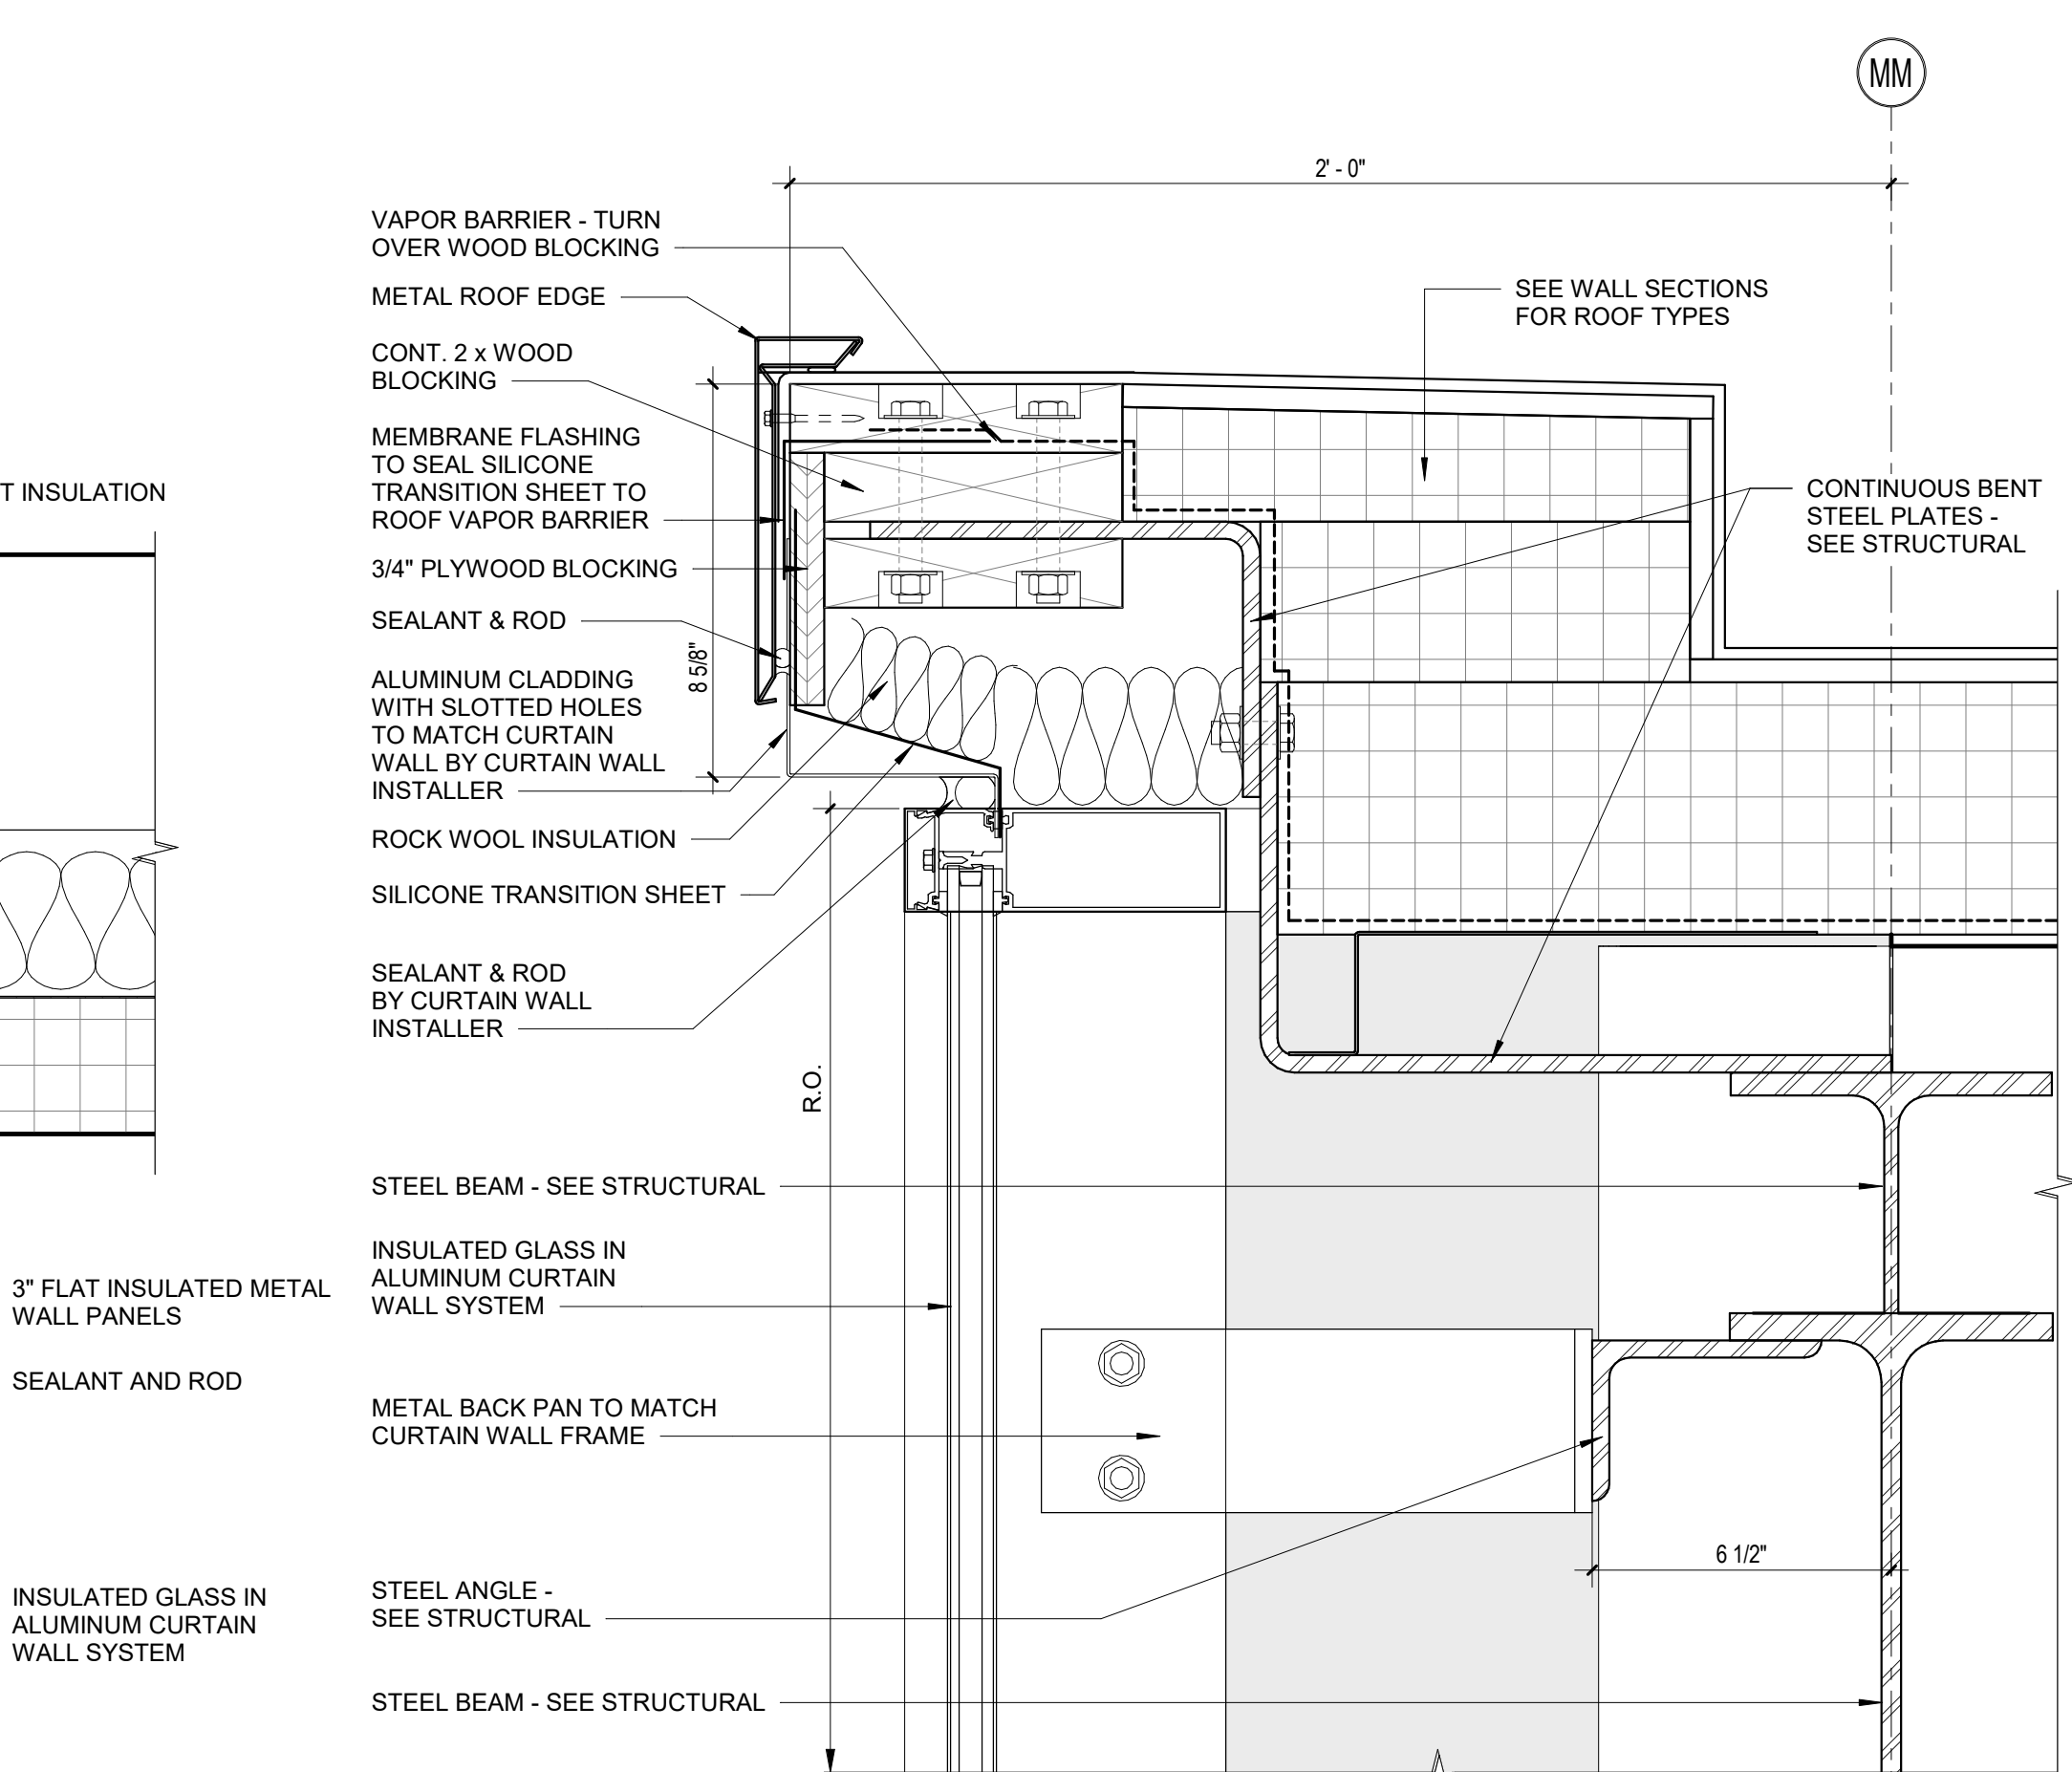


11 CURTAIN WALL HEAD DETAIL
3" = 1'-0"


14 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

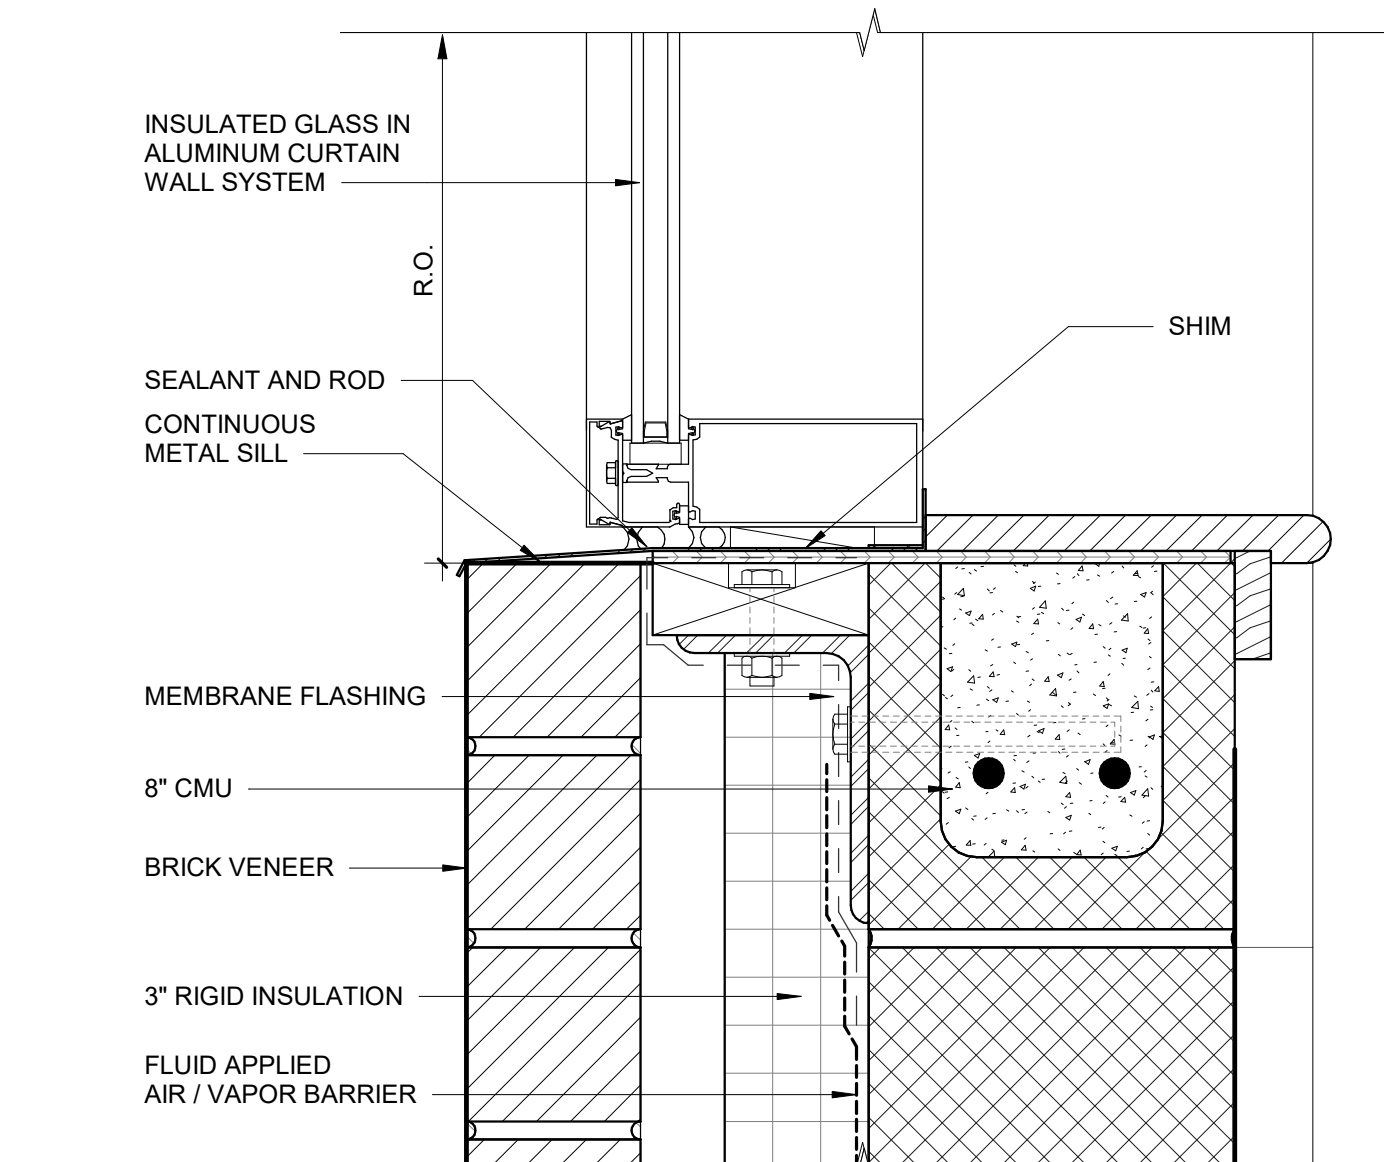


10 CURTAIN WALL SILL DETAIL
3" = 1'-0"

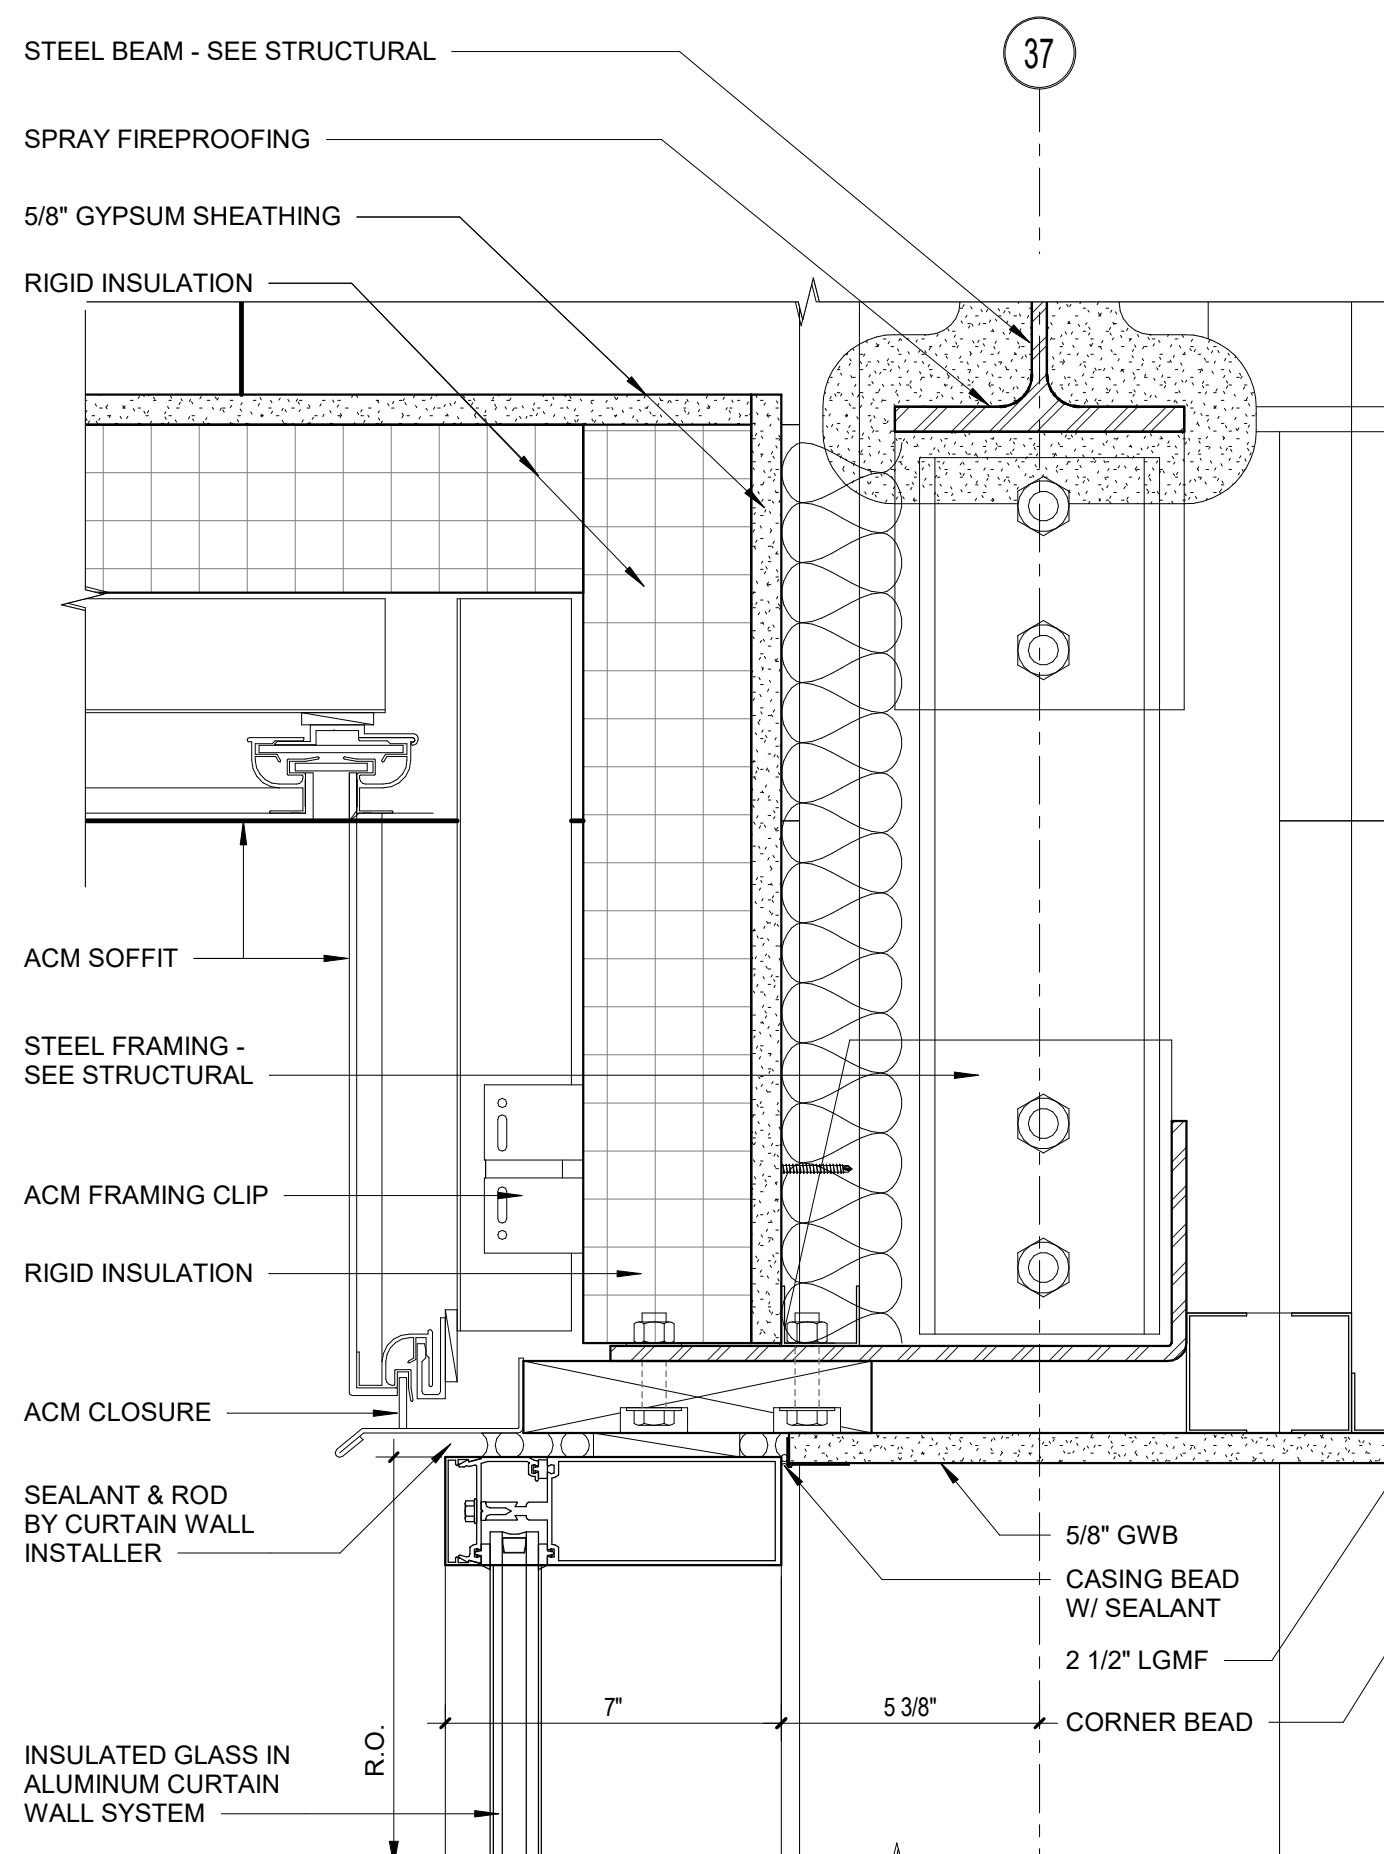


9 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

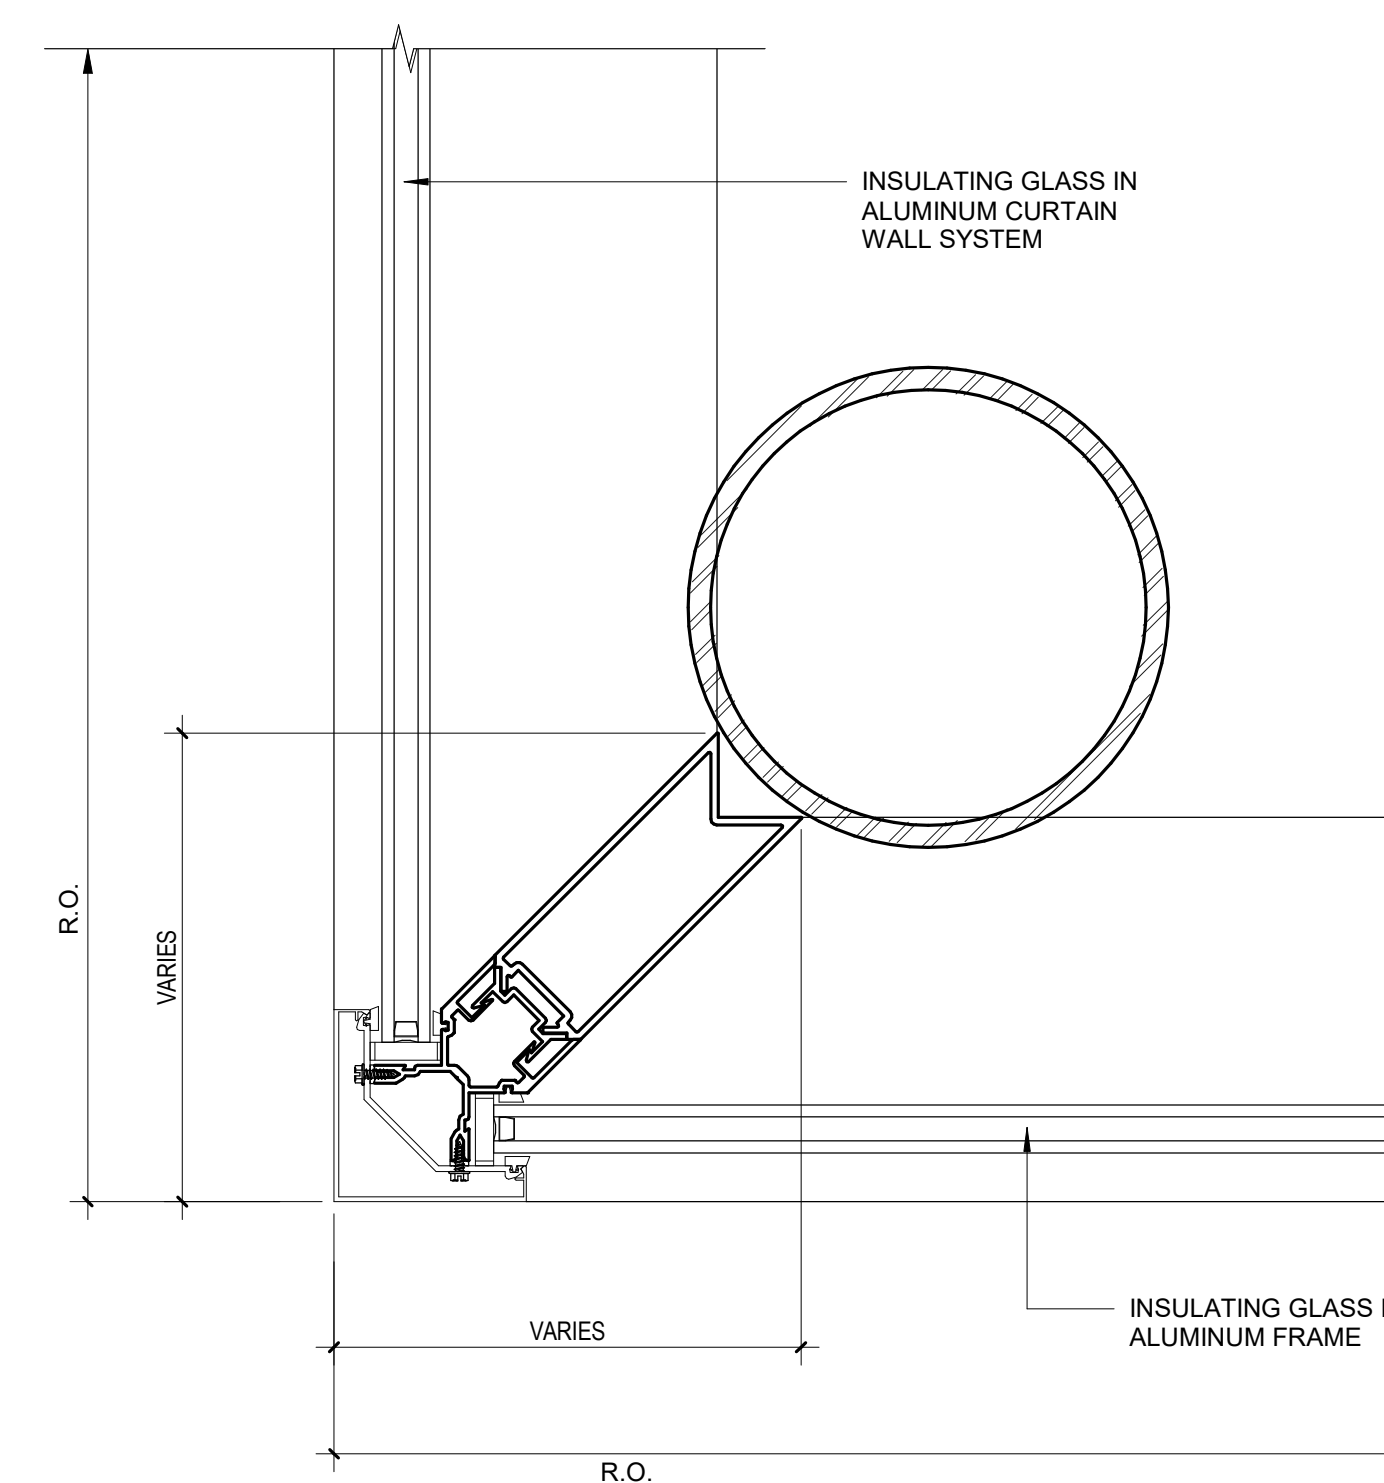


8 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

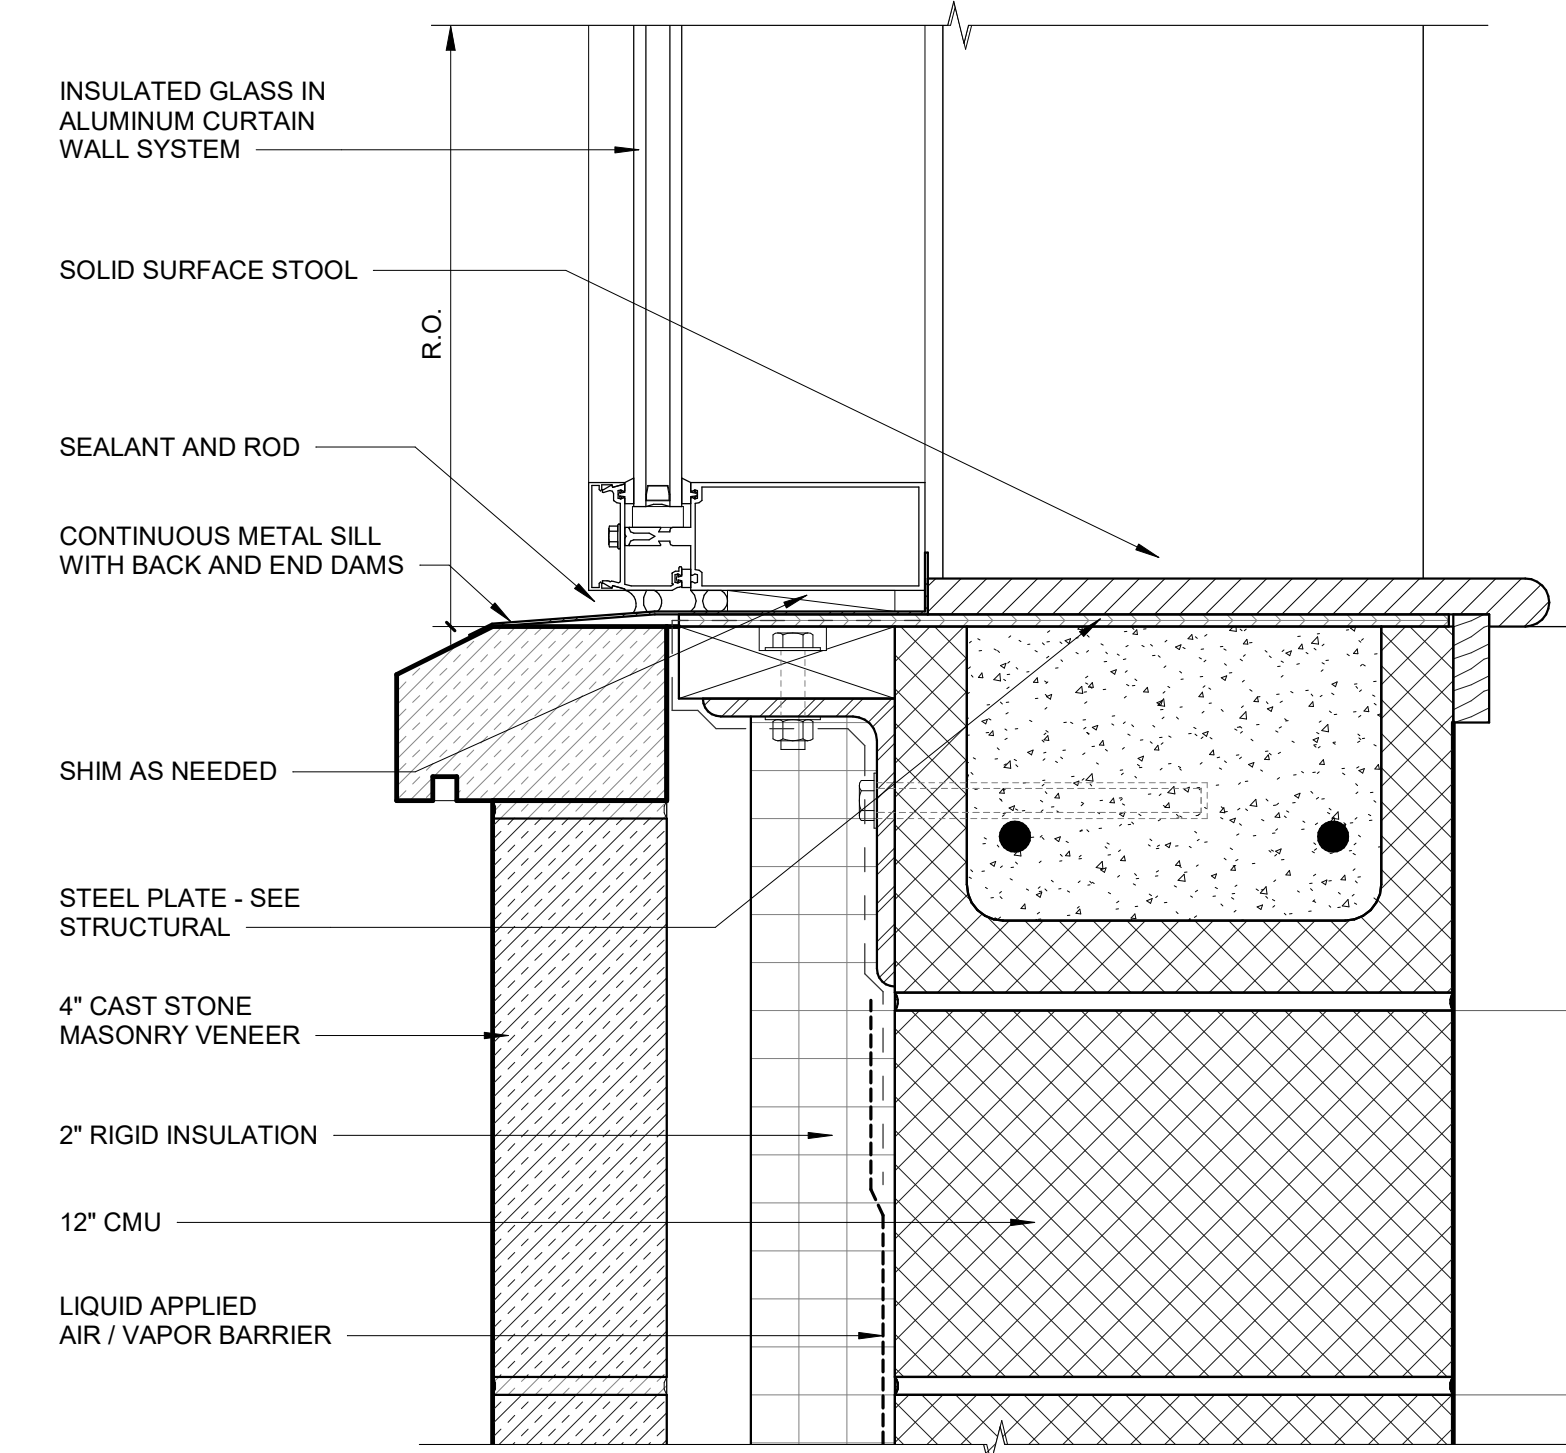


7 CURTAIN WALL SILL DETAIL
3" = 1'-0"

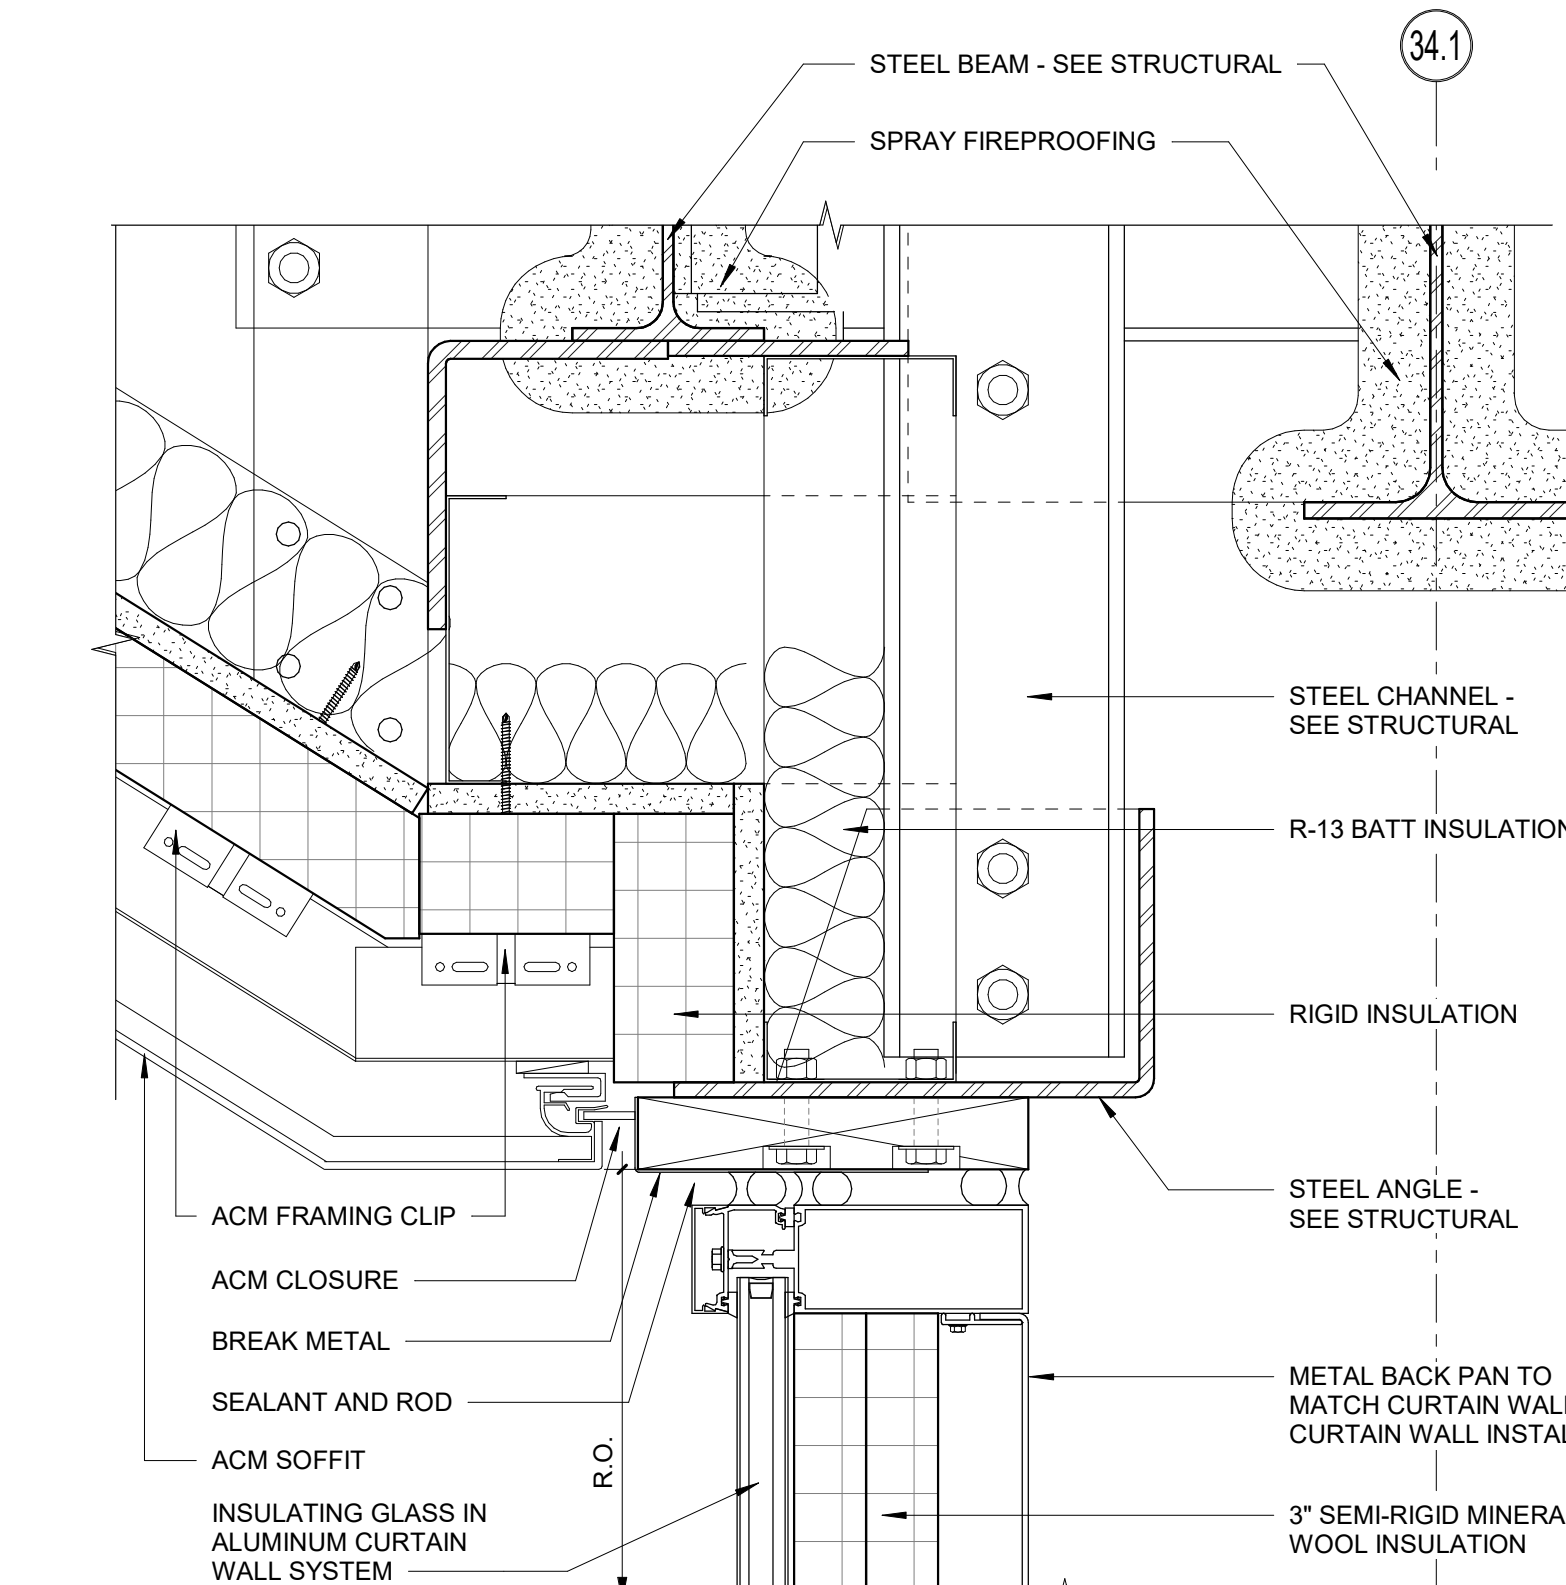


6 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

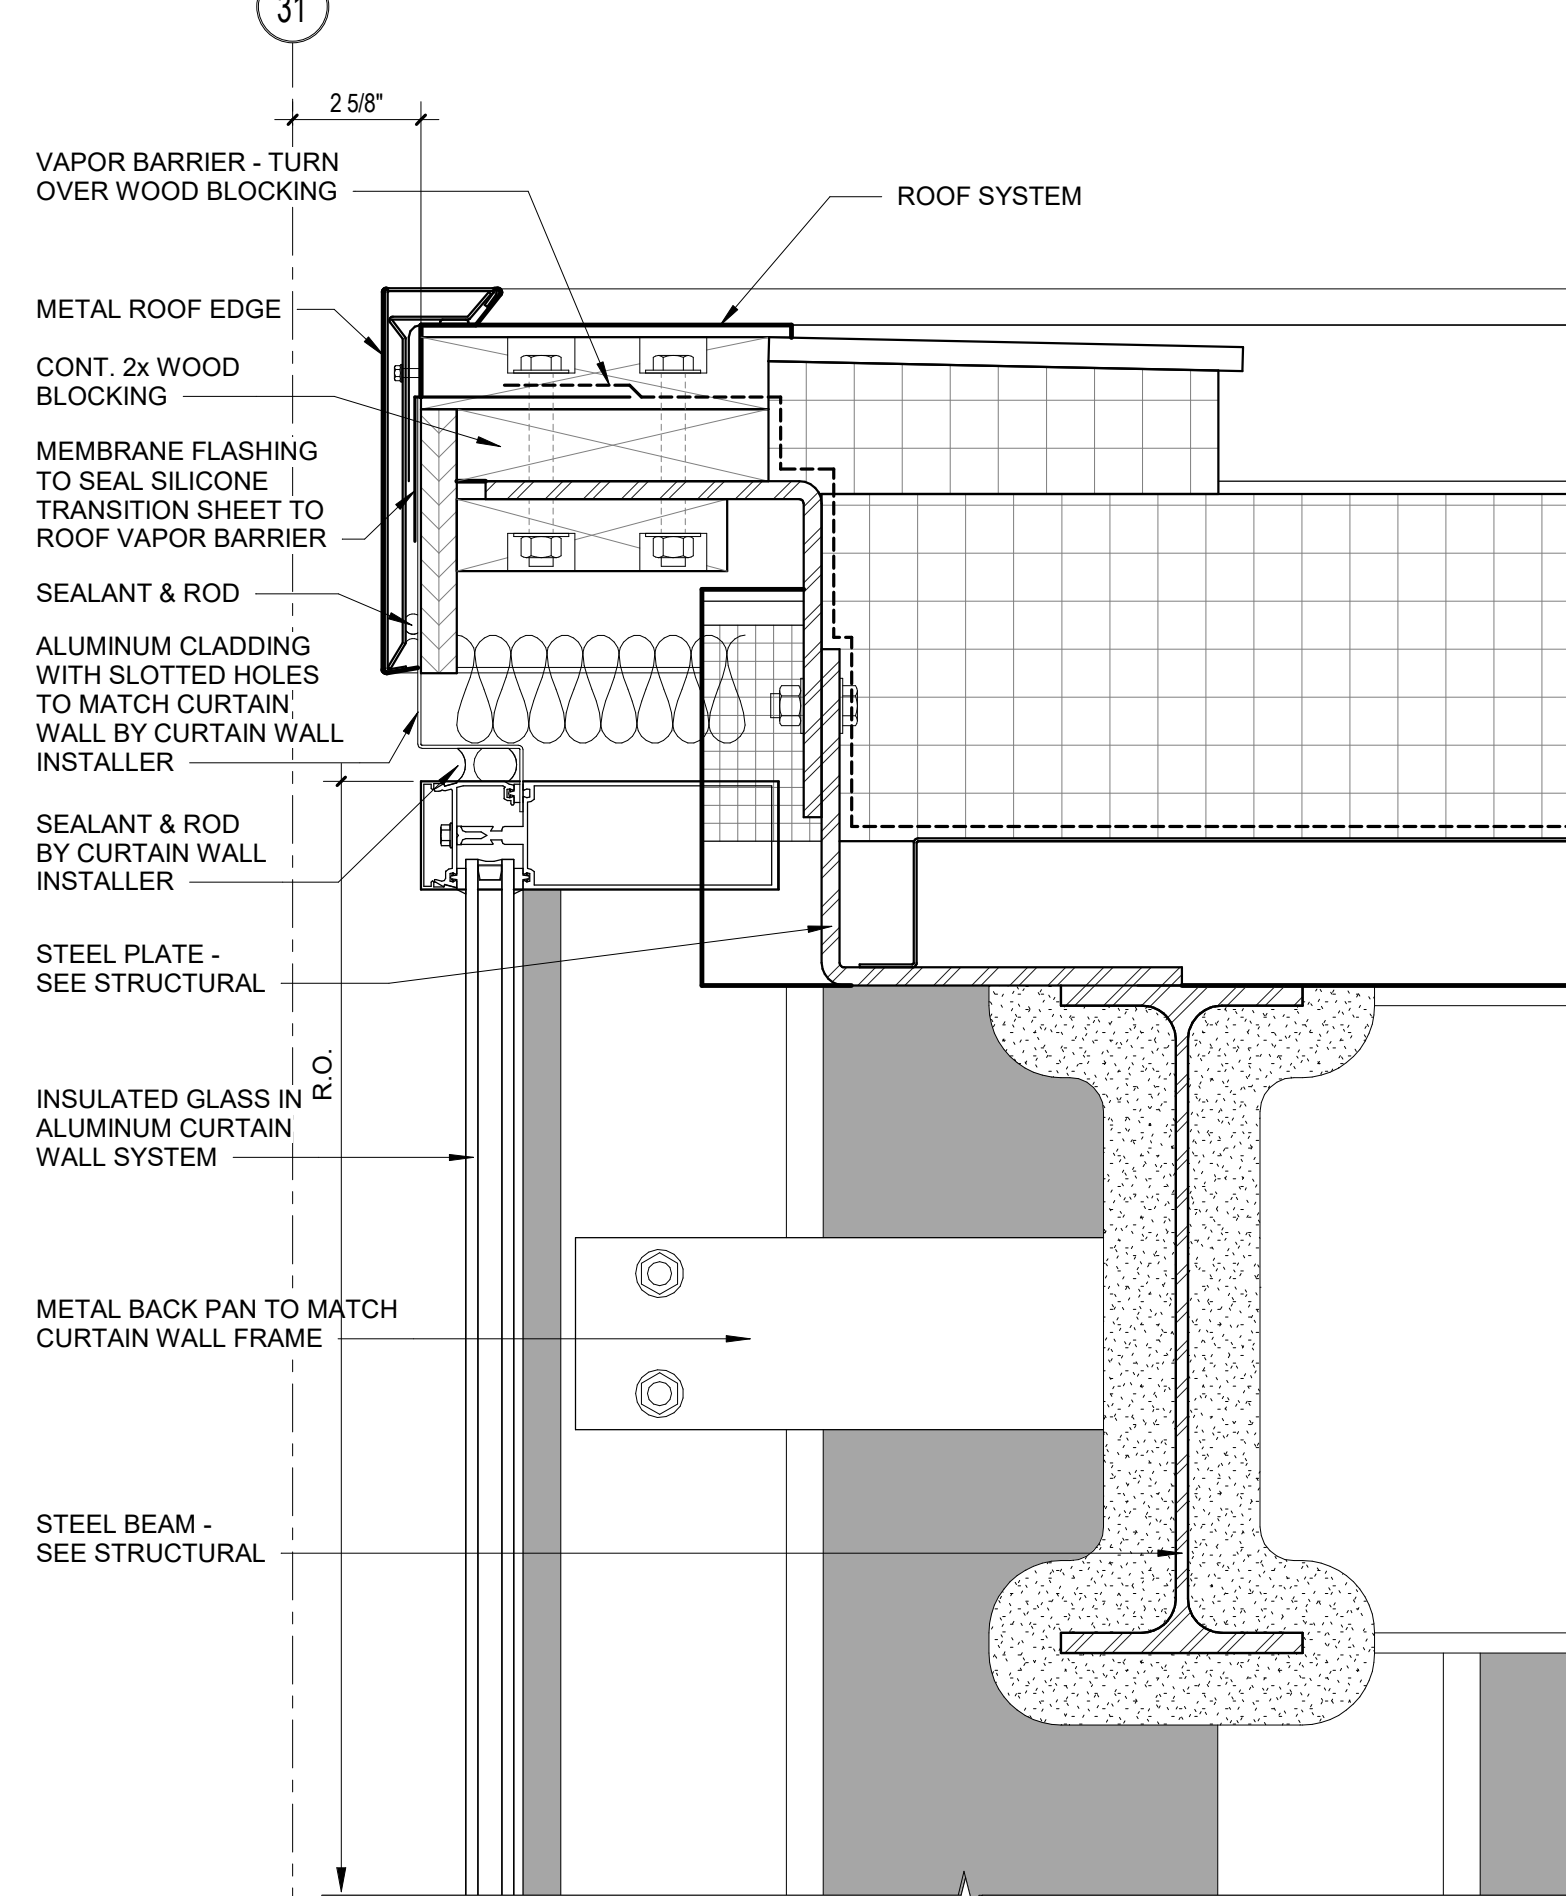


5 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

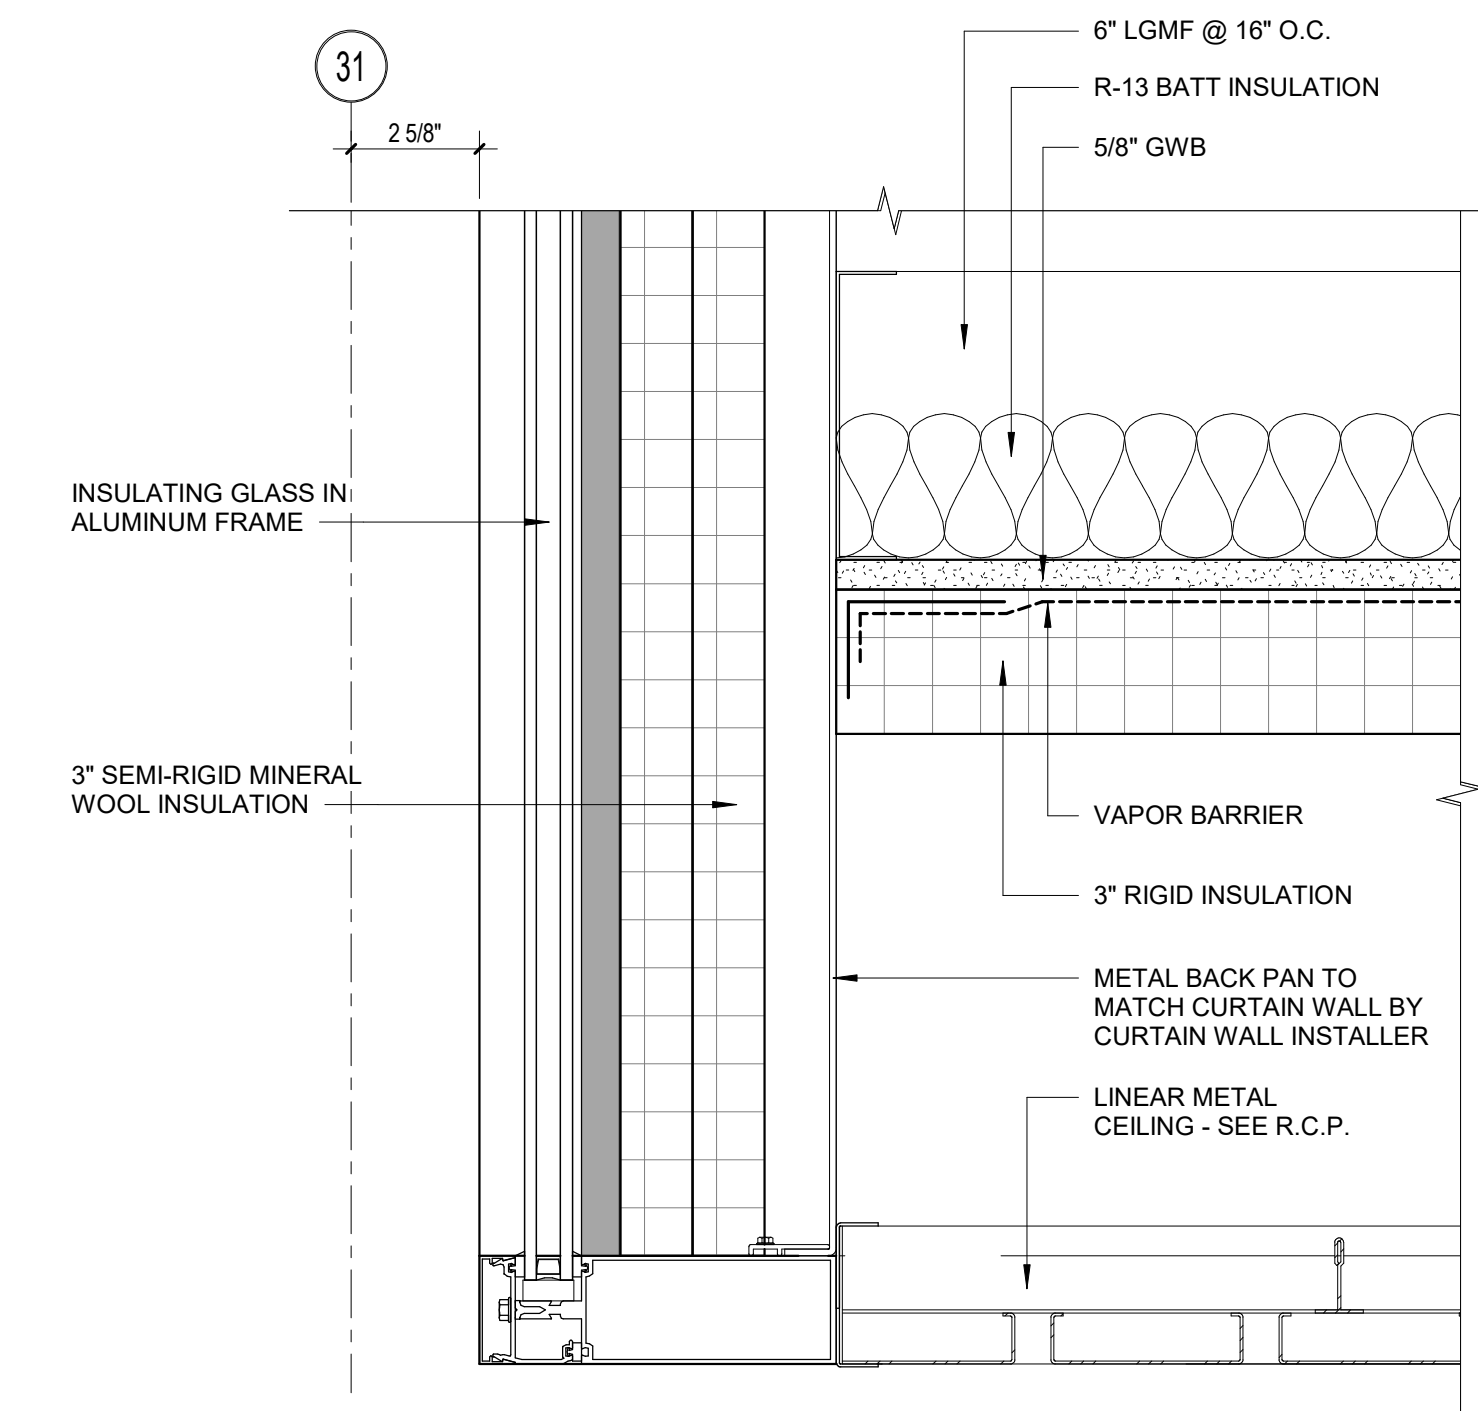


4 CURTAIN WALL SILL DETAIL
3" = 1'-0"

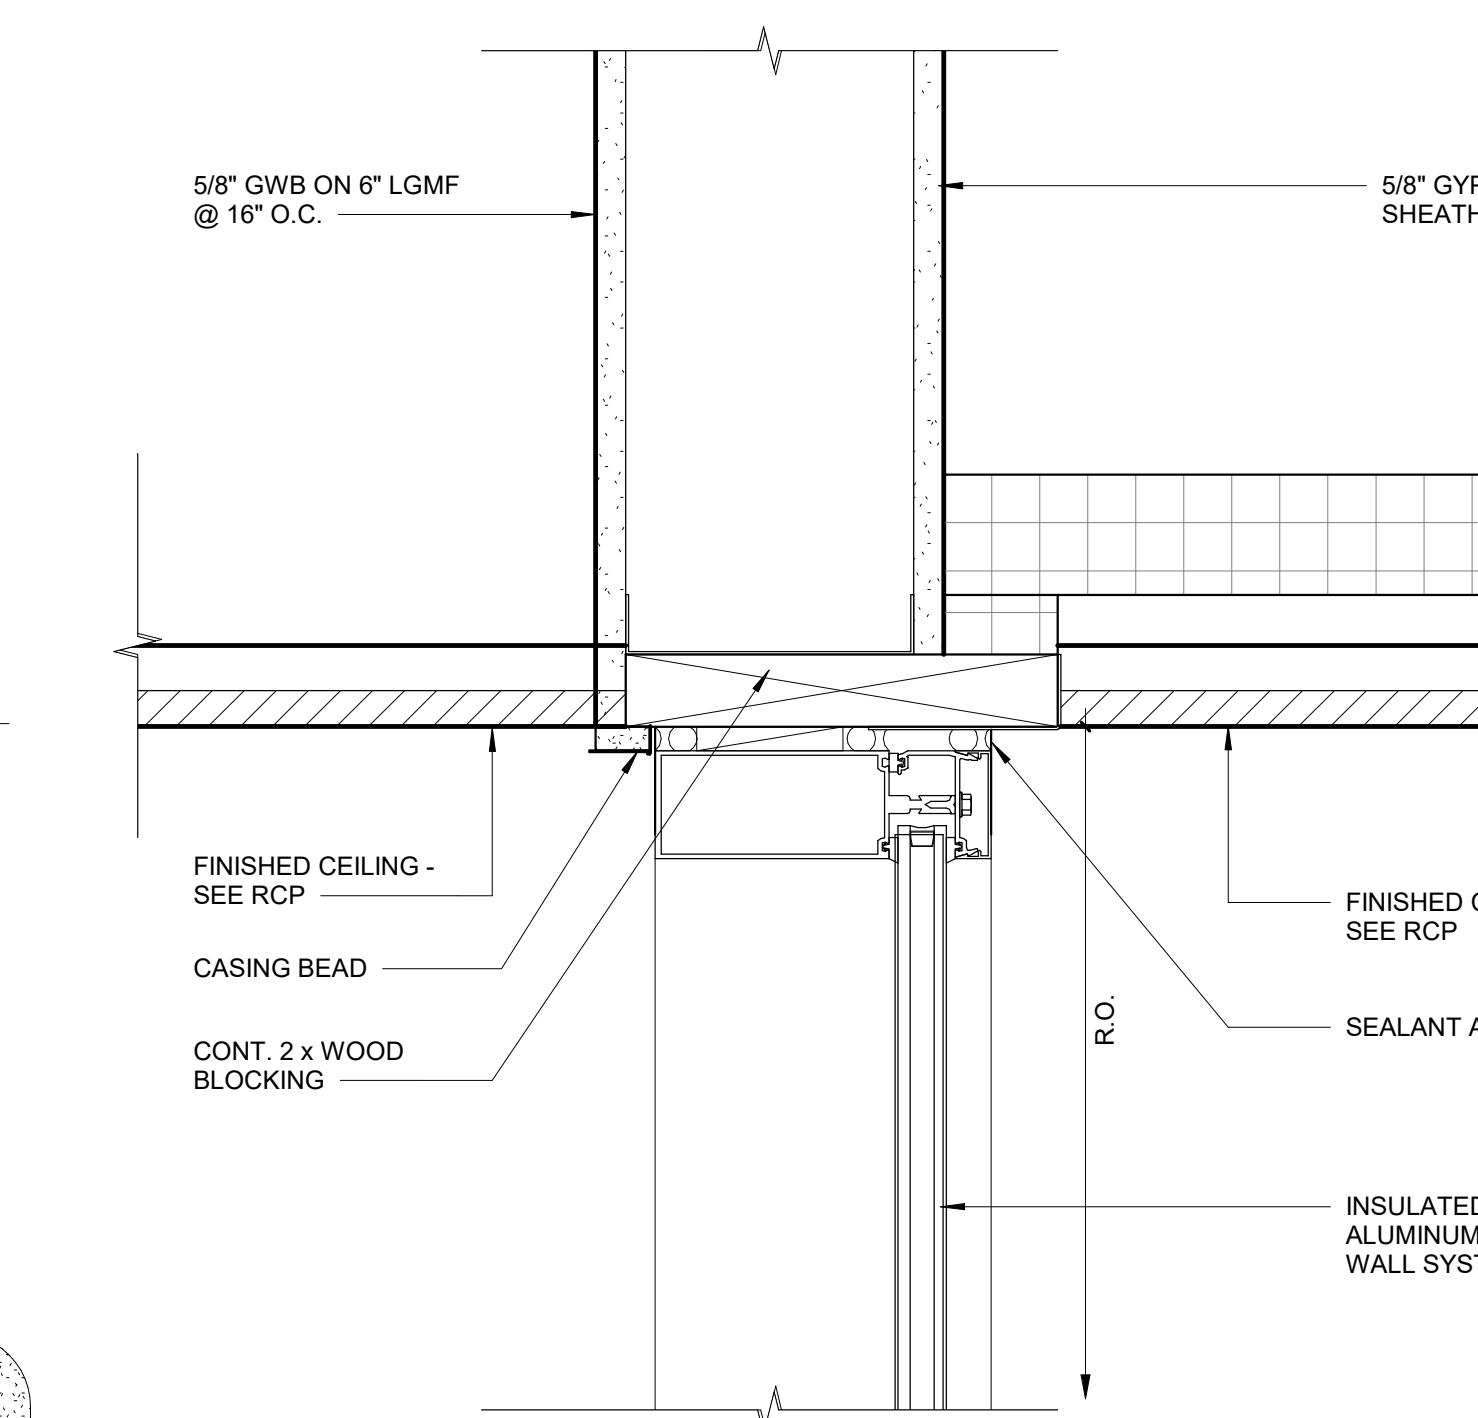

3 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

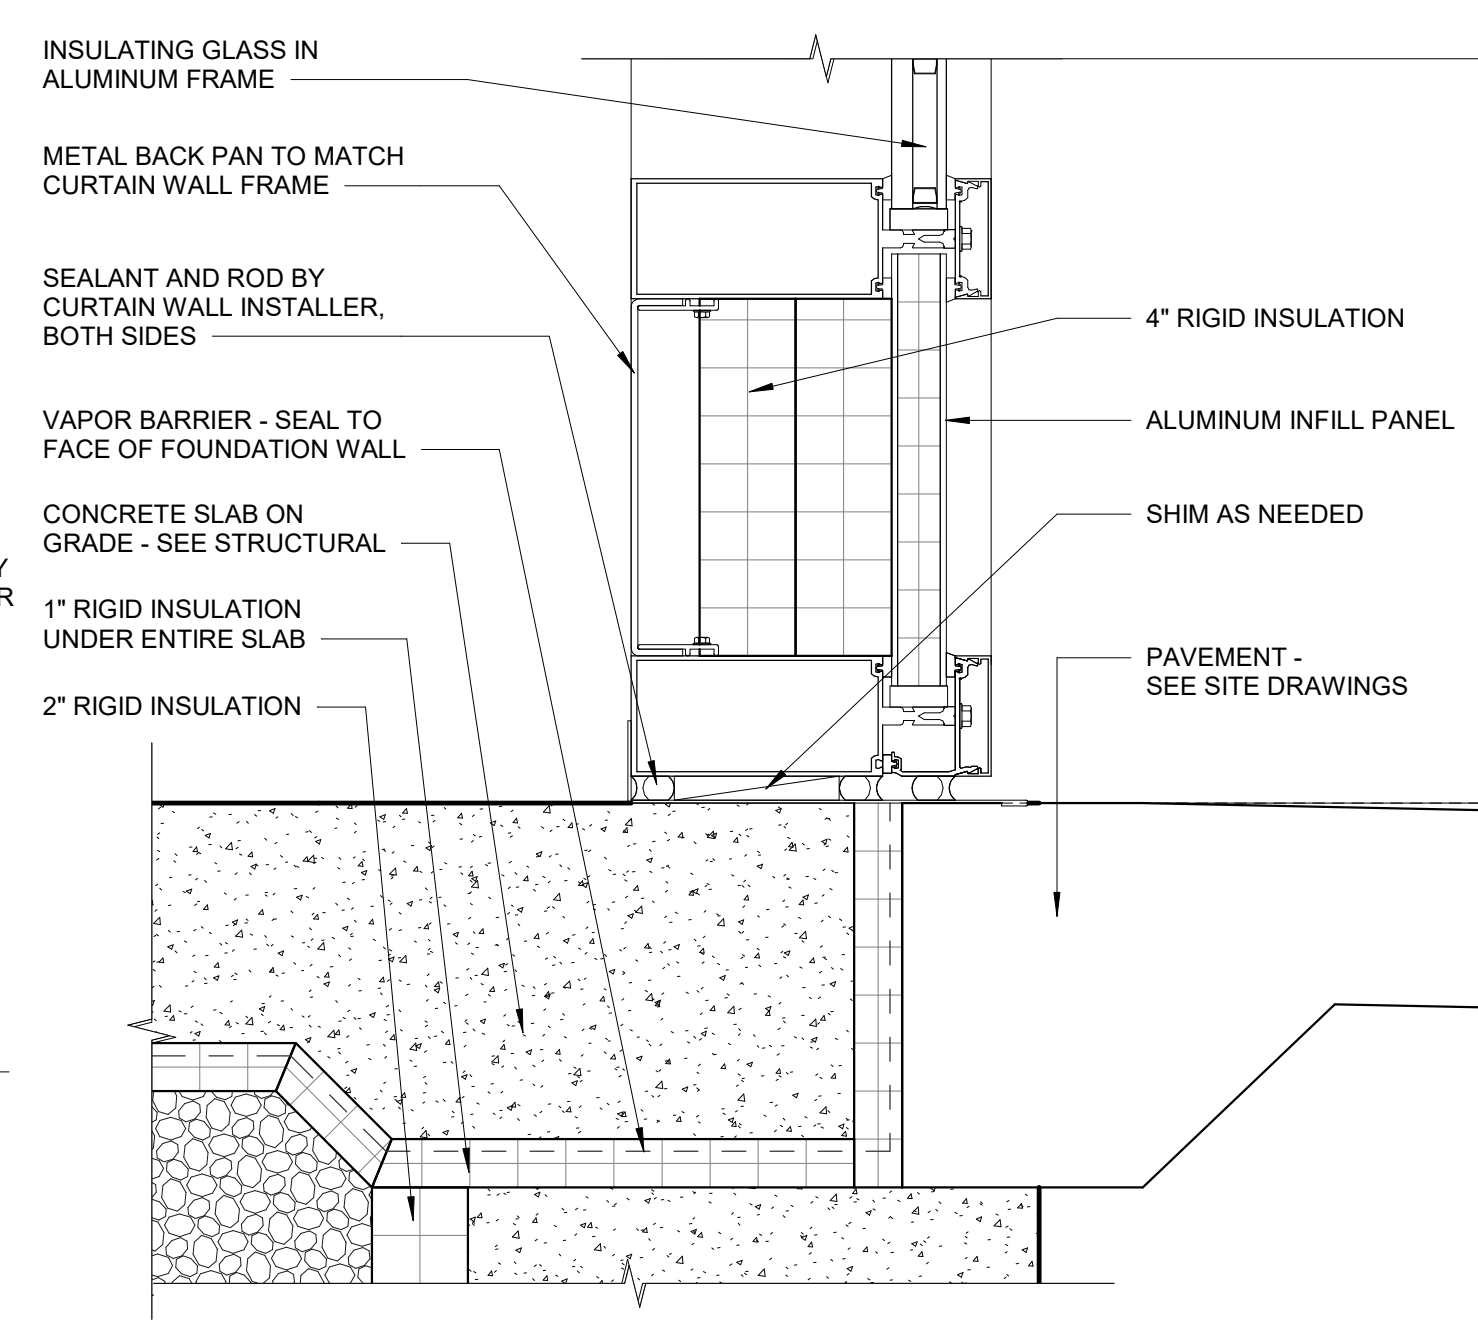

2 CURTAIN WALL SILL DETAIL
3" = 1'-0"

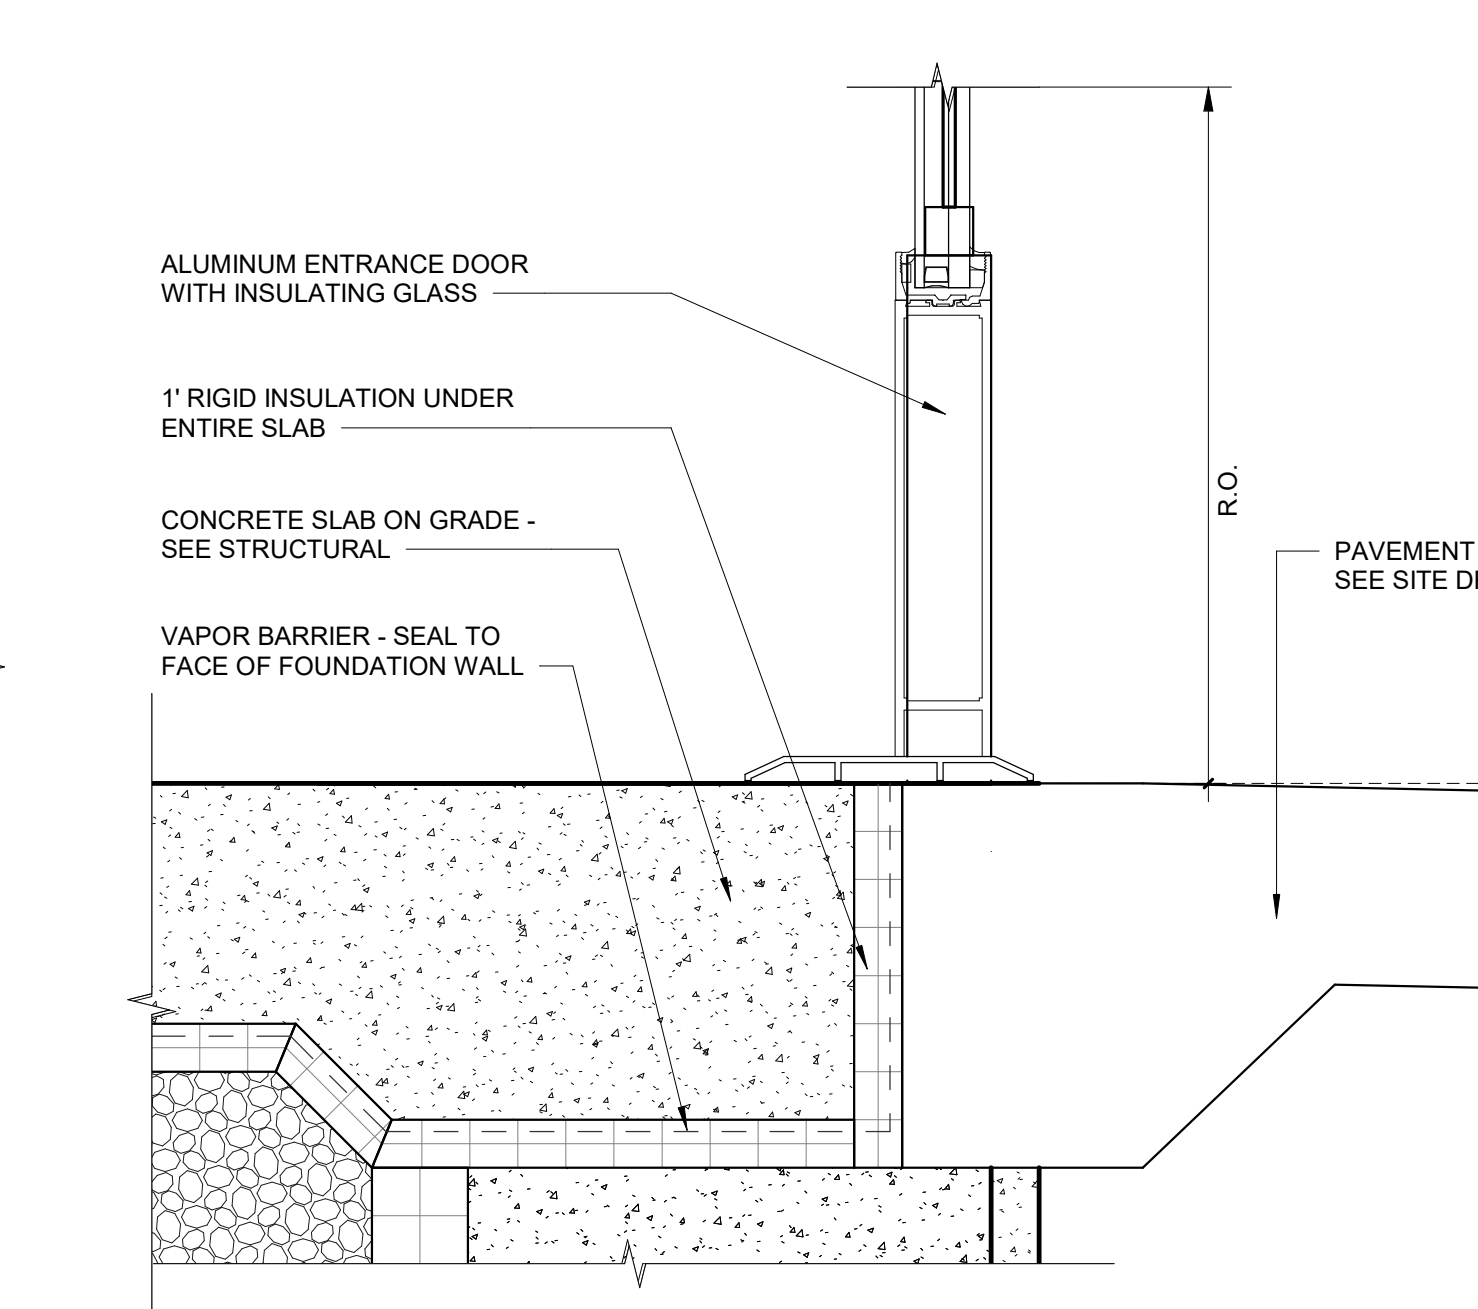


1 CURTAIN WALL SILL DETAIL
3" = 1'-0"

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

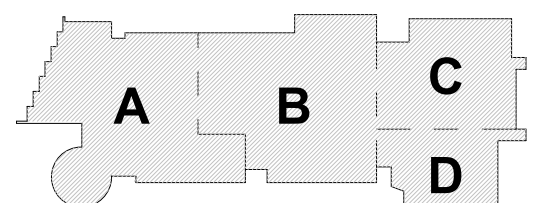


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**CURTAIN WALL
DETAILS**

Scale: 3" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A6-3-10

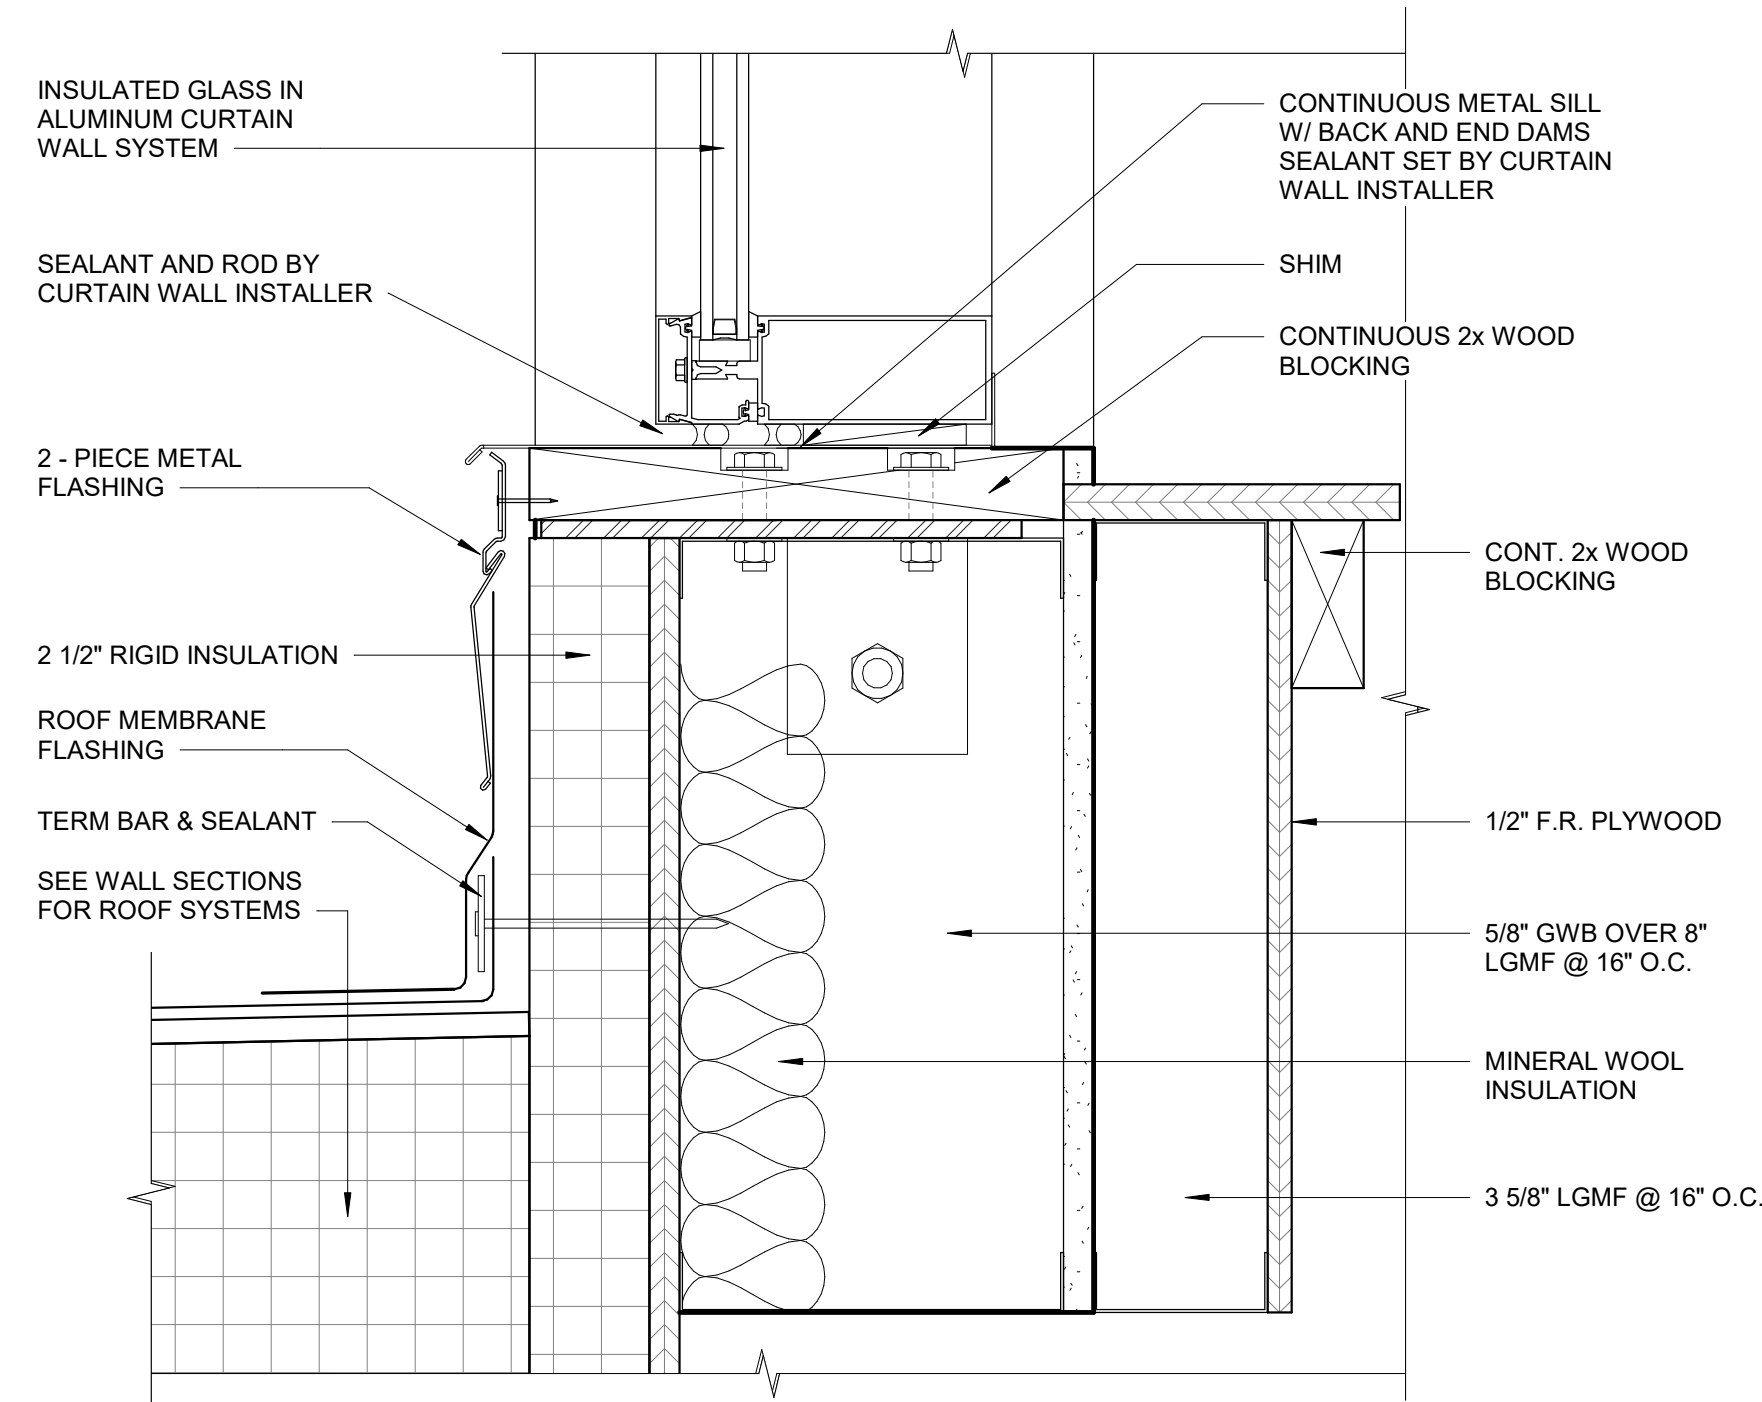


13 CURTAIN WALL SILL DETAIL
3" = 1'-0"

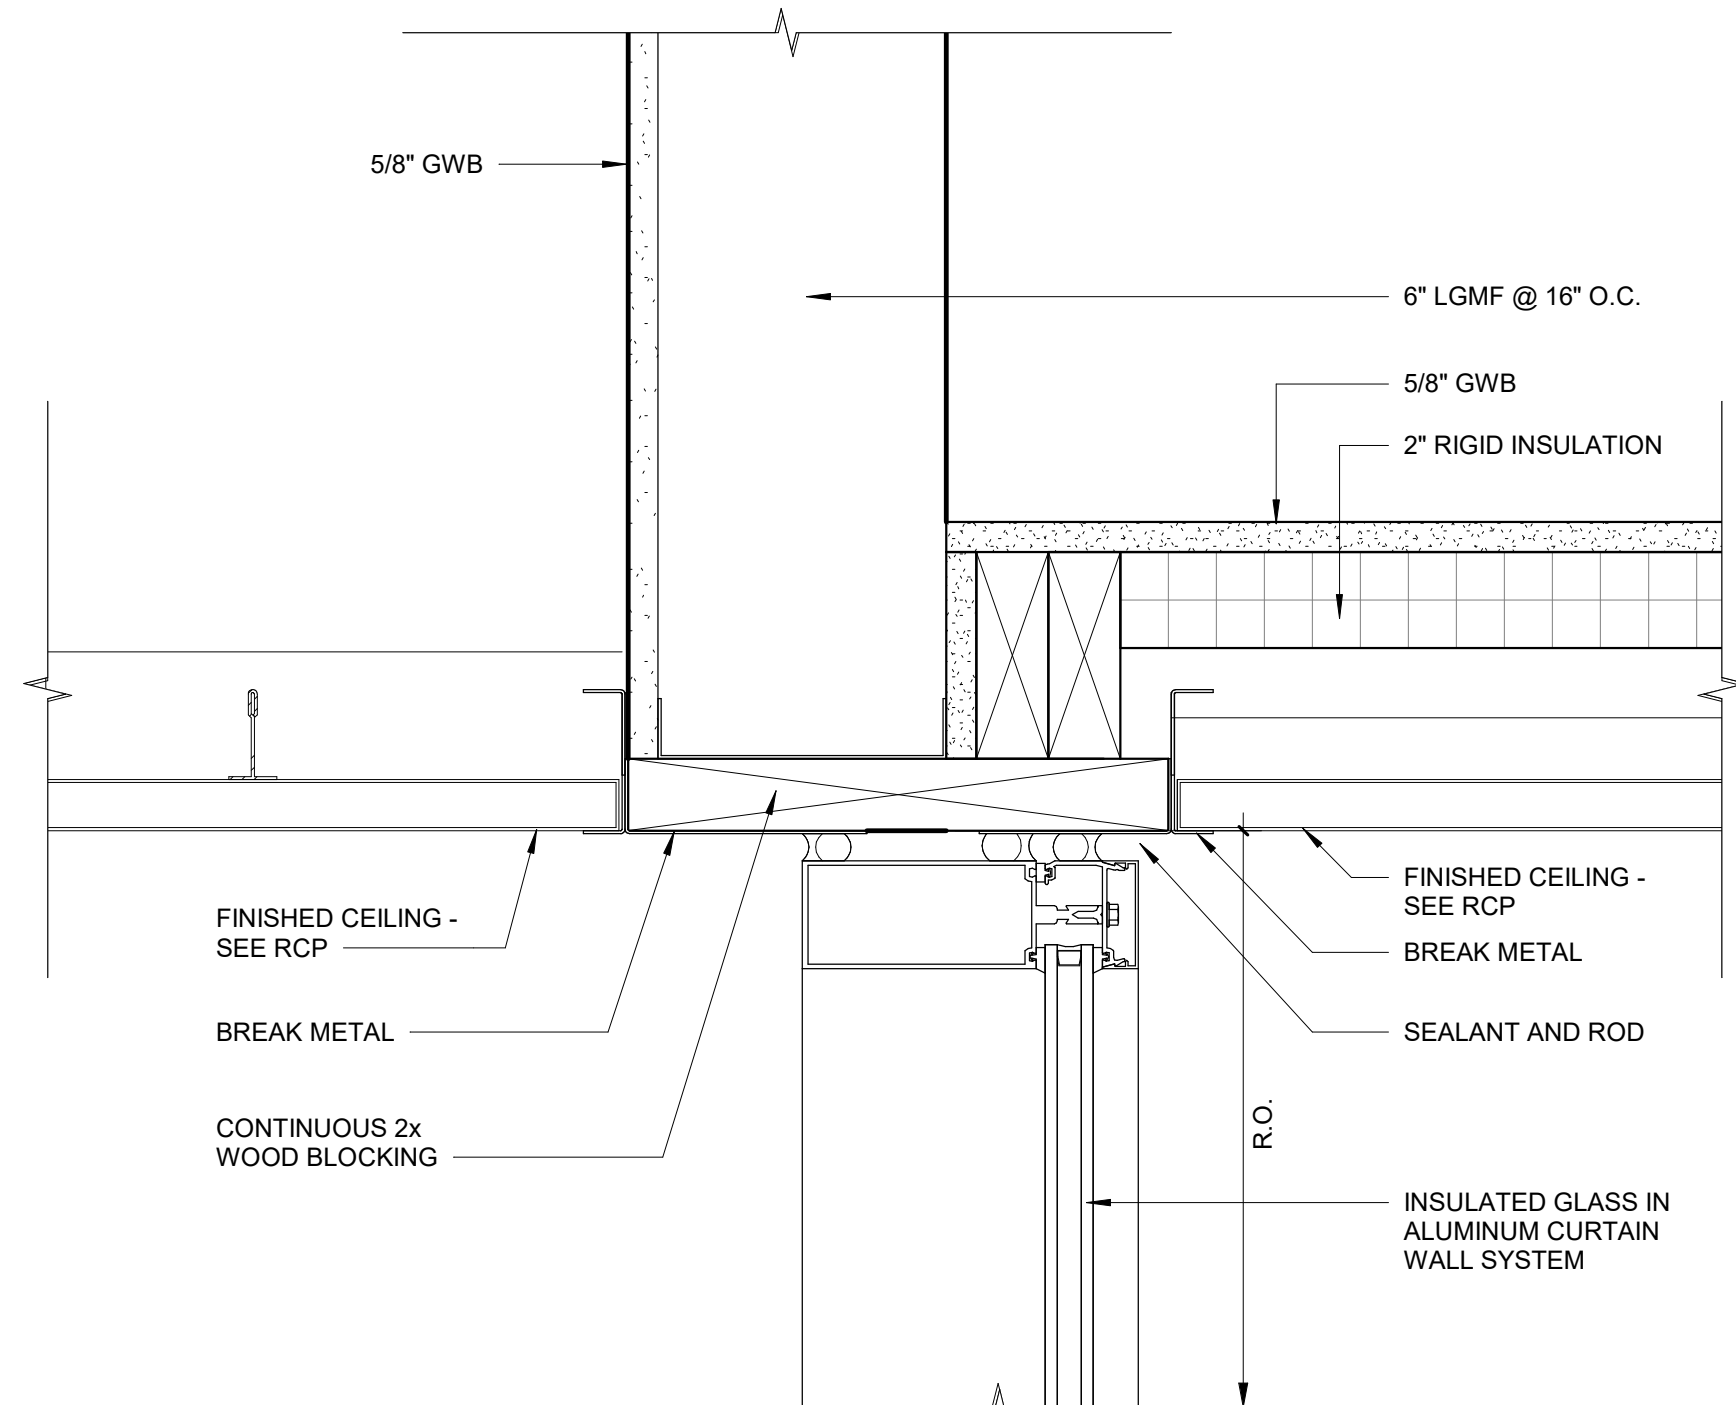


12 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

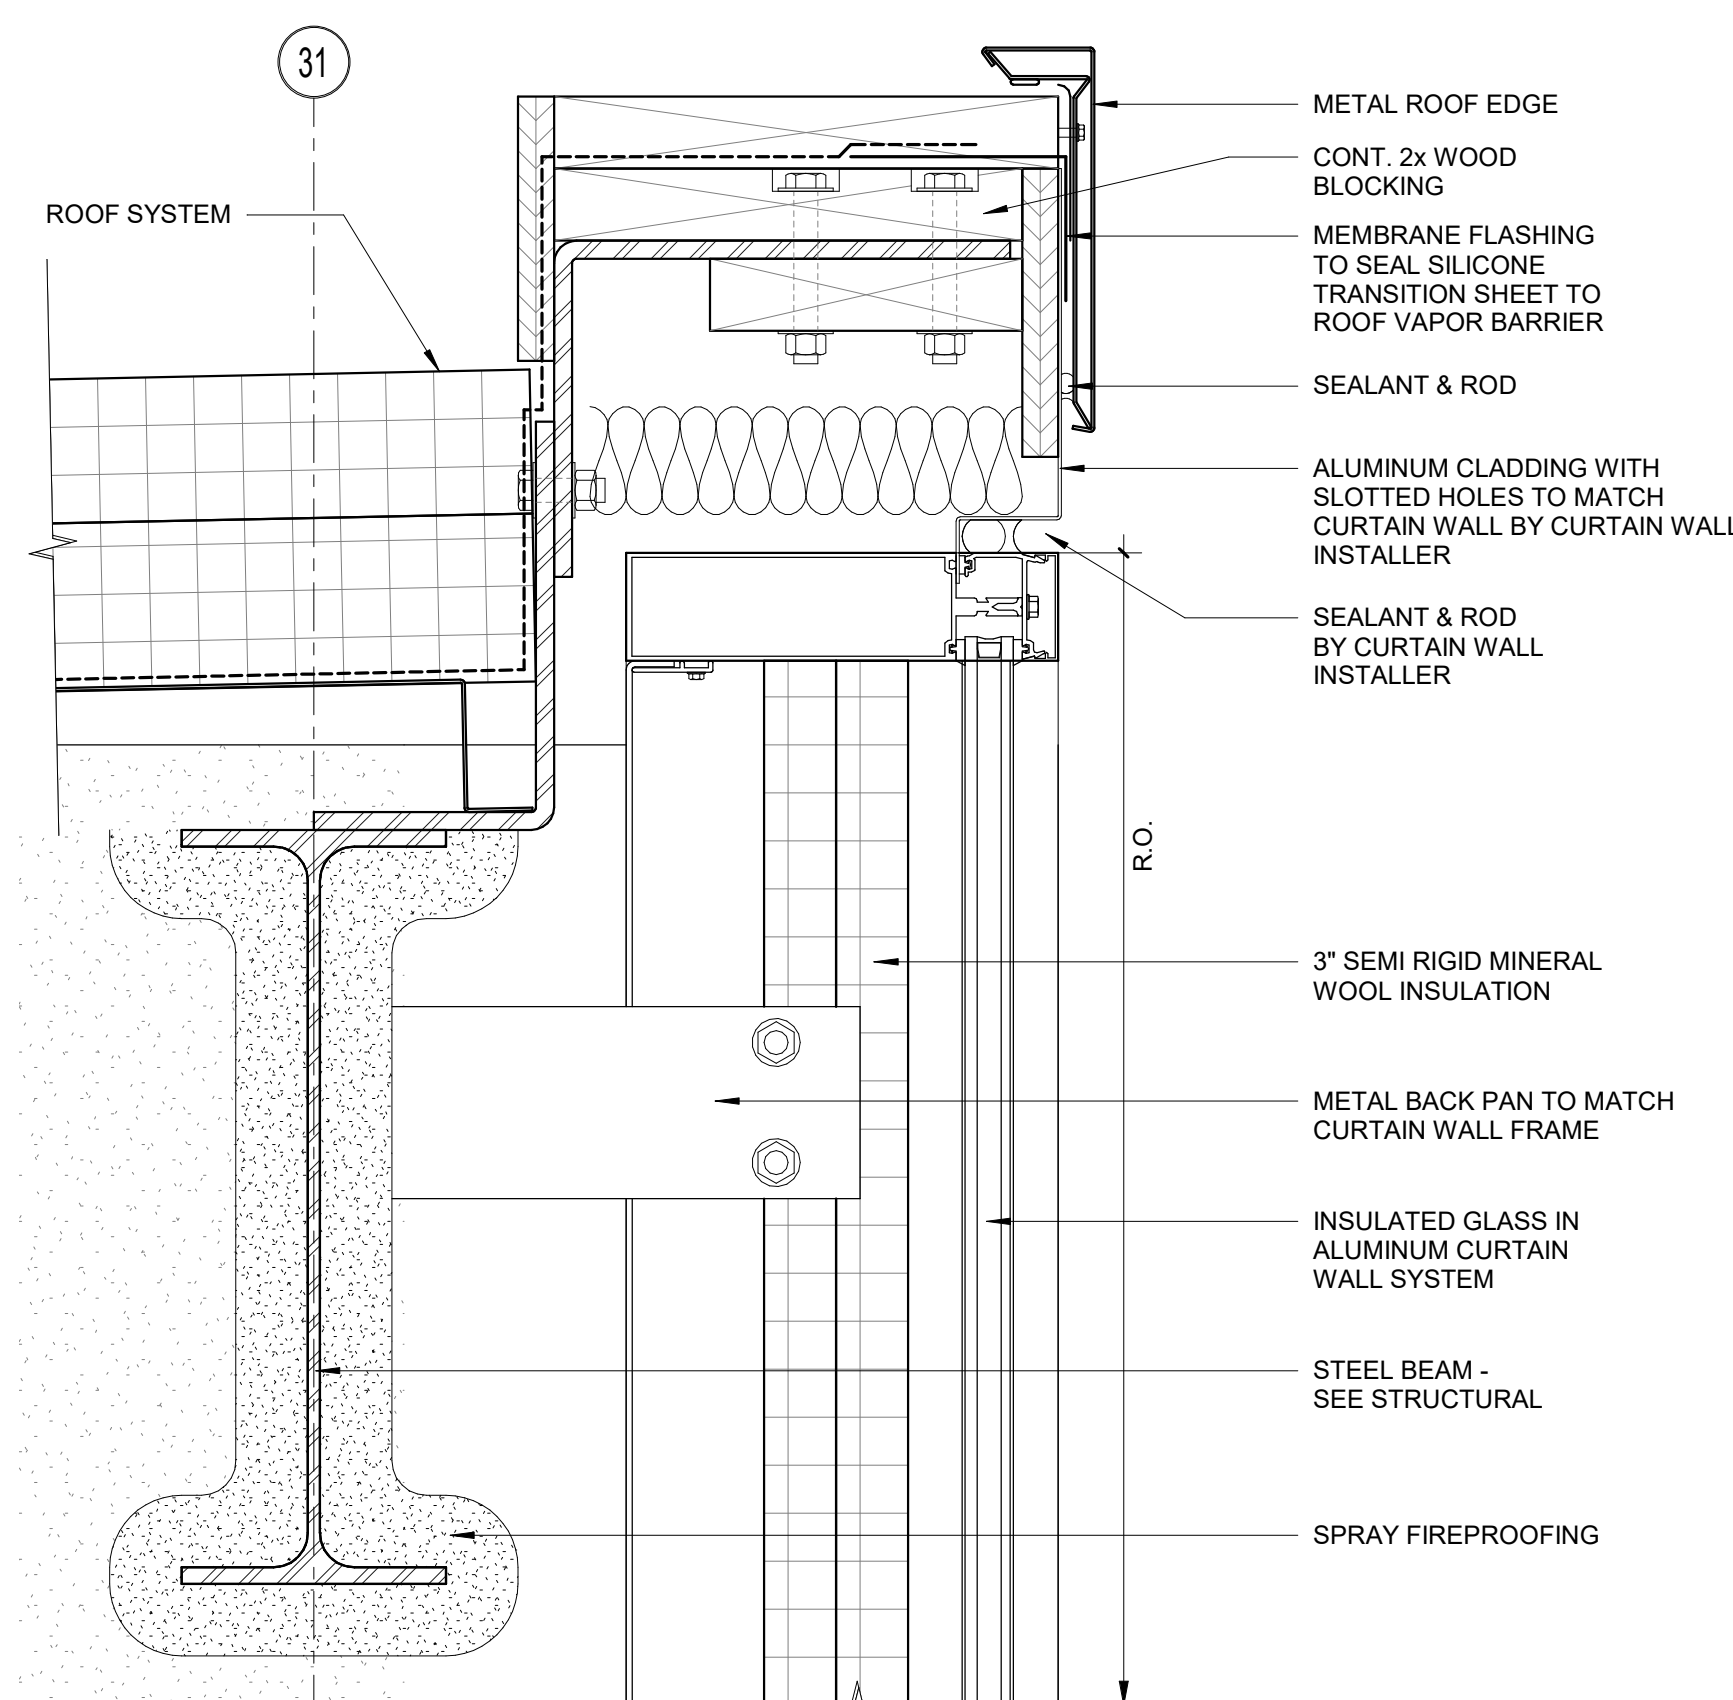


11 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

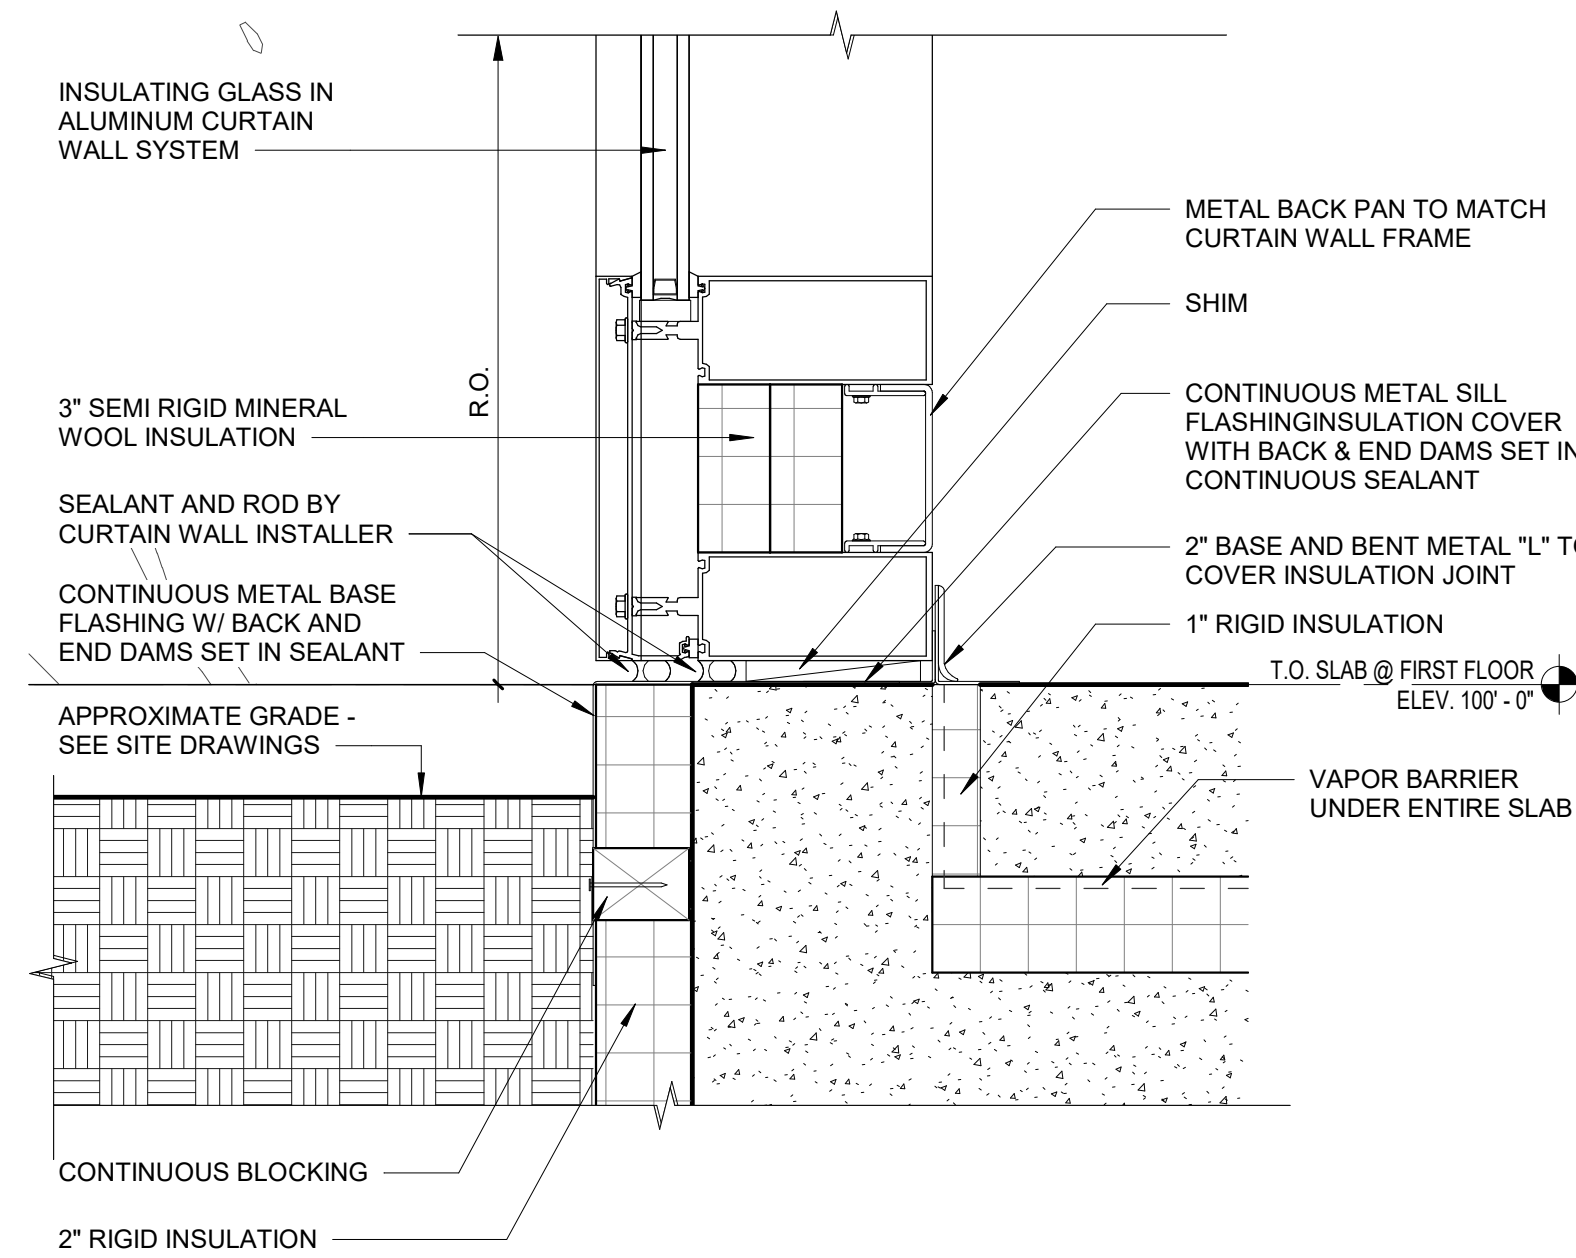


9 CURTAIN WALL SILL DETAIL
3" = 1'-0"

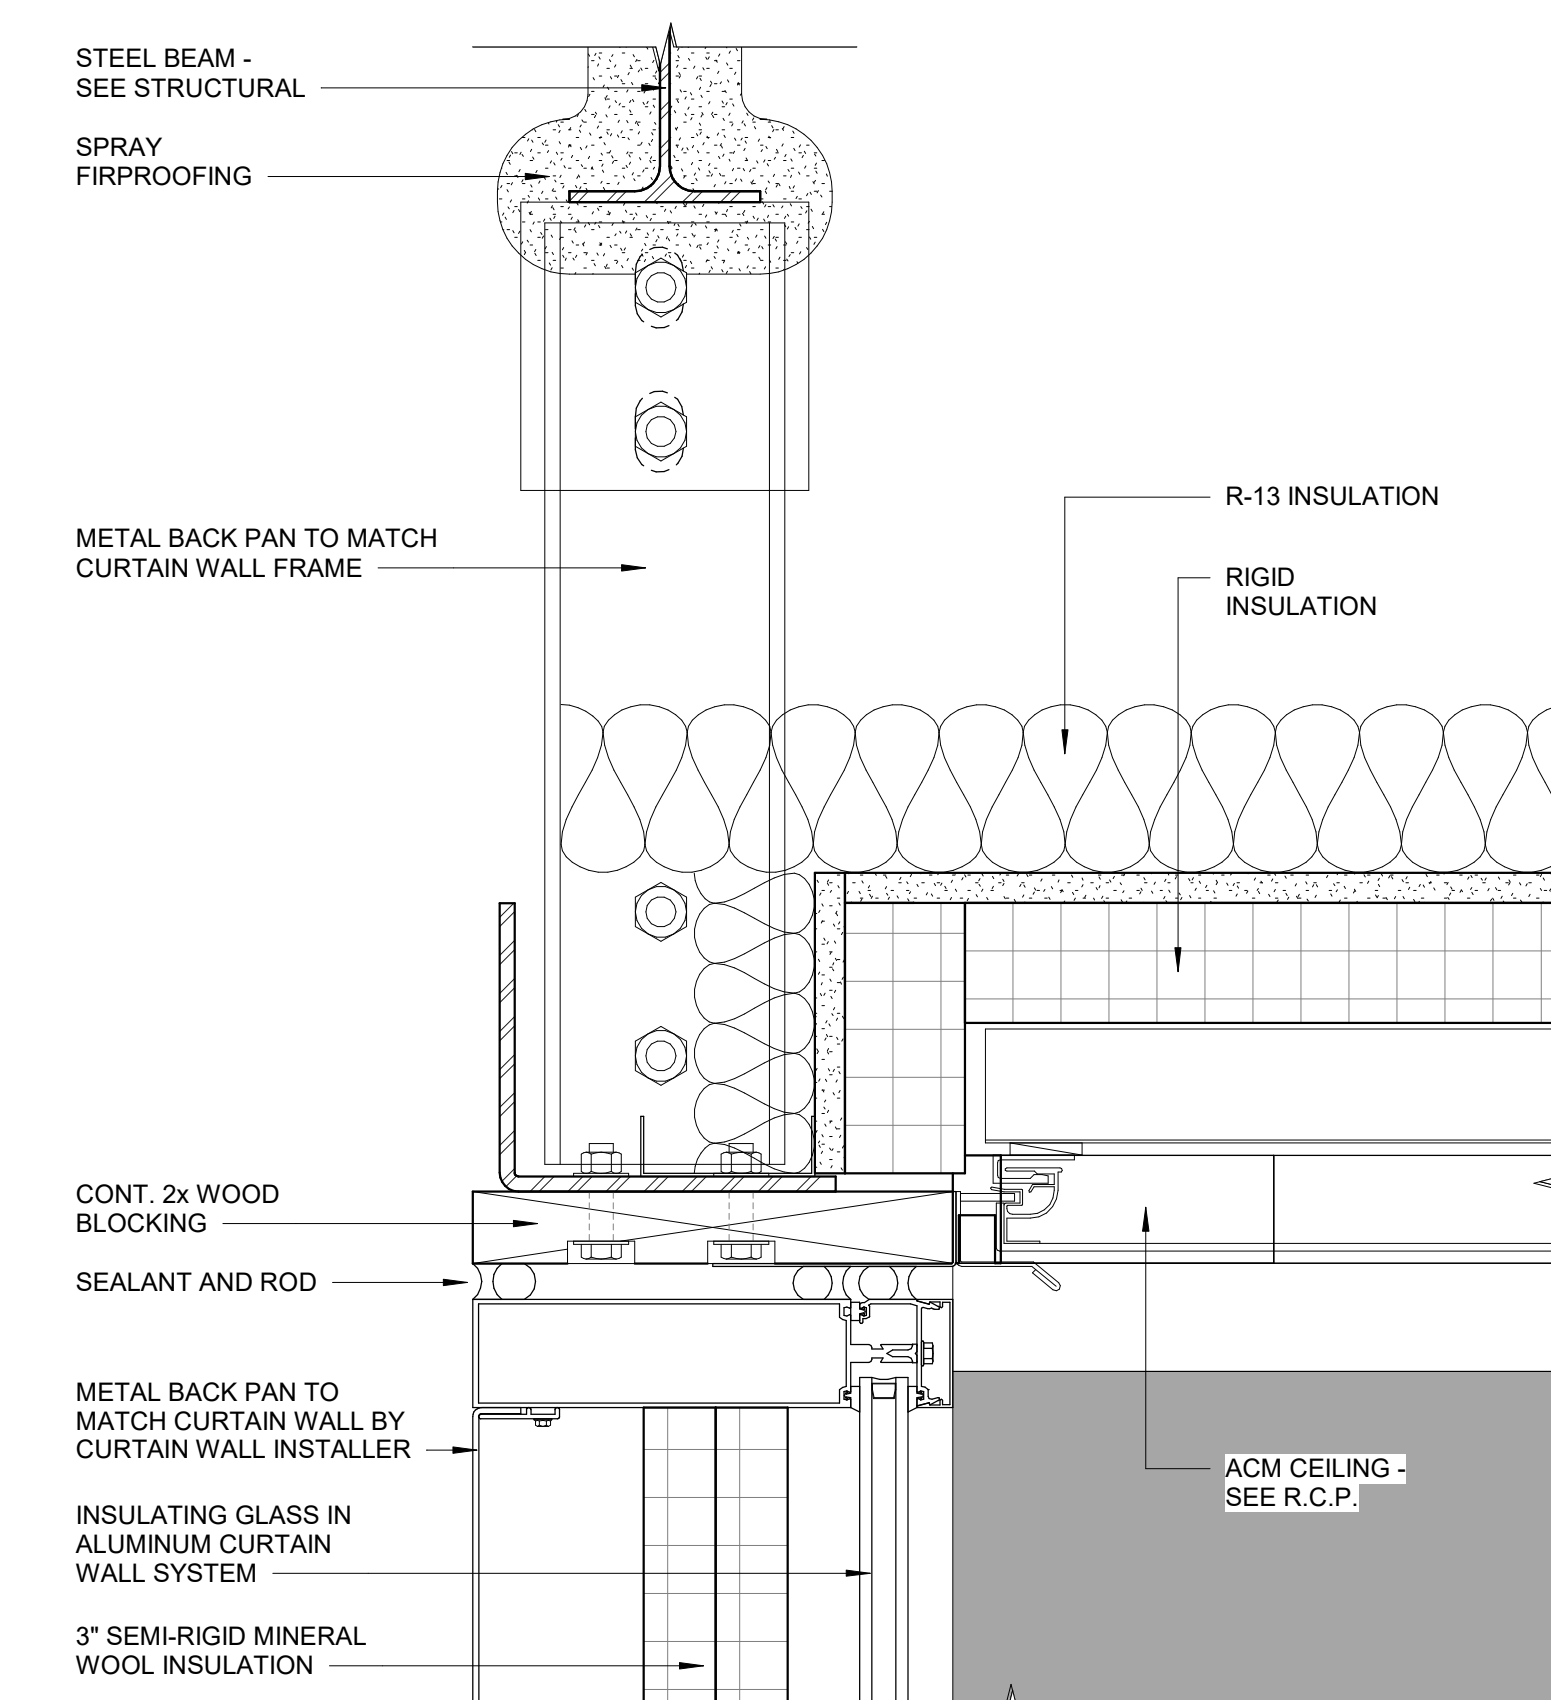


8 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

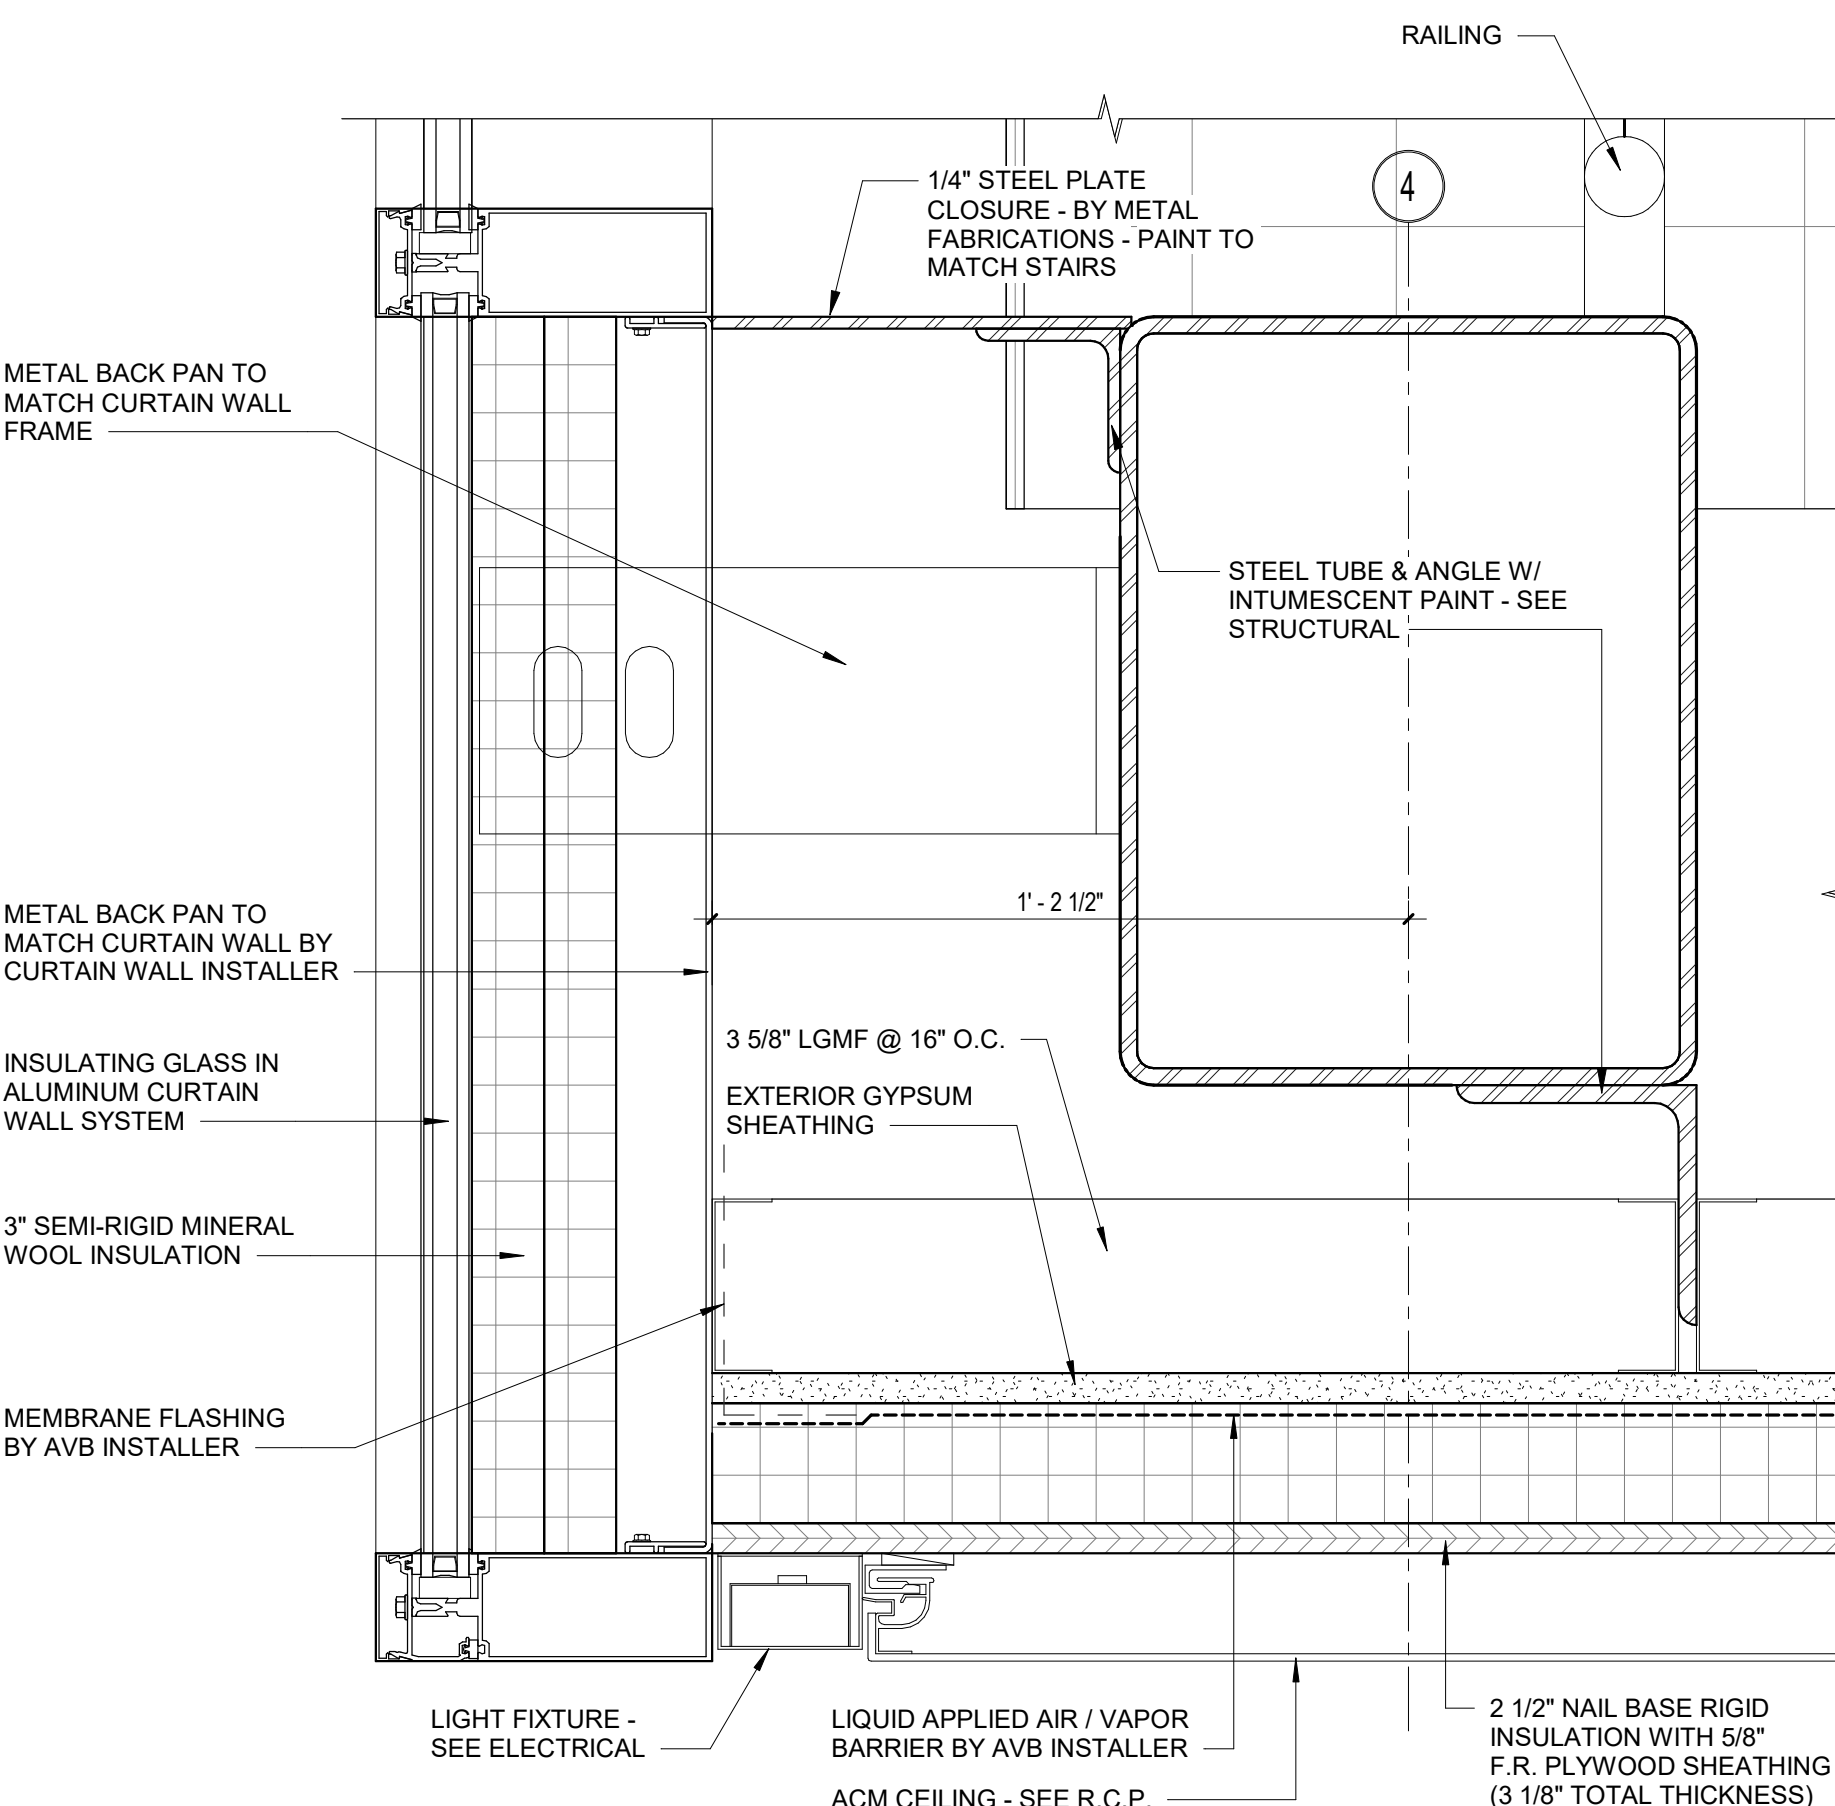


7 CURTAIN WALL SILL DETAIL
3" = 1'-0"

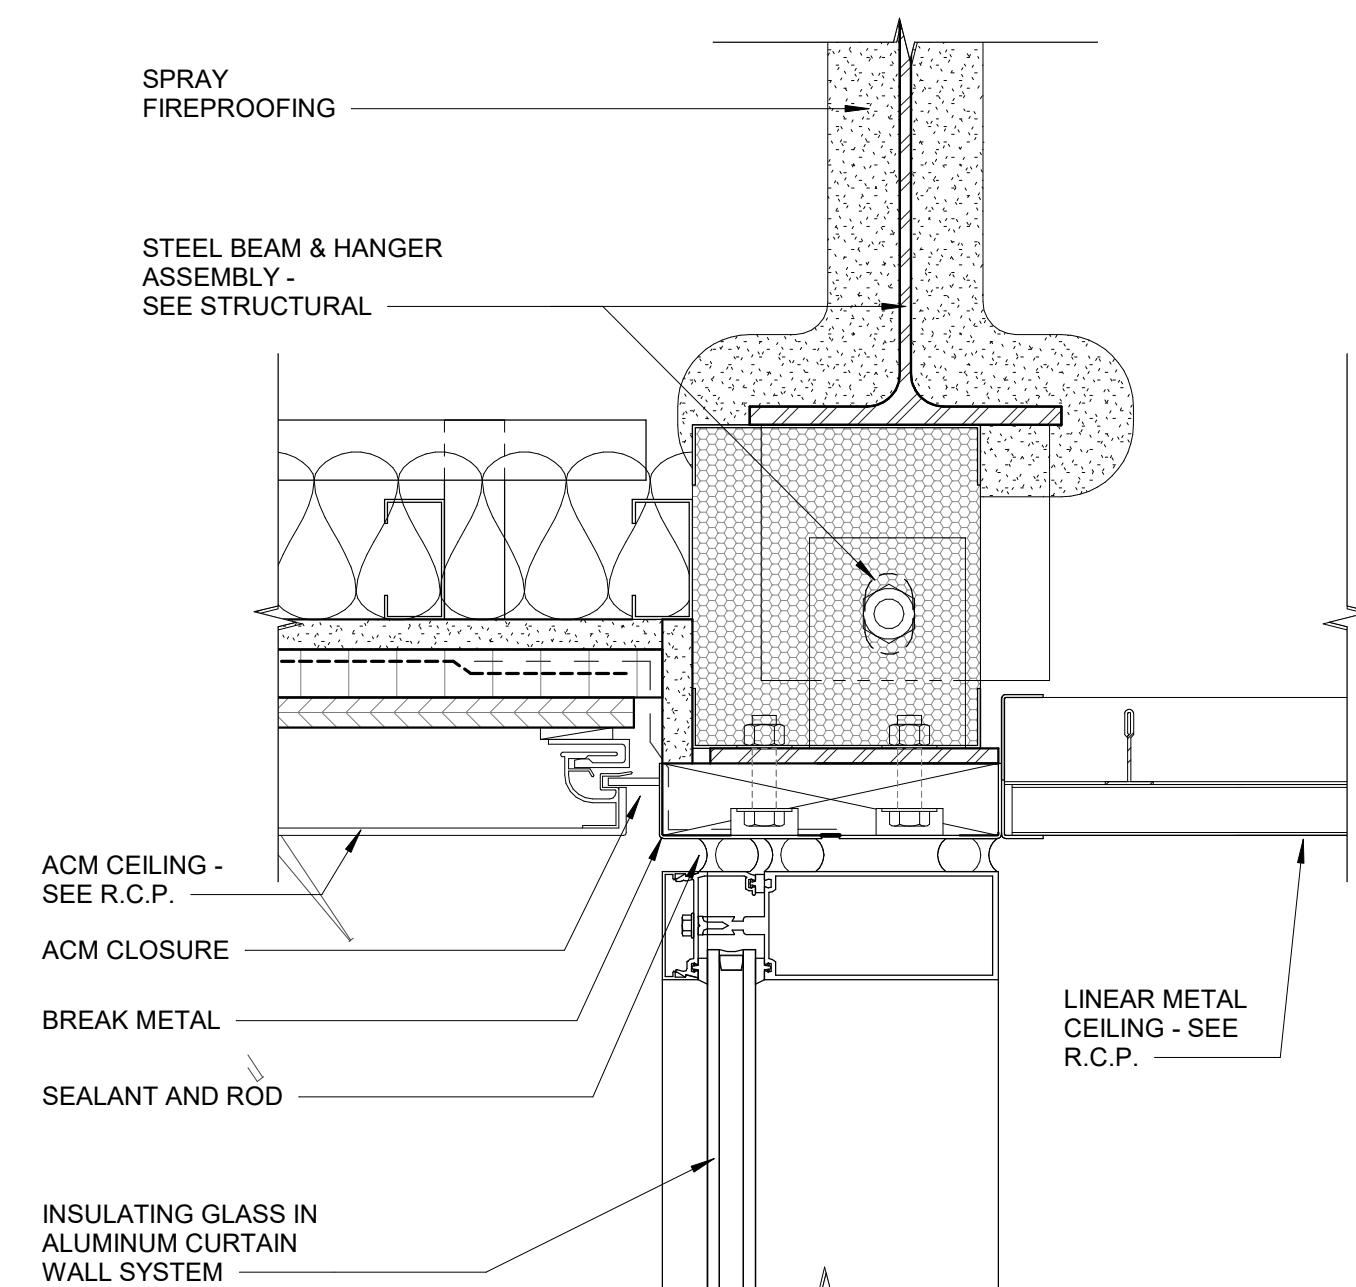


10 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

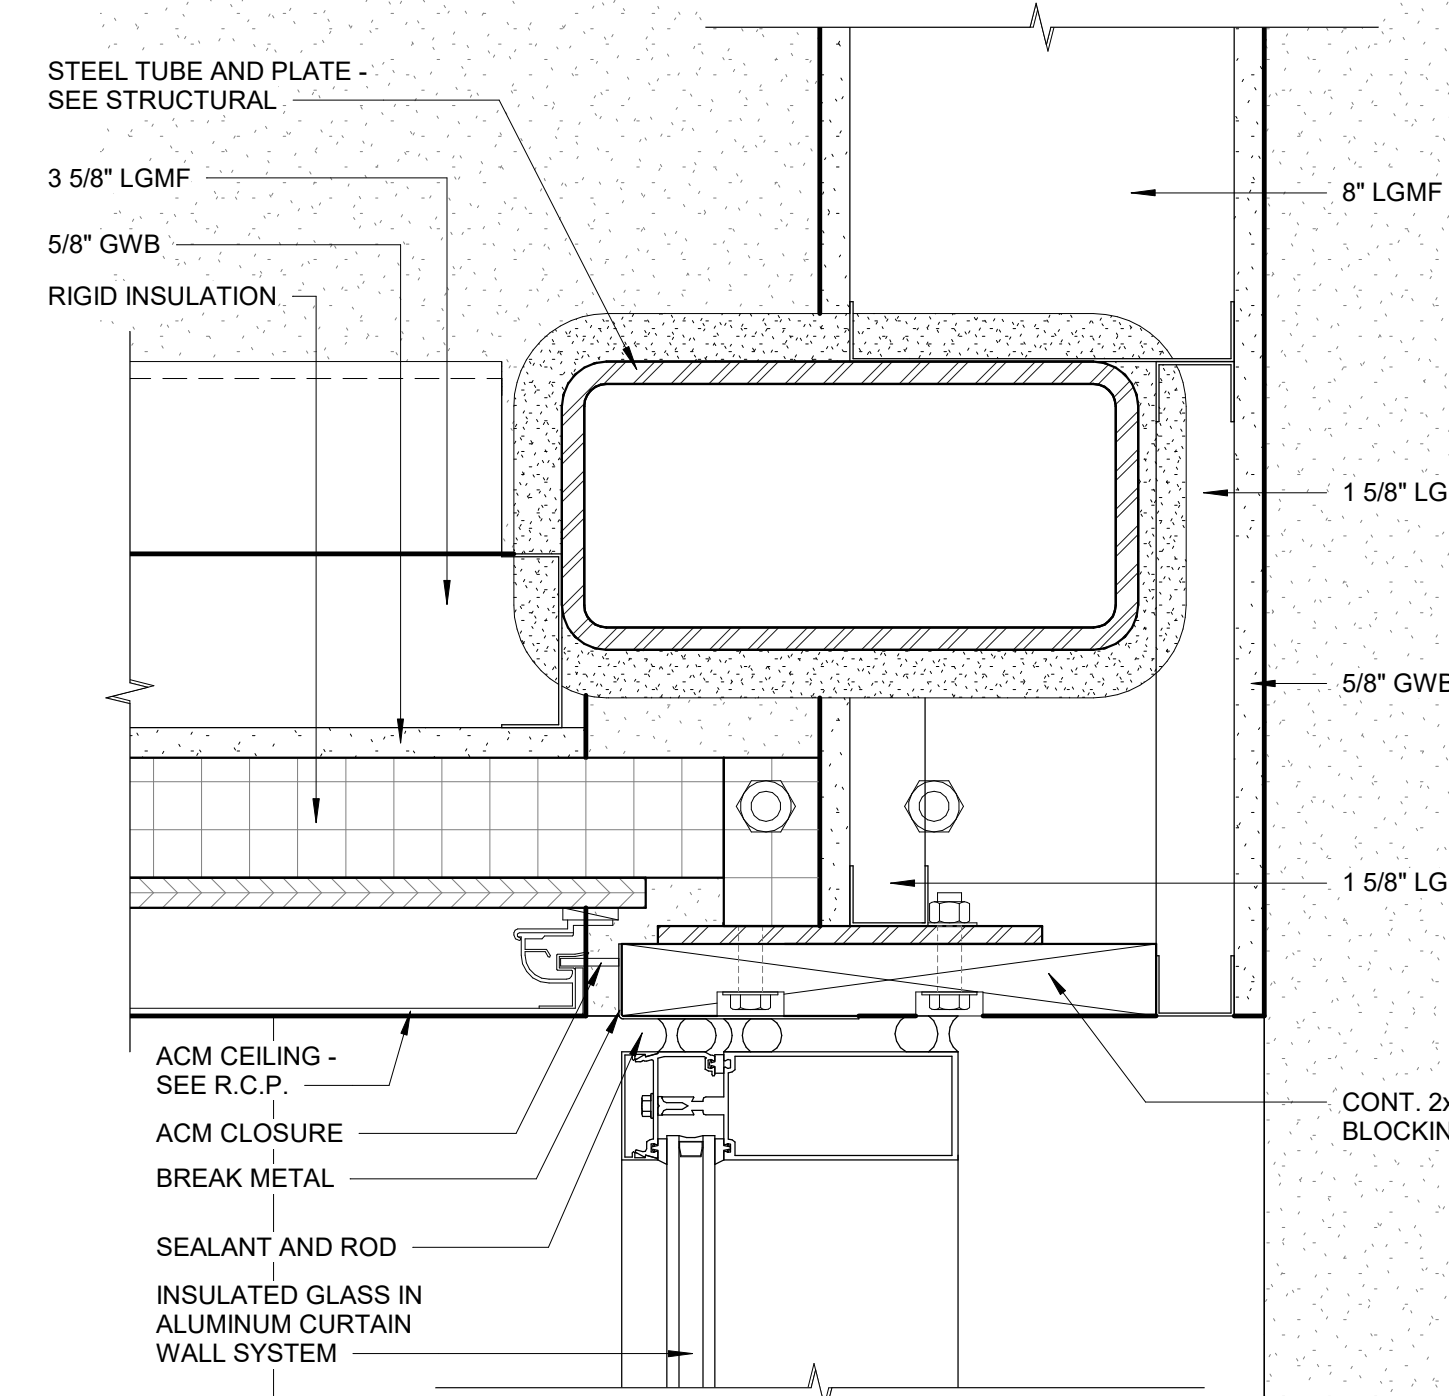


6 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

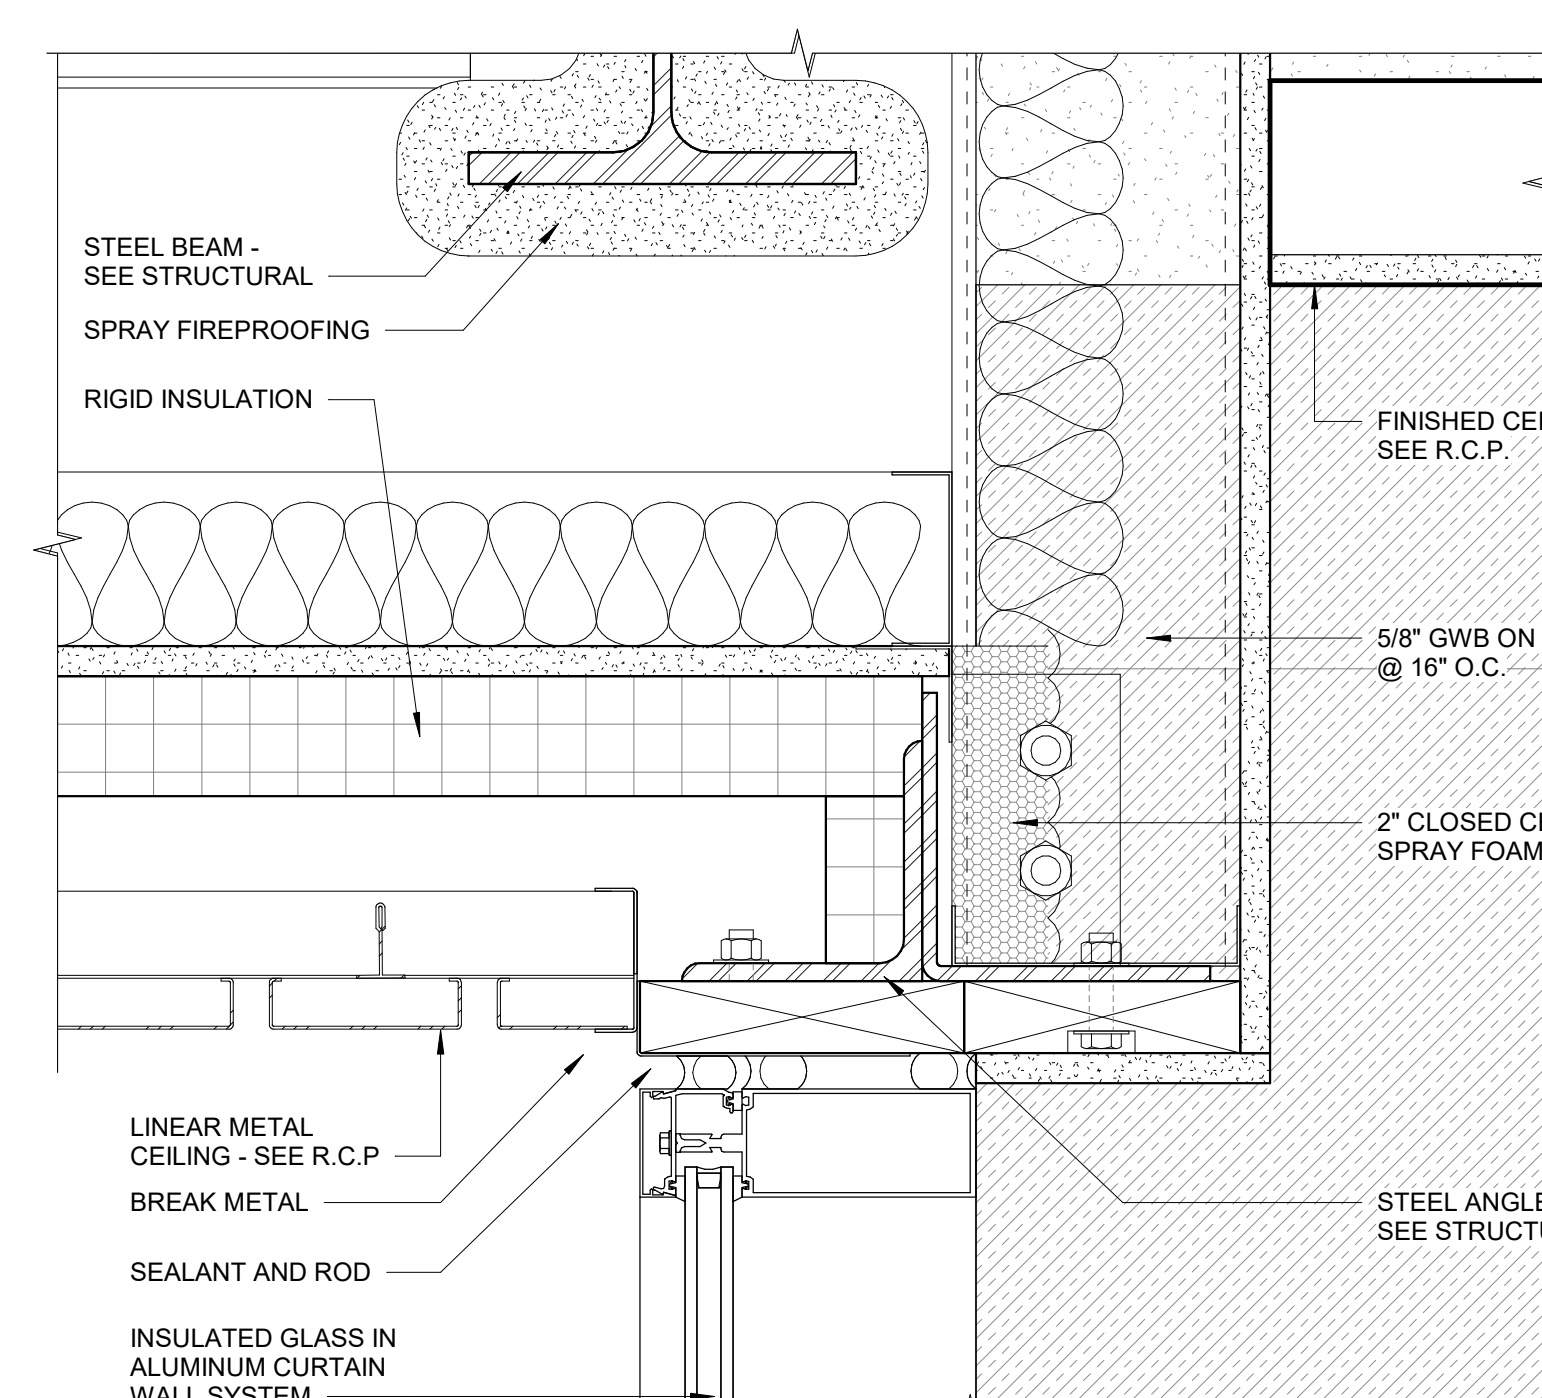


5 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

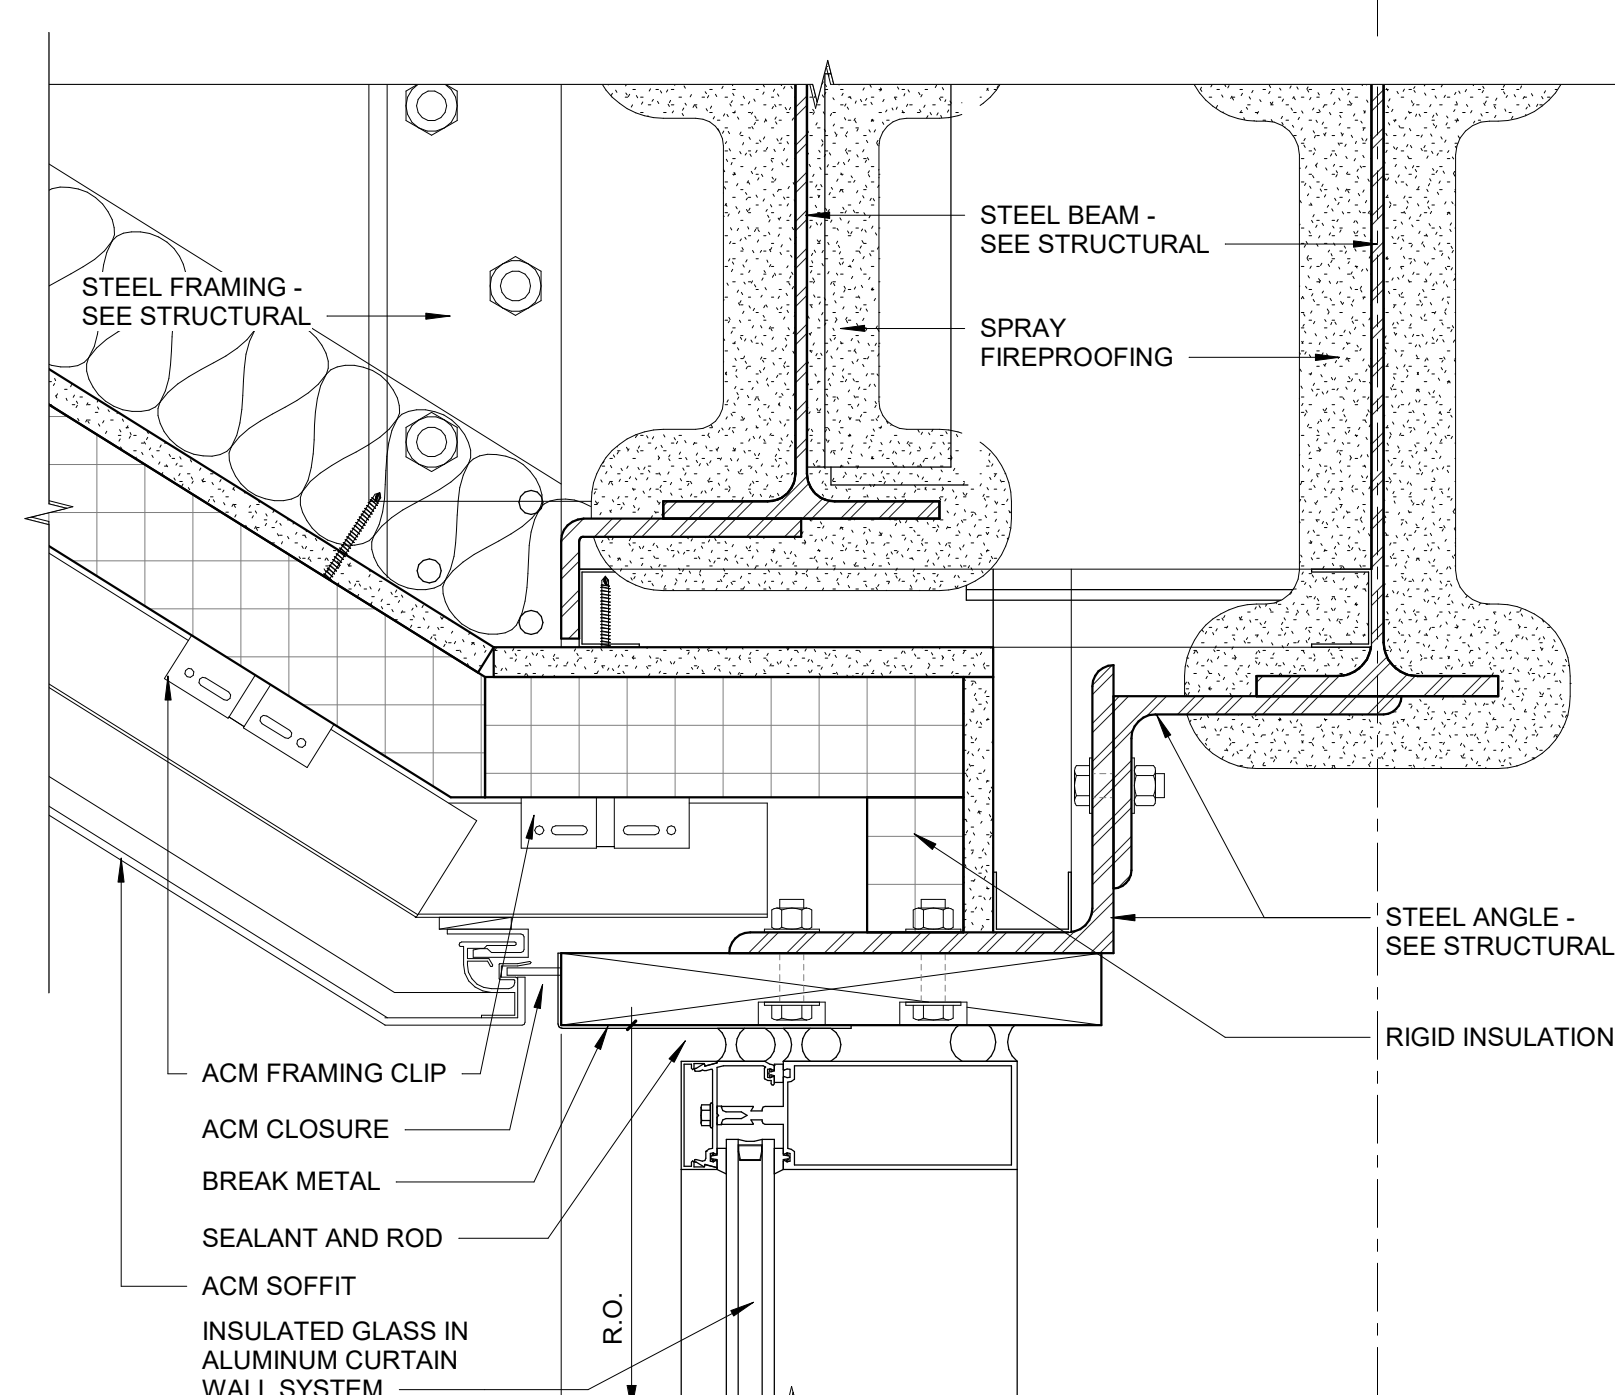


4 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

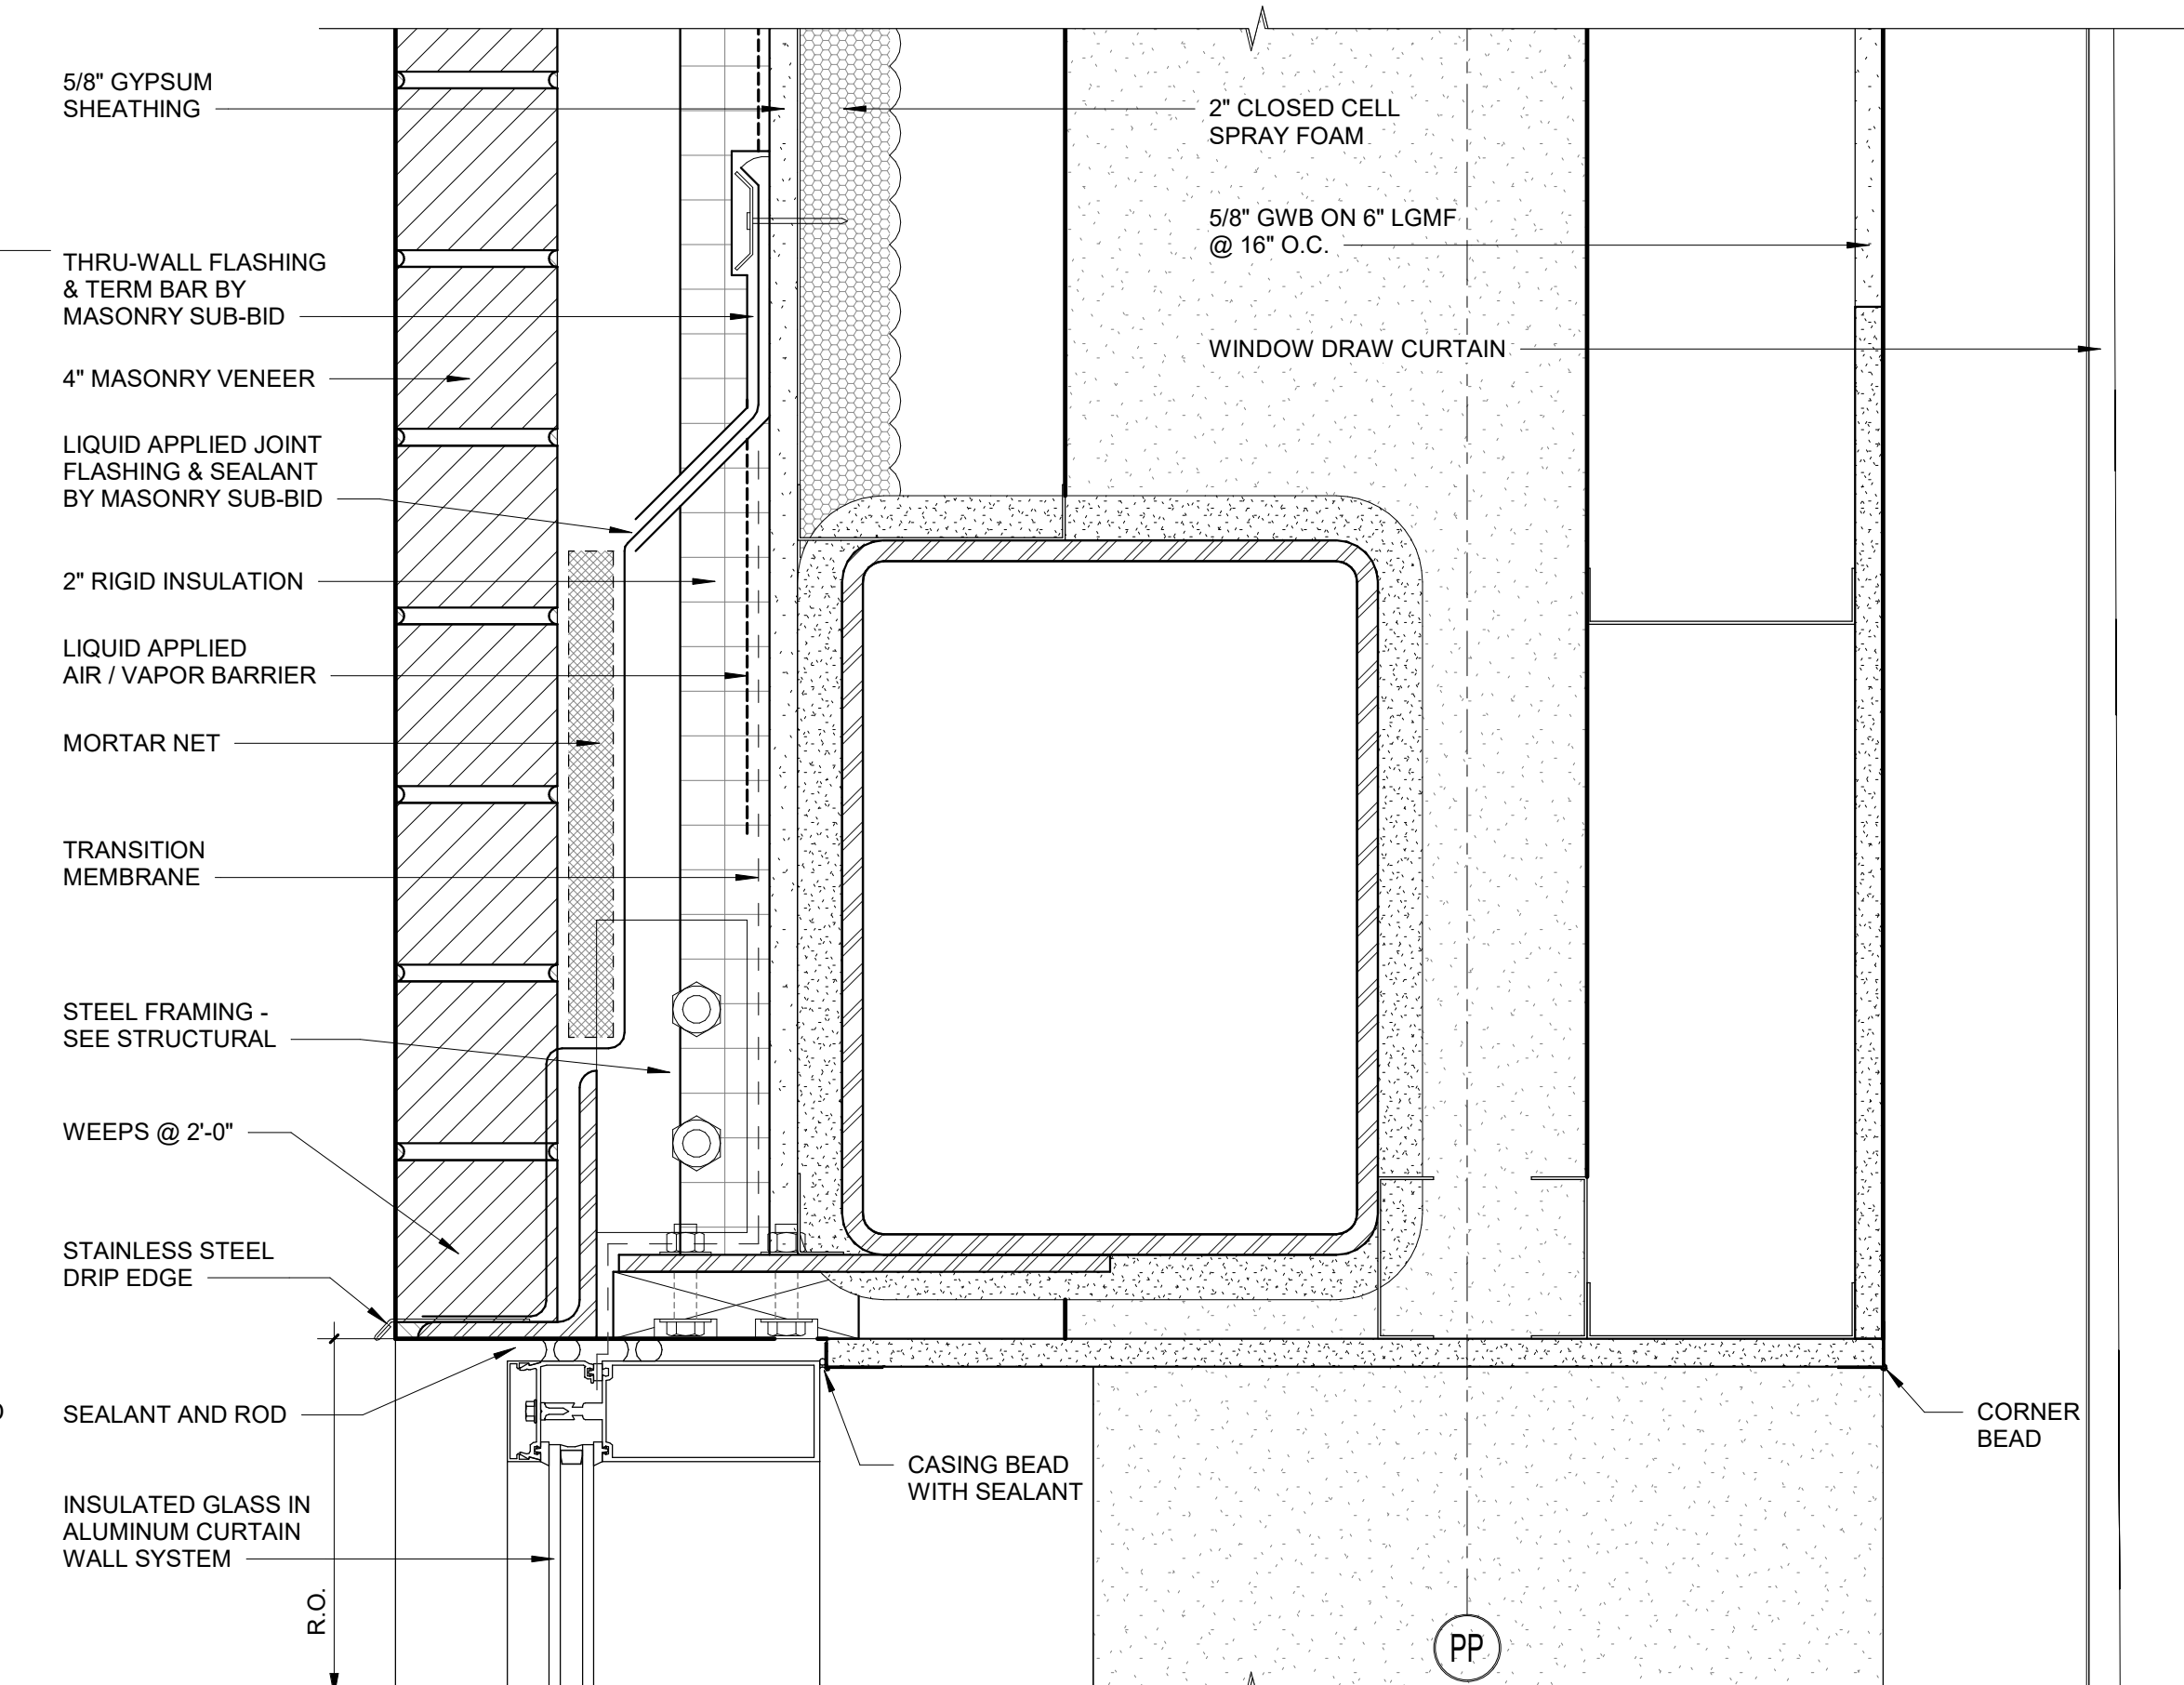

3 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

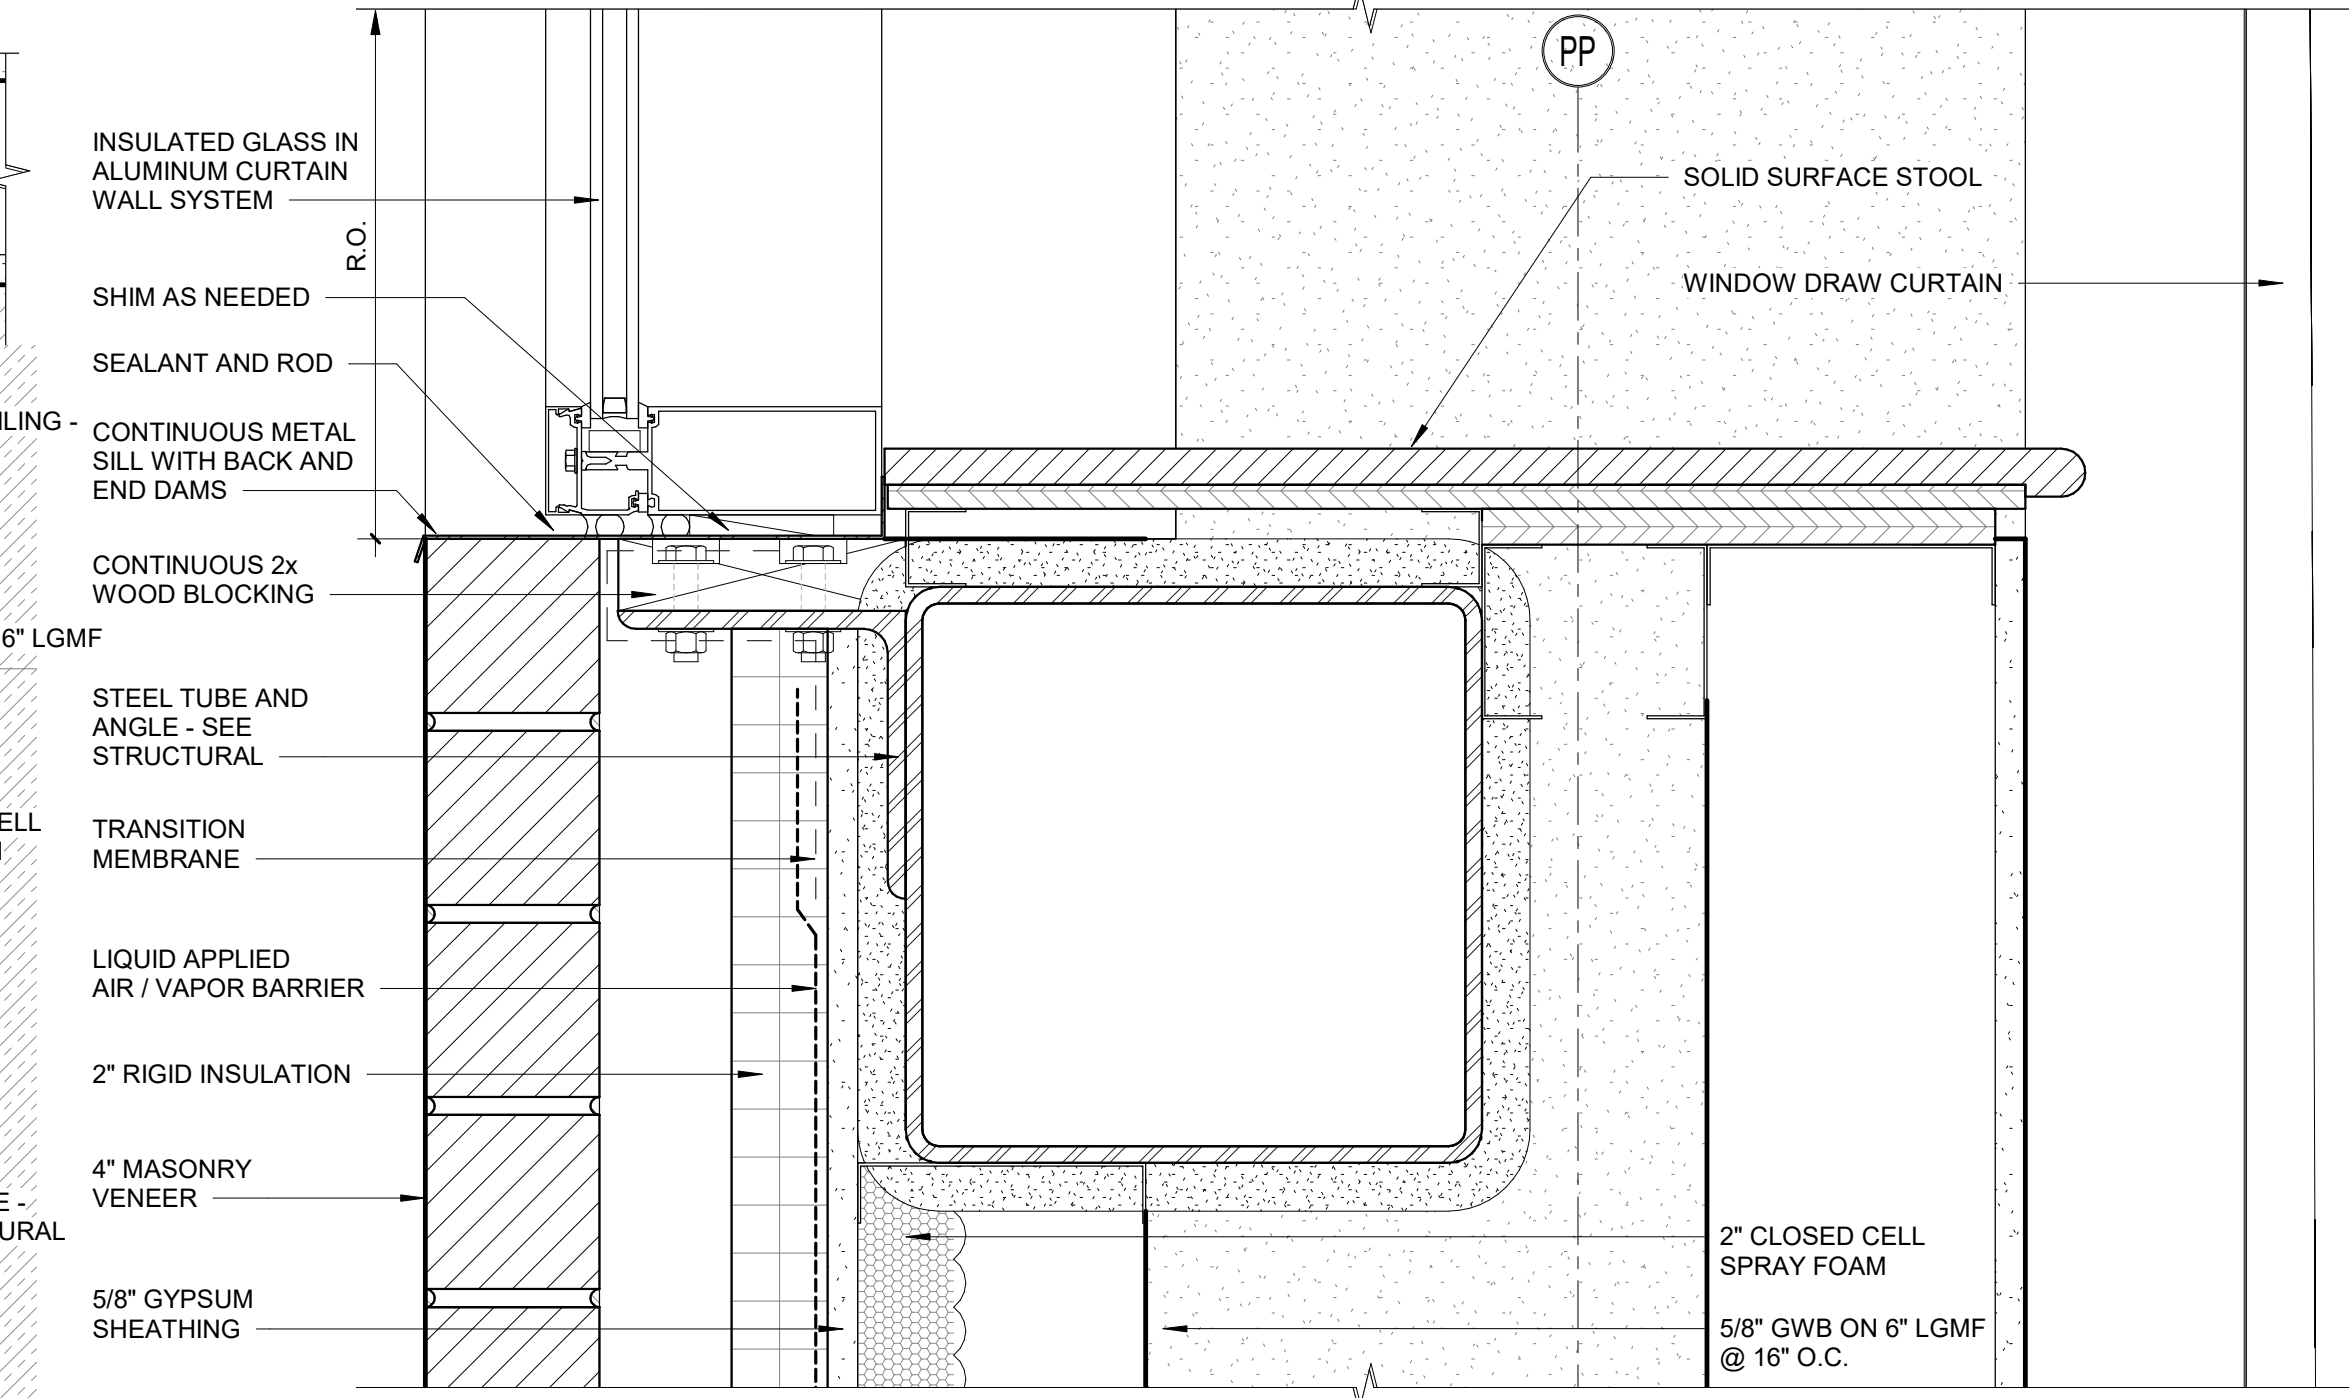

2 CURTAIN WALL SILL DETAIL
3" = 1'-0"

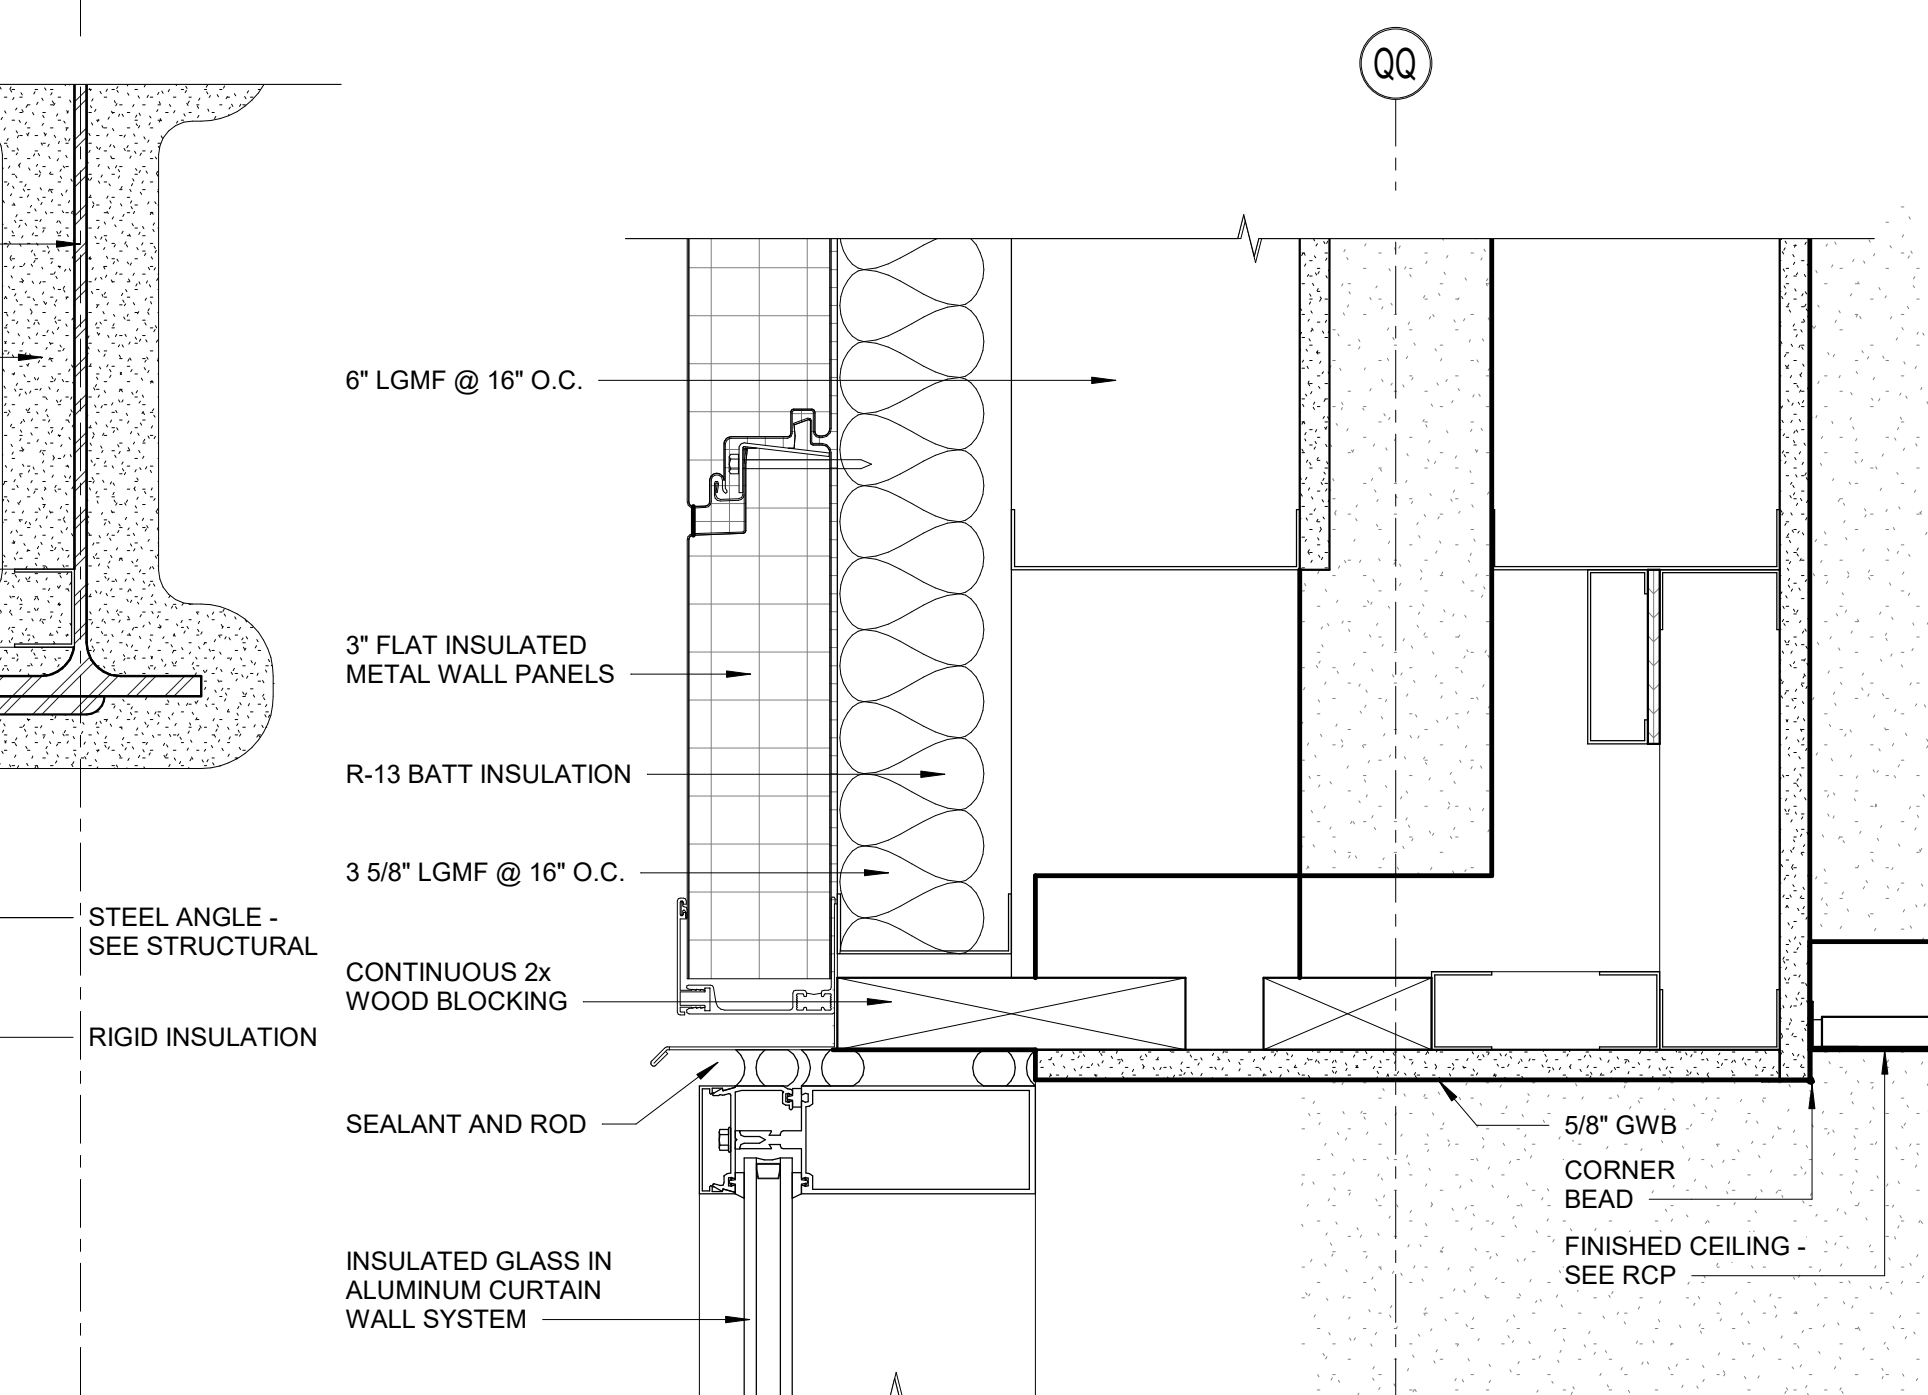


1 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

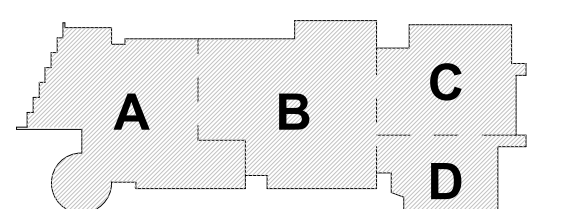

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

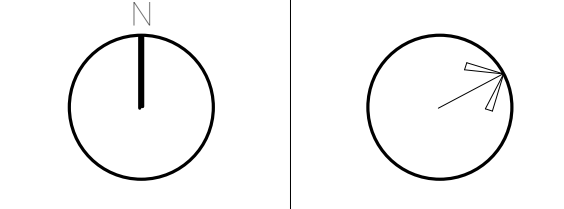

**CURTAIN WALL
DETAILS**

Scale: 3" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A6-3-11

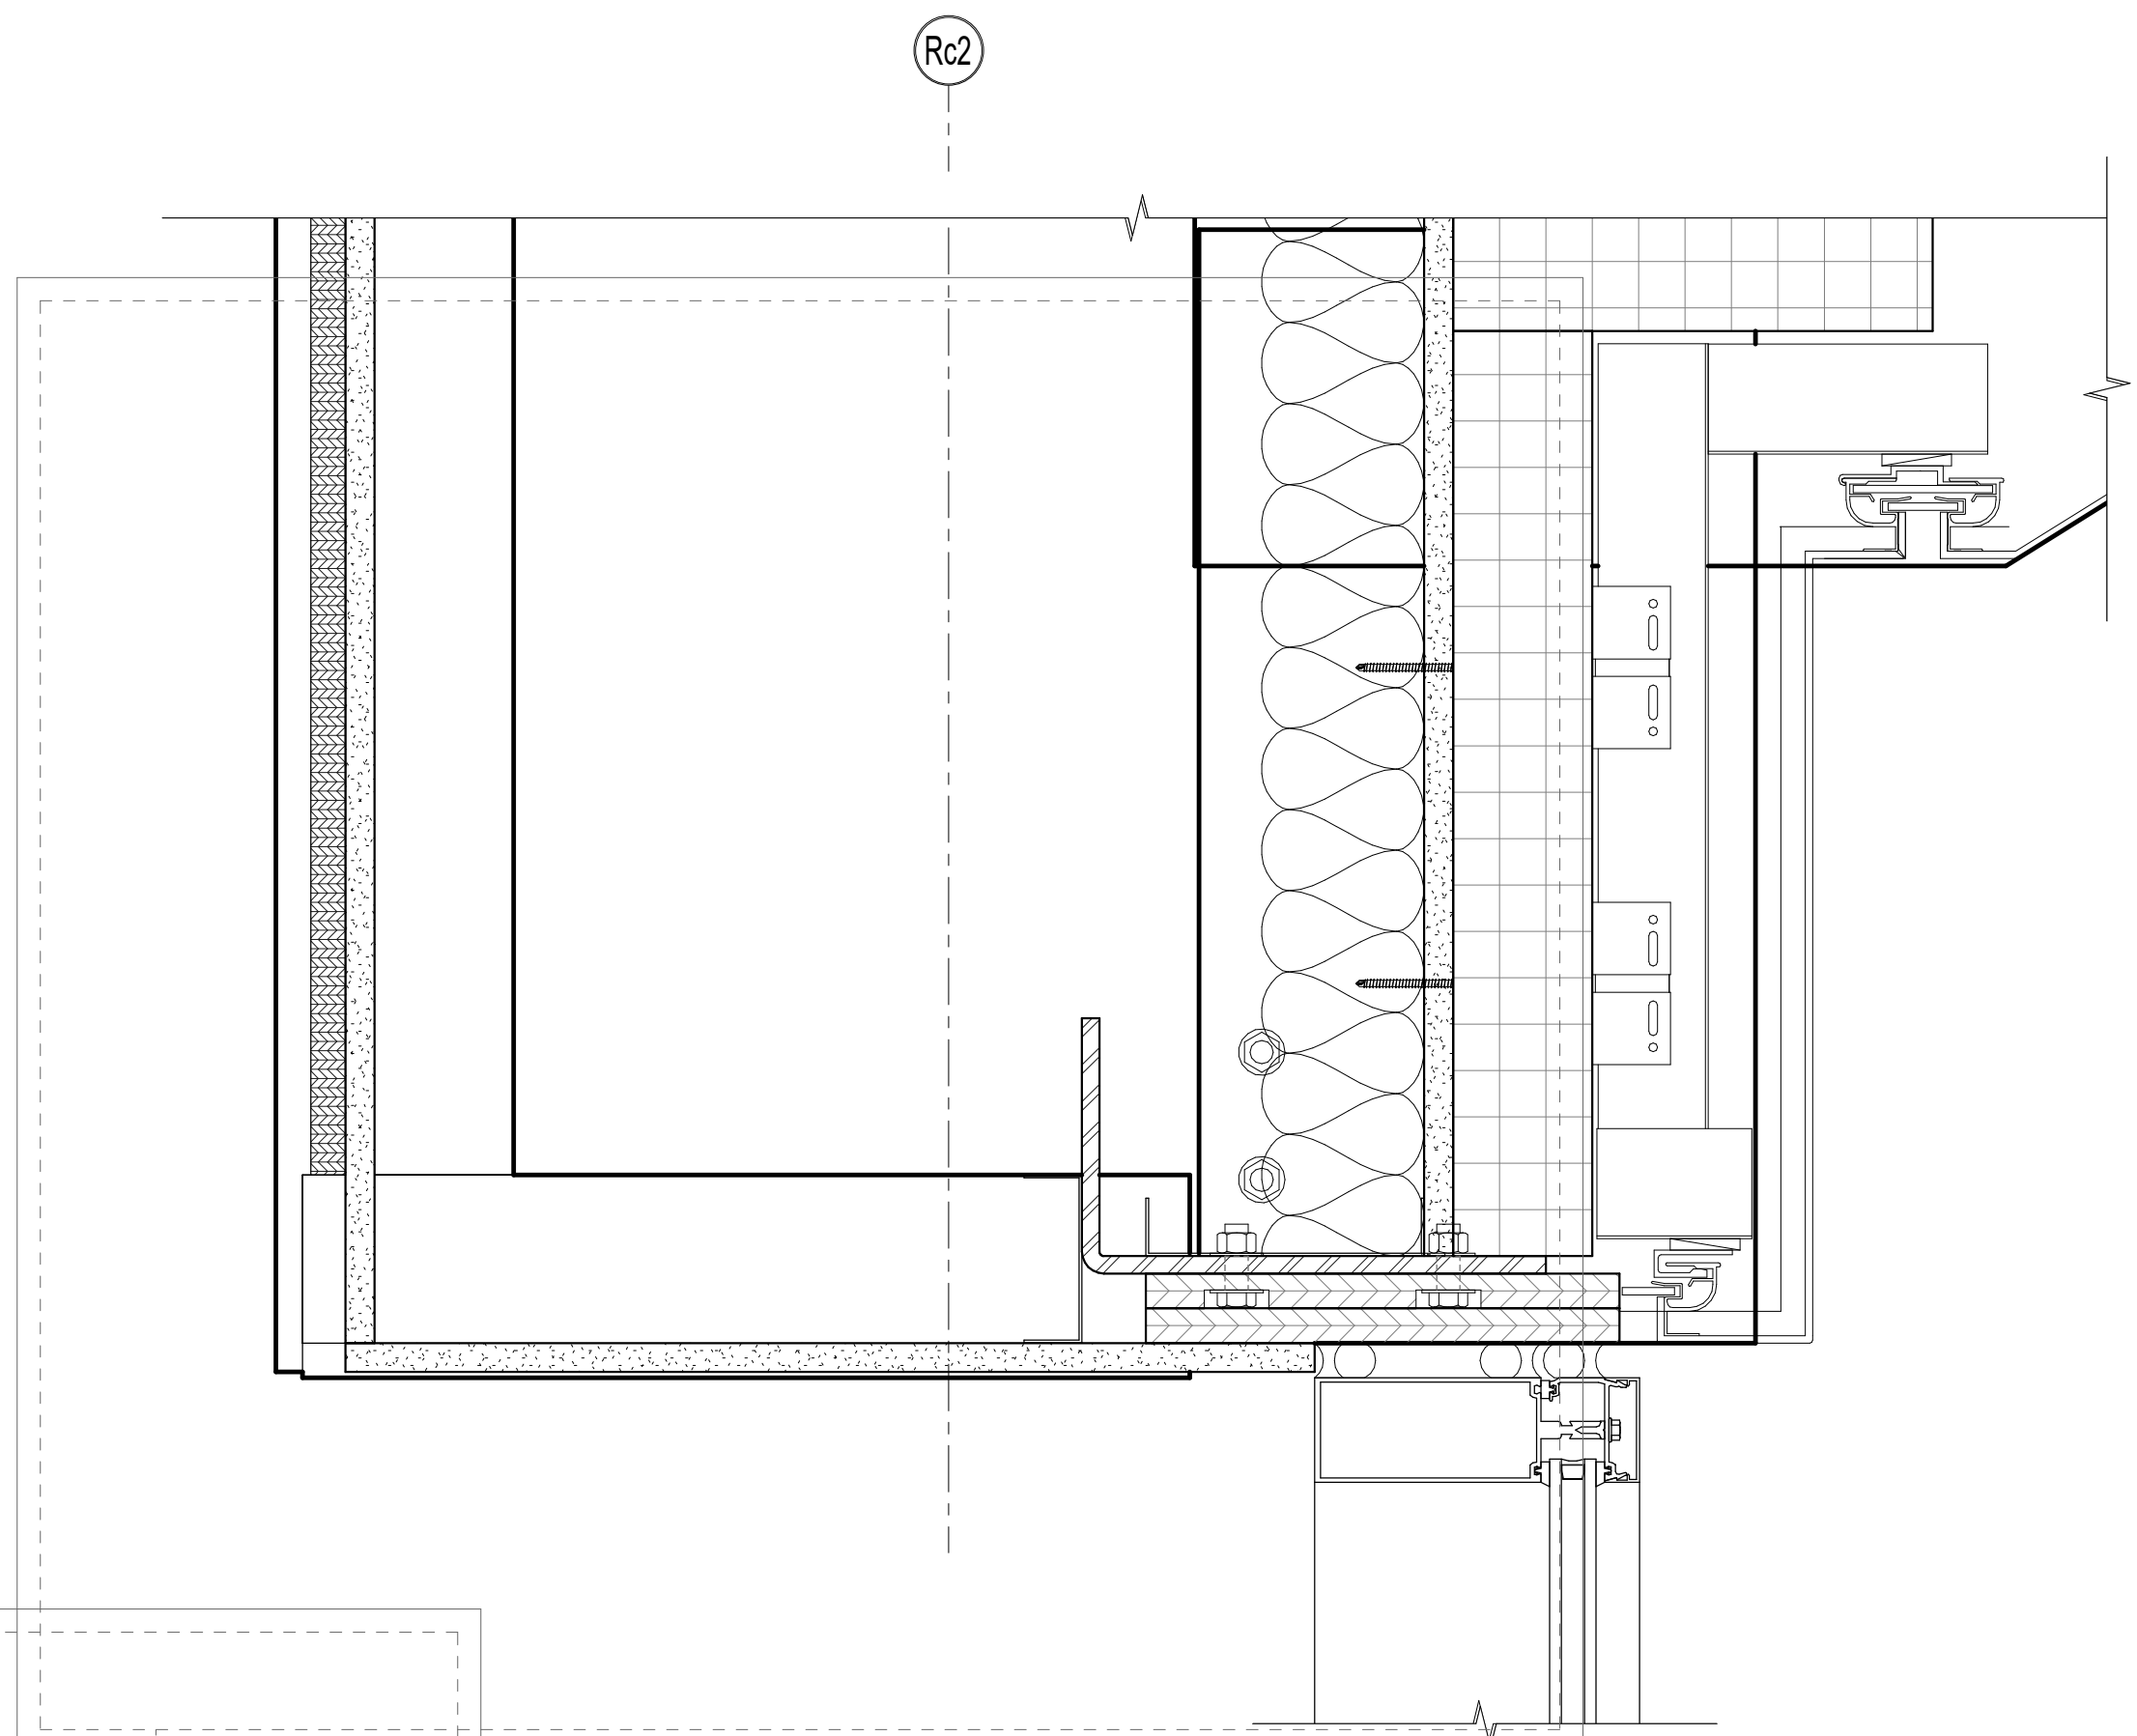


9 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

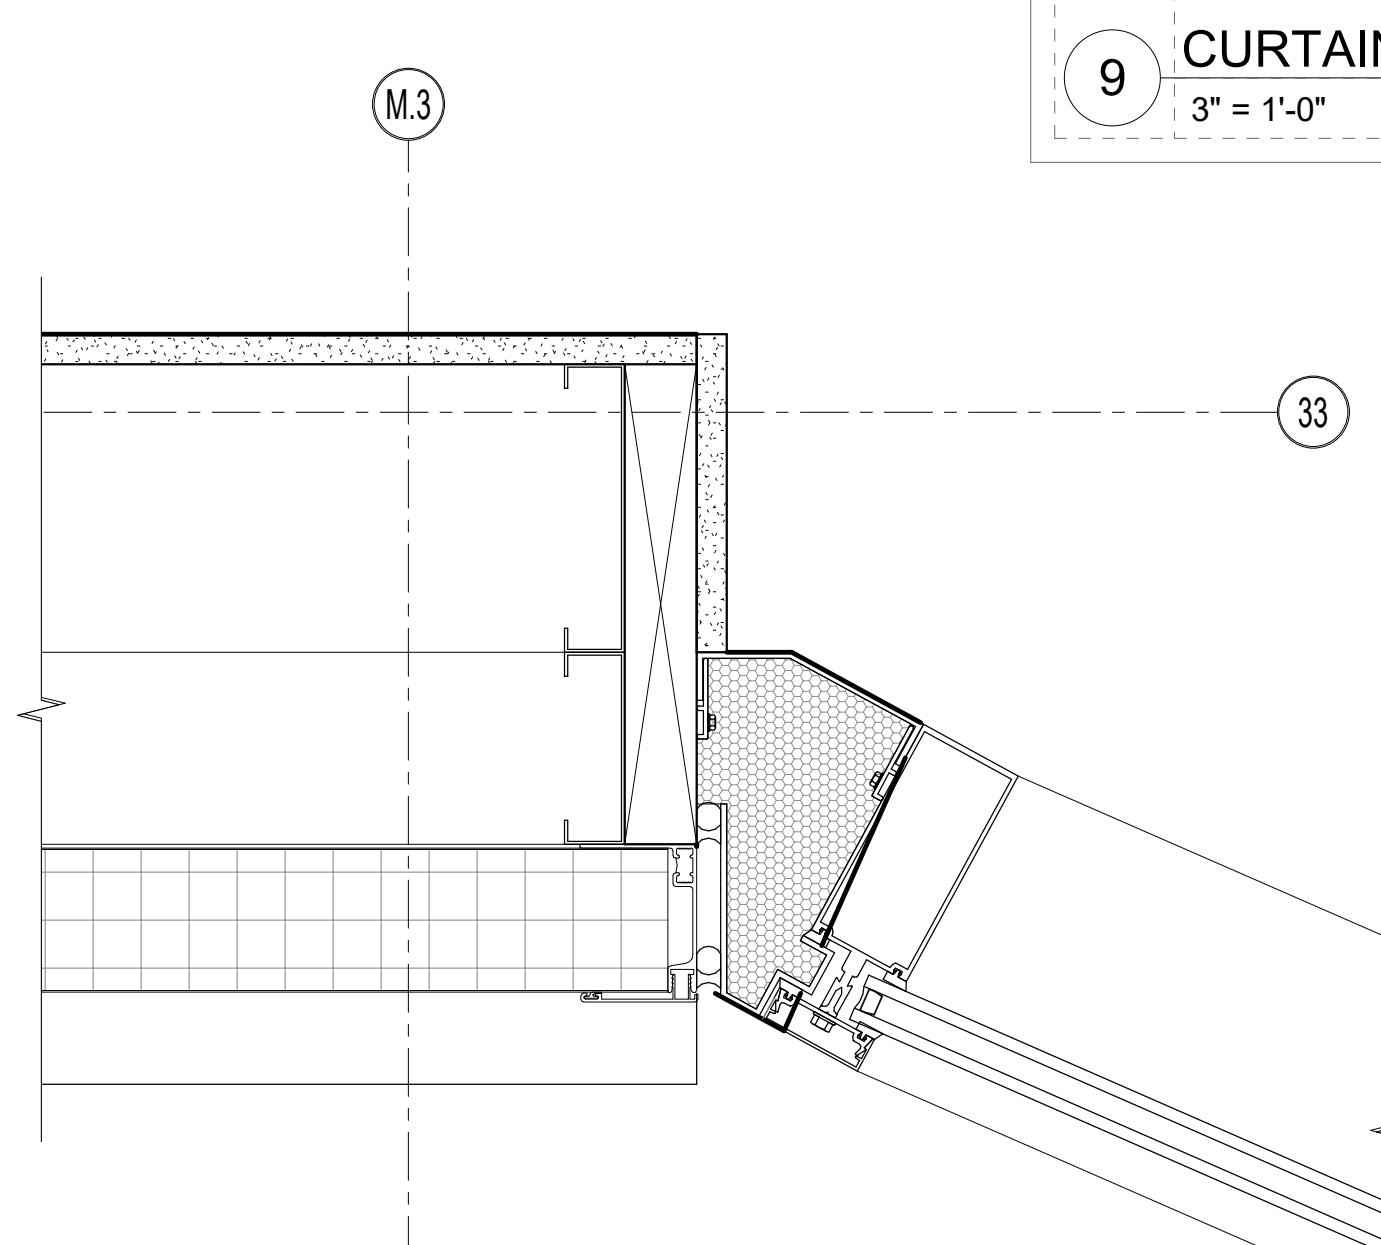


13 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

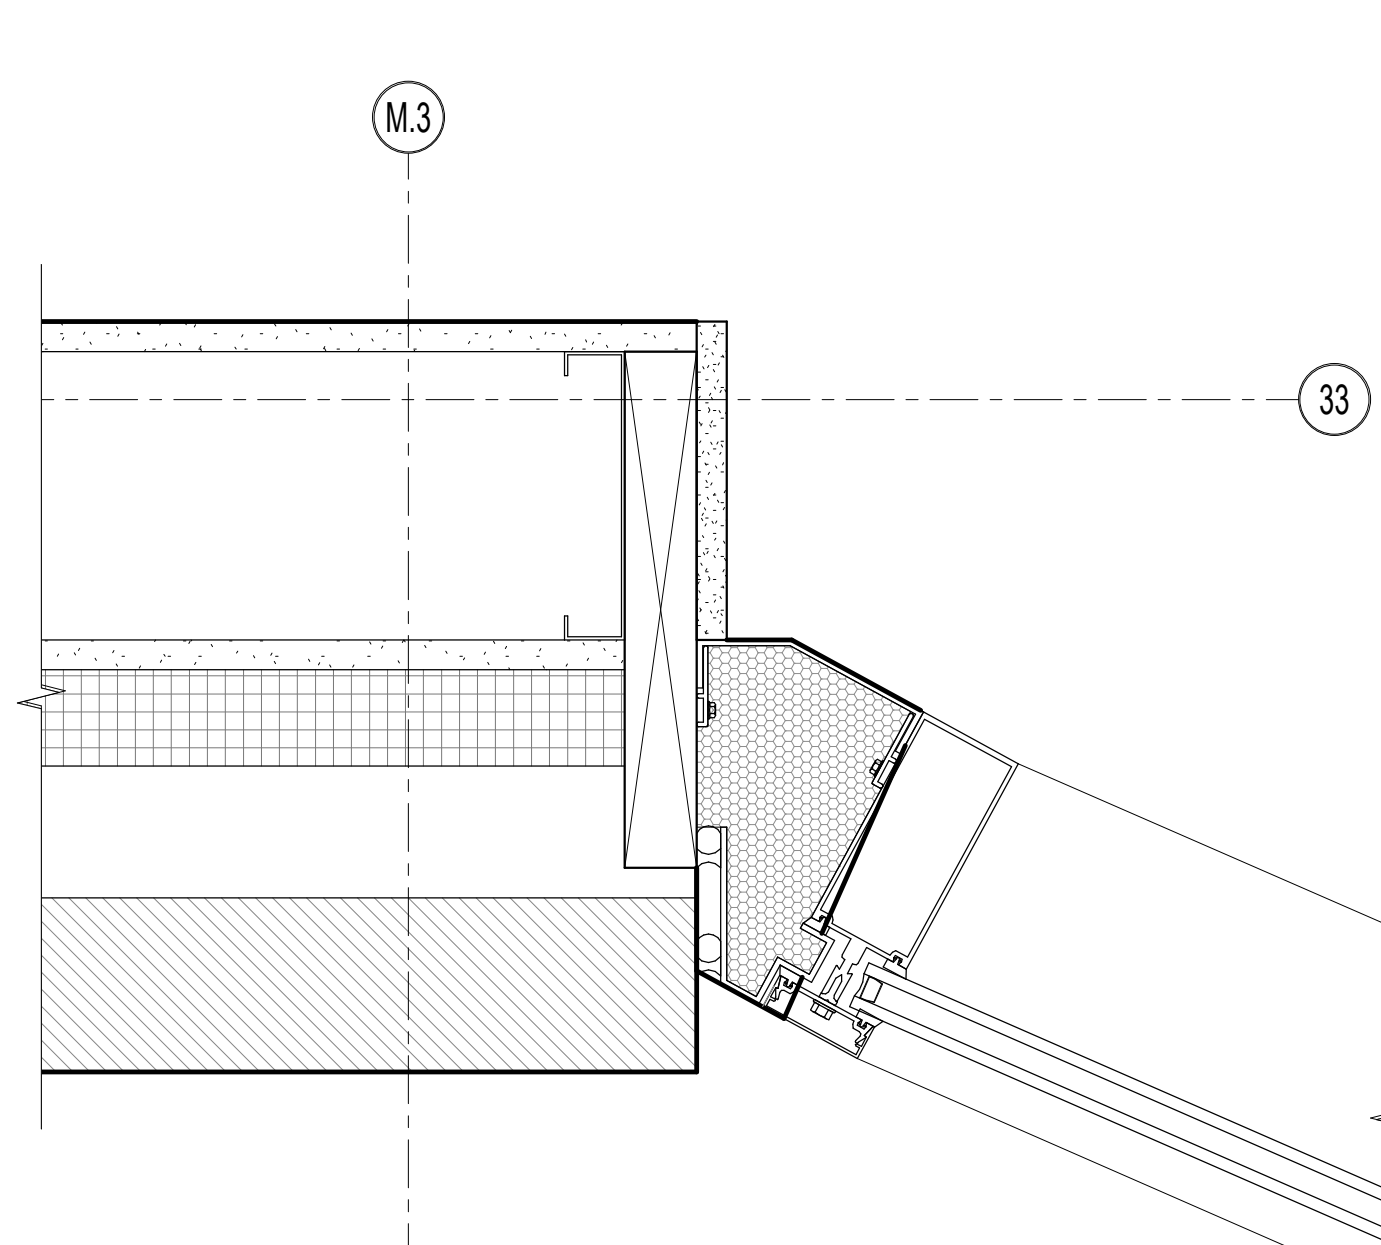


12 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

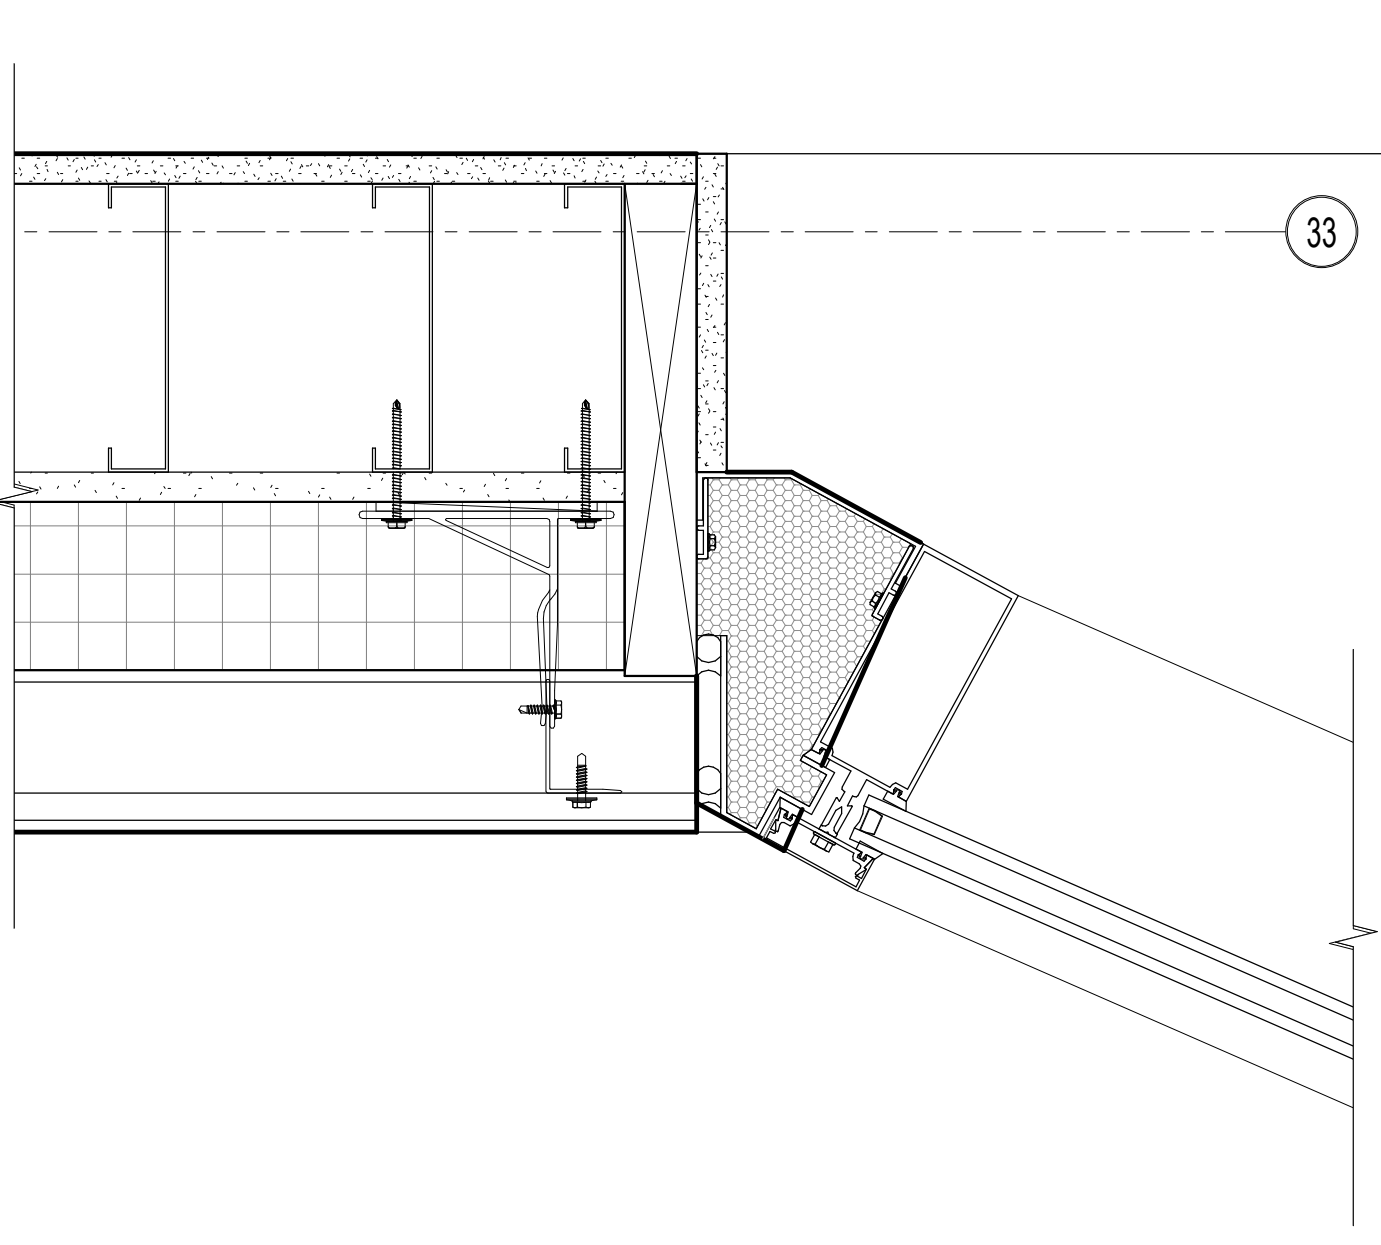


11 CURTAIN WALL JAMB DETAIL
3" = 1'-0"

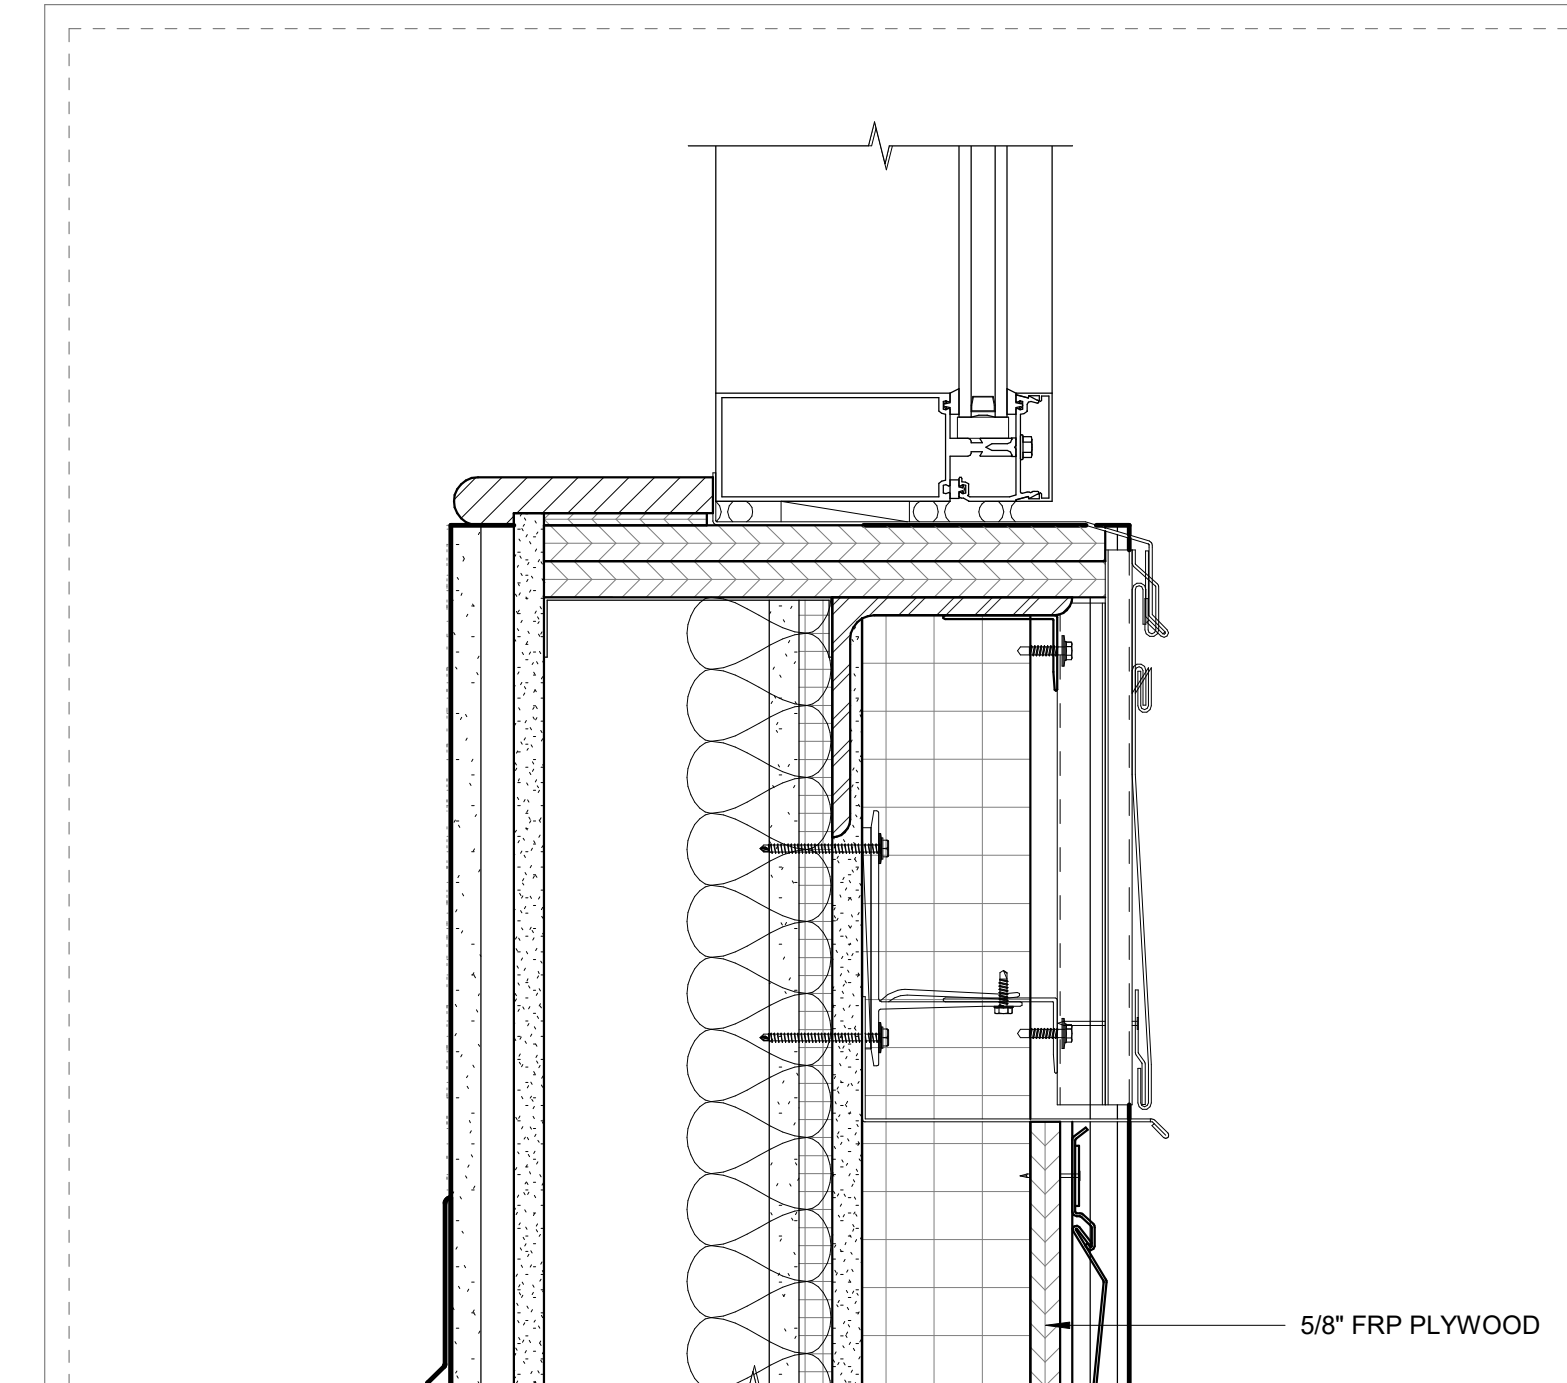


8 CURTAIN WALL SILL DETAIL
3" = 1'-0"

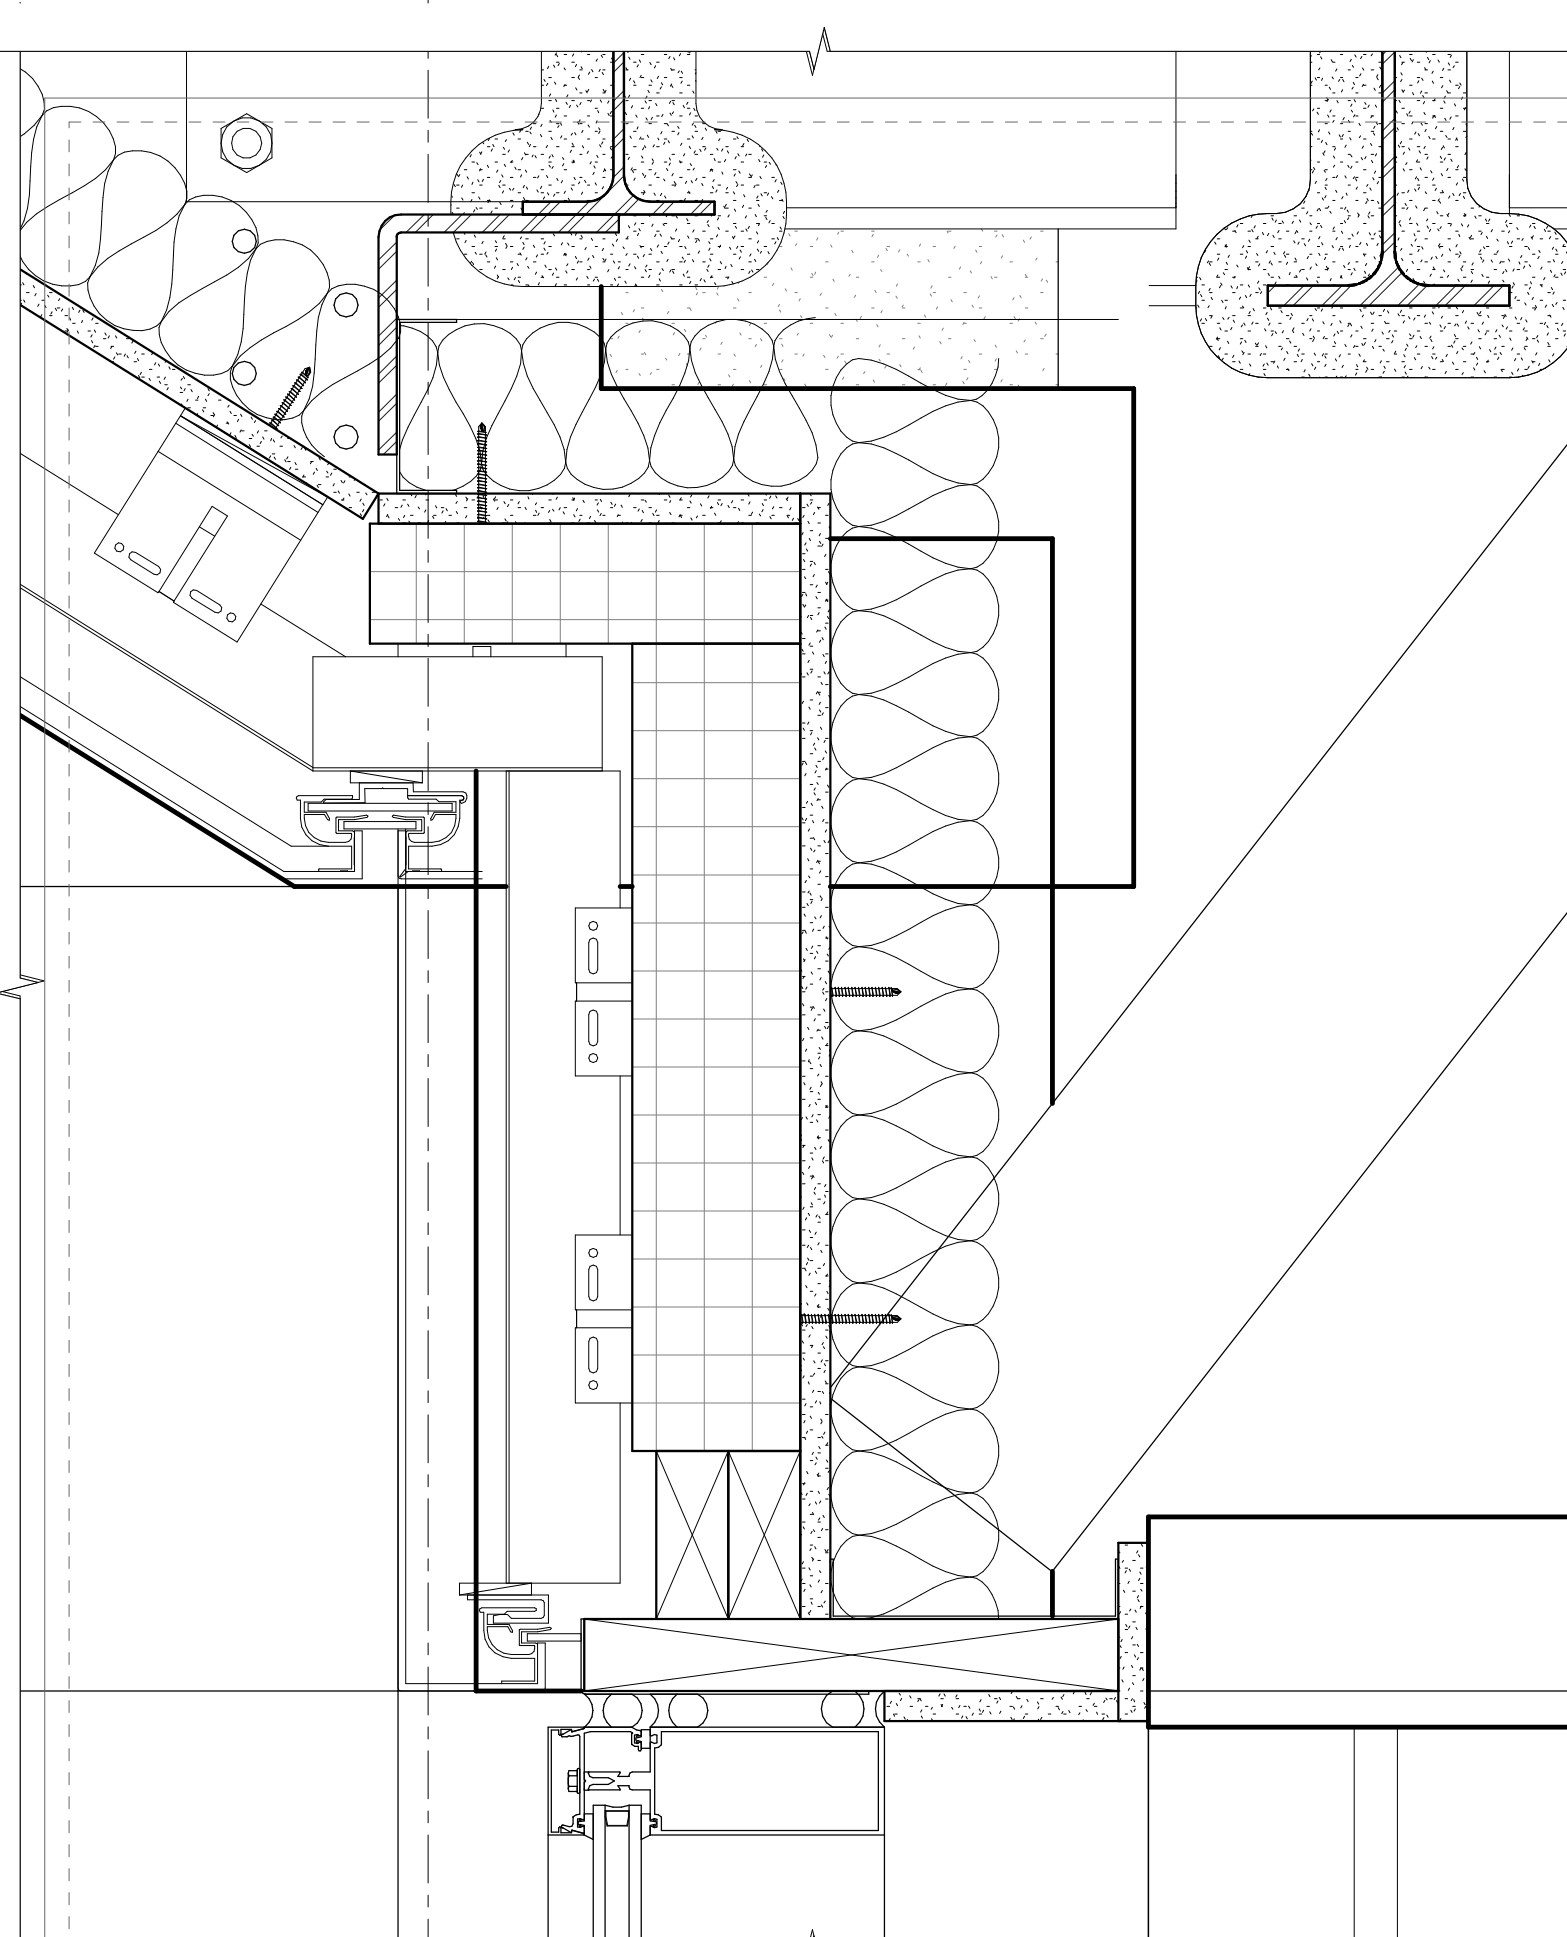


7 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

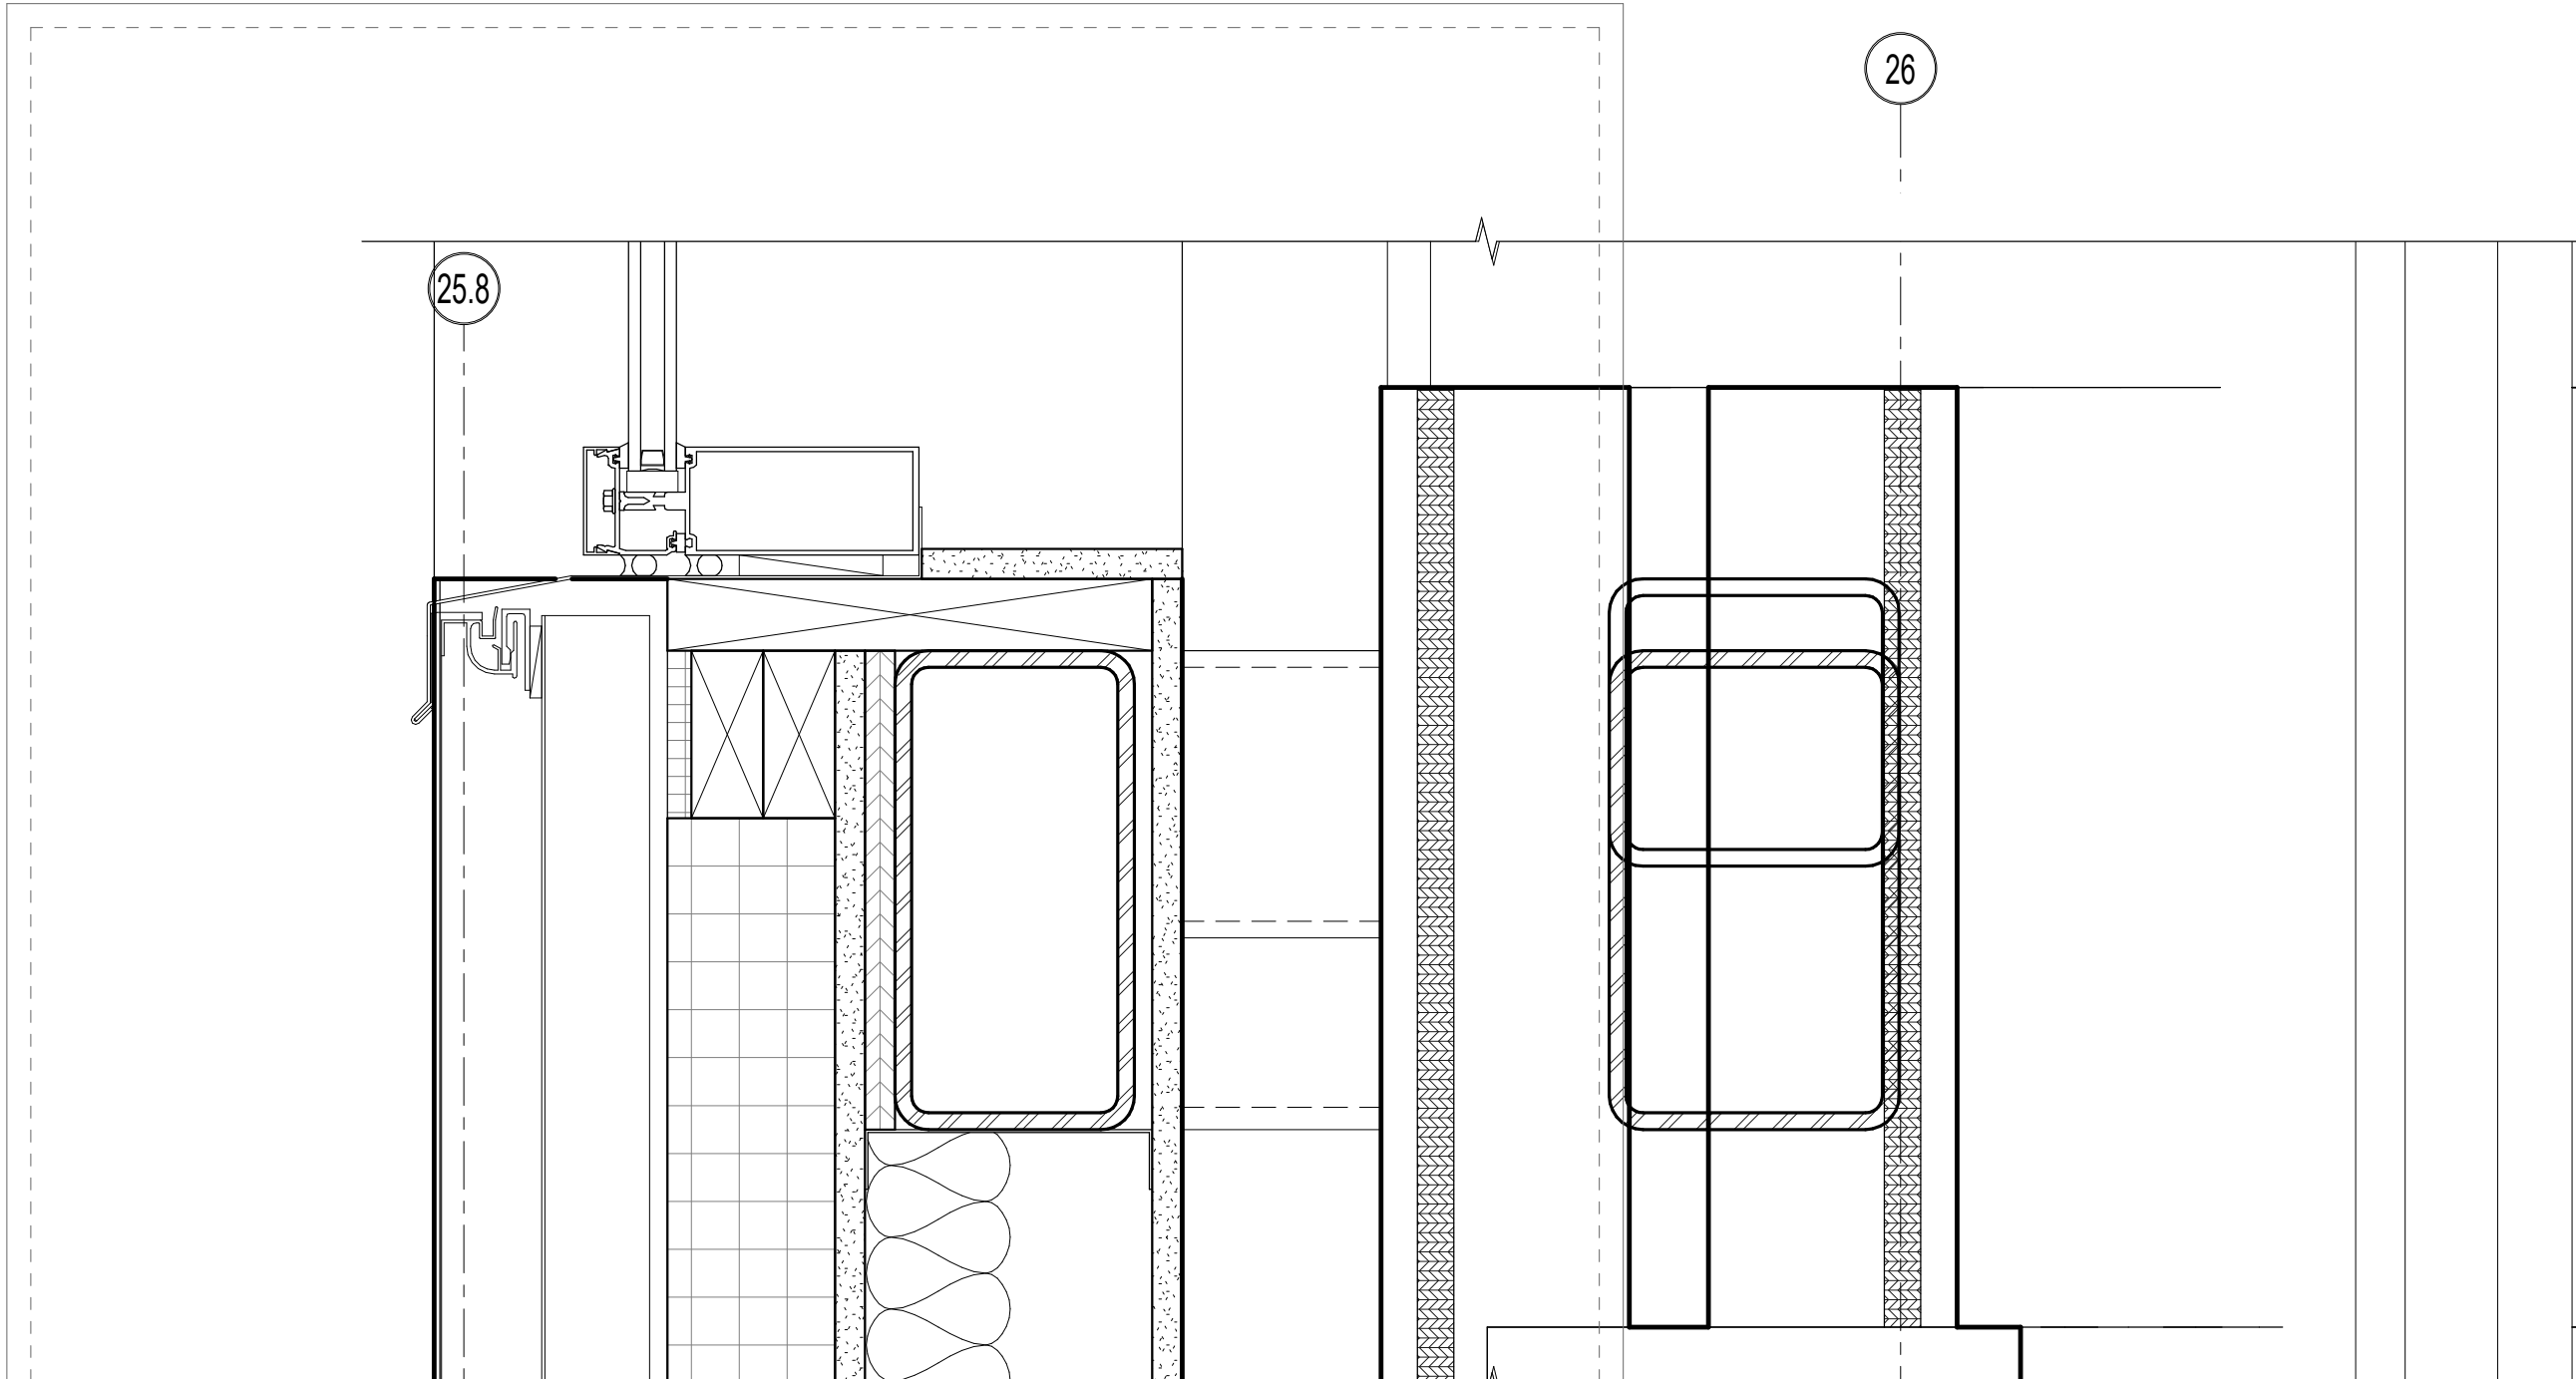


6 CURTAIN WALL SILL DETAIL
3" = 1'-0"

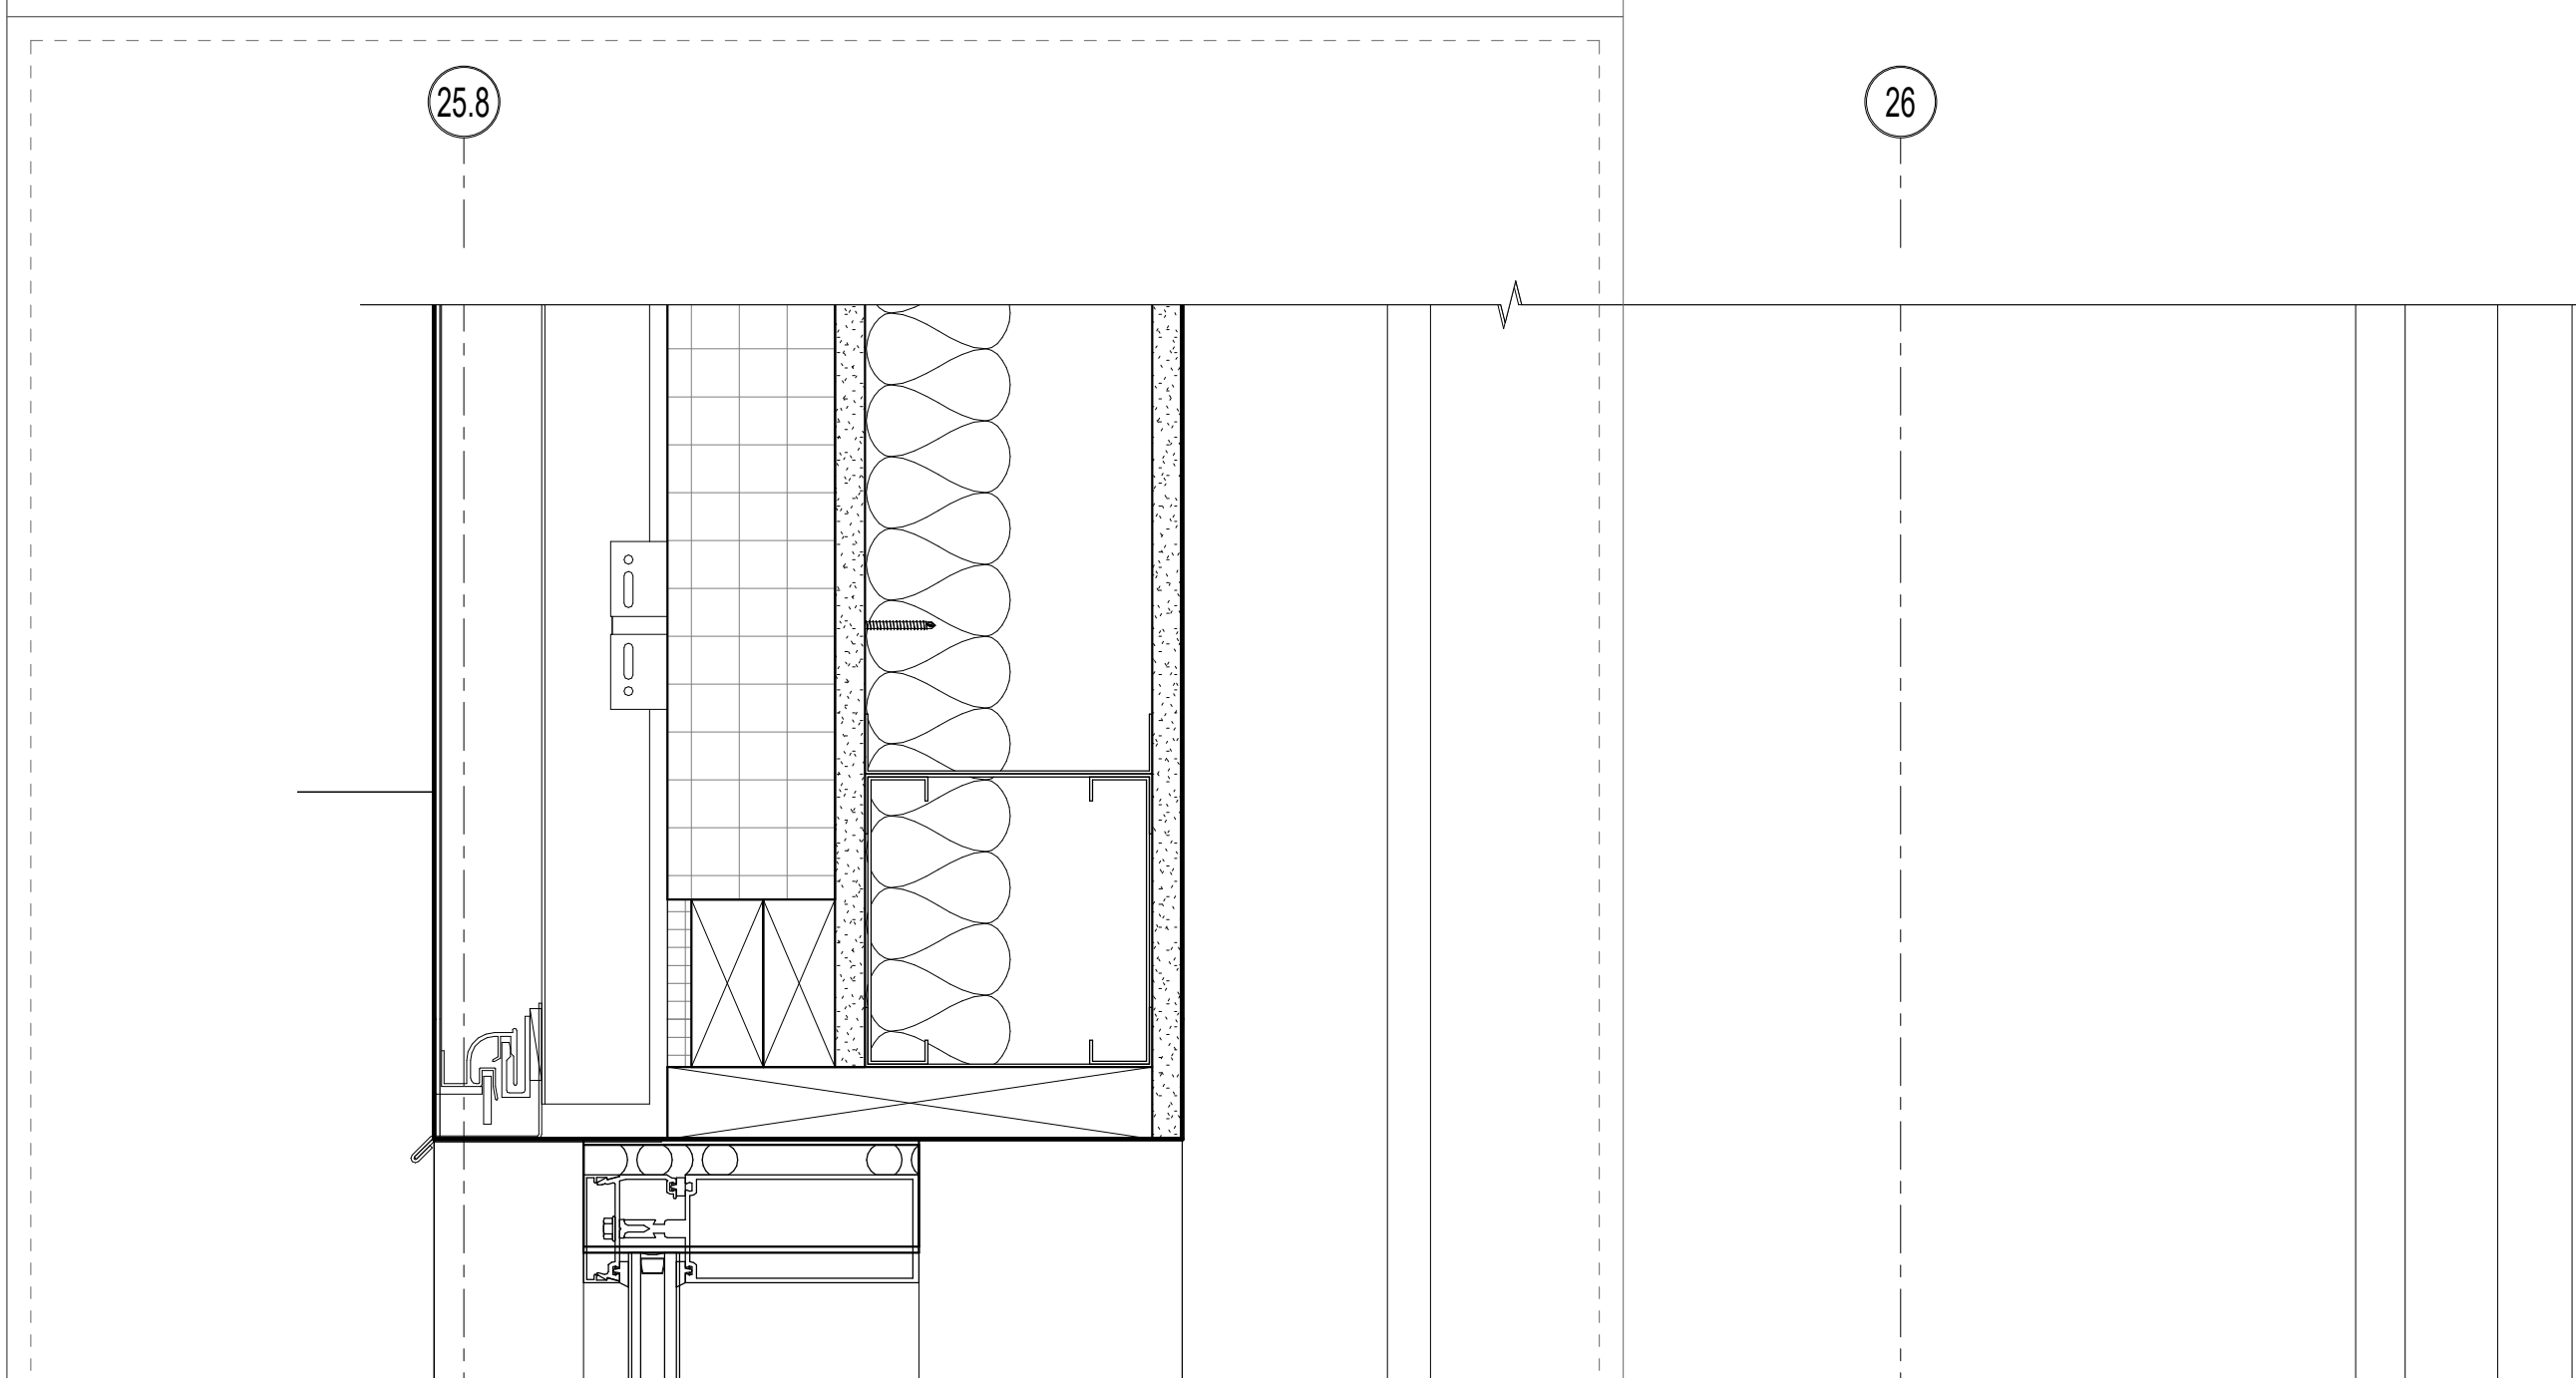


5 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

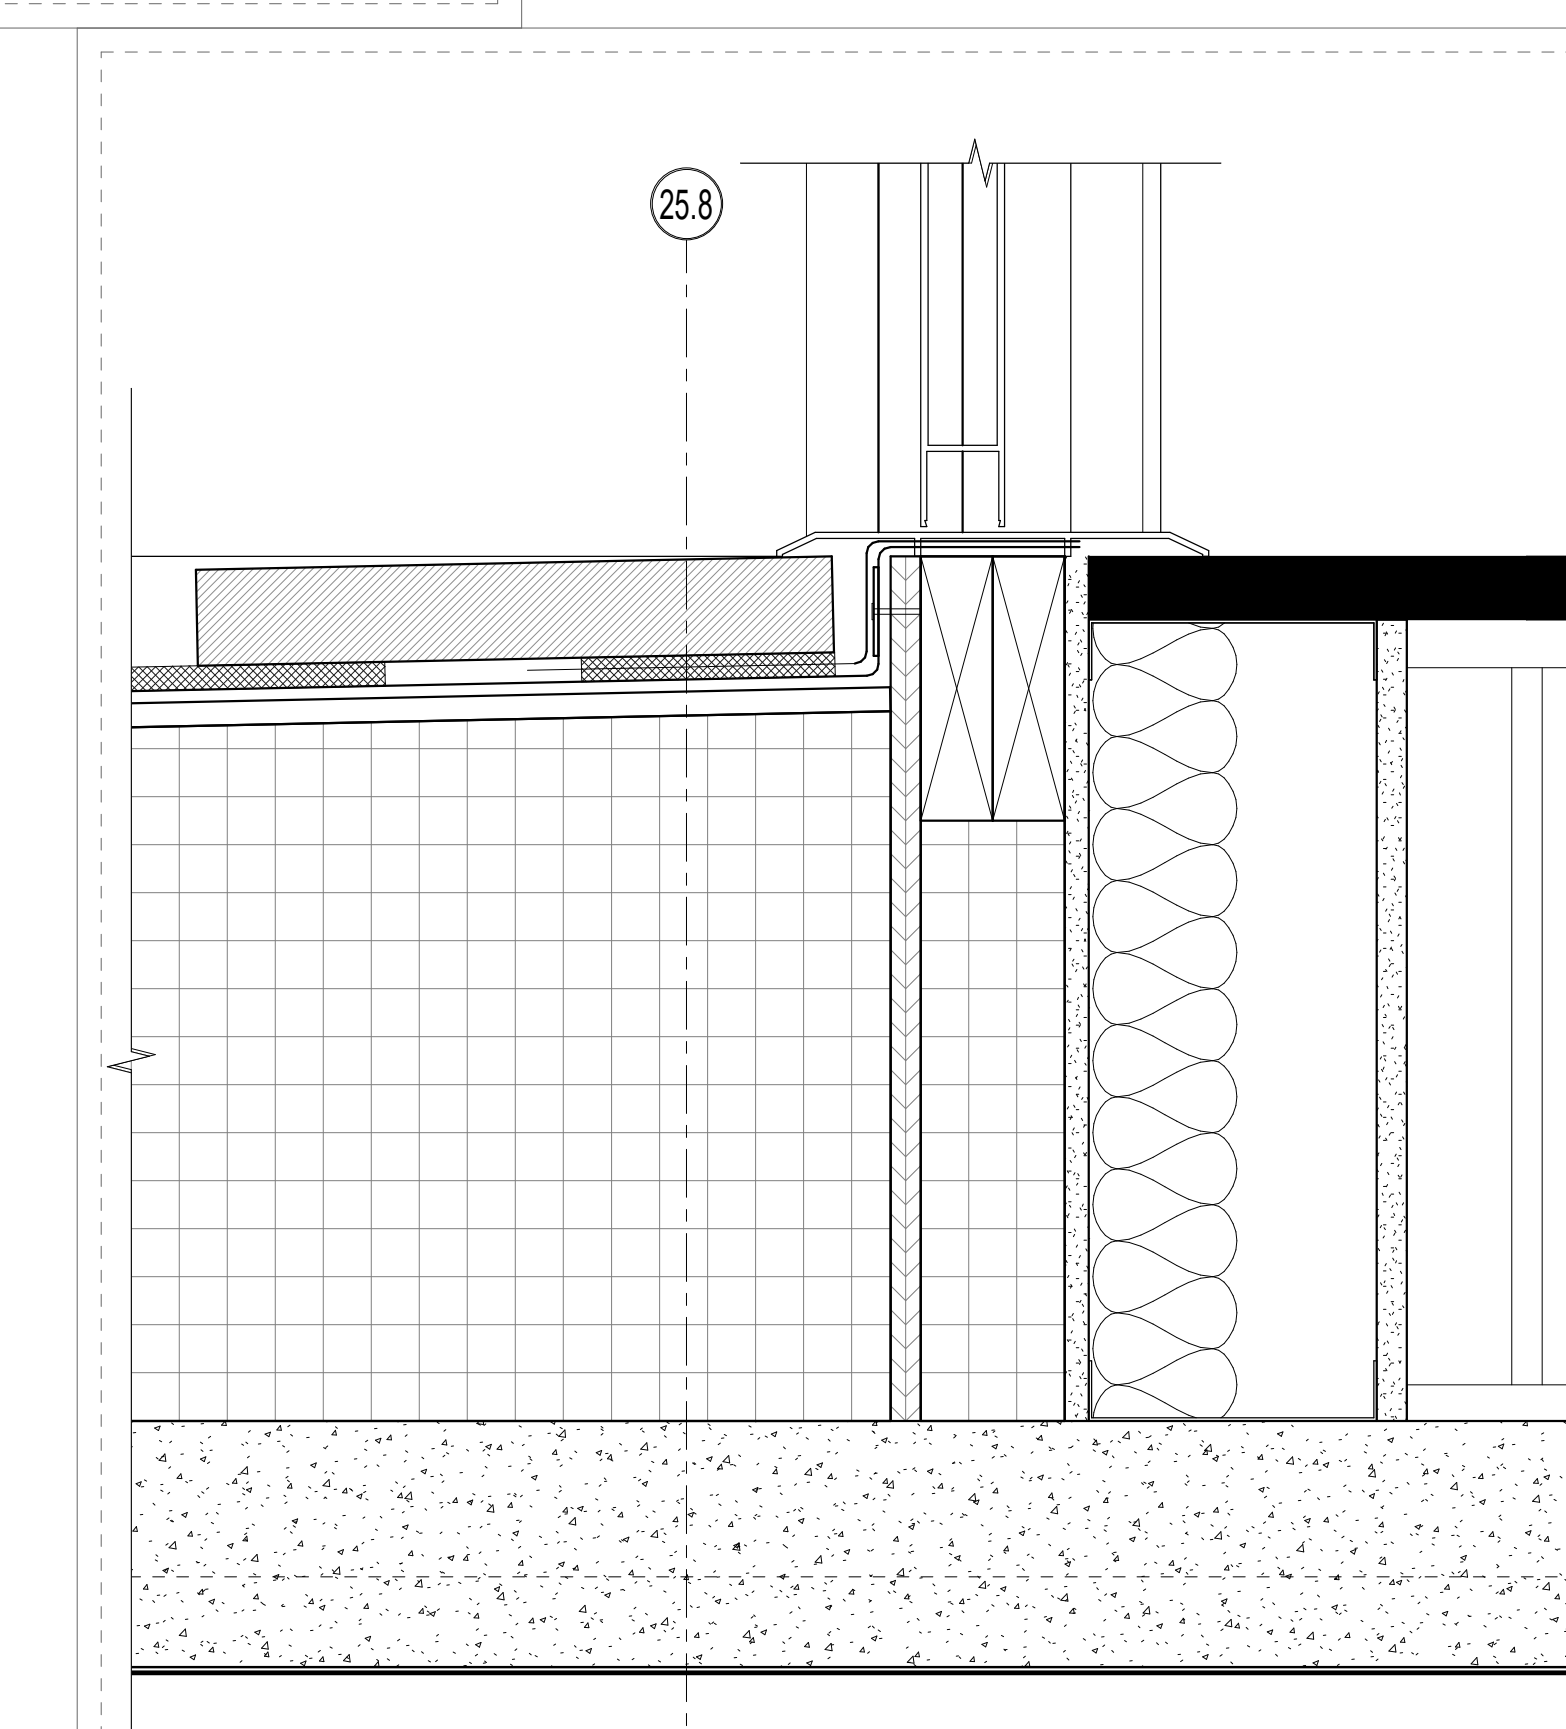


4 CURTAIN WALL SILL DETAIL
3" = 1'-0"

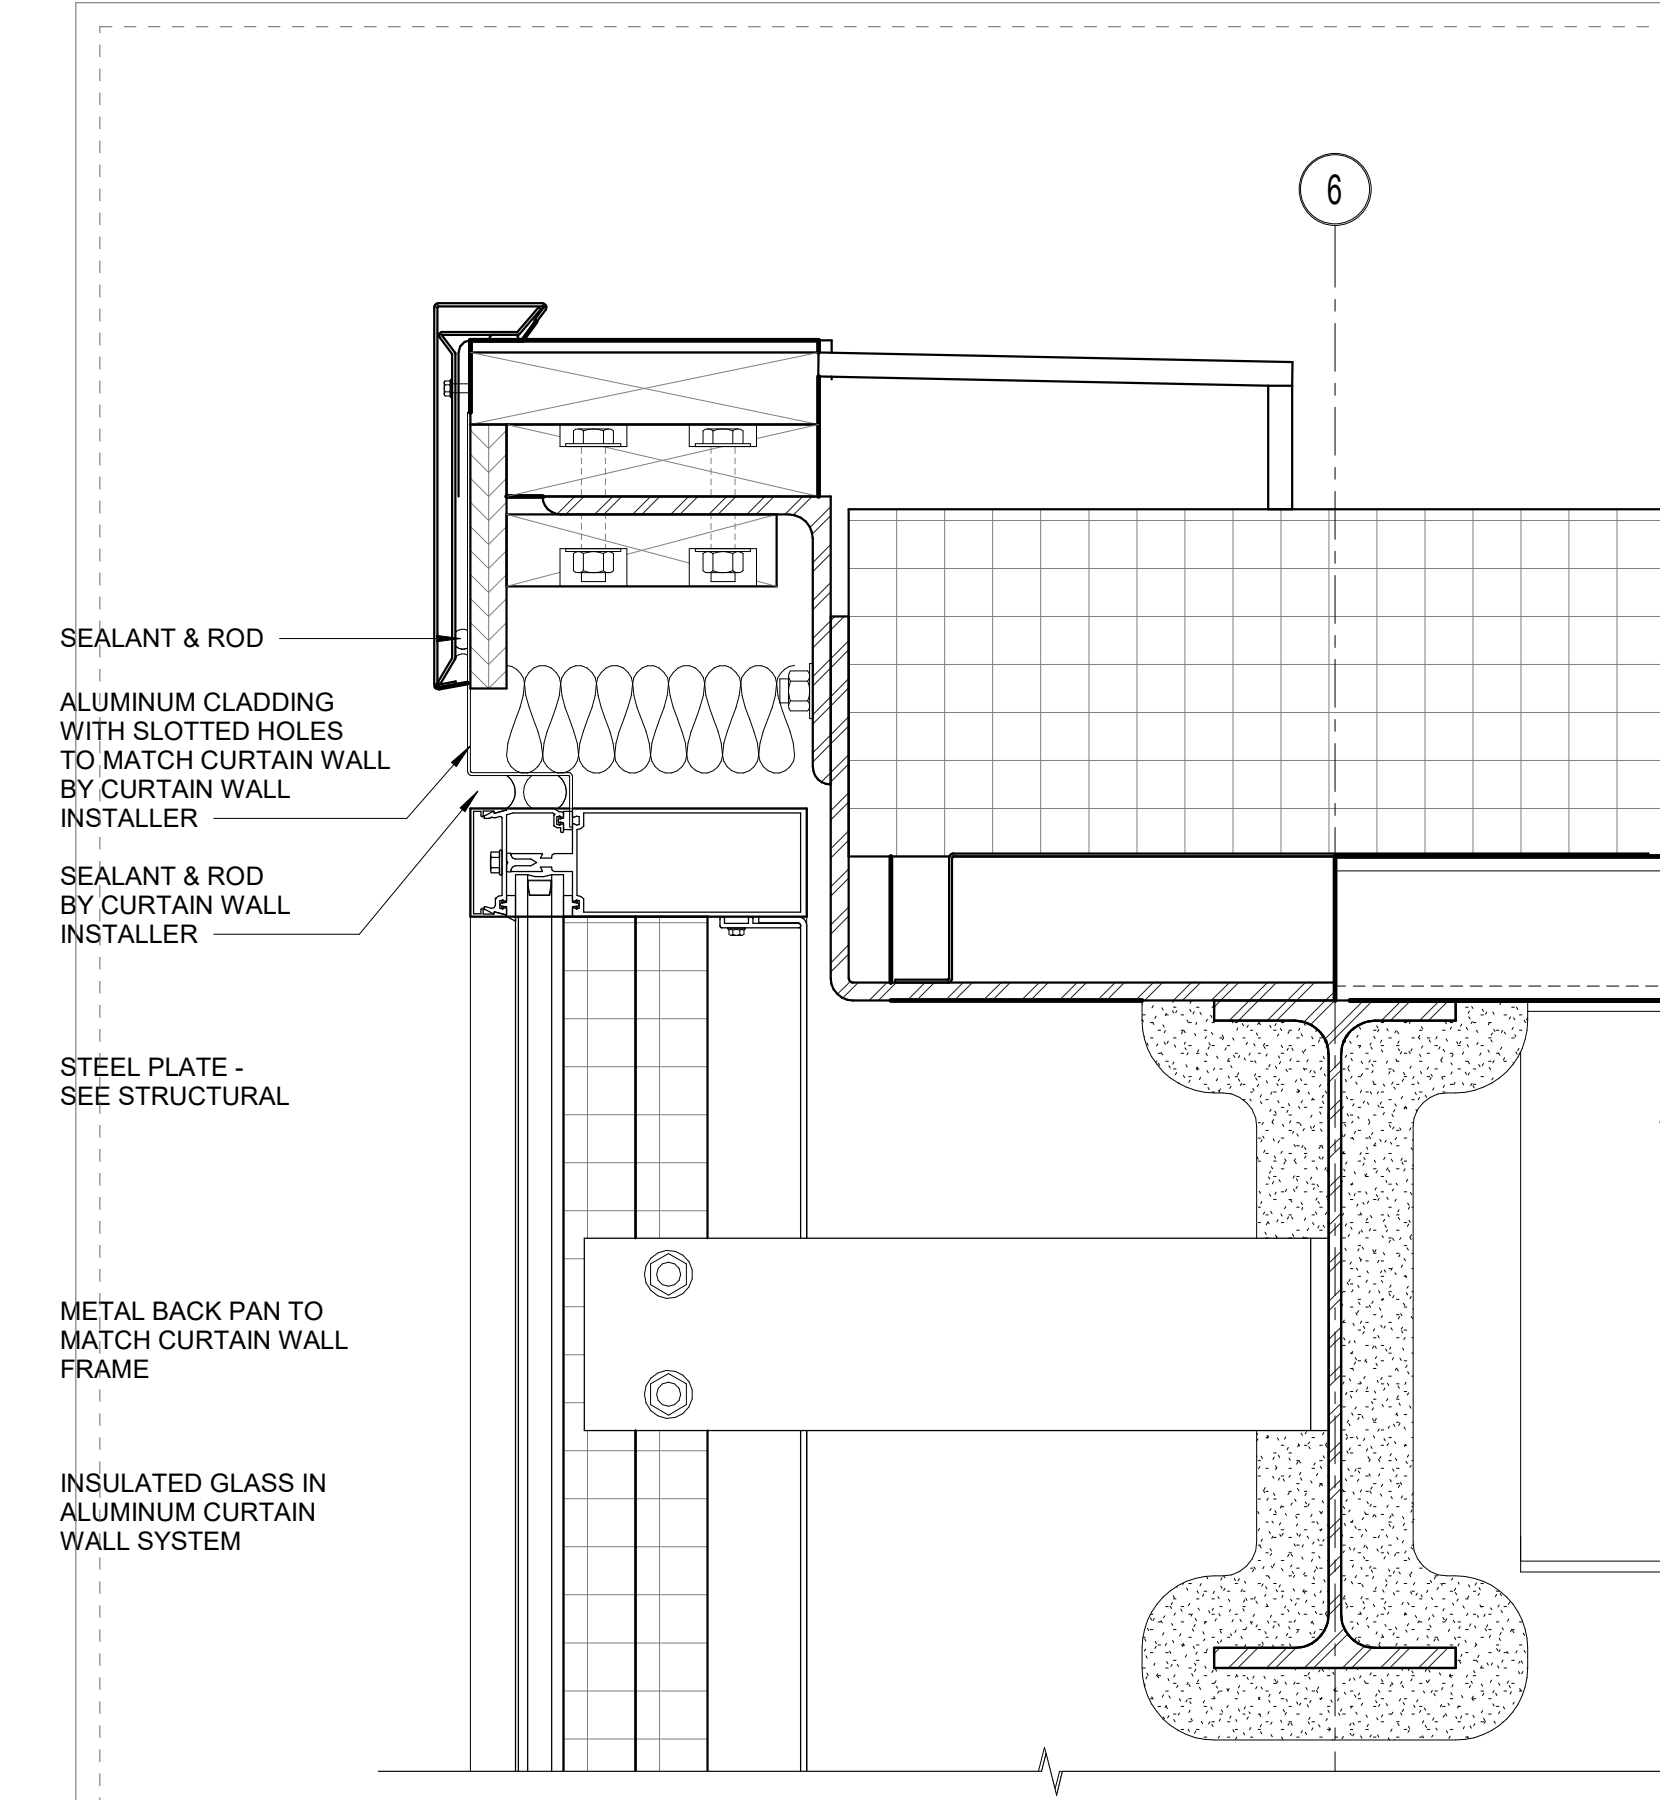

3 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

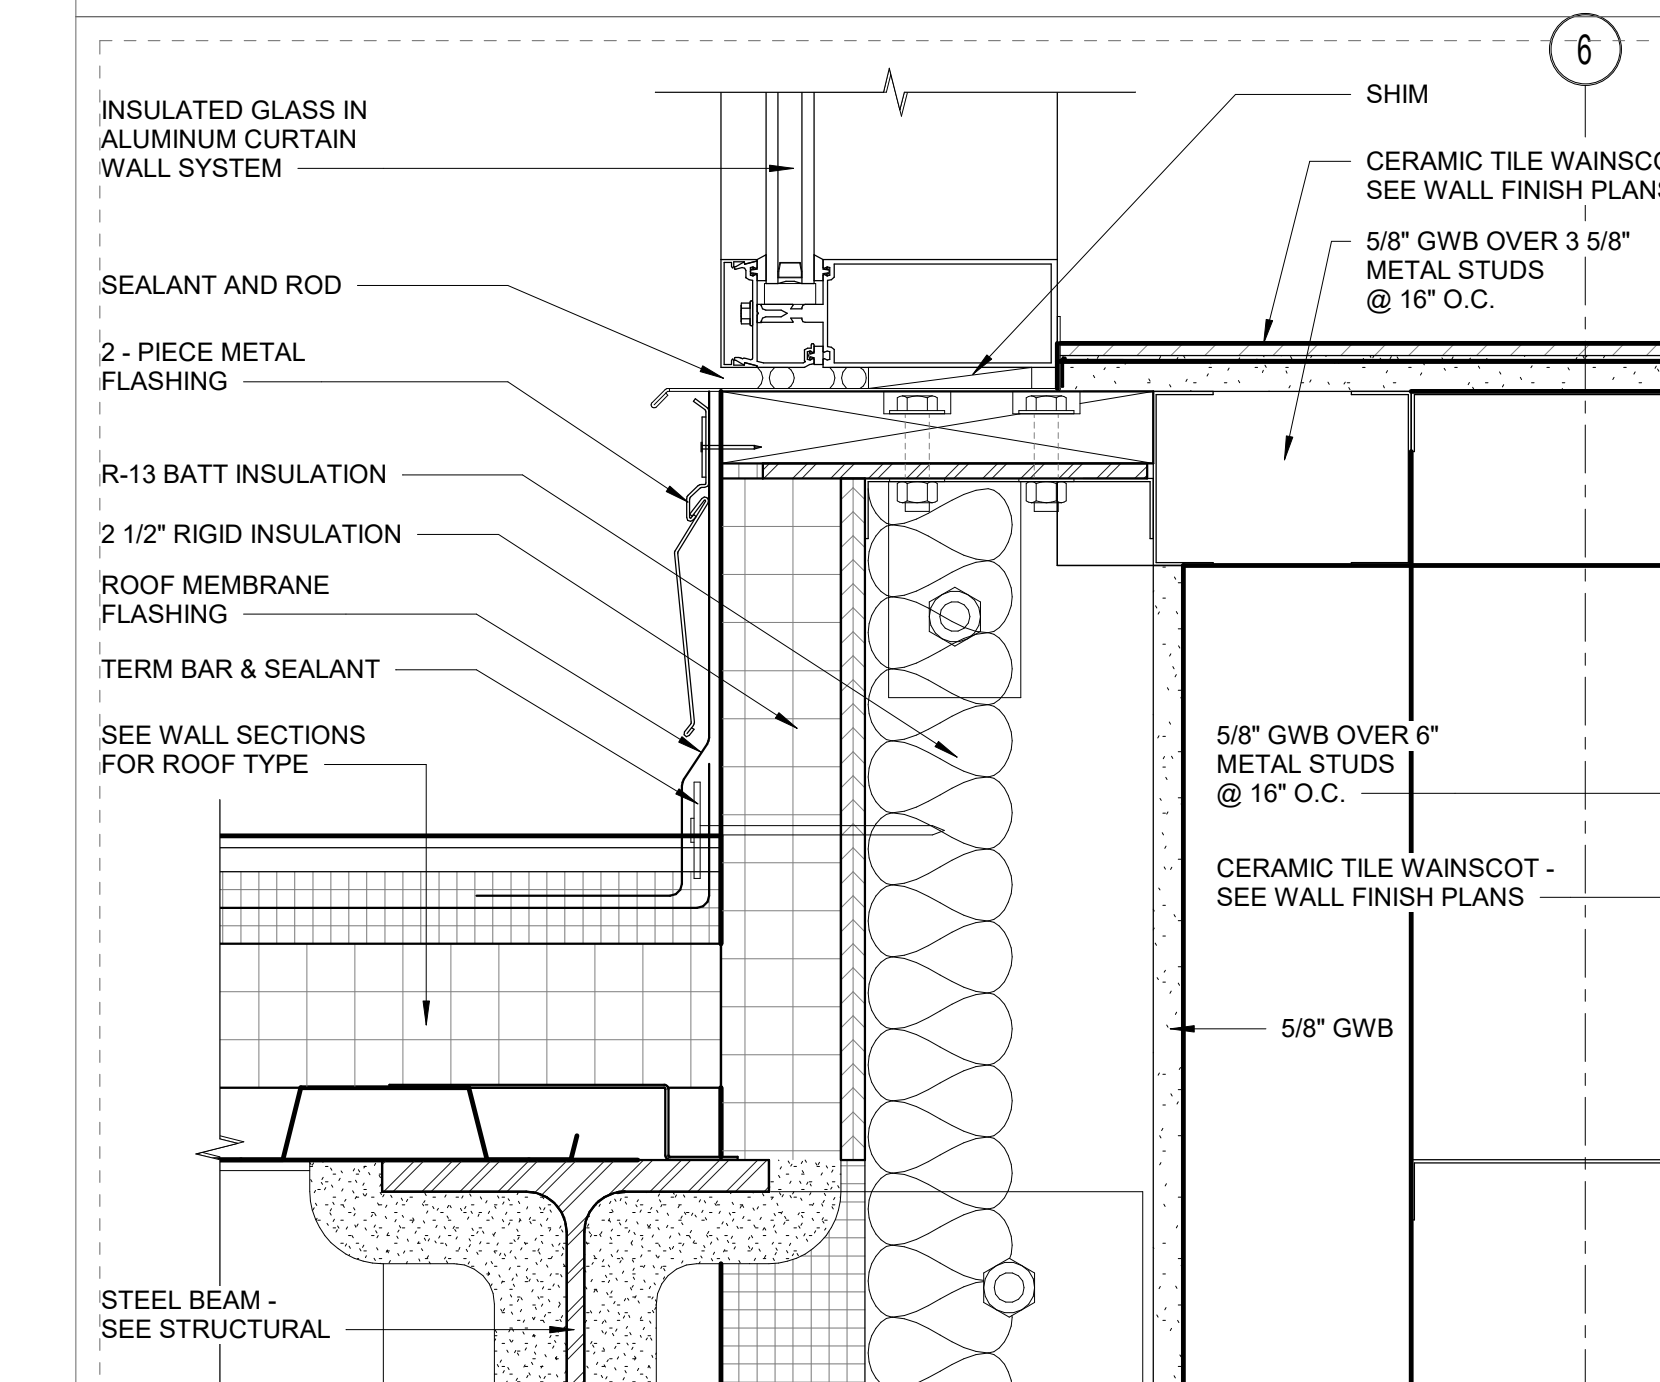

2 CURTAIN WALL SILL DETAIL
3" = 1'-0"

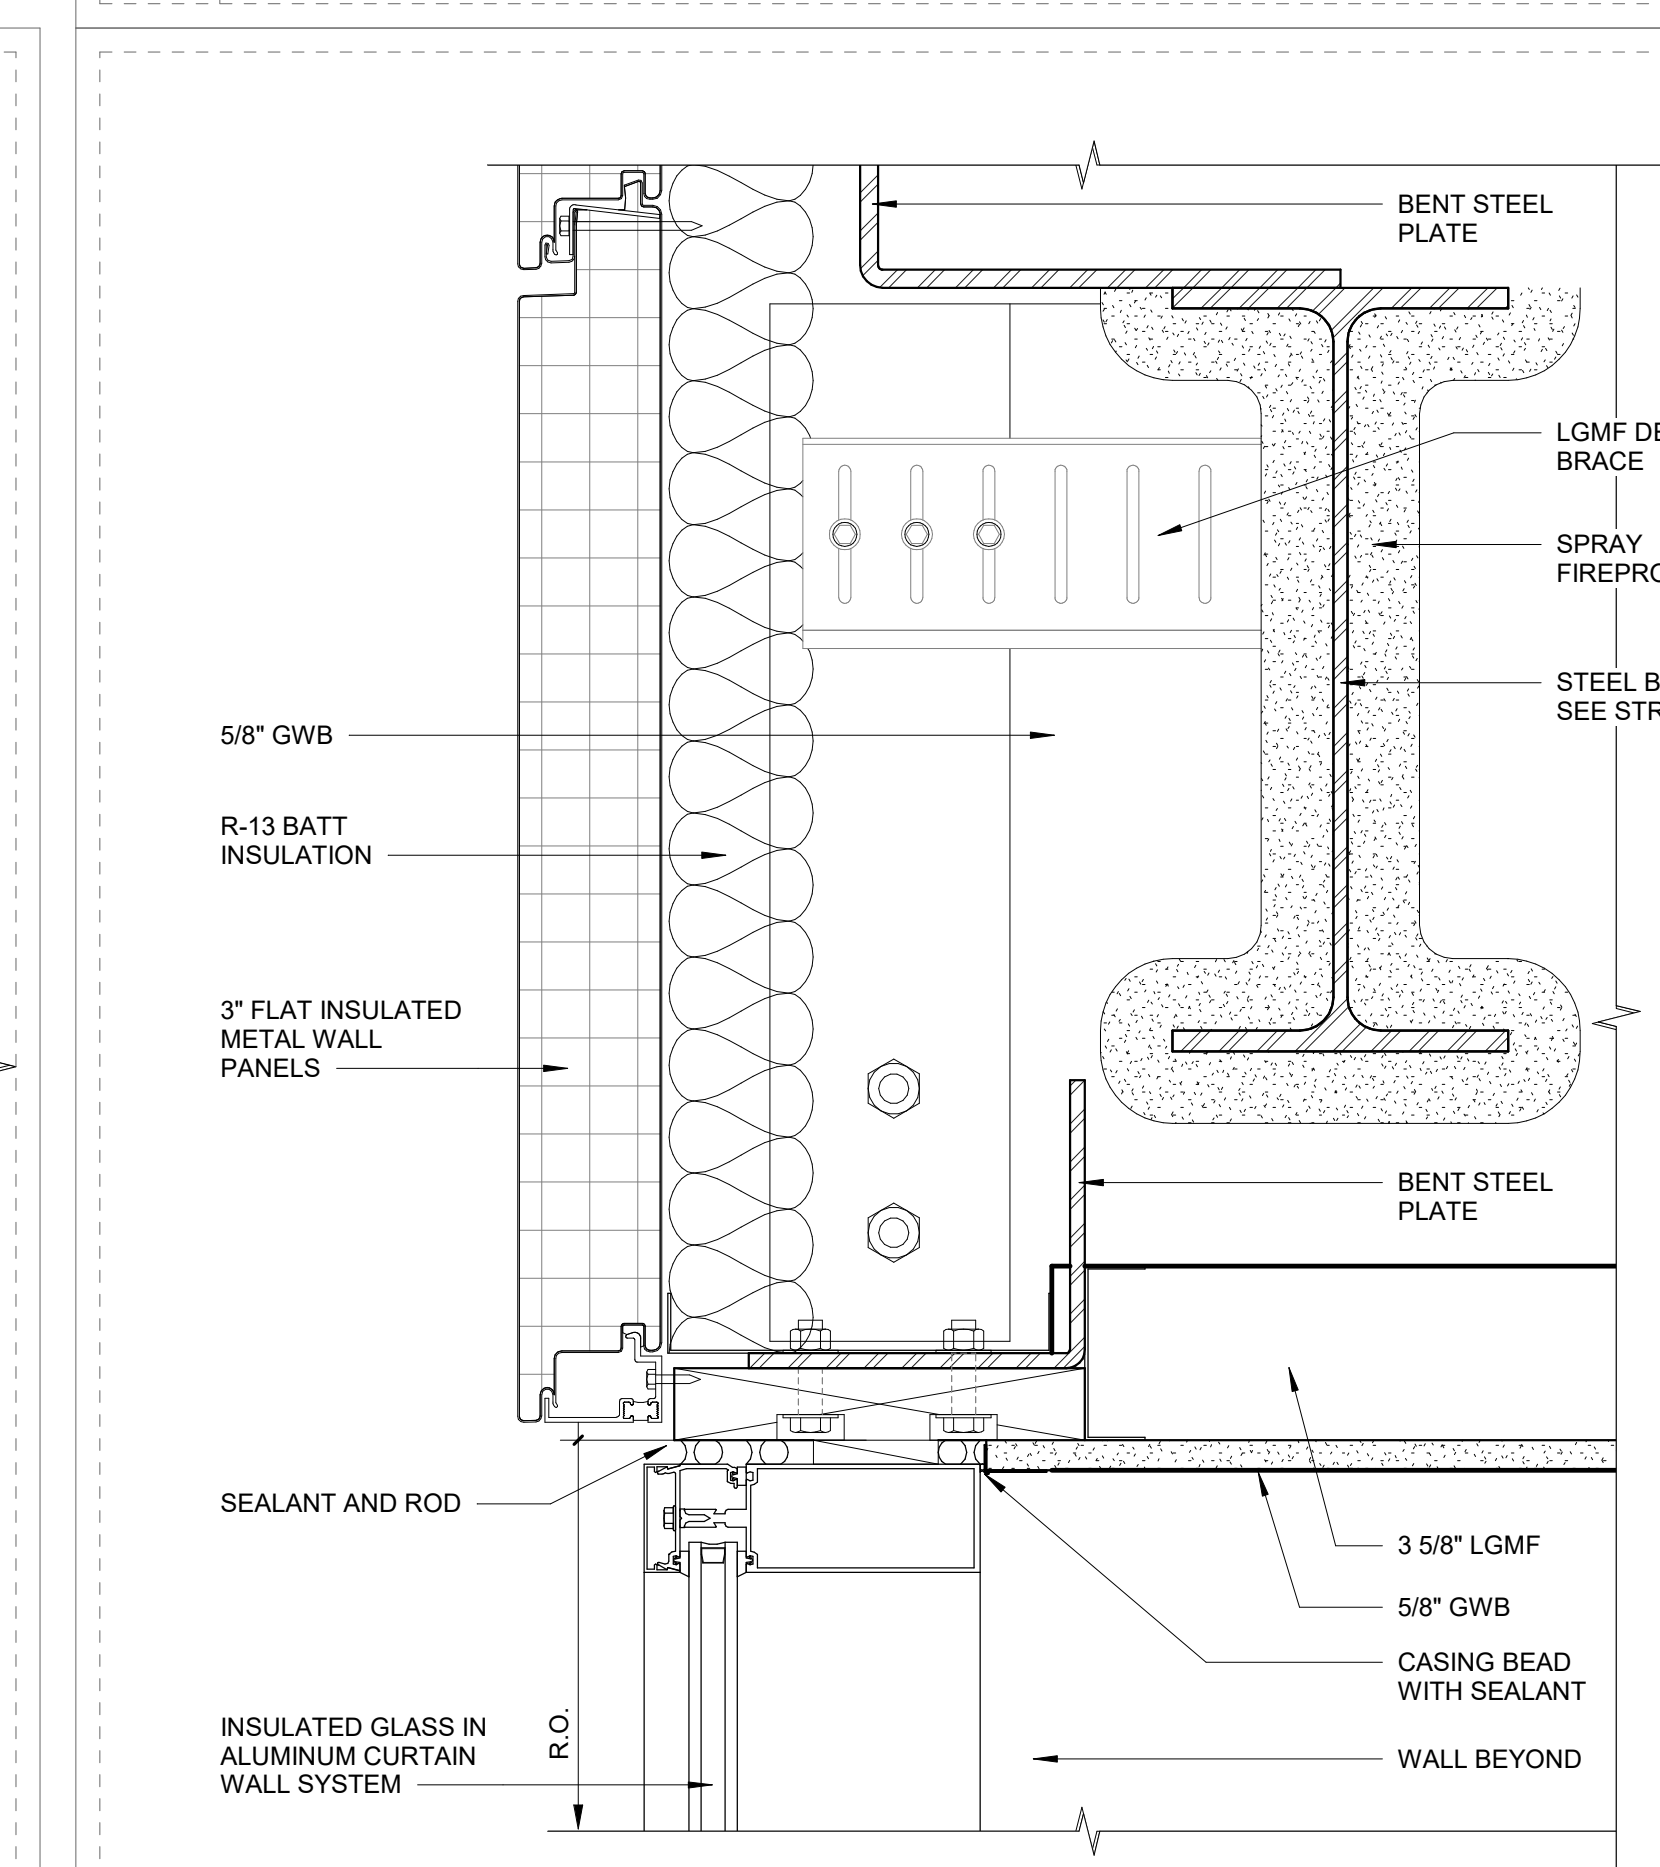


1 CURTAIN WALL HEAD DETAIL
3" = 1'-0"

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023




KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**CURTAIN WALL
DETAILS**

Scale: 3" = 1'-0"

Job No.: 20202


Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A6-3-12

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

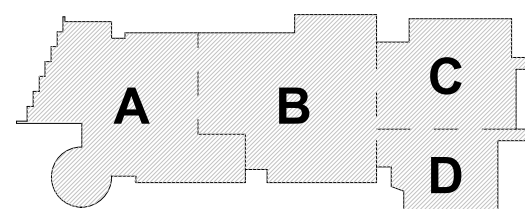

KEY PLAN

PROJECT NO.

MAGNETIC NORTH

CURTAIN WALL DETAILS

Scale: 3" = 1'-0"

Job No.: 20202

Drawn By: DF


Date: May 12TH, 2023

Volume 3 of 4


A6-3-13

**Northeast
Metropolitan
Regional
Vocational High
School**


100 Hemlock Road,
Wakefield, MA 01880

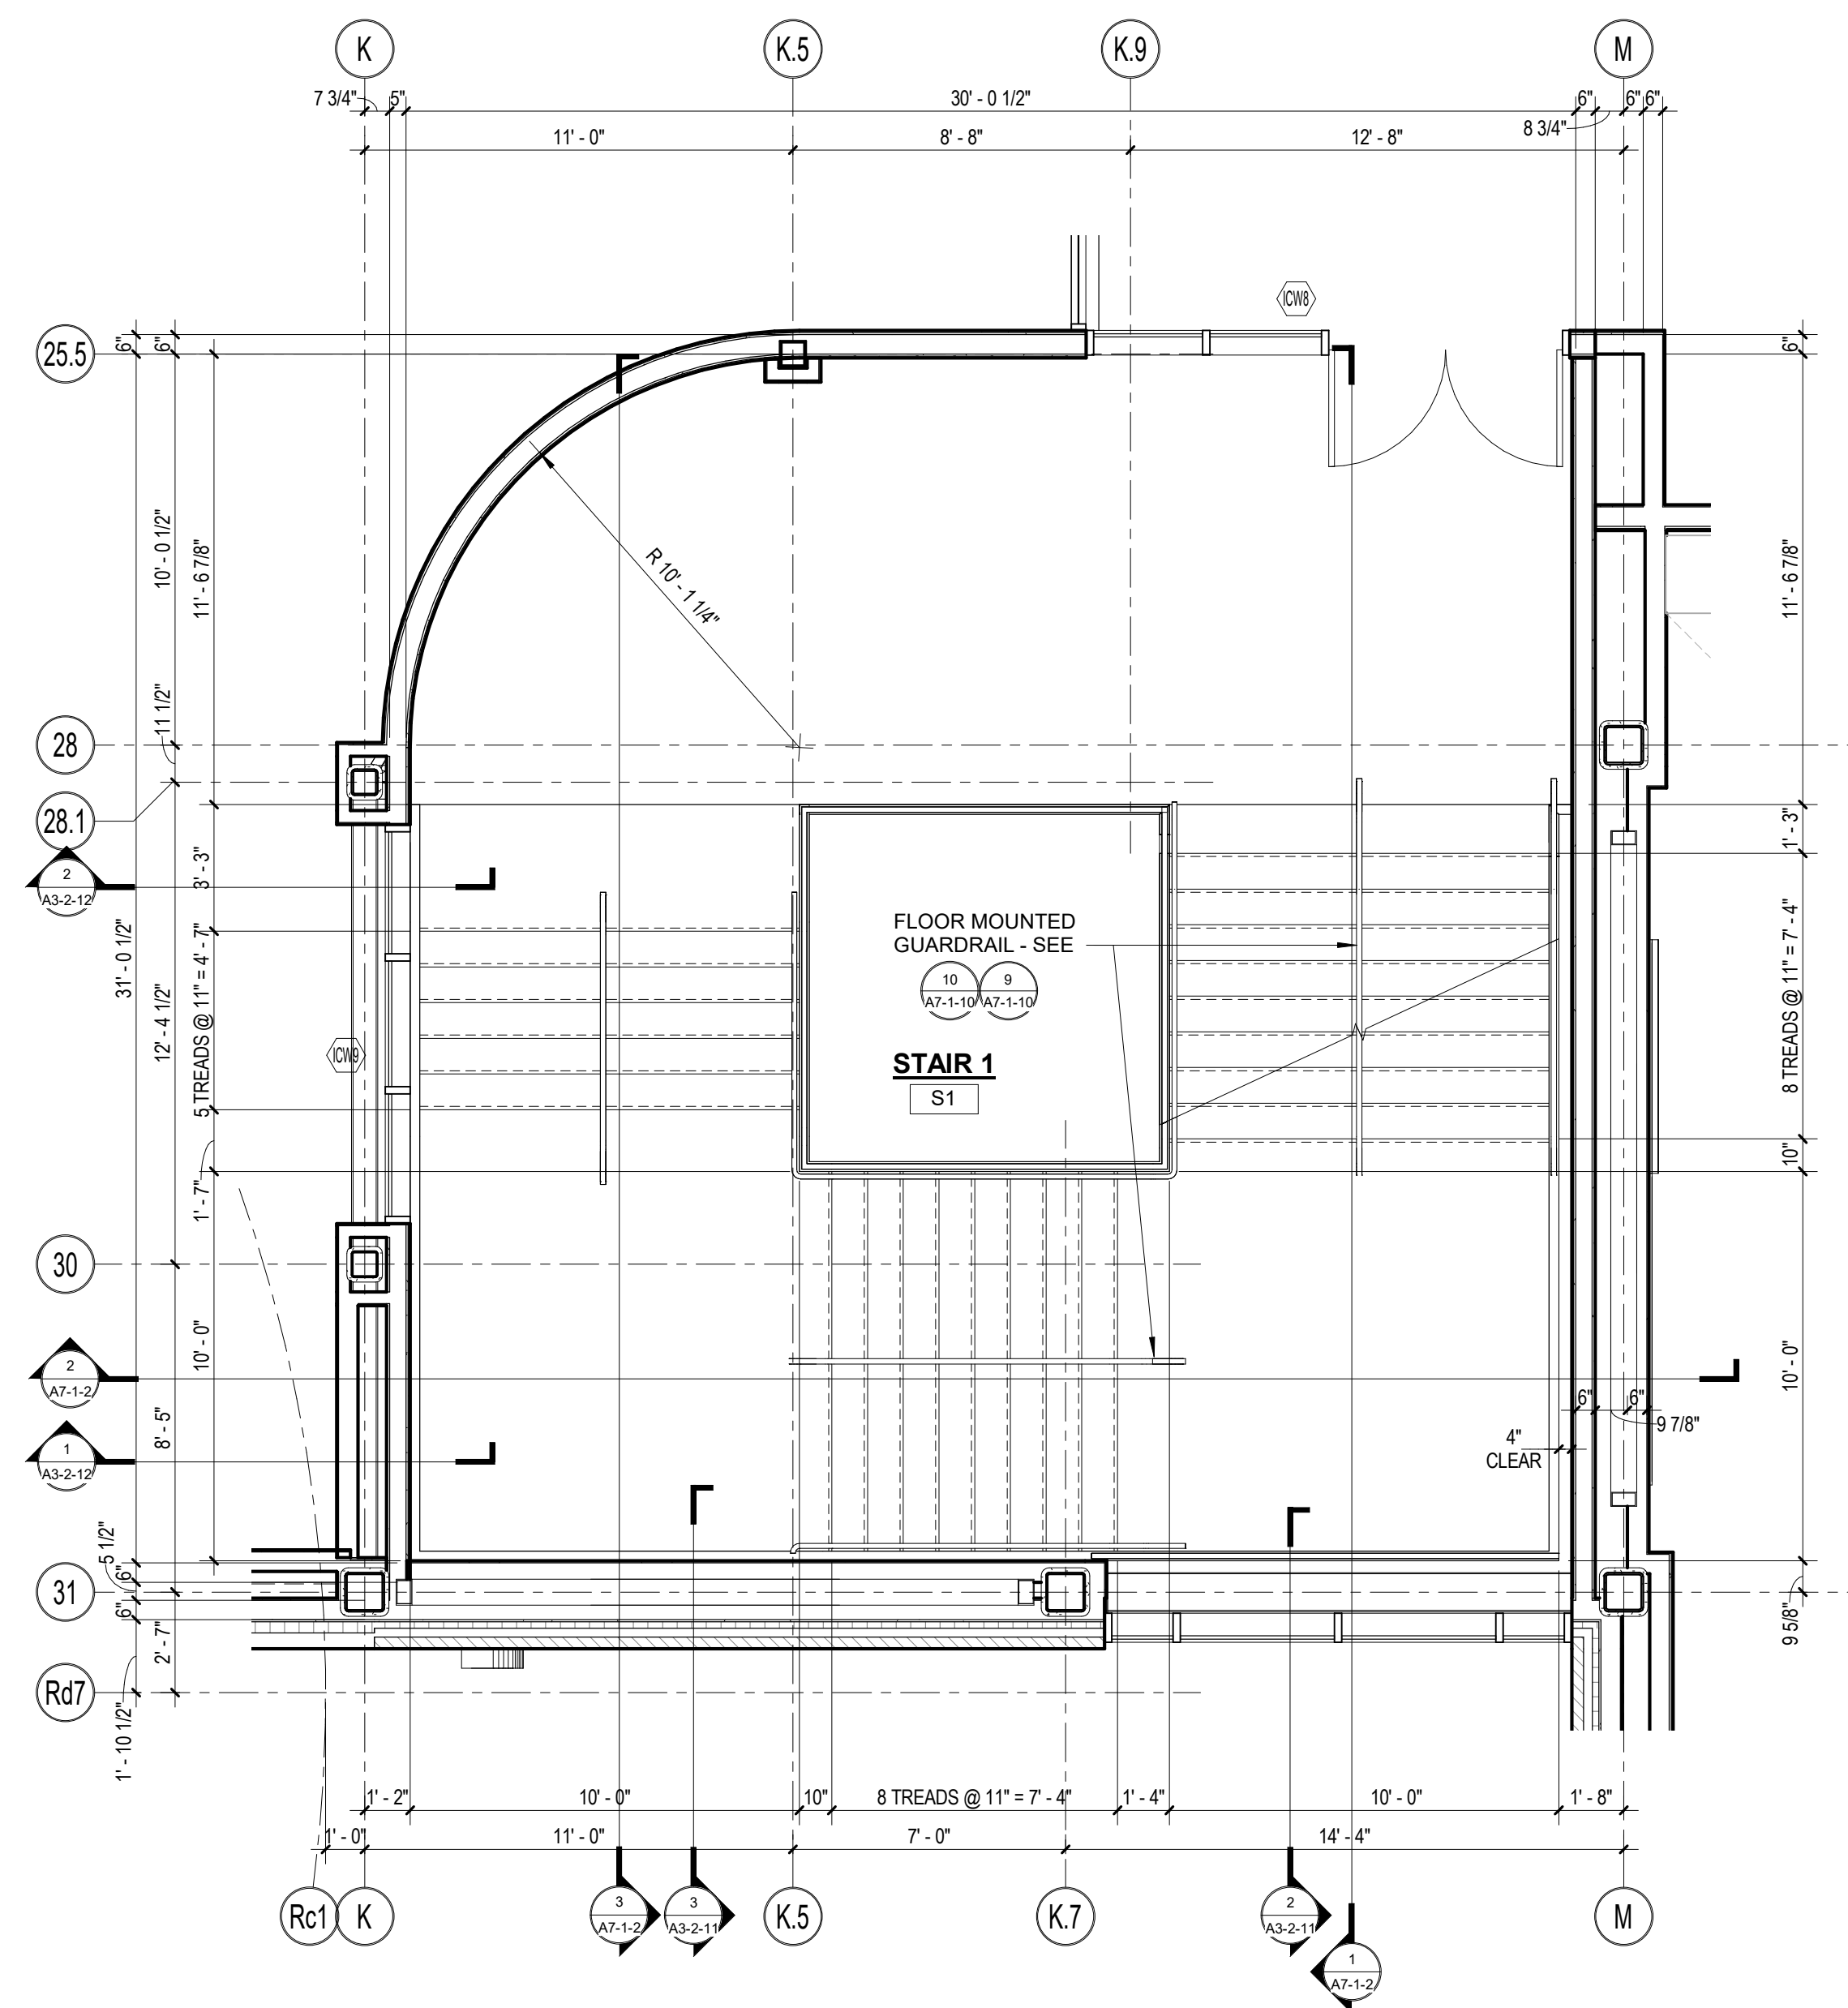


3 STAIR #1 PLAN - THIRD FLOOR
1/4" = 1'-0"

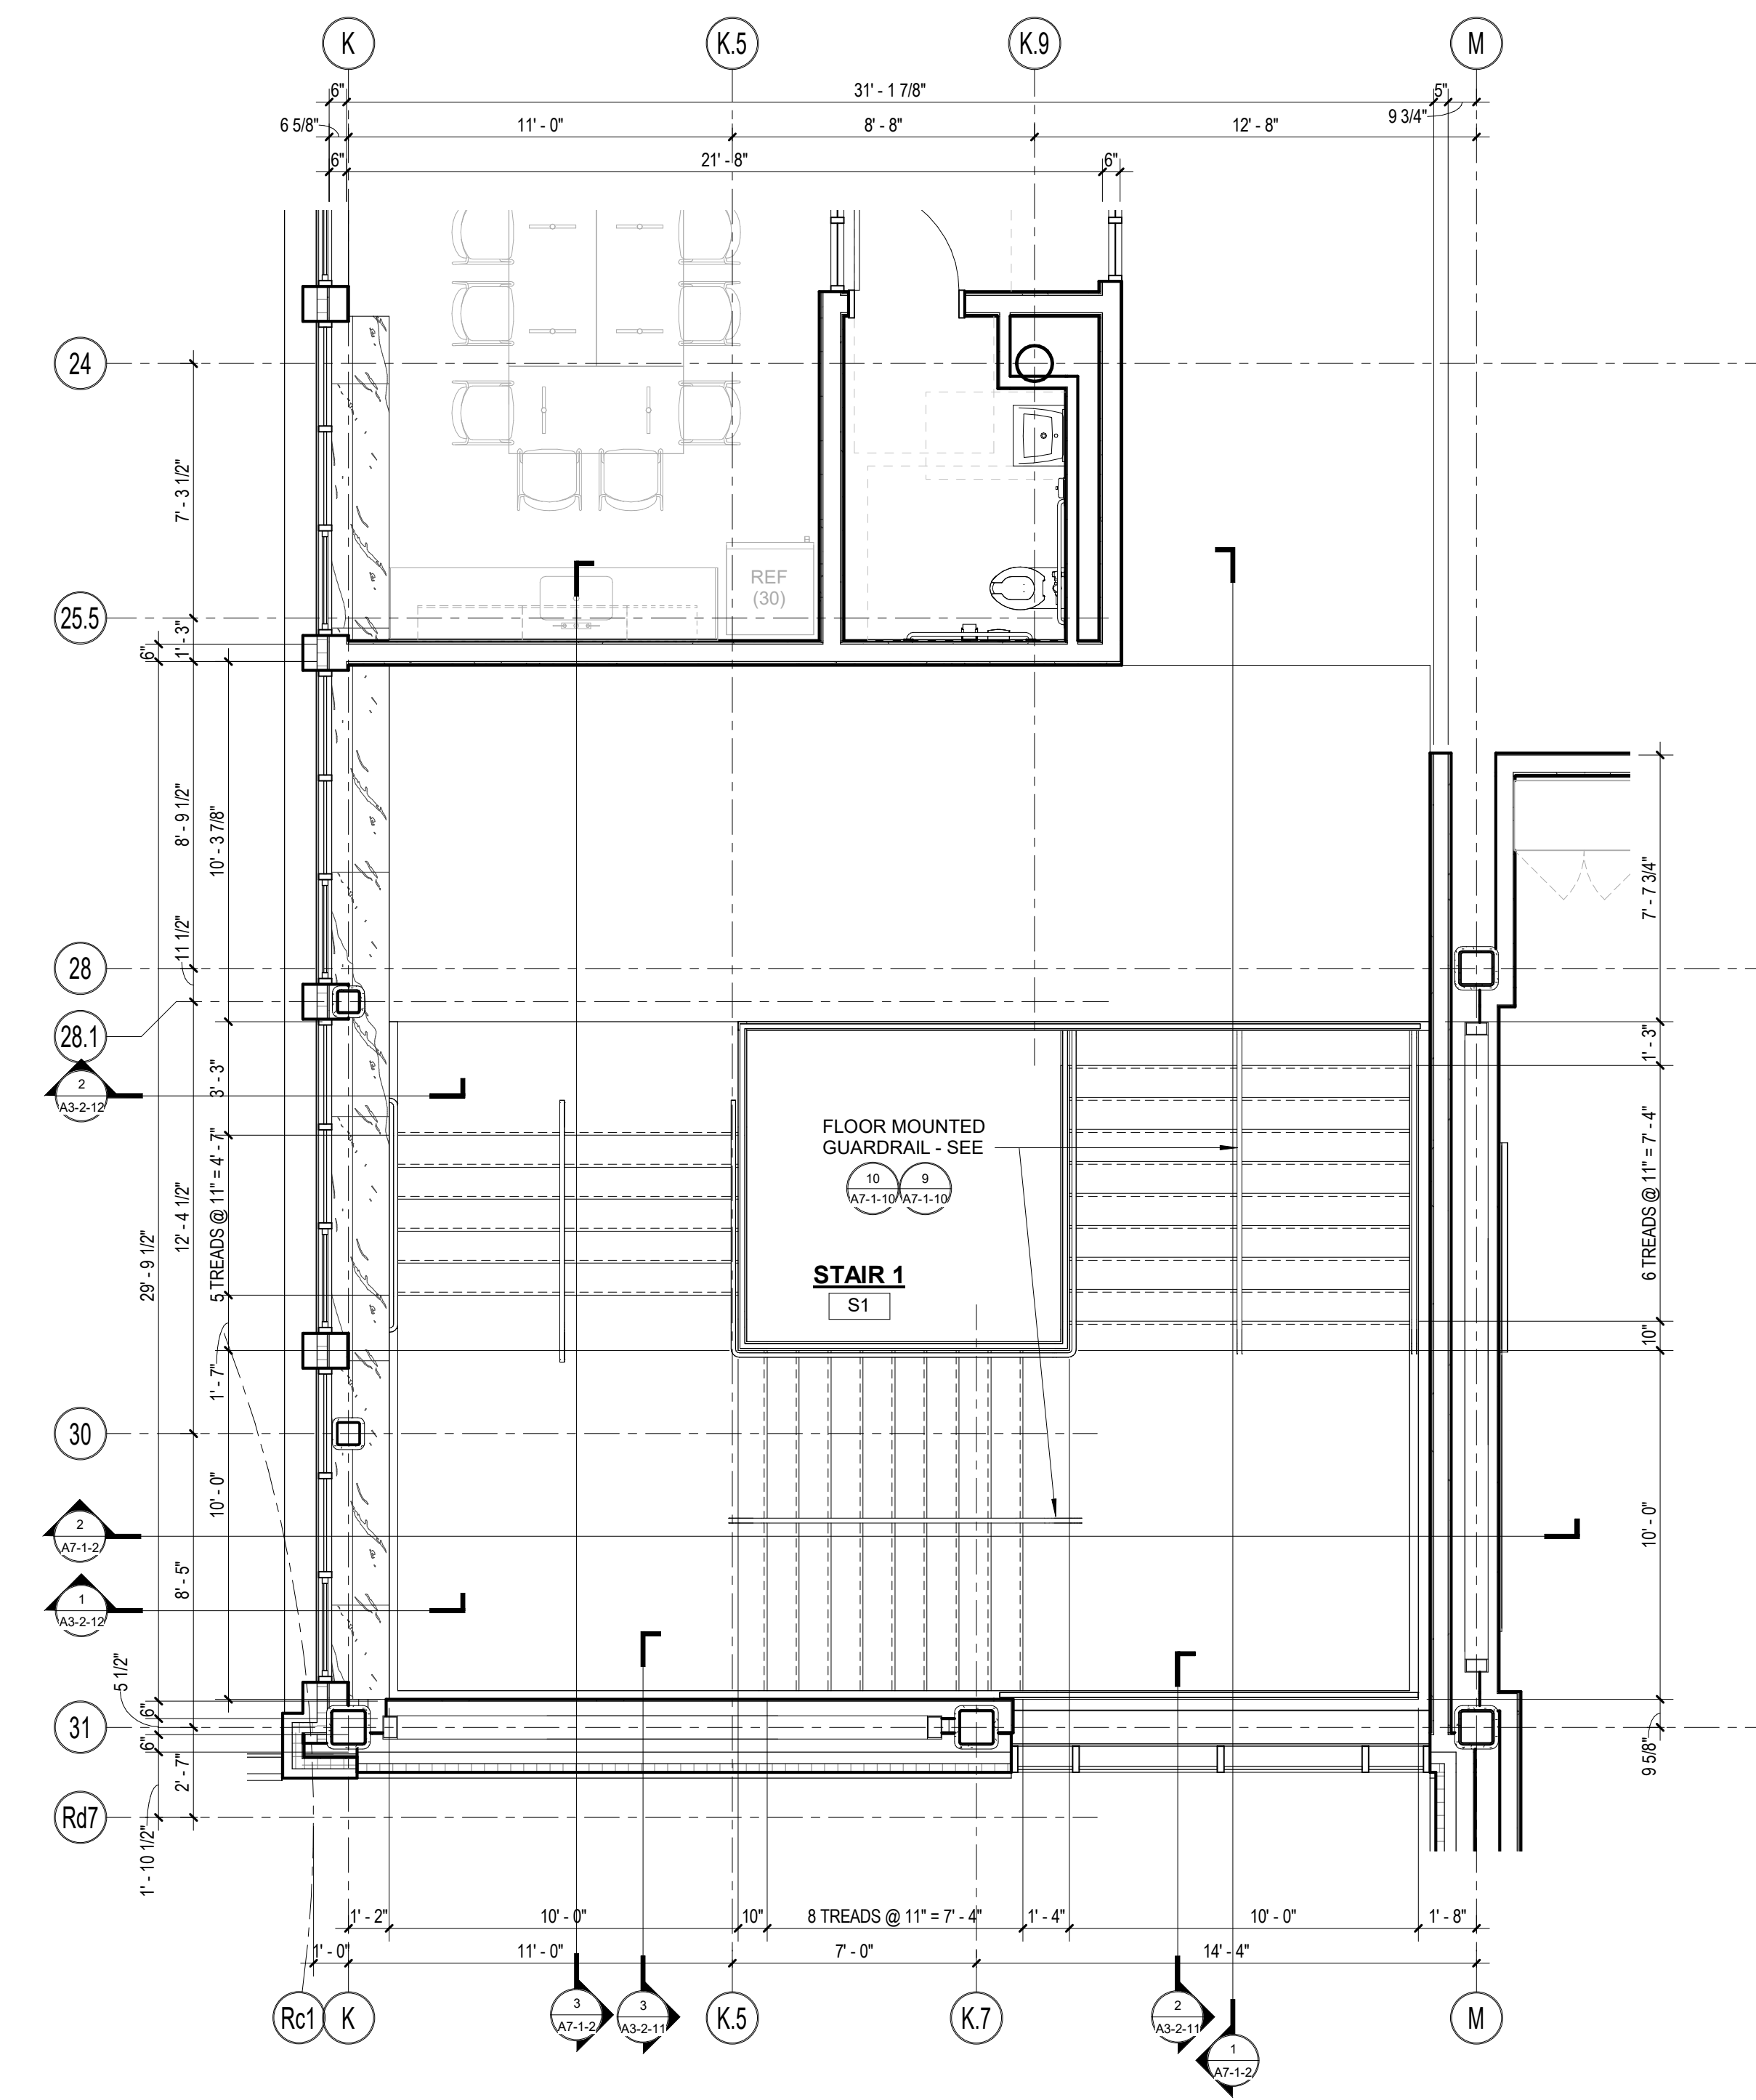

4 STAIR #1 PLAN - FORTH FLOOR
1/4" = 1'-0"

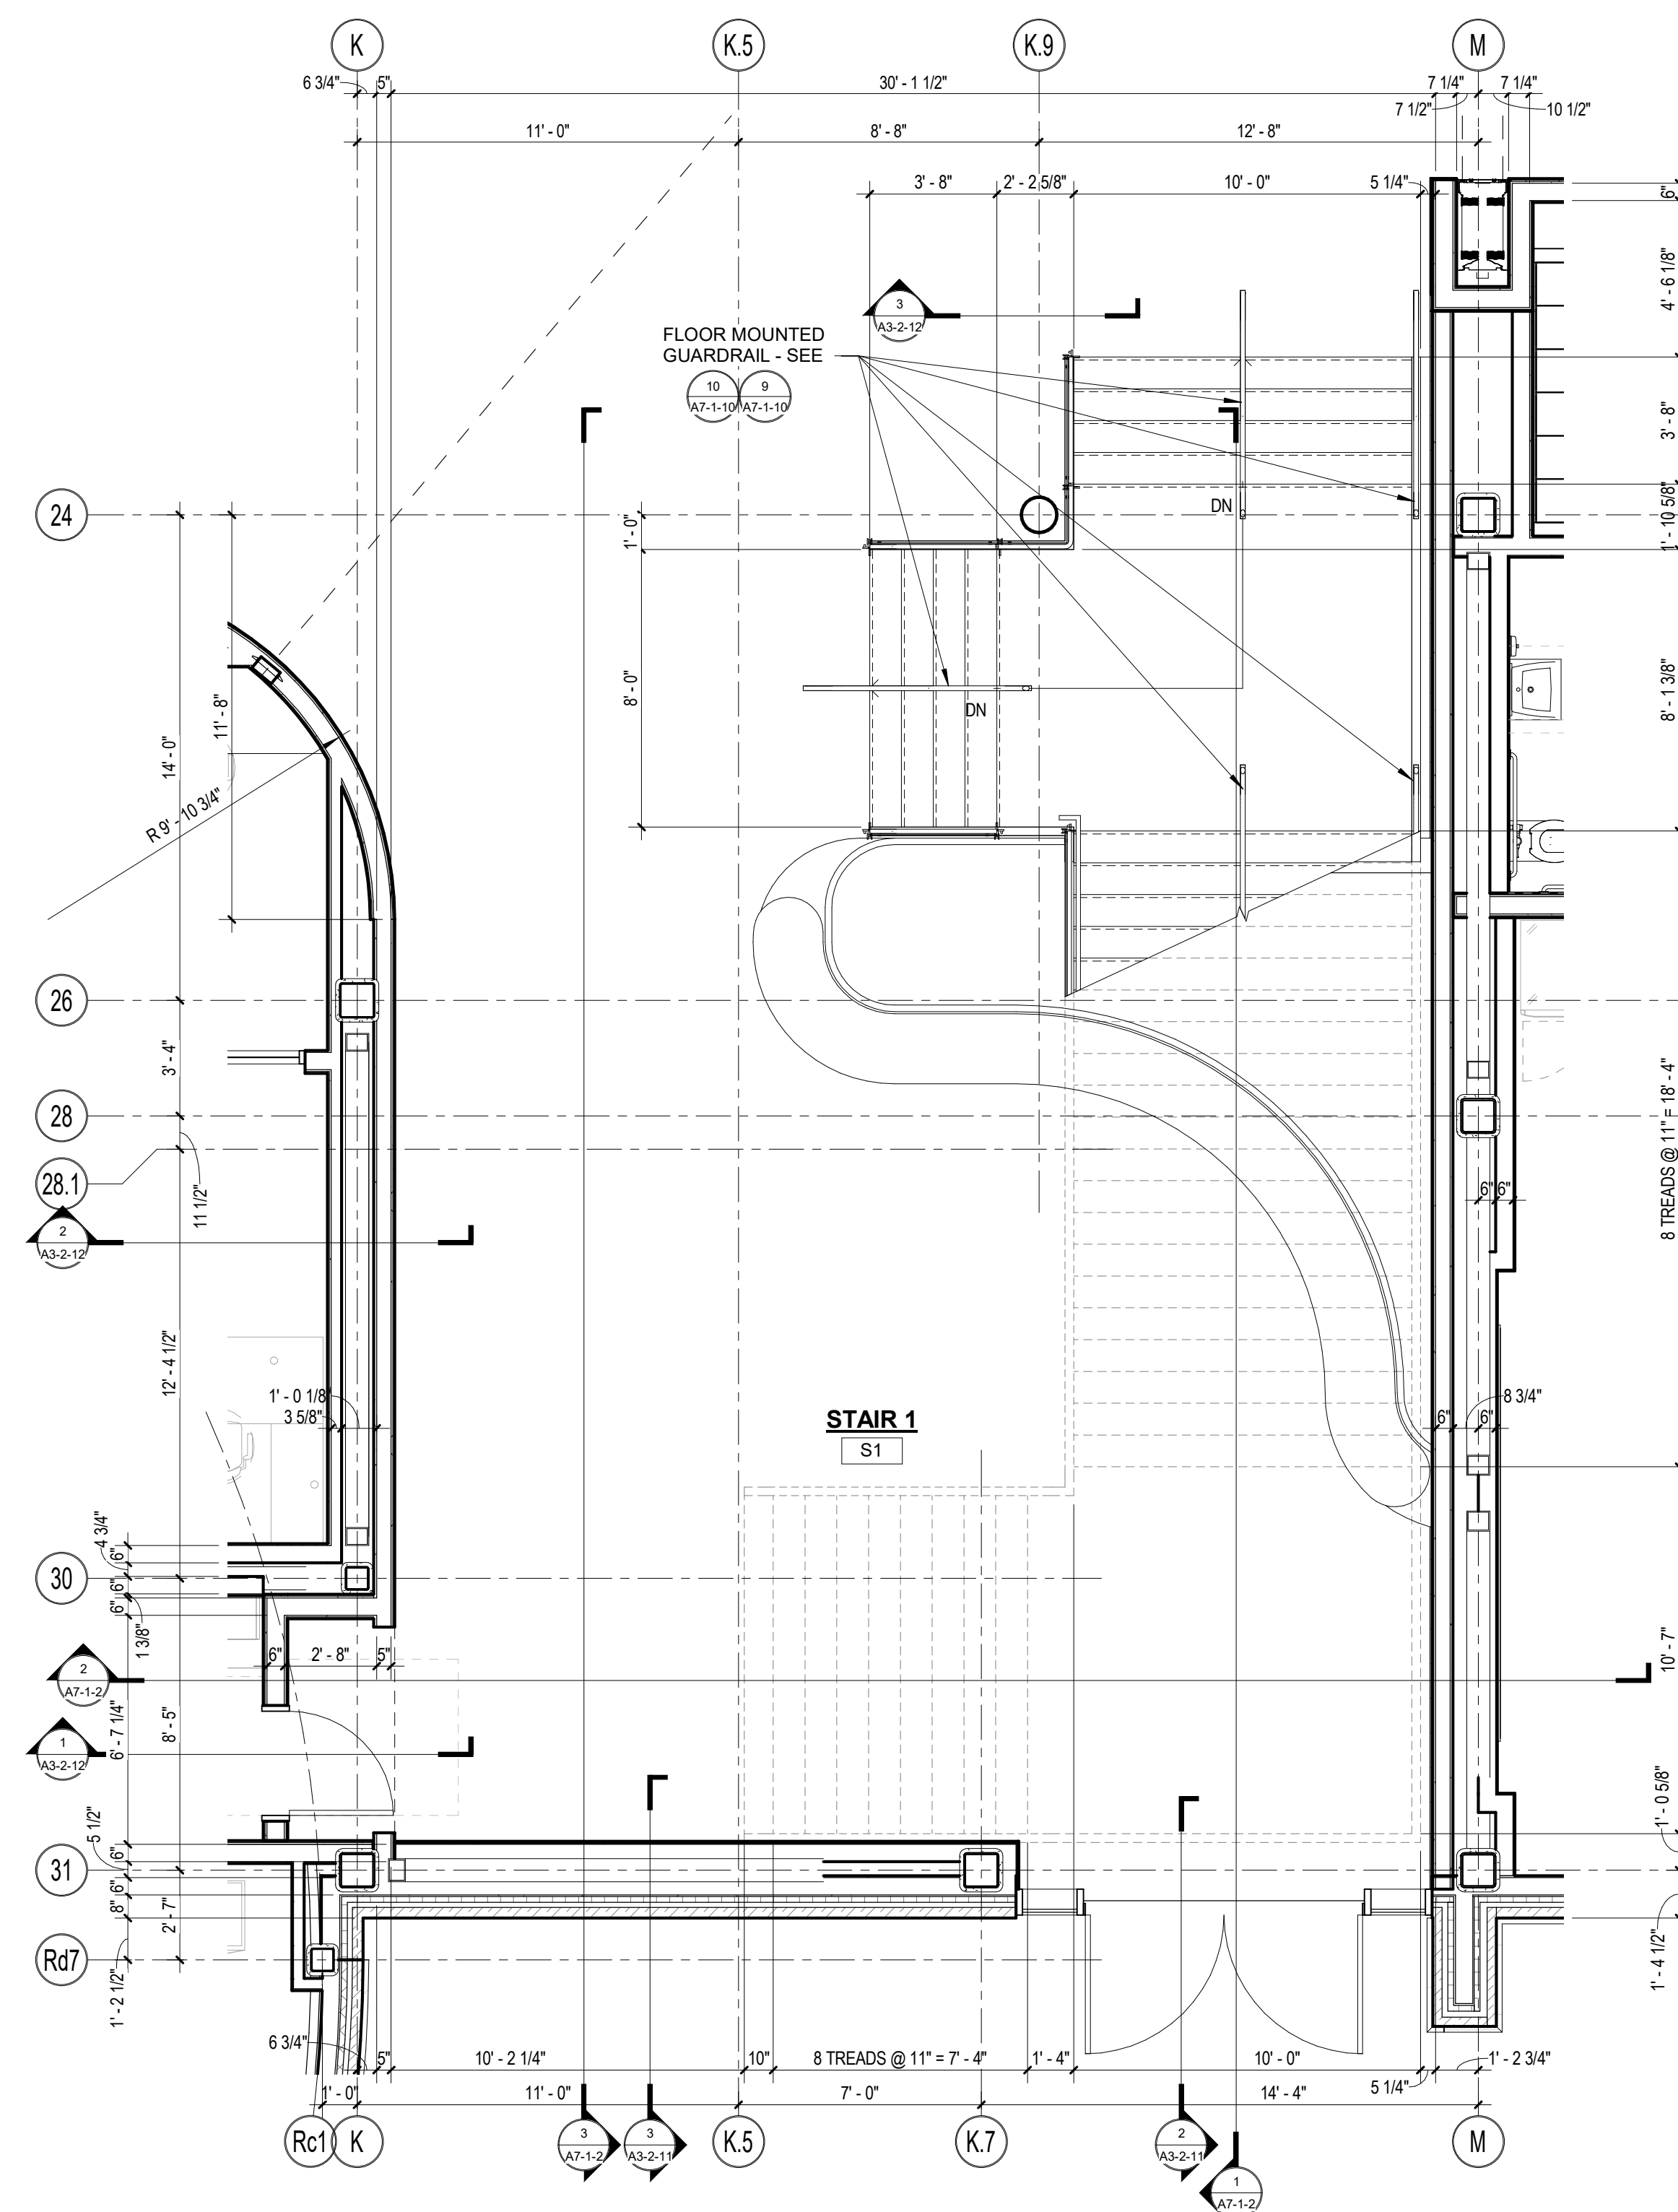

1 STAIR #1 PLAN - FIRST FLOOR
1/4" = 1'-0"

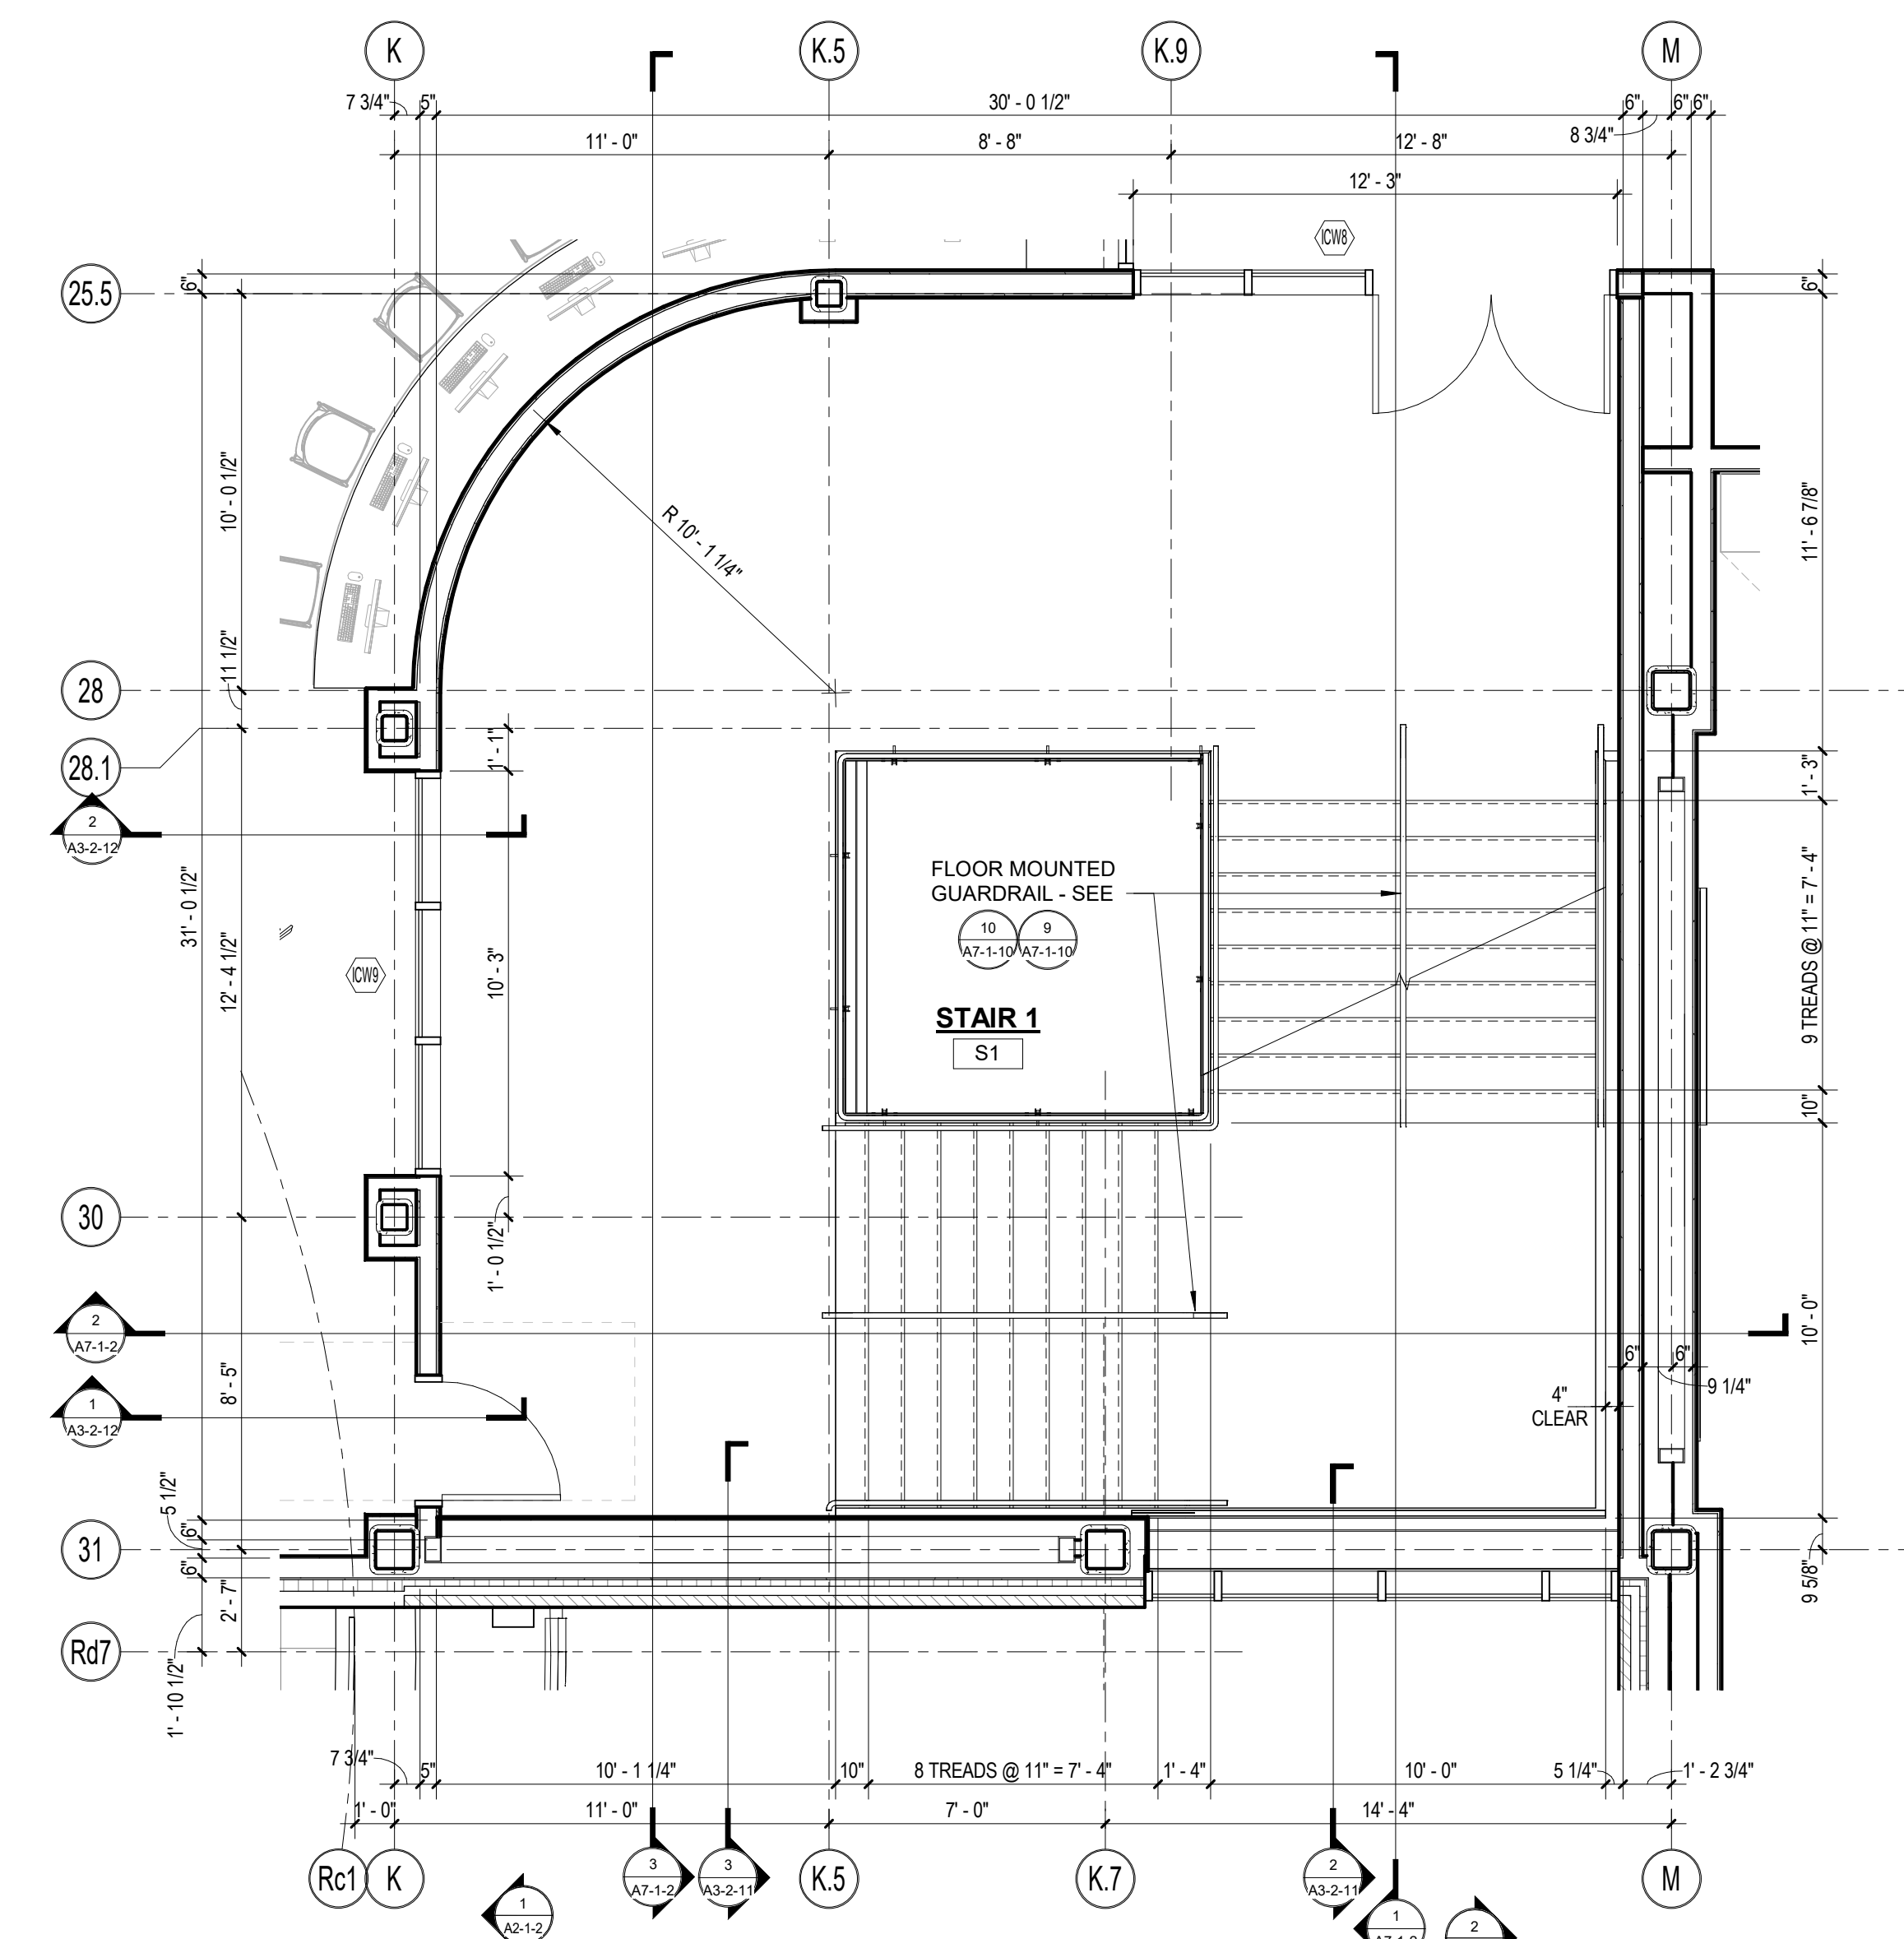


2 STAIR #1 PLAN - SECOND FLOOR
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

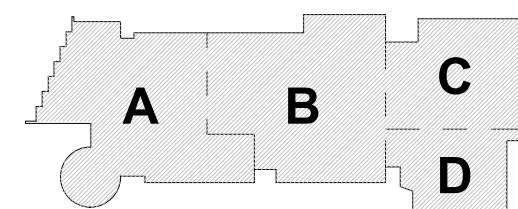


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



STAIR PLANS

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A7-1-1

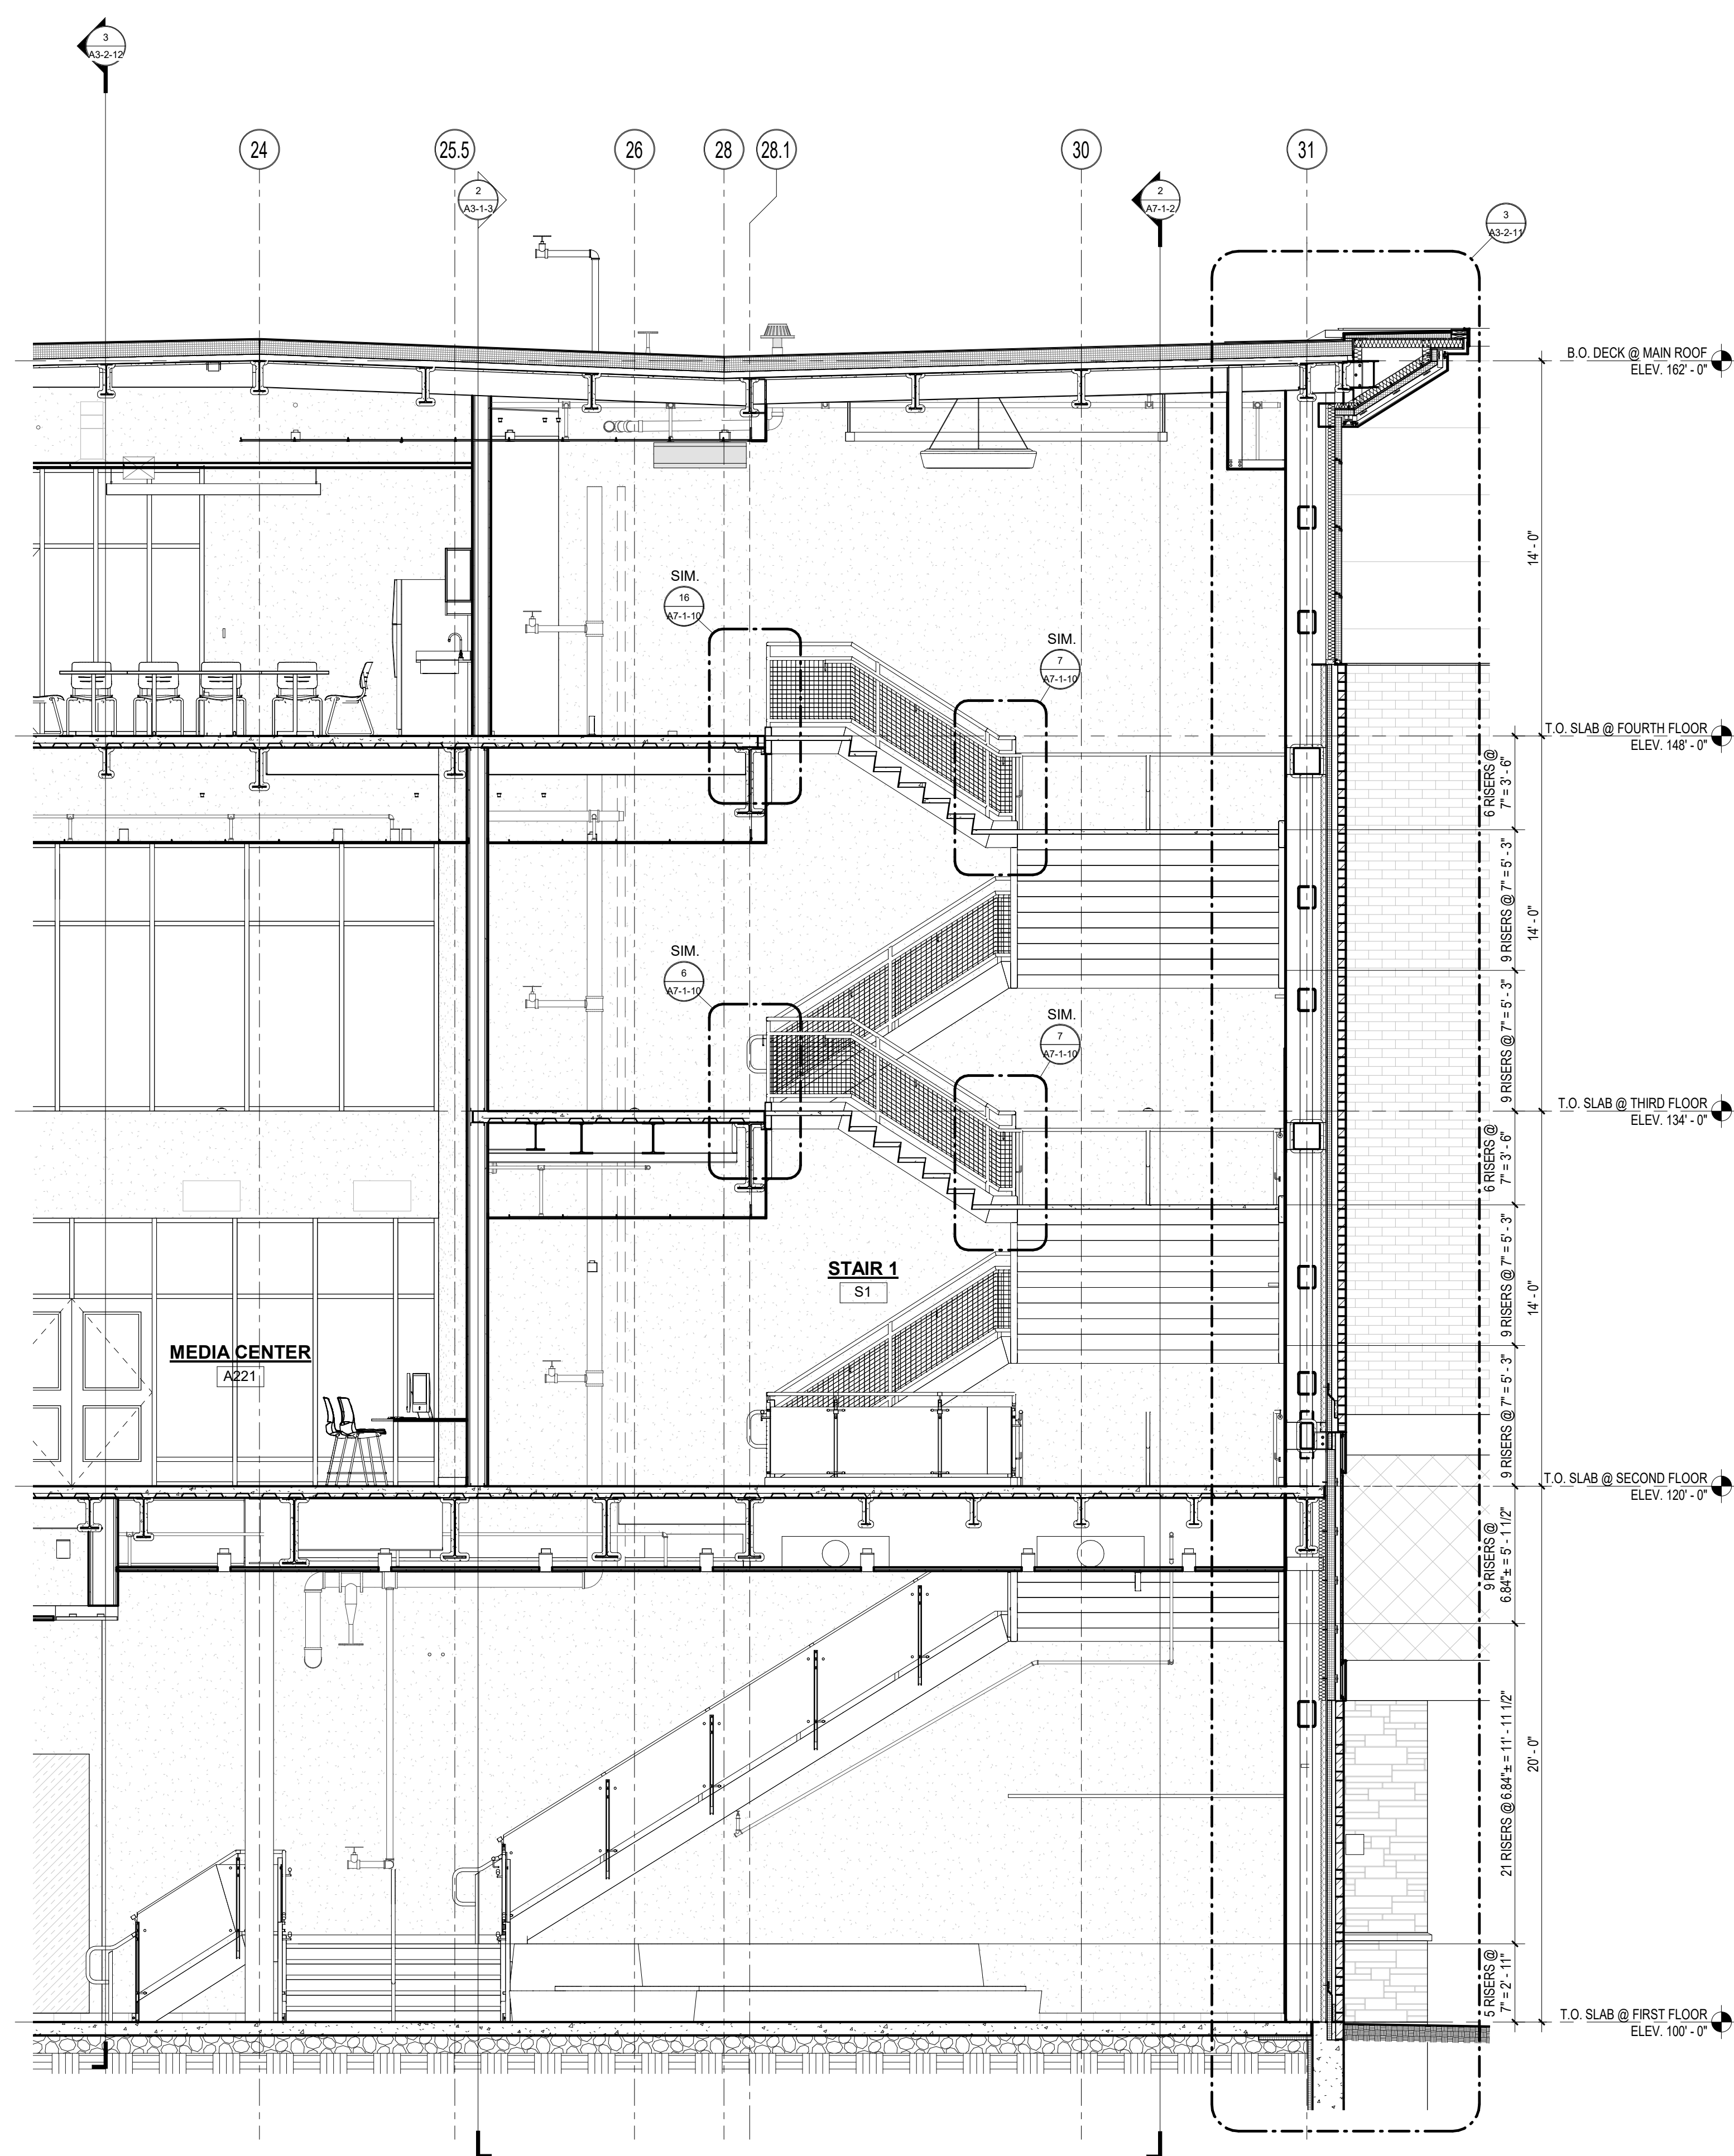

3 STAIR #1 SECTION 3
1/4" = 1'-0"

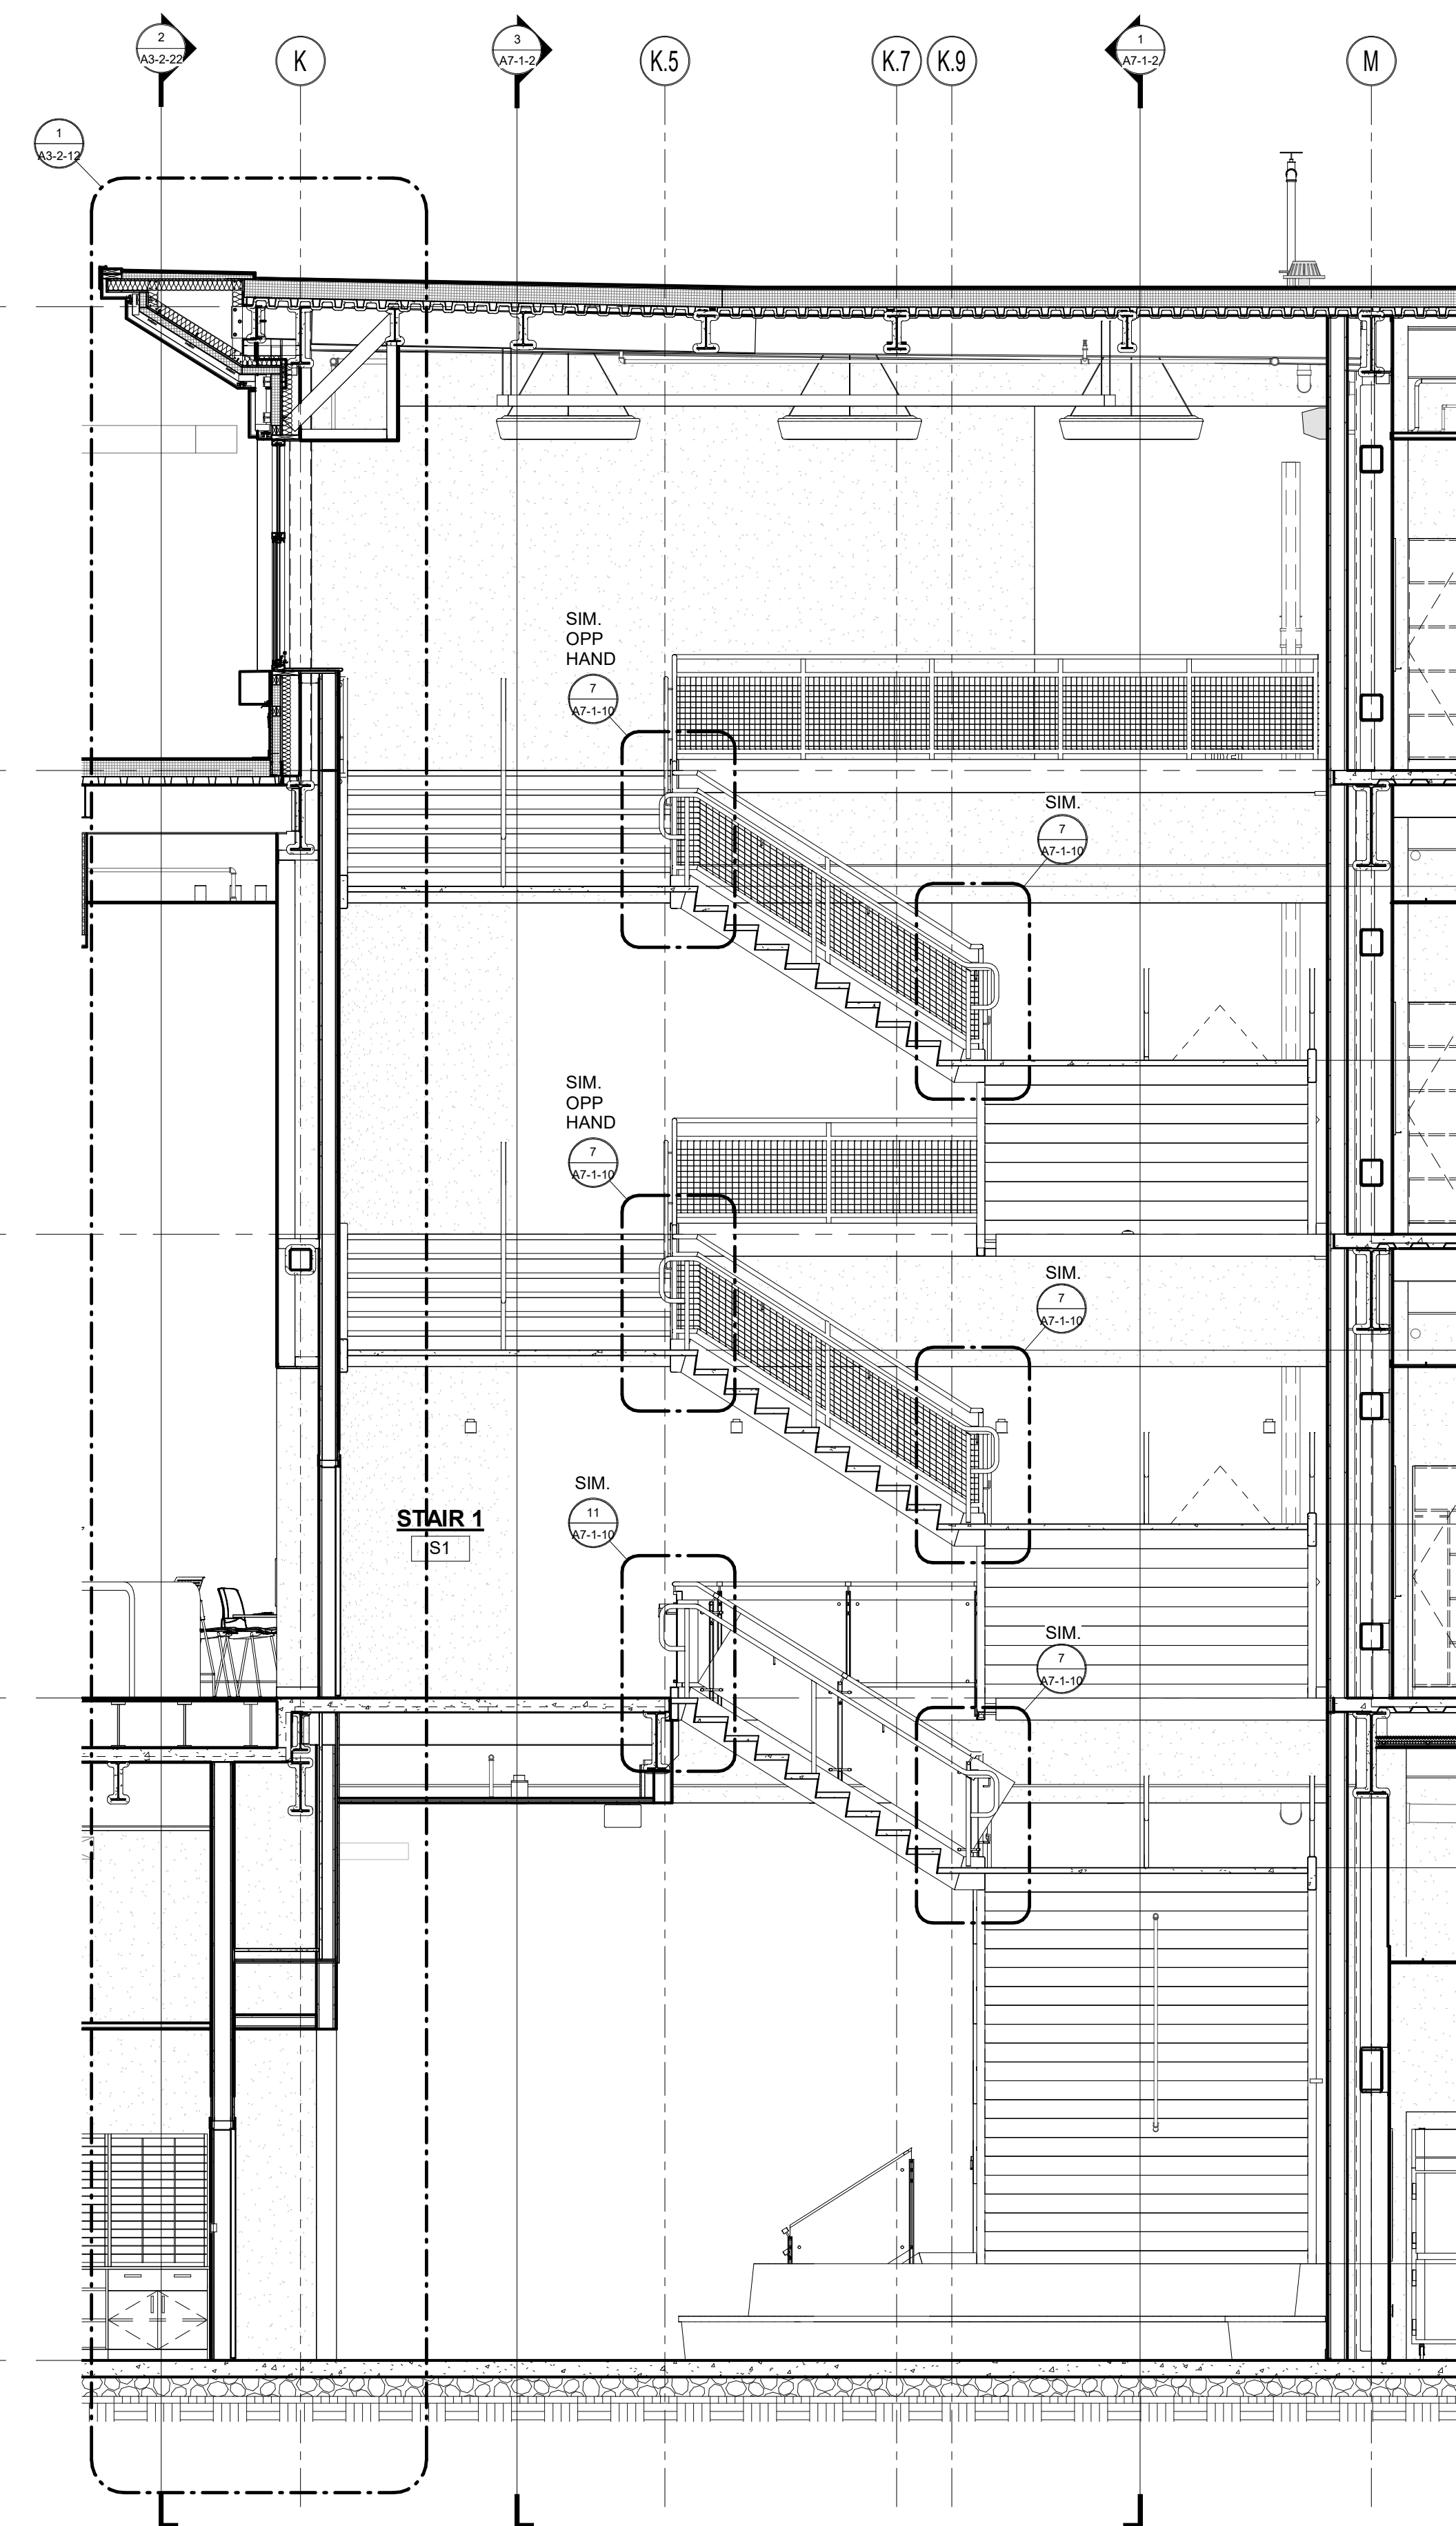


2 STAIR #1 SECTION 2
1/4" = 1'-0"

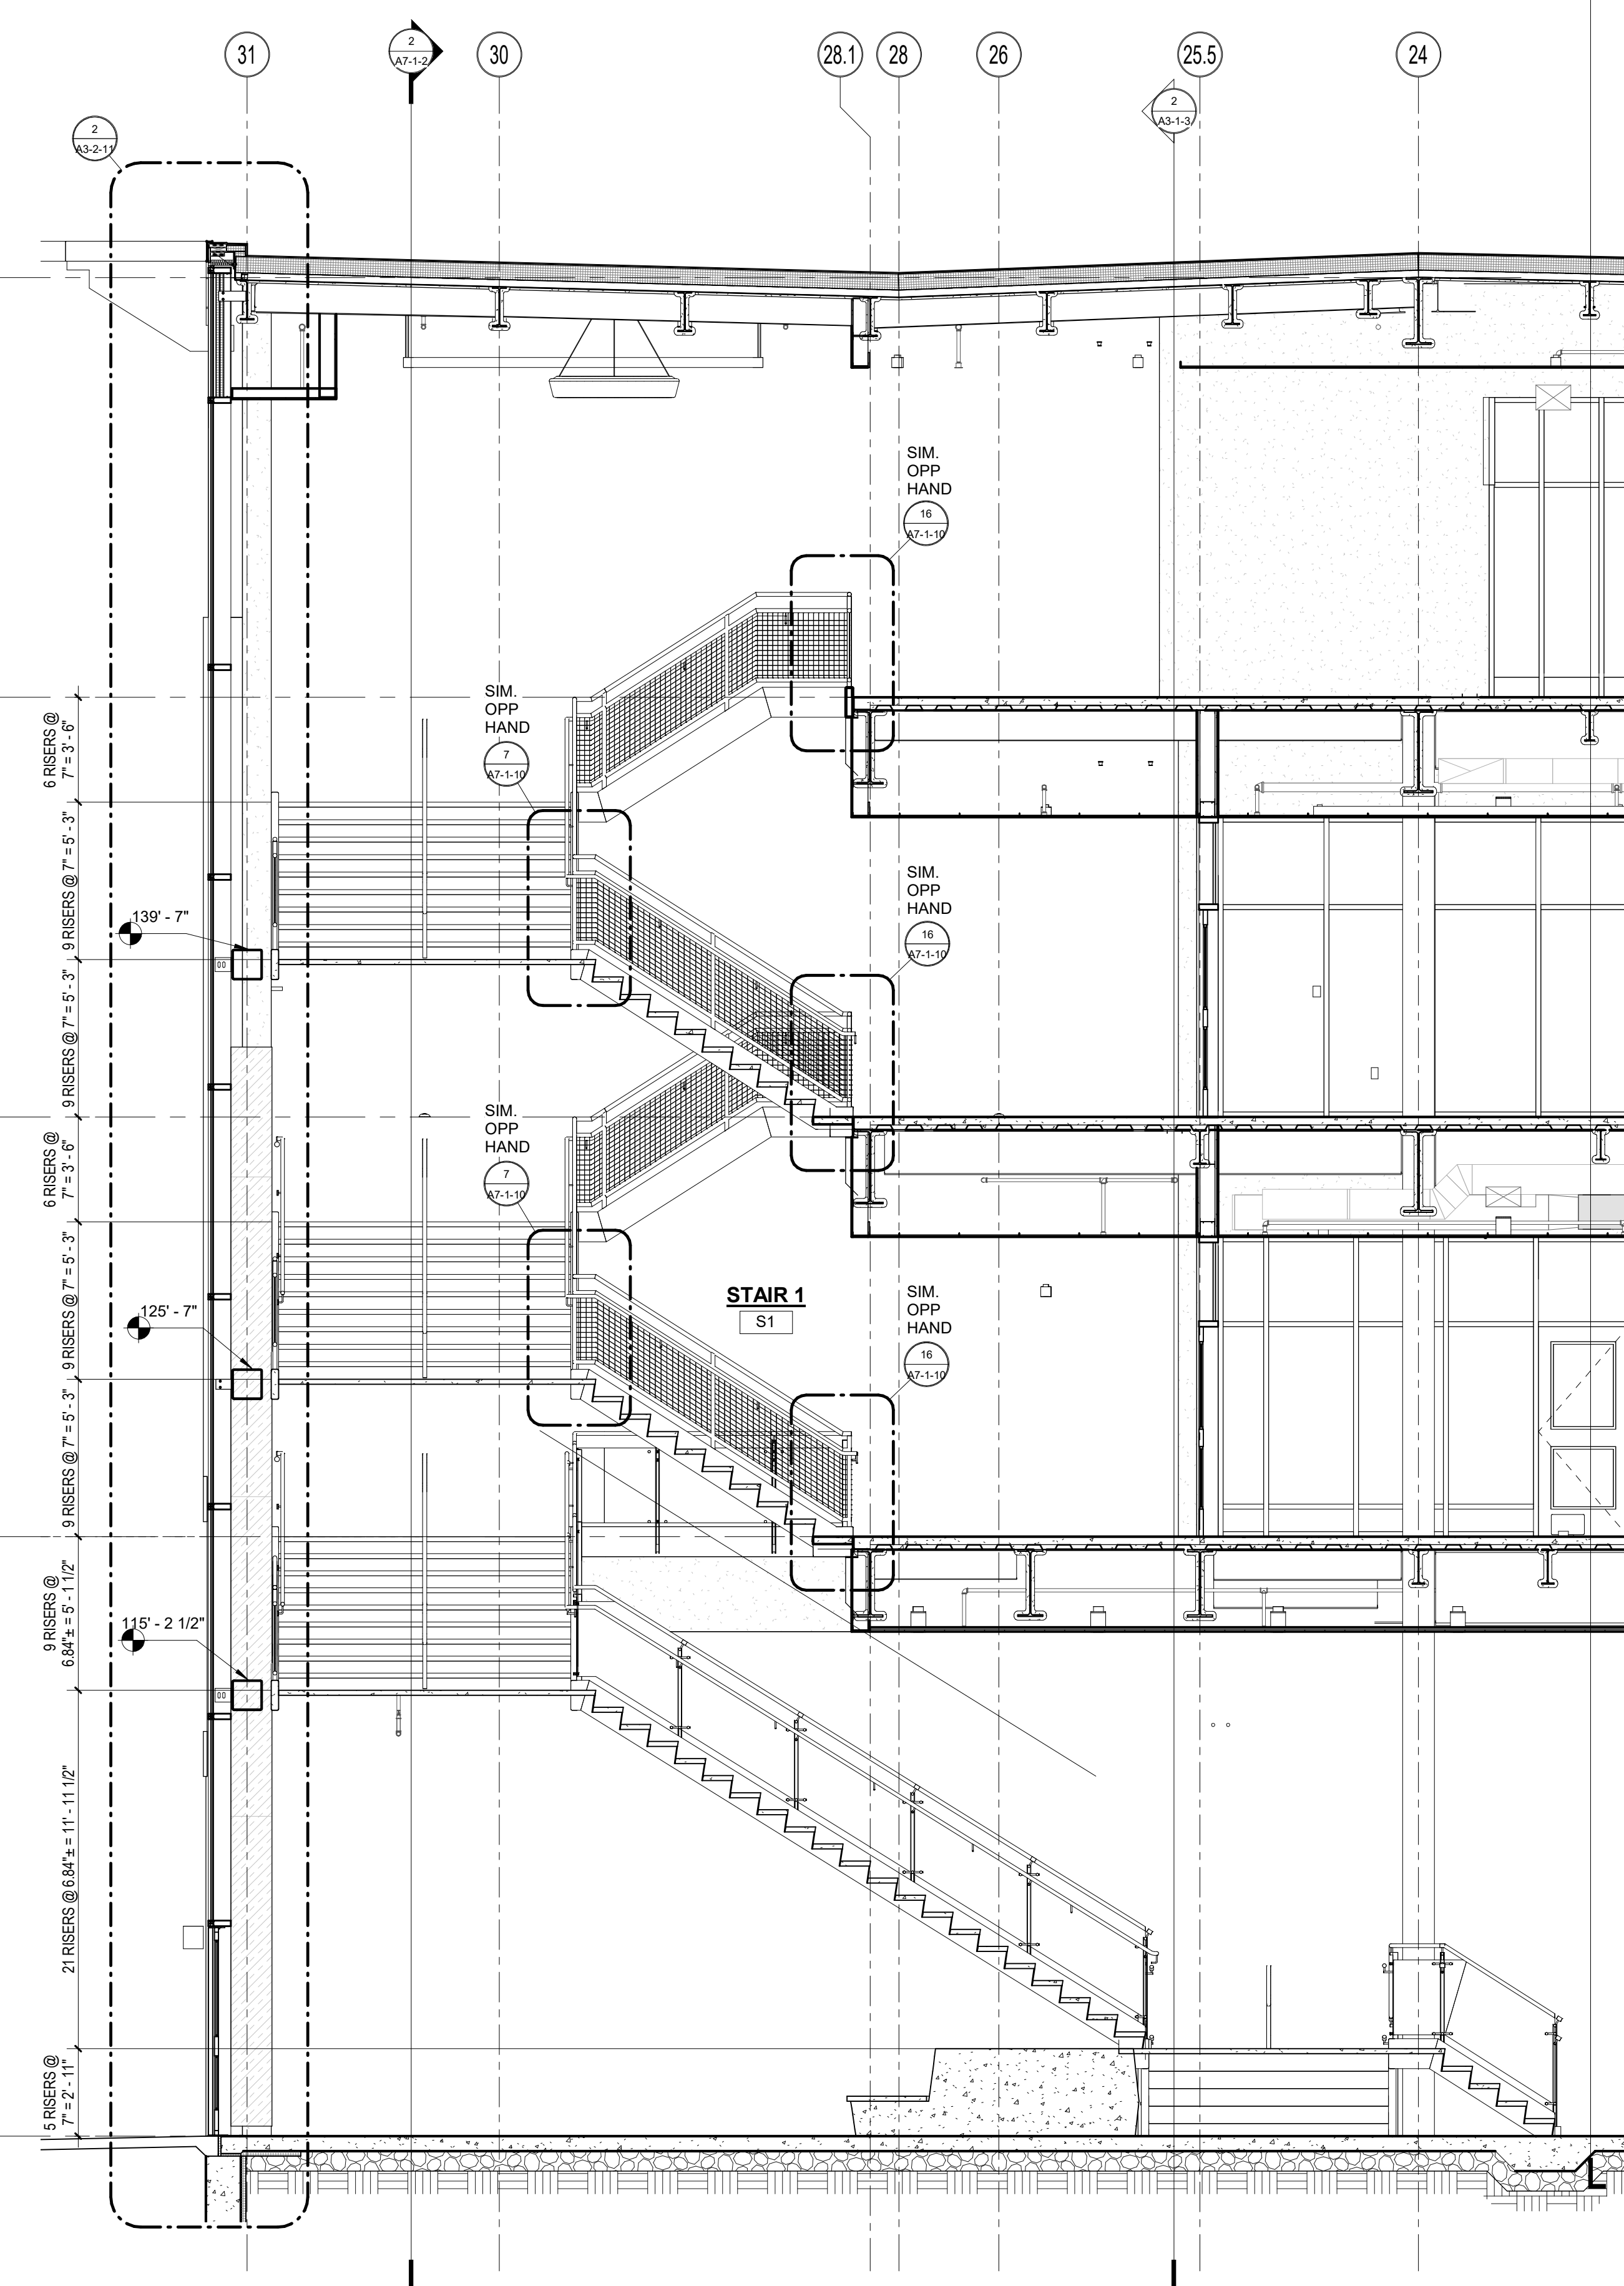

1 STAIR #1 SECTION 1
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

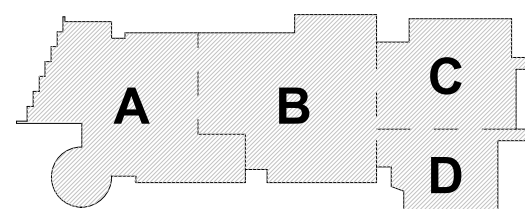

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

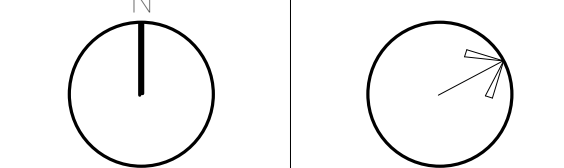

STAIR SECTIONS

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A7-1-2

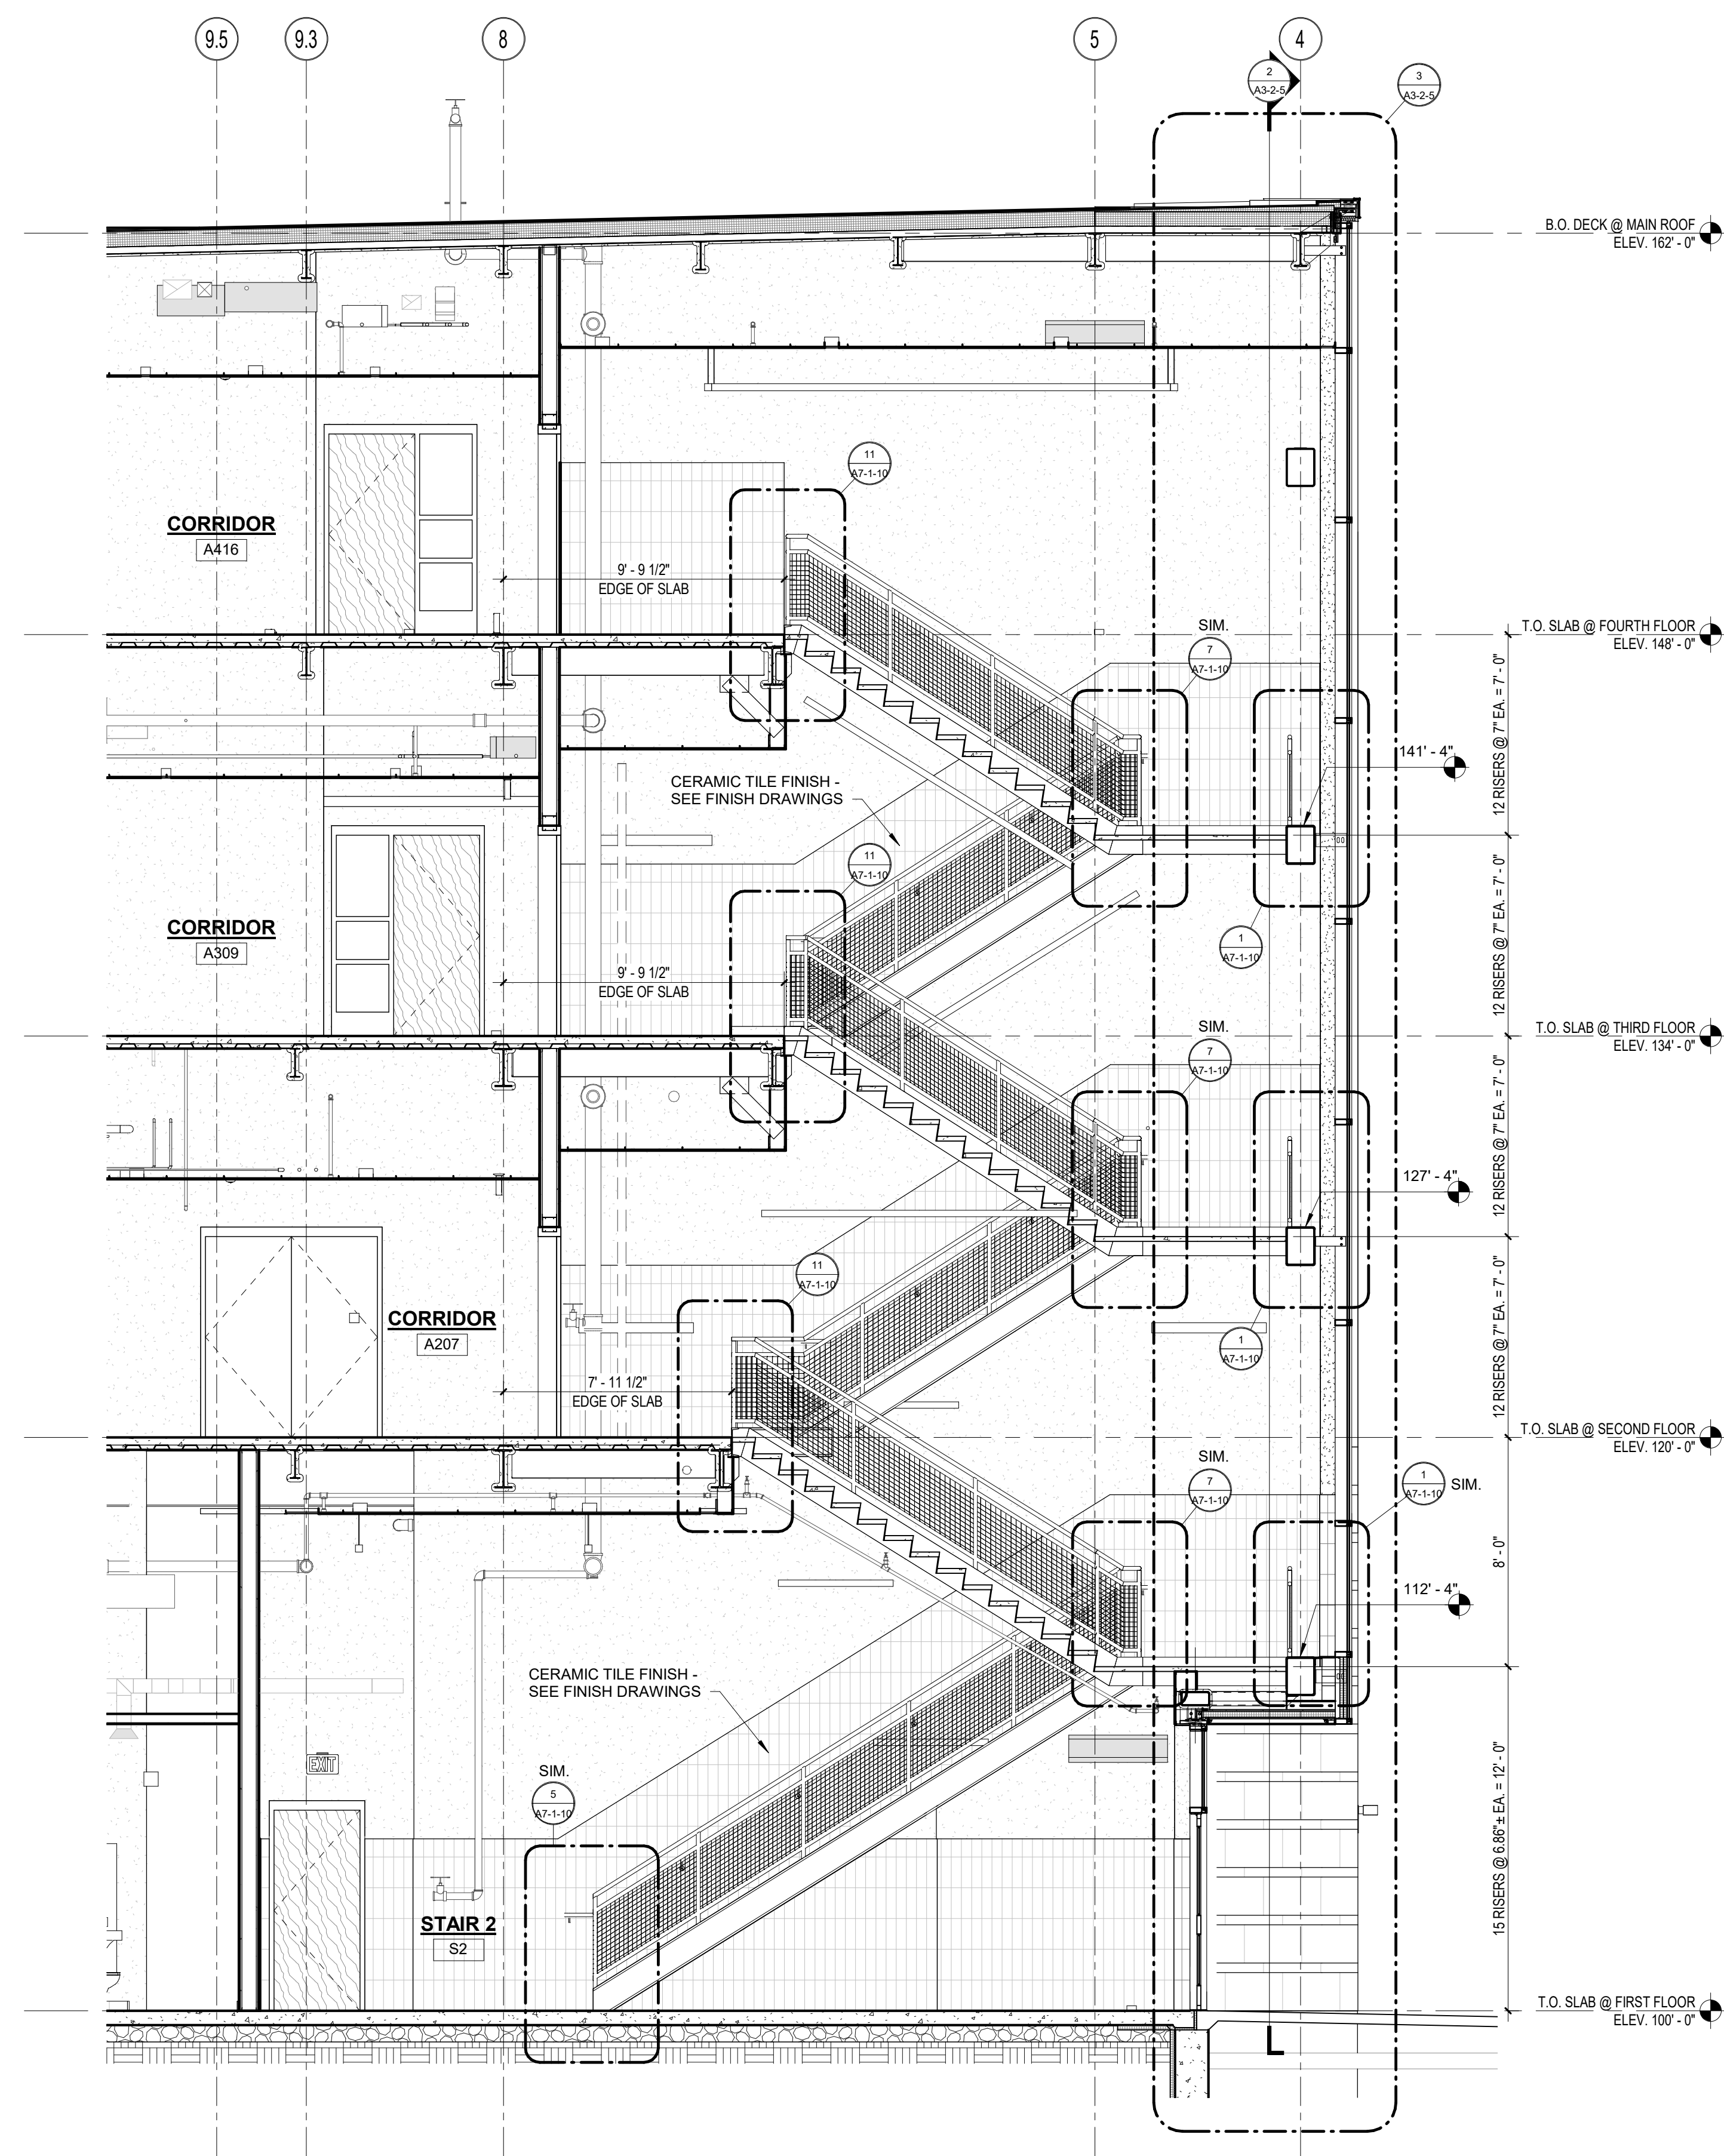


1 STAIR #2 SECTION
1/4" = 1'-0"

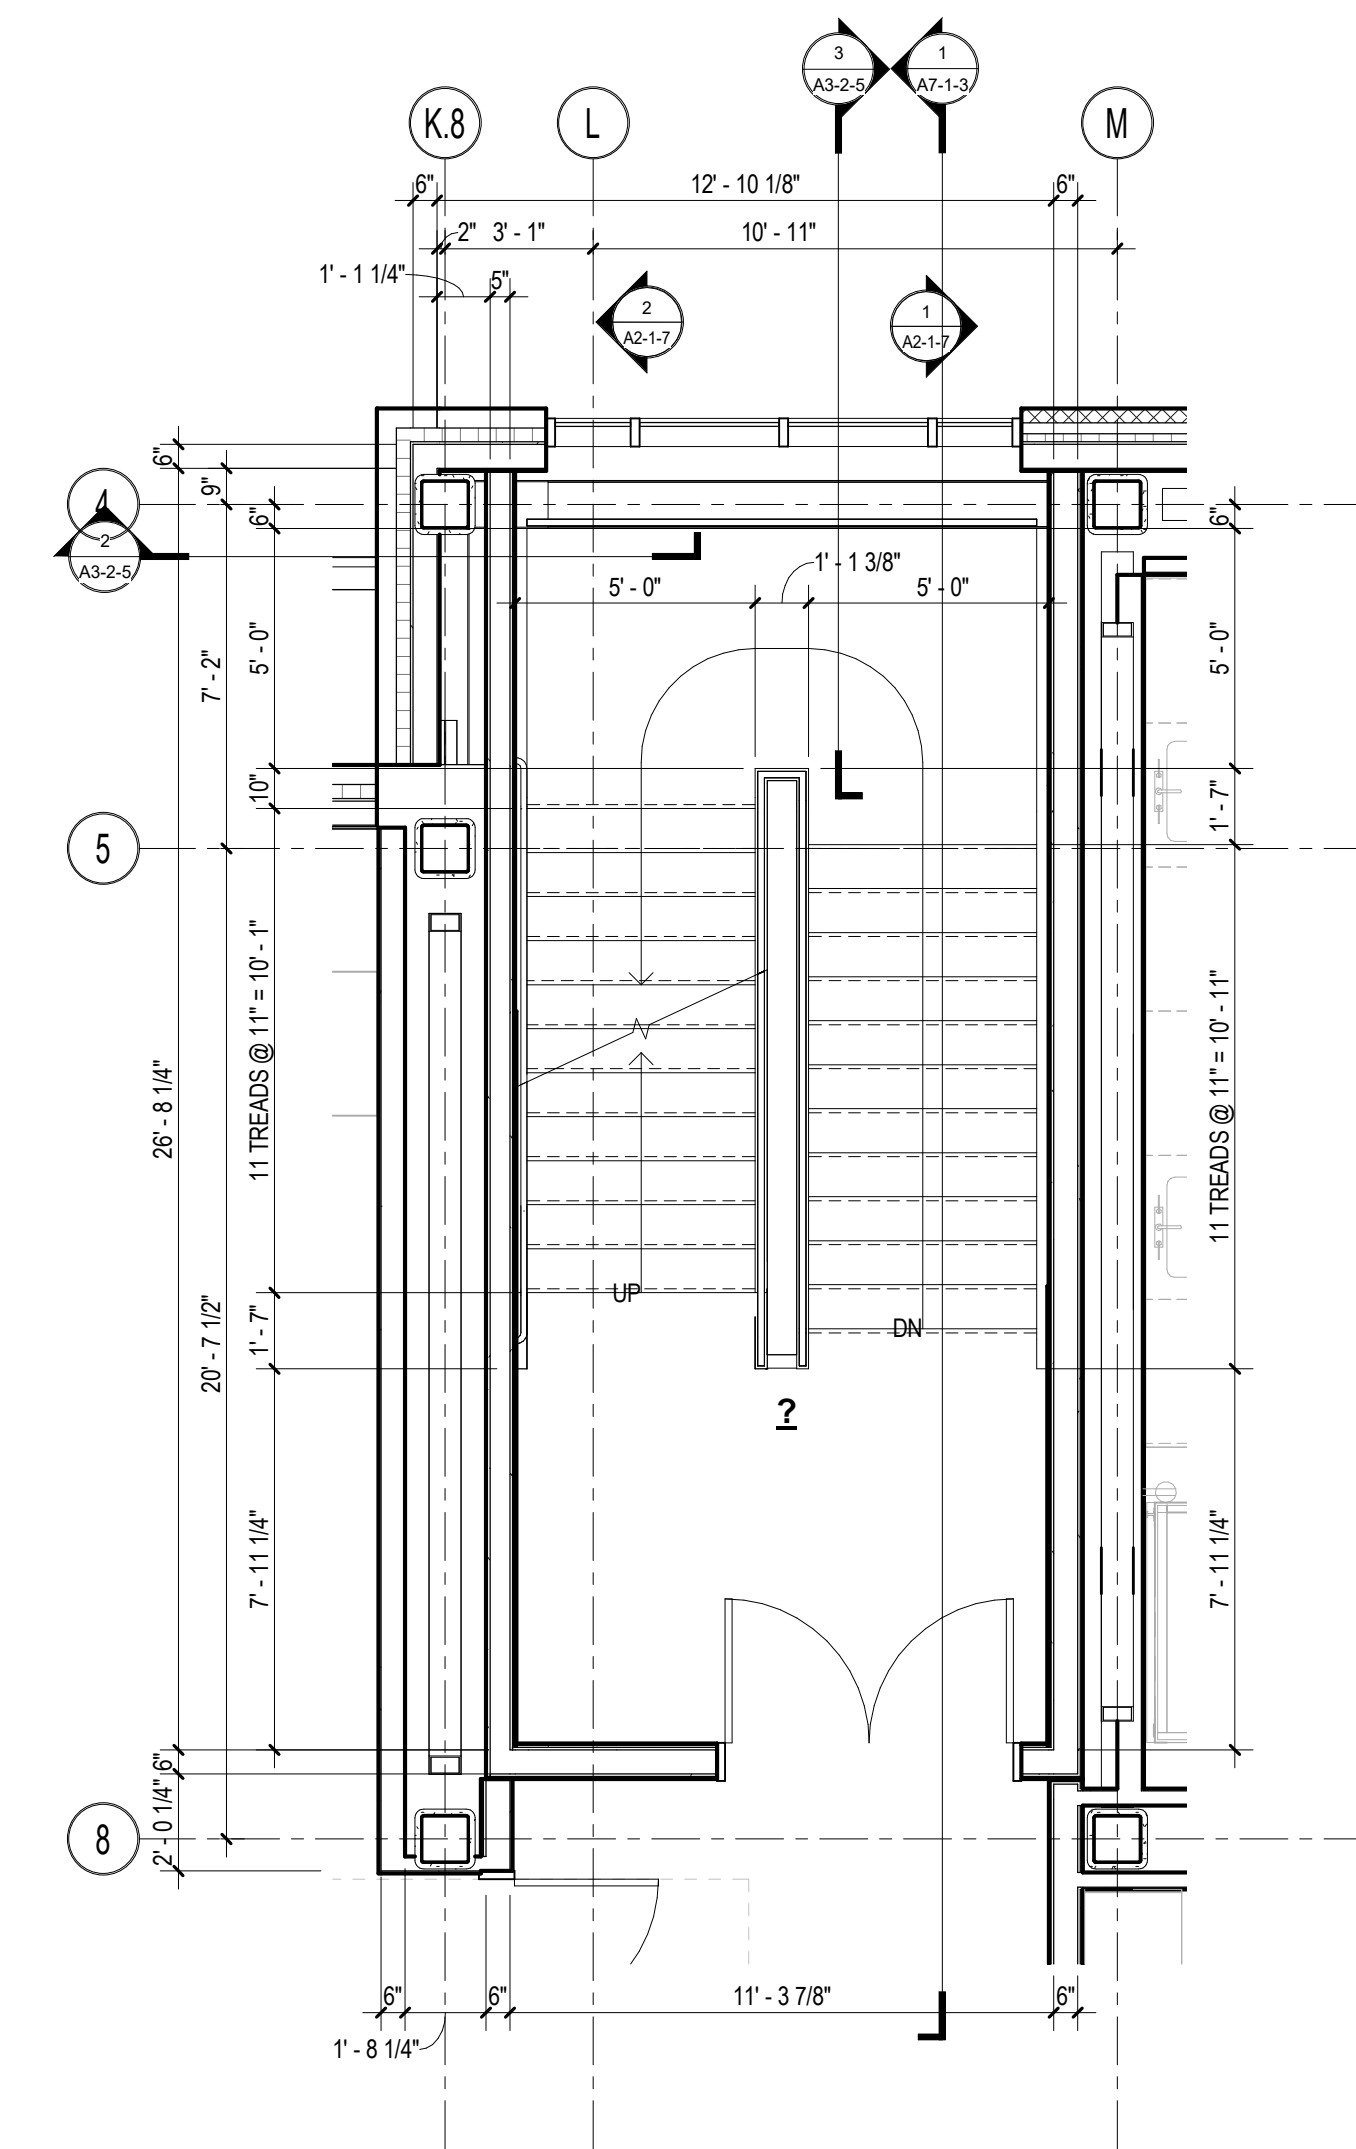


4 STAIR #2 PLAN - THIRD FLOOR
1/4" = 1'-0"

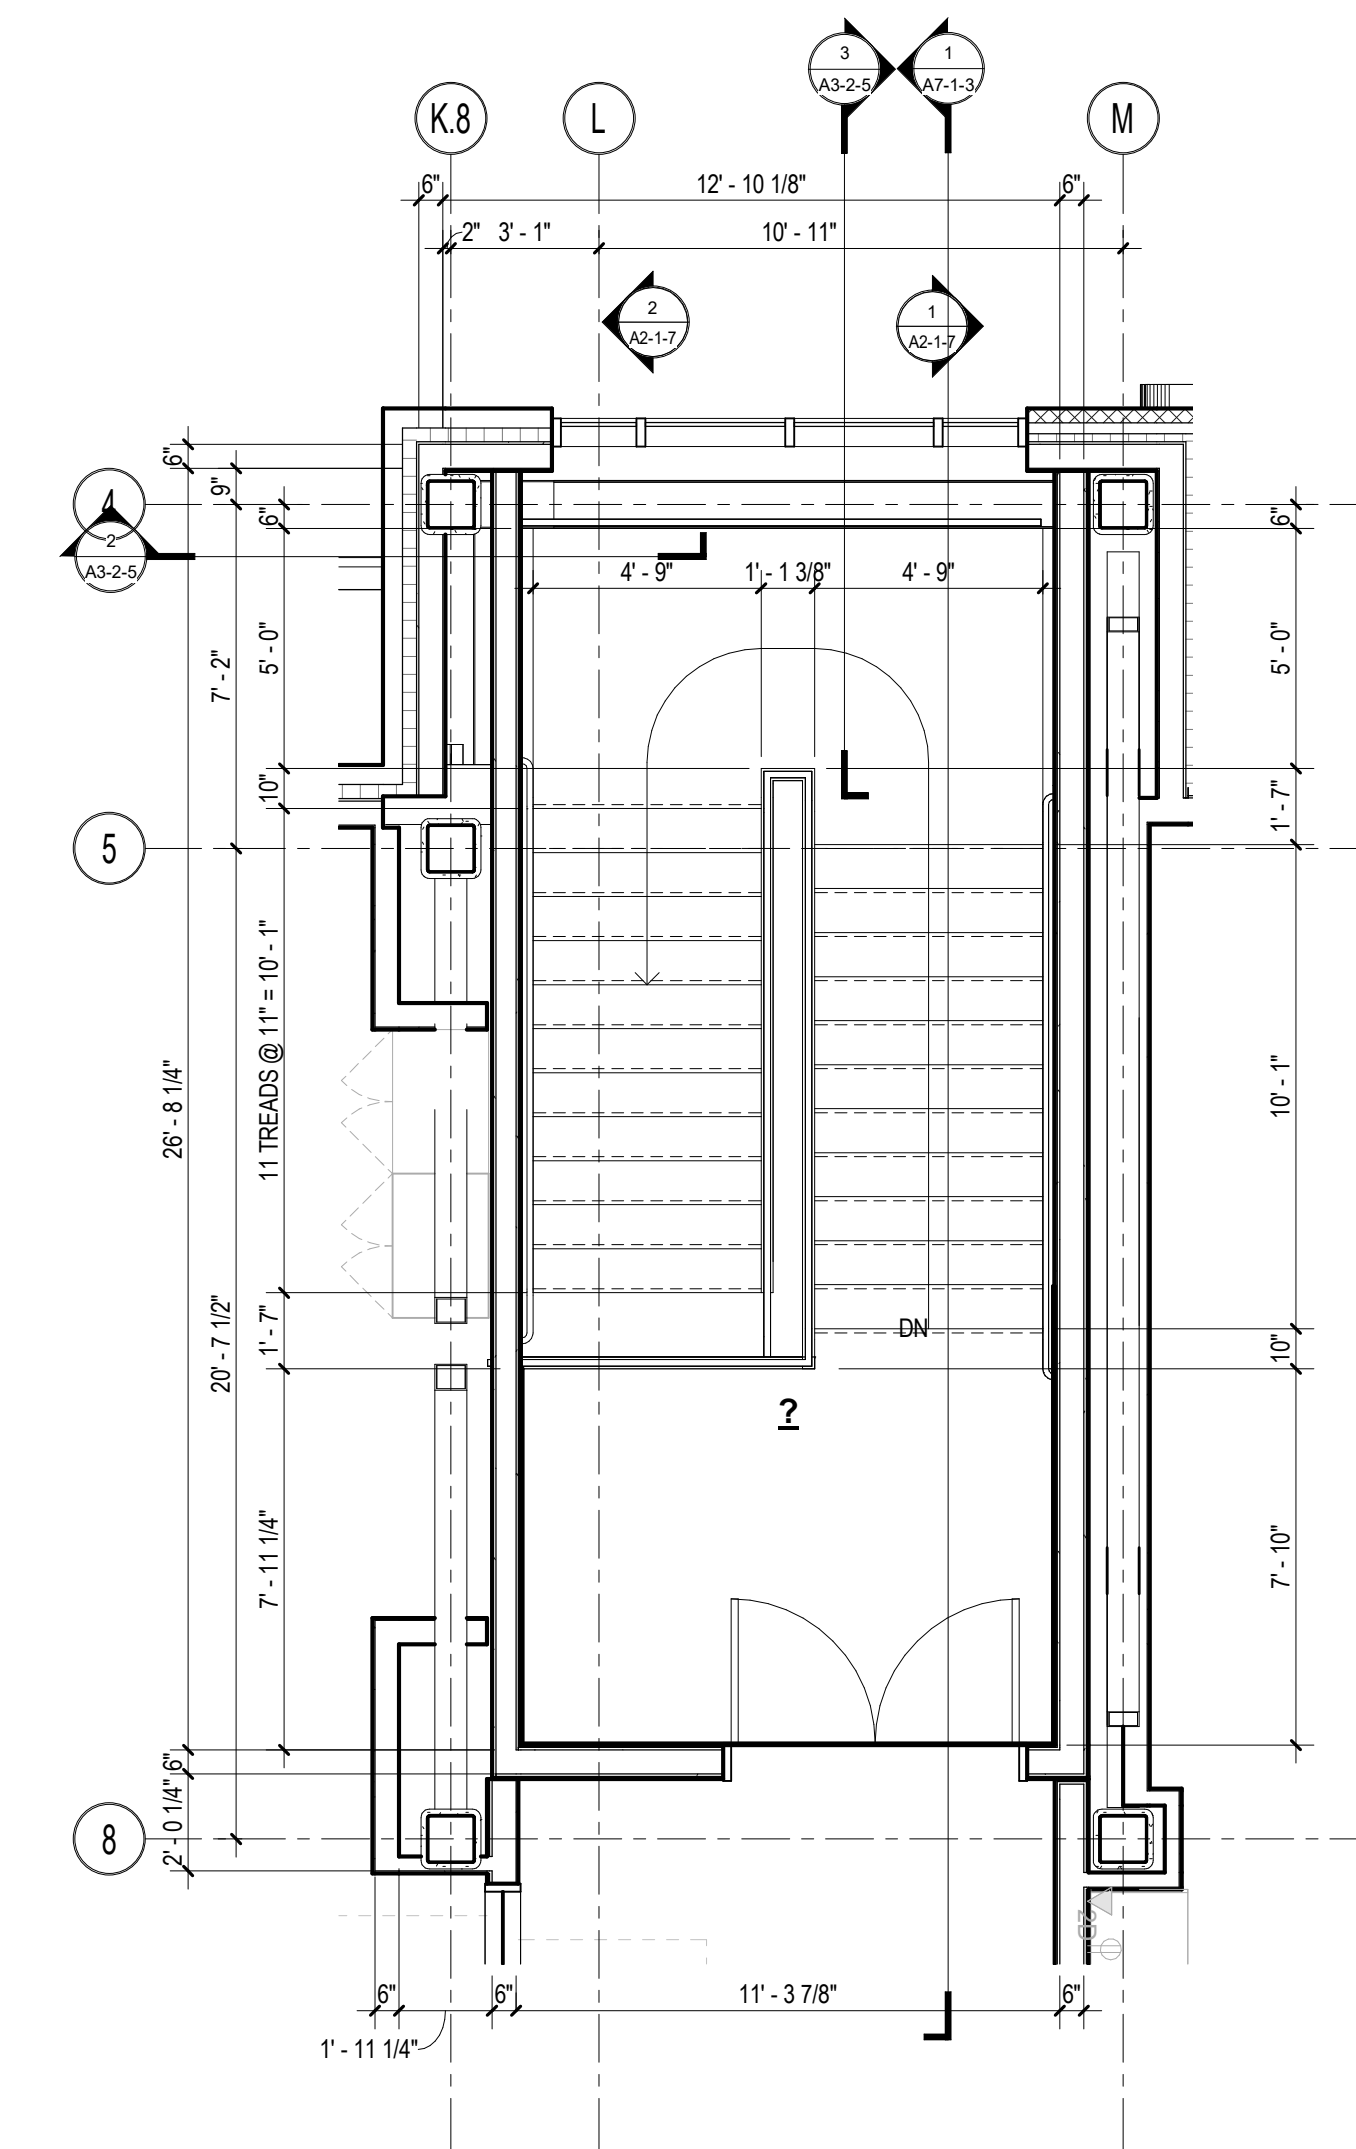

5 STAIR #2 PLAN - FOURTH FLOOR
1/4" = 1'-0"

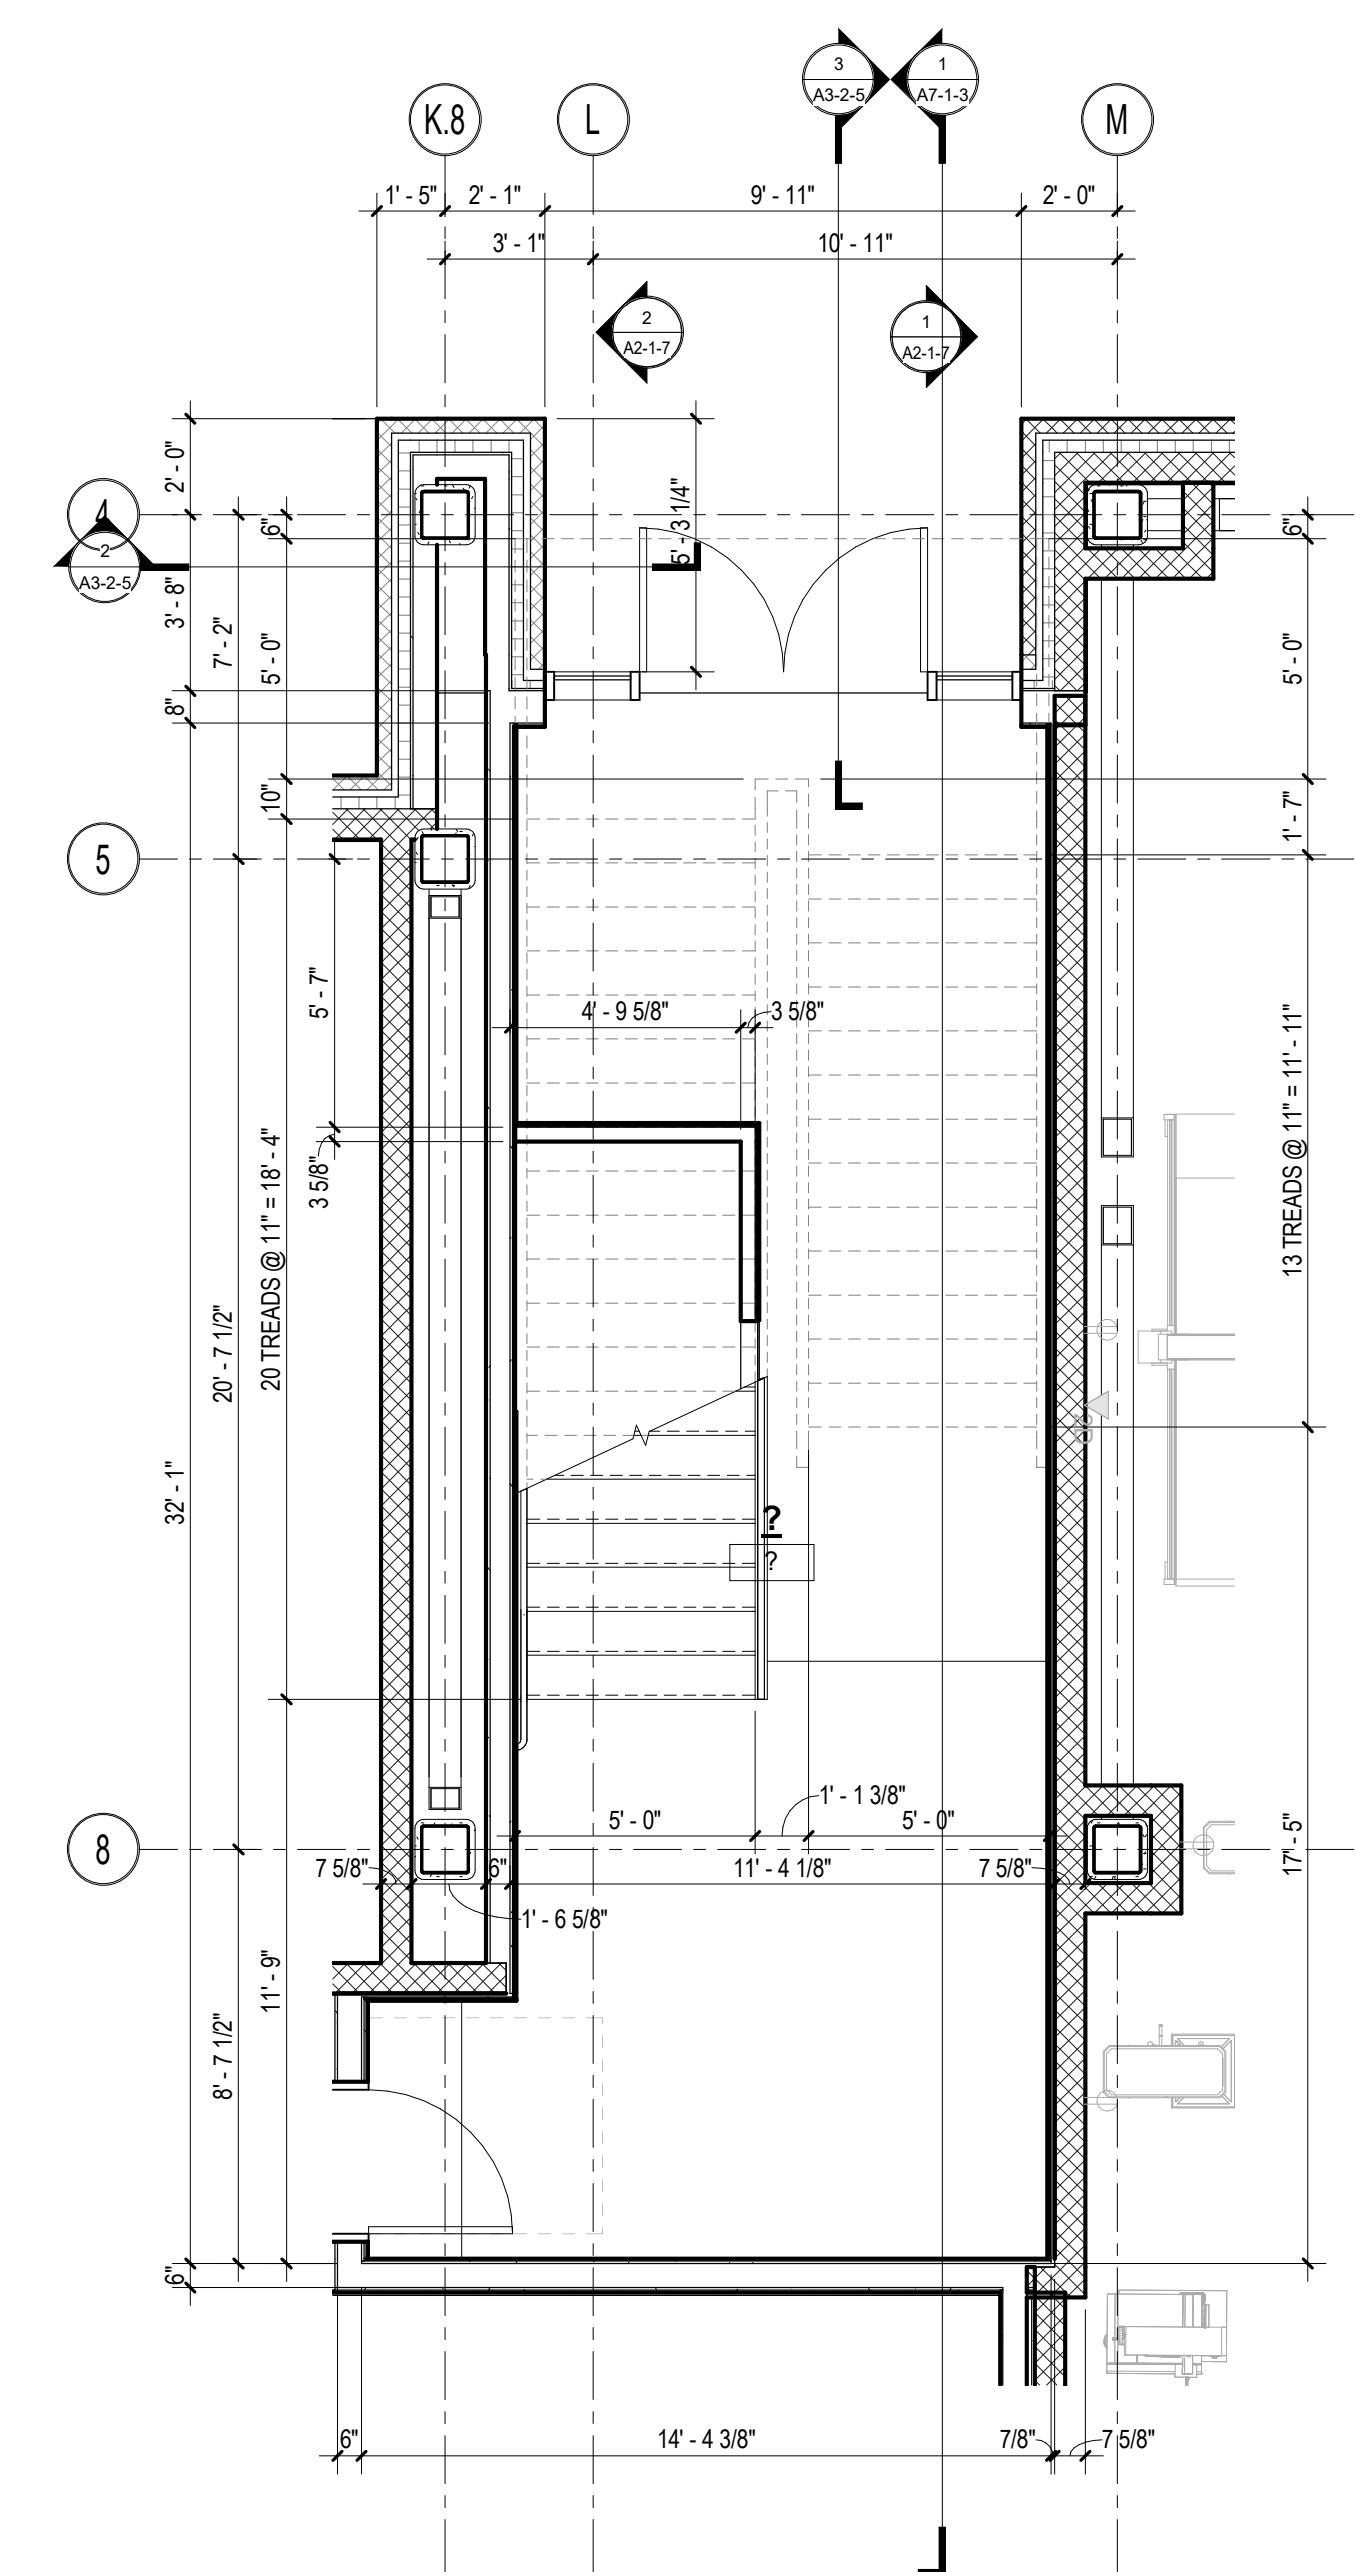


2 STAIR #2 PLAN - FIRST FLOOR
1/4" = 1'-0"

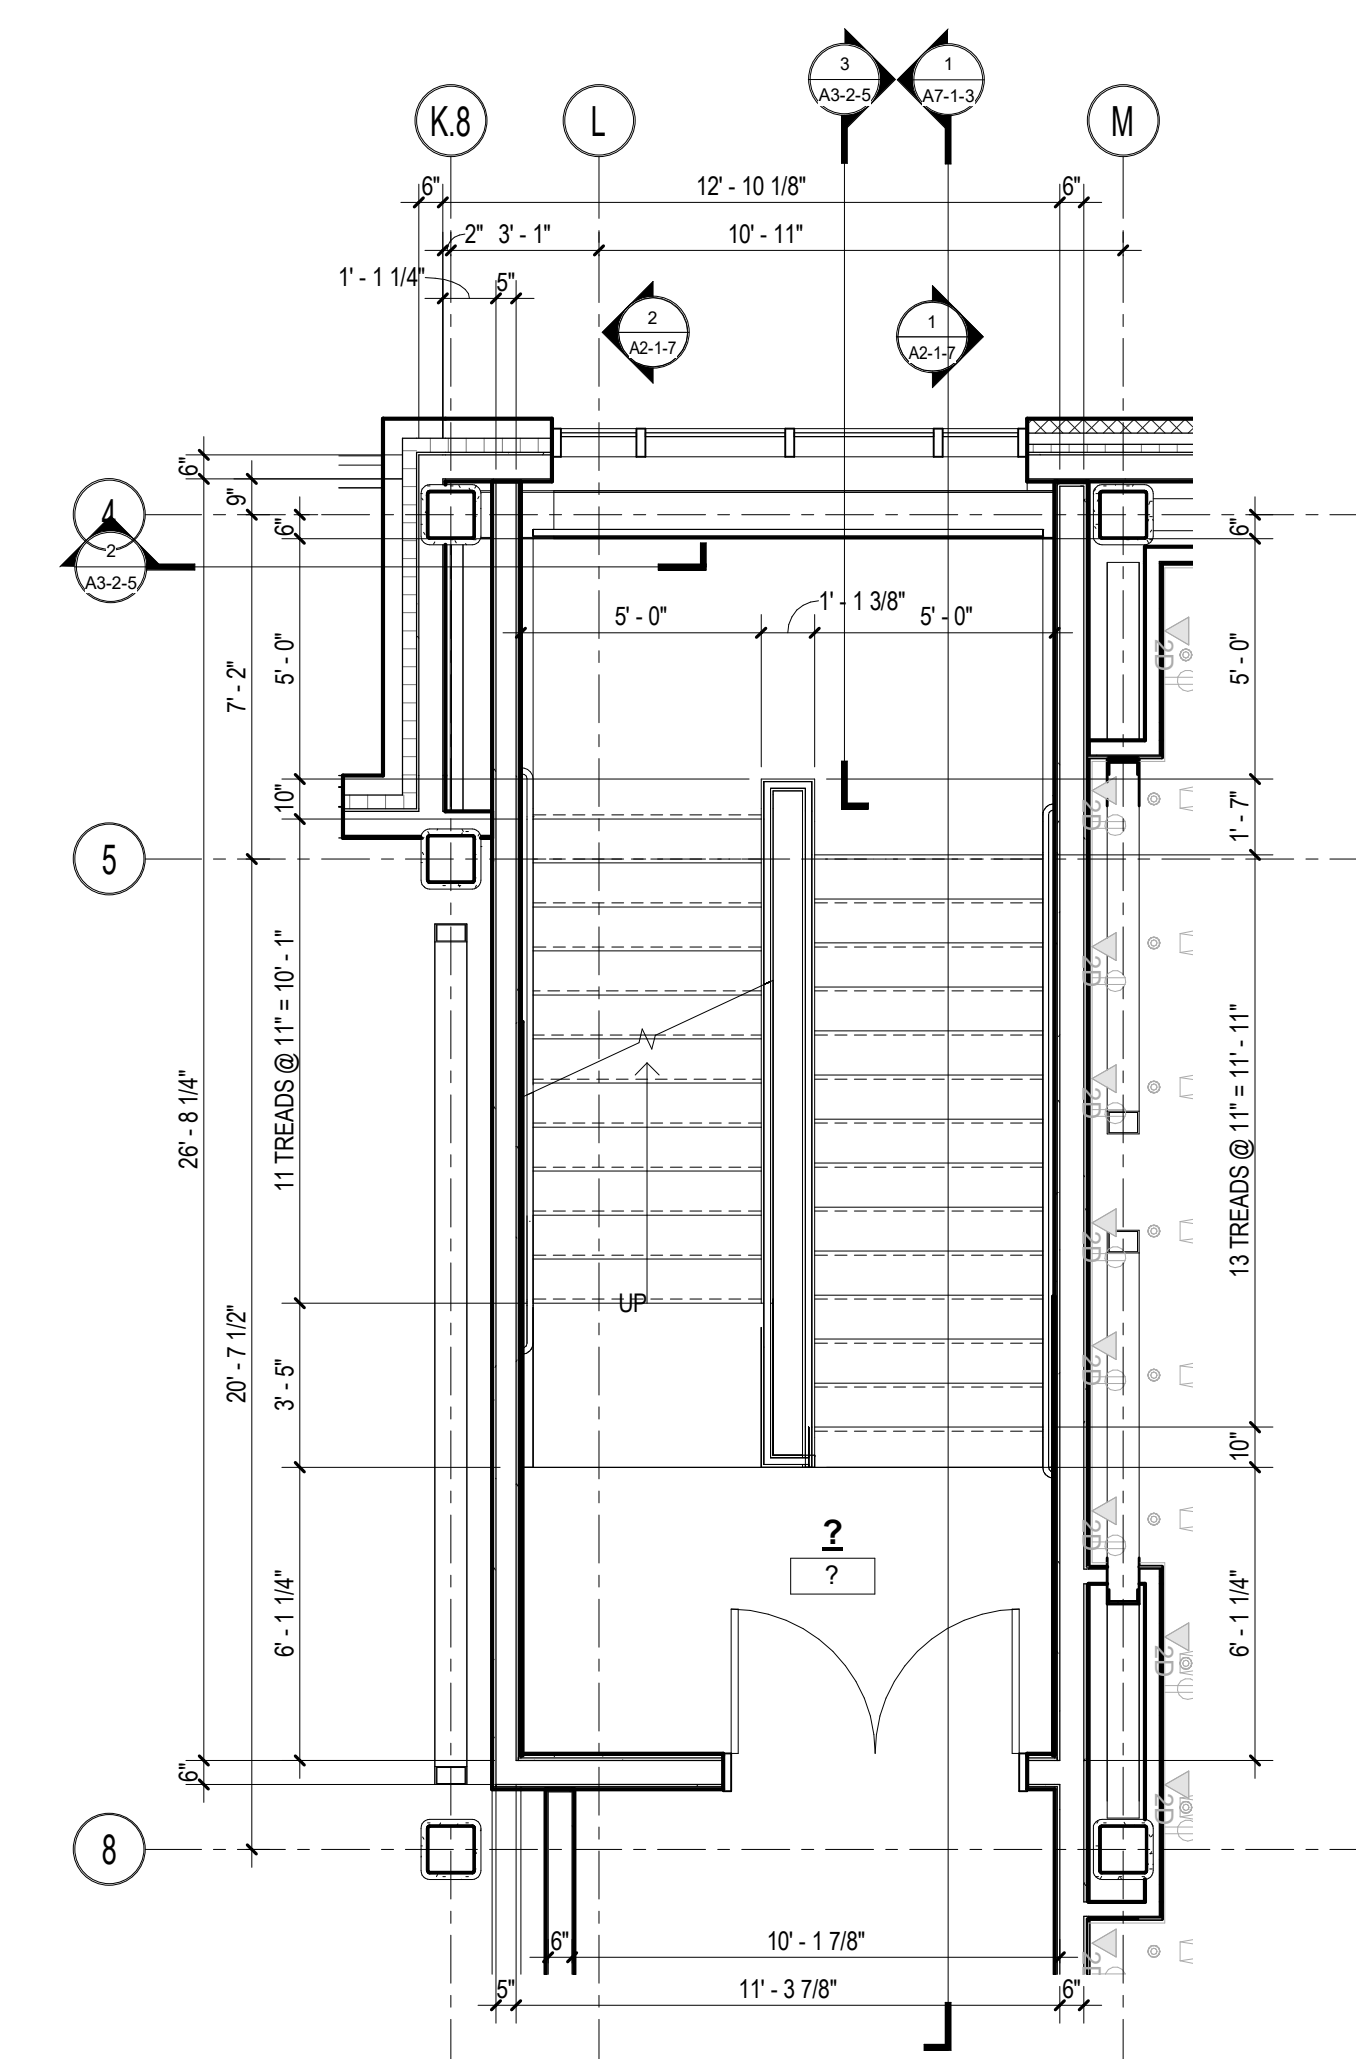

3 STAIR #2 PLAN - SECOND FLOOR
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

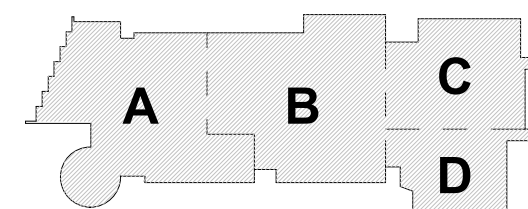

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

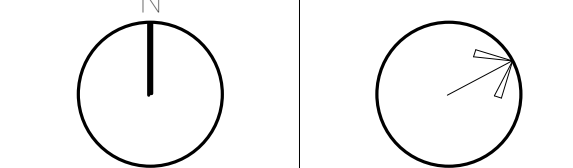

**STAIR PLANS &
SECTIONS**

Scale: 1/4" = 1'-0"





Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

A7-1-3

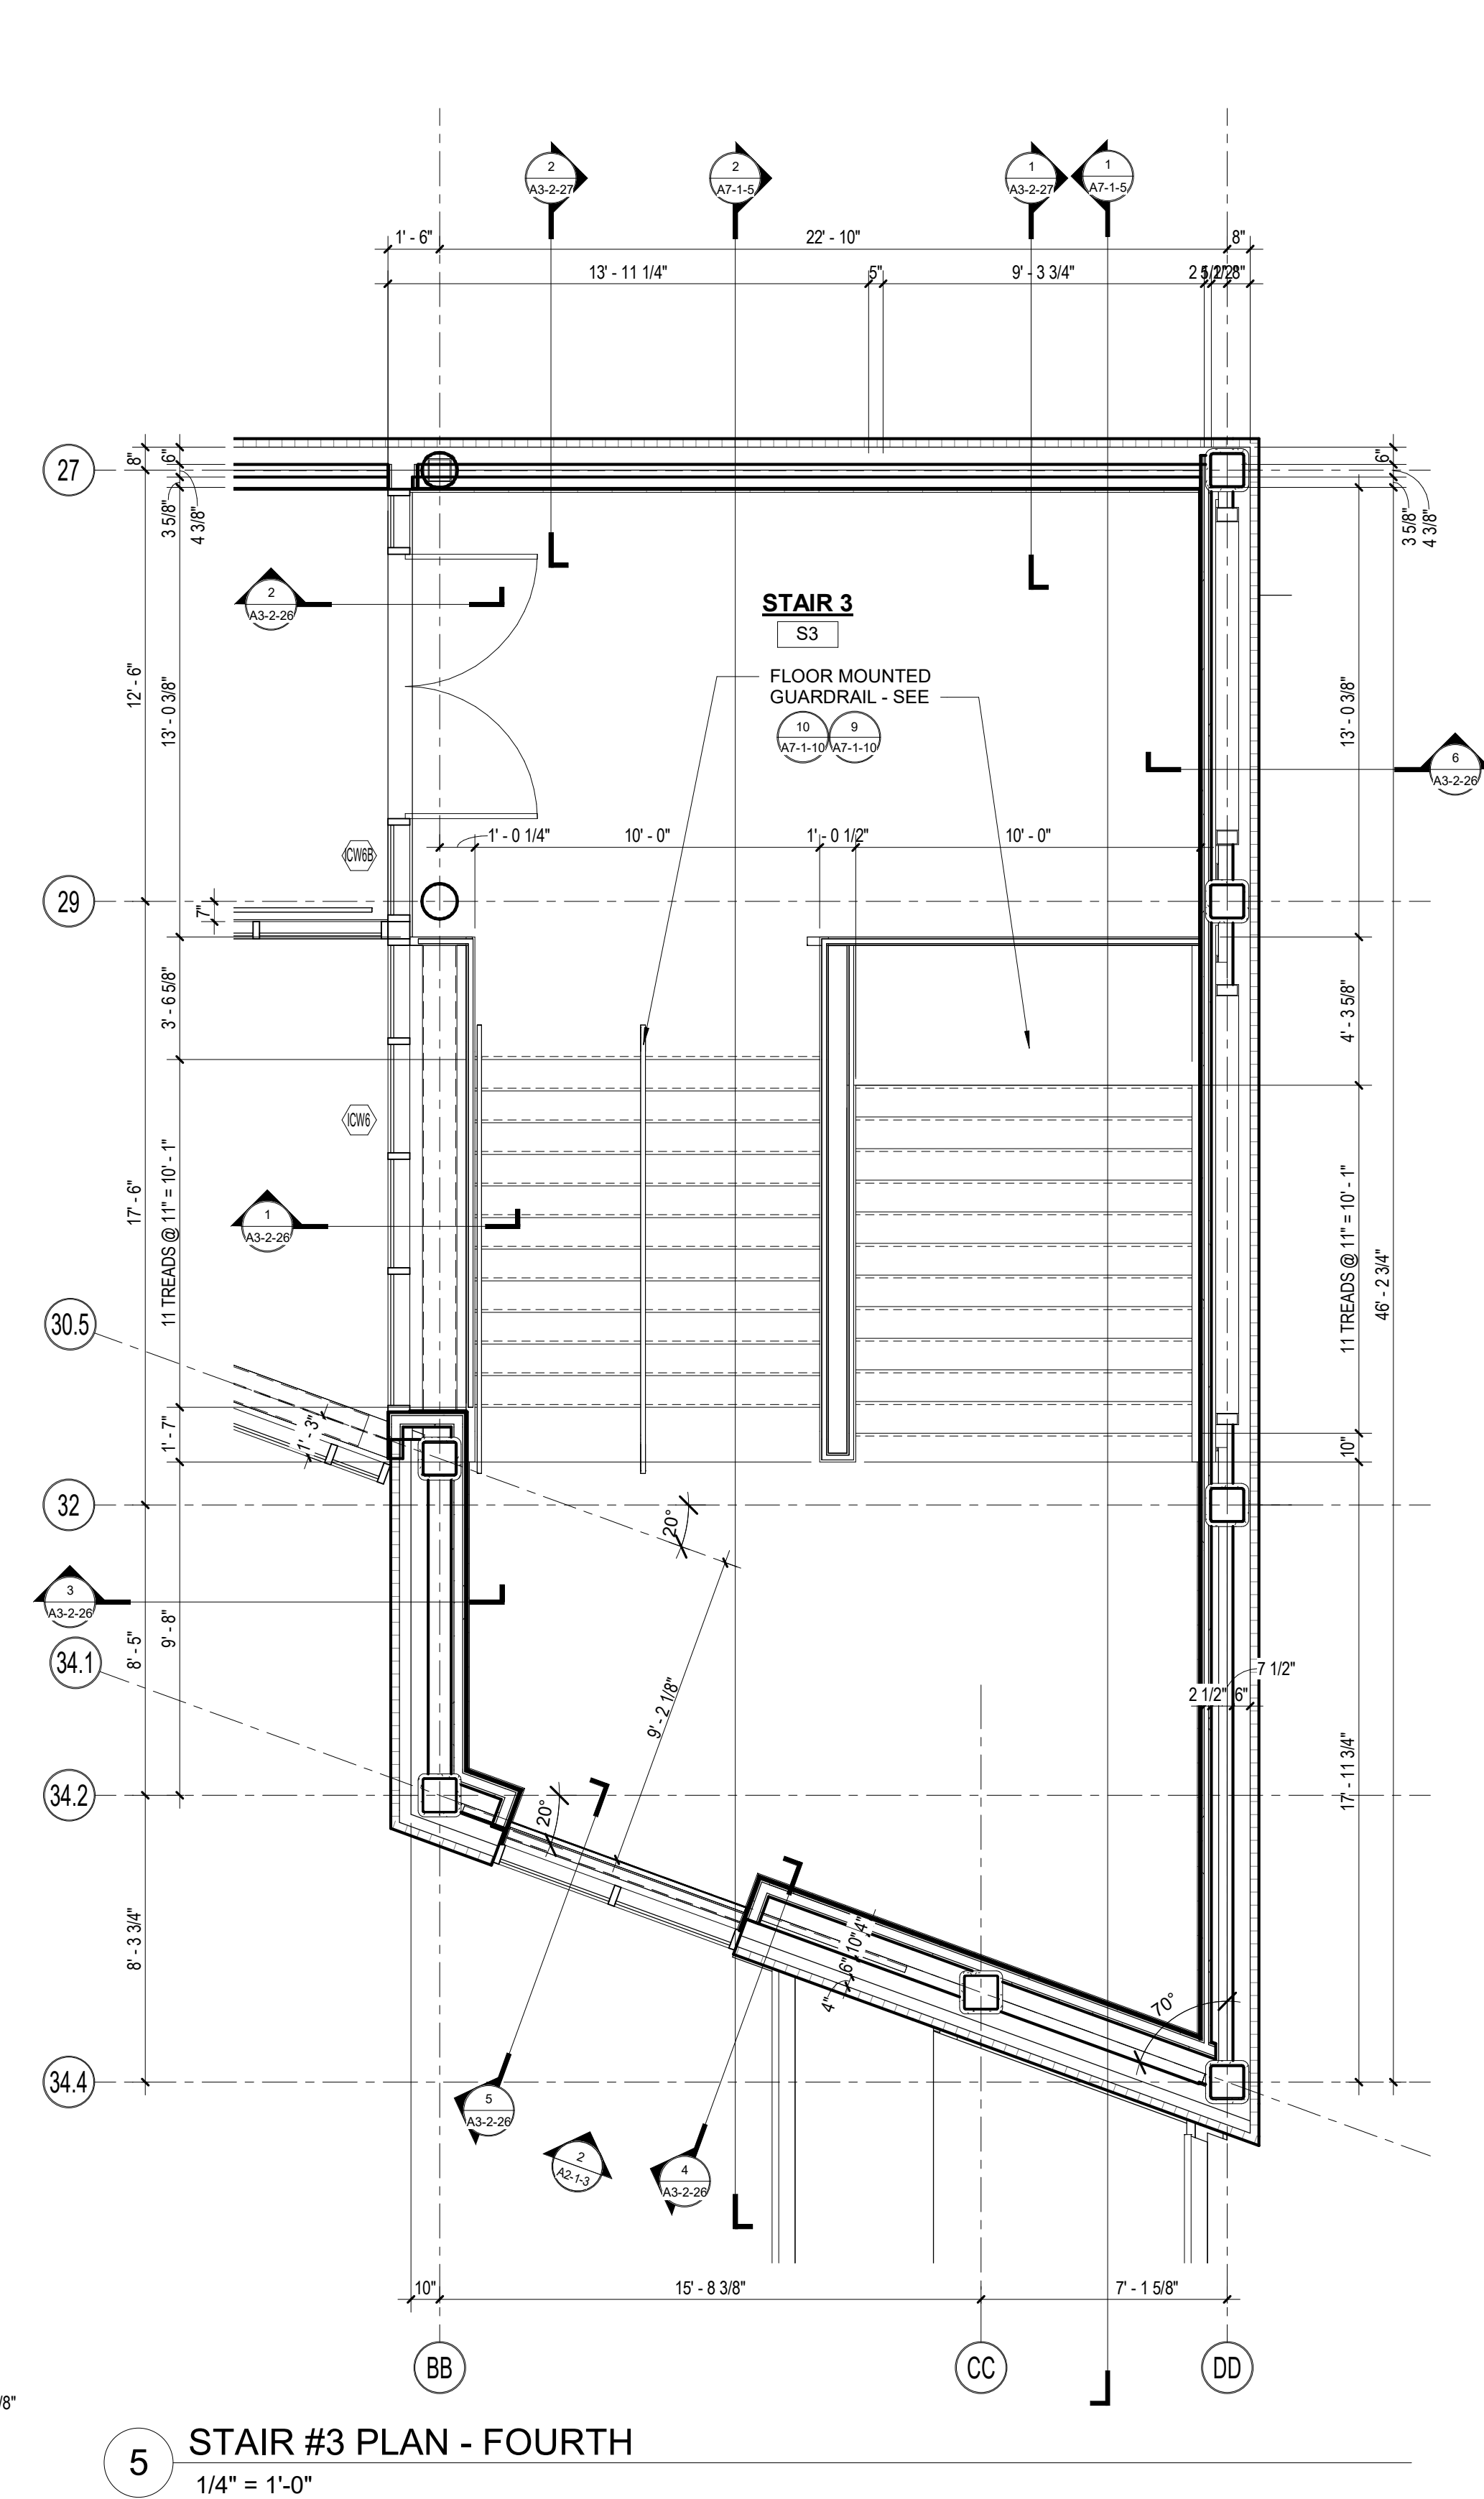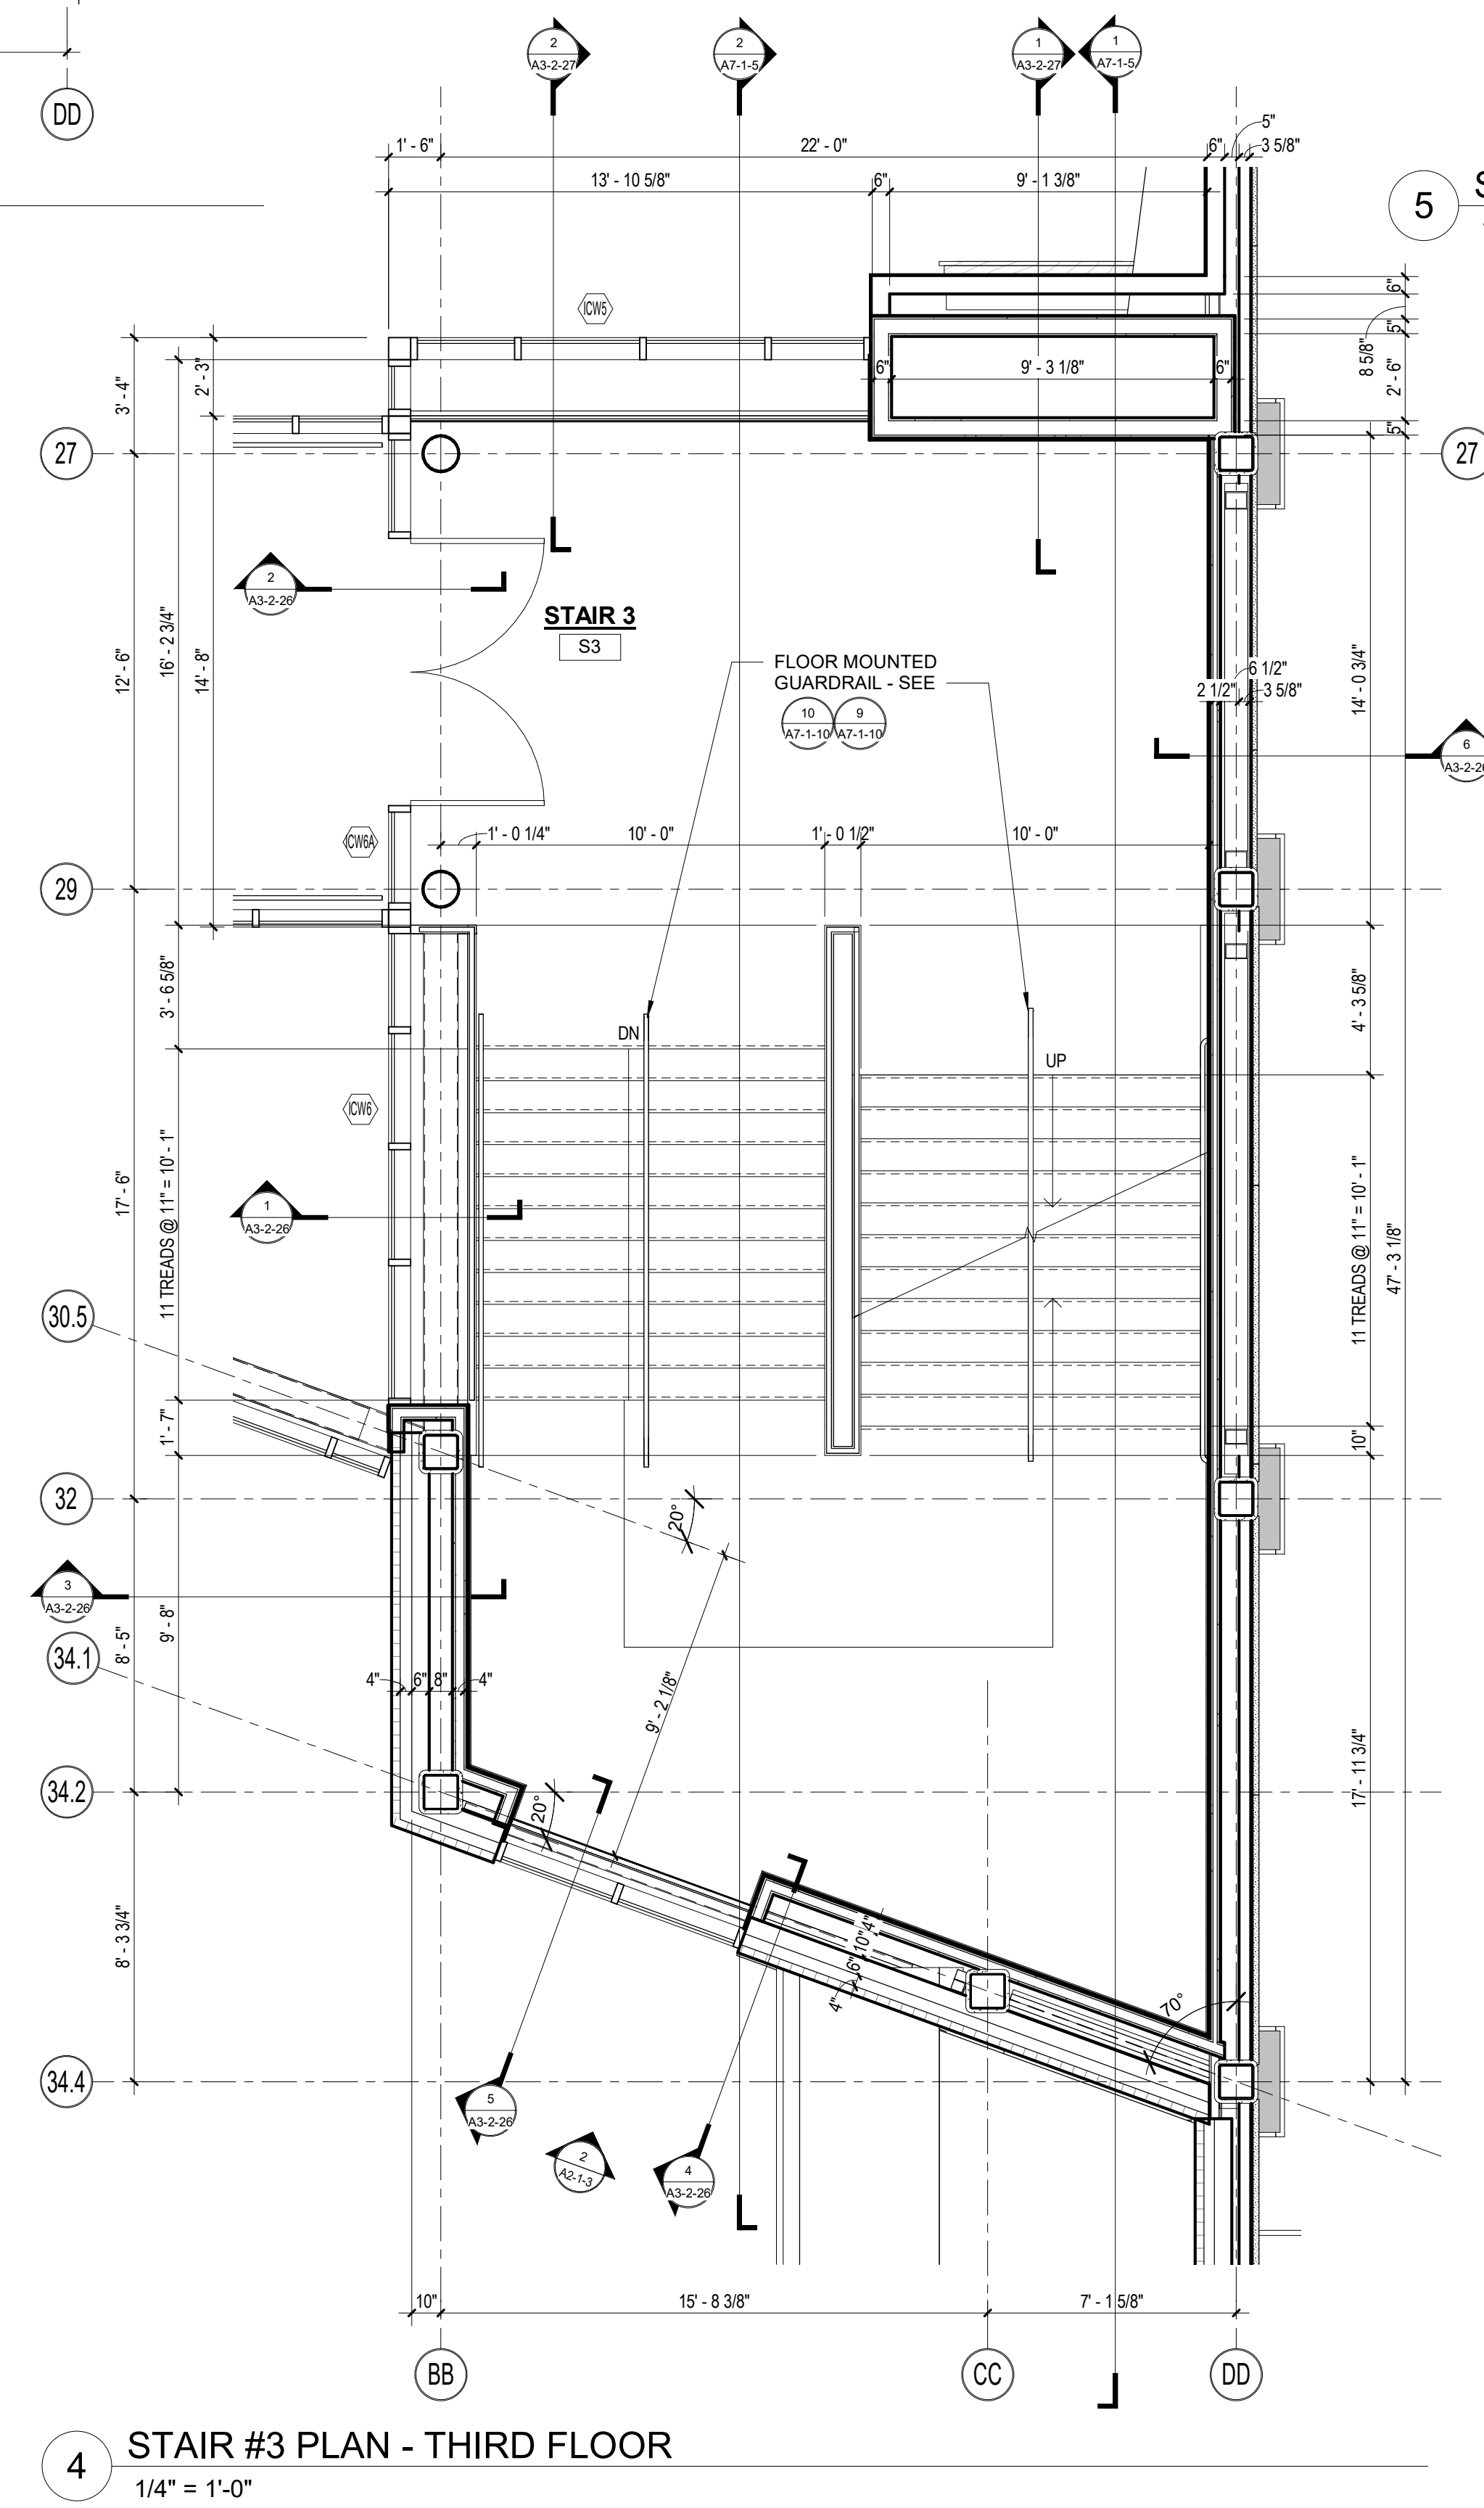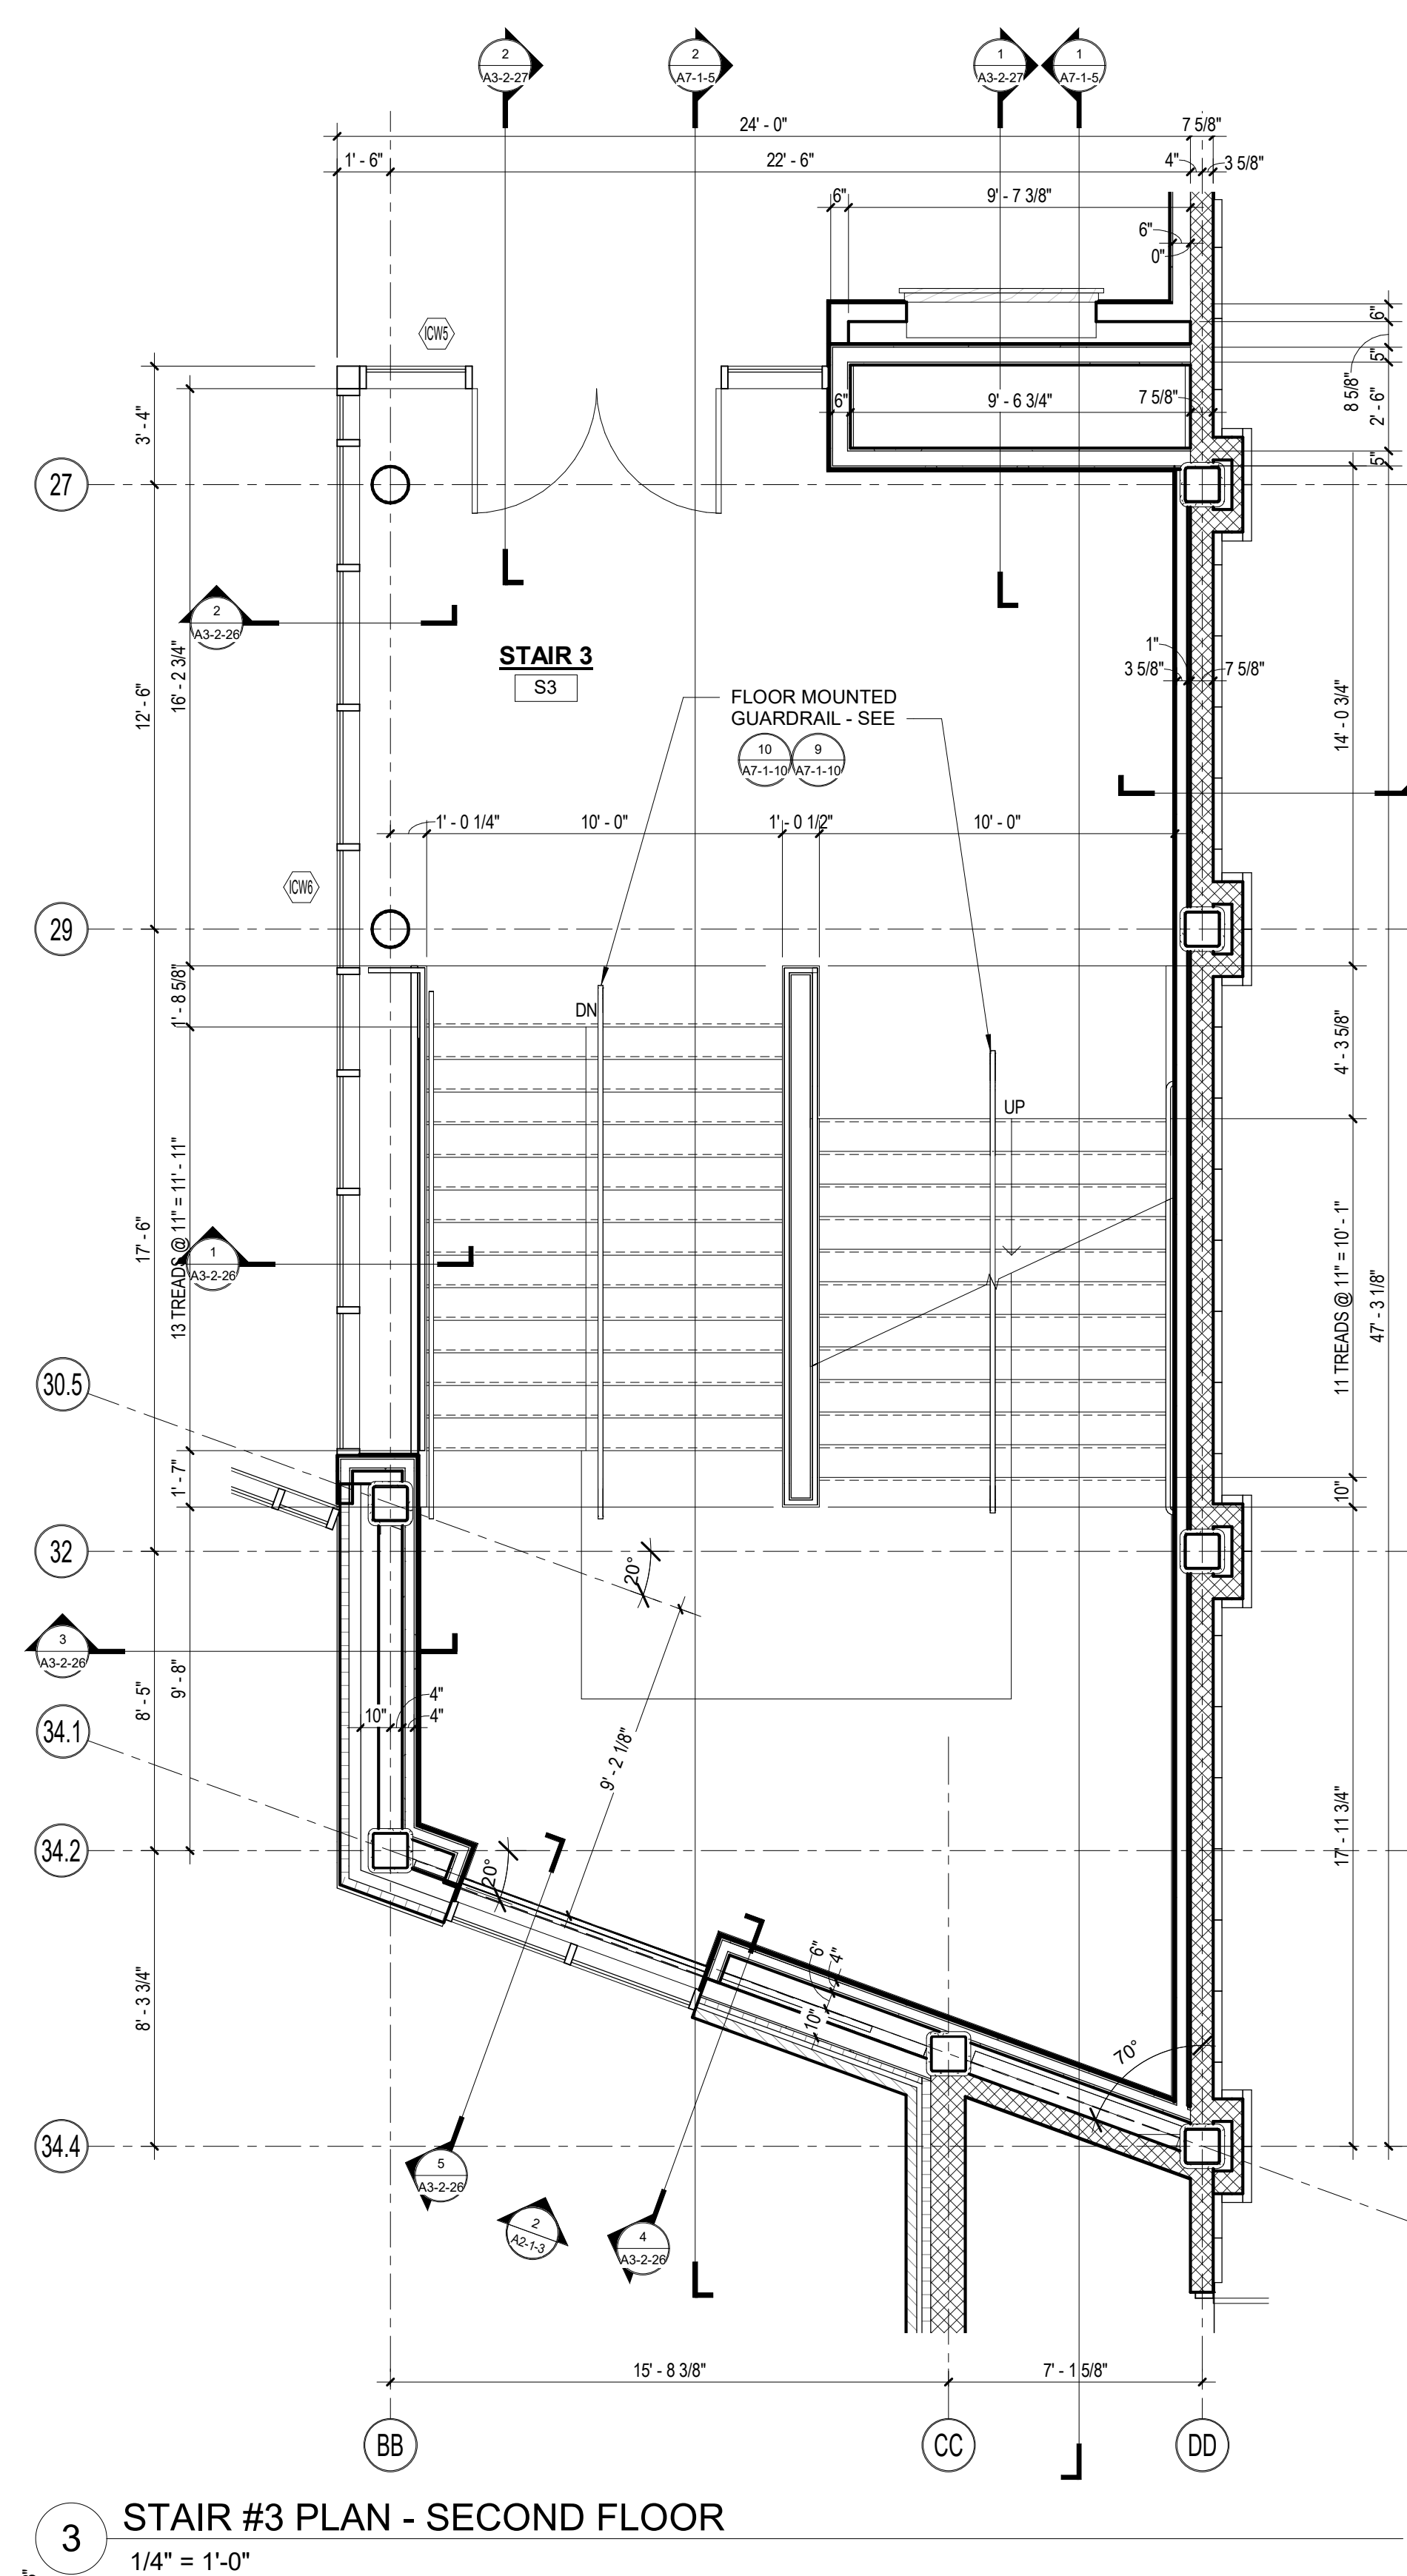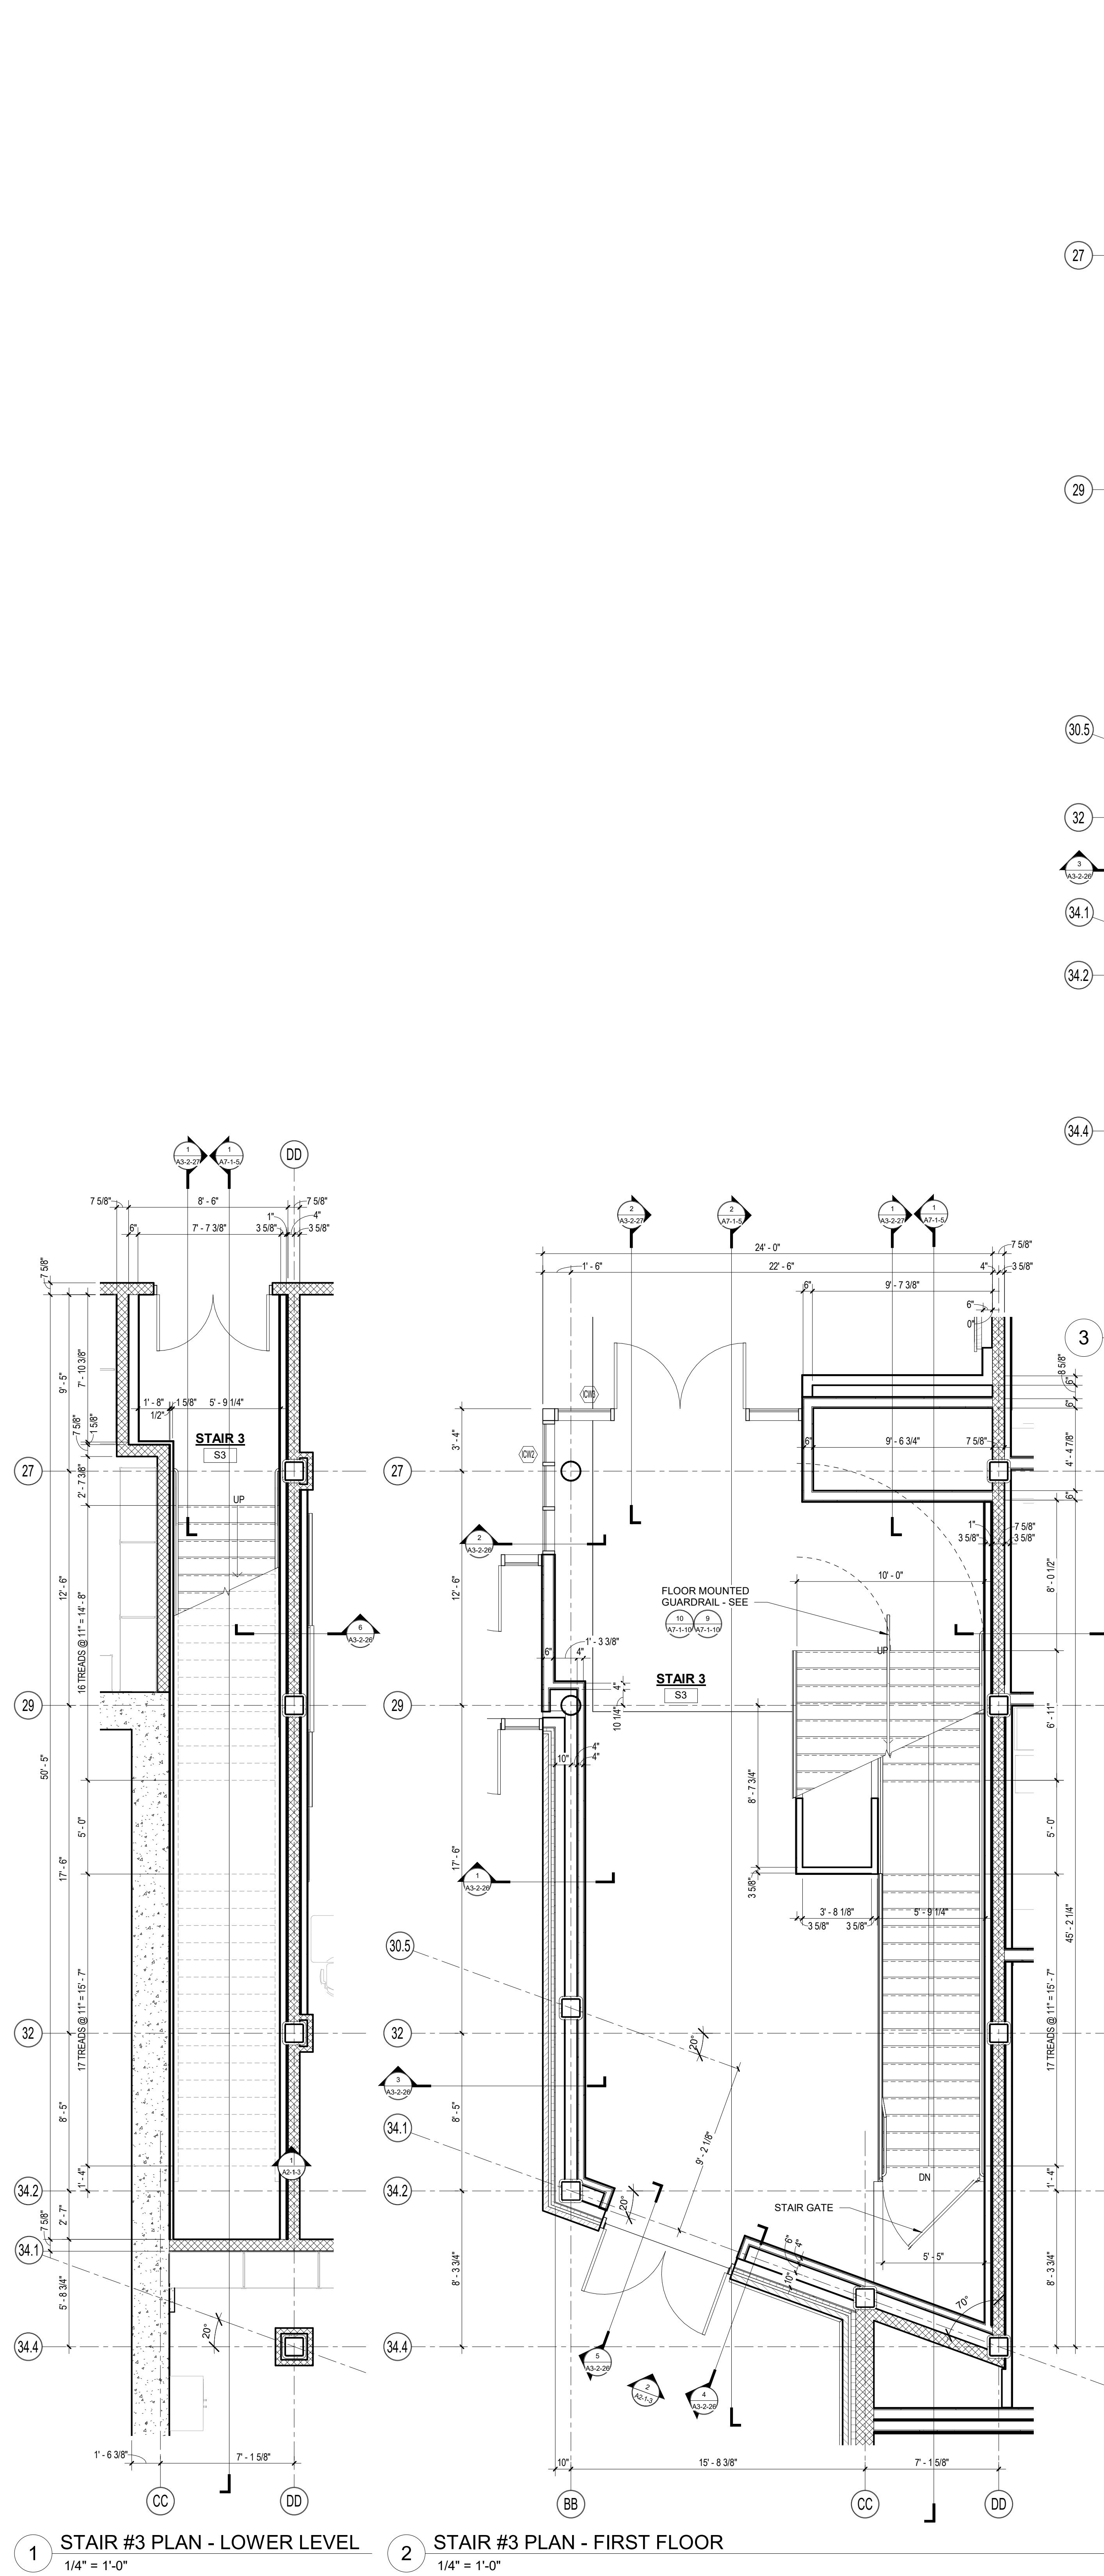


**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

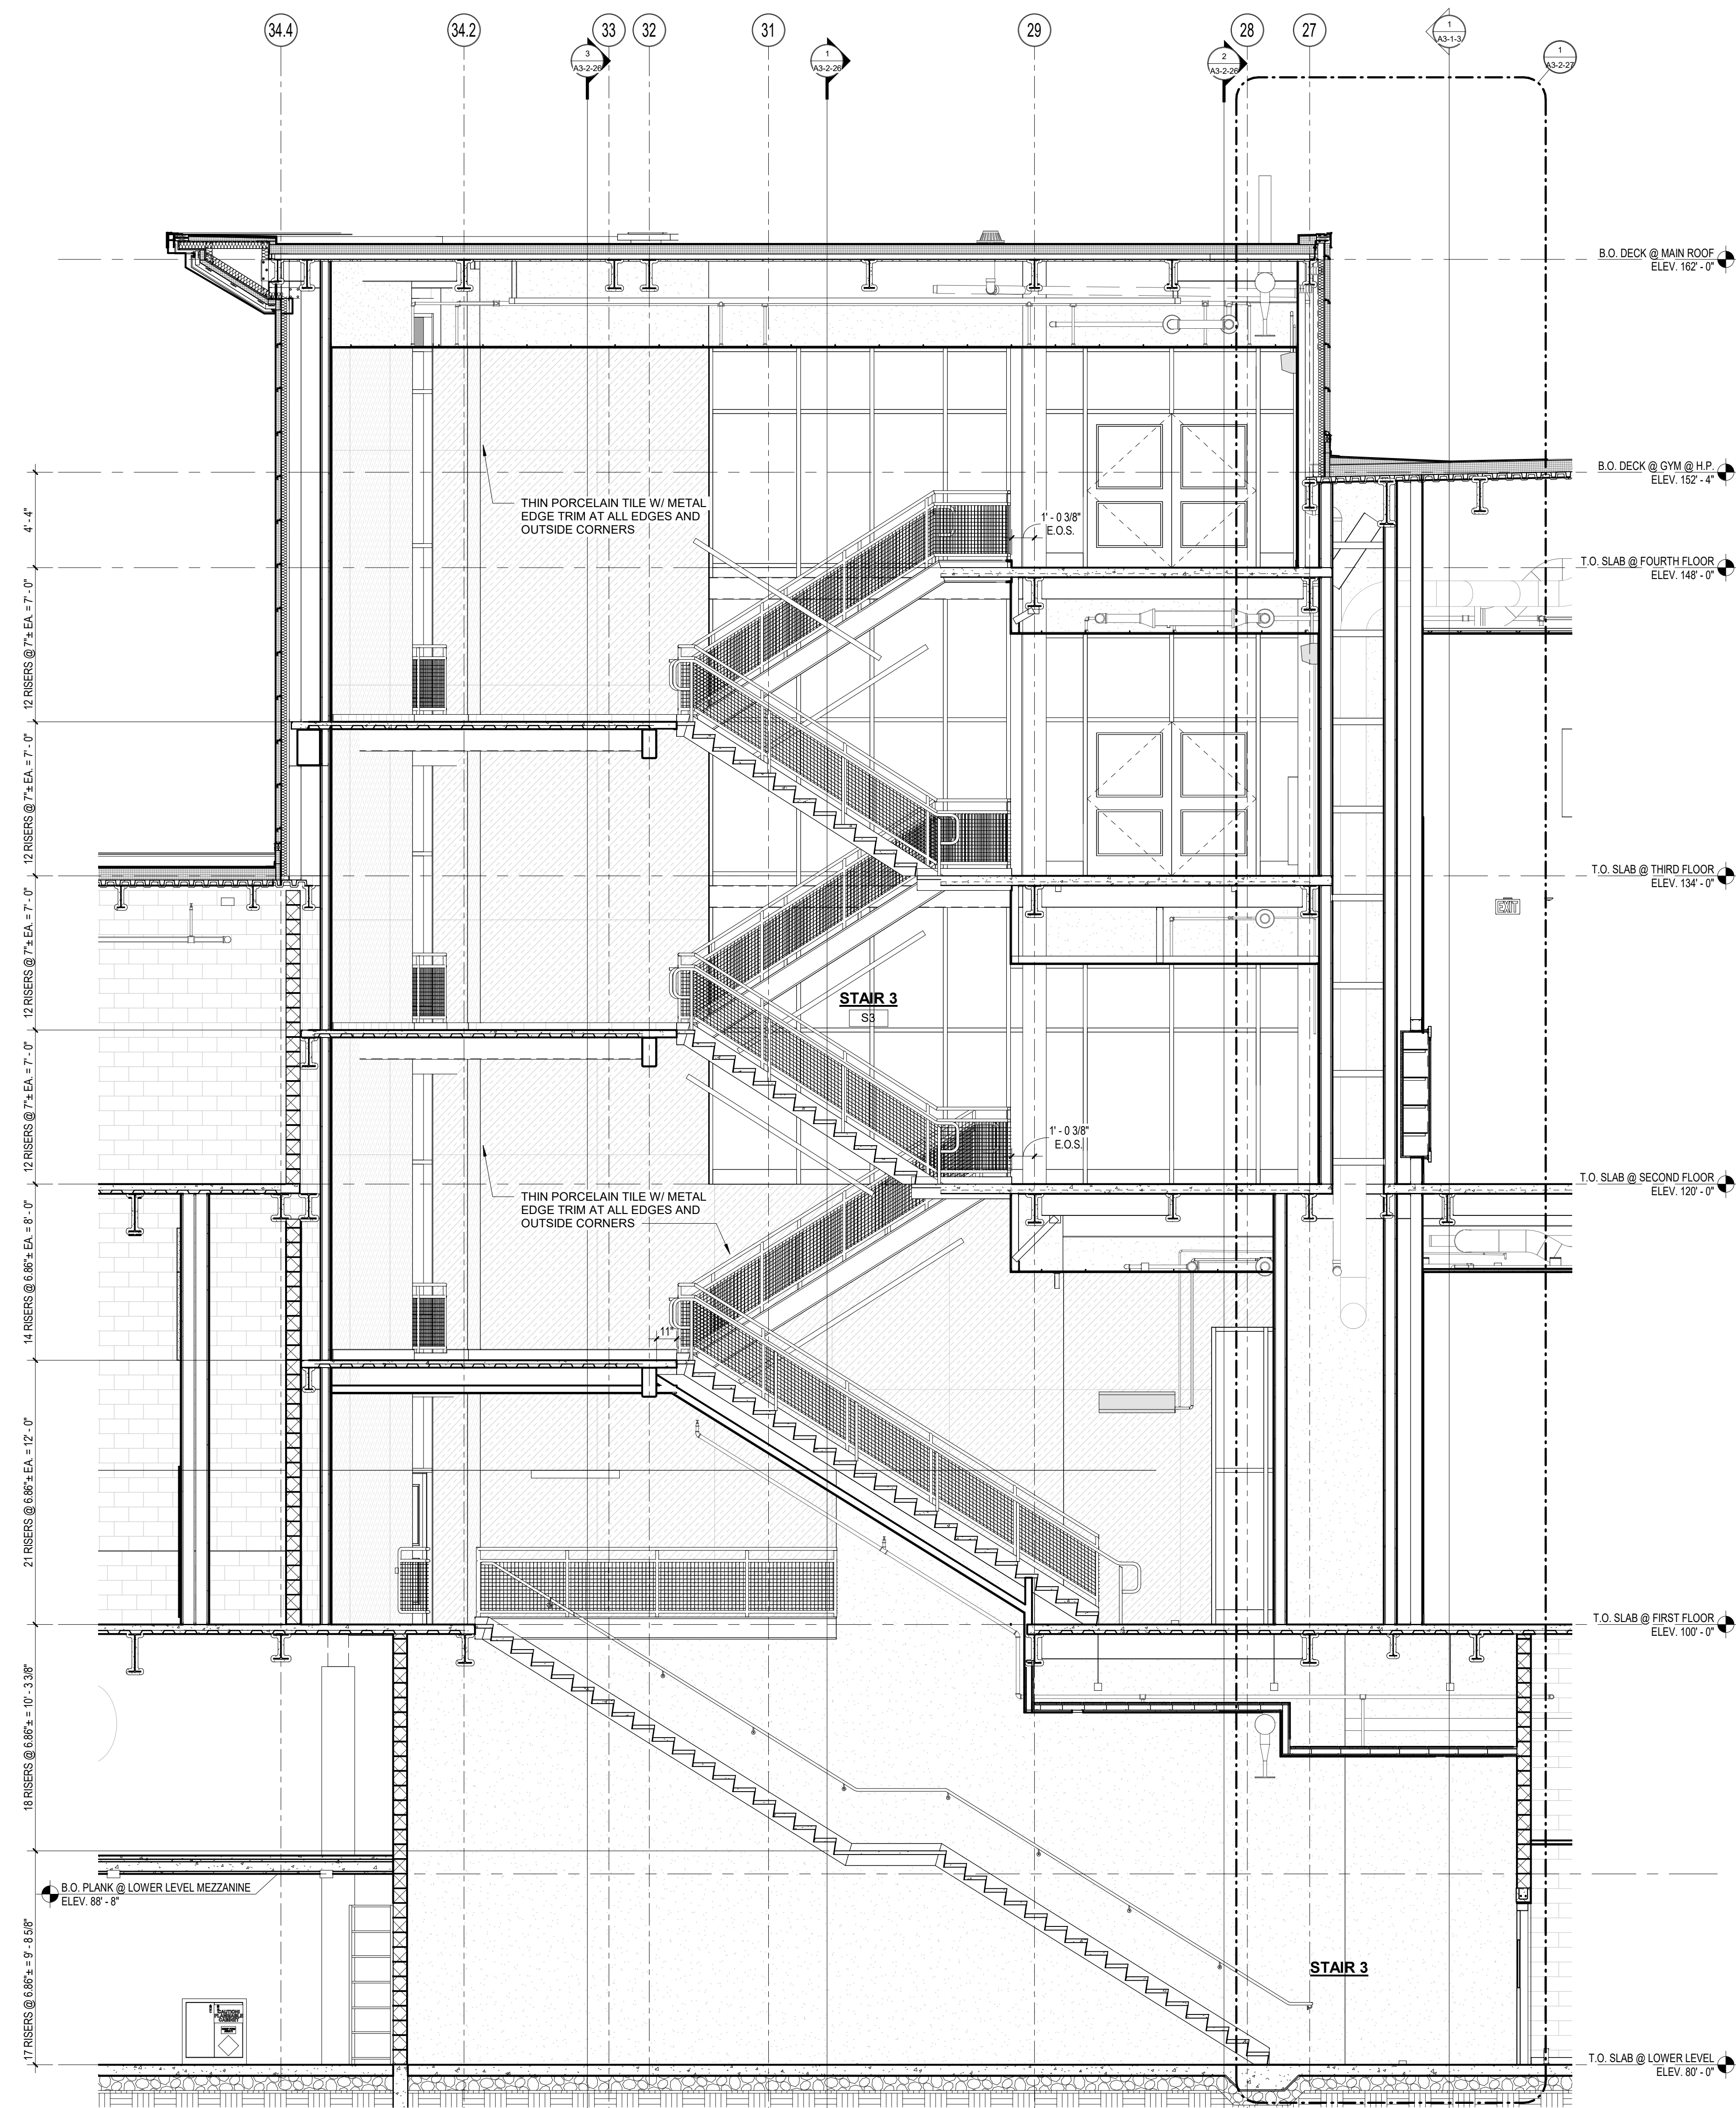

1 STAIR #3 SECTION 1
1/4" = 1'-0"

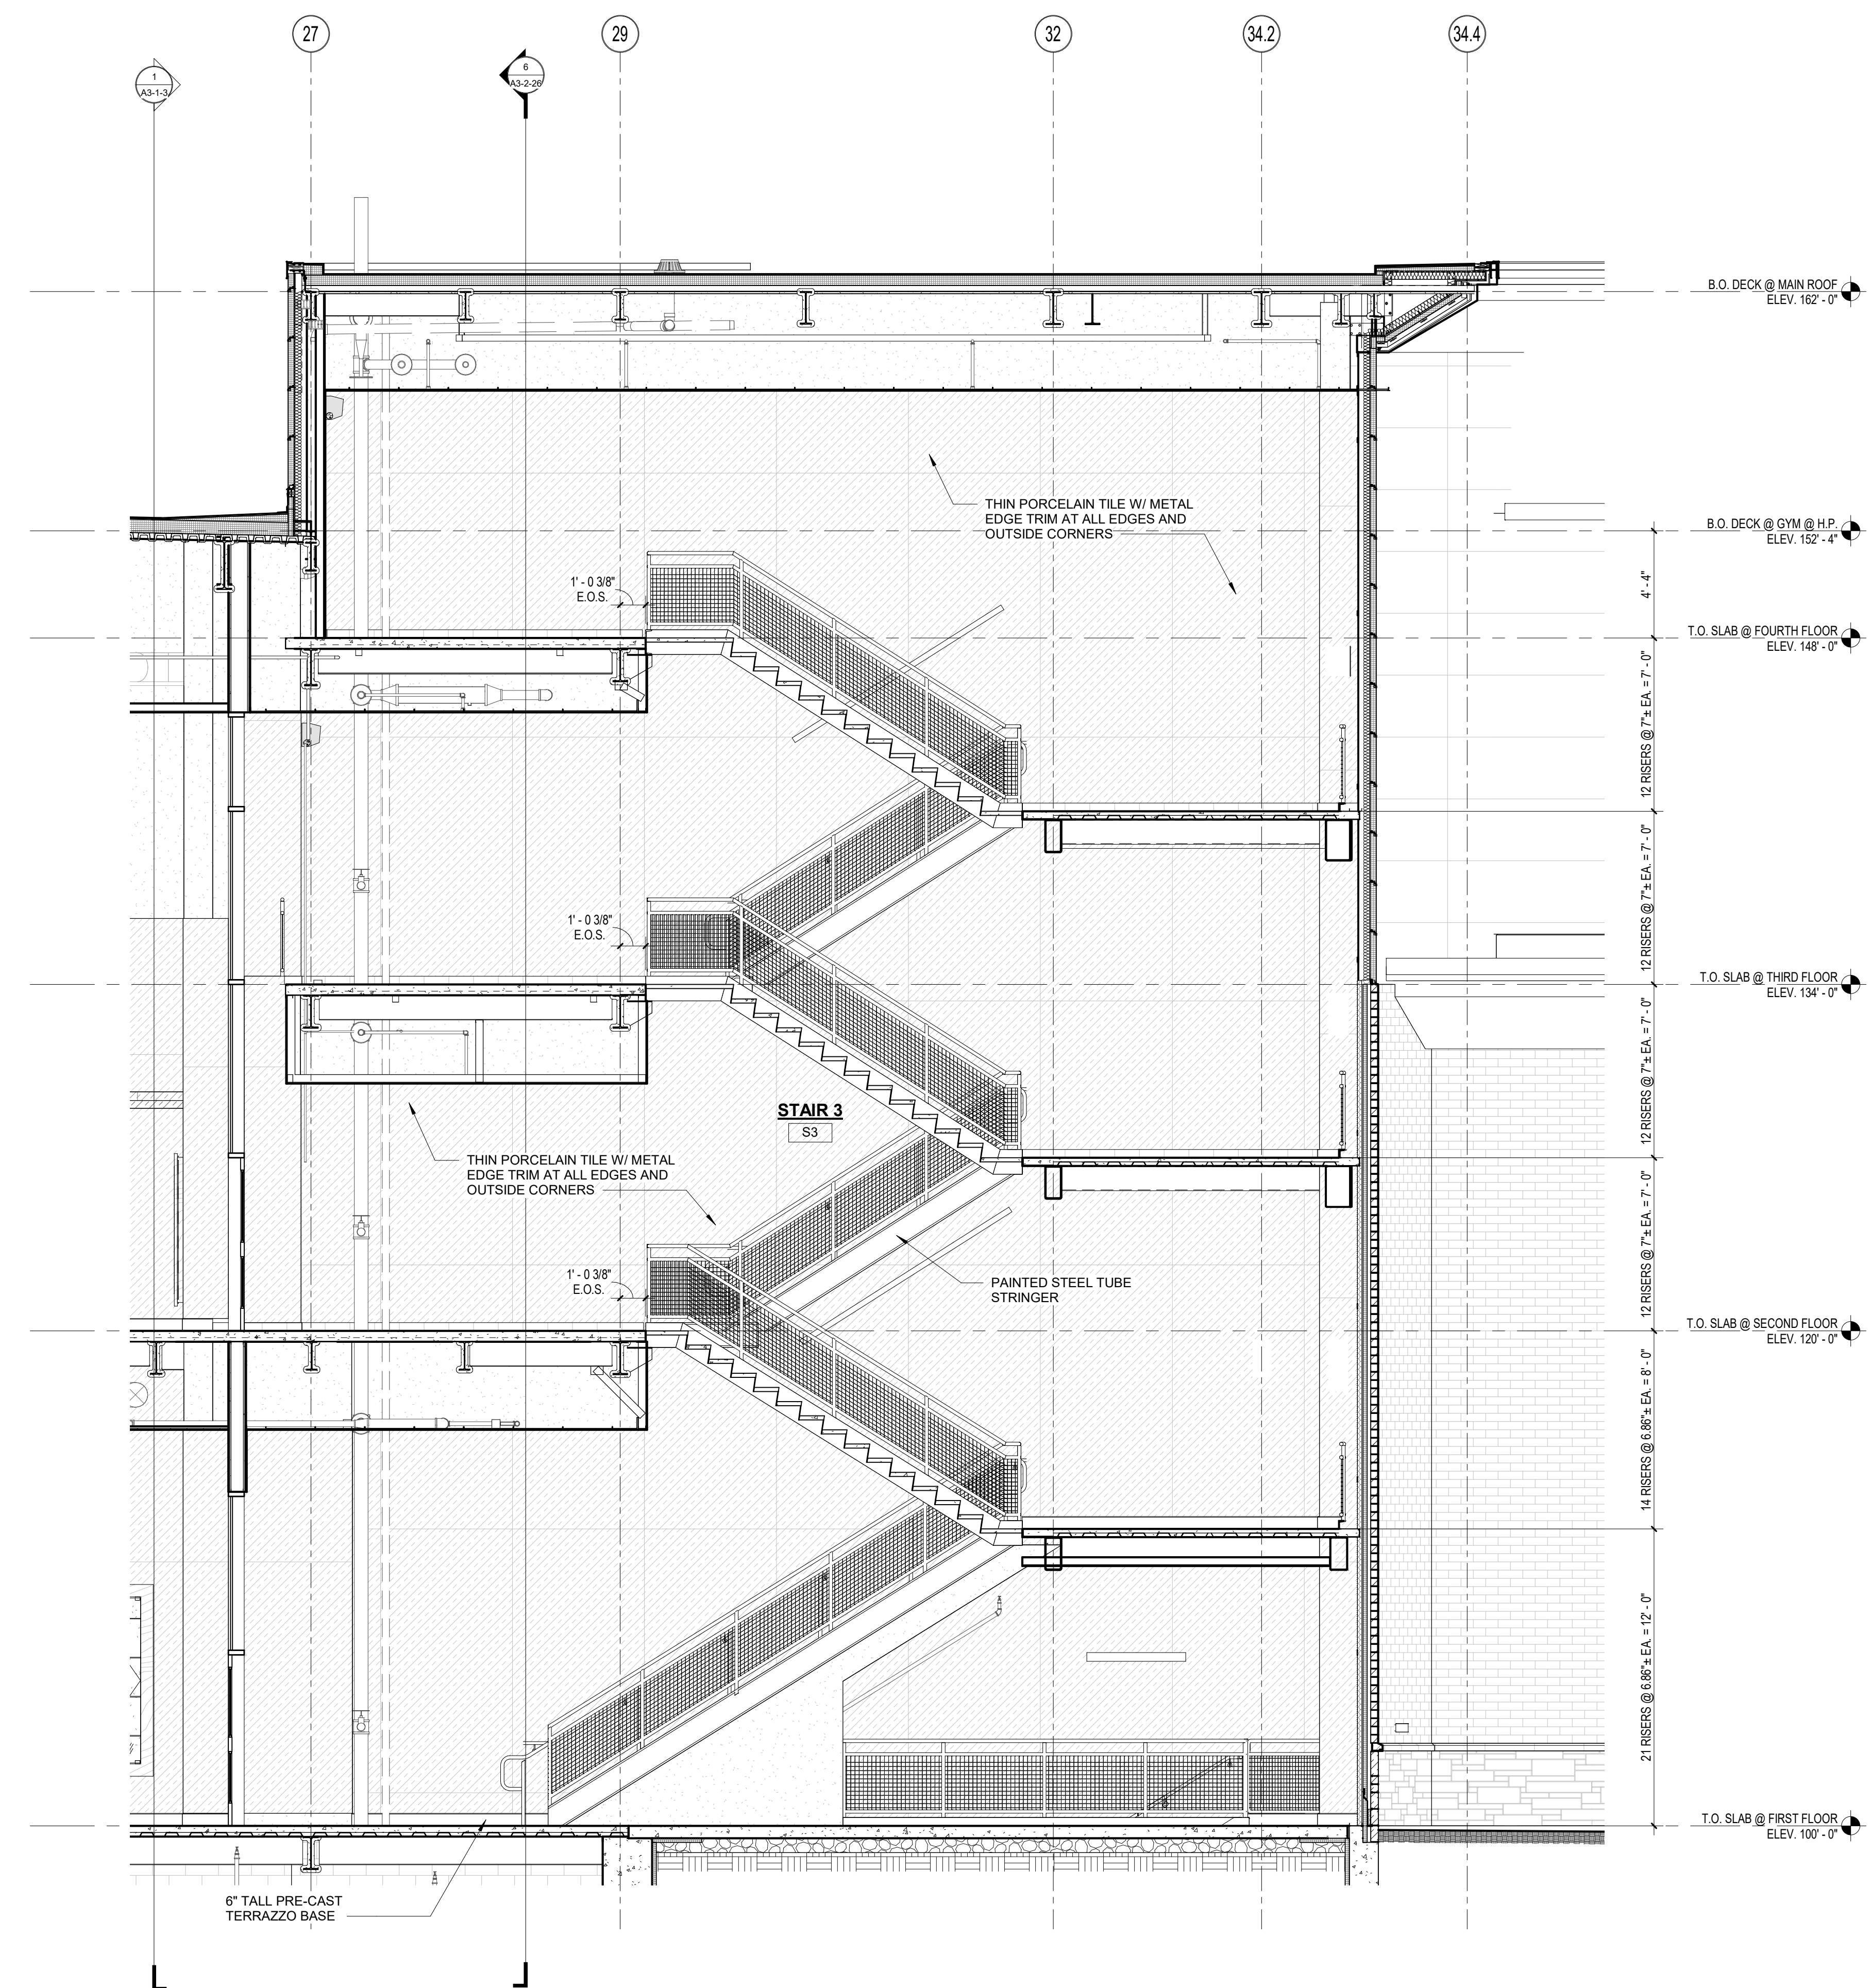


2 STAIR #3 SECTION 2
1/4" = 1'-0"

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023




KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



STAIR SECTIONS

Scale: 1/4" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


A7-1-5

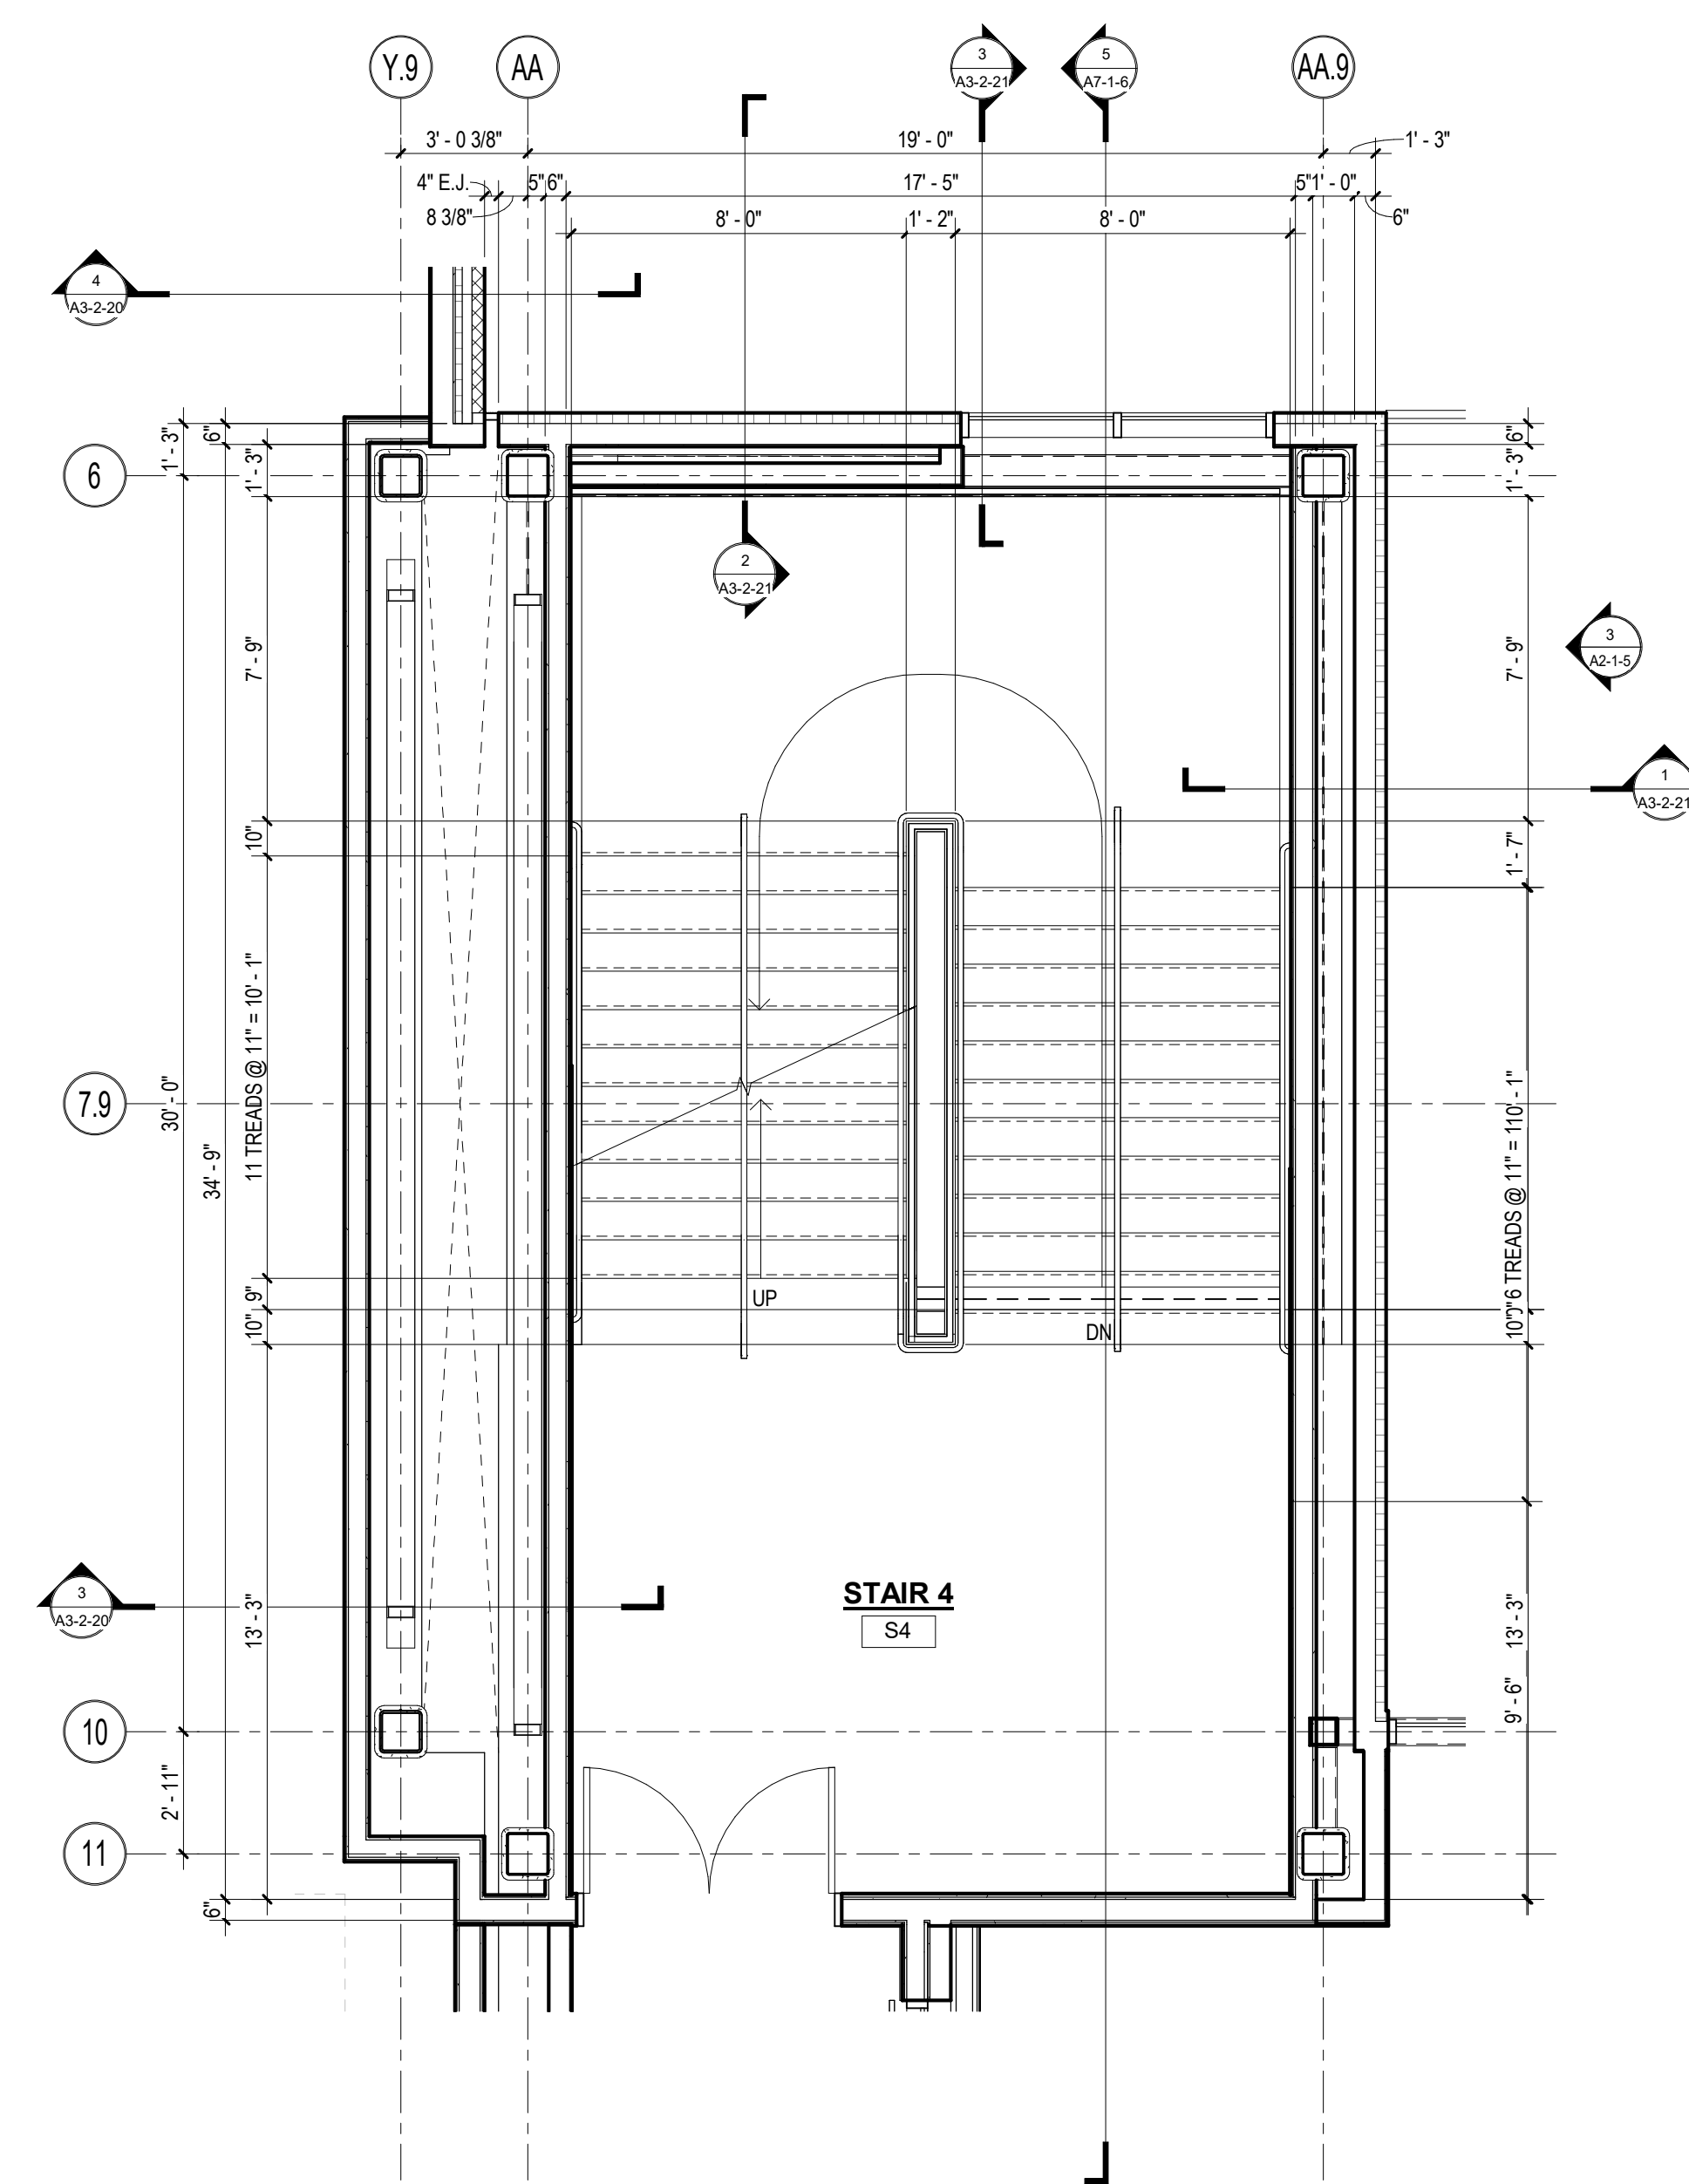


3 STAIR #4 PLAN - THIRD FLOOR
1/4" = 1'-0"

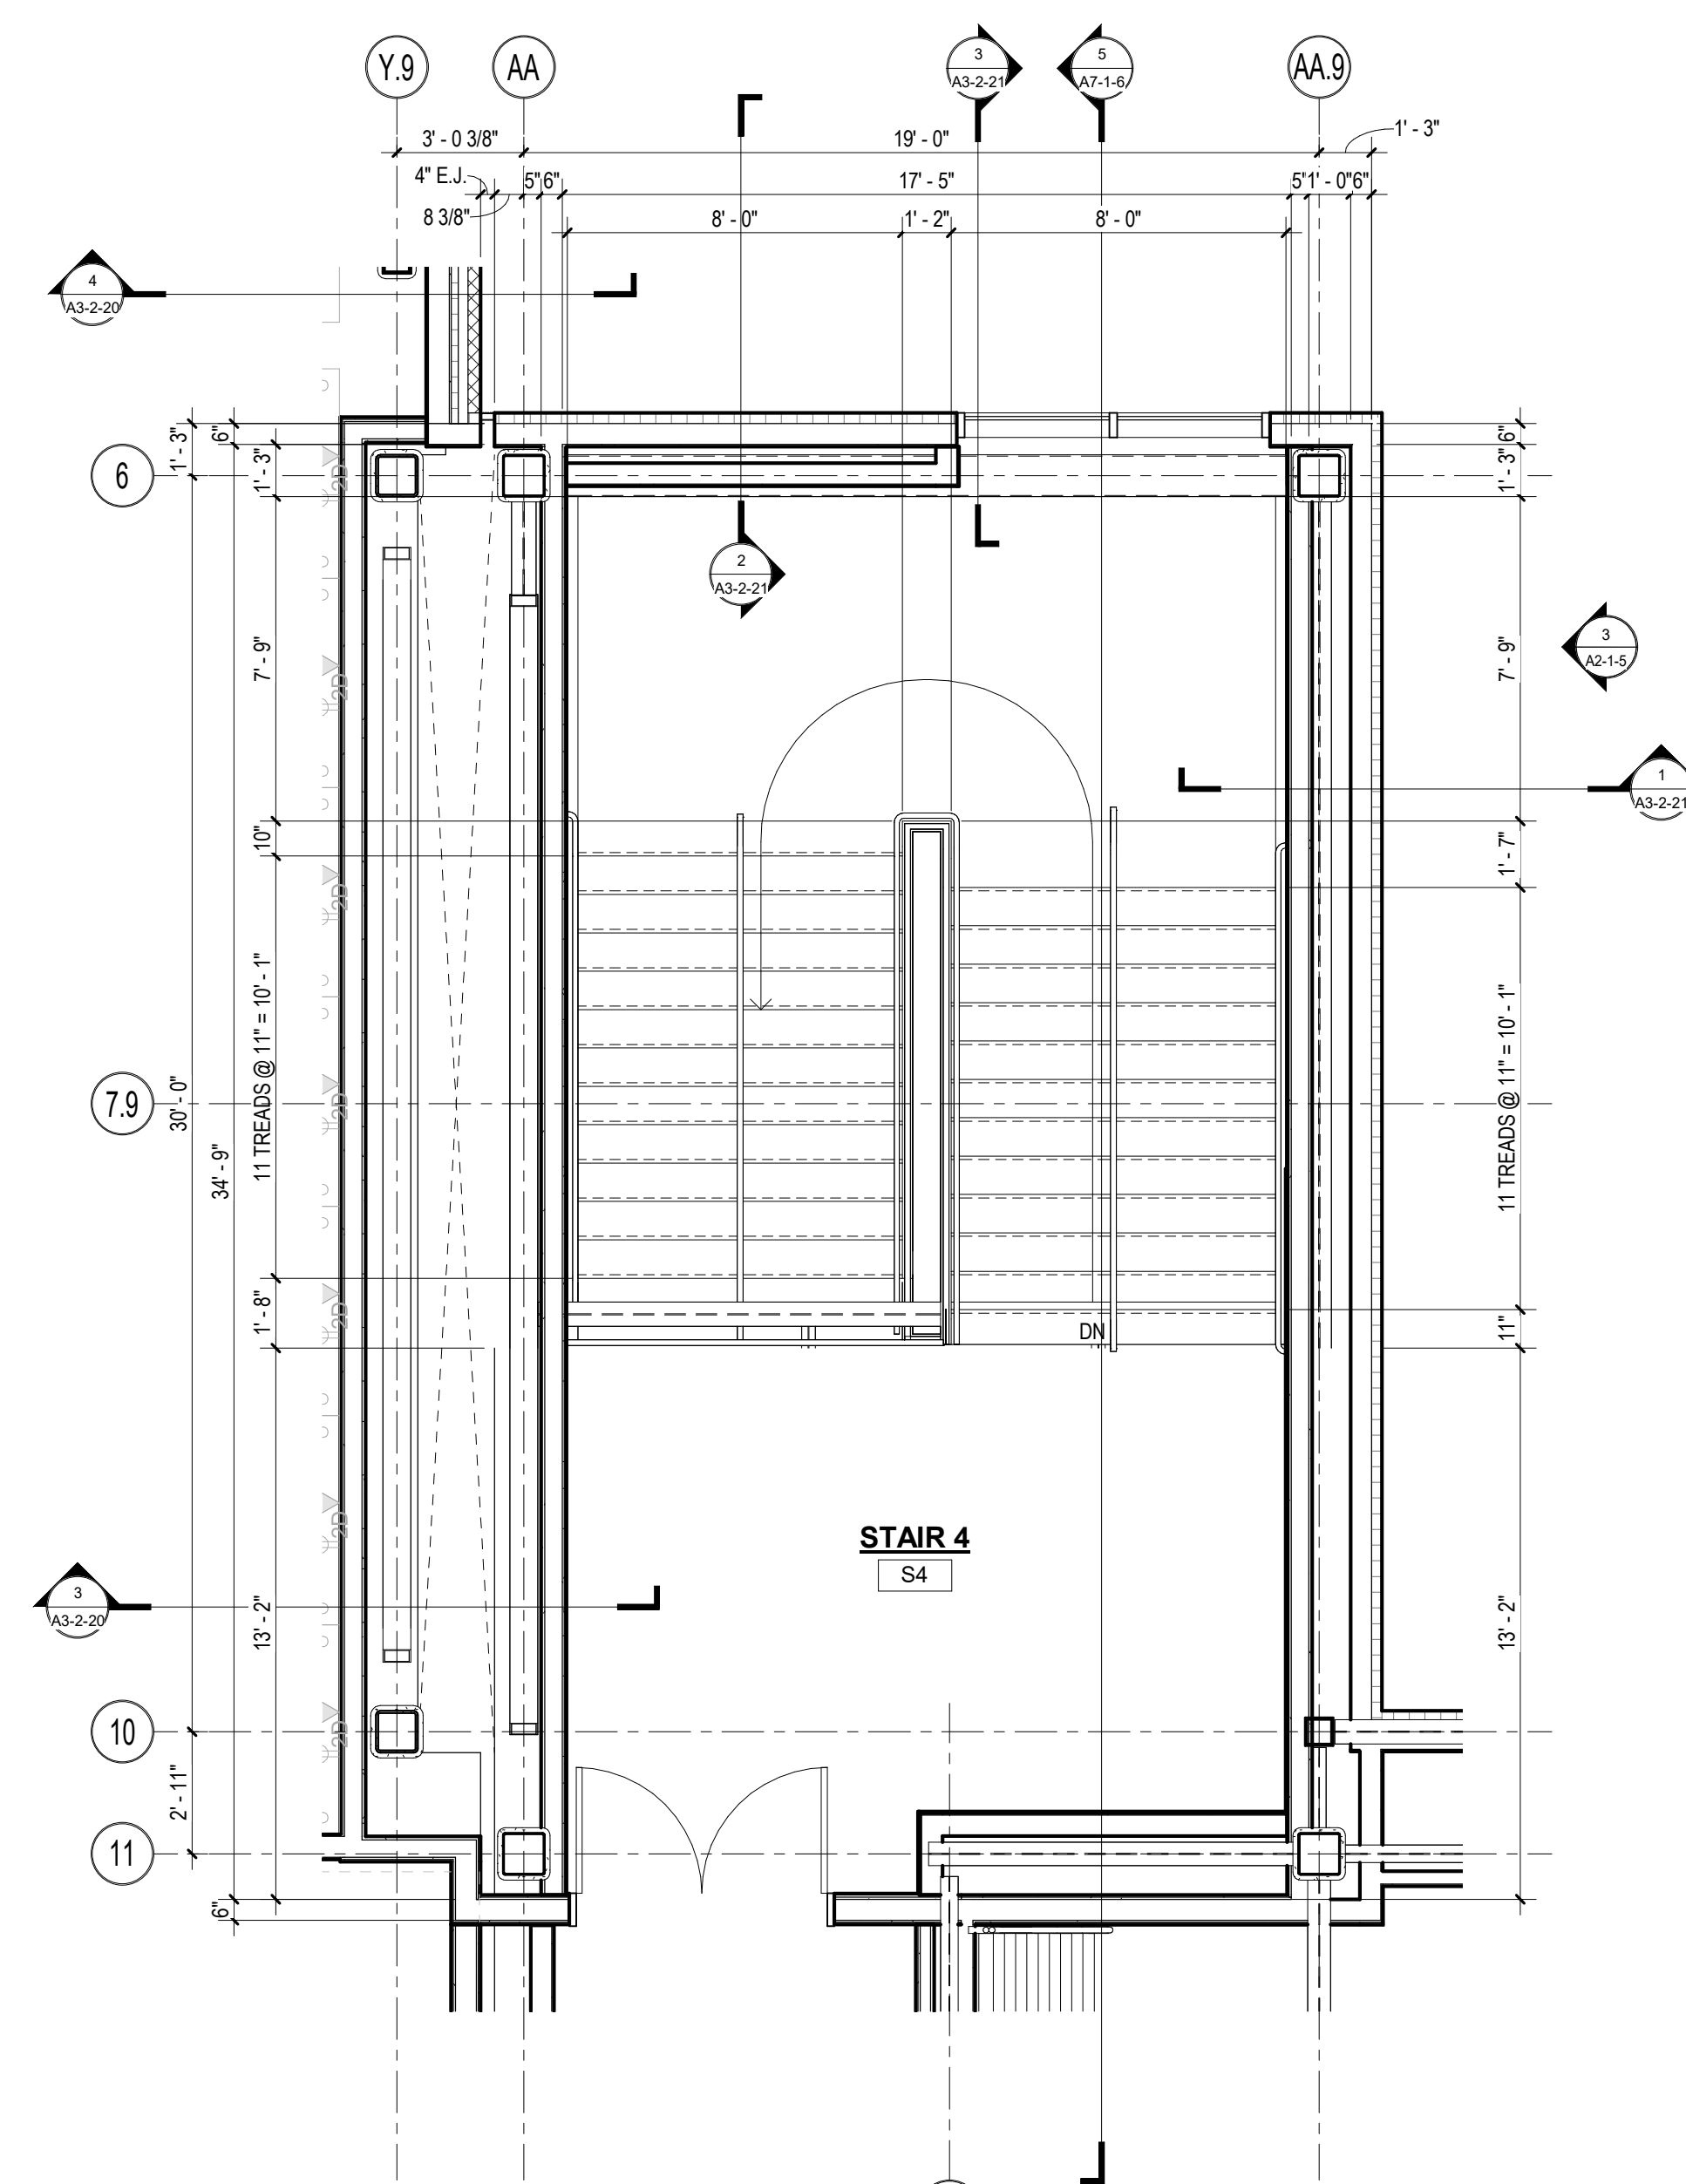


4 STAIR #4 PLAN - FOURTH FLOOR
1/4" = 1'-0"

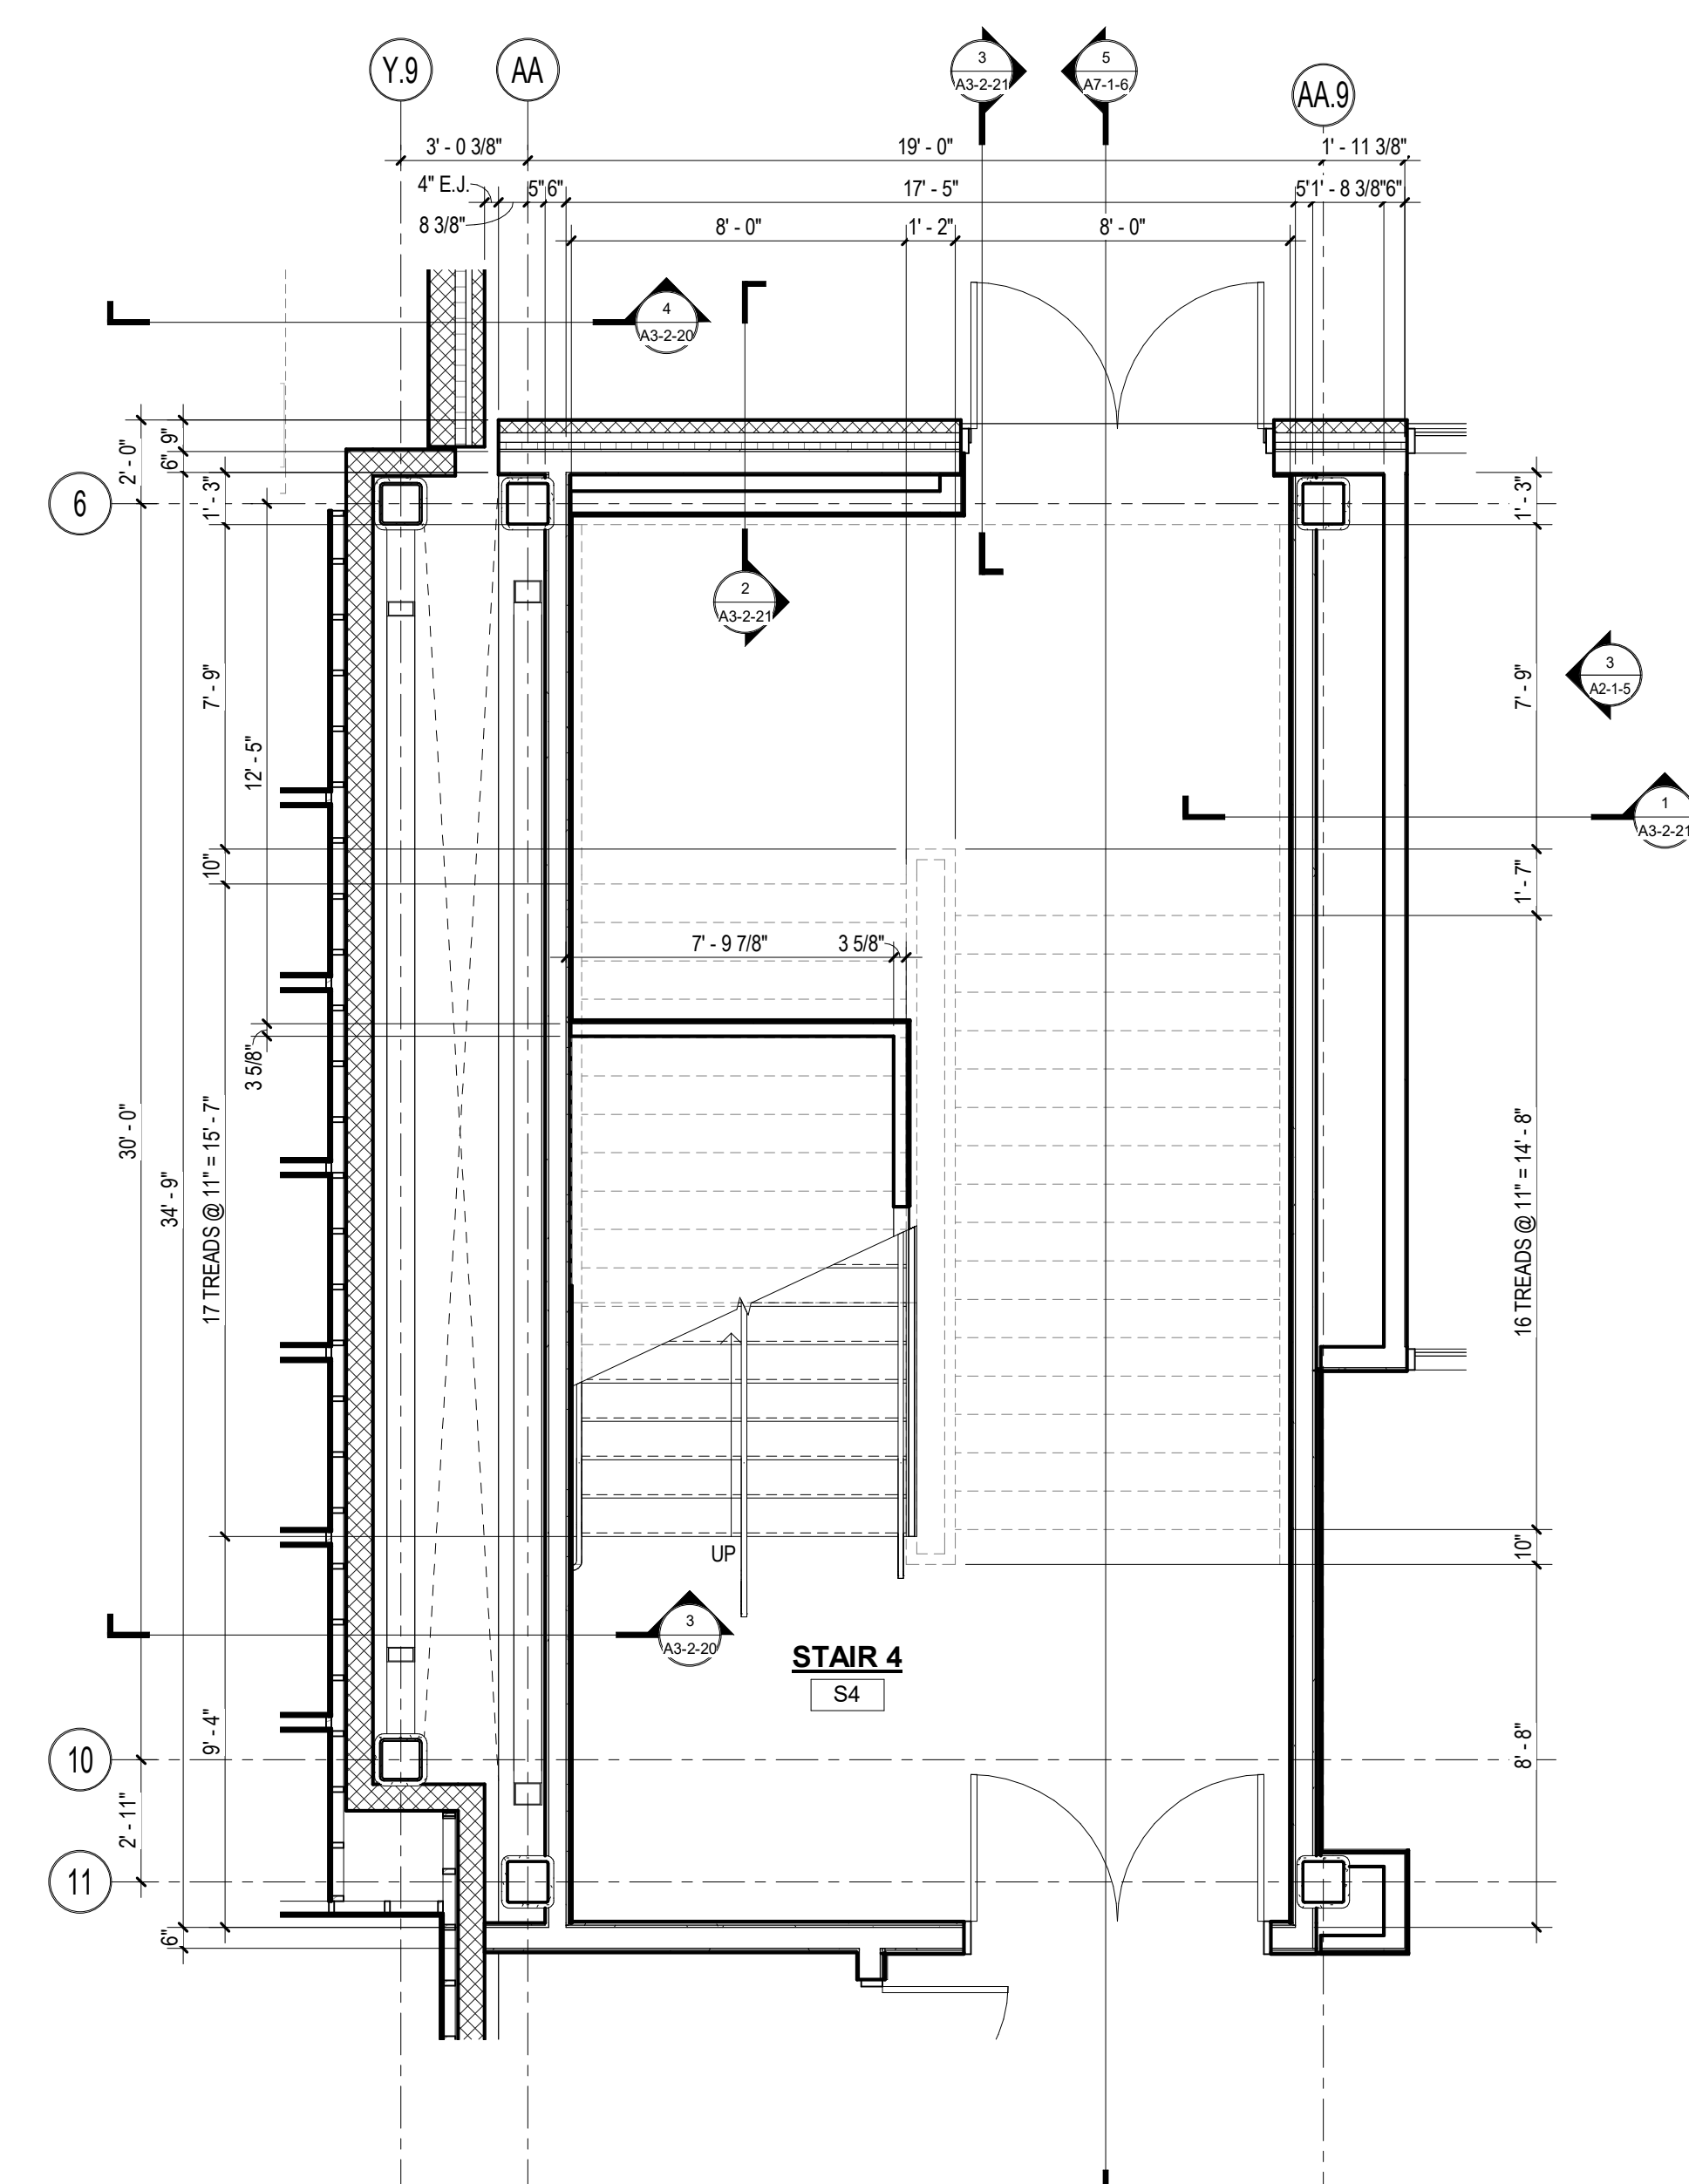

1 STAIR #4 PLAN - FIRST FLOOR
1/4" = 1'-0"

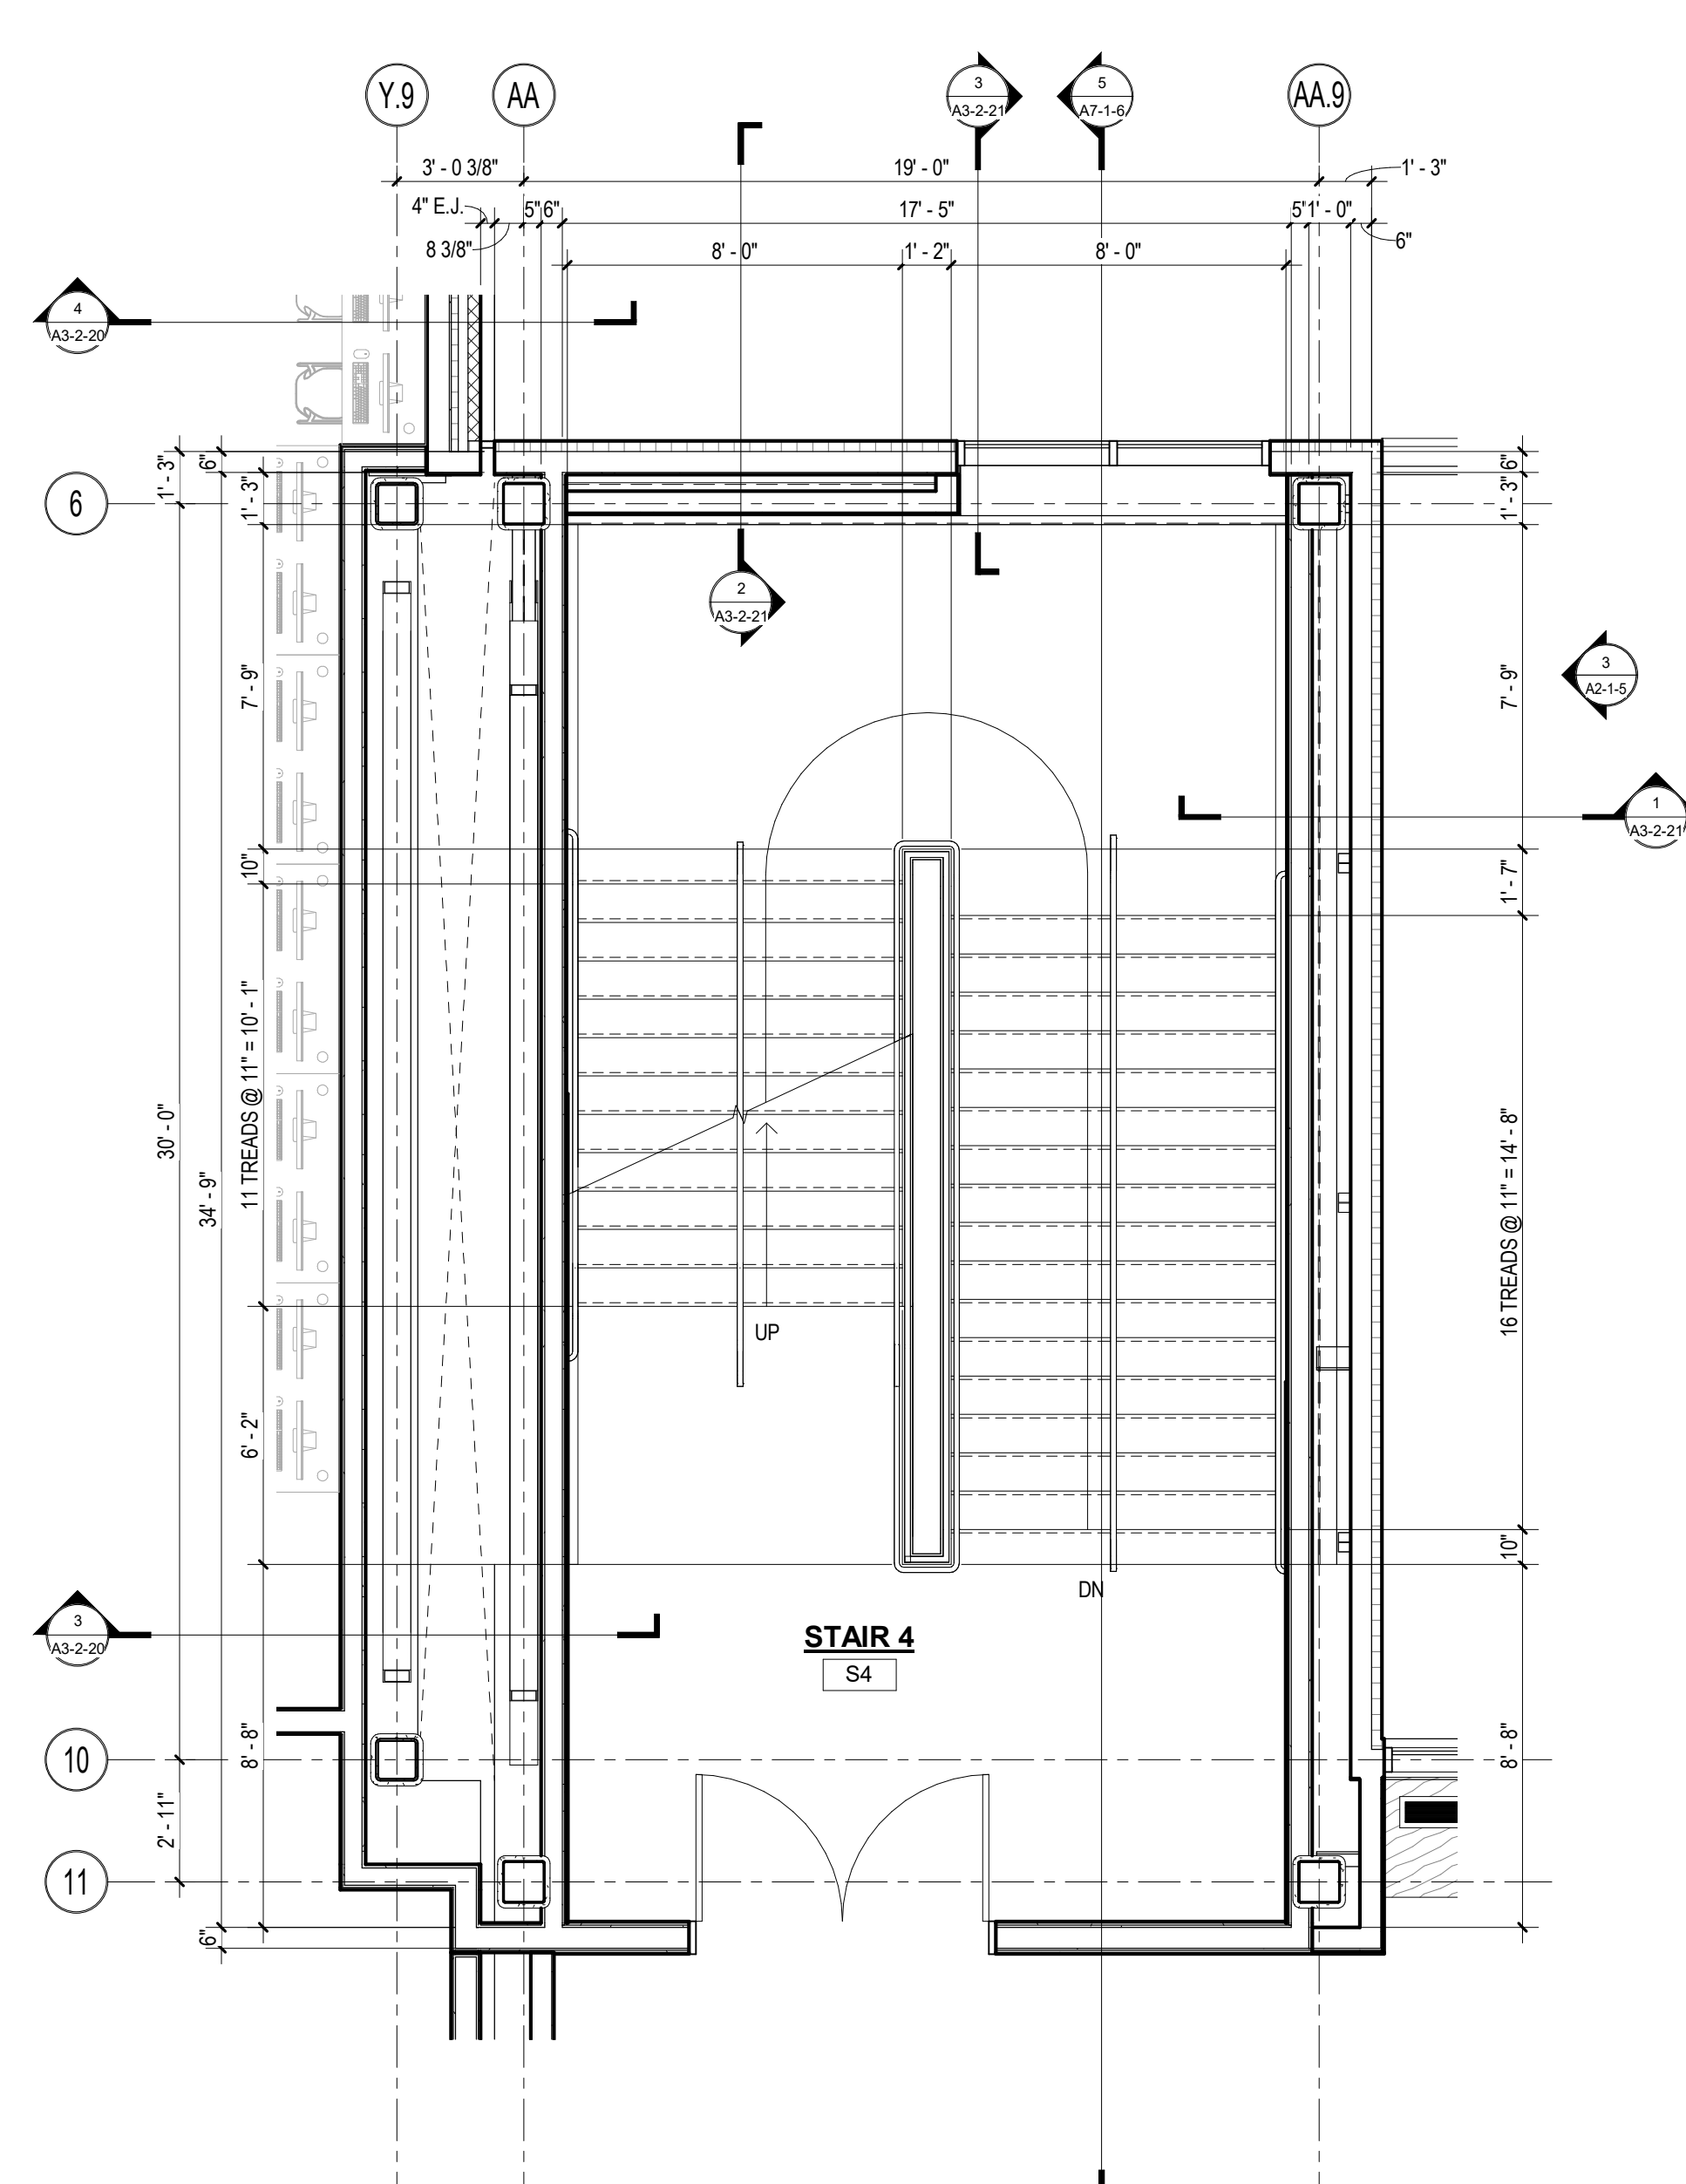


2 STAIR #4 PLAN - SECOND FLOOR
1/4" = 1'-0"

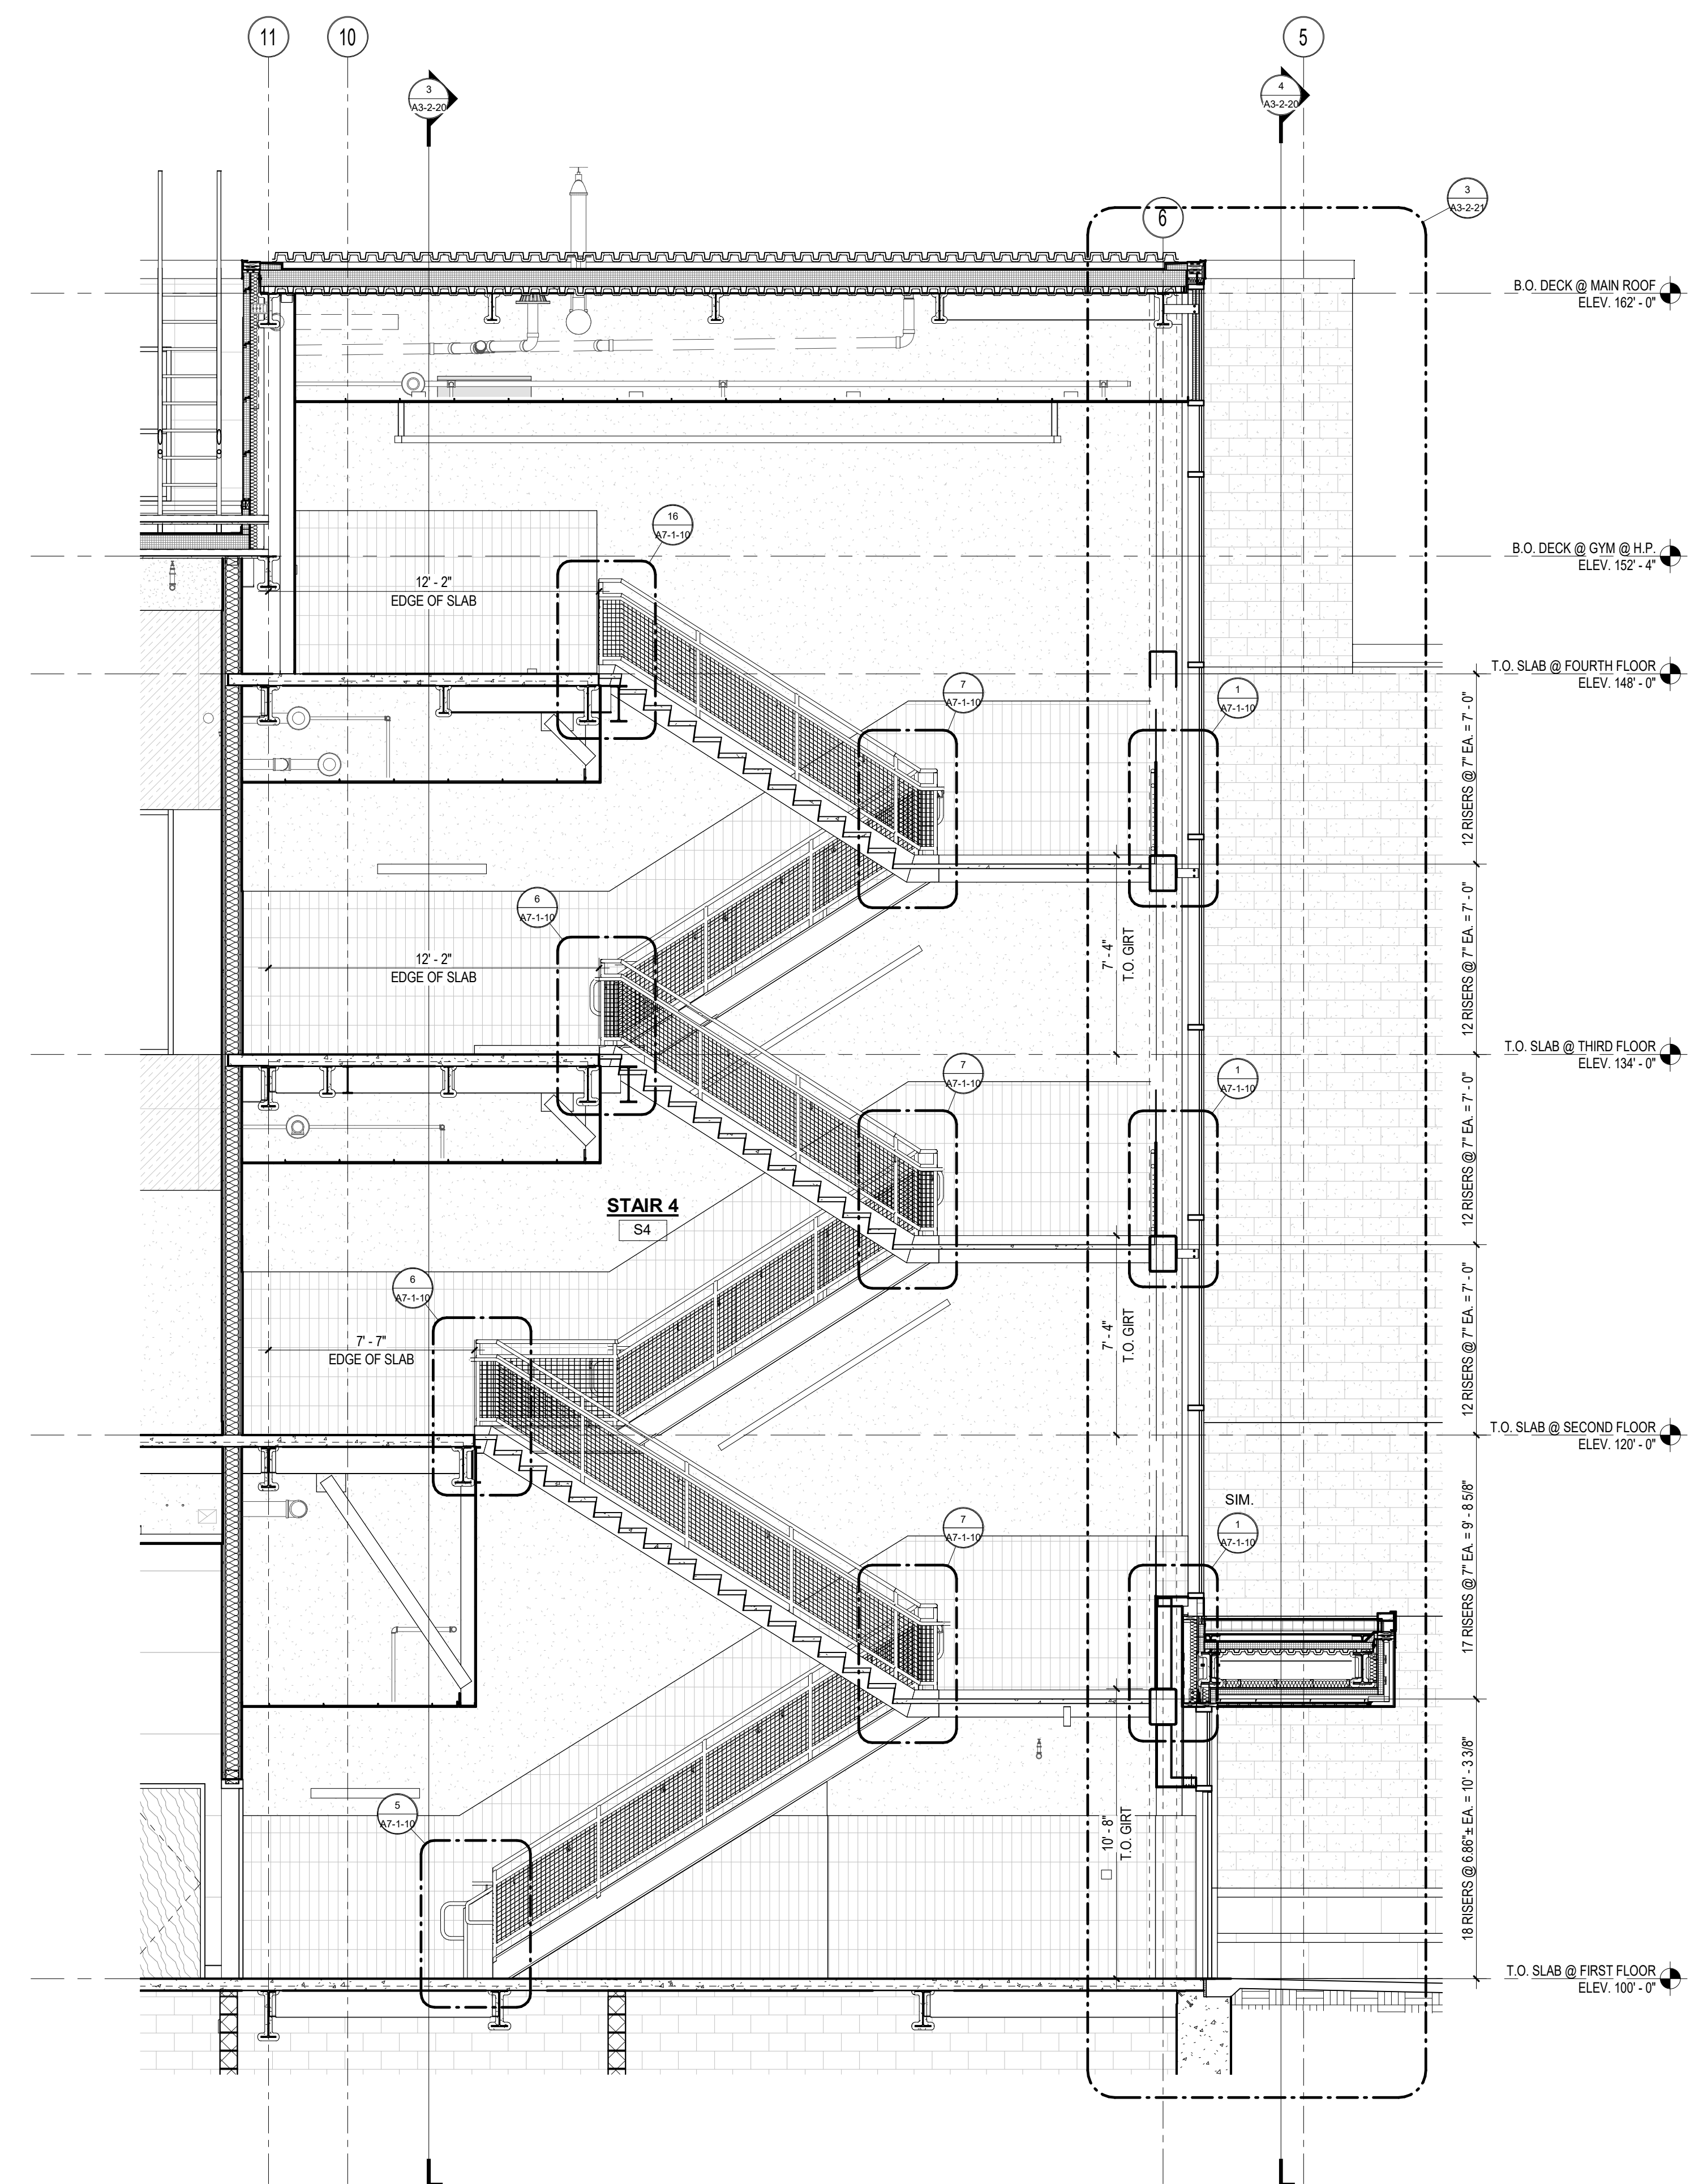

5 STAIR #4 SECTION
1/4" = 1'-0"


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023




KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**STAIR PLANS &
SECTIONS**

Scale: 1/4" = 1'-0"

Job No.: 20202



Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

A7-1-6

100 Hemlock Road,
Wakefield, MA 01880

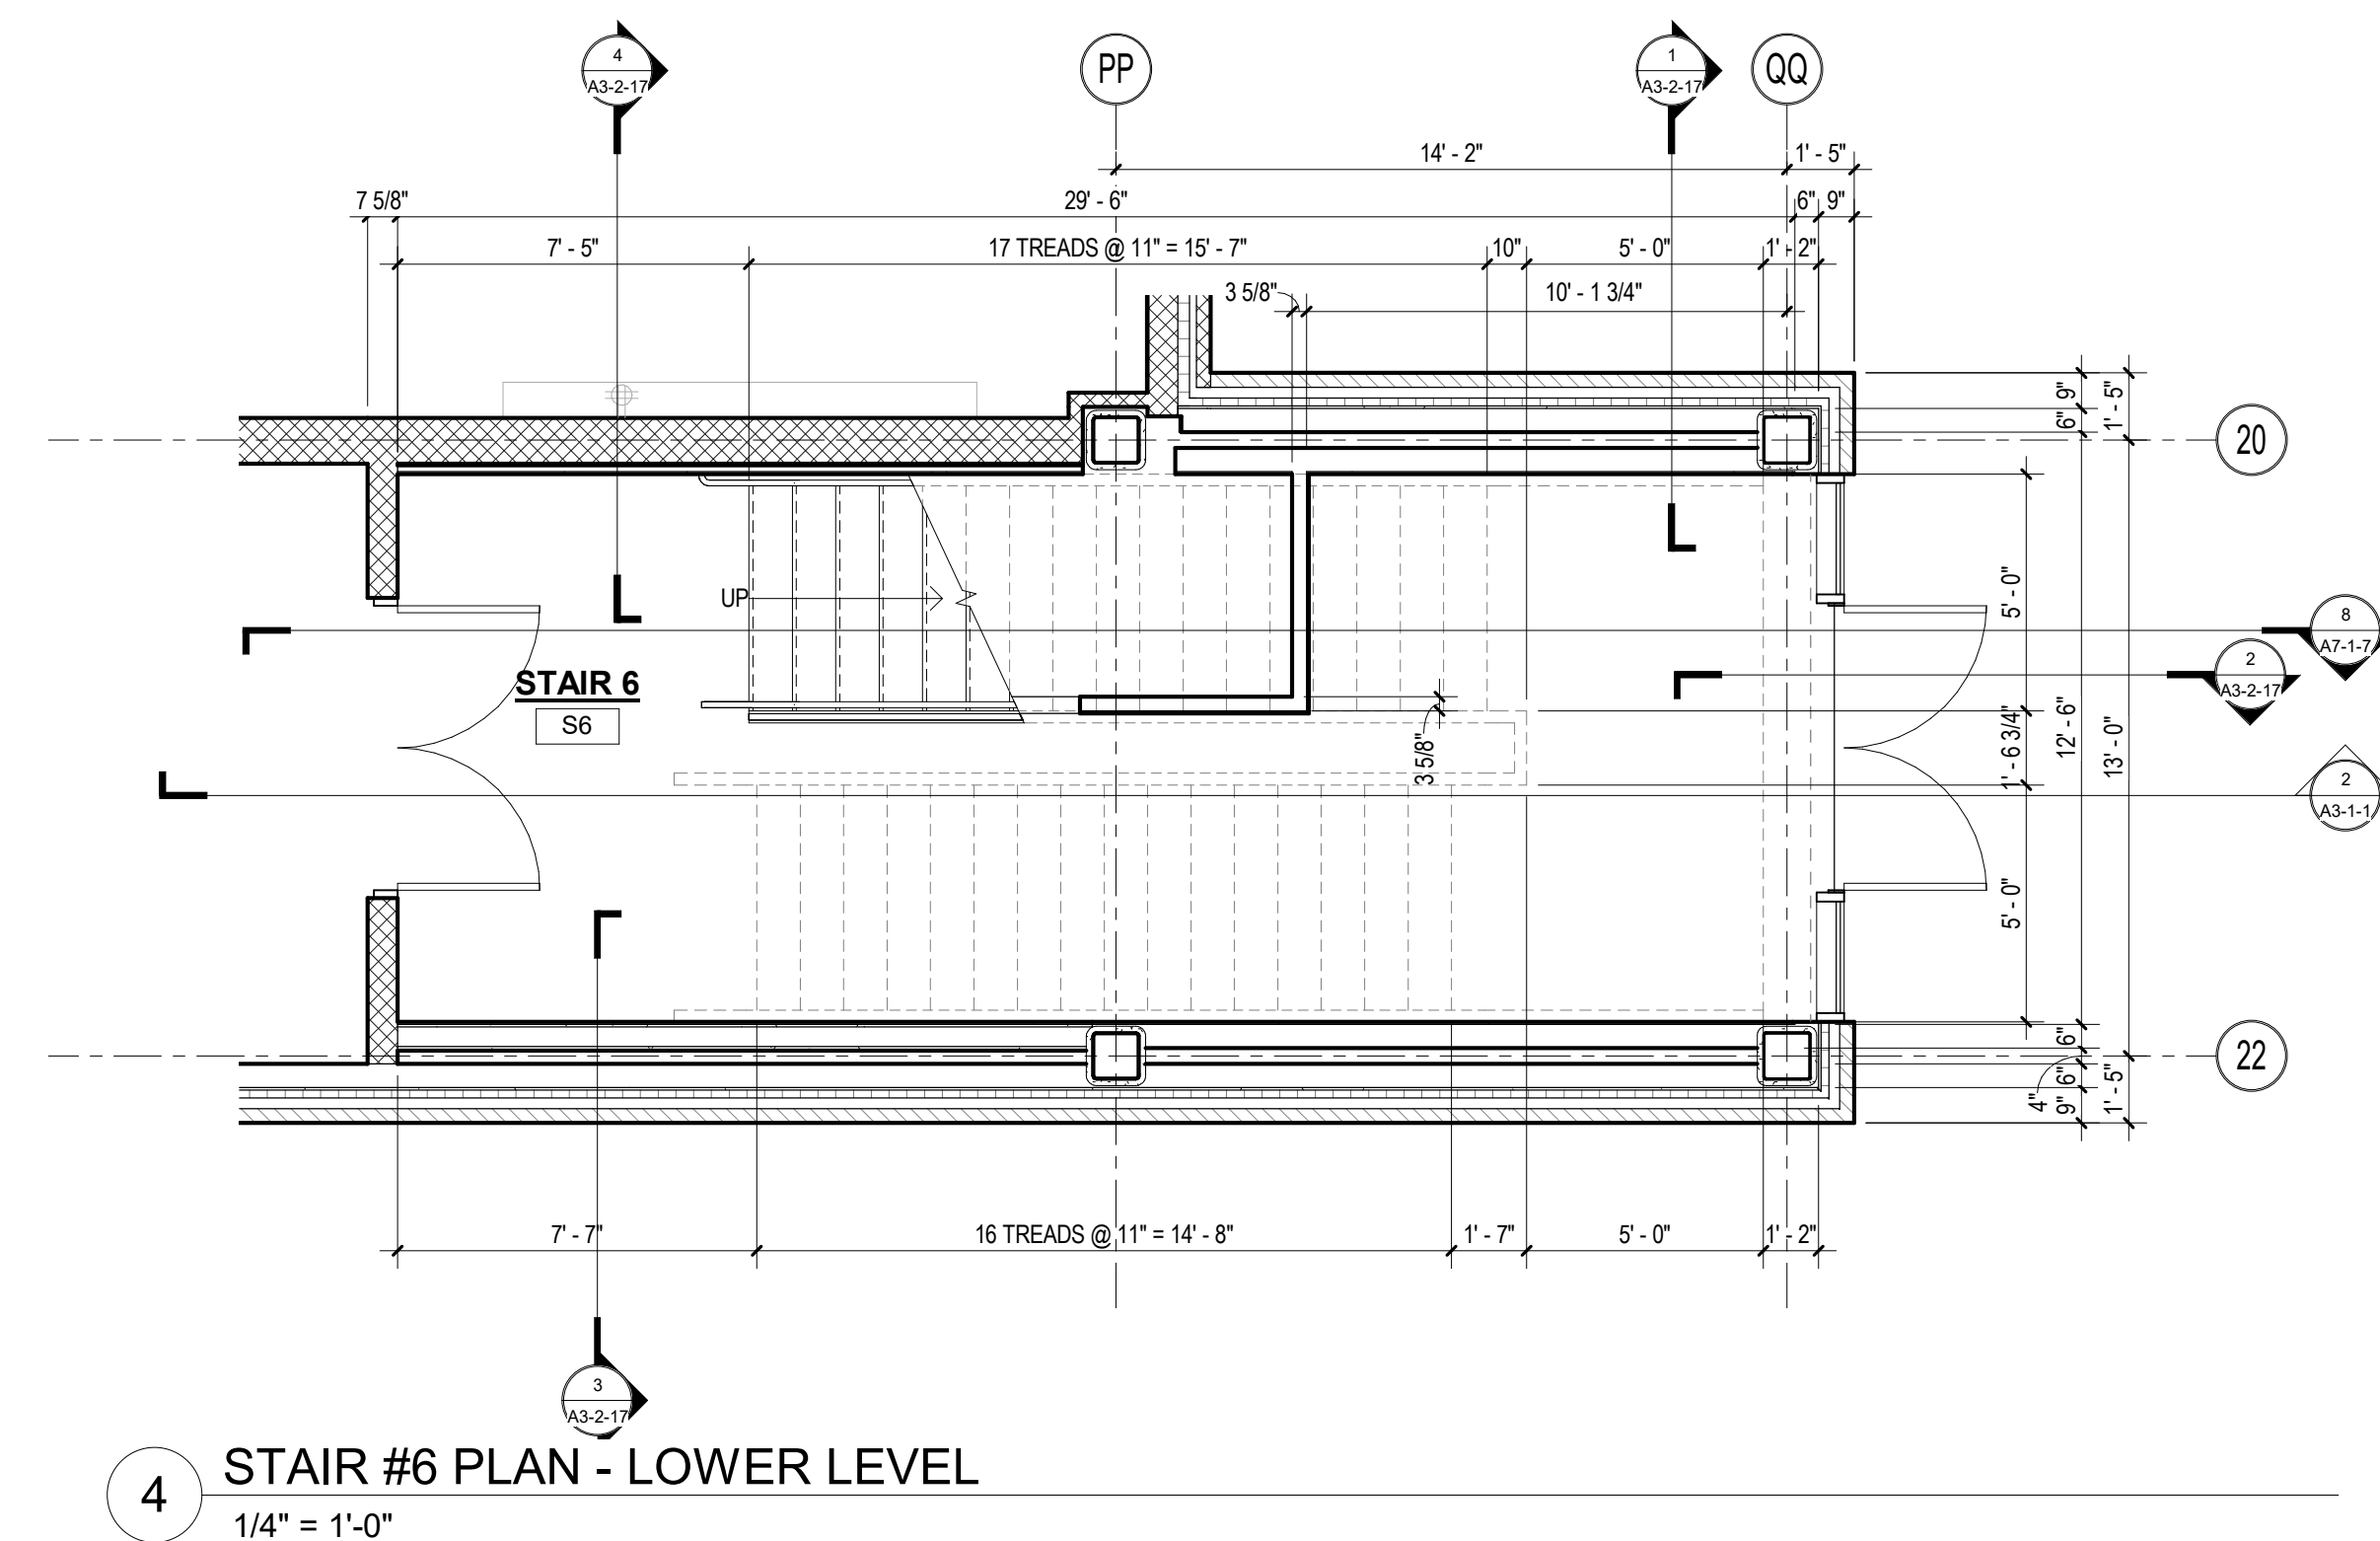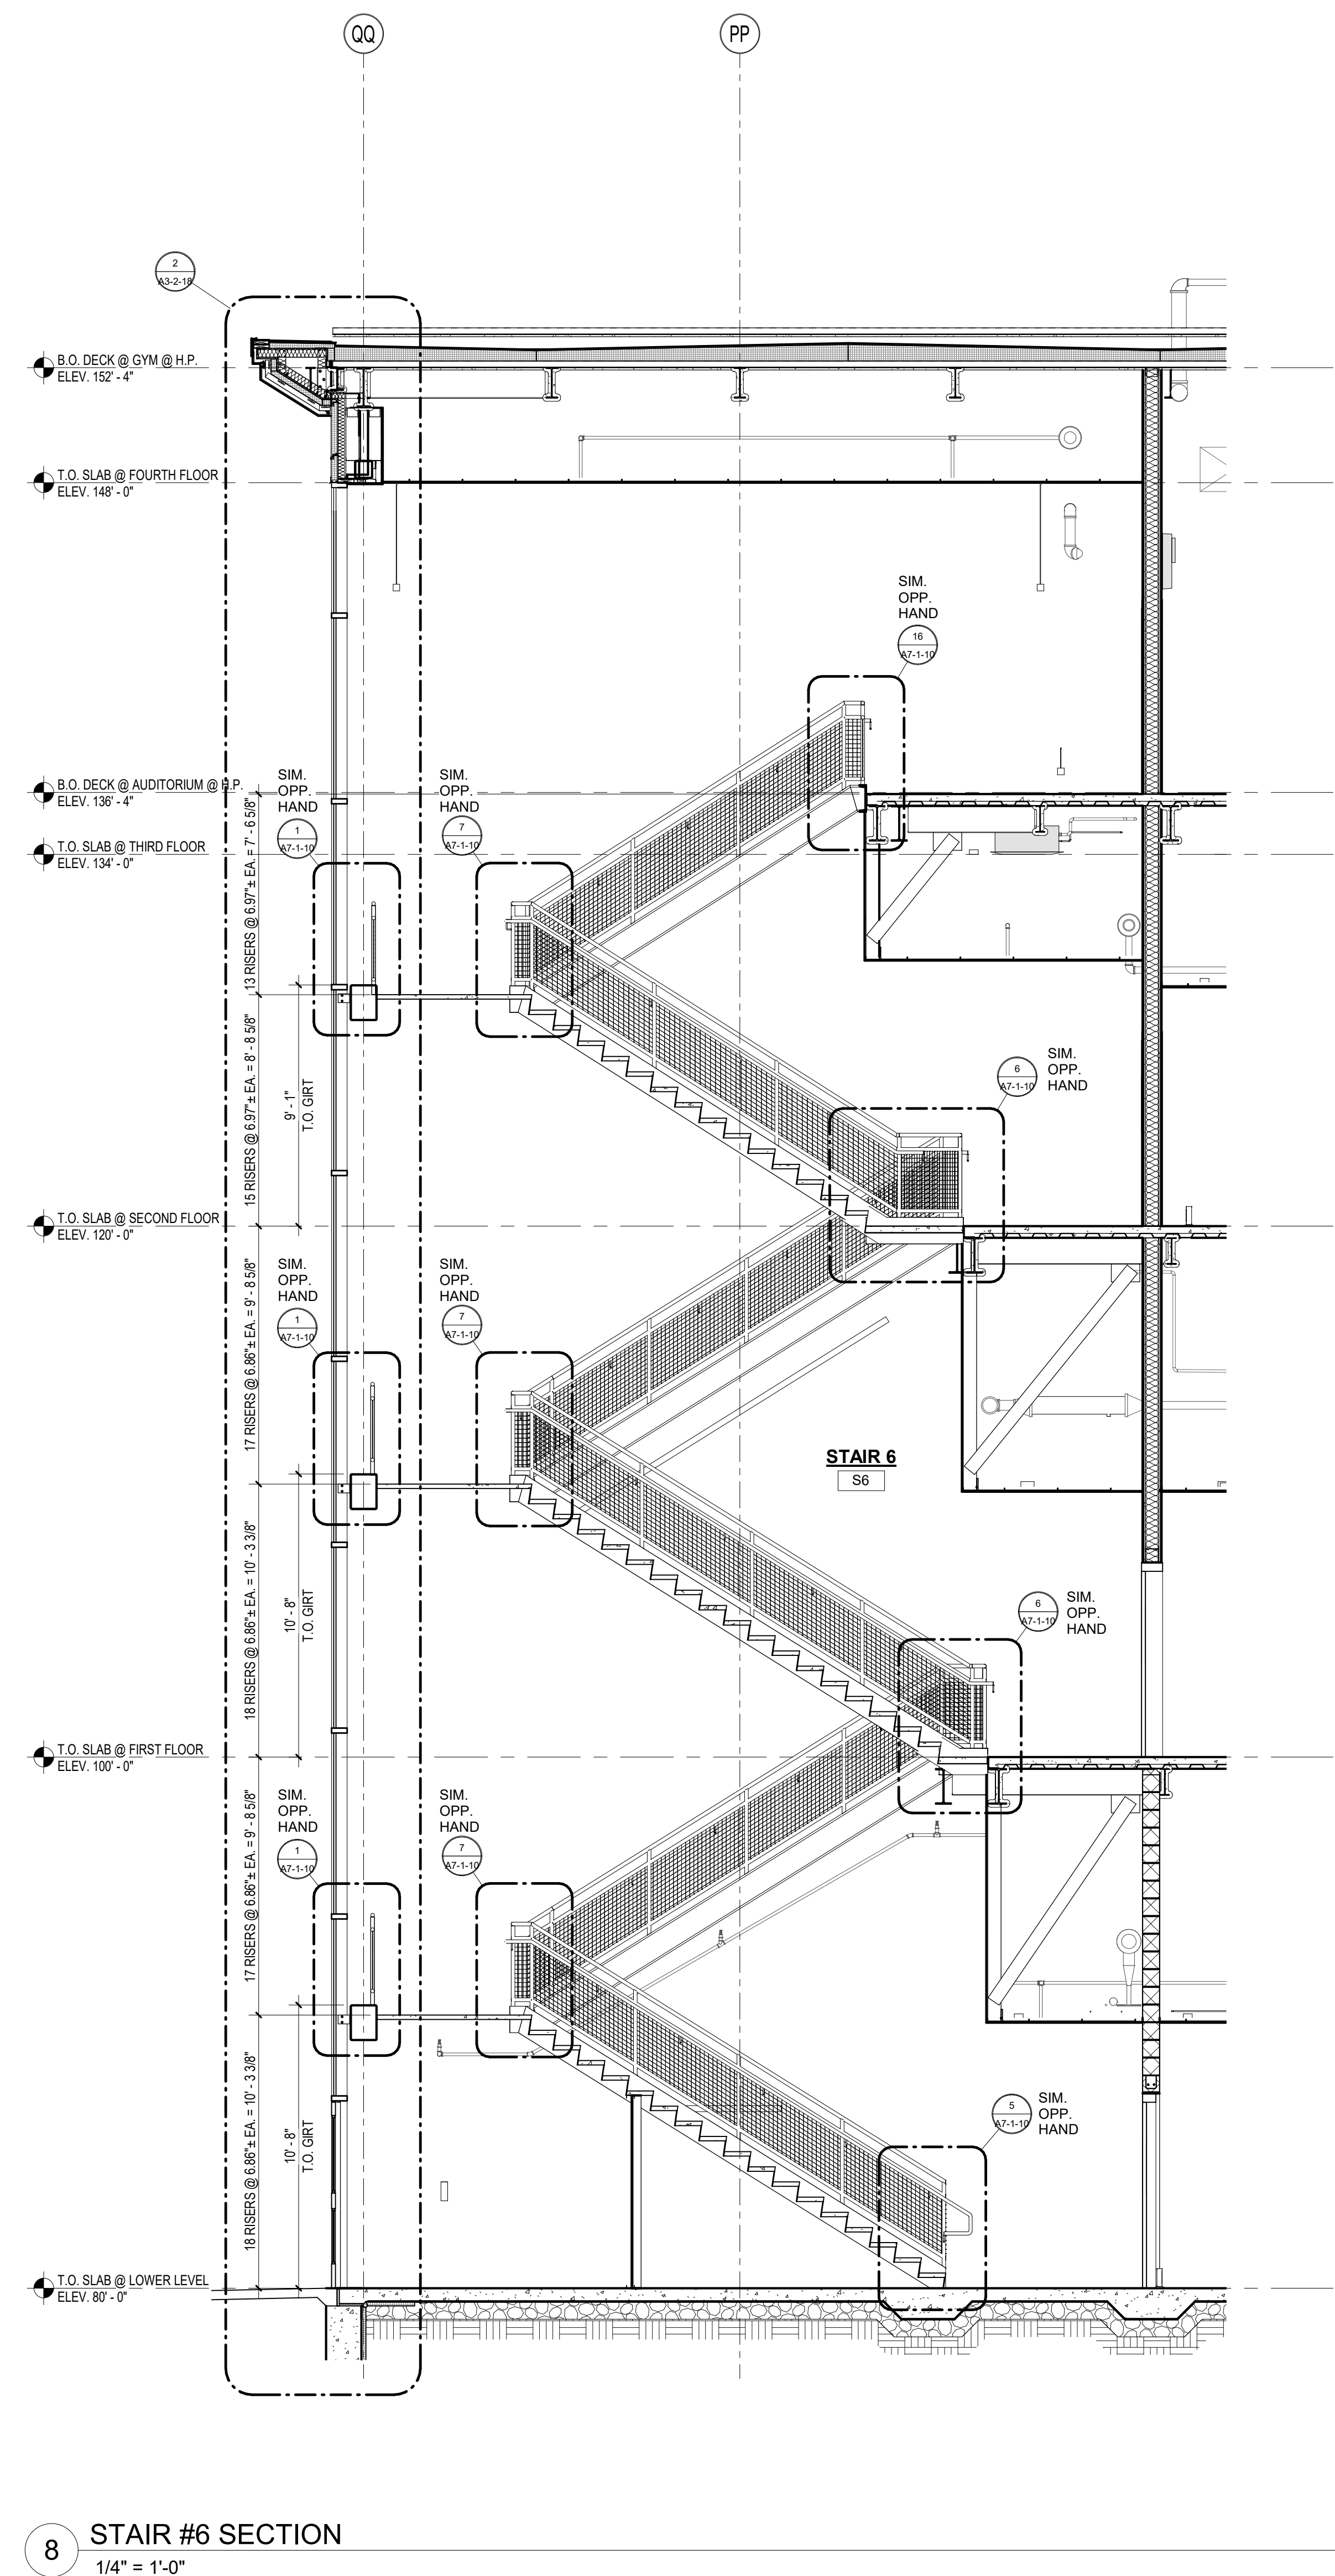



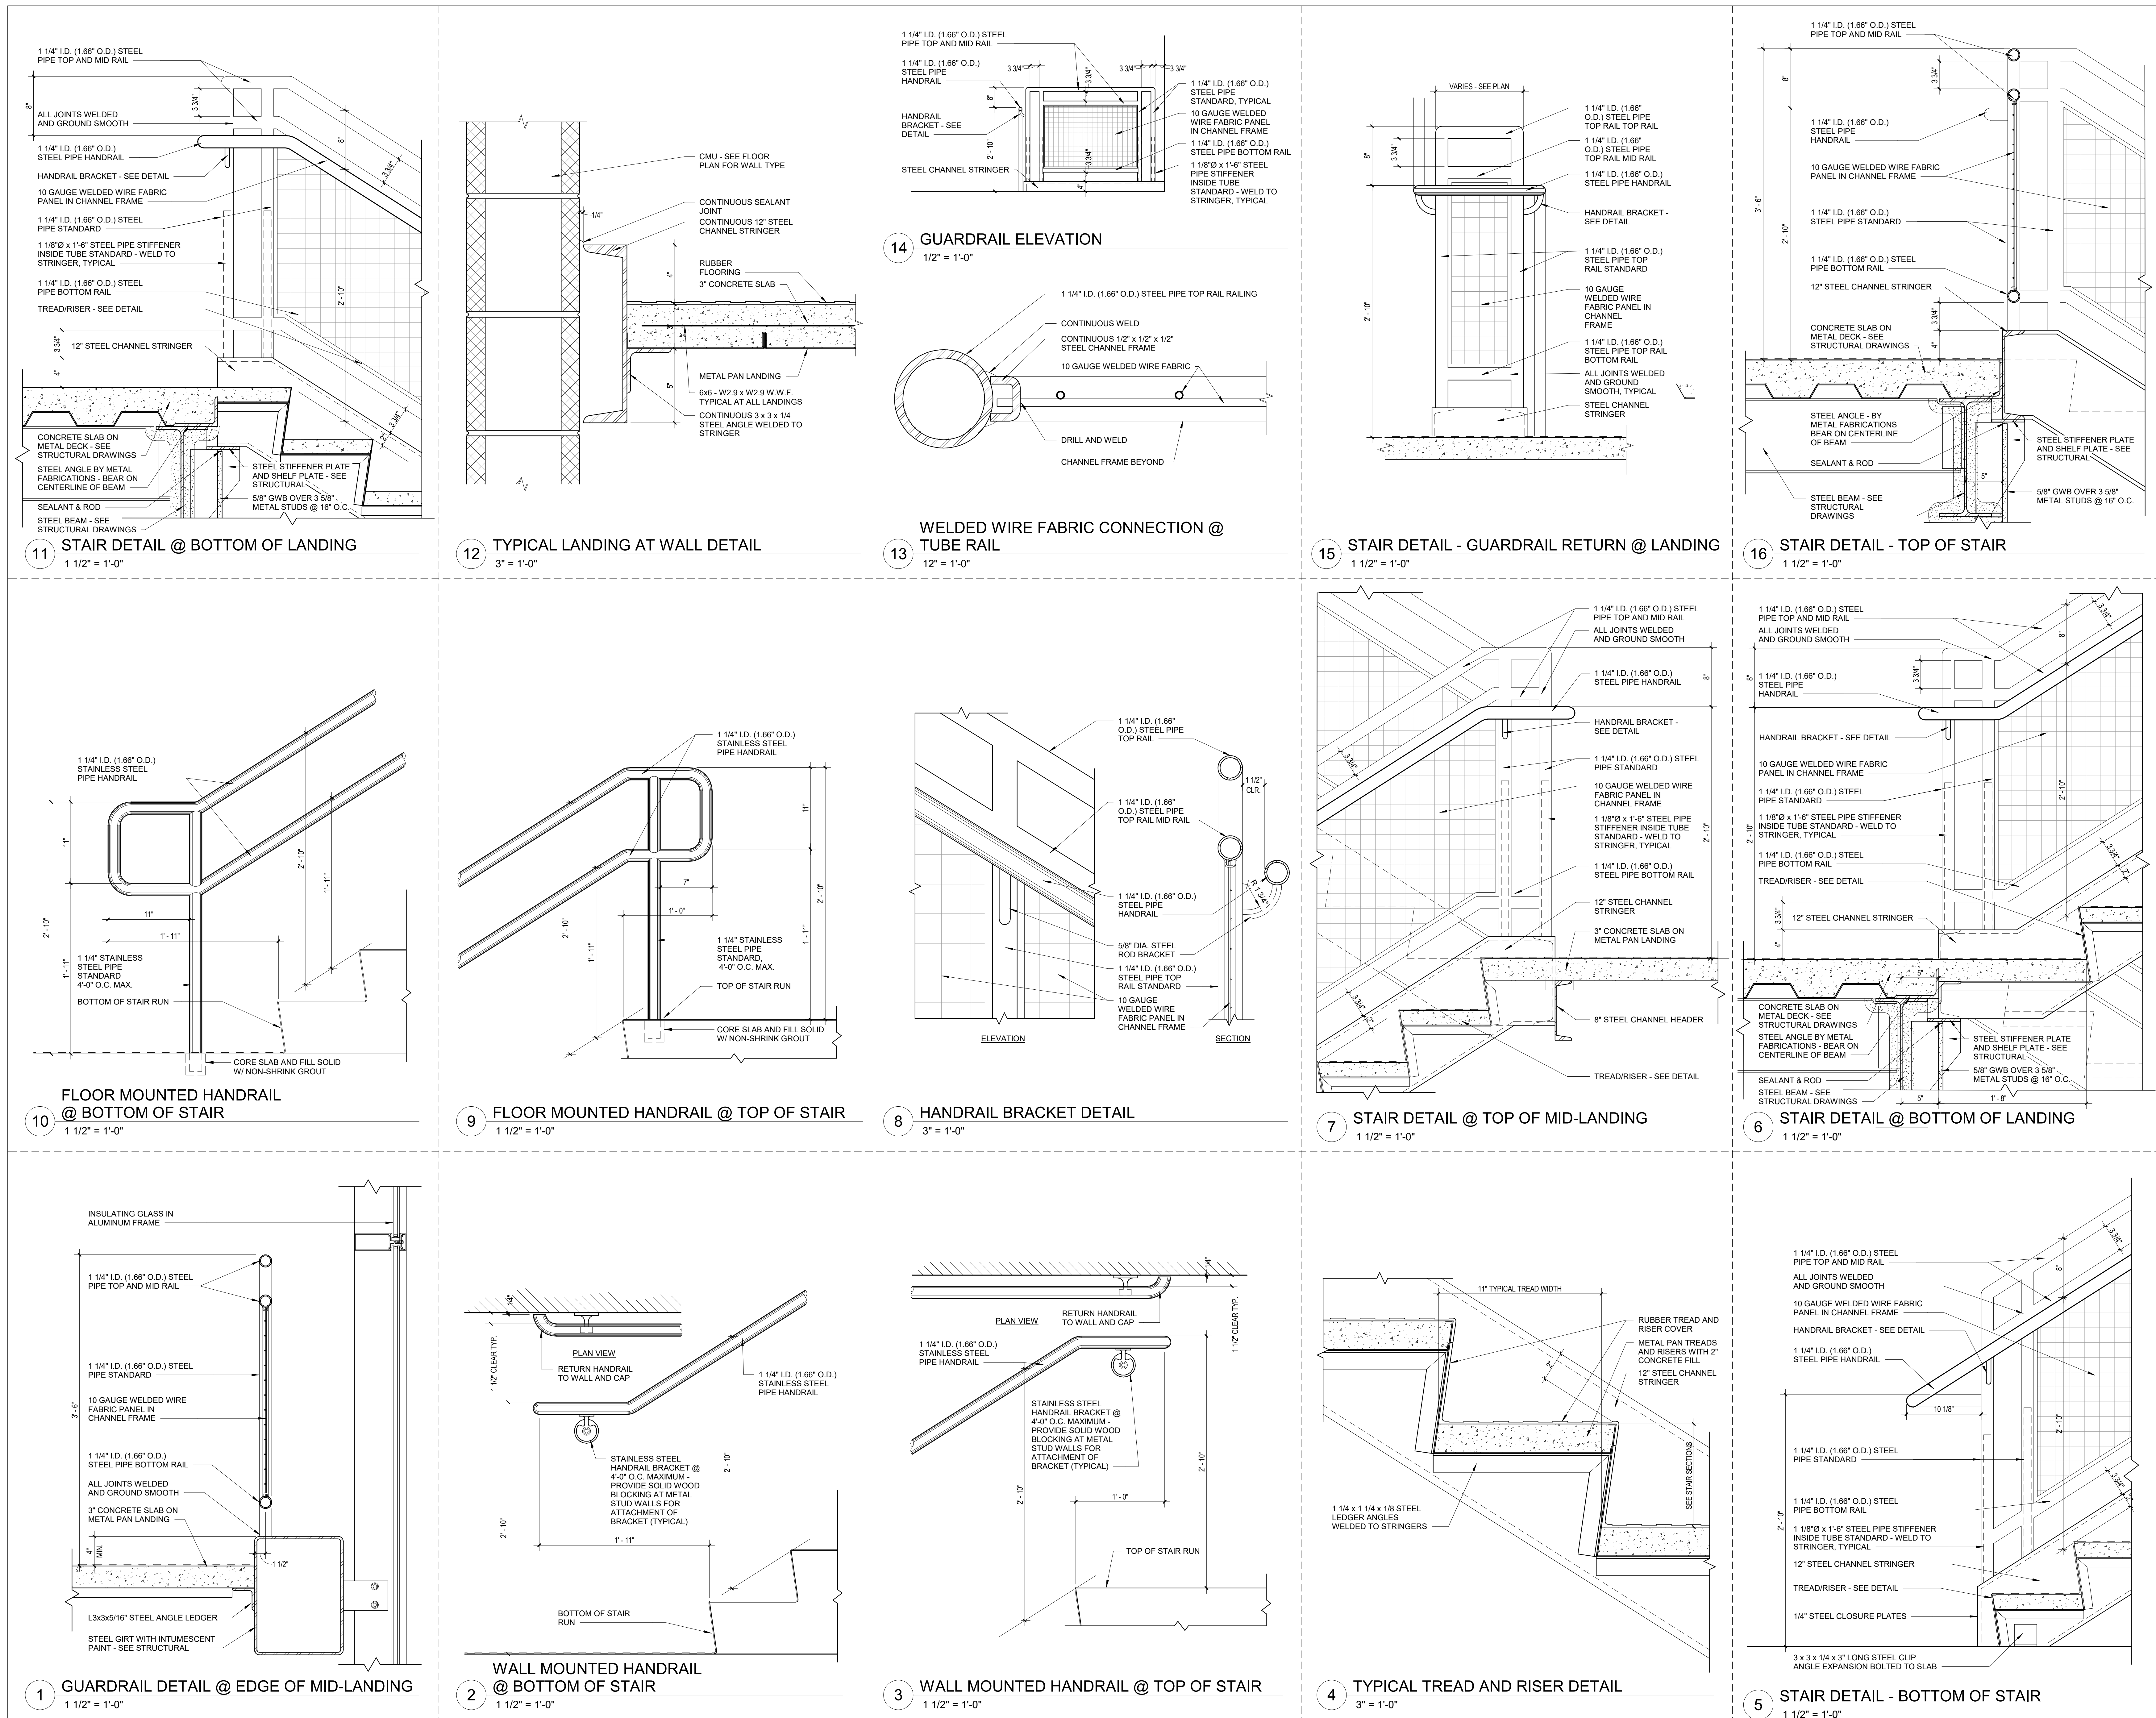

100 Hemlock Road,
Wakefield, MA 01880



STAIR DETAILS - ELEVATOR DETAILS, SPECIALTY DETAILS

100 Hemlock Road,
Wakefield, MA 01880




KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A7-1-12

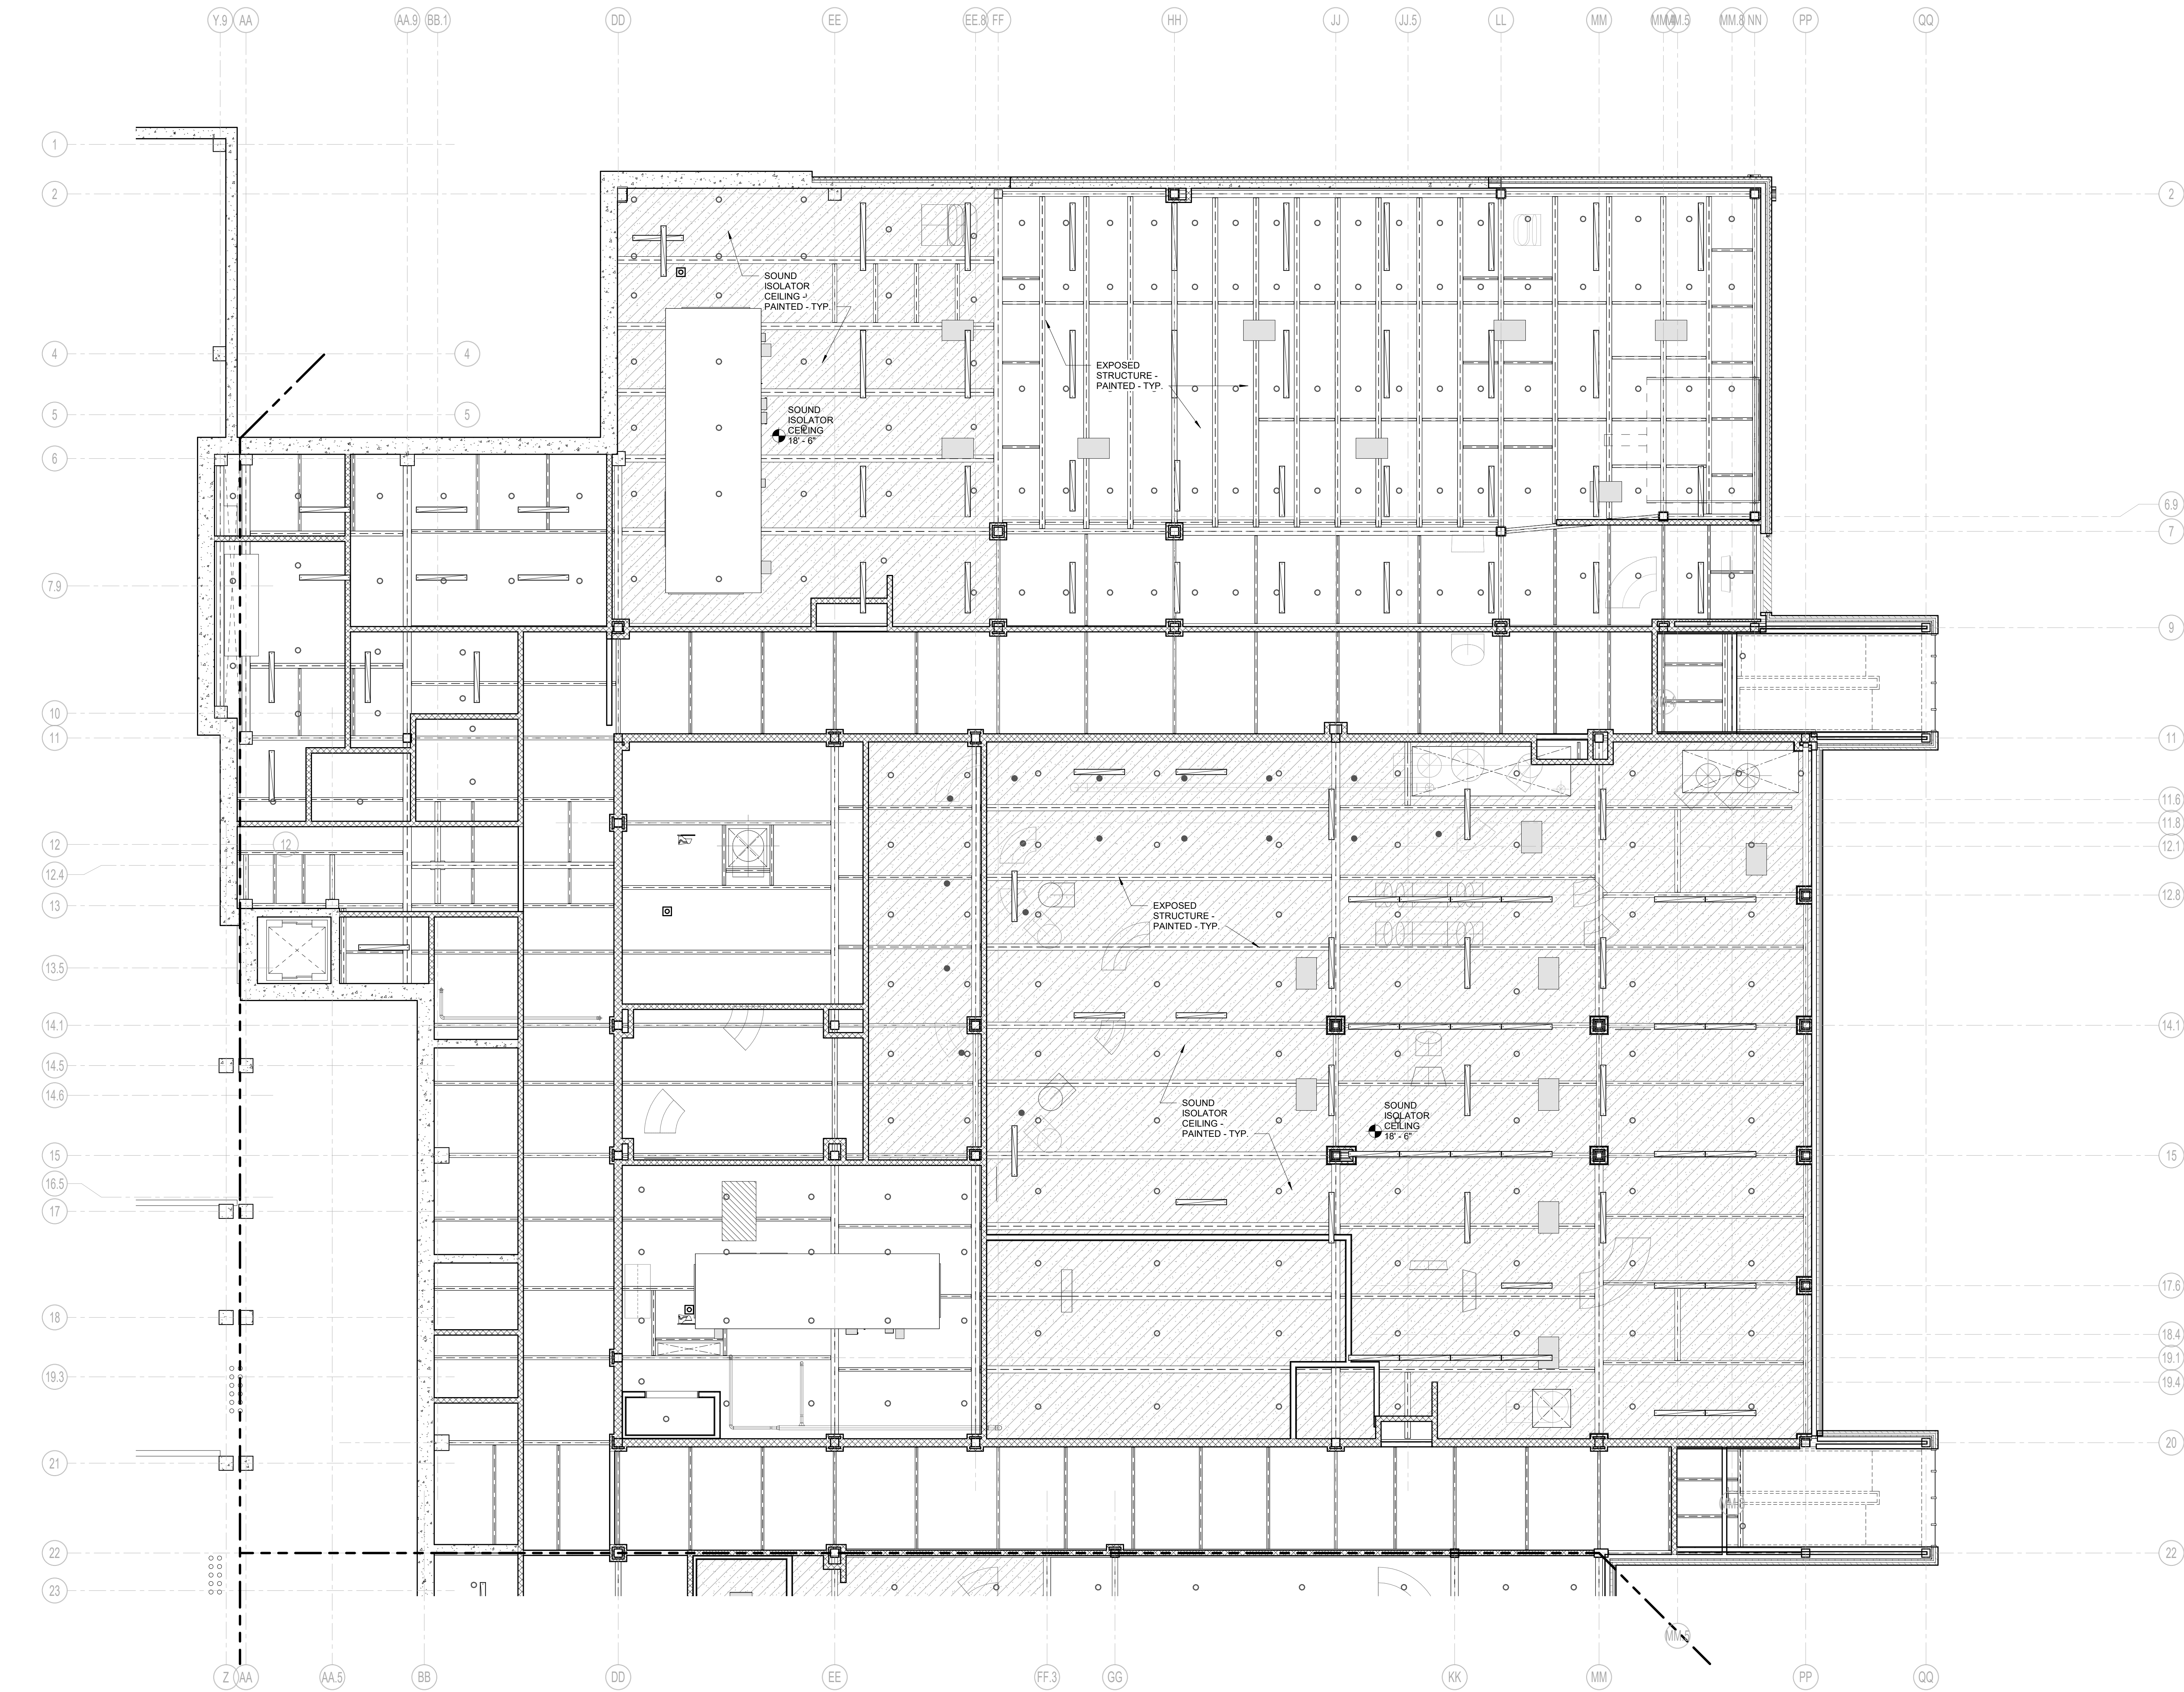

1 LOWER LEVEL MEZZANINE REFLECTED PLAN - AREA C
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.draa.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:	
	CEILING TYPE 1' - 8"
	CEILING TYPE 2' - 8"
	CEILING TYPE 3' - 8"
	CEILING TYPE 4' - 8"
	CEILING TYPE 5' - 8"
	CEILING TYPE 6' - 8"
	CEILING TYPE 7' - 8"
	CEILING TYPE 8' - 8"
	CEILING TYPE 9' - 8"
	CEILING TYPE 10' - 8"
	CEILING TYPE 11' - 8"
	CEILING TYPE 12' - 8"
	CEILING TYPE 13' - 8"
	CEILING TYPE 14' - 8"
	CEILING TYPE 15' - 8"
	CEILING TYPE 16' - 8"
	CEILING TYPE 17' - 8"
	CEILING TYPE 18' - 8"
	CEILING TYPE 19' - 8"
	CEILING TYPE 20' - 8"
	CEILING TYPE 21' - 8"
	CEILING TYPE 22' - 8"
	CEILING TYPE 23' - 8"
	CEILING TYPE 24' - 8"
	CEILING TYPE 25' - 8"
	CEILING TYPE 26' - 8"
	CEILING TYPE 27' - 8"
	CEILING TYPE 28' - 8"
	CEILING TYPE 29' - 8"
	CEILING TYPE 30' - 8"
	CEILING TYPE 31' - 8"
	CEILING TYPE 32' - 8"
	CEILING TYPE 33' - 8"
	CEILING TYPE 34' - 8"
	CEILING TYPE 35' - 8"
	CEILING TYPE 36' - 8"
	CEILING TYPE 37' - 8"
	CEILING TYPE 38' - 8"
	CEILING TYPE 39' - 8"
	CEILING TYPE 40' - 8"
	CEILING TYPE 41' - 8"
	CEILING TYPE 42' - 8"
	CEILING TYPE 43' - 8"
	CEILING TYPE 44' - 8"
	CEILING TYPE 45' - 8"
	CEILING TYPE 46' - 8"
	CEILING TYPE 47' - 8"
	CEILING TYPE 48' - 8"
	CEILING TYPE 49' - 8"
	CEILING TYPE 50' - 8"
	CEILING TYPE 51' - 8"
	CEILING TYPE 52' - 8"
	CEILING TYPE 53' - 8"
	CEILING TYPE 54' - 8"
	CEILING TYPE 55' - 8"
	CEILING TYPE 56' - 8"
	CEILING TYPE 57' - 8"
	CEILING TYPE 58' - 8"
	CEILING TYPE 59' - 8"
	CEILING TYPE 60' - 8"
	CEILING TYPE 61' - 8"
	CEILING TYPE 62' - 8"
	CEILING TYPE 63' - 8"
	CEILING TYPE 64' - 8"
	CEILING TYPE 65' - 8"
	CEILING TYPE 66' - 8"
	CEILING TYPE 67' - 8"
	CEILING TYPE 68' - 8"
	CEILING TYPE 69' - 8"
	CEILING TYPE 70' - 8"
	CEILING TYPE 71' - 8"
	CEILING TYPE 72' - 8"
	CEILING TYPE 73' - 8"
	CEILING TYPE 74' - 8"
	CEILING TYPE 75' - 8"
	CEILING TYPE 76' - 8"
	CEILING TYPE 77' - 8"
	CEILING TYPE 78' - 8"
	CEILING TYPE 79' - 8"
	CEILING TYPE 80' - 8"
	CEILING TYPE 81' - 8"
	CEILING TYPE 82' - 8"
	CEILING TYPE 83' - 8"
	CEILING TYPE 84' - 8"
	CEILING TYPE 85' - 8"
	CEILING TYPE 86' - 8"
	CEILING TYPE 87' - 8"
	CEILING TYPE 88' - 8"
	CEILING TYPE 89' - 8"
	CEILING TYPE 90' - 8"
	CEILING TYPE 91' - 8"
	CEILING TYPE 92' - 8"
	CEILING TYPE 93' - 8"
	CEILING TYPE 94' - 8"
	CEILING TYPE 95' - 8"
	CEILING TYPE 96' - 8"
	CEILING TYPE 97' - 8"
	CEILING TYPE 98' - 8"
	CEILING TYPE 99' - 8"
	CEILING TYPE 100' - 8"
	CEILING TYPE 101' - 8"
	CEILING TYPE 102' - 8"
	CEILING TYPE 103' - 8"
	CEILING TYPE 104' - 8"
	CEILING TYPE 105' - 8"
	CEILING TYPE 106' - 8"
	CEILING TYPE 107' - 8"
	CEILING TYPE 108' - 8"
	CEILING TYPE 109' - 8"
	CEILING TYPE 110' - 8"
	CEILING TYPE 111' - 8"
	CEILING TYPE 112' - 8"
	CEILING TYPE 113' - 8"
	CEILING TYPE 114' - 8"
	CEILING TYPE 115' - 8"
	CEILING TYPE 116' - 8"
	CEILING TYPE 117' - 8"
	CEILING TYPE 118' - 8"
	CEILING TYPE 119' - 8"
	CEILING TYPE 120' - 8"
	CEILING TYPE 121' - 8"
	CEILING TYPE 122' - 8"
	CEILING TYPE 123' - 8"
	CEILING TYPE 124' - 8"
	CEILING TYPE 125' - 8"
	CEILING TYPE 126' - 8"
	CEILING TYPE 127' - 8"
	CEILING TYPE 128' - 8"
	CEILING TYPE 129' - 8"
	CEILING TYPE 130' - 8"
	CEILING TYPE 131' - 8"
	CEILING TYPE 132' - 8"
	CEILING TYPE 133' - 8"
	CEILING TYPE 134' - 8"
	CEILING TYPE 135' - 8"
	CEILING TYPE 136' - 8"
	CEILING TYPE 137' - 8"
	CEILING TYPE 138' - 8"
	CEILING TYPE 139' - 8"
	CEILING TYPE 140' - 8"
	CEILING TYPE 141' - 8"
	CEILING TYPE 142' - 8"
	CEILING TYPE 143' - 8"
	CEILING TYPE 144' - 8"
	CEILING TYPE 145' - 8"
	CEILING TYPE 146' - 8"
	CEILING TYPE 147' - 8"
	CEILING TYPE 148' - 8"
	CEILING TYPE 149' - 8"
	CEILING TYPE 150' - 8"
	CEILING TYPE 151' - 8"
	CEILING TYPE 152' - 8"
	CEILING TYPE 153' - 8"
	CEILING TYPE 154' - 8"
	CEILING TYPE 155' - 8"
	CEILING TYPE 156' - 8"
	CEILING TYPE 157' - 8"
	CEILING TYPE 158' - 8"
	CEILING TYPE 159' - 8"
	CEILING TYPE 160' - 8"
	CEILING TYPE 161' - 8"
	CEILING TYPE 162' - 8"
	CEILING TYPE 163' - 8"
	CEILING TYPE 164' - 8"
	CEILING TYPE 165' - 8"
	CEILING TYPE 166' - 8"
	CEILING TYPE 167' - 8"
	CEILING TYPE 168' - 8"
	CEILING TYPE 169' - 8"
	CEILING TYPE 170' - 8"
	CEILING TYPE 171' - 8"
	CEILING TYPE 172' - 8"
	CEILING TYPE 173' - 8"
	CEILING TYPE 174' - 8"
	CEILING TYPE 175' - 8"
	CEILING TYPE 176' - 8"
	CEILING TYPE 177' - 8"
	CEILING TYPE 178' - 8"
	CEILING TYPE 179' - 8"
	CEILING TYPE 180' - 8"
	CEILING TYPE 181' - 8"
	CEILING TYPE 182' - 8"
	CEILING TYPE 183' - 8"
	CEILING TYPE 184' - 8"
	CEILING TYPE 185' - 8"
	CEILING TYPE 186' - 8"
	CEILING TYPE 187' - 8"
	CEILING TYPE 188' - 8"
	CEILING TYPE 189' - 8"
	CEILING TYPE 190' - 8"
	CEILING TYPE 191' - 8"
	CEILING TYPE 192' - 8"
	CEILING TYPE 193' - 8"
	CEILING TYPE 194' - 8"
	CEILING TYPE 195' - 8"
	CEILING TYPE 196' - 8"
	CEILING TYPE 197' - 8"
	CEILING TYPE 198' - 8"
	CEILING TYPE 199' - 8"
	CEILING TYPE 200' - 8"
	CEILING TYPE 201' - 8"
	CEILING TYPE 202' - 8"
	CEILING TYPE 203' - 8"
	CEILING TYPE 204' - 8"
	CEILING TYPE 205' - 8"
	CEILING TYPE 206' - 8"
	CEILING TYPE 207' - 8"
	CEILING TYPE 208' - 8"
	CEILING TYPE 209' - 8"
	CEILING TYPE 210' - 8"
	CEILING TYPE 211' - 8"
	CEILING TYPE 212' - 8"
	CEILING TYPE 213' - 8"
	CEILING TYPE 214' - 8"
	CEILING TYPE 215' - 8"
	CEILING TYPE 216' - 8"
	CEILING TYPE 217' - 8"
	CEILING TYPE 218' - 8"
	CEILING TYPE 219' - 8"
	CEILING TYPE 220' - 8"
	CEILING TYPE 221' - 8"
	CEILING TYPE 222' - 8"
	CEILING TYPE 223' - 8"
	CEILING TYPE 224' - 8"
	CEILING TYPE 225' - 8"
	CEILING TYPE 226' - 8"
	CEILING TYPE 227' - 8"
	CEILING TYPE 228' - 8"
	CEILING TYPE 229' - 8"
	CEILING TYPE 230' - 8"
	CEILING TYPE 231' - 8"
	CEILING TYPE 232' - 8"
	CEILING TYPE 233' - 8"
	CEILING TYPE 234' - 8"
	CEILING TYPE 235' - 8"
	CEILING TYPE 236' - 8"
	CEILING TYPE 237' - 8"
	CEILING TYPE 238' - 8"
	CEILING TYPE 239' - 8"
	CEILING TYPE 240' - 8"
	CEILING TYPE 241' - 8"
	CEILING TYPE 242' - 8"
	CEILING TYPE 243' - 8"
	CEILING TYPE 244' - 8"
	CEILING TYPE 245' - 8"
	CEILING TYPE 246' - 8"
	CEILING TYPE 247' - 8"
	CEILING TYPE 248' - 8"
	CEILING TYPE 249' - 8"
	CEILING TYPE 250' - 8"
	CEILING TYPE 251' - 8"
	CEILING TYPE 252' - 8"
	CEILING TYPE 253' - 8"
	CEILING TYPE 254' - 8"
	CEILING TYPE 255' - 8"
	CEILING TYPE 256' - 8"
	CEILING TYPE 257' - 8"
	CEILING TYPE 258' - 8"
	CEILING TYPE 259' - 8"
	CEILING TYPE 260' - 8"
	CEILING TYPE 261' - 8"
	CEILING TYPE 262' - 8"
	CEILING TYPE 263' - 8"
	CEILING TYPE 264' - 8"
	CEILING TYPE 265' - 8"
	CEILING TYPE 266' - 8"
	CEILING TYPE 267' - 8"
	CEILING TYPE 268' - 8"
	CEILING TYPE 269' - 8"
	CEILING TYPE 270' - 8"
	CEILING TYPE 271' - 8"
	CEILING TYPE 272' - 8"
	CEILING TYPE 273' - 8"
	CEILING TYPE 274' - 8"
	CEILING TYPE 275' - 8"
	CEILING TYPE 276' - 8"
	CEILING TYPE 277' - 8"
	CEILING TYPE 278' - 8"
	CEILING TYPE 279' - 8"
	CEILING TYPE 280' - 8"
	CEILING TYPE 281' - 8"
	CEILING TYPE 282' - 8"
	CEILING TYPE 283' - 8"
	CEILING TYPE 284' - 8"
	CEILING TYPE 285' - 8"
	CEILING TYPE 286' - 8"
	CEILING TYPE 287' - 8"
	CEILING TYPE 288' - 8"
	CEILING TYPE 289' - 8"
	CEILING TYPE 290' - 8"
	CEILING TYPE 291' - 8"
	CEILING TYPE 292' - 8"
	CEILING TYPE 293' - 8"
	CEILING TYPE 294' - 8"
	CEILING TYPE 295' - 8"
	CEILING TYPE 296' - 8"
	CEILING TYPE 297' - 8"
	CEILING TYPE 298' - 8"
	CEILING TYPE 299' - 8"
	CEILING TYPE 300' - 8"
	CEILING TYPE 301' - 8"
	CEILING TYPE 302' - 8"
	CEILING TYPE 303' - 8"
	CEILING TYPE 304' - 8"
	CEILING TYPE 305' - 8"
	CEILING TYPE 306' - 8"
	CEILING TYPE 307' - 8"
	CEILING TYPE 308' - 8"
	CEILING TYPE 309' - 8"
	CEILING TYPE 310' - 8"
	CEILING TYPE 311' - 8"
	CEILING TYPE 312' - 8"
	CEILING TYPE 313' - 8"
	CEILING TYPE 314' - 8"
	CEILING TYPE 315' - 8"
	CEILING TYPE 316' - 8"
	CEILING TYPE 317' - 8"
	CEILING TYPE 318' - 8"
	CEILING TYPE 319' - 8"
	CEILING TYPE 320' - 8"
	CEILING TYPE 321' - 8"
	CEILING TYPE 322' - 8"
	CE



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.draa.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design



**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:	
	CEILING HEIGHT RELATIVE TO FINISHED FLOOR
	SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MROWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTOWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACTB ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING 18" x 48"
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS. SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION
May 12TH, 2023

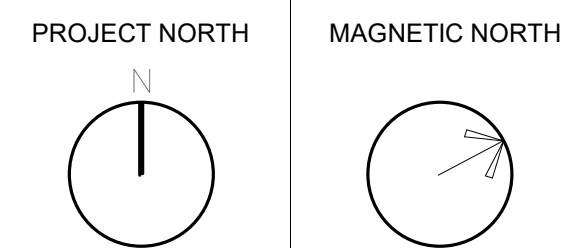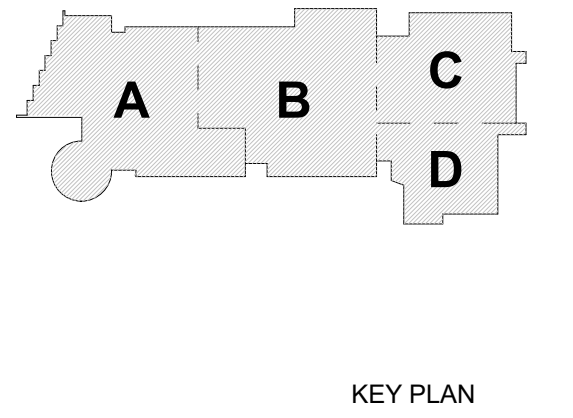

**LOWER LEVEL
MEZZANINE
REFLECTED
CEILING PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-0MD

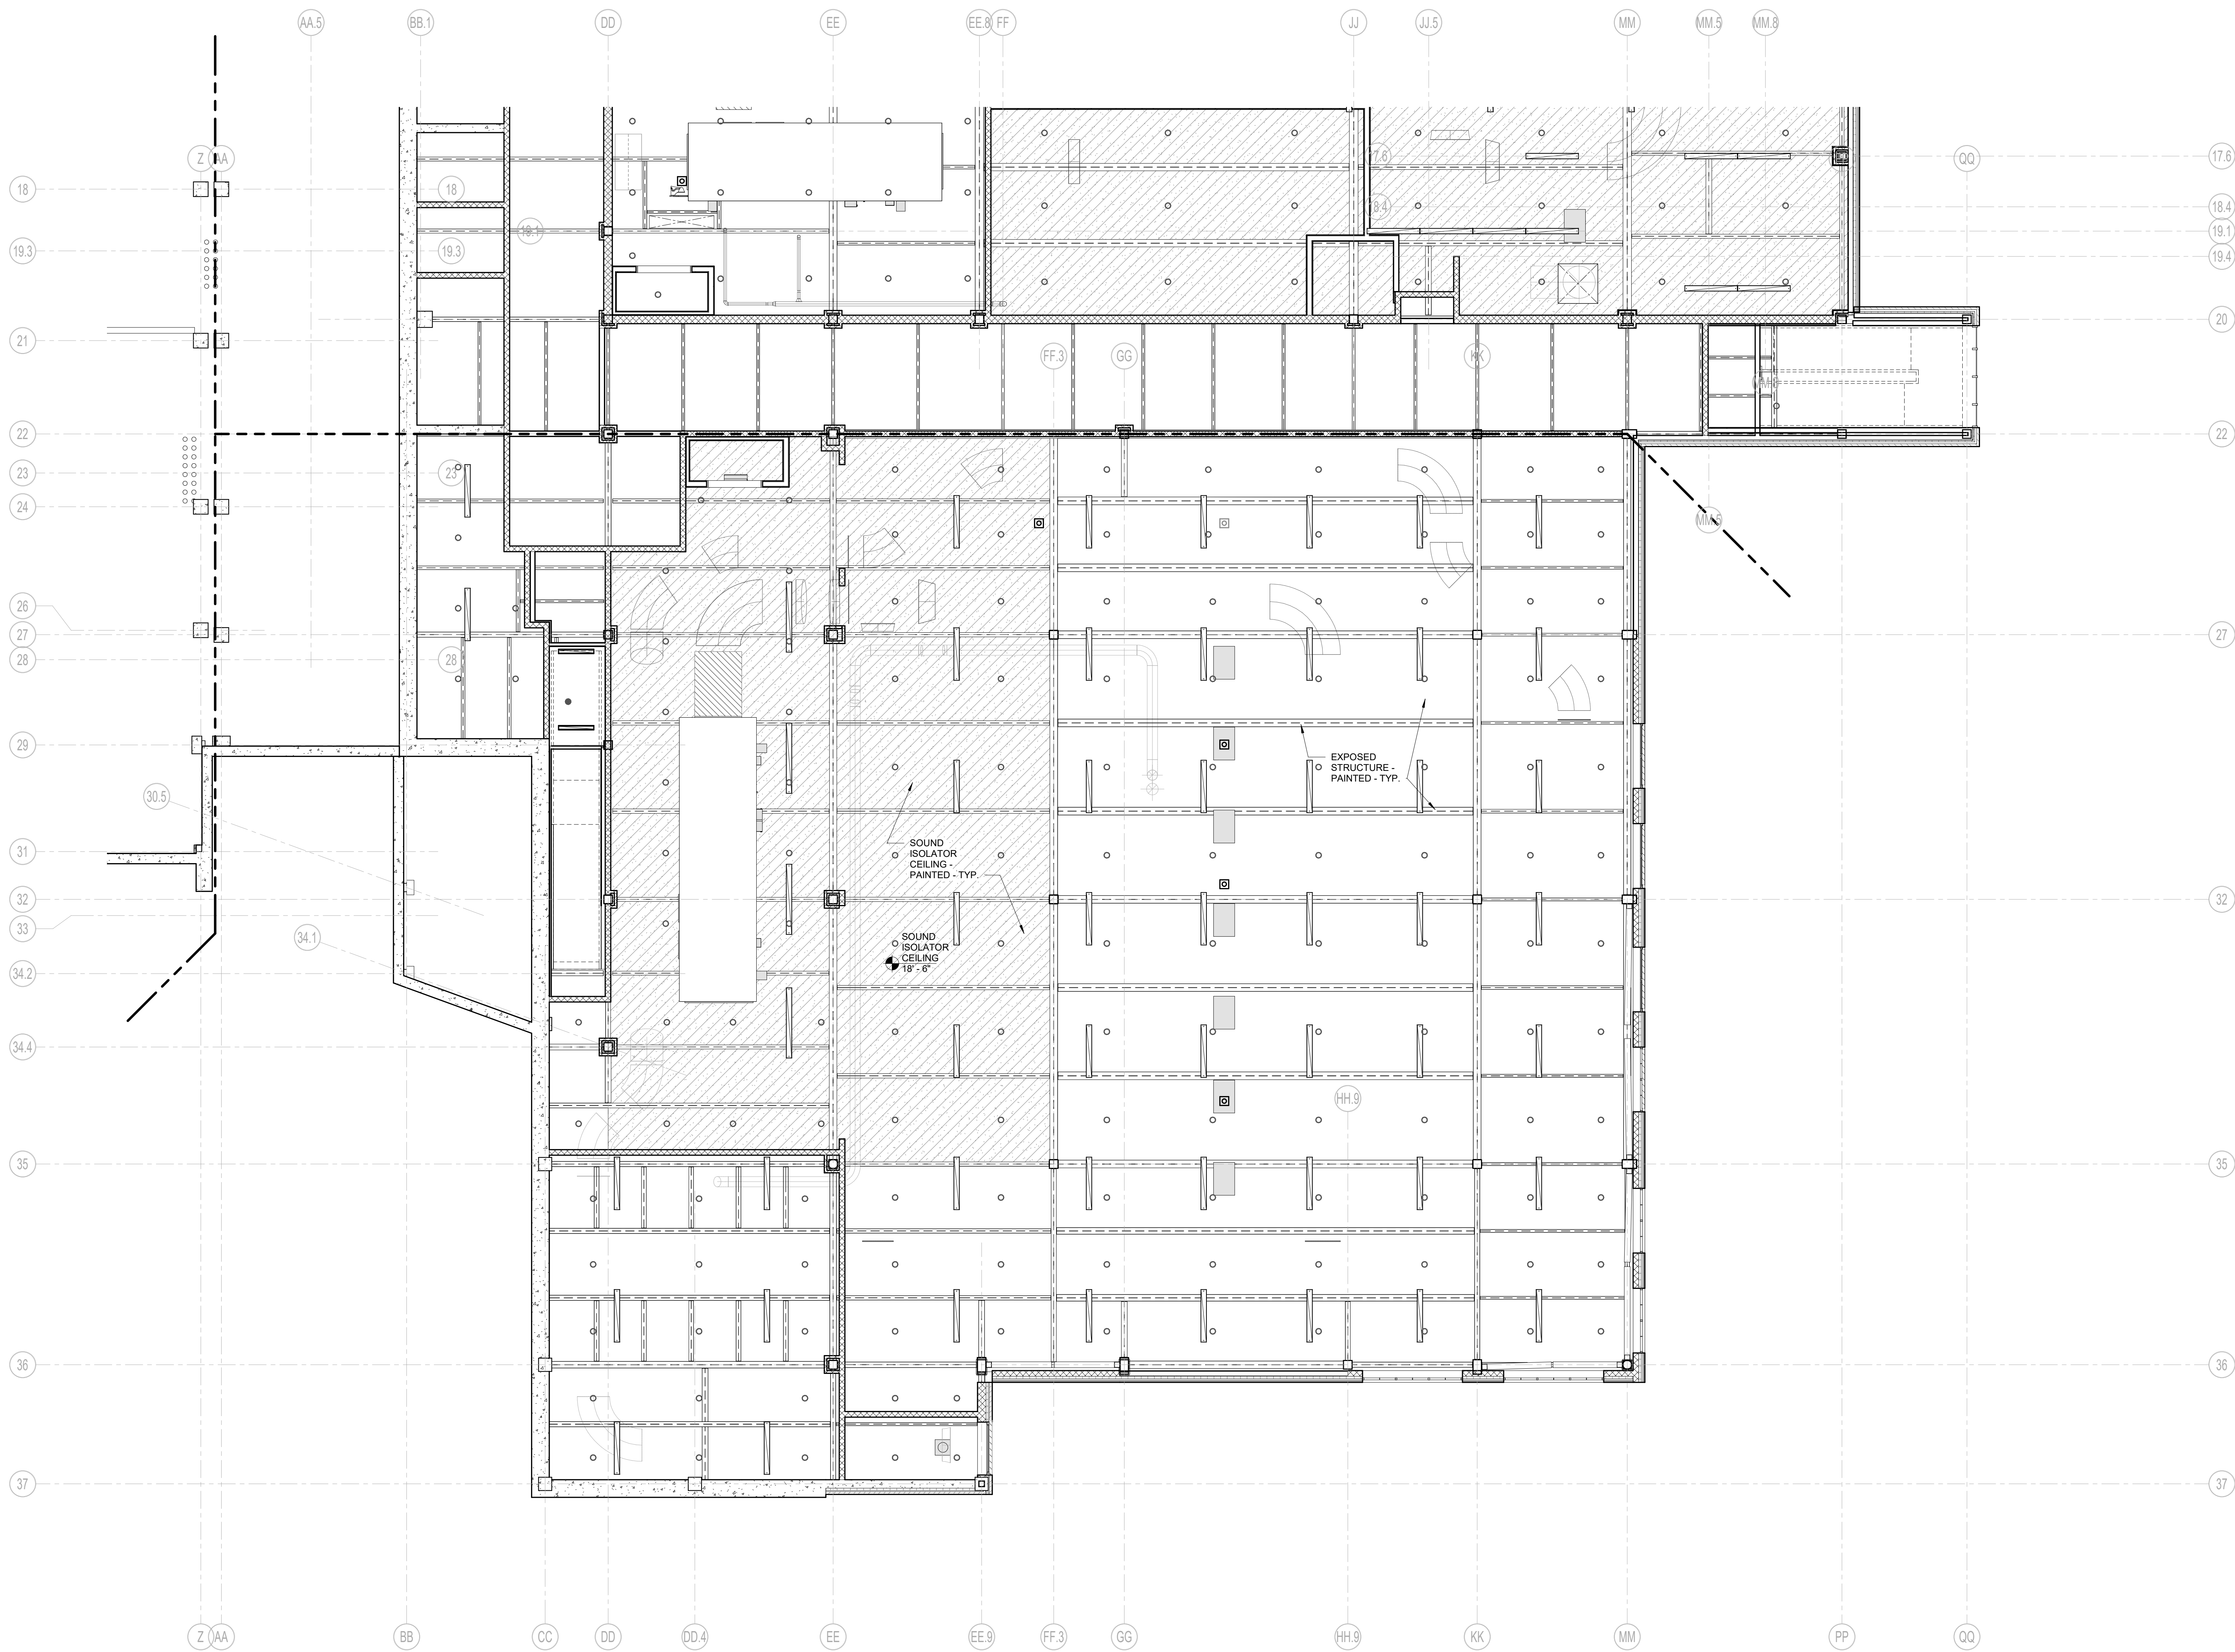

1 LOWER LEVEL MEZZANINE REFLECTED CEILING PLAN - AREA D
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR.
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL.

CEILING LEGEND:	
	CEILING TYPE 1 CEILING HEIGHT RELATIVE TO FINISHED FLOOR
	CEILING TYPE 2 SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	CEILING TYPE 3 BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MRGWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACT-2 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

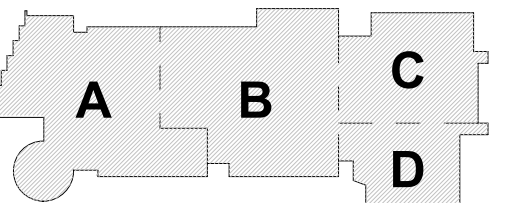


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**FIRST FLOOR
REFLECTED
CEILING PLAN -
AREA A**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A8-1-1A

1 FIRST FLOOR REFLECTED CEILING PLAN - AREA A

1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR.
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL.

CEILING LEGEND:	
	CEILING TYPE 8'-0"
	SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MRGWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACT ACoustic CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS *SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

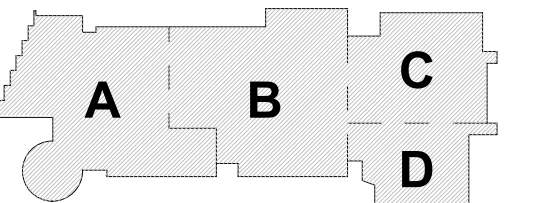

KEY PLAN


PROJECT NORTH MAGNETIC NORTH

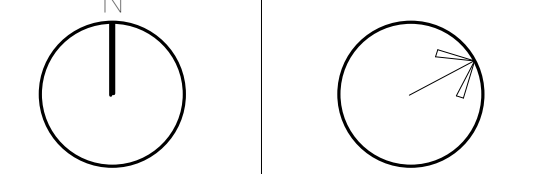

**FIRST FLOOR
REFLECTED
CEILING PLAN -
AREA B**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-1B

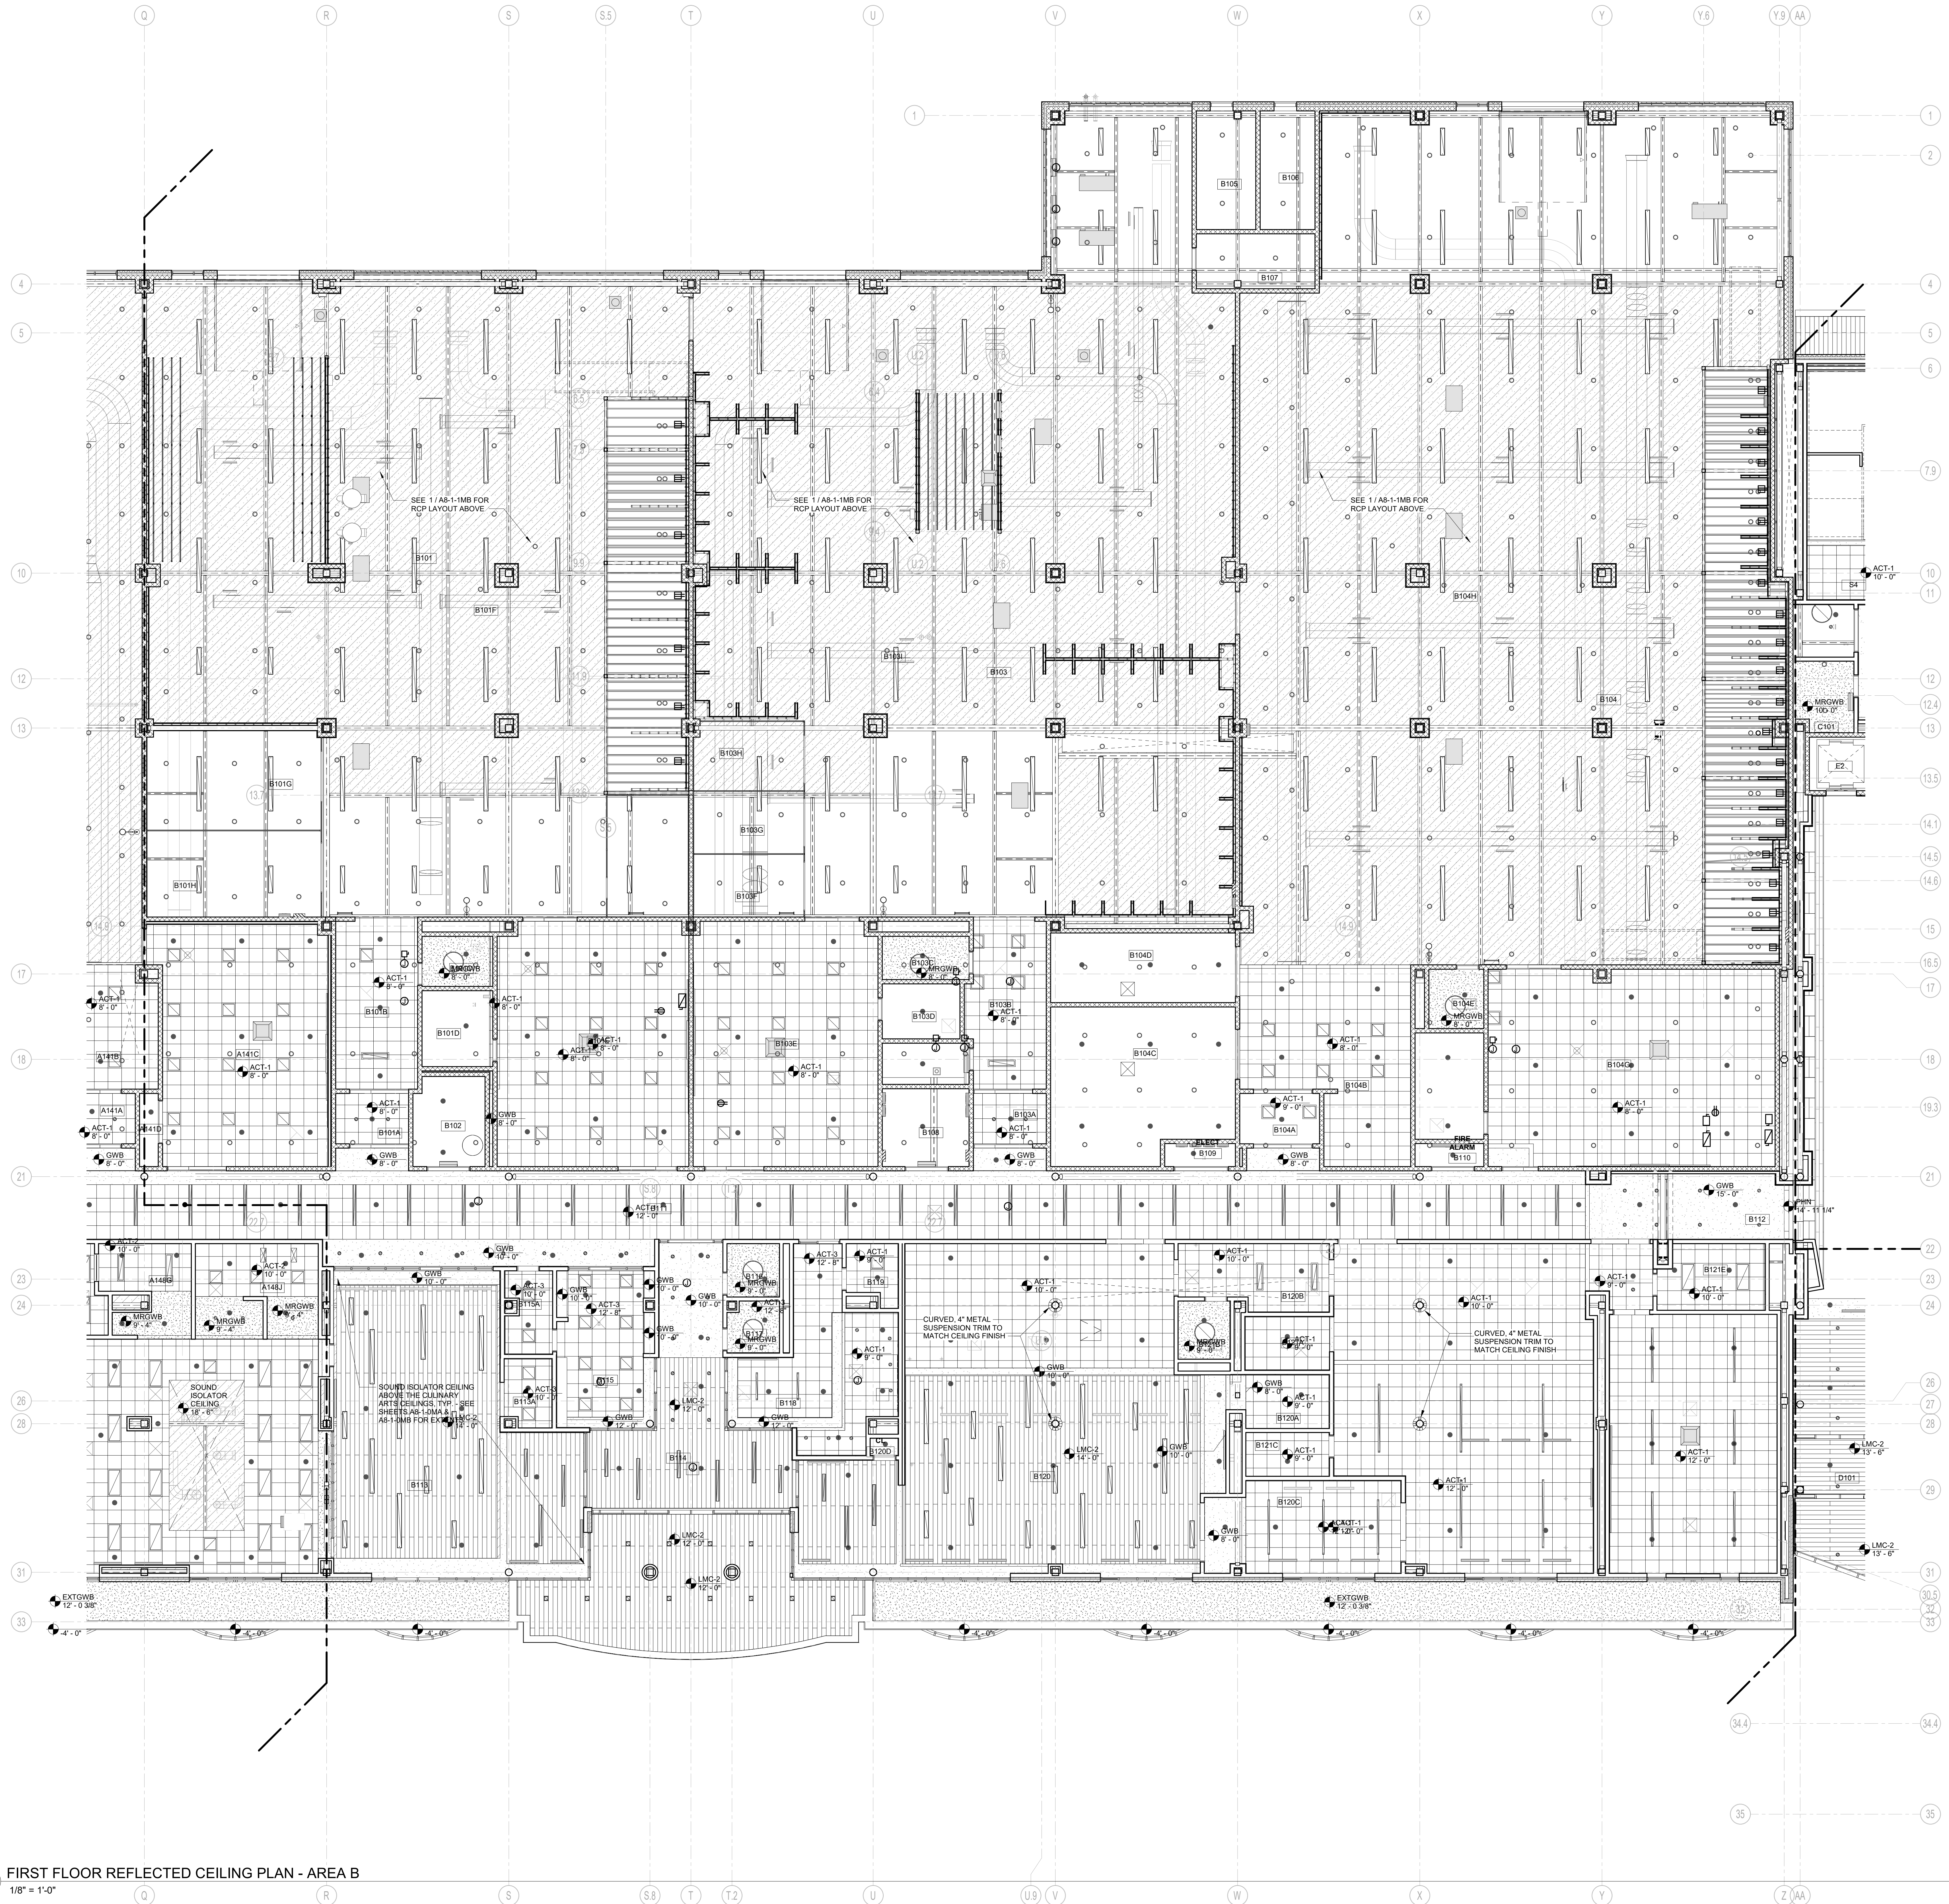

1 FIRST FLOOR REFLECTED CEILING PLAN - AREA B
1/8" = 1'-0"



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:

PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR



CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL

- CEILING LEGEND:**
- CEILING TYPE: CEILING HEIGHT RELATIVE TO FINISHED FLOOR
 - CEILING TYPE: SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
 - CEILING TYPE: BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
 - GWB GYPSUM WALL BOARD
 - MROGWB MOISTURE RESISTANT GYPSUM WALL BOARD
 - EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
 - ACT-8 ACoustic CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
 - LMC LINEAR METAL CEILING
 - PHN PHENOLIC PANEL CEILING
 - EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
 - SOUND ISOLATOR CEILING
 - ACM ALUMINUM COMPOSITE MATERIAL
 - LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - RECESSED OR COVE LIGHT
 - SUSPENDED OR PENDANT
 - CEILING OR WALL SURFACE MOUNTED
 - GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION

May 12TH, 2023

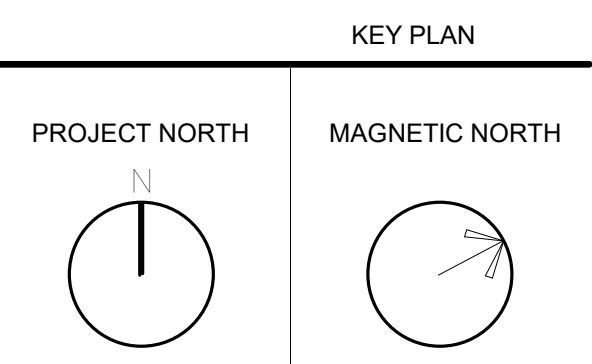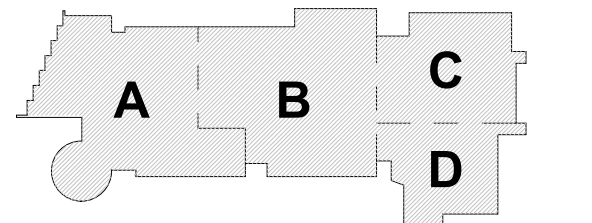

**FIRST FLOOR
REFLECTED
CEILING PLAN -
AREA C**

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A8-1-1C

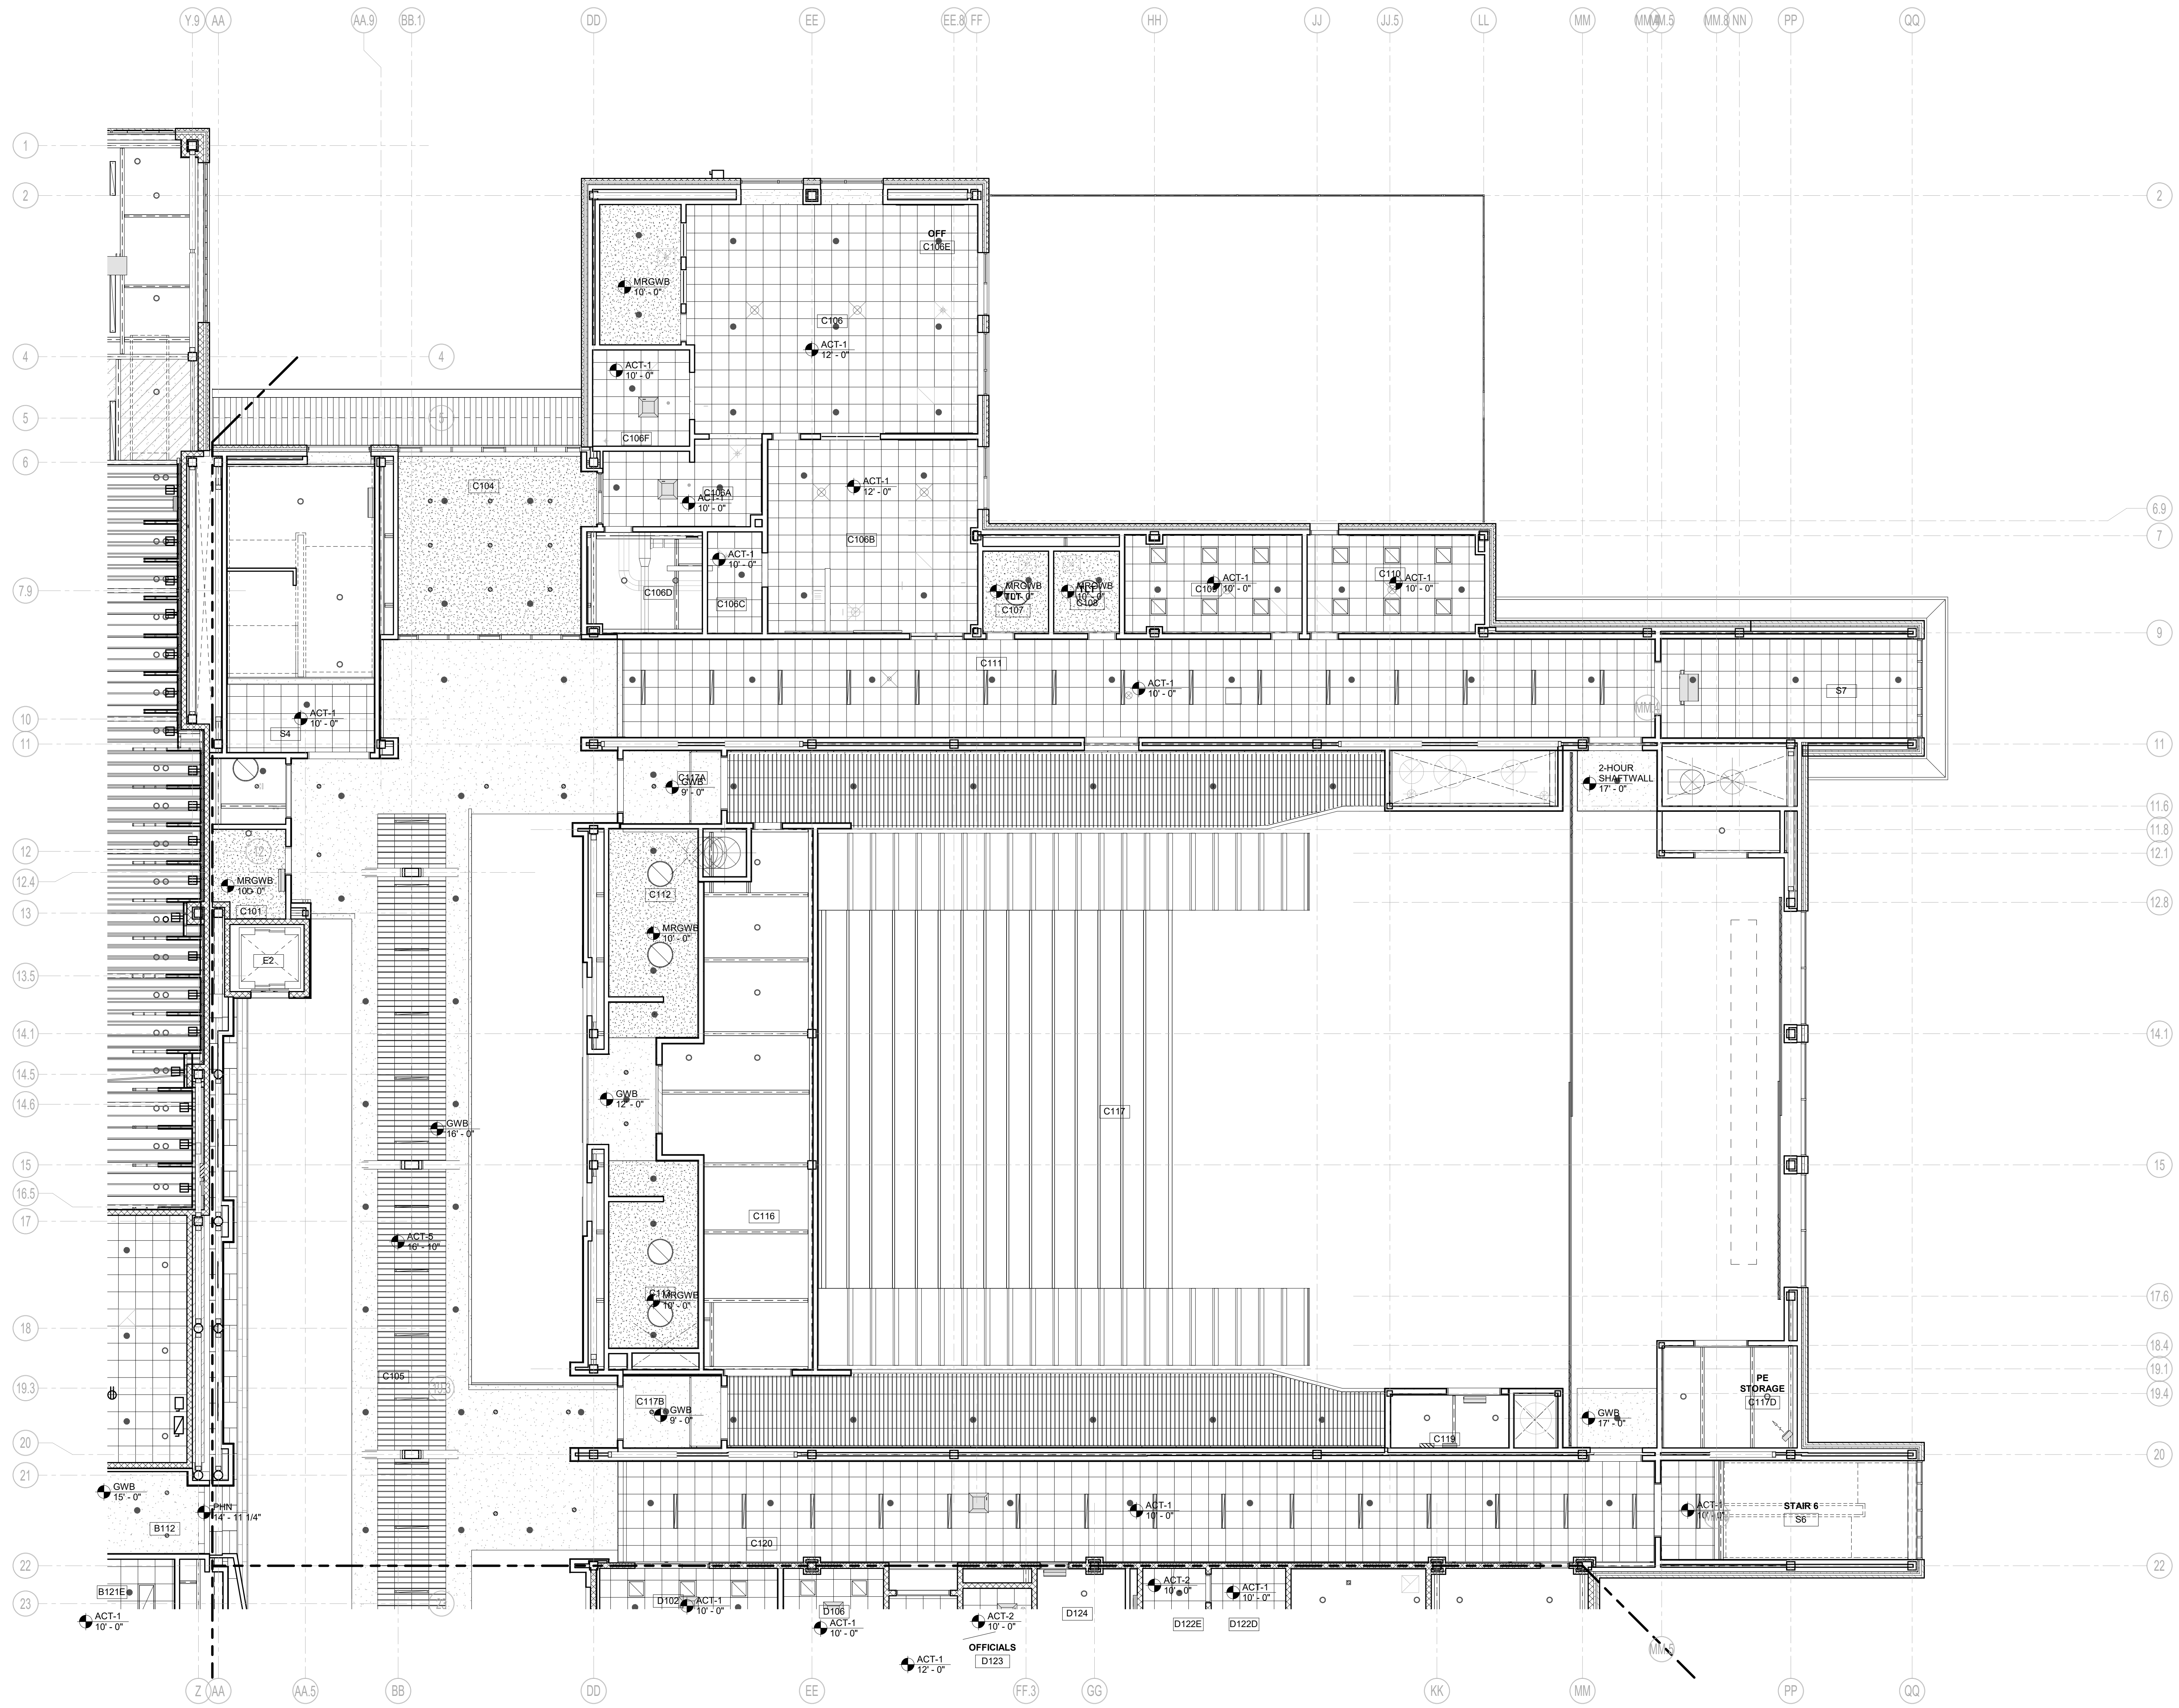



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design



**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR.
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL.

- CEILING LEGEND:**
- CEILING TYPE
8' - 8" CEILING HEIGHT RELATIVE TO FINISHED FLOOR
 - CEILING TYPE
8' - 8" SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
 - CEILING TYPE
8' - 8" BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
 - GWB GYPSUM WALL BOARD
 - MROWB MOISTURE RESISTANT GYPSUM WALL BOARD
 - EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
 - ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
 - LMC LINEAR METAL CEILING
 - PHN PHENOLIC PANEL CEILING
 - EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
 - SOUND ISOLATOR CEILING
 - ACM ALUMINUM COMPOSITE MATERIAL
 - LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - RECESSED OR COVE LIGHT
 - SUSPENDED OR PENDANT
 - CEILING OR WALL SURFACE MOUNTED
 - GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION
May 12TH, 2023

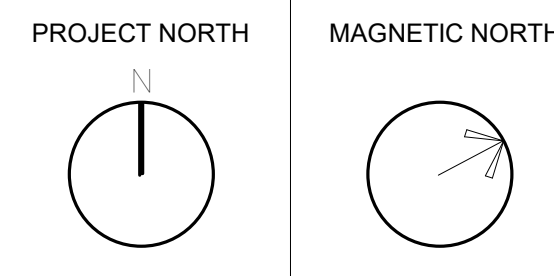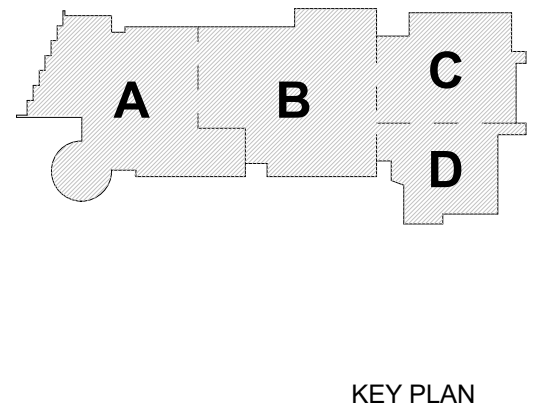


**FIRST FLOOR
REFLECTED
CEILING PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-1D

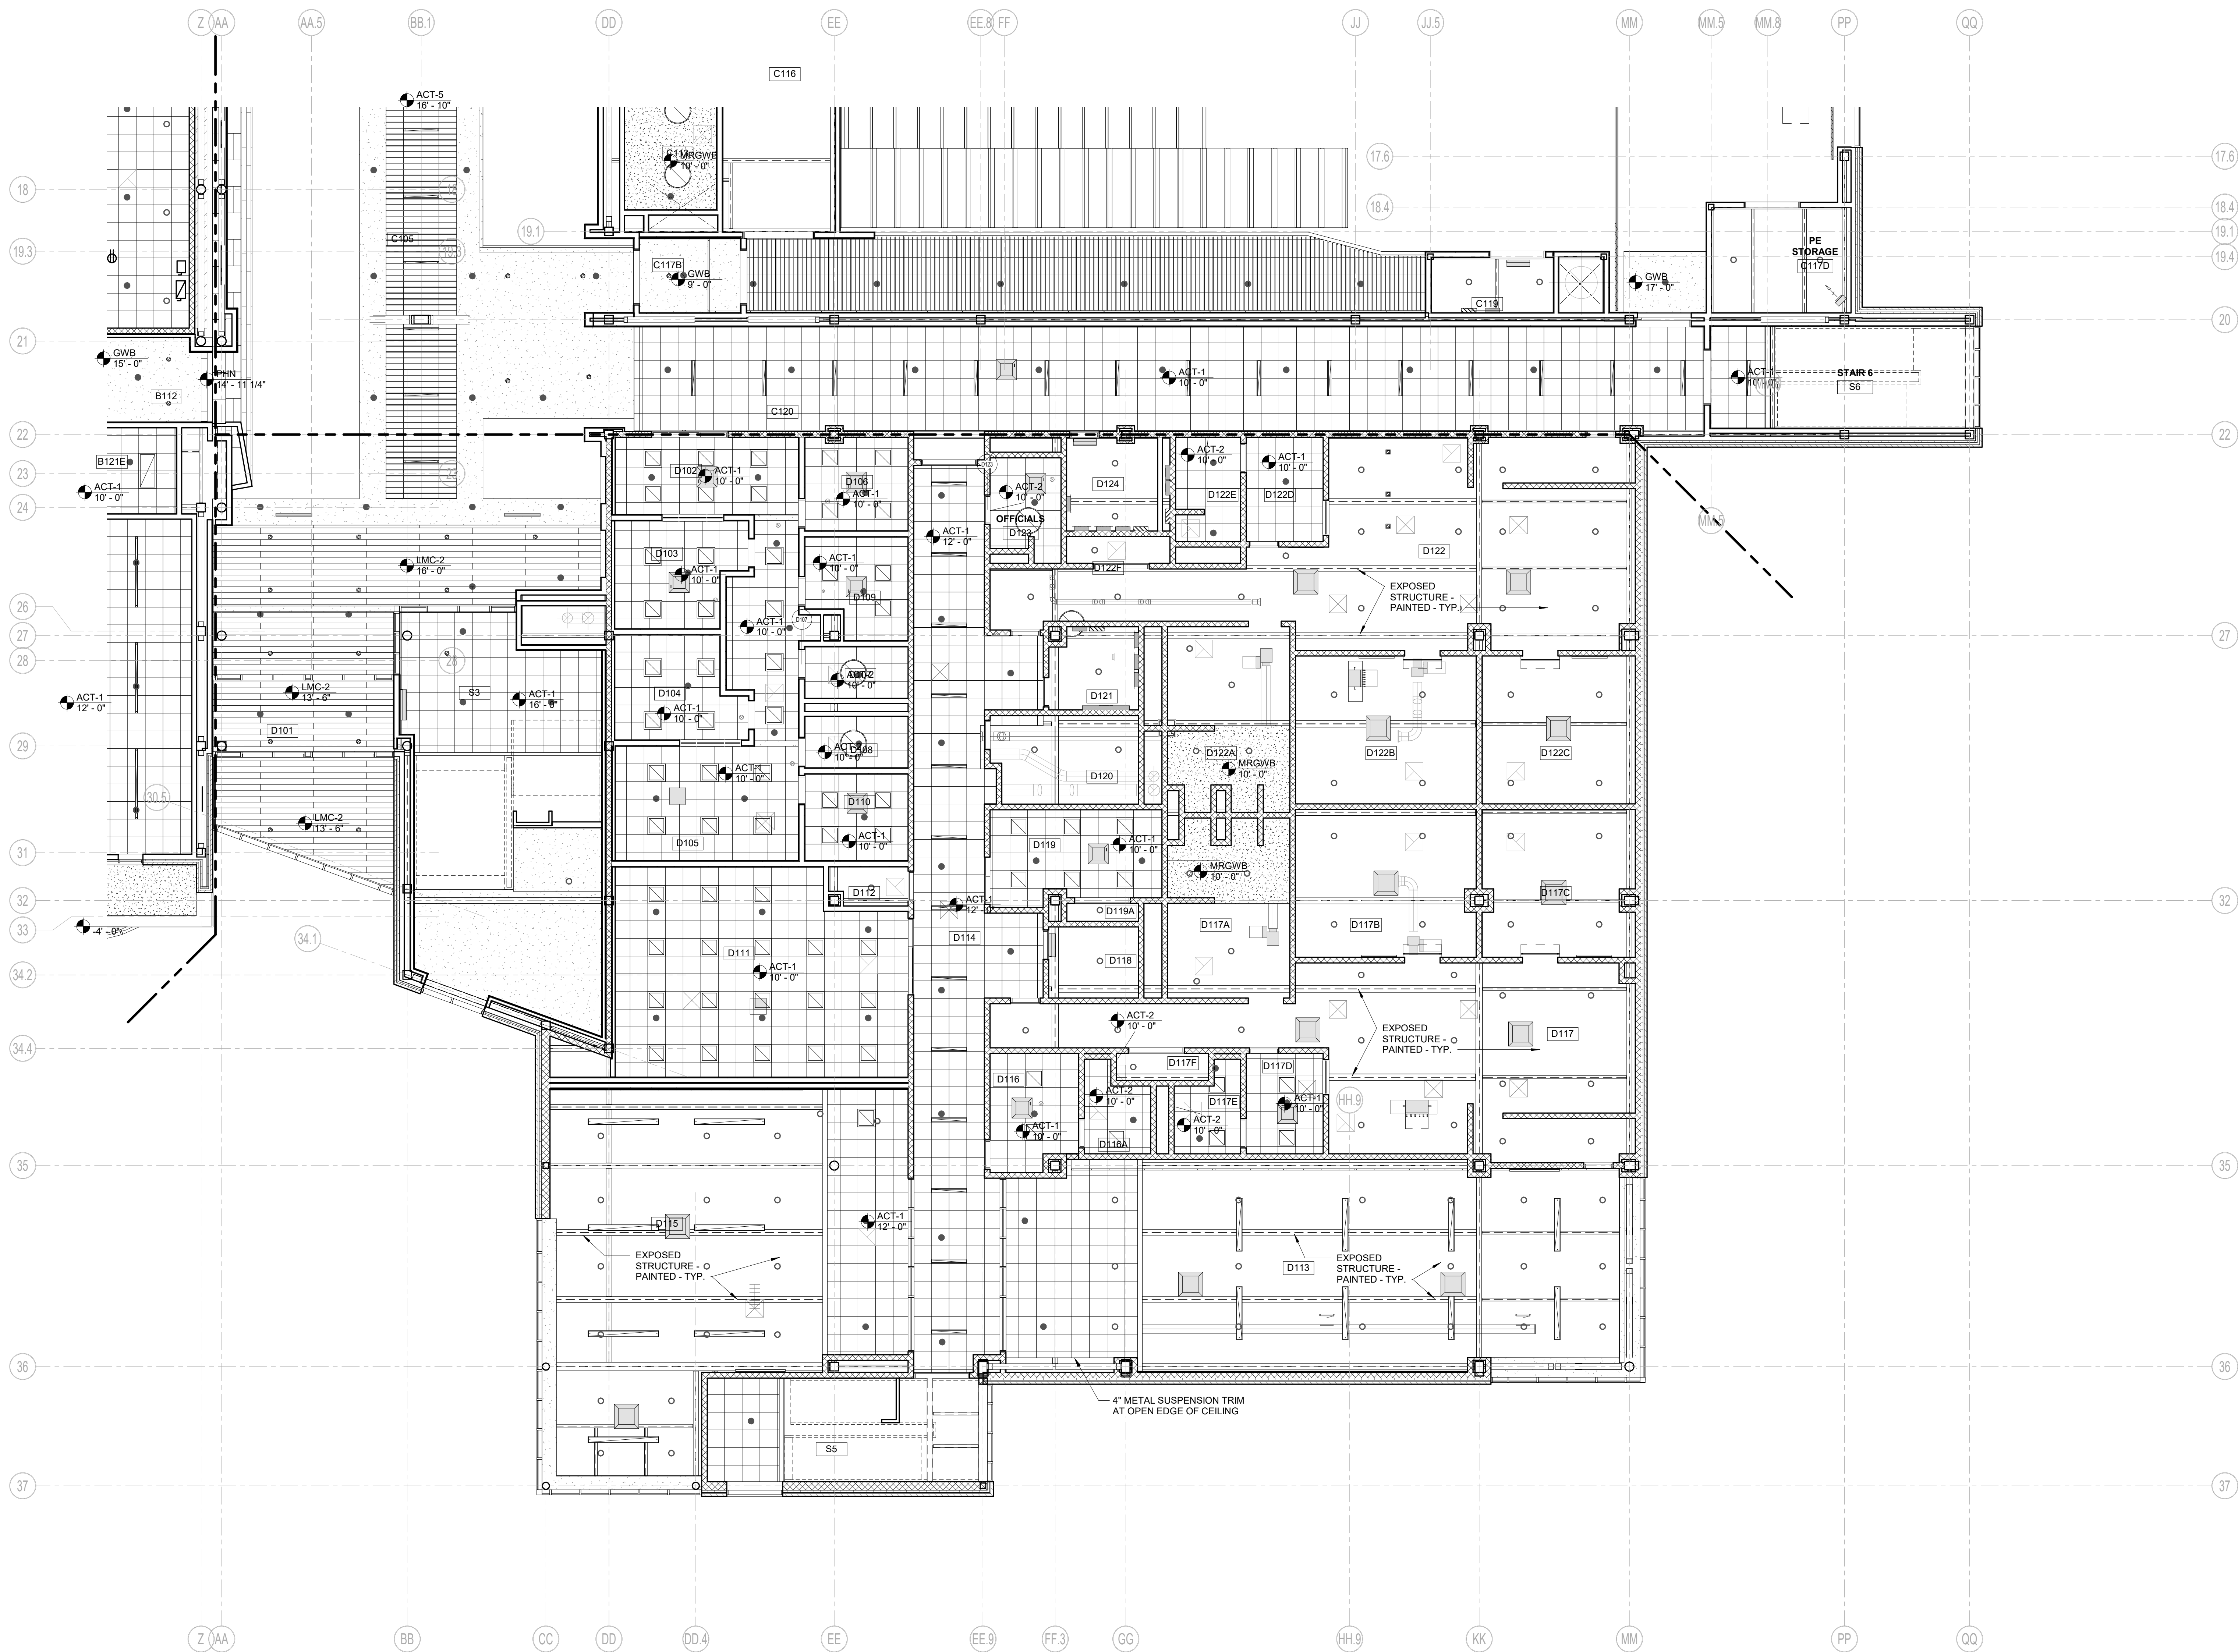

1 FIRST FLOOR REFLECTED CEILING PLAN - AREA D
1/8" = 1'-0"

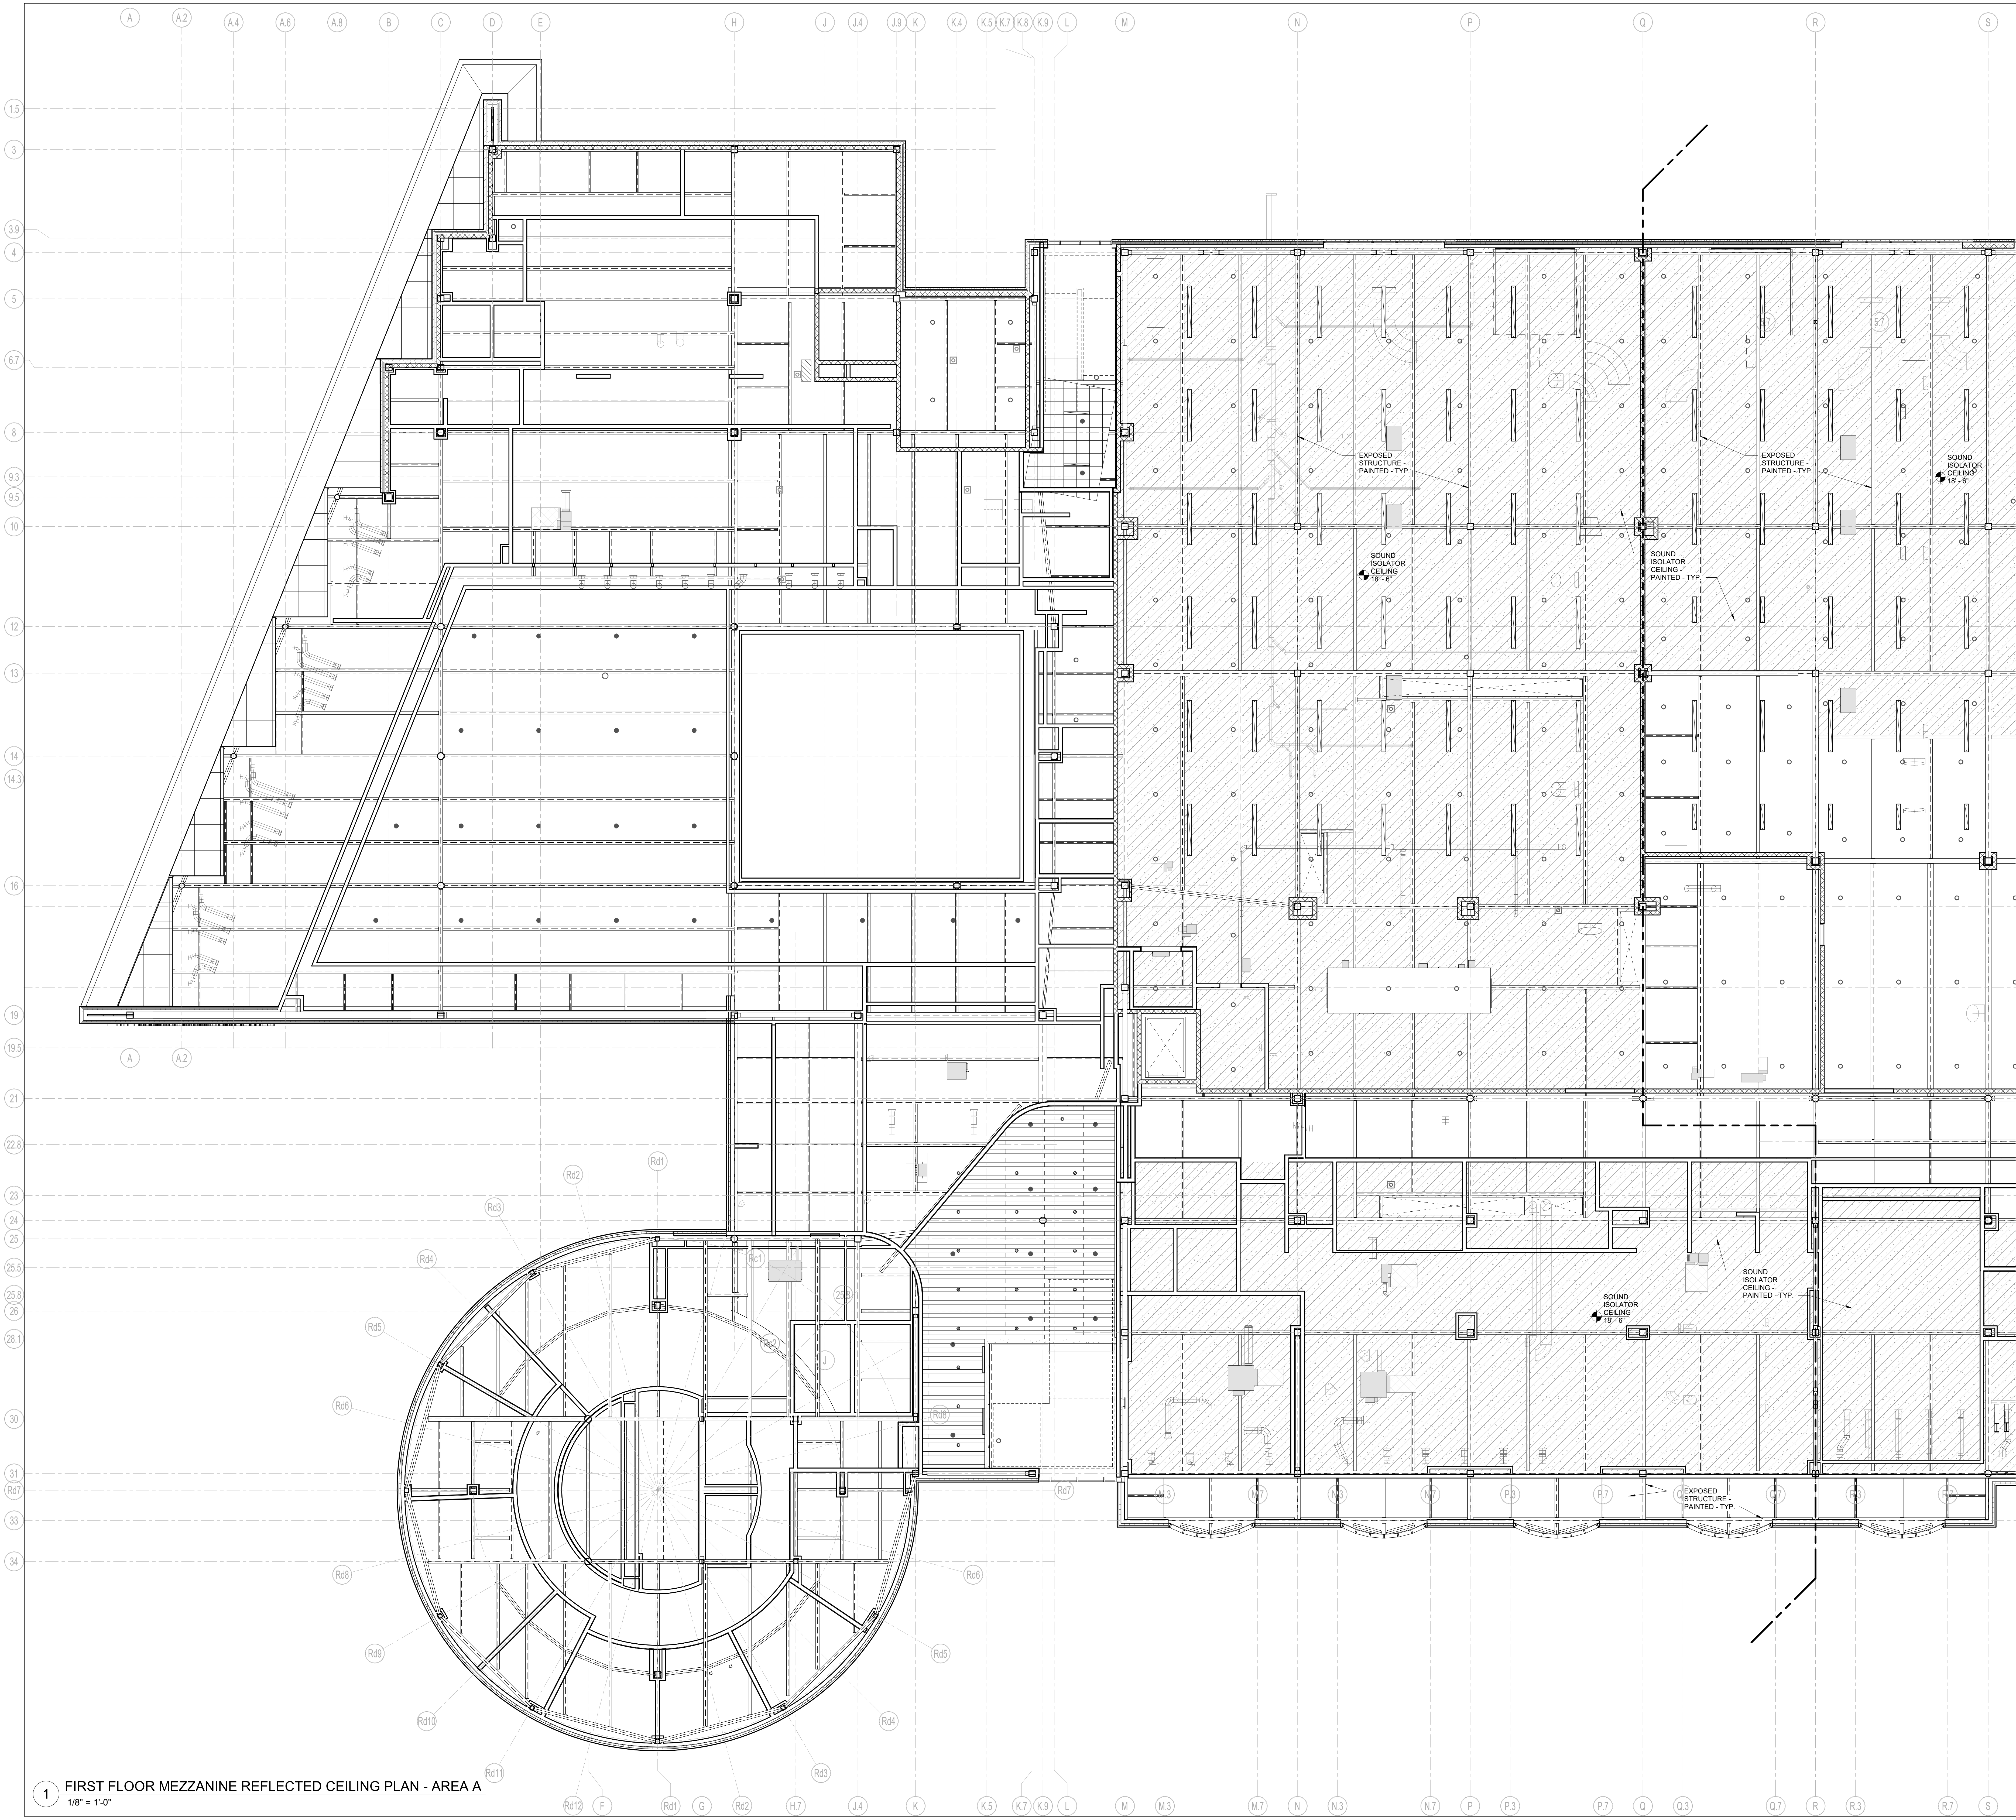

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:

PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR

CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:

CEILING TYPE

CEILING HEIGHT RELATIVE TO FINISHED FLOOR

SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"

BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY

GWB GYPSUM WALL BOARD

MROWB MOISTURE RESISTANT GYPSUM WALL BOARD

EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS

ACTB ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER

LMC LINEAR METAL CEILING

PHN PHENOLIC PANEL CEILING

EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE

SOUND ISOLATOR CEILING

ACM ALUMINUM COMPOSITE MATERIAL

LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY

RECESSED OR COVE LIGHT

SUSPENDED OR PENDANT

CEILING OR WALL SURFACE MOUNTED

GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY

CCTV CAMERA, SEE SECURITY

MSBA 90% CD
SUBMISSION

May 12TH, 2023

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

FIRST FLOOR
MEZZANINE
REFLECTED
CEILING PLAN -
AREA A

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A8-1-1MA

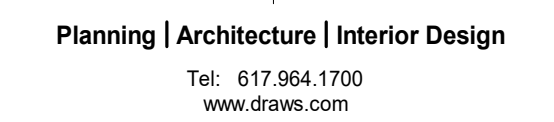

100 Hemlock Road,
Wakefield, MA 01880

FILED NOTES:

PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR PLUMBING INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR

CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO ORDERING AND ORDERING MATERIAL

CEILING LEGEND:

- | | |
|-----------------------|---|
| CEILING TYPE
- # | CEILING HEIGHT RELATIVE
TO FINISHED FLOOR |
| CEILING TYPE
- # | SPOT ELEVATION
RELATIVE TO MAIN
FLOOR SLAB AT 100'-0" |
| # - # | BOTTOM OF LIGHT FIXTURE
ELEVATION RELATIVE TO
FINISHED FLOOR; ONE
SYMBOL PER ROOM UNLESS |

- OWB** GYPSUM WALL BOARD
- MRGBW** MOISTURE RESISTANT GYPSUM WALL BOARD
- EXTGWB** EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RC FOR C.J. LOCATIONS
- ACT** ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
- LMC** LINEAR METAL CEILING
- PHN** PHENOLIC PANEL CEILING
- EAVB** EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 1" O.C. - SEE CEILING PLAN FOR A.C.T. CEILING TYPE
- SOUND** ISOLATOR CEILING
- ACM** ALUMINUM COMPOSITE MATERIAL

-  RECESSED OR COVE LIGHT
 SUSPENDED OR PENDANT
 CEILING OR WALL - SURFACE MOUNTED

- 





- CCT CAMERA; SEE SECURITY


© COPYRIGHT 2023 DRILLMEY ROSANE ANDERSON INC

MSBA 90% CD
SUBMISSION

May 12TH, 2023



PROJECT NORTH	MAGNETIC NORTH
100	100
90	90
80	80
70	70
60	60
50	50
40	40
30	30
20	20
10	10
0	0
330	330
320	320
310	310
300	300
290	290
280	280
270	270
260	260
250	250
240	240
230	230
220	220
210	210
200	200
190	190
180	180
170	170
160	160
150	150
140	140
130	130
120	120
110	110
100	100



**FIRST FLOOR
MEZZANINE
REFLECTED
CEILING PLAN -
AREA B**

ale: $1/8'' = 1'-0''$

No.: 20202

Drawn By: DRA **A8-1-1M**

to: May 12TH, 2023



1 FIRST F
1/8" = 1'-0"

Northeast
Metropolitan
Regional
Vocational High
School
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILING PRIOR TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:

CEILING TYPE

8'-0"

CEILING HEIGHT RELATIVE TO FINISHED FLOOR

CEILING TYPE

8'-0"

SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"

8'-0"

BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY

MRGWB

GYPGUM WALL BOARD

MRGWB

MOISTURE RESISTANT GYPGUM WALL BOARD

EXTGWB

EXTERIOR GYPGUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS

ACT-1

ACCT-1

ACCT-2

ACCT-3

ACCT-4

ACCT-5

ACCT-6

ACCT-7

ACCT-8

ACCT-9

ACCT-10

ACCT-11

ACCT-12

ACCT-13

ACCT-14

ACCT-15

ACCT-16

ACCT-17

ACCT-18

ACCT-19

ACCT-20

ACCT-21

ACCT-22

ACCT-23

ACCT-24

ACCT-25

ACCT-26

ACCT-27

ACCT-28

ACCT-29

ACCT-30

ACCT-31

ACCT-32

ACCT-33

ACCT-34

ACCT-35

ACCT-36

ACCT-37

ACCT-38

ACCT-39

ACCT-40

ACCT-41

ACCT-42

ACCT-43

ACCT-44

ACCT-45

ACCT-46

ACCT-47

ACCT-48

ACCT-49

ACCT-50

ACCT-51

ACCT-52

ACCT-53

ACCT-54

ACCT-55

ACCT-56

ACCT-57

ACCT-58

ACCT-59

ACCT-60

ACCT-61

ACCT-62

ACCT-63

ACCT-64

ACCT-65

ACCT-66

ACCT-67

ACCT-68

ACCT-69

ACCT-70

ACCT-71

ACCT-72

ACCT-73

ACCT-74

ACCT-75

ACCT-76

ACCT-77

ACCT-78

ACCT-79

ACCT-80

ACCT-81

ACCT-82

ACCT-83

ACCT-84

ACCT-85

ACCT-86

ACCT-87

ACCT-88

ACCT-89

ACCT-90

ACCT-91

ACCT-92

ACCT-93

ACCT-94

ACCT-95

ACCT-96

ACCT-97

ACCT-98

ACCT-99

ACCT-100

ACCT-101

ACCT-102

ACCT-103

ACCT-104

ACCT-105

ACCT-106

ACCT-107

ACCT-108

ACCT-109

ACCT-110

ACCT-111

ACCT-112

ACCT-113

ACCT-114

ACCT-115

ACCT-116

ACCT-117

ACCT-118

ACCT-119

ACCT-120

ACCT-121

ACCT-122

ACCT-123

ACCT-124

ACCT-125

ACCT-126

ACCT-127

ACCT-128

ACCT-129

ACCT-130

ACCT-131

ACCT-132

ACCT-133

ACCT-134

ACCT-135

ACCT-136

ACCT-137

ACCT-138

ACCT-139

ACCT-140

ACCT-141

ACCT-142

ACCT-143

ACCT-144

ACCT-145

ACCT-146

ACCT-147

ACCT-148

ACCT-149

ACCT-150

ACCT-151

ACCT-152

ACCT-153

ACCT-154

ACCT-155

ACCT-156

ACCT-157

ACCT-158

ACCT-159

ACCT-160

ACCT-161

ACCT-162

ACCT-163

ACCT-164

ACCT-165

ACCT-166

ACCT-167

ACCT-168

ACCT-169

ACCT-170

ACCT-171

ACCT-172

ACCT-173

ACCT-174

ACCT-175

ACCT-176

ACCT-177

ACCT-178

ACCT-179

ACCT-180

ACCT-181

ACCT-182

ACCT-183

ACCT-184

ACCT-185

ACCT-186

ACCT-187

ACCT-188

ACCT-189

ACCT-190

ACCT-191

ACCT-192

ACCT-193

ACCT-194

ACCT-195

ACCT-196

ACCT-197

ACCT-198

ACCT-199

ACCT-200

ACCT-201

ACCT-202

ACCT-203

ACCT-204

ACCT-205

ACCT-206

ACCT-207

ACCT-208

ACCT-209

ACCT-210

ACCT-211

ACCT-212

ACCT-213

ACCT-214

ACCT-215

ACCT-216

ACCT-217

ACCT-218

ACCT-219

ACCT-220

ACCT-221

ACCT-222

ACCT-223

ACCT-224

ACCT-225

ACCT-226

ACCT-227

ACCT-228

ACCT-229

ACCT-230

ACCT-231

ACCT-232

ACCT-233

ACCT-234

ACCT-235

ACCT-236

ACCT-237

ACCT-238

ACCT-239

ACCT-240

ACCT-241

ACCT-242

ACCT-243

ACCT-244

ACCT-245

ACCT-246

ACCT-247

ACCT-248

ACCT-249

ACCT-250

ACCT-251

ACCT-252

ACCT-253

ACCT-254

ACCT-255

ACCT-256

ACCT-257

ACCT-258

ACCT-259

ACCT-260

ACCT-261

ACCT-262

ACCT-263

ACCT-264

ACCT-265

ACCT-266

ACCT-267

ACCT-268

ACCT-269

ACCT-270

ACCT-271

ACCT-272

ACCT-273

ACCT-274

ACCT-275

ACCT-276

ACCT-277

ACCT-278

ACCT-279

ACCT-280

ACCT-281

ACCT-282

ACCT-283

ACCT-284

ACCT-285

ACCT-286

ACCT-287

ACCT-288

ACCT-289

ACCT-290

ACCT-291

ACCT-292

ACCT-293

ACCT-294

ACCT-295

ACCT-296

ACCT-297

ACCT-298

ACCT-299

ACCT-300

ACCT-301

ACCT-302

ACCT-303

ACCT-304

ACCT-305

ACCT-306

ACCT-307

ACCT-308

ACCT-309

ACCT-310

ACCT-311

ACCT-312

ACCT-313

ACCT-314

ACCT-315

ACCT-316

ACCT-317

ACCT-318

ACCT-319

ACCT-320

ACCT-321

ACCT-322

ACCT-323

ACCT-324

ACCT-325

ACCT-326

ACCT-327

ACCT-328

ACCT-329

ACCT-330

ACCT-331

ACCT-332

ACCT-333

ACCT-334

ACCT-335

ACCT-336

ACCT-337

ACCT-338

ACCT-339

ACCT-340

ACCT-341

ACCT-342

ACCT-343

ACCT-344

ACCT-345

ACCT-346

ACCT-347

ACCT-348

ACCT-349

ACCT-350

ACCT-351

ACCT-352

ACCT-353

ACCT-354

ACCT-355

ACCT-356

ACCT-357

ACCT-358

ACCT-359

ACCT-360

ACCT-361

ACCT-362

ACCT-363

ACCT-364

ACCT-365

ACCT-366

ACCT-367

ACCT-368

ACCT-369

ACCT-370

ACCT-371

ACCT-372

ACCT-373

ACCT-374

ACCT-375

ACCT-376

ACCT-377

ACCT-378

ACCT-379

ACCT-380

ACCT-381

ACCT-382

ACCT-383

ACCT-384

ACCT-385

ACCT-386

ACCT-387

ACCT-388

ACCT-389

ACCT-390

ACCT-391

ACCT-392

ACCT-393

ACCT-394

ACCT-395

ACCT-396

ACCT-397

ACCT-398

ACCT-399

ACCT-400

ACCT-401

ACCT-402

ACCT-403

ACCT-404

ACCT-405

ACCT-406

ACCT-407

ACCT-408

ACCT-409

ACCT-410

ACCT-411

ACCT-412

ACCT-413

ACCT-414

ACCT-415

ACCT-416

ACCT-417

ACCT-418

ACCT-419

ACCT-420

ACCT-421

ACCT-422

ACCT-423

ACCT-424

ACCT-425

ACCT-426

ACCT-427

ACCT-428

ACCT-429

ACCT-430

ACCT-431

ACCT-432

ACCT-433

ACCT-434

ACCT-435

ACCT-436

ACCT-437

ACCT-438

ACCT-439

ACCT-440

ACCT-441

ACCT-442

ACCT-443

ACCT-444

ACCT-445

ACCT-446

ACCT-447

ACCT-448

ACCT-449

ACCT-450

ACCT-451

ACCT-452

ACCT-453

ACCT-454

ACCT-455

ACCT-456

ACCT-457

ACCT-458

ACCT-459

ACCT-460

ACCT-461

ACCT-462

ACCT-463

ACCT-464

ACCT-465

ACCT-466

ACCT-467

ACCT-468

ACCT-469

ACCT-470

ACCT-471

ACCT-472

ACCT-473

ACCT-474

ACCT-475

ACCT-476

ACCT-477

ACCT-478

ACCT-479

ACCT-480

ACCT-481

ACCT-482

ACCT-483

ACCT-484

ACCT-485

ACCT-486

ACCT-487

ACCT-488

ACCT-489

ACCT-490

ACCT-491

ACCT-492

ACCT-493

ACCT-494

ACCT-495

ACCT-496

ACCT-497

ACCT-498

ACCT-499

ACCT-500

ACCT-501

ACCT-502

ACCT-503

ACCT-504

ACCT-505

ACCT-506

ACCT-507

ACCT-508

ACCT-509

ACCT-510

ACCT-511

ACCT-512

ACCT-513

ACCT-514

ACCT-515

ACCT-516

ACCT-517

ACCT-518

ACCT-519

ACCT-520

ACCT-521

ACCT-522

ACCT-523

ACCT-524

ACCT-525

ACCT-526

ACCT-527

ACCT-528

ACCT-529

ACCT-530

ACCT-531

ACCT-532

ACCT-533

ACCT-534

ACCT-535

ACCT-536

ACCT-537

ACCT-538

ACCT-539

ACCT-540

ACCT-541

ACCT-542

ACCT-543

ACCT-544

ACCT-545

ACCT-546

ACCT-547

ACCT-548

ACCT-549

ACCT-550

ACCT-551

ACCT-552

ACCT-553

ACCT-554

ACCT-555

ACCT-556

ACCT-557

ACCT-558

ACCT-559

ACCT-560

ACCT-561

ACCT-562

ACCT-563

ACCT-564

ACCT-565

ACCT-566

ACCT-567

ACCT-568

ACCT-569

ACCT-570

ACCT-571

ACCT-572

ACCT-573

ACCT-574

ACCT-575

ACCT-576

ACCT-577

ACCT-578

ACCT-579

ACCT-580

ACCT-581

ACCT-582

ACCT-583

ACCT-584

ACCT-585

ACCT-586

ACCT-587

ACCT-588

ACCT-589

ACCT-590

ACCT-591

ACCT-592

ACCT-593

ACCT-594

ACCT-595

ACCT-596

ACCT-597

ACCT-598

ACCT-599

ACCT-600

ACCT-601

ACCT-602

ACCT-603

ACCT-604

ACCT-605

ACCT-606

ACCT-607

ACCT-608

ACCT-609

ACCT-610

ACCT-611

ACCT-612

ACCT-613

ACCT-614

ACCT-615

ACCT-616

ACCT-617

ACCT-618

ACCT-619

ACCT-620

ACCT-621

ACCT-622

ACCT-623

ACCT-624

ACCT-625

ACCT-626

ACCT-627

ACCT-628

ACCT-629

ACCT-630

ACCT-631

ACCT-632

ACCT-633

ACCT-634

ACCT-635

ACCT-636

ACCT-637

ACCT-638

ACCT-639

ACCT-640

ACCT-641

ACCT-642

ACCT-643

ACCT-644

ACCT-645

ACCT-646

ACCT-647

ACCT-648

ACCT-649

ACCT-650

ACCT-651

ACCT-652

ACCT-653

ACCT-654

ACCT-655

ACCT-656

ACCT-657

ACCT-658

ACCT-659

ACCT-660

ACCT-661

ACCT-662

ACCT-663

ACCT-664

ACCT-665

ACCT-666

ACCT-667

ACCT-668

ACCT-669

ACCT-670

ACCT-671

ACCT-672

ACCT-673

ACCT-674

ACCT-675

ACCT-676

ACCT-677

ACCT-678

ACCT-679

ACCT-680

ACCT-681

ACCT-682

ACCT-683

ACCT-684

ACCT-685

ACCT-686

ACCT-687

ACCT-688

ACCT-689

ACCT-690

ACCT-691

ACCT-692

ACCT-693

ACCT-694

ACCT-695

ACCT-696

ACCT-697

ACCT-698

ACCT-699

ACCT-700

ACCT-701

ACCT-702

ACCT-703

ACCT-704

ACCT-705

ACCT-706

ACCT-707

ACCT-708

ACCT-709

ACCT-710

ACCT-711

ACCT-712

ACCT-713

ACCT-714

ACCT-715

ACCT-716

ACCT-717

ACCT-718

ACCT-719

ACCT-720

ACCT-721

ACCT-722

ACCT-723

ACCT-724

ACCT-725

ACCT-726

ACCT-727

ACCT-728

ACCT-729

ACCT-730

ACCT-731

ACCT-732

ACCT-733

ACCT-734

ACCT-735

ACCT-736

ACCT-737

ACCT-738

ACCT-739

ACCT-740

ACCT-741

ACCT-742

ACCT-743

ACCT-744

ACCT-745

ACCT-746

ACCT-747

ACCT-748

ACCT-749

ACCT-750

ACCT-751

ACCT-752

ACCT-753

ACCT-754

ACCT-755

ACCT-756

ACCT-757

ACCT-758

ACCT-759

ACCT-760

ACCT-761

ACCT-762

ACCT-763

ACCT-764

ACCT-765

ACCT-766

ACCT-767

ACCT-768

ACCT-769

ACCT-770

ACCT-771

ACCT-772

ACCT-773

ACCT-774

ACCT-775

ACCT-776

ACCT-777

ACCT-778

ACCT-779

ACCT-780

ACCT-781

ACCT-782

ACCT-783

ACCT-784

ACCT-785

ACCT-786

ACCT-787

ACCT-788

ACCT-789

ACCT-790

ACCT-791

ACCT-792

ACCT-793

ACCT-794

ACCT-795

ACCT-796

ACCT-797

ACCT-798

ACCT-799

ACCT-800

ACCT-801

ACCT-802

ACCT-803

ACCT-804

ACCT-805

ACCT-806

ACCT-807

ACCT-808

ACCT-809

ACCT-810

ACCT-811

ACCT-812

ACCT-813

ACCT-814

ACCT-815

ACCT-816

ACCT-817

ACCT-818

ACCT-819

ACCT-820

ACCT-821

ACCT-822

ACCT-823

ACCT-824

ACCT-825

ACCT-826

ACCT-827

ACCT-828

ACCT-829

ACCT-830

ACCT-831

ACCT-832

ACCT-833

ACCT-834

ACCT-835

ACCT-836

ACCT-837

ACCT-838

ACCT-839

ACCT-840

ACCT-841

ACCT-842

ACCT-843

ACCT-844

ACCT-845

ACCT-846

ACCT-847

ACCT-848

ACCT-849

ACCT-850

ACCT-851

ACCT-852

ACCT-853

ACCT-854

ACCT-855

ACCT-856

ACCT-857

ACCT-858

ACCT-859

ACCT-860

ACCT-861

ACCT-862

ACCT-863

ACCT-864

ACCT-865

ACCT-866

ACCT-867

ACCT-868

ACCT-869

ACCT-870

ACCT-871

ACCT-872

ACCT-873

ACCT-874

ACCT-875

ACCT-876

ACCT-877

ACCT-878

ACCT-879

ACCT-880

ACCT-881

ACCT-882

ACCT-883

ACCT-884

ACCT-885

ACCT-886

ACCT-887

ACCT-888

ACCT-889

ACCT-890

ACCT-891

ACCT-892

ACCT-893

ACCT-894

ACCT-895

ACCT-896

ACCT-897

ACCT-898

ACCT-899

ACCT-900

ACCT-901

ACCT-902

ACCT-903

ACCT-904

ACCT-905

ACCT-906

ACCT-907

ACCT-908

ACCT-909

ACCT-910

ACCT-911

ACCT-912

ACCT-913

ACCT-914

ACCT-915

ACCT-916

ACCT-917

ACCT-918

ACCT-919

ACCT-920

ACCT-921

ACCT-922

ACCT-923

ACCT-924

ACCT-925

ACCT-926

ACCT-927

ACCT-928

ACCT-929

ACCT-930

ACCT-931

ACCT-932

ACCT-933

ACCT-934

ACCT-935

ACCT-936

ACCT-937

ACCT-938

ACCT-939

ACCT-940

ACCT-941

ACCT-942

ACCT-943

ACCT-944

ACCT-945

ACCT-946

ACCT-947

ACCT-948

ACCT-949

ACCT-950

ACCT-951

ACCT-952

ACCT-953

ACCT-954

ACCT-955

ACCT-956

ACCT-957

ACCT-958

ACCT-959

ACCT-960

ACCT-961

ACCT-962

ACCT-963

ACCT-964

ACCT-965

ACCT-966

ACCT-967

ACCT-968

ACCT-969

ACCT-970

ACCT-971

ACCT-972

ACCT-973

ACCT-974

ACCT-975

ACCT-976

ACCT-977

ACCT-978

ACCT-979

ACCT-980

ACCT-981

ACCT-982

ACCT-983

ACCT-984

ACCT-985

ACCT-986

ACCT-987

ACCT-988

ACCT-989

ACCT-990

ACCT-991

ACCT-992

ACCT-993

ACCT-994

ACCT-995

ACCT-996

ACCT-997

ACCT-998

ACCT-999

ACCT-1000

ACCT-1001

ACCT-1002

ACCT-1003

ACCT-1004

ACCT-1005

ACCT-1006

ACCT-1007

ACCT-1008

ACCT-1009

ACCT-1010

ACCT-1011

ACCT-1012

ACCT-1013

ACCT-1014

ACCT-1015

ACCT-1016

ACCT-1017

ACCT-1018

ACCT-1019

ACCT-1020

ACCT-1021

ACCT-1022

ACCT-1023

ACCT-1024

ACCT-1025

ACCT-1026

ACCT-1027

ACCT-1028

ACCT-1029

ACCT-1030

ACCT-1031

ACCT-1032

ACCT-1033

ACCT-1034

ACCT-1035

ACCT-1036

ACCT-1037

ACCT-1038

ACCT-1039

ACCT-1040

ACCT-1041

ACCT-1042

ACCT-1043

ACCT-1044

ACCT-1045

ACCT-1046

ACCT-1047

ACCT-1048

ACCT-1049

ACCT-1050

ACCT-1051

ACCT-1052

ACCT-1053

ACCT-1054

ACCT-1055

ACCT-1056

ACCT-1057

ACCT-1058

ACCT-1059

ACCT-1060

ACCT-1061

ACCT-1062

ACCT-1063

ACCT-1064

ACCT-1065

ACCT-1066

ACCT-1067

ACCT-1068

ACCT-1069

ACCT-1070

ACCT-1071

ACCT-1072

ACCT-1073

ACCT-1074

ACCT-1075

<

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:

CEILING TYPE
" - " CEILING HEIGHT RELATIVE
TO FINISHED FLOOR
" - " SPOT ELEVATION
RELATIVE TO MAIN
FLOOR SLAB AT 100'-0"

CEILING TYPE
" - " BOTTOM OF LIGHT FIXTURE
ELEVATION RELATIVE TO
FINISHED FLOOR, ONE
SYMBOL PER ROOM UNLESS
FIXTURE ELEVATIONS VARY

GWB GYPSUM WALL BOARD
MRGWB MOISTURE RESISTANT
GYPSUM WALL BOARD
EXTGWB EXTERIOR GYPSUM
WALL BOARD SOFFIT - SEE RCP
FOR C.J. LOCATIONS

ACT-2 ACoustic CEILING
TILE SEE CEILING PLANS
FOR TYPE NUMBER

LMC LINEAR METAL CEILING

PHN PHENOLIC PANEL CEILING

EAVB EXTRUDED ALUMINUM
VERTICAL BLADE SYSTEM
SUSPENDED FROM A.C.T. GRID
ABOVE BLADES ARE SPACED
AT 8" O.C. SEE CEILING PLAN
FOR A.C.T. CEILING TYPE

SOUND ISOLATOR CEILING

ACM ALUMINUM
COMPOSITE MATERIAL


LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS
SIZES AND SHAPES MAY VARY
RECESSED OR COVE LIGHT
SUSPENDED OR PENDANT
CEILING OR WALL -
SURFACE MOUNTED

GRILLES, REGISTERS, AND DIFFUSERS: SEE
MECHANICAL DRAWINGS "SIZES AND SHAPES
MAY VARY"

CCTV CAMERA, SEE SECURITY


© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

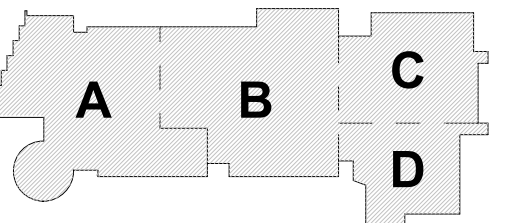

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

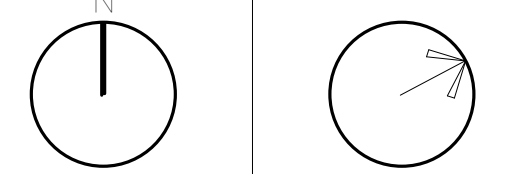

**SECOND FLOOR
REFLECTED
CEILING PLAN -
AREA B**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A8-1-2B

1 SECOND FLOOR REFLECTED CEILING PLAN - AREA B
1/8" = 1'-0"



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.drainc.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School


100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL


- CEILING LEGEND:**
- CEILING TYPE
8' - 8" CEILING HEIGHT RELATIVE TO FINISHED FLOOR
 - CEILING TYPE
8' - 8" SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
 - CEILING TYPE
8' - 8" BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
 - GWB GYPSUM WALL BOARD
 - MGWB MOISTURE RESISTANT GYPSUM WALL BOARD
 - EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
 - ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
 - LMC LINEAR METAL CEILING
 - PHN PHENOLIC PANEL CEILING
 - EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
 - SOUND ISOLATOR CEILING
 - ACM ALUMINUM COMPOSITE MATERIAL
 - LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - RECESSED OR COVE LIGHT
 - SUSPENDED OR PENDANT
 - CEILING OR WALL SURFACE MOUNTED
 - GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023




KEY PLAN

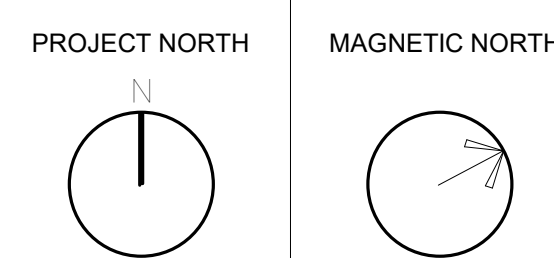

SECOND FLOOR REFLECTED CEILING PLAN - AREA C

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-2C

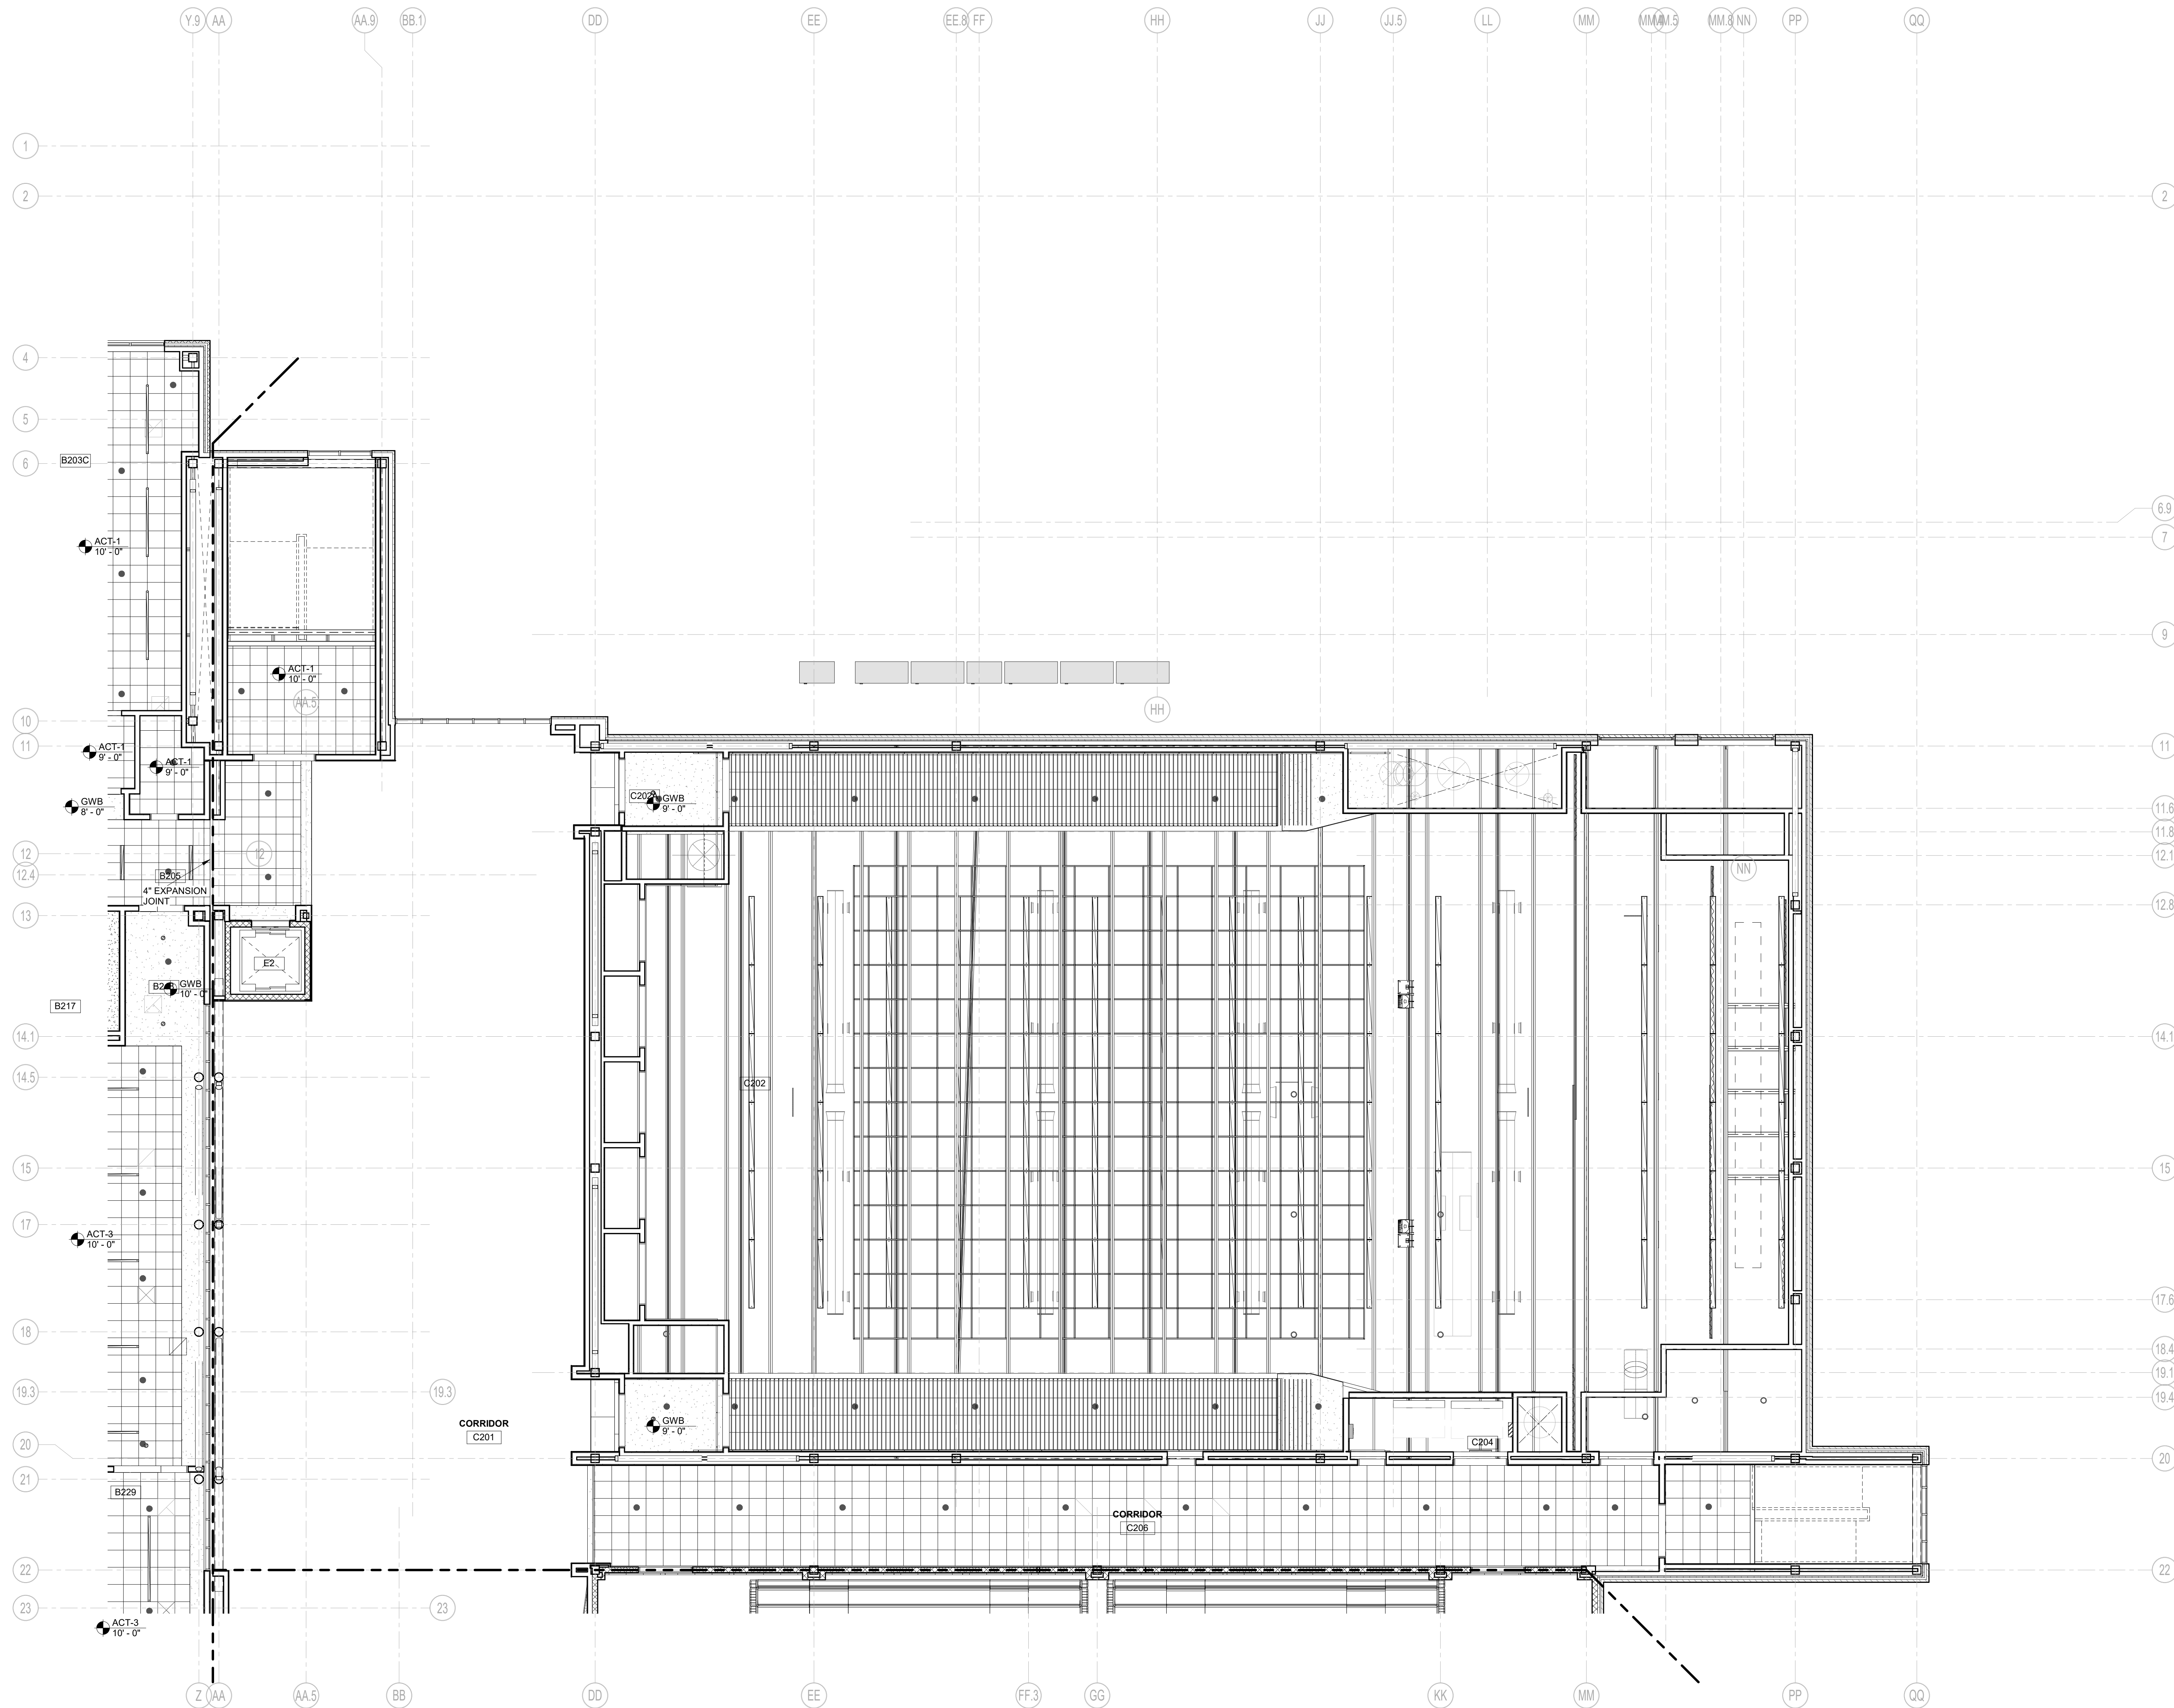



Drummeey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design



**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:	
	CEILING HEIGHT RELATIVE TO FINISHED FLOOR 1' - 0"
	SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MROWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTOWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS - SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION
May 12TH, 2023

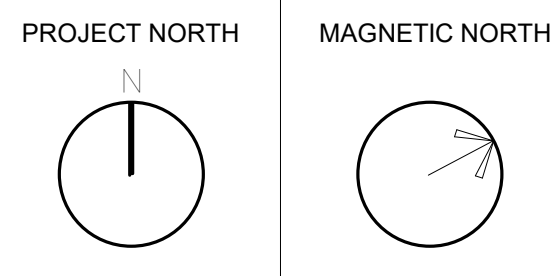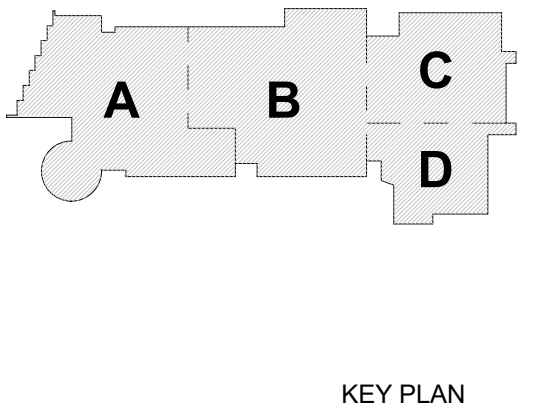


**SECOND FLOOR
REFLECTED
CEILING PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-2D

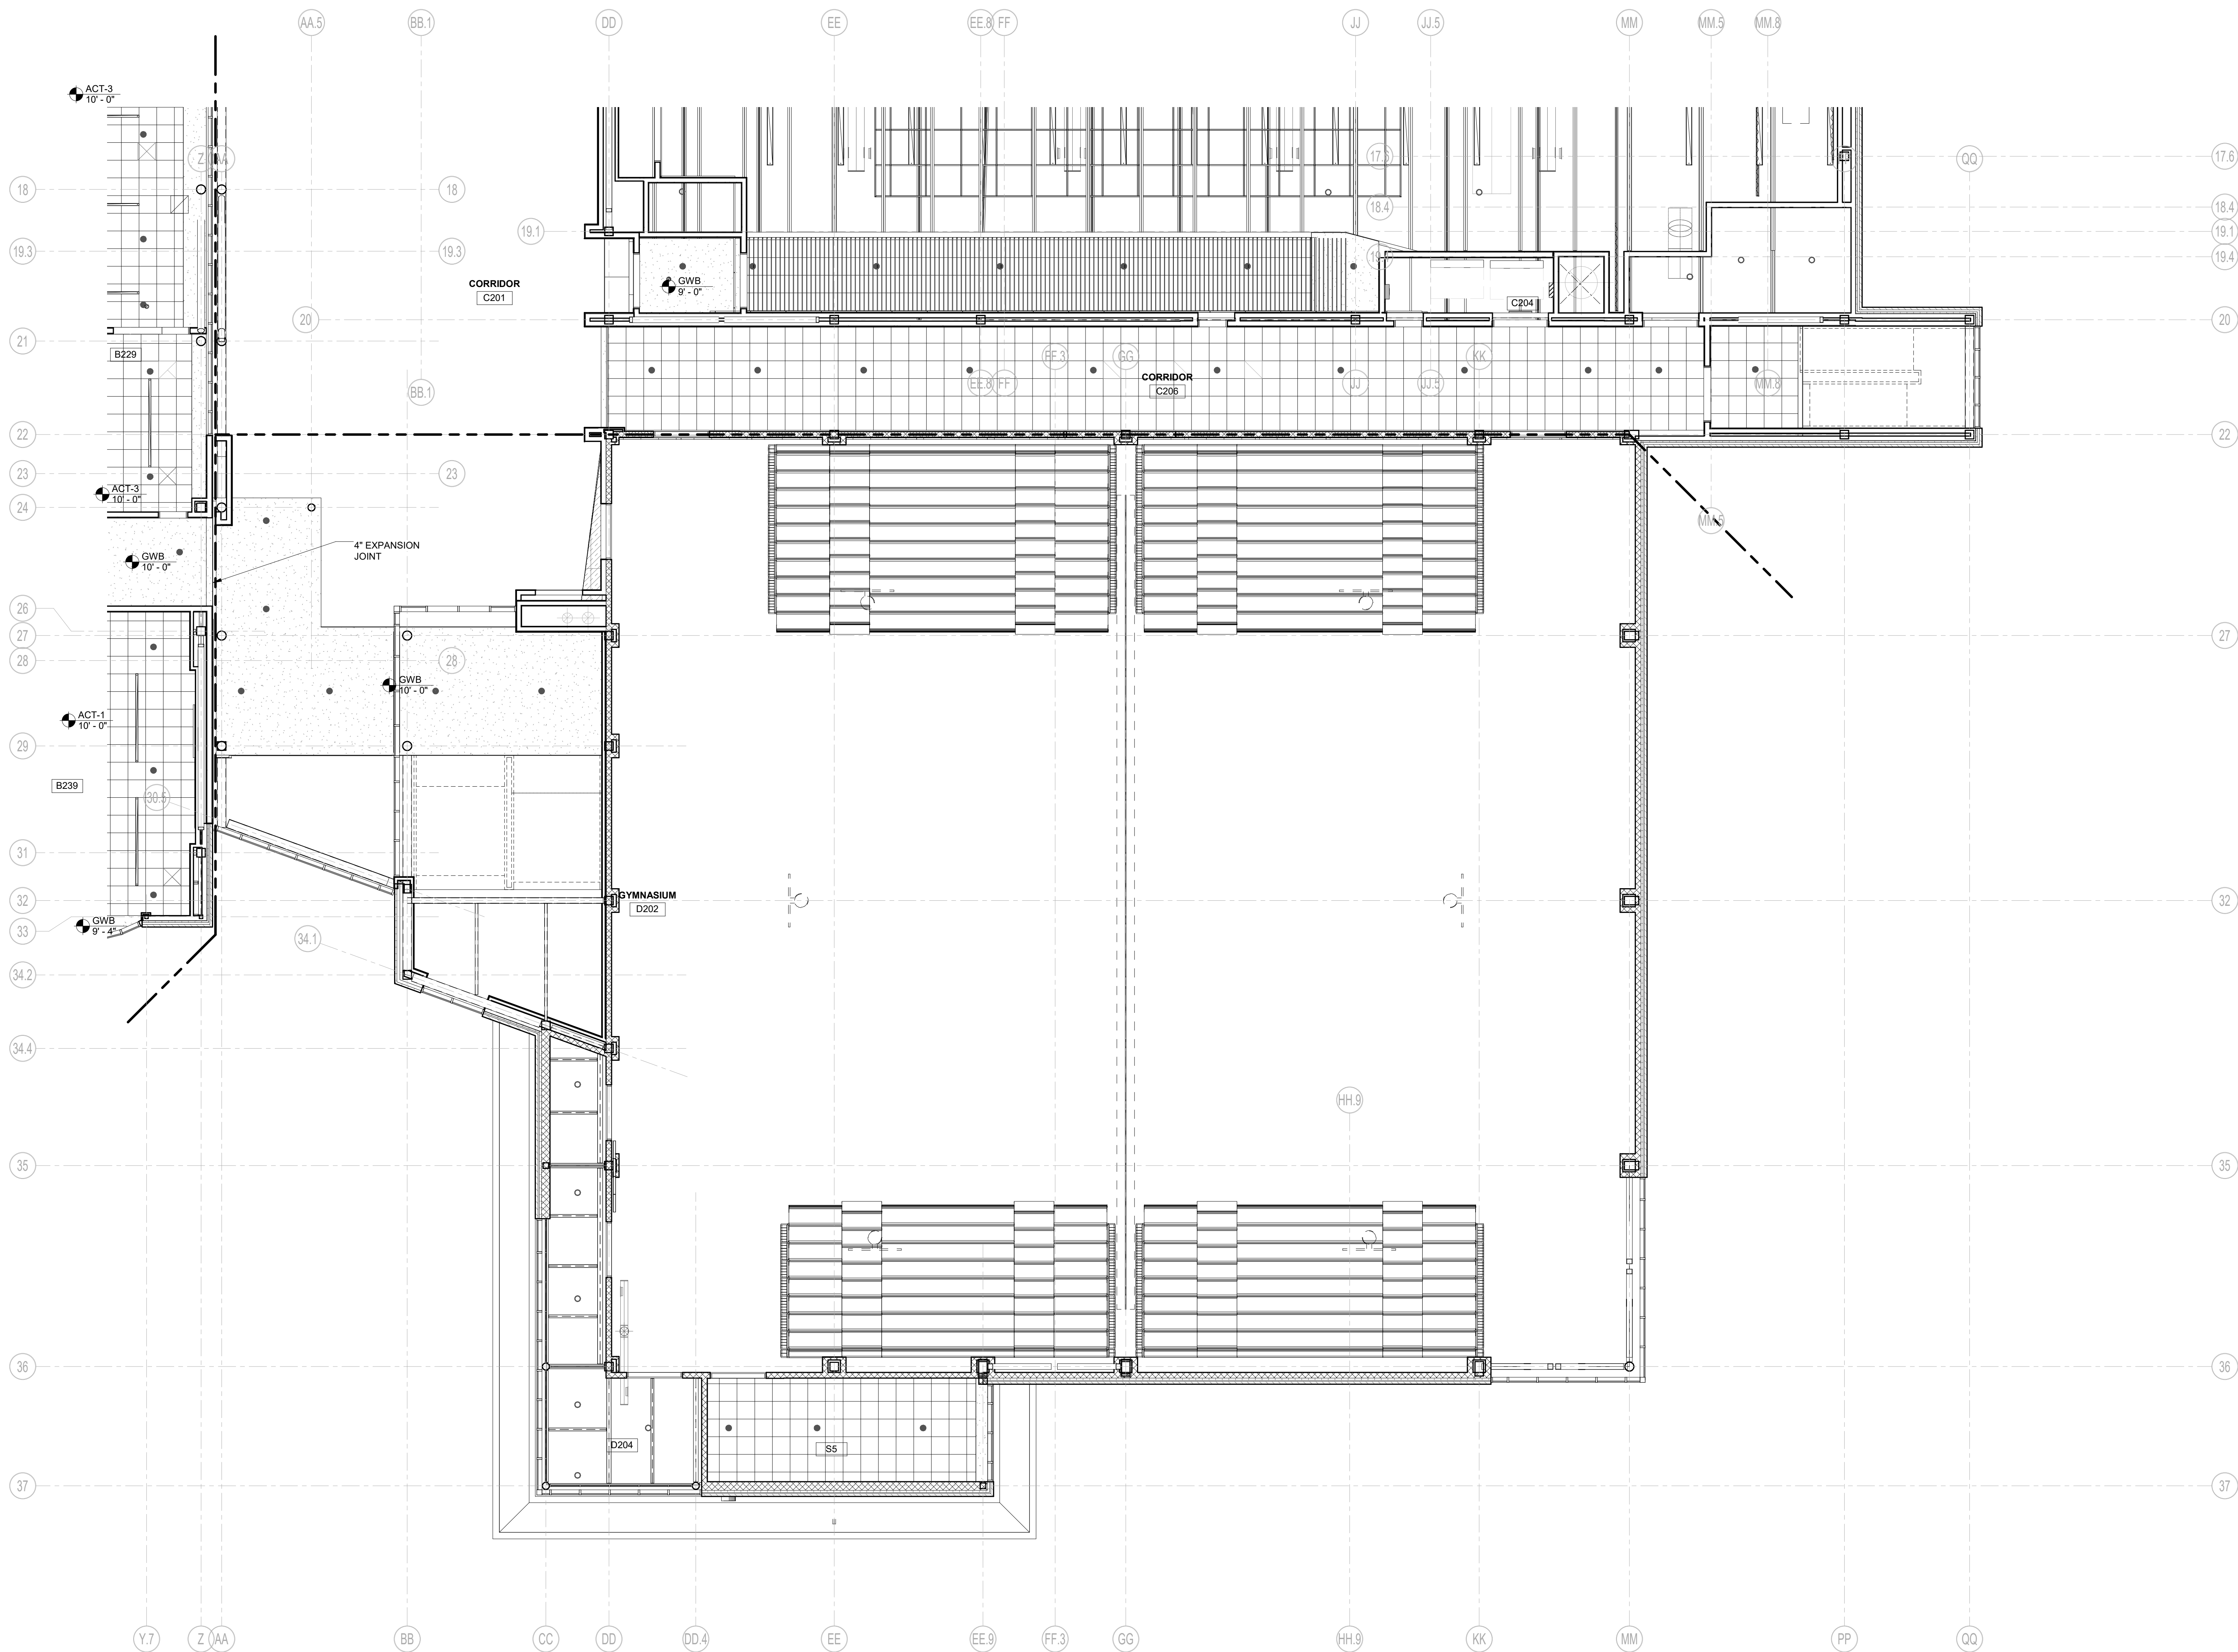

1 SECOND FLOOR REFLECTED CEILING PLAN - AREA D
1/8" = 1'-0"

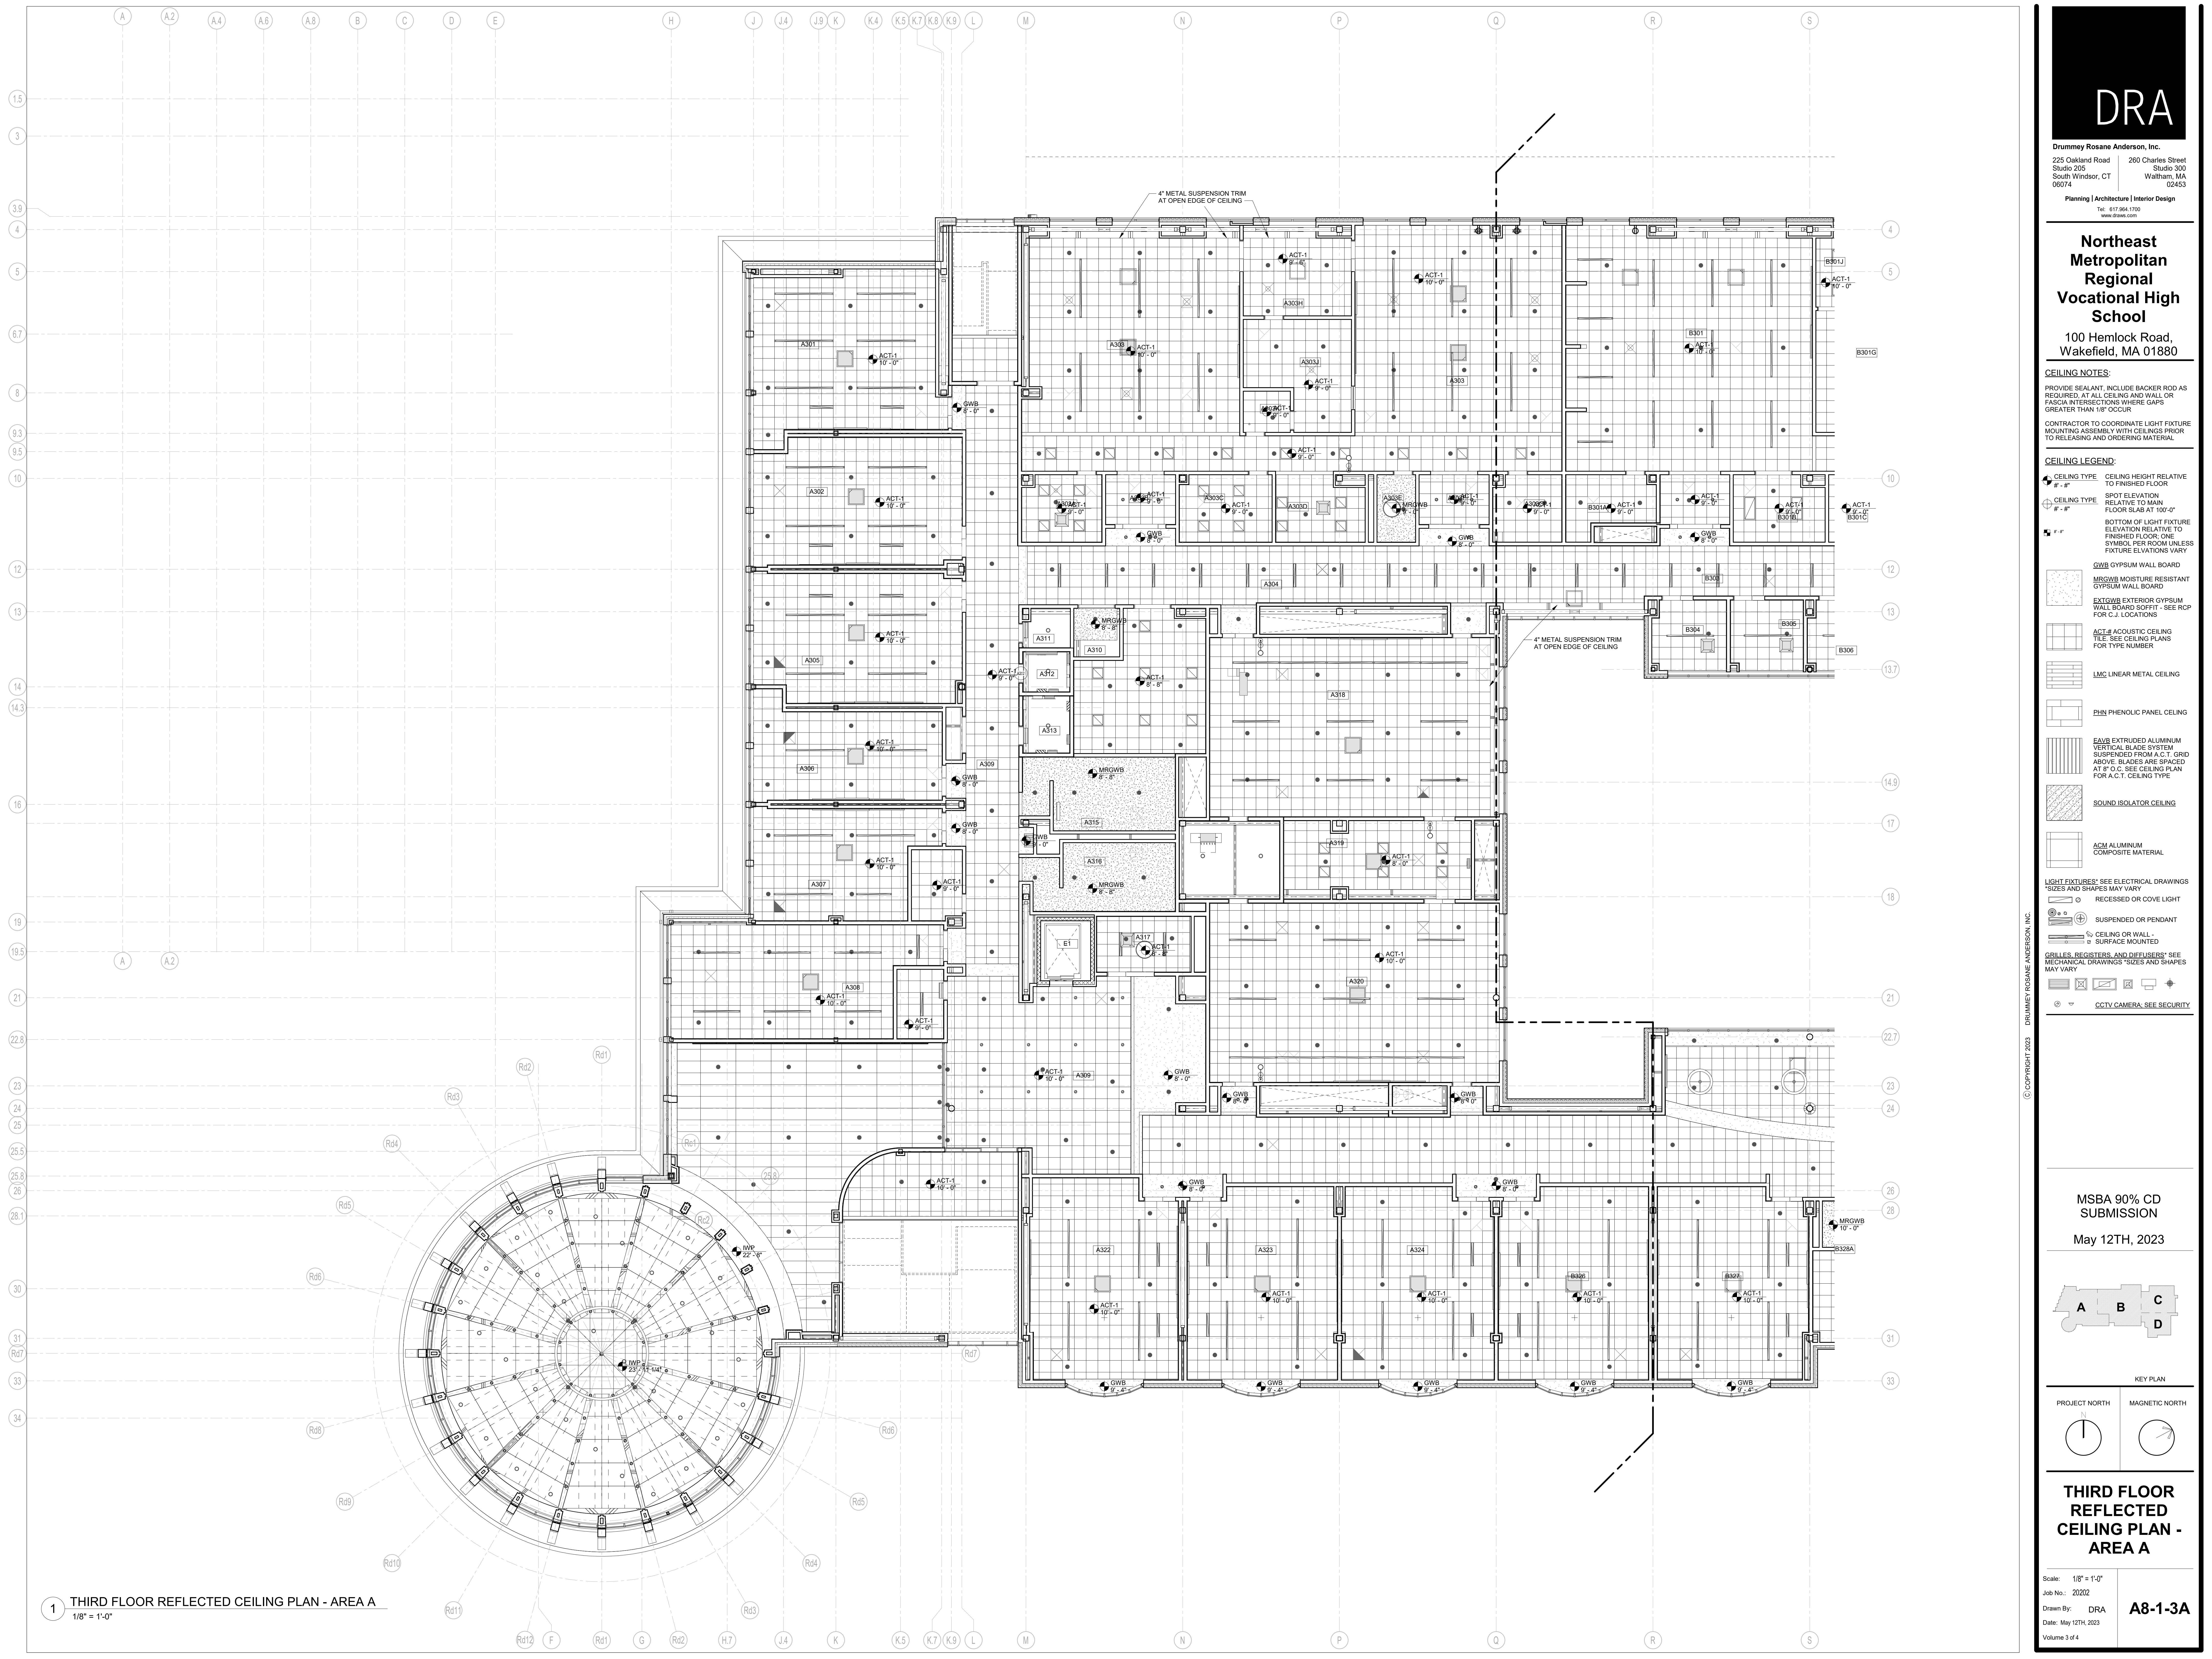

1 THIRD FLOOR REFLECTED CEILING PLAN - AREA A
1/8" = 1'-0"



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design



**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL

- CEILING LEGEND:**
- CEILING TYPE 9'-0" CEILING HEIGHT RELATIVE TO FINISHED FLOOR
 - CEILING TYPE 8'-0" SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
 - CEILING TYPE 7'-0" BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
 - GWB GYPSUM WALL BOARD
 - MRGWB MOISTURE RESISTANT GYPSUM WALL BOARD
 - EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
 - ACT-2 ACoustic CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
 - LMC LINEAR METAL CEILING
 - PHN PHENOLIC PANEL CEILING
 - EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
 - SOUND ISOLATOR CEILING
 - ACM ALUMINUM COMPOSITE MATERIAL
 - LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - RECESSED OR COVE LIGHT
 - SUSPENDED OR PENDANT
 - CEILING OR WALL SURFACE MOUNTED
 - GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMME ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

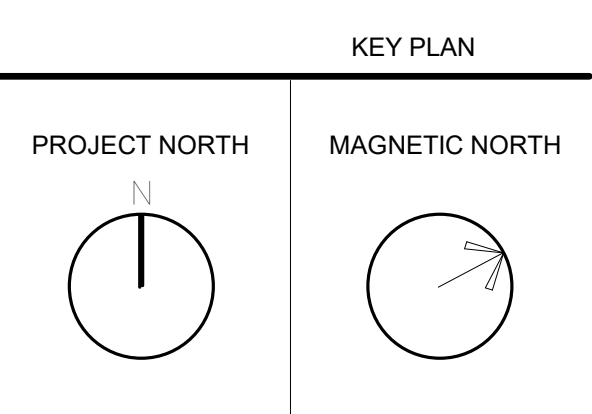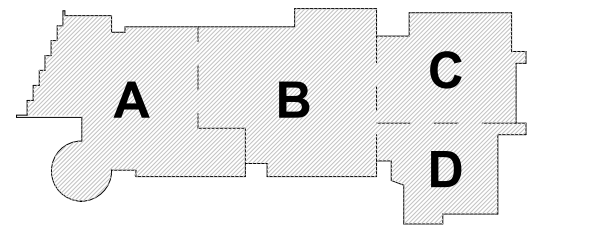

**THIRD FLOOR
REFLECTED
CEILING PLAN -
AREA A**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-3A



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.drainc.com


280 Charles Street
Studio 300
Waltham, MA
02453
Tel: 817.854.1700
www.drainc.com

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880



CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL

- CEILING LEGEND:**
- CEILING TYPE
" - " CEILING HEIGHT RELATIVE TO FINISHED FLOOR
 - CEILING TYPE
" - " SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
 - CEILING TYPE
" - " BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
 - GWB GYPSUM WALL BOARD
 - MEOWB MOISTURE RESISTANT GYPSUM WALL BOARD
 - EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
 - ACT-8 ACoustic CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
 - LMC LINEAR METAL CEILING
 - PHN PHENOLIC PANEL CEILING
 - EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
 - SOUND ISOLATOR CEILING
 - ACM ALUMINUM COMPOSITE MATERIAL
 - LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - RECESSED OR COVE LIGHT
 - SUSPENDED OR PENDANT
 - CEILING OR WALL SURFACE MOUNTED
 - GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY
 - CCTV CAMERA, SEE SECURITY

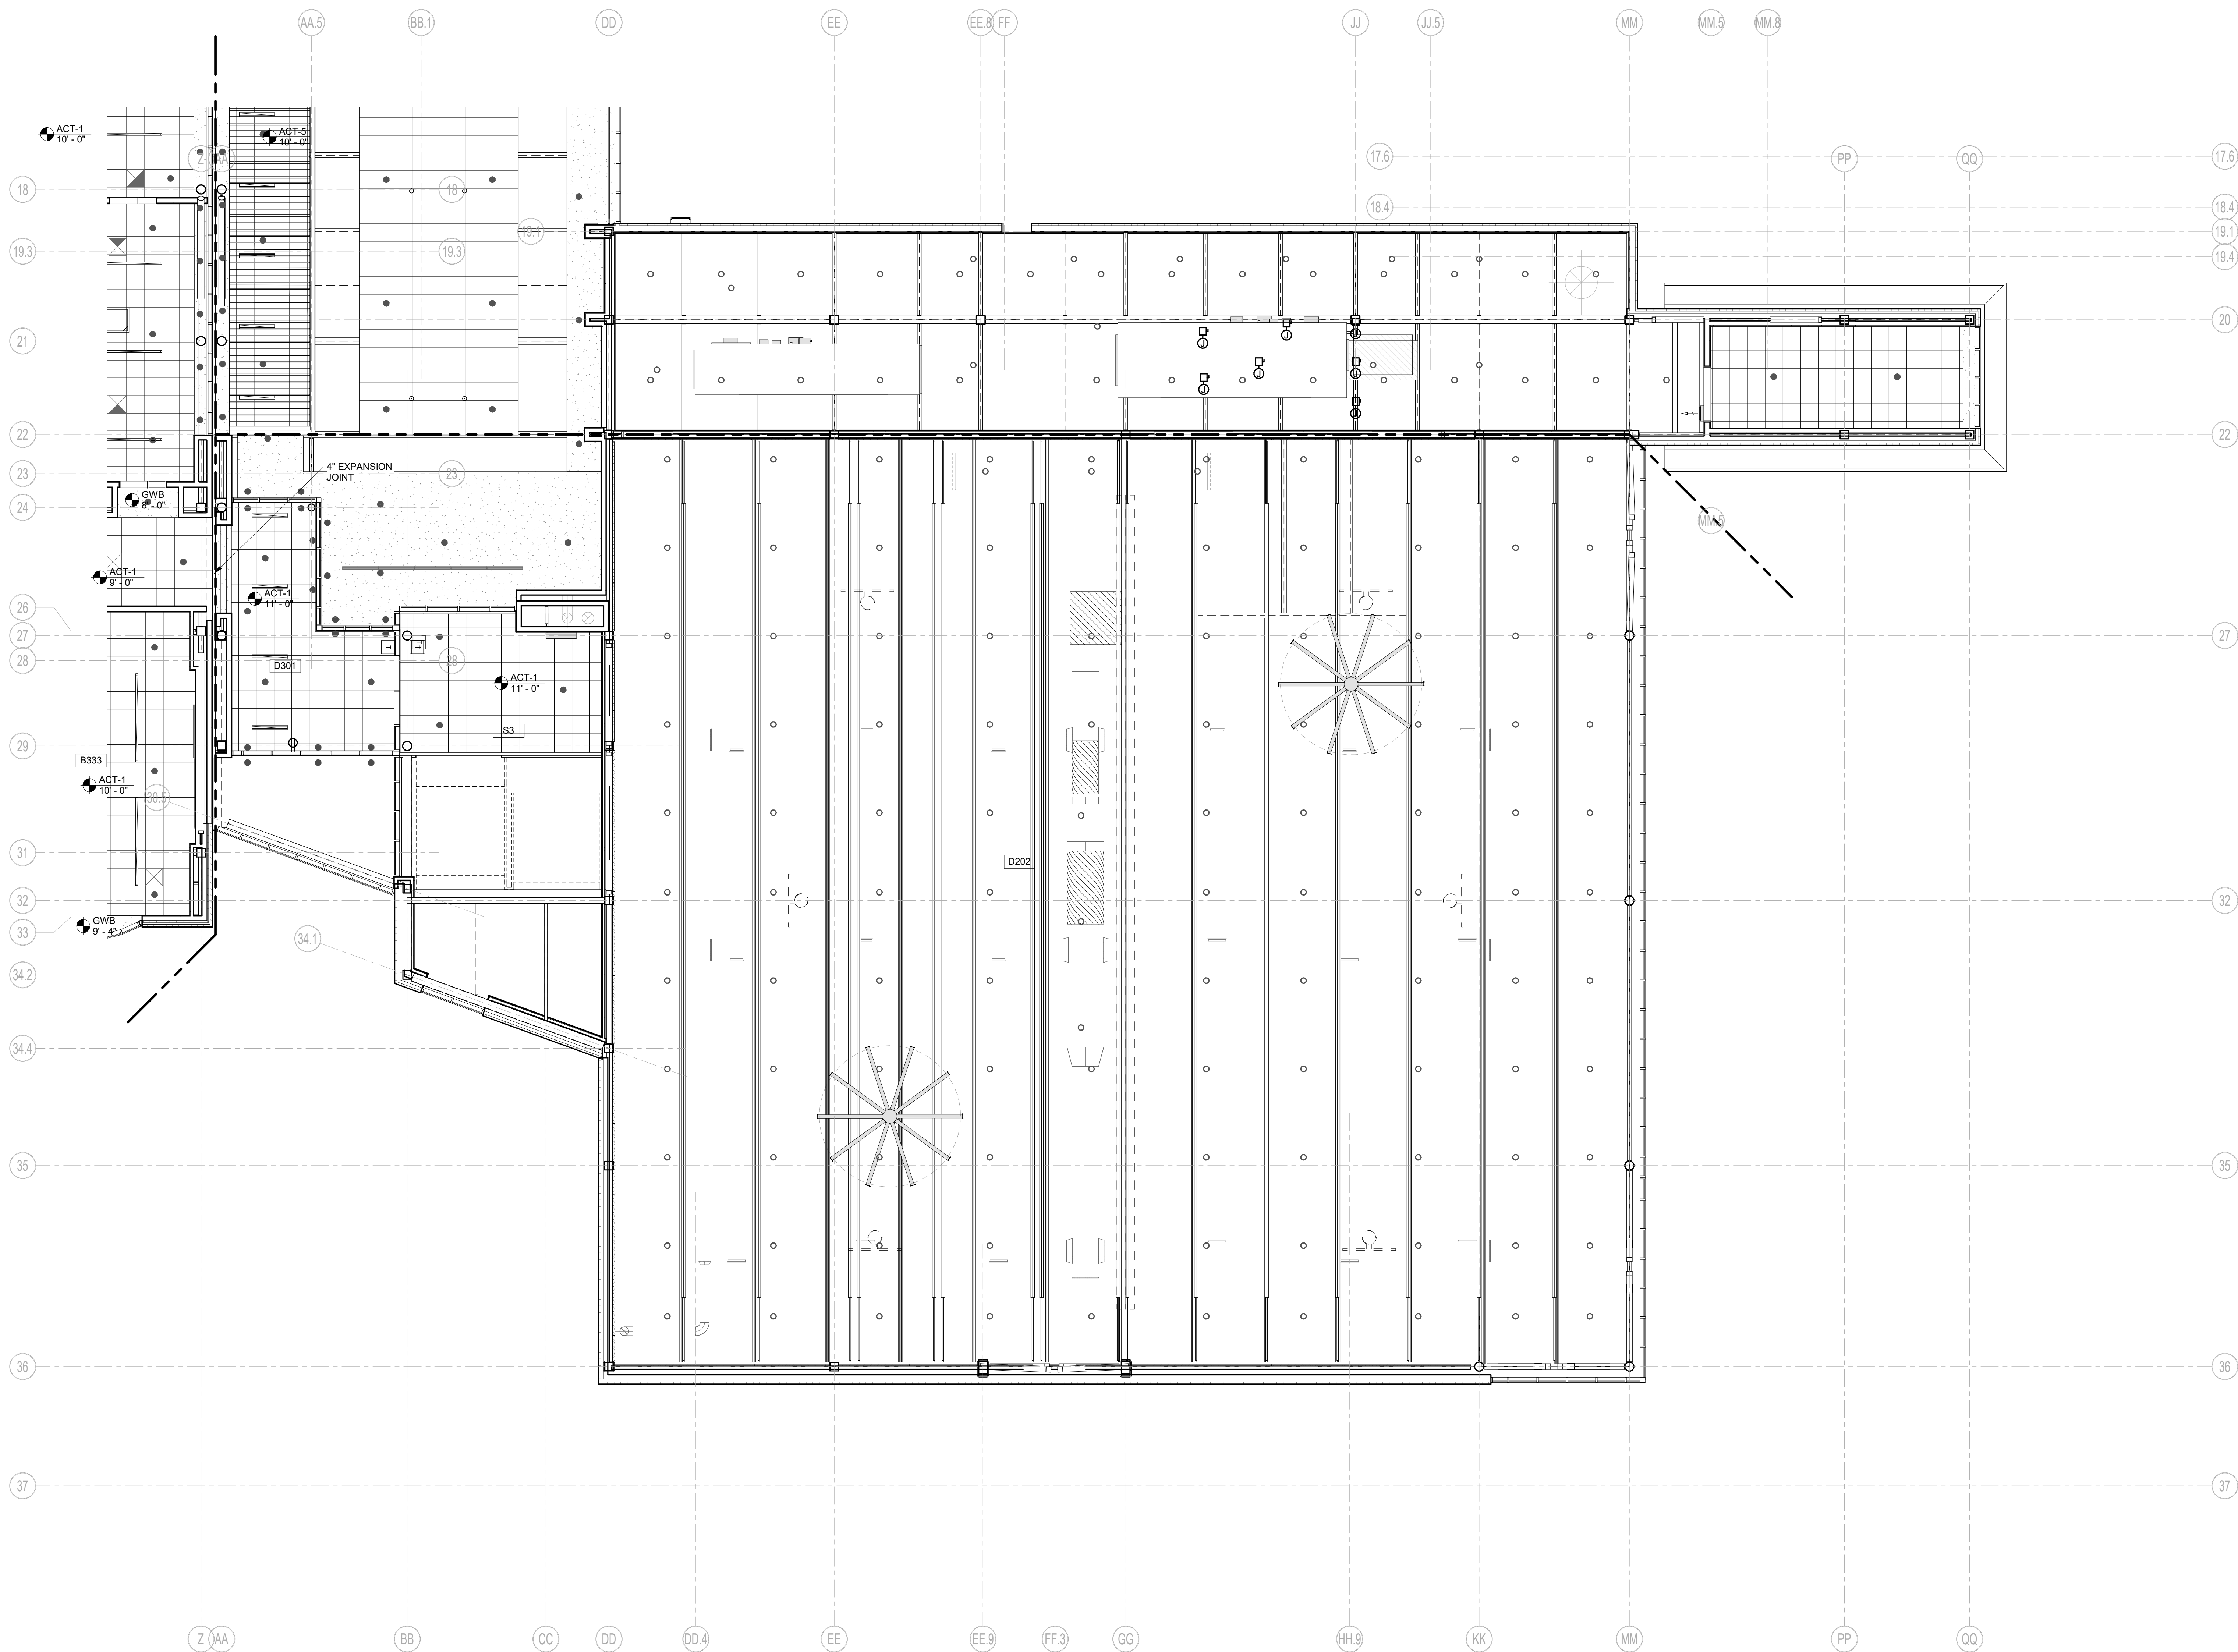

1 THIRD FLOOR REFLECTED CEILING PLAN - AREA D
1/8" = 1'-0"


MSBA 90% CD
SUBMISSION
May 12TH, 2023

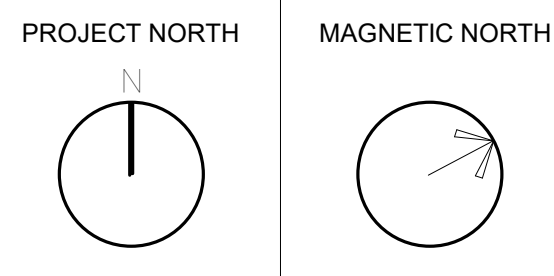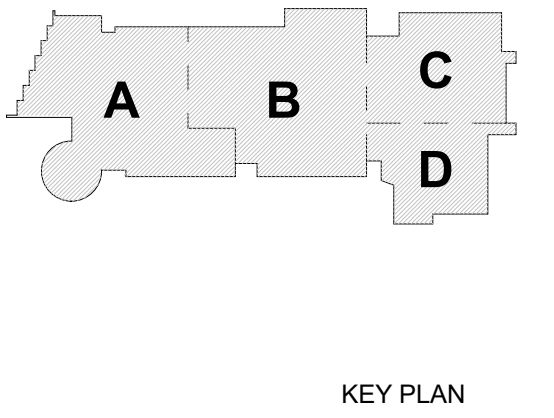

**THIRD FLOOR
REFLECTED
CEILING PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-3D

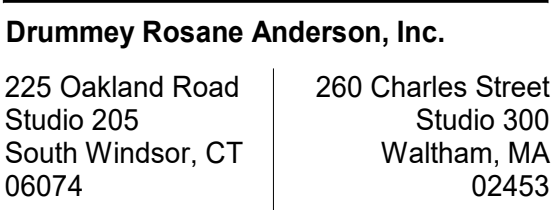

**Northeast
Metropolitan
Regional
Vocational High
School**

INSTALLATION NOTES:

PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR PLUMBING INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR

CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO ORDERING AND ORDERING MATERIAL

CEILING TYPE # - #	CEILING HEIGHT RELATIVE TO FINISHED FLOOR
CEILING TYPE # - #	SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
# - #	BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR; ONE SYMBOL PER ROOM UNLESS

Page 3 of 4

1 FOURTH FLOOR REFLECTED CEILING PLAN - AREA A
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1702
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**

100 Hemlock Road,
Wakefield, MA 01880


CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL

CEILING LEGEND:	
	CEILING TYPE 1 CEILING HEIGHT RELATIVE TO FINISHED FLOOR 8' - 0"
	CEILING TYPE 2 SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	CEILING TYPE 3 BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MRGWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL - SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS *SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

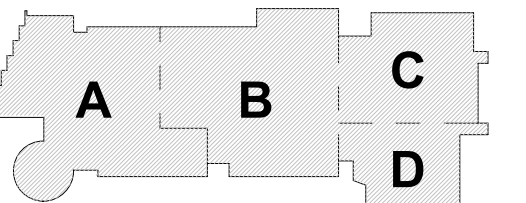


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH



**FOURTH FLOOR
REFLECTED
CEILING PLAN -
AREA B**

Scale: 1/8" = 1'-0"

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

A8-1-4B

FOURTH FLOOR REFLECTED CEILING PLAN - AREA B
1/8" = 1'-0"



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS
REQUIRED, AT ALL CEILING AND WALL OR
FASCIA INTERSECTIONS WHERE GAPS
GREATER THAN 1/8" OCCUR
CONTRACTOR TO COORDINATE LIGHT FIXTURE
MOUNTING ASSEMBLY WITH CEILINGS PRIOR
TO RELEASING AND ORDERING MATERIAL


CEILING LEGEND:	
	CEILING HEIGHT RELATIVE TO FINISHED FLOOR
	SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
	BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY
	GWB GYPSUM WALL BOARD
	MROWB MOISTURE RESISTANT GYPSUM WALL BOARD
	EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS
	ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER
	LMC LINEAR METAL CEILING
	PHN PHENOLIC PANEL CEILING
	EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE
	SOUND ISOLATOR CEILING
	ACM ALUMINUM COMPOSITE MATERIAL
LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY	
	RECESSED OR COVE LIGHT
	SUSPENDED OR PENDANT
	CEILING OR WALL SURFACE MOUNTED
GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS *SIZES AND SHAPES MAY VARY	
	CCTV CAMERA, SEE SECURITY

© COPYRIGHT 2023 DRUMMEY ROSANE ANDERSON, INC.

MSBA 90% CD
SUBMISSION
May 12TH, 2023

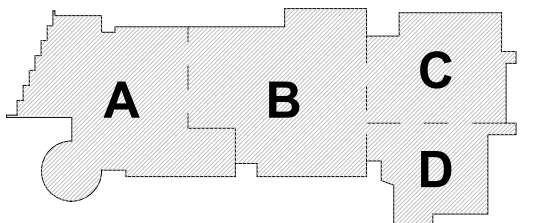


KEY PLAN

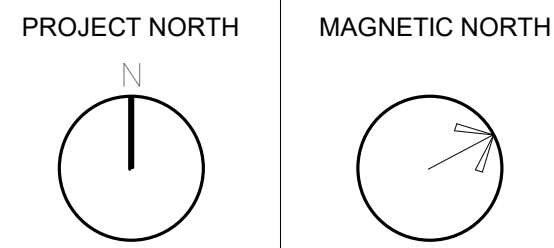

**FOURTH FLOOR
REFLECTED
CEILING PLAN -
AREA C**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-4C

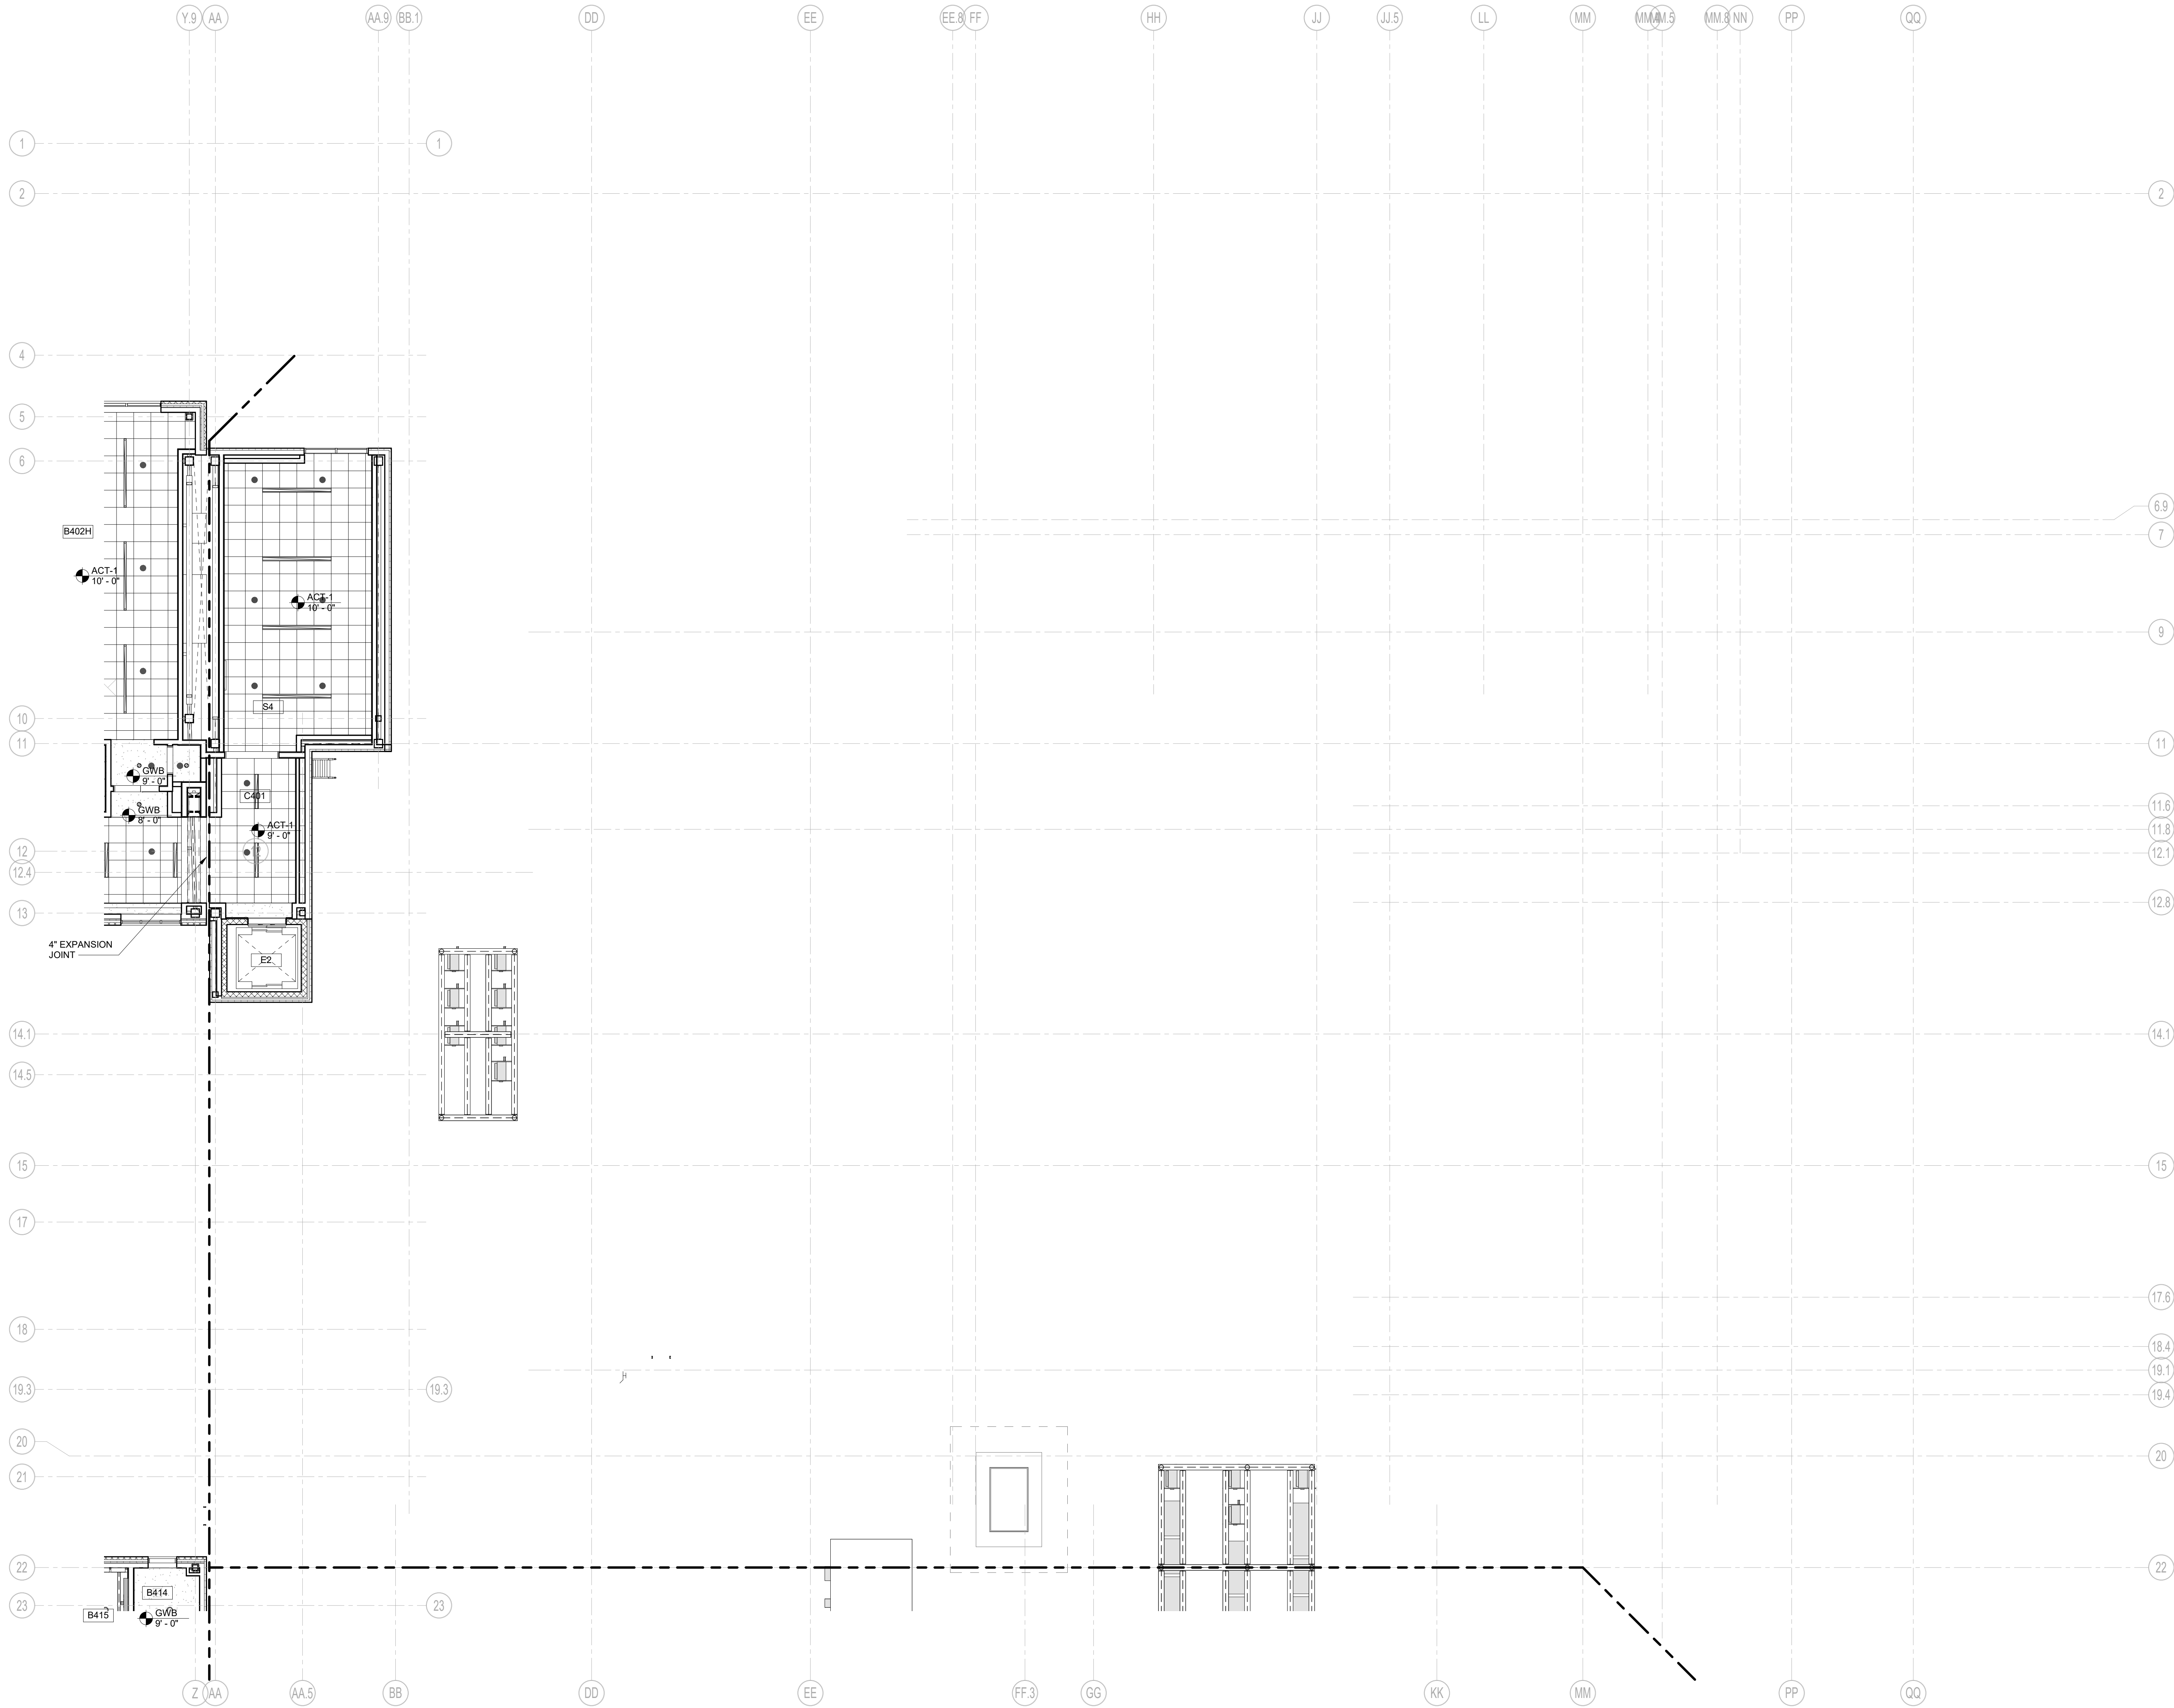



Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.drainc.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

CEILING NOTES:
PROVIDE SEALANT, INCLUDE BACKER ROD AS REQUIRED, AT ALL CEILING AND WALL OR FASCIA INTERSECTIONS WHERE GAPS GREATER THAN 1/8" OCCUR.
CONTRACTOR TO COORDINATE LIGHT FIXTURE MOUNTING ASSEMBLY WITH CEILINGS PRIOR TO RELEASING AND ORDERING MATERIAL.

CEILING LEGEND:
▲ CEILING TYPE
#'-0" CEILING HEIGHT RELATIVE TO FINISHED FLOOR
+ CEILING TYPE
#'-0" SPOT ELEVATION RELATIVE TO MAIN FLOOR SLAB AT 100'-0"
▲ CEILING TYPE
#'-0" BOTTOM OF LIGHT FIXTURE ELEVATION RELATIVE TO FINISHED FLOOR, ONE SYMBOL PER ROOM UNLESS FIXTURE ELEVATIONS VARY

GWB GYPSUM WALL BOARD
MROWB MOISTURE RESISTANT GYPSUM WALL BOARD
EXTGWB EXTERIOR GYPSUM WALL BOARD SOFFIT - SEE RCP FOR C.J. LOCATIONS

ACT-8 ACOUSTIC CEILING TILE - SEE CEILING PLANS FOR TYPE NUMBER

LMC LINEAR METAL CEILING

PHN PHENOLIC PANEL CEILING

EAVB EXTRUDED ALUMINUM VERTICAL BLADE SYSTEM SUSPENDED FROM A.C.T. GRID ABOVE. BLADES ARE SPACED AT 8" O.C. SEE CEILING PLAN FOR A.C.T. CEILING TYPE

SOUND ISOLATOR CEILING

ACM ALUMINUM COMPOSITE MATERIAL

LIGHT FIXTURES: SEE ELECTRICAL DRAWINGS SIZES AND SHAPES MAY VARY

○ RECESSED OR COVE LIGHT


○ SUSPENDED OR PENDANT

○ CEILING OR WALL SURFACE MOUNTED


GRILLES, REGISTERS, AND DIFFUSERS: SEE MECHANICAL DRAWINGS SIZES AND SHAPES MAY VARY

○ CCTV CAMERA, SEE SECURITY

MSBA 90% CD
SUBMISSION
May 12TH, 2023

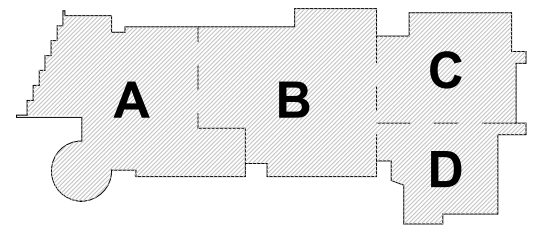


KEY PLAN

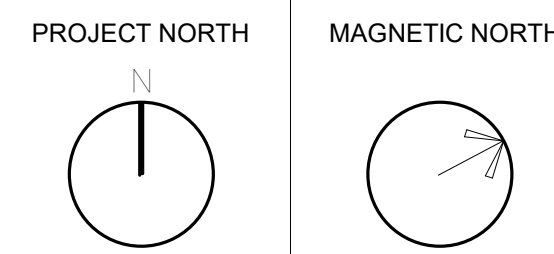


**FOURTH FLOOR
REFLECTED
CEILING PLAN -
AREA D**

Scale: 1/8" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

A8-1-4D

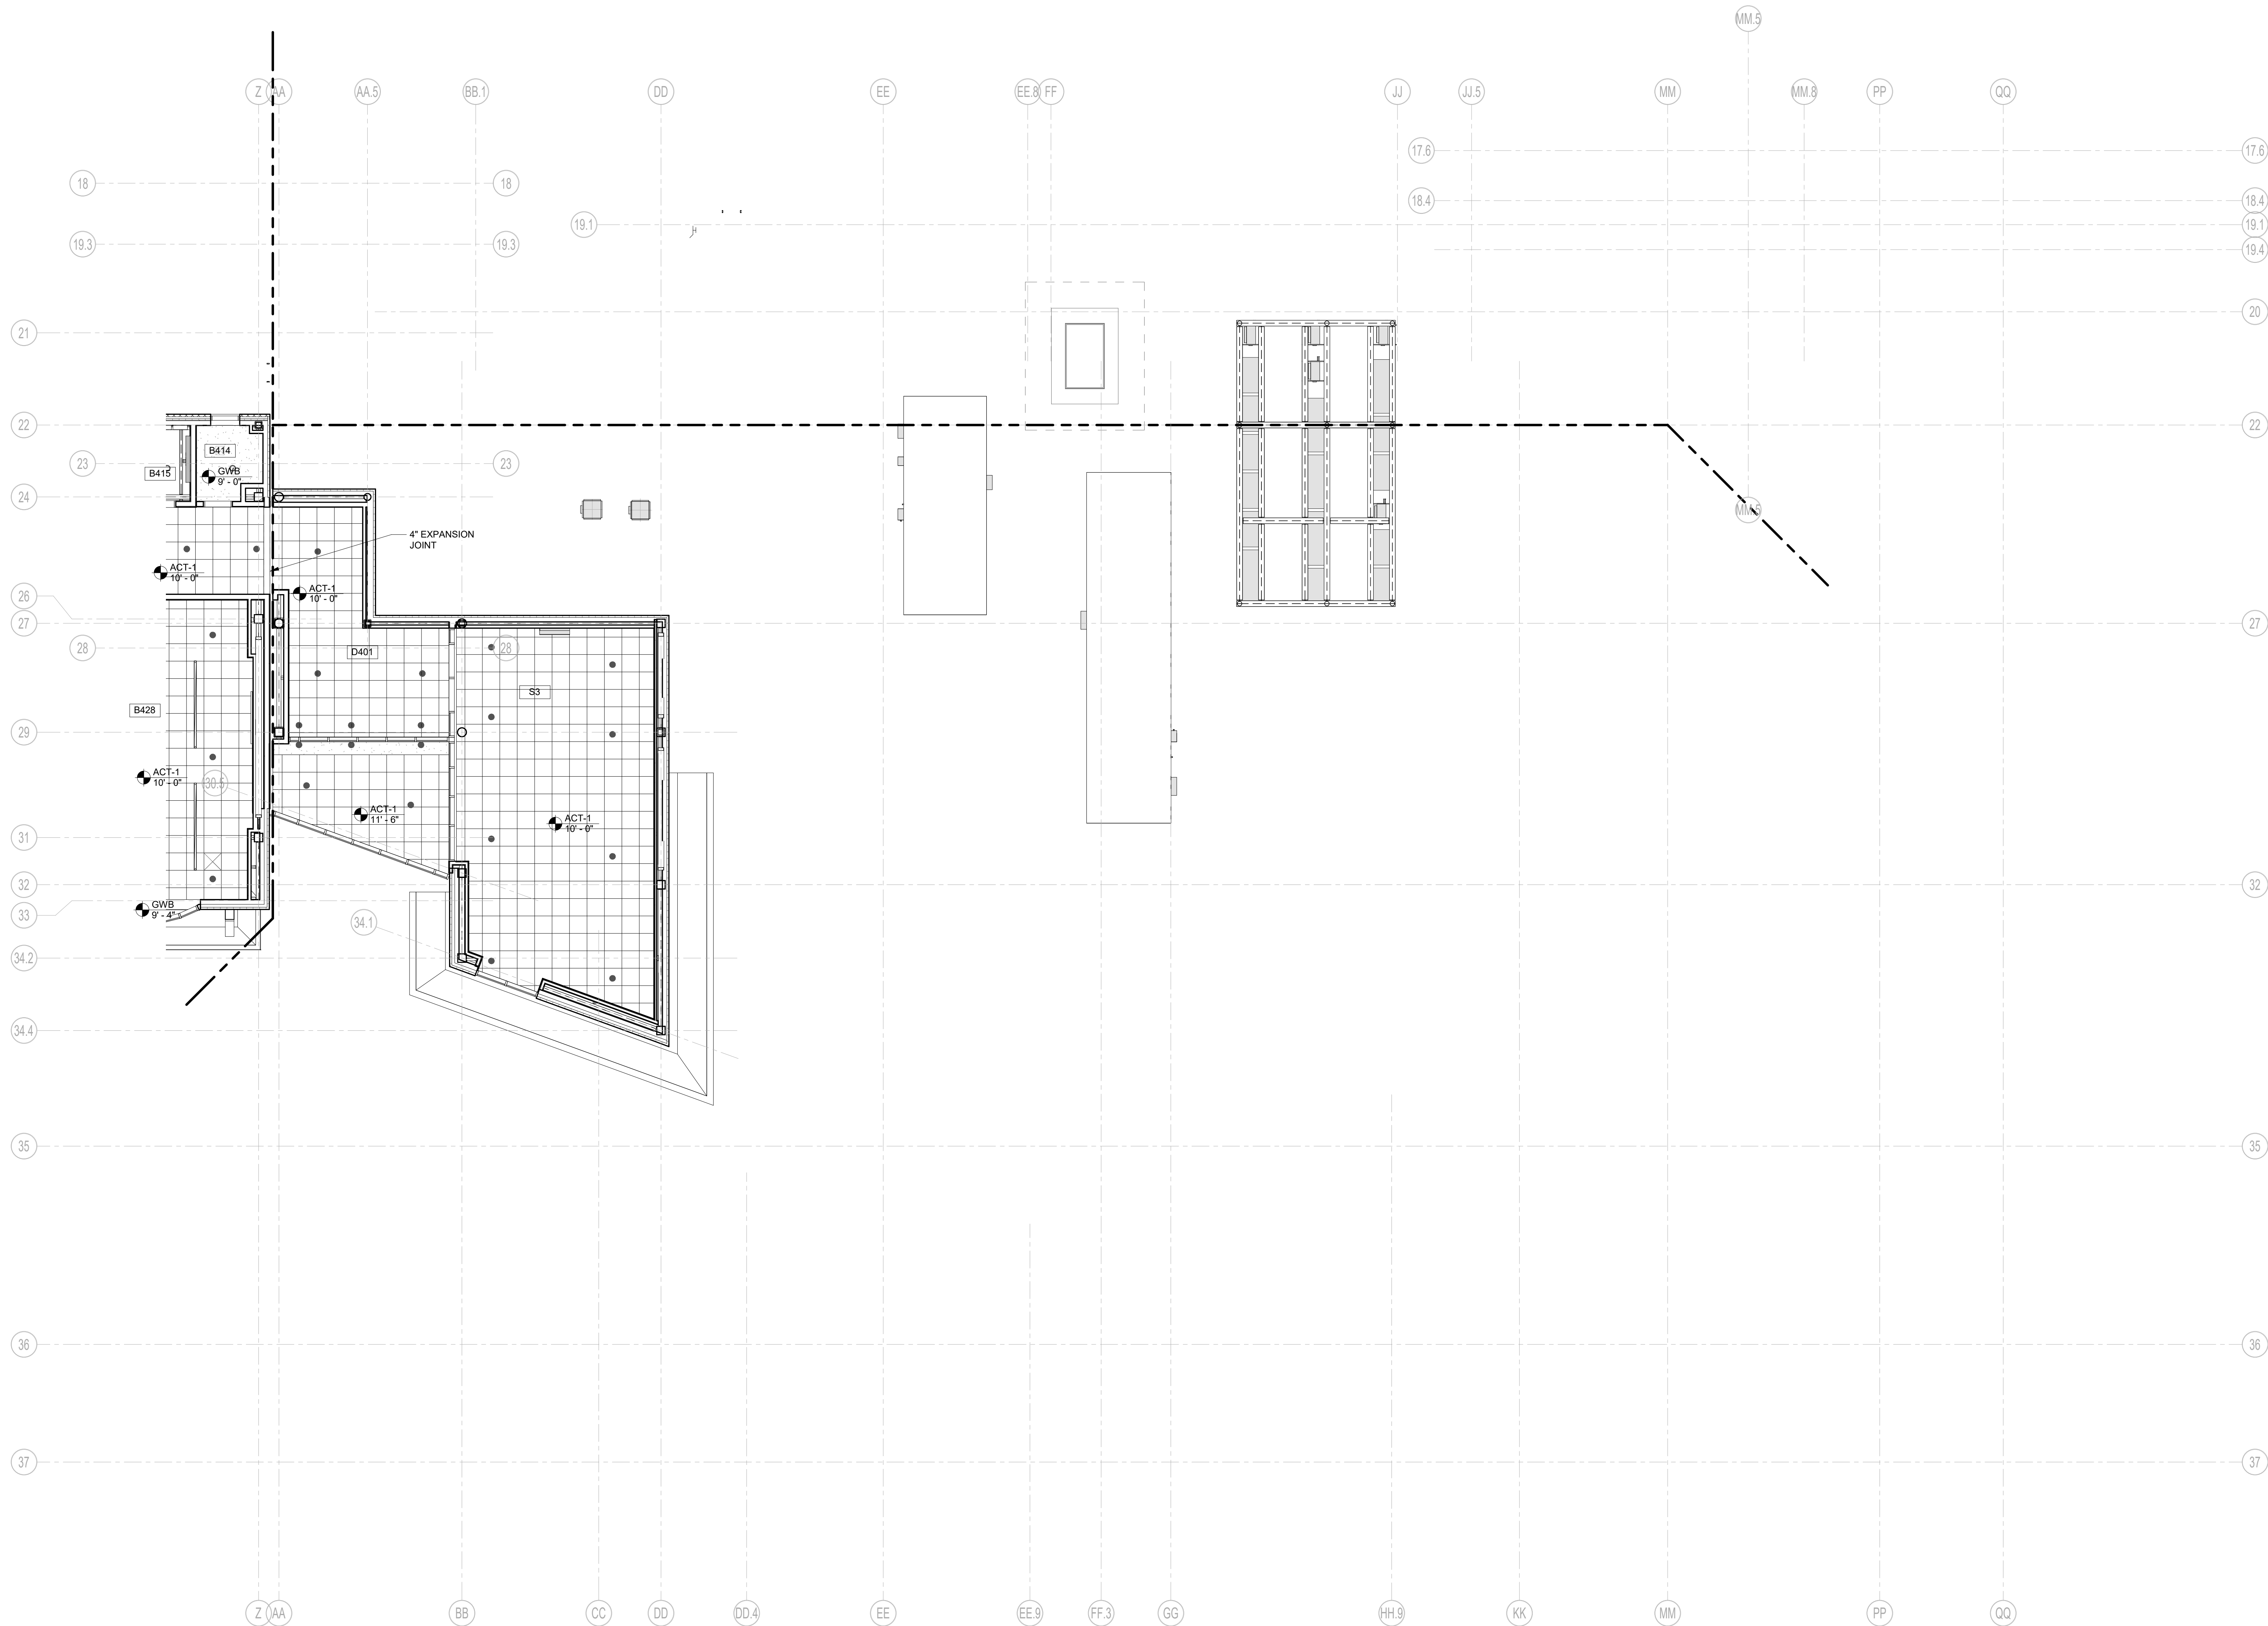

1 FOURTH FLOOR REFLECTED CEILING PLAN - AREA D
1/8" = 1'-0"

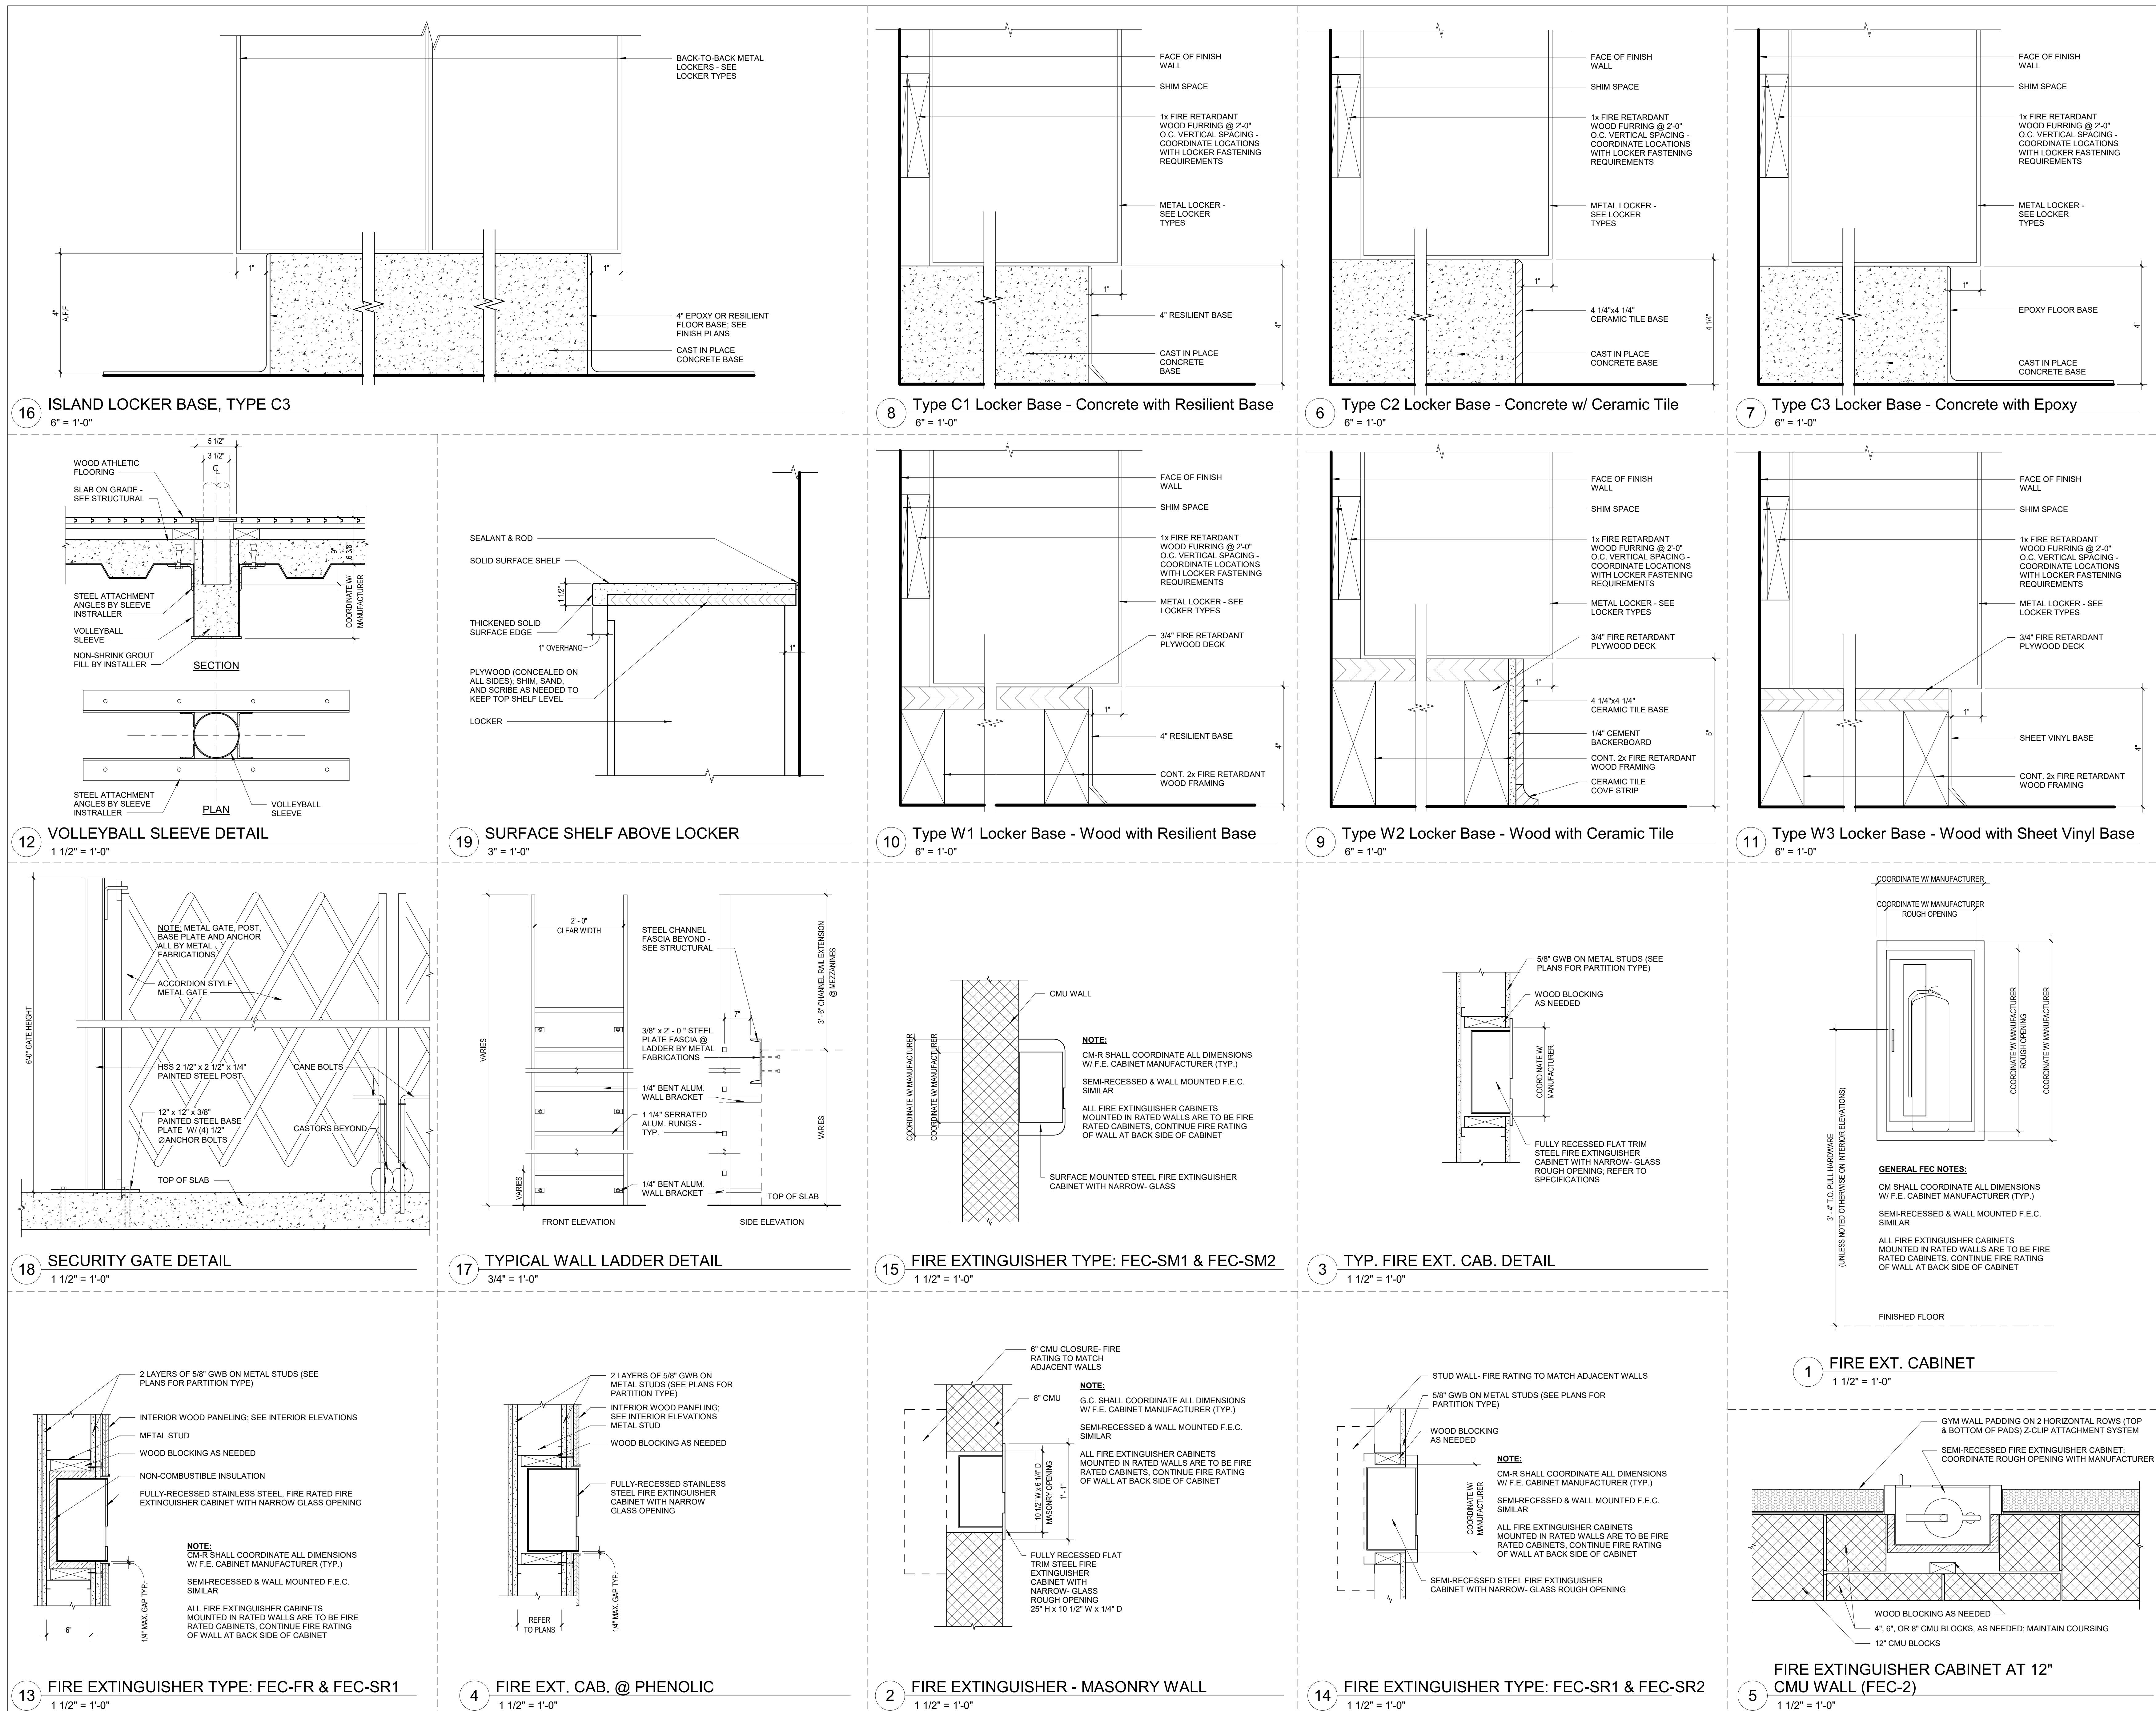


**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880

© COPYRIGHT 2023 DRUMMEYS ROSANE ANDERSON, INC.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

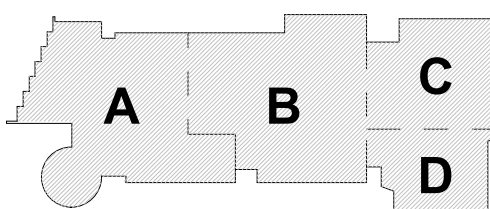


KEY PLAN

PROJECT NORTH



MAGNETIC NORTH

**MISCELLANEOUS
DETAILS**


Scale: As indicated

Job No.: 20202


Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

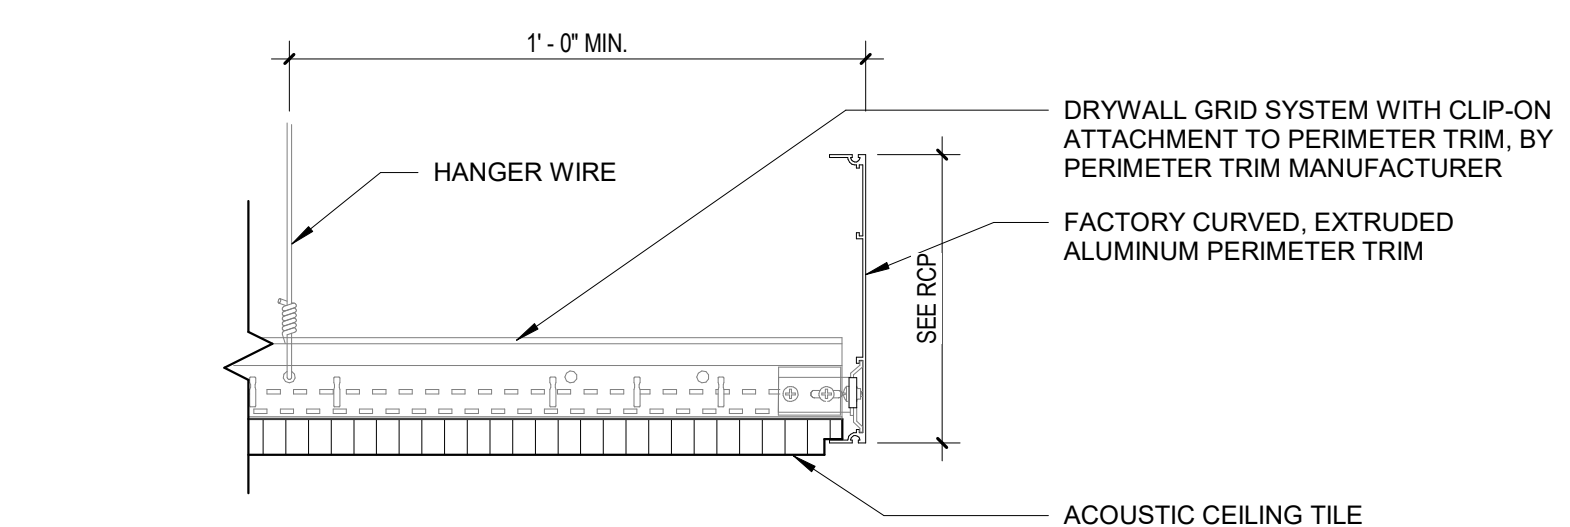A9-1-2**5 PERIMETER TRIM FOR ACT CEILING**


3" = 1'-0"

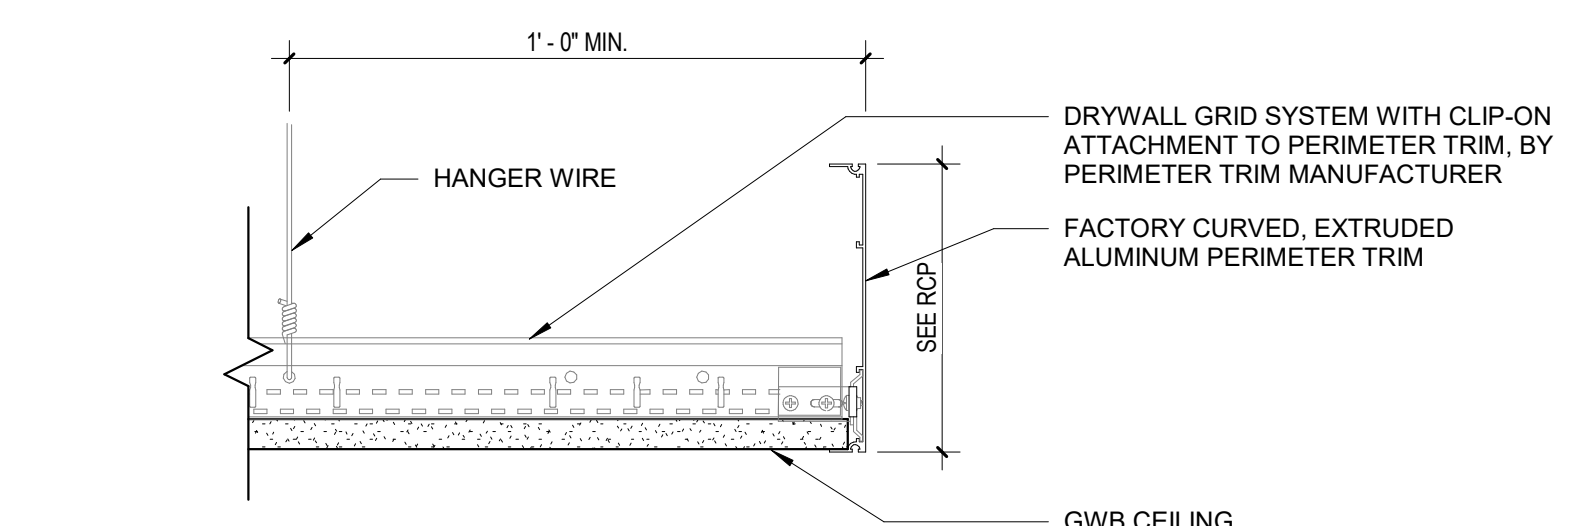**4 PERIMETER TRIM FOR GWB CEILING**


3" = 1'-0"

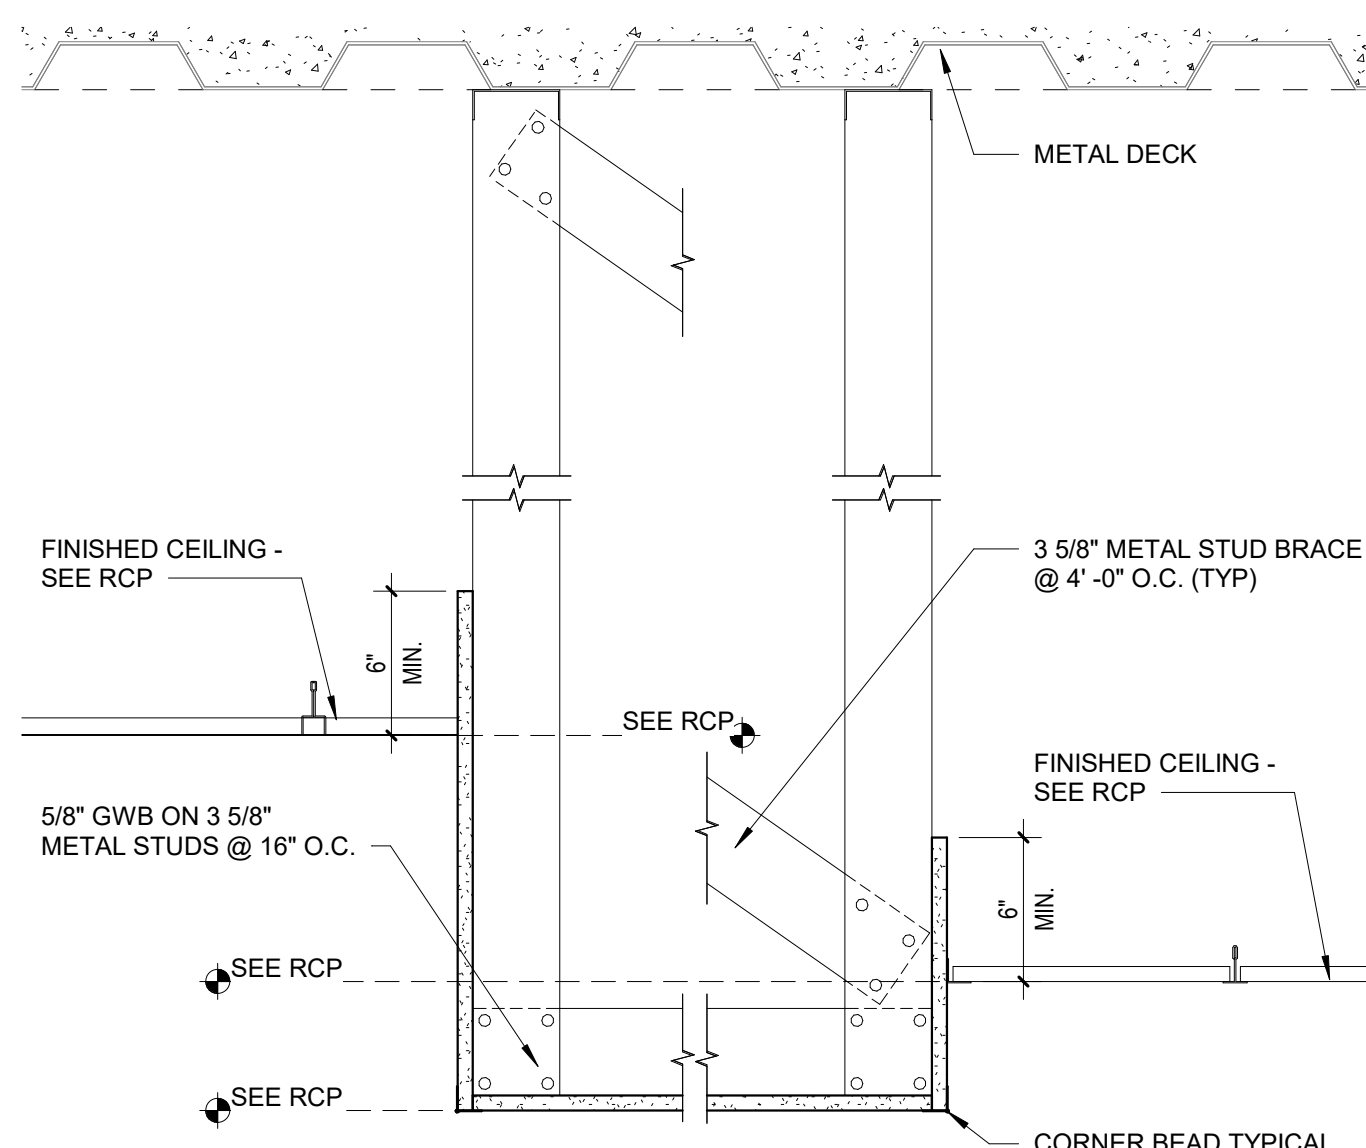**3 TYPICAL BULKHEAD DETAIL**

1 1/2" = 1'-0"

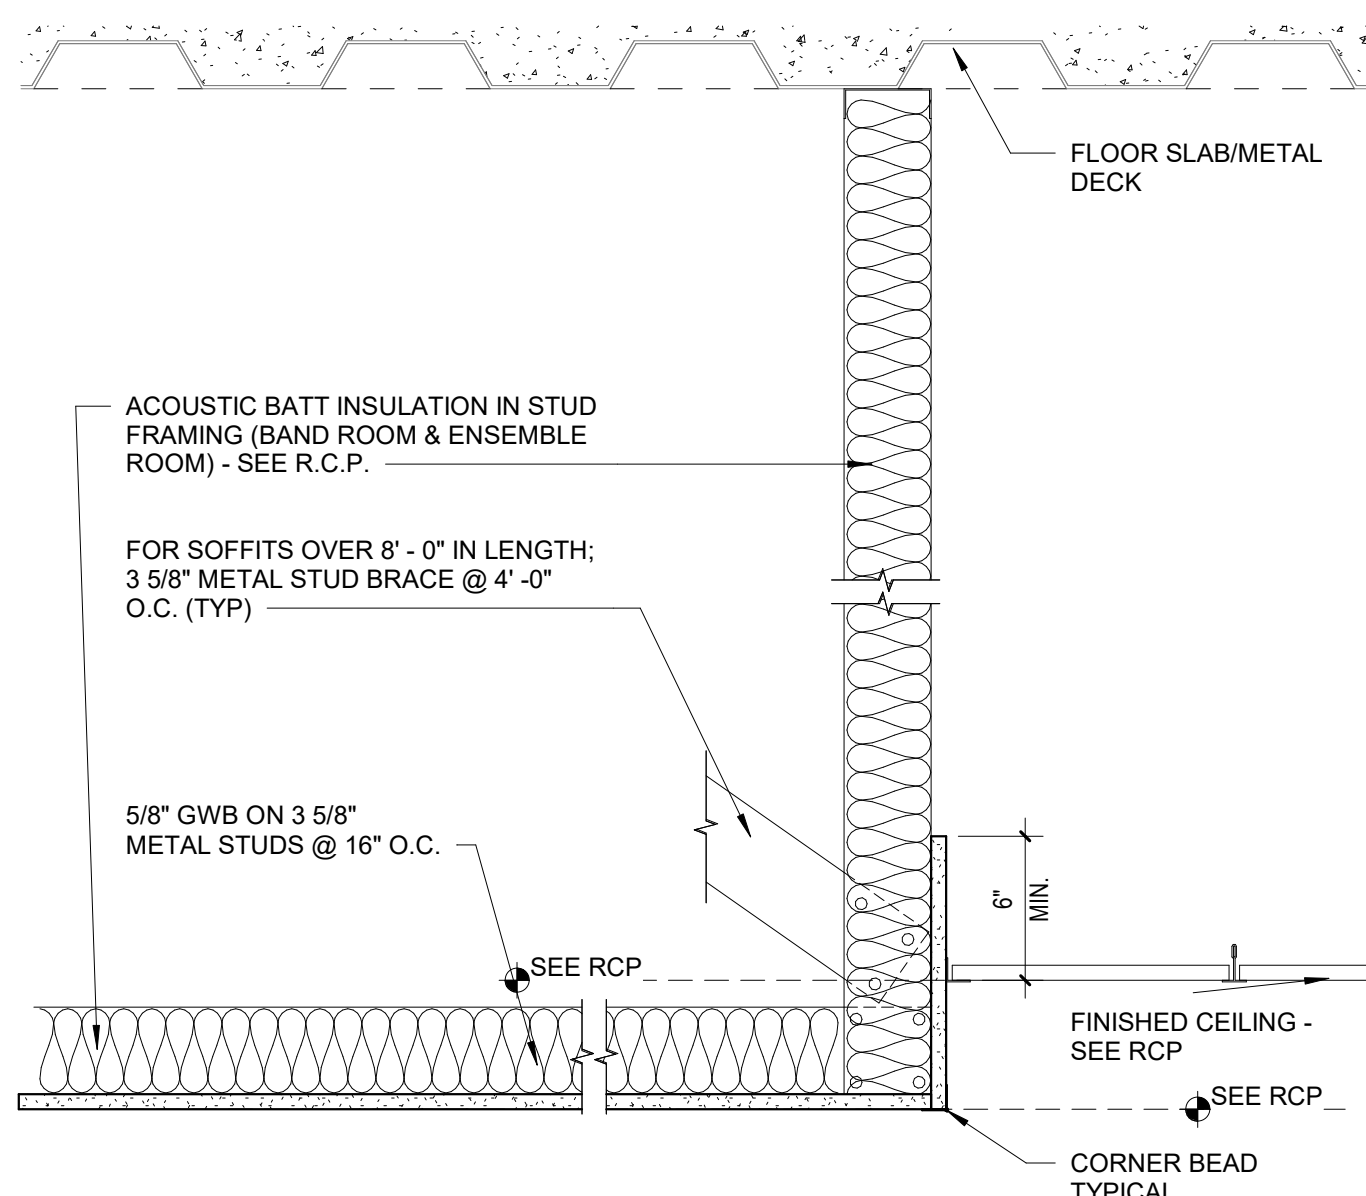**2 TYPICAL SOFFIT DETAIL**

1 1/2" = 1'-0"

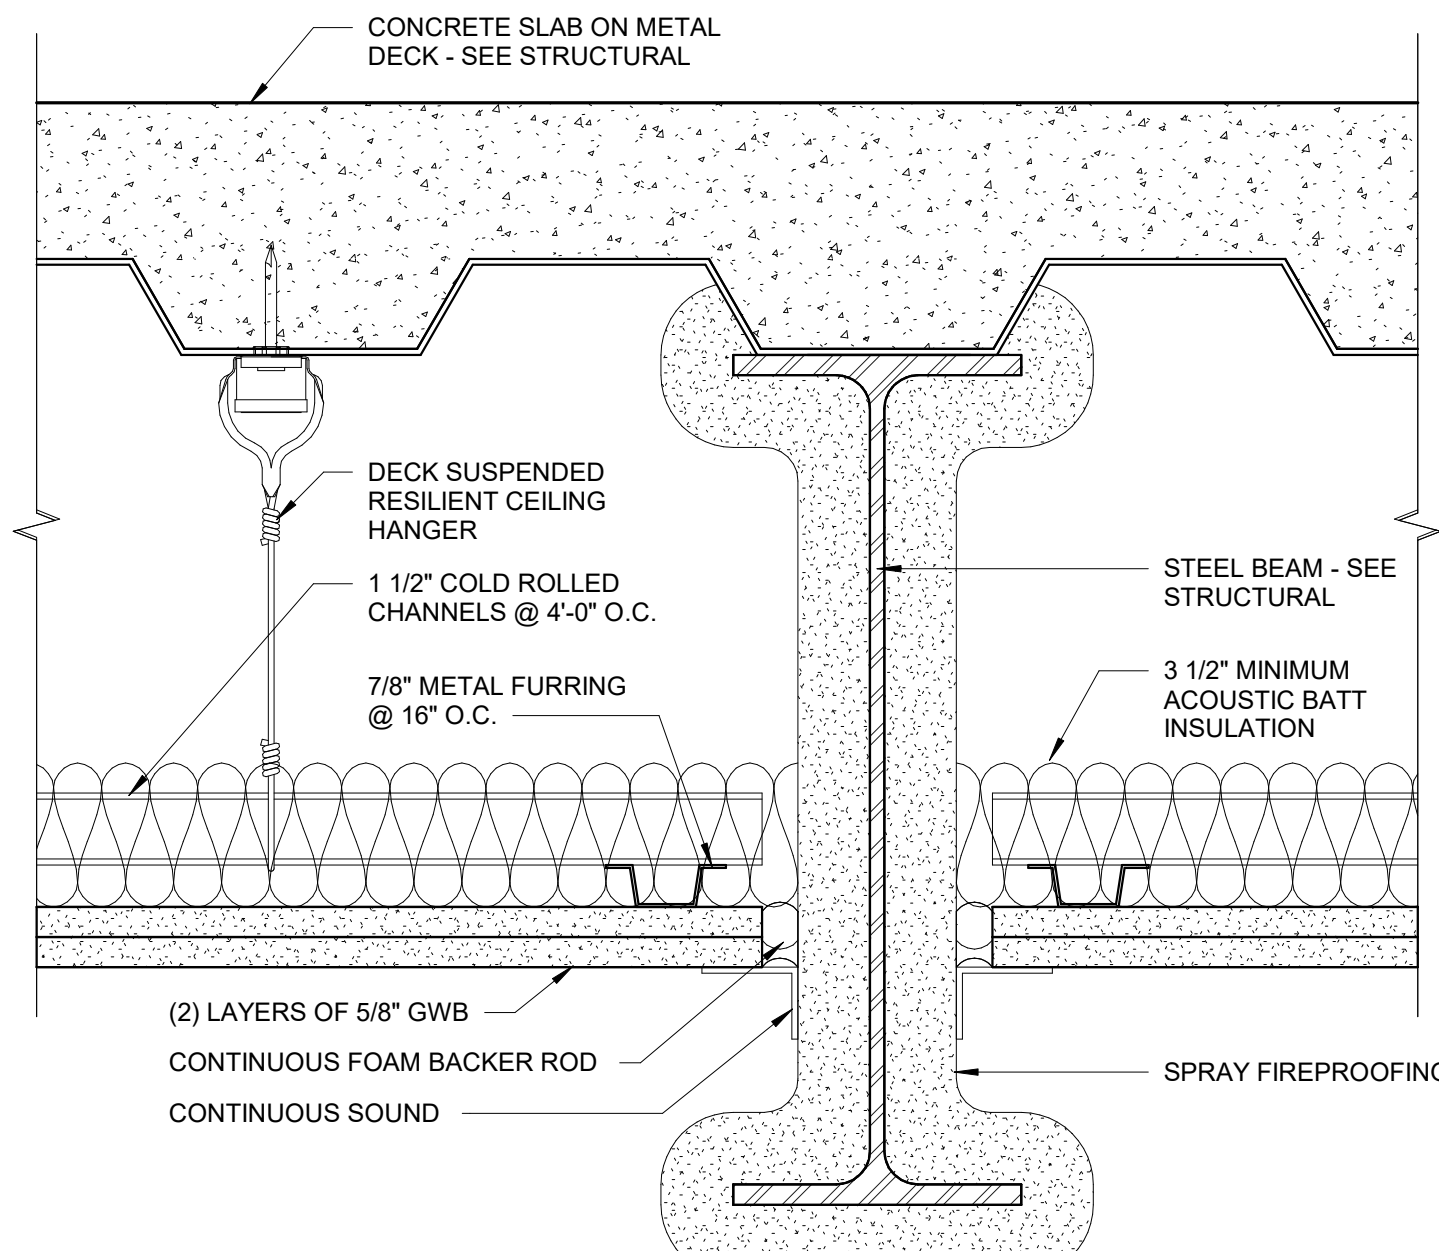**1 SOUND ISOLATOR CEILING DETAIL**

3" = 1'-0"


**Northeast
Metropolitan
Regional
Vocational High
School**100 Hemlock Road,
Wakefield, MA 01880**FLOOR PLAN GENERAL NOTES:**

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 163.50' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".
2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
3. ALL GWS INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.
4. FURNISH AND INSTALL MASONRY UNITS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY UNITS SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.
5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATORS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.
6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.
7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.
8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.
9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
10. FOR CONTROL JOINT LOCATION AT GWS PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS, AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.
12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.
14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWS (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACoustICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.
15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWS (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.
16. PROVIDE WOOD BLOCKING BEHIND GWS (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILET SHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.
17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".
18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWS TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWS, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE: A. AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDED ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


**MSBA 90% CD
SUBMISSION**

May 12TH, 2023

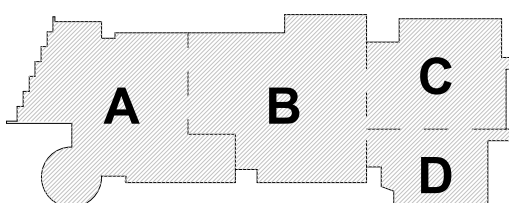

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

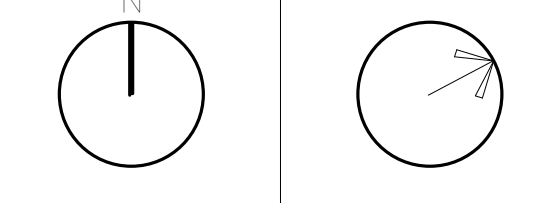**TOILET AND
CONCESSION
BUILDING PLANS
& ELEVATIONS**


Scale: As indicated

Job No.: 20202


Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

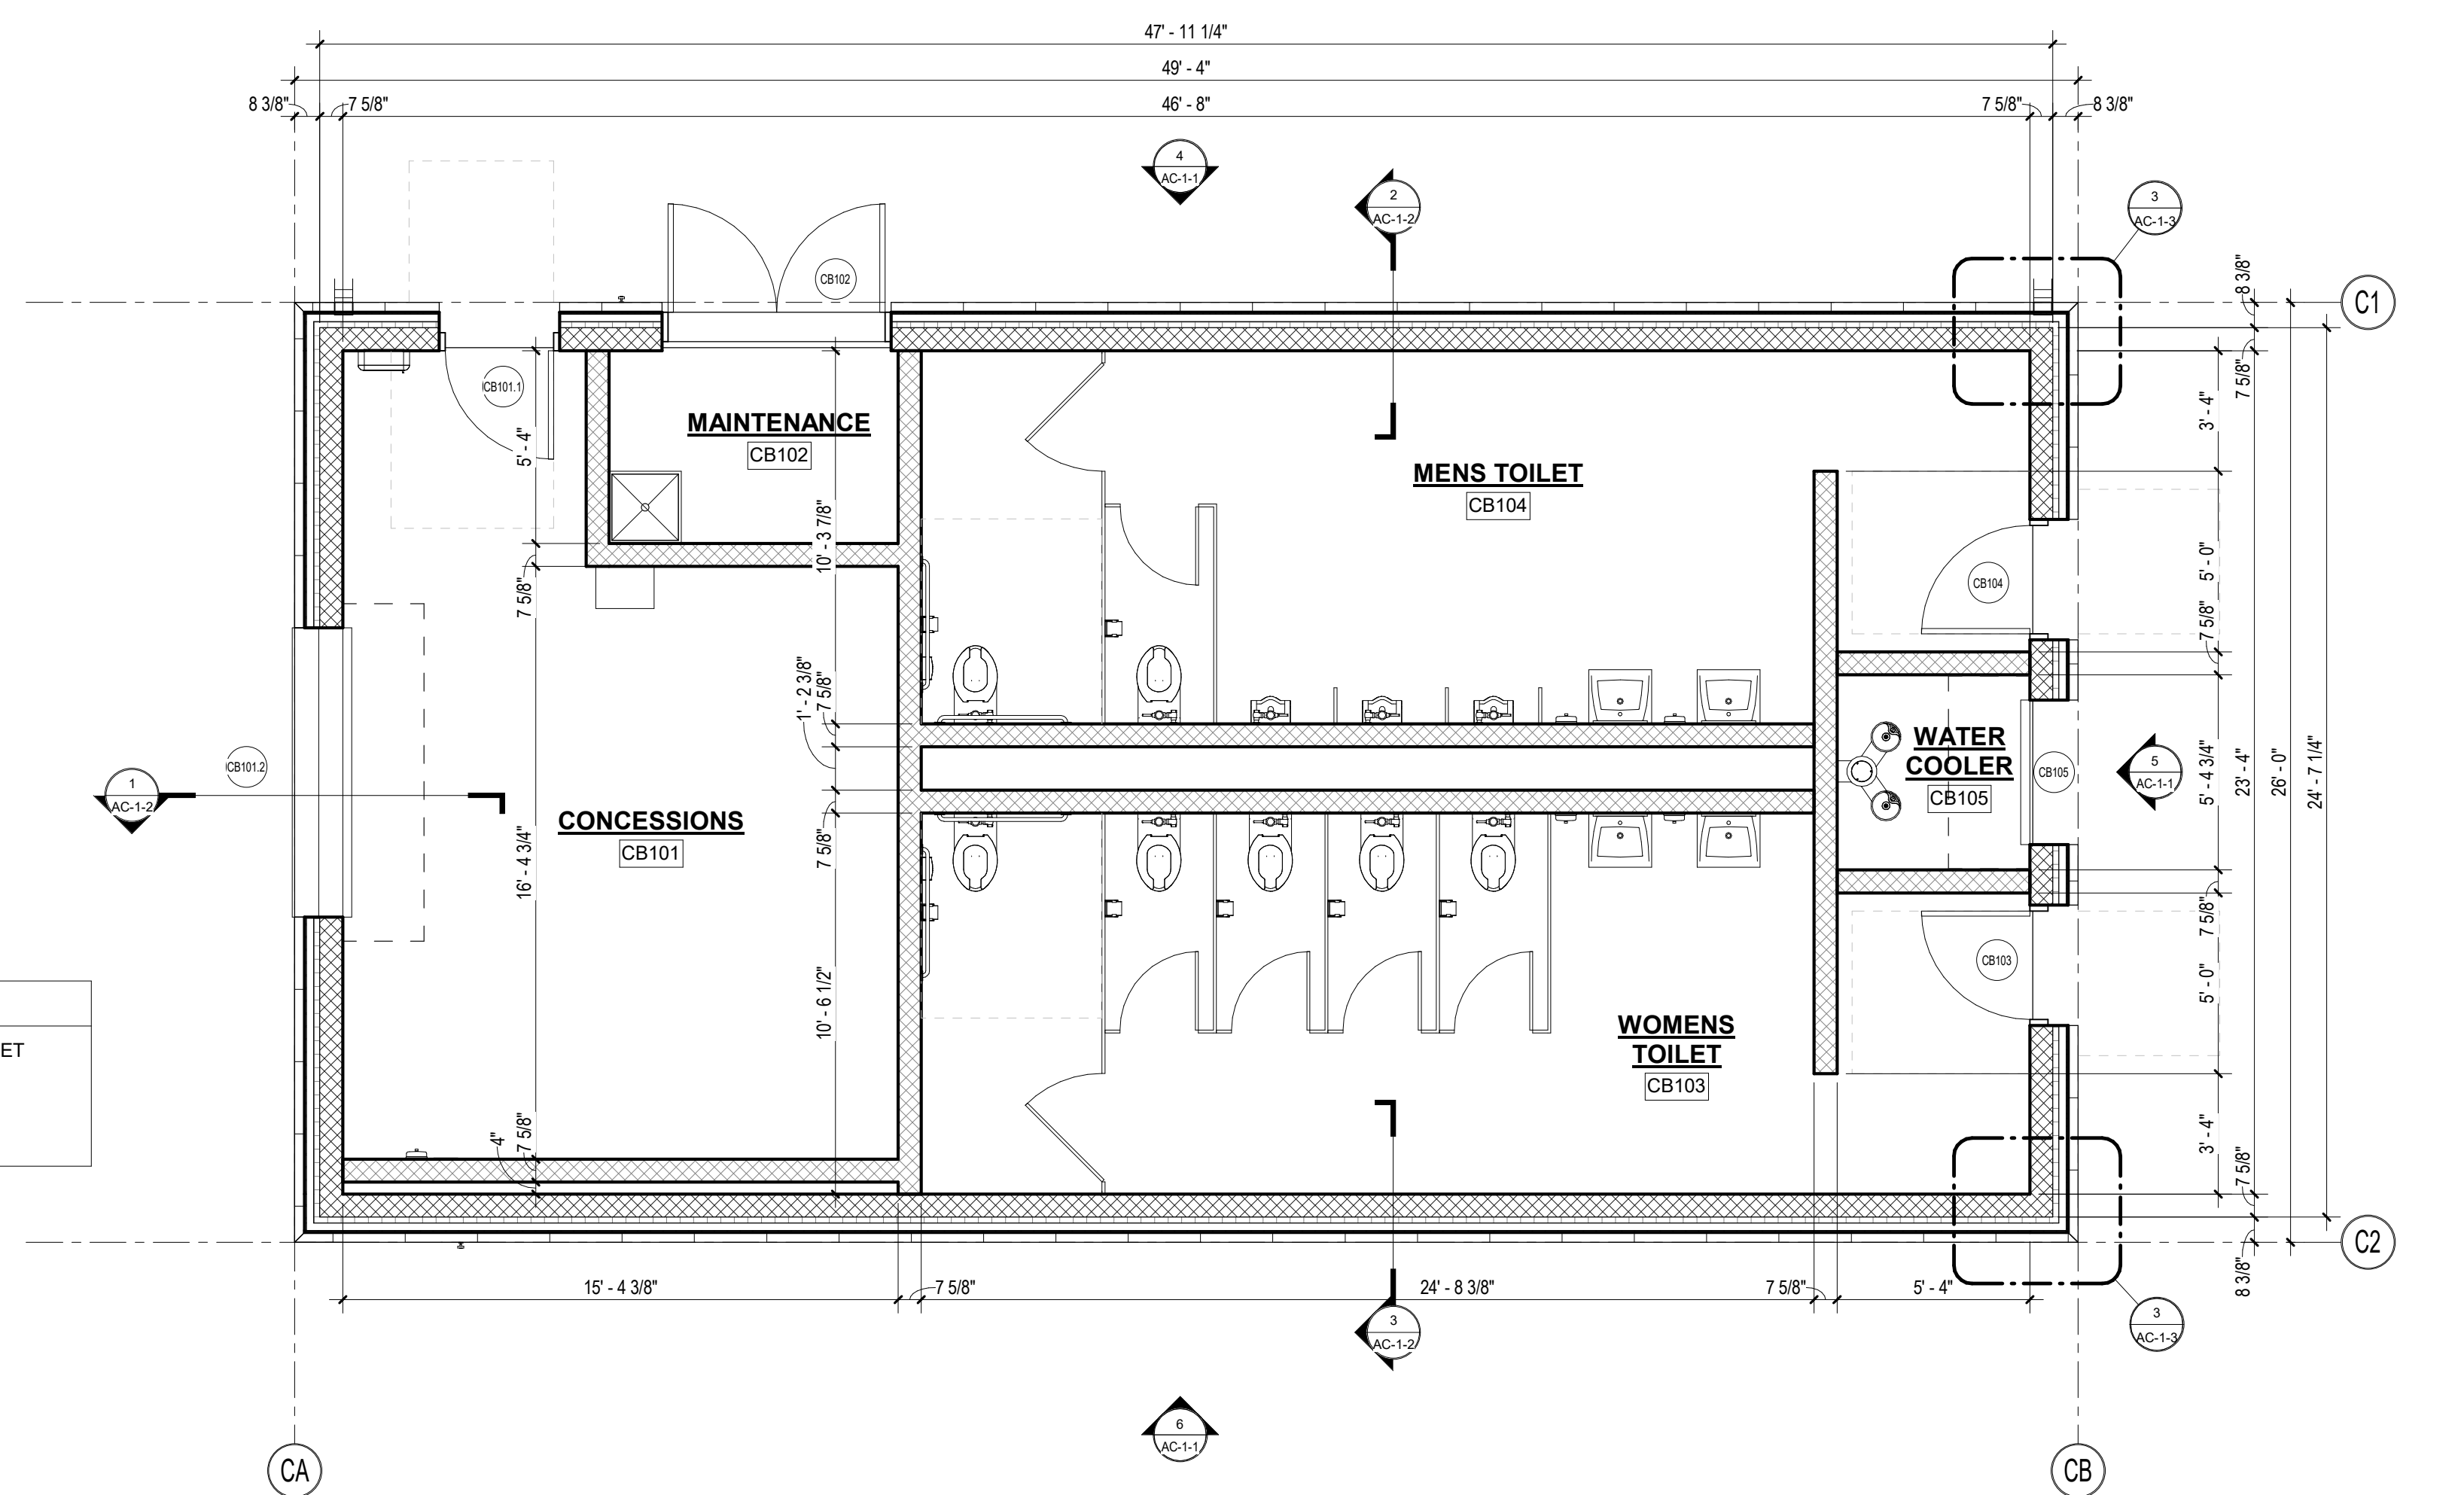AC-1-1**1 CONCESSION BUILDING FLOOR PLAN**


1/4" = 1'-0"

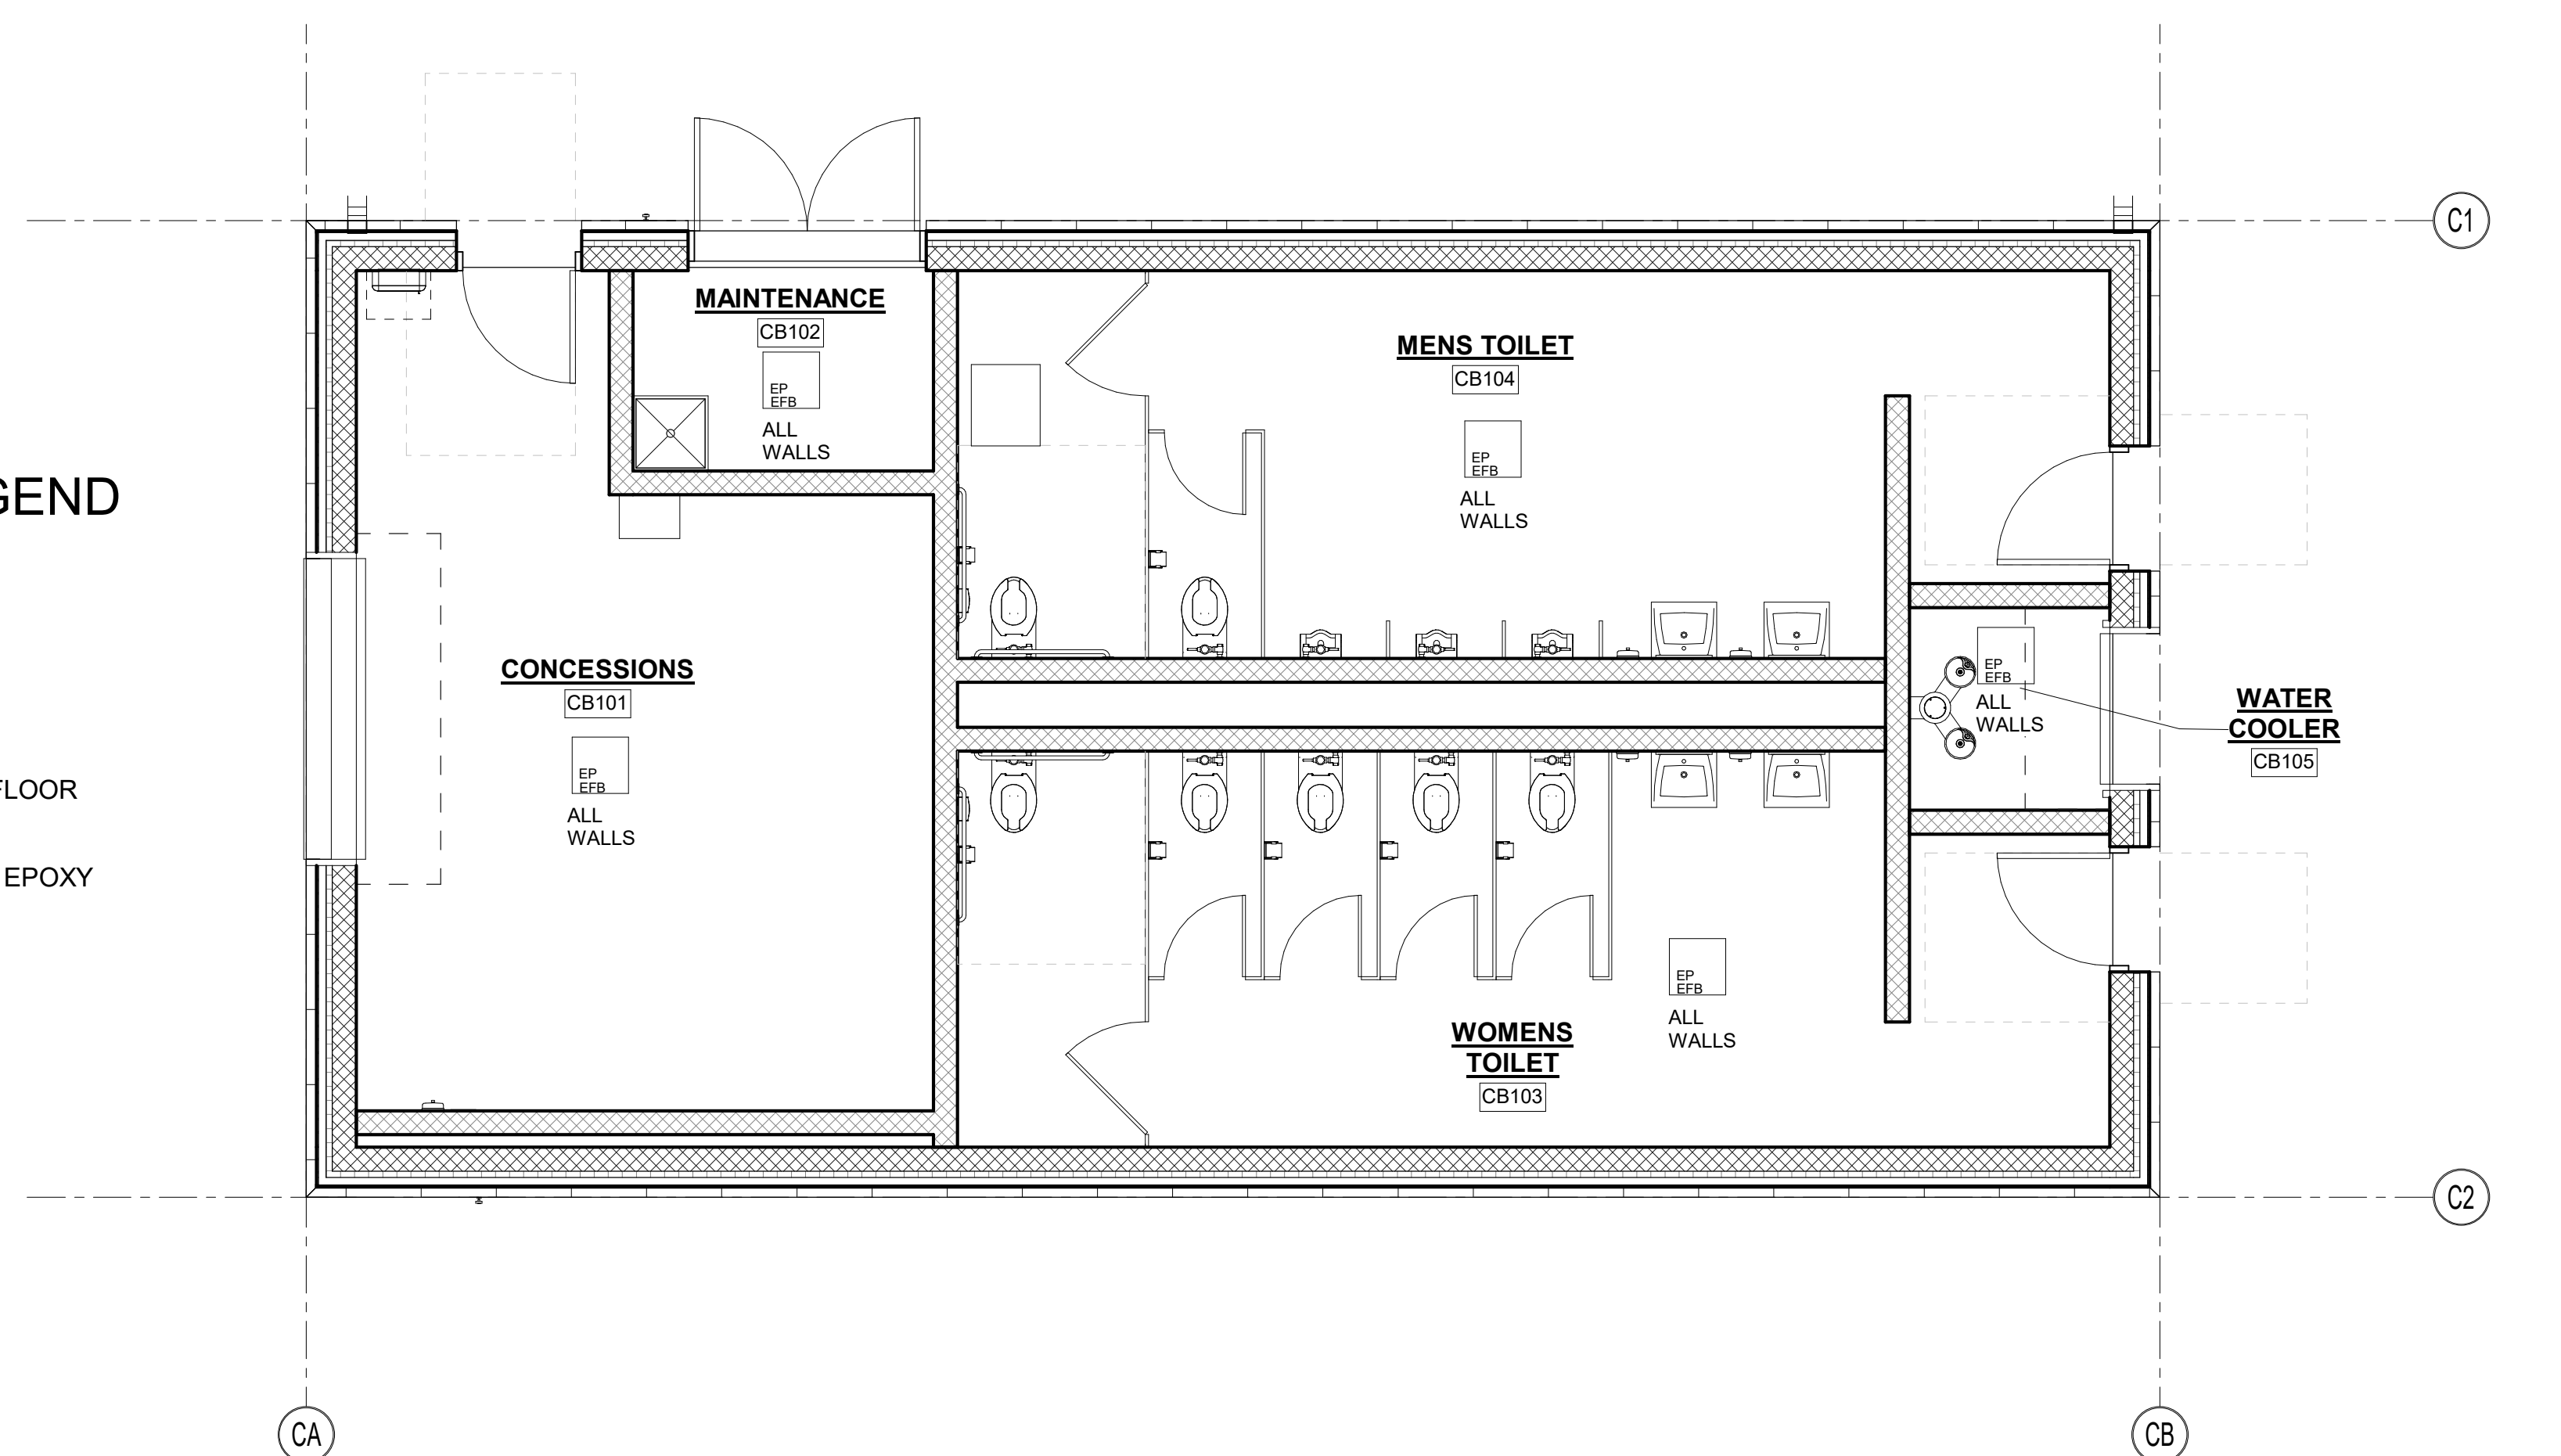**2 CONCESSION BUILDING WALL FINISHES PLAN**


1/4" = 1'-0"

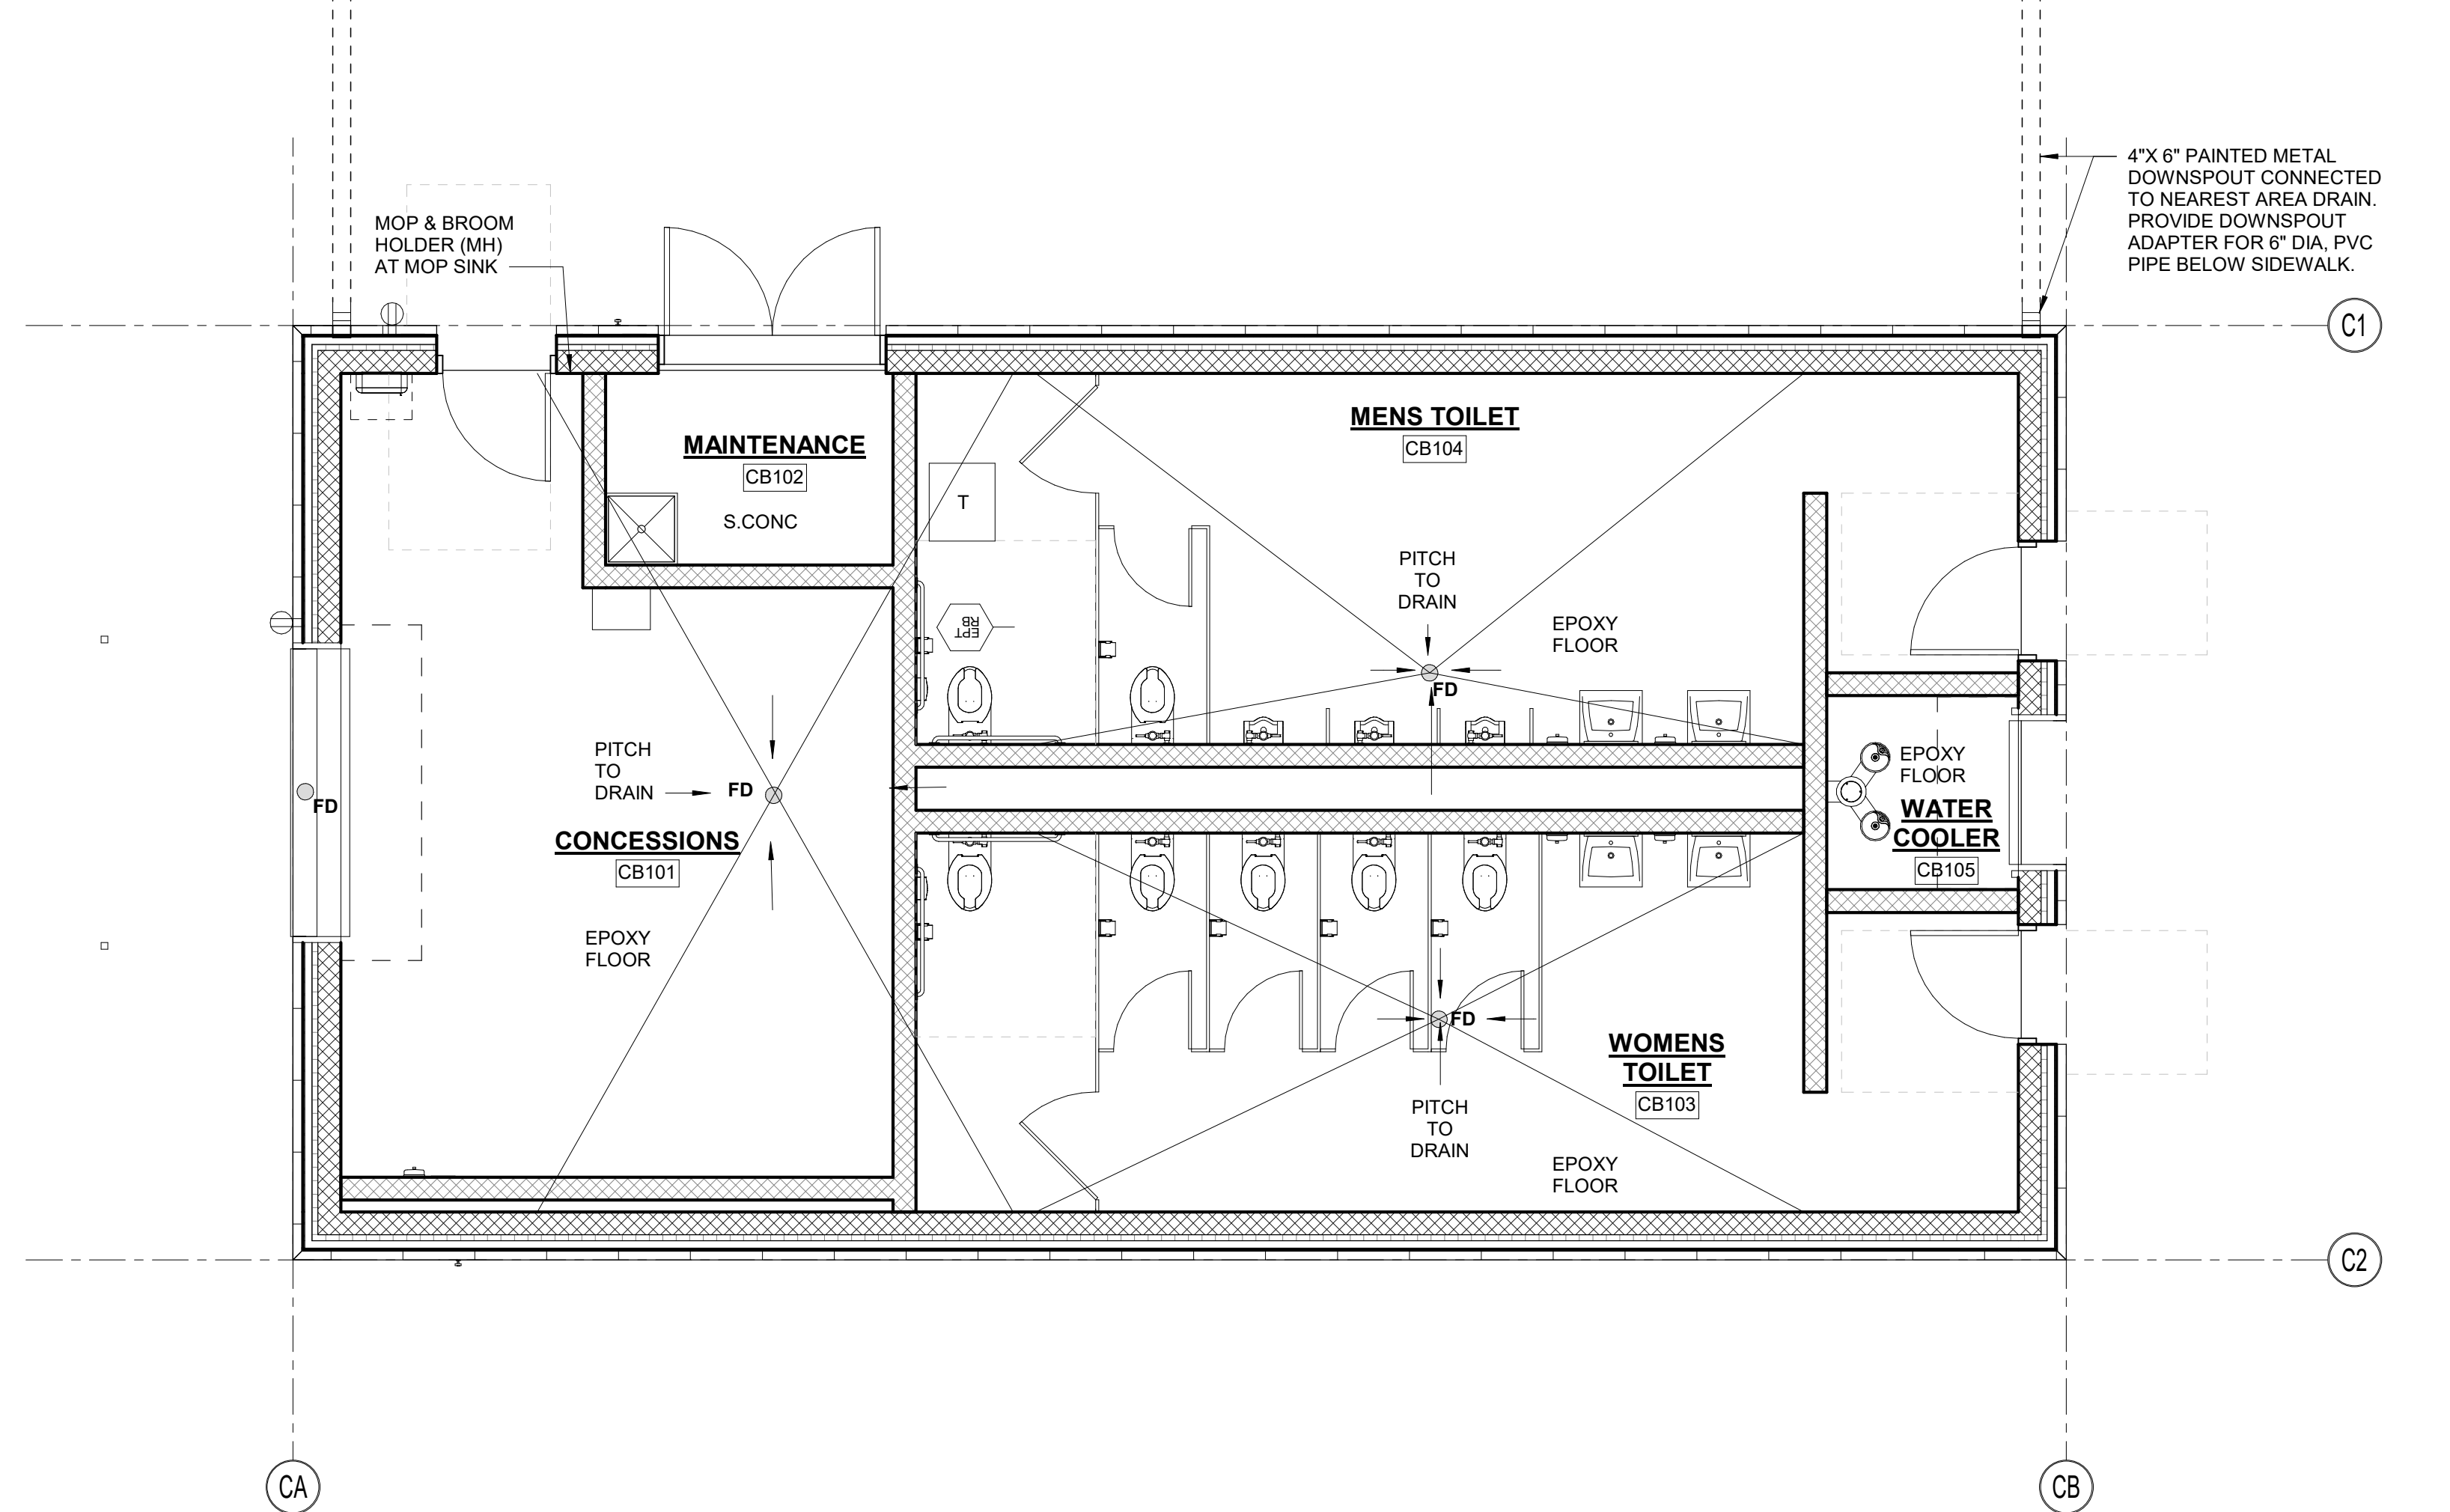**3 CONCESSION BUILDING FLOOR FINISHES PLAN**


1/4" = 1'-0"

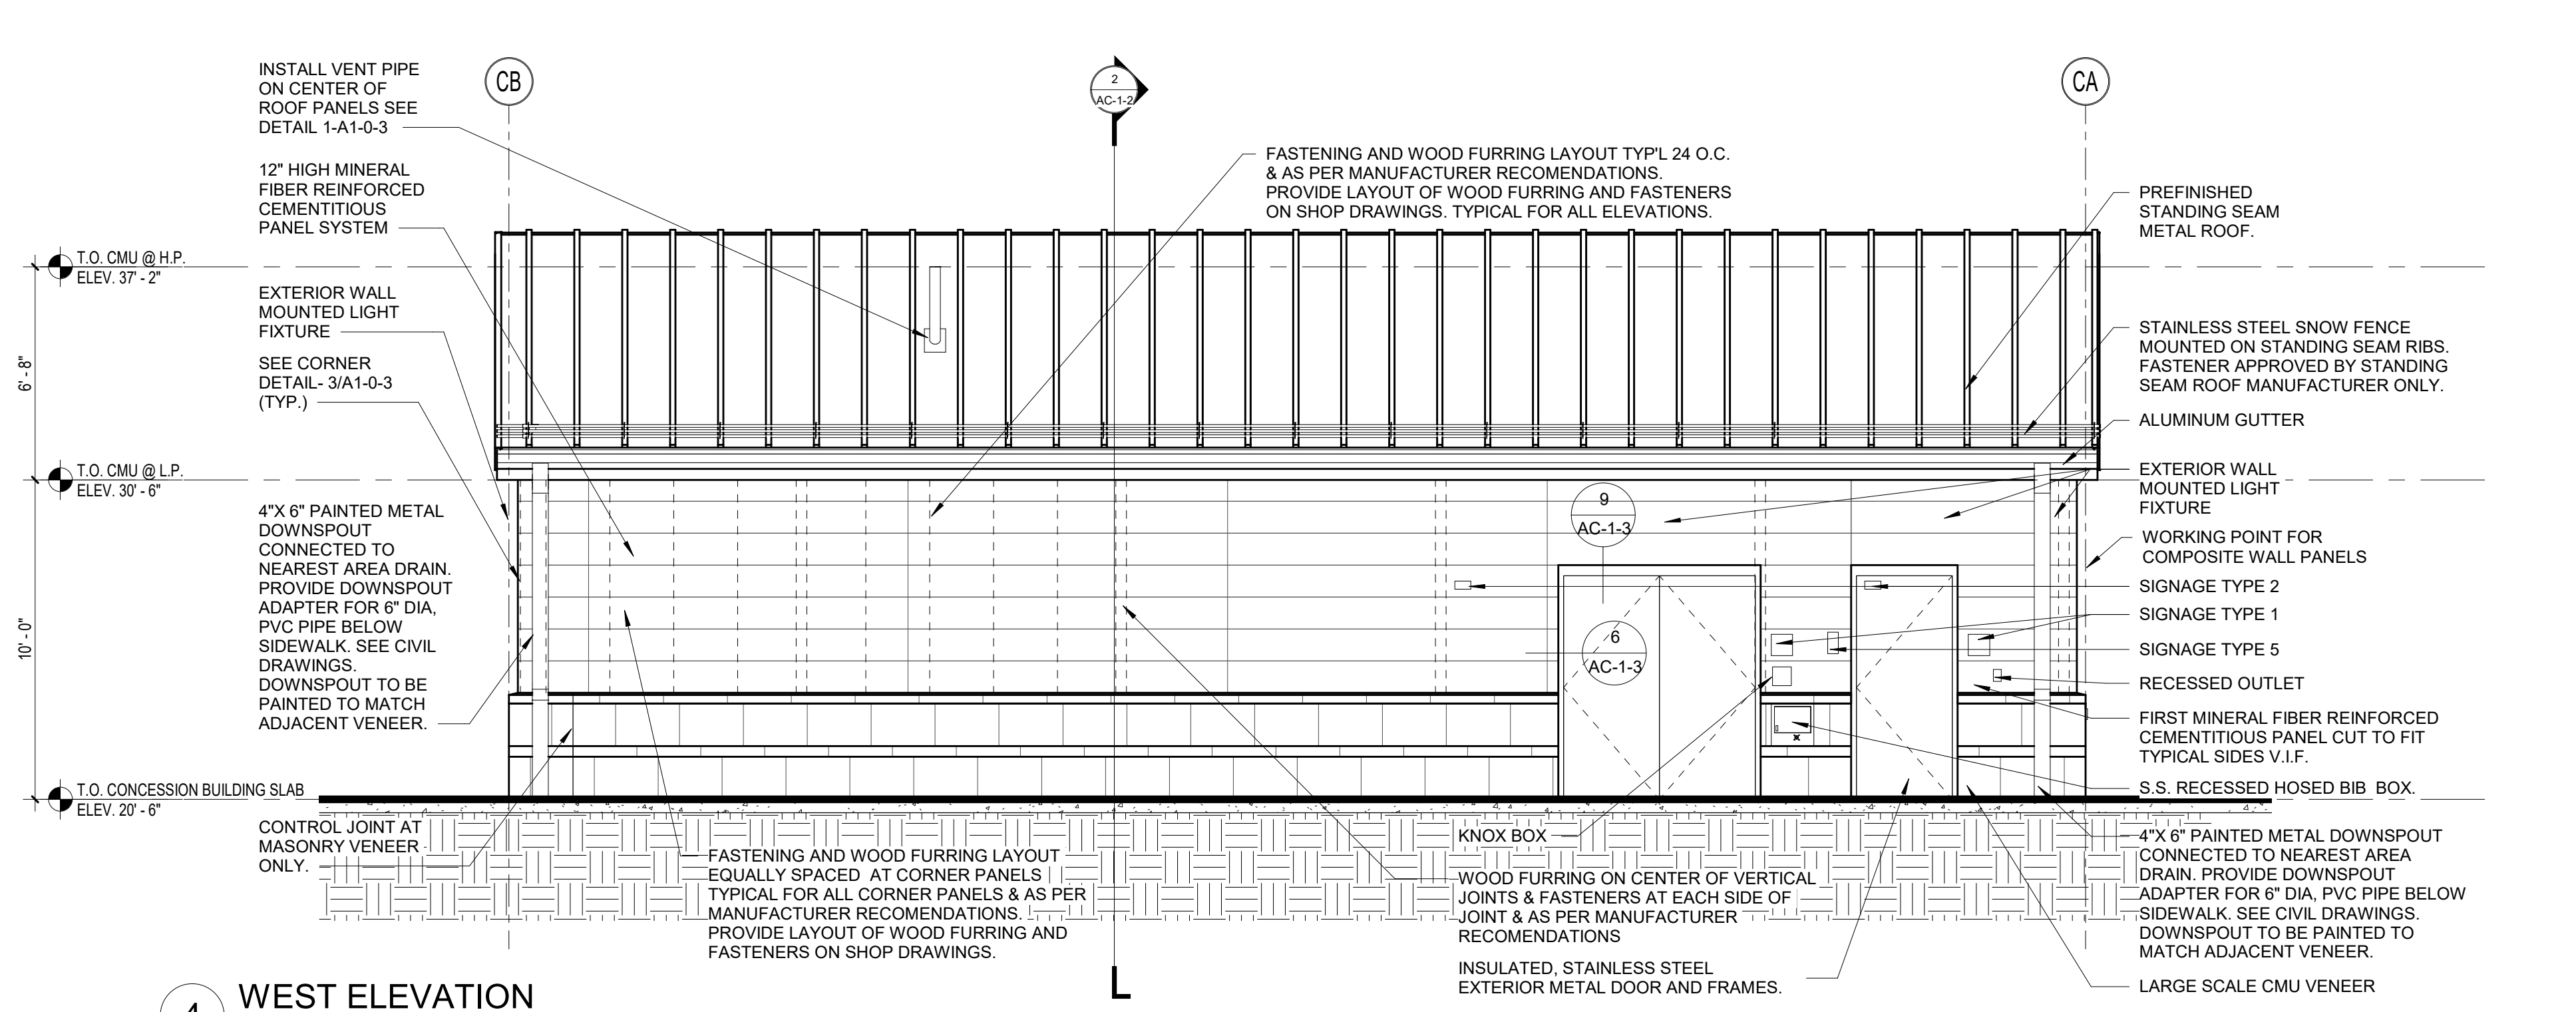**4 WEST ELEVATION**


1/4" = 1'-0"

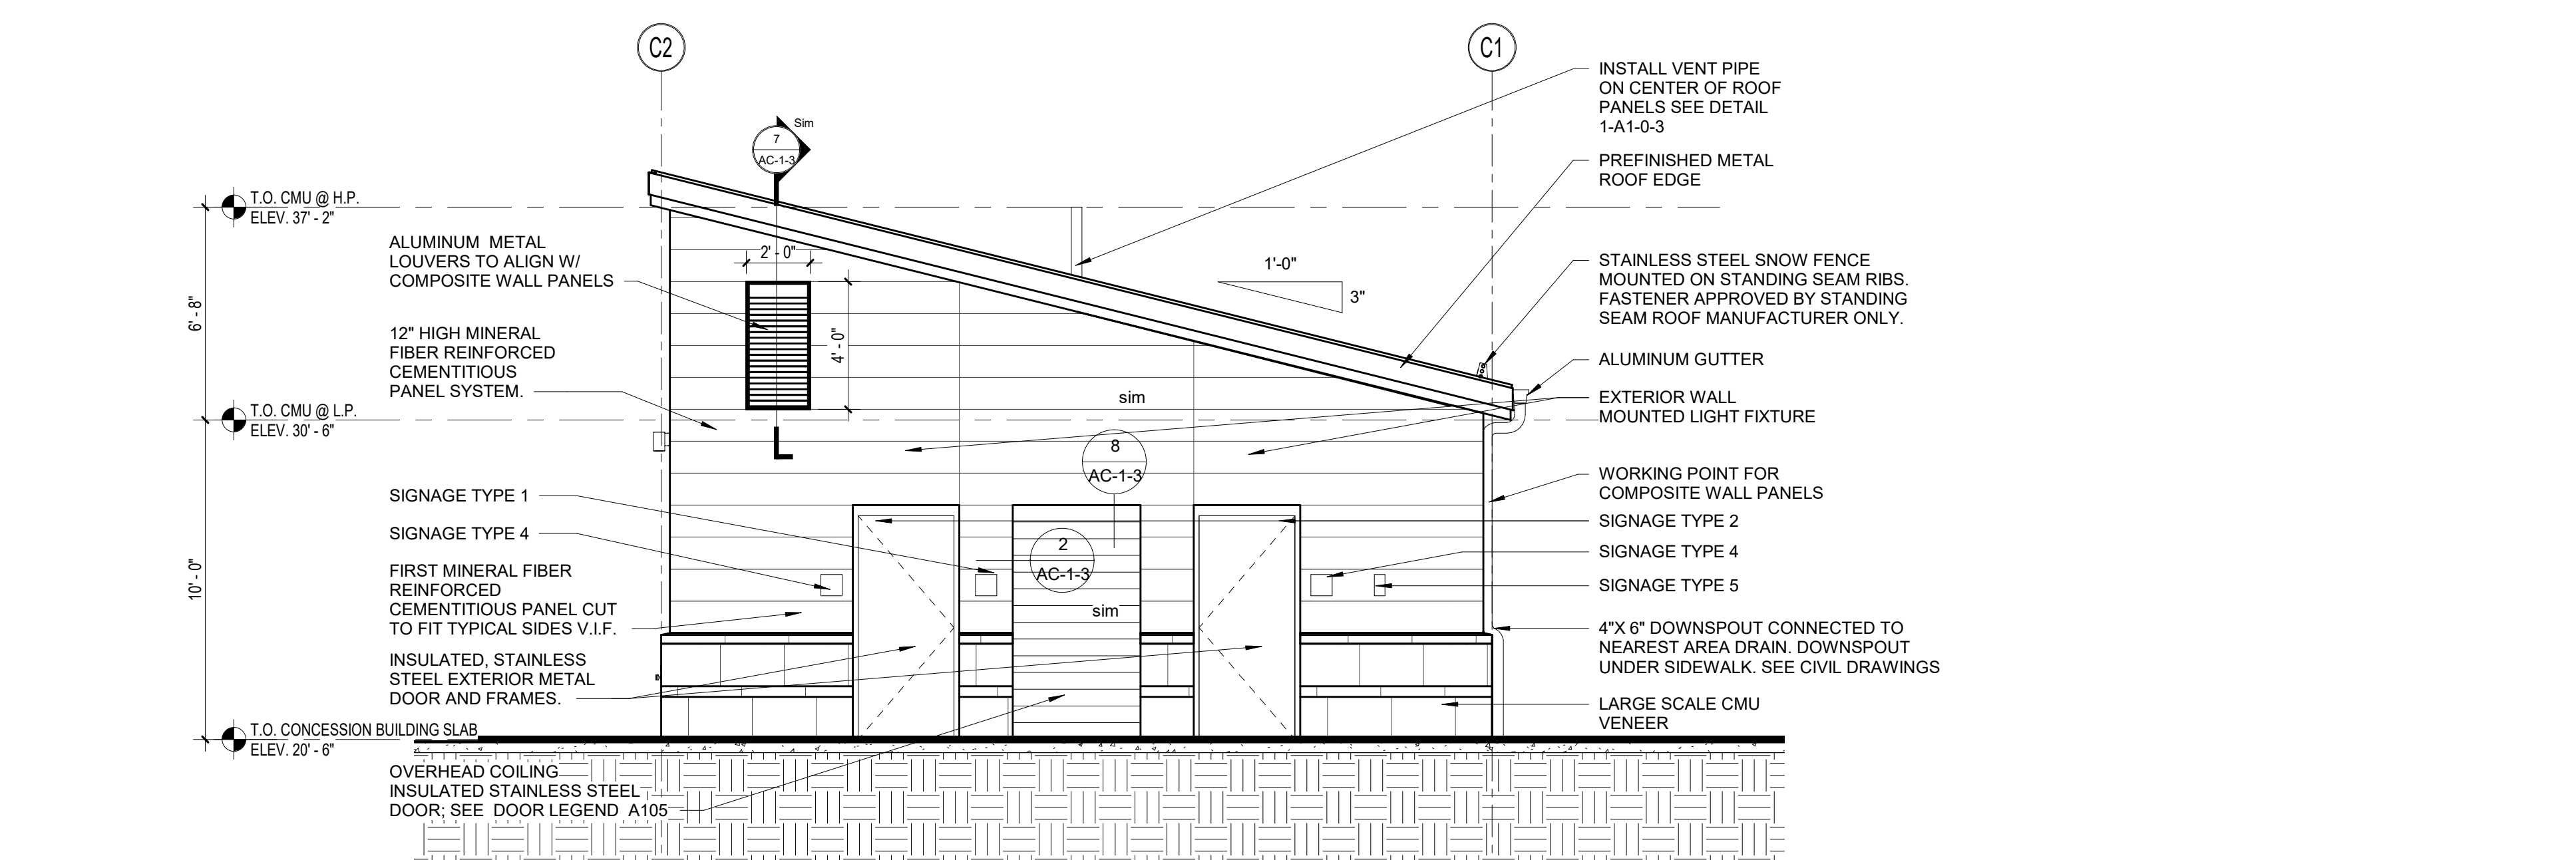**5 NORTH ELEVATION**

1/4" = 1'-0"

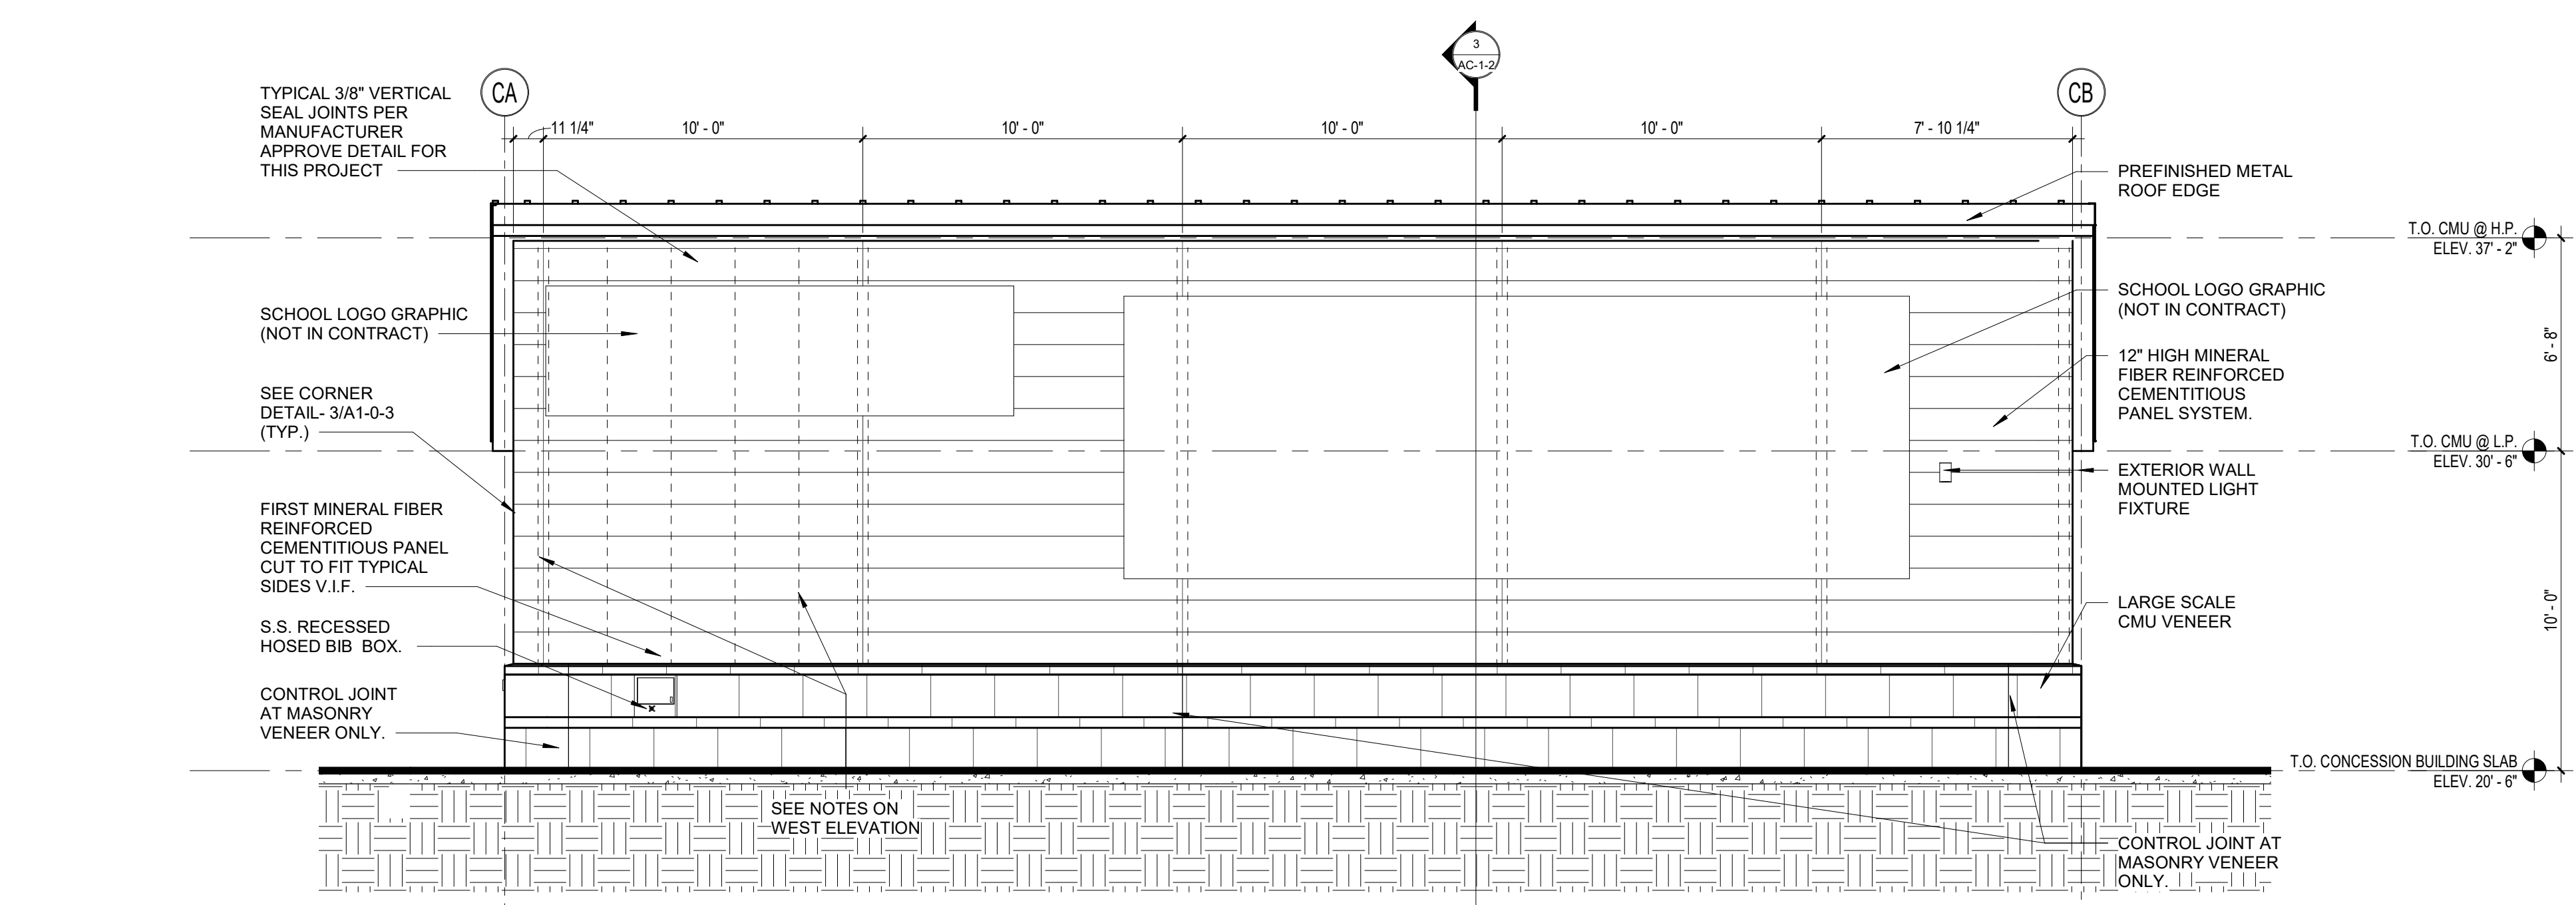**6 EAST ELEVATION**

1/4" = 1'-0"

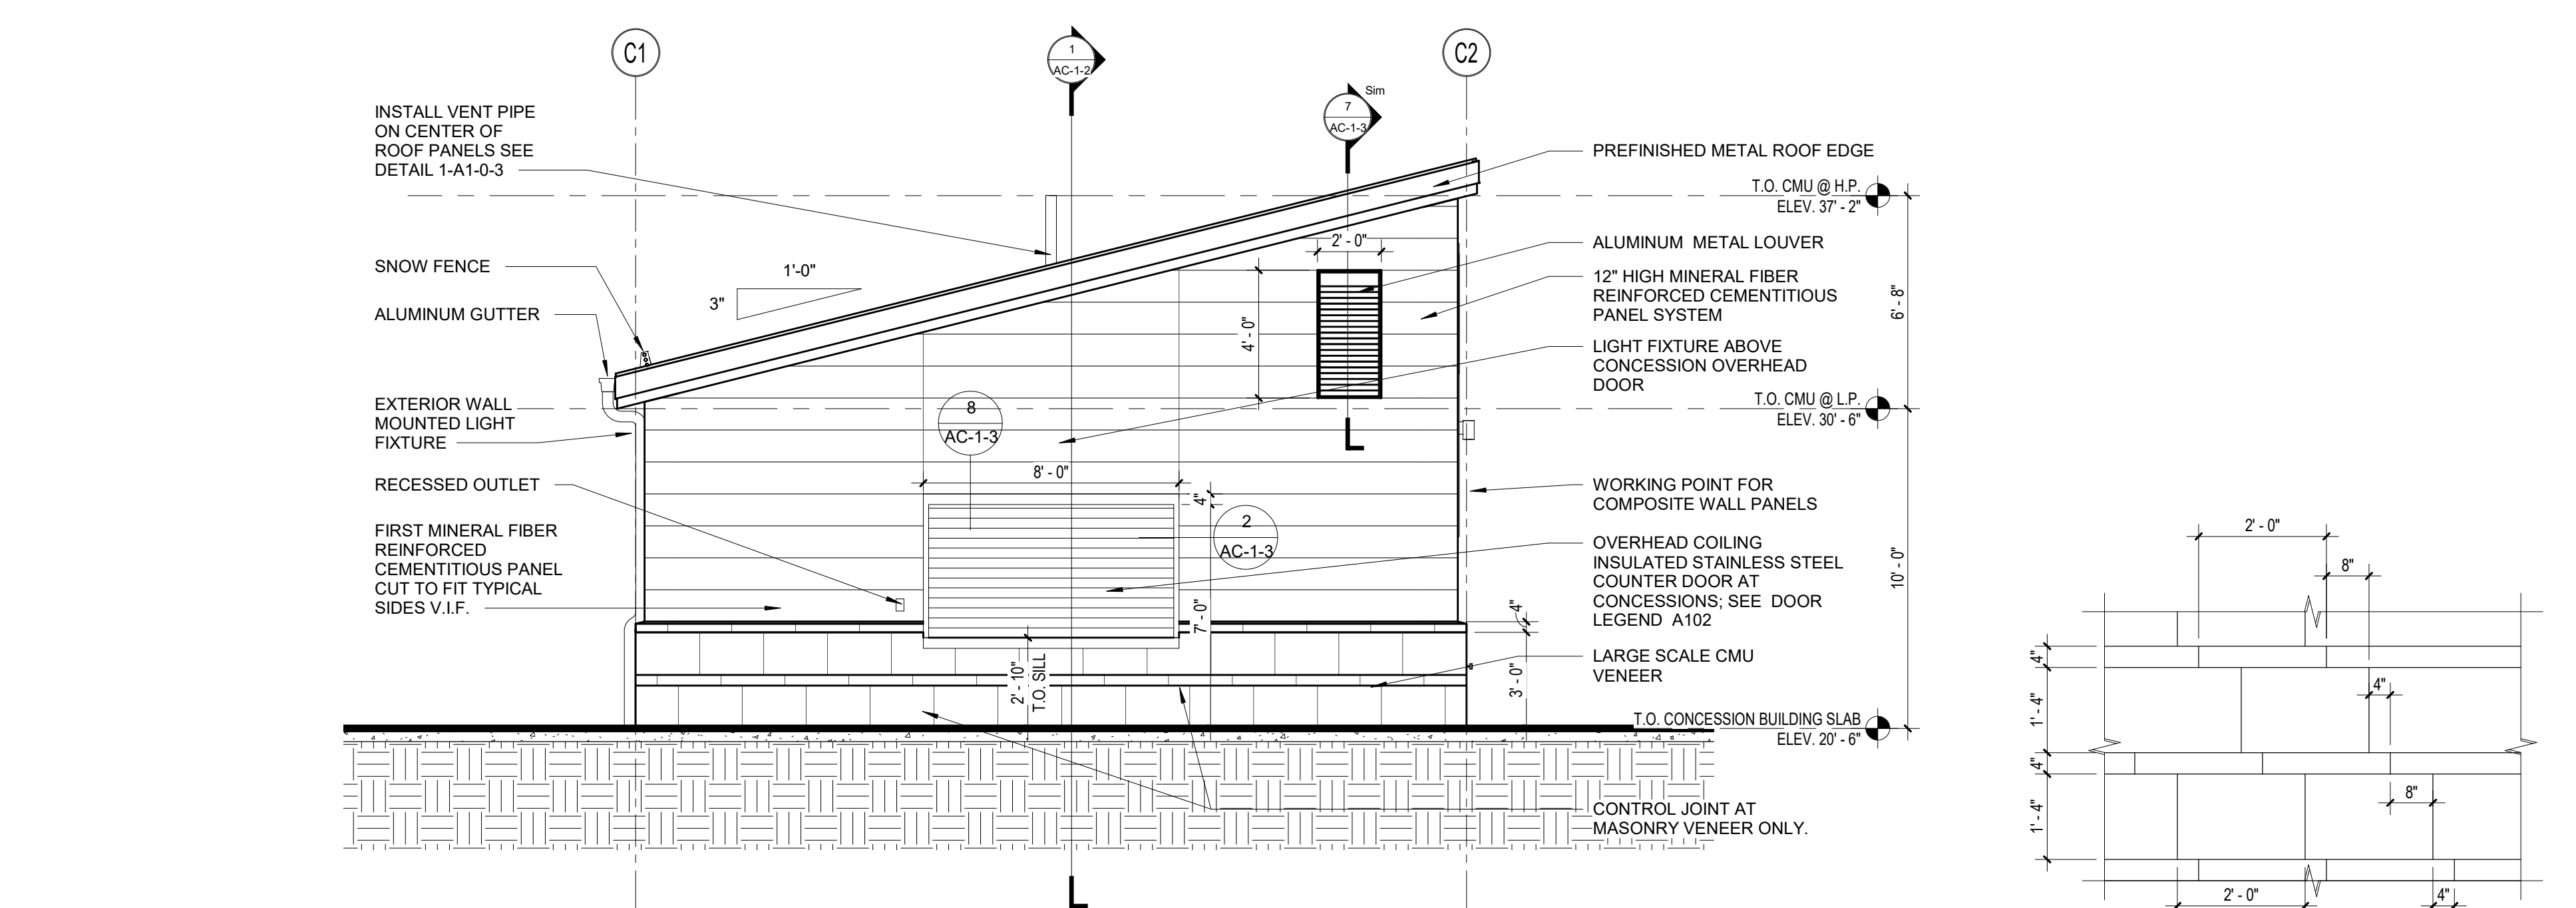**7 SOUTH ELEVATION**

1/4" = 1'-0"

8 VENEER PATTERN

1/2" = 1'-0"

- NOTE:
- 1) SEE DRAWING A1-0-2/6 FOR TYPICAL TOILET ACCESSORIES MOUNTING DIMENSIONS.
 - 2) SHEET A1-0-2 FOR TOILET ACCESSORIES SCHEDULE.

WALL FINISH LEGEND

- EPOXY PAINT =EPT / EPOXY BASE= EB
- EPOXY PAINT / EPOXY BASE FLOOR EP/ EB
- RUBBER COVE BASE FLOOR / EPOXY PAINT ABOVE RUBBER BASE- RB /EP

SIGNAGE- ALL SIGNAGE TO BE FABRICATED & INSTALLED BY SIGNAGE CONTRACTOR WITH AT LEAST FIVE YEARS OF EXPERIENCE WITH SIMILAR SCOPE.

SIGN TYPE 1,3,4 AND 5

- VINYL TEXT AND GRAPHICS
- ACRYLIC PLAQUE, PAINTED
- VHB FOAM TAPE
- STAINLESS STEEL SHIM & FASTENERS AS A MOUNTING PLATE

SIGN TYPE 2

VINYL

SIGNAGE MATERIALS

ACRYLIC SHALL BE CLEAR ACRYLITE FF ACRYLIC SHEET, SMOOTH BOTH FACES, AS MANUFACTURED BY EVONIK INDUSTRIES, WWW.ACRYLITE.NET, OR EQUAL.

PRESSURE SENSITIVE VINYL GRAPHIC FILM SHALL BE SCOTCHCAL 7125 ELECTRO CUT GRAPHIC FILM, AS MANUFACTURED BY 3M COMPANY, ST. PAUL, MN, WWW.3M.COM OR EQUAL.


PAINT SHALL BE ACRYLIC POLYURETHANE MAP, AS MANUFACTURED BY MATTHEWS PAINT, DELAWARE, OH, WWW.MATTHEWSPAINT.COM, OR EQUAL.

VHB FOAM TAPE SHALL BE 4655, AS MANUFACTURED BY 3M COMPANY, ST. PAUL, MN, WWW.3M.COM OR EQUAL.

PROVIDE PRICING FOR TWO CUSTOM PAINT AND TWO VINYL FILM. COLORS TO BE DETERMINED DURING SUBMITTAL PROCESS.


SUBMITTALS

ALL SIGN CONTENT IS PRELIMINARY; FINAL SIGN CONTENT TO BE DETERMINED DURING SUBMITTALS. PROVIDE SIGNAGE SHOP DRAWINGS SHOWING ALL TYPES, DIMENSIONS, SYMBOLS, METHOD OF GRAPHIC APPLICATION, LOCATION ON BUILDING, MATERIALS, AND MOUNTING DETAILS. PROVIDE A PHYSICAL ACRYLIC SIGN SAMPLE WITH SELECTED COLOR, FONT, GRAPHICS AND HARDWARE FOR REVIEW & APPROVAL. APPROVED SAMPLE CAN BE INSTALLED ON THE BUILDING.

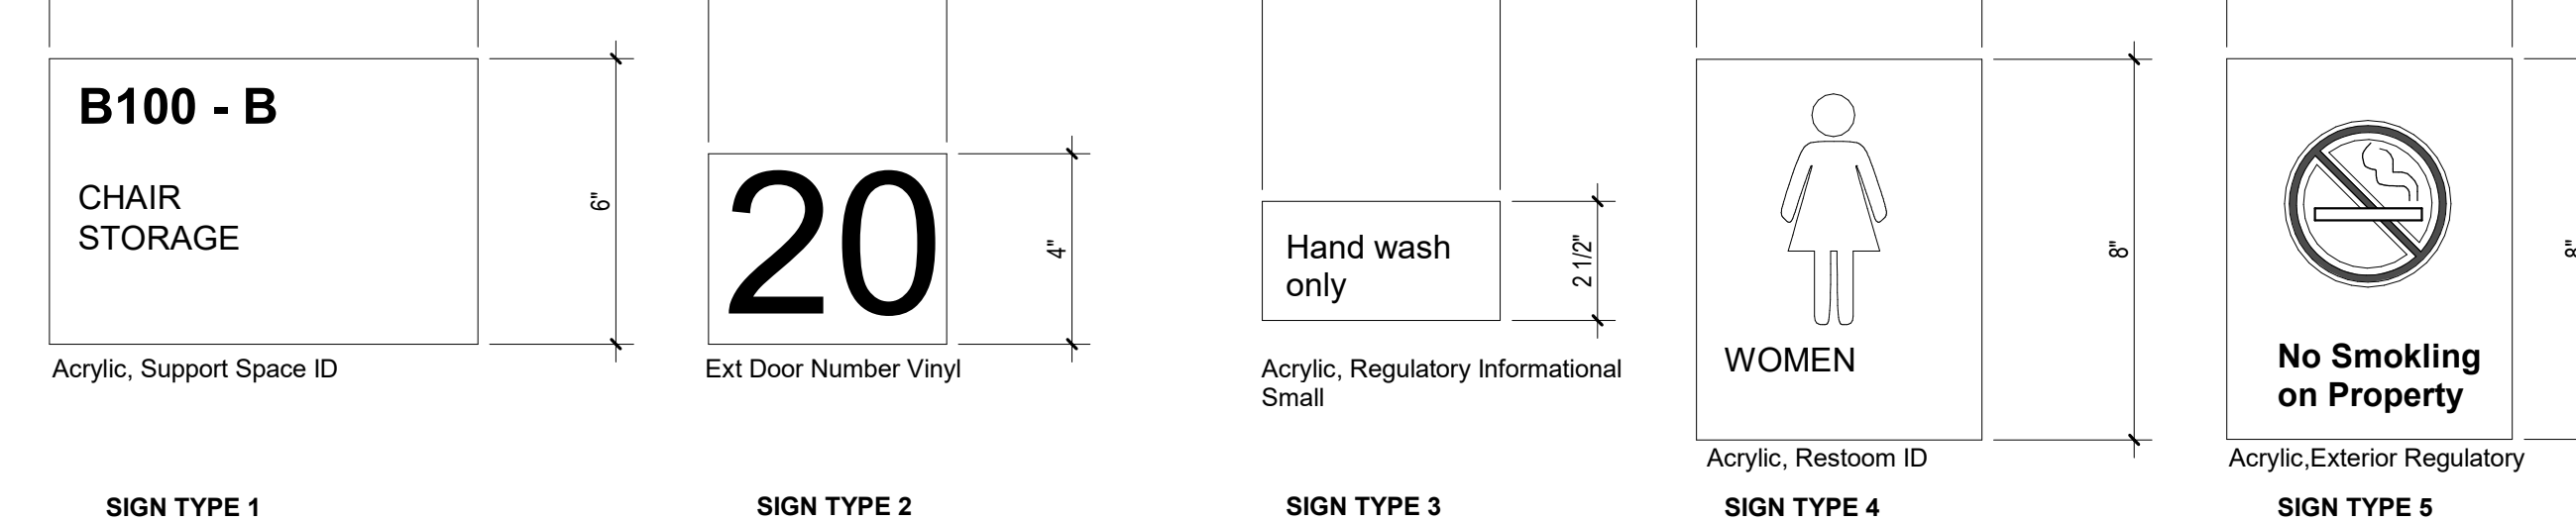

BUILDING SIGNAGE SCHEDULE


3" = 1'-0"

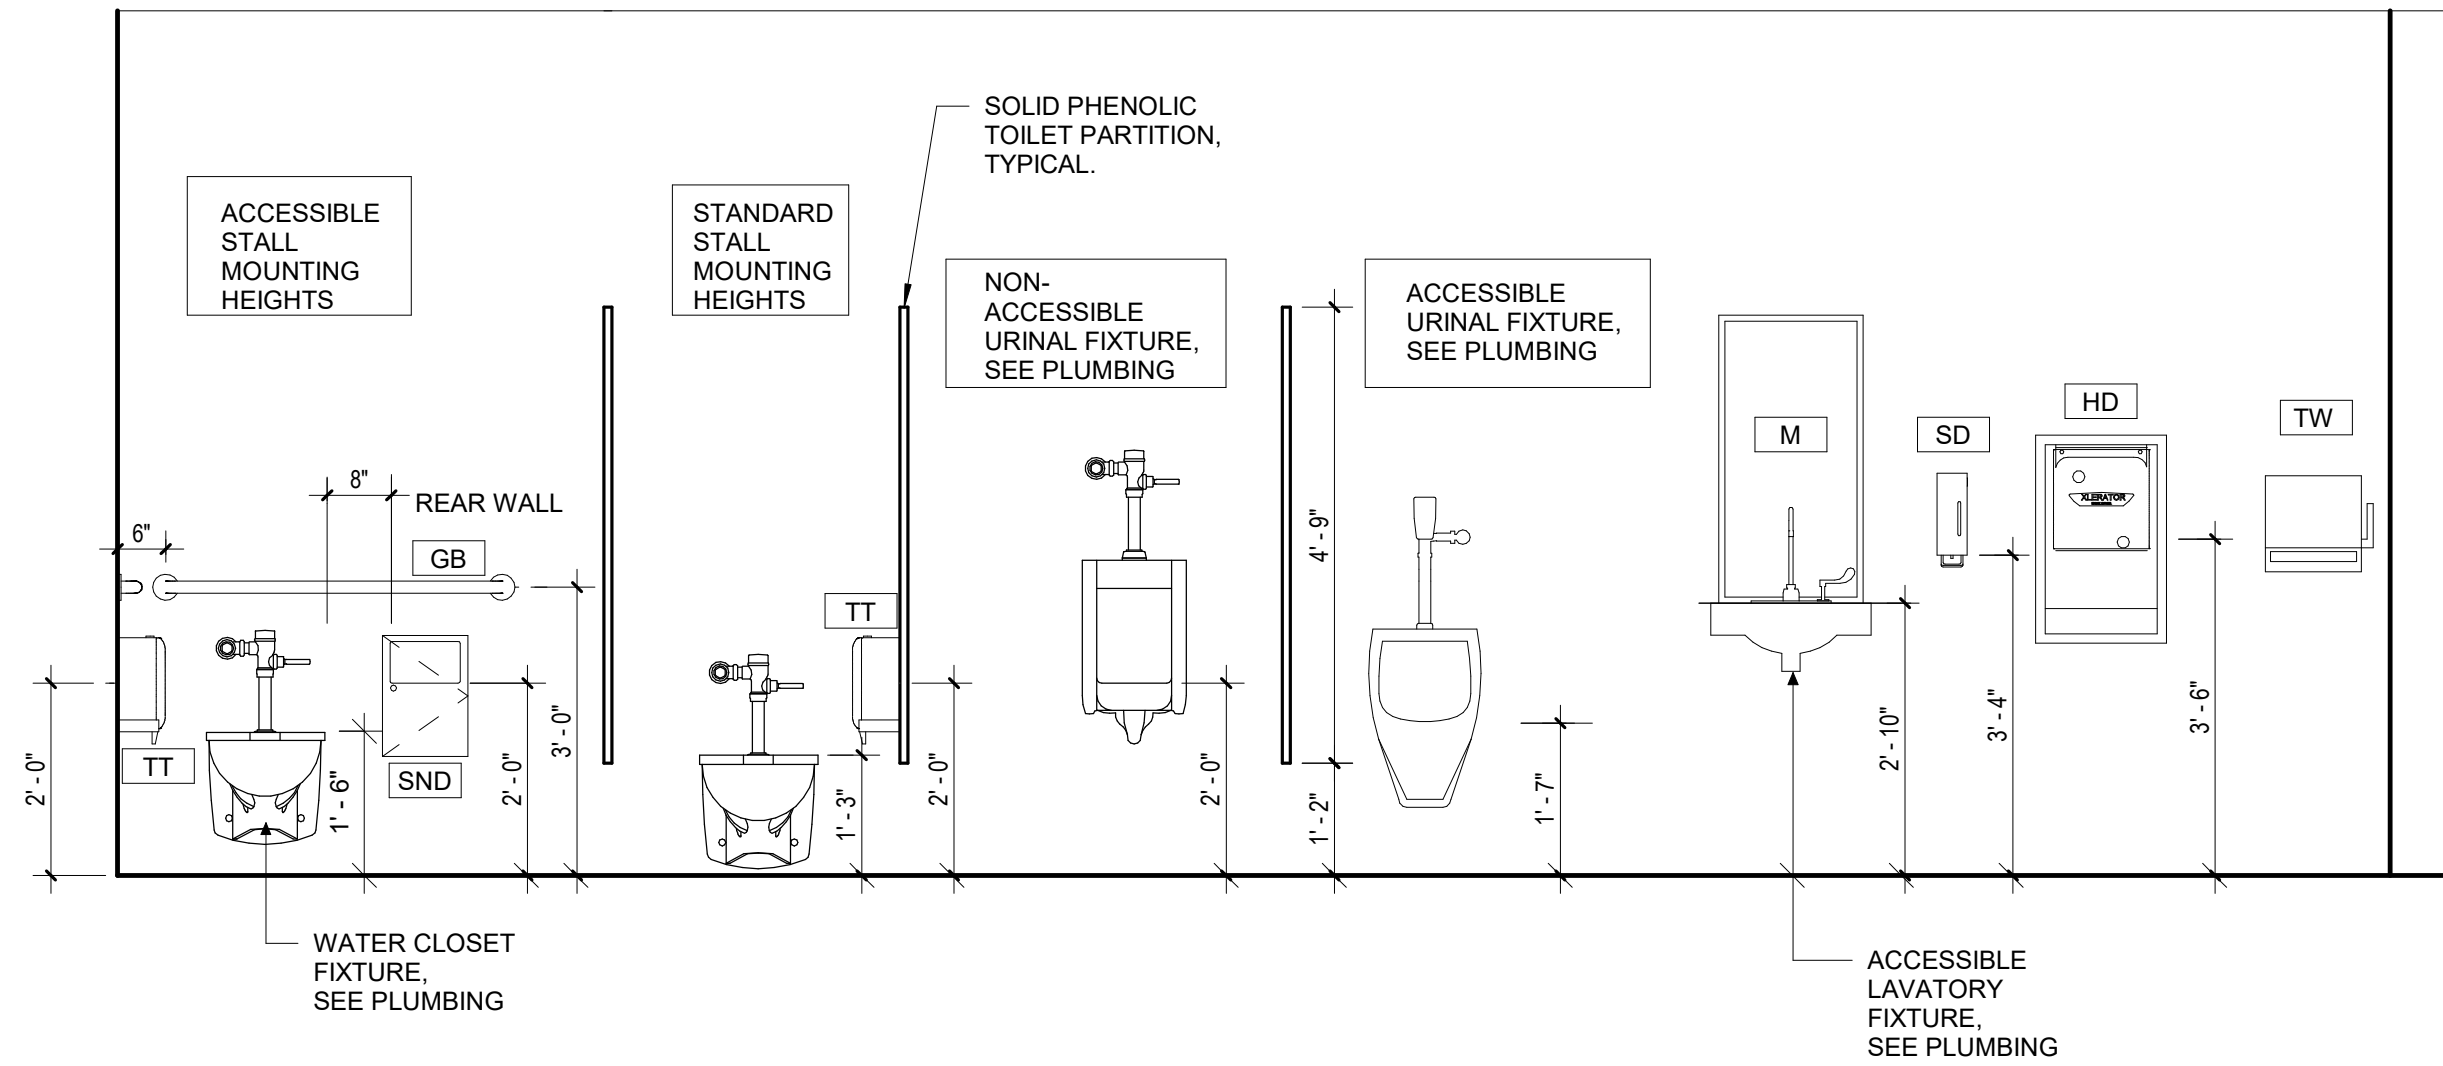

CONCESSIONS TOILET MOUNTING HEIGHTS

1/2" = 1'-0"

TOILET ACCESSORY SCHEDULE			
TYPE	DESCRIPTION	MOUNTING HEIGHT	REMARKS
GB	1 1/2" DIA. x 42" STAINLESS STEEL HORIZONTAL GRAB BAR	3'-0" AFF TO CENTER LINE OF BAR	1 1/2" CLEARANCE FROM WALL WITH CONCEALED MOUNTING
HD	SURFACE MOUNTED ELECTRICAL HAND DRYER	3'-6" AFF TO CONTROLS	
M	18" x 36" STAINLESS STEEL FRAMED MIRROR	3'-4" AFF TO BOTTOM OF MIRROR	PROVIDE ONE AT ALL LAVATORY LOCATIONS
SD	SURFACE MOUNTED SOAP DISPENSER	3'-6" AFF TO CONTROLS	FURNISHED BY OWNER. INSTALLED BY GENERAL CONTRACTOR.
TP	TOILET PARTITION PANEL, SURFACE MOUNTED	1'-8" AFF. MAX TO BOTTOM OF SURFACE	
TW	PAPER TOWEL DISPENSER	42" AFF MAX TO CONTROL HANDLE OR TOWEL OPENING	DISPENSER FURNISHED BY THE OWNER, INSTALLED BY THE GENERAL CONTRACTOR.
SND	SANITARY NAPKIN DISPOSAL	24" AFF TO DISPOSAL DOOR	
TT	SURFACE MOUNTED MULTI-ROLL TOILET TISSUE DISPENSER	24" AFF TO CENTER LINE OF DISPENSER	INSTALL ONE AT EACH TOILET FURNISHED OWNER, INSTALLED BY GENERAL CONTRACTOR.

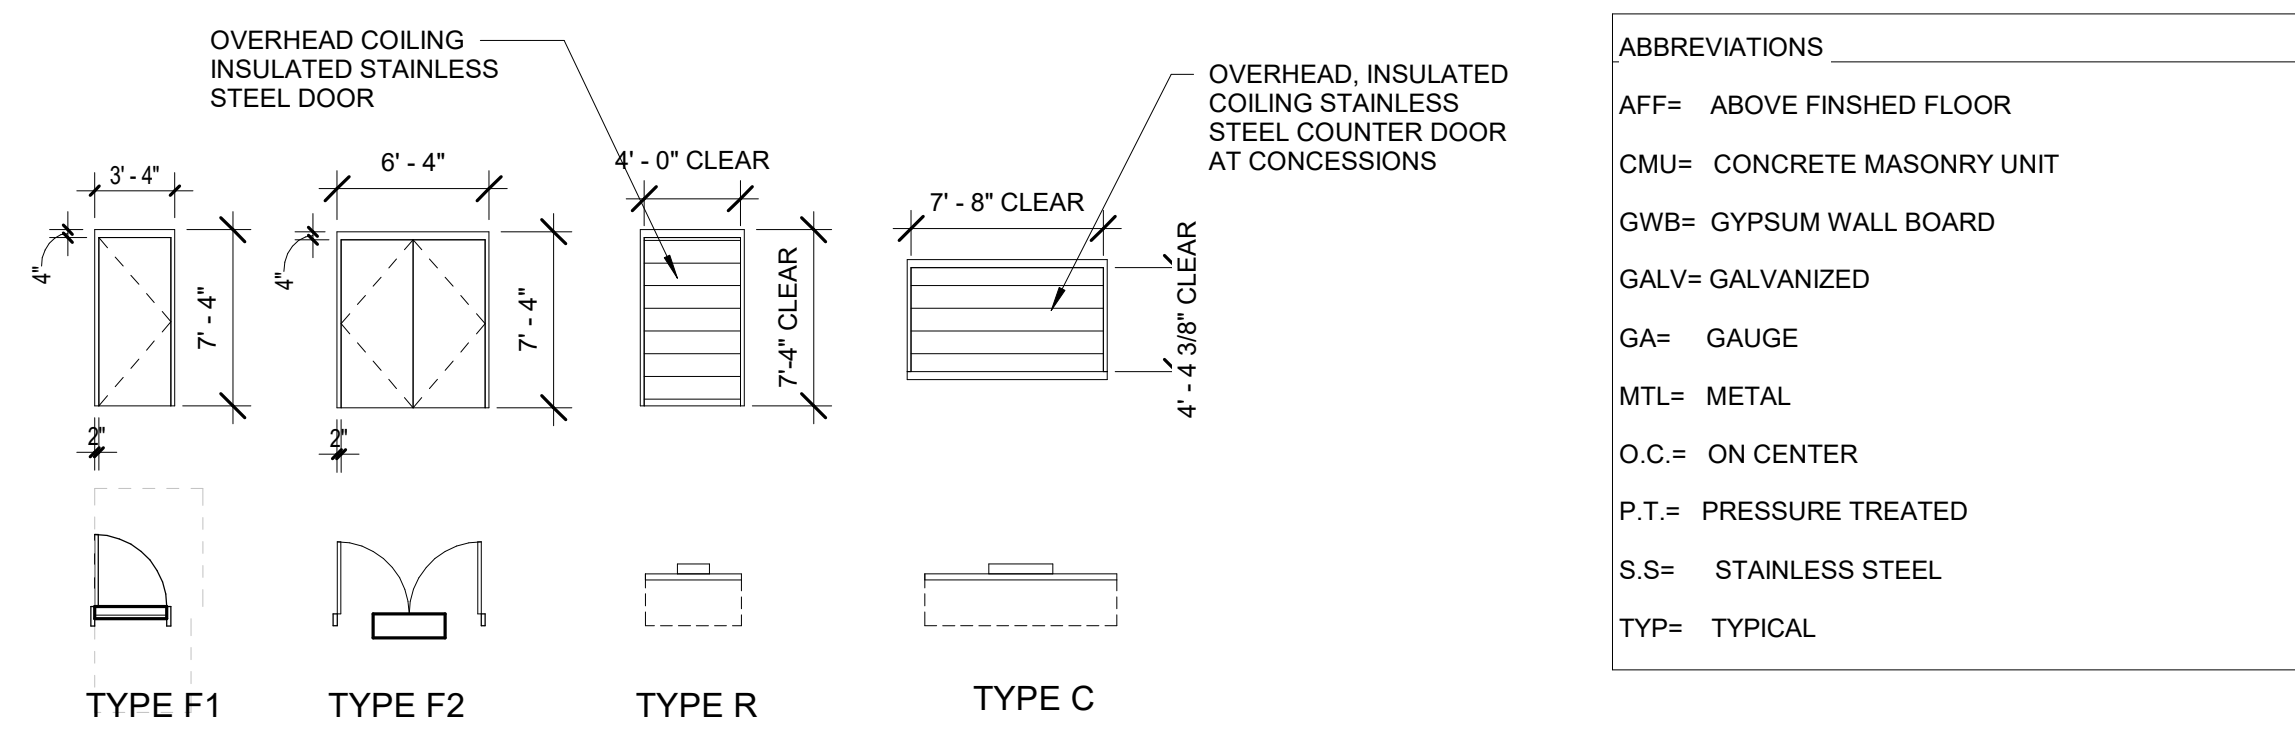


WALL SECTION LEGEND			
SYMBOL	ABBREVIATION	DESCRIPTION	REMARKS
	CMU	CONCRETE MASONRY UNIT	
	BATT	BATT INSULATION	MINERAL WOOL OR EQUAL

WALL AND BASE FINISHES			
SYMBOL	ABBREVIATION	DESCRIPTION	REMARKS
	EPT ECR	EPOXY PAINT EPOXY COVE BASE	
	EPT RB	EPOXY PAINT RESILIENT FLOOR BASE	


CEILING TYPES			
SYMBOL	ABBREVIATION	DESCRIPTION	REMARKS
	MRGWB	MOISTURE RESISTANT GYPSUM WALL BOARD. ELEVATION IS RELATIVE TO FINISHED FLOOR BELOW.	PROVIDE SEALANT & ROD AT ALL EDGES AND PERIMETERS WHERE CEILING MATERIALS ABUTT DISSIMILAR MATERIALS. TYPICAL.

WALL TYPES			
SYMBOL	ABBREVIATION	DESCRIPTION	REMARKS
	CMU	7 5/8" CMU (CONCRETE MASONRY UNIT) 6 HOUR RATED	REFER TO STRUCTURAL DRAWINGS FOR TOP OF WALL EXTENT AND TOP OF WALL ATTACHMENT DETAILS. WHERE CMU WALLS ARE TO EXTEND TO UNDERSIDE OF SLOPED DECK, CUT BLOCK TO MATCH SLOPE.

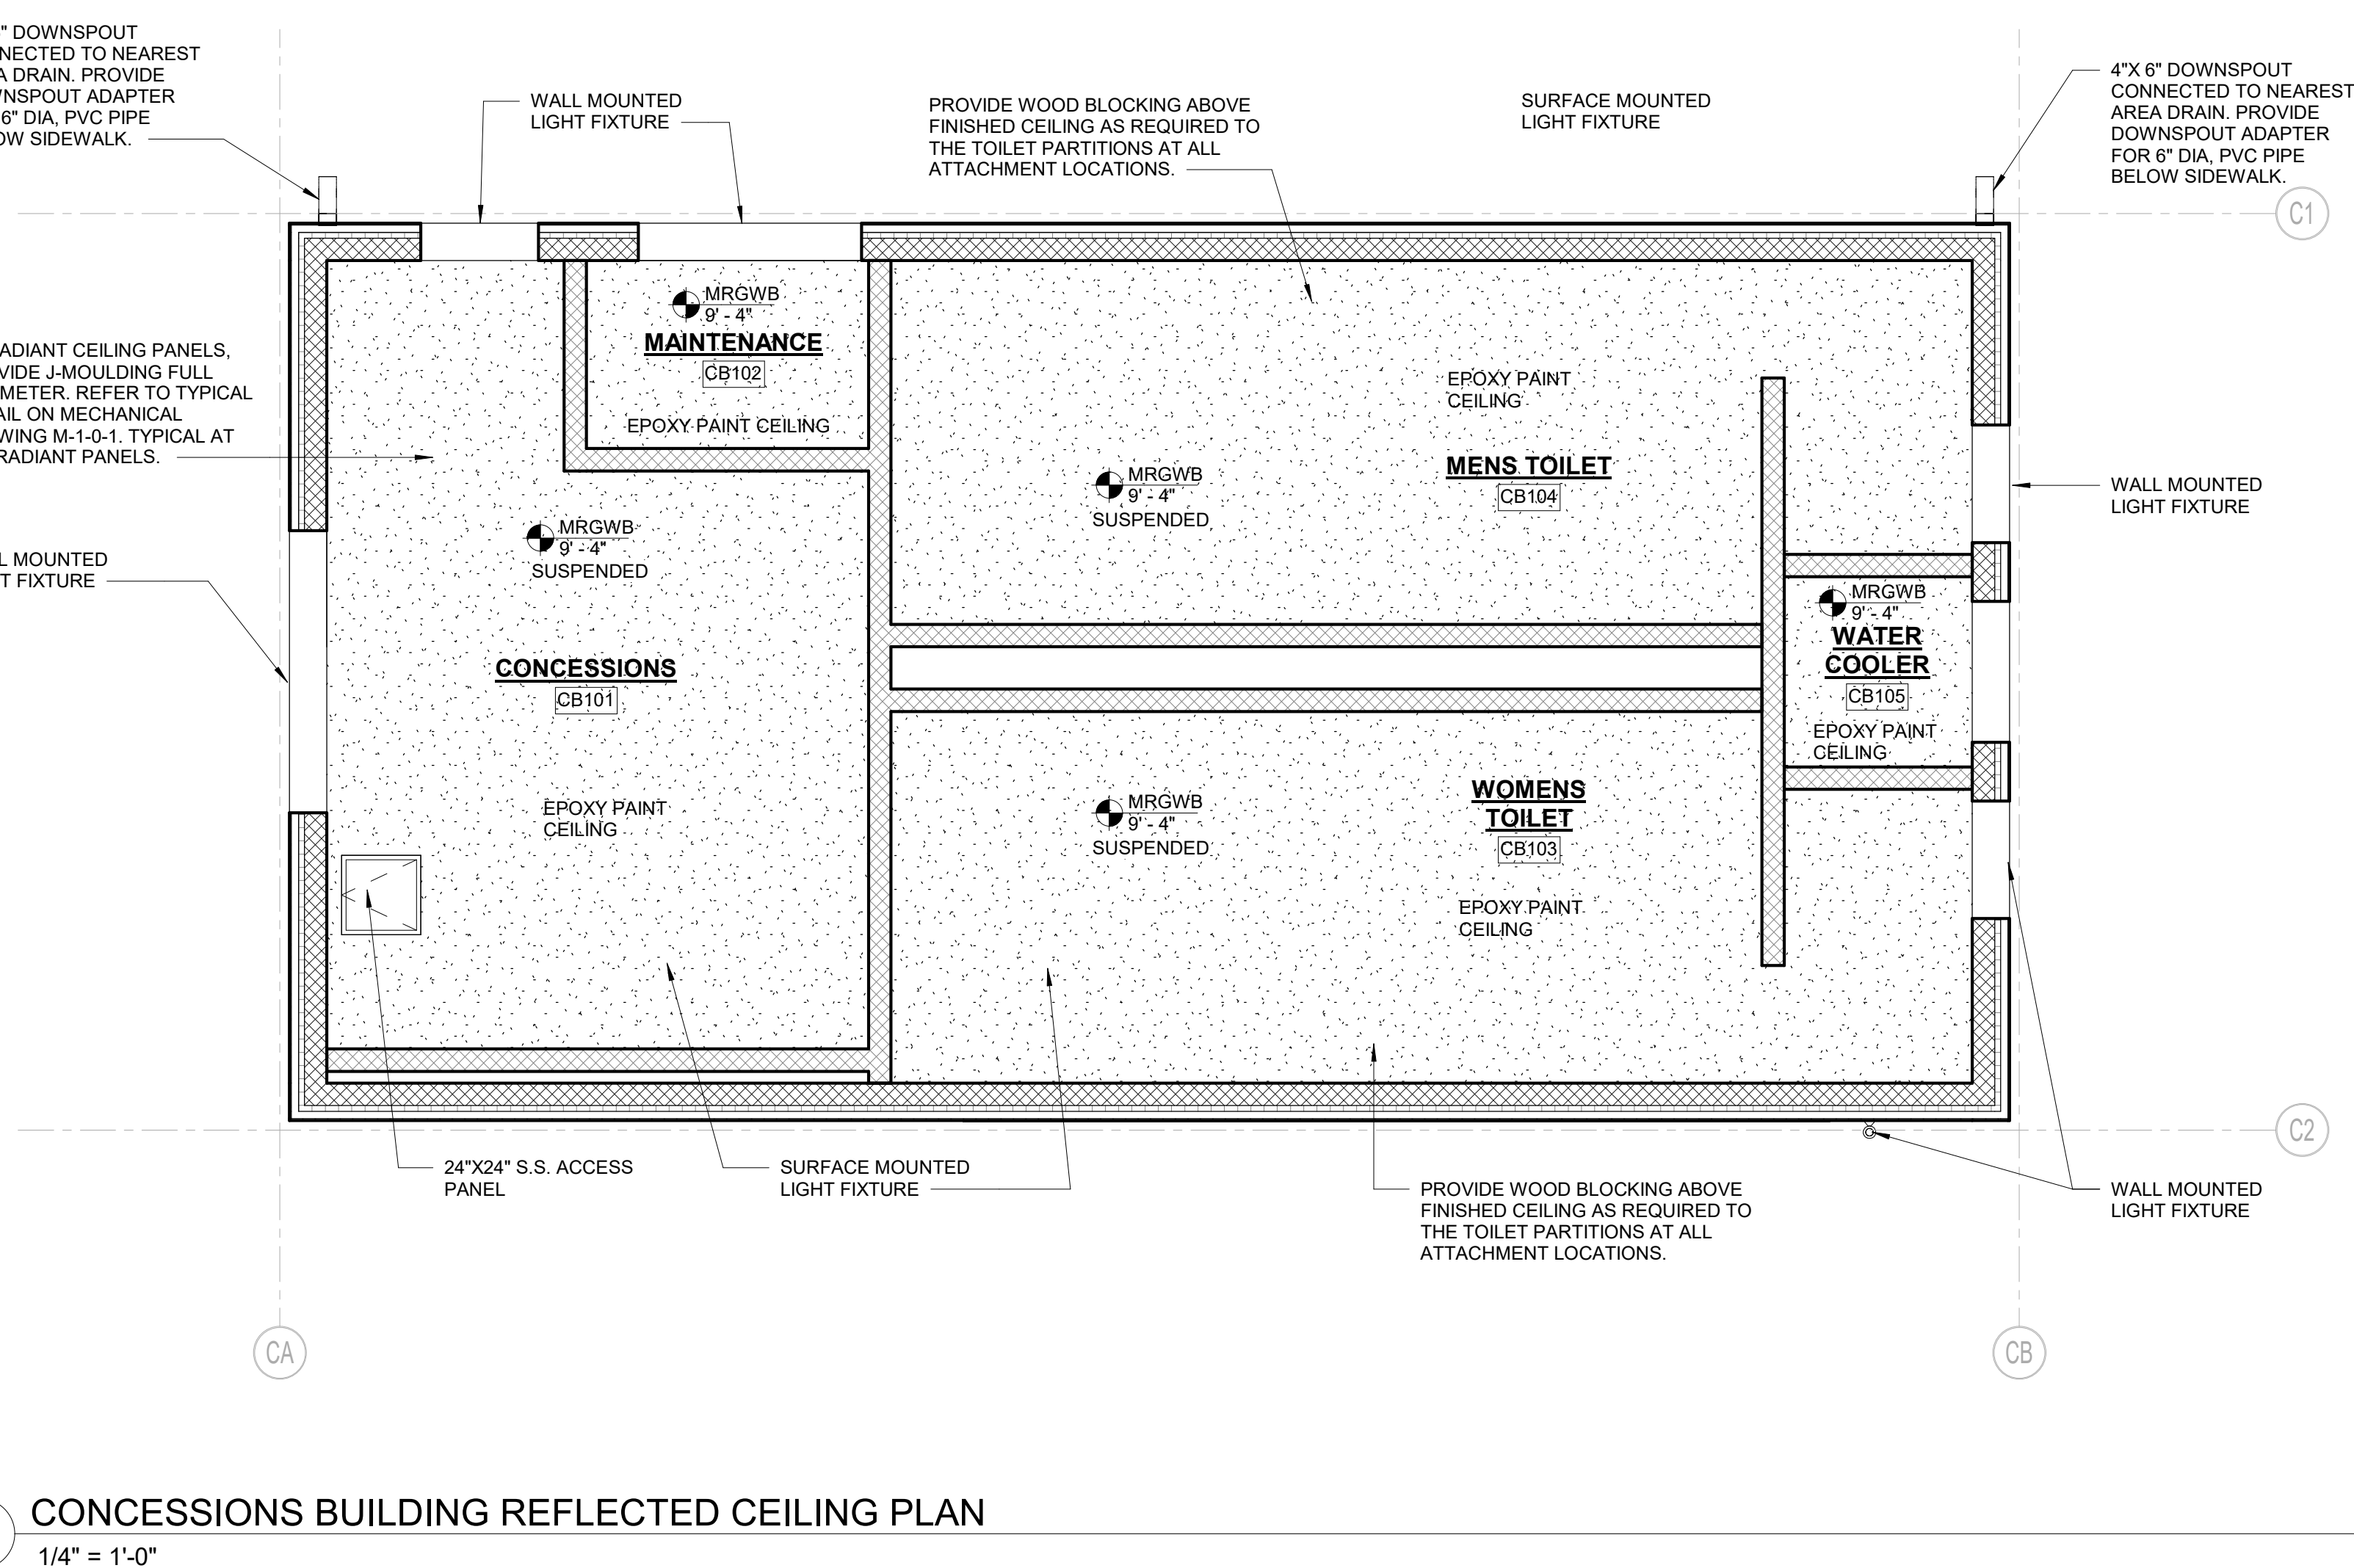


CONCESSIONS BUILDING REFLECTED CEILING PLAN

1/4" = 1'-0"

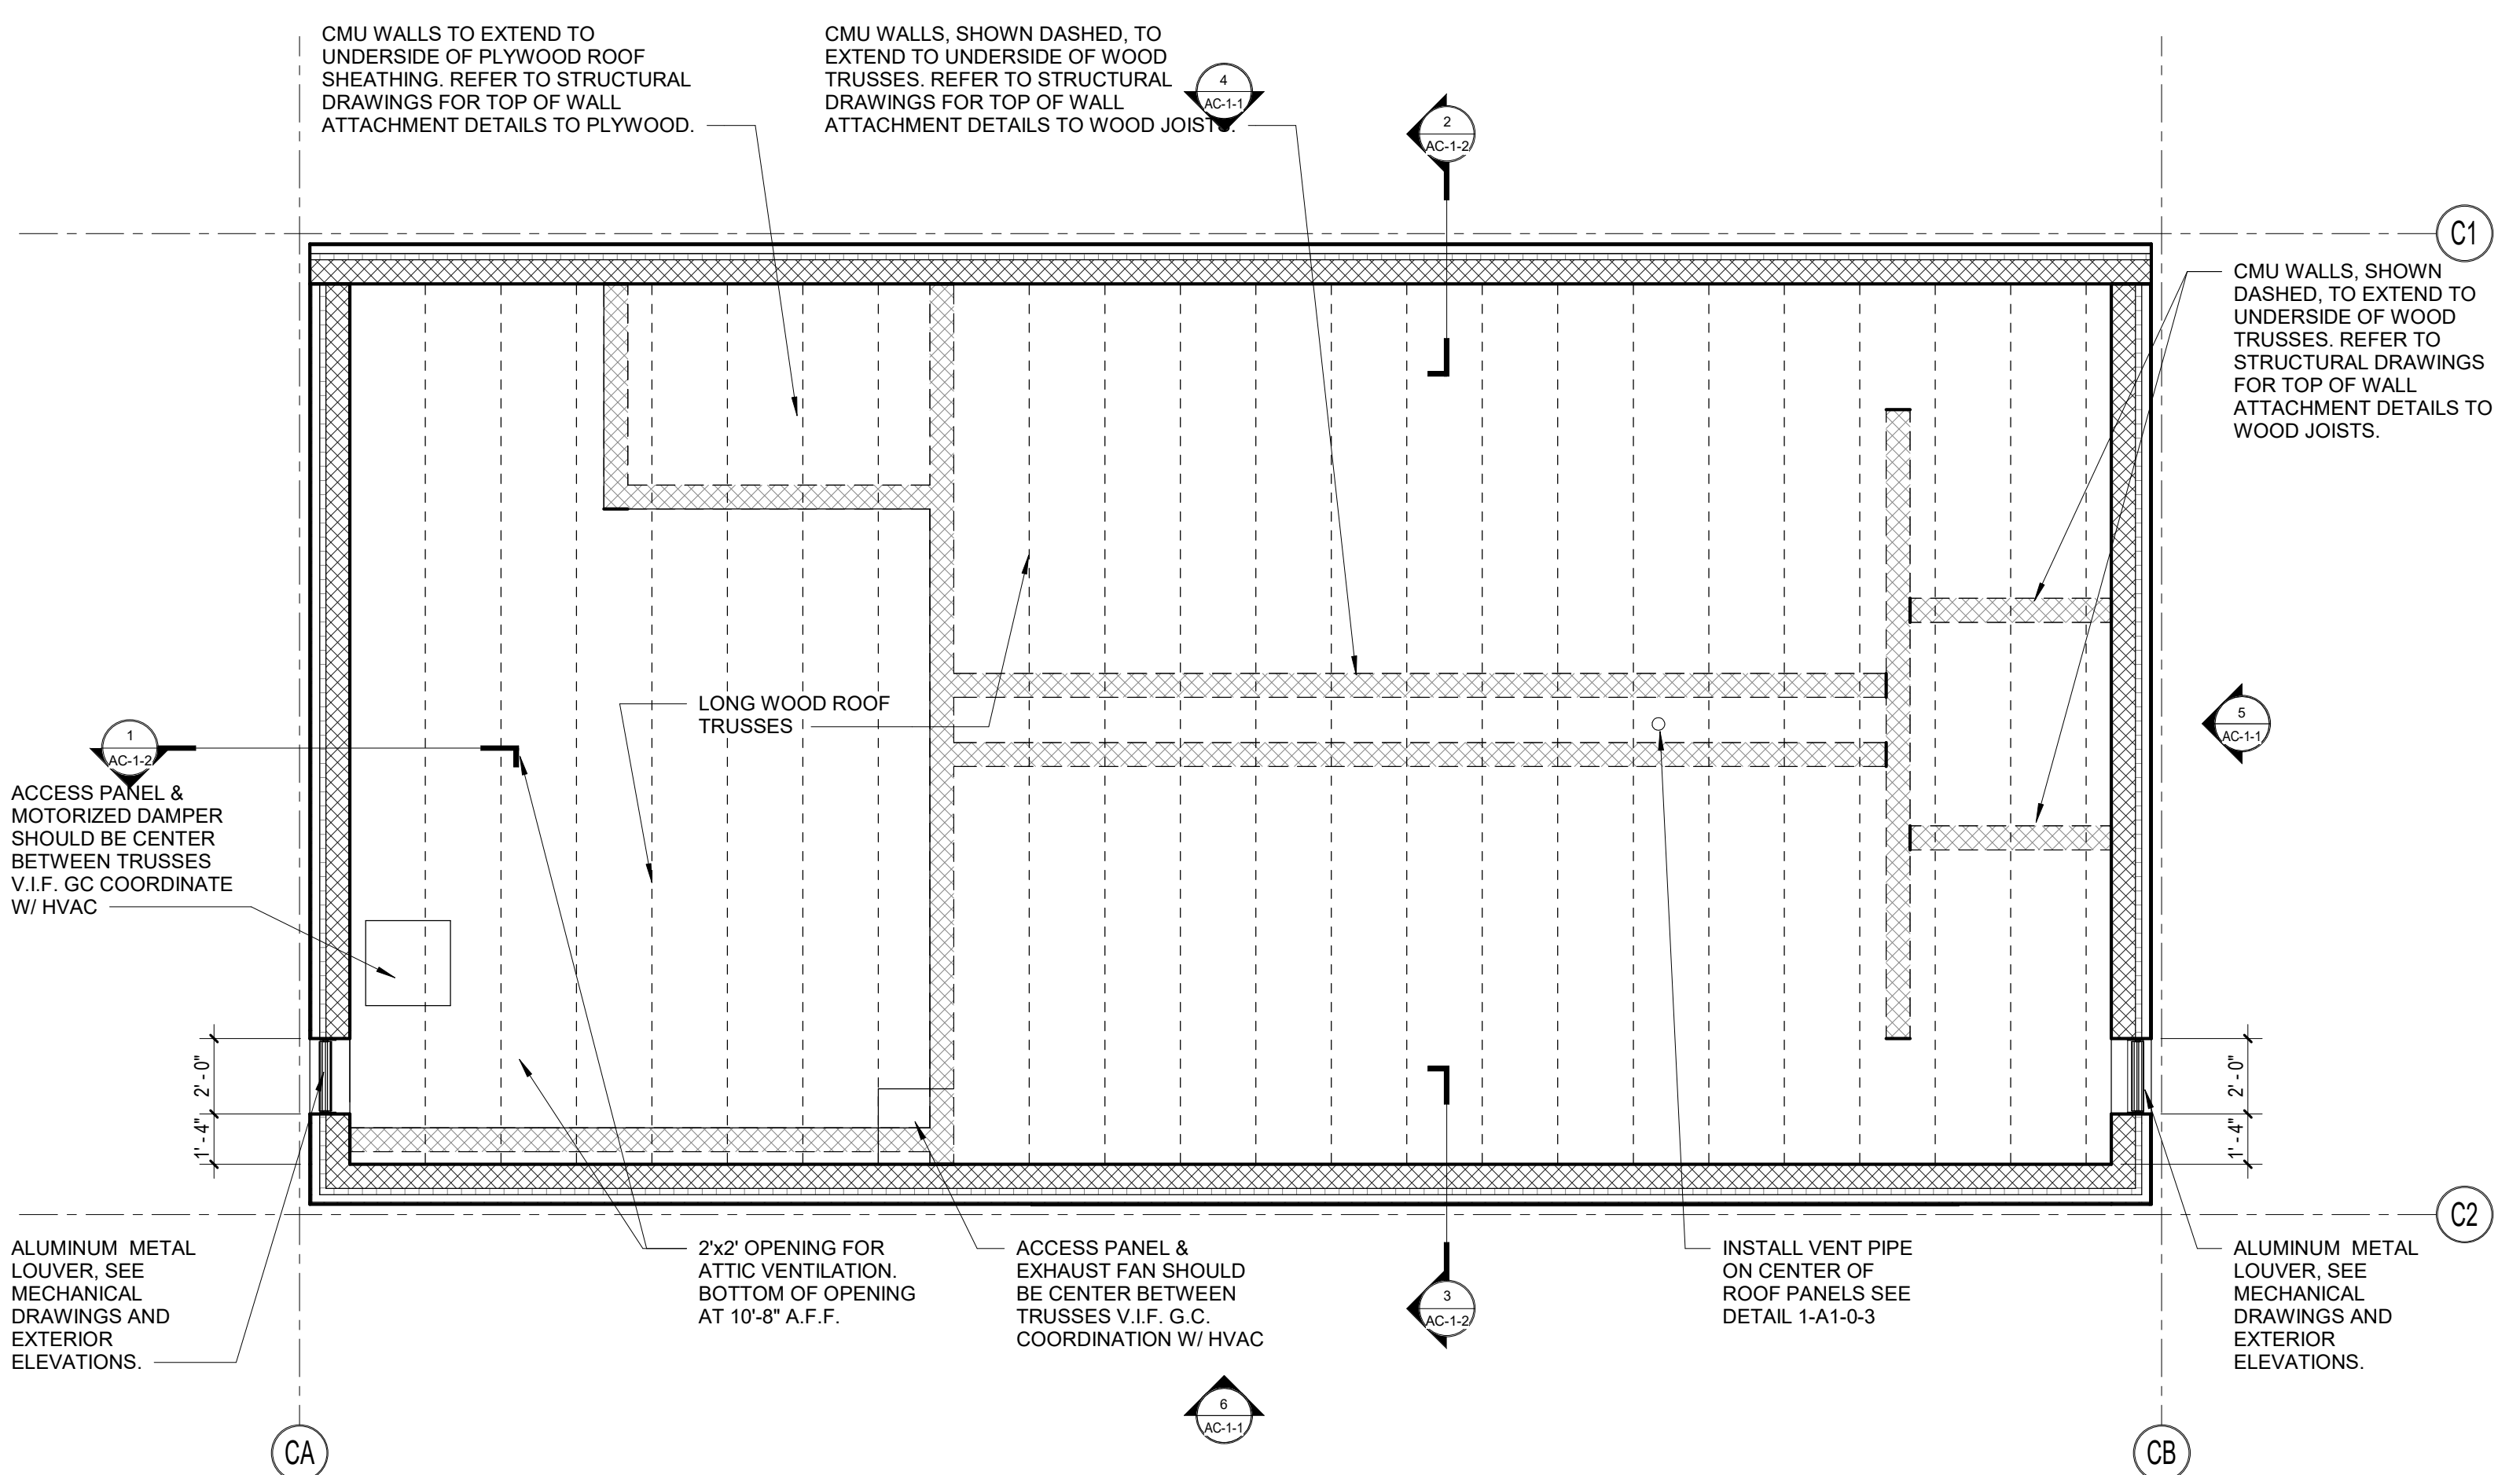


TOP OF CMU

1/4" = 1'-0"

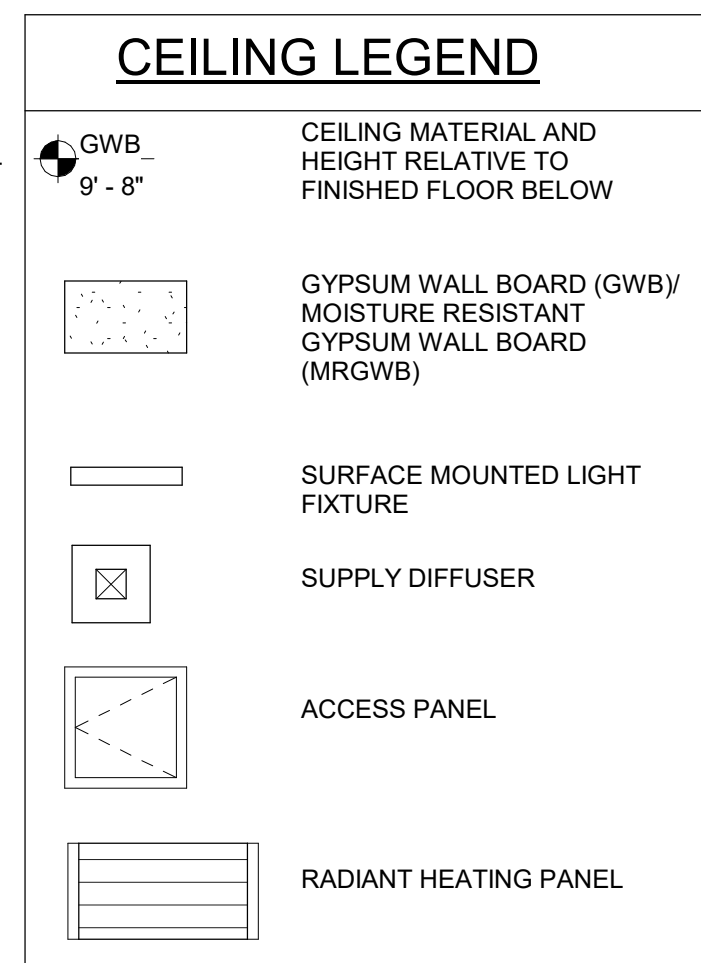

WALL SECTION 3 - CONCESSIONS

3/4" = 1'-0"

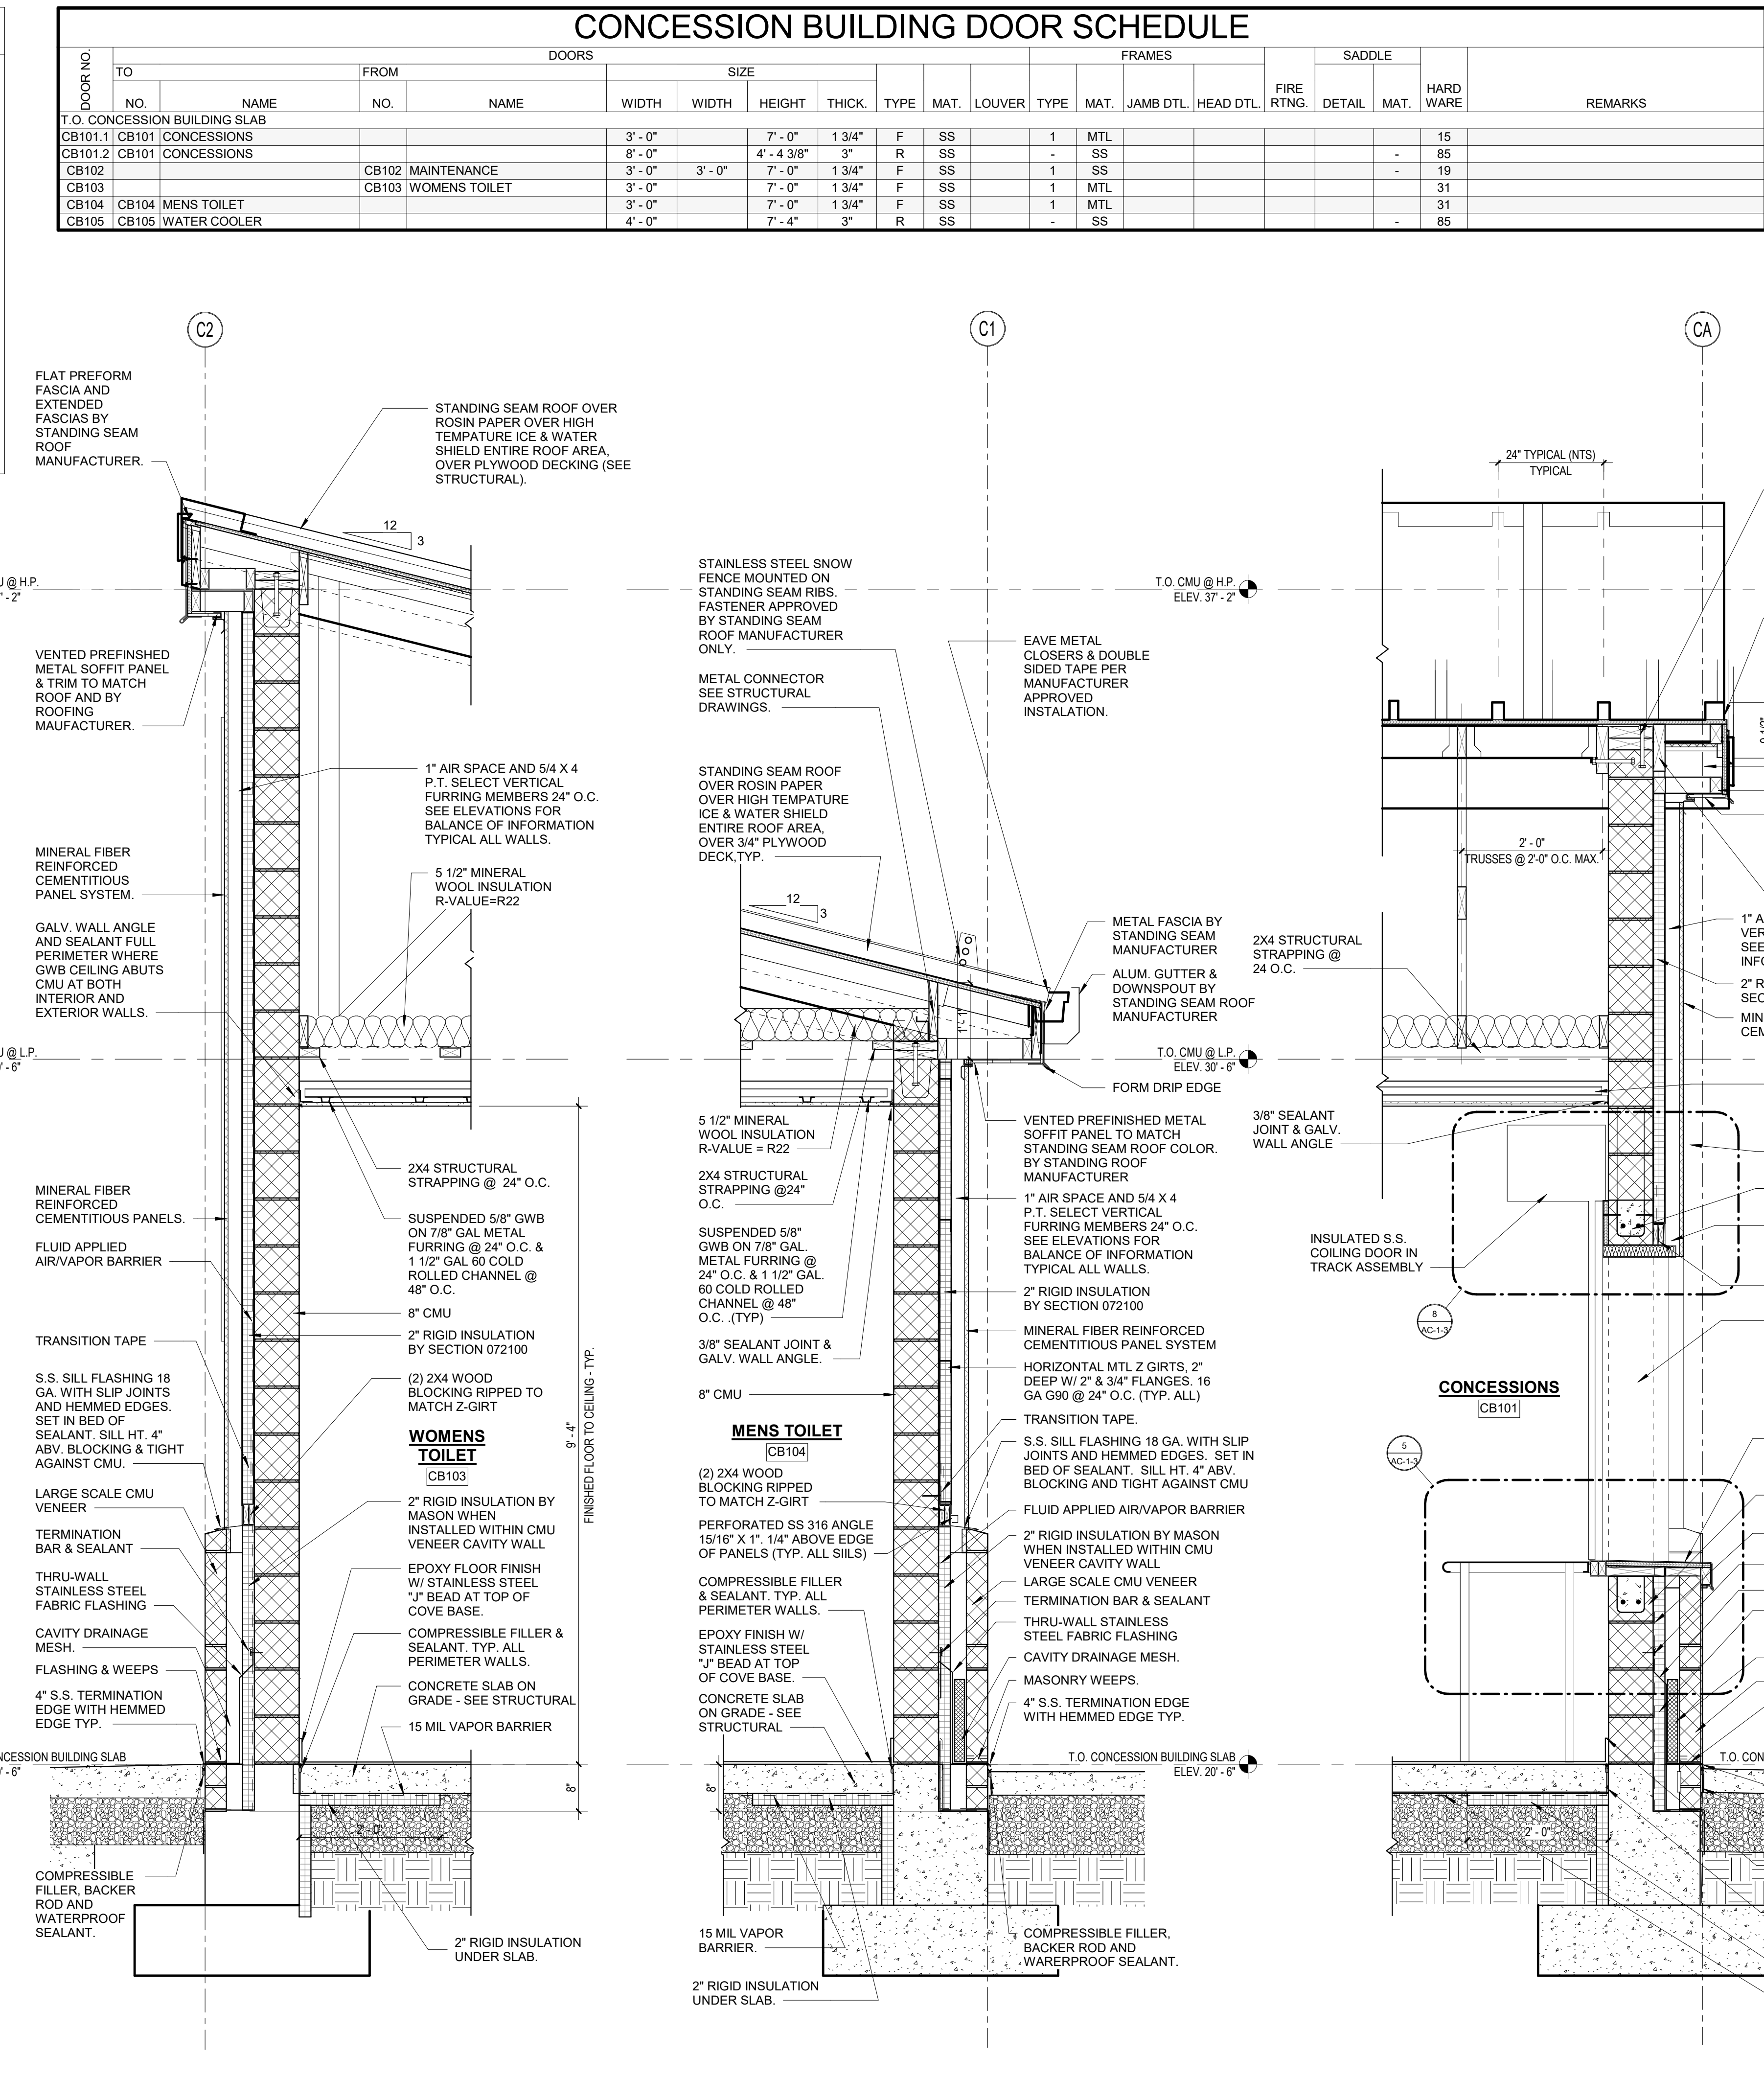

WALL SECTION 2 - CONCESSIONS

3/4" = 1'-0"


WALL SECTION 1 - CONCESSIONS

3/4" = 1'-0"

Northeast Metropolitan Regional Vocational High School
100 Hemlock Road, Wakefield, MA 01880

MSBA 90% CD SUBMISSION

May 12TH, 2023

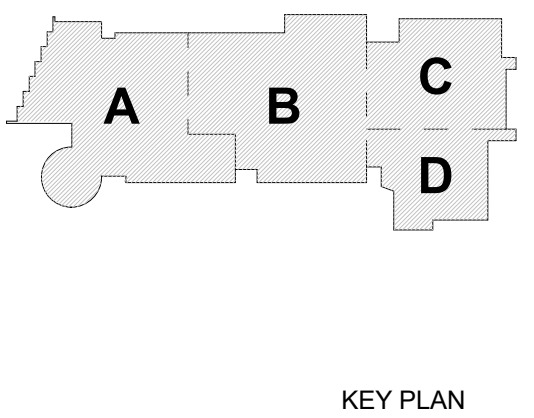

WALL SECTIONS, PLANS & SCHEDULES

Scale: As indicated

Job No.: 20202


Drawn By: DRA

Date: May 12TH, 2023


Volume 3 of 4

AC-1-2


**Northeast
Metropolitan
Regional
Vocational High
School**
100 Hemlock Road,
Wakefield, MA 01880

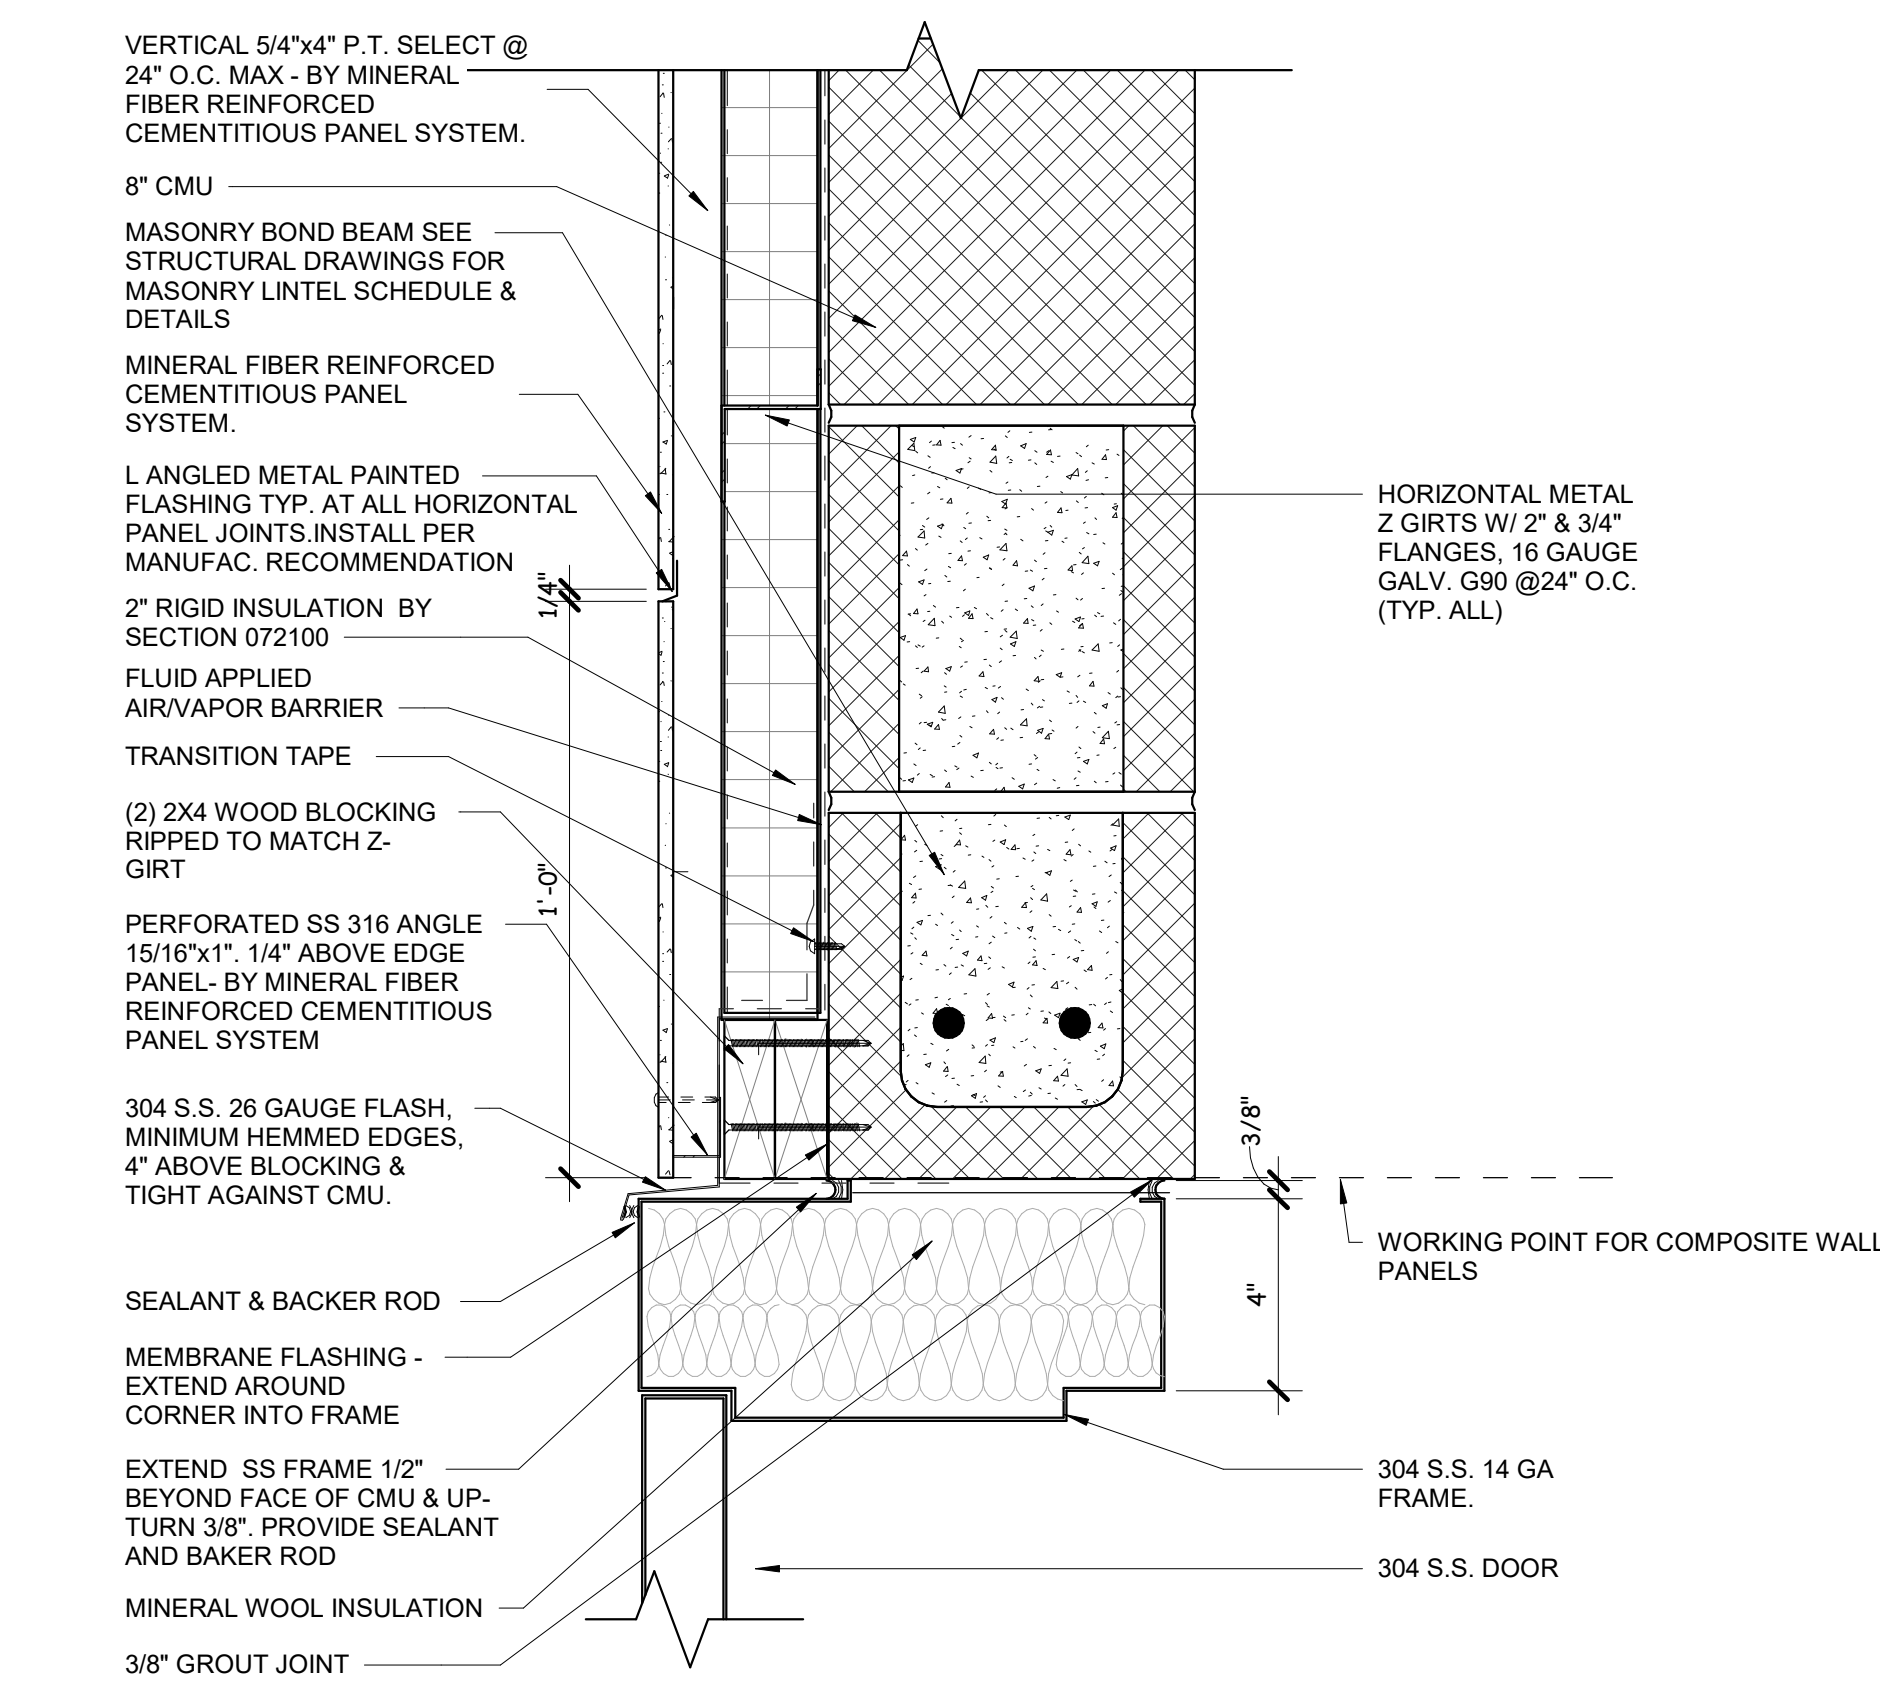


9 DOOR HEAD DETAIL
3" = 1'-0"

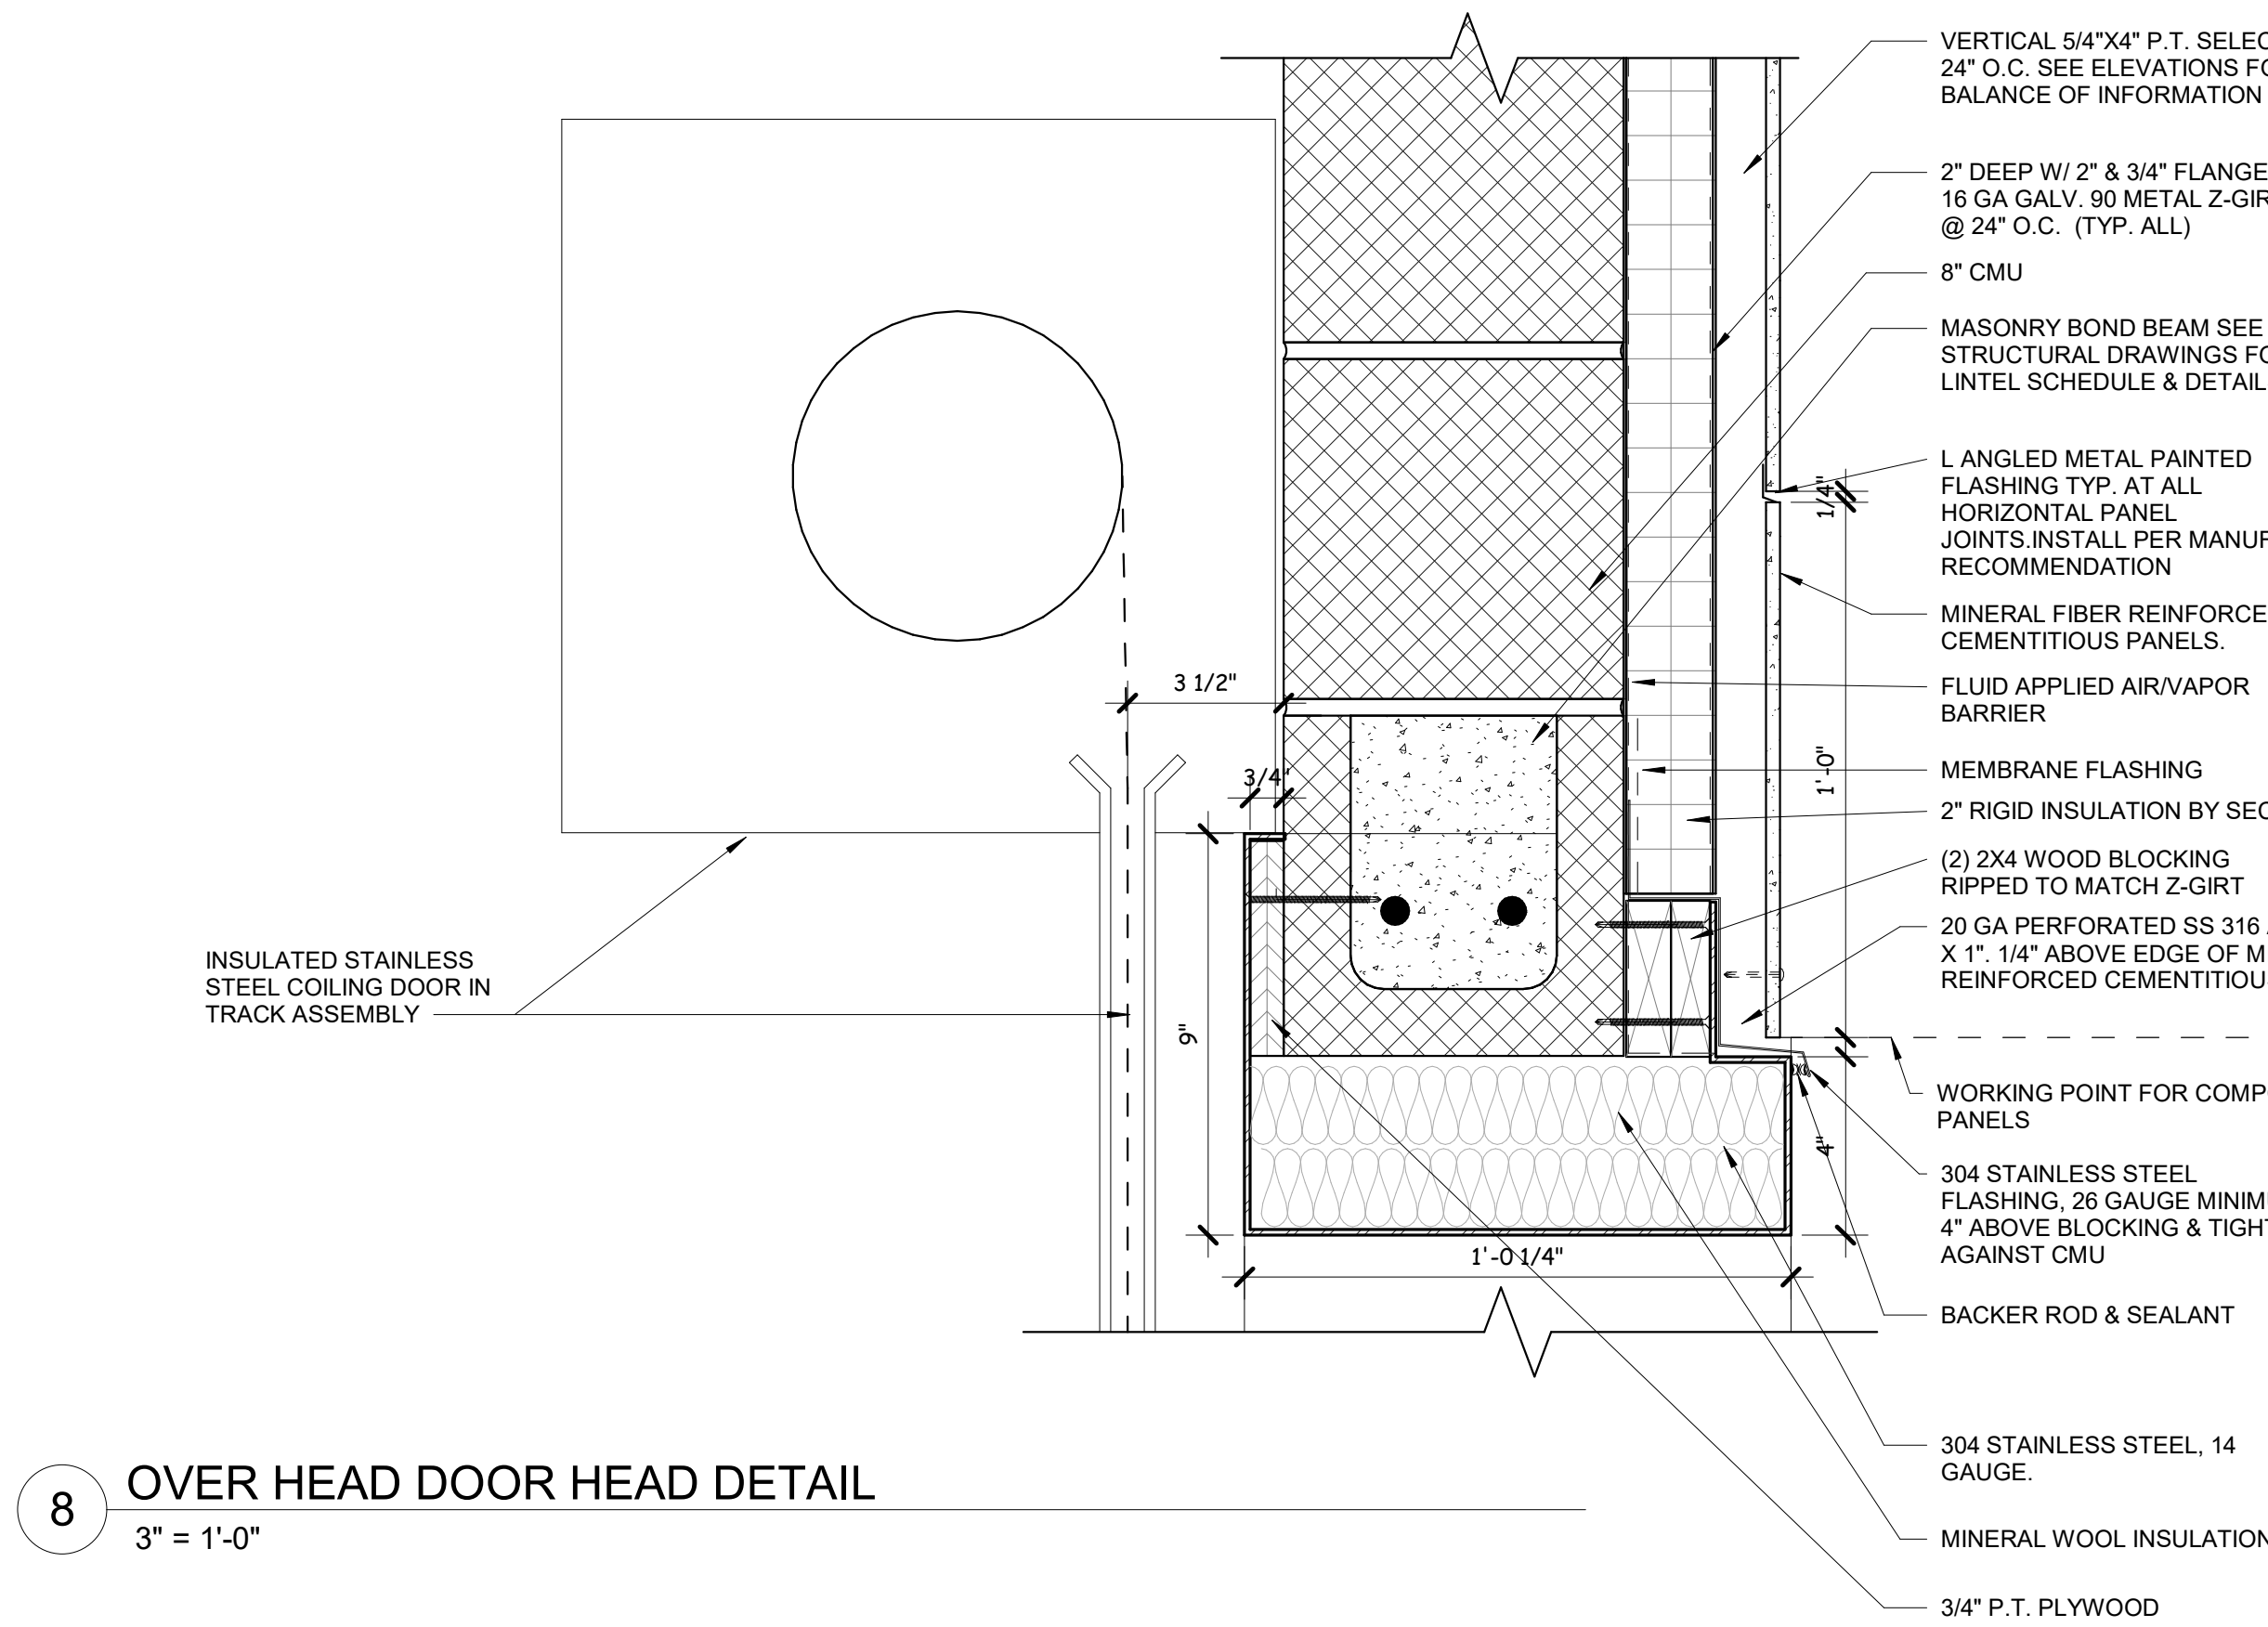


8 OVER HEAD DOOR HEAD DETAIL
3" = 1'-0"

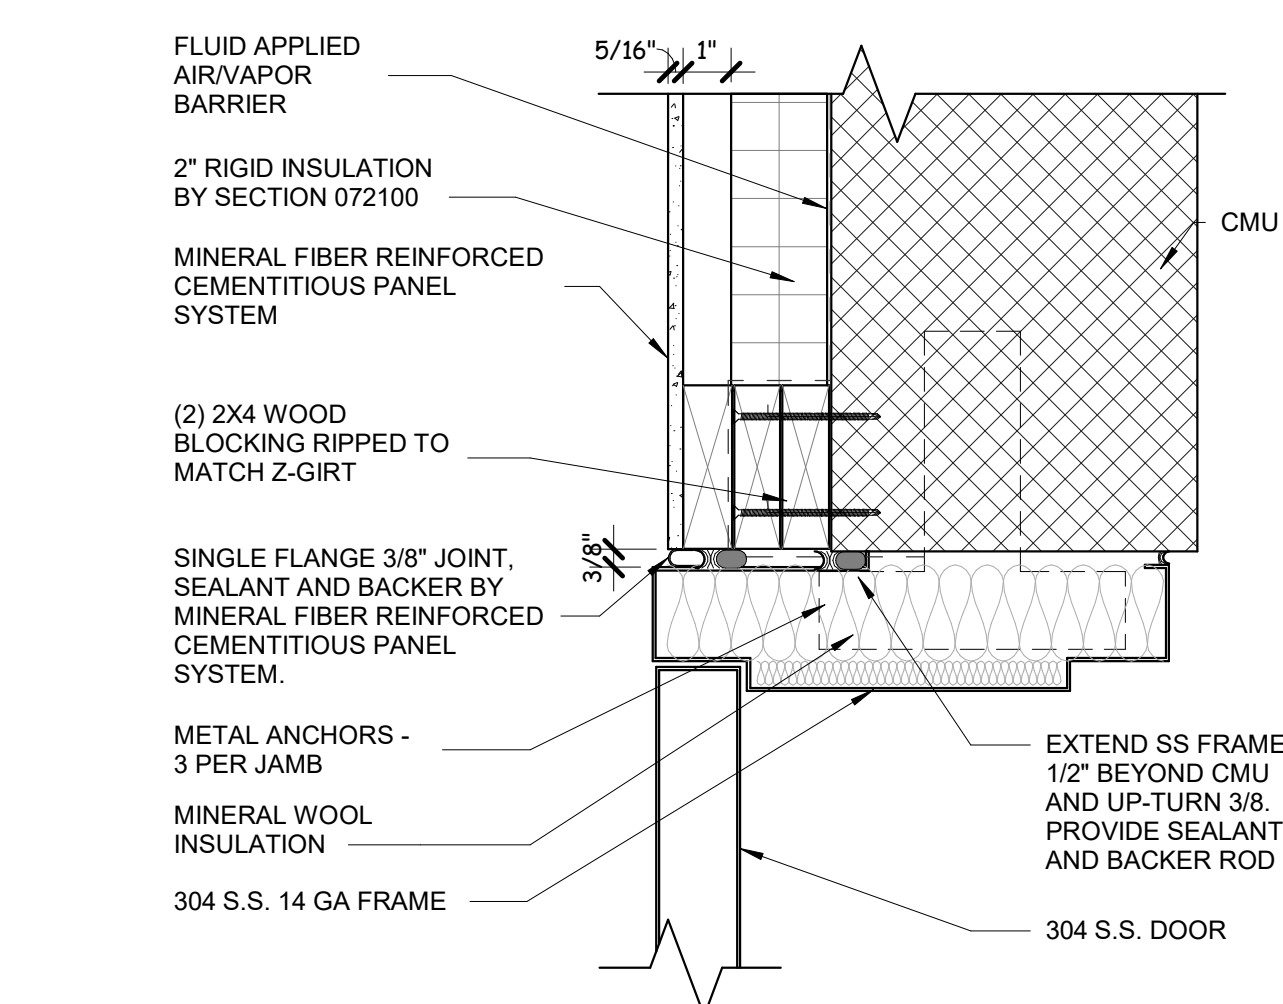

6 DOOR JAMB DETAIL
3" = 1'-0"

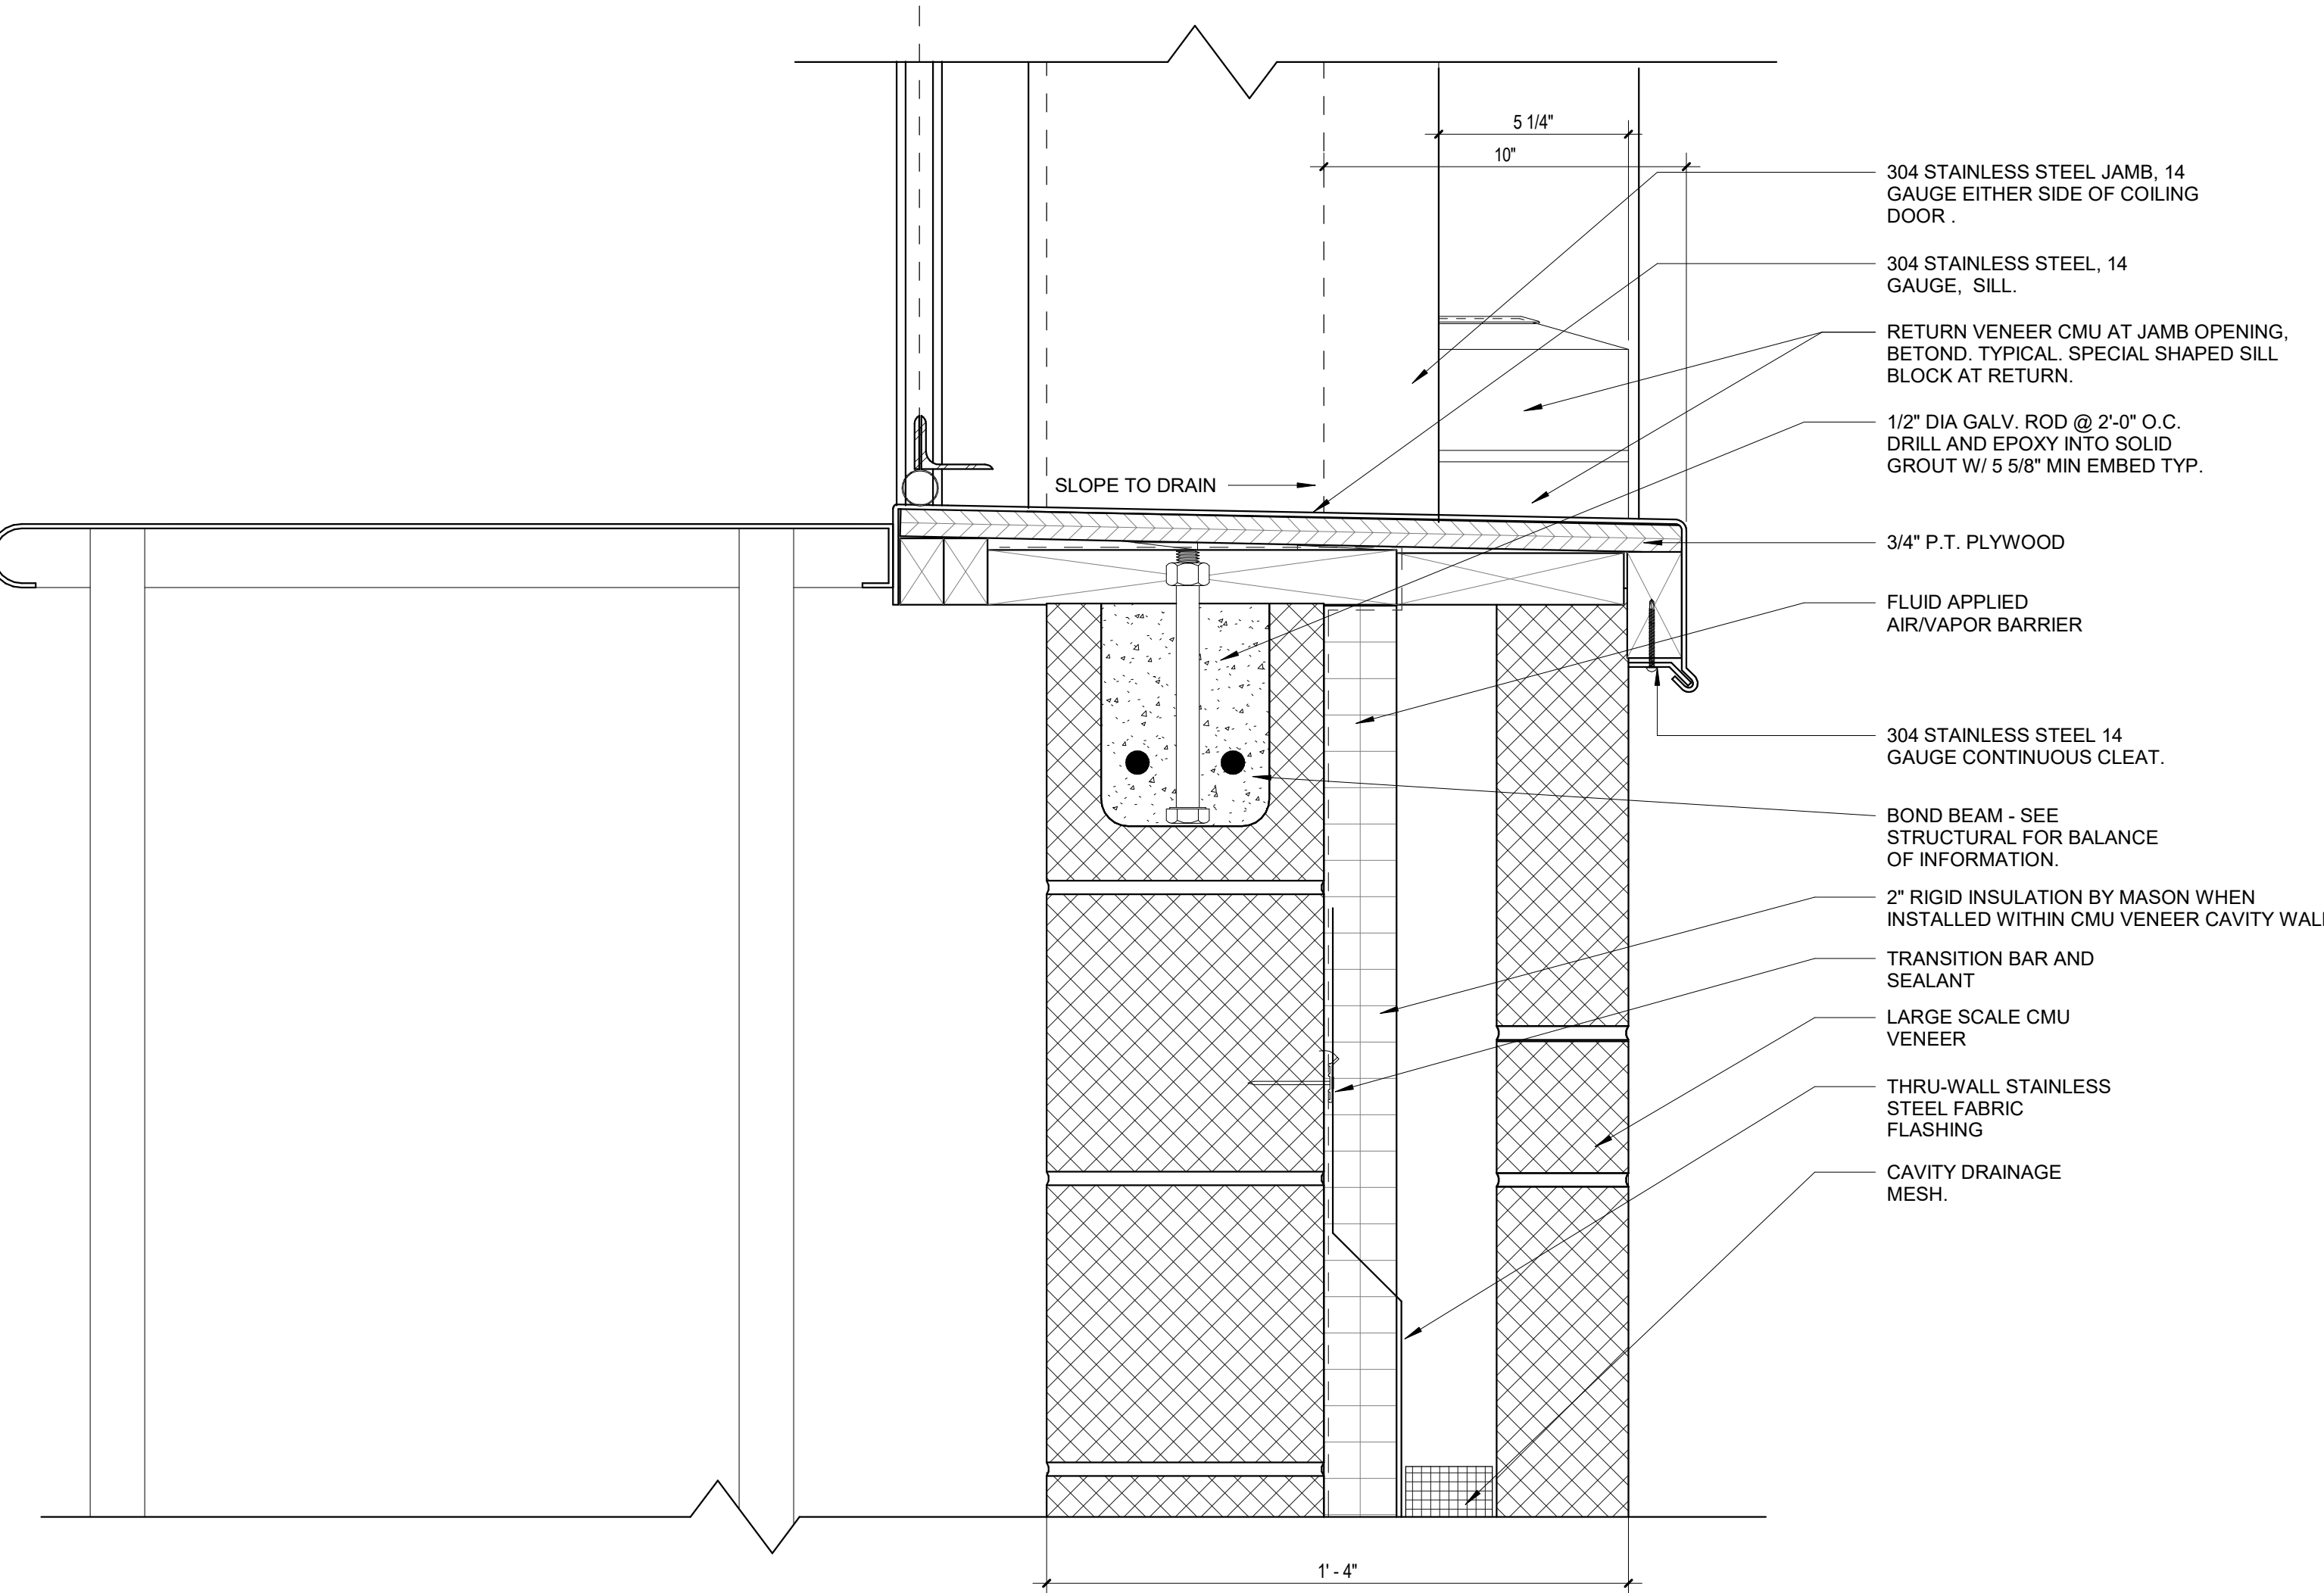


5 OVER HEAD DOOR SILL DETAIL
3" = 1'-0"

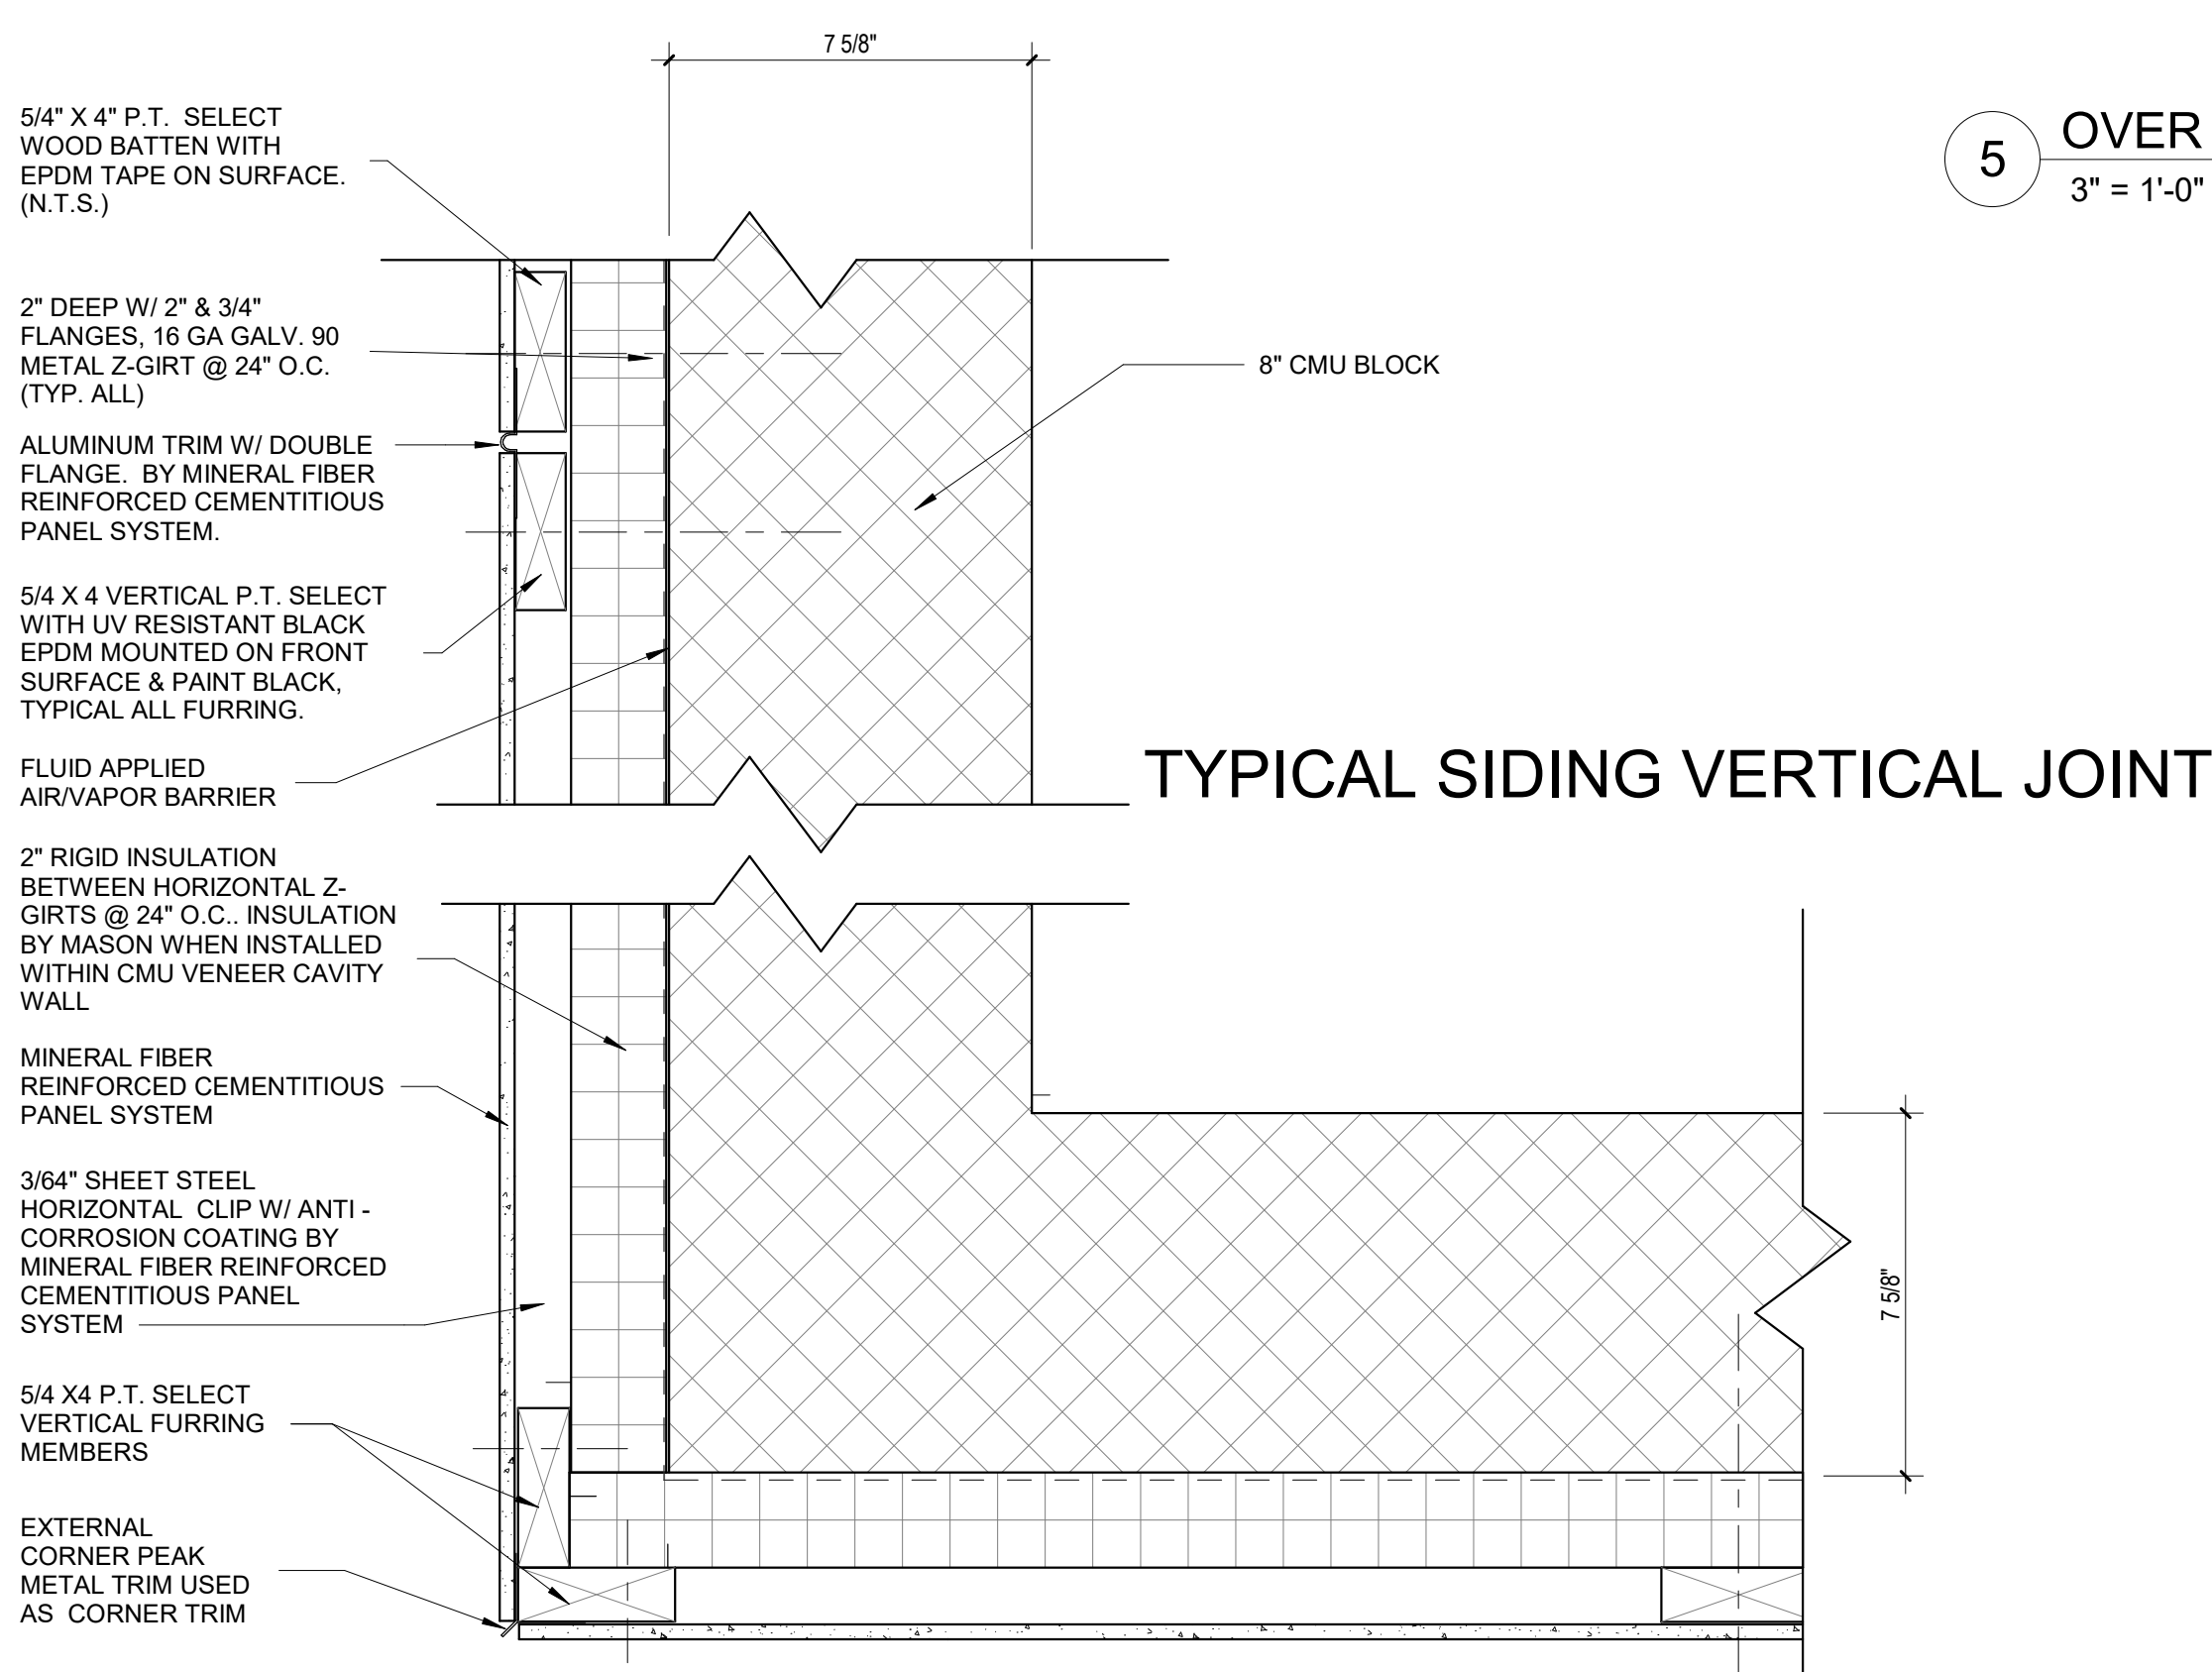



3 CORNER HEAD DETAIL
3" = 1'-0"

2 OVER HEAD DOOR JAMB DETAIL
3" = 1'-0"

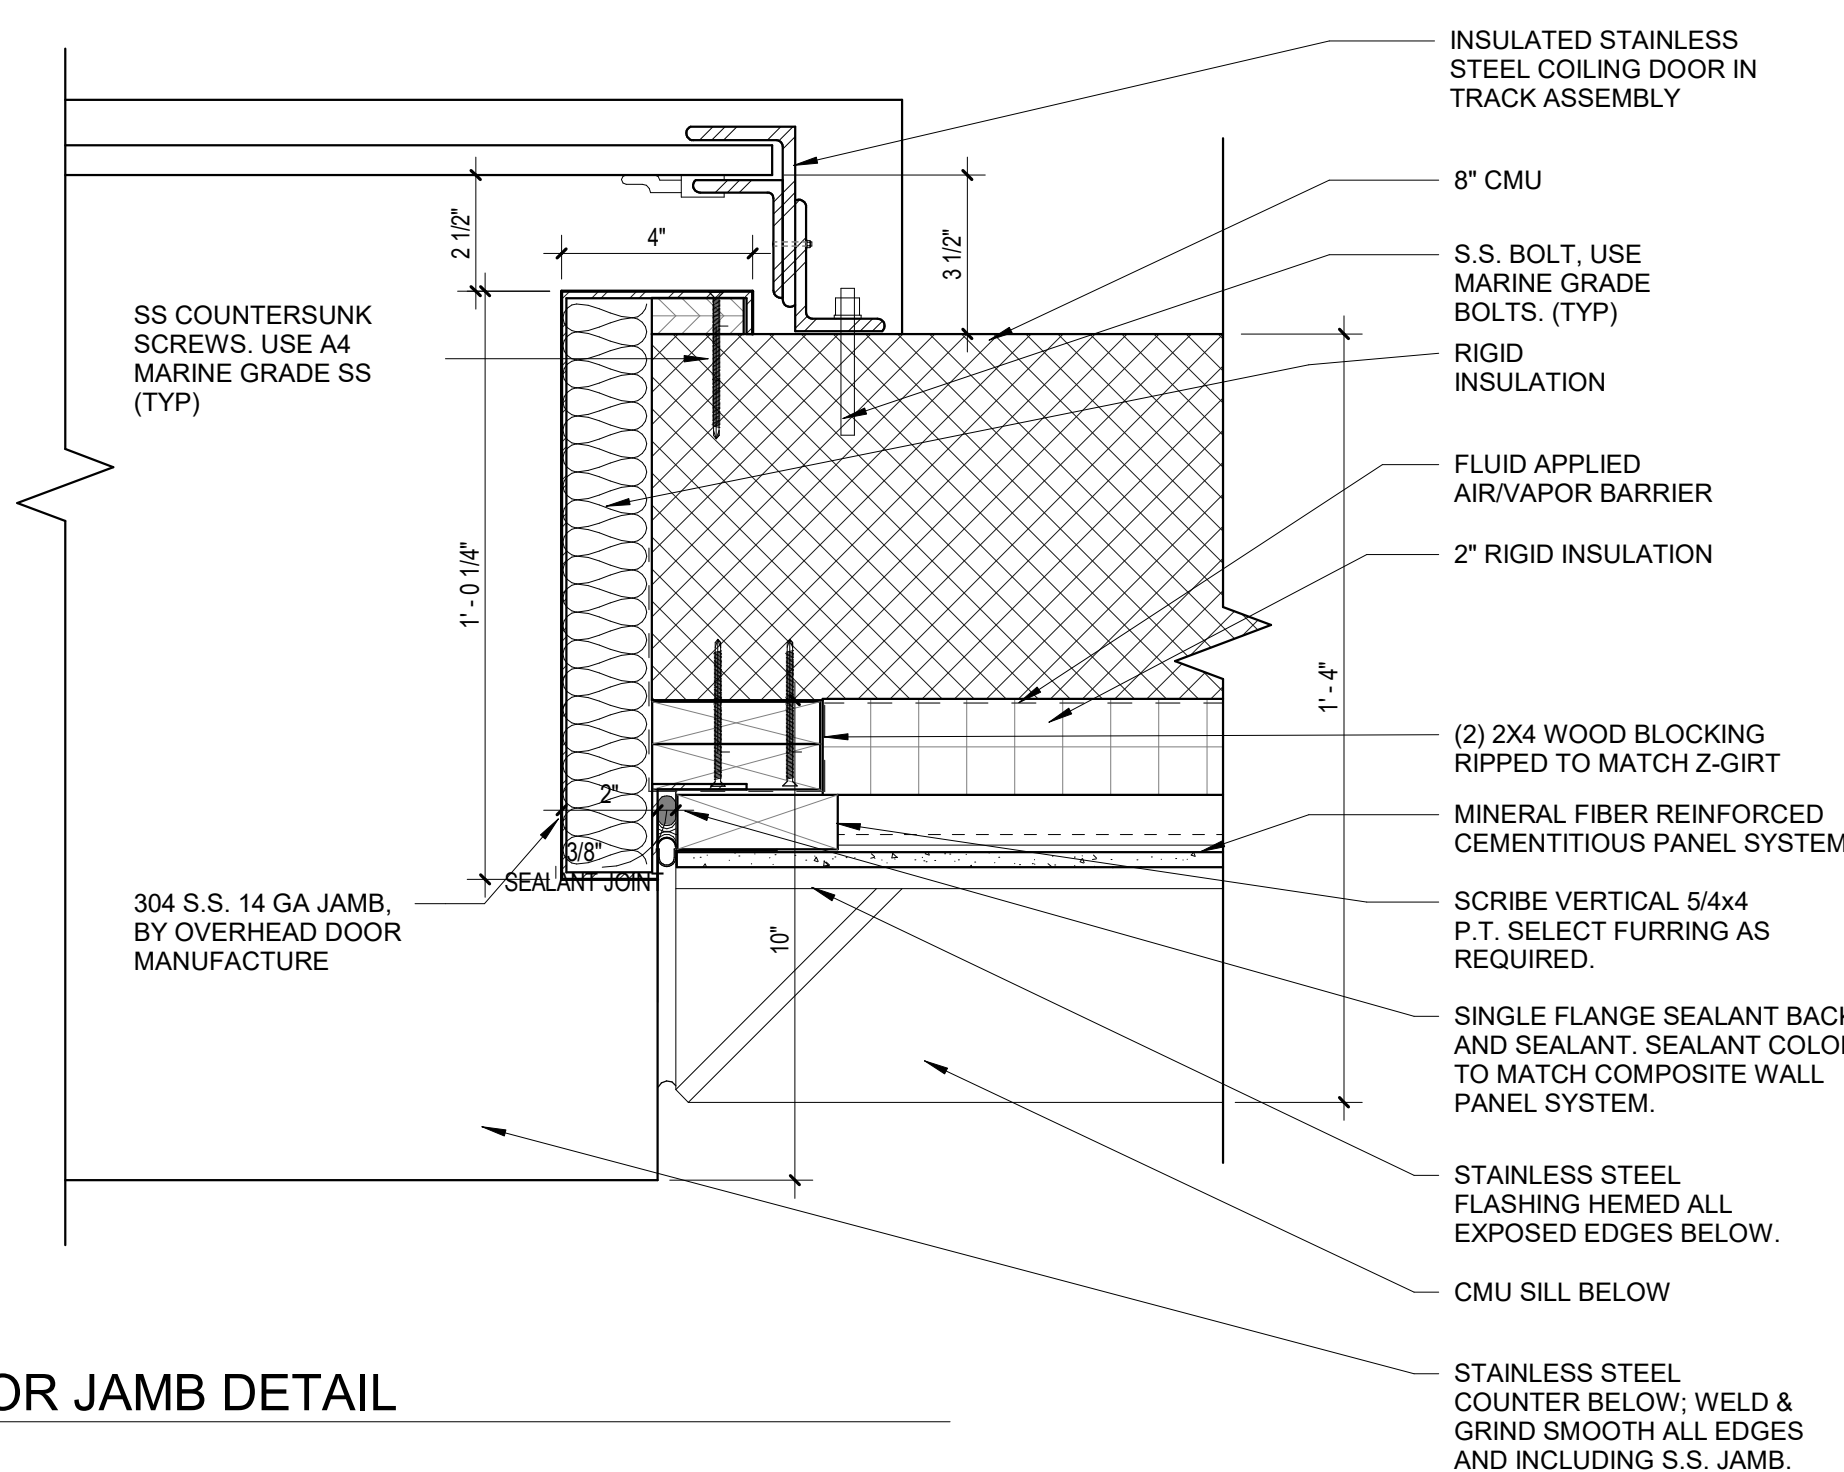

1 TYPICAL ROOF PENETRATION DETAIL
1 1/2" = 1'-0"

7 LOUVER DETAIL
3" = 1'-0"

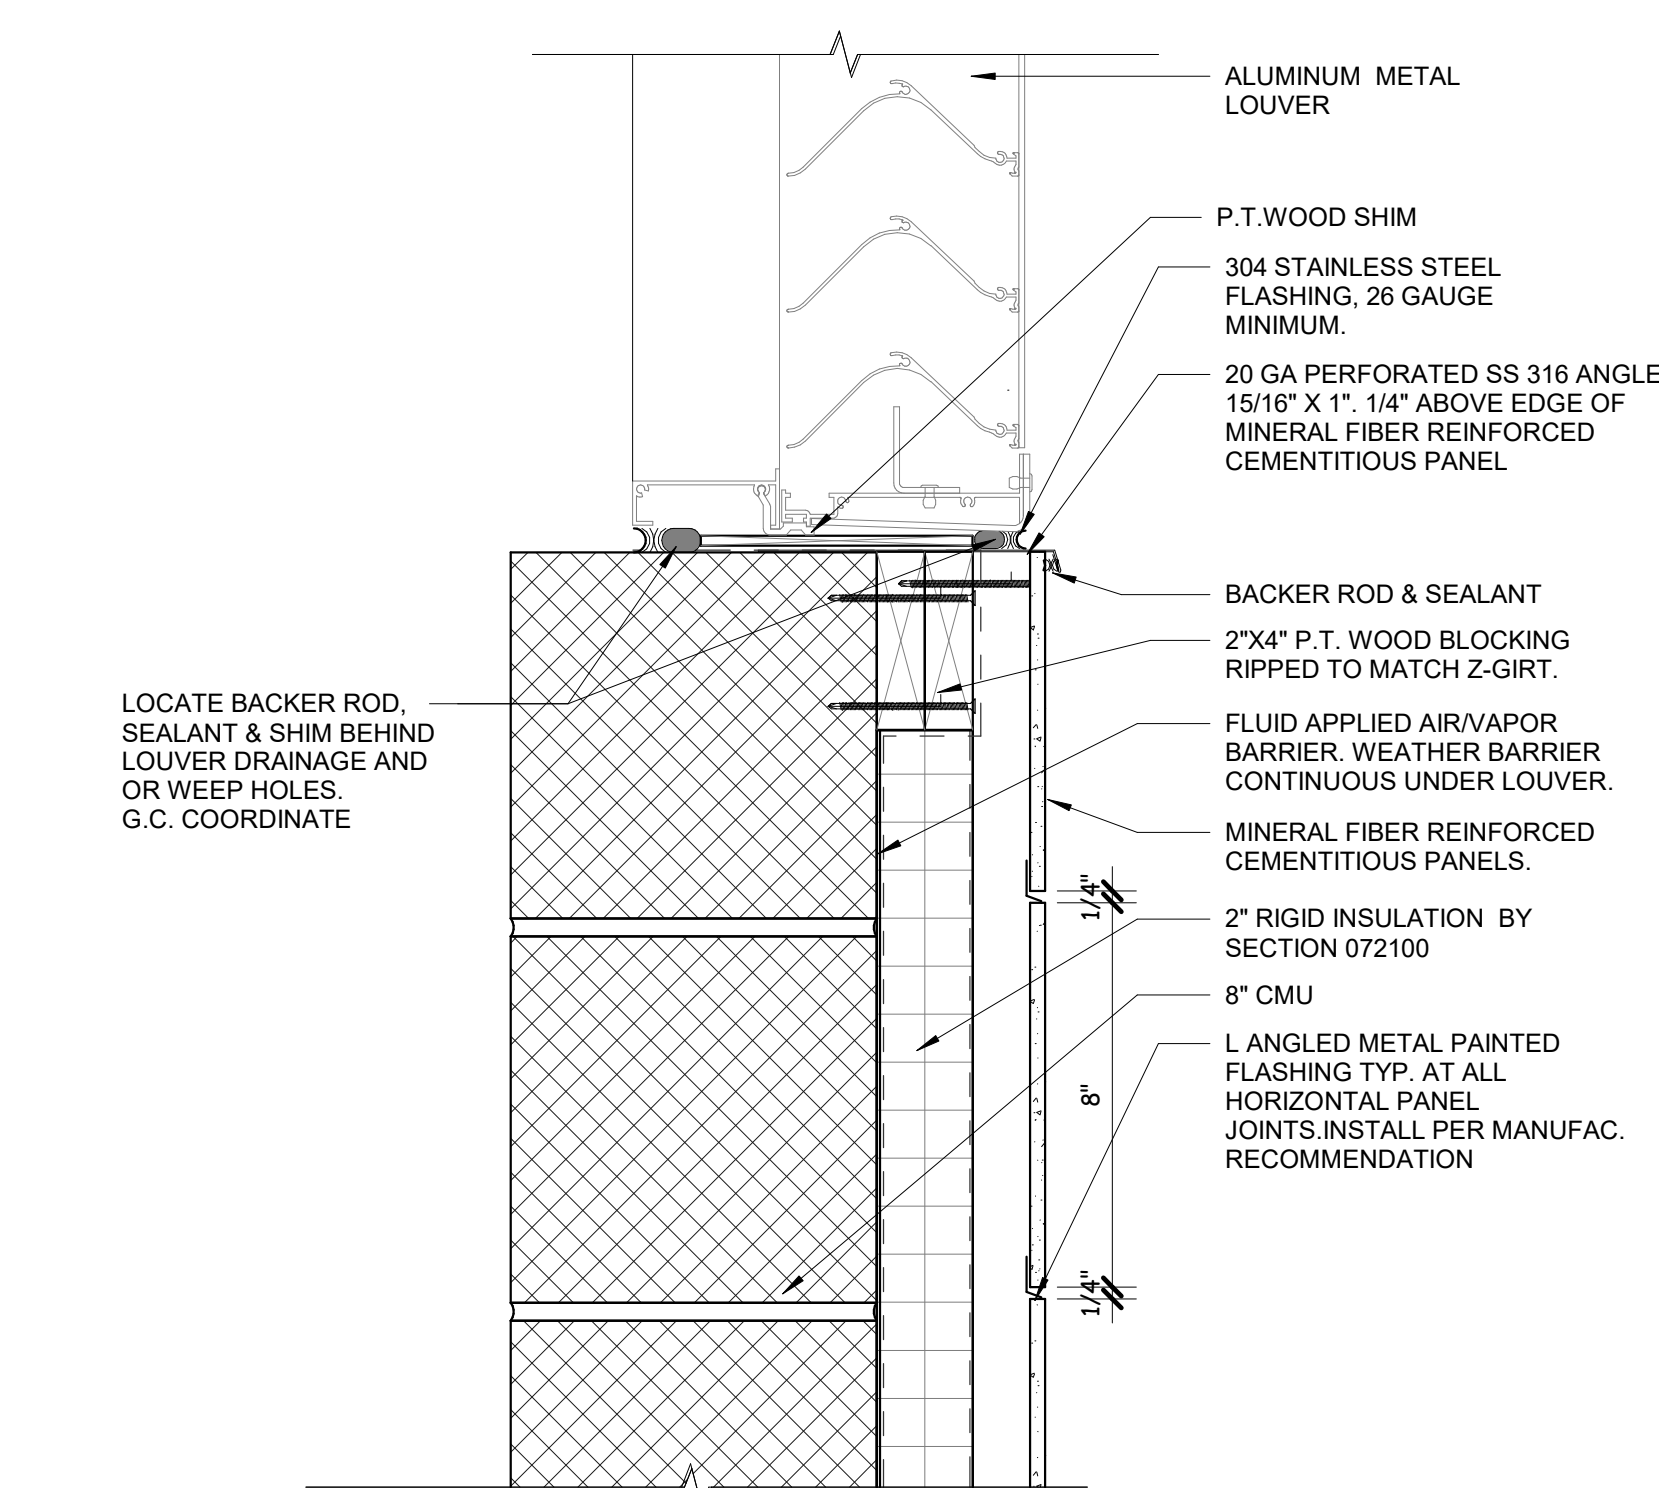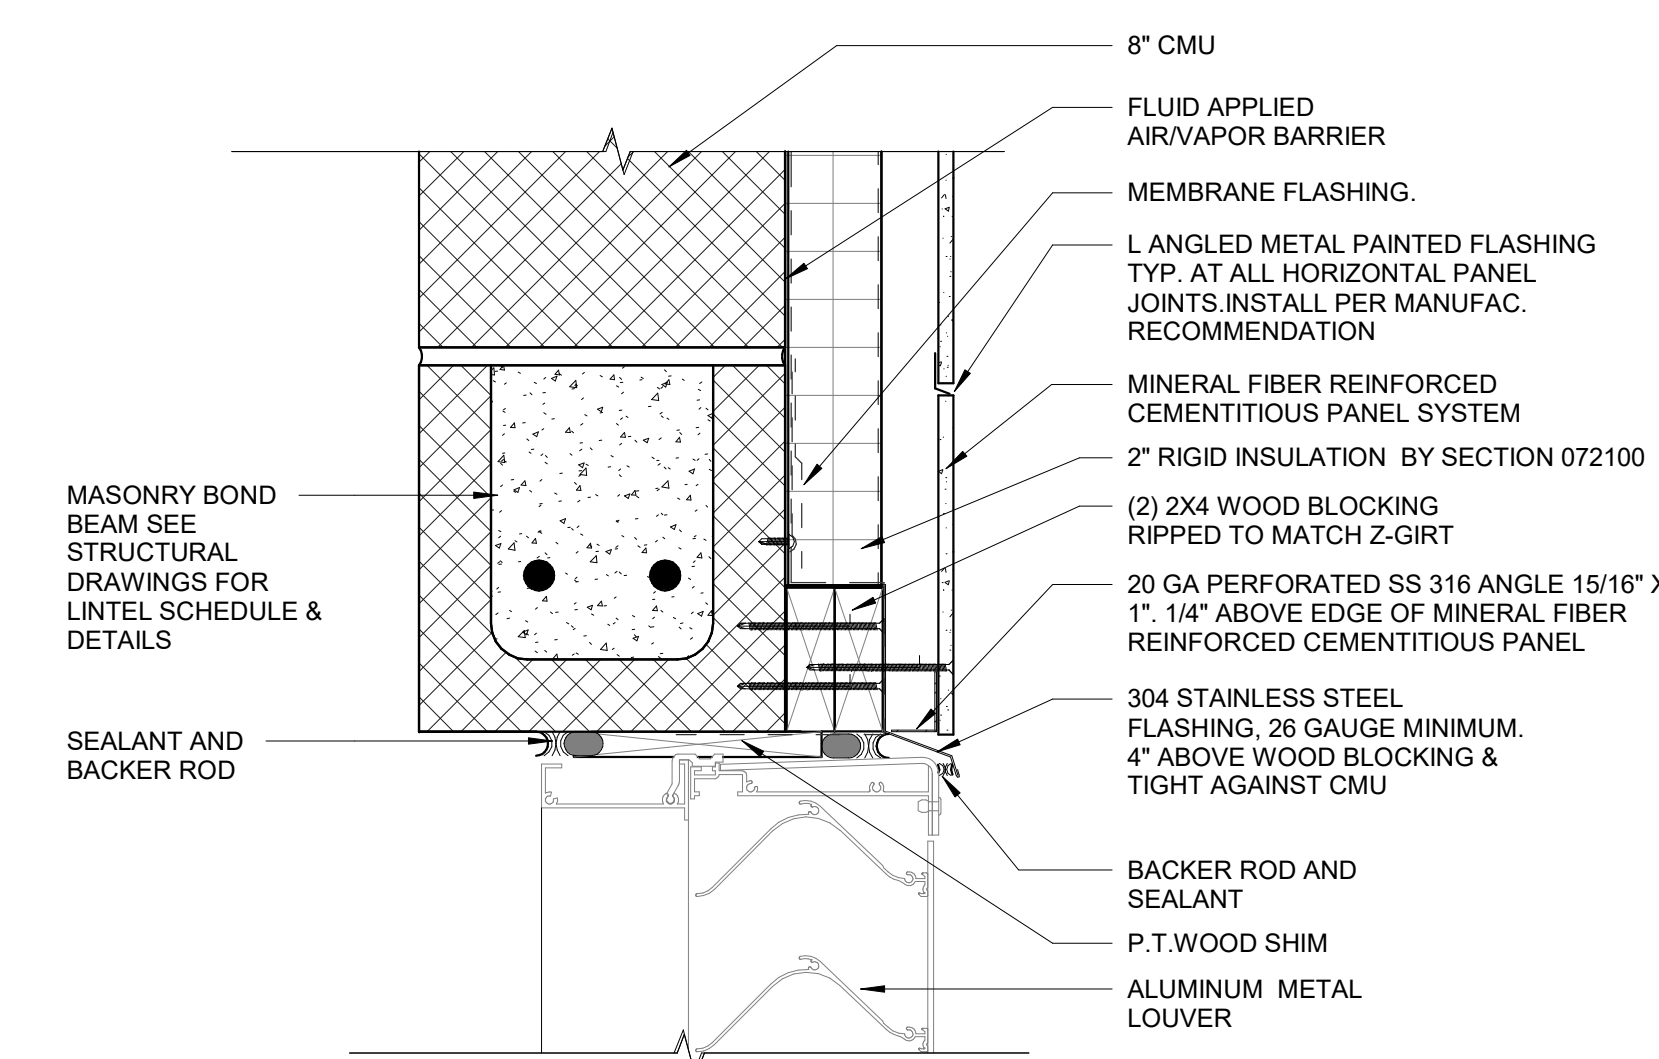


GENERAL NOTES:

1. REFER TO STRUCTURAL DRAWINGS FOR ALL MASONRY REINFORCEMENT REQUIREMENTS. COMPLETE REINFORCEMENT SCOPE IS NOT INDICATED, FOR CLARITY.
2. MASONRY TIES NOT INDICATED FOR CLARITY, REFER TO SPECIFICATIONS.


MSBA 90% CD
SUBMISSION

May 12TH, 2023

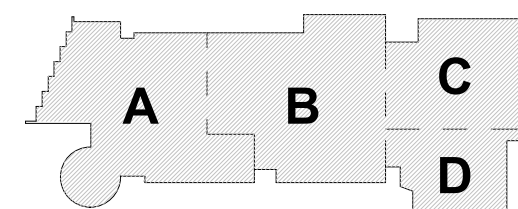

KEY PLAN

PROJECT NORTH MAGNETIC NORTH

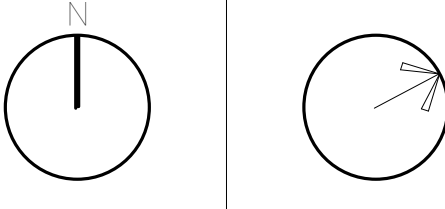

ENLARGED
DETAILS

Scale: As indicated

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

AC-1-3



DRA

Drumrey Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT 06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA 02453

Planning | Architecture | Interior Design

Northeast Metropolitan Regional Vocational High School

100 Hemlock Road, Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.30' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0".

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWB PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTES/DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.

13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.

17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.

ADD ALTERNATE SUBMISSION

MSBA 90% CD SUBMISSION

May 12TH, 2023

A B C D

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

LOCKER BUILDING PLANS

Scale: 1/8" = 1'-0"


Job No.: 20202

Drawn By: DRA


Date: May 12TH, 2023

Volume 3 of 4


AL-1-1

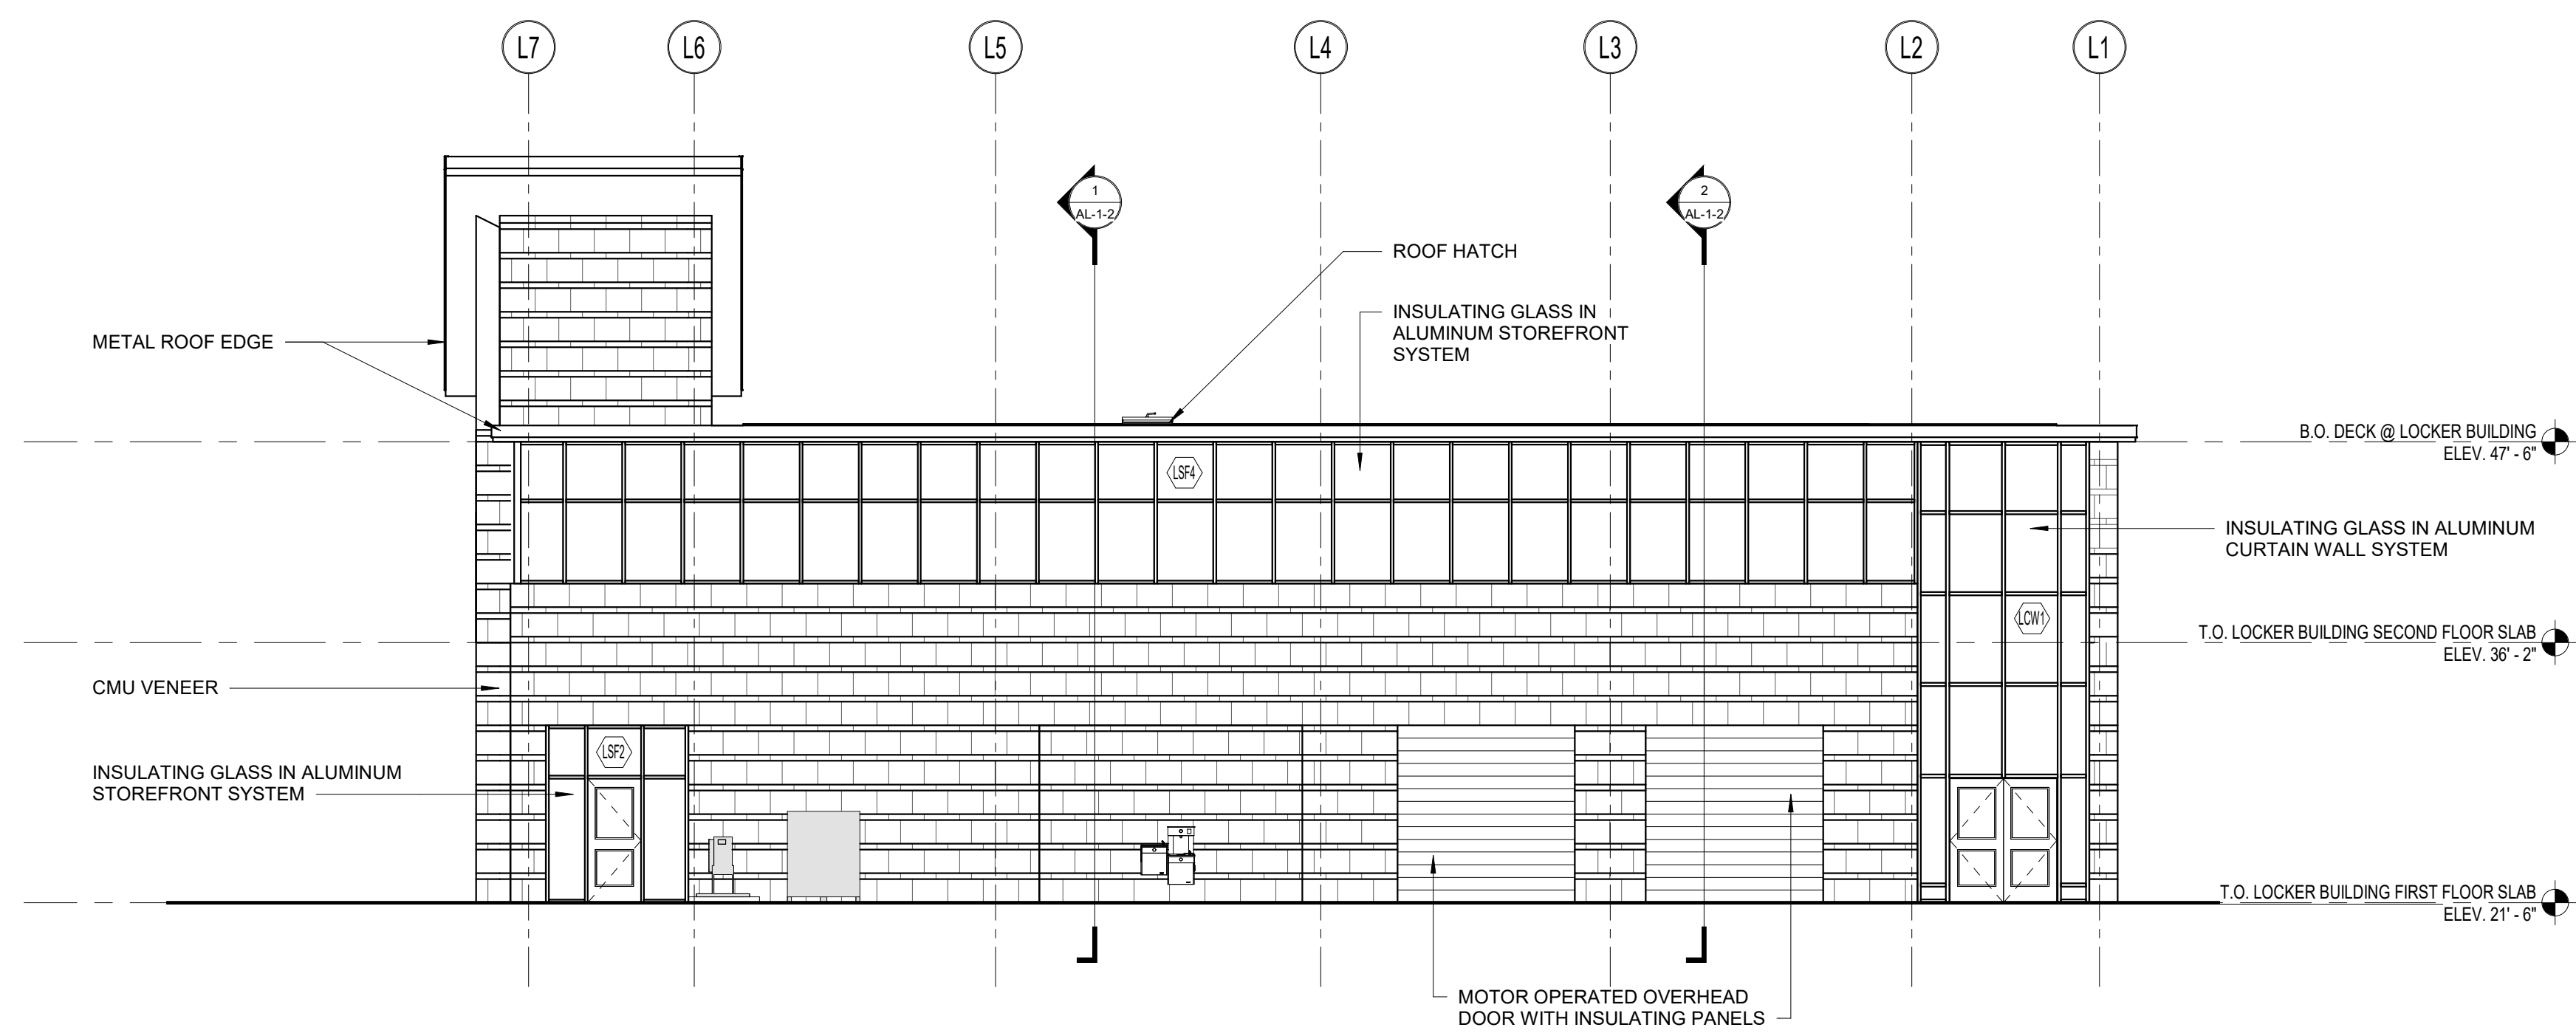


7 LOCKER BUILDING ELEVATION - NORTH
1/8" = 1'-0"

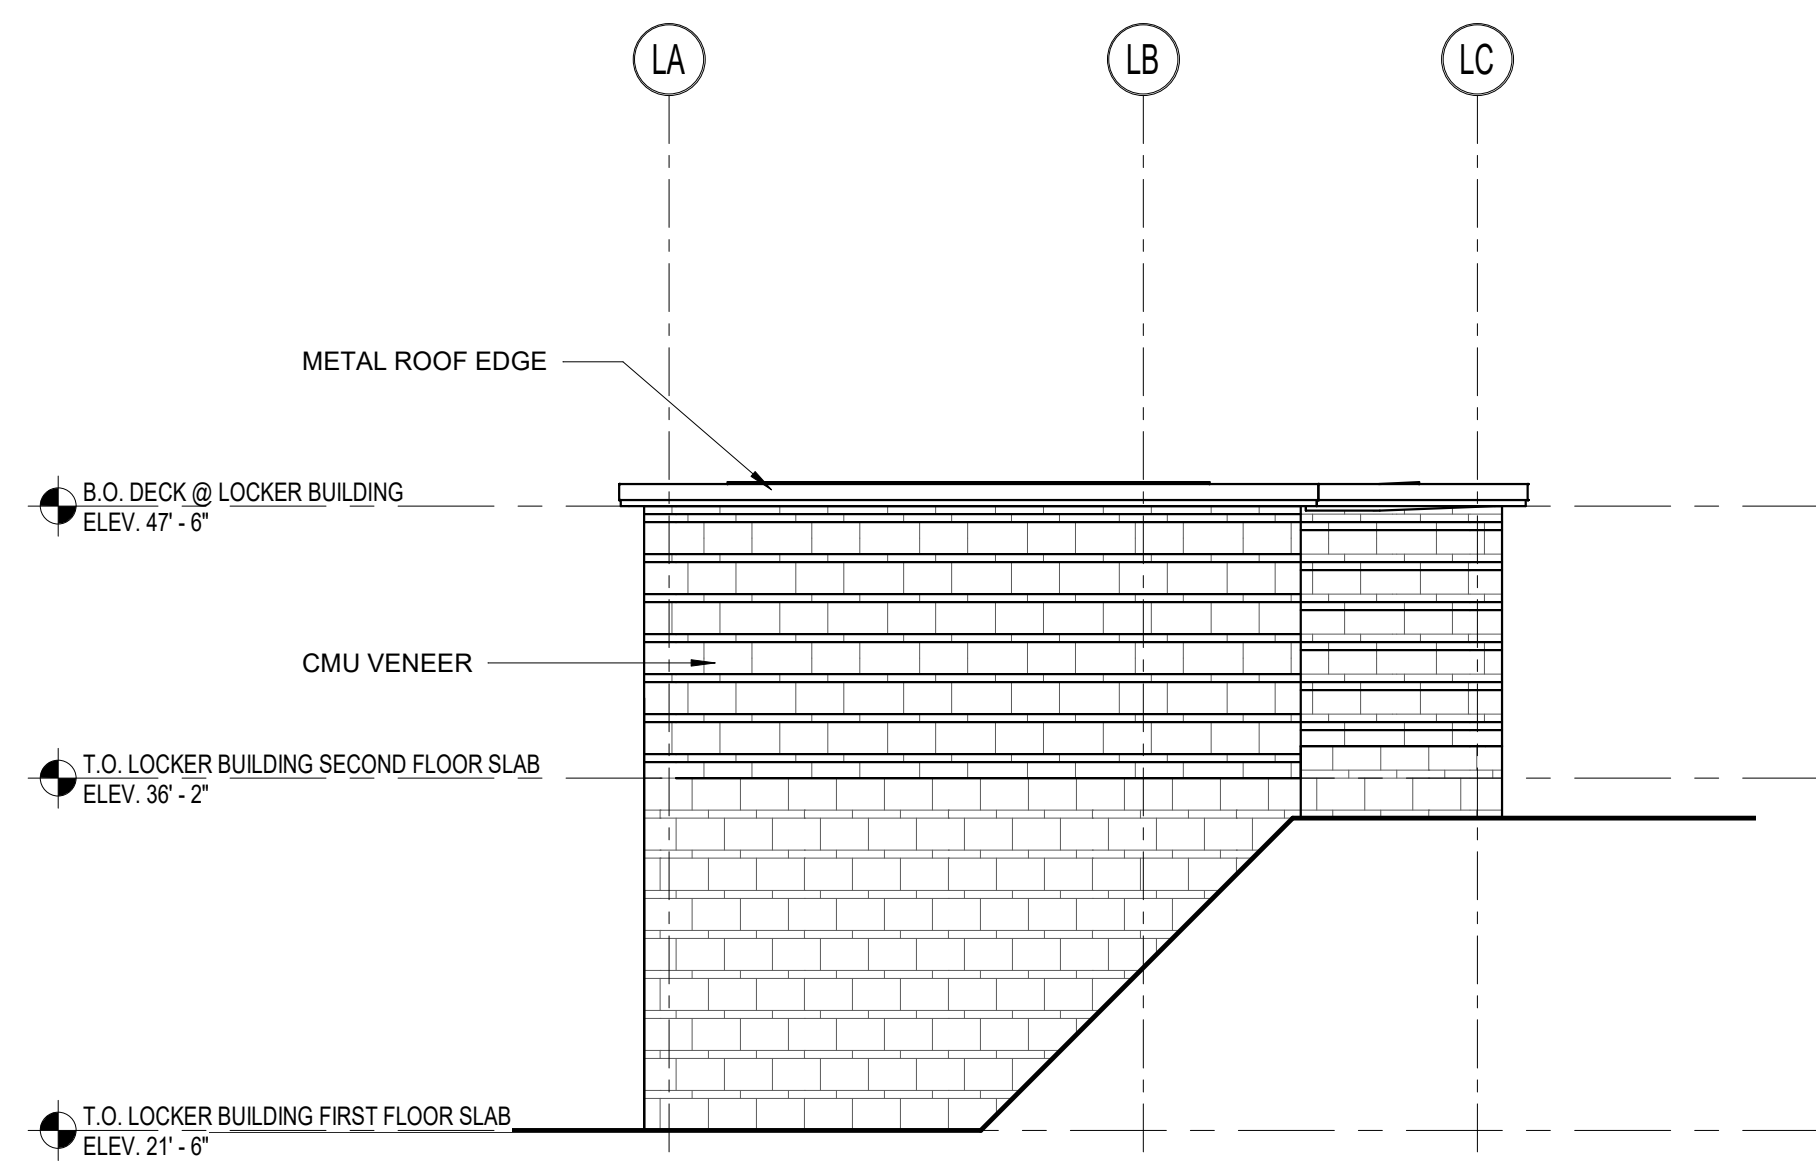


6 LOCKER BUILDING ELEVATION - WEST
1/8" = 1'-0"

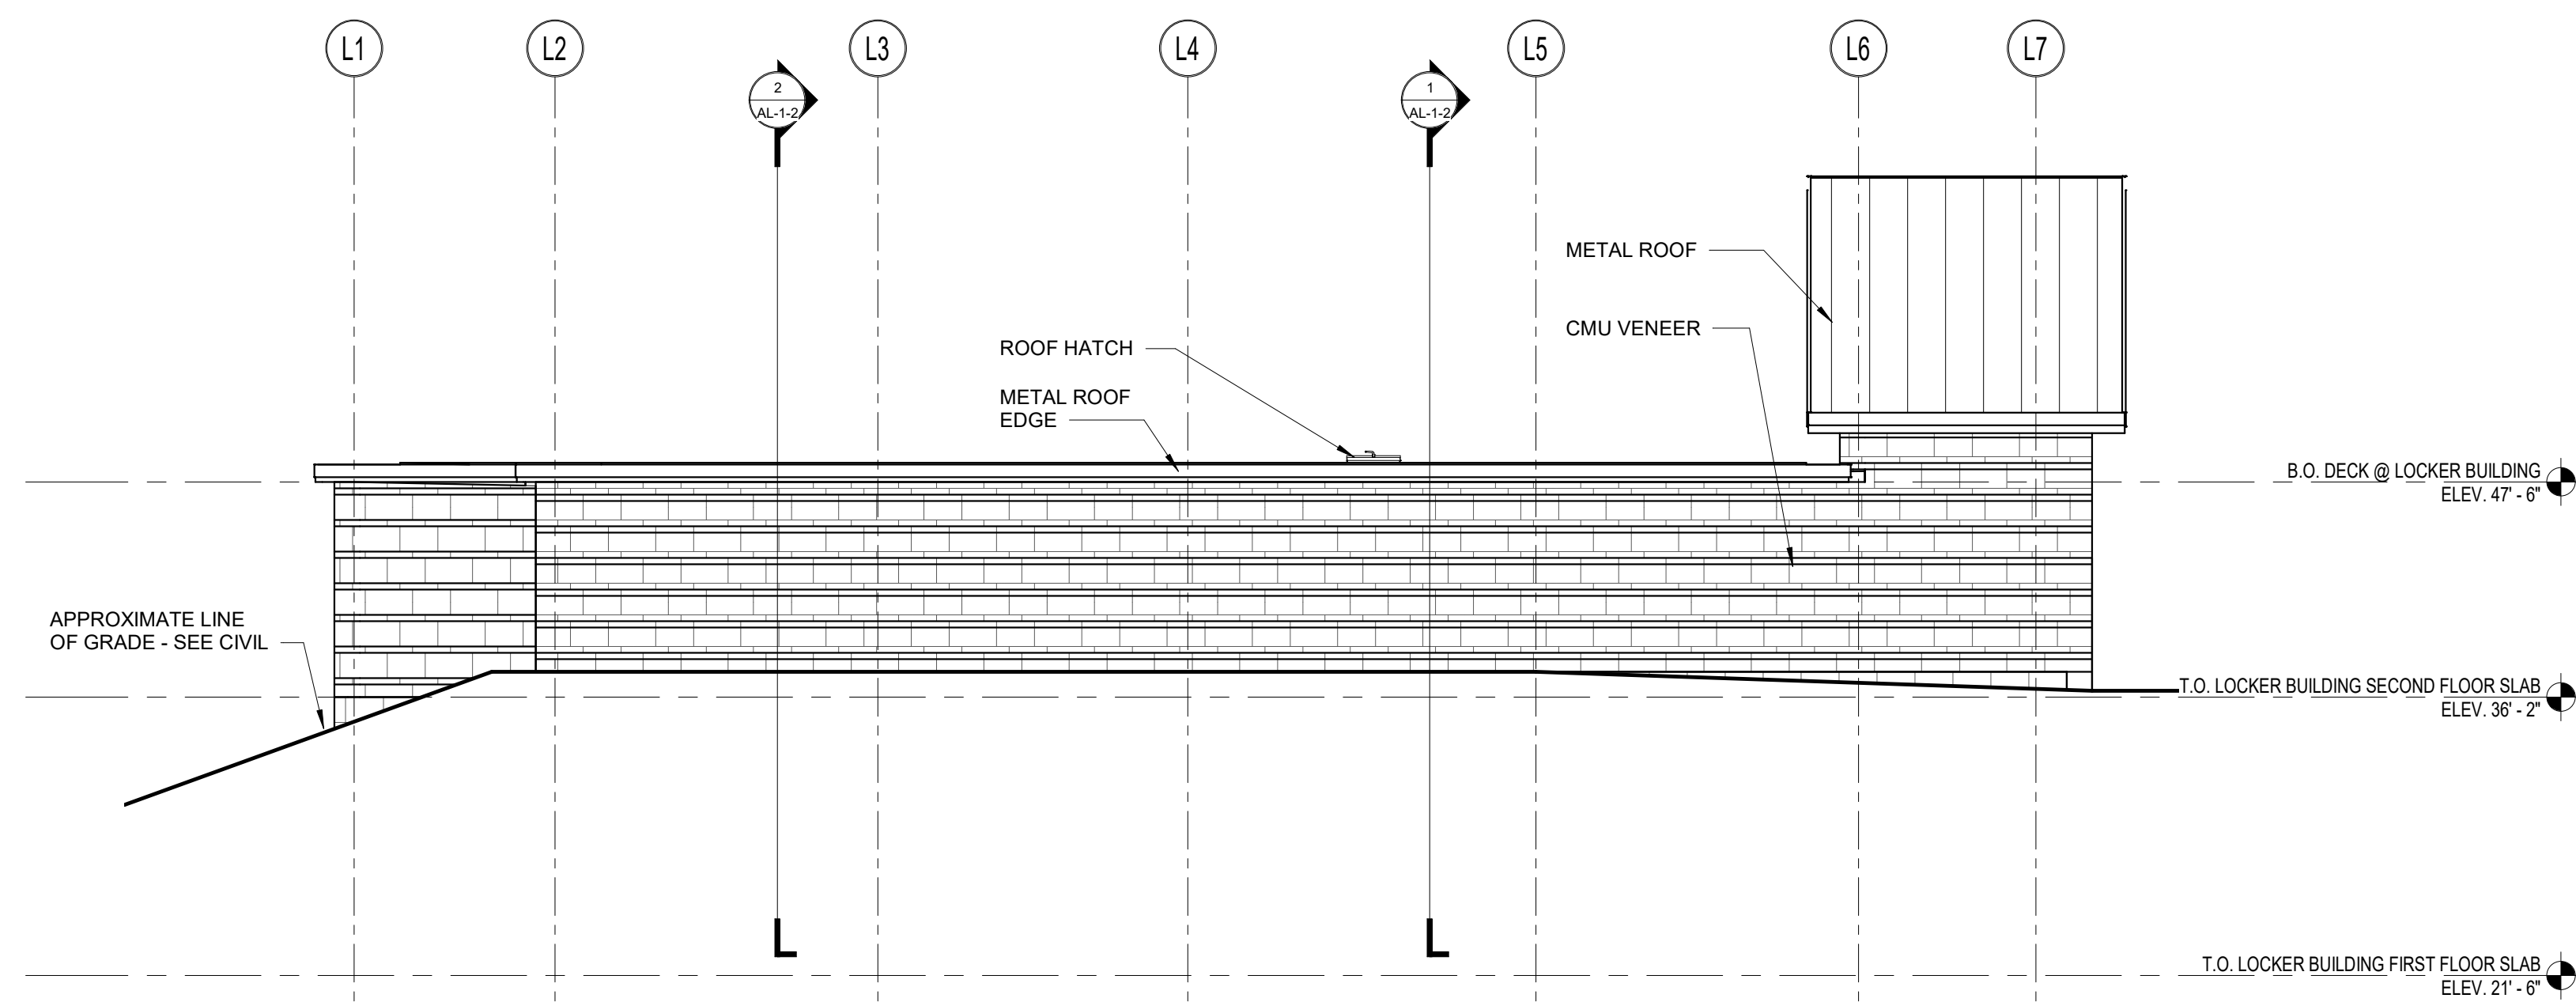


5 LOCKER BUILDING ELEVATION - SOUTH
1/8" = 1'-0"

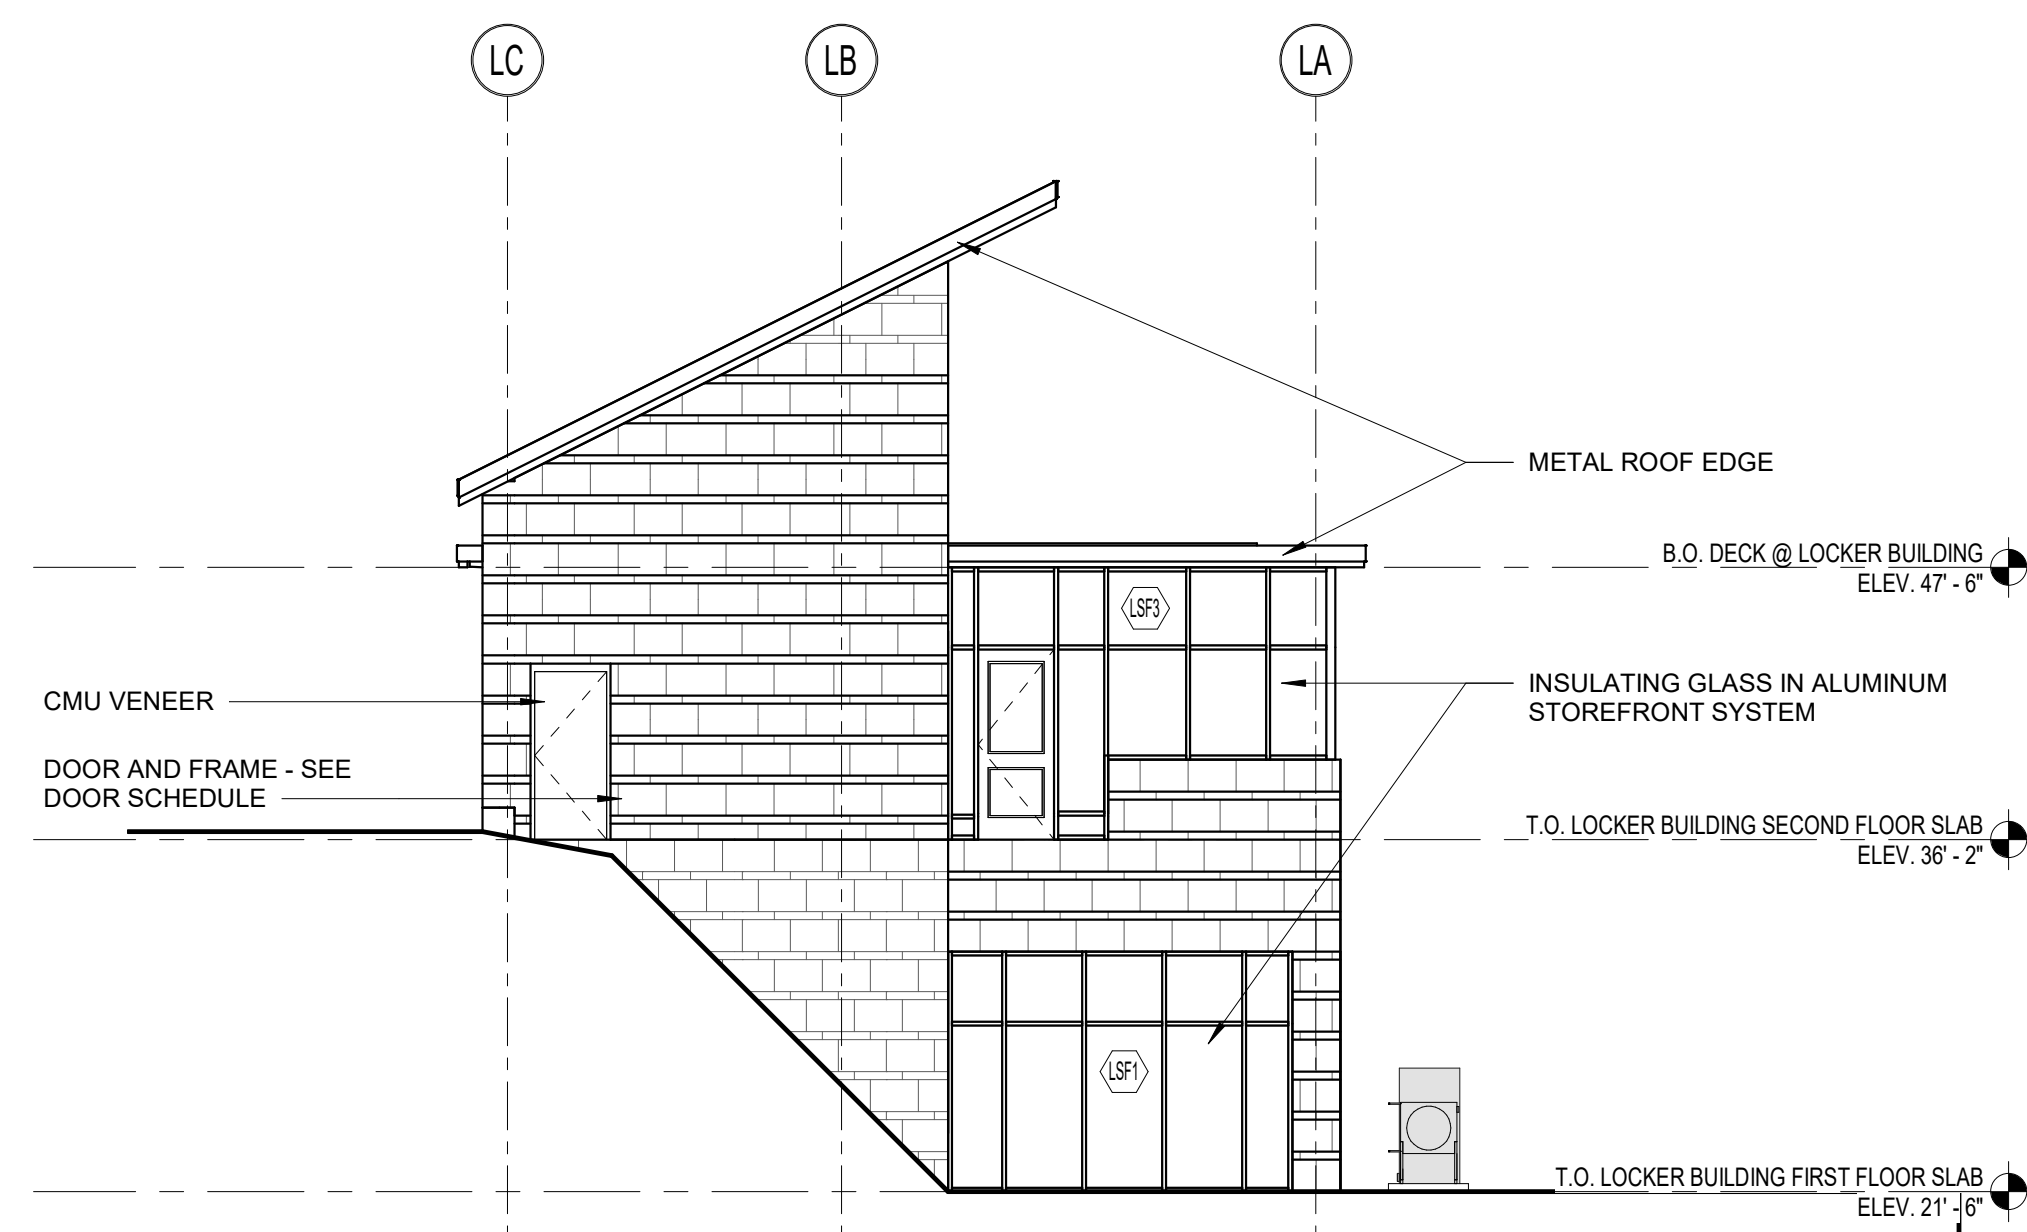

4 LOCKER BUILDING ELEVATION - EAST
1/8" = 1'-0"

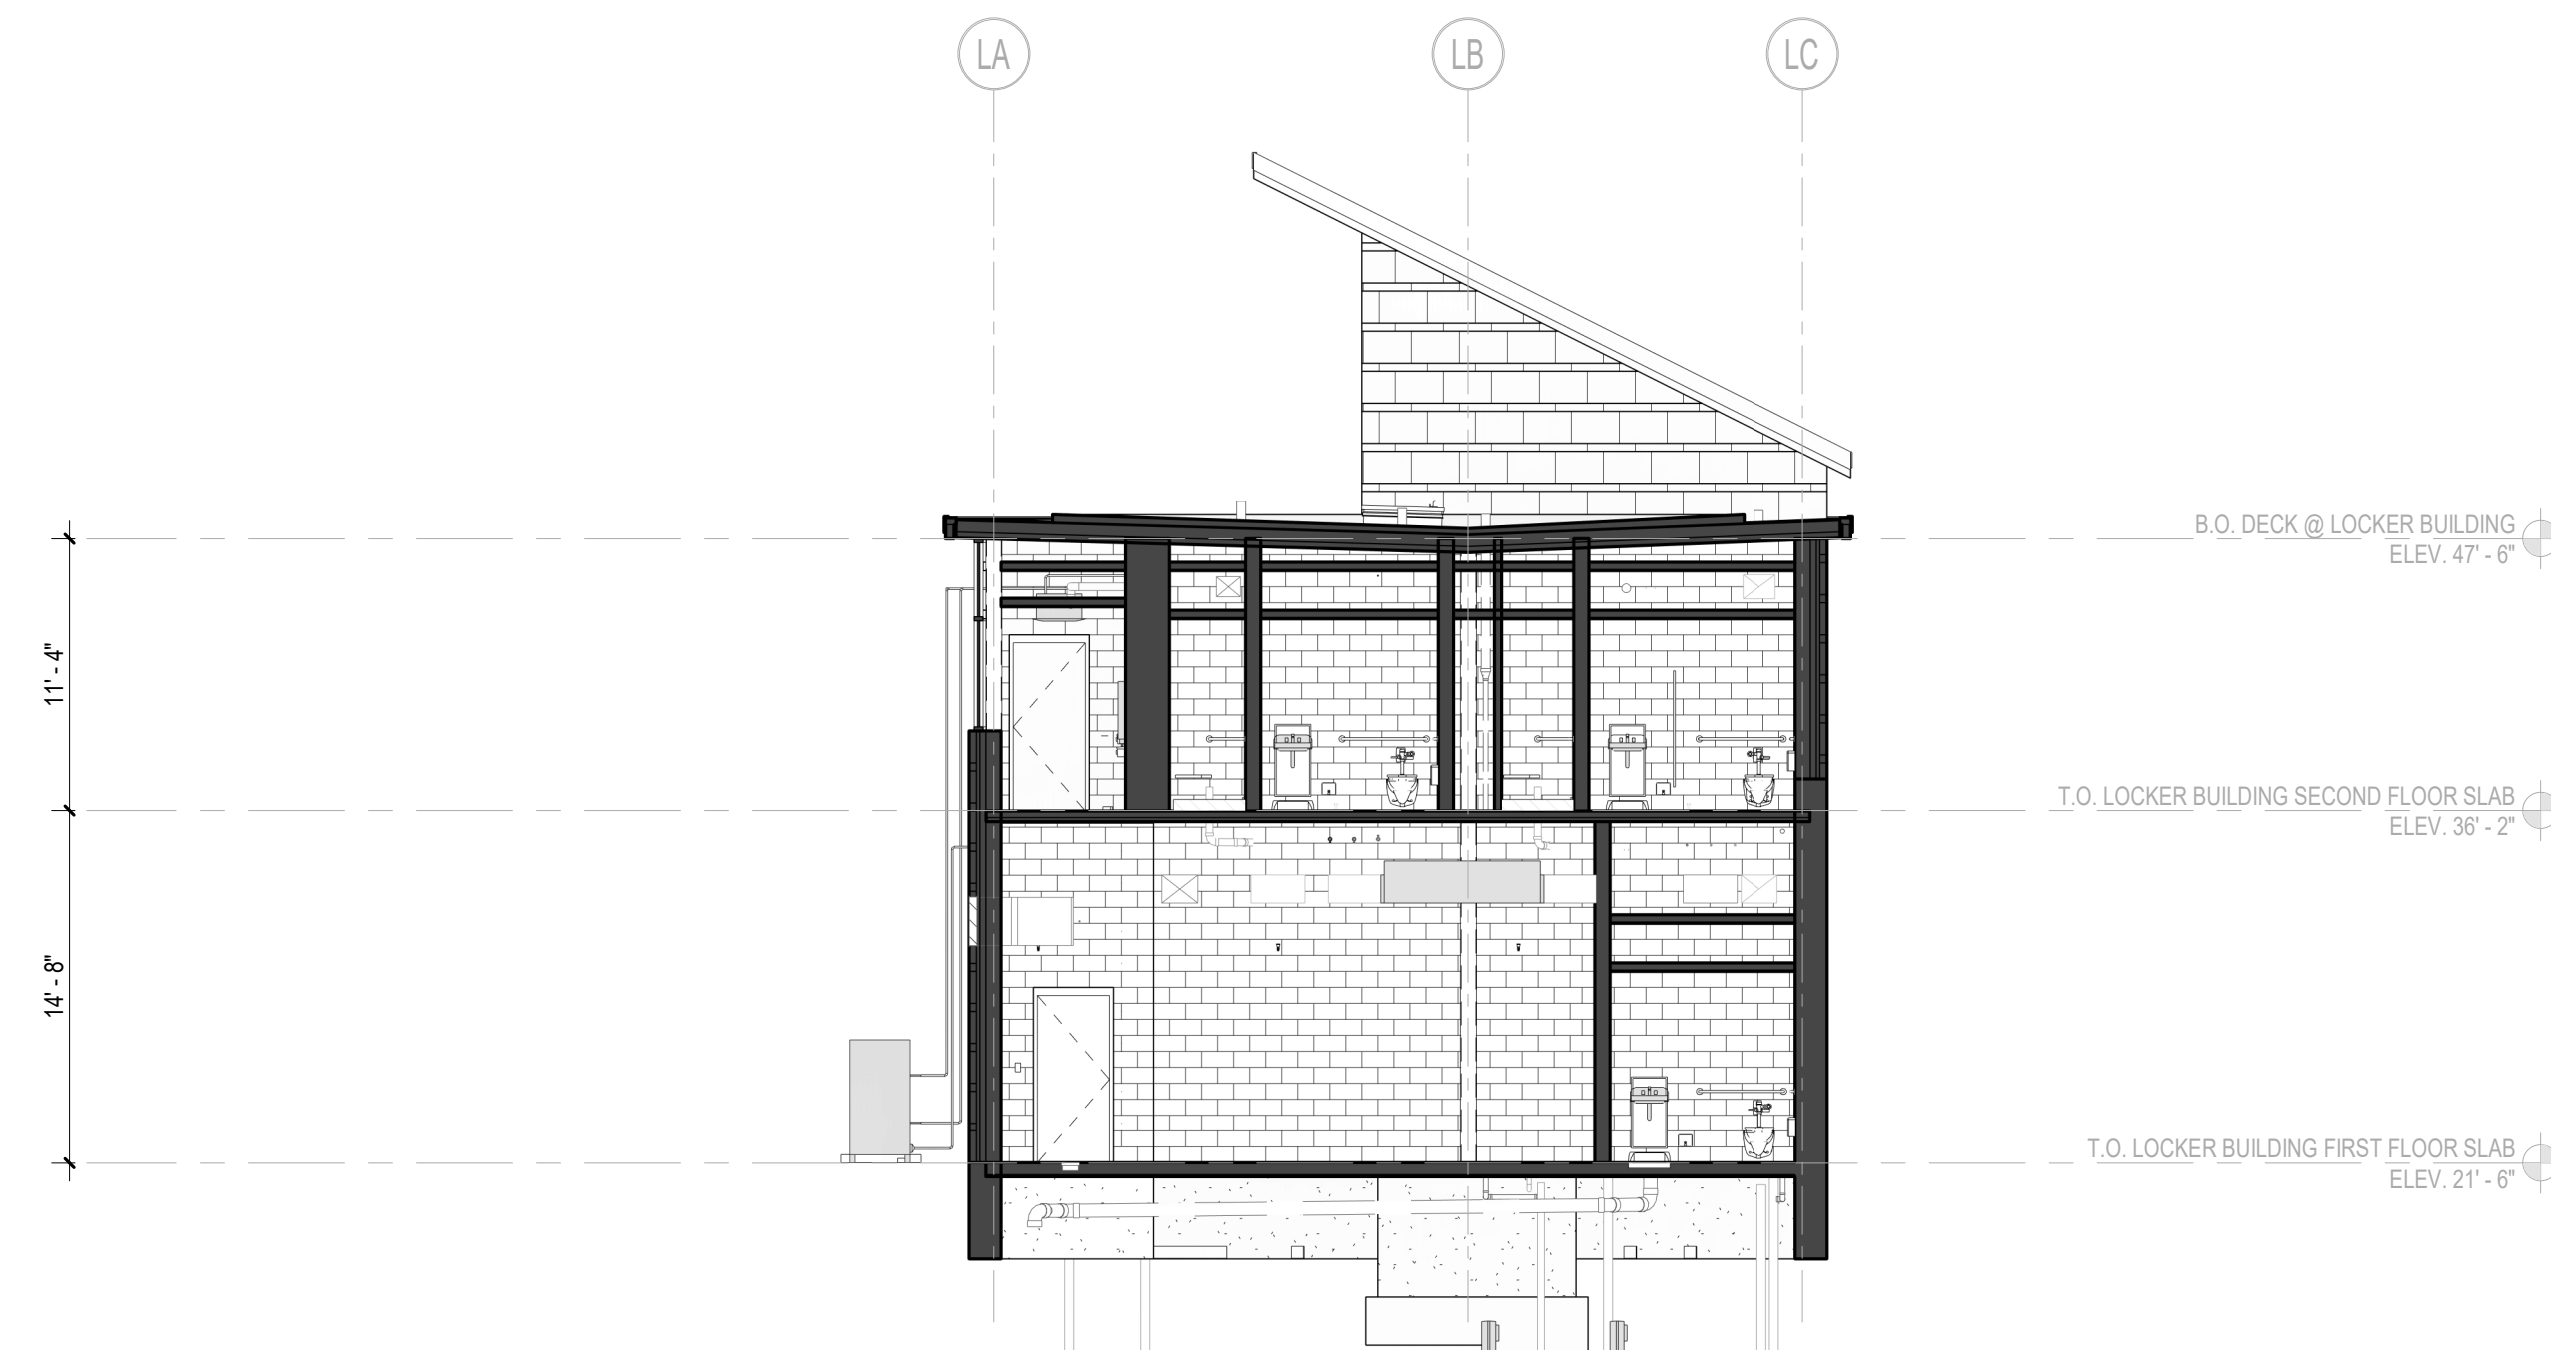

3 LOCKER BUILDING SECTION
1/8" = 1'-0"

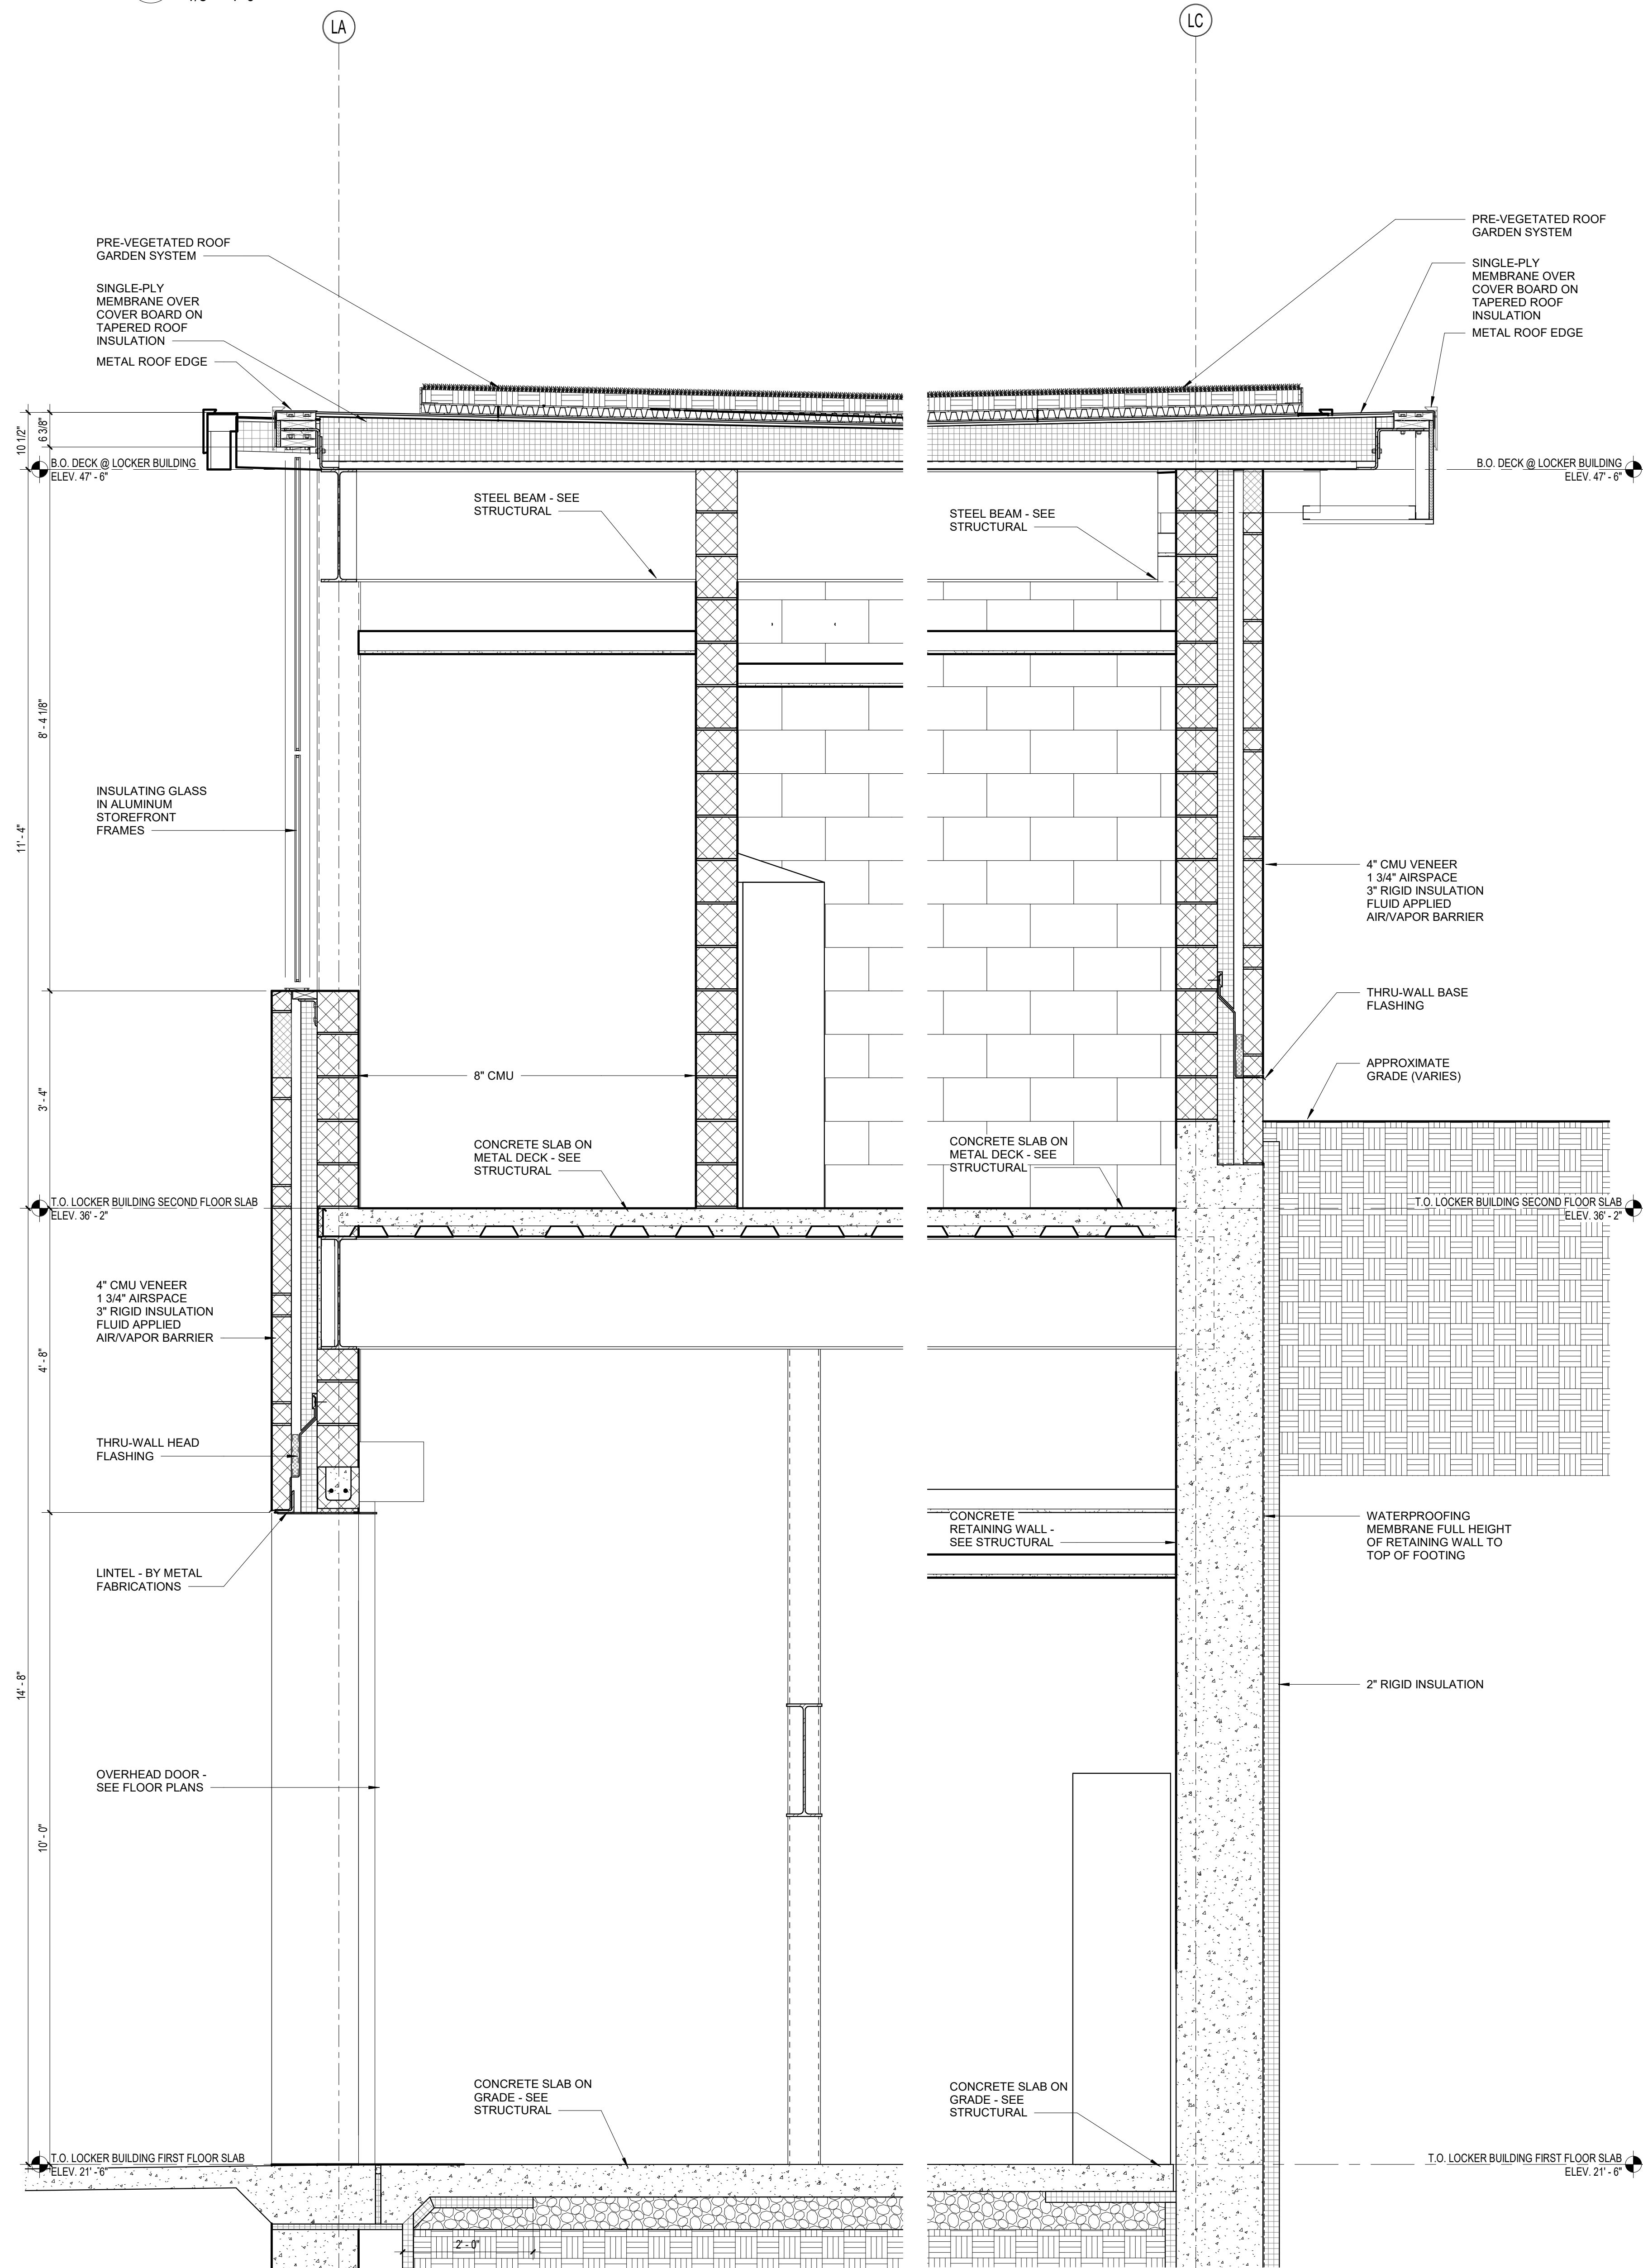

2 WALL SECTION - SATELLITE LOCKER BUILDING
3/4" = 1'-0"

1 WALL SECTION - SATELLITE LOCKER BUILDING
3/4" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 817.854.1700
www.dra.com

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

ADD ALTERNATE
MSBA 90% CD
SUBMISSION
May 12TH, 2023

A B C
D

KEY PLAN

PROJECT NORTH
MAGNETIC NORTH


LOCKER
BUILDING
ELEVATIONS &
SECTIONS

Scale: As indicated
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4


AL-1-2

LOCKER BUILDING DOOR SCHEDULE


DOOR NO.	TO	DOORS				SIZE				FRAMES						SADDLE			HARD WARE	REMARKS			
		NO.	NAME	NO.	NAME	WIDTH	HEIGHT	THICK.	TYPE	MAT.	LOUVER	TYPE	MAT.	JAMB DTL	HEAD DTL	FIRE RTNG	DETAIL	MAT.					
T.O. LOCKER BUILDING FIRST FLOOR SLAB																							
LR101		LR101	VEST			3'-0"	7'-0"	1 3/4"	AL2	ALUM		SF	ALUM					-	01				
LR102.1	LR102	TEAM ROOM				3'-0"	7'-0"	1 3/4"	F	MTL	1	MTL						-	15				
LR102.2	LR102	TEAM ROOM				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	21				
LR103	LR103	STOR				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	47				
LR104.1	LR104	FIELD MAINT. GARAGE & STO				3'-0"	7'-0"	1 3/4"	F	MTL	1	MTL						-	15				
LR104.2	LR104	FIELD MAINT. GARAGE & STO				10'-0"	10'-0"	3"	R	MTL	-	MTL						-	85				
LR104.3	LR104	FIELD MAINT. GARAGE & STO				10'-0"	10'-0"	3"	R	MTL	-	MTL						-	85				
LR105	LR104	FIELD MAINT. GARAGE & STO				3'-0"	7'-0"	1 3/4"	F	MTL	1	MTL						-	35				
LR3.1	LR3	ELEV				3'-0"	7'-6"	1 1/8"	F	MTL	1	MTL						-	86				
LR8.1	LR8	STAIR				3'-0"	3'-0"	1 3/4"	AL2	ALUM		CW	ALUM					-	08				
T.O. LOCKER BUILDING SECOND FLOOR SLAB																							
LR201	LR201	VEST				3'-2"	7'-11"	1 3/4"	AL2	ALUM		SF	ALUM					-	01				
LR202	LR201	VEST				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	21				
LR203	LR203	TEAM ROOM				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	22				
LR204	LR204	COACH/OFFICIAL				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	35				
LR205	LR205	COACH/OFFICIAL				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	35				
LR206	LR202	Corridor				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	22				
LR209	LR209	ELEV MACH				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	51				
LR3.2	LR208	TLT / SHOWER				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	57				
LR81.2	LR81	STAIR				3'-0"	7'-0"	1 3/4"	F	WD	1	MTL						-	51				

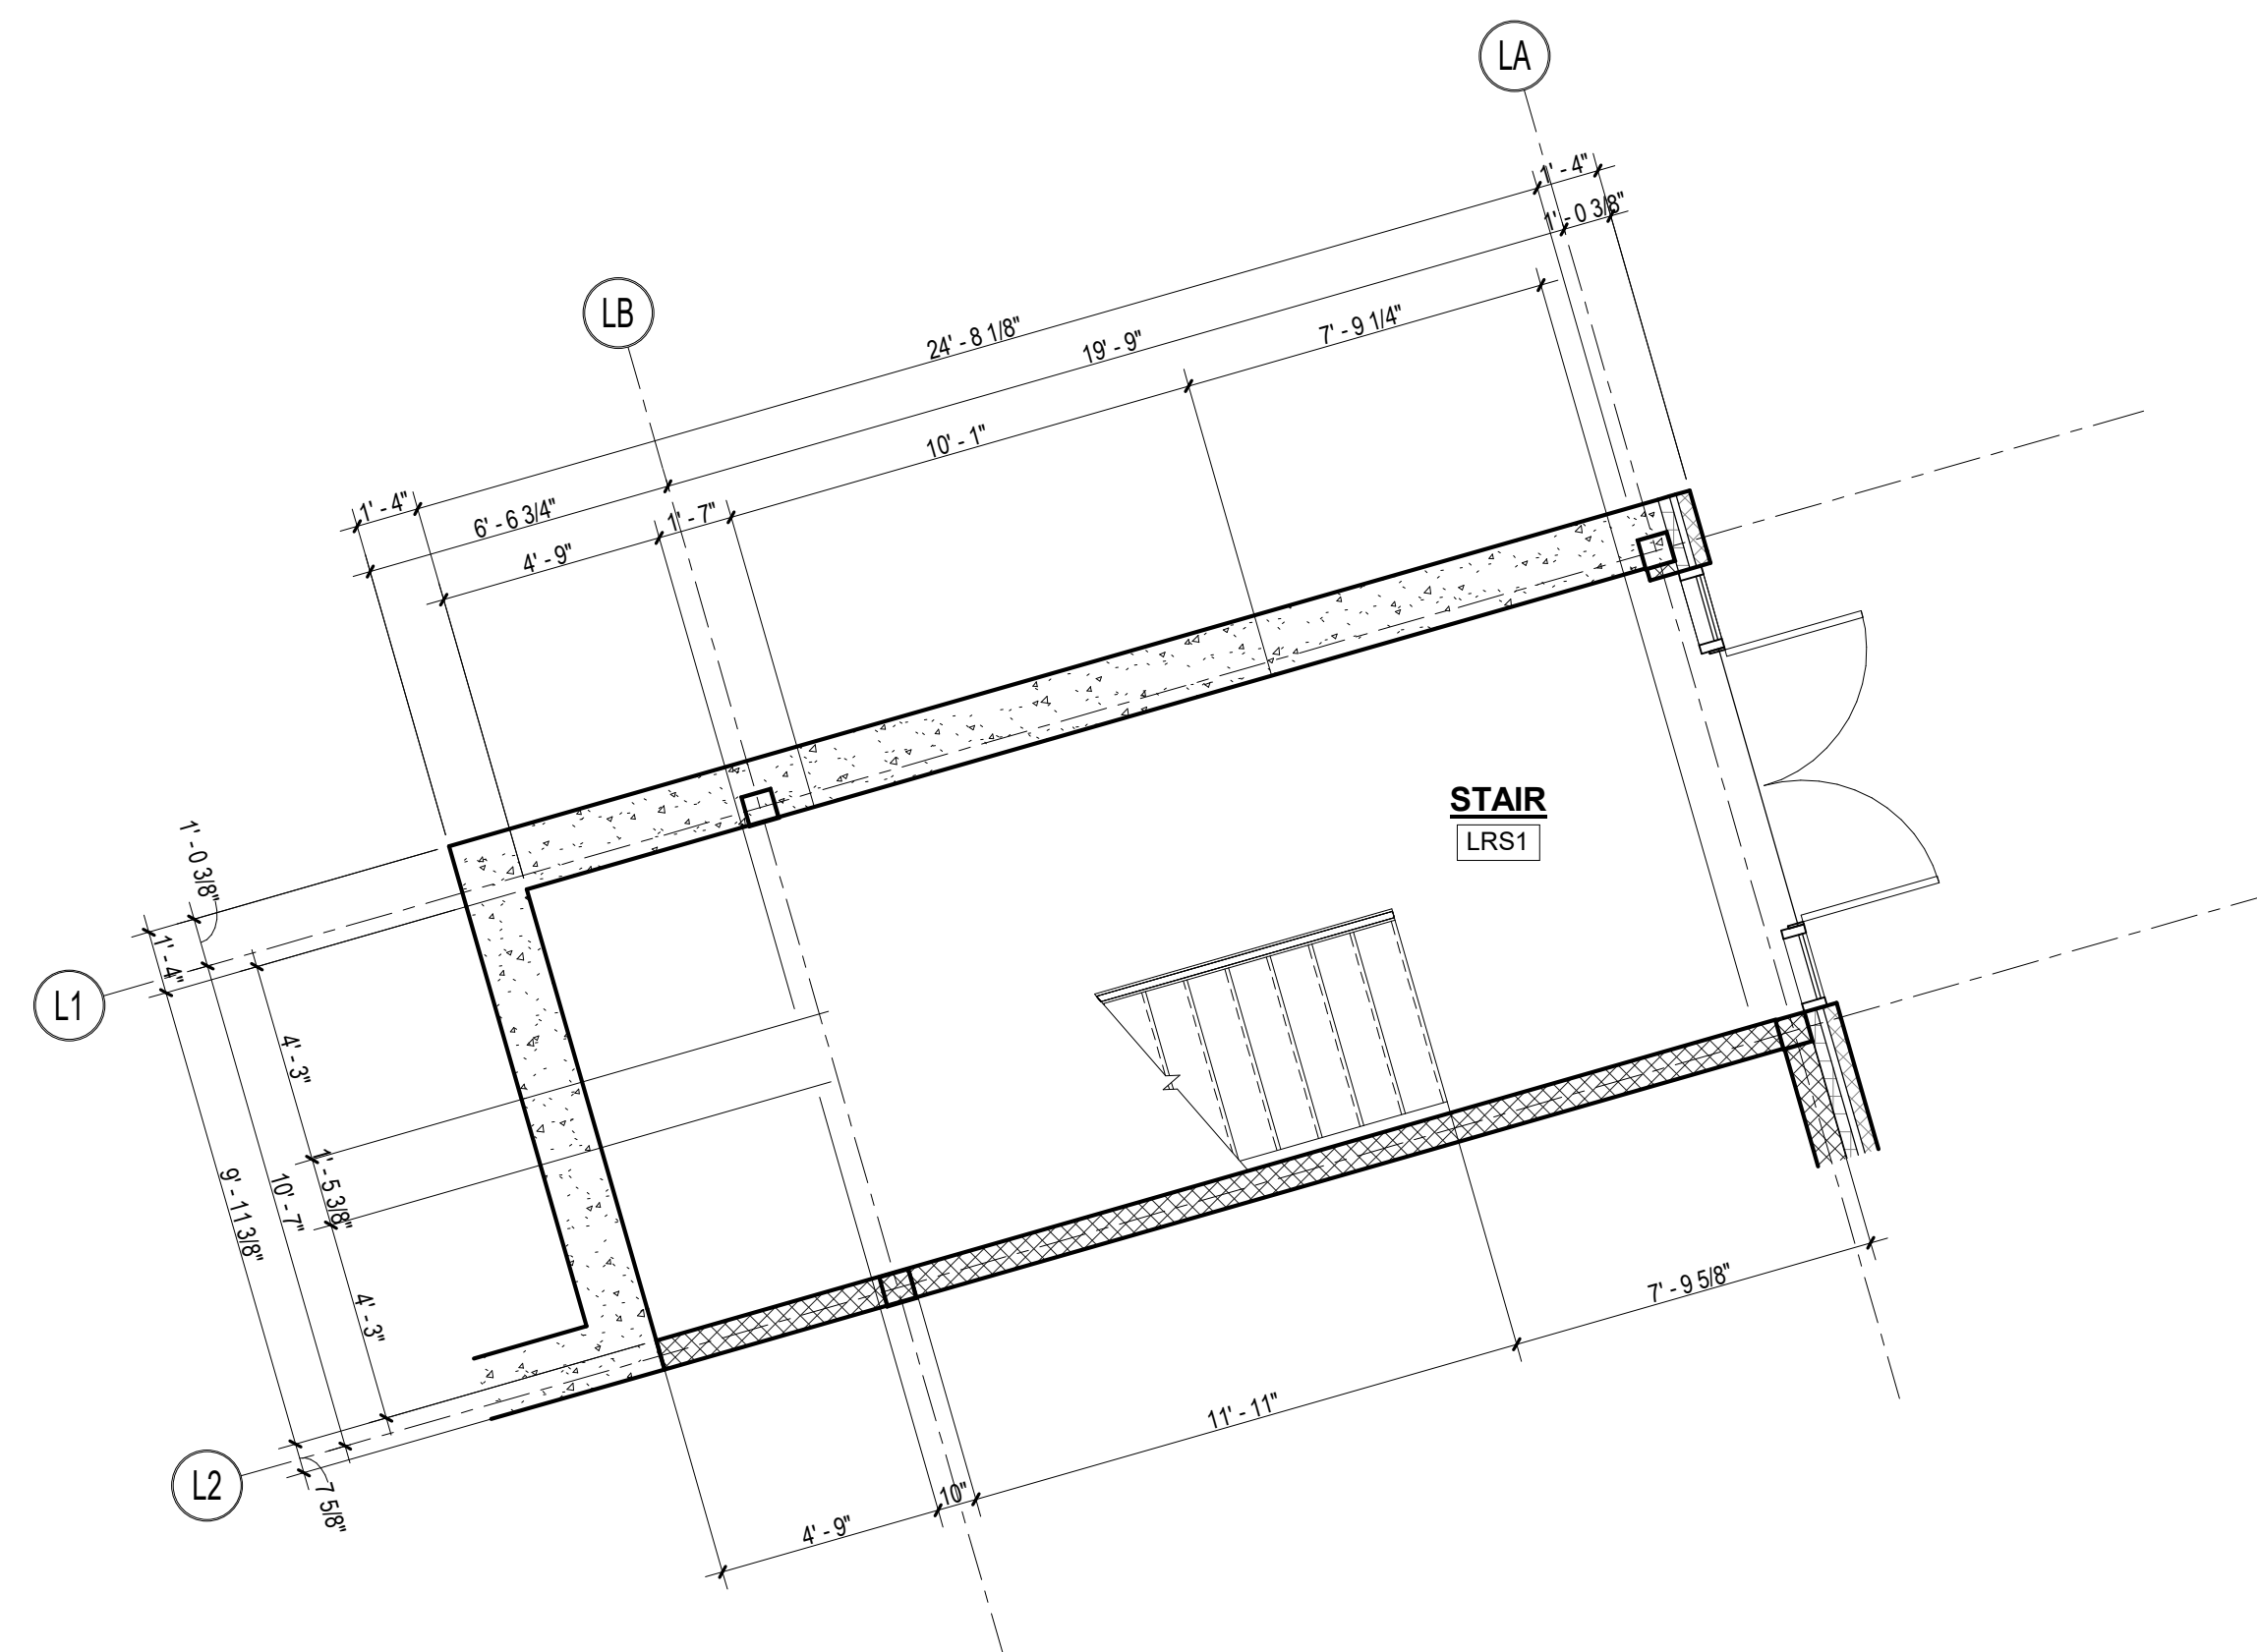


1 STAIR PLAN - LOCKER BUILDING FIRST FLOOR
1/4" = 1'-0"

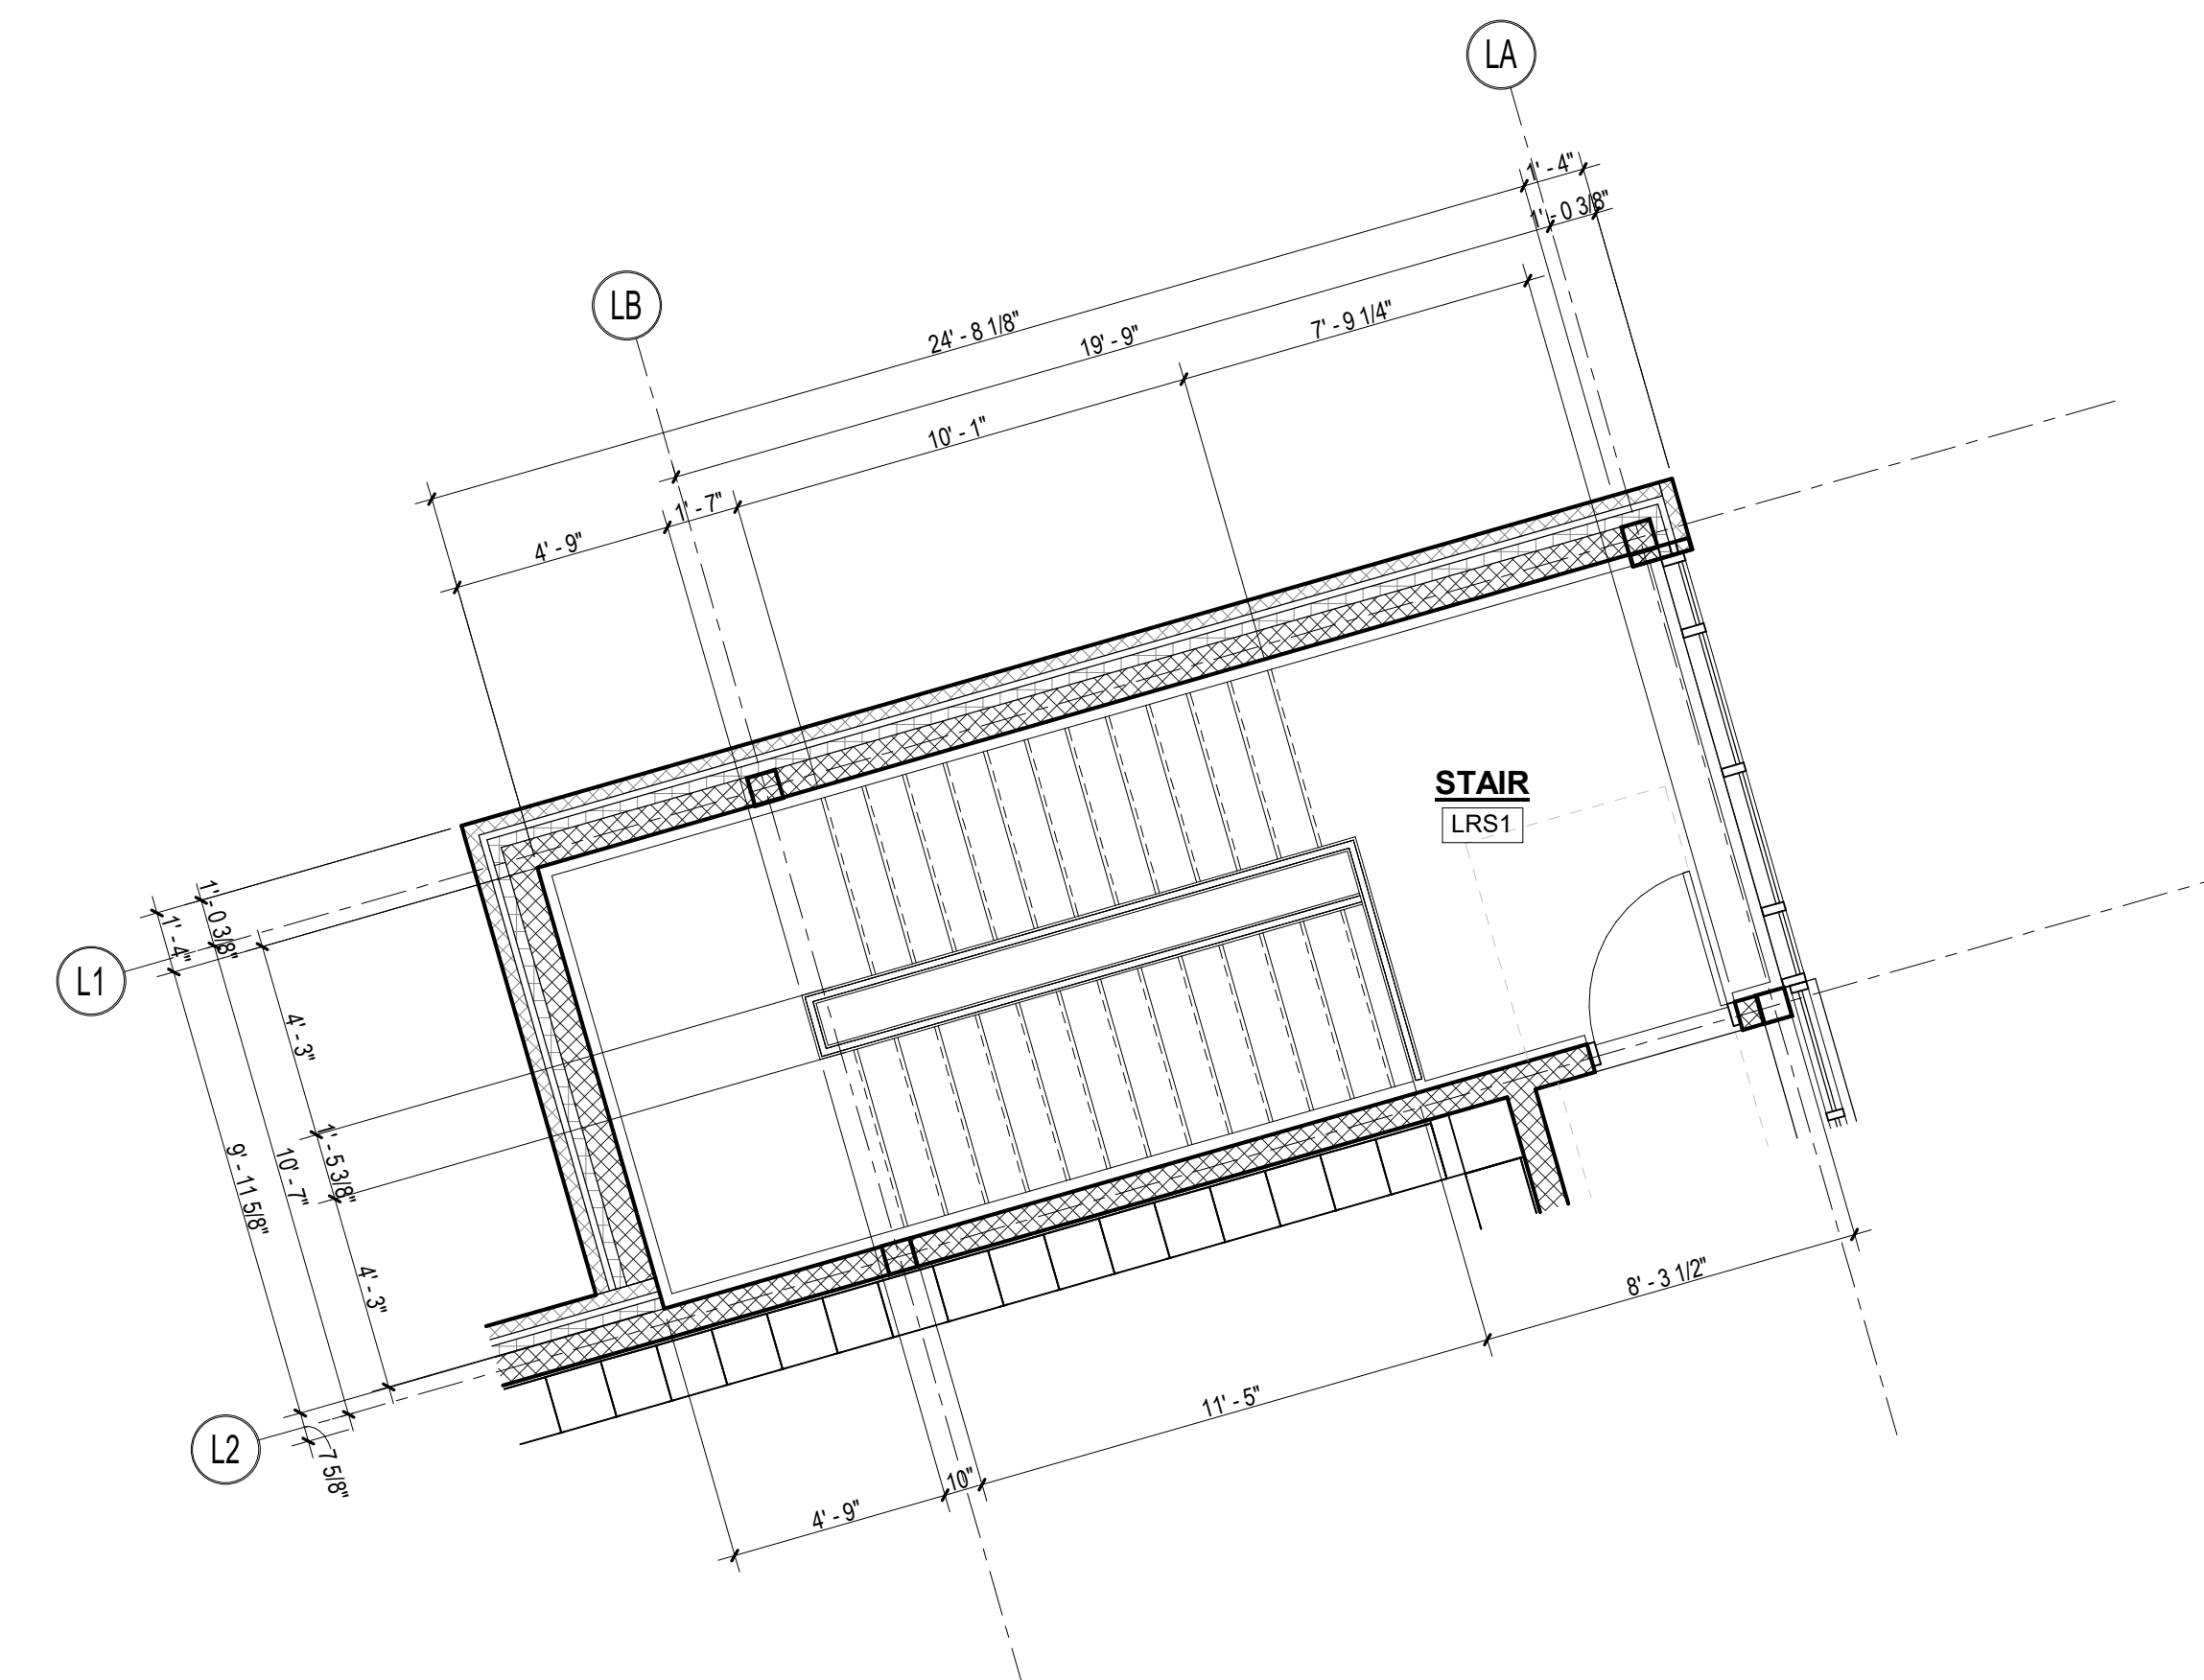

2 STAIR PLAN - LOCKER BUILDING SECOND FLOOR
1/4" = 1'-0"

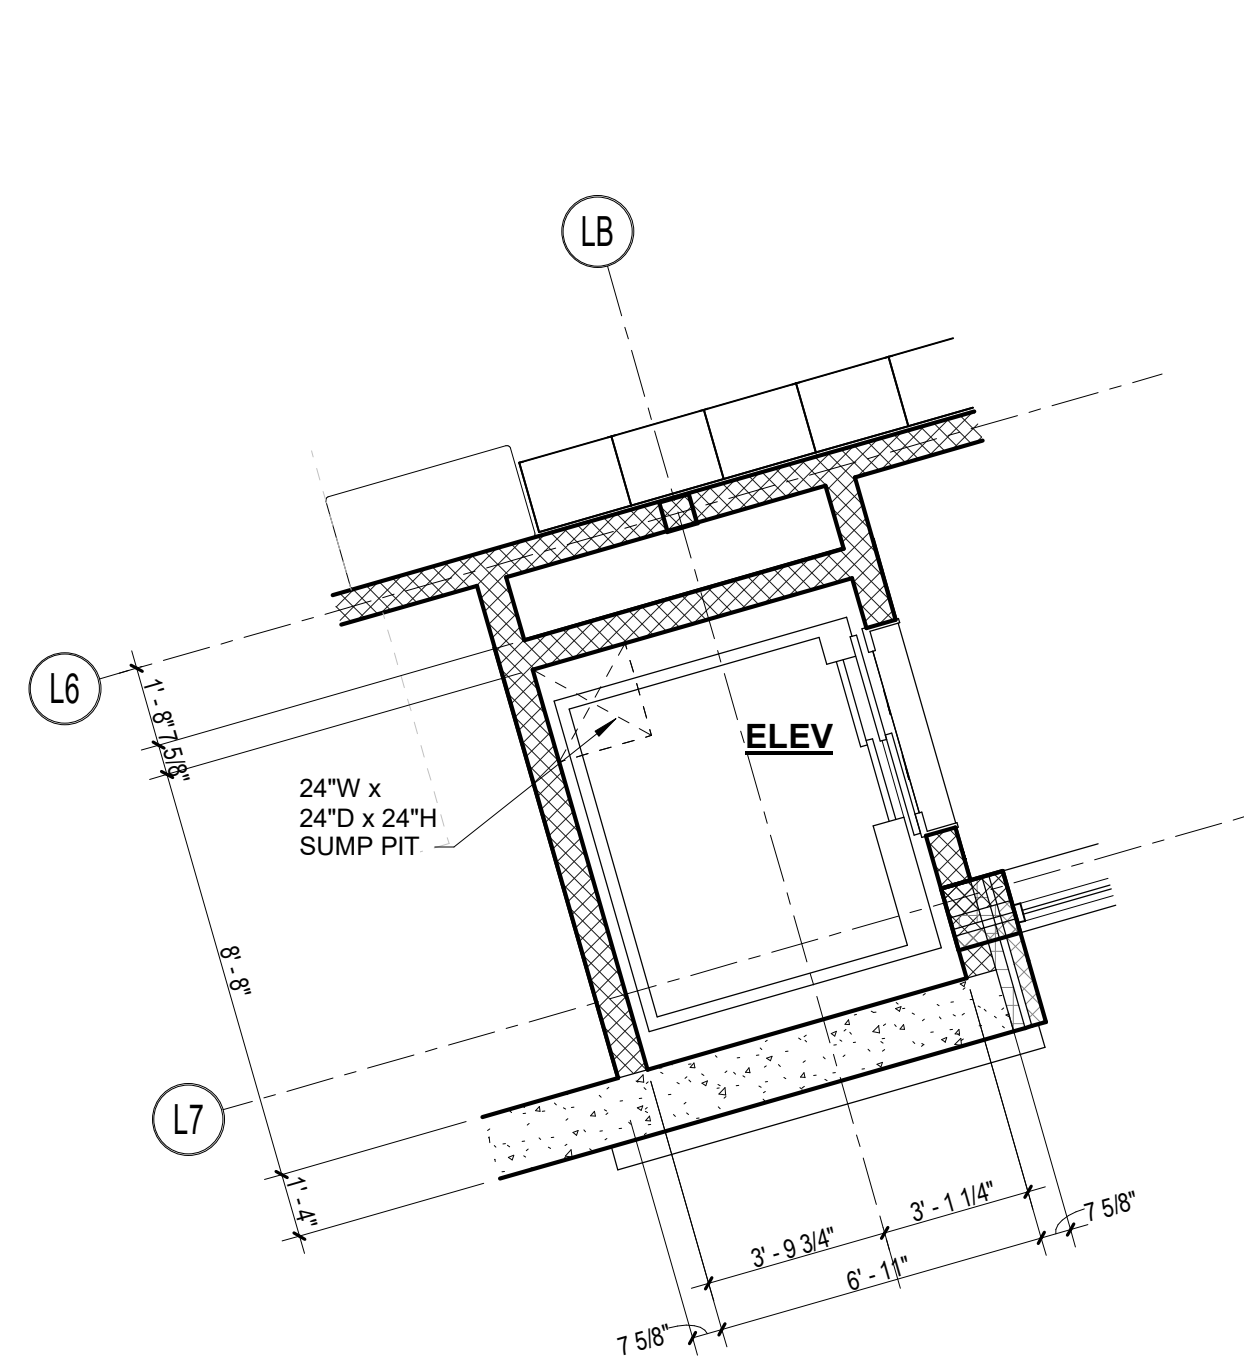


3 ELEVATOR PLAN - LOCKER BUILDING FIRST FLOOR
1/4" = 1'-0"

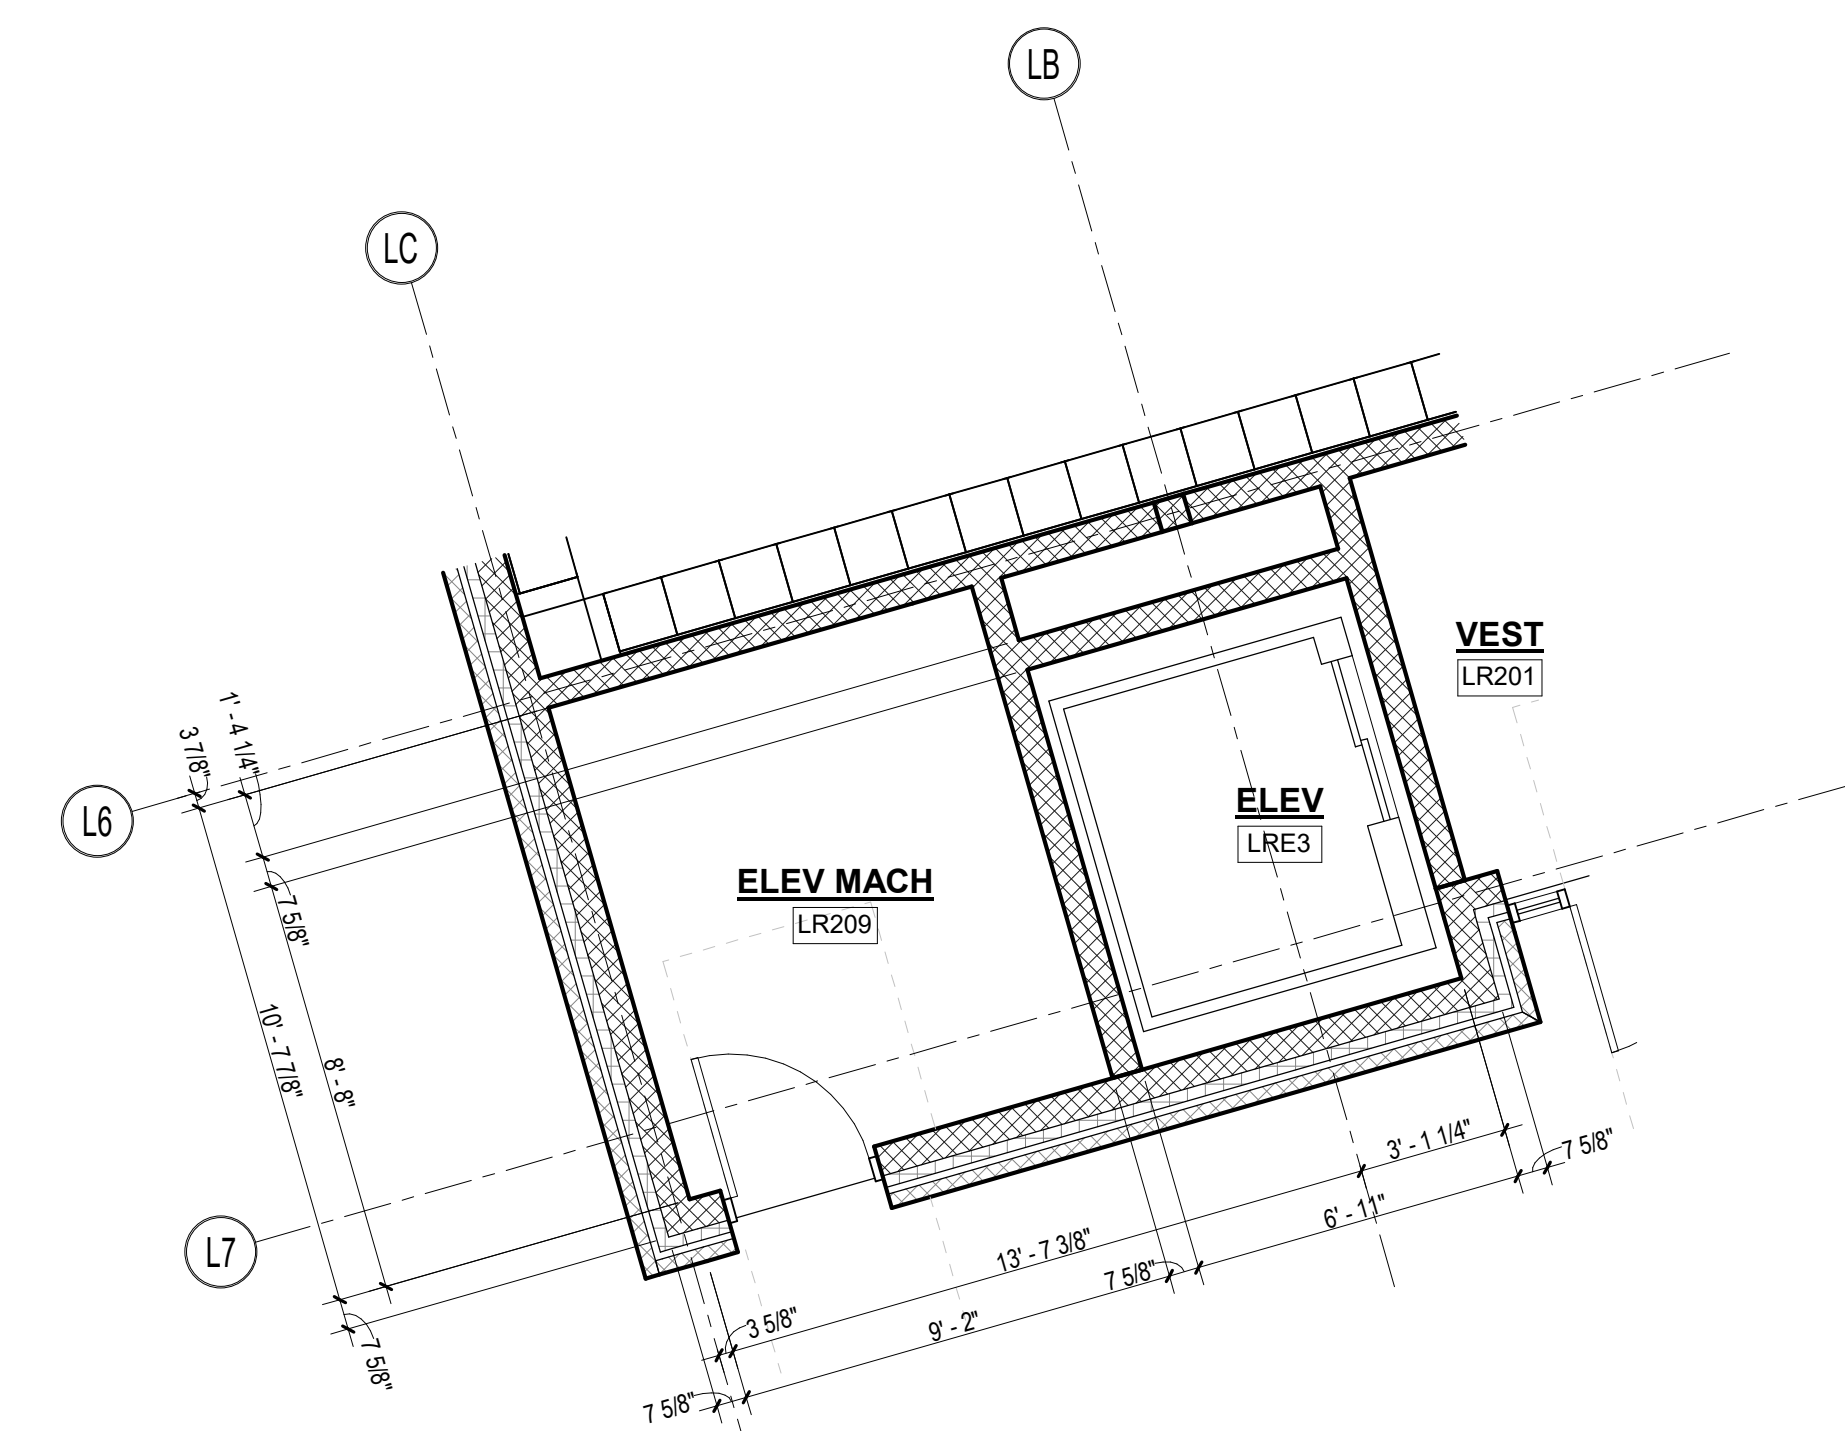

4 ELEVATOR PLAN - LOCKER BUILDING SECOND FLOOR
1/4" = 1'-0"

MSBA 90% CD
SUBMISSION


May 12TH, 2023

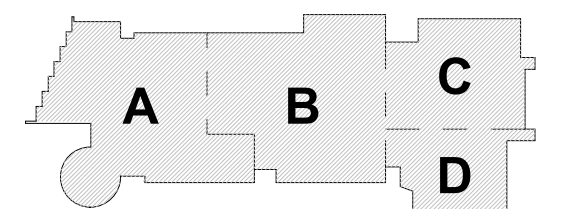

KEY PLAN

PROJECT NORTH

MAGNETIC NORTH

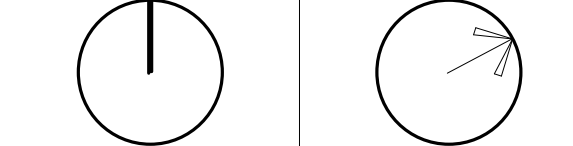

**LOCKER
BUILDING STAIR
& ELEVATOR
DRAWINGS**

Scale: 1/4" = 1'-0"






Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4

AL-1-3

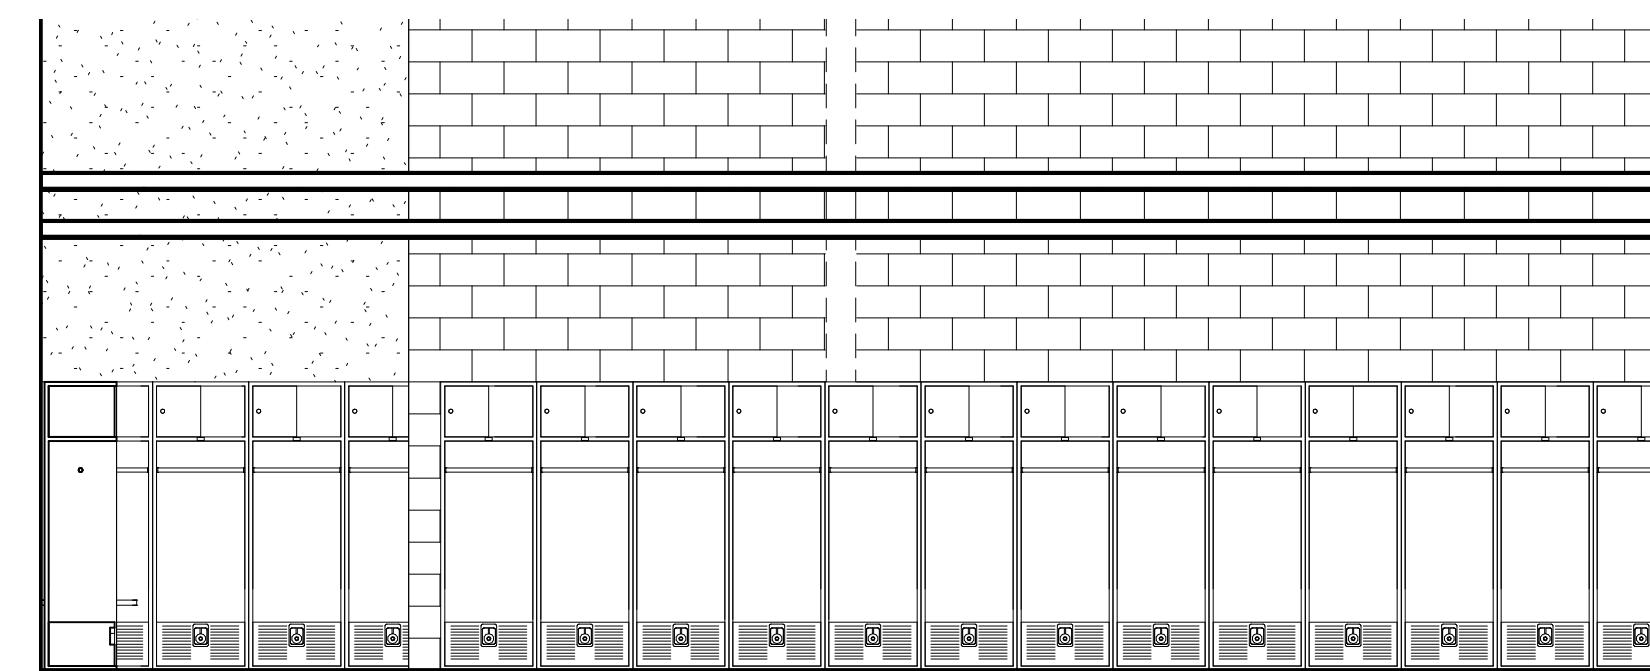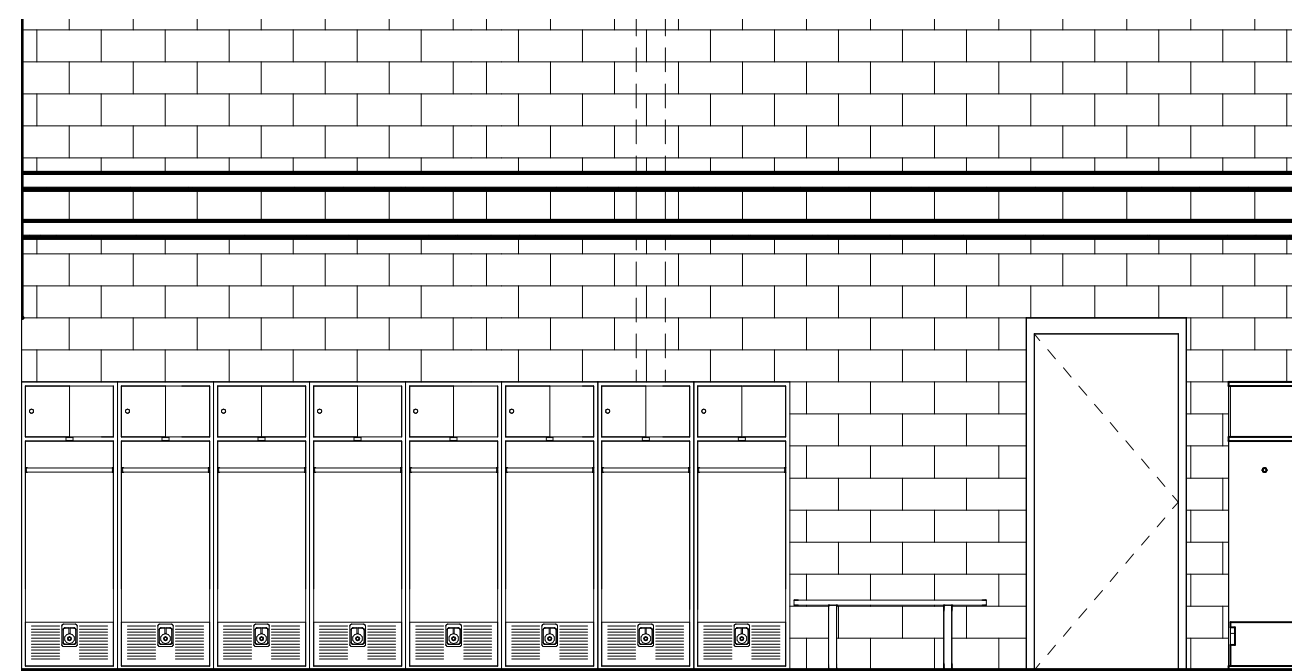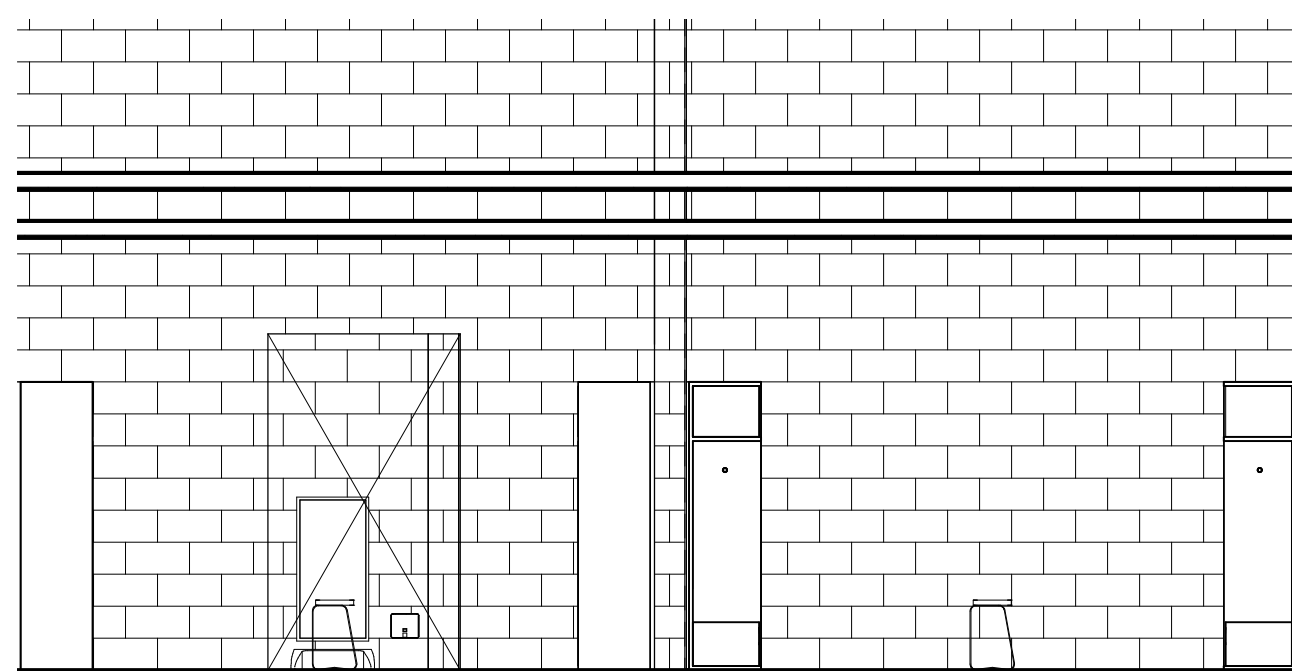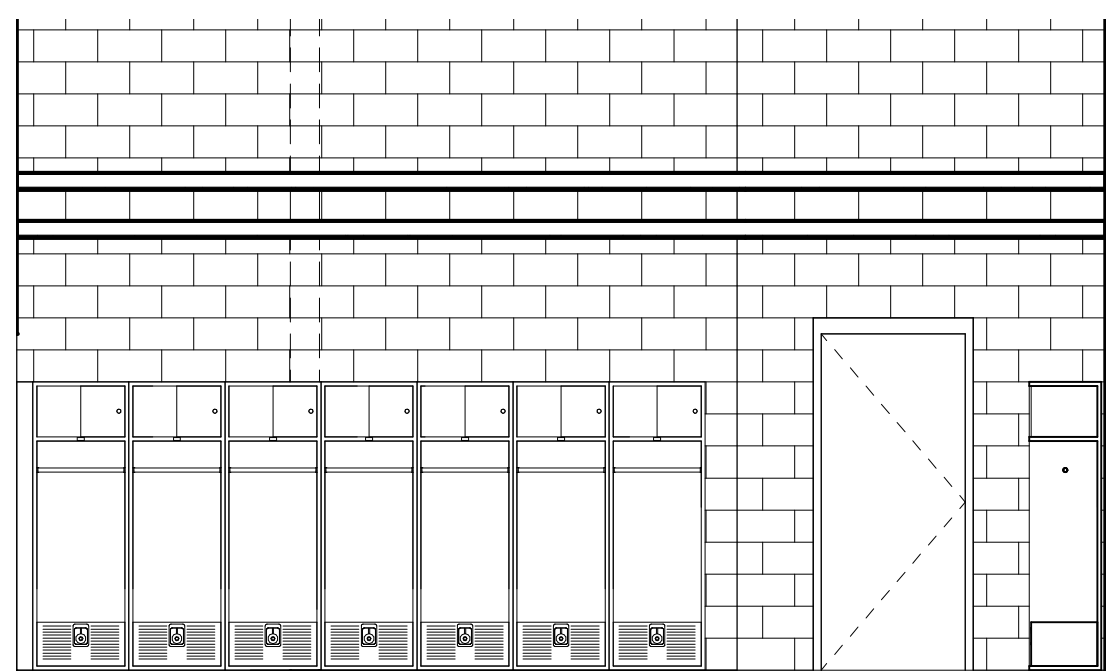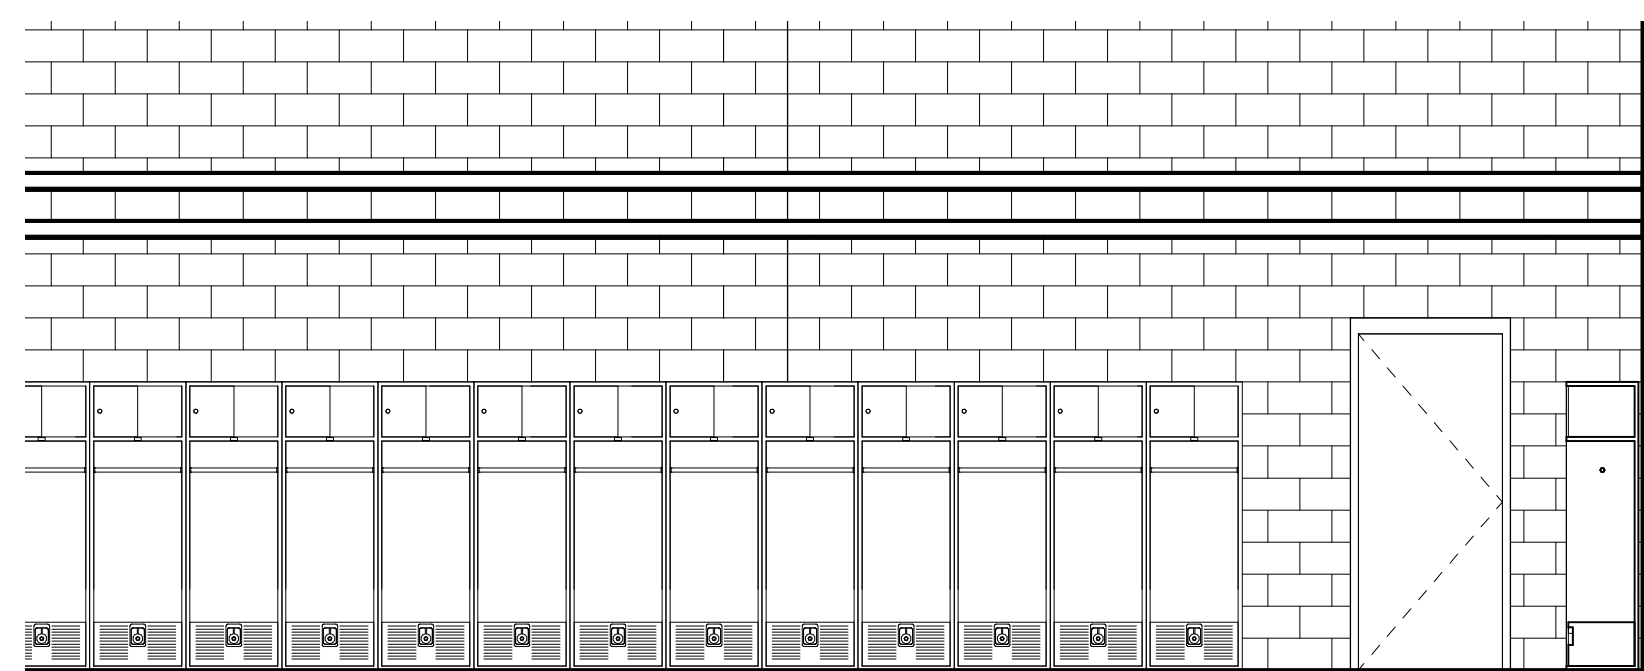






3 TEAM ROOM LR102 - EAST
1/4" = 1'-0"

4 TEAM ROOM LR102 - EAST
1/4" = 1'-0"

5 TEAM ROOM LR102 - NORTH
1/4" = 1'-0"

6 TEAM ROOM LR102 - SOUTH
1/4" = 1'-0"

7 TEAM ROOM LR102 - WEST
1/4" = 1'-0"

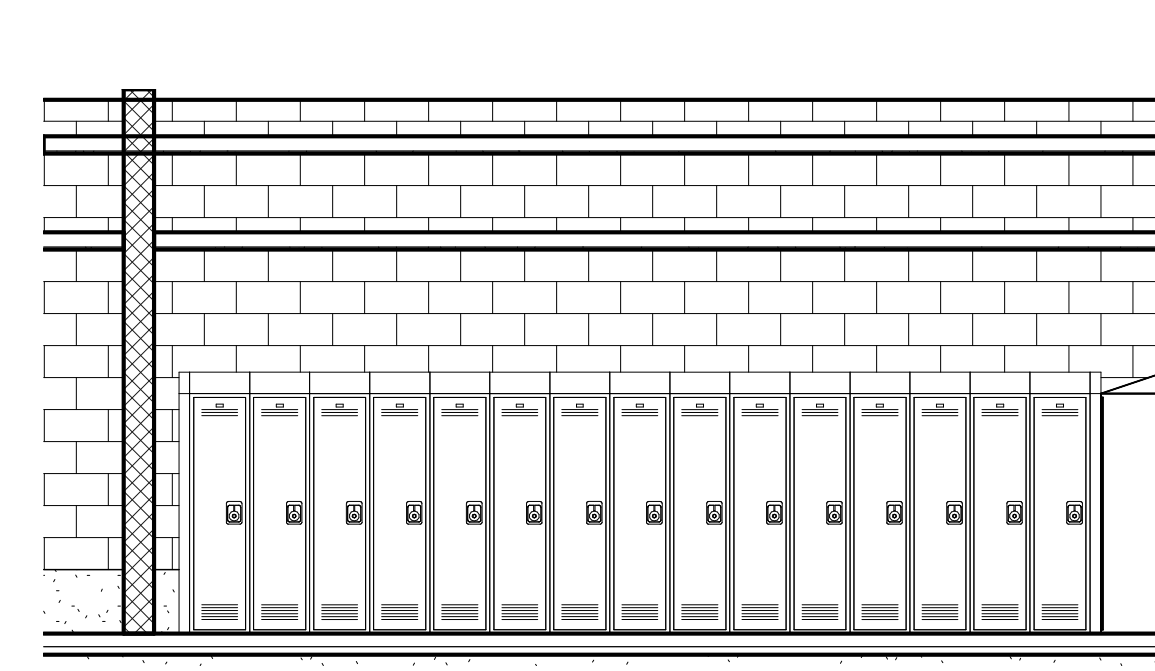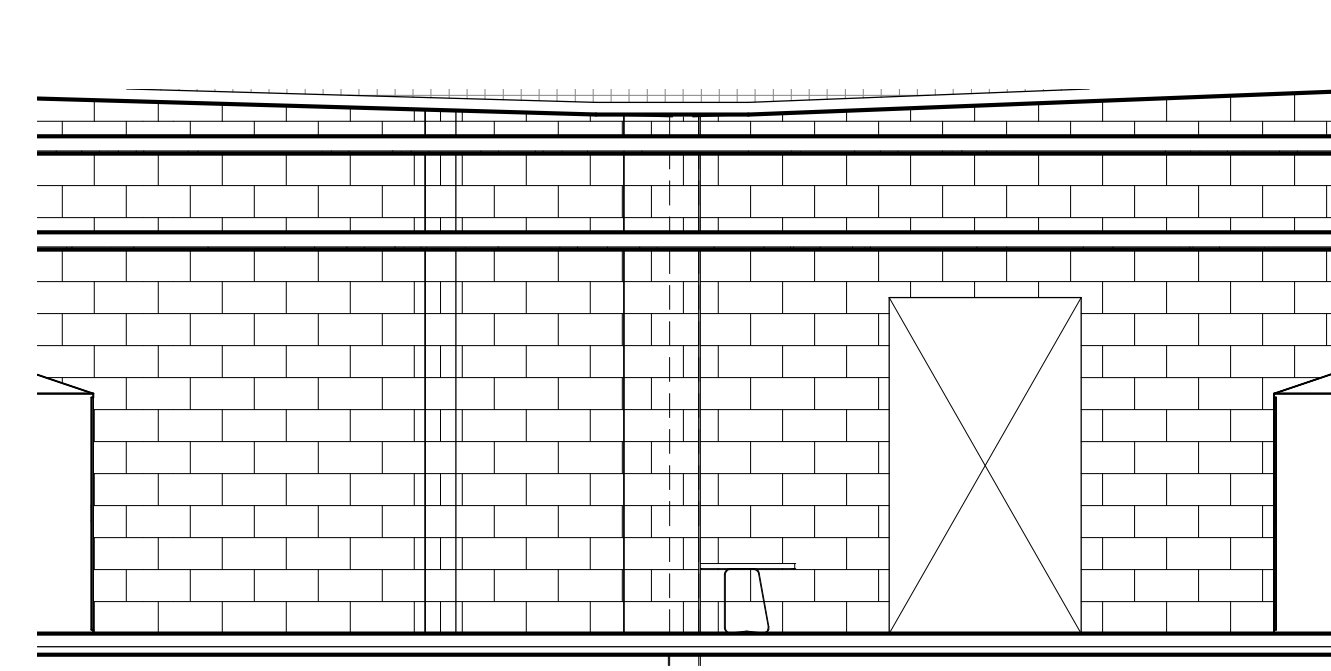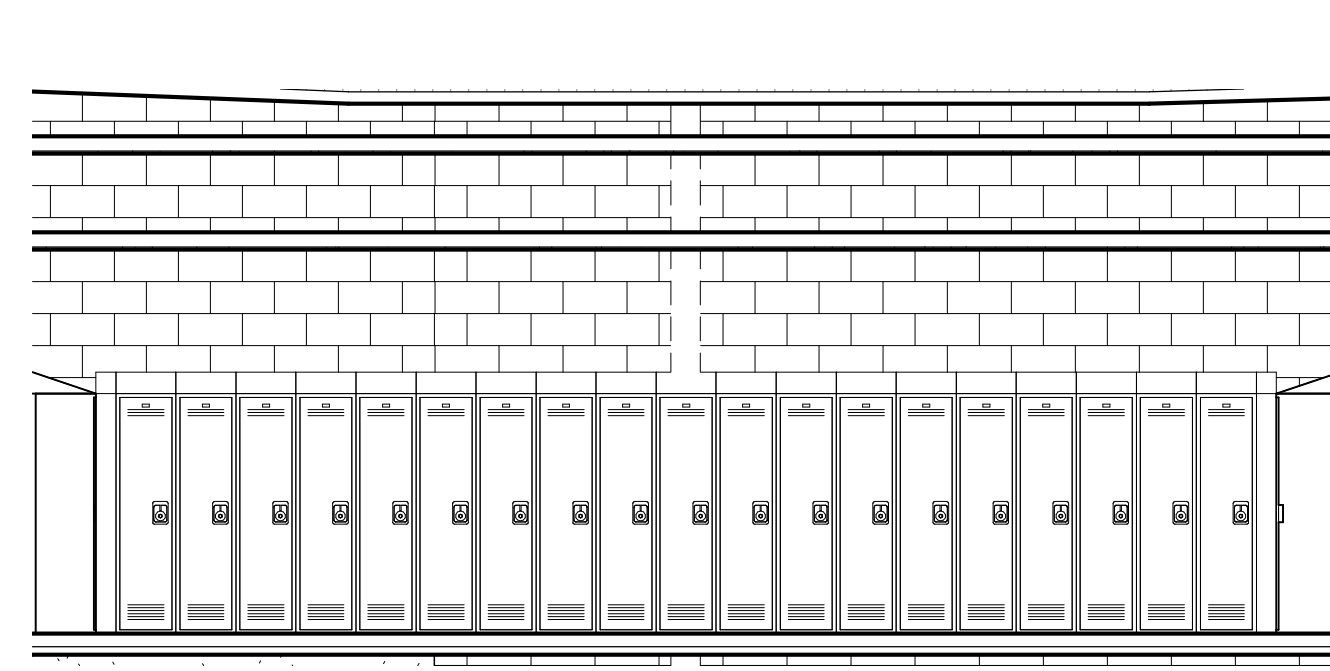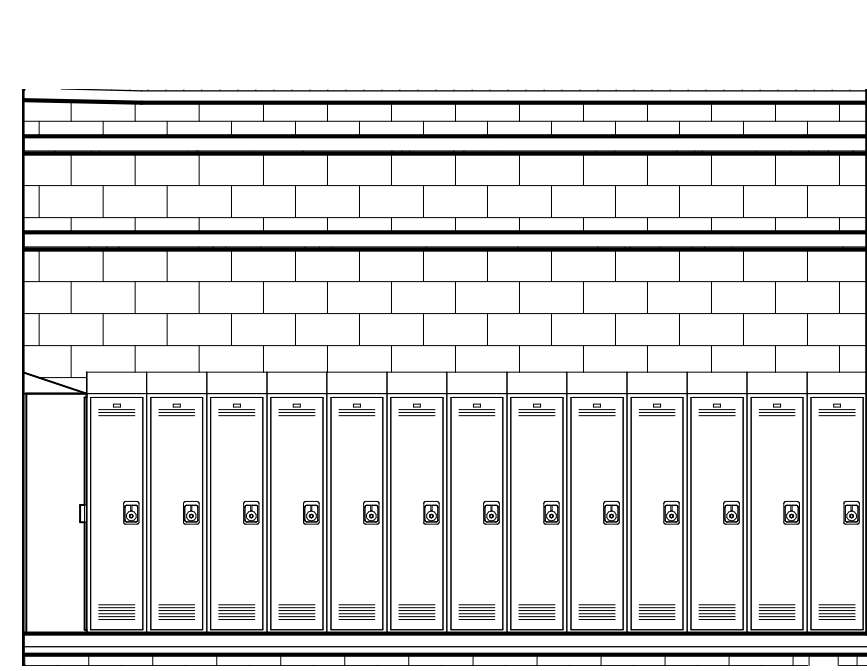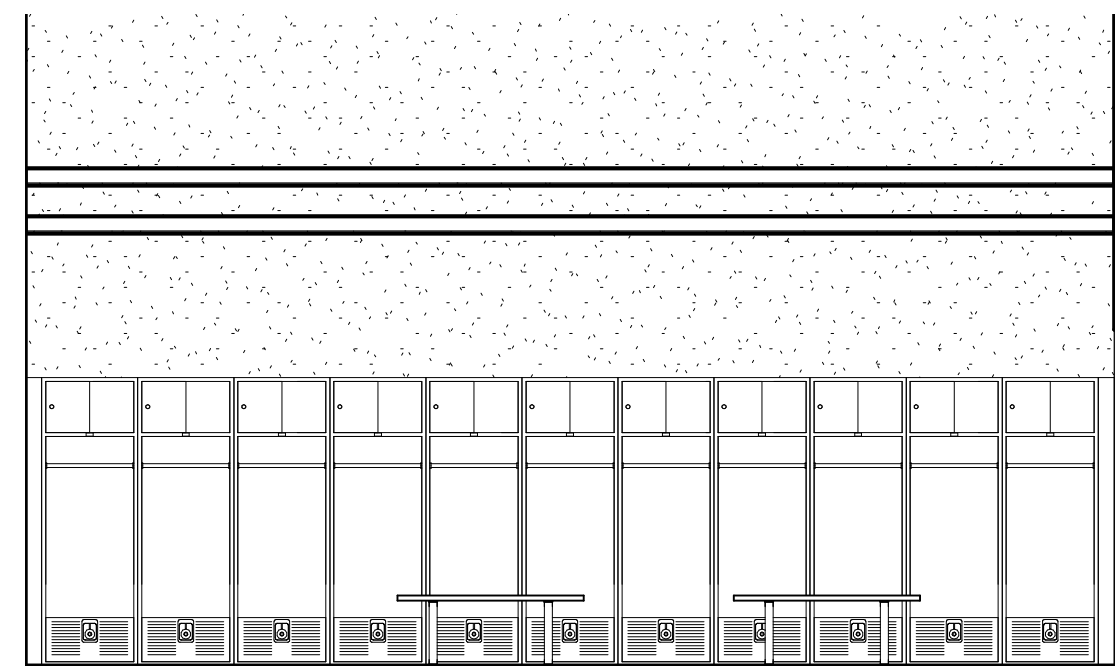







8 TEAM ROOM LR102 - WEST
1/4" = 1'-0"

9 TEAM ROOM LR206 - EAST
1/4" = 1'-0"

10 TEAM ROOM LR206 - NORTH
1/4" = 1'-0"

11 TEAM ROOM LR206 - SOUTH
1/4" = 1'-0"

12 TEAM ROOM LR206 - WEST
1/4" = 1'-0"

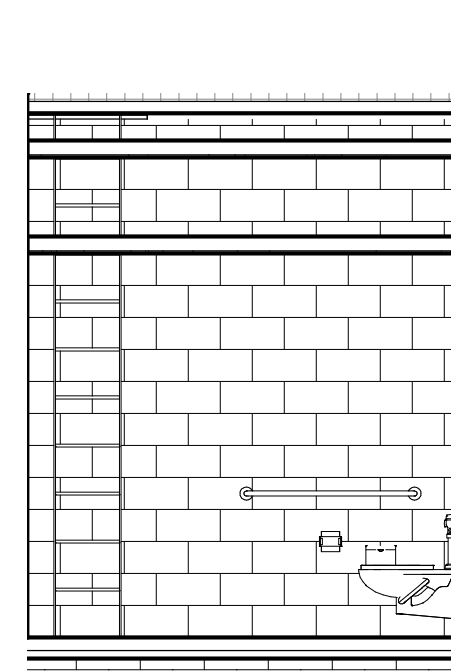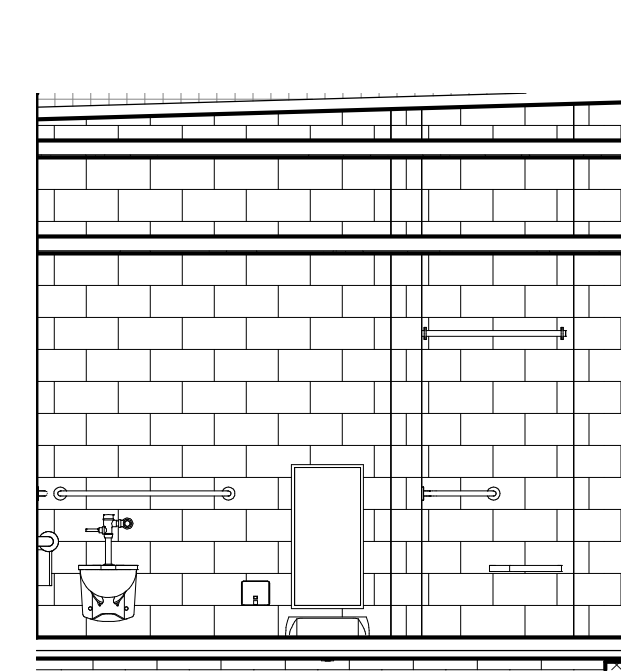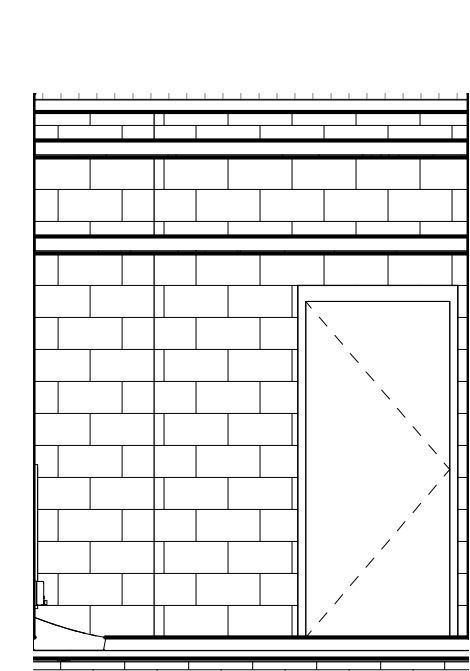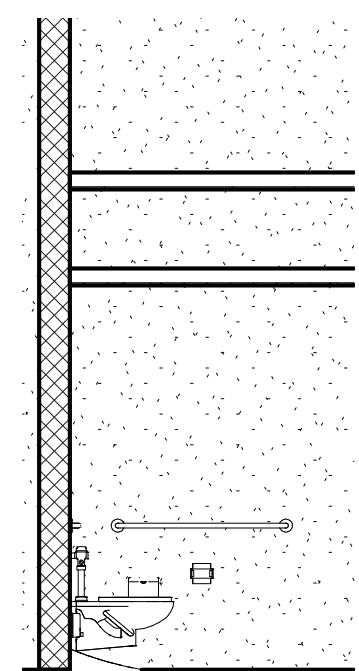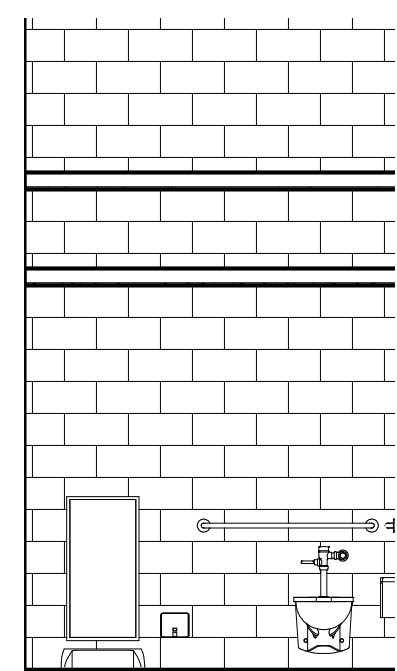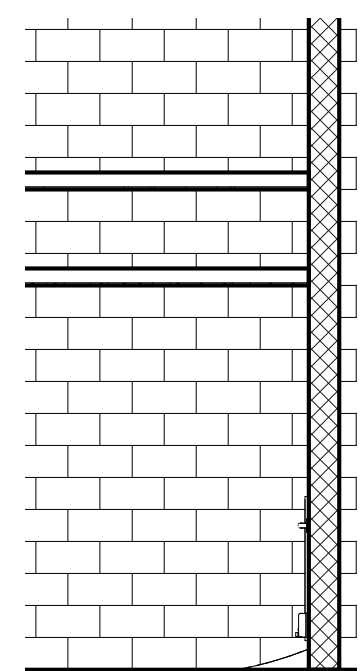

13 TLT LR105 - EAST
1/4" = 1'-0"




14 TLT LR105 - SOUTH
1/4" = 1'-0"

15 TLT LR105 - WEST
1/4" = 1'-0"

16 COACH / OFFICIAL LR204 - EAST
1/4" = 1'-0"

17 COACH / OFFICIAL LR204 - NORTH
1/4" = 1'-0"




18 COACH / OFFICIAL LR204 - WEST
1/4" = 1'-0"

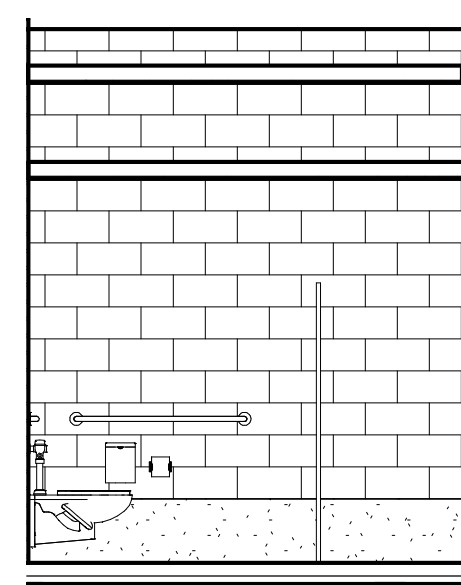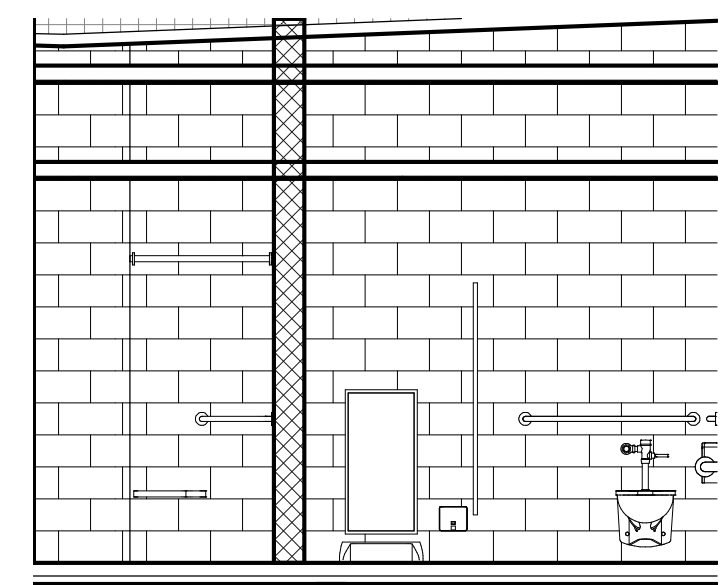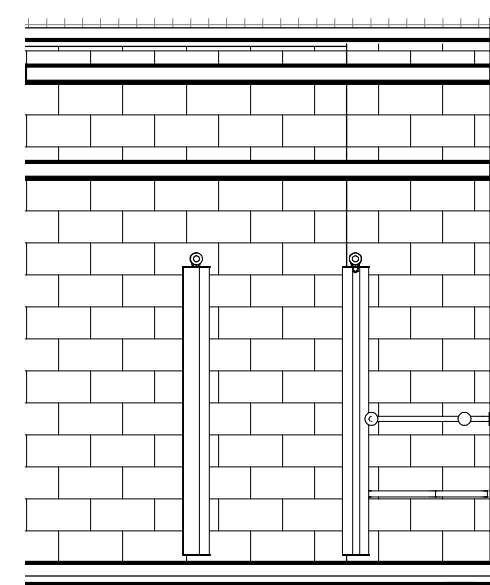

19 TLT / SHOWER E5 - EAST
1/4" = 1'-0"

20 TLT / SHOWER E5 - SOUTH
1/4" = 1'-0"


21 TLT / SHOWER E5 - EAST
1/4" = 1'-0"

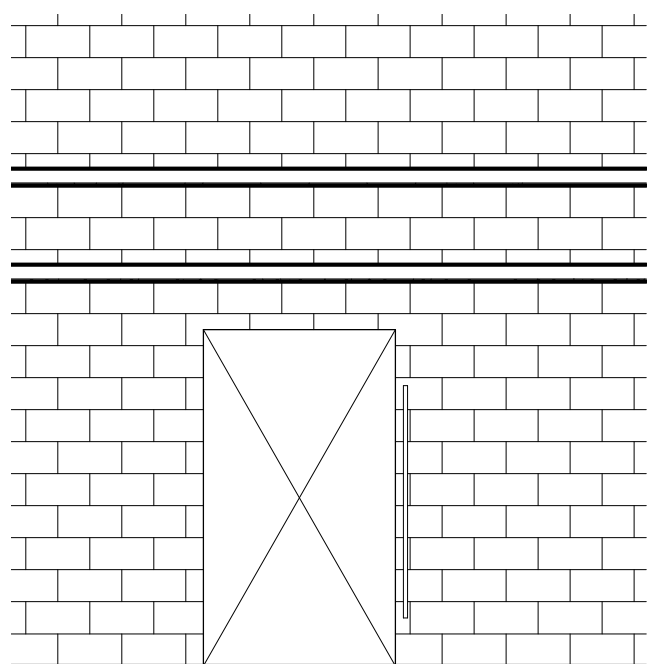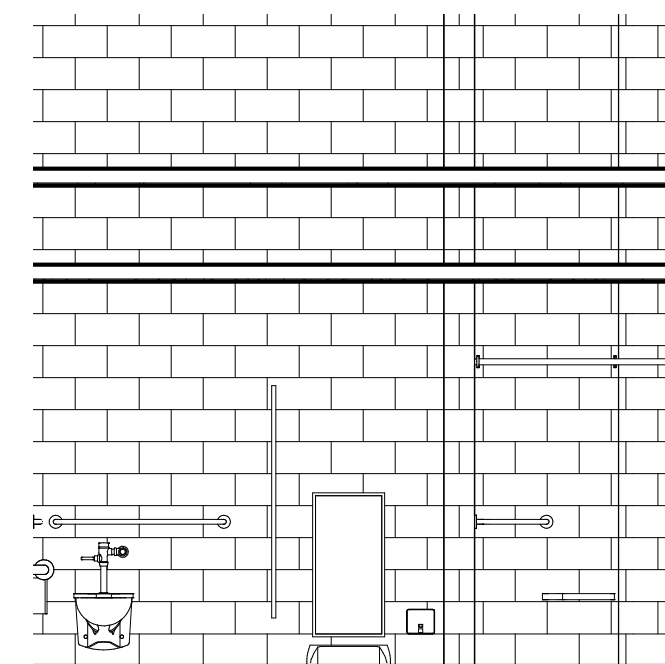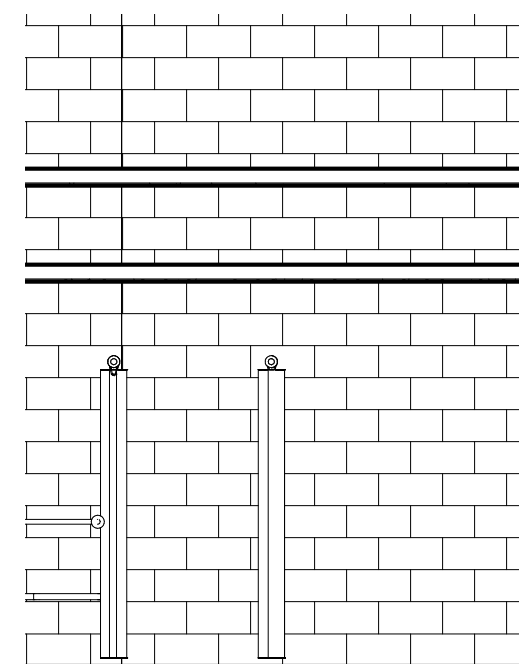

22 TLT / SHOWER E7 - EAST
1/4" = 1'-0"

23 TLT / SHOWER E7 - NORTH
1/4" = 1'-0"

24 TLT / SHOWER E7 - SOUTH
1/4" = 1'-0"

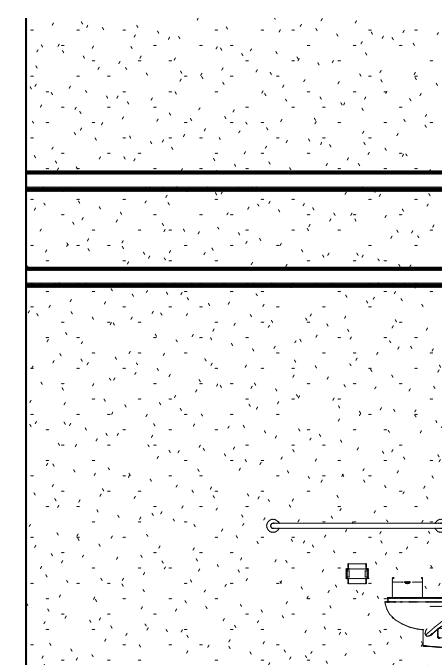

25 TLT / SHOWER E7 - WEST
1/4" = 1'-0"



1 LOCKER ROOM LR102 - FIRST FLOOR LOCKER BUILDING
1/4" = 1'-0"


2 LOCKER ROOM LR203 - SECOND FLOOR LOCKER BUILDING
1/4" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074
Tel: 617.854.1700
www.dra.com


Northeast
Metropolitan
Regional
Vocational High
School
100 Hemlock Road,
Wakefield, MA 01880

ADD ALTERNATE
MSBA 90% CD
SUBMISSION
May 12TH, 2023

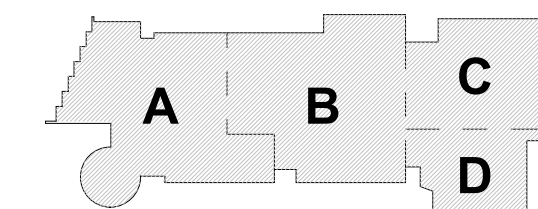

KEY PLAN

PROJECT NORTH


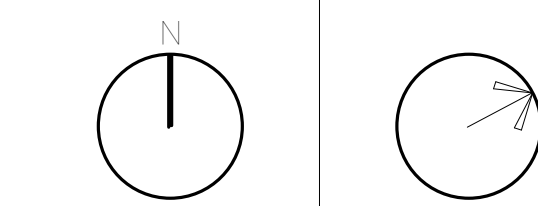


TOILET AND
LOCKER ROOM
PLANS


Scale: 1/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

AL-1-4


100 Hemlock Road,
Wakefield, MA 01880

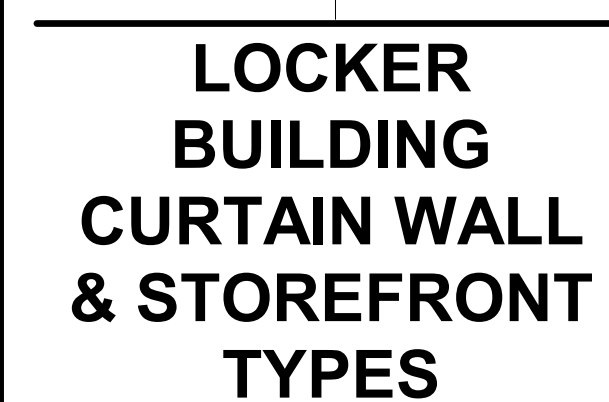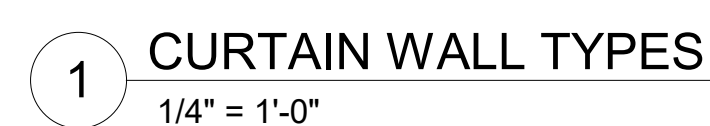


Scale: 1/4" = 1'-0"
Job No.: 20202
Drawn By: DRA
Date: May 12TH, 2023
Volume 3 of 4

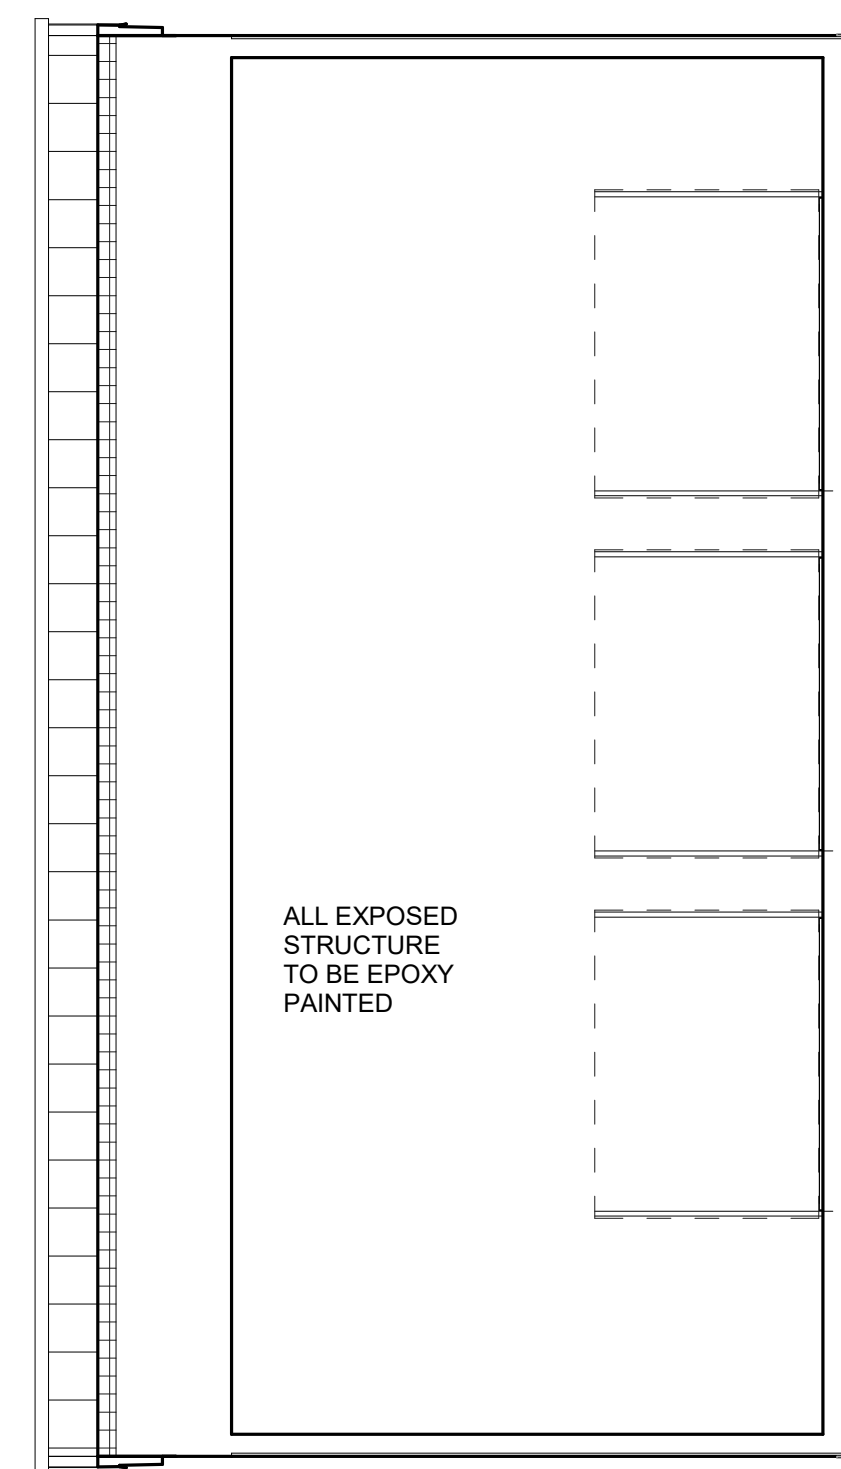


11 MAINTENANCE BUILDING REFLECTED CEILING PLAN
1/8" = 1'-0"

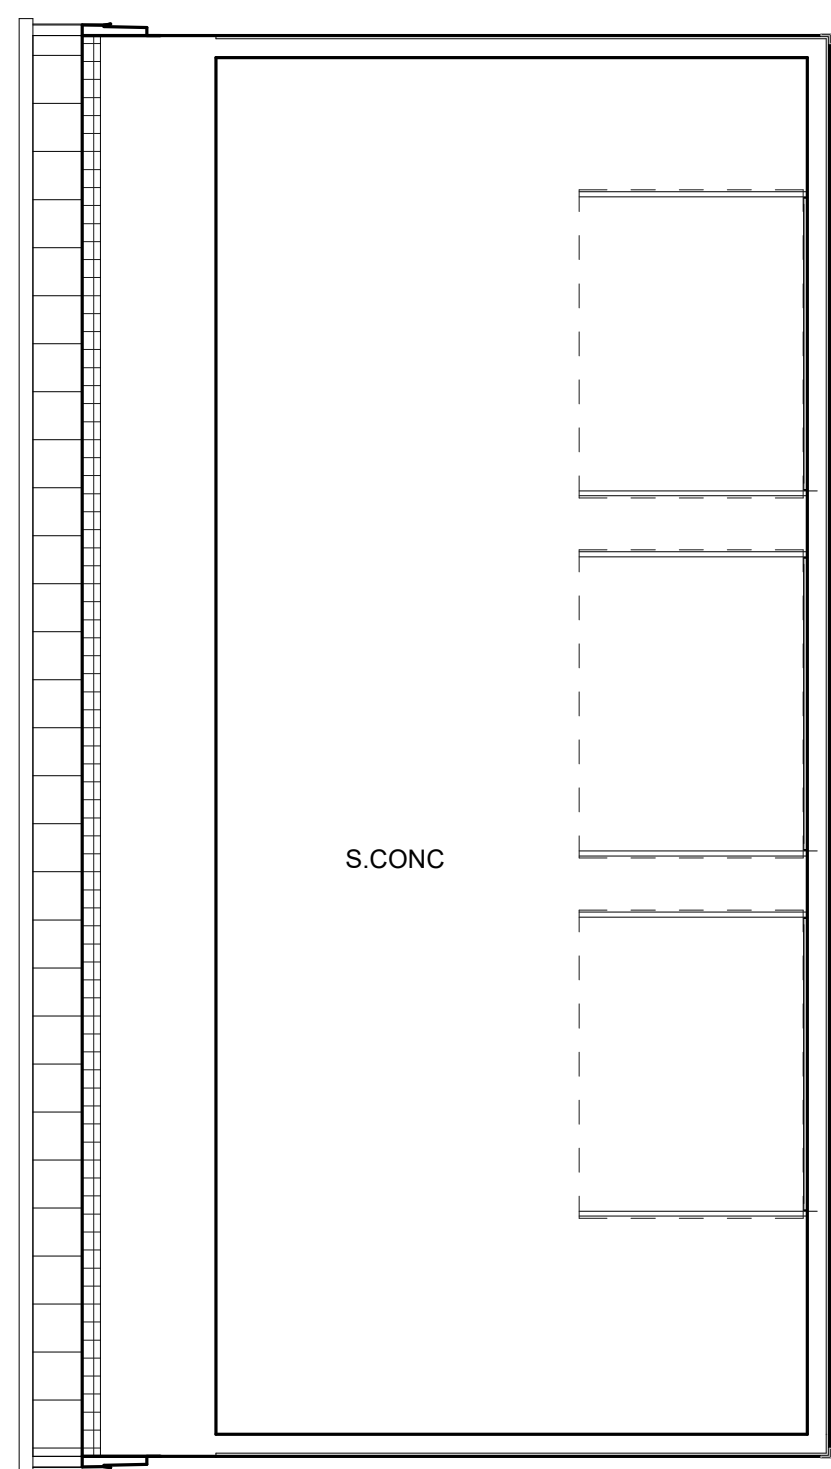

10 MAINTENANCE FLOOR FINISHES PLAN
1/8" = 1'-0"

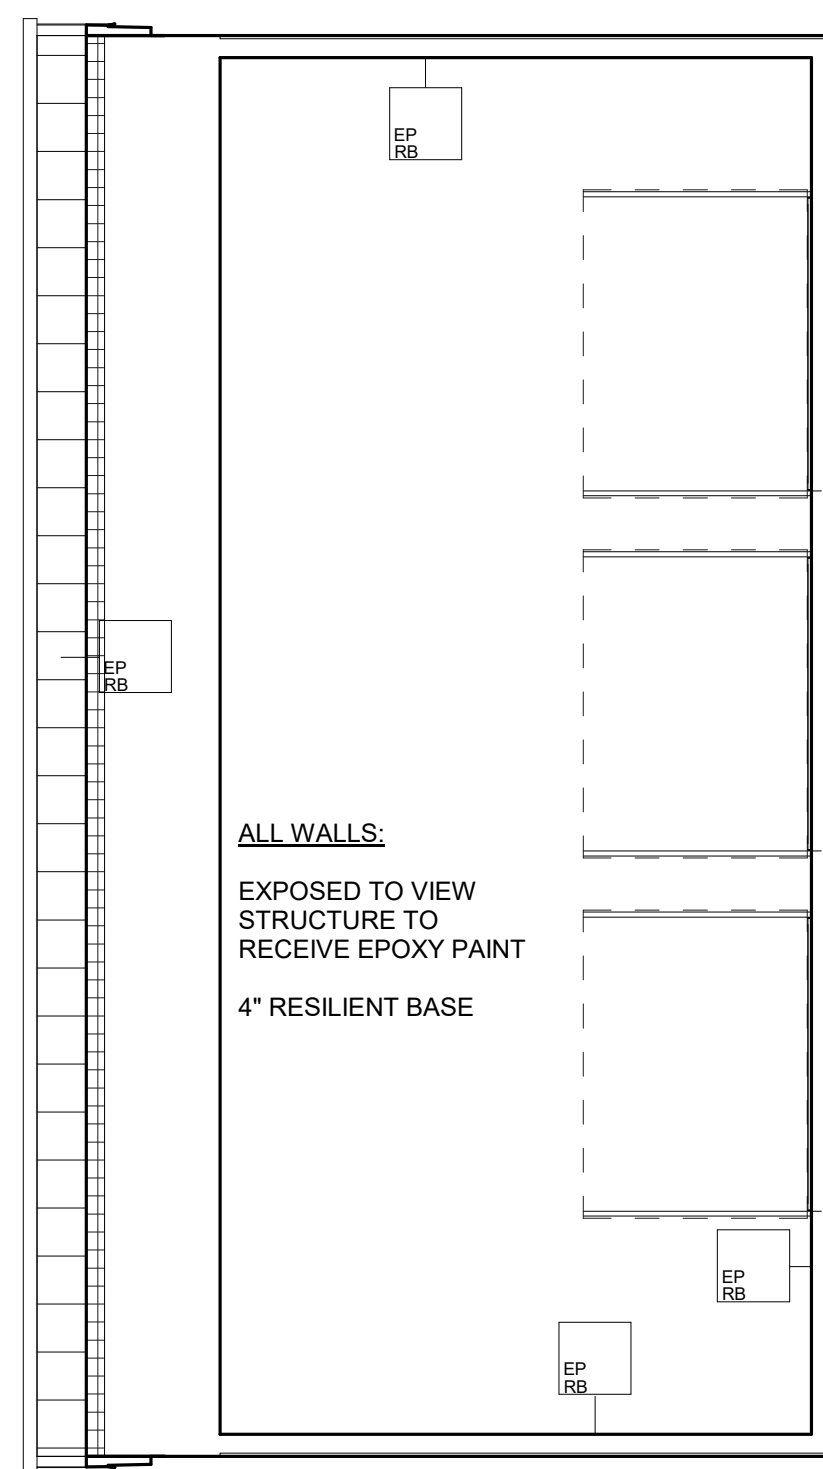


9 MAINTENANCE WALL FINISHES PLAN
1/8" = 1'-0"

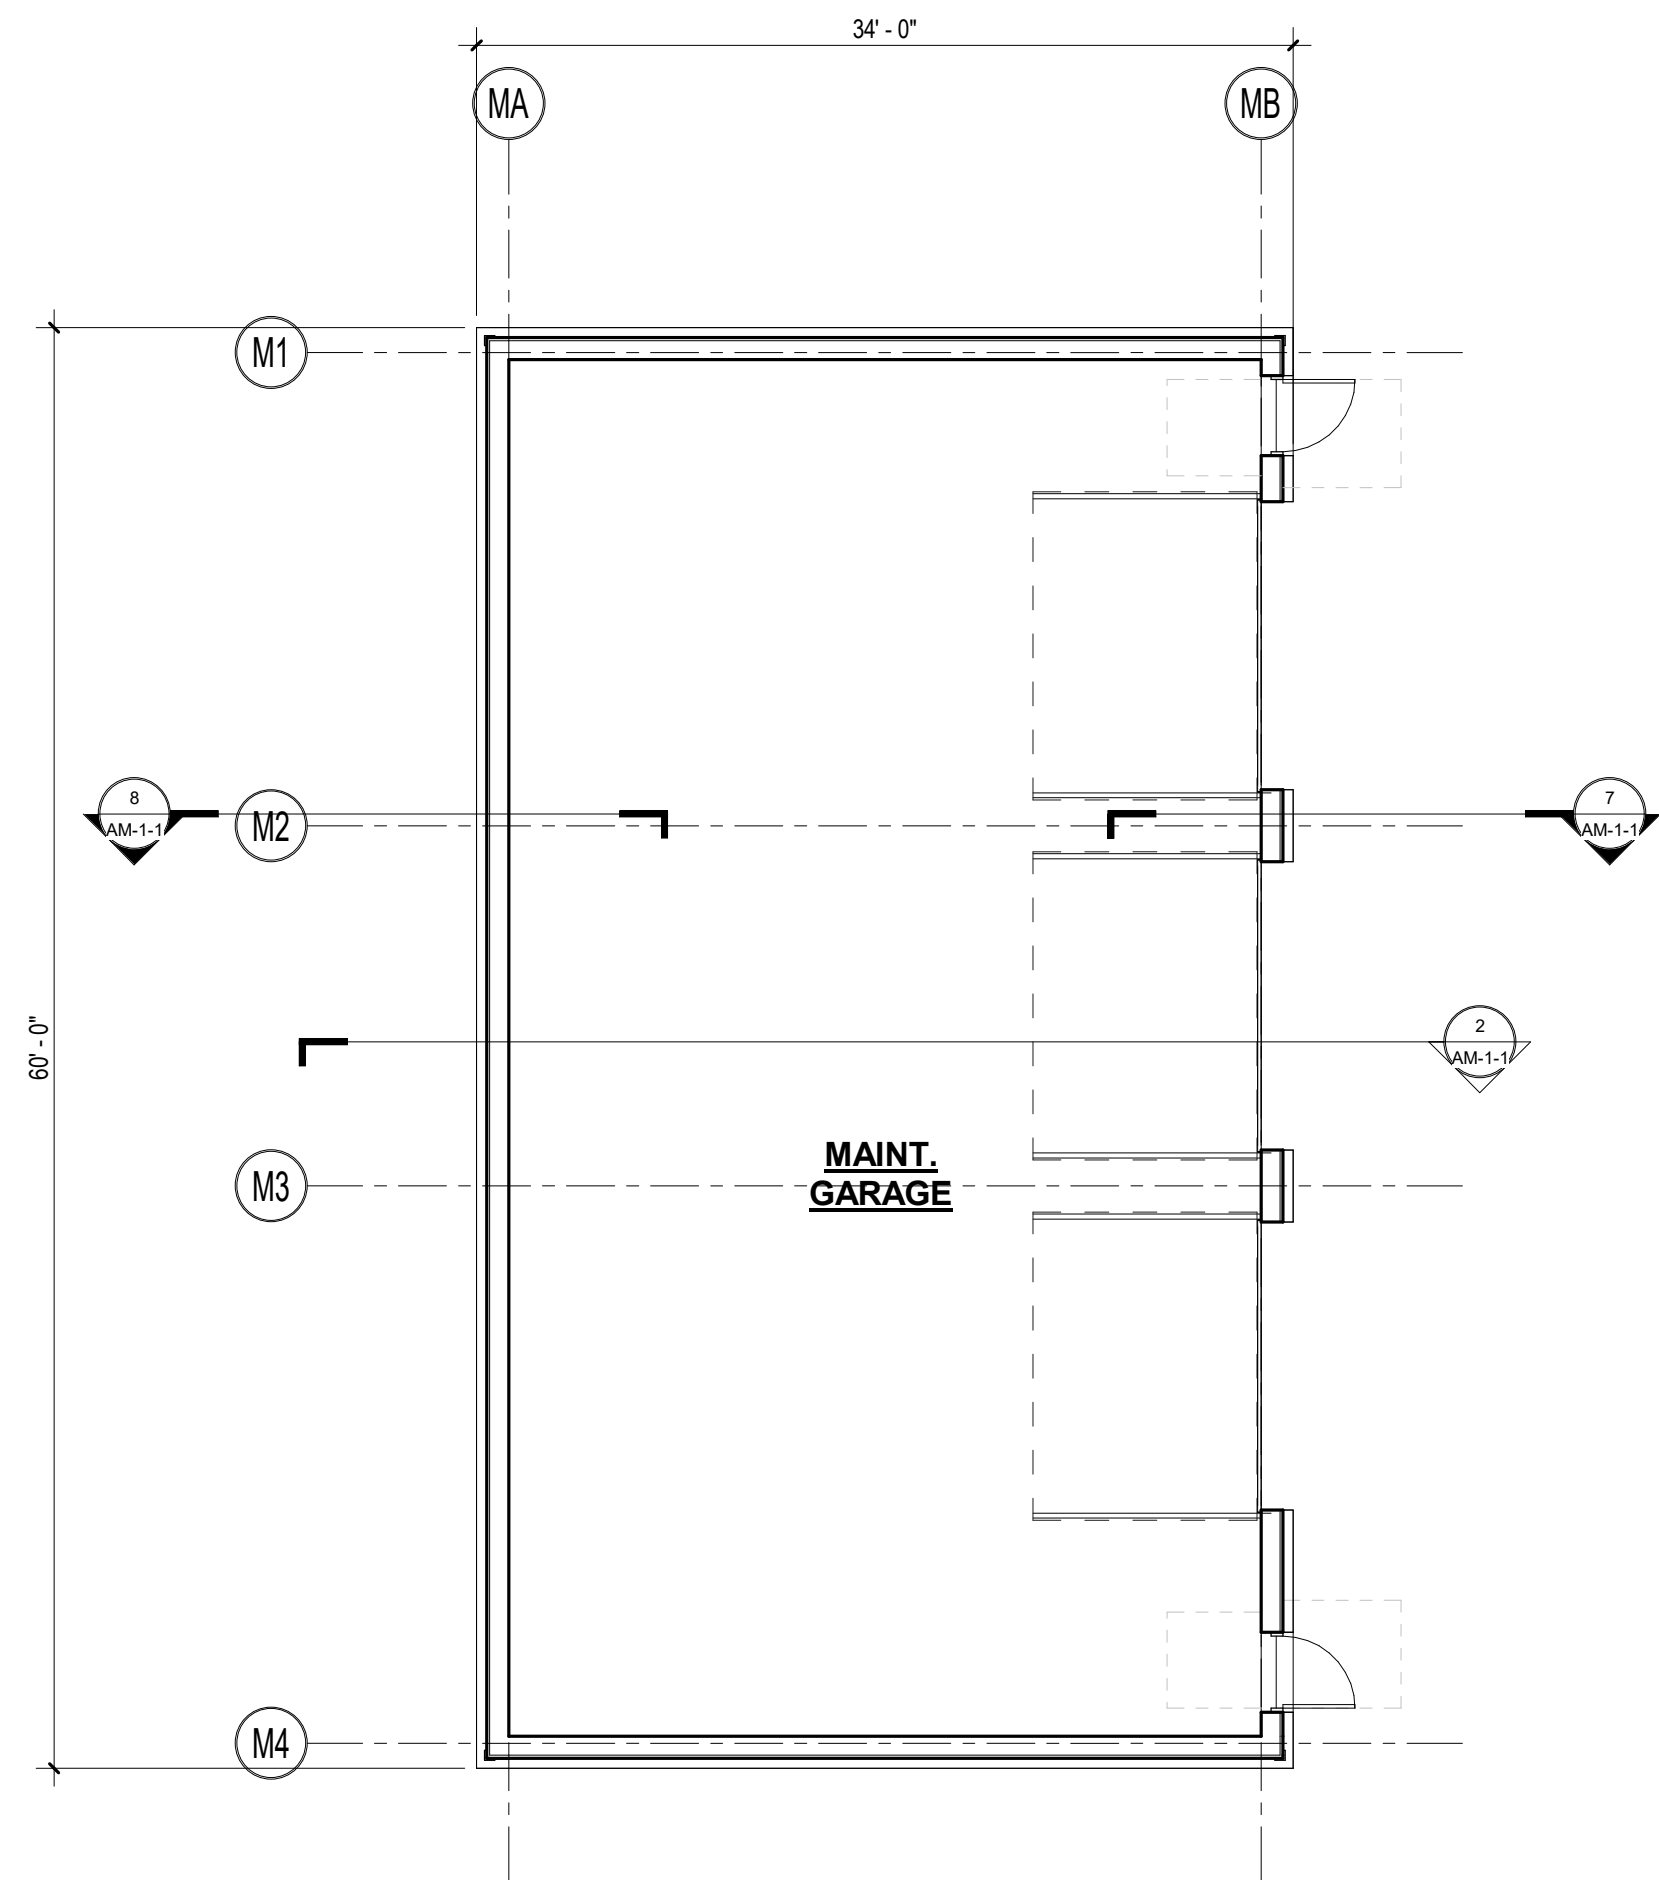


1 MAINTENANCE BUILDING PLAN
1/8" = 1'-0"

MAINTENANCE BUILDING DOOR SCHEDULE																			
DOOR NO.	DOORS				FRAMES				SADDLE				REMARKS						
	TO	FROM	NAME	SIZE	WIDTH	HEIGHT	THICK.	TYPE	MAT.	LOUVER	TYPE	MAT.	JAMB DTL.	HEAD DTL.	FIRE RTNG.	DETAIL	MAT.	HARD WARE	
T.O. MAINTENANCE BUILDING SLAB	M101.1	M101	MAINT. GARAGE	3'-0"	7'-0"	1 3/4"	F	MTL			1	MTL						15	
M101.2		M101	MAINT. GARAGE	12'-0"	12'-0"	1 3/4"	OH2	ALUM			-	MTL						85	
M101.3		M101	MAINT. GARAGE	12'-0"	12'-0"	1 3/4"	OH2	ALUM			-	MTL						85	
M101.4		M101	MAINT. GARAGE	12'-0"	12'-0"	1 3/4"	OH2	ALUM			-	MTL						85	
M101.5		M101	MAINT. GARAGE	3'-0"	7'-0"	1 3/4"	F	MTL			1	MTL						15	

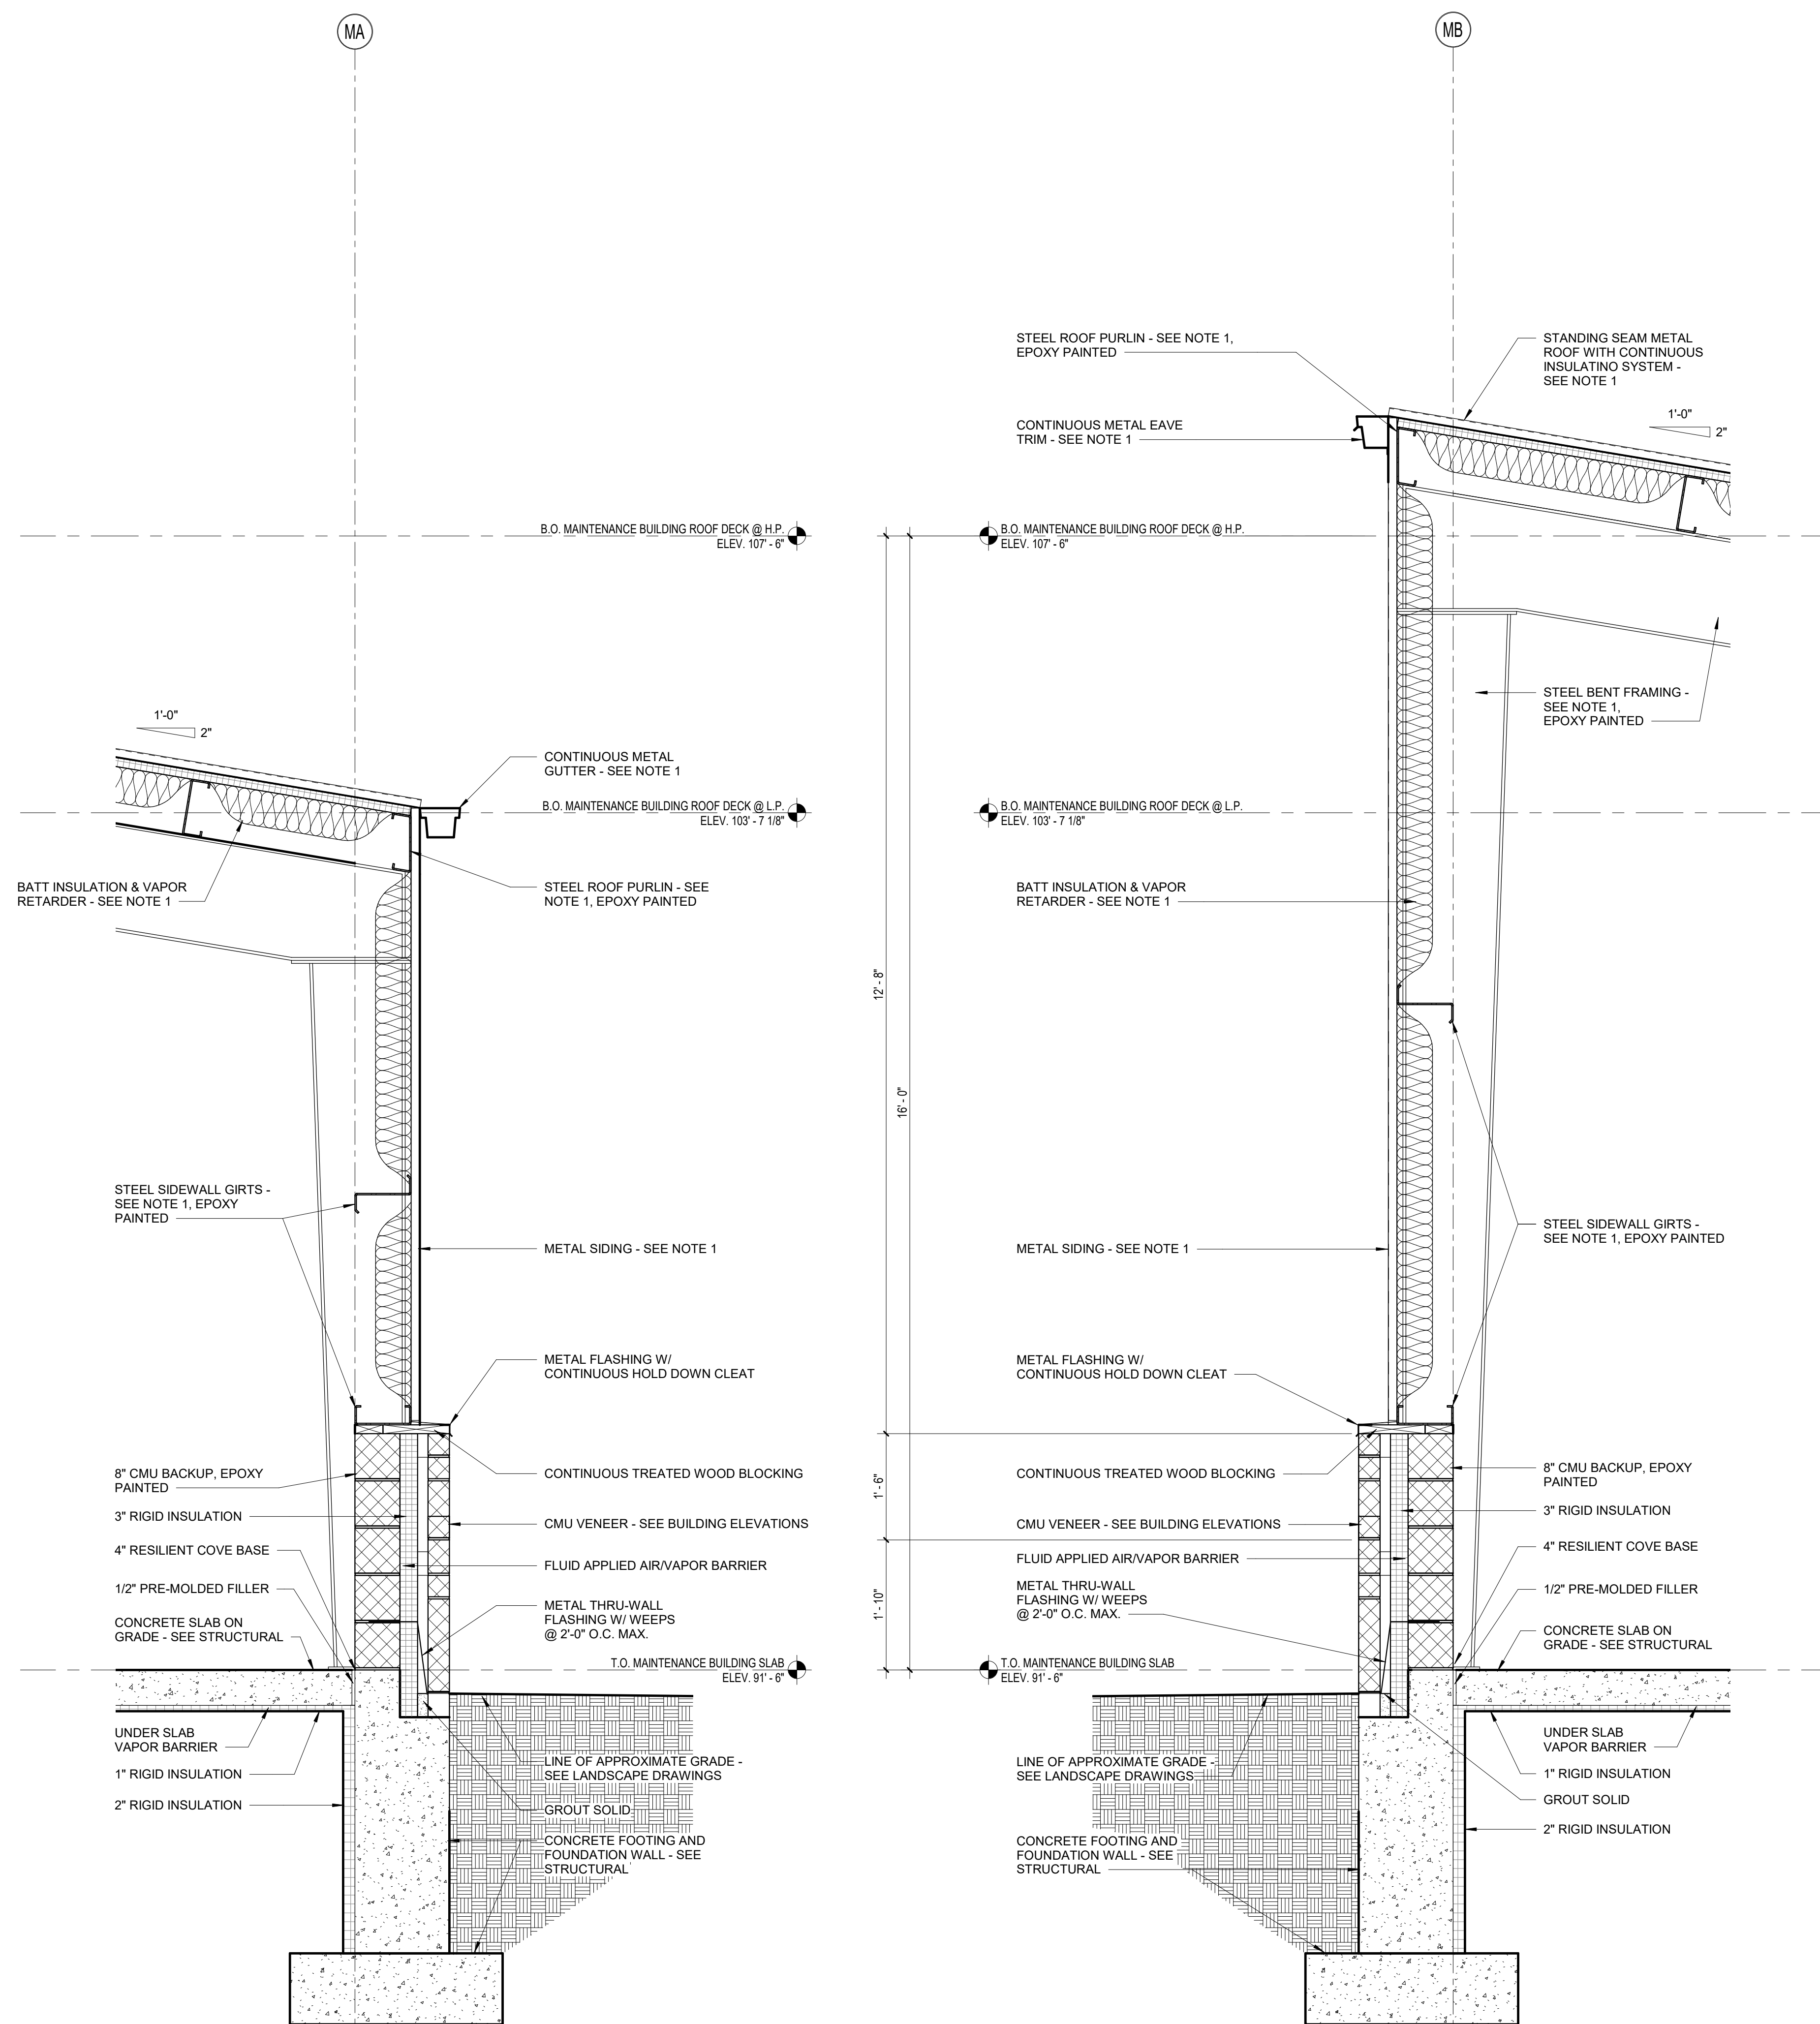


8 WALL SECTION
3/4" = 1'-0"


7 WALL SECTION
3/4" = 1'-0"

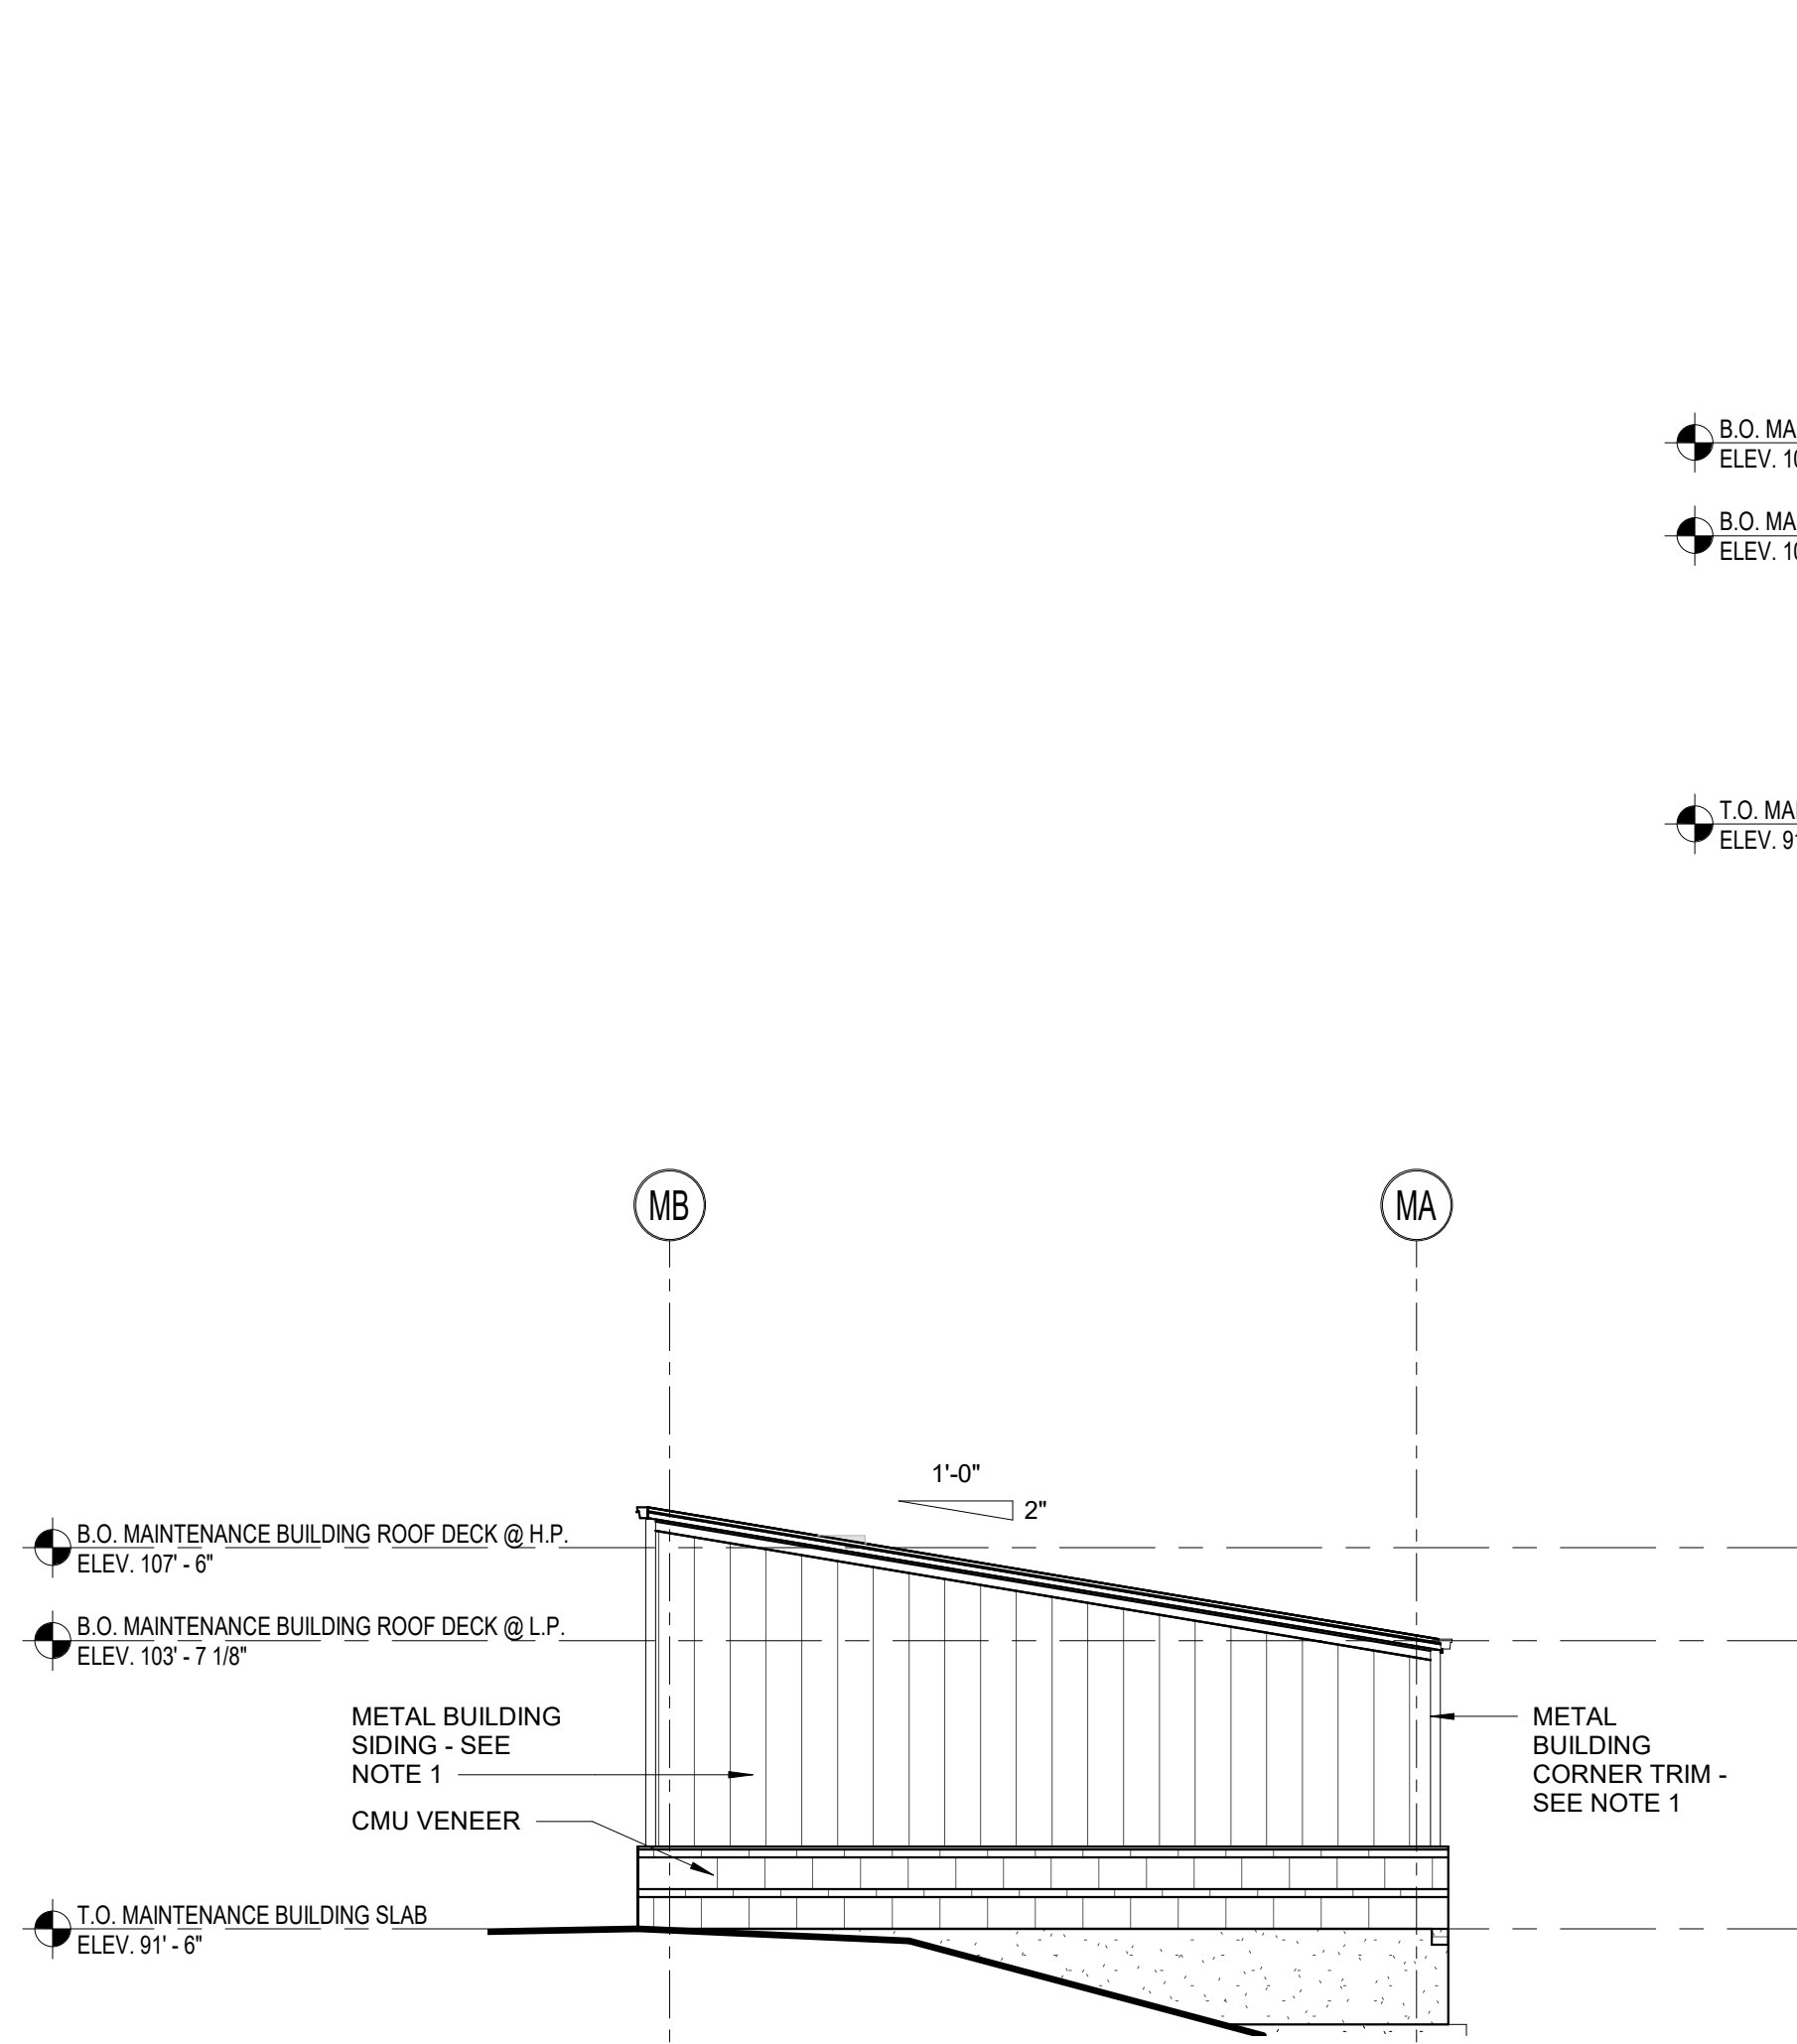


6 MAINTENANCE BUILDING ELEVATION - WEST
1/8" = 1'-0"

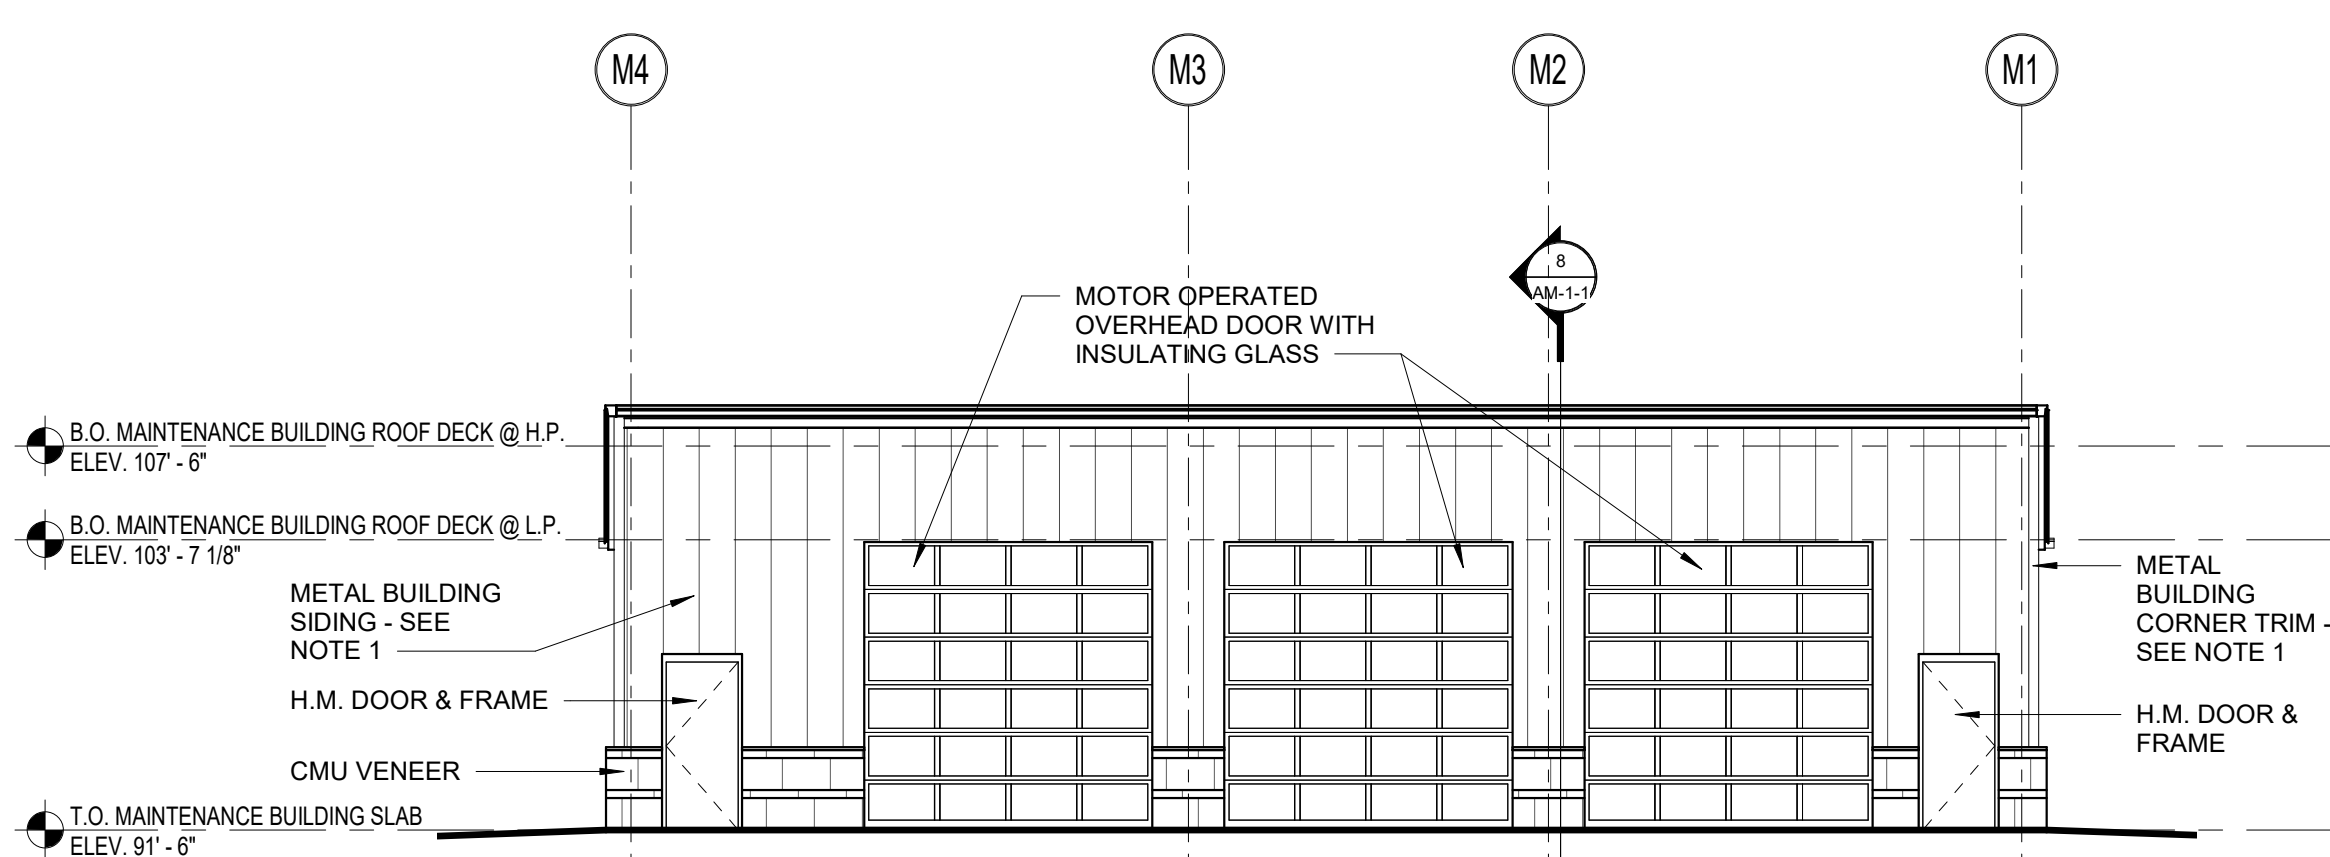


3 MAINTENANCE BUILDING ELEVATION - NORTH
1/8" = 1'-0"

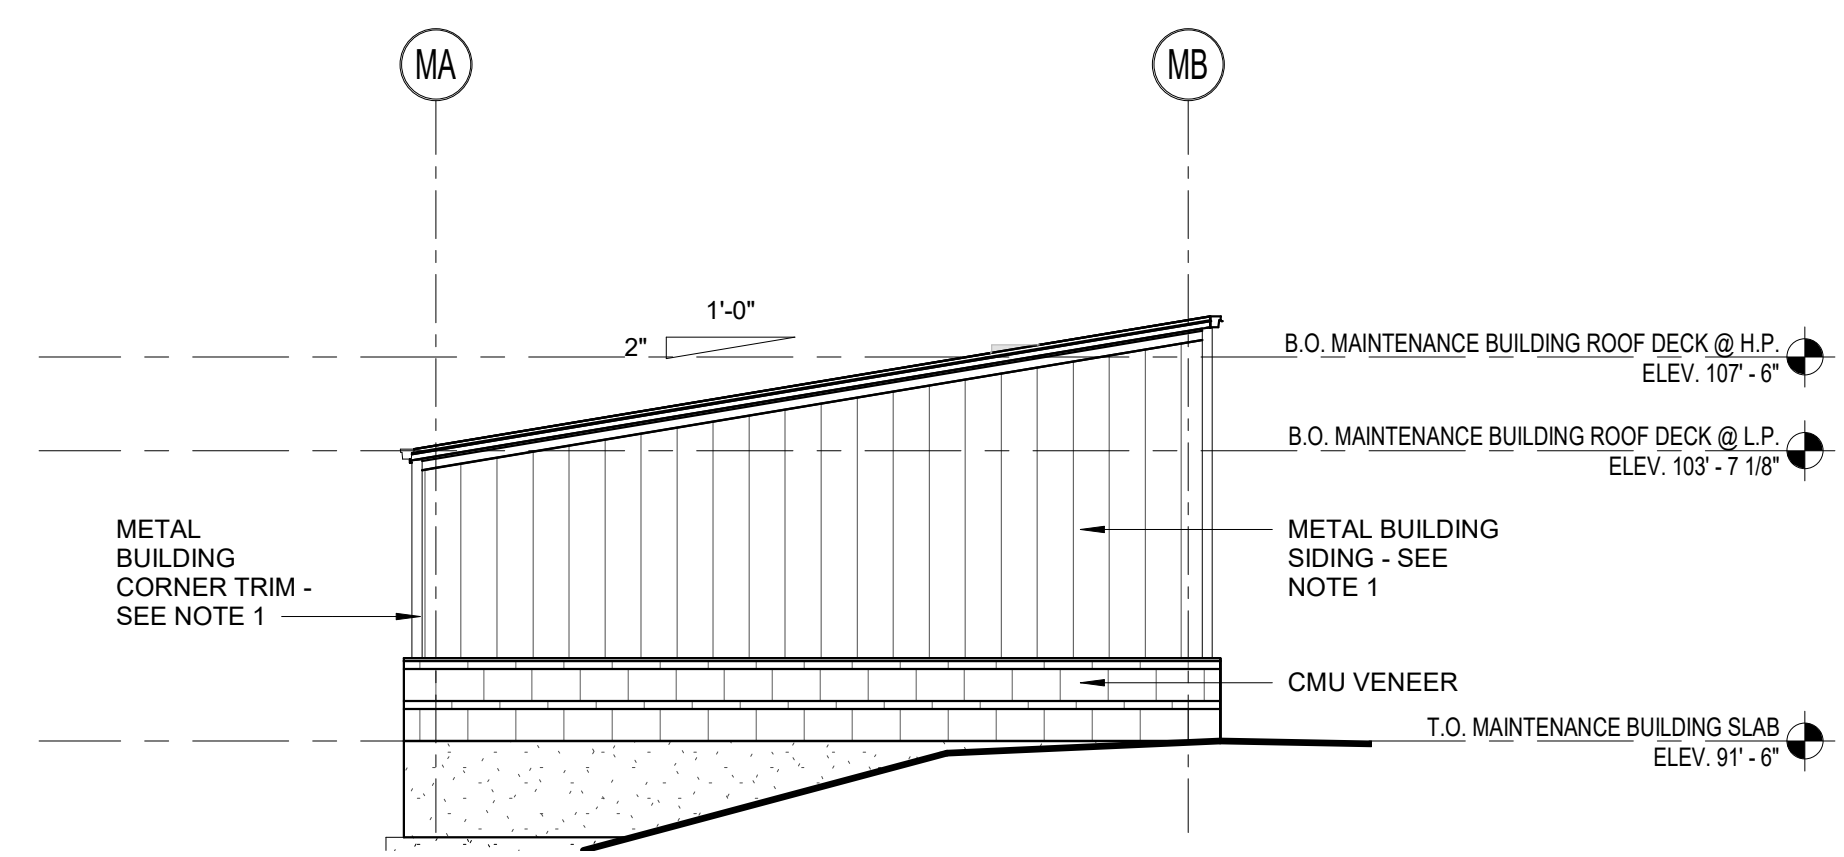

4 MAINTENANCE BUILDING ELEVATION - EAST
1/8" = 1'-0"

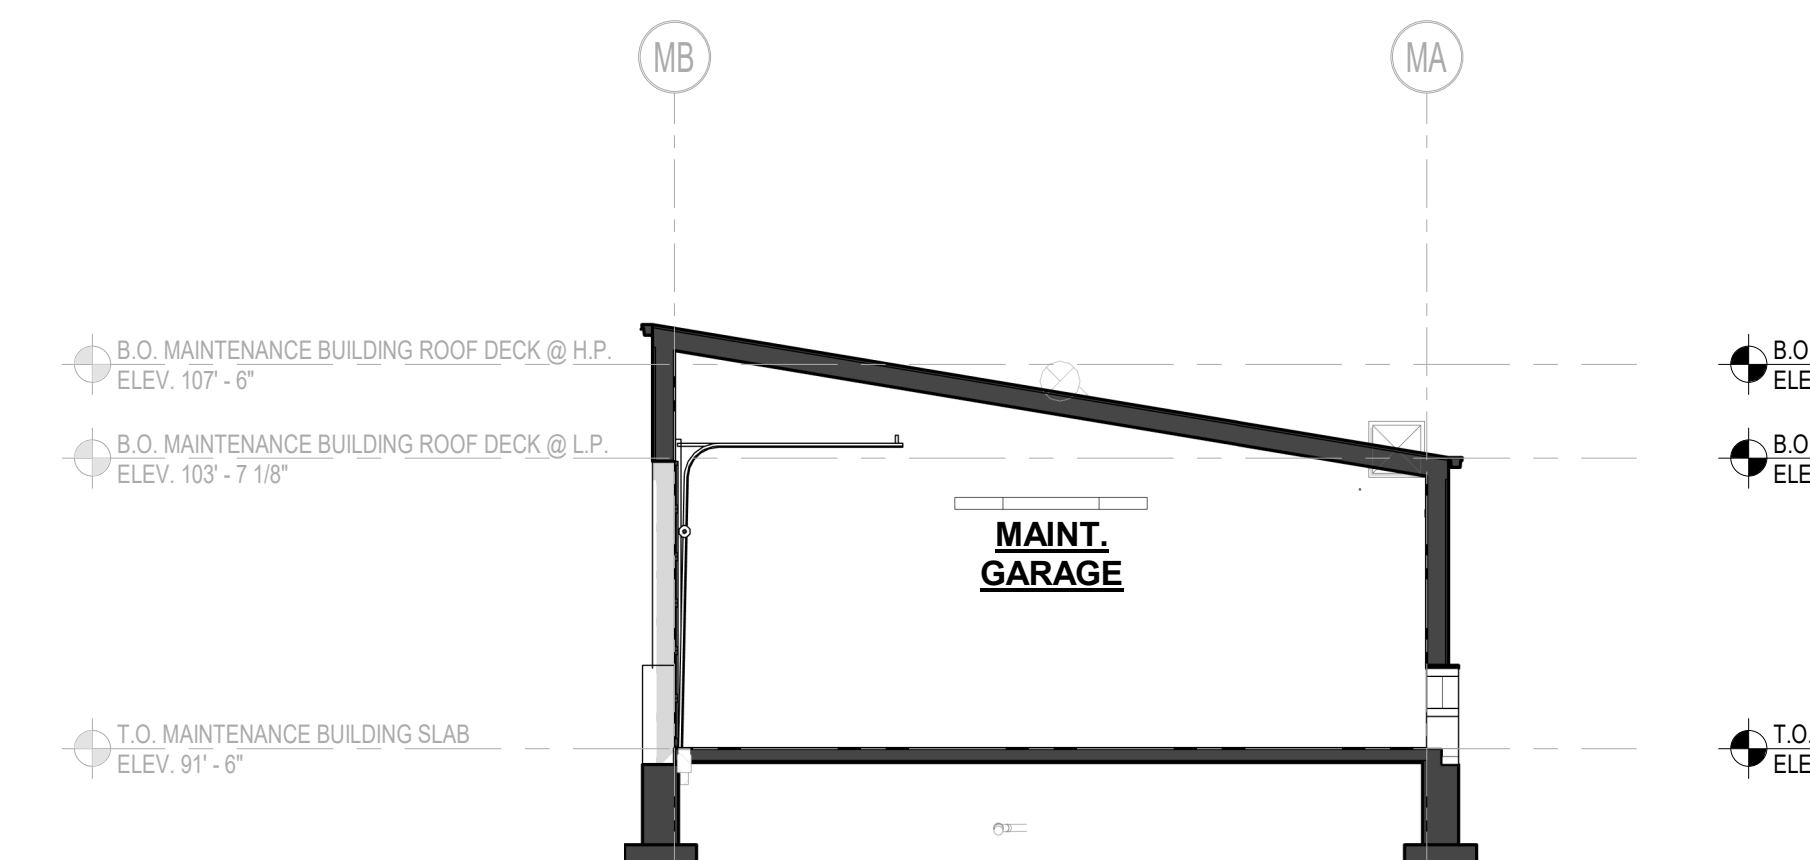

2 MAINTENANCE BUILDING SECTION
1/8" = 1'-0"

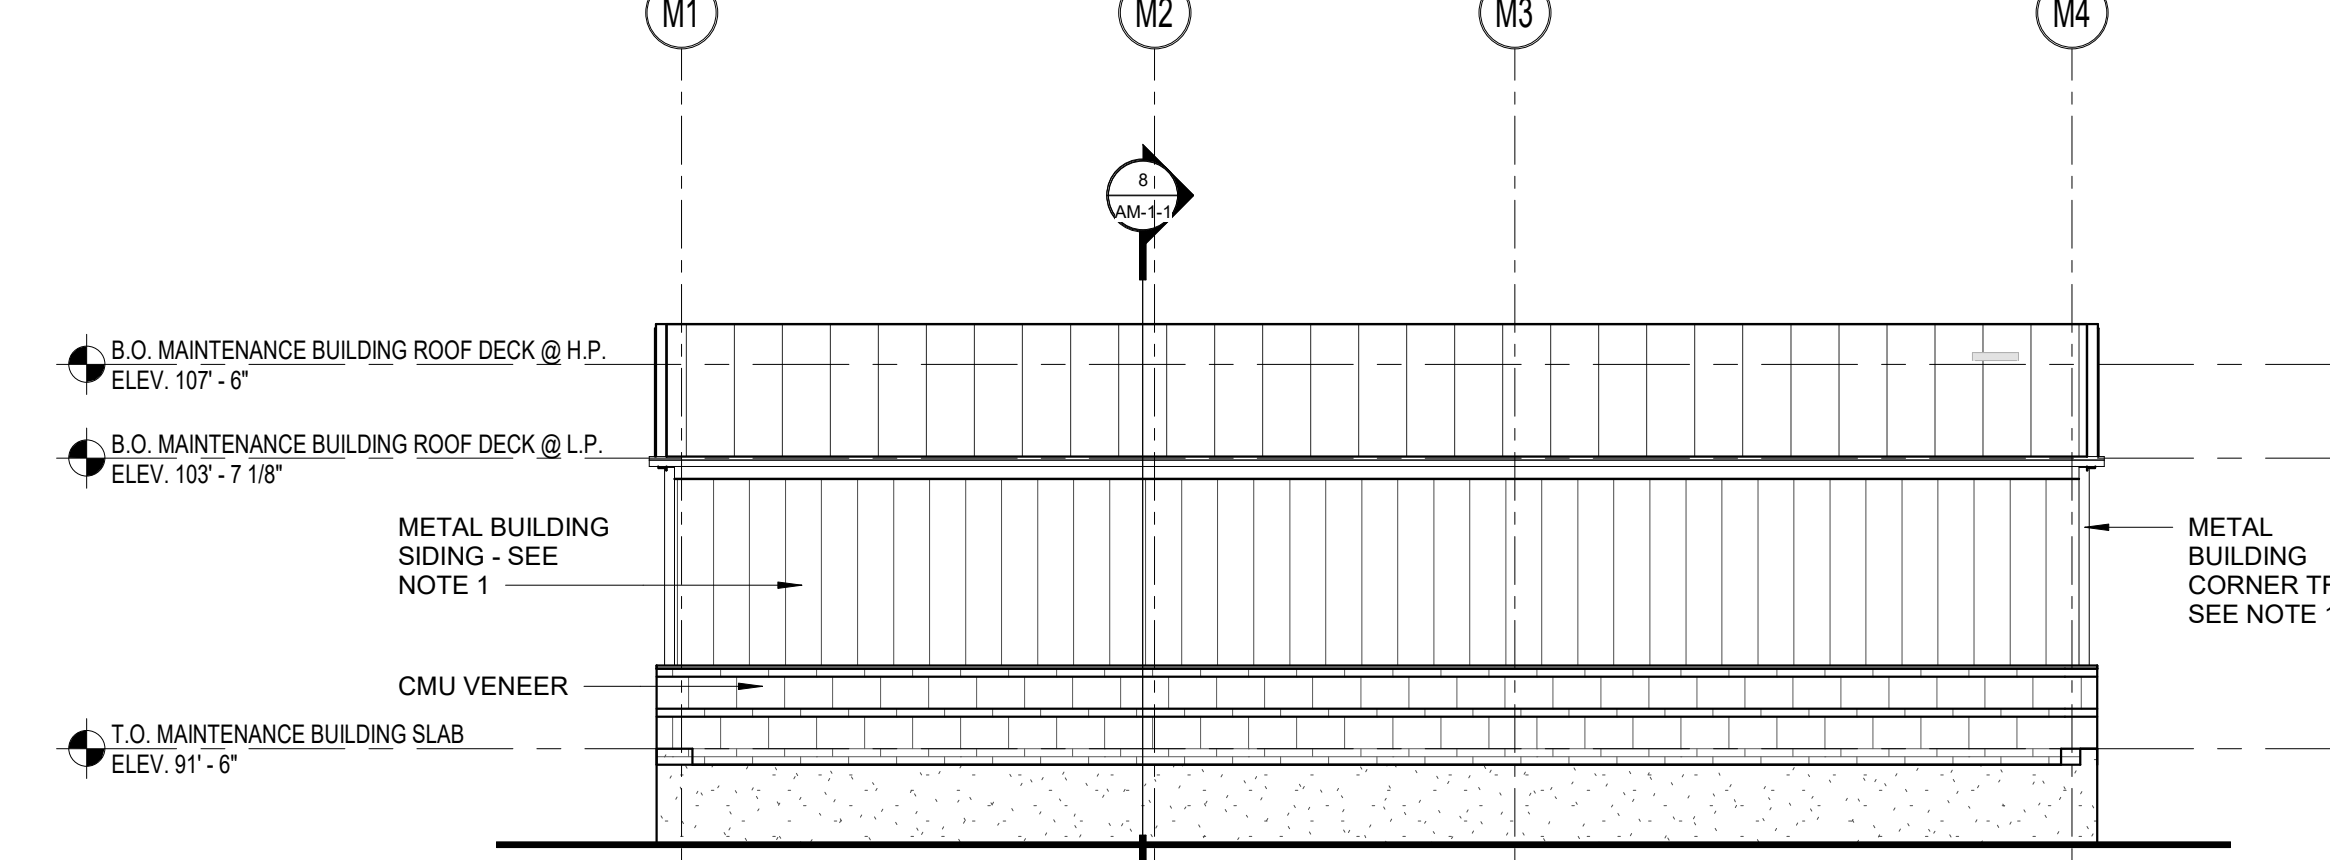

5 MAINTENANCE BUILDING ELEVATION - SOUTH
1/8" = 1'-0"

DRA

Drumme Rosane Anderson, Inc.
225 Oakland Road
Studio 205
South Windsor, CT
06074

280 Charles Street
Studio 300
Waltham, MA
02453

Planning | Architecture | Interior Design
Tel: 617.854.1700
www.dra.com

Northeast
Metropolitan
Regional
Vocational High
School

100 Hemlock Road,
Wakefield, MA 01880

FLOOR PLAN GENERAL NOTES:

1. T.O. SLAB @ FIRST FLOOR DATUM ELEVATION OF 100'-0" CORRESPONDS TO 103.00' MEAN SEA LEVEL, AS SHOWN ON SITE AND CIVIL DRAWINGS. ALL OTHER ELEVATION DATUM SHOWN IN THE ARCHITECTURAL SET IS RELATIVE TO 100'-0"

2. ALL MASONRY PARTITIONS SHALL BE 8" CMU (8.0 WALL TYPE) UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

3. ALL GWB INTERIOR PARTITIONS PROVIDE G6.0 WALL TYPE UNLESS OTHERWISE NOTED ON THE FLOOR PLANS.

4. FURNISH AND INSTALL MASONRY LINTELS BY MASON (TRADE-BID CONTRACTOR) AT ALL MASONRY OPENINGS UNLESS INDICATED OTHERWISE. REFER TO PLANS, ELEVATIONS, SECTIONS, DOOR SCHEDULES AND MECHANICAL (HVAC) DRAWINGS FOR INFORMATION. REFER TO MASONRY LINTEL SCHEDULE ON STRUCTURAL DRAWINGS FOR DETAILS AND INFORMATION.

5. FURNISH AND INSTALL SEISMIC RESTRAINTS BY METAL FABRICATIONS (TRADE-BID CONTRACTOR) AT ALL MASONRY PARTITIONS. REFER TO DETAILS ON STRUCTURAL DRAWINGS.

6. UNLESS NOTED OTHERWISE, PROVIDE PARTITION CONSTRUCTION ABOVE ALL OPENINGS TO MATCH PARTITION TYPE CONSTRUCTION ADJACENT TO OPENING.

7. REFER TO STRUCTURAL DRAWINGS FOR ALL CMU REINFORCING REQUIREMENTS.

8. PROVIDE 1" RADIUS BULL NOSE CMU TO THE UNDERSIDE OF THE CEILING AT ALL EXPOSED INTERIOR CORNER CONDITIONS, UNLESS NOTED OTHERWISE.

9. FOR CONTROL JOINT LOCATIONS AT INTERIOR MASONRY WALLS REFER TO SPECIFICATIONS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

10. FOR CONTROL JOINT LOCATION AT GWR PARTITIONS, SOFFITS AND CEILINGS REFER TO SPECIFICATIONS. AND/OR INTERIOR ELEVATIONS AND/OR REFLECTIVE CEILING PLANS. SUBMIT PROPOSED CONTROL JOINT LAYOUT TO THE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.

11. REFER TO CODE ANALYSIS CD 1-1, CD 1-2 FOR FIRE RATING REQUIREMENTS OF THE BUILDING COMPONENTS.

12. REFER TO STRUCTURAL DRAWINGS FOR NOTED DESCRIPTIONS OF THE SPRAY APPLIED FIREPROOFING EXTENTS AND INTUMESCENT MASTIC FIREPROOFING SCOPE REQUIRED AT THE STRUCTURAL STEEL COMPONENTS. SEE INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.

13. SEE FOODSERVICE AND EQUIPMENT DRAWINGS FOR ADDITIONAL INFORMATION.

14. PROVIDE 20 GAUGE METAL STRAPPING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE MARKERBOARDS, TACKBOARDS, ACOUSTICAL PANELS, AND MARKER WALLS OCCURRING ON METAL STUD WALLS.

15. PROVIDE 3/4" PLYWOOD BLOCKING (SIZES SHALL BE COORDINATED WITH TECHNOLOGY EQUIPMENT REQUIREMENTS) BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF THE WALL MOUNTED PROJECTORS, INTERACTIVE FLAT PANELS, DISPLAYS, AND TV MONITORS OCCURRING ON METAL STUD WALLS.

16. PROVIDE WOOD BLOCKING BEHIND GWB (CONCEALED FROM VIEW) AS REQUIRED FOR MOUNTING OF HANDRAILS, TOILET ACCESSORIES AND TOILETSHOWER PARTITIONS, AND DIVIDER CURTAIN TRACKS OCCURRING ON METAL STUD WALLS AND CEILINGS.


17. ALL DIMENSIONS AT METAL STUD PARTITIONS ARE TO THE FACE OF THE STUD UNLESS NOTED AS "CLEAR".

18. AT WALL LOCATIONS WHERE PARTITIONS WITH MULTIPLE LAYERS OF 5/8" GWB TRANSITION TO THE PARTITION WITH SINGLE LAYER OF 5/8" GWB, ALIGN THE FACES OF THE FINISH WALL SURFACES. STUD FRAMING LOCATIONS SHALL BE ADJUSTED ACCORDINGLY. REFER TO THE PLAN DRAWINGS FOR PARTITION TYPES DESIGNATIONS.

NOTE A: AT METAL STUD PARTITIONS WITHIN THE SPACE PROVIDE ABUSE RESISTANT GYPSUM BOARD (ARGB) TO 8'-0" A.F.F. REFER TO PARTITION TYPES FOR WALL CONSTRUCTION REQUIREMENTS.


MSBA 90% CD
SUBMISSION

May 12TH, 2023



PROJECT NORTH

MAGNETIC NORTH



MAINTENANCE
BUILDING
DRAWINGS

Scale: As indicated

Job No.: 20202

Drawn By: DRA

Date: May 12TH, 2023

Volume 3 of 4